
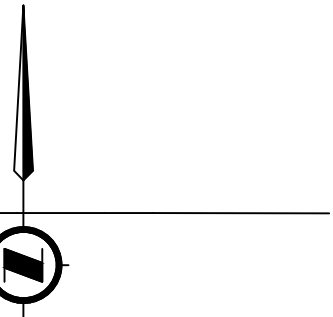


Plot Date: Jun 01, 2026 - 06:50:05am Plotted by: AragoA
E:\CS\Y\WCA-25014896-A0\Drawings\Production\WCA-25014896-A0_RTWL01.dwg XREFS: C:\Y\21\019763-90\LEGAL.dwg

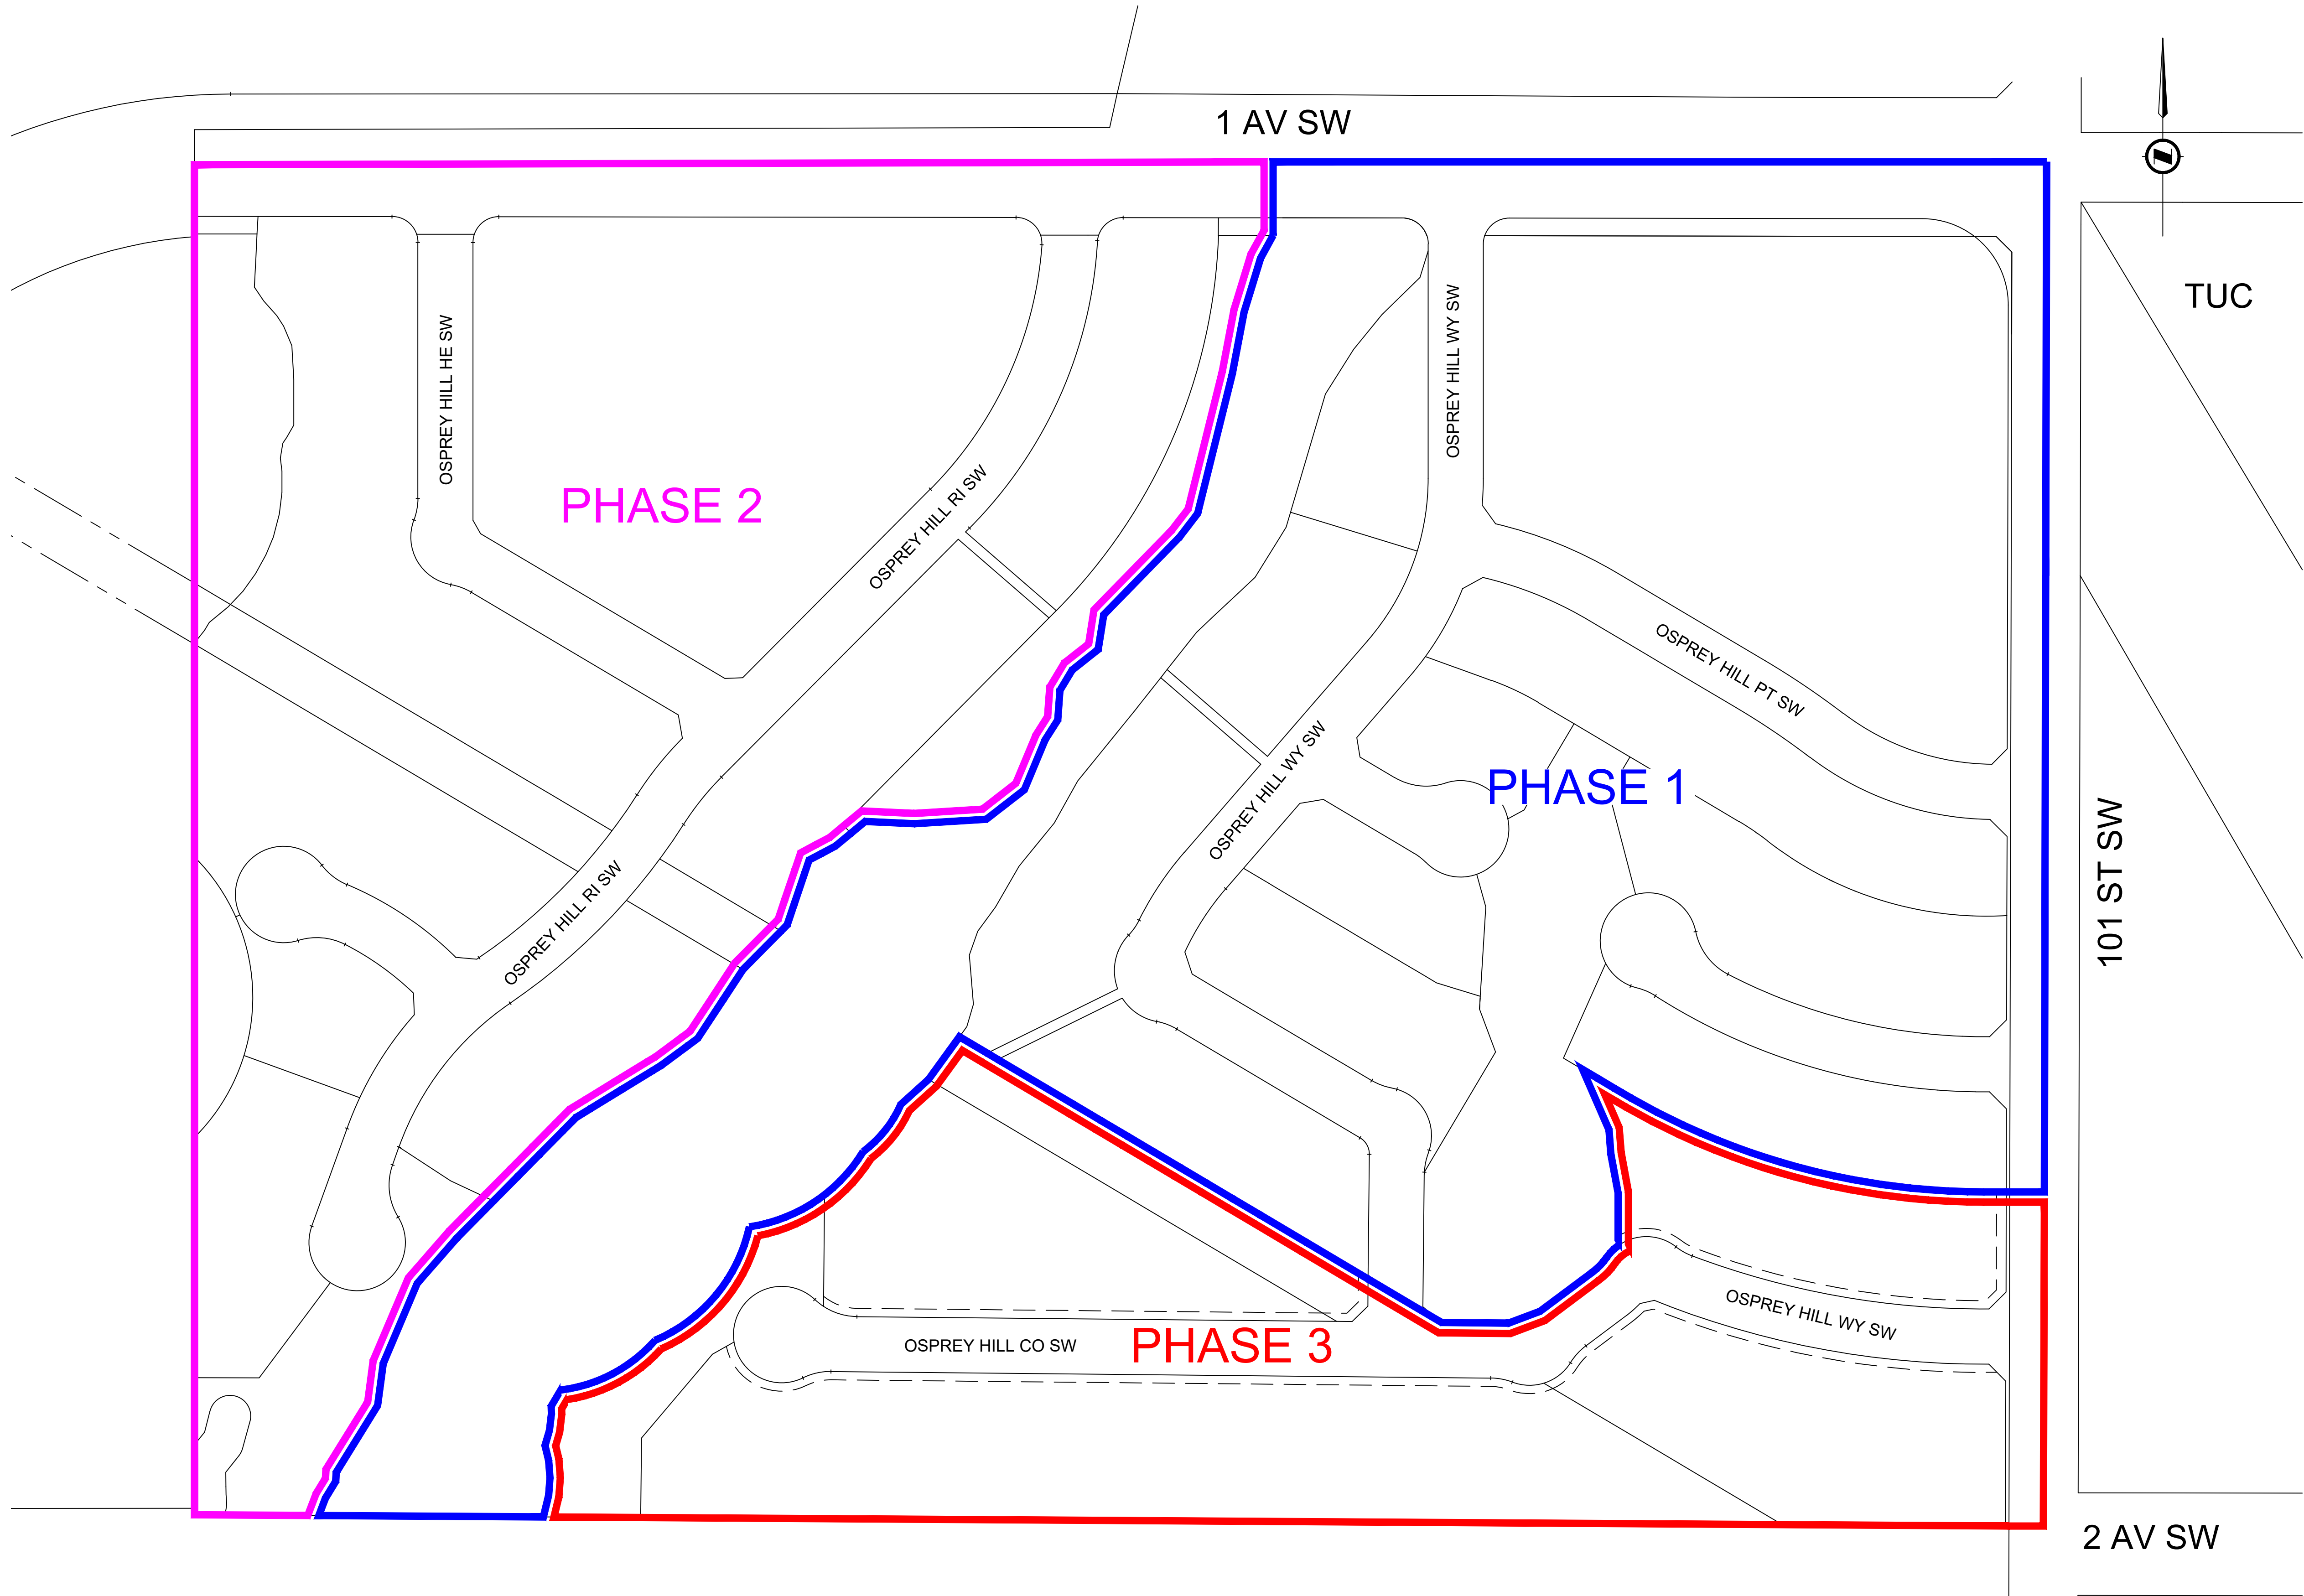

TUC

101 ST SW

2 AV SW

NOTES

1. THE CONTRACTOR SHALL VERIFY AND BE RESPONSIBLE FOR ALL DIMENSIONS. DO NOT SCALE THE DRAWING - ANY ERRORS AND/OR OMISSIONS SHALL BE REPORTED TO EXP SERVICES INC.
2. ALL PIPE SIZES ARE IN MILLIMETRES AND ALL DIMENSIONS ARE IN METRES UNLESS OTHERWISE NOTED.
3. ALL COORDINATES AND DISTANCES ARE BASED ON 3TM COORDINATE SYSTEM (NAD 83).

LEGEND

- APPROXIMATE PHASE 1 CONSTRUCTION BOUNDARY
- APPROXIMATE PHASE 2 CONSTRUCTION BOUNDARY
- APPROXIMATE PHASE 3 CONSTRUCTION BOUNDARY



NAD 83
COORDINATES

0	ISSUED FOR REVIEW	2026-04-10	RL	MT
NO.	DESCRIPTION	DATE (YYYY-MM-DD)	BY	APPD

PERMIT

PERMIT TO PRACTICE
EXP SERVICES INC.

RM SIGNATURE: *[Signature]*

RM APEGA ID #: 82288

DATE: 2026-06-03

PERMIT NUMBER: P005437
The Association of Professional Engineers and Geoscientists of Alberta (APEGA)

	BY	DATE (YYYY-MM-DD)
DESIGNED	RL	2026-02-02
DRAWN	DK	2026-02-09
CHECKED	MT	2026-03-06
SCALE	0 20 40 m	1:1000



PROJECT
**OSPREY HILL
PHASE 3**

SEC: 32 - TWP: 24 - RGE: 2 - W 5th M

SHEET TITLE
**RETAINING WALL
KEY PLAN**

FILE NO. WCA-25014896-A0_RTWL01.dwg		ENG DWG NO.	
SHEET ID. RTWL-01		SHEET NO. RTWL-01	
	BY	DATE (YYYY-MM-DD)	PROFILE NO.
DRAWN			

THE CONTRACTOR SHALL VERIFY AND BE RESPONSIBLE FOR ALL DIMENSIONS. DO NOT SCALE THE DRAWING - ANY ERRORS AND/OR OMISSIONS SHALL BE REPORTED TO EXP SERVICES INC.

COPYRIGHT RESERVED
THE COPYRIGHTS TO ALL DESIGNS AND DRAWINGS ARE THE PROPERTY OF EXP SERVICES INC.
REPRODUCTION OR USE FOR ANY PURPOSES OTHER THAN THAT AUTHORIZED BY EXP SERVICES INC. IS PROHIBITED.



Plot Date: Jun 01, 2026 - 07:19:47am Plotted by: AragoA
E:\CS\Y\WCA-25014896-A0_RTWL02-05.dwg XREFS: C:\21019753-30-LEGAL.dwg House Footprints Ph. 3.dwg ACAD-CGY-21019753-30-URW ARW ODRWS for Phase 2 and 3-Model.dwg CGY-21019753-30-Surface Base.dwg

1.0 GENERAL NOTES:

- 1.1 IN THESE NOTES, THE CLIENT IS OSPREY HILL LIMITED PARTNERSHIP.
- 1.2 IN THESE NOTES, THE CIVIL ENGINEER IS EXP SERVICES INC. (EXP).
- 1.3 IN THESE NOTES, THE GEOTECHNICAL ENGINEER IS EXP SERVICES INC. (EXP).
- 1.4 THESE NOTES ARE TO BE READ IN CONJUNCTION WITH THE DESIGN DRAWINGS.
- 1.5 THESE DRAWINGS AND NOTES ARE BASED ON THE INFORMATION OBTAINED FROM OSPREY HILL LIMITED PARTNERSHIP CORPORATION AVAILABLE TO EXP AT THE TIME OF THESE DRAWINGS PREPARATION. IT IS CONTRACTOR'S RESPONSIBILITY TO VERIFY ALL DIMENSIONS AND TO REPORT ANY DISCREPANCIES TO THE GEOTECHNICAL ENGINEER.
- 1.6 THE RETAINING WALL CONSTRUCTION SHALL BE GOVERNED BY WRITTEN DIMENSIONS, NOT SCALED DIMENSIONS.
- 1.7 THE CONTRACTOR SHALL CONFIRM THE LOCATION OF ALL SURROUNDING UNDERGROUND FACILITIES WHICH CAN BE DAMAGED BY THE PROPOSED INSTALLATION PRIOR TO EXCAVATION. IT IS THE CONTRACTOR'S RESPONSIBILITY TO PROVIDE ADVANCE NOTIFICATION TO THE GEOTECHNICAL ENGINEER OF ANY FACILITY THAT CAN BE DAMAGED BY THE PROPOSED CONSTRUCTION.
- 1.8 THE CONTRACTOR IS RESPONSIBLE FOR ACCURATE LAYOUT OF THE RETAINING WALL AS PER OWNER'S REQUIREMENTS PRIOR TO EXCAVATION. OVER-EXCAVATION MAY RESULT IN THE REQUIREMENT FOR ADDITIONAL BACKFILL. ADDITIONAL COSTS INCURRED DUE TO OVER-EXCAVATION MUST BE APPROVED IN WRITING BY THE GEOTECHNICAL ENGINEER AND/OR THE OWNER.
- 1.9 THE CONTRACTOR SHALL SCHEDULE, COORDINATE, AND CONDUCT THE WORK WITH THE OWNER OR THEIR REPRESENTATIVE IN ACCORDANCE WITH THE OWNER'S REQUIREMENTS.
- 1.10 THE CONTRACTOR SHALL CONDUCT THEIR OWN INSPECTIONS OF THE TEMPORARY CUT SLOPE AND RETAINING WALL CONSTRUCTION ON A DAILY BASIS AND IMMEDIATELY REPORT ANY IRREGULARITIES OR DETERIORATING SOIL AND GROUNDWATER CONDITIONS TO THE GEOTECHNICAL ENGINEER.
- 1.11 THE CONTRACTOR SHALL BUILD AND MAINTAIN PROPERLY SECURED HOARDING AROUND THE SITE FOR THE SAFETY OF SITE PERSONNEL AND THE PUBLIC IN THE SITE VICINITY.
- 1.12 THE CONTRACTOR SHALL BUILD AND MAINTAIN EROSION CONTROL MEASURES.
- 1.13 IT IS CONTRACTOR'S RESPONSIBILITY TO OBTAIN ANY NECESSARY PERMITS REQUIRED TO CARRY OUT THE PROPOSED CONSTRUCTION IN ACCORDANCE WITH CITY'S APPLICABLE REGULATIONS AND BY-LAWS.
- 1.14 THE GEOTECHNICAL ENGINEER IS TO HAVE ACCESS TO THE SITE WHENEVER REQUIRED AND IS THE SOLE JUDGE OF WHEN A TECHNICIAN, STAFF ENGINEER, OR SENIOR ENGINEER IS REQUIRED ON SITE.

2.0 MATERIALS:

2.1 MOISTURE BARRIER

IF SOIL EROSION OCCURS ON TEMPORARY AND PERMANENT CUT SLOPES, THE SLOPES SHALL BE COVERED BY 0.24 INCH (6 MIL) POLYETHYLENE SHEETING TO REDUCE FURTHER EROSION DURING WET WEATHER. THE POLYETHYLENE SHEETING SHALL BE TIGHTLY SECURED AT THE TOP, MID PORTION AND BOTTOM OF THE CUT SLOPES. WHEREVER POSSIBLE, CROSS-SLOPE JOINTS SHALL BE AVOIDED IN FAVOUR OF DOWNSLOPE JOINTS.WHERE CROSS-SLOPE JOINTS ARE UNAVOIDABLE, THE POLYETHYLENE SHEETING SHALL BE OVERLAPPED SUCH THAT THE UPHILL SHEET EXTENDS OVER THE DOWNHILL SHEET. ALL SHEET JOINTS SHALL OVERLAP BY A MINIMUM OF 0.6 m.

2.2 GEOTEXTILE

THE GEOTEXTILE FOR THE RETAINING WALL DRAINAGE SYSTEM SHALL CONSIST OF MIRAFI 160N FILTER FABRIC ON AN APPROVED SUBGRADE. THE CONTRACTOR SHALL SUBMIT SELECTED ALTERNATES TO THE GEOTECHNICAL ENGINEER FOR APPROVAL AT LEAST 2 WORKING DAYS PRIOR TO OF THE MATERIAL. THE CONTRACTOR SHALL SUBMIT ALL NECESSARY TEST INFORMATION AND RELATED DOCUMENTATION ON WHICH AN ADEQUATE REVIEW CAN BE CARRIED OUT BY EXP.

2.3 WALL FACING

AS PER STATED IN THE DRAWING SET, THE WALL FACING SHALL COMPRISE OF STONE FILLED GABION BASKET WITH WOVEN MESH CONSISTING OF GABION POLIMAC 80/489. ALTERNATE WALL FACINGS SHALL BE SUBMITTED TO THE GEOTECHNICAL ENGINEER FOR REVIEW AND APPROVAL AT LEAST 7 WORKING DAYS PRIOR TO THE ACQUISITION OF THE MATERIAL.

2.4 GABION BASKET STONE FILL

GABION BASKET STONE FILL SHOULD CONSIST OF DURABLE FRACTURED STONE WITH DIAMETERS BETWEEN 75mm AND 200mm AS FACING STONE AND DURABLE ROUND COBBLES WITH DIAMETERS OF 75mm TO 200mm ARE TO BE USED AS FILLER STONE.

2.5 BACKFILL

BACKFILL BEHIND CHIMNEY DRAIN TO CONSIST OF 80mm - CRUSHED SAND AND GRAVEL WITH <5% MATERIAL WEIGHT PASSING THE 0.075mm SIEVE SCREEN IN MAX 200mm LOOSE THICKNESS LIFTS, ADEQUATELY MOISTURE CONDITIONED AND COMPACTED TO 100% SPMDD (ASTM D698).

2.6 DRAINAGE

DRAINAGE FOR THE PROPOSED RETAINING WALLS SHALL BE PROVIDED BY A 150mm Ø RIGID PERFORATED PVC DRAIN PIPE SURROUNDED WITH 200mm OF 19mm CLEAR CRUSHED GRAVEL WRAPPED IN NON-WOVEN GEOTEXTILE SUCH AS MIRAFI 160N OR GEOTECHNICAL ENGINEER APPROVED EQUIVALENTS. THE PERFORATED PIPE SHALL EXTEND OVER THE FULL LENGTH OF THE WALL AND SHALL BE PLACED WITH A POSITIVE GRADIENT (NOT LESS THAN 1%), WHICH SHALL DISCHARGE TO DAYLIGHT AT APPROVED LOCATIONS AS DETERMINED IN THE FIELD PRIOR TO CONSTRUCTION. EXP IS NOT RESPONSIBLE FOR ANY PLUMBING SPECIFIC ASPECTS.

2.7 GEOGRID

MIRAGRID 22XT: POLYMERIC GRID FORMED BY REGULAR NETWORK OF INTEGRALLY CONNECTED TENSILE ELEMENTS WITH APERTURES OF SUFFICIENT SIZE TO ALLOW INTERLOCKING WITH SURROUNDING SOIL, ROCK, OR EARTH AND FUNCTION PRIMARILY AS REINFORCEMENT. ULTIMATE TENSILE STRENGTH FOR MIRAGRID 22XT OF 306.4 KN/m, MINIMUM AVERAGE ROLL VALUE, WHEN TESTED IN ACCORDANCE WITH ASTM D 6637. IF AN ALTERNATIVE GEOGRID IS REQUIRED, SUFFICIENT TEST INFORMATION AND RELATED DOCUMENTATION PERTAINING TO THE LONG - TERM PERFORMANCE AND STRENGTH OF THE GEOGRID SHALL BE SUBMITTED TO THE GEOTECHNICAL ENGINEER FOR REVIEW AND APPROVAL AT LEAST 5 WORKING DAYS PRIOR TO ACQUISITION OF THE MATERIAL.

3.0 CONSTRUCTION:

3.1 EXCAVATION SLOPES

- 3.1.1 TEMPORARY CUT SLOPES REQUIRED TO ACHIEVE THE DESIGN WALL SUBGRADE ELEVATIONS SHALL BE SLOPED NO STEEPER THAN 1H:1V WHERE APPROVED LOCALLY IN THE SITE SOILS. ANY SEEPAGE OBSERVED DURING CONSTRUCTION SHALL BE BROUGHT TO THE ATTENTION OF GEOTECHNICAL ENGINEER, WHICH MAY RESULT IN FLATTER TEMPORARY SLOPES.
- 3.1.2 TEMPORARY EXCAVATION SLOPE RECOMMENDATIONS SHALL BE CONFIRMED BY THE GEOTECHNICAL ENGINEER DURING CONSTRUCTION WHEN ACTUAL SUBSURFACE CONDITIONS ARE EXPOSED.
- 3.1.3 STEEPER TEMPORARY SLOPES MAY BE FEASIBLE OVER LIMITED WIDTH AND HEIGHT, OR BY THE USE OF TEMPORARY SHORING, WHICH SHALL BE ASSESSED BY THE GEOTECHNICAL ENGINEER WHEN ACTUAL SUBSURFACE CONDITIONS ARE EXPOSED DURING CONSTRUCTION. STEEPER TEMPORARY CUT SLOPES MUST BE APPROVED BY EXP IN WRITING PRIOR TO EXCAVATION. IF TEMPORARY SHORING IS REQUIRED, TEMPORARY SHORING DESIGN CAN BE PROVIDED BY EXP UPON REQUEST.
- 3.1.4 SURFACE WATER SHALL BE DIRECTED AWAY FROM TEMPORARY CUT AND FILL SLOPES OR DRAINED IN A CONTROLLED MANNER DOWN THE SLOPE TO LIMIT SLOPE EROSION. SURFACE WATER FLOWS MUST BE DRAINED TO A SUITABLE LOCATION IN ACCORDANCE WITH THE DESIGN AND AS APPROVED BY THE CIVIL ENGINEER AND ENVIRONMENTAL CONSULTANT TO MAINTAIN CLEAN OFF-SITE STORMWATER FLOWS.
- 3.1.5 THE GEOTECHNICAL ENGINEER SHALL PERIODICALLY REVIEW THE STABILITY OF THE EXISTING TEMPORARY SLOPE CUTS. THE GEOTECHNICAL ENGINEER SHALL BE ADVISED OF ANY SIGNS OF SLOPE INSTABILITY OR SEEPAGE OBSERVED DURING CONSTRUCTION, WHICH MAY RESULT IN FLATTER TEMPORARY SLOPE CUT.

3.2 SUBGRADE PREPARATION

THE PREPARED SUBGRADE FOR THE RETAINING WALL SHALL CONSIST OF INORGANIC UNDISTURBED SOILS APPROVED IN WRITING BY THE GEOTECHNICAL ENGINEER. THE SUBGRADE MUST BE APPROVED BY THE GEOTECHNICAL ENGINEER PRIOR TO PLACEMENT OF ANY FILL. ANY ORGANICS OR SOFT / LOOSE SOIL ZONES IDENTIFIED BY THE GEOTECHNICAL ENGINEER SHALL BE REMOVED AND REPLACED WITH STRUCTURAL FILL. THE GRADATION OF STRUCTURAL FILL SHALL BE IN ACCORDANCE WITH ITEM 2.5 OF THESE NOTES. THE SUBGRADE FILL SHALL BE COMPACTED TO MINIMUM OF 100 % SPMDD (ASTM D698) PRIOR TO REVIEW BY THE GEOTECHNICAL ENGINEER.

3.3 RETAINING WALL

- 3.3.1 GABION BASKET PLACEMENT SHALL BE STAGGERED BETWEEN ROWS.
- 3.3.2 THE REINFORCED FILL WITHIN THE MSE WALLS SHALL BE PLACED IN A MANNER WHICH WILL REDUCE THE POTENTIAL FOR DEVELOPING WAVES OR FOLDS IN THE GEOSYNTHETIC MATERIAL. IT IS RECOMMENDED THAT COMPACTION BEGINS CLOSE TO THE BACK FACE OF THE RETAINING WALL FACE AND PROCEED OUTWARDS, AWAY FROM THE WALL FACE. THE COMPACTION EQUIPMENT SHOULD RUN PARALLEL TO THE WALL FACE. MAXIMUM HAND OPERATED 1000lb COMPACTION EQUIPMENT SHOULD BE USED WITHIN 1m OF THE WALL FACE. EXTREME CAUTION SHALL BE TAKEN NOT TO GENERATE BULGING FROM WITHIN THE WALL FACE DURING COMPACTION. CONSEQUENTLY, THIN FILL LIFTS WITHIN 1m OF THE FORMS (TO ACHIEVE ADEQUATE COMPACTION) MAY BE REQUIRED.

THE CONTRACTOR SHALL VERIFY AND BE RESPONSIBLE FOR ALL DIMENSIONS. DO NOT SCALE THE DRAWING - ANY ERRORS AND/OR OMISSIONS SHALL BE REPORTED TO EXP SERVICES INC.

COPYRIGHT RESERVED

THE COPYRIGHTS TO ALL DESIGNS AND DRAWINGS ARE THE PROPERTY OF EXP SERVICES INC. REPRODUCTION OR USE FOR ANY PURPOSES OTHER THAN THAT AUTHORIZED BY EXP SERVICES INC. IS PROHIBITED.

NOTES



NAD 83
COORDINATES

PERMIT
**PERMIT TO PRACTICE
EXP SERVICES INC.**
RM SIGNATURE: *[Signature]*
RM APEGA ID #: 82288
DATE: 2026-06-03
PERMIT NUMBER: P005437
The Association of Professional Engineers and Geoscientists of Alberta (APEGA)



	BY	DATE
DESIGNED	RL	2026-02-02
DRAWN	DK	2026-02-09
CHECKED	MT	2026-03-06

SCALE



PROJECT
**OSPREY HILL
PHASE 3**

SEC: 32 - TWP: 24 - RGE: 2 - W 5th M

SHEET TITLE
**RETAINING WALL
NOTES**

FILE NO. WCA-25014896-A0_RTWL02-05.dwg	ENG DWG NO.
SHEET ID.	SHEET NO. RTWL-02
BY	DATE (YYYY-MM-DD)
DRAWN	PROFILE NO.

Plot Date: Jun 01, 2026 - 07:20:18am Plotted by: AragoA
E:\CSY\WCA-25014896-A0_RTWL02-05.dwg XREFS: CGY-21019753-30-LEGAL.dwg House Footprints Ph. 3.dwg ACAD-CGY-21019753-30-URW ARW ODRWS for Phase 2 and 3-Model.dwg CGY-21019753-30-Surface Base.dwg

3.4 GEOGRID PLACEMENT

- 3.4.1 GEOGRIDS SHALL BE INSTALLED AT THE LENGTHS, ELEVATIONS, AND LOCATIONS SHOWN ON THE DRAWINGS HEREIN. GEOGRID SHALL BE PLACED SO THAT THE PRINCIPAL STRENGTH AXIS IS ORIENTED PERPINDEUDCLAR TO THE WALL ALIGNMENT. THE TRANSVERSE BAR OF THE GEOGRID (ACROSS THE ROLL WIDTH) SHALL BE POSITIONED AT THE SLOPE FACE.
- 3.4.2 GEOGRID REINFORCEMENT SHALL BE CONTINUOUS THROUGHOUT THEIR EMBEDMENT LENGTH. GEOGRID-TO-GEOGRID CONNECTION IS NOT ALLOWED. THE ADJACENT STRIPS OF GEOGRID SHALL BE PLACED CONTINUOUSLY ALONG THE WALL ALIGNMENT.
- 3.4.3 THE GEOGRID SHALL BE TENSIONED BY HAND AND SECURED TO THE GROUND SURFACE BY DRIVING STAKES, STAPLES, OR HOOKS, ETC., THROUGH THE GRID APERTURES INTO THE GROUND SUCH THAT NO WAVES EXIST.
- 3.4.4 TRACKED CONSTRUCTION EQUIPMENT SHALL NOT BE OPERATED DIRECTLY ON THE GEOGRID REINFORCEMENT. A MINIMUM BACKFILL THICKNESS OF 150 mm IS REQUIRED FOR OPERATION OF TRACKED VEHICLES OVER THE GEOGRID REINFORCEMENT. TURNING OF TRACKED VEHICLES BE KEPT TO A MINIMUM TO PREVENT TRACKS FROM DISPLACING THE FILL AND/OR GEOGRID REINFORCEMENT. RUBBER-TIRED VEHICLES MAY PASS OVER THE GEOGRID REINFORCEMENT AT SPEEDS LESS THAN 5 KM/H. SUDDEN BRAKING AND SHARP TURNING SHALL BE AVOIDED.

4.0 CONSTRUCTION REVIEW:

- 4.1 SITE REVIEWS OF CONSTRUCTION, MATERIALS AND COMPACTION TESTING BY THE GEOTECHNICAL ENGINEER ARE ESSENTIAL TO VERIFY THAT THE RETAINING WALL SYSTEM PRESENTED IN THESE DRAWINGS IS CONSTRUCTED IN ACCORDANCE WITH THE SPECIFICATIONS DESCRIBED ABOVE. GEOTECHNICAL ENGINEER SHALL BE RETAINED TO CONDUCT FIELD REVIEW DURING EXCAVATION, SUBGRADE PREPARATION, DRAINAGE INSTALLATION, GABION BASKET RETAINING WALL CONSTRUCTION, PLACEMENT AND COMPACTION OF BACKFILL.

NOTES



NAD 83
COORDINATES

0	ISSUED FOR REVIEW		2026-04-10	RL MT
NO.	DESCRIPTION		DATE (YYYY-MM-DD)	BY APPD

PERMIT

PERMIT TO PRACTICE
EXP SERVICES INC.
RM SIGNATURE:
RM APEGA ID #: 82288
DATE: 2026-06-03
PERMIT NUMBER: P005437
The Association of Professional Engineers and Geoscientists of Alberta (APEGA)

	BY	DATE (YYYY-MM-DD)
DESIGNED	RL	2026-02-02
DRAWN	DK	2026-02-09
CHECKED	MT	2026-03-06

SCALE



PROJECT
OSPREY HILL
PHASE 3
SEC: 32 - TWP: 24 - RGE: 2 - W 5th M

SHEET TITLE
RETAINING WALL
NOTES

FILE NO.
WCA-25014896-A0_RTWL02-05.dwg

ENG DWG NO.

SHEET ID.

SHEET NO.
RTWL-03


	BY	DATE (YYYY-MM-DD)	PROFILE NO.
DRAWN			

THE CONTRACTOR SHALL VERIFY AND BE RESPONSIBLE FOR ALL DIMENSIONS. DO NOT SCALE THE DRAWING - ANY ERRORS AND/OR OMISSIONS SHALL BE REPORTED TO EXP SERVICES INC.

COPYRIGHT RESERVED
THE COPYRIGHTS TO ALL DESIGNS AND DRAWINGS ARE THE PROPERTY OF EXP SERVICES INC.
REPRODUCTION OR USE FOR ANY PURPOSES OTHER THAN THAT AUTHORIZED BY EXP SERVICES INC. IS PROHIBITED.

Plot Date: Jun 02, 2026 - 01:26:43pm Plotted by: AragoA
E:\CS\Y\WCA-25014896-A0_RTWL02-05.dwg XREFS: COY-21019753-30-LEGAL.dwg House Footprints PH 3.dwg ACAD-CGY-21019753-30-URW ARW ODRWS for Phase 2 and 3-Model.dwg CGY-21019753-30-Surface Base.dwg
Production\WCA-25014896-A0_RTWL02-05.dwg

COPYRIGHT RESERVED THE COPYRIGHTS TO ALL DESIGNS AND DRAWINGS ARE THE PROPERTY OF EXP SERVICES INC. REPRODUCTION OR USE FOR ANY PURPOSES OTHER THAN THAT AUTHORIZED BY EXP SERVICES INC. IS PROHIBITED.

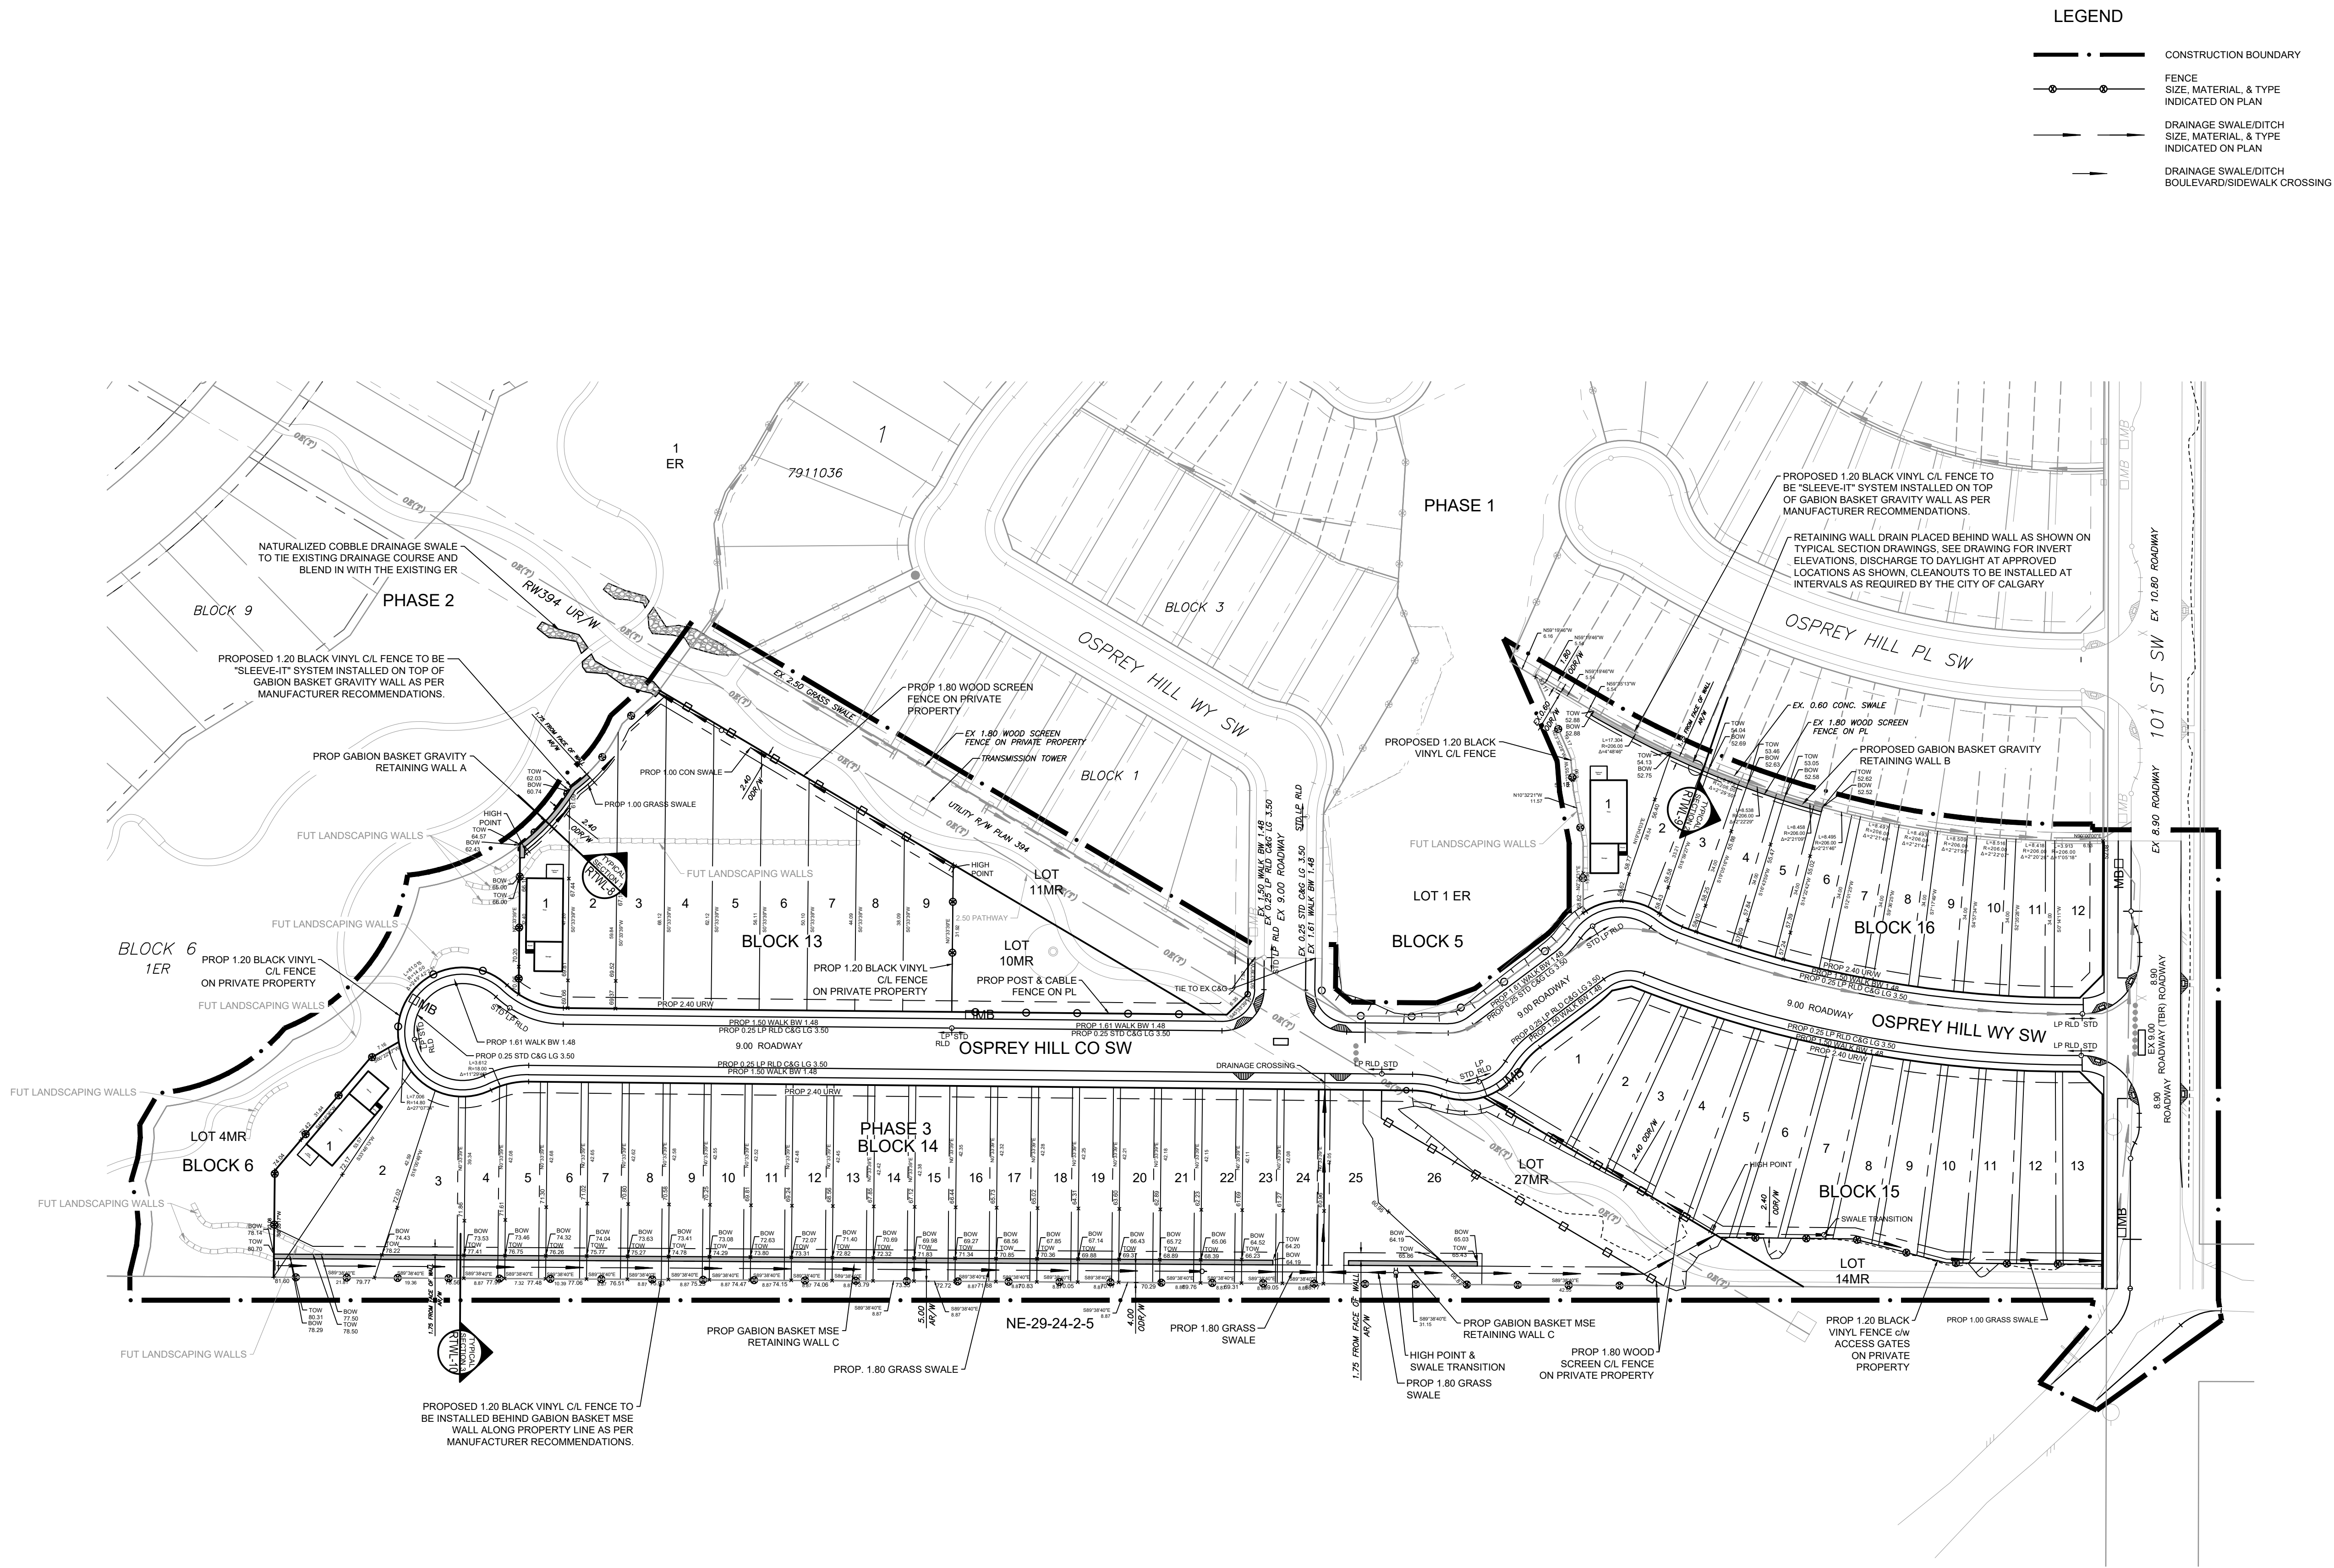

PROJECT NAME: OSPREY HILL PHASE 3
SITE AREA: 7.07 ha
MUNICIPAL ADDRESS: 221 101 STREET SW
LEGAL DESCRIPTION: BLOCK 1, PLAN 791 1036

THE CONTRACTOR SHALL VERIFY AND BE RESPONSIBLE FOR ALL DIMENSIONS. DO NOT SCALE THE DRAWING - ANY ERRORS AND/OR OMISSIONS SHALL BE REPORTED TO EXP SERVICES INC.

COPYRIGHT RESERVED
THE COPYRIGHTS TO ALL DESIGNS AND DRAWINGS ARE THE PROPERTY OF EXP SERVICES INC.
REPRODUCTION OR USE FOR ANY PURPOSES OTHER THAN THAT AUTHORIZED BY EXP SERVICES INC. IS PROHIBITED.

NOTES

1. THE CONTRACTOR SHALL VERIFY AND BE RESPONSIBLE FOR ALL DIMENSIONS. DO NOT SCALE THE DRAWING - ANY ERRORS AND/OR OMISSIONS SHALL BE REPORTED TO EXP SERVICES INC.
2. ALL PIPE SIZES ARE IN MILLIMETRES AND ALL DIMENSIONS ARE IN METRES UNLESS OTHERWISE NOTED.
3. ALL COORDINATES AND DISTANCES ARE BASED ON 3TM COORDINATE SYSTEM (NAD 83).



NAD 83
COORDINATES

0	ISSUED FOR REVIEW	2026-04-10	RL	MT
NO.	DESCRIPTION	DATE	BY	APPD

PERMIT	
PERMIT TO PRACTICE EXP SERVICES INC.	
RM SIGNATURE:	
RM APEGA ID #: 82288	
DATE: 2026-06-03	
PERMIT NUMBER: P005437 The Association of Professional Engineers and Geoscientists of Alberta (APEGA)	

DESIGNED	BY	DATE
DRAWN	RL	2026-02-02
CHECKED	DK	2026-02-09
SCALE	MT	2026-03-06
1:750 0 15 30 m		





PROJECT	OSPREY HILL PHASE 3
SEC: 32 - TWP: 24 - RGE: 2 - W 5th M	

SHEET TITLE		
RETAINING WALLS SITE PLAN		
FILE NO.	ENG DWG NO.	
WCA-25014896-A0_RTWL02-05.dwg		
SHEET ID.	SHEET NO.	
	RTWL-04	
BY	DATE	PROFILE NO.
	(YYYY-MM-DD)	
DRAWN		

ISC: SHEET SIZE ANSI D 25 mm 0

Plot Date: Jun 02, 2026 - 01:28:06pm Plotted by: AragoA
E:\CS\Y\WCA-25014896-A0_RTWL02-05.dwg XREFS: C:\21019753-30-LEGAL.dwg House Footprints Ph. 3.dwg ACAD-CGY-21019753-30-URW ARW ODRWS for Phase 2 and 3-Model.dwg CGY-21019753-30-Surface Base.dwg

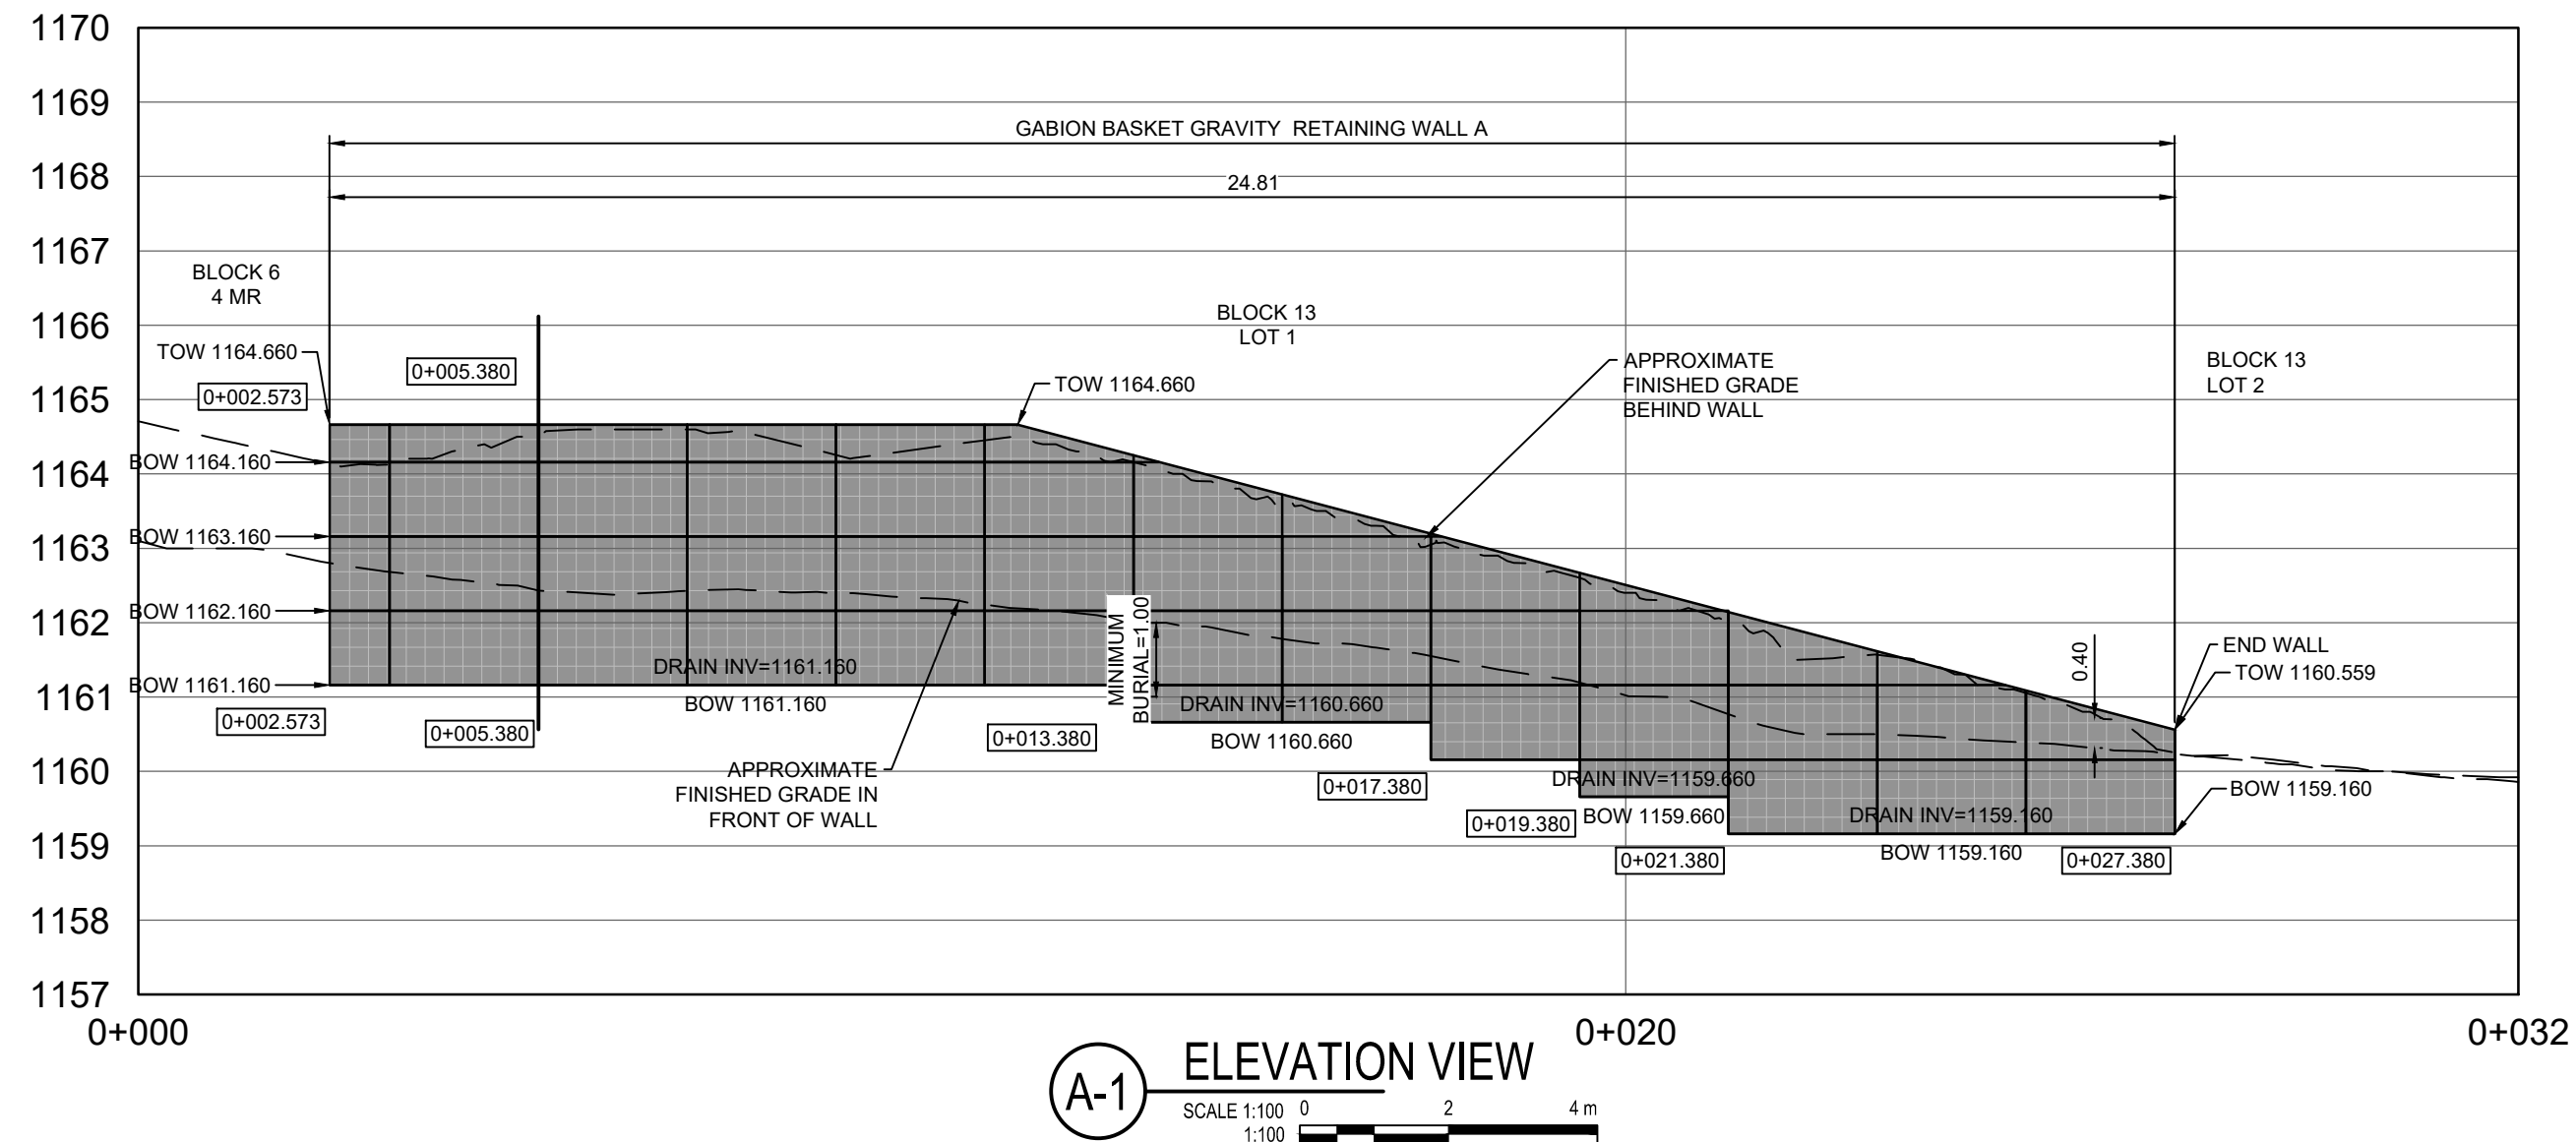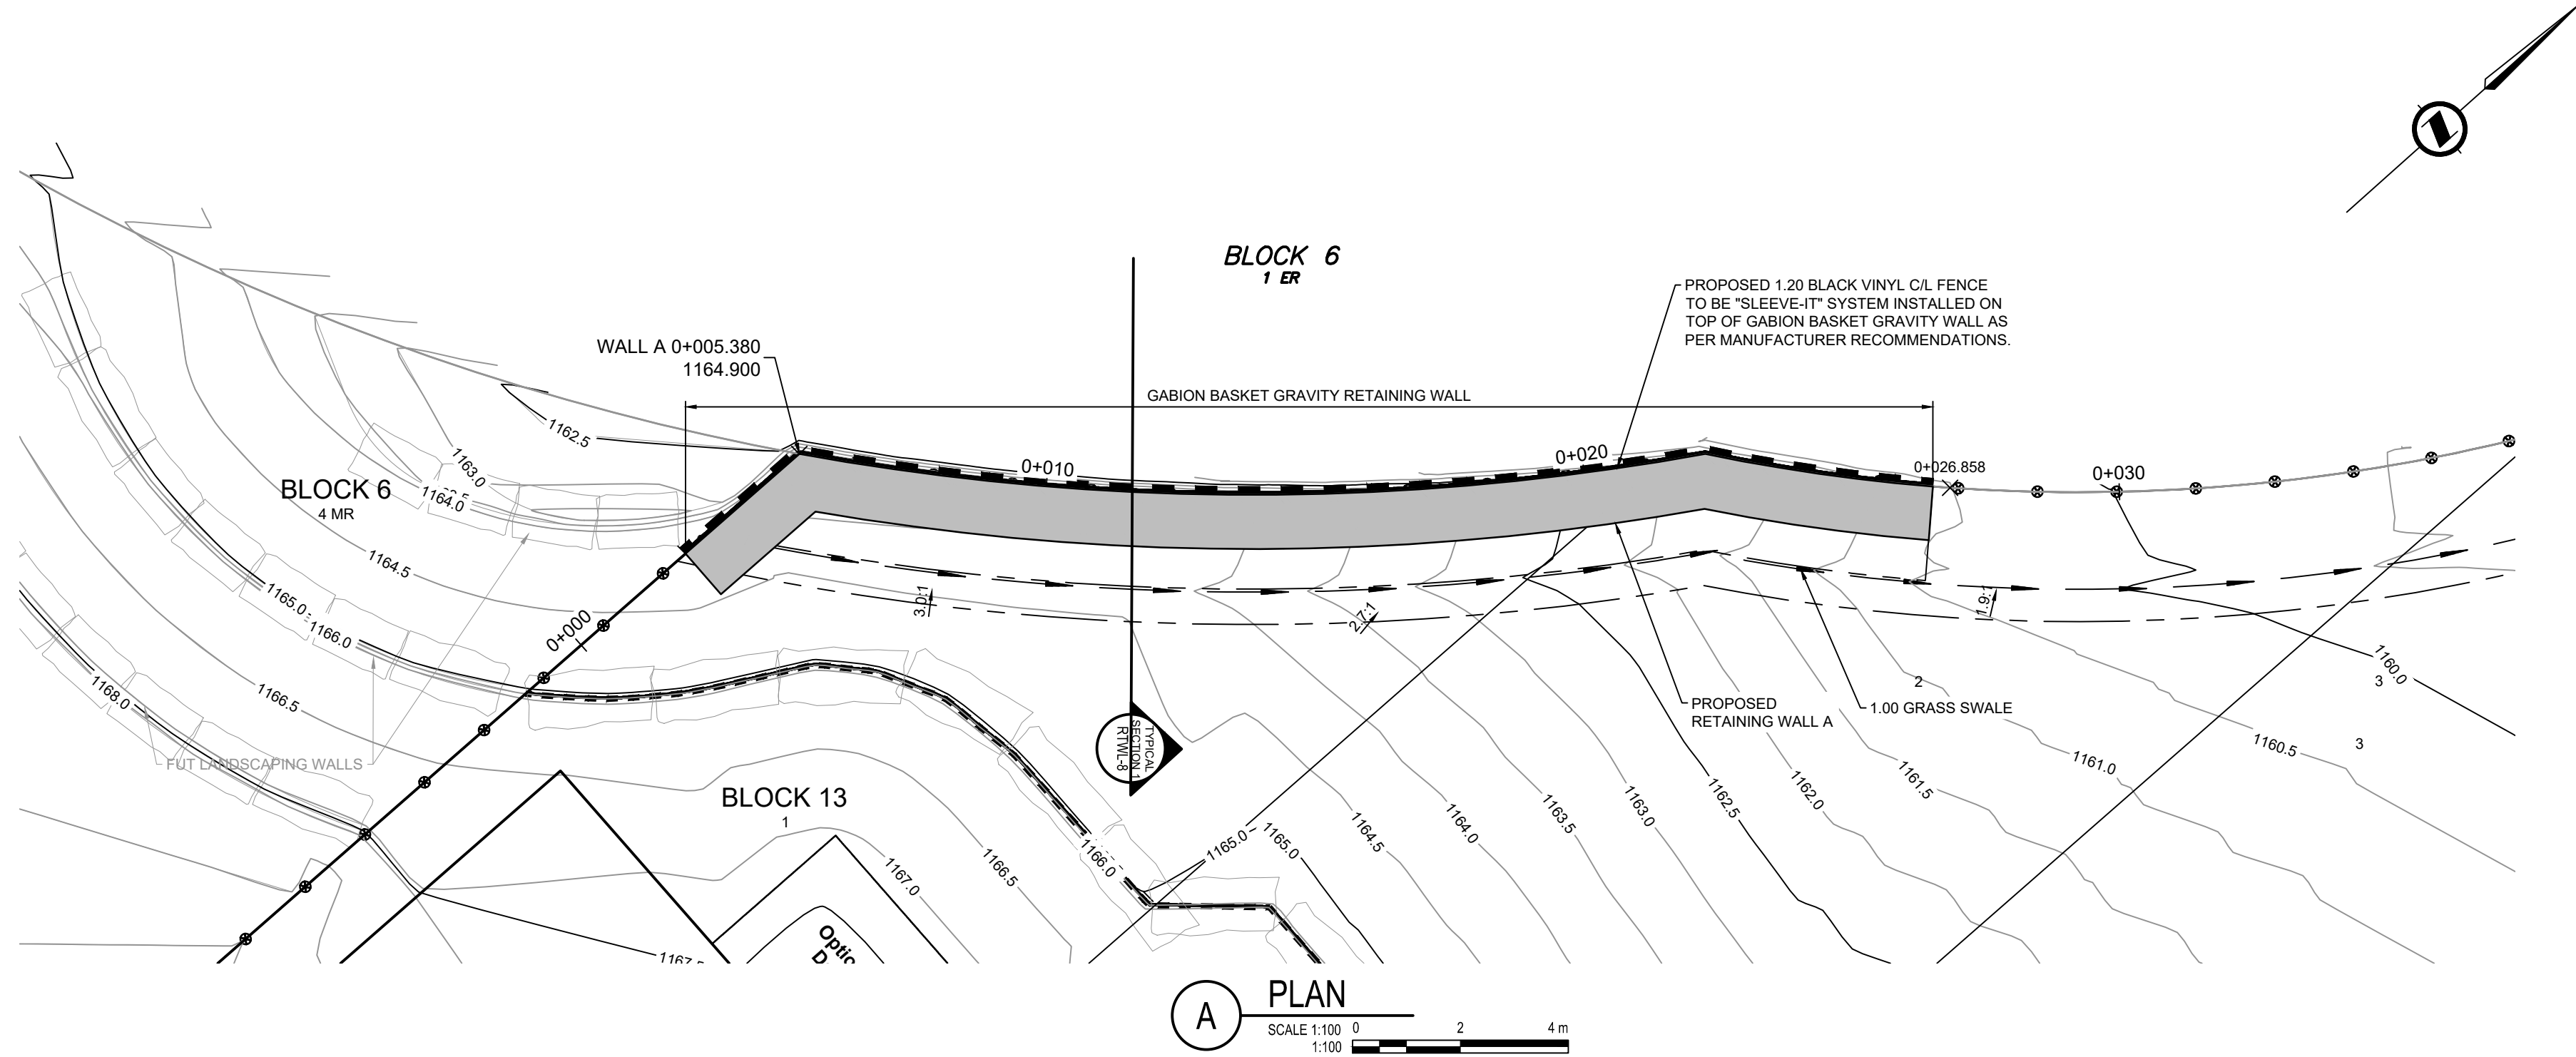

NOTES: LOCATION OF STEPS ARE APPROXIMATE
BASED ON PROVIDED DATA; ALL ELEVATIONS TO BE
CONFIRMED IN THE FIELD PRIOR TO CONSTRUCTION.

THE CONTRACTOR SHALL VERIFY AND BE RESPONSIBLE FOR ALL DIMENSIONS. DO NOT SCALE THE DRAWING - ANY ERRORS AND/OR OMISSIONS SHALL BE REPORTED TO EXP SERVICES INC.

COPYRIGHT RESERVED
THE COPYRIGHTS TO ALL DESIGNS AND DRAWINGS ARE THE PROPERTY OF EXP SERVICES INC.
REPRODUCTION OR USE FOR ANY PURPOSES OTHER THAN THAT AUTHORIZED BY EXP SERVICES INC. IS PROHIBITED.

NOTES

1. THE CONTRACTOR SHALL VERIFY AND BE RESPONSIBLE FOR ALL DIMENSIONS. DO NOT SCALE THE DRAWING - ANY ERRORS AND/OR OMISSIONS SHALL BE REPORTED TO EXP SERVICES INC.
2. ALL PIPE SIZES ARE IN MILLIMETRES AND ALL DIMENSIONS ARE IN METRES UNLESS OTHERWISE NOTED.
3. ALL COORDINATES AND DISTANCES ARE BASED ON 3TM COORDINATE SYSTEM (NAD 83).



NAD 83
COORDINATES

0	ISSUED FOR REVIEW	2026-04-10	RL	MT
NO.	DESCRIPTION	DATE (YYYY-MM-DD)	BY	APPD

PERMIT TO PRACTICE EXP SERVICES INC. RM SIGNATURE: <i>[Signature]</i> RM APEGA ID #: 82288 DATE: 2026-06-03 PERMIT NUMBER: P005437 The Association of Professional Engineers and Geoscientists of Alberta (APEGA)	
--	--

	BY	DATE (YYYY-MM-DD)
DESIGNED	RL	2026-02-02
DRAWN	DK	2026-02-09
CHECKED	MT	2026-03-06
SCALE	0 2 4 m 1:100	





PROJECT
**OSPREY HILL
PHASE 3**
SEC: 32 - TWP: 24 - RGE: 2 - W 5th M

SHEET TITLE VERTI-BLOCK MSE RETAINING WALL A PLAN & PROFILE	FILE NO. WCA-25014896-A0_RTWL02-05.dwg	ENG DWG NO.
SHEET ID.	SHEET NO. RTWL-05	
DRAWN	BY	DATE (YYYY-MM-DD)
		PROFILE NO.

ISC: SHEET SIZE ANSI D 25 mm 0

Plot Date: Jun 02, 2026 - 01:33:32pm Plotted by: AragoVA
E:\CS\WCA\25014896-A0\RTWL06-10.dwg XREFS: C:\21019763-30-Surface Base.dwg; C:\21019763-30-LEGAL.dwg; House Footprints Plt 3.dwg

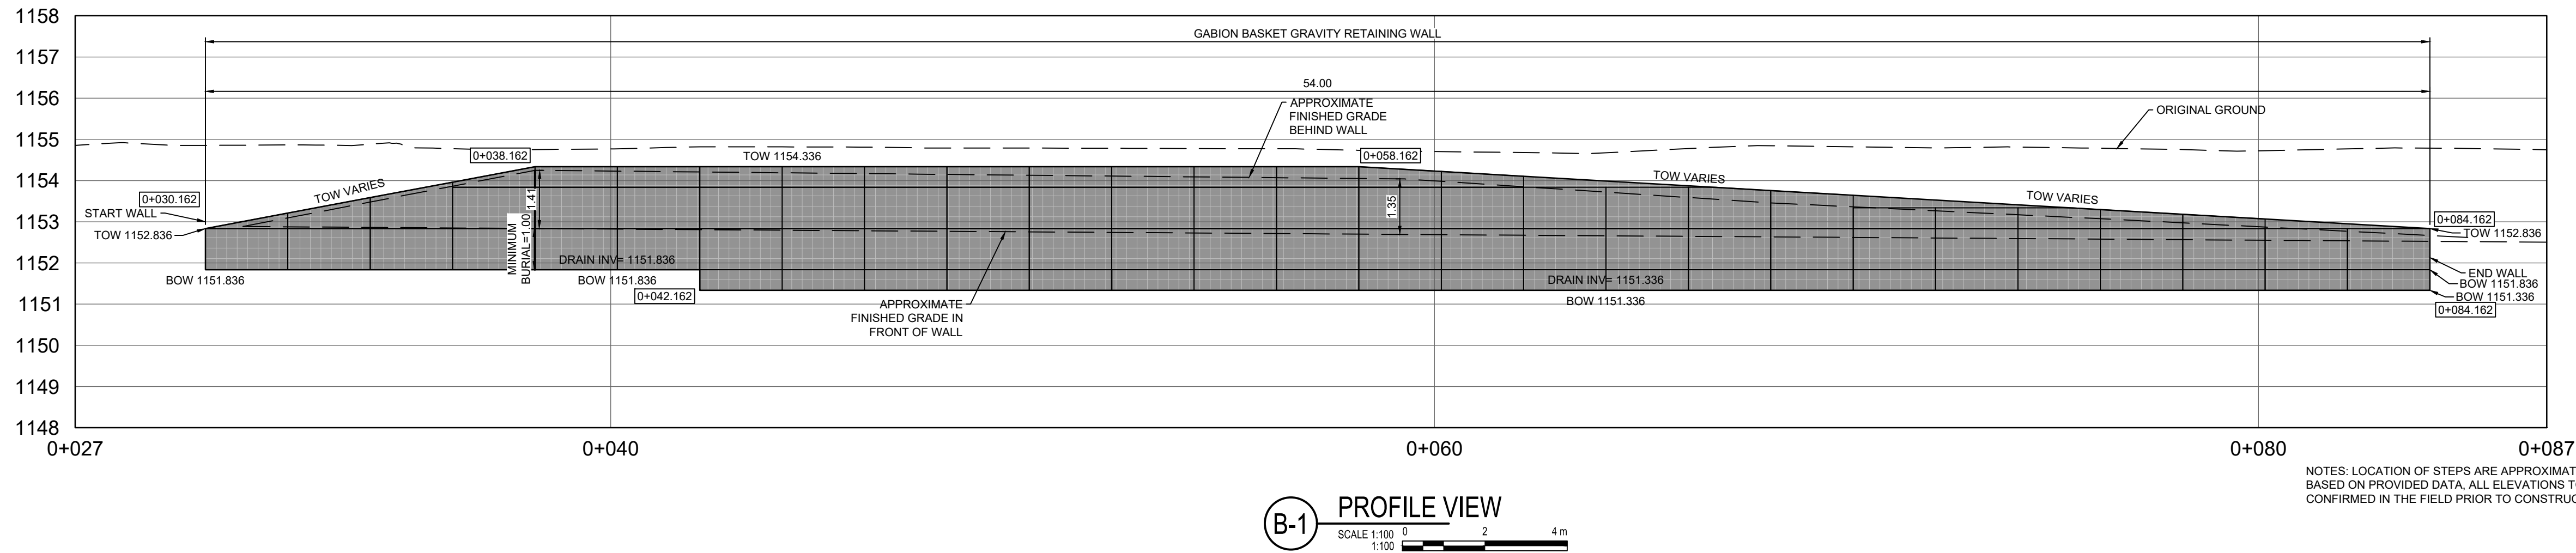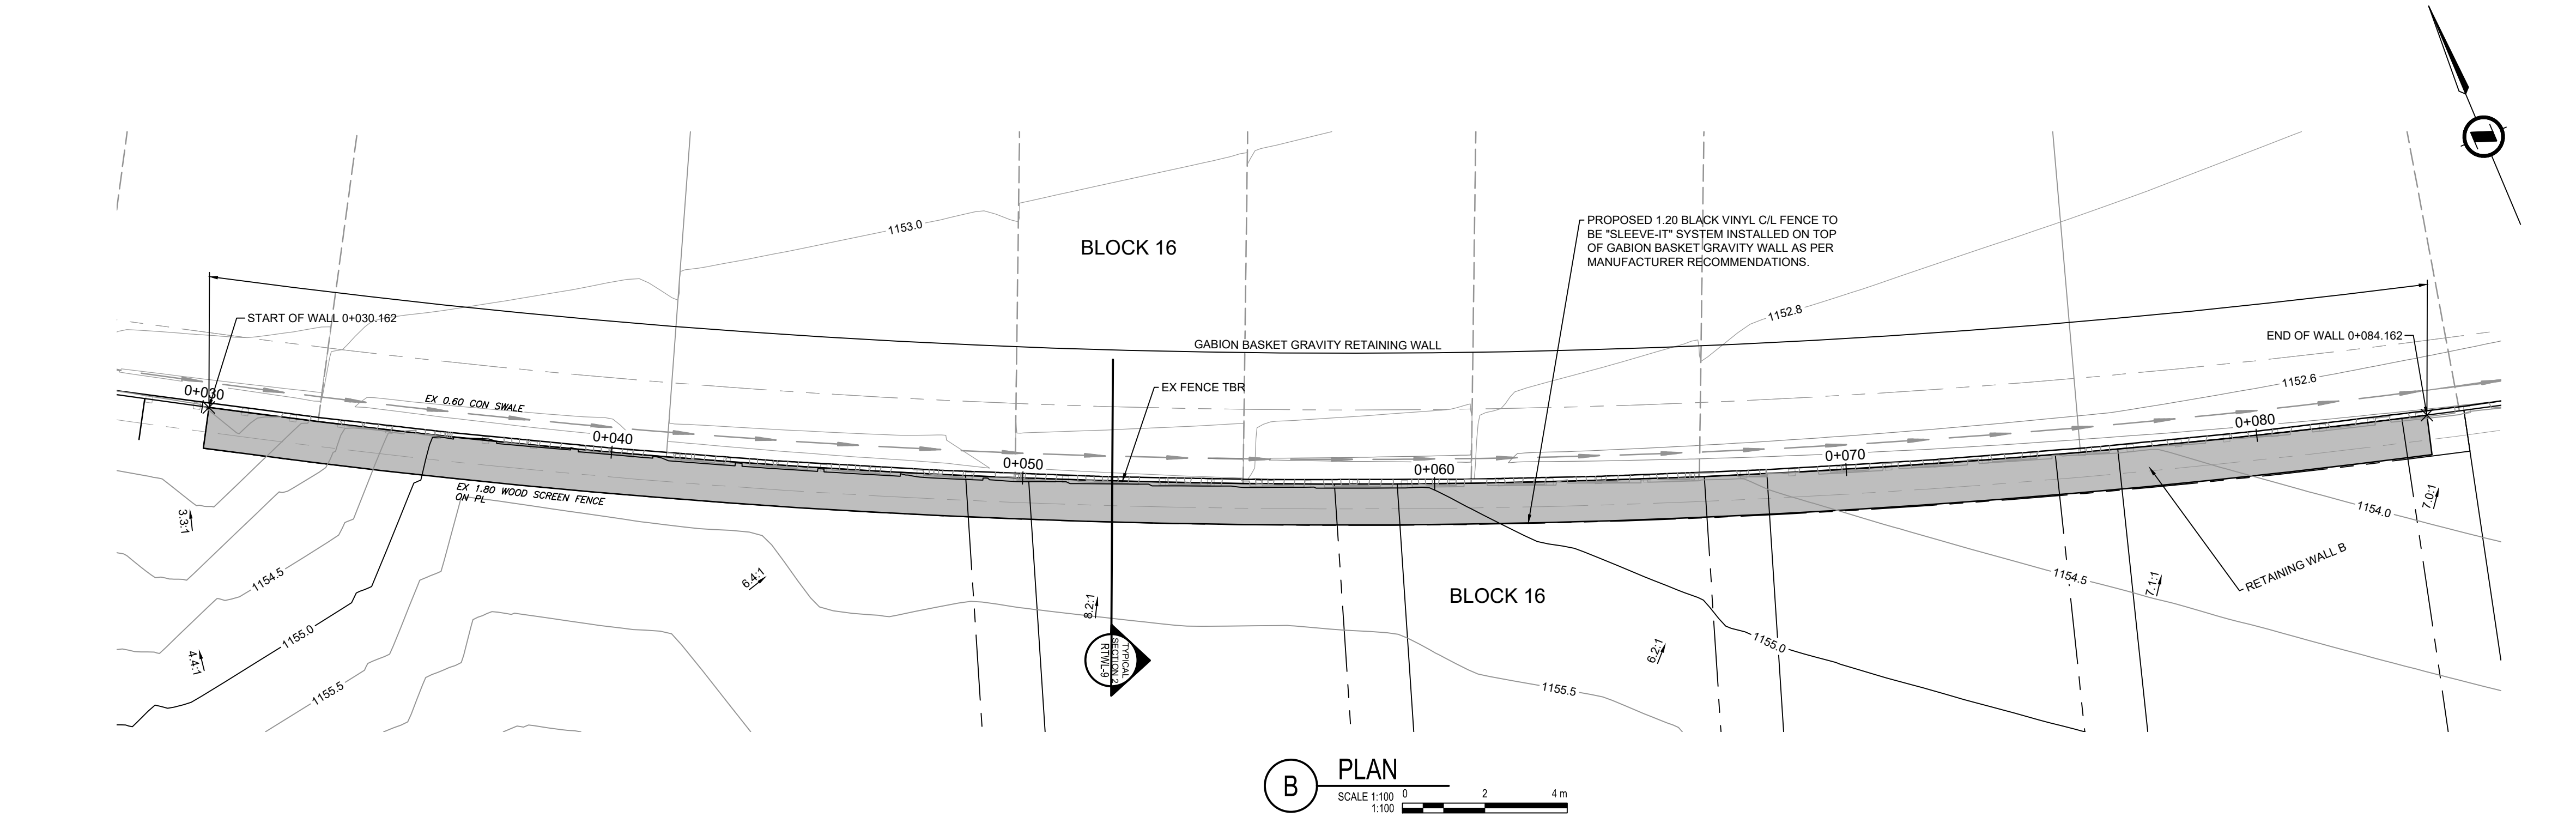

NOTES: LOCATION OF STEPS ARE APPROXIMATE
BASED ON PROVIDED DATA. ALL ELEVATIONS TO BE
CONFIRMED IN THE FIELD PRIOR TO CONSTRUCTION.

NOTES

1. THE CONTRACTOR SHALL VERIFY AND BE RESPONSIBLE FOR ALL DIMENSIONS. DO NOT SCALE THE DRAWING - ANY ERRORS AND/OR OMISSIONS SHALL BE REPORTED TO EXP SERVICES INC.
2. ALL PIPE SIZES ARE IN MILLIMETRES AND ALL DIMENSIONS ARE IN METRES UNLESS OTHERWISE NOTED.
3. ALL COORDINATES AND DISTANCES ARE BASED ON 3TM COORDINATE SYSTEM (NAD 83).



NAD 83
COORDINATES

0	ISSUED FOR REVIEW	2026-04-10	RL	MT
NO.	DESCRIPTION	DATE (YYYY-MM-DD)	BY	APPD

PERMIT TO PRACTICE EXP SERVICES INC. RM SIGNATURE: <i>[Signature]</i> RM APEGA ID #: 82288 DATE: 2026-06-03 PERMIT NUMBER: P005437 The Association of Professional Engineers and Geoscientists of Alberta (APEGA)	
--	--

	BY	DATE (YYYY-MM-DD)
DESIGNED	RL	2026-02-02
DRAWN	DK	2026-02-09
CHECKED	MT	2026-03-06
SCALE	1:100 0 2 4 m	




PROJECT	
OSPREY HILL PHASE 3	
SEC: 32 - TWP: 24 - RGE: 2 - W 5th M	
SHEET TITLE	
GABION BASKET RETAINING WALL B PLAN & PROFILE	
FILE NO. WCA-25014896-A0_RTWL06-10.dwg	ENG DWG NO.
SHEET ID. RTWL-6	SHEET NO. RTWL-6
BY	DATE (YYYY-MM-DD)
DRAWN	PROFILE NO.

THE CONTRACTOR SHALL VERIFY AND BE RESPONSIBLE FOR ALL DIMENSIONS. DO NOT SCALE THE DRAWING - ANY ERRORS AND/OR OMISSIONS SHALL BE REPORTED TO EXP SERVICES INC.

COPYRIGHT RESERVED
THE COPYRIGHTS TO ALL DESIGNS AND DRAWINGS ARE THE PROPERTY OF EXP SERVICES INC. REPRODUCTION OR USE FOR ANY PURPOSES OTHER THAN THAT AUTHORIZED BY EXP SERVICES INC. IS PROHIBITED.

Plot Date: Jun 02, 2026 - 01:36:28m Plotted by: ArgoA
E:\C:\V\WCA-25014896-A0 RTWL06-10.dwg XREFS: C:\V\21019753-30-Surface Base.dwg; C:\V\21019753-30-LEGAL.dwg; House Footprints PH 3.dwg
E:\C:\V\WCA-25014896-A0 RTWL06-10.dwg Execution: 06/02/2026 01:36:28m

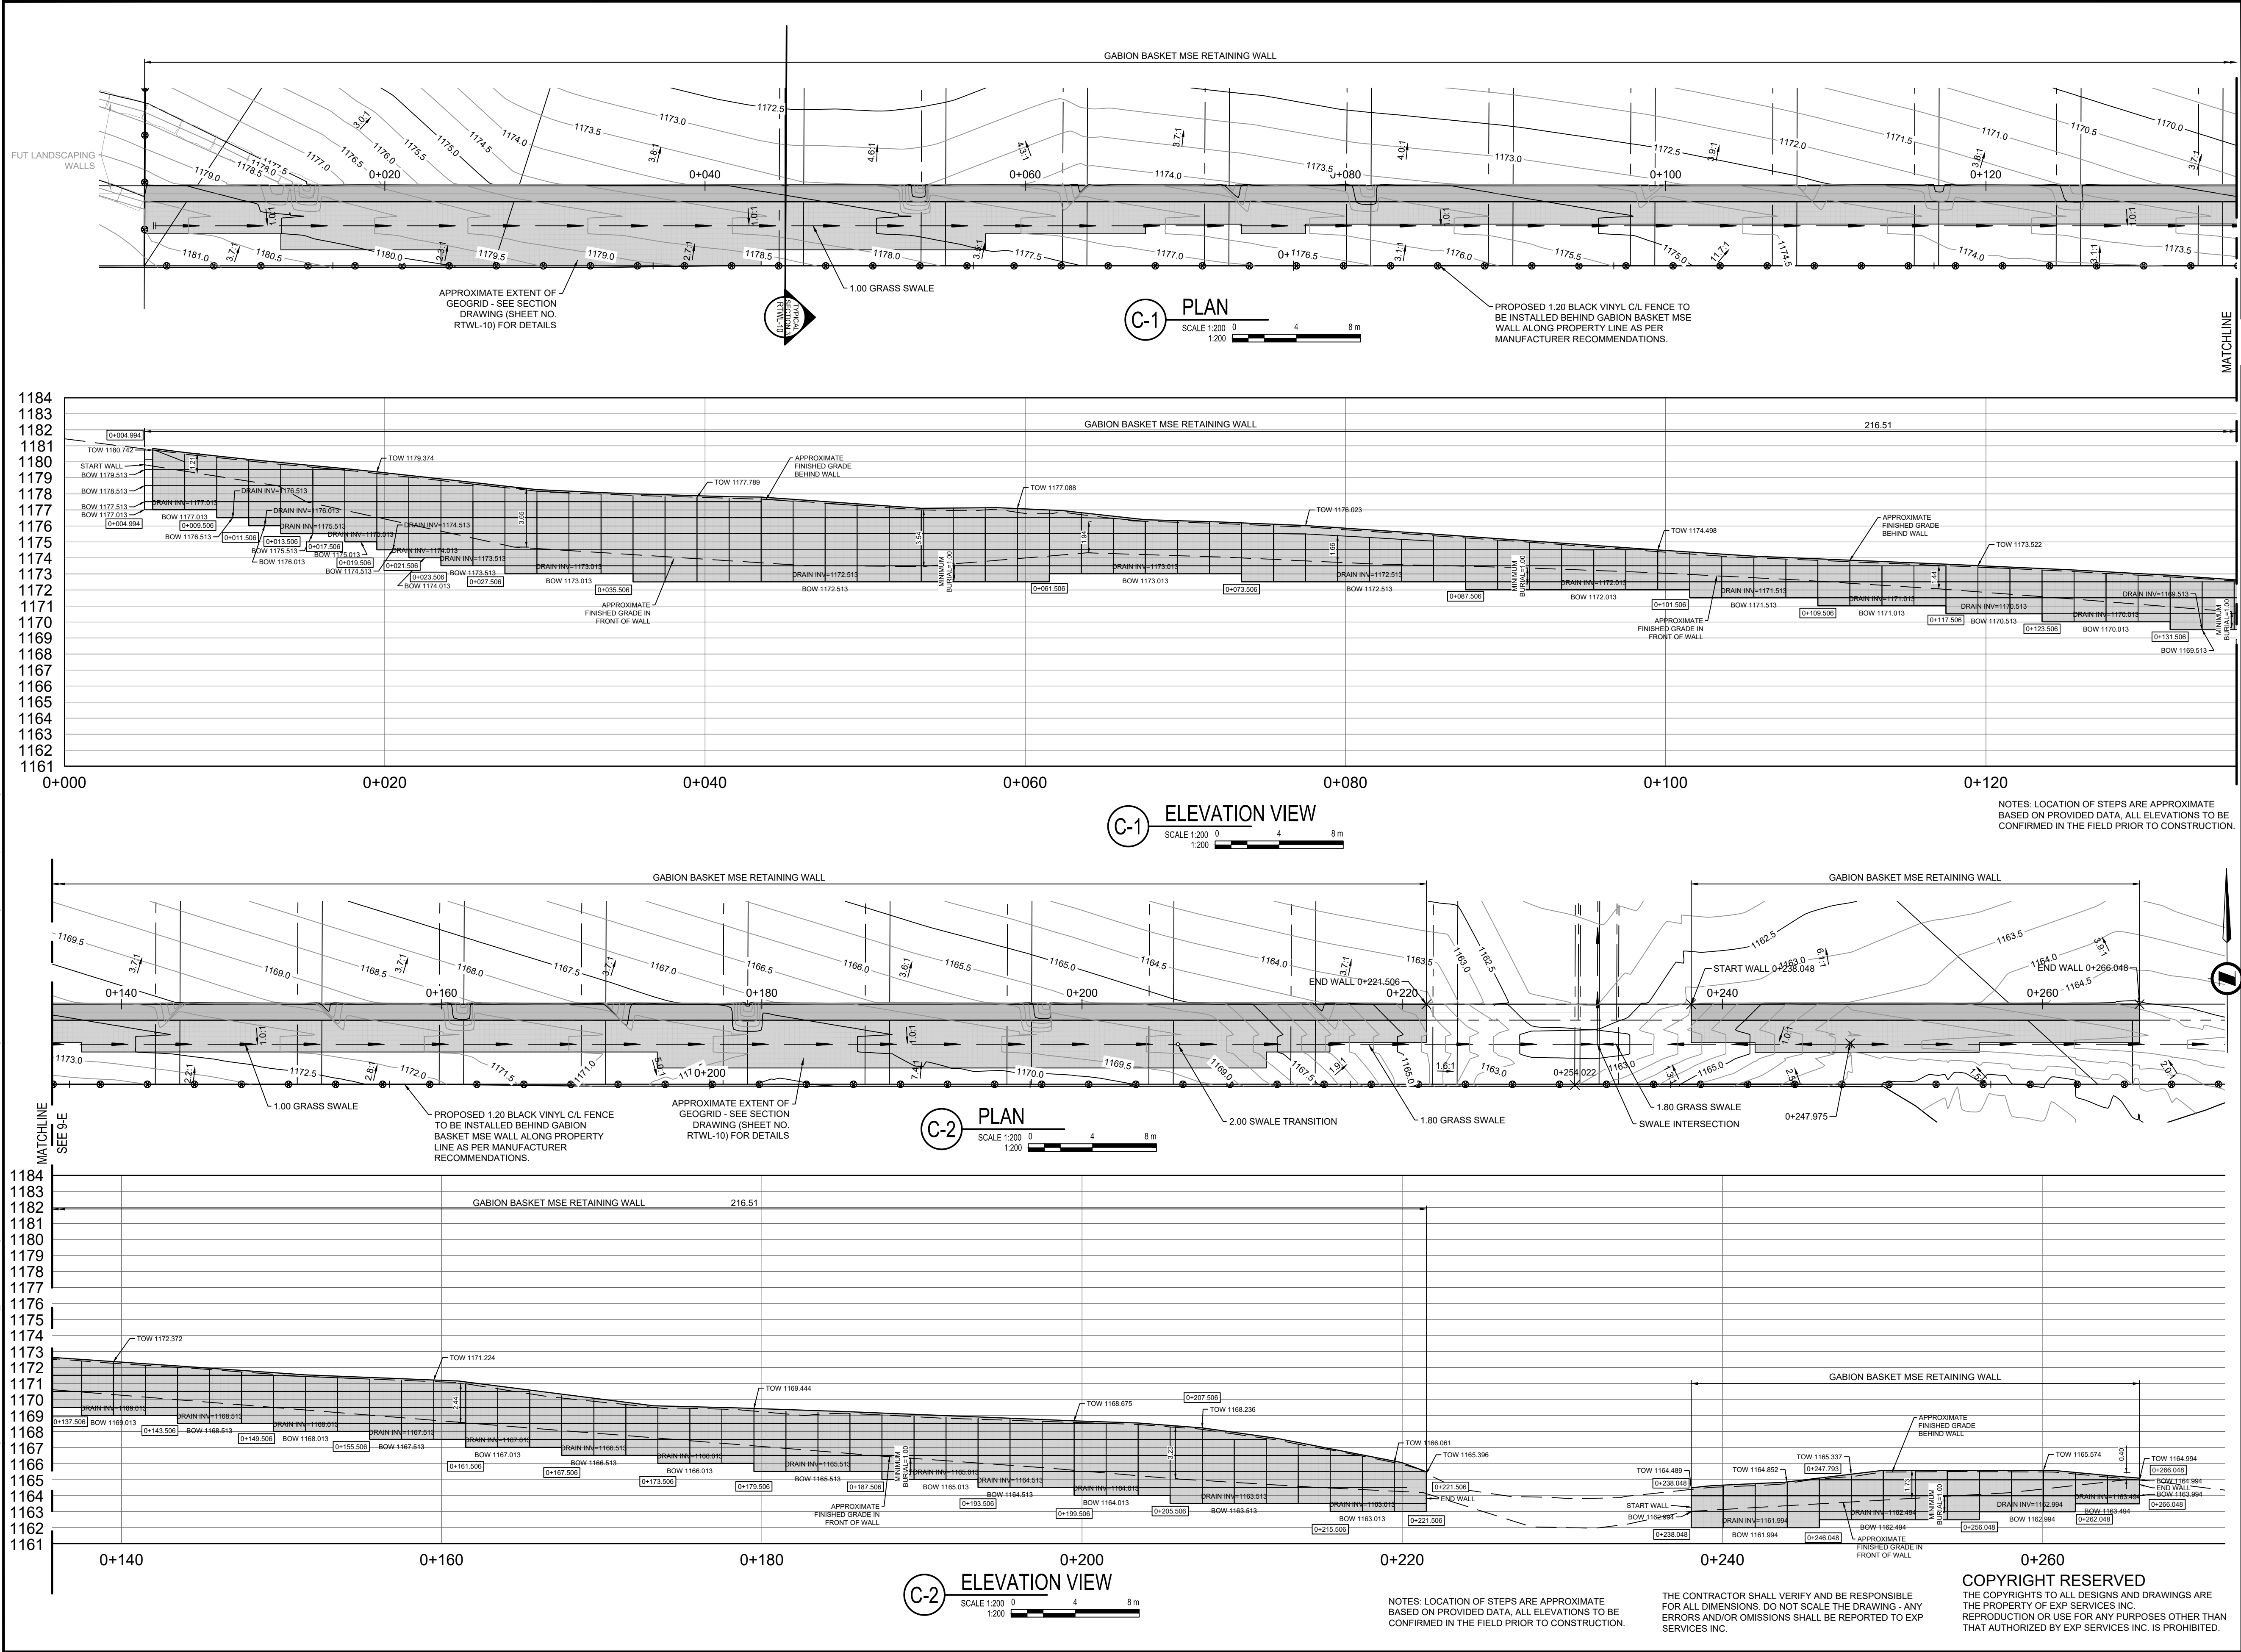

NOTES

1. THE CONTRACTOR SHALL VERIFY AND BE RESPONSIBLE FOR ALL DIMENSIONS. DO NOT SCALE THE DRAWING - ANY ERRORS AND/OR OMISSIONS SHALL BE REPORTED TO EXP SERVICES INC.
2. ALL PIPE SIZES ARE IN MILLIMETRES AND ALL DIMENSIONS ARE IN METRES UNLESS OTHERWISE NOTED.
3. ALL COORDINATES AND DISTANCES ARE BASED ON 3TM COORDINATE SYSTEM (NAD 83).

Click Before You Dig

NAD 83 COORDINATES

0	ISSUED FOR REVIEW	2026-04-10	RL	MT
NO.	DESCRIPTION	DATE	BY	APPD

PERMIT TO PRACTICE
EXP SERVICES INC.

RM SIGNATURE: *[Signature]*
RM APEGA ID #: 82288
DATE: 2026-06-03
PERMIT NUMBER: P005437
The Association of Professional Engineers and Geoscientists of Alberta (APEGA)

PROFESSIONAL ENGINEER
ALBERTA
MELODIE S. K. LANG
03 June 2026

DESIGNED	BY	DATE
DRAWN	DK	2026-02-09
CHECKED	MT	2026-03-06

SCALE 1:200 0 4 8 m

PROJECT
**OSPREY HILL
PHASE 3**

SEC: 32 - TWP: 24 - RGE: 2 - W 5th M

SHEET TITLE
**GABION BASKET
RETAINING WALL C
PLAN & PROFILE**

FILE NO. WCA-25014896-A0_RTWL06-10.dwg	ENG DWG NO.
SHEET ID. RTWL-7	SHEET NO. RTWL-7
DRAWN BY	DATE (YYYY-MM-DD)
PROFILE NO.	

ISC: SHEET SIZE ANSI D 25 mm