David Schaeffer Engineering Ltd.
120 Iber Road, Suite 103
Stittsville, ON K2S 1E9
613-836-0856
dsel.ca

SCOPED MASTER SERVICING STUDY

FOR

STITTSVILLE SOUTH URBAN EXPANSION AREA (W-4)

CAIVAN (STITTSVILLE SOUTH) INC. & CAIVAN (STITTSVILLE WEST) LTD.

CITY OF OTTAWA

PROJECT NO.: 21-1247

OCTOBER 2024
1ST SUBMISSION (REV.1)
© DSEL

EXECUTIVE SUMMARY

This scoped Master Servicing Study (***MSS***) review has been prepared in support of the Stittsville South Urban Expansion Area (W-4) (SSUEA) development on behalf of Caivan (Stittsville South) Inc. and Caivan (Stittsville West) Ltd. which will collectively be referred to as "Caivan".

The overall ***MSS*** study area encompasses approximately 80 ha of land and is bound by Flewellyn Road to the south, Shea Road to the east, an existing urban subdivision development to the north (Stittsville South – Area 6 ("Edenwylde")) and an estate lot subdivision (Woodside Acres) to the west. The SSUEA area includes Caivan's landholdings as well as an additional ~8.82 ha consisting of 5.68 ha residential holdout land parcels and 3.97 ha of Hydro One Networks Inc. (HONI) corridor west of the Faulkner Municipal Drain (FMD). The easternmost parcel of Caivan's lands, referred to henceforth as the Eder parcel, (6030 Fernbank Road, 14.24 ha) has been considered within this scoped ***MSS*** given the importance of its inclusion from an infrastructure servicing and development phasing perspective. The Eder parcel is proposed to be brought into the urban boundary through the planning process. The proposed development concept consists of detached single homes, townhomes, stacked townhomes, park blocks, stormwater management blocks, open space and road allowances. The development area is bisected by a Hydro One 500 kV utility corridor.

Following completion of the Terms of Reference, Existing Conditions Report, Public Open House and ongoing consultation with City staff, this ***MSS*** represents the next step in the planning process. The purpose of this ***MSS*** report is to recommend a feasible servicing strategy for the Stittsville South Urban Expansion Area (SSUEA), with respect to water, wastewater collection and stormwater management. Furthermore, this report includes an ***MSS*** level servicing design in support of a future draft plan application for the SSUEA Lands. The report also meets the requirements set out by the City of Ottawa's Serviceability Study Checklist.

The SSUEA is located within the Jock River Watershed and is subject to the regulations associated with the Rideau Valley Conservation Authority (RVCA). The ultimate storm outlet for the site is the Faulkner Drain at the southeast corner of the site, however, the channel extends from the existing subdivision to the North (at Friendly Crescent) via a storm sewer and concrete headwall structure and continues straight south to meet the existing drain at the Hydro corridor. The existing Faulkner Drain makes a 90-degree bend and flows on the north side of Flewellyn Road to Shea Road. Based on preliminary consultation with the City's Municipal Drain group, it is our opinion the subject site has legal and sufficient outlet in the Faulkner Municipal Drain (FMD). The City indicated that the scope of work would fall under Section 65 of the Drainage Act with updates to the change in land use and incorporation of new connections to the FMD. This process has been initiated with the City.

The stormwater analysis contained in this report indicates that the existing Davidson SWM facility, located within the SSUEA lands, can receive peak runoff from 4.13 ha of

© DSEL

SSUEA lands. Preliminary analysis has been completed to size the storm trunk sewers for the 1:5-year event (minor system) while accounting for flows in excess of the minor system by providing an overland flow route (major system). Several alternative SWM strategies were evaluated and the preferred option has minor and major system flows directed towards two new stormwater management facilities and the existing Davidson SWM facility for treatment. Trunk storm servicing would be provided by 875 to 1500 mm diameter pipe within the development's Public Right of ways.

The Shea Road Sanitary Pump Station (SRSPS) is expected to service the SSUEA, supplied from a network of gravity sewers. The Fernbank Trunk sewer has been extended within Fernbank Road which provides a gravity outlet to the SRSPS. Currently, significant residual capacity is available within the SRSPS and the Fernbank Road Trunk sewer. The wastewater servicing strategy is to direct all sanitary flows within the Study Area to the SRSPS located on the Davidson property. The existing SRSPS has a current firm capacity of 84 L/s, complete with backup power, emergency overflow and will outlet through dual 200mm forcemains to the Fernbank Trunk Sewer. It is anticipated that the existing SRSPS can accommodate the first phases of SSUEA development. Staged upgrades will be required to increase firm capacity to accommodate the full SSUEA development. Timing and details of these upgrades will be further evaluated as part of the Functional Servicing Report. Trunk wastewater collection will be provided by 200 to 375 mm diameter pipes within the SSUEA public right of ways and include an outlet to the proposed Sanitary Pump Station. The proposed pipe sizes and slopes are to meet the minimum requirements set out by the City of Ottawa Sewer Design Guidelines.

For potable water servicing, the study area is located at the northern boundary of the 3W pressure zone which is fed by the Glen Cairn and Campeau Drive Pump Stations and the Stittsville Elevated Tank. Line pressure is generally good and is suitable to service the entire study area. The proposed trunk watermain network was analysed to ensure that City of Ottawa guidelines were met. The potable water network is expected to provide the level of service required for the development of the SSUEA lands.

© DSEL

SCOPED MASTER SERVICING STUDY
FOR
STITTSVILLE SOUTH URBAN EXPANSION AREA (W-4)

CAIVAN (STITTSVILLE SOUTH) INC. & CAIVAN (STITTSVILLE WEST) LTD.

PROJECT NO: 21-1247

TABLE OF CONTENTS

1.0 INTRODUCTION 1
1.1 Study Area 1
1.2 Report Integration 4
1.3 Master Servicing Study Scope 6
1.4 Environmental Assessment Act 6
1.5 Development Plan 7

2.0 GUIDELINES, PREVIOUS STUDIES, AND REPORTS 8
2.1 Existing Studies, Guidelines, and Reports 8

3.0 EXISTING CONDITIONS AND SITE CONSTRAINTS 11
3.1 Land Ownership 11
3.2 Geotechnical Conditions 11
3.3 Hydrogeology 12
3.4 Drainage 14
3.5 Natural Environment Features 14
3.5.1 Natural Heritage System and Headwater Assessment 14
3.5.2 Limit of Development 16
3.6 Existing Land Use and Adjacent Land Uses 17
3.7 Opportunities and Constraints 17

4.0 NEED AND JUSTIFICATION FOR MUNICIPAL SERVICING 18
4.1 Vision & Goals for the SSUEA 18
4.2 Servicing Problem Statement 19

5.0 IDENTIFICATION AND EVALUATION OF ALTERNATIVE SERVICING SOLUTIONS 19

© DSEL

5.1 Water Distribution Alternatives 19
5.2 Wastewater Collection Alternatives 20
5.3 Stormwater Collection & Management Alternatives 20

6.0 ASSESSMENT OF ALTERNATIVE NEIGHBOURHOOD CONCEPT PLANS/SERVICING DESIGN CONCEPTS 22

6.1 Preliminary Land Use Plans 22
6.2 Assessment of Alternative Land Use Plans 23
6.3 Preferred Concept Plan and General Servicing Strategy 23
6.4 Phasing Strategy 24

7.0 WATER SUPPLY SERVICING PLAN 25

7.1 Existing Water Supply Services 25
7.2 Water Supply Servicing Design 25
7.2.1 Water Supply Servicing Alternatives 26
7.2.2 Water Servicing Plan Recommended Alternative 26
7.2.3 Water Supply Design Criteria 27
7.2.4 Fire Flow Demand 28
7.2.5 Boundary Conditions 29
7.3 Commitments for Functional and Detailed Design 30
7.4 Water Supply Conclusion 30

8.0 WASTEWATER SERVICING PLAN 32

8.1 Existing Wastewater Services 32
8.2 Wastewater Design Criteria 33
8.3 SSUEA Wastewater Servicing 34
8.3.1 SSUEA Wastewater Servicing Options 35
8.3.2 Preferred Wastewater Servicing Plan 36
8.3.2.1 West Lands Preferred Wastewater Servicing Plan 36
8.3.2.2 South Lands Preferred Wastewater Servicing Plan 36
8.3.3 Sanitary Flow Review 37
8.3.4 SRSPS Anticipated Upgrades 37
8.3.5 Consideration of Alternatives for Sanitary Servicing Design 38
8.4 Commitments for Functional and Detailed Design 38
8.5 Wastewater Servicing Conclusion 39

9.0 STORMWATER CONVEYANCE 41

© DSEL

9.1 Existing Stormwater Drainage 41
9.1.1 Faulkner Municipal Drain 41
9.2 SSUEA Stormwater Management Ponds and Servicing Options 43
9.2.1 Option 1A: Two New SWM Ponds (East Pond on Eder Parcel) 43
9.2.2 Option 1B: Two New SWM Ponds (East Pond on Davidson Parcel) 44
9.2.3 Option 2A: One SWM Pond and Relocation of Existing Drain (Perimeter Channel) 45
9.2.4 Option 2B One SWM Pond and Relocation of Existing Drain (Central) 47
9.2.5 Option 3: Two SWM Ponds and Decommissioning of Davidson Pond 49
9.2.6 Cost Comparison 50
9.2.7 Preferred SWM Pond Alternative 51
9.2.7.1 South Lands 51
9.2.7.2 West Lands 52
9.3 Post-Development Stormwater Management Targets 52
9.3.1 Quality Control 53
9.3.2 Quantity Control 53
9.4 Stormwater Management Design 53
9.4.1 Proposed Minor System 53
9.4.2 Proposed Major System 56
9.5 Proposed Grading 57
9.6 Low Impact Development (LID) - Infiltration 57
9.7 Commitments for Functional and Detailed Design 58
9.8 Stormwater Servicing Conclusions 59
10.0 EROSION AND SEDIMENT CONTROL 60
11.0 CONCLUSIONS AND RECOMMEDATIONS 61

LIST OF IN-TEXT EXHIBITS

Exhibit 1 Stittsville South Urban Expansion Area – Location Plan
Exhibit 2 Option 1A: Two New SWM Ponds (East Pond on Eder Parcel)
Exhibit 3 Option 1B: Two New SWM Ponds (East Pond on Davidson Parcel)
Exhibit 4 Option 2A: One SWM Pond and Relocate Drain (Perimeter Channel)
Exhibit 5 Option 2B One SWM Pond and Relocate Drain (Central Channel)
Exhibit 6 Option 3: Two SWM Ponds and Decommissioning of Davidson Pond

© DSEL

LIST OF IN-TEXT TABLES

Table 1: Summary of SSUEA Studies/Reports 5
Table 2: Development Statistics Projection 7
Table 3: HDFA Summary 15
Table 4: Water Supply Design Criteria 27
Table 5: Summary of Minimum Available Fire Flows (GeoAdvice, 2023) 29
Table 6: Sanitary Flow Review 32
Table 7: Wastewater Design Criteria 33
Table 8: Summary of Estimated SWM Costs 50
Table 9: Storm Sewer Design Criteria 54

FIGURES

Figure 1 NAK SSUEA Concept Plan
Figure 2 Water Distribution System Facilities
Figure 3 SWM Options – Servicing Comparison

DRAWINGS

Drawing 1 Conceptual Grading Plan
Drawing 2 Conceptual Servicing Plan
Drawing 3 Conceptual Storm Servicing Plan
Drawing 4 Conceptual Sanitary Servicing Plan
Drawing 5 Conceptual Watermain Servicing Plan

© DSEL

APPENDICES

Appendix A	• A.1 Terms of Reference (DSEL, June 2022) • A.2 Class Environmental Assessment Requirements Overview Memo (Morrison Hershfield, October 2023) • A.3 Existing Conditions Report – Servicing (DSEL, September 2023)
Appendix B	• B.1 Bedrock Contour Plan – Proposed Residential Development 5993, 60701 & 6115 Flewellyn Road (Paterson, Drawing PF5570-2, 01/2022)
Appendix C	• C.1 Hydraulic Capacity and Modeling Analysis SSUEA Development – Final Report (GeoAdvice Engineering Inc., August 2024) • C.2 Design Criteria Correspondence with City Staff • C.3 Updated Boundary Conditions Request to City • C.4 City Boundary Conditions (March 2023)
Appendix D	• D.1 ECA 3415-ADQLJG – Shea Road Sanitary Pump Station (September 2016) • D.2 Stittsville South – Area 6 MSR Excerpt • D.3 Fernbank Lands MSS – Sanitary Design Sheet • D.4 Sanitary Trunk Sewer Design Sheet (DSEL, 2024) • D.5 SRSPS – Site Servicing and Grading (Sanitary Overflow Elevation) • D.6 Shea Road Pump Station & Fernbank Trunk Capacity Review (Novatech, May 2023) • D.7 Excerpt from City of Ottawa Infrastructure Master Plan, Draft Final (July 2024)
Appendix E	• E.1 Conceptual SWM Ponds and Preliminary HGL Analysis (JFSA, November 2023) • E.2 Storm Trunk Sewer Design Sheet (DSEL, 2024)

© DSEL

SCOPED MASTER SERVICING STUDY
FOR
STITTSVILLE SOUTH URBAN EXPANSION AREA (W-4)

CAIVAN (STITTSVILLE SOUTH) INC. & CAIVAN (STITTSVILLE WEST) LTD.

CITY OF OTTAWA
PROJECT NO: 21-1247

1.0 INTRODUCTION

David Schaeffer Engineering Limited (DSEL) has been retained to prepare a scoped Master Servicing Study (***MSS***) review in support of the Stittsville South Urban Expansion Area (W-4) (***SSUEA***) development on behalf of Caivan (Stittsville South) Inc. and Caivan (Stittsville West) Ltd. which will collectively be referred to as ("Caivan"). The ***MSS*** supports the Official Plan Amendment for the removal of the Future Neighborhood Overlay on Schedule C17 of the City of Ottawa Official Plan and for the inclusion of the Southeast parcel within the Urban Boundary. The scoped MSS also provides guidance and direction for the Draft Plan of Subdivision and Zoning applications for the subject lands.

1.1 Study Area

The overall scoped ***MSS*** study area encompasses approximately 80 ha of land and is bound by Flewellyn Road to the south, Shea Road to the east, an existing urban subdivision development to the north (Stittsville South – Area 6 ("Edenwylde")) and an estate lot subdivision (Woodside Acres) to the west. The SSUEA area includes Caivan's landholdings as well as an additional ~8.82 ha consisting of 5.68ha residential holdout land parcels and 3.97 ha of Hydro One Networks Inc. (HONI) corridor west of the Faulkner Municipal Drain (FMD). The easternmost parcel of Caivan's lands, referred to henceforth as the Eder parcel, (6030 Fernbank Road, 14.24 ha; and two holdout properties, 0.81 ha per property) has been considered within this scoped MSS given the importance of its inclusion from an infrastructure servicing and development phasing perspective. The Eder parcel is proposed to be brought into the urban boundary through the planning process. The Caivan parcels are legally described as parts of Lots 24 and 25 Concession 9 (Geographic Township of Goulbourn now in the City of Ottawa).

The W-4 lands were newly designated as 'Urban Expansion Area' in the City of Ottawa Official Plan as of November 2022 and will be implemented as an amendment to the City of Ottawa Official Plan (OP) with removal of the '*Future Neighborhood Overlay*' on the OP's Schedule C17. The study area includes all of the W-4 Lands as well as the east parcel located at northwest corner of Shea Road and Flewellyn Road. The east parcel was considered for inclusion in the W-4 area by the City of Ottawa and scored

© DSEL

well from a servicing perspective in the City of Ottawa January 2021 Growth Management Strategy report but was not carried forward due a tree cutting violation by the previous owners. The east parcel is thus included in the study area given that the City of Ottawa's prior decision to exclude the lands from the boundary expansion was not based on servicing or physical constraints.

Given the constraints imposed by the presence of the Faulkner Municipal Drain (FMD), the development area has been divided into two distinct land parcels for the purposes of this ***MSS***. See the following ***Exhibit 1*** for details and the study area boundary with the respective areas referred to **Stittsville West Lands** and **Stittsville South Lands**.

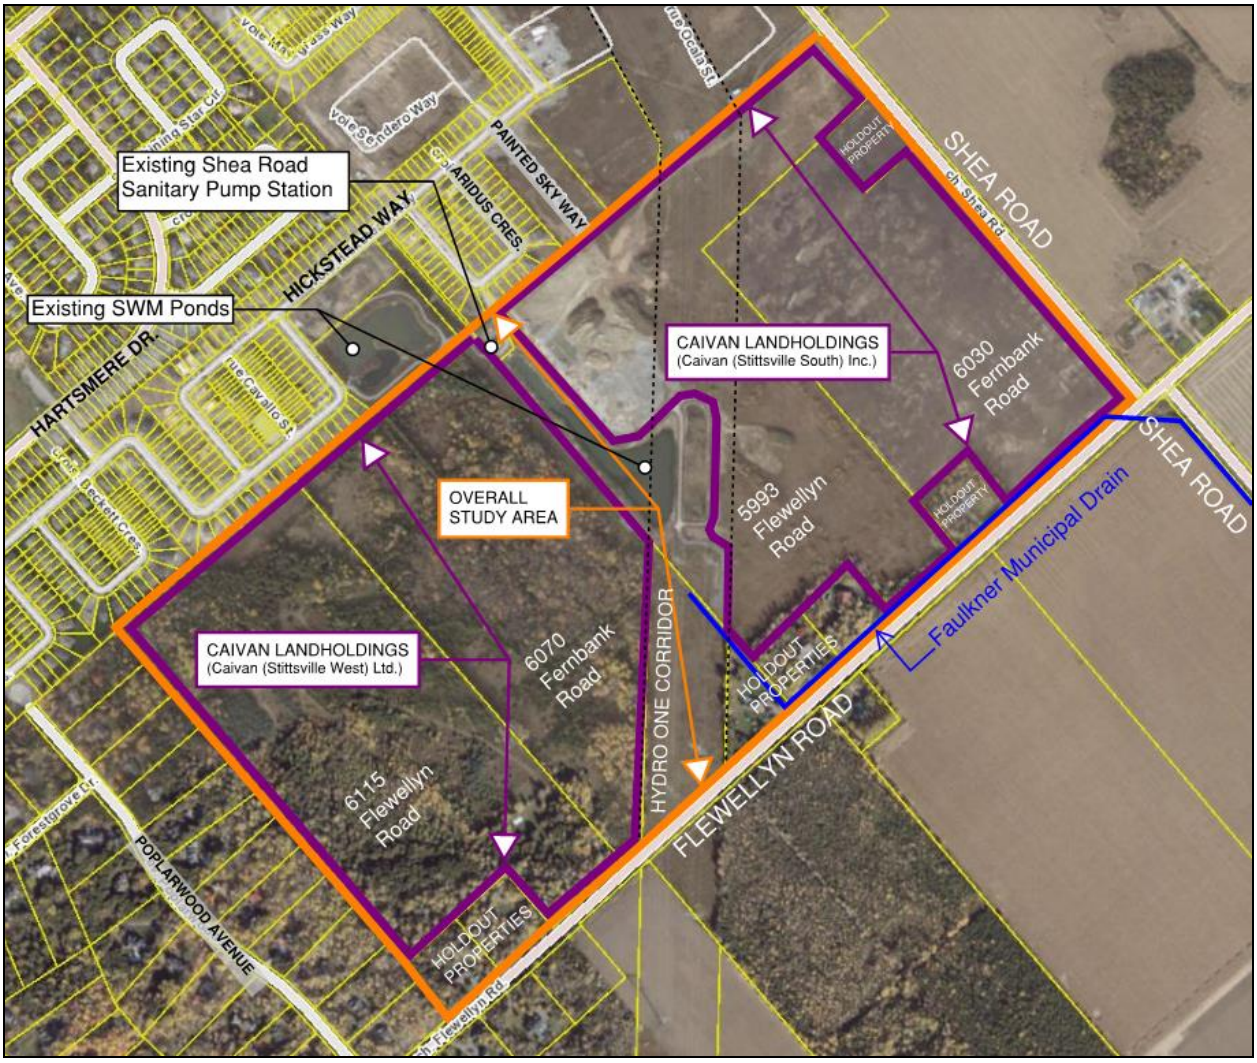

Exhibit 1: Stittsville South Urban Expansion Area – Location Plan

The subject property is within the Jock River subwatershed and is under the jurisdiction of the Rideau Valley Conservation Authority (RVCA). The existing topography,

© DSEL

characterized in the available City of Ottawa base mapping, and site-specific survey, indicates that all flows from the subject property are ultimately conveyed from the site by way of the Faulkner Municipal Drain (FMD), that generally divides the site into west and east parcels, and is conveyed along Shea Road to the Flowing Creek Municipal Drain and then the Jock River.

The subject property is currently zoned Rural Countryside (RU) Zone.

The proposed future development activities within the SSUEA area require approvals under the *Planning Act*, including an Official Plan Amendment application. Components of the development activities are also subject to the *Environmental Assessment Act*. Specifically, the proposed future development activities include the following land uses:

- Low Density Residential (single detached homes);
- Medium Density Residential (townhomes and stacked townhomes);
- Parkland;
- Woodlot / Open Space;
- Stormwater Management Facilities;
- Hydro Easement / Open Space; and
- Roads (18 m and 24m right-of-ways (ROW)) and Multiuse Pathways.

A Concept Plan for the SSUEA is presented in ***Figure 1***, prepared by NAK Design Strategies, and illustrates the various components noted above. The preferred concept was prepared and refined in conjunction with the preferred sanitary and storm servicing strategies presented in this ***MSS***.

This MSS has been prepared in accordance with the Municipal Engineers Association's *Municipal Class Environmental Assessment* (March 2023, as amended in 2000, 2007, 2011 & 2015) to support the Official Plan Amendment.

Caivan, majority landowner aside from seven smaller existing residential holdout properties, has retained **David Schaeffer Engineering Ltd.** to complete this scoped Master Servicing Study (***MSS***), which includes: environmental assessment input provided by **Morrison Hershfield**, stormwater management analysis provided by **J.F. Sabourin and Associates Inc.**, watermain analysis provided by **GeoAdvice Engineering Inc.**, geotechnical and hydrogeological investigations completed by **Paterson Group Inc.,** sanitary pumping station analysis completed by **Novatech** and natural environment investigations completed by **Kilgour & Associates Ltd**.

The objective of this ***MSS*** report is to provide technical details about the proposed servicing plan for the SSUEA, specifically detailing the proposed water supply servicing

© DSEL

strategy, wastewater servicing strategy, stormwater servicing strategy, grading strategy and utility service strategy. This ***MSS*** also considers the serviceability of the holdout properties, as demonstrated in ***Exhibit 1***, to ensure these lands will be serviceable in the future or are able to maintain their current servicing strategy. This ***MSS*** uses environmental assessment planning principles to evaluate alternative servicing solutions and alternative servicing designs for the SSUEA, leading to the identification of a preferred servicing strategy complete with mitigation of potential adverse environmental effects.

1.2 Report Integration

In support of the Official Plan Amendment application for the SSUEA study, various studies and plans are required to identify: on-site and off-site municipal infrastructure (e.g. roads, water, and sewers); the natural heritage system; recreational pathways; community facility requirements; on-site and off-site transportation infrastructure; and land use densities and mixes.

The reports and planning for the SSUEA were undertaken in a similar time frame and in a coordinated manner, resulting in an iterative planning and decision-making process. An inventory of the concurrent and inter-related reports is provided in the following table highlighting how the various components influence this ***MSS***. These reports are referenced throughout the ***MSS*** and are provided for reference in the appendices or as companion documents under separate cover.

Examples of inter-related aspects of the infrastructure and land use planning process include:

- Analysis of existing conditions, which led to the identification of development constraints that were used as the starting point for the Land Use/Demonstration Plan;
- The establishment of trunk watermains, storm collector sewers and sanitary collector sewers along proposed major roads, which is meant to support orderly and cost-effective phasing within SSUEA; and,
- The integration and design of the pathways system to reflect environmental amenities, transportation networks, and neighborhood requirements.

© DSEL

Table 1: Summary of SSUEA Studies/Reports

Report	***Relationship to Master Servicing Study***
Class Environmental Assessment Requirements Overview (Morrison Hershfield) dated October 2023	Provides overview of infrastructure projects to service the development area and applicability of the *Environmental Assessment* and *Planning Act* process.
Existing Conditions Report - Servicing Infrastructure (DSEL) dated Sept. 2023	Identifies the existing municipal infrastructure within, and surrounding, the SSUEA and assesses capacity to service the study area.
Stittsville South Expansion Lands – Transportation Report (Existing Conditions Report) (CGH) dated March 2023	Identifies transportation and traffic goals within the SSUEA and identifies current transportation and traffic patterns study area.
Stittsville South W4 Future Neighborhood Area – Existing Conditions Report (Kilgour & Associates Ltd.) dated October 3, 2023	Delineates the natural heritage system within the SSUEA based on field studies performed and identifies opportunities for consideration in the planning process related to development options. Defines drainage features and setbacks within and adjacent to the subject lands, which influences stormwater management recommendations for the development.
Geotechnical Investigation – Proposed Residential Development (Paterson) dated July 5, 2024	Determines general site subsoil and groundwater conditions, provides grade-raise recommendations, and bedrock contours.
Hydrogeological Existing Conditions Report (Paterson) dated July 5, 2024	Assesses the hydrogeological setting of the site with respect to bedrock and surficial geology, aquifers, aquitards, horizontal and vertical flow patterns, existing groundwater recharge/discharge, and aquifer vulnerability.
Hydrogeological Study and Water Budget Assessment (Paterson) dated July 5, 2024	Assesses the hydrogeological setting of the site with respect to aquifer systems, groundwater levels, hydraulic properties and catchment characteristics. Provides pre-development water budget analyses to identify infiltration potential and opportunities for the use of LID measures.
Conceptual SWM Ponds Sizing and Preliminary HGL Analysis – Draft Report (JFSA) dated November 30, 2023	Conceptual sizing of two SWM ponds, impacts of discharging a portion of SSUEA lands to the Davidson SWM Pond, and preliminary storm and sanitary HGL analysis.
Hydraulic Capacity and Modeling Analysis – Stittsville South Urban Expansion Area Development – Final Report (GeoAdvice Engineering Inc.) dated August	Describes the assumptions and results of the hydraulic modeling and capacity analysis for proposed development within the SSUEA lands. Includes identification of connections to existing municipal infrastructure and ensuring guideline requirements are

© DSEL

2024	satisfied.
New Urban Expansion Development – Terms of Reference (DSEL, Revised per City Comments Dated March 15, 2024)	Terms of Reference (TOR) to document the servicing strategy approach for development of 5993, 6070 & 6115 Flewellyn Road parcels of land located within Stittsville.

1.3 Master Servicing Study Scope

The subject properties have been considered as a part of the new Official Plan (OP) process and identified for future urban expansion through the application of a *Future Neighbourhood Overlay* on Schedule C17 of the new OP. Seven smaller parcels along Flewellyn Road and one parcel along Shea Road, owned by others, are also subject to the *Overlay* and are defined as Holdout Properties.

The objectives of this Master Servicing Study are to:

- Provide historical background information regarding the servicing of the subject property;
- Present servicing options explored while determining the recommended servicing strategy;
- Provide sufficient detail to demonstrate that development of the subject property will be adequately supported by municipal services;
- Define the course of subsequent detailed design, review, and acceptance of the proposed municipal services;
- Demonstrate how the proposed municipal services will conform with current Ministry of the Environment, Conservation and Parks (MECP) servicing design criteria and other applicable agency guidelines; and,
- Demonstrate good engineering practice for the protection of public safety, the environment, and sustainable operation.

1.4 Environmental Assessment Act

As of early 2023, amendments to the Municipal Class Environmental Assessment were adopted by the Ministry of Environment, Conservation, and Parks (MECP), and therefore this report references that document. Per *Ontario Regulation 345/93: Designation and Exemption Private Sector Developers* under the Environmental Assessment Act, works undertaken by private sector developers are exempt from the Environmental Assessment Act unless they are:

© DSEL

- Schedule C projects (e.g. new wastewater treatment plant, stormwater pond w. biological treatment, new well, etc.); and
- Providing the project for the residents of a municipality for roads, water or wastewater.

Morrison Hershfield has prepared a Class Environmental Assessment Requirements Overview which summarizes the various infrastructure projects that are anticipated to be associated with the development of the SSUEA area including:

- Sanitary pump station upgrades;
- New stormwater management facilities for quality/quantity control;
- Low Impact Development (LID) systems; and
- New local and collector roadways.

Morrison Hershfield has concluded that based on the infrastructure requirements for the SSUEA, the projects are exempt from the Class EA process.

1.5 Development Plan

The proposed community concept is shown in ***Figure 1***. The plan was informed by the environmental, site servicing and other studies and guidelines noted in ***Section 2.0*** below. The subdivision is contemplated to consist of a mix of single-family homes, townhomes, stacked townhomes, park blocks, stormwater management blocks, open space and road allowances/widenings. The following table summarizes the land use breakdown and predicted populations associated with the development concept.

Table 2: Development Statistics Projection

Land Use [1,2]	Area (ha)	Projected Residential Units per Area (ha)	Residential Population per Unit	Projected Population
Residential (Low Density)	14.4	33	3.4	1629
Residential (Low Density)	14.8	67	2.7	2677
Residential (Medium Density)	5.5	123	1.8	1214
Holdout Properties	5.7 (Existing Residential)	-	-	-
Streets & Widening	18.3	-	-	-
Parks	3.5	-	-	-
Natural Heritage Site	4.6	-	-	-

© DSEL

Stormwater Facilities	4.4	-	-	-
Hydro Easement	4.0			
Davidson SWM Pond	3.8 (Existing)			
Shea Road Pump Station	0.20 (Existing			
Total	**79.20**	**-**	**-**	**5520**

Notes:
(3) Population density based upon above densities = 33 person/ha (SFH TH), 67 persons/ha (TH), 123 persons/ha (Condo).
(4) Population projections may differ from population estimates used in other background studies. Population projection and residential population per unit values are based on Ministry of Environment, Conservation, and Parks (MECP) guidelines for servicing demand calculations and through consultation with City of Ottawa staff.

The above statistics are used to inform the servicing design for the site.

2.0 GUIDELINES, PREVIOUS STUDIES, AND REPORTS

2.1 Existing Studies, Guidelines, and Reports

The following studies were utilized in the preparation of this report.

- Ottawa Sewer Design Guidelines, City of Ottawa, October 2012 *(City Standards)*
    - Technical Bulletins (ISDTB-2014-01, PIEDTB-2016-01, ISTB-2018-01, ISTB-2018-04 & ISTB-2019-02).
- Ottawa Design Guidelines – Water Distribution (July 2010) *(Water Supply Guidelines)*
    - Technical Bulletins (ISDTB-2010-2, ISDTB-2014-2, ISTB-2018-02, and ISDTB-2021-032014-01, PIEDTB-2016-01, ISTB-2018-01, ISTB-2018-04 & ISTB-2019-02).
- Design Guidelines for Sewage Works, Ministry of the Environment, Conservation and Parks, 2008. *(**ECP Design Guidelines**)*
- Stormwater Planning and Design Manual, Ministry of the Environment, March 2003. *(**SWMP Design Manual**)*
- Infrastructure Master Plan (City of Ottawa, June 2024)
- Fire Underwriters Survey, 2020 (**FUS**)
- City of Ottawa Official Plan, adopted by Council 2023. *(**Official Plan**)*
- Low Impact Development Stormwater Management Guidance Manual (Ministry of the Environment, Conservation and Parks, Draft for Consultation MECP, January 2022 *(**MECP LID Manual**)*

© DSEL

- Low Impact Development Technical Guidance Report, Implementation in Areas with Potential Hydrogeological Constraints
  Dillon Consulting and Aquafor Beech, February 2021
  *(**LID Report**)*

- Fernbank Community Design Plan, Master Servicing Study
  Novatech, June 2009
  *(**Fernbank MSS**)*

- Stittsville South – Area 6, City of Ottawa, Master Servicing Report & Stormwater Management Design Plan
  Novatech/DSEL, December 2013
  *(**Area 6 MSS**)*

- Stittsville South Subdivision, City of Ottawa – Detailed Servicing & Stormwater Management Report
  Novatech, July 2016
  *(**Stittsville South Servicing Report**)*

- Stittsville South Subdivision, City of Ottawa – Shea Road Sanitary Pump Station Design Brief
  Novatech, May 2016 *(**Shea Road P.S. Design**)*

- Design Brief for the Stormwater Management Pond for the Davidson Lands
  JFSA/DSEL, November 2017 *(**Davidson Pond Brief**)*

- Design Brief, Davidson Lands – OPA 76 Area 6a, Phase 1 (5993 Flewellyn Road)
  IBI Group, February 2018
  *(**IBI Phase 1**)*

- Design Brief, Davidson Lands – OPA 76 Area 6a, Phase 2 (5993 Flewellyn Road)
  IBI Group, July 2020
  *(**IBI Phase 2**)*

- Geotechnical Investigation, Proposed Residential Development, 5993, 6070 & 6115 Flewellyn Road, Ottawa
  Paterson Group (PG5570-2), July 5, 2024
  *(**Stittsville South Geotechnical**)*

- Hydrogeological Existing Conditions Report, Proposed Residential Development, 5993 & 6115 Flewellyn Road & 6030 & 6070 Fernbank Road, Ottawa, Ontario
  Paterson Group (PH4625-REP.01.R1), July 5, 2024
  *(**Stittsville South Hydrogeology**)*

© DSEL

- Stittsville South W4 Future Neighborhood Area – Existing Conditions Report
  Kilgour & Associates Ltd., October 3, 2023.
  *(**Kilgour Natural Heritage Conditions**)*

- Jock River Reach 2 & Mud Creek Subwatershed Study
  Marshall Macklin Monaghan / WESA, May 2009.
  *(**Jock River Reach 2 SWS**)*

- Amendment to the Engineer's Report for the Faulkner Municipal Drain & Addendum #1
  Robinson, December 2020 and March 2021.
  *(**Faulkner Engineer's Report**)*

- Engineer's Report for the Flowing Creek Municipal Drain
  A.J. Graham Engineering, December 1973.
  *(**Flowing Creek Engineer's Report**)*

- Flowing Creek Flood Risk Mapping from Flewellyn Road to Jock River
  Rideau Valley Conservation Authority, May 2017.
  *(**Flowing Creek Flood Mapping**)*

- Caivan – Stittsville Lands (5993, 6070 & 6115 Flewellyn Road): Conceptual SWM Ponds Sizing and Preliminary HGL Analysis.
  JFSA (P2267), November 2023. *(**Davidson Pond Brief**)*

- Hydraulic Capacity and Modeling Analysis – Stittsville South Urban Expansion Area Development (*Final Report*). GeoAdvice Engineering Inc., August 2024.
  *(**GeoAdvice Hydraulic Analysis**)*

- Stittsville South Expansion Lands – Transportation Report. CGH Transportation (PN: 2021-128), November 2023.

- Sanitary Pump Station Pre-Design Report, Stittsville South (Novatech, July 2015)

- Hydrogeological Study and Water Budget Assessment, Proposed Residential Development, 5993 & 6115 Flewellyn Road & 6030 & 6070 Fernbank Road, Ottawa, Ontario
  Paterson Group (PH4681-REP.01.R1), July 5, 2024
  *(**Stittsville South Water Budget**)*

© DSEL

3.0 EXISTING CONDITIONS AND SITE CONSTRAINTS

3.1 Land Ownership

The SSUEA subject area is comprised of multiple landowners with lands of varying size. However, the majority of land ownership (approximately 88%) within the development area is under one ownership (Caivan) with the remainder being smaller holdout parcels as indicated in ***Exhibit 1*** in ***Section 1.1*** of this report.

3.2 Geotechnical Conditions

Paterson Group (Paterson) was commissioned to complete geotechnical investigation for the SSUEA lands. The following report was prepared:

- Geotechnical Investigation – Proposed Residential Development, 5993, 6070 & 6115 Flewellyn Road, Ottawa, Ontario (Paterson Group, July 5, 2024)

Key details are discussed herein, while full details are provided in the above report. The geotechnical investigation indicates that:

- **Surface Conditions:** Western portions of the subject site (west of FMD) are heavily vegetated while eastern areas are generally cleared of trees and vegetation. The site gradually slopes from the northwest to the southeast. The site also gradually slopes downward from the northeast and southwest to the central portion of the site, thereby having a shallow valley bearing northwest to southeast.

- **Soil Profile:** Profile consists of topsoil overlying a loose to compact, brown silty sand to sandy silt deposit, followed by compact to dense glacial till, underlain by bedrock. The glacial till deposit was generally observed to consist of compact to dense brown silty sand with gravel, cobbles and traces of clay.

- **Bedrock:** Based on available geological mapping, the bedrock within the subject area consists of limestone, dolostone, shale and sandstone of the Gull River Formation and an overburden drift thickness of 0.3 to 6.1 m depth across the subject site. Borehole investigations into the bedrock surface yielded an average Rock Quality Designation (RQD) value ranging from 57 to 100% indicating a fair to excellent quality bedrock across the site. Proposed development within bedrock may require blasting; specific blasting requirements would apply.

- **Preliminary Grade Raise:** From a geotechnical perspective, the subject site has been considered satisfactory for the proposed development. There will be

© DSEL

areas in the northwestern portion of the development area where bedrock removal will be required. Only two borehole locations observed a discontinuous shallow stiff, brown, silty clay layer which may have isolated specific 2m permissible grade raise restrictions but that would be refined at a site-specific level in future development applications.

- **Groundwater:** A total of 13 groundwater monitoring wells were installed within the development area. The groundwater table will fluctuate seasonally but measured groundwater levels generally ranged from 0 to 3.7 m below existing ground.

The above-mentioned geotechnical elements have informed the evaluation of servicing solutions and the preferred servicing designs included herein. As site-specific designs advance, a licensed geotechnical engineer is required to carry out final geotechnical investigations, complete with a review of any detailed grading plans.

3.3 Hydrogeology

The hydrogeology of the subject area has been analyzed by Paterson Group. Key implications are discussed herein, while full details are provided in the following report that was prepared:

- Hydrogeological Existing Conditions Report – Proposed Residential Development: 5993 & 6115 Flewellyn Road & 6030 & 6070 Fernbank Road, Ottawa, Ontario (Paterson Group, July 5, 2024)

- Hydrogeological Study and Water Budget Assessment – Proposed Residential Development: 5993 & 6115 Flewellyn Road & 6030 & 6070 Fernbank Road, Ottawa, Ontario (Paterson Group, July 5, 2024)

The hydrogeological investigations indicates that:

- **Groundwater Recharge:** The surficial geology mapping was reviewed and indicates that overburden soils at the subject site consist primarily of glaciomarine deposits with fine grained material to the east and coarse-grained material to the west. To the north, a small portion of the subject site consists of glacial till. Overburden soils identified by the geotechnical investigations by Paterson were generally consistent with the available mapping. Overburden thickness was observed to extend from 0.3 to 6.1 m below ground surface across the subject site, with available mapping indicating between 0 to 10 m of soil generally present. The overburden generally consisted of topsoil over silty sand to a sandy silt deposit underlain by glacial till. Clay was observed interbedded with the sandy silt layer on the eastern portion of the subject site.

© DSEL

Based on the field hydraulic conductivity testing undertaken, the hydraulic conductivity of the overburden materials were observed to range between 4.2 x 10^{-6} m/sec to 2.2 x 10^{-5} m/sec while the hydraulic conductivity of the bedrock were observed to range between 4.3 x 10^{-7} to 1.6 x 10^{4} m/sec. The test results showed the surficial field saturated hydraulic conductivity ranged from 1.1 x 10^{-7} to 6.4 x 10^{-6} m/sec at a depth of 0.3 m and ≤8.3 x 10^{-9} to 5.9 x 10^{-6} m/sec at a depth of 0.6 m. The field saturated hydraulic conductivity indicates that the overburden soils are considered to have a moderate hydraulic conductivity suggesting that the overburden materials act as a permeable layer to predominantly transmit groundwater in a horizontal direction with insignificant recharge to the bedrock layer below due to the higher RQD values. A portion of the site is mapped as a significant groundwater recharge area (SGRA). The Mississippi- Rideau Source Protection Region (MRSPR) SGRA mapping shows that the site area mapped as a recharge area is negligible compared to the overall SGRA zones.

- **Groundwater Flow:** The direction of hydraulic gradients shows that groundwater flow travels predominantly from west to east towards the eastern corner of the subject site. The overburden and bedrock groundwater flow in the vicinity of the study area is considered to partially reflect local topography and subwatershed regional boundaries. The horizontal hydraulic gradient in the bedrock was observed to be in a general eastward direction with increased values within the western portion of the subject site. Vertical hydraulic gradients were calculated within two nested well installations across the study area. Boreholes in the west area of the study area had vertical upward gradient of approximately 0.011 to 0.015 m/m while boreholes in the east area of the study area had a vertical downward gradient of 0.004 to 0.035 m/m. It is anticipated that the vertical gradient observed in the west portion of the site is due to the higher topography to the west of the subject site providing additional head where groundwater may daylight in areas such as the man-made excavation observed in the west portion of the site. The eastern portion of the site is showing a slight downward gradient which is indicative of the overburden providing insignificant recharge to the underlying bedrock aquifer.

- **Aquifers:** In general, the overburden soils at the subject site are relatively shallow and consist of moderate hydraulic conductivities with lower value materials on the east side of the development area. With the limited thickness of available quantity of groundwater within the overburden aquifer, it is not considered an adequate source for water supply wells. Surrounding water wells in the vicinity of the site are accessing the bedrock aquifers.

  Based on a review of the MECP water well record database, Paterson has identified one aquifer system in the vicinity of the study area which consists of the underlying bedrock aquifer. The Gull River Formation aquifer system is located

© DSEL

over the entirety of the study area. The majority of water wells are completed at greater depths within the bedrock unit.

- **Wells:** As noted above, water supply wells are the primary source for drinking water for existing residential properties to the west (Woodside Acres) and adjacent holdout properties.

The above-mentioned hydrogeological elements have informed the evaluation of servicing solutions and the preferred designs included herein, along with the recommendations for mitigation measures to be implemented.

3.4 Drainage

For the Caivan landholdings west of the HONI corridor the site topography generally drains eastward and southward (elevations ranging from 109 m to 103 m) with drainage ultimately being conveyed to the north Flewellyn Road right-of-way (ROW) and the FMD which bisects the development area.

Similarly, the development area east of the HONI corridor also drains eastward and southward (elevations ranging from 104 m to 102 m) to the portion of the FMD along the northern Flewellyn Road ROW as well as the western side of the Shea Road ROW.

The conceptual grading plan, ***Drawing No. 1***, demonstrates the SSUEA's overland flow routes based on the preliminary concept.

3.5 Natural Environment Features

Kilgour & Associates Limited (KAL) was retained by Caivan to complete an Environmental Existing Conditions Report for the SSUEA dated October 3, 2023, herein referenced as *Kilgour Natural Heritage Conditions,* for the proposed development area.

3.5.1 Natural Heritage System and Headwater Assessment

The natural heritage system and headwater drainage features of the subject area have been analyzed by KAL. Key implications are discussed herein, while full details are provided in the *Kilgour Natural Heritage Conditions* report.

The subject area is within the Rideau Valley Conservation Authority jurisdiction. During review of the site KAL conducted a headwater drainage feature assessment (HDFA) of the subject area. The review identified six (6) HDF's located both adjacent and within the development. One group of channels (tributaries A, B and D) is associated/located within the western treed area of the site while the second grouping (tributaries C, E and

© DSEL

F) is primarily associated with the FMD which bisects the study area and ultimately conveys all flows from the site. The following table describes the various features.

Table 3: HDFA Summary

KAL HDF Identifier(1)	***Tributary (HDF) Description***
Tributary A	Originates in the northwest region of the site (~150 m offset from west boundary and roughly parallel to Tributary D) and flows southward as a braided channel towards Flewellyn Road. It primarily functions as a drainage feature supporting spring/rainfall run-off.
Tributary B	Originates within the northwest, central region of the site and flows southeast, eventually joining Tributary E. It has a standing water pool present with interstitial flow towards the Flewellyn Drain.
Tributary C	Flewellyn Road ditch feature (north side) originating at the southwestern corner of the Site, at the terminus of Tributary D. Flows eastward, joining the Faulkner Drain. Tributary C is a permanent feature that has water present year-round
Tributary D	Man-made, engineered lot swale feature that originates in the northwestern corner of the Site. It follows the western property boundary and is present within portions of the rear yard allowances of the adjacent Woodside Acres estate lot development. Primarily functions as a drainage feature supporting spring/rainfall run-off.
Tributary E	Constructed, linear channel feature that originates within the west, central portion of the site and flows south eventually turning eastward joining the Faulkner Drain. It has intermittent standing water pools present with intermittent flow towards Faulkner Drain and receives intermittent flow from Tributary B.
Tributary F	Shea Road ditch feature (west side) at the eastern Site boundary. It is located adjacent to an agricultural field and connects downstream to the Faulkner Drain at Flewellyn Road. It primarily functions as a drainage feature supporting spring and rainfall run-off.

HDFs on the site currently exist in primarily forested areas such that they include extensive tree cover along their riparian corridors. The HDFs themselves are hydrologically limited, having insufficient water level though most of the year to support fish or other aquatic wildlife. Based upon site topography and constraints, future site development is anticipated to require the construction of multiple wet stormwater management facilities to support quality/quantity stormwater management for the area. The outlet channels for each feature provide an opportunity to design local watercourses following principles of natural channel design and with increased levels of hydration that would support improved habitat conditions beyond the limited capacity afforded by the current HDFs.

© DSEL

Standard HDFA management directives of "Mitigation" indicate that a feature may be maintained, replicated, or enhanced using natural channel design techniques to maintain or enhance the reach. There is no requirement to retain the feature per se, but on-site flow, outlet flows, and overall water balance for the area must be maintained by providing mitigation measures to infiltrate clean stormwater. Per KAL, this applies to Tributaries A and D

Standard HDFA management directives of "Protection" indicate that the feature may be maintained and/or enhanced, but typically should not be relocated. The general directive is for the feature to be protected and its riparian zone enhanced where feasible. Notably for Tributaries B and E, however, these tributaries are sourced from the SWCM1-1 community wetland (see *Kilgour Natural Heritage Conditions* report for further details). As the wetland would be unlikely to remain with development occurring on the western half of the site, (i.e. even with standard setbacks) the hydrology of those tributaries is unlikely to remain regardless of protections otherwise applied. Tributaries C and F are also designated as "Protection" but those HDFs are periphery to the site (i.e. roadside ditches) and can be maintained in their respective locations.

The above-mentioned requirements informed the evaluation of servicing solutions and the preferred designs included herein, along with the recommendations for mitigation measures to be implemented.

3.5.2 Limit of Development

Detailed site-specific studies have been undertaken to define development constraints as they relate to the existing natural environment conditions. Tributary D along the western boundary of the study area, and the Faulkner Drain were identified as requiring development setbacks. Tributary D with a development setback of 5 m is anticipated to protect the limited flows within the feature. KAL has indicated that the existing FMD has variable setback buffers from 0 m through much of its length beyond the site. North of the SSUEA also has minimal setbacks. KAL concludes that the functionality of any buffer would be limited to providing filtration of overland runoff could be provided by a setback of 15m with simple vegetation buffers, or less provided that overland flows are treated by a stormwater facility prior to release or landscaping with comprehensive plantings.

Please refer to the *Kilgour Natural Heritage Conditions* report for full discussion.

The above-mentioned elements informed the evaluation of servicing solutions and the preferred pond footprint designs included herein, along with the recommendations for mitigation measures to be implemented – see ***Section 10*** of this report for additional information on mitigation measures.

© DSEL

3.6 Existing Land Use and Adjacent Land Uses

Land uses within the subject area is currently a mix of active/former agricultural/pasture land in the eastern portions and partial forested areas in the western portion. The overall area is bisected diagonally (north/south) by an existing HONI 500kV utility corridor and an existing stormwater management facility (Davidson Stormwater Pond) is located centrally within the property and manages flows from a portion of the Edenwylde Subdivision to the north.

In addition, a stormwater conveyance ditch originating from the development areas to the north, conveys drainage southward parallel to the east boundary of the current 6070 Fernbank Road property. The ditch officially transitions to being the Faulkner Municipal Drain (FMD) approximately 215 m north of the Flewellyn Road ROW and then flows eastward along the Flewellyn Road corridor and then southward along the west side of Shea Road.

Land use to the southwest of the subject consists of a rural estate lot subdivision (Woodside Acres) while lands to the northwest are comprised of new urban community development areas (Stittsville South – Area 6 ("Edenwylde")) which began construction in ~2016/17.

Along the subject area periphery are six rural residential properties fronting onto Flewellyn Road and one undeveloped rural parcel fronting Shea Road. For the purpose of this MSS, these properties have been defined as holdout properties and are included as part of the overall SSUEA assessment.

3.7 Opportunities and Constraints

Based on the inventory of existing conditions:

- There is an opportunity to develop the subject area, while protecting some of the existing watercourses that have been identified for protection from alteration and development. Specific components of the natural heritage system are required to be protected from alteration and development are periphery to the site and can be protected while some internal areas will be impacted by the change in hydrologic regime and will have limited potential for mitigation.
- The general urbanization of the subject area is expected to increase runoff and has the potential to increase erosive forces in downstream receivers (i.e. the FMD). Generally speaking, directing controlled post-development flows to respect the existing receiver(s) and coordinating details with the recently updated studies and Engineer's Report for the FMD are expected to provide opportunity to limit release of runoff from development slowly over time, to mitigate erosive forces in run off and any impacts to downstream water levels.

© DSEL

- The surficial geology across the site generally consists of topsoil overlying a loose to compact, brown silty sand to sandy silt deposit, follow by compact to dense glacial till, underlain by bedrock.

  Based on field hydraulic conductivity testing completed for the site, the hydraulic conductivity of the overburden materials were observed to range between 4.2 x 10^{-6} m/sec to 2.2 x 10^{-5} m/sec (moderate conductivity) while the high RQD bedrock conductivity was observed to range between 4.3 x 10^{-7} to 1.6 x 10^{-4} m/sec. Generally, Paterson concluded that the overburden materials act as a permeable layer to predominantly transmit groundwater in a horizontal direction with insignificant recharge to the bedrock layer below.
- There is an expected opportunity to support the development of the SSUEA by connecting to the existing municipal watermain and sanitary infrastructure. An allowance for capacity, with any appropriate upgrades, is expected within the receiving sewer systems to support the proposed development.
- The development area generally has no grade raise restrictions of note. There were two isolated locations where a discontinuous shallow stiff, brown, silty clay was observed at a shallow depth (located in the northeast area of the site) which may lead to a requirement of an area specific restriction of 2 m pending further detailed review as required. The grading plans will have regard for this constraint; bearing in mind that there is an identified opportunity for betterment (reduction) of these restrictions through additional study and programs such as a long-term settlement plan or a lightweight fill strategy depending upon the extents.

4.0 NEED AND JUSTIFICATION FOR MUNICIPAL SERVICING

4.1 Vision & Goals for the SSUEA

It is envisioned that the SSUEA study area will be a residential enclave for the residents in the southern boundary area of Stittsville. The combination of diverse housing options, in addition to the leisure and recreational opportunities, will make it an attractive place to live and play. The integration of various housing options, coupled with leisure and recreational amenities within the development, is anticipated to foster an appealing living and recreational environment.

An offset grid pattern road network, characterized by regularly spaced intersections will optimize transit, cycling, vehicular travel, and pedestrian circulation. The Hydro One Corridor will provide a strong linear corridor for pedestrians and cyclists, which will form part of a Greenspace network that links features such as the Davidson Stormwater Facility, watercourses, parks, and open spaces.

© DSEL

4.2 Servicing Problem Statement

A servicing strategy is needed to support the wastewater collection requirements, water demands, storm drainage requirements, and stormwater management requirements for the proposed land uses within the SSUEA. The servicing strategy must be consistent with the Provincial Policy Statement (PPS), must meet City of Ottawa requirements, must meet the requirements of other approval agencies (e.g. Ontario Ministry of Environment, Conservation, and Parks, Ontario Ministry of Natural Resources and Forestry, Rideau Valley Conservation Authority, etc.), and must demonstrate good engineering practice for the protection of public safety, the environment, and sustainable operation.

5.0 IDENTIFICATION AND EVALUATION OF ALTERNATIVE SERVICING SOLUTIONS

Servicing solutions have been evaluated in terms of their ability to meet the problem statement (e.g. their ability to support the proposed level of development and their ability to meet relevant regulations and guidelines) and their expected net environmental impacts, including consideration of social and natural environments.

5.1 Water Distribution Alternatives

- **Do Nothing:** By not developing any water infrastructure, the problem statement would not be addressed, as the proposed urban development could not be supported.
- **Construct Private or Communal Wells:** Private or communal wells are not expected to support the water demands for the proposed urban development. This solution would not be consistent with the Provincial Policy Statement or other agency guidelines, which state that municipal service is the preferred form of water supply in urban areas.
- **Expand Existing Municipal Water System:** Expanding the municipal water system would provide safe and reliable drinking water to the new community, would offer wide-spread fire protection, would make efficient use of existing capacity, and would be consistent with City servicing practices for the urban area.

Based on the assessment summarized above, expanding the existing municipal water system is the preferred solution for water distribution for the proposed SSUEA development.

© DSEL

5.2 Wastewater Collection Alternatives

- **Do Nothing:** By not developing any wastewater infrastructure, the problem statement would not be addressed, as the proposed urban development could not be supported.
- **Construct Private or Communal Septic Systems:** Private or communal septic systems are not expected to support the wastewater generated by the proposed urban development. This solution is not consistent with the Provincial Policy Statement or other agency guidelines, which state that municipal sewage services are the preferred form of servicing within urban areas.
- **Expand Existing Municipal Wastewater System:** Municipal sewage services are the preferred form of servicing for urban areas in Ontario, as per the Provincial Policy Statement. An extension/expansion of the existing sanitary sewer system would make efficient use of existing capacity and is considered the best alternative solution to address the problem statement.

Based on the assessment summarized above, expanding the existing municipal wastewater system is the preferred solution for wastewater collection for the proposed development in the SSUEA.

5.3 Stormwater Collection & Management Alternatives

- **Do Nothing:** By urbanizing the subject lands and not developing any stormwater management infrastructure, the problem statement would not be addressed, as City and other agency requirements for environmental protection would not be met.
- **Open Ditches & Culverts for Stormwater Collection Systems:** Open ditches and culverts can be used in road rights-of-way (ROWs) and public lands (e.g. owned by the City of Ottawa, easement in favor of a utility, etc.) to convey stormwater runoff from the roadway and adjacent development blocks towards a downstream outlet. Open ditches provide an element of quality treatment, but alone are not expected to provide sufficient quantity or quality control for protection of downstream watercourses in accordance with agency guidelines, so would need to be paired with other stormwater management practices to address the problem statement. While open ditches and culverts are appropriate in rural/semi-rural settings and certain urban settings (ROWs widths accommodate ditches, elevation changes across the site allow for ditches to remain relatively shallow, etc.), open ditches and culverts alone along all ROWs would not be consistent with City of Ottawa guidelines, which state that municipal sewers are the preferred form of servicing within urban areas. Open ditches necessitate wider ROWs which would lead to inefficient land uses for the development area that has obvious potential to be on

© DSEL

municipal services for water and sanitary servicing. The use of open ditches has not been carried forward for consideration.

- **Expand Existing and Construct New Municipal Stormwater Minor/Major Collection Systems:** A dual drainage system is a reasonable and feasible alternative stormwater management solution for the site, with the minor system consisting of underground storm sewers that accommodate runoff from frequent events, and the major systems consisting of overland flow routes for the less frequent, high intensity storm events. However, the dual drainage system alone cannot support the stormwater management requirements of the development area: the storm sewers and overland routes do not provide sufficient quantity or quality control for protection of downstream watercourses in accordance with agency guidelines, so would need to be paired with other stormwater management practices to address the problem statement. The use of minor/major collector systems has been carried forward for inclusion in the stormwater management approach.
- **Implement Stormwater Control & Treatment within Rights of Way:** The implementation of controls on development lots/blocks and in rights of way - such as underground storage, oil and grit separator units, pervious pipe infiltrations systems, rear yard storage, etc. - can contribute to meeting agency requirements for stormwater quantity control, stormwater quality control, and infiltration objectives for the proposed development plan. In addition, storage within Parks and Hydro Corridor lands can contribute to meeting agency guidelines for stormwater management. These controls alone are not expected to be sufficient to meet agency guidelines for protection of downstream watercourses. These controls have been carried forward for potential inclusion in a stormwater 'treatment train' approach, which is a recommended approach in agency guidelines that uses a combination of practices to address stormwater runoff generated in urban environments.
- **Expand Existing Davidson Stormwater Management Pond**: There is an existing stormwater management wet pond (Davidson SWM Pond) which has previously been constructed within the north central region of the SSUEA. The facility was implemented to service development lands to the north. The Davidson SWM Pond has the potential to service a portion of the east side of the SSUEA that is in close proximity based on site conditions. Wet ponds are a common type of stormwater management facility used throughout the City and the province, and can be designed to meet agency guidelines for protection of watercourses. In order to address the problem statement and meet all current agency guidelines, the existing pond would need to be expanded within its current designated block area given its constrained location.

  The amount of additional tributary land that could be accommodated has to be assessed based on the facility's configuration. Other adjacent SSUEA

© DSEL

land area that cannot be treated by the Davidson SWM Pond would require an alternative (and smaller footprint) SWM solution due to topography constraints given that overall grades for the SSUEA trend southward, away from the Davidson SWM Pond. Any potential Davidson SWM pond expansion would make most efficient use of existing infrastructure and, when considered with the other elements of the "treatment train" mentioned above, is considered a complementary alternative solution to address the problem statement.

- **Construct New Large-Scale Stormwater Management Pond(s):** One or multiple new end-of-pipe stormwater management ponds are a feasible solution for stormwater management for the proposed urban development. Wet ponds are a common type of stormwater management facility used throughout the City and the province, and can be designed to meet agency guidelines for protection of watercourses. Based on site topography one or multiple new ponds would require additional land be dedicated to stormwater management. While the expansion of the Davidson SWM Pond may lower the extent of land area to be serviced, the inclusion of new facilities is the most suitable way to address the problem statement.

Based on the assessment above, a stormwater management strategy consisting of lot/block and rights-of-way controls, minor/major collection system, and the implementation of new SWM facilities is the preferred solution for stormwater management for the proposed development in the SSUEA.

6.0 ASSESSMENT OF ALTERNATIVE NEIGHBOURHOOD CONCEPT PLANS/SERVICING DESIGN CONCEPTS

6.1 Preliminary Land Use Plans

The preferred servicing solution for the SSUEA is to expand the existing municipal water and sanitary sewer network, and to provide adequate quality and quantity treatment of stormwater using applicable stormwater management techniques. Alternative neighborhood design concepts are to be developed and evaluated in terms of their ability to meet the problem statement (i.e. their ability to support the approved level of development and their ability to meet relevant regulations and guidelines) and their expected net environmental impacts. In considering net environmental impacts, consideration is given to impacts on: air, land, and water; plant, animal, and human life; social, economic, climate change, and cultural conditions; existing buildings and infrastructure; and the generation of noise, vibrations, radiation, and odours.

For the evaluation of alternative neighborhood concepts, the intent is to compare various alternatives to determine which best meets the vision and goals of the SSUEA development.

© DSEL

From a servicing and grading perspective, the preferred concept plan was evaluated for:

- Minimizing construction, maintenance, and operations requirements for stormwater management facilities;
- Minimizing construction and operations requirements for deep sewers; and,
- Minimizing front-ending costs and allowing for efficient area development (e.g. phasing of collector roads and associated collector sewers and watermains).

6.2 Assessment of Alternative Land Use Plans

Based on the evaluation of servicing solutions and consideration of the net environmental impacts, the concept plan presented in ***Figure 1*** is the preferred land use plan for the SSUEA development based on the servicing options evaluated in the following sections of this report.

Other factors that were considered in the evaluation of different land use alternatives included:

- Parks and preserved woodlot adjacent to FMD and SWMP;
- Loss of watercourses;
- Minimizing upgrades to existing water system requirements;
- Compatibility with existing and future municipal infrastructure;
- Impacts to existing downstream flood levels; and
- Disruptions of natural habitat (loss / fragmentation).

6.3 Preferred Concept Plan and General Servicing Strategy

The preferred concept plan is provided in ***Figure 1.***

For the purposes of this MSS, the SSUEA lands have been divided into two distinct land areas, with the Davidson Pond and Hydro Corridor serving as the internal limits within the study area. The land areas are referred to as the Stittsville West Lands and Stittsville South Lands.

The **Stittsville West Lands** (6115 Flewellyn Road and 6070 Fernbank Road under the ownership of Caivan (Stittsville West) Ltd.) are bound by an existing urban subdivision development to the north (Stittsville South – Area 6), Flewellyn Road to south, an estate lot subdivision (Woodside Acres) to the west, and the Davidson SWM Pond/ Hydro One Corridor to the east. The West Lands are proposed to have a mix of varying density residential, park land and woodlot area, a SWM Pond facility, and a portion of the existing Hydro corridor.

© DSEL

The **Stittsville South Lands** (5993 Flewellyn Road and 6030 Fernbank Road under the ownership of Caivan (Stittsville South) Ltd.) are bound by an existing urban subdivision development to the north (Stittsville South – Area 6), Flewellyn Road to south, Shea Road to the west, and the Davidson SWM Pond to the east. The South Lands are proposed to have a mix of varying density residential, park land, a SWM Pond facility, and a portion of the existing Hydro corridor.

The holdout properties along Flewellyn Road and Shea Road have been incorporated into the SSUAE study area and have been considered for future development. Note that the Concept Plan corresponding to the Preferred Land Use Plan can also be seen in ***Figure 1.***

The road network included in the Concept Plan has been carried forward for the purposes of this MSS. The network serves only as a basis for high-level infrastructure capacity calculations contained in this MSS and is subject to change. A summary of the land uses and population projections used for the development of servicing requirements is provided in ***Table 2***.

It is expected that as specific parcels are developed within the study area, the number of people and the associated servicing demands will be refined as part of *Planning Act* approvals. The MSS has been developed to account for flexibility at the detailed design level, by providing sewer sizing with reserve capacity, anticipating a 10% increase in water demands, etc. Alignment and sizing of infrastructure is subject to change as part of *Planning Act* approvals and would be treated as a minor change to this MSS.

6.4 Phasing Strategy

The land uses, services, and earthworks described in this Master Servicing Study will be built out by a singular landowner in separate discrete phases, according to the landowner's preferred timing. As such, there may be works outside of phase limits that are required to support a certain phase of development. The timing and approval of such works are to be addressed as part of future detailed design and approval processes for development of the lands within the SSUEA.

© DSEL

7.0 WATER SUPPLY SERVICING PLAN

7.1 Existing Water Supply Services

The SSUEA study area will be within the City's Pressure Zone 3W service area of the City of Ottawa water distribution network (see ***Figure 2*** for reference). The pressure zone receives supply from the Campeau Drive and Glen Cairn Pump stations. The Stittsville Elevated Tank provides balanced storage during peak usage and fire flow conditions. The available options for connectivity to the City's water supply network include:

- The major water supply line in the vicinity of the development is a 400mm diameter watermain along Fernbank Road, with a watermain stub approximately 300m southwest of the Fernbank Road and Shea Road intersection;
- An existing 250mm diameter watermain located within the Parade Drive ROW, immediately north of the western portion of the development area. A future southbound ROW block from Parade Drive is located between civic addresses 714 and 720 Parade Drive;
- An existing 250mm diameter watermain is located within the Aridus Crescent ROW which is north of the Davidson Lands parcel. An existing 50mm water service within a servicing block from Aridus Crescent to the SRPS pump station is also installed facilitating water supply to that facility;
- An existing 200mm diameter watermain located within the Painted Sky Way ROW at the northwest portion of the Davidson land parcel; and;
- An existing 200mm diameter watermain location within the Ocala Street ROW north of the northeastern portion of the Davidson land parcel.

7.2 Water Supply Servicing Design

GeoAdvice Engineering Inc. was retained to perform a preliminary hydraulic assessment for the SSUEA Lands. The *Hydraulic Capacity and Modeling Analysis – Stittsville South Urban Expansion Area Development* ***(GeoAdvice Hydraulic Analysis)*** prepared by GeoAdvice Engineering Inc. dated August 2024 is enclosed in ***Appendix C.1*** for reference. This report is prepared for the ***SSUEA*** (W-4) and also considered the southeast parcel in the potable water servicing strategy.

The sizing of the trunk watermain infrastructure was considered in the ***GeoAdvice Hydraulic Analysis***. Updated boundary conditions will be provided within the forthcoming Functional Servicing Report and the overall distribution network will be assessed at the detailed design stage.

© DSEL

7.2.1 Water Supply Servicing Alternatives

To supply water to the entirety of the subject property, a local watermain network will follow the road network and ultimately connect to off-site watermains based on the layout presented in *Figure 1.1 of the Hydraulic Capacity and Modelling Analysis Stittsville South Urban Expansion Area Development* (GeoAdvice, August 2024) report. Watermain connections and sizing were reviewed as part of MSS-level design to address City of Ottawa and MECP requirements.

Based on GeoAdvice's review of the background infrastructure in this area, the watermain connections available to the north of the subject property present the only feasible option to service the lands, and no other logical or efficient alternative designs were advanced for additional analysis and evaluation. At this time, no opportunities exist to connect to the existing municipal infrastructure outside of what will be proposed below. Future extension of the 400 mm diameter watermain within Fernbank Road and the 300 mm diameter watermain within Shea Road (Cope Drive-Shea Road Intersection) would provide possible connection opportunities, however, no infrastructure upgrades are currently identified in the *Infrastructure Master Plan* (City of Ottawa, 2023) and adequate supply can be provided to the SSUEA in the absence of public infrastructure upgrades.

7.2.2 Water Servicing Plan Recommended Alternative

Stittsville West Lands

An existing, single, future north/south roadway connection is depicted within the legal fabric of the subdivision to the north (located between 714 and 720 Parade Drive). This location would provide a future roadway connection and watermain feed location from the existing watermain network for to the West Lands for initial phases of development in this area.

There are no additional future right of way blocks for a second roadway connection to the Parade Drive watermain from the West Lands. In terms of additional watermain feeds (either interim or permanent) a secondary watermain connection for the development area could be implemented via:

(a) An interim/permanent loop through the Parade Drive stormwater management pond block at the east end of Parade Drive.
(b) A watermain loop underneath the tributary to the FMD, then north through the walkway block adjacent to the SRSPS and connecting to the Aridus Crescent 250 mm watermain. This would require an upsize of the existing 50mm water service to the sanitary pump station.

© DSEL

Stittsville South Lands

An existing, single, future north/south roadway connection is depicted within the legal fabric of the subdivision as an extension of Painted Sky Way from the adjacent Stittsville South – Area 6 (Edenwylde) development to the north. This location provides the primary water supply point to the South Lands. Similar to the second feed option for the West Lands, a connection to the Aridus Crescent 250mm watermain could be implemented. For the ultimate development of the South Lands area, east of the HONI corridor, an external connection from Ocala Street will provide additional water supply and looping to the development area.

7.2.3 Water Supply Design Criteria

As detailed design progresses; timing, alignment, and sizing of local watermains will be confirmed. The subdivision's local watermain network will be sized to meet maximum hour and maximum day plus fire flow demands, with consideration given to proposed phasing plans. ***Table 4*** summarizes the Water Supply Design Criteria employed in the preparation of the preliminary water demand estimate as provided by the City of Ottawa for expansion areas where the population exceeds 3000 persons. See correspondence with City staff in ***Appendix C.2***.

Table 4: Water Supply Design Criteria

Design Parameter	Value
Extracted from Section 4: Ottawa Design Guidelines, Water Distribution (July 2010)	
Minimum Watermain Size	150 mm diameter
Minimum Depth of Cover	2.4 m from top of watermain to finished grade
During normal operating conditions desired operating pressure is within	350 kPa and 480 kPa
During normal operating conditions pressure must not drop below	276 kPa
During normal operating conditions pressure must not exceed	552 kPa
During fire flow operating pressure must not drop below	140 kPa
City of Ottawa – Email Correspondence (July 2024)	
Residential - Single Family	3.4 p/unit
Residential – Townhome/ Semi	2.7 p/unit
Residential – MediumDensity	1.8 p/unit
Average Day Demand	
Single Detached	612 L/unit/day
Multifamily	535 L/unit/day
Apartment/Condo	394 L/unit/day
Water Loss per Connection	80 L/unit/day
Parkland	28,000 L/ha/day
Outdoor Water Demand	
Single Detached	700 L/unit/day

© DSEL

Multifamily	350 L/unit/day
Apartment/Condo	0 L/unit/day
Parkland	0 L/unit/day
Maximum Day Demand	
Single Detached	AVDY + OWD L/unit/day
Multifamily	AVDY + OWD L/unit/day
Apartment/Condo	AVDY + OWD L/unit/day
Parkland	1.5 x AVDY
Peak Hour Demand	
Single Detached	2.1 x MXDY L/unit/day
Multifamily	2.1 x MXDY L/unit/day
Apartment/Condo	1.6 x MXDY L/unit/day
Parkland	1.8 x MXDY L/unit/day

[1] Values represent L/cap/day for residential land uses.
[2] Occupancy factors chosen according to housing type. The values shown were extracted from Section 4.2.8 of the Ottawa Design Guidelines - Water Distribution (2010)
[3] Outdoor water demand is applied to single family, semi-detached and townhome units with rear yards.
[4] The 1.5 multiplier represents the additional outdoor water demand associated with employment areas.

7.2.4 Fire Flow Demand

Fire Flow requirements are to be confirmed in accordance with Local Guidelines (Fire Underwriters Survey, 2020), City of Ottawa Water Supply Guidelines, and the Ontario Building Code, upon development of detailed concepts for the detached single homes, townhouses, stacked townhomes, and the park blocks. For planning purposes, fire flow estimates are provided in the preliminary water demand estimate based on the information available in the preliminary concept plan and comparable recent developments in the City of Ottawa.

Based on the initial boundary conditions provided by the City of Ottawa, the maximum allowable fire flow requirement to ensure the minimum level of service within the distribution network is 217 L/s. As such, a fire flow of 167 L/s and 217 L/s were used for low density residential and medium density residential, respectively, to assess the trunk watermain network capacity and ensure that guideline requirements are met. Based on the analysis provided by GeoAdvice, the distribution network can sufficiently meet the required level of service under normal and emergency operating conditions. Adequate looping, hydrant spacing, and the elimination of dead end watermains will be emphasized within the development as detailed design proceeds to ensure that all guideline requirements are addressed. In addition, detailed fire flow calculations are to be completed for the purpose of sizing local watermains. The trunk watermain network has been designed for the maximum day plus 217 L/s fire flow requirement which will govern the watermain sizing for the SSUEA.

© DSEL

A fire flow requirement of 167 L/s and 217 L/s was assigned to low density and high-density residential areas for the purpose of trunk watermain network design in support of the proposed land uses in the SSUEA. A summary of the minimum available fire flows is shown in ***Table 5.***

Table 5: Summary of Minimum Available Fire Flows (GeoAdvice, 2023)

Required Fire Flow	***Minimum Available Fire Flow***
167 L/s (10,000 L/min)	273 L/s (16,380 L/min)
217 L/s (13,000 L/min)	254 L/s (15,240 L/min)

The modelling and reporting provided in ***Appendix C.1*** indicates that the proposed watermain network can provide domestic flows to the subject area with service pressures within the acceptable range and can provide the required fire flow at all modelled nodes. This fire flow is considered representative of the maximum allowable flow for residential uses under current City guidelines and is suitable for planning purposes for the residential uses proposed.

7.2.5 Boundary Conditions

To support the future development of a hydraulic analysis for the subdivision, updated boundary conditions have been requested for the preliminary water demands (see ***Appendix C.3***). To assess serviceability and recommend a preferred trunk watermain network in support of development within the SSUEA, a preliminary water distribution model has been prepared by GeoAdvice Engineering Inc. to demonstrate the feasibility of the proposed servicing layout within the SSUEA using boundary conditions previously provided by the City of Ottawa (included in ***Appendix C.4***). Although the population estimate associated with the recent boundary conditions request differs slightly from the population estimate provided previously, sufficient pressures are available within the network to support a reasonable variation in population density, and it is expected that the fire flow requirements will ultimately govern the water servicing design.

- **Boundary Condition Location 1:** Pressure Zone 3W, Parade Drive, Existing 254 mm diameter watermain.
- **Boundary Condition Location 2**: Pressure Zone 3W, Hickstead Way via Aridus Crescent, Existing 254 mm diameter PVC watermain.
- **Boundary Condition Location 3:** Pressure Zone 3W, Hickstead Way via Painted Sky Way, Existing 254 mm diameter PVC watermain.

© DSEL

- **Boundary Condition Location 4**: Pressure Zone 3W, Ocaia Street, Existing 203 mm diameter PVC watermain.

7.3 Commitments for Functional and Detailed Design

Detailed hydraulic analyses will be prepared for the phases of the proposed water distribution network at the time of their respective detailed designs, to determine that water supply is made available to the SSUEA as specified in the City of Ottawa Water Supply Guidelines.

The water distribution network will have to be designed to support the phased development of the lands making up the SSUEA. The phased water supply systems will be looped for areas > 50 m^3, per ISTB 2018-02-08, to provide for system security and redundancy.

The proposed trunk watermain network is shown to generally follow the proposed road network. Note that as the road network is conceptual in nature and is subject to change, the watermain network is also subject to change. Easements may be required for local and trunk watermains as detailed design progresses for the development lands, in order to meet City and MECP guidelines.

During detailed design of the developments within the SSUEA:

- Demands will be updated, and distribution refined, once more detailed development information is available;
- Demand factors according to Section 4.2.1 of the City of Ottawa *Design Guidelines* & subsequent Technical Bulletins will be used (for localized areas with populations less than 3,000 and/or areas less than 50 ha);
- Local watermain sizing will need to be evaluated at the subdivision approval stage; and,
- Individual residential blocks will be evaluated for required fire flow as detailed plans for these sites are developed.

7.4 Water Supply Conclusion

The SSUEA is to be serviced by a proposed network of trunk watermains varying in diameter from 250 mm to 300 mm. At this stage of analysis, only the trunk watermain within the West and South Lands are shown. A network of local watermains is assumed to service developments within the SSUEA.

A preliminary hydraulic analysis, provided in ***Appendix C.1***, has been completed to ensure compliance with City of Ottawa Water Supply Guidelines. The proposed

© DSEL

watermain network is expected to deliver all domestic and fire flows as per Ministry of the Environment, Conservation, and Parks (MECP), City of Ottawa and Fire Underwriters Criteria to support development within the SSUEA. Estimated fire flows of 167 L/s and 217 L/s for low density residential and parkland, and medium density residential, respectively, can be achieved for the development and service pressures are expected to fall within the appropriate ranges.

All proposed water infrastructure is to be designed and constructed in accordance with Ministry of the Environment, Conservation, and Parks (MECP) and City of Ottawa guidelines as part of detailed design associated with the SSUEA.

© DSEL

8.0 WASTEWATER SERVICING PLAN

8.1 Existing Wastewater Services

The adjacent developments to the north of the subject lands are serviced by the existing Shea Road Sanitary Pumping Station (SRSPS) which is located along the north boundary within the SSUEA lands being assessed and generally located within the ***Stittsville South Lands*** portion of the development area (North of the existing stormwater management pond (Davidson Pond)). As per the Environmental Compliance Approval (*ECA #3415-ADWLJG*) issued September 21, 2016 (see report excerpt in ***Appendix D.1***), the SRSPS, constructed in 2017, was designed with an interim firm capacity of 42 L/s and upgraded to its current firm capacity of 84 L/s (in accordance with its original design) in late 2022. The SRSPS forcemains were also directed to the most recent extension of the Fernbank Sanitary Trunk Sewer (FSTS).

A 450mm diameter sanitary sewer connected to the SRSPS is available to service the SSUEA. The existing 450mm diameter inlet sanitary sewer has a residual capacity of approximately 80% which would allow for an additional ~390 L/s of sanitary flows which is more than the capacity required.

Per the Master Servicing Report for the *Stittsville South – Area 6* development, there is excess capacity available in the Fernbank Lands trunk sewer (see report excerpt in ***Appendix D.2).*** The *Area 6* study summarized that the Fernbank Trunk was designed for a peak flow of 528 L/s (*Fernbank CDP Lands – New Trunk Sewer* sanitary design sheet provided in ***Appendix D.3*** for reference) and had a capacity of 670 L/s (excess capacity of 142 L/s). The Area 6 report further summarized that the *Area 6* and Liard Street P.S. (monitored) flows to the Fernbank Trunk totaled approximately 85 L/s and 39 L/s respectively and would utilize a portion of this capacity. However, the original design criteria of the Fernbank Trunk system (and Area 6) was based on older City of Ottawa design criteria. When considering the new criteria adopted by the City after those designs the excess capacity available is increased.

Table 6: Sanitary Flow Review

Network Reviewed	Area (ha)	Pop.	PF (7)	Q_{units} (L/s)	$Q_{Com/Inst}$ (L/s)	$Q_{I/I}$ (L/s)	Q_{TOT} (L/s)	Diff. (L/s)
Old City Parameters for Sanitary (1)								
Fernbank CDP Lands (2)	551.8	30,169	2.47	302.5	71.0	154.5	528.0	--
Stittsville Area 6(3)	70.74	4,502	3.29	59.94	2.37	19.81	82.1	--
Liard St P.S. (monitored) (4)	--	--	--	--	--	--	39.0	--

© DSEL

New City Parameters for Sanitary [5]								
Fernbank CDP Lands	551.8	30,169	2.18	213.1	39.76	182.09	435.0	-93.0
Stittsville Area 6	70.74	4,502	2.83	41.2	1.33	23.34	66.0	-16.1
Liard St P.S. (monitored) [6]	--	--	--	--	--	--	39.0	0

(1) Old City Parameters: 350 L/day; 0.28 L/s/ha infiltration; Comm./Inst. Flow = 50,000 l/ha/day
(2) Sanitary design sheet excerpt provided in Appendix B. From "Fernbank Community Design Plan – Master Servicing Study (June 2009)"
(3) Sanitary design sheet excerpt from updated IB design for Edenwylde development. From City submission 2020-04-09"
(4) Liard Street pump station – monitored flow summary from the "*West Urban Community – Wastewater Collection System Master Servicing Plan*" by RV Anderson Associates Ltd., dated July 2012 and as summarized in the Area 6 MSS.
(5) New City Parameters: 280 L/day; 0.33 L/s/ha infiltration; Comm./Inst. Flow = 28,000 l/ha/day; updated Peak Factor correction factor
(6) Same value as prior as it was monitored information.
(7) Peaking Factor

From the table above the flow summarized in the Fernbank Lands trunk is reduced from 528.0 L/s to ~435.0 L/s (-93.0 L/s) based on review with new parameters.
The Area 6 land development flows are reduced from 82.1 L/s to ~66.0 L/s (-16.1 L/s).

The *Area 6 MSS* summarized excess capacity at peak flow in the Fernbank Lands trunk at 142 L/s. With the new parameters this excess capacity increases to 235 L/s based on the above table with 105 L/s of that taken up by the Area 6 and the Liard St. P.S. flows (130 L/s capacity remaining).

8.2 Wastewater Design Criteria

The City of Ottawa *Sewer Design Guidelines* are to be used to design the SSUEA wastewater conveyance systems. The criteria employed in the preliminary design of the proposed wastewater system are summarized in ***Table 9.***

Table 7: Wastewater Design Criteria

Design Parameter	Value
Current Design Guidelines	
Residential - Single Family	3.4 p/unit
Residential – Townhome/ Semi	2.7 p/unit
Residential – Apartment	1.8 p/unit
Average Daily Demand	280 L/d/per
Peaking Factor	Harmon's Peaking Factor. Max 4.0, Min 1.0
Infiltration and Inflow Allowance	0.33 L/s/ha for all areas
Park Flows	9300 L/ha/d (75 p/acre per Sewer Guidelines Appendix 4-A)
Park Peaking Factor	1.0
Sanitary sewers are to be sized employing the Manning's Equation	$Q = \frac{1}{n} AR^{2/3} S^{1/2}$
Minimum Sewer Size	200mm diameter
Minimum Manning's 'n'	0.013
Minimum Depth of Cover	2.5m from crown of sewer to grade

© DSEL

Minimum Full Flowing Velocity	0.6m/s
Maximum Full Flowing Velocity	3.0m/s
Extracted from Sections 4 and 6 of the City of Ottawa Sewer Design Guidelines, October 2012, and recent residential subdivisions in City of Ottawa.	
Operational Parameters on Monitoring Data ***(Example Only, Values to be Reviewed on Case-by-Case Basis with City of Ottawa)***	
Average Daily Demand	280 L/d/per
Harmon – Correction Factor	0.4 to 0.6
Commercial / Institutional Peak Factor	1 (non-coincident peak)
Extracted from Sections 4 and 6 of the City of Ottawa Sewer Design Guidelines, October 2012, and recent residential subdivisions in City of Ottawa.	

The City of Ottawa *Sewer Design Guidelines* state that wherever possible, the design of sanitary sewers should be based on the ultimate sewage flows permitted by the land use zoning. The preferred concept plan and associated population projections, detailed in ***Section 1.5*** of this report, represent the best available planning information and thus have been used for the purpose of sizing the proposed trunk sanitary sewer network. A summary of the associated design assumptions is provided below:

- **Low Density Residential Areas:** Based on the unit type areas available from the preferred concept plan, as well as the population densities from the City of Ottawa *Sewer Design Guidelines* (single family – 3.4p/unit, townhomes – 2.7p/unit, back-to-back townhomes – 2.1 p/unit, apartments 1.8 p/unit), a population density of 148 pop/gross ha was assigned to all low-density residential areas.
- **Medium Density Residential Areas:** Based on the unit type areas available from the preferred concept plan, as well as, the population densities from the City of Ottawa *Sewer Design Guidelines* (single family – 3.4p/unit, townhomes – 2.7p/unit, back-to-back townhomes – 2.1 p/unit, apartments 1.8 p/unit), a population density of 144 pop/gross ha was assigned to all medium density residential areas. Applying the 221 pop/gross ha density to the medium density areas allows for more flexibility in the future design of the medium density blocks.

Note that with the use of the population densities reported above, the population may differ from the populations reported in ***Section 1.5.*** The populations used for the wastewater servicing design are conservative in nature to allow for the sanitary sewer networks to accommodate potential changes in population and servicing demand estimates at the detailed design level, as site-specific designs advance.

8.3 SSUEA Wastewater Servicing

Sanitary sewer routing and sizes have been preliminarily proposed as part of MSS-level design, to meet City and MECP guidelines. The preferred trunk wastewater design follows and ultimately connects to the existing 450 mm diameter PVC sanitary sewer

© DSEL

which conveys flows to the SRSPS based on the layout presented in ***Drawing No. 4***. The preferred design is a sanitary network that makes efficient use of existing SRSPS pump station and applicable downstream infrastructure.

8.3.1 SSUEA Wastewater Servicing Options

The following options were evaluated for sanitary servicing for the ***West/South Lands***:

Option 1: Gravity sanitary flows for ***Stittsville West/South Land*** areas to the existing SRSS along with:

a. Upgrades to the SRSPS to accommodate new flows (pumps, instrumentation, electrical, generator etc);
b. Utilization of existing forcemains to the FSTS (pending capacity review);
c. Construction of a new emergency overflow to a future stormwater management pond (SWMP) for the ***SSUEA*** to allow for lower underside of footings for the development.

Option 2: Construction of a new sanitary pump station within the southern portion of the ***South Lands*** along with:

a. Forcemains pumping flows to the existing SRSPS;
b. Upgrades to the SRSPS to accommodate new flows (pumps, instrumentation, electrical, generator etc);
c. Utilization of existing forcemains to the Fernbank Sanitary Trunk Sewer (FSTS);
d. Construction of a new emergency overflow to a future stormwater management pond (SWMP) to allow for lower underside of footings for new development.

Option 3: Construction of a new sanitary pump station within the southern portion of the ***South Lands*** which would accept all sanitary flows within the service area along with:

a. Decommissioning of the existing SRSPS;
b. Extension of gravity sewers to the new pump station;
c. Utilization of existing forcemains to the Fernbank Sanitary Trunk Sewer (FSTS);
d. Construction of a new emergency overflow to a future stormwater management pond (SWMP) to allow for lower underside of footings for new development.

Option 4: Similar to Option 3 above with the difference of implementing construction of new, independent, twin forcemains to the FSTS via Shea and Fernbank Roads (i.e. should the existing forcemains be found not suitable due to the additional head required to pump from the southern area).

© DSEL

Option 5: Construction of a new sanitary pump station within the southern portion of the ***South Lands*** which would be independent of the SRSPS:

a. SRSPS is not touched;
b. Construct new, independent, twin forcemains to the FSTS via Shea and Fernbank Roads;
c. Independent emergency overflow to a new SWMP.

8.3.2 Preferred Wastewater Servicing Plan

Of the various options reviewed, it was concluded that **Option 1** is the preferable approach/configuration. This option mitigates additional costs, utilizes/optimizes existing infrastructure and does not add additional uncertainty into the advancement of development. This is option is also consistent with the City's *Infrastructure Master Plan, Draft Final (July 2024*) which includes costs for the SRSPS and forcemain upgrades as part of its Wastewater Master Plan (Collection) Capital Program. See excerpts from the Draft IMP included ***Appendix D.7***.

See attached ***Drawing No. 4*** for an overview of the proposed trunk sanitary network.

8.3.2.1 West Lands Preferred Wastewater Servicing Plan

Proposed trunk sanitary sewers within the Stittsville West Lands are shown in ***Drawing No. 4***. To demonstrate servicing feasibility, the trunk sewer is carried back at minimum slopes while accounting for drops at manholes, existing infrastructure sizing, and possible conflicts with crossing other sewers. As the design of the ***West Lands*** advance, the sanitary sewer network details are subject to change; for example, to be raised where appropriate to offer construction cost savings, provided that conditions related to minor changes are met.

The peak sanitary flow from the Stittsville ***West Lands*** are expected to be 44.11 L/s. See ***Appendix D*** for detailed calculations.

8.3.2.2 South Lands Preferred Wastewater Servicing Plan

Proposed trunk sanitary sewers within the Stittsville South Lands are shown ***Drawing No. 4***. To demonstrate servicing feasibility, the trunk sewer is carried back at minimum possible slopes while accounting for drops at manholes, existing infrastructure sizing, and possible conflicts with crossing other sewers. As the design of the Stittsville South Lands advance, the sanitary sewer network details are subject to change; for example, to be raised where appropriate to offer construction cost savings, provided that conditions related to minor changes are met.

© DSEL

The peak sanitary flow from the Stittsville ***South Lands*** are expected to be 37.21 L/s. See ***Appendix D.4*** for the sanitary trunk sewer design sheet calculations.

8.3.3 Sanitary Flow Review

As noted in ***Section 8.1***, the SRSPS was recently upgraded to a firm capacity of 84 L/s. Buildout of the tributary areas to the SRSPS is ongoing, however there remains excess capacity available in the facility prior to any further upgrade/expansion being required. Novatech (the original designers of the SRSPS) have reviewed staged flows to the SRSPS with consideration given to inclusion of flows from the ***Stittsville West/South Lands*** development area under various flow conditions. The evaluation of various flow conditions (as often required by the City) considered the following:

a) Condition 1 – Design Flow Parameters for Occupied & Unoccupied
b) Condition 2 – Annual flow Parameters for Occupied & Design Parameters for Unoccupied
c) Condition 3 – Annual flow Parameters for Occupied & Unoccupied
d) Condition 4 – Rare Parameters for Occupied & Unoccupied

(Design Parameters meaning standard design guideline values for design of sewers and pumping stations; Annual Parameters meaning typical flows based on data, and Rare Parameters meaning exceptional events)

Based on proposed conceptual development layout and density, the SSUEA has a projected population potential and effective extraneous area of ~5,760 persons and 64.2 ha (excluding HONI corridor and ponds), respectively. The theoretical peaked flow for the SSUEA, not considering peaking factors from external areas, is approximately 70 L/s.

With consideration to ongoing development, and existing lands, that are currently allocated as being tributary to the SRSPS (i.e. Area 6 development, redirected flows from the planned decommissioning of the Friendly Street Sanitary Pump Station etc.) the maximum required firm capacity of an updated SRSPS will be approximately 130 L/s.

8.3.4 SRSPS Anticipated Upgrades

In its May 2023 *Shea Road Pump Station & Fernbank Trunk Capacity Review* Novatech anticipated the following anticipated SRSPS upgrades to accommodate a new firm capacity (See ***Appendix D.6*** for further details):

Certain Upgrades:

- Higher horsepower pumps;

© DSEL

- Starters; and
- Power to pumps.

More than Likely Upgrades:

- New generator.

Possible Upgrades:

- Primary power supply and 600V wiring; and
- Upsize 150mm piping between wet well and valve chamber and within basement.

Current Configuration Likely Sufficient:

- Controls;
- 200mm forcemain (need to demonstrate that surge pressures will not be an issue due to higher velocities; the theoretical velocity will be confirmed by a transient analysis as part of the detailed design for the SRSPS upgrades);
- Wet well (as long as new pumps fit and operating volumes are adjusted);
- Control room; and
- Bypass chamber.

Existing SCADA data for the current wastewater flows to the SRSPS will need to be reviewed further during the Draft Plan stage, prior to detailed design, to determine residual capacity and timing for future upgrades.

8.3.5 Consideration of Alternatives for Sanitary Servicing Design

Wastewater sewer sizing and routing were reviewed as part of MSS-level design, to address all City of Ottawa and MECP requirements. Given the background infrastructure planning in this area and the predicted performance, no other logical or efficient alternative designs were advanced for additional analysis and evaluation.

8.4 Commitments for Functional and Detailed Design

The wastewater conveyance systems will be designed to support the phased developments within the SSUEA lands. All proposed sanitary sewer infrastructure is to be designed in accordance with the City of Ottawa Sewer Design Guidelines and all MECP guidelines.

The proposed gravity sewer conveyance systems are shown to generally follow the proposed road network. Note that as the road network is conceptual in nature, the alignments of the trunk sanitary sewers are also subject to change. Easements may be required in order to provide efficient servicing to address City and MECP guidelines.

© DSEL

During design of the development within the SSUEA lands:

- Demands will be updated and distribution refined, once the more detailed development information is available;
- Design parameters according to City of Ottawa Sewer Design Guidelines will be used;
- Design of the trunk sewers are to be optimized for construction efficiencies, provided that there are no significant negative impacts to affected landowners and that other requirements for minor amendments are met;
- Local sanitary sewer sizing will need to be evaluated at the subdivision approval stage; and
- Capacity in downstream infrastructure will be confirmed through sanitary sewer network modelling, as-builts, and/or sanitary design sheet information, as required.
- Shea Road Sanitary Pump Station upgrade requirements will be reviewed from a timing and cost perspective.

8.5 Wastewater Servicing Conclusion

The design of the sanitary sewer network is in accordance with the City of Ottawa Sewer Design Guidelines.

The West and South Lands within the SSUEA are tributary to the Shea Road Sanitary Pump Station (SRSPS) and Fernbank Trunk sanitary sewer. The South and West Lands are to be directed to the Shea Road Sanitary Pump Station via the proposed trunk sanitary infrastructure as outlined in ***Drawing No. 4***. Adequate residual capacity is available within the receiving downstream infrastructure and it can be concluded that the downstream infrastructure can adequately service the SSUEA lands. To support the full proposed development, the SRSPS will require upgrades to increase the PS firm capacity. There is currently excess capacity to accommodate the first phases of development and the timeline for staged upgrades will be reviewed as part of the FSR and detailed design. Additionally, JFSA has provided PCSWMM modelling to analyze the sanitary HGL elevations within the proposed development lands based on the flow details previously provided. From JFSA's analysis, it was found that the proposed existing sanitary sewer infrastructure is sufficiently sized to convey sanitary flows away from the proposed development under various extreme conditions. Please see the JFSA report in ***Appendix E.1*** for additional details. Note that updated HGL analyses will be provided at the functional and detailed design stage as additional details are established.

© DSEL

All proposed sanitary sewer infrastructure is to be designed and constructed in accordance with the City of Ottawa Sewer Design Guidelines and MECP guidelines as part of detailed design associated with *Planning Act* applications within the SSUEA.

© DSEL

9.0 STORMWATER CONVEYANCE

9.1 Existing Stormwater Drainage

The existing site topography for the subject properties generally drains eastward and southward. As noted previously the site is essentially bisected by an existing drainage watercourse which transitions into the Faulkner Municipal Drain (FMD). See ***Drawing No. 3*** for an overview.

Parade Drive Stormwater Management Facility

The residential development area to the north of the Maguire/Faulkner properties is serviced via an existing 1.9 ha stormwater pond block adjacent to Parade Drive. This stormwater facility has the following characteristics:
Drainage Area = ~33.7ha
Permanent Pool Elevation = 103.50 m
Extended Detention Elevation = 103.70 m
100-Year Elevation = 105.33 m

The facility outlets to an existing ditch located east of the storm outlet approximately 405 m upstream of the commencement of the Faulkner Municipal Drain.

Davidson Stormwater Management Facility
The existing development to the north of the Davidson/Eder properties is serviced by the central "Davidson" stormwater management pond. The existing Davidson stormwater pond occupies approximately 3.2 ha of land and is partially located under the existing Hydro One tower line. The ponds are sized for their respective areas with no specific additional areas considered. This stormwater facility has the following characteristics:
Drainage Area = ~40.6 ha
Permanent Pool Elevation = 101.50 m
Extended Detention Elevation = 102.10 m
100-Year Elevation = 103.17 m

The facility outlets from the south end of its configuration to a ditched outlet that conveys the flows southwest to the Faulkner Municipal Drain.

9.1.1 Faulkner Municipal Drain

Official Plan section 4.7.1(7) requires the applicant demonstrate that a legal and sufficient outlet can be established (not that the outlet *has* been established). Based on preliminary consultation with the City's Municipal Drain group, it is our opinion the subject site has legal and sufficient outlet available in the Faulkner Municipal Drain

© DSEL

(FMD).

Consultation on the municipal drain was initiated in November 2023 with the City of Ottawa. The City noted the Faulkner Municipal Drain (FMD) had recently undergone an upgrades with construction of improvements completed in 2022 and 2023. Based on preliminary review, the City of Ottawa indicated the scope of work would fall under Section 65 of the Drainage Act with updates to the change in land use and incorporation of new connections to the FMD. This may require the City's Drainage Engineer involvement for confirmation of adequate outlet. This process has been initiated as outlined below.

In early 2024, the City of Ottawa provided stormwater management comments including the following direction regarding the municipal drain:

"Post-development discharge criteria will need to factor conveyance constraints along the Faulkner Municipal Drain (MD) along Shea Road, and possibly along the Flowing Creek MD. A request/Petition for a Drainage Engineer should be filed with the City to assist with identifying drainage improvements required to establish a legal and sufficient outlet for the future urban runoff from the expansion lands."

The Drainage Engineer assignment was carried at ARAC on October 3rd, 2024 and will be recommended for consideration to Council on October 9th, 2024.

During a September 2024 meeting, City of Ottawa staff further confirmed that the Drainage Act amendment process for the Faulkner Municipal Drain can proceed in parallel with the development review process and could be addressed in Draft Plan Conditions as required.

The FMD conveys flows from north to south to the Flewellyn Road right-of-way (ROW) then heads eastward along Flewellyn Road until it shifts southwards along the west side of Shea Road. The FMD drain begins at approximately 215 m north of Flewellyn Road (within the development lands) and ultimately discharges to Flowing Creek Municipal Drain 5.45 km away.

Based on the site topography the drainage for the ***Stittsville West Lands*** trends to the southeast where it is picked up by the FMD. The ***Stittsville South Lands*** similarly drain to the southeast and are collected in FMD along the north side of Flewellyn Road and also conveyed to the FMD via the Shea Road ditch.

Due to the presence of this FMD physical constraint within the development areas, an independent stormwater solution for quantity and enhanced water quality control (80% Total Suspended Solids removal) will be required for each of the ***West/South Lands*** areas with the most suitable solution being the incorporation of wet stormwater management facilities.

© DSEL

9.2 SSUEA Stormwater Management Ponds and Servicing Options

There were several options evaluated for stormwater management and servicing for the ***West/South Lands,*** below is an overview of the stormwater servicing opportunities and constraints associated with the development for the SSUEA.

Based on the existing site topography the drainage for the ***West Lands*** trends to the southeast where it is picked up by the FMD. The ***South Lands*** similarly drain to the southeast and are collected in FMD along the north side of Flewellyn Road

The invert of the FMD at the proposed road crossing between the ***West*** and ***South Lands*** is ~101.5m. In order to drain the ***West Lands*** to a pond east of the FMD, DSEL's preliminary analysis found that a storm sewer with a top of pipe elevation of ~102.5m would be required at this crossing which conflicts with the FMD. As such, an independent stormwater solution for quantity and enhanced water quality control will be required for each of the ***West/South Lands*** areas with the most suitable solution being the incorporation of wet stormwater management facilities in the southeast corner of each of each area. This servicing strategy (as outlined in Option 1A) below, was presented to City staff in a February 8, 2024 consultation. While the City agreed this was the most logical servicing strategy, it requested that DSEL assess additional options including the feasibility of combining the proposed facilities and/or decommissioning the City's existing Davidson Pond facility. The results of this analysis are presented below.

A summary of all options evaluated is presented in ***Figure 3***.

9.2.1 Option 1A: Two New SWM Ponds (East Pond on Eder Parcel)

This option consists of maintaining the existing Davidson SWM Pond and constructing two new ponds, one in the southeast corner of the ***West Lands*** and one in the southeast corner of the ***South Lands***. Each pond would outlet to the FMD, with the outlet from for the West facility crossing the HONI corridor. Similar to the existing Davidson Pond it would be proposed to use the Hydro corridor land for 5-year storage.

Under this option, 4.1 Ha of the ***South Lands*** would drain to the existing Davidson Pond.

The unnamed watercourse, upstream of the Faulkner Municipal Drain and downstream of the Area 6 Pond headwall (Inv. 103.20) will be maintained and convey flows through the hydro corridor. This option will provide 56.4 Ha of developable land and have 7.6 Ha of area designated for the SWM ponds, including 2.1 Ha within the Hydro corridor.

© DSEL

Construction of a new emergency overflow to the future stormwater management pond (SWMP) at the south east corner of the development will allow for lower underside of footings for the new development.

This option is shown below in ***Exhibit 2***.

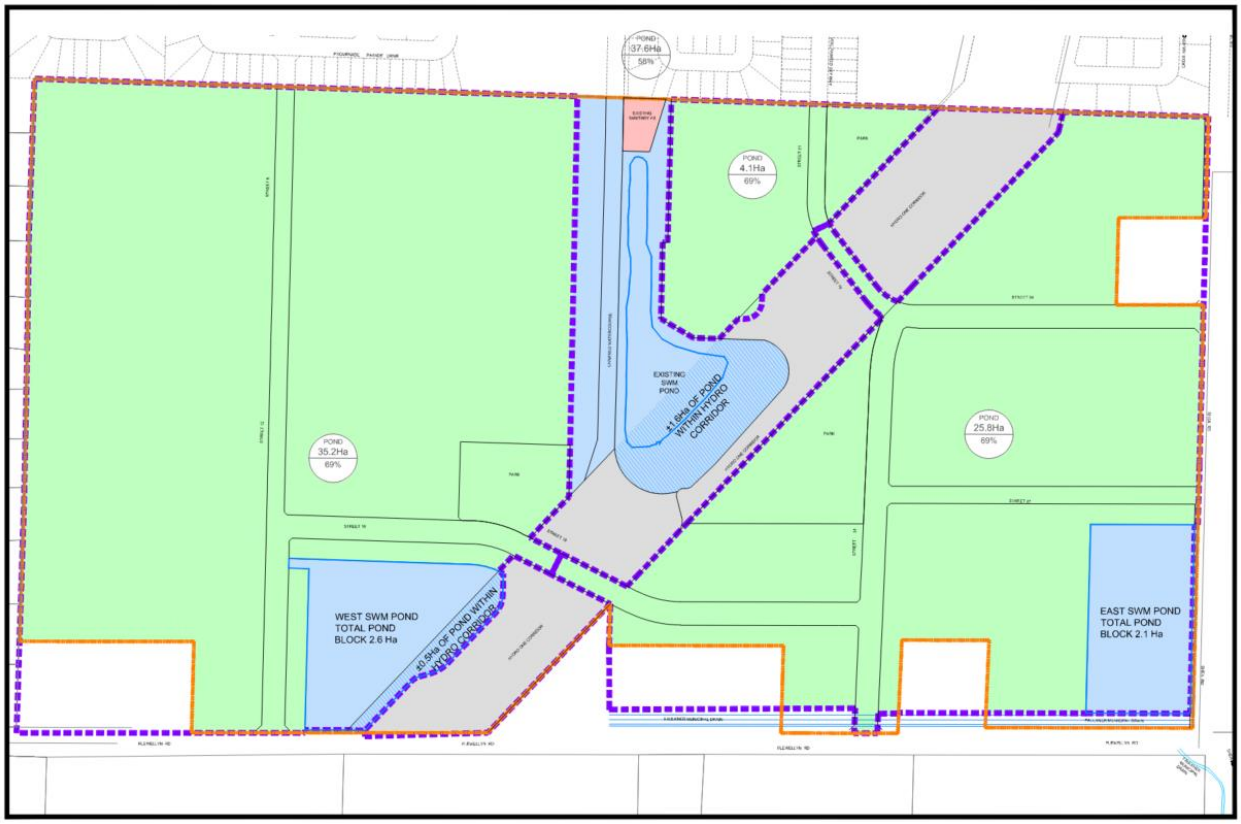

Exhibit 2: Option 1A - Two New SWM Ponds (East Pond on Eder Parcel)

9.2.2 Option 1B: Two New SWM Ponds (East Pond on Davidson Parcel)

Similar to Option 1A but with the East SWMP constructed within the Davidson Lands. This option presents the following constraints/challenges compared to Option 1A:

1) Construction of the pond within the Davidson Lands would be inconsistent with the natural topography/drainage;
2) Significant cost increase due to:
    a. Approximately 175,000 cu.m of addition fill required on the ***South Lands*** to redirect drainage.
    b. Additional retaining walls required along Flewellyn and Shea Roads.

© DSEL

This option is shown below in ***Exhibit 3***.

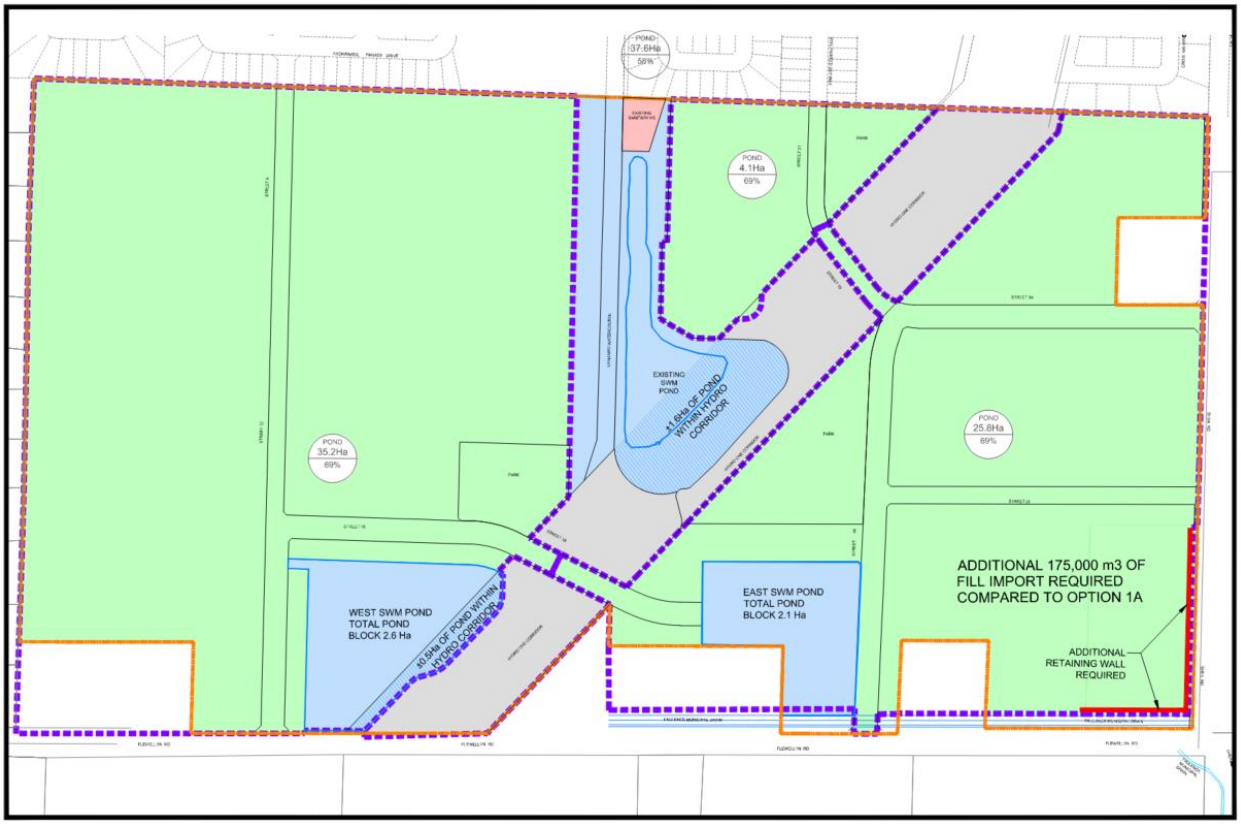

Exhibit 3: Option 1B - Two New SWM Ponds (East Pond on Davidson Parcel)

9.2.3 Option 2A: One SWM Pond and Relocation of Existing Drain (Perimeter Channel)

This option would consist of decommissioning the existing Davidson SWM Pond and constructing one new SWM pond within the ***South Lands***. The unnamed watercourse, upstream of the Faulkner Municipal Drain and downstream of the Area 6 Pond headwall (Inv. 103.20) will be realigned and convey flows along the north and east perimeter of the development. This option will provide 54.9 Ha of developable land and have 6.2 Ha of area designated for the SWM pond.

Construction of a new emergency overflow to the future stormwater management pond (SWMP) at the southeast corner of the development will allow for lower underside of footings for the new development.

© DSEL

The City would decommission its Davidson Pond under this option with its drainage area accommodated by the new pond. In order to remove the constraint caused by the existing FMD, the tributary ditch north of the FMD would be rerouted around the perimeter of the ***South Lands.*** This option presents the following constraints/challenges compared to Option 1A:

1) Rerouted drain requires participation of holdout property;
2) Trunk storm sewer requires non-standard box culvert cross section in order to cross under rerouted drain. Limited cover on storm sewer at crossing (even with box culvert) of ~0.3m;
3) Non-standard pond inlet:
    a. Submerged inlet pipe (invert at pond ~99.5m with PP WL of 100.5m)
    a. Limited cover on sewer (~0.3m)
    b. Inlet pipe invert at ~1.0m above pond bottom;
4) Decrease in net developable area of ~1.5ha when compared to Option 0;
5) Significant cost increase due to:
    a. New channel construction
    b. Davidson Pond decommissioning for future residential development
    c. Additional new pond construction costs to accommodate existing Davidson Pond drainage area.

This option is shown below in ***Exhibit 4***.

© DSEL

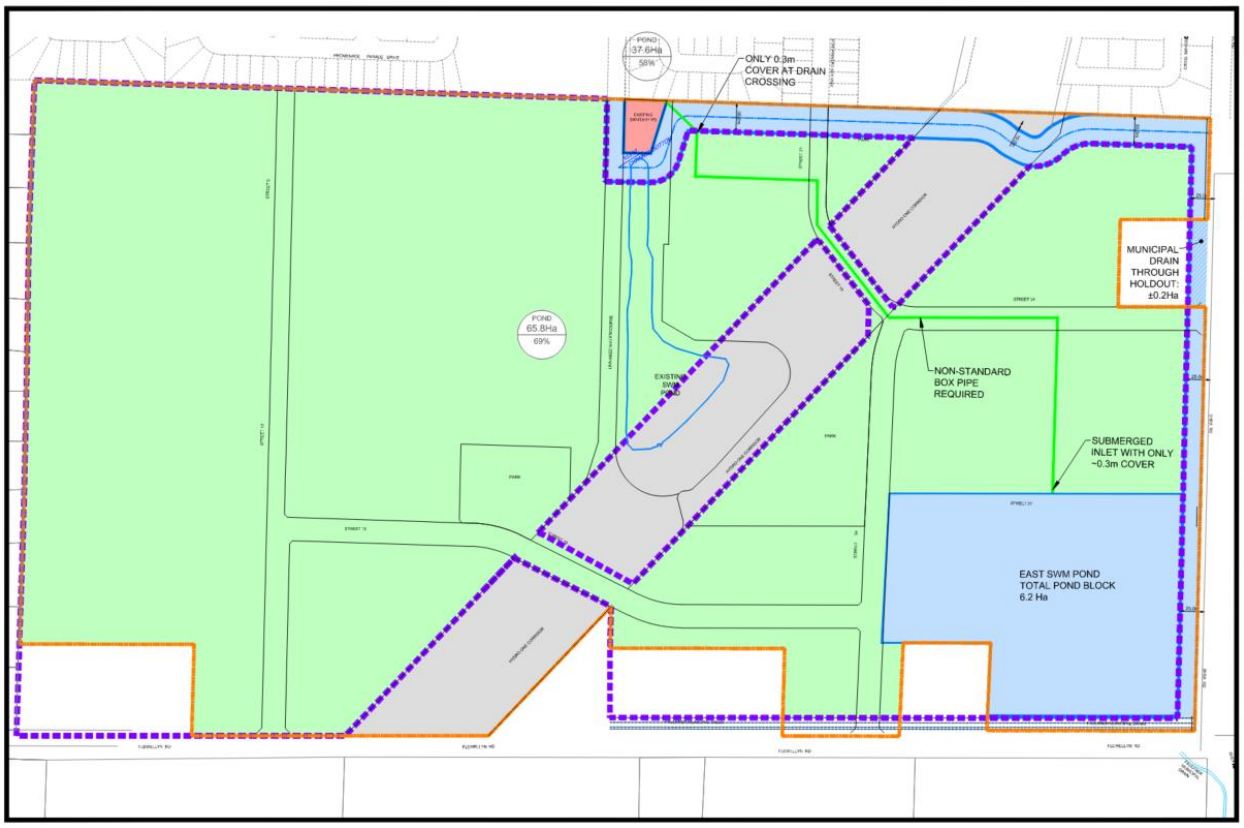

Exhibit 4: Option 2A - One SWM Pond and Relocate Existing Drain (Perimeter Channel)

9.2.4 Option 2B One SWM Pond and Relocation of Existing Drain (Central)

Similar to Option 2A, this option would require decommissioning of the existing Davidson SWM Pond and construction of one new SWM pond within the ***South Lands***. In addition, one new dry pond would be proposed within the Hydro corridor. The unnamed watercourse, upstream of the Faulkner Municipal Drain and downstream of the Area 6 Pond headwall (Inv. 103.20) will be maintained until it intersects the Hydro corridor, and a new channel would be constructed to convey flows easterly to the SWMP at the southeast corner of the development before discharging to the Faulkner Municipal Drain. This option would utilize a Dry Pond within the Hydro corridor for volume storage. This option will provide 54.8 Ha of developable land and have 8.4 Ha of area designated for the SWM ponds.

Construction of a new emergency overflow to the future stormwater management pond (SWMP) at the southeast corner of the development will allow for lower underside of footings for the new development.

The City would decommission its Davidson Pond under this option with its drainage area accommodated by the new pond. Under this option, in order to remove the

© DSEL

constraint caused by the existing FMD, the tributary ditch north of the FMD would be rerouted through the ***South Lands.*** With this configuration, the Hydro corridor could be used for 5-year storage. This option presents the following constraints/challenges compared to Option 1A:

1) Trunk storm sewer requires non-standard box culvert cross section in order to cross under rerouted drain. Limited cover on storm sewer at crossing (even with box culvert) of ~0.3m;
2) Non-standard pond inlet:
    a. Fully submerged pipe (invert at pond ~99.05m with PP WL of 100.5m)
    b. Limited cover on sewer (~0.3m)
    c. Inlet pipe invert at ~0.5m above pond bottom;
3) Decrease in net developable area of ~1.6ha when compared to Option 0;
4) Significant cost increase due to:
    a. New channel construction
    b. Davidson Pond decommissioning for future residential development
    c. Additional new pond construction costs to accommodate existing Davidson Pond drainage area.

This option is shown below in ***Exhibit 5***.

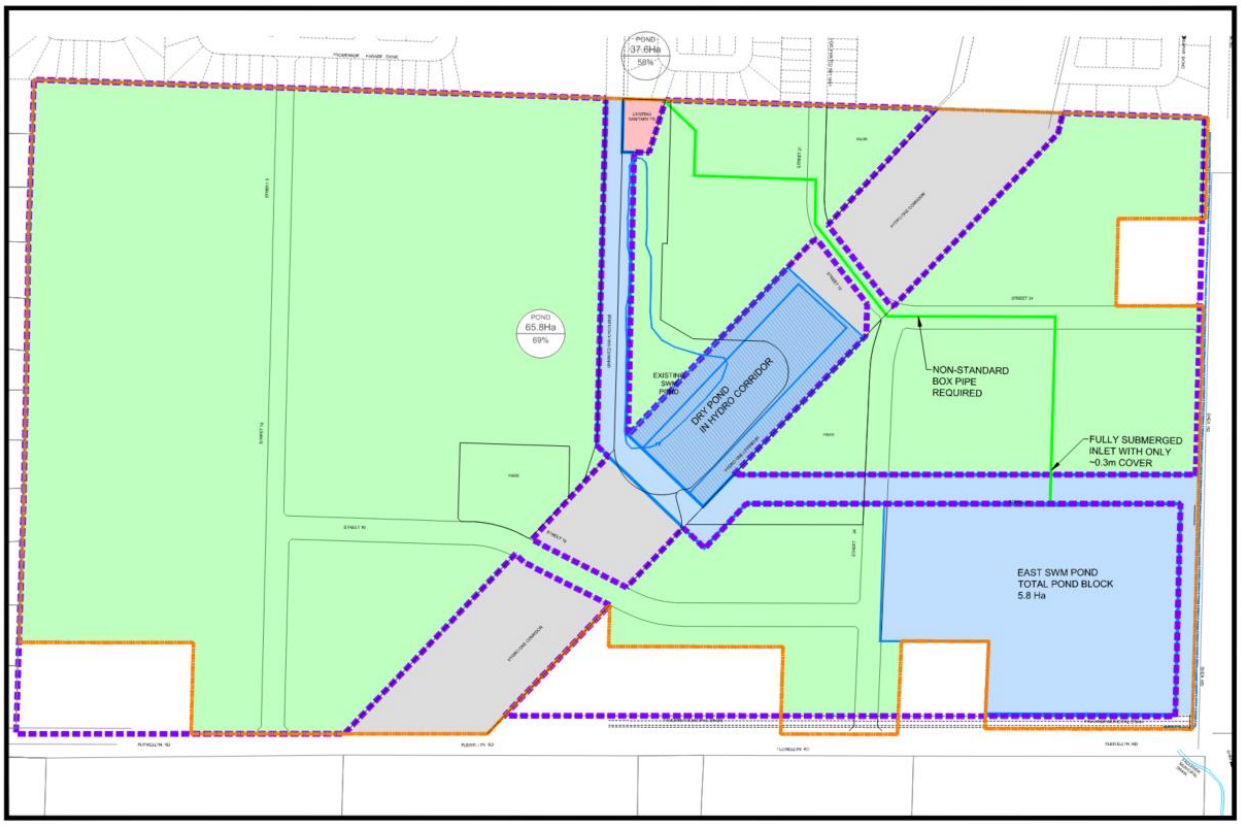

© DSEL

Exhibit 5: Option 2B - One SWM Pond and Relocate Existing Drain (Central Channel)

9.2.5 Option 3: Two SWM Ponds and Decommissioning of Davidson Pond

This option would consist of decommissioning the existing Davidson SWM Pond and constructing two new SWM ponds, one in the southeast corner of the ***West Lands*** and one in the southeast corner of the ***South Lands***. The unnamed watercourse, upstream of the Faulkner Municipal Drain and downstream of the Area 6 Pond headwall (Inv. 103.20) will be maintained and convey flows through the hydro corridor to the Faulkner Municipal Drain. This option will provide 55.4 Ha of developable land and have 7.0 Ha of area designated for the SWM ponds, including 0.5 Ha within the Hydro corridor.

Construction of a new emergency overflow to the future stormwater management pond (SWMP) at the southeast corner of the development will allow for lower underside of footings for the new development.

Under this option, the ditch tributary to the FMD would remain in its current location. This option presents the following constraints/challenges compared to Option 1A:

1) Decrease in net developable area of ~1.0ha when compared to Option 1A;
2) Significant cost increase due to:
    a. Davidson Pond decommissioning for future residential development
    b. Additional new pond construction costs to accommodate existing Davidson Pond drainage area.

This option is shown below in ***Exhibit 6***.

© DSEL

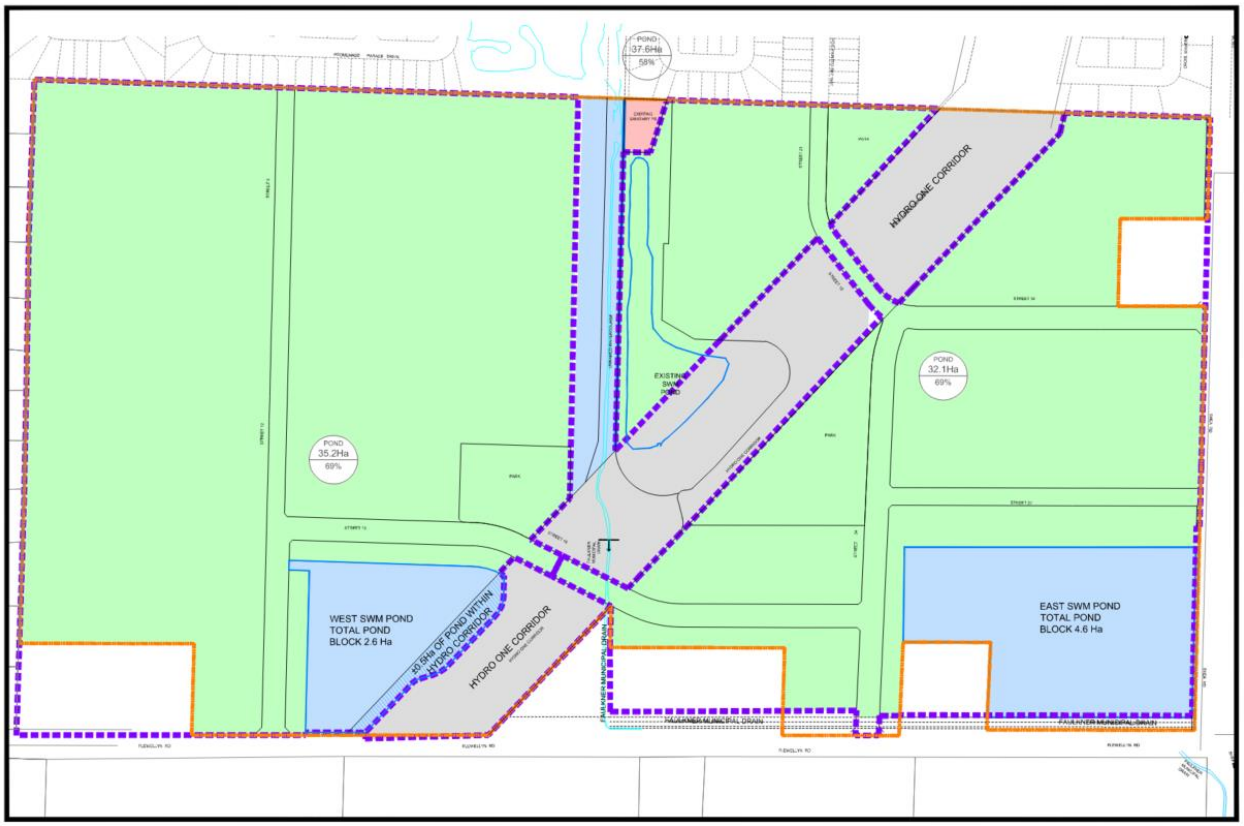

Exhibit 6: Option 3 - Two SWM Ponds and Decommissioning of Davidson Pond

9.2.6 Cost Comparison

A comparison of estimated SWM Pond costs for each option was prepared based on costs for similar work and summarized in ***Table 8*** below.

Table 8: Summary of Estimated SWM Costs

© DSEL

			Option 1A		Option 1B		Option 2A		Option 2B		Option 3	
Estimated SWM Costs	**Unit**	**Unit Cost**	**Quantity**	**Estimated Cost**	**Quantity**	**Estimated Cost**	**Quantity**	**Estimated Cost**	**Quantity**	**Estimated Cost**	**Quantity**	**Estimated Cost**
SWM Pond	ha	$ 1,875,000	5.20	$ 9,750,000	5.20	$ 9,750,000	6.20	$ 11,625,000	8.40	$ 15,750,000	7.00	$ 13,125,000
SWM Pond Channel	m	$ 3,000	-	$ -	-	$ -	1,200	$ 3,600,000	800	$ 2,400,000	-	$ -
SWM Total				*$ 9,750,000*		*$ 9,750,000*		*$ 15,225,000*		*$ 18,150,000*		*$ 13,125,000*
City Costs for Davidson Pond Decommissioning	Allowance	$ 2,100,000	-	$ -	-	$ -	1	$ 2,100,000.00	1	$ 2,100,000.00	1	$ 2,100,000.00
	Total Estimated SWM Costs		**$**	**9,750,000.00**	**$**	**9,750,000.00**	**$**	**17,325,000.00**	**$**	**20,250,000.00**	**$**	**15,225,000.00**

9.2.7 Preferred SWM Pond Alternative

Due to the technical, cost and land ownership constraints presented above, *Option 1A – Two New SWM Ponds (East Pond on Eder Parcel)* remains the preferred stormwater servicing strategy for the Stittsville South Urban Expansion Area. This alternative minimizes new stormwater facility and channel construction and utilizes capacity in the existing Davidson Pond. As shown in ***Table 8*** above, this option presents the lowest overall SWM servicing cost. While the estimated stormwater costs for Option 1B are shown as equivalent to Option 1A, this alternative is not consistent with the existing site topography and would require significant additional costs, beyond SWM facility costs, for fill import and retaining walls.

9.2.7.1 South Lands

Stormwater flows from the existing development to the north of the ***South Lands*** is serviced by the existing Davidson SWM Pond. The existing Davidson SWM Pond was sized for its contributing area at the time of its construction and did not specifically account for other development areas.

The facility outlets from the south end of its configuration to a ditched outlet that conveys the flows southwest to the Faulkner Municipal Drain. Preliminary review of the Davidson SWM Pond indicates that it has the potential to accept additional flows from the ***South Lands*** development area.

The full extent of area that can be directed to the Davidson SWM Pond still has to be fully vetted but it is anticipated that a minimum of ~4.0 ha of SSUEA ***South Lands*** could be accommodated (assuming imperviousness of 58%). JFSA reviewed the capacity of of the Davidson Pond in its *Conceptual SWM Ponds and Preliminary HGL Analysis (JFSA, November 2023)* memo and concluded that the pond can accommodate this additional drainage area with minor modifications to the outlet structure. A detailed analysis of the pond operation to assess the release rates, pond water levels and HGL elevations within the proposed and existing development will be completed as part of the design process.

The remainder of the ***South Lands*** development area will ultimately require the construction of a new stormwater management facility (SWMF) utilizing the FMD as its outlet. The facility will be required to provide an enhanced level of protection as well as

© DSEL

providing 2-, 5- and 100-year target release rates and would most appropriately be located in the southeast portion of the property abutting the Flewellyn Road ROW.

9.2.7.2 West Lands

The development of ***West Lands*** will require the construction of a new stormwater management facility utilizing the FMD as its outlet. The facility will be required to provide an enhanced level of protection as well as providing 2-, 5- and 100-year target release rates and would most appropriately be located in the southeast portion of the property abutting the HONI corridor easement. The outlet from the SWMF would preferably cross the HONI corridor in order to outlet to the FMD.

An update to the Drainage Engineer's report for the FMD would be required as part of the proposed new pond outlet to the FMD.

9.3 Post-Development Stormwater Management Targets

Stormwater management requirements for the proposed alternative Stormwater management scheme have been adopted from the ***Jock River Reach 2 Subwatershed SWS***, City of Ottawa ***Sewer Design Guidelines*** and the ***MECP SWMP Manual***.

Given the general criteria mentioned above, the following specific standards are applied for stormwater management within the subject property:

- Enhanced quality treatment will be provided for stormwater runoff from the subject property, corresponding to a long-term average Total Suspended Solid removal efficiency of 80%, as defined by the MECP prescribed treatment levels.
- Downstream receiving watercourses will be assessed for responses to planned stormwater management outflows, and stabilization mitigation measures will be planned as required.
- Storm sewers on local roads are to be designed to provide at least a 2-year level of service without any ponding per the City's latest Technical Bulletin PIEDTB-2016-01.
- Storm sewers on collector roads are to be designed to provide at least a 5-year level of service without any ponding per the City's latest Technical Bulletin PIEDTB-2016-01.
- For less frequent storms (i.e. larger than 2-year or 5-year), the minor system sewer capture will be restricted with the use of inlet control devices to prevent excessive hydraulic surcharges.
- Under full flow conditions, the allowable velocity in storm sewers is to be no less than 0.80 m/s and no greater than 6.0 m/s.

© DSEL

- For the 100-year storm and for all roads, the maximum depth of water (static and/or dynamic) on streets, rear yards, public space and parking areas shall not exceed 0.35 m at the gutter.
- The major system shall be designed with sufficient capacity to allow the excess runoff of a 100-year storm to be conveyed within the public ROW or adjacent to the right-of-way provided that the water level must not touch any part of the building envelope, must remain below all building openings during the stress test event (100-year + 20%), and must maintain 15 cm vertical clearance between spill elevation on the street and the ground elevation at the nearest building envelope.
- Flow across road intersections shall not be permitted for minor storms (generally 5-year or less).
- When catch basins are installed in rear yards, safe overland flow routes are to be provided to allow the release of excess flows from such areas. A minimum of 30 cm of vertical clearance is required between the rear yard spill elevation and the ground elevation at the adjacent building envelope.
- The product of the maximum flow depths on streets and maximum flow velocity must be less than 0.60 m^2/s on all roads.

9.3.1 Quality Control

Per the ***Jock River Reach 2 SWS***, prior to discharge to the receiver, quality treatment of stormwater runoff from the subject property is to be provided to meet the MECP Enhanced Protection criteria, corresponding to a long-term average Total Suspended Solid removal efficiency of 80%.

9.3.2 Quantity Control

Quantity control will be provided by the proposed West and South (JFSA's EAST) SWM facilities and the existing Davidson SWM facility. Peak flows will be attenuated by these facilities in order to ensure erosion concerns are mitigated downstream in the FMD.

9.4 Stormwater Management Design

9.4.1 Proposed Minor System

The subject property will be serviced by an internal gravity storm sewer system that is to generally follow the local road network and proposed servicing easements as required. The drainage will be conveyed within the underground piped sewer system to outlets located along the natural heritage corridor, providing hydration to wetlands. There will also be proposed outlets to the Faulkner Municipal Drain in order to provide some

© DSEL

baseflow to that feature (per City comments) along with rear yard sheet flow from lots backing onto the watercourse.

Street catchbasins will collect drainage from the streets and front yards, while rear yard catchbasins will capture drainage from backyards. Perforated catch basin leads will be provided in rear yards, except the last segment where they connect to the right-of-way which will be solid pipe, per City standards.

The preliminary rational method design of the minor system captures drainage for storm events up to and including the 2-year (local), 5-year (collector) and 10-year (arterial) event assuming the use of inlet control devices (ICD) for all catch basins within the subject property. The following table summarizes the standards that will be employed in the detailed design of the storm sewer network. The drainage area plans and rational method design sheets are provided in ***Appendix E.2***.

Table 9: Storm Sewer Design Criteria

Design Parameter	Value
Minor System Design Return Period	1:2 year (PIEDTB-2016-01) for local roads, without ponding 1:5 year (PIEDTB-2016-01) for collector roads, without ponding 1:100 year (PIEDTB-2016-01) for arterial road, without ponding
Major System Design Return Period	1:100 year
Intensity Duration Frequency Curve (IDF) 2-year storm event: A=732.951 | B=6.199 | C=0.810 5-year storm event: A = 998.071 | B = 6.053 | C = 0.814	$i = \frac{A}{(t_c + B)^C}$
Minimum Time of Concentration	10 minutes
Rational Method	$Q = CiA$
Storm sewers are to be sized employing the Manning's Equation	$Q = \frac{1}{n} A R^{2/3} S^{1/2}$
Runoff coefficient for paved and roof areas	0.9
Runoff coefficient for landscaped areas	0.2
Minimum Sewer Size	250 mm diameter
Minimum Manning's 'n' for pipe flow	0.013
Minimum Depth of Cover	1.5 m from crown of sewer to grade
Minimum Full Flowing Velocity	0.8 m/s
Maximum Full Flowing Velocity	6.0 m/s
Clearance from 100-Year Hydraulic Grade Line to Building Opening	0.30 m
Max. Allowable Flow Depth on Municipal Roads	35 cm above gutter (PIEDTB-2016-01)
Extent of Major System	To be contained within the municipal right-of-way or adjacent to the right-of-way provided that the water level must not touch any part of the building envelope

© DSEL

	and must remain below the lowest building opening during the stress test event (100-year + 20%) and 15cm vertical clearance is maintained between spill elevation on the street and the ground elevation at the nearest building envelope (PIEDTB-2016-01)
Stormwater Management Model	DDSWMM (release 2.1), SWMHYMO (v. 5.02) and XPSWMM (v. 10)
Model Parameters	Of = 76.2 mm/hr, Fc = 13.2 mm/hr, DCAY = 4.14/hr, D.Stor.Imp. = 1.57 mm, D.Stor.Per. = 4.67 mm
Imperviousness	Based on runoff coefficient (C) where Percent Imperviousness = (C - 0.2) / 0.7 x 100%.
Design Storms	Chicago 3-hour Design Storms and 24-hour SCS Type II Design Storms. Maximum intensity averaged over 10 minutes.
Historical Events	July 1st, 1979, August 4th, 1988 and August 8th, 1996
Climate Change Street Test	20% increase in the 100-year, 3-hour Chicago storm
Extracted from City of Ottawa Sewer Design Guidelines, October 2012, and ISSU, based on recent residential subdivisions in City of Ottawa.	

The following key City standards will be required for stormwater management within the subject lands and conveyance to the proposed stormwater management ponds, among other requirements:

- For less frequent storms (i.e. larger than the minimum level of service), the minor system sewer capture will be restricted with the use of inlet control devices to prevent excessive hydraulic surcharges;
- When catchbasins are installed in rear yards, safe overland flow routes are to be provided to allow the release of excess flows from such areas. A minimum of 30 cm of vertical clearance is required between the rear yard spill elevation and the ground elevation at the adjacent building envelope; and,
- The product of the maximum flow depths on streets and maximum flow velocity must be less than 0.60 m^2/s on all roads.

The following additional grading criteria and guidelines will be applied to the detailed grading designs as per City of Ottawa Guidelines:

- Driveway slopes will have a maximum slope of 6%;
- Slope in grassed areas will be between 2% and 5%;
- Grades in excess of 7% will require terracing to a maximum of a 3:1 slope;
- Swales are to be 0.15 m deep with 3:1 side slopes unless otherwise indicated; and,
- Perforated pipe will be required for drainage swales if they are less than 1.5% in slope (preferred to promote infiltration) and will be used to interconnect rear yard catchbasins where possible.

© DSEL

Conservative average runoff coefficients (C) values have been applied according to the conceptual land uses and the amount of impervious area in each catchment:

- **Low Density Residential Areas:** The Concept Plan designates these areas for detached dwellings, semi-detached dwellings. These areas have been assigned an average runoff coefficient of 0.68 to account for impervious surfaces (driveways, roads, roofs) and pervious areas (backyards). This C value is representative of Caivan's developments in other parts of Ottawa.
- **Medium Density Residential Areas:** The Concept plan designates these areas rear-lane townhomes, back-to-back townhomes, stacked townhomes, back-to-back stacked townhomes, low-rise and mid-rise apartment buildings. These areas have conservatively been expected to have a small number of pervious surfaces. As such, an average runoff coefficient of 0.7 has been assigned. These C values are representative of recently approved studies of a similar scope to this MSS.
- **Park Blocks:** These blocks have been assigned an average runoff coefficient of 0.4, associated with maintained grass lawns.

MECP has indicated a priority to prepare communities for the costs and impacts of climate change, including lowering the risk of basement flooding. As part of this MSS, the City of Ottawa's climate change stress test (100-year 3-hour Chicago storm plus 20%) has been applied in the sections that follow, to confirm that no basement flooding and no unacceptable surface flooding is expected in this test condition.

As detailed design progresses, the runoff coefficients will be refined to reflect the proposed building envelopes, driveways and other details.

The preliminary conceptual servicing plan is shown on ***Drawing No.2***. As detailed design progresses, alignment and sizing of local storm sewers will be confirmed and additional servicing easements may be required, guiding the development of the future proposed lot fabric in the concept plan.

9.4.2 Proposed Major System

Major system conveyance, or overland flow (OLF), will be provided to accommodate flows in excess of the minor system capacity. OLF is accommodated by generally storing stormwater up to the 100-year design event in road sags then routing additional surface flow along the road network and service easements towards the proposed naturalized wetlands, discharging to the FMD, as shown on ***Drawing No.2***.

© DSEL

The detailed grading design will include a saw-toothed-road design with 0.10 % minimum grade from highpoint to highpoint, in order to maximize available surface storage for management of flows up to the 100-year design event where possible.

Given the elements above, the proposed drainage systems are expected to safely capture and convey all storms up to and including the 100-year event in accordance with the requirements of the City Standards.

9.5 Proposed Grading

A site grading approach has been developed to provide major system conveyance to the receiving outlets at the proposed SWM wetland facilities, will outlet to the existing FMD drainage network. The proposed grading plan can be seen on ***Drawing No.1***.

Paterson completed geotechnical investigations for the subject site.

The geotechnical conditions are described in detail in ***Section 3.2 and 3.3.*** For the SSUEA there is generally no raise restriction based on subsurface conditions for most of the site. Within an isolated area of the eastern portion of the site there were indications of a minor discontinuous clay seam that may require a 2 m restriction, but the area will have to be reviewed further in later stages to assess its extent and the possibility of mitigation measures. Any actual exceedances will ultimately be determined at detailed design at which time review and signoff by a licensed Geotechnical Engineer will be required.

The following additional grading criteria and guidelines will be applied to detailed design, per ***City of Ottawa Guidelines***:

- Driveway slopes will have a maximum slope of 6%;
- Grading in grassed/landscaped areas to range from 2% to 3:1, with terracing required for slopes larger than 7%;
- Swales are to be 0.15m deep with 3:1 side slopes unless otherwise indicated on the drawings; and,
- Perforated pipe will be required for drainage swales if they are less than 1.5% in slope.

The conceptual grading plans for the subdivision have been prepared with the objective of site elevations being kept as low as possible to minimize the importation of fill material.

9.6 Low Impact Development (LID) - Infiltration

The following general Low Impact Development techniques should be considered for implementation, where possible, as part of detailed design:

© DSEL

- Rear-yard swales should be designed with minimum grades where possible, to promote infiltration;
- Rear-yard catchbasin leads should be perforated (except for the last segment connecting to the storm sewer within the right-of-way), to promote infiltration; and,
- Where eavestroughs are provided on residential units, they are to be directed to landscaped surfaces, to promote infiltration.
- Furthermore, the following techniques can be examined as part of detailed landscaping design of the park block:
- Amended topsoil (minimum 300mm thick) can be considered for use;
- Micro-grading can be considered to promote infiltration; and

Although Best Management Practices (BMPs) should be implemented, where feasible, the site is not conducive for infiltration based on the soil conditions and the Paterson conclusion that subsurface flows are generally horizontal with a gradient towards the FMD.

9.7 Commitments for Functional and Detailed Design

The minor and major sewer systems and associated stormwater management facilities will be designed to support phased developments within the SSUAE. All proposed storm sewer infrastructure will be designed in accordance with the *Ottawa Sewer Design Guidelines*. The Stittsville West and South SWM pond designs will be completed according to City guidelines and the *MOE SWMP Design Manual*, further detailing inlet and outlet structures, orifice sizing, and pond block design – including the maintenance of natural heritage lands along the FMD and the implementation of multi-use pathways within the Pond blocks to create connectivity. Pond side slopes design is to be approved by a licensed Geotechnical Engineer prior to construction.

The proposed gravity sewer conveyance systems are shown to generally follow the proposed road network, with the exception of select conceptual servicing easements and a trunk sewer that will connect the West and South Lands through the Hydro Corridor. Note that the road network is conceptual in nature and is subject to change. As such, the trunk storm sewer routing is also subject to change. Easements may be required to provide efficient servicing per City of Ottawa and MECP standards.

During design of the developments within the SSUEA Lands:

- Average runoff coefficients will be updated to reflect detailed pervious/impervious surfaces information;
- Design parameters factors according to City of Ottawa Sewer Design Guidelines will be used;

© DSEL

- Design of the trunk sewers are to be optimized for construction efficiencies, provided that there are no significant impacts to affected landowners and other requirements related to minor amendments are met;
- Local storm sewer sizing will need to be evaluated at the subdivision approval stage;
- Permissible grade raises will be further analyzed and confirmed by a licensed Geotechnical Engineer;
- Detailed storage calculations/modelling will be done to ensure storage targets are being met;
- Overland flow routes will be detailed further; and,
- Capacity in downstream infrastructure will be confirmed through storm sewer network modelling, as-builts, and rational method design information.

Of special note is the stormwater management design for the Stittsville South Lands. Decisions related to stormwater management criteria for this area are to be subject to additional City review as part of *Planning Act* approvals for this area, based on the strategy that the lands east and west of the Hydro Corridor outlet to the Faulkner Municipal Drain from the proposed SWM facility.

9.8 Stormwater Servicing Conclusions

Based on the existing site topography and constraints including the FMD and tributary drain, DSEL prepared a stormwater servicing solution consisting of two new SWM ponds, servicing the ***West*** and ***South Lands***, respectively (Option 1A above).

The stormwater runoff is designed to be captured by an internal gravity sewer system that will convey flows to multiple outlet locations

A preliminary assessment was conducted for the conceptual stormwater management (SWM) ponds in a development site, focusing on the Faulkner Municipal Drain. Simulations and sensitivity tests were performed to address erosion concerns. PCSWMM modeling analyzed storm and sanitary water elevations, concluding that gravity storm connections are feasible. Recent downstream upgrades in the FMD, designed by the Drainage Engineer, have been completed to accommodate new and planned development in the area. Coordination with the Drainage Engineer will be completed to verify the recently constructed drain improvements are sufficient to accommodate flows from this development.

© DSEL

10.0 EROSION AND SEDIMENT CONTROL

Soil erosion occurs naturally and is a function of soil type, climate and topography. The extent of erosion losses is exaggerated during construction where vegetation has been removed and the top layer of soil becomes agitated.

Preliminary erosion and sediment controls are currently in place as part of the cut/fill work completed on the property and will be monitored, updated and maintained throughout future construction as required.

The following specific recommendations to the Contractor will be included in contract documents.

- Limit extent of exposed soils at any given time.
- Re-vegetate exposed areas as soon as possible.
- Minimize the area to be cleared and grubbed.
- Protect exposed slopes with plastic or synthetic mulches.
- Install silt fence to prevent sediment from leaving the site and entering existing watercourses, and clean and maintain throughout construction.
- Install catchbasin inserts during construction to protect from silt entering the storm sewer system.
- Install mud mat in order to prevent mud tracking onto adjacent roads.
- No refueling or cleaning of equipment near existing watercourses.
- No material stockpiles within 30 m of existing watercourses, unless otherwise permitted by RVCA and City of Ottawa.
- Provide sediment traps and basins during dewatering.
- Plan construction at proper time to avoid flooding.
- The Contractor will, at every rainfall, complete inspections and guarantee proper performance.
- Erosion and sediment control will remain in place until the working areas have been stabilized and re-vegetated.

© DSEL

11.0 CONCLUSIONS AND RECOMMEDATIONS

This Master Servicing Study (***MSS***) provides historical background information regarding the servicing in the vicinity of the subject property and presents servicing options explored while determining the recommended servicing strategy. Sufficient detail is provided to demonstrate that the development of the subject property will be adequately supported by municipal services and demonstrate how the municipal services will conform to current guidelines and design criteria. The conclusions from this report are as follows:

- Paterson Group has completed geotechnical investigations of the development areas and has noted that the site has a minor area that may be subject to a grade raise restriction of up to 2 m pending additional investigation. The majority of the site does not have a grade raise restriction.

- The recommended water servicing preferred option of those evaluated is to connect to multiple connection points from the existing development lands to the north. The proposed network has demonstrated a watermain network that could provide RFF of 167 L/s or up to 217 L/s based on the boundary conditions provided by City staff.

- Detailed modelling at the detailed design stage will confirm phasing of the extensions of trunk watermains and sizing of the local watermain network. The proposed water design supply is to conform to all relevant City and MECP Guidelines and Policies.

- Sanitary service will be provided for the subject property via the upgrading of the adjacent Shea Road Sanitary Pump Station located within the north central portion of the site. Additional analyses and studies will assess the full scope of the upgrades and staging of the improvements.

- Stormwater service is to be provided by capturing stormwater runoff by an internal gravity sewer system that will convey flows to multiple stormwater management facilities:

    1. Existing Davidson SWM Pond – adjustments to the outlet control of the facility will result in minimal variations in water levels to service the northeastern portion of the SSUEA, optimizing existing infrastructure;
    2. A new SWM Pond in the southeast quadrant of the site to service lands east of the FMD as shown in ***Section 9.2.1 Exhibit 2***;
    3. A new SWM Pond along the southwest boundary of the HONI corridor to service the SSUEA lands west of the FMD. All outletting to the FMD.

© DSEL

- The storm outlets will be set at, or above, the 2-year summer water level of the FMD.
- A preliminary Hydraulic Grade Line (HGL) modelling analysis has been completed and demonstrates that the HGL is maintained below the anticipated future underside of footings for the site.
- Erosion and sediment control measures will be implemented and maintained throughout construction. The FMD and adjacent watercourses will be protected from any negative impacts during construction.
- The proposed servicing and grading plans are expected to meet all City, RVCA, and MECP requirements as set out in background studies and current standards.

Prepared by,
David Schaeffer Engineering Ltd.

Per: Peter Mott, P.Eng.

Reviewed by,
David Schaeffer Engineering Ltd.

Per: Marc Pichette, P.Eng.

© DSEL

David Schaeffer Engineering Ltd.
120 Iber Road, Suite 103
Stittsville, ON K2S 1E9
613-836-0856
dsel.ca

FIGURES

Caivan Stittsville
CONCEPT PLAN

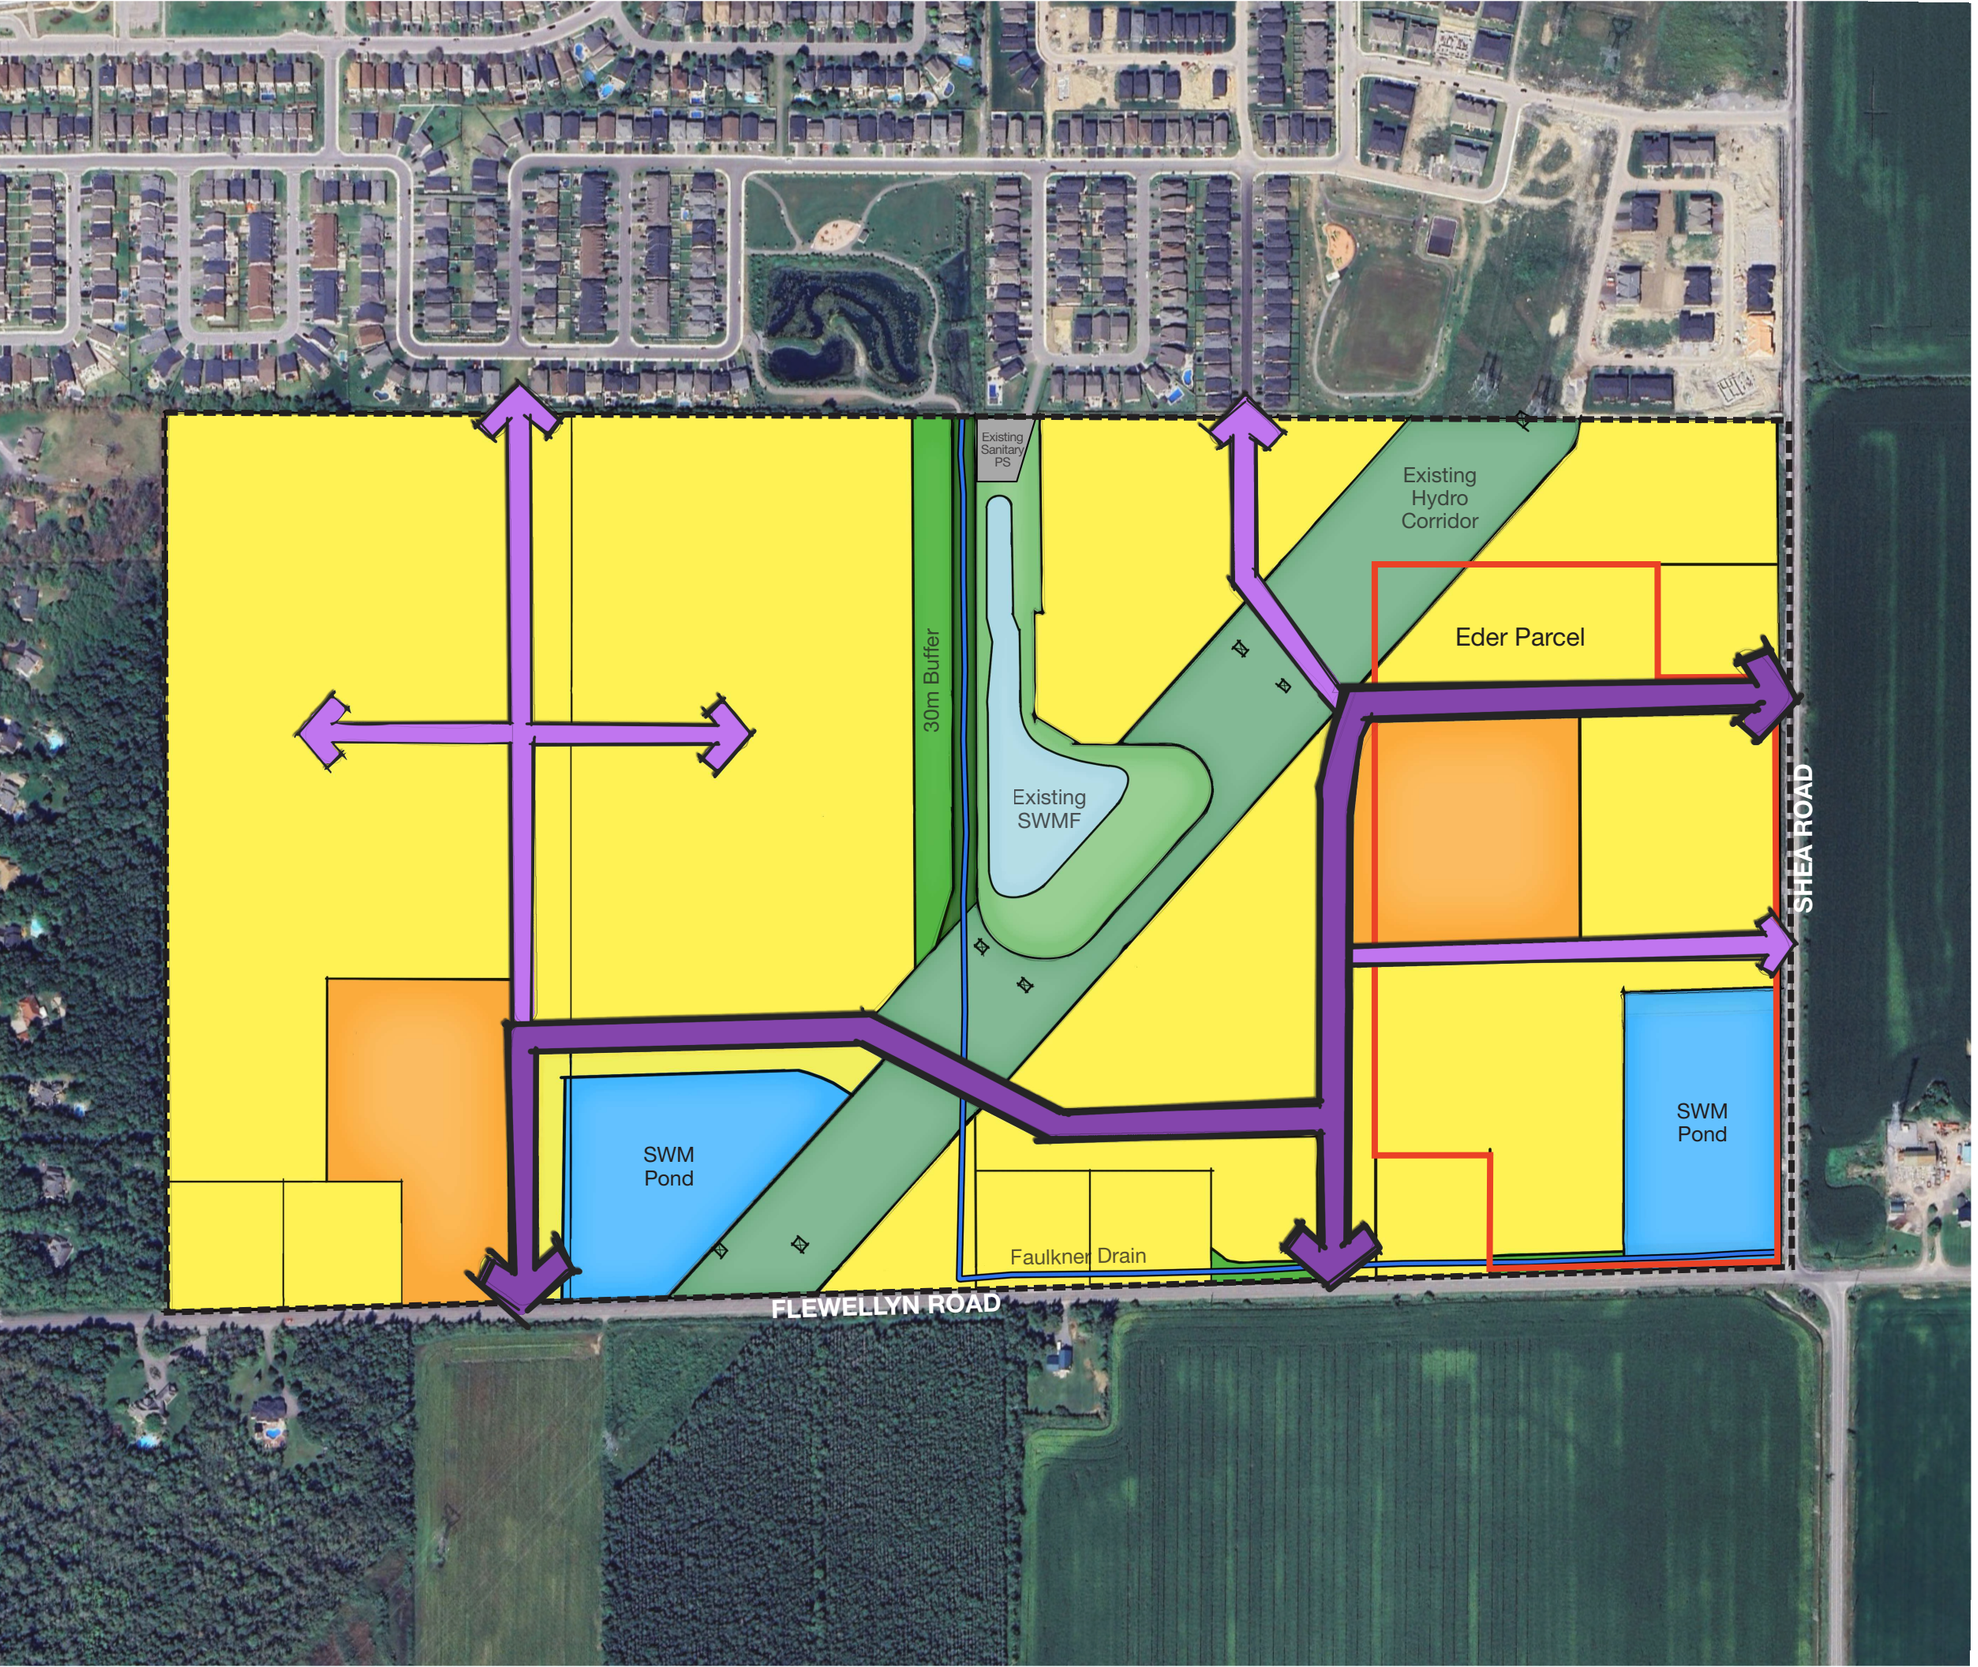

LEGEND

- Subject Lands
- Eder Parcel
- Low-Density
- Medium-Density
- Drainage Corridor
- Hydro Corridor
- Buffer
- Proposed SWM Pond
- Existing SWM Pond
- Existing Sanitary PS
- Major Roads
- Major Connections
- Faulkner Drain
- Parcel Lines

0 100 200

NAK design strategies

City of Ottawa - Water Distribution System
Facilities & Feedermains







ORLEANS P.S.
FOREST RIDGE P.S
Ogilvie Rd. Backup P.S.
ORLEANS RES.
MONTREAL ROAD P.S.
BRITTANY DRIVE P.S.
INNES RD ELEVATED TANK
FLEET STREET P.S.
LEMIEUX ISLAND PURIFICATION PLANT & P.S. & RES.
HURDMAN P.S.
Innes Rd Backup P.S.
Innes Rd/BearBrook Rd Backup P.S.
BRITANNIA PURIFICATION PLANT & P.S. & RES.
BILLINGS BRIDGE P.S.
MORGAN'S GRANT P.S.
CARLINGTON HEIGHTS P.S. & RES.
CONROY RD ELEVATED TANK
CAMPEAU DR. P.S.
ENERGY MINES & RESOURCES P.S.
SOUTH GLOUCESTER P.S.
LEITRIM P.S.
GLEN CAIRN P.S. & RES
BARRHAVEN P.S.
Merivale Rd. Backup P.S.
OTTAWA SOUTH P.S & RES.
FALLOWFIELD RD. RES. & P.S.
STITTSVILLE ELEVATED TANK
Abbott/Iber St. Backup P.S.
MOODIE ELEVATED TANK
SUBJECT SITE
SHADOW RIDGE P.S. & WELLS

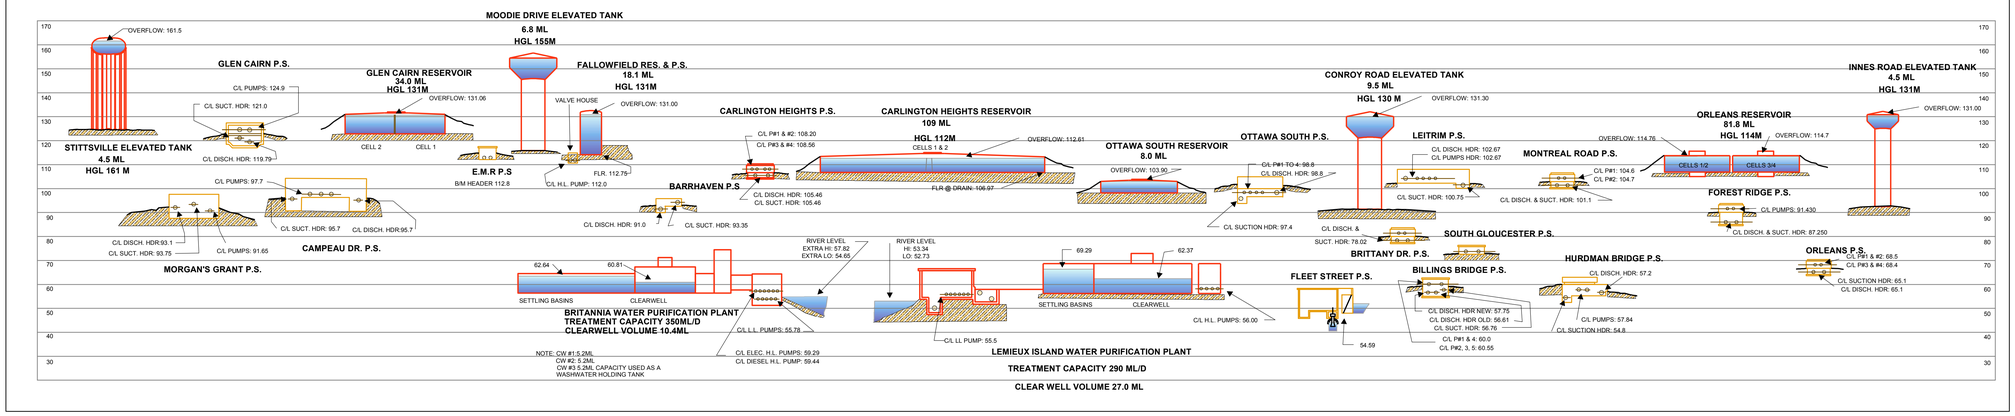

Legend

Water System Structure

- Pump Station
- Backup Pump Station
- Water Treatment Plant
- Well
- Elevated Tank
- Reservoir

WATERMAINS

Priority, Internal Diameter

- Backbone 1524mm - 1981mm
- Backbone 1067mm - 1372mm
- Backbone 610mm - 914mm
- Backbone 406mm - 508mm
- Backbone 152mm - 305mm
- Distribution 1676mm - 1981mm
- Distribution 1067mm - 1372mm
- Distribution 610mm - 914mm
- Distribution 406mm - 508mm
- Distribution 305mm - 381mm

PRESSURE ZONES

- 1E
- 1W
- 2E
- 2W2C
- 3C
- 3W
- 4C
- BARR
- EMR
- ME
- MG
- MONT
- SHADOW RIDGE

N W E S

Ottawa

Planning, Infrastructure and Economic Development Department
Right of Way, Heritage & Urban Design Services
Infrastructure Services

0 1,000 2,000 4,000 6,000

Meters

FIGURE 1-1

Drawn By: Gis & Data Management

Date:23- Oct- 2017

OPTION 1A:
TWO NEW SWM PONDS (EAST SWM POND ON EDER PARCEL)

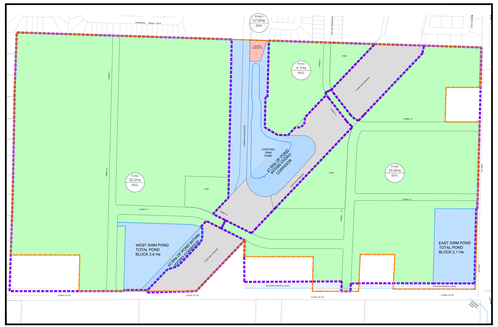

Option 1A				
Land Use				
Net Developable Area	ha	56.4		
No. of SWM Ponds (including Davidson)	no.	3		
Total Caivan SWM Pond Area	ha	4.7		
Hydro Corridor SWM Pond - Caivan Built	ha	0.5		
New Pond Channel	m	0		
Estimated SWM Costs	**Unit**	**Unit Cost**	**Quantity**	**Estimated Cost**
SWM Pond	ha	$ 1,875,000	5.20	$ 9,750,000
SWM Pond Channel	m	$ -		$ -
SWM Total				$ 9,750,000
City Costs for Davidson Pond Decommissioning	Allowance			$ -
Total Estimated Costs				**$ 9,750,000.00**

OPTION 1B:
TWO NEW SWM PONDS (EAST SWM POND ON DAVIDSON PARCEL)

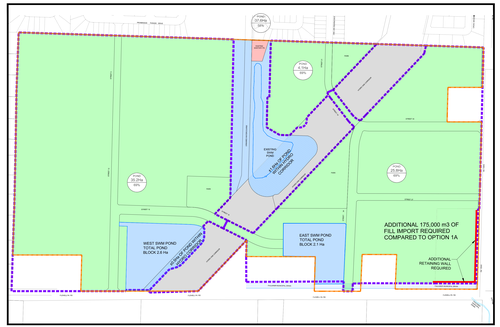

Option 1B				
Land Use				
Net Developable Area	ha	56.4		
No. of SWM Ponds (including Davidson)	no.	3		
Total Caivan SWM Pond Area	ha	4.7		
Hydro Corridor SWM Pond - Caivan Built	ha	0.5		
New Pond Channel	m	0		
Estimated SWM Costs	**Unit**	**Unit Cost**	**Quantity**	**Estimated Cost**
SWM Pond	ha	$ 1,875,000	5.20	$ 9,750,000
SWM Pond Channel	m	$ -		$ -
SWM Total				$ 9,750,000
City Costs for Davidson Pond Decommissioning	Allowance			$ -
Total Estimated Costs				**$ 9,750,000.00**

*NOTE: ADDITIONAL COSTS, BEYOND THOSE PRESENTED ABOVE FOR SWM PONDS, WOULD BE REQUIRED FOR ADDITIONAL FILL/ENGINEERED FILL AND RETAINING WALLS COMPARED TO OPTION 1A

OPTION 2A:
ONE NEW SWM POND. RELOCATE DRAIN (PERIMETER)

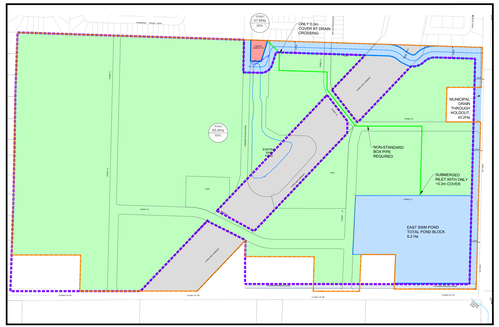

Option 2A				
Land Use				
Net Developable Area	ha	54.9		
No. of SWM Ponds (including Davidson)	no.	1		
Total Caivan SWM Pond Area	ha	6.2		
Hydro Corridor SWM Pond - Caivan Built	ha	0		
New Pond Channel	m	1200		
Estimated SWM Costs	**Unit**	**Unit Cost**	**Quantity**	**Estimated Cost**
SWM Pond	ha	$ 1,875,000	6.20	$ 11,625,000
SWM Pond Channel	m	$ 3,000	1,200	$ 3,600,000
SWM Total				$ 15,225,000
City Costs for Davidson Pond Decommissioning	Allowance			$ 2,100,000.00
Total Estimated Costs				**$ 17,325,000.00**

OPTION 2B:
ONE NEW SWM POND. RELOCATE DRAIN (CENTRAL)

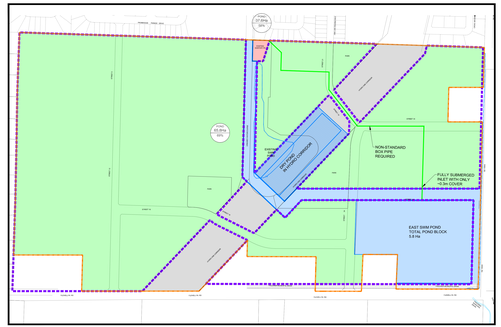

Option 2B				
Land Use				
Net Developable Area	ha	54.8		
No. of SWM Ponds (including Davidson)	no.	1		
Total Caivan SWM Pond Area	ha	5.8		
Hydro Corridor SWM Pond - Caivan Built	ha	2.6		
New Pond Channel	m	800		
Estimated SWM Costs	**Unit**	**Unit Cost**	**Quantity**	**Estimated Cost**
SWM Pond	ha	$ 1,875,000	8.40	$ 15,750,000
SWM Pond Channel	m	$ 3,000	800	$ 2,400,000
SWM Total				$ 18,150,000
City Costs for Davidson Pond Decommissioning	Allowance			$ 2,100,000.00
Total Estimated Costs				**$ 20,250,000.00**

OPTION 3:
TWO NEW SWM PONDS. DECOMMISSION DAVIDSON SWM POND

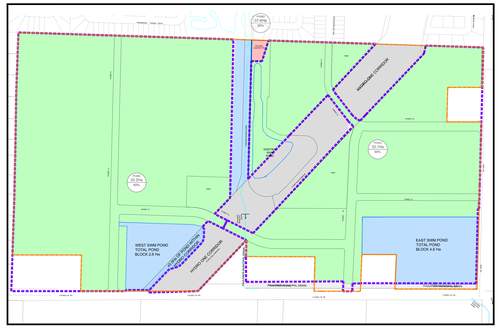

Option 3				
Land Use				
Net Developable Area	ha	55.4		
No. of SWM Ponds (including Davidson)	no.	2		
Total Caivan SWM Pond Area	ha	6.5		
Hydro Corridor SWM Pond - Caivan Built	ha	0.5		
New Pond Channel	m	0		
Estimated SWM Costs	**Unit**	**Unit Cost**	**Quantity**	**Estimated Cost**
SWM Pond	ha	$ 1,875,000	7.00	$ 13,125,000
SWM Pond Channel	m	$ 3,000		$ -
SWM Total				$ 13,125,000
City Costs for Davidson Pond Decommissioning	Allowance			$ 2,100,000.00
Total Estimated Costs				**$ 15,225,000.00**

LEGEND

(POND 65.8Ha) 71% — DRAINAGE AREA TO POND; IMPERVIOUSNESS (FROM JFSA REPORT)

- DEVELOPABLE LAND
- POND
- MUNICIPAL DRAIN
- SANITARY P.S.
- HYDRO CORRIDOR

DSEL
Dan Snow Emery Limited
Stittsville, Ontario, K2S 1Z2
Tel. (613) 836-0934
Fax. (613) 836-0935
www.DSEL.ca

STITTSVILLE SOUTH URBAN EXPANSION AREA
SWM POND DESIGN OPTIONS
CITY OF OTTAWA

SCALE: 1:5000 | PROJECT No.: 21-1347
DATE: AUG 2024 | FIGURE: 3

David Schaeffer Engineering Ltd.
120 Iber Road, Suite 103
Stittsville, ON K2S 1E9
613-836-0856
dsel.ca

DRAWINGS

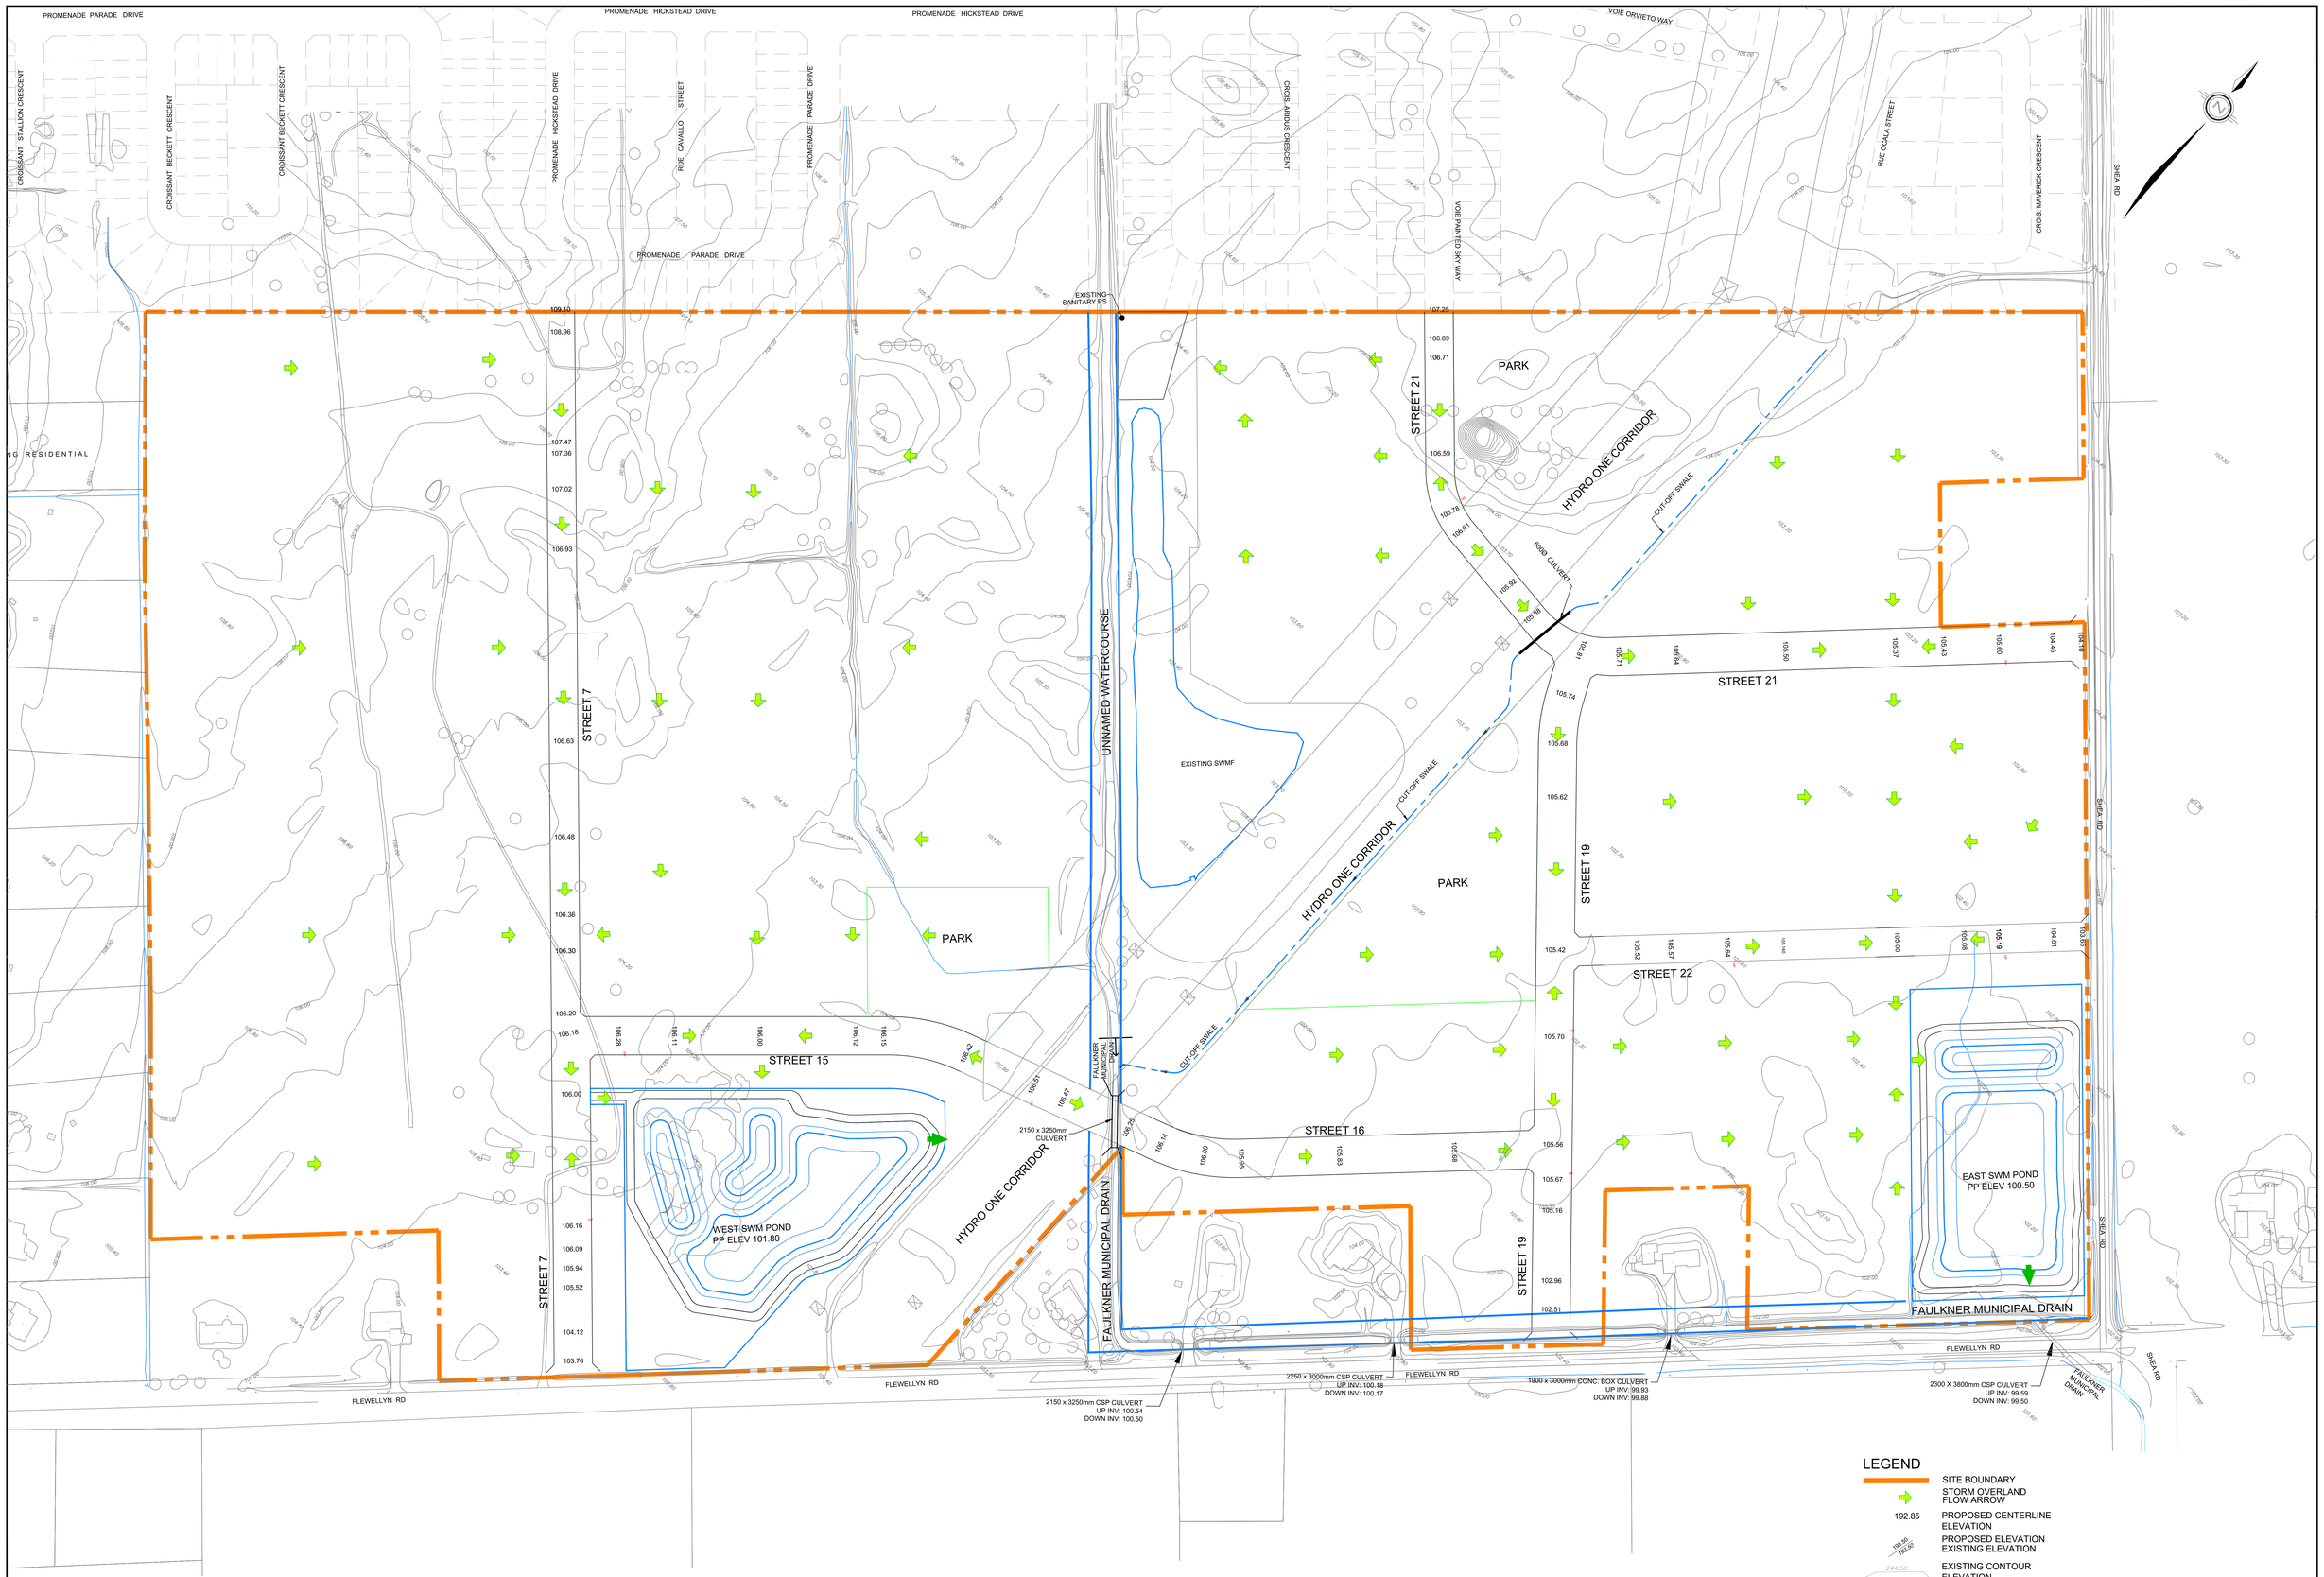

DSEL
120 Iber Road, Unit 103
Stittsville, ON K2S 1E9
Tel. (613) 836-0856
Fax. (613) 836-7183
www.DSEL.ca

STITTSVILLE SOUTH URBAN EXPANSION AREA
CONCEPTUAL GRADING PLAN
CITY OF OTTAWA

PROJECT No. :	21-1247
SCALE:	1:1250
DATE:	AUG 2024
DRAWING No.	1

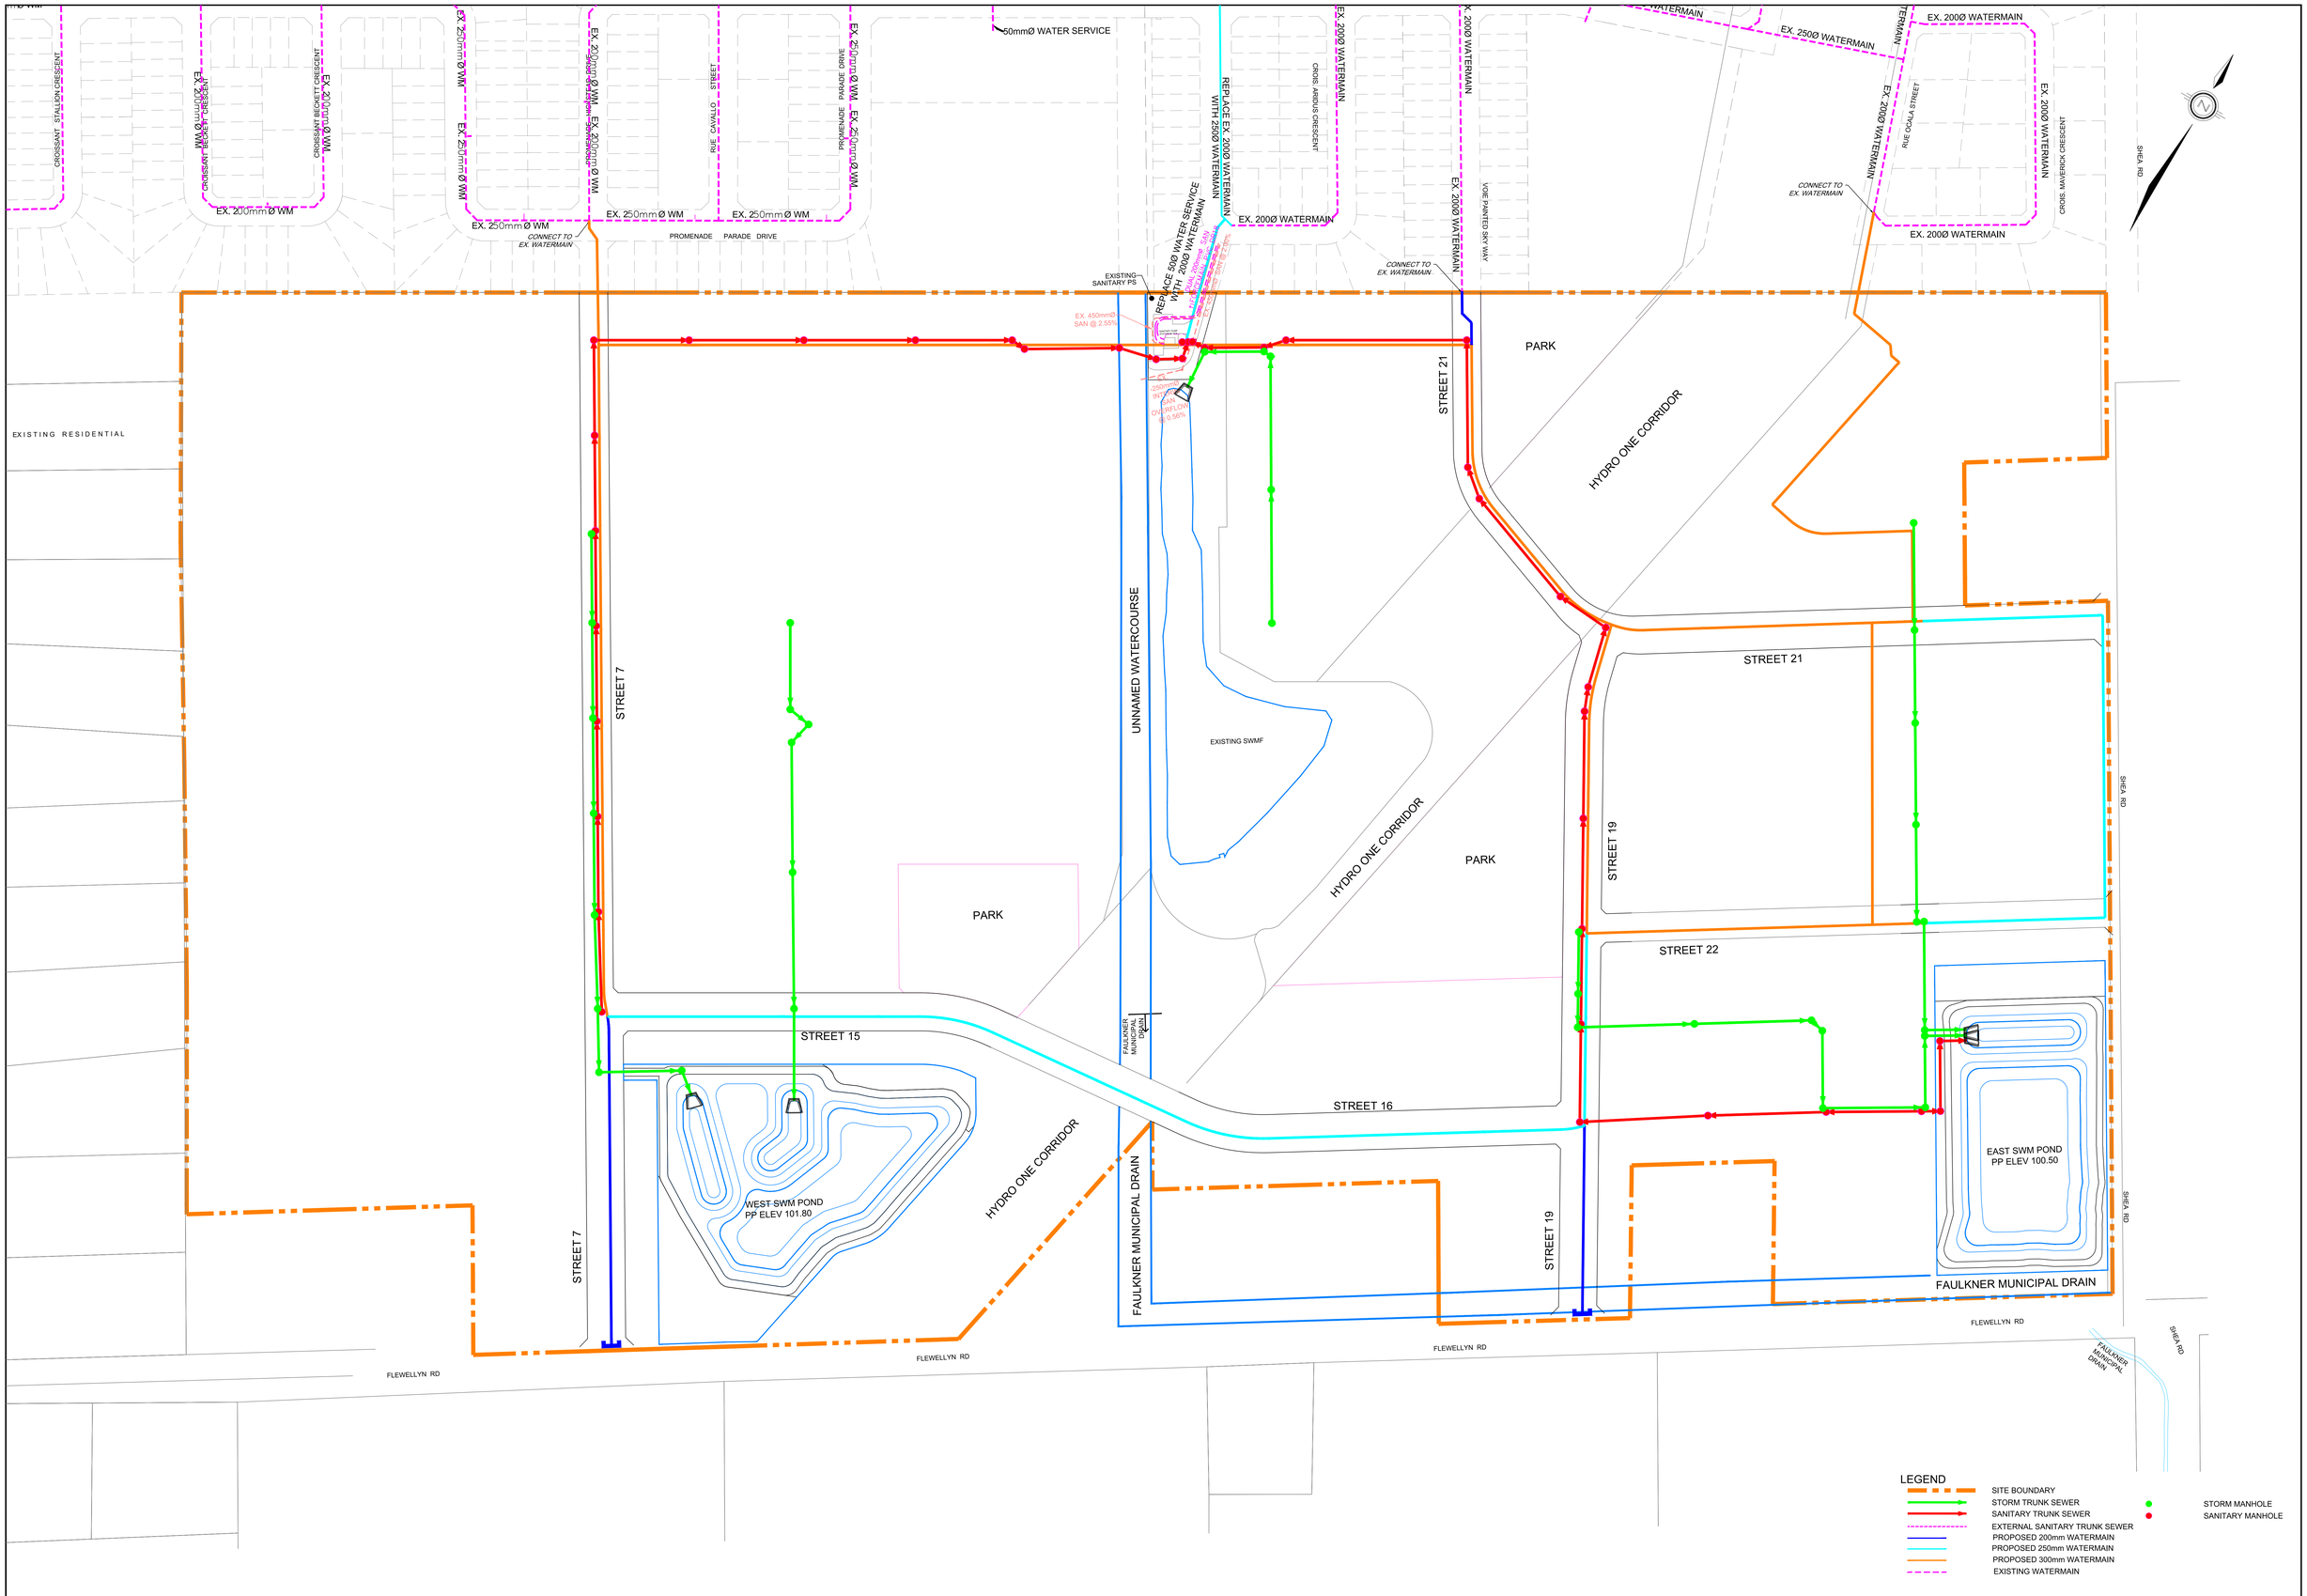

DSEL
120 Iber Road, Unit 103
Stittsville, ON K2S 1E9
Tel. (613) 836-0856
Fax. (613) 836-7183
www.DSEL.ca

STITTSVILLE SOUTH URBAN EXPANSION AREA
CONCEPTUAL SERVICING PLAN
CITY OF OTTAWA

PROJECT No. :	21-1247
SCALE:	1:1250
DATE:	AUG 2024
DRAWING No.	2

LEGEND

- SITE BOUNDARY
- PROPOSED STORM TRUNK SEWER
- STORM MANHOLE
- STORM TRUNK TRIBUTARY AREA

1.32 / 0.90 — AREA IN HECTARES / RUNOFF COEFFICIENT

PROMENADE HICKSTEAD DRIVE
PROMENADE PARADE DRIVE
RUE CAVALLO STREET
CROSSANT BI
CROSS
VOIE HICKSTEAD WAY
VOIE ORVIETO WAY
CROS. ARIDUS CRESCENT
VOIE PAINTED SKY WAY
RUE OCULA STREET
CROS. MAVERICK CRESCENT
SHEA RD
EXISTING RESIDENTIAL
EXISTING SANITARY PS
UNNAMED WATERCOURSE
EXISTING SWMF
STREET 7
STREET 15
STREET 16
STREET 19
STREET 21
STREET 22
PARK
HYDRO ONE CORRIDOR
FAULKNER MUNICIPAL DRAIN
FLEWELLYN RD
STORM TRUNK 1
STORM TRUNK 2
STORM TRUNK 3
STORM TRUNK 4
STORM TRUNK 5
WEST SWM POND PP ELEV 101.80
EAST SWM POND PP ELEV 100.50
2150 x 3250mm CSP CULVERT UP INV: 100.54 DOWN INV: 100.50
2250 x 3000mm CSP CULVERT UP INV: 100.18 DOWN INV: 100.17
1900 x 3000mm CONC. BOX CULVERT UP INV: 99.93 DOWN INV: 99.88
2300 X 3800mm CSP CULVERT UP INV: 99.59 DOWN INV: 99.50

1.70 / 0.68	18.88 / 0.70
11.11 / 0.68	0.93 / 0.40
1.17 / 0.68	3.36 / 0.68
0.73 / 0.40	2.35 / 0.25
2.28 / 0.25	0.81 / 0.68
9.38 / 0.70	1.91 / 0.40
10.14 / 0.70	0.68 / 0.68

DSEL
120 Iber Road, Unit 103
Stittsville, ON K2S 1E9
Tel. (613) 836-0856
Fax. (613) 836-7183
www.DSEL.ca

STITTSVILLE SOUTH URBAN EXPANSION AREA
STORM SERVICING PLAN
CITY OF OTTAWA

PROJECT No. :	21-1247
SCALE:	1:1250
DATE:	AUG 2024
DRAWING No.	3

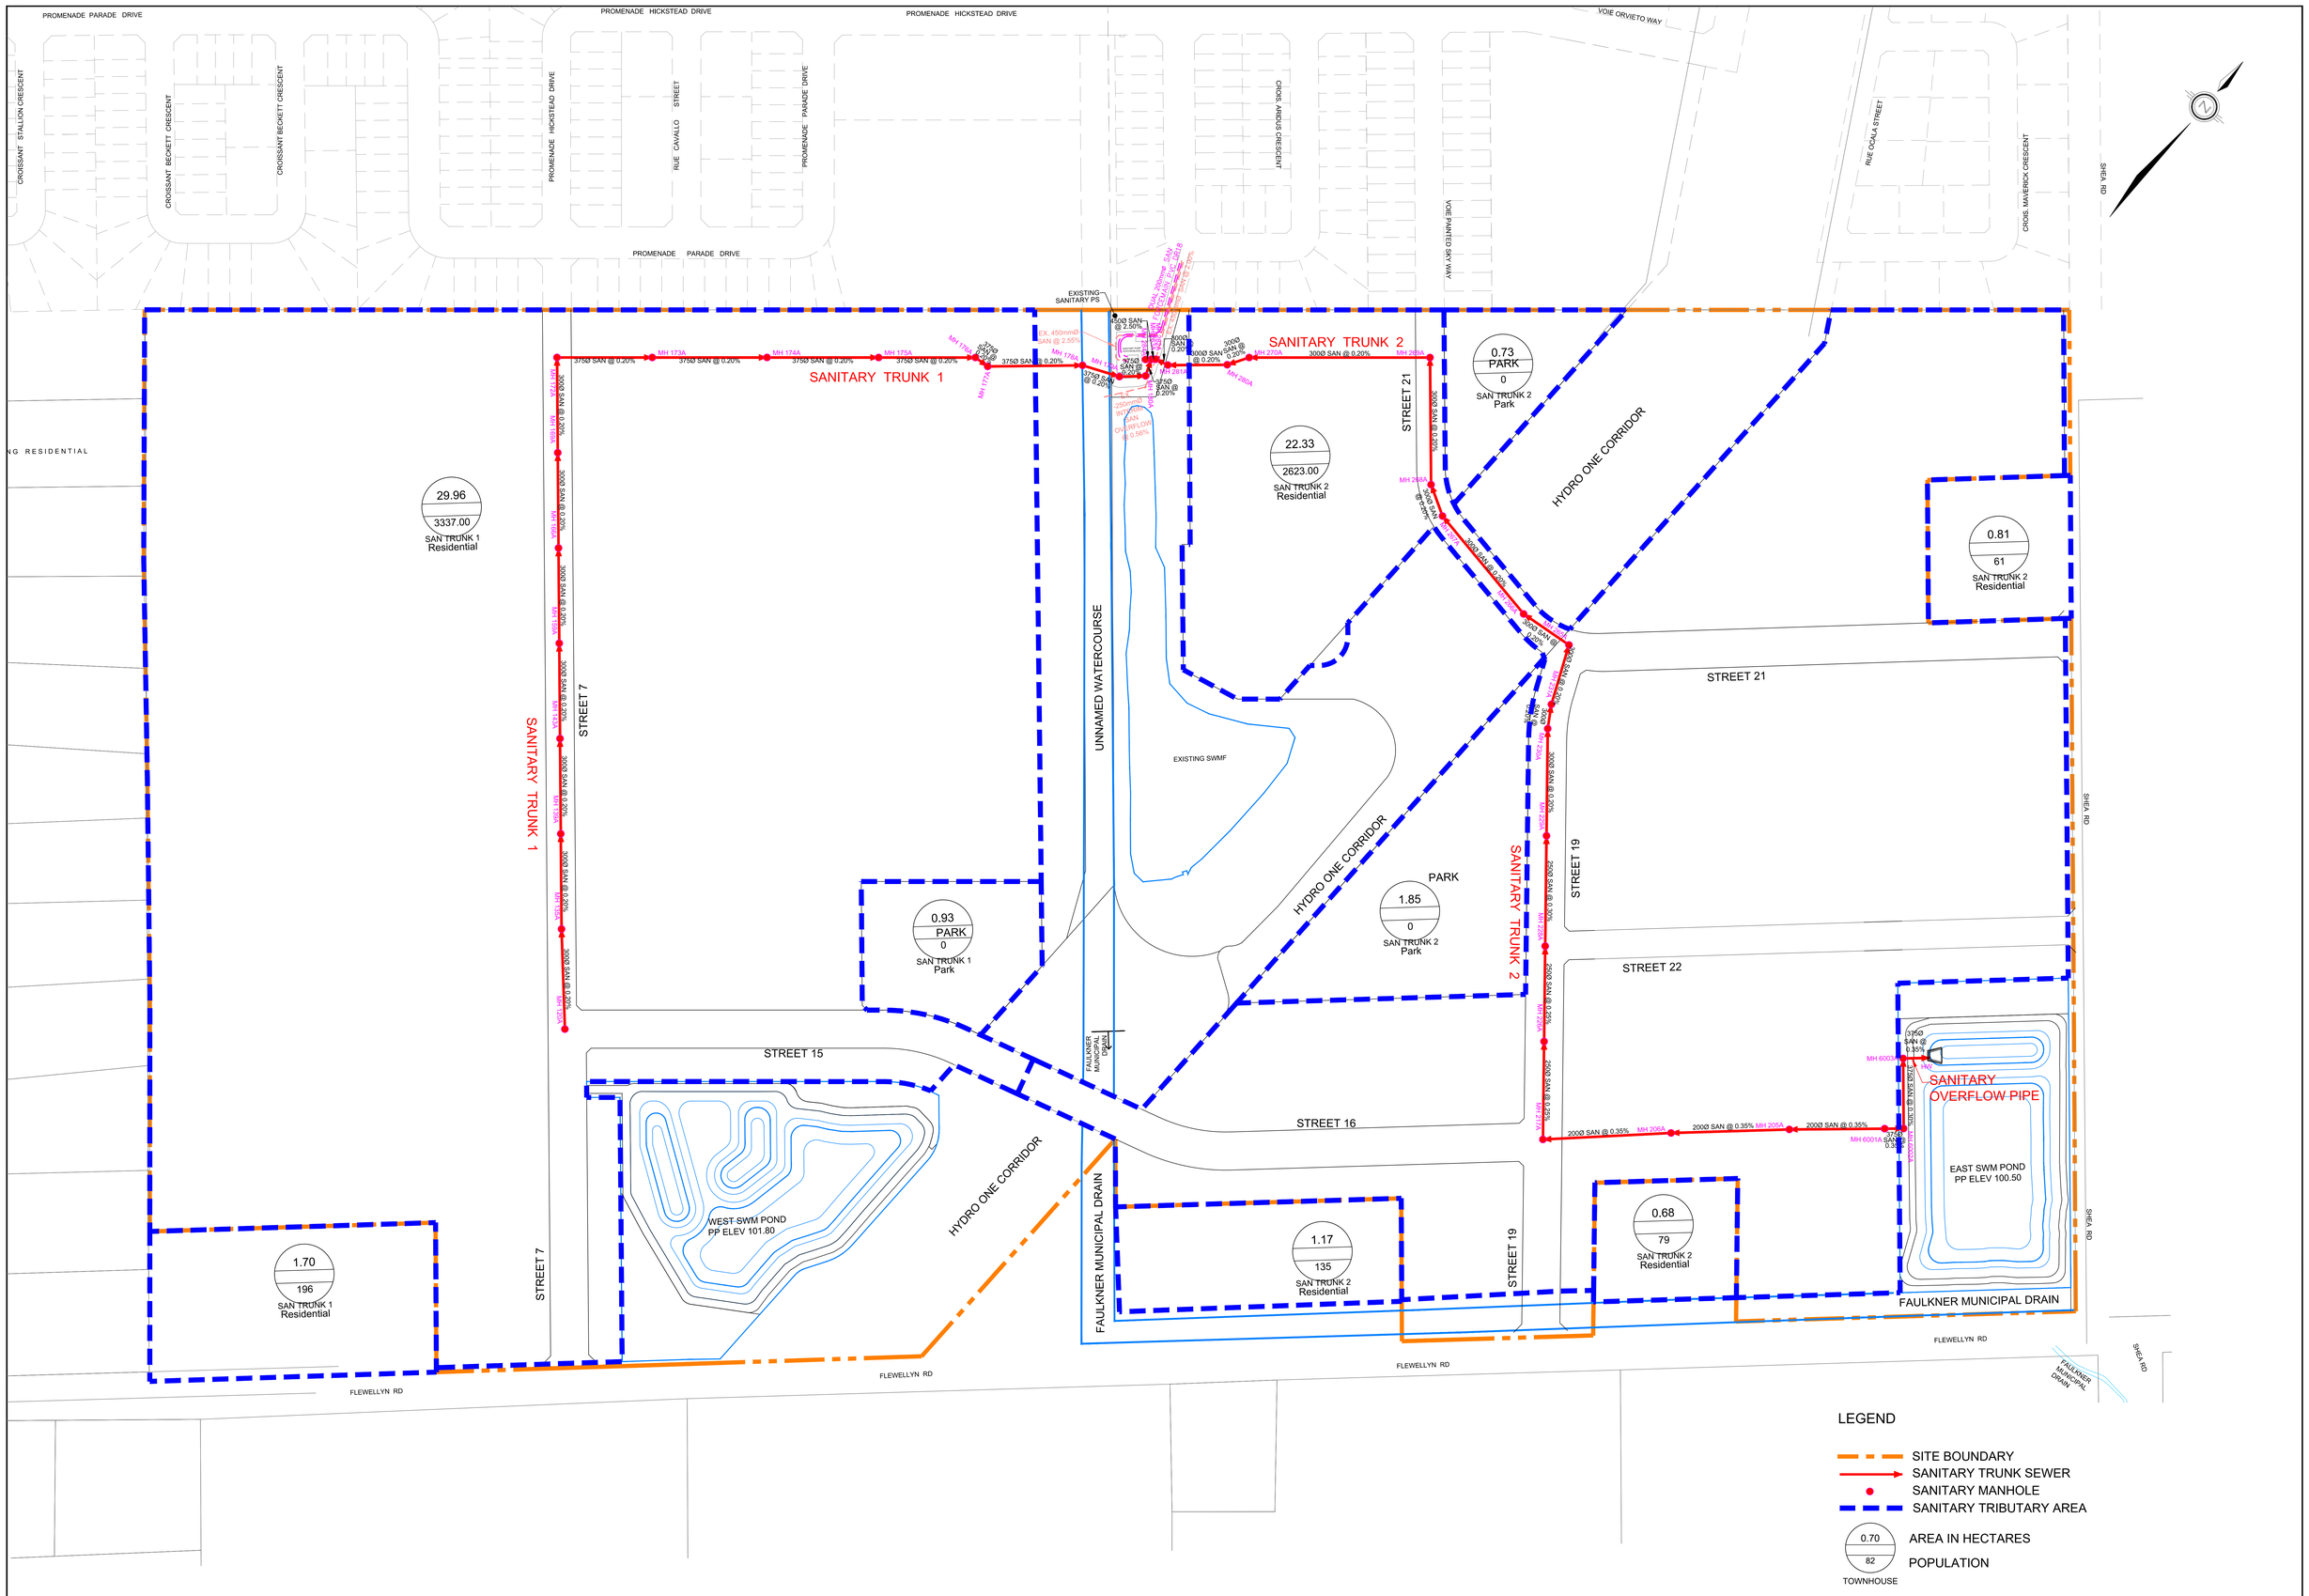

DSEL
120 Iber Road, Unit 103
Stittsville, ON K2S 1E9
Tel. (613) 836-0856
Fax. (613) 836-7183
www.DSEL.ca

STITTSVILLE SOUTH URBAN EXPANSION AREA
CONCEPTUAL SANITARY SERVICING PLAN
CITY OF OTTAWA

PROJECT No. :	21-1247
SCALE:	1:1250
DATE:	AUG 2024
DRAWING No.	4

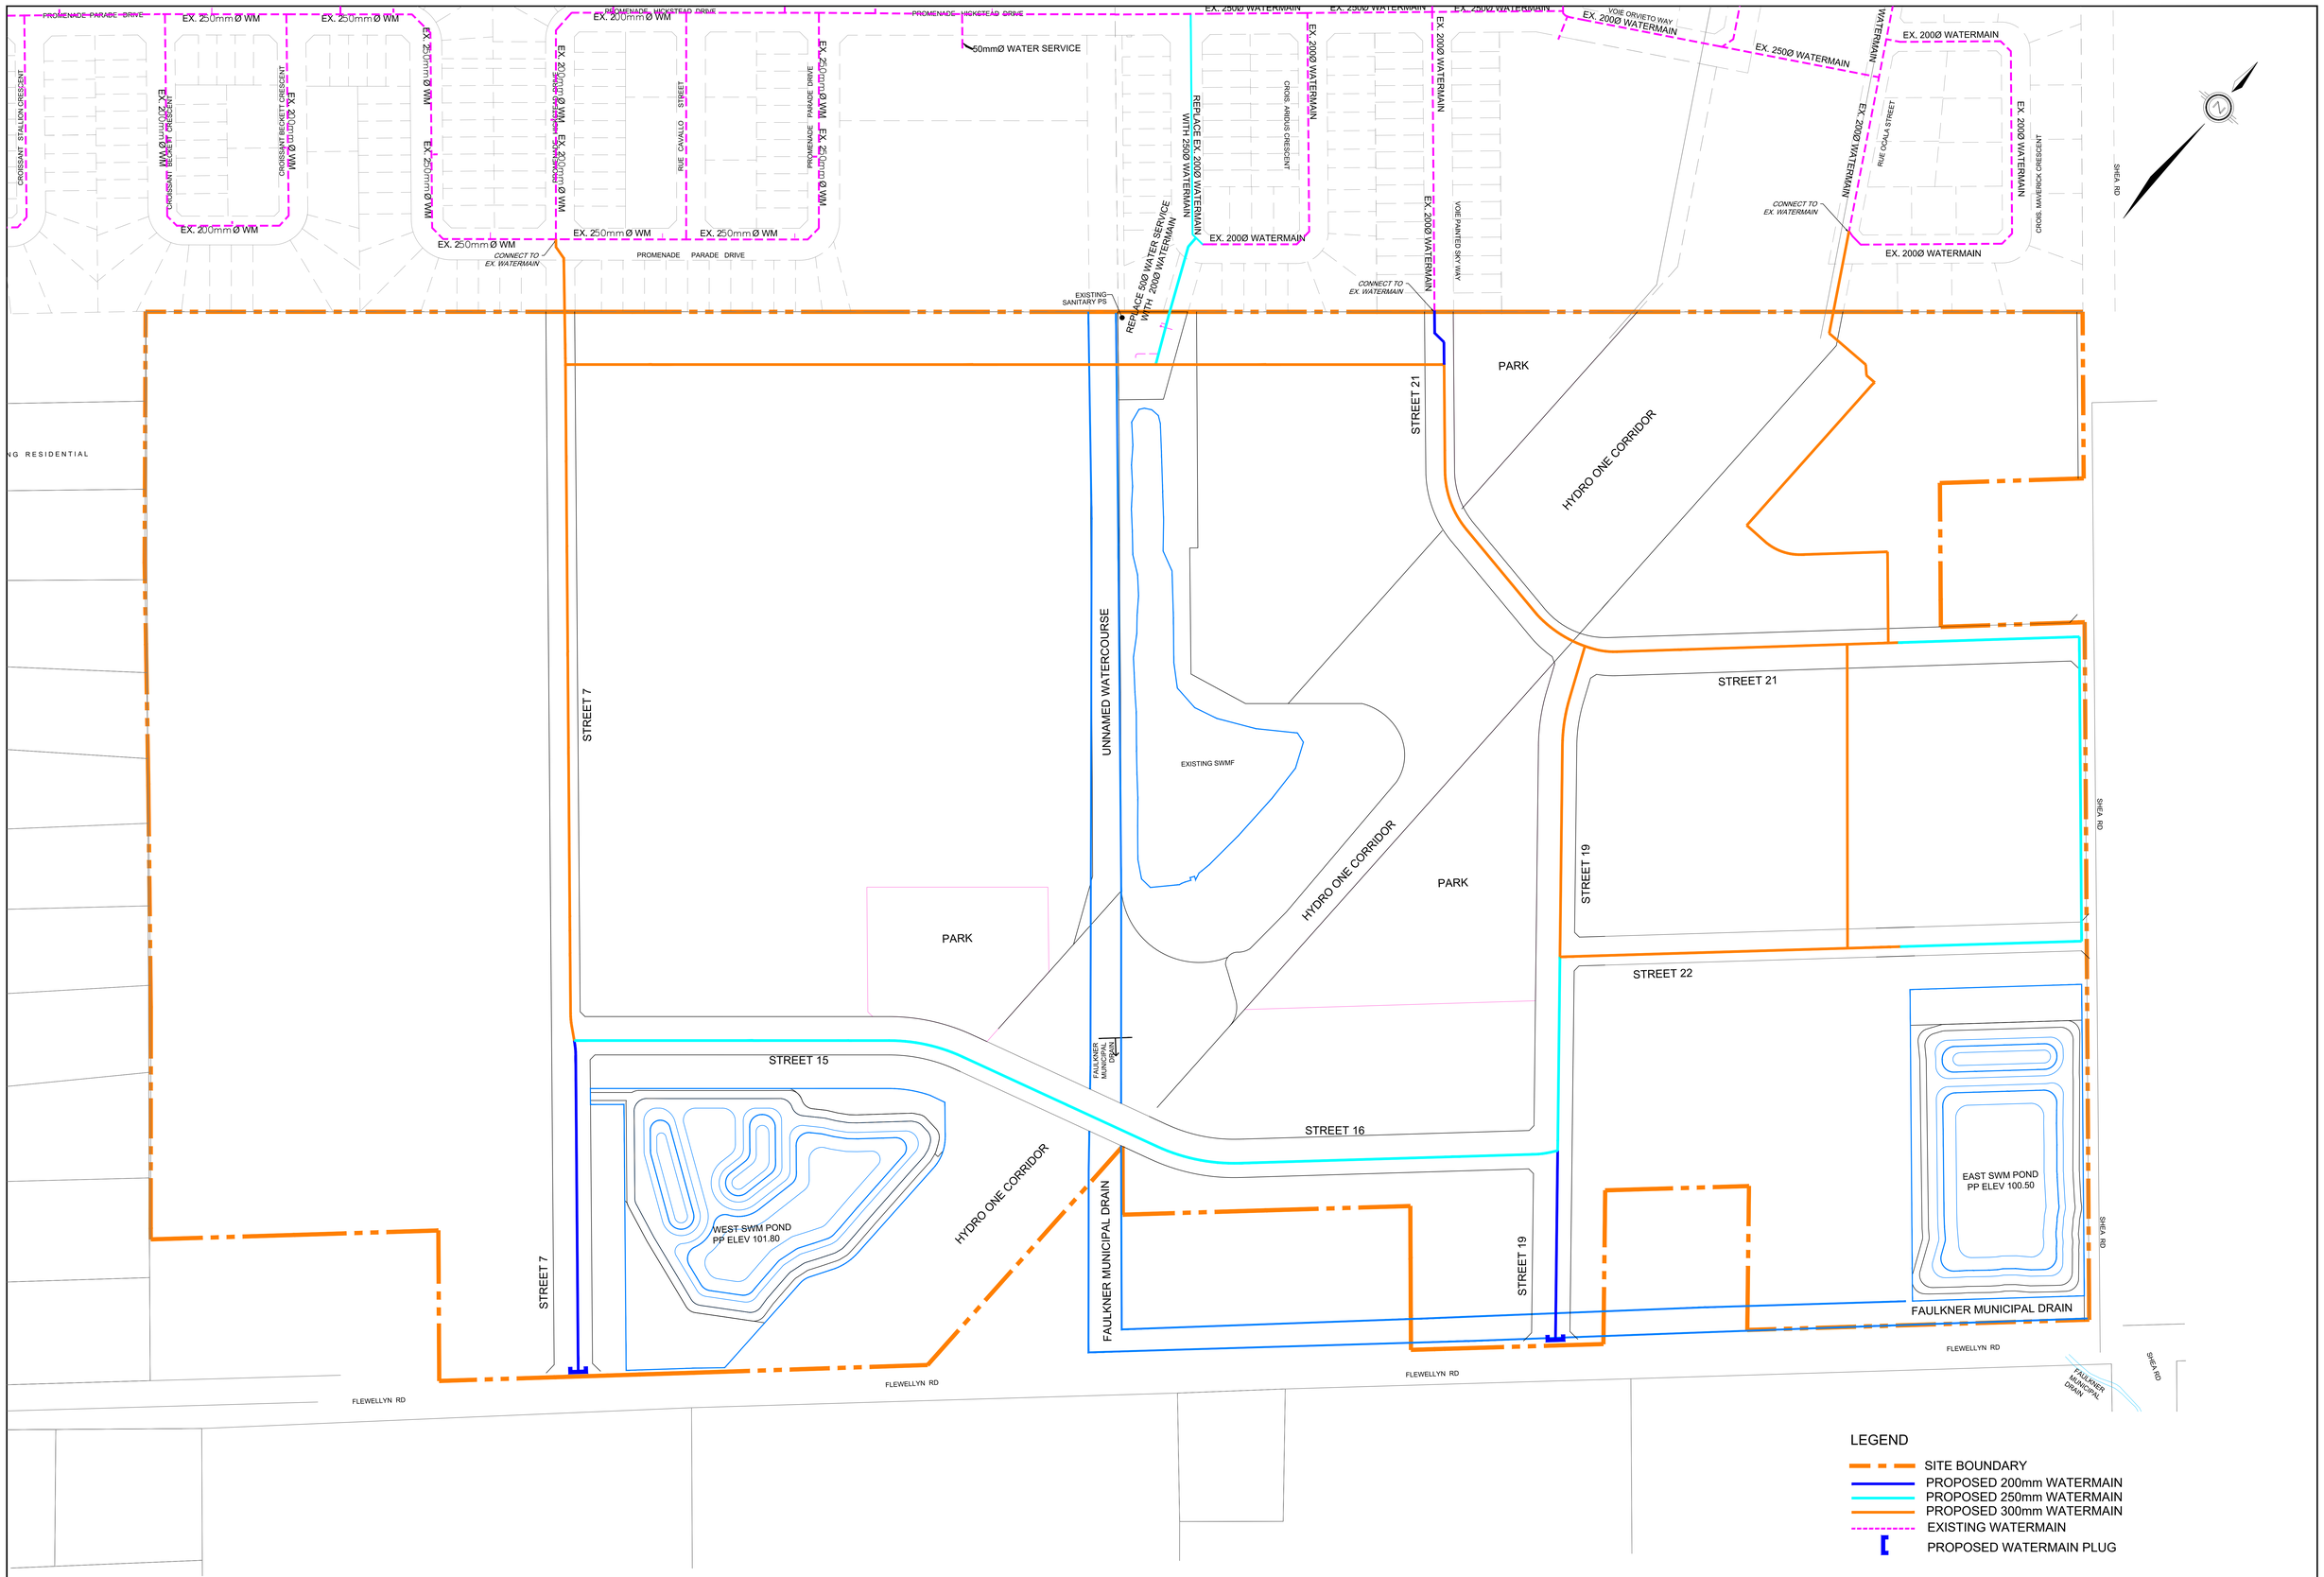

DSEL
120 Iber Road, Unit 103
Stittsville, ON K2S 1E9
Tel. (613) 836-0856
Fax. (613) 836-7183
www.DSEL.ca

STITTSVILLE SOUTH URBAN EXPANSION AREA
CONCEPTUAL WATERMAIN SERVICING PLAN
CITY OF OTTAWA

PROJECT No. :	21-1247
SCALE:	1:1250
DATE:	AUG 2024
DRAWING No.	5

David Schaeffer Engineering Ltd.
120 Iber Road, Suite 103
Stittsville, ON K2S 1E9
613-836-0856
dsel.ca

APPENDIX A

David Schaeffer Engineering Ltd.
120 Iber Road, Suite 103
Stittsville, ON K2S 1E9
613-836-0856
dsel.ca

MEMORANDUM

DATE:	March 19, 2024
TO:	**Christopher Rogers, P.Eng.**
FROM:	Marc Pichette, P. Eng.
SUBJECT:	**Caivan – Stittsville Lands (5993, 6070 & 6115 Flewellyn Road) New Urban Expansion Development – Terms of Reference (REVISED PER CITY COMMENTS DATED MARCH 15, 2024)**
DSEL Job No.	21-1247
ATTACHMENTS:	

Chris,

Per comments provided to Caivan on March 15/24, the following is a proposed summary of Terms of Reference (TOR) to document the servicing strategy approach for development of the above noted parcels of land located within Stittsville.

1.0 BACKGROUND

Fotenn Consultants Inc. ("Fotenn") has previously circulated a January 27, 2022 outline for the development of Concept Plans and processes related to the above noted subject lands. Caivan Communities ("Caivan") has ownership of land parcels that are currently located in the rural area and are designated to be brought within the urban boundary through the new Official Plan process.

1.1 Study Area & Objectives

The subject lands are bound by Flewellyn Road to south, Shea Road to the east, an existing urban subdivision development to the north (Stittsville South – Area 6) and an estate lot subdivision to the west. The area is also bisected by the Faulkner Municipal Drain and a Hydro One power transmission corridor.

The main objective of the servicing review is to develop an overall servicing strategy for the Stittsville Lands that will fulfill the requirements of municipal and provincial standards. The review will consider, evaluate and assess the servicing needs of the development area as it relates to geotechnical considerations, availability of service connections and stormwater management objectives. Several development alternatives for road network layouts, parks and unit mixes will be analyzed and assessed with respect to servicing strategies with a preferred overall servicing scheme identified.

The preferred internal servicing plan will be developed to meet regulatory requirements and will be free of conflicts between the various infrastructure components (water, wastewater, storm and stormwater infrastructure). The following sections present the anticipated scope of work to be completed:

- Task 1 (Agreement on Terms of Reference),
- Task 2 (Internal Concept Plan Review Process (Input Evaluation)),
- Task 3 (Functional Servicing Report and Master Infrastructure Review).

2.0 WORK PLAN

Task 1: Agreement on Terms of Reference

Preparation and finalizing of the TOR for the proposed servicing assessment approach guiding the Concept Plan development process. This draft TOR will be circulated to the City for review/comment on the proposed scope and will form the basis of the future servicability review.

Task 2: Internal Concept Plan Review Process (Input Evaluation)

From an Overall Servicing perspective, this task will include a thorough consolidation of the documents listed in Section 2.1, investigate and quantify residual capacities and servicing constraints while keeping in mind the environmental constraints identified as part of the Task 2 process. The scope of work to complete the Concept Plan Review Process will include the following components:

2.1 Review and Consolidate

As part of the Concept Plan Review Process, a review of background reports that are concerned with the study area will be completed. The review will, at minimum, include the following reports and guidelines being considered:

- City of Ottawa Sewer Design Guidelines (City of Ottawa, October 2012) & Technical Bulletins (ISDTB-2014-01, PIEDTB-2016-01, ISTB-2018-01, ISTB-2018-04 & ISTB-2019-02)
- City of Ottawa Water Distribution Guidelines (City of Ottawa, July 2010) & Technical Bulletins (ISD-2010-2, ISDTB-2014-2, ISTB-2018-02, & ISDTB-2021-03)
- Infrastructure Master Plan (City of Ottawa, 2013)
- Low Impact Development Technical Guidance Report, Implementation in Areas with Potential Hydrogeological Constraints (Dillon Consulting and Aquafor Beech, February 2021)
- Stormwater Planning and Design Manual (Ministry of the Environment, March 2003)
- Amendment to the Engineer's Report for the Faulkner Municipal Drain (Robinson, December 2020) & Addendum No. 1 (Robinson, March 2021)
- Stittsville South – Area 6, City of Ottawa, Master Servicing Report & Stormwater Management Design Plan (Novatech/DSEL, December 2013)
- Stittsville South Subdivision, City of Ottawa – Detailed Servicing & Stormwater Management Report (Novatech July 2016)
- Sanitary Pump Station Pre-Design Report, Stittsville South (Novatech, July 2015)
- Stittsville South Subdivision, City of Ottawa – Shea Road Sanitary Pump Station Design Brief (Novatech, May 2016)
- Design Brief, Davidson Lands – OPA 76 Area 6a, Phase 1 (5993 Flewellyn Road) (IBI Group, February 2018)
- Fernbank Community Design Plan, Master Servicing Study (Novatech, June 2009)

- Geotechnical Investigation, Proposed Residential Development 5993, 6070 & 6115 Flewellyn Road – Ottawa (Paterson (PG5570-2) January 2022)
- Low Impact Development Stormwater Management Guidance Manual (Ministry of the Environment, Conservation and Parks, Draft for Consultation – January 2022)

2.2 Hydrological Modelling

Based on a review of background reports and topographic information available, a hydrologic model will be developed to estimate peak flows and hydrographs under for the various outlets from the Study Area. The analysis will be conducted with SWMHYMO under the design storm types, return periods and hydrological parameters described in the Ottawa Sewer Design Guidelines. The analysis will consider the drainage features inventoried as part of the topographical survey (open ditch, culverts, etc.) as well as any drainage divides. Surface flows will be calculated based on the existing flow patterns for the various outlets; drainage ditches, culverts and storm sewers (if applicable).

2.3 Coordination and Liaise with Other Disciplines

The Concept Plan review process will discuss findings from other disciplines including geotechnical, hydrogeology, water budget, hydrology, ecology (aquatic resources and natural areas), etc., which will establish the existing environmental conditions. The coordination will ensure that the hydrologic analysis considers natural environmental inventories and constraints. Where required, drawings prepared will note existing conditions constraints and potential opportunities, which may impact storm and stormwater servicing or other municipal infrastructure.

2.3.1 Coordinate and Liaise with Geotechnical Engineer

In consultation with the geotechnical engineer, DSEL will:

- Review specific grade raise restrictions to better understand the potential grading constraints versus potential land use;
- Review the soil's characteristics to better understand whether they are conducive to infiltration measures;
- Review the soil's structural capabilities from a support/strength perspective;
- Review the areas of either recharge or discharge potential.

2.3.2 Coordinate with the Hydrogeologist

In consultation with the hydrogeologist, the existing conditions water budget analysis will be reviewed to identify the zones conducive to infiltration measures or other low impact development (LID) strategies. These measures could potentially be used to mitigate impacts on the water budget. As part of this task, LID strategies will be reviewed, at a conceptual level, to determine their viability and effectiveness in maintaining the existing conditions water budget and potential benefits to mitigating downstream impacts.

- Prepare a conceptual LID plan which illustrates the zones noted above and how the measures will be integrated into the overall plan(s);
- Evaluate viability and performance of LIDs with respect to soil conditions, groundwater levels and depth of storm sewer infrastructure within the development area. The feasibility of LID performance will be assessed as part of the master planning process;

2.3.3 Coordinate with Biologist

In consultation with the biologist, the environmental constraints will be further reviewed to better understand their sensitivity to various land uses and their proximity to Concept Plan elements. The objectives and targets from a storm discharge perspective will be based on the on-site environmental constraints as well as the limitations of the receiving watercourses.

2.3.4 Review Topographical Survey and Complete Inventory of Existing Infrastructure

Once all constraints have been compiled a further review of topographical surveys will be completed as well as the drainage patterns identified under current conditions. As part of this task, existing services and outlets will be inventoried for wastewater, water and stormwater. The assessment of residual capacities for existing services will also be reviewed. Any additional survey data will be obtained as required to supplement as-built information.

2.4 Evaluation and Assessment of Storm Design Criteria , Objectives and Pond Alternatives

Based on the findings of the natural resource inventories, storm criteria for both water quality and quantity will be established from a consensus with other disciplines and based on requirements prevalent in the Study Area. Once adopted by the consultant team, the storm criteria will be presented and confirmed by regulatory agencies. Review and comment on potential end-of-pipe solutions that would satisfy the storm criteria and the most suitable approach and siting (based on topography, soil type etc) for the Concept Plans. Based on the siting of the facilities, establish footprint of the end-of-pipe facilities in accordance with the guidance described in Section 4 of the MECP SWMPDM. This includes evaluation of potential capacity of the existing Area 6 SWM pond to optimize use of that infrastructure.

Geosynthetic clay liners, or equivalent, will be incorporated into pond design where required based on the recommendations of the geotechnical engineer.

Pond sizing will be established conservatively and not be downsized based on the finding of LID options reviewed to establish water balance.

Several stormwater drainage alternatives will be prepared and evaluated, taking into consideration the following planning constraints:

1) The management of drainage from existing SWM ponds;
2) The development site is bisected by Faulkner Municipal Drain;
3) The lower-lying lands being occupied by non-participating landowners;
4) The seperation of residential developable areas by the Hydro corridor;

2.5 Coordination with Drainage Engineer for requirements relating to the Faulkner Municipal Drain (FMD).

Preliminary consultation with the City's Municipal Drain Group, indicated that the scope of work would fall under Section 65 of the Drainage Act with updates to the change in land use and incorporation of new connections to the FMD. The City would engage with the same Drainage Engineer that completed the design of the recently constructed FMD upgrades to confirm adequate outlet (sufficient capacity) and determine if any further work is required under this project. There are sections of the Faulkner Municipal Drain that currently exist inside the urban boundary and will be abandoned as part of the development approval process. Further consultation will be undertaken with the City's Municipal Drain Group to verify and complete all requirements under the Ontario Drainage Act.

2.6 Concept Plan Summary Discussions & Preferred Plan Selection

The preceding evaluations considered along with the Concept Plans reviewed will determine a preferred plan which will be brought forward for the more detailed review and assessment of servicing in Task 3.

Task 3: Functional Servicing Report and Master Infrastructure Review

After the completion of Task 2, the Consulting Team will have developed several Concept Plans based on the findings and any other discipline inputs compiled to date from the Team with a preferred option selected. This will include environmental, stormwater, geotechnical and transportation. For the preferred Concept Plan the municipal servicing constraints criteria (see Task 3.1) will be investigated for the preparation of the servicing analysis. Review will also include comment on suitable servicing routes via either servicing blocks and/or the establishment of right-of-way corridors that have appropriate cross-sections to accommodate the various elements of servicing infrastructure required.

3.1 Evaluation of Municipal Servicing Requirements for the Preferred Concept Plan

DSEL will evaluate infrastructure servicing alternatives for the Concept Plans prepared by considering each option and providing the Team with inputs using the general criteria outlined below in order to resolve the preferred Concept as described in the Fotenn outline memo previously circulated. The tasks envisioned to be included in a Site Servicing and Stormwater Management Report area as follows:

3.1.1 Grading

1. Develop a macro level Grading Plan for the Concept Plans based on the constraints identified by the geotechnical engineer. Grading will be developed in accordance with the criteria described in the Design Guidelines.

3.1.2 Identify and Assess Capacity of Existing Conveyance Systems

1. Based on topographical maps/surveys and servicing reports of existing developments adjacent to the limits of the Study Area, free flowing capacity of watercourses (i.e. Faulkner Drain), roadside ditches and water crossings (if any) will be reviewed.

3.1.3 Water Infrastructure

1. Confirm pressure objectives with the City along feedermains under both domestic and fire flow conditions. Connections will be to the development areas to the north of the Study Area. Coordination with the Water Master Plan to be undertaken with City staff.

2. Calculate domestic demands (average, maximum day and peak hour) based on “system level parameters” (expectation being there will be in excess of 3,000 persons) under the build-out condition of the proposed land use for the selected Concept Plans. The preferred parameters will be provided by the City.

3. Calculate required design fire flow for concurrence by City staff.

4. Calculate theoretical domestic demands for potential phases of development based on a phasing strategy. Develop and populate a base water model for the preferred Concept Plan.

5. Acquire hydraulic boundary conditions at each of the connection points of the existing water distribution system. Proposed connection locations to be concurred with by City Staff.

6. Evaluate the performance of the distribution system against municipal requirements under domestic demand conditions for the Concept Plan. Assess and identify deficiencies and develop system upgrades, if required, to meet municipal requirements from both pressure and demand criteria.

7. Evaluate the performance of the proposed distribution system under a maximum day plus fire flow conditions for the Concept Plans supply characteristics of the pressure zone in accordance with Technical Bulletins.

8. Prepare a Water Servicing Plan for the preferred Concept Plan.

3.1.4 Wastewater Infrastructure

1. Based on the sanitary sewer outlets inventoried as part of Task 2, assess residual capacities. Coordination Wasterwater Master Plan to be undertaken with City Staff.

2. Develop peak wastewater flows based on the land use and population projections for the different land uses associated with the Concept Plans as per the Sewer Design Guidelines.

3. Prepare a Sanitary Drainage Area Plan and Design Sheets for the preferred Concept Plan.

4. Review trunk sanitary sewer routes, establish preliminary invert elevations based on topography and existing outlets. Prepare Sanitary Servicing Plan and assess impact of phasing on infrastructure. Identify servicing constraints, potential crossing conflicts and adjust, as required once the Storm Servicing Plan has been completed.

5. Assess residual capacities, beyond the Study Area population.

6. Review Shea Road Sanitary Pump Station for capacity and potential upgrades. Coordination with the Wastewater Master Plan Project Manager to be undertaken in order to assess conceptual pumping upgrates that will be required to accommodate the expansion area.:

   a. Summarize the existing pump station parameters.

   b. Review of potential component upgrades as well as overflow requirements.

   c. Review electrical changes needed to accommodate higher HP pumps and high-level electrical overview.

d. Transient analysis review.

7. Summarize findings for Wastewater Component within reporting.

3.1.5 Storm Servicing and Stormwater Management

1. Based on the prior Task findings, confirm storm design criteria (quantity and quality) with the RVCA, MECP and the City and discuss potential impacts.

2. Review topographic survey and maps. Based on the storm sewer outlets inventoried as part of prior tasks, confirm outlet locations and inverts, and assess residual capacities and drainage patterns, etc.

3. Review existing conditions hydrological analysis to establish the baseline condition.

4. Finalize capacity assessment of existing surface outlets using desktop calculations.

5. Determine minor and major system drainage boundaries for the Concept Plans based on residual capacities of the existing outlets.

6. Carry out post-development Water Budget based on the Concept Plan. Identify and assess water budget deficits for the preferred Concept Plan.

7. In consultation with the hydrogeologist:

   - Investigate, at the conceptual level, the integration of low impact development (LID) strategies within the Study Area based on inputs from the hydrogeologist
   - evaluate potential infiltration measures, and
   - assess conceptually the performance of the LID strategies and infiltration measures with respect to the potential water budget deficits.

8. Based on the minor and major system boundaries, prepare post-development Storm Drainage Area Plan and Servicing Layout for the preferred Concept Plan. Identify servicing constraints, potential crossing conflicts and adjust, as required.

9. Coordinate with the City Drainage Group regarding the Faulkner Drain and any requirements under the Ontario Drainage Act.

10. Prepare Storm Sewer Design Sheets and Drainage Area Plans for the preferred Concept Plan with appropriate runoff coefficients, assessment of trunk storm sewer inverts etc as per Sewer Design Guidelines.

11. Review and finalize potential end-of-pipe solutions that would satisfy the storm criteria (water quality and quantity) and the most suitable approach and siting (based on topography, soil type etc) for the preferred Concept Plan. Based on the siting of the facilities, establish footprint of the end-of-pipe facilities in accordance with the guidance described in Section 4 of the MECP SWMPDM.

12. Carry out a hydraulic grade line (HGL) analysis of the proposed storm sewer system to evaluate the freeboard between the potential underside of footings and the 1:100 year storm. The analysis is to include the evaluation under the climate change event in accordance with the OSDG.

13. Assess impact of phasing on proposed storm infrastructure.

14. Summarize findings for Stormwater Management within the reporting

3.1.6 Water Budget

1. In consultation with the hydrogeological/geotechnical engineer, JFSA/DSEL will prepare a pre- and post-development water balance review (infiltration, runoff and evapotranspiration) for the site in accordance with the methodology summarized in Section 3.2 of the MECP's "Stormwater Management Planning & Design Manual, March 2003". This will include consideration of *Table 3.1 – Hydrologic Cycle Component Values* and evaluation of 39 years of historical rainfall data from the Ottawa Airport via continuous hydrologic SWMHYMO model simulations. As per 4.7.1 (3.b) of the draft Official Plan.

2. Findings above will also be correlated to the mitigation of potential downstream impacts of the development.

3.1.7 Opinion of Probable Cost and Phasing

1. Coordination with other disciplines to finalize phasing for the Concept Plan in regard to servicing constraints.

2. Prepare an opinion of probable cost for municipal servicing for the preferred Concept Plan.

Marc Pichette, P.Eng.

DSEL

david schaeffer engineering ltd.

MORRISON HERSHFIELD

October 16, 2023

Hugo Lalonde
Director, Land Development
Caivan
3813 Borrisokaen Roade
Ottawa Ontario K2J 4J4

Dear Mr. Lalonde:

Re: Stittsville South W-4 Urban Expansion Area, Class Environmental Assessment Requirements Overview

The new City of Ottawa Official Plan (OP) was approved on November 4, 2022 and added over 1,900 hectares to the urban area including the Stittsville South Urban Expansion Area (SSUEA) and identified by the City as Area W-4. The W-4 lands are shown on Schedule C17 of the Official Plan, excerpt below shown in Figure 1:

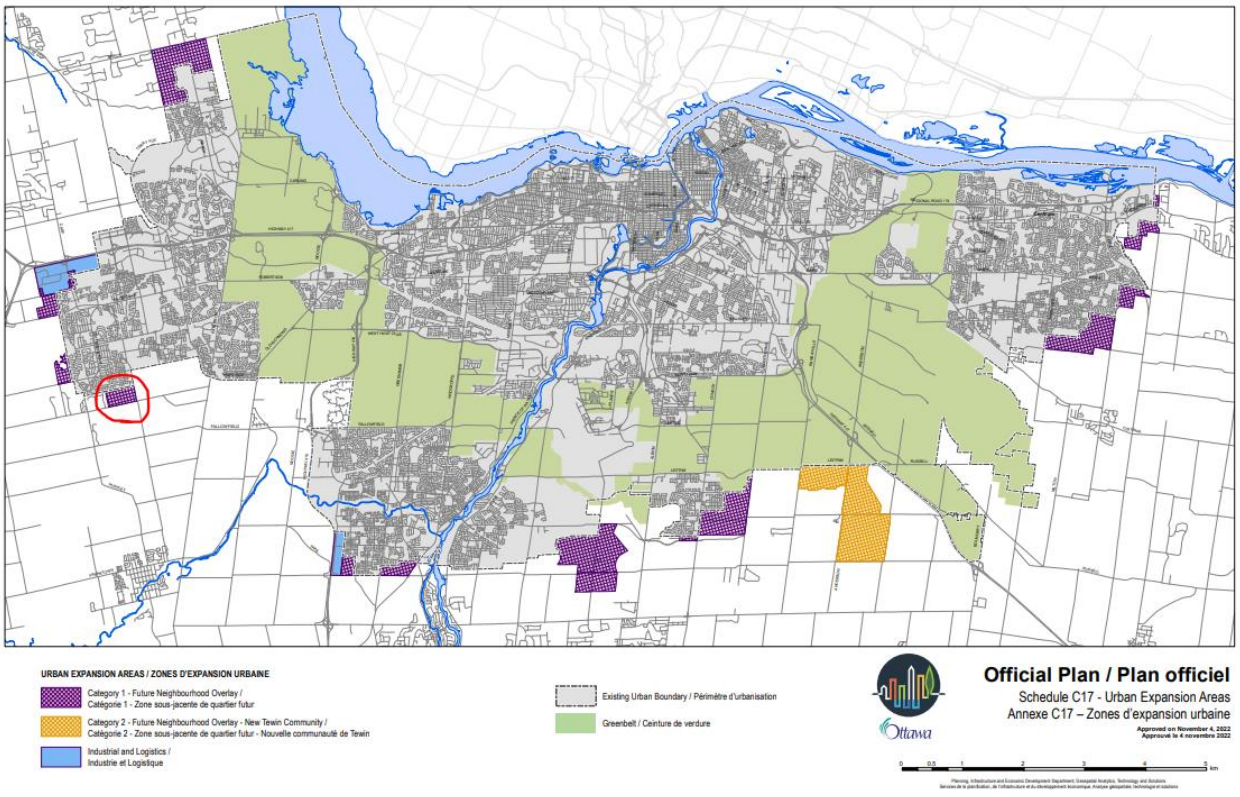

Figure 1: City of Ottawa Official Plan - Schedule C17

The W-4 lands consist of the following parcels and are more accurately shown on Figure 2:

- West Lands (6115 Flewellyn Road and 6070 Fernbank Road under the ownership of Caivan (Stittsville West) Ltd.)
- South Lands (5993 Flewellyn Road and 6030 Fernbank Road under the ownership of Caivan (Stittsville South) Inc.)
- City SWMF lands
- 7 hold out parcels along Shea Road and Flewellyn Road
- Hydro One Network Inc. Corridor

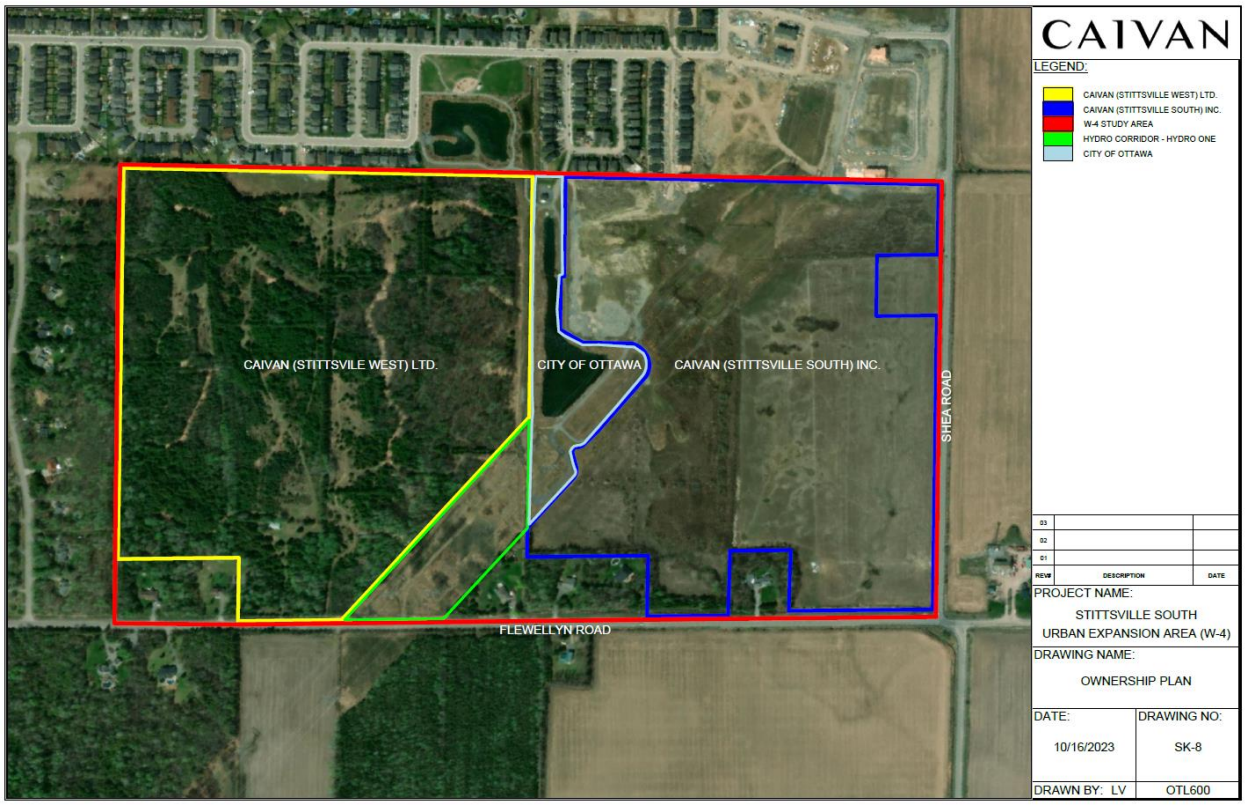

Figure 2: W-4 Study Area

Existing Condition Reports for the W-4 Lands have been completed and submitted to the City of Ottawa for review, including but not limited to:

- Existing Conditions Report – Servicing, DSEL, September 2023
- Stittsville South Expansion Lands Transportation Report, CGH, March 2023

A technical memorandum by DSEL (October 4, 2023), summarizing the findings of the engineering Existing Conditions and advancing preliminary servicing considerations for the future scoped Master Servicing Study for W-4 has also been submitted to the City of Ottawa. This includes the Shea Road PS Capacity upgrade wastewater project as recommended in the draft City of Ottawa Infrastructure Master Plan.

MH has reviewed the above noted documents and the purpose of this memo is to summarize the identified infrastructure projects as they relate to Class EA requirements. The following list identifies infrastructure projects to service the future development area for Caivan's Stittsville South Urban Expansion Area (SSUEA) along with the Class EA requirements as per Appendix 1 of the MCEA (March 2023).

1. Upgrades associated with an existing sanitary pump station (Shea Road Sanitary Pump Station). Upgrades anticipated to consist of:

    a. Potential electrical service to building as well as instrumentation/wiring.
    b. New generator & switchgear.
    c. Potential bigger control building footprint to be assessed at design stage.
    d. New pumps (change all 3 pumps from 30HP to 60HP) and associated variable frequency drives for power supply.
    e. Upsize miscellaneous internal piping.
    f. There is the potential that one of the existing forcemains may have to be upsized. This would also be assessed at the design stage in consultation with City staff.
    g. Provision of a new sanitary emergency overflow pipe to lower sanitary hydraulic grade line constraints for the Caivan landholdings. The new overflow will the overflow from its current location to the existing 'Davidson SWM Pond' to a new SWM Pond associated with development of the Caivan landholdings.

Increase pumping station capacity by adding or replacing equipment and appurtenances, where new equipment is located in an existing building or structure & Extending of existing sewage collection system 'Exempt' from EA process

2. Stormwater management:
    a. Potential to utilize an existing stormwater management pond (the adjacent 'Davidson SWM Pond') for initial phase of development. [Establish new or replace or expand an existing stormwater detention/retention pond where no additional property is required. ***'Exempt' from EA process***
    b. Two new stormwater management facilities that will provide quality and quantity control to the Caivan SSUEA landholdings (a west pond and an east pond). Two facilities are required due to a physical site constraint imposed by the existing Faulkner Municipal Drain which bisects the Caivan landholding. Both new facilities will outlet to the Faulkner Municipal Drain. [Establish new or replace or expand an existing stormwater detention/retention pond where no additional property is required (i.e., owned by Caivan). ***'Exempt' from EA process***
    c. LIDS –strategy/system may be considered. ***'Exempt' from the EA process***

3. Potable water supply will be provided by a southward extension of existing watermains at multiple locations from the development areas to the north of the SSUEA. ***'Exempt' from EA process***

4. Transportation:

a. Local roads which are required as a condition of approval on a site plan, consent, plan of subdivision or plan of condominium which will come into effect under the *Planning Act* prior to the construction of the road. ***'Exempt' from EA process***

b. New collector roads are required as a condition of approval on a plan of subdivision and/or the subdivision agreement which will come into effect under the *Planning Act* prior to the construction of the road.

d. These projects would be 'Exempt' based on the results of the Archaeological Screening Process (Stage 3 AA conducted and no further archaeological assessment or mitigation study is required)

Accordingly, based on our review of the infrastructure requirements for the W-4 Urban Expansion Area, all projects are exempt from the Class EA.

Yours truly,

Kelly Roberts, Principal / Senior Environmental Planner

KRoberts@morrisonhershfield.com
613 739 2910 EXT. 1022303

David Schaeffer Engineering Ltd.
120 Iber Road, Suite 103
Stittsville, ON K2S 1E9
613-836-0856
dsel.ca

EXISTING CONDITIONS REPORT - SERVICING

FOR

STITTSVILLE SOUTH URBAN EXPANSION AREA

CAIVAN (STITTSVILLE SOUTH) INC. & CAIVAN (STITTSVILLE WEST) LTD.

CITY OF OTTAWA

PROJECT NO.: 21-1247

SEPTEMBER 2023 – 1ST SUBMISSION

© DSEL

EXISTING CONDITIONS REPORT - SERVICING
FOR

STITTSVILLE SOUTH URBAN EXPANSION AREA

CAIVAN (STITTSVILLE SOUTH) INC. & CAIVAN (STITTSVILLE WEST) LTD.

TABLE OF CONTENTS

1.0 INTRODUCTION 1

2.0 STUDY AREA 1

2.1 Location 1

2.2 Site Characteristics 2

3.0 BACKGROUND DOCUMENTS 3

4.0 EXISTING INFRASTRUCTURE AND SERVICING 4

4.1 Wastewater Servicing 4

4.2 Water Supply Servicing 7

4.2.1 Existing Water Supply Services 7
4.2.2 Existing Watermains and Operating Pressures 7

4.3 Stormwater Servicing 9

4.3.1 Parade Drive Stormwater Management Facility 9
4.3.2 Davidson Stormwater Management Facility 9
4.3.3 Faulkner Municipal Drain 9
4.3.4 Flowing Creek Municipal Drain 10
4.3.5 Site Drainage 10

5.0 OPPORTUNITIES AND CONSTRAINTS 11

5.1 Drainage Network 11

5.2 Water Quantity Control 11

5.3 Water Quality Control 11

5.4 Infiltration 11

5.5 Existing Servicing Infrastructure 12

5.5.1 Wastewater Servicing 12
5.5.2 Water Servicing 13
5.5.3 Stormwater Servicing 13

6.0 SUMMARY AND CONCLUSIONS 14

6.1 Wastewater Servicing 14

6.2 Water Servicing 14

6.3 Stormwater Servicing 14

APPENDICES

Appendix A	Drawings
Appendix B	Sanitary
Appendix C	Water
Appendix D	Stormwater
Appendix E	Terms of Reference

© DSEL

EXISTING CONDITIONS REPORT - SERVICING
FOR

STITTSVILLE SOUTH URBAN EXPANSION AREA

SEPTEMBER 2023 – 1ST SUBMISSION
CITY OF OTTAWA
PROJECT NO.: 21-1247

1.0 INTRODUCTION

Caivan (Stittsville South) Inc. and Caivan (Stittsville West) Ltd. (Caivan) have retained a Consultant Team to prepare documents to support the Stittsville South Urban Expansion Area (SSUEA)which will be implemented as an Amendment to the City of Ottawa Official Plan (OP) and removal of the Future Neighborhood Overlay on Schedule C17.

Per the City of Ottawa request, a Terms of Reference (TOR) document was prepared and validated by the City (TOR included in Appendix E for reference) to outline the servicing assessment approach for the subject lands. David Schaeffer Engineering Ltd. (DSEL) has been retained to prepare a scoped Master Servicing Study (MSS) to outline water, wastewater, and stormwater management servicing strategies for the SSUEA. In advance of preparing the MSS, an Existing Conditions Report is required to evaluate and assess existing water resources and servicing infrastructure in the vicinity of the SSUEA, and to identify constraints and opportunities that will provide the baseline conditions of an Environmental Management Plan (EMP).

2.0 STUDY AREA

2.1 Location

The properties comprising the Caivan landholdings within the SSUEA are as follows and illustrated in Figure 1:

- ~18.8 ha 6115 Flewellyn Road;
- ~16.1 ha 6070 Fernbank Road;
- ~17.4 ha 5993 Flewellyn Road
- ~12.4 ha (6030 Fernbank Road) parcel and
- ~8.8 ha of holdout land parcels (including Hydro corridor owned lands west of Faulkner Drain) within the SSUEA study area.

The noted land parcels are now designated as Urban Expansion Area in the City of Ottawa Official Plan as of November 2022. As illustrated in the following figure, the overall development area is bound by Flewellyn Road to south, Shea Road to the east, an existing urban subdivision development to the north (Stittsville South – Area 6 ("Edenwylde")) and an estate lot subdivision (Woodside Acres) to the west.

© DSEL

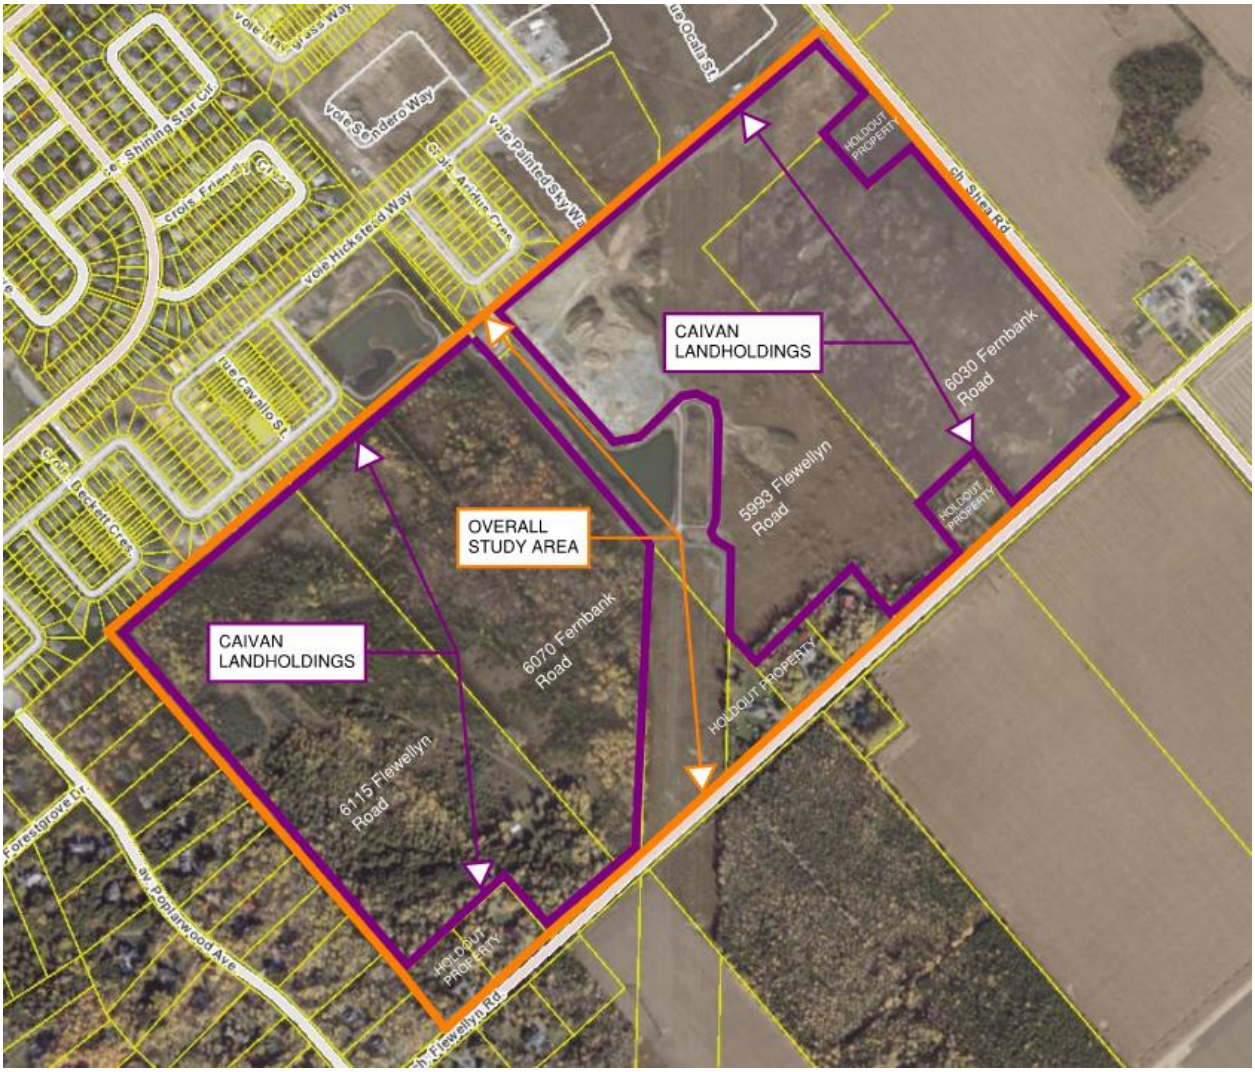

Figure 1: Stittsville South Urban Expansion Area – Location Plan

2.2 Site Characteristics

The subject site is currently undeveloped and is a mix of active/former farmland in the eastern areas and forested areas in the western portion. The overall area is bisected diagonally (north/south) by an existing a Hydro One 500kV utility corridor and an existing stormwater management facility is located centrally within the property and manages flows from a portion of the Edenwylde Subdivision.

In addition, a stormwater conveyance ditch originating from the development areas to the north, runs southward parallel to the east boundary of the Faulkner Property. The ditch officially transitions to being the Faulkner Municipal Drain (FMD) approximately 215 m north of Flewellyn Road and then conveys flows eastward along Flewellyn Road.

For the land parcel west of the Hydro corridor the terrain generally trends lower from northwest to southeast with elevations ranging from 109 m to 103 m. For land area east of

© DSEL

the Hydro corridor the same southeast trend existing with elevations ranging from 104 m to 102 m at Flewellyn Road. The various Existing Conditions figures provided in the Appendices demonstrate the SSUEA site contours.

3.0 BACKGROUND DOCUMENTS

There are a variation of documents and reports that have been prepared in relation to lands surrounding the site. The documents include subwatershed studies of the Jock River, covering the areas south of the site, and servicing documents for the urban area north of the site.

- City of Ottawa Sewer Design Guidelines (City of Ottawa, October 2012) & Technical Bulletins (ISDTB-2014-01, PIEDTB-2016-01, ISTB-2018-01, ISTB-2018-04 & ISTB-2019-02).
- City of Ottawa Water Distribution Guidelines (City of Ottawa, July 2010) & Technical Bulletins (ISD-2010-2, ISDTB-2014-2, ISTB-2018-02, & ISDTB-2021-03).
- Infrastructure Master Plan (City of Ottawa, 2013).
- West Urban Community – Wastewater Collection System Master Servicing Plan (RV Anderson Associates Ltd, July 2012).
- Stittsville Master Drainage Plan (A.J. Robinson, 1994).
- Low Impact Development Technical Guidance Report, Implementation in Areas with Potential Hydrogeological Constraints (Dillon Consulting and Aquafor Beech, February 2021).
- Stormwater Planning and Design Manual (Ministry of the Environment, March 2003).
- Low Impact Development Stormwater Management Guidance Manual (Ministry of the Environment, Conservation and Parks, Draft for Consultation – January 2022).
- Jock River Reach 2 & Mud Creek Subwatershed Study Marshall Macklin Monaghan / WESA, May 2009
- Amendment to the Engineer's Report for the Faulkner Municipal Drain (Robinson, December 2020) & Addendum No. 1 (Robinson, March 2021).
- Engineer's Report for the Flowing Creek Municipal Drain (A.J. Graham Engineering, December 1973).
- Flowing Creek Flood Risk Mapping from Flewellyn Road to Jock River (Rideau Valley Conservation Authority, May 8, 2017).
- Stittsville South – Area 6, City of Ottawa, Master Servicing Report & Stormwater Management Design Plan (Novatech/DSEL, December 2013).
- Stittsville South Subdivision, City of Ottawa – Detailed Servicing & Stormwater Management Report (Novatech July 2016).
- Sanitary Pump Station Pre-Design Report, Stittsville South (Novatech, July 2015)
- Stittsville South Subdivision, City of Ottawa – Shea Road Sanitary Pump Station Design Brief (Novatech, May 6, 2016).

© DSEL

- Design Brief, Davidson Lands – OPA 76 Area 6a, Phase 1 (5993 Flewellyn Road) (IBI Group, February 2018).
- Design Brief, Davidson Lands – OPA 76 Area 6a, Phase 2 (5993 Flewellyn Road) (IBI Group, July 2020).

- Design Brief for the Stormwater Management Pond for the Davidson Lands (JFSA/DSEL, November 2017).
- Fernbank Community Design Plan, Master Servicing Study (Novatech, June 2009).
- Geotechnical Investigation, Proposed Residential Development 5993, 6070 & 6115 Flewellyn Road – Ottawa (Paterson (PG5570-2) January 2022).

4.0 EXISTING INFRASTRUCTURE AND SERVICING

4.1 Wastewater Servicing

A recently (2017) constructed sanitary pump station (Stittsville South Area 6 Sanitary Pumping Station – also referred to as the Shea Road Pump Station (SRPS)) associated with the recent new development to the north is located along the north boundary centrally to the land parcels being reviewed (immediately north of an existing stormwater management pond (Davidson Pond)). As per the Environmental Compliance Approval (ECA #3415-ADWLJG issued September 21, 2016. See ***Appendix B***) for the pump station, the initial firm capacity of the station was 42 L/s with recently completed pump expansions to an ultimate firm design capacity of 84 L/s (December 2022).

A 450mm diameter sanitary sewer connects to the existing Shea Road sanitary pump station. The existing 450mm diameter inlet sanitary sewer has an inlet pipe elevation of 98.72 m at the last manhole upstream of the station and wet well invert elevation of 96.50 m. The inlet sewer has a residual capacity of approximately 80% which would allow for an additional ~390 L/s of sanitary flows.

Previously, the SRPS directed forcemain flows northward to the existing Liard Street pumping station. As of December 2022 the SRPS now directs flows directly to the recently completed extension of the Fernbank Lands trunk sanitary sewer. Additionally, there is an existing low lift pumping station located on nearby Friendly Crescent which provides service to 70 dwellings and discharges to the Hartsmere Drive sanitary sewer through a 100mm diameter forcemain. Ultimately this low lift station will be decommissioned and the sanitary flows redirected to the SRPS. Timing for this decommissioning is still pending.

As per the Master Servicing Report for the *Stittsville South – Area 6* development, there is excess capacity available in the Fernbank Lands trunk sewer (see report excerpt in ***Appendix B).*** The *Area 6* study summarized that the Fernbank Trunk was designed for a peak flow of 528 L/s (*Fernbank CDP Lands – New Trunk Sewer* sanitary design sheet provided in ***Appendix B*** for reference) and had a capacity of 670 L/s (excess capacity of 142 L/s). The Area 6 report further summarized that the *Area 6* and Liard Street P.S. (monitored) flows to the Fernbank Trunk totaled approximately 85 L/s and 39 L/s respectively and would utilize a portion of this capacity. However, the original design criteria of the Fernbank Trunk system (and Area 6)

© DSEL

was based on older City of Ottawa design criteria. When considering the new criteria adopted by the City after those designs the excess capacity available is increased.

Table 1
Sanitary Flow Review

Network Reviewed	Area (ha)	Pop.	PF (7)	Q_{units} (L/s)	$Q_{Com/Inst}$ (L/s)	$Q_{I/I}$ (L/s)	Q_{TOT} (L/s)	Diff. (L/s)
Old City Parameters for Sanitary (1)								
Fernbank CDP Lands (2)	551.8	30,169	2.47	302.5	71.0	154.5	528.0	--
Stittsville Area 6(3)	70.74	4,502	3.29	59.94	2.37	19.81	82.1	--
Liard St P.S. (monitored) (4)	--	--	--	--	--	--	39.0	--
New City Parameters for Sanitary (5)								
Fernbank CDP Lands	551.8	30,169	2.18	213.1	39.76	182.09	435.0	-93.0
Stittsville Area 6	70.74	4,502	2.83	41.2	1.33	23.34	66.0	-16.1
Liard St P.S. (monitored) (6)	--	--	--	--	--	--	39.0	0

(1) Old City Parameters: 350 L/day; 0.28 L/s/ha infiltration; Comm./Inst. Flow = 50,000 l/ha/day
(2) Sanitary design sheet excerpt provided in Appendix B. From "Fernbank Community Design Plan – Master Servicing Study (June 2009)"
(3) Sanitary design sheet excerpt from updated IB design for Edenwylde development. From City submission 2020-04-09"
(4) Liard Street pump station – monitored flow summary from the "*West Urban Community – Wastewater Collection System Master Servicing Plan*" by RV Anderson Associates Ltd., dated July 2012 and as summarized in the Area 6 MSS.
(5) New City Parameters: 280 L/day; 0.33 L/s/ha infiltration; Comm./Inst. Flow = 28,000 l/ha/day; updated Peak Factor correction factor
(6) Same value as prior as it was monitored information.
(7) Peaking Factor

From the table above the flow summarized in the Fernbank Lands trunk is reduced from 528.0 L/s to ~435.0 L/s (-93.0 L/s) based on review with new parameters.
The Area 6 land development flows are reduced from 82.1 L/s to ~66.0 L/s (-16.1 L/s).

The *Area 6 MSS* summarized excess capacity at peak flow in the Fernbank Lands trunk at 142 L/s. With the new parameters this excess capacity increases to 235 L/s based on the above table with 105 L/s of that taken up by the Area 6 and the Liard St. P.S. flows (130 L/s capacity remaining).

Construction of the Fernbank Lands trunk extension up to the Area 6 development was completed/commissioned in December 2022.

The SRPS details are as follows:

- pump station control building complete with mechanical and electrical systems, process piping, valves, control panels, SCADA system, odour control system, swab launchers and appurtenances;
- one (1) 2400 mm diameter FRP wet well, complete with valves, couplings and appurtenances; with three (3) pumps with each pump capable of delivering 42

© DSEL

liters/second at a TDH of 29 meters for an ultimate firm capacity of 84 liters/second;

- wastewater flows are pumped via dual 200 mm diameter HDPE DR13.5 sanitary forcemains to a to a new discharge chamber on Fernbank Road outletting flows to the newly constructed Fernbank Sanitary Trunk Sewer (completed/commissioned in December 2022);
- one (1) 2400 mm x 1800 mm concrete by-pass chamber, complete with valves, couplings and appurtenances;
- one (1) 1800 mm diameter concrete by-pass manhole, complete with valves, couplings and appurtenances;
- one (1) 1800 mm diameter concrete emergency overflow manhole, complete with one (1) primary measuring device consisting of broad crest weir complete with ultrasonic level recorder (referred to as SAN MH 97);
- one (1) concrete encased underground dedicated commercial hydro service;
- one (1) 170 KW self-enclosed diesel generator on a reinforced concrete pad adjustment to the pump station control building, complete with diesel fuel tank, valves and controls;
- emergency sanitary sewer overflow consisting of a 600 mm diameter sewer to the adjacent Davidson Stormwater Management facility located south of the SRPS (outlet elevation 103.40 m).

© DSEL

4.2 Water Supply Servicing

4.2.1 Existing Water Supply Services

The SSUEL study area will be part of the City's Zone 3W of the City of Ottawa water distribution network (see Drawing 3 for reference). The pressure zone receives supply from the Campeau Drive and Glen Cairn Pump stations. The Stittsville Elevated Tank provides balancing storage during peak usage and fire flow conditions.

Existing watermains to the north of the subject lands represent the only option for water servicing. These include:

- The major water supply line in the vicinity of the development is a 400mm diameter watermain along Fernbank Road;
- An existing 250mm diameter watermain located within the Parade Drive right-of-way (ROW), immediately north of the Maguire and Faulkner land parcels. A future southbound ROW block is located between civic addresses 714 and 720 Parade Drive;
- An existing 250mm diameter watermain is located within the Aridus Crescent ROW which is north of the Davidson Lands parcel. An existing 50mm water service within a servicing block from Aridus Crescent to the SRPS pump station is also installed facilitating water supply to that facility;
- An existing 200mm diameter watermain located within the Painted Sky Way ROW at the northwest portion of the Davidson land parcel; and
- An existing 200mm diameter watermain location within the Ocala Street ROW north of the northeastern portion of the Davidson land parcel.

4.2.2 Existing Watermains and Operating Pressures

In relation to the Stittsville Area 6 development areas to the north, the water supply was reviewed for two separate analyses:

1. Stantec Consulting Ltd. prepared a hydraulic analysis of the proposed western portion of the Area 6 lands in their report titled "Stittsville Area 6 – Phase 1 & 2 – Potable Water Hydraulic Assessment (September 2, 2015). This model was based on the City up to date model that was updated for the 2013 Water Master Plans with current (in 2015) conditions and future conditions (projected 2031 conditions from the 2013 Water Master model) analyzed.
2. IBI Group prepared a hydraulic analysis as part of their "Design Brief – Davidson Lands – OPA 76 Area 6a, Phase 1" (February 2018) servicing reporting for the eastern portion of the Stittsville Area 6 lands. This analysis was based on boundary conditions provided by the City of Ottawa (see report excerpts in ***Appendix C***).

The Stantec analysis above notes that head losses under peak demands could reduce minimum pressure to below guideline requirements at higher elevations (i.e. ground elevations greater than 124m). However, future planned connections within the Fernbank Lands development area will mitigate the issue.
During average day demands ground elevations less than 106m may experience system pressures greater than the upper 80psi limit specified in City guidelines. As noted in Section

© DSEL

2.2, existing site elevations range from 109 m to 103 m (for areas west of the Hydro One corridor) and from 104 m to 102 m in the eastern areas. Should higher pressures be encountered in the southern areas of the development pressure reducing valves would be required.

Water servicing needs in the SSUEA will be evaluated as part of the future MSS review of the development area in consultation with City staff via the generation of hydraulic boundary conditions.

© DSEL

4.3 Stormwater Servicing

4.3.1 Parade Drive Stormwater Management Facility

The residential development area to the north of the Maguire/Faulkner properties is serviced via an existing 1.9 ha stormwater pond block adjacent to Parade Drive. This stormwater facility has the following characteristics:

Drainage Area = ~33.7ha
Permanent Pool Elevation = 103.50 m
Extended Detention Elevation = 103.70 m
100-Year Elevation = 105.33 m

The facility outlets to an existing ditch located east of the storm outlet. The ditch is approximately 405 m upstream of the commencement of the Faulkner Municipal Drain.

4.3.2 Davidson Stormwater Management Facility

The existing development to the north of the Davidson/Eder properties is serviced by the central "Davidson" stormwater management pond. The existing Davidson stormwater pond occupies approximately 3.2 ha of land and is partially located under the existing Hydro One tower line. The ponds are sized for their respective areas with no specific additional areas considered. This stormwater facility has the following characteristics:

Drainage Area = ~40.6 ha
Permanent Pool Elevation = 101.50 m
Extended Detention Elevation = 102.10 m
100-Year Elevation = 103.17 m

The facility outlets from the south end of its configuration to a ditched outlet that conveys the flows southwest to the Faulkner Municipal Drain.

4.3.3 Faulkner Municipal Drain

The Faulkner Municipal Drain (FMD) generally bisects the whole of the development area in half. The FMD conveys flows from north to south to the north side of Flewellyn Road (i.e. roadside ditch) then heads eastward and then southwards along the west side of Shea Road. The FMD drain begins at approximately 215 m north of Flewellyn Road (within the development lands) and ultimately discharges to Flowing Creek Municipal Drain 5.45 km away (approximately 330 m south of the intersection of Shea Road and Brownlee Road). Figure 6.1 (*Maintenance Sections and Section Drainage Areas*) from the Engineer's Report is provided in **Appendix D** for reference.

The Engineer's Report for the FMD was recently amended in December 2020 by Robinson Consultants Inc. to accommodate the changes in land use from rural, or agricultural, to urban development. Additionally, some modifications of the main drain were also documented in order to relocate a portion, lower the profile in some locations, and modify the cross-section where required in order to increase capacity and reduce erosion potential. No specific erosion thresholds are noted for the FMD in the Engineer's Report.
Subsequent to the amended Report, there was a minor addendum in March 2021 to account for an adjustment in the prescribed value for lands utilized for construction of the drain and the resultant modified value of allowances.

© DSEL

The FMD model will be utilized during the design of future stormwater management facilities to confirm that there will be no negative impacts to water levels or capacity of the drain in the post-development condition. JFSA has reviewed the existing conditions as a component of their "*Pre-Development Hydraulic and Hydrologic Study*" (provided in **Appendix D**) and noted some private access culverts along Flewellyn Road are close to or at capacity as summarized in the Engineer's Report Table 4.2. These culverts can be revisited in association with future consultation with the Drainage Engineer is association with the advancement of the development area.

4.3.4 Flowing Creek Municipal Drain

As noted in the prior section, the FMD outlets to the Flowing Creek Municipal Drain (FCMD) south of Brownlee Road. The Engineer's Report for FCMD was prepared by A.J. Graham Engineering Consultants Limited in December 1973 and was constructed in 1974 by the former Township of Goulbourn. There are no known issues with the FCMD.

The Rideau Valley Conservation Authority completed Flood Risk Mapping for Flowing Creek in May 2017 (covering from Flewellyn Road to the confluence with the Jock River). The RVCA report makes reference to some possible shallow field flood areas southwest of Akins/Shea Road, however, it goes on to detail the 'considerable uncertainty' as to how this may occur and whether there would be any material impact to the adjacent FMD (see RVCA report excerpts in ***Appendix D*** for reference). However, it is presumed that the Drainage Engineer for the FMD has considered this potentiality based on their recent FMD improvements and knowledge of the FCMD Flood Risk Mapping results.

4.3.5 Site Drainage

For the Caivan landholdings west of the Hydro one corridor the site topography generally drains eastward and southward with drainage ultimately being conveyed to the FMD which bisects the development area.

Similarly, the development area east of the Hydro One corridor also drains eastward and southward to the portion of the FMD along the northern Flewellyn Road right-of-way.

JFSA has reviewed the development area's existing conditions as a component of their "*Pre-Development Hydraulic and Hydrologic Study*" provided in **Appendix D** for reference.

There are no minor storm sewer systems that the development area is tributary to.

© DSEL

5.0 OPPORTUNITIES AND CONSTRAINTS

5.1 Drainage Network

The review of site topography has generally shown that surface water is conveyed to adjacent perimeter roadside ditches and the Faulkner Municipal Drain.

As a component of the review of storm servicing for the future MSS, any adjustment to drainage boundaries or outlets will require consultation with appropriate agencies. Generally speaking, the development only has one viable stormwater outlet which is the FMD and stormwater management facilities will be located at the southern boundary of study area due to site topography. Therefore any adjustments will need to be coordinated with the Drainage Engineer and any processes completed in accordance with the Drainage Act. This includes consideration of the Flowing Creek Municipal Drain (FCMD) (which the FMD connects to) and ultimately the Jock River.

Lands which comprise the SSUEA are not restricted by floodplain areas from any major watercourses. Preliminary review of the FMD HEC-RAS modelling associated with the recently updated Engineer's Report (see Section 4.3.3) has indicated that there may be private access culverts on the FMD along Flewellyn Road that could constrain flows during the 100-year event and these will be further assessed in future design stages in consultation with the Drainage Engineer.

5.2 Water Quantity Control

Water quantity controls for the development area will be impacted by various site constraints (i.e. infiltration potential, development density, etc) as well as downstream capacities. At minimum, post-development peak flows within the FMD are not to exceed pre-development levels for all storms up to the 100-year event. Generally this will require review of the FMD and FCMD based on the on-site controls implemented and also manage runoff volumes so as not to create downstream impacts. Prior consultation with the RVCA for other development areas tributary to the Jock River has indicated that there are no quantity control required within the Jock River Reach 2 subwatershed. Updated subwatershed reporting is currently a work in progress.

5.3 Water Quality Control

Water quality control for the development area will have to be in accordance with the Jock River Reach 2 & Mud Creek Subwatershed Study. Similar to the adjacent development areas recently advanced, this would mean that the requirement is for an enhanced protection level (80% TSS removal) of water quality treatment.

5.4 Infiltration

The Hydrogeological review completed by Paterson Group characterized the hydrogeological condition of the SSUEA with respect to bedrock and surficial geology, aquifers, aquitards, horizontal and vertical flow patterns, existing groundwater use, and aquifer vulnerability. The report generally summarizes that the overburden and bedrock within the SSUEA have hydraulic conductivity values ranging from 4.2×10^{-6} m/sec to 2.2×10^{-5} m/sec (moderate hydraulic conductivity) and 4.3×10^{-7} m/sec to 1.6×10^{-4}, respectively (refer to the *Table 2* summary from the Paterson report in ***Appendix D***). Field saturated conductivity values from Paterson's *Table 3* are also provided. Highest surficial field saturated values were observed

© DSEL

within the southwestern portion of the subject site indicating that this area will have more permeable characteristics than the northeastern areas and as such are more conducive for providing LID measures for water balance and could be considered for optimizing the rate of infiltration via typical lot level and conveyance Best Management Practices (BMPs).

JFSA has reviewed the development area's existing conditions as a component of their "*Pre-Development Hydraulic and Hydrologic Study*" provided in **Appendix D** for reference. JFSA's water budget modelling considered the shallow infiltration results, as reported by Paterson, in their analysis. The JFSA detailed PCSWMM model was run for 39 year, from 1967 to 2007, using hourly rainfall data from Environment Canada's Ottawa International Airport monitoring station. Table 1 from the JFSA report are provided in ***Appendix D*** for reference. The table outlines the water budget breakdown of the development area of the SSUEA. Based on the simulations, JFSA assessed that the eastern portion of the development area (east of the Faulkner Drain) will have 17% of the annual rainfall resulting in runoff with 63% evaporating and 20% infiltrating.

Mapping from the Mississippi-Rideau Source Protection Plan indicates that some portions of the development area may fall under the fringes of the Significant Groundwater Recharge Area (SGRA) mapping. The site review by Paterson has indicated that the high Rock Quality Designation (RQD) of the bedrock within the site area supports an interpretation that the significance of the recharge to the bedrock aquifer is minimal.

5.5 Existing Servicing Infrastructure

The following opportunities and constraints have been identified for the SSUEA and will be reviewed in further detail in a future MSS.

5.5.1 Wastewater Servicing

Wastewater servicing for the SSUEA is governed by the capacity of the SRPS (and its forcemains) and ultimately by the available residual capacity in the existing recently completed Fernbank Lands Sanitary Trunk sewer. As per the Master Servicing Report for the Stittsville South – Area 6 development, there is excess capacity available in the Fernbank Lands trunk sewer. The Area 6 study summarized that the Fernbank Trunk was designed for a peak flow of 528 L/s and had a capacity of 670 L/s (excess capacity of 142 L/s). The prior sanitary system flows were based on older City of Ottawa parameters. When evaluations flows based on updated parameters in Technical Bulletin ISTB-2018-01 the excess capacity is theoretically increased to 235 L/s.

The existing SRPS also has an emergency overflow outlet (internal weir elevation of 103.40m – see Novatech Drawing No. 113004-PS-SVC in ***Appendix B***) to the adjacent "Davidson" stormwater management pond to the south. This overflow will have to be assessed at detailed design to determine if a new overflow is required based on projected underside of footing elevations during the future MSS preparation.

As noted in Section 4.1 the existing sanitary sewer inlet at the SRPS is at an invert elevation of 98.72m. Existing ground elevations in the southeast portion of the SSUEA are as low as ~101.60m which imposes some constraint in terms of fill import required to facilitate a gravity system that would conveys sanitary flows all the way to the SRPS approximately 1km away.

© DSEL

5.5.2 Water Servicing

Based on prior analyses undertaken for development areas within Area 6 to the north of the subject site, lower water pressures are anticipated during peak hours in areas with ground elevations of 124m or higher and high pressures during average day demands for areas with ground elevations lower than 106m. A future detailed analysis to be prepared in conjunction with the MSS will determine where mitigation may be required within the watermain network.

5.5.3 Stormwater Servicing

There are currently no existing or planned stormwater management facilities associated with the SSUEA lands. The overall site currently drains to the Faulkner Municipal Drain via sheet drainage and various periphery roadside drainage ditches. The FMD poses a constraint for the development area given that it bisects the central portion of the development area while topography for the lands areas on either site have the same northwest to southeast drainage pattern. This drainage pattern does provide the opportunity to have a wet pond facility adjacent to the FMD as an outlet(s) at the southern boundary of the development areas but detailed review during MSS preparation will fully assess whether one or two facilities would ultimately be required.

© DSEL

6.0 SUMMARY AND CONCLUSIONS

6.1 Wastewater Servicing

The sanitary flows from the SSUEA will require conveyance by sanitary pumping to convey flows to the Fernbank Lands Trunk sewer. Gravity flows to the existing SSUEA are possible but are likely constrained by the extent of fill importation required to facilitate sufficient sewer cover on a gravity system in the lower (southern) areas of the SSUEA based on site topography. This includes having appropriate freeboard over the sanitary overflow for the SRPS.

The MSS should evaluate proposed servicing alternatives should fill importation be deemed excessive (i.e. new pumping facility, relocation of the SRPS, etc). In addition, the MSS should review the SRPS sanitary overflow condition and assess whether a new overflow elevation to another location (i.e. a new SWM facility) is warranted to further mitigate site grading conditions.

6.2 Water Servicing

At the Master Servicing Study stage the water supply for the SSUEA will be assessed via a hydraulic assessment of the proposed distribution network in order to confirm sufficient water supply is available, and within the required pressure ranges, under future demands during average day, peak hour and fire flow conditions. Watermain boundary conditions will be requested from the City of Ottawa and the analysis will be completed in accordance with the most current design guidelines and technical bulletins.

6.3 Stormwater Servicing

There are currently no planned stormwater management facilities associated within the SSUEA. The local drainage for the subject area is ultimately conveyed by the FMD which bisects the SSSUEA lands.

The site topography has natural gradients from the northwest to the southeast lending to the practical implementation of stormwater management facility/facilities in the southern areas of the site, with an outlet to the FMD. It is anticipated that any proposed facility/facilities could provide both quantity and quality control to meet required targets. Quantity control would be required to maintain the integrity of the FMD and mitigate any increases in water levels within that system. The MSS will detail the target requirements of the facilities.

A review of options for adjustments to the FMD, where it bisects the site, can be reviewed as part of the MSS but there appears to be limited opportunities due to the location of the FMD in relation to holdout properties not under control by the proponent.

Analyses completed by Paterson Group and JFSA have shown areas of moderate hydraulic conductivity. The MSS will quantify the post-development water balance to summarize that a water balance condition is met.

© DSEL

Prepared by,
David Schaeffer Engineering Ltd.

Per: Kevin L. Murphy, P.Eng.

© DSEL
20230912_stittsville_south_exconditions_final.docx

APPENDIX A

DRAWINGS

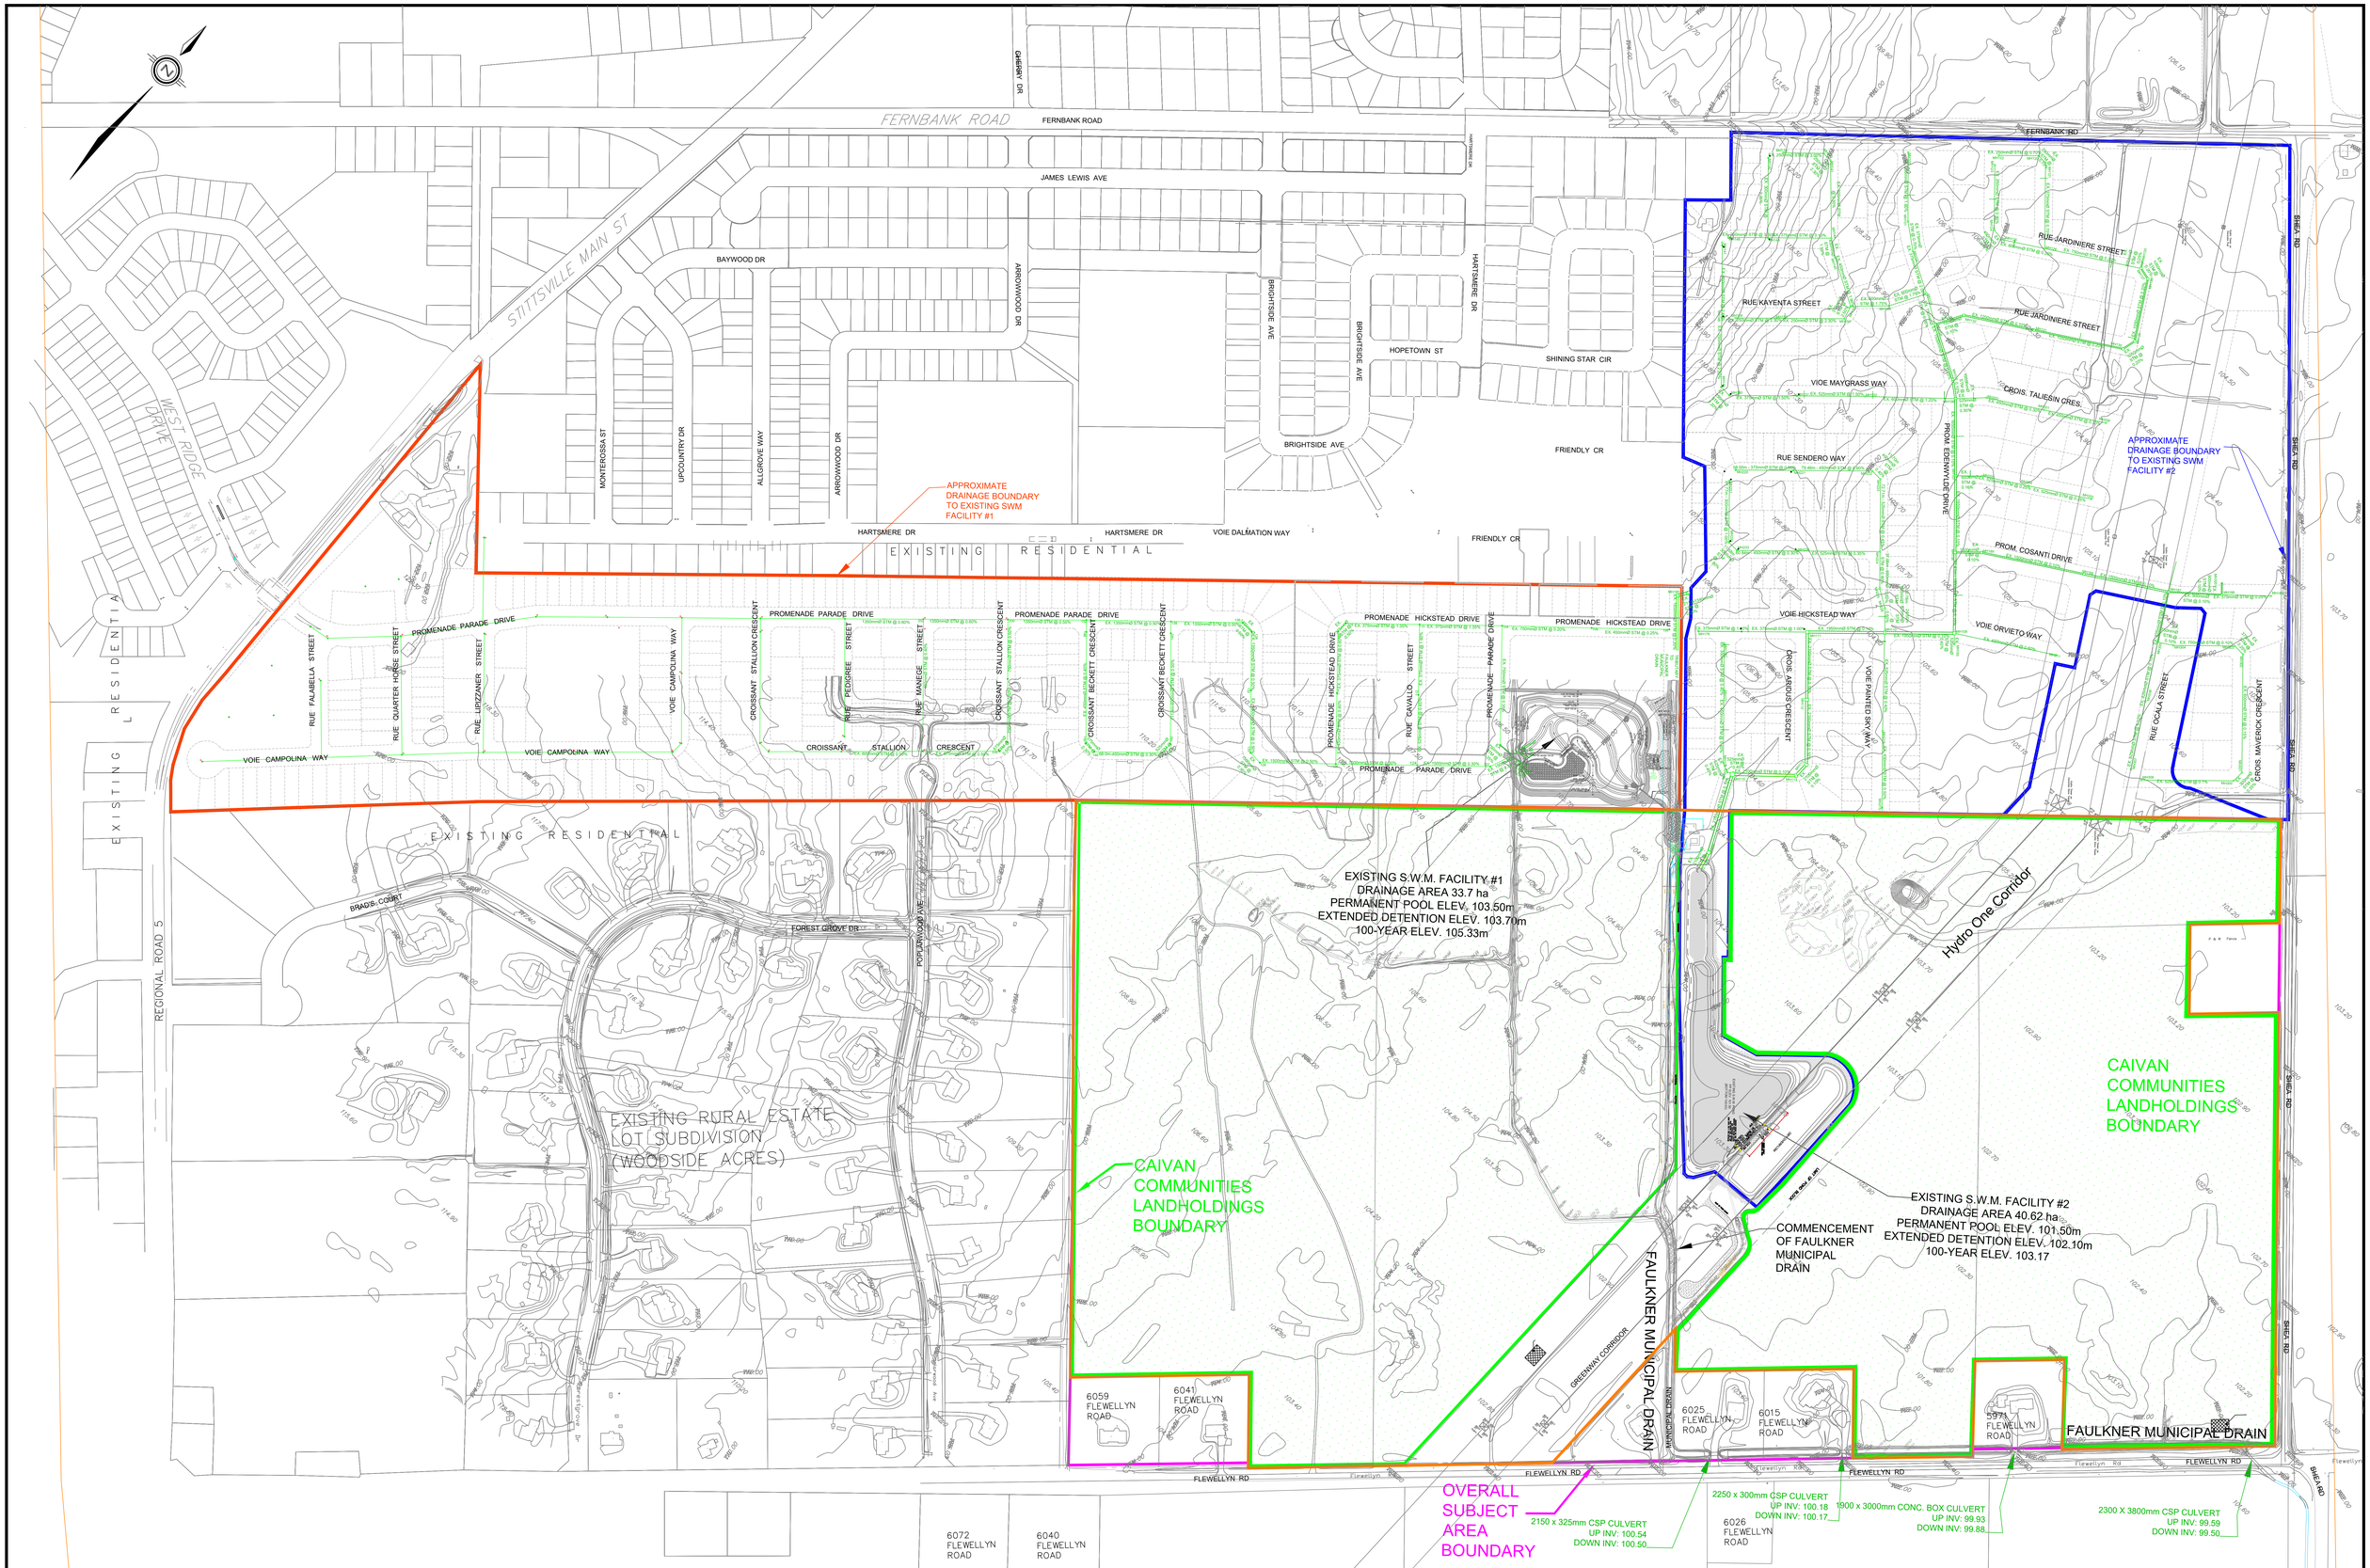

DSEL
120 Iber Road, Unit 103
Stittsville, Ontario, K2S 1E9
Tel. (613) 836-0856
Fax. (613) 836-7183
www.DSEL.ca

STITTSVILLE SOUTH URBAN EXPANSION AREA

STORM SERVICING EXISTING CONDITIONS

CITY OF OTTAWA

LEGEND

- EXISTING STORM MANHOLE
- EXISTING STORM SEWER
- OVERALL SUBJECT AREA BOUNDARY
- CAIVAN LANDHOLDINGS

PROJECT No.:	21-1247
DATE:	Sep 2023
SCALE:	1:2000
DRAWING:	1

FORCEMAIN CONNECTION POINT AS OF DECEMBER 2022

CONSTRUCTED AS OF DECEMBER 2022

EX. LIARD STREET SANITARY PUMP STATION

GHERRY DR

FERNBANK ROAD

JAMES LEWIS AVE

STITTSVILLE MAIN ST

BAYWOOD DR

ARROWWOOD DR

BRIGHTSIDE AVE

HARTSMERE

HOPETOWN ST

SHINING STAR CIR

EX. FRIENDLY CRESCENT SANITARY PUMP STATION TO BE DECOMMISSIONED IN FUTURE WITH FLOWS DIRECTED TO SHEA ROAD PUMP STATION

FRIENDLY CR

VOIE DALMATION WAY

MONTEROSSA ST

UPCOUNTRY DR

ALLGROVE WAY

HARTSMERE DR

EXISTING RESIDENTIAL

WEST RIDGE DRIVE

RUE JARDINIERE STREET

RUE KAYENTA STREET

VIOE MAYGRASS WAY

CROIS. TALIESIN CRES.

RUE SENDERO WAY

PROM. EDENWYLDE DRIVE

PROM. COSANTI DRIVE

VOIE HICKSTEAD WAY

VOIE ORVIETO WAY

CROIS. ARDUS CRESCENT

VOIE HAMPTON WAY

RUE OCALA STREET

CROIS MAVERICK CRESCENT

SHEA RD

PROMENADE PARADE DRIVE

PROMENADE HICKSTEAD DRIVE

RUE FALABELLA STREET

RUE QUARTER HORSE STREET

RUE LIPIZZANER STREET

VOIE CAMPOLINA WAY

CROISSANT STALLION CRESCENT

RUE PEDIGREE STREET

RUE MANEGE STREET

CROISSANT BECKETT CRESCENT

RUE CAVALLO STREET

PROMENADE PARADE DRIVE

CROISSANT STALLION CRESCENT

EXISTING RESIDENTIAL

REGIONAL ROAD 5

BRADIS COURT

FOREST GROVE DR

FOREST GROVE AVE

EXISTING RURAL ESTATE LOT SUBDIVISION (WOODSIDE ACRES)

EX. SHEA ROAD SANITARY PUMP STATION (57 Aridius Crescent)

- one (1) 2400 mm diameter FRP wet well,
- houses three (3) pumps with each pump capable of delivering 42 litres /second at a TDH of 29 metres for an ultimate firm capacity of 84 litres/second;(commissioned as of December 2022)
- wastewater flows are pumped via approximately 815.0 metres of dual 200 mm diameter HDPE DR13.5 sanitary forcemains to a discharge chamber at Fernbank Road outletting flows to the Fernbank Sanitary Trunk Sewer.
- one (1) 170 KW self - enclosed diesel generator complete with diesel fuel tank, valves and controls;
- emergency sanitary sewer overflow consisting of a 600 mm diameter sewer to the adjacent SWM Facility #2 (to the south).

Hydro One Corridor

CAIVAN COMMUNITIES LANDHOLDINGS BOUNDARY

CAIVAN COMMUNITIES LANDHOLDINGS BOUNDARY

FAULKNER MUNICIPAL DRAIN

GREENWAY CORRIDOR

OVERALL SUBJECT AREA BOUNDARY

6059 FLEWELLYN ROAD

6041 FLEWELLYN ROAD

6025 FLEWELLYN ROAD

6015 FLEWELLYN ROAD

5971 FLEWELLYN ROAD

6026 FLEWELLYN ROAD

6072 FLEWELLYN ROAD

6040 FLEWELLYN ROAD

FLEWELLYN RD

120 Iber Road, Unit 103
Stittsville, Ontario, K2S 1E9
Tel. (613) 836-0856
Fax. (613) 836-7183
www.DSEL.ca

STITTSVILLE SOUTH URBAN EXPANSION AREA

SANITARY EX. CONDITIONS

CITY OF OTTAWA

LEGEND

- EX. SANITARY MANHOLE
- EX. SANITARY SEWER
- EX. SANITARY FORCEMAIN
- OVERALL SUBJECT AREA BOUNDARY
- CAIVAN LANDHOLDINGS

PROJECT No.:	21-1247
DATE:	Jan 2023
SCALE:	1:2000
DRAWING:	2

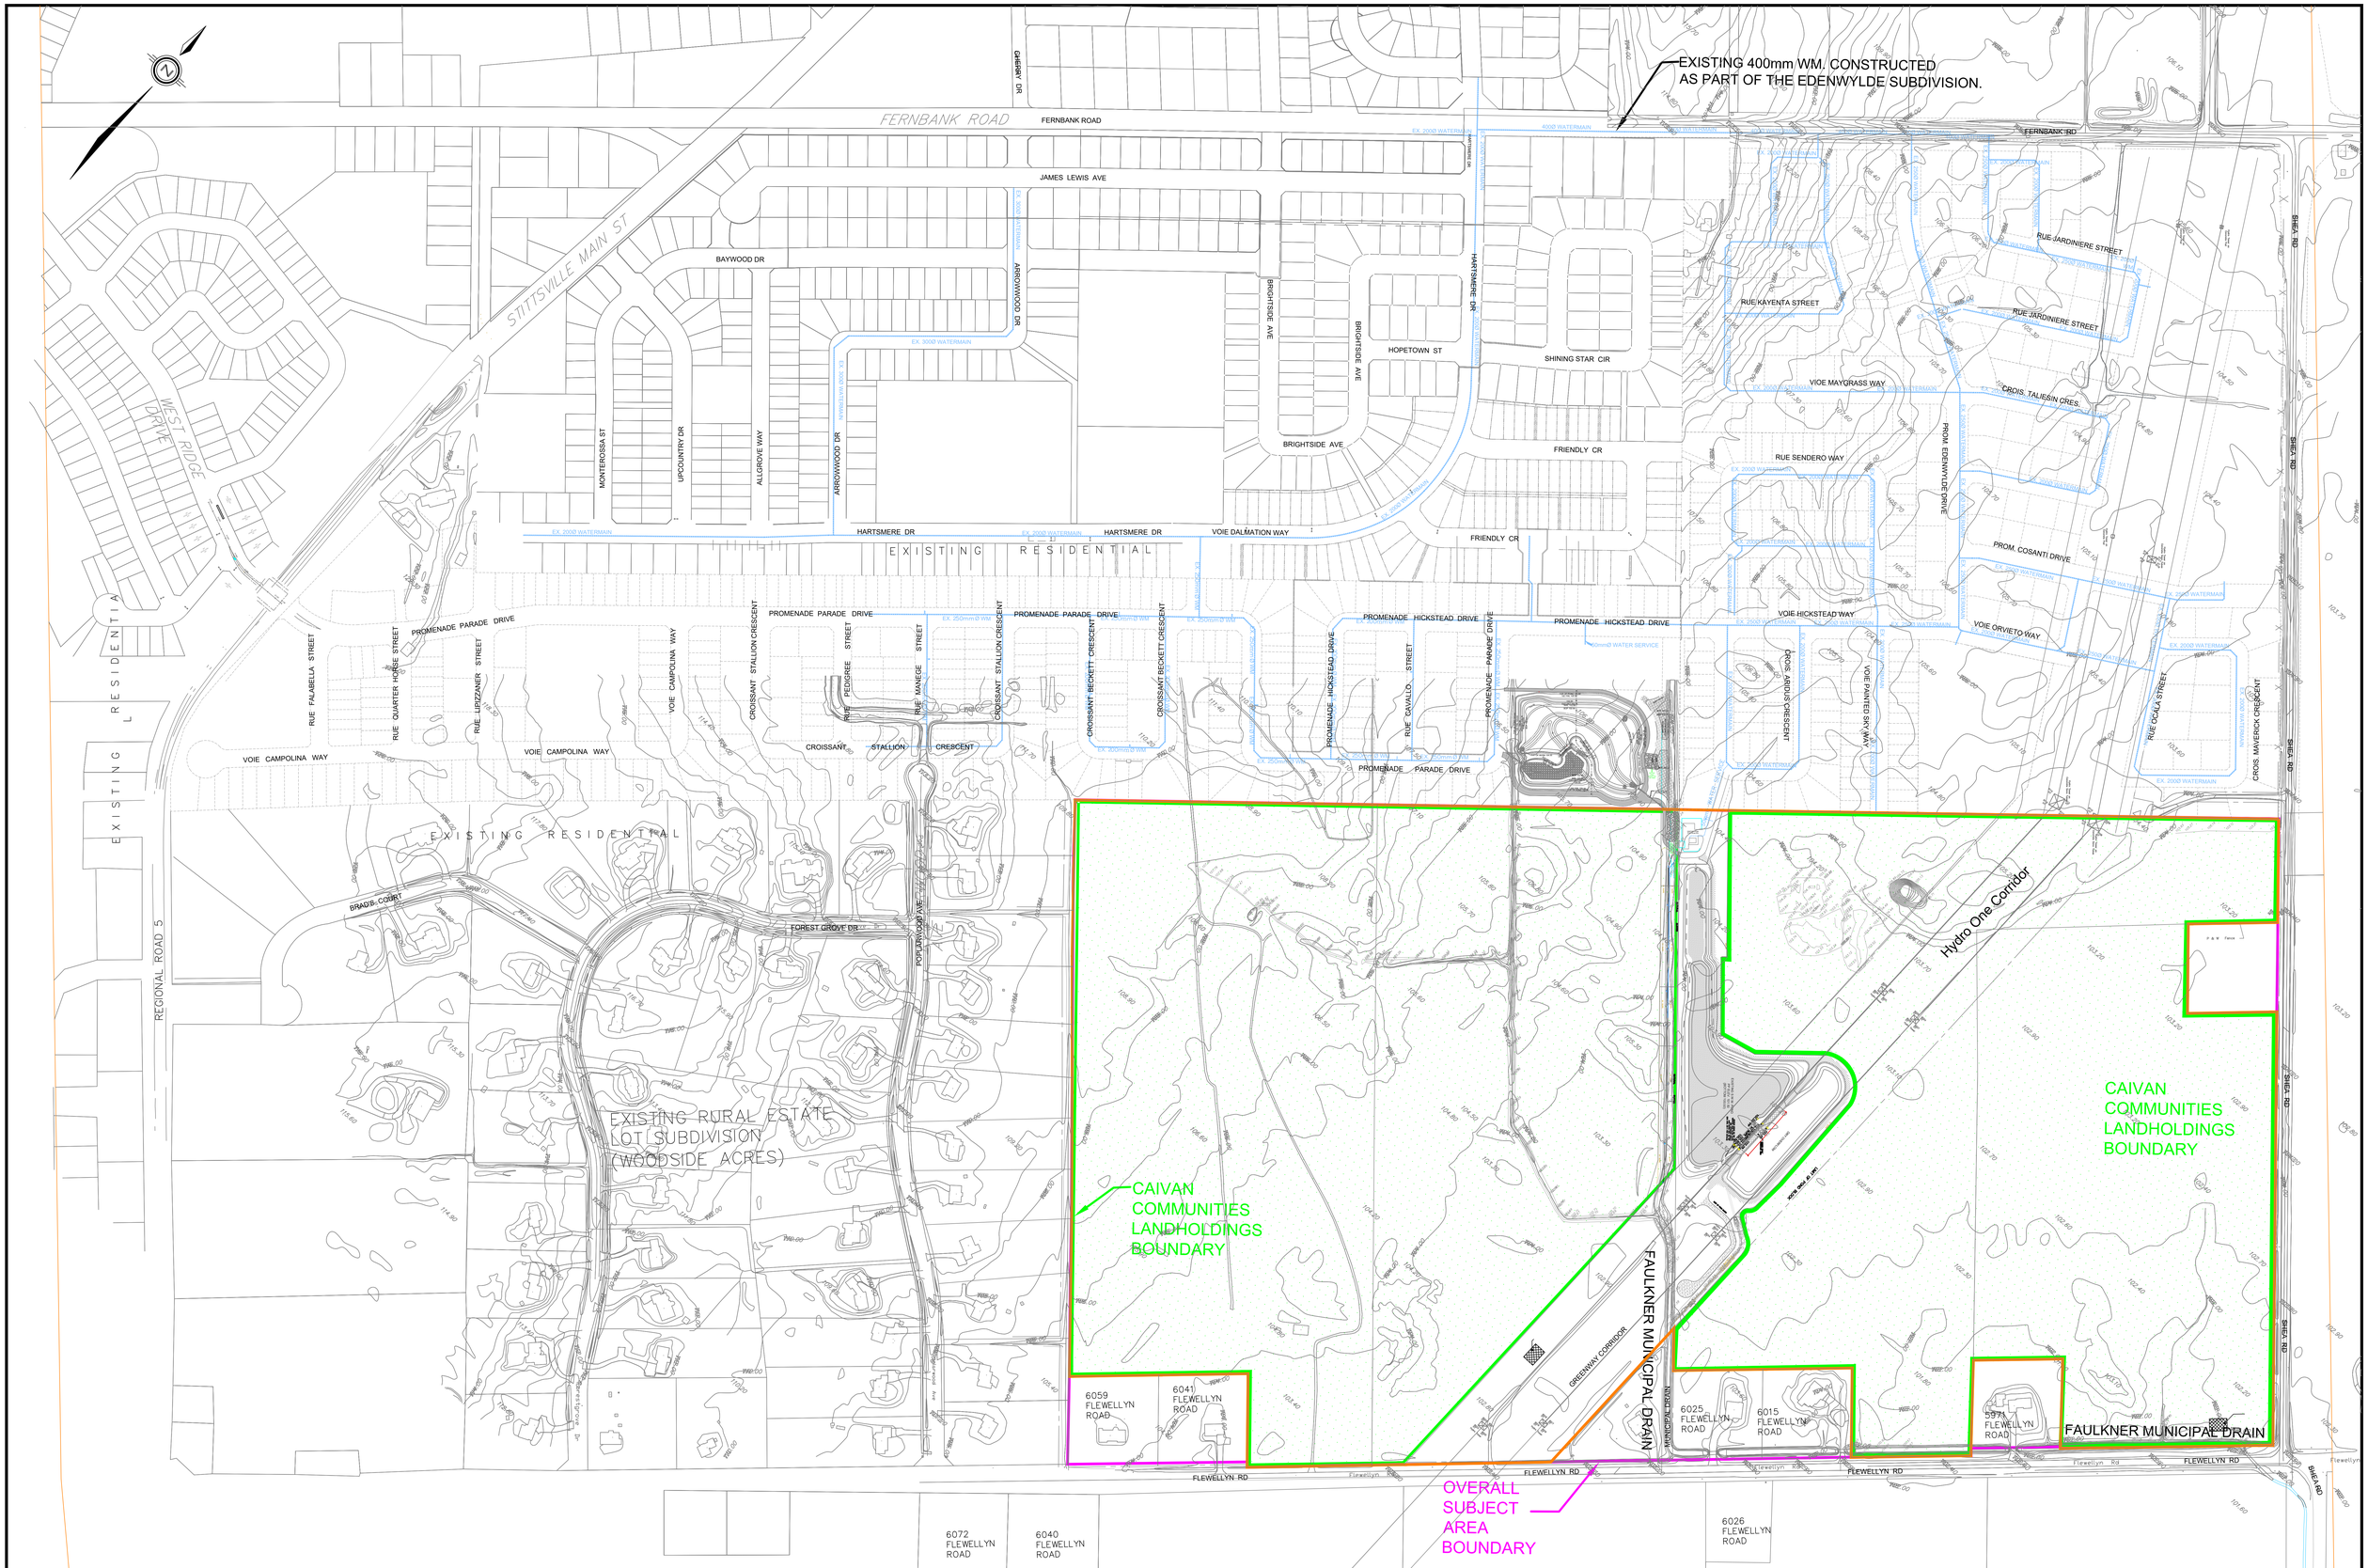

DSEL
120 Iber Road, Unit 103
Stittsville, Ontario, K2S 1E9
Tel. (613) 836-0856
Fax. (613) 836-7183
www.DSEL.ca

STITTSVILLE SOUTH URBAN EXPANSION AREA
WATERMAIN EXISTING CONDITIONS FIGURE
CITY OF OTTAWA

LEGEND

- EXISTING WATERMAIN
- OVERALL SUBJECT AREA BOUNDARY
- CAIVAN LANDHOLDINGS

PROJECT No.:	21-1247
DATE:	Sep 2023
SCALE:	1:2000
DRAWING:	3

APPENDIX B

WASTEWATER

ENVIRONMENTAL COMPLIANCE APPROVAL

NUMBER 3415-ADQLJG
Issue Date: September 21, 2016

Stittsville South Inc. and 1384341 Ontario Ltd.
1737 Woodward Drive, 2nd Floor
Ottawa, Ontario
K2C 0P9

Site Location: Stittsville South Area 6 Sanitary Pumping Station
5970 Fernbank Road and part of 5993 Flewellyn Road
City of Ottawa, Ontario

You have applied under section 20.2 of Part II.1 of the Environmental Protection Act, R.S.O. 1990, c. E. 19 (Environmental Protection Act) for approval of:

Sanitary Pump Station and Forcemain

- one (1) 3000 mm diameter and 8.65 metre deep wet well with provision for three (3) submersible non-clog wastewater pumps, each pump designed for 42 litres/second at a Total Dynamic Head (TDH) of 29 metres, complete with trash basket, pipe rails, level regulation, force air blower unit and appurtenances;

- two (2) pumps will be initially installed with each pump capable of delivering 42 litres/second at a TDH of 29 metres for an initial firm capacity of 42 litres/second;

- the third pump will be added through an amendment to the ECA once development flows approach 42 litres/second to bring the pump station to its ultimate firm capacity of 84 litres/second;

- approximately 870 metres of dual 200 mm diameter HDPE DR13.5 sanitary forcemains originating at the pump station control building and terminating at the existing sanitary sewer on Fernbank Road;

- one (1) 2400 mm x 1800 mm concrete discharge manhole, complete with Swab Catcher, replacing the existing sanitary MH 401 on Fernbank Road. Dual forcemains will discharge to this new manhole;

- pump station control building complete with mechanical and electrical systems, process piping, valves, control panels, SCADA system, odour control system, swab launchers and appurtenances;

- one (1) 170 KW self-enclosed diesel generator (to be registered under Environmental Activity and Sector Registry (EASR)) on a reinforced concrete pad adjustment to the pump station control building complete with diesel fuel tank, valves and controls;

- one (1) 2400 mm x 1800 mm concrete by-pass chamber complete with valves, couplings and appurtenances;

Sanitary Sewers Pump Station

- approximately 4.8 metres of 450 mm diameter sanitary sewer @ 2.55% from Sanitary MH 99 to wet well;

- approximately 18 metres of 200 mm diameter sanitary forcemain HDPE 13.5 from SAN MH 99 to By-pass Chamber;

- approximately 18.7 metres of 600 mm diameter sanitary sewer from SAN MH 99 to SAN MH 97;

Interim Emergency Sanitary Sewer Overflow

approximately 26.6 metres of 250 mm diameter sanitary sewer from sanitary MH 97 to the existing Faulkner Ditch. Elevation of emergency overflow in sanitary MH 97 is 104.27m;

Permanent Emergency Sanitary Sewer Overflow

the permanent Emergency Sanitary Sewer Overflow will discharge to the future Davidson Stormwater Management Facility which is anticipated to be constructed within the next 2-4 years;

- the permanent emergency sanitary sewer overflow will consist of 3 metres of 600 mm diameter sewer from sanitary MH 97 to the future stormwater management facility. The elevation of the emergency overflow in MH 97 is 103.40m;

- provision to adjust the elevation of the permanent emergency sanitary overflow in MH 97 within a range of 102.80m to 103.70m based on the final 100-year water level in the future Davidson Stormwater Management Facility;

- one (1) primary measuring device in MH 97 consisting of a broad crest weir complete with ultrasonic level recorder;

- once permanent emergency sanitary sewer overflow is established, the interim overflow will be abandoned;

including erosion/sedimentation control measures during construction and all other controls and appurtenances essential for the proper operation of the aforementioned Works;

all in accordance with the application from the Stittsville South Inc. and 1384341 Ontario Ltd., dated March 03, 2016, and all other supporting documents, final plans and specifications prepared by Novatech.

For the purpose of this environmental compliance approval, the following definitions apply:

"Approval" means this entire document including the application and any supporting documents listed in any schedules in this Approval;

"BOD5" (also known as TBOD5) means five day biochemical oxygen demand measured in an unfiltered sample and includes carbonaceous and nitrogenous oxygen demand;

"Director" means a person appointed by the Minister pursuant to section 5 of the Environmental Protection Act for the purposes of Part II.1 of the Environmental Protection Act;

"E. Coli" refers to the thermally tolerant forms of Escherichia that can survive at 44.5 degrees Celsius;

"Emergency Situation" means a structural, mechanical or electrical failure that causes a temporary reduction in the capacity of the sanitary sewage pumping station or an unforeseen flow condition that may result in:

a) danger to the health or safety of any person; or
b) injury or damage to any property, or serious risk of injury or damage to any property.

"EPA" means the Environmental Protection Act, R.S.O. 1990, c.E.19, as amended;

"Event" in the context the sanitary sewage pumping station located outside a Sewage Treatment Plant, means an action or occurrence, at the sanitary sewage pumping station that causes a Sewage Pumping Station Overflow. An Event ends when there is no recurrence of a Sewage Pumping Station Overflow in the 12-hour period following the last Sewage Pumping Station Overflow. Two Events are separated by at least 12 hours during which there has been no recurrence of a Sewage Pumping Station Overflow;

"Limited Operational Flexibility" (LOF) means the modifications that the Owner is permitted to make to the Works under this Approval;

"Ministry" means the ministry of the government of Ontario responsible for the Environmental Protection Act and the Ontario Water Resources Act and includes all officials, employees or other persons acting on its behalf;

"Notice of Modifications" means the form entitled “Notice of Modifications to Sewage Works” included in Schedule "A";

"Owner" means the Stittsville South Inc. and 1384341 Ontario Ltd., and includes their successors and assignees;

"Professional Engineer" means a person entitled to practise as a Professional Engineer in the Province of Ontario under a licence issued under the Professional Engineers Act;

"Sewage Pumping Station Overflow" means any discharge from a sanitary sewage pumping station located outside a Sewage Treatment Plant that does not undergo any treatment or only receives partial treatment before it is discharged to the environment;

"Substantial Completion" has the same meaning as “substantial performance” in the Construction Lien Act;

"Water Supervisor" means the person appointed as Water Supervisor of the Ottawa office of the Ministry;

"Works" means the sewage works described in the Owner's application(s) and this Approval.

You are hereby notified that this environmental compliance approval is issued to you subject to the terms and conditions outlined below:

TERMS AND CONDITIONS

1. GENERAL PROVISIONS

(1) The Owner shall ensure that any person authorized to carry out work on or operate any aspect of the Works is notified of this Approval and the Conditions herein and shall take all reasonable measures to ensure any such person complies with the same.

(2) The designation of the The City of Ottawa as the operating authority of the site on the application for approval of the Works does not relieve the Owner from the responsibility of complying with any and all of the Conditions of this Approval.

(3) Except as otherwise provided by these Conditions, the Owner shall design, build, install, operate and maintain the Works in accordance with the description given in this Approval, and the application for approval of the Works.

(4) Where there is a conflict between a provision of any submitted document referred to in this Approval and the Conditions of this Approval, the Conditions in this Approval shall take precedence, and where there is a conflict between the listed submitted documents, the document bearing the most recent date shall prevail.

(5) Where there is a conflict between the listed submitted documents, and the application, the application shall take precedence unless it is clear that the purpose of the document was to amend the application.

(6) The Conditions of this Approval are severable. If any Condition of this Approval, or the application of any requirement of this Approval to any circumstance, is held invalid or unenforceable, the application of such Condition to other circumstances and the remainder of this Approval shall not be affected thereby.

(7) The issuance of, and compliance with the Conditions of this Approval does not:

(a) relieve any person of any obligation to comply with any provision of any applicable statute, regulation or other legal requirement, including, but not limited to, the obligation to obtain approval from the local conservation authority necessary to construct or operate the sewage Works; or

(b) limit in any way the authority of the Ministry to require certain steps be taken to require the

Owner to furnish any further information related to compliance with this Approval.

2. EXPIRY OF APPROVAL

(1) This Approval will cease to apply to those parts of the new Works which have not been constructed within **five (5) years** of the date of this Approval.

3. CHANGE OF OWNER

(1) The Owner shall notify the Director, in writing, of any of the following changes within **thirty (30) days** of the change occurring:

(a) change of Owner;

(b) change of address of the Owner;

(c) change of partners where the Owner is or at any time becomes a partnership, and a copy of the most recent declaration filed under the Business Names Act, R.S.O. 1990, c. B17 shall be included in the notification to the Director;

(d) change of name of the corporation where the Owner is or at any time becomes a corporation, and a copy of the most current information filed under the Corporations Information Act, R.S.O. 1990, c. C39 shall be included in the notification to the Director.

4. UPON SUBSTANTIAL COMPLETION OF THE SEWAGE PUMPING STATION

(1) Upon Substantial Completion of the sewage pumping station, the Owner shall prepare a statement, certified by a Professional Engineer, that the sewage pumping station was constructed in accordance with this Approval, and shall make the written statement available to the Ministry, upon request.

(2) Within **one (1) year** of Substantial Completion of the sewage pumping station, a set of as-built drawings showing the sewage pumping station "as constructed" shall be prepared. These drawings shall be kept up to date through revisions undertaken from time to time and a copy shall be retained at the sewage pumping station for the operational life of the sewage pumping station.

5. SEWAGE PUMPING STATION OVERFLOW

(1) Any Sewage Pumping Station Overflow is prohibited, except:

(a) in an Emergency Situation;

(b) where the Sewage Pumping Station Overflow is a direct and unavoidable result of a planned maintenance procedure, the Owner notified the Water Supervisor **fifteen (15) days** prior to the Sewage Pumping Station Overflow and the Water Supervisor has given written consent of the Sewage Pumping Station Overflow; or,

(c) where the Sewage Pumping Station Overflow is planned for research or training purposes, the discharger notified the Water Supervisor **fifteen (15) days** prior to the Sewage Pumping Station Overflow and the Water Supervisor has given written consent of the Sewage Pumping Station Overflow.

(2) The Owner shall forthwith notify the Spills Action Centre (SAC) at 1-800-268-6060 or e-mail at moe.sac.moe@ontario.ca and the Medical Officer of Health of every Sewage Pumping Station Overflow Event. This notice shall include, at a minimum, the following information:

(a) the date and time at which the Event(s) started,

(b) duration of the Event(s);

(c) the location of the Event(s);

(d) the measured or estimated volume of the Event(s) (unless the Event(s) is/are ongoing); and

(e) the reason for the Event (s).

(3) The Owner shall submit Sewage Pumping Station Overflow Event Reports to the Ministry's local office on an Annual basis, no later than forty-five (45) days following the end of the calendar year. Event Reports shall be in an electronic format specified by the Ministry. In each Event Report the Owner shall include, at a minimum, the following information on any Event(s) that occurred during the preceding year:

(a) the date and time at which the Event(s) started,

(b) duration of the Event(s);

(c) the location of the Event**(s**);

(d) the measured or estimated volume of the Event(s) (unless the Event(s) is/are ongoing); and

(e) the reason for the Event(s).

(4) The Owner shall use best efforts to collect a representative sample consisting of a minimum of two (2) grab samples of the Sewage Pumping Station Overflow and have it analysed for parameters outlined in Table 1 of Condition 7 (2) using the protocols specified in Condition 7 (3), one at the beginning of the Event and the second approximately near the end of the Event, to best reflect the effluent quality of such Sewage Pumping Station Overflow.

(5) The Owner shall maintain a record of all Sewage Pumping Station Overflow(s), which shall contain, at a minimum, the types of information set out in Condition 5 (2 (a)) to 5 (2 (e)) in respect of each Sewage Pumping Station Overflow.

6. OPERATION AND MAINTENANCE

(1) The Owner shall exercise due diligence in ensuring that, at all times, the Works and the related equipment and appurtenances used to achieve compliance with this Approval are properly operated and maintained. Proper operation and maintenance shall include effective performance, adequate funding, adequate operator staffing and training, including training in all procedures and other requirements of this Approval and the Act and regulations, adequate laboratory facilities, process controls and alarms and the use of process chemicals and other substances used in the Works.

(2) The Owner shall prepare an operations manual within **six (6) months** of Substantial Completion of the sewage pumping station, that includes, but not necessarily limited to, the following information:

(a) operating procedures for routine operation of the sewage pumping station;

(b) inspection programs, including frequency of inspection, for the sewage pumping station and the methods or tests employed to detect when maintenance is necessary;

(c) repair and maintenance programs, including the frequency of repair and maintenance for the sewage pumping station;

(d) procedures for the inspection and calibration of monitoring equipment;

(e) a spill prevention control and countermeasures plan, consisting of contingency plans and procedures for dealing with equipment breakdowns, potential spills and any other abnormal situations, including notification of the Water Supervisor; and

(f) procedures for receiving, responding and recording public complaints, including recording any follow-up actions taken.

(3) The Owner shall maintain the operations manual current and retain a copy at the location of the sewage pumping station for the operational life of the sewage pumping station. The Owner shall make the manual available to the Ministry, upon request.

(4) The Owner shall make all manuals, plans, records, data, procedures and supporting documentation available to the Ministry, upon request.

7. MONITORING AND RECORDING

The Owner shall, upon the issuance of this Approval, carry out the following monitoring program:

(1) All samples and measurements taken for the purposes of this Approval are to be taken at a time and in a location characteristic of the quality and quantity of the effluent stream over the time period being monitored.

(2) Samples shall be collected at the following sampling points, at the frequency specified, by means of

the specified sample type and analysed for each parameter listed and all results recorded:

Table 1 - Monitoring during a Sewage Pumping Station Overflow Event (Samples to be collected from the Sewage Pumping Station Overflow sewer near the sewage pumping station)	
Sample Type	Grab
Parameters	BOD5, Total Suspended Solids, Total Phosphorus, E. Coli (E. Coli samples may be limited to overflows occurring between Apr 1 and Oct 31)

(3) The methods and protocols for sampling, analysis and recording shall conform, in order of precedence, to the methods and protocols specified in the following:

(a) the Ministry's Procedure F-10-1, "Procedures for Sampling and Analysis Requirements for Municipal and Private Sewage Treatment Works (Liquid Waste Streams Only), as amended from time to time by more recently published editions;

(b) the Ministry's publication "Protocol for the Sampling and Analysis of Industrial/Municipal Wastewater" (January 1999), ISBN 0-7778-1880-9, as amended from time to time by more recently published editions; and

(c) the publication "Standard Methods for the Examination of Water and Wastewater" (21st edition), as amended from time to time by more recently published editions.

8. REPORTING

(1) **Fifteen (15) days** prior to the date of a planned Sewage Pumping Station Overflow being conducted pursuant to Condition 5 and as soon as possible for an unplanned Sewage Pumping Station Overflow, the Owner shall notify the Water Supervisor in writing of the pending start date, in addition to an assessment of the potential adverse effects on the environment and the duration of the Sewage Pumping Station Overflow.

(2) In addition to the obligations under Part X of the Environmental Protection Act, (which includes contacting the Spills Action Centre (SAC) at 1-800-268-6060 or e-mail at moe.sac.moe@ontario.ca), the Owner shall, within **ten (10) working days** of the occurrence of any reportable spill as defined in Ontario Regulation 675/98, Bypass or loss of any product, by-product, intermediate product, oil, solvent, waste material or any other polluting substance into the environment, (with the exception of a sanitary sewage discharged during an Event), submit a full written report of the occurrence to the Water Supervisor describing the cause and discovery of the spill or loss, clean-up and recovery measures taken, preventative measures to be taken and schedule of implementation.

(3) The Owner shall prepare and submit a report to the Water Supervisor on an annual basis. The reports shall contain the following information:

(a) a copy of all Notice of Modifications submitted to the Water Supervisor as a result of Schedule A, Section 1 (Limited Operational Flexibility) with a status report on the implementation of each modification;

(b) a report summarizing all modifications completed as a result of Schedule A, Section 3.

9. LIMITED OPERATIONAL FLEXIBILITY

(1) The Owner may make modifications to the Works in accordance with the Terms and Conditions of this Approval and subject to the Ministry's "Limited Operational Flexibility Criteria for Modifications to Sewage Works", included under Schedule "A" of this Approval, as amended.

(2) The sewage pumping station works proposed under Limited Operational Flexibility shall adhere to the design guidelines contained within the Ministry's publication "Design Guidelines for Sewage Works 2008", as amended.

(3) The Owner shall ensure at all times, that the sewage pumping station works, related equipment and appurtenances which are installed or used to achieve compliance are operated in accordance with all Terms and Conditions of this Approval.

(4) For greater certainty, the following are not permitted as part of Limited Operational Flexibility:

(a) Modifications to the sewage pumping station works that result in an increase of the Rated Capacity of the sewage pumping station works;

(b) Modifications to the sewage pumping station works that may adversely affect the approved effluent quality criteria or the location of the discharge/outfall;

(c) Modifications to the sewage pumping station works approved under s.9 of the EPA, and

(d) Modifications to the sewage pumping station works pursuant to an order issued by the Ministry.

(5) Implementation of Limited Operational Flexibility is not intended to be used for piecemeal measures that result in major alterations or expansions.

(6) If the implementation of Limited Operational Flexibility requires changes to be made to the Emergency Response, Spill Reporting and Contingency Plan, the Owner shall, as deemed necessary in consultation with the Water Supervisor, provide a revised copy of this plan for approval to the local fire services authority prior to implementing Limited Operational Flexibility.

(7) For greater certainty, any alteration made under the Limited Operational Flexibility may only be carried out after other legal obligations have been complied with including those arising from the Environmental Protection Act, Niagara Escarpment Planning and Development Act, Oak Ridges Moraine Conservation Act, Lake Simcoe Protection Act and Greenbelt Act.

(8) Prior to implementing Limited Operational Flexibility, the Owner shall complete a Notice of Modifications describing any proposed modifications to the sewage pumping station works and submit it to the Water Supervisor.

10. TEMPORARY EROSION AND SEDIMENT CONTROL

(1) The Owner shall install and maintain temporary sediment and erosion control measures during construction and conduct inspections once every **two (2) weeks** and after each significant storm event (a significant storm event is defined as a minimum of 25 mm of rain in any 24 hours period). The inspections and maintenance of the temporary sediment and erosion control measures shall continue until they are no longer required and at which time they shall be removed and all disturbed areas reinstated properly.

(2) The Owner shall maintain records of inspections and maintenance which shall be made available for inspection by the Ministry, upon request. The record shall include the name of the inspector, date of inspection, and the remedial measures, if any, undertaken to maintain the temporary sediment and erosion control measures.

11. RECORD KEEPING

The Owner shall retain for a minimum of **five (5) years** from the date of their creation, all records and information related to or resulting from the operation and maintenance activities required by this Approval.

Schedule "A"

Limited Operational Flexibility Criteria for Modifications to Sewage Works

1. The modifications to a sewage pumping station approved under an Environmental Compliance Approval (Approval) that are permitted under the Limited Operational Flexibility (LOF), are outlined below and are subject to the LOF conditions in the Approval, and require the submission of the Notice of Modifications. If there is a conflict between the sewage pumping station works listed below and the Terms and Conditions in the Approval, the Terms and Conditions in the Approval shall take precedence.

1.1 Sewage Pumping Stations

a. Adding or replacing equipment where new equipment is located within an existing sewage pumping station site, provided that the facility Rated Capacity is not exceeded and the existing flow process and/or treatment train are maintained, as applicable.

1.2 Pilot Systems

a. Installation of pilot systems for new or existing technologies provided that:
   i. any effluent from the pilot system is discharged to the inlet of the sewage pumping station or hauled off-site for proper disposal,
   ii. any effluent from the pilot system discharged to the inlet of the sewage pumping station or sewage conveyance system does not significantly alter the composition/concentration of the influent sewage to be treated in the downstream process; and that it does not add any inhibiting substances to the downstream process, and
   iii. the pilot system's duration does not exceed a maximum of two years; and a report with results is submitted to the Director and Water Supervisor three months after completion of the pilot project.

2. Sewage works that are exempt from section 53 of the OWRA by O. Reg. 525/98 continue to be exempt and are not required to follow the notification process under this Limited Operational Flexibility.

3. Normal or emergency operational modifications, such as repairs, reconstructions, or other improvements that are part of maintenance activities, including cleaning, renovations to existing approved sewage works equipment, provided that the modification is made with Equivalent Equipment, are considered pre-approved.

4. The modifications noted in section (3) above are not required to follow the notification protocols under Limited Operational Flexibility, provided that the number of pieces and description of the equipment as described in the Approval does not change.

Ontario
Ministry of
the Environment

Notice of Modification to Sewage Works

RETAIN COPY OF COMPLETED FORM AS PART OF THE ECA AND SEND A COPY TO THE WATER SUPERVISOR (FOR MUNICIPAL) OR DISTRICT MANAGER (FOR NON-MUNICIPAL SYSTEMS)

Part 1 – Environmental Compliance Approval (ECA) with Limited Operational Flexibility

(Insert the ECA's owner, number, issuance date and notice number, which should start with "01" and consecutive numbers thereafter)

ECA Number	Issuance Date (mm/dd/yy)	Notice number (if applicable)

ECA Owner	Municipality

Part 2: Description of the modifications as part of the Limited Operational Flexibility

(Attach a detailed description of the sewage works)

Description shall include:
1. A detail description of the modifications and/or operations to the sewage works (e.g. sewage work component, location, size, equipment type/model, material, process name, etc.)
2. Confirmation that the anticipated environmental effects are negligible.
3. List of updated versions of, or amendments to, all relevant technical documents that are affected by the modifications as applicable, i.e. submission of documentation is not required, but the listing of updated documents is (design brief, drawings, emergency plan, etc.)

Part 3 – Declaration by Professional Engineer

I hereby declare that I have verified the scope and technical aspects of this modification and confirm that the design:
1. Has been prepared or reviewed by a Professional Engineer who is licensed to practice in the Province of Ontario;
2. Conforms with the Limited Operational Flexibility as per the ECA;
3. Has been designed consistent with Ministry's Design Guidelines, adhering to engineering standards, industry's best management practices, and demonstrating ongoing compliance with s.53 of the Ontario Water Resources Act; and other appropriate regulations.

I hereby declare that to the best of my knowledge, information and belief the information contained in this form is complete and accurate.

Name (Print)	PEO License Number

Signature	Date (mm/dd/yy)

Name of Employer

Part 4 – Declaration by Owner

I hereby declare that:
1. I am authorized by the Owner to complete this Declaration;

2. The Owner consents to the modification; and
3. These modifications to the sewage works are proposed in accordance with the Limited Operational Flexibility as described in the ECA.
4. The Owner has fulfilled all applicable requirements of the *Environmental Assessment Act*.
I hereby declare that to the best of my knowledge, information and belief the information contained in this form is complete and accurate.

Name of Owner Representative (Print)	Owner representative's title (Print)
Owner Representative's Signature	Date (mm/dd/yy)

The reasons for the imposition of these terms and conditions are as follows:

1. Condition 1 is imposed to ensure that the Works are built and operated in the manner in which they were described for review and upon which approval was granted. This Condition is also included to emphasize the precedence of Conditions in the Approval and the practice that the Approval is based on the most current document, if several conflicting documents are submitted for review.

2. Condition 2 is included to ensure that, when the Works are constructed, the Works will meet the standards that apply at the time of construction to ensure the ongoing protection of the environment.

3. Condition 3 is included to ensure that the Ministry records are kept accurate and current with respect to approved Works and to ensure that any subsequent Owner of the Works is made aware of the Approval and continue to operate the Works in compliance with it.

4. Condition 4 is included to ensure that the sewage pumping station is constructed in accordance with the Approval and that record drawings of the sewage pumping station "as constructed" are maintained for future reference.

5. Conditions 5 and 7 are included to indicate that Sewage Pumping Station Overflow of untreated and/or partially treated sewage to the environment is prohibited, save in certain limited circumstances where the failure to do so could result in greater injury to the public interest than the Sewage Pumping Station Overflow itself, or where the Sewage Pumping Station Overflow can be limited or otherwise mitigated by handling it in accordance with an approved contingency plan. The notification and documentation requirements allow the Ministry to take action in an informed manner and will ensure the Owner is aware of the extent and frequency of Sewage Pumping Station Overflow Event(s).

6. Condition 6 is included to require that the Works be properly operated, maintained, funded, staffed and equipped such that the environment is protected and deterioration, loss, injury or damage to any person or property is prevented. As well, the inclusion of a comprehensive operations manual for the sewage pumping station governing all significant areas of operation, maintenance and repair is prepared, implemented and kept up-to-date by the Owner and made available to the Ministry. Such a manual is an integral part of the operation of the sewage pumping station. Its compilation and use should assist the Owner in staff training, in proper plant operation and in identifying and planning for contingencies during possible abnormal conditions. The manual will also act as a benchmark for Ministry staff when reviewing the Owner's operation of the Works.

7. Condition 8 is included to provide a performance record for future references, to ensure that the Ministry is made aware of problems as they arise, so that the Ministry can work with the Owner in resolving any problems in a timely manner.

8. Condition 9 is included to ensure that the Works are operated in accordance with the application and supporting documentation submitted by the Owner, and not in a manner which the Director has not been asked to consider. These Conditions are also included to ensure that a Professional Engineer has reviewed the proposed Modifications and attests that the Modifications are in line with that of Limited Operational Flexibility, and provide assurance that the proposed Modifications comply with the Ministry's requirements stipulated in the Terms and Conditions of this Approval, Ministry policies, guidelines, and industry engineering standards and best management practices.

9. Condition 10 is included as installation, regular inspection and maintenance of the temporary sediment and erosion control measures is required to mitigate the impact on the downstream receiving watercourse during construction, until they are no longer required.

10. Condition 11 is included to require that all records are retained for a sufficient time period to adequately evaluate the long-term operation and maintenance of the Works.

In accordance with Section 139 of the Environmental Protection Act, you may by written Notice served upon me and the Environmental Review Tribunal within 15 days after receipt of this Notice, require a hearing by the Tribunal. Section 142 of the Environmental Protection Act provides that the Notice requiring the hearing shall state:

1. The portions of the environmental compliance approval or each term or condition in the environmental compliance approval in respect of which the hearing is required, and;
2. The grounds on which you intend to rely at the hearing in relation to each portion appealed.

The Notice should also include:

3. The name of the appellant;
4. The address of the appellant;
5. The environmental compliance approval number;
6. The date of the environmental compliance approval;
7. The name of the Director, and;
8. The municipality or municipalities within which the project is to be engaged in.

And the Notice should be signed and dated by the appellant.

This Notice must be served upon:

The Secretary*
Environmental Review Tribunal
655 Bay Street, Suite 1500
Toronto, Ontario
M5G 1E5

AND

The Director appointed for the purposes of
Part II.1 of the Environmental Protection Act
Ministry of the Environment and
Climate Change
135 St. Clair Avenue West, 1st Floor
Toronto, Ontario
M4V 1P5

*** Further information on the Environmental Review Tribunal's requirements for an appeal can be obtained directly from the Tribunal at: Tel: (416) 212-6349, Fax: (416) 326-5370 or www.ert.gov.on.ca**

The above noted activity is approved under s.20.3 of Part II.1 of the Environmental Protection Act.

DATED AT TORONTO this 21st day of September, 2016

Gregory Zimmer, P.Eng.
Director
appointed for the purposes of Part II.1 of the
Environmental Protection Act

MS/

c: District Manager, MOECC Ottawa office
Greg McDonald, Novatech
Charles Warnock, Program Manager, City of Ottawa, Development Review
Linda Carkner, Program Manager, City of Ottawa, Infrastructure Services

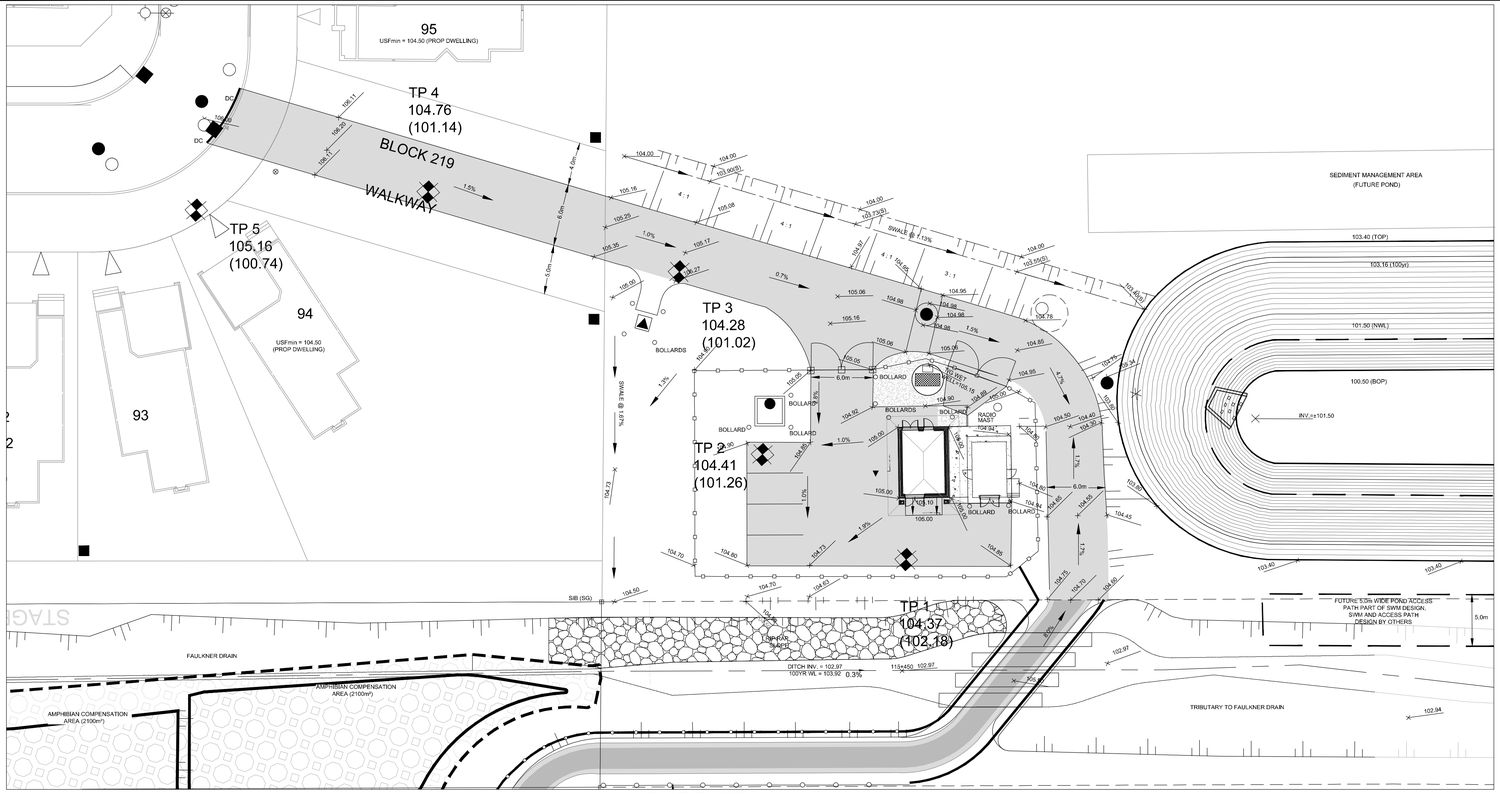

PUMP STATION GRADING

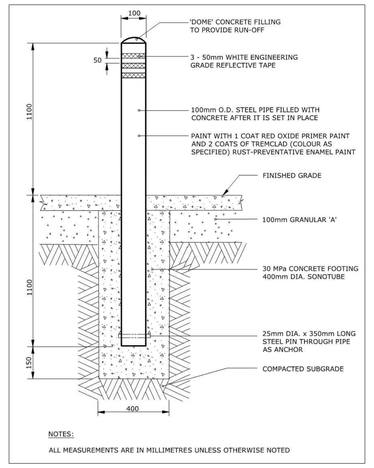

NOTES:

ALL MEASUREMENTS ARE IN MILLIMETRES UNLESS OTHERWISE NOTED

BOLLARD DETAIL

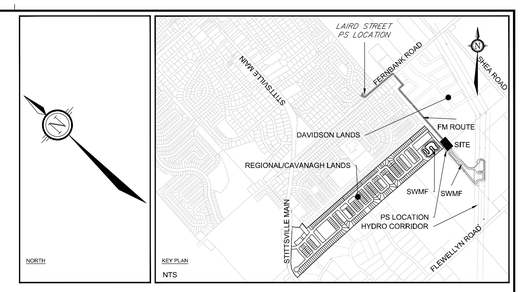



CONCRETE ENCASED HYDRO

SCALE: 1:20

LEGEND

- SANMH — PROPOSED SANITARY MH & SEWER
- 200mmØ — PROPOSED DUAL 200mmØ SANITARY FORCEMAIN
- STMMH — PROPOSED STORM MH & SEWER
- DIRECTION OF FLOW
- PROPOSED CONCRETE ENCASED 3Ø HYDRO SERVICE
- PROPOSED HYDRO TRANSFORMER
- PROPOSED FENCE LINE
- GAS — PROPOSED GAS
- TEST PIT (REFER TO HOULE CHEVRIER ENG. LTD. PROJECT No. 12-478 AND 14-420)
- BORE HOLES (REFER TO HOULE CHEVRIER ENG. LTD. PROJECT No. 64153.53)
- TEST PITS DUG OCTOBER 18TH, 2016

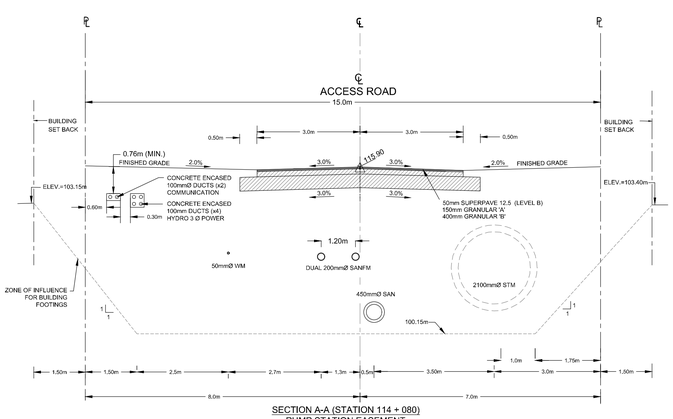

SECTION A-A (STATION 114 + 080)
PUMP STATION EASEMENT

SCALE: 1:75

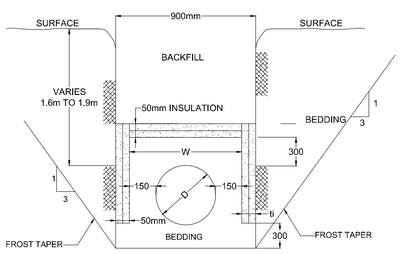

SANITARY FORCEMAIN
INSULATION DETAIL
STA 114+110 TO 114+156
N.T.S.

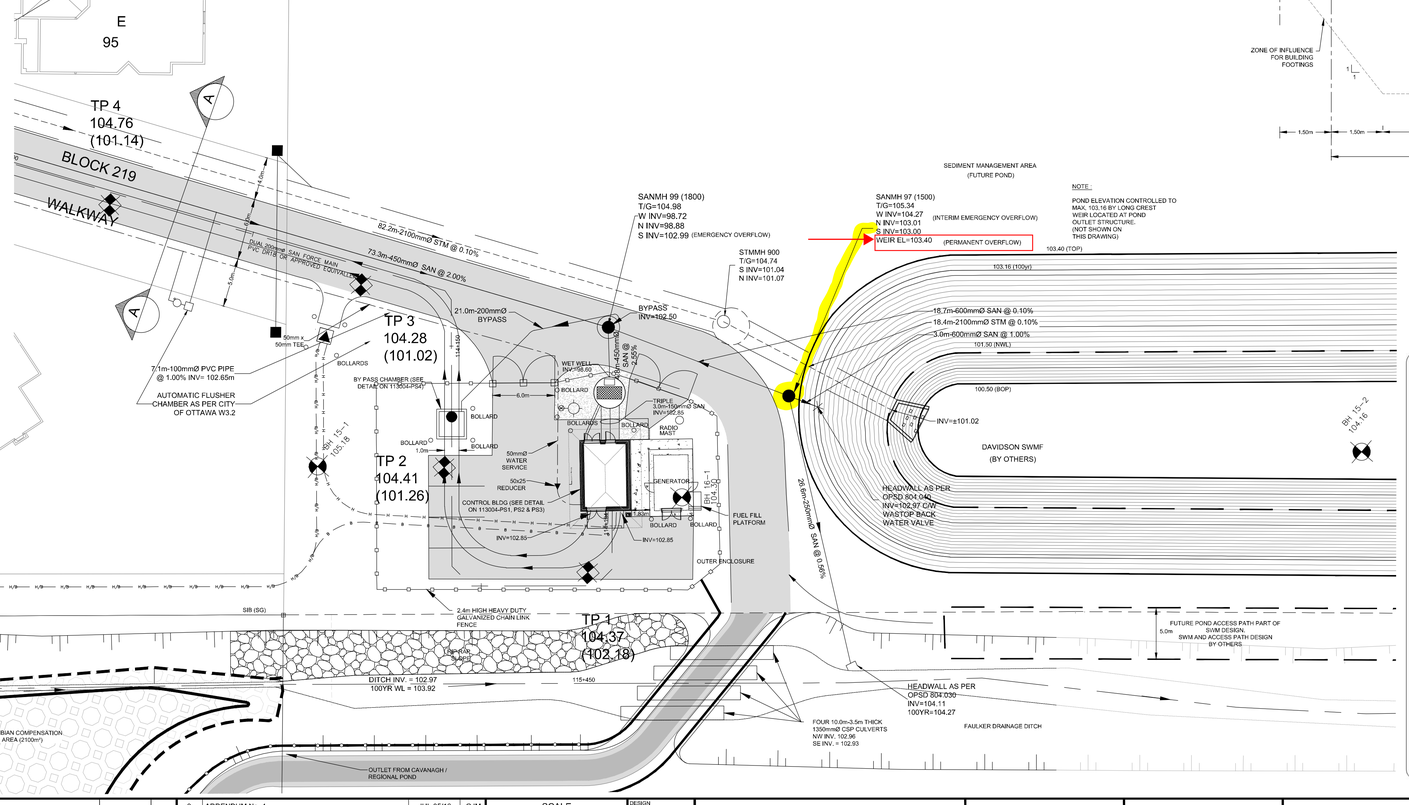

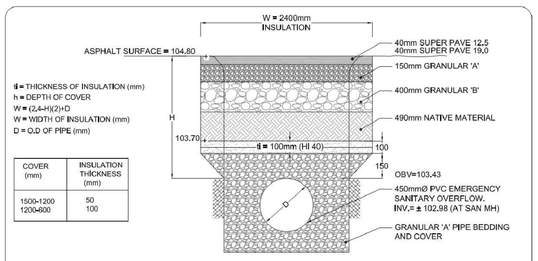

COVER (mm)	INSULATION THICKNESS (mm)
1500-1200	50
1200-600	100

NOTES:

1. INCREMENTS OF THICKNESS SHALL BE ADJUSTABLE TO 50mm
2. THICKNESS OF INSULATION IS 50mm (min.)
3. INSULATE ALL PIPES AS SPECIFIED WITH MIN 50mm (MIN) x 1200mm HI-40 INSULATION. PROVIDE 150mm CLEARANCE BETWEEN PIPE AND INSULATION. (SEE ABOVE DETAIL).
4. THE THICKNESS OF INSULATION SLAB SHALL BE THE EQUIVALENT OF 25mm FOR EVERY 300mm REDUCTION IN THE REQUIRED DEPTH OF COVER (ROUNDED TO THE NEAREST 25mm INCREMENT).

TYPICAL INSULATION DETAIL - SANITARY OVERFLOW

N.T.S.

NOTE:
THE POSITION OF ALL POLE LINES, CONDUITS, WATERMAINS, SEWERS AND OTHER UNDERGROUND AND OVERGROUND UTILITIES AND STRUCTURES IS NOT NECESSARILY SHOWN ON THE CONTRACT DRAWINGS, AND WHERE SHOWN, THE ACCURACY OF THE POSITION OF SUCH UTILITIES AND STRUCTURES IS NOT GUARANTEED. BEFORE STARTING WORK, DETERMINE THE EXACT LOCATION OF ALL SUCH UTILITIES AND STRUCTURES AND ASSUME ALL LIABILITY FOR DAMAGE TO THEM.

No.	REVISION	DATE	BY
14.	AS BUILT	SEP 06/18	GJM
13.	REVISED GRADES FROM SANMH 99 TO FAULKNER DRAIN	JUN 23/17	GJM
12.	ISSUED FOR MYLARS	FEB 23/17	GJM
11.	ISSUED FOR LAYOUT	JAN 13/17	GJM
10.	REVISED SANMH 99 AND 101 INVERTS	NOV 17/16	GJM
9.	AUTOMATIC FLUSHER CHAMBER ADDED	SEPT 09/16	BHB
8.	ADDENDUM No. 4	JUL 05/16	GJM
7.	REVISED MANHOLES 97 AND 99. 200mm BYPASS ADDED	JUN 22/16	GJM
6.	ISSUED FOR TENDER	MAY 25/16	GJM
5.	ISSUED FOR ENVIRONMENTAL COMPLIANCE APPROVAL	MAY 04/16	GJM
4.	ISSUED WITH MINOR ADJUSTMENTS	MAR 29/16	GJM
3.	ISSUED FOR 75% DESIGN	MAR 14/16	GJM
2.	50 % DESIGN	DEC 22/15	GJM
1.	ISSUED WITH PUMP STATION PRE-DESIGN REPORT	JUNE 24/15	GJM

SCALE
1 : 250
(UNLESS NOTED)

DESIGN	GJM/BHB
CHECKED	GJM
DRAWN	MWC
CHECKED	GJM
APPROVED	GJM

NOVATECH
Engineers, Planners & Landscape Architects
Suite 200, 240 Michael Cowpland Drive
Ottawa, Ontario, Canada K2M 1P6
Telephone (613) 254-9643
Facsimile (613) 254-5867
Website www.novatech-eng.com

LOCATION
CITY OF OTTAWA
STITTSVILLE SOUTH - AREA 6

DRAWING NAME
SHEA ROAD SANITARY PUMP STATION - SITE SERVICING AND GRADING

PROJECT No. 113004-00
REV REV # 14
DRAWING No. 113004-PS-SVC

M:\2013\113004\CAD\Design\113004-PR[R2].dwg, PS-SVC, Sep 07, 2018 - 11:06am, bolam

PLAN/PLOT/REF - SWSHeavyStorm

TABLE D-1: FERNBANK CDP LANDS - NEW TRUNK SEWER
SANITARY SEWER DESIGN SHEET (2031)

AREA			RESIDENTIAL																COMMERCIAL		INSTITUTIONAL		C+I	INFILTRATION			Total Flow (l/s)	PIPE					
			LOW DENSITY			MEDIUM DENSITY			HIGH DENSITY			MIXED USE			TOTAL								Peak Flow (l/s)	Total Area (ha)	Accum. Area (ha)	Infilt. Flow (l/s)							
ID	From	To	Area (ha)	Pop.	Accum. Pop.	Area (ha)	Pop.	Accum. Pop.	Area (ha)	Pop.	Accum. Pop.	Area (ha)	Pop.	Accum. Pop.	Pop.	Accum. Pop.	Peak Factor	Peak Flow (l/s)	Area (ha)	Accum. Area (ha)	Area (ha)	Accum. Area (ha)						Size (mm)	Slope (%)	Length (m)	Capacity (l/s)	Full Flow Vel. (m/s)	Q/Q_{full} (%)
1	902	904	9.85	910	910	0.36	54	54	0.00	0	0	0.00	0	0	964	964	3.8	14.9	0.00	0.00	0.78	0.78	0.7	16.07	16.07	4.5	20.1	250	0.24	154	30.4	0.60	66.0%
2	904	908	11.65	1076	1986	3.10	465	519	0.00	0	0	0.00	0	0	1541	2505	3.5	35.6	0.00	0.00	0.91	1.69	1.5	22.29	38.36	10.7	47.8	300	0.24	306	49.4	0.68	96.7%
3	906	908	7.45	688	688	0.00	0	0	0.00	0	0	0.00	0	0	688	688	3.9	10.9	0.00	0.00	2.63	2.63	2.3	14.51	14.51	4.1	17.2	250	1.50	373	76.0	1.50	22.7%
4	908	912	4.45	411	3085	1.67	251	770	0.00	0	0	0.00	0	0	662	3855	3.3	52.3	0.63	0.63	0.00	4.32	4.3	16.43	69.30	19.4	76.0	300	0.61	396	78.8	1.08	96.4%
5	910	912	10.35	956	956	0.00	0	0	0.00	0	0	0.00	0	0	956	956	3.8	14.8	0.00	0.00	0.83	0.83	0.7	19.34	19.34	5.4	20.9	250	0.24	320	30.4	0.60	68.8%
6	912	920	11.15	1030	5071	0.00	0	770	0.00	0	0	0.00	0	0	1030	5841	3.2	75.3	0.00	0.63	2.50	7.65	7.2	18.11	106.75	29.9	112.4	450	0.15	207	115.2	0.70	97.5%
7	914	916	16.35	1511	1511	0.90	135	135	0.00	0	0	0.00	0	0	1646	1646	3.7	24.3	0.00	0.00	0.45	0.45	0.4	25.23	25.23	7.1	31.8	300	0.25	152	50.4	0.69	63.0%
8	916	920	10.45	966	2477	0.00	0	135	0.00	0	0	0.00	0	0	966	2612	3.5	37.0	0.00	0.00	0.85	1.30	1.1	15.69	40.92	11.5	49.5	375	0.20	314	81.8	0.72	60.6%
9	918	920	5.55	513	513	0.49	74	74	0.00	0	0	0.00	0	0	587	587	3.9	9.4	0.00	0.00	6.14	6.14	5.3	16.04	16.04	4.5	19.2	250	0.85	363	57.2	1.13	33.5%
	920	922	0.00	0	8061	0.00	0	979	0.00	0	0	0.00	0	0	0	9040	3.0	109.8	0.00	0.63	0.00	15.09	13.6	0.00	163.71	45.8	169.3	525	0.18	265	190.3	0.85	88.9%
10	922	924	12.20	1127	9188	0.09	14	993	0.00	0	0	0.00	0	0	1141	10181	2.9	121.5	0.00	0.63	1.52	16.61	15.0	27.31	191.02	53.5	190.0	525	0.23	290	215.2	0.96	88.3%
	924	934	0.00	0	9188	0.00	0	993	0.00	0	0	0.00	0	0	0	10181	2.9	121.5	0.00	0.63	0.00	16.61	15.0	0.00	191.02	53.5	190.0	525	0.79	669	398.8	1.78	47.6%
11	926	930	4.95	457	457	8.40	1260	1260	0.00	0	0	3.45	279	279	1996	1996	3.6	29.0	1.99	1.99	0.82	0.82	2.4	26.79	26.79	7.5	38.9	375	0.14	530	68.4	0.60	56.9%
12	928	930	9.35	864	864	3.55	533	533	0.00	0	0	0.00	0	0	1397	1397	3.7	20.9	0.00	0.00	3.85	3.85	3.3	22.72	22.72	6.4	30.7	200	7.00	55	90.5	2.79	33.9%
13	930	932	1.65	152	1473	2.95	443	2236	0.00	0	0	0.00	0	279	595	3988	3.3	53.9	0.34	2.33	0.80	5.47	6.8	10.54	60.05	16.8	77.4	450	0.11	308	99.1	0.60	78.2%
14	932	934	0.00	0	1473	0.00	0	2236	0.00	0	0	7.12	577	856	577	4565	3.3	60.7	3.56	5.89	6.10	11.57	15.2	17.52	77.57	21.7	97.6	525	0.10	455	141.9	0.63	68.8%
15	934	972	2.90	268	10929	1.80	270	3499	0.00	0	0	1.21	98	954	636	15382	2.8	172.4	0.61	7.12	0.40	28.58	31.0	15.08	283.67	79.4	282.8	600	0.26	1007	326.6	1.12	86.6%
16	936	938	7.58	700	700	0.70	105	105	0.00	0	0	0.00	0	0	805	805	3.9	12.6	0.00	0.00	2.17	2.17	1.9	14.42	14.42	4.0	18.5	250	1.00	108	62.0	1.22	29.8%
17	938	940	8.05	744	1444	1.00	150	255	0.00	0	0	4.41	357	357	1251	2056	3.6	29.8	2.21	2.21	0.83	3.00	4.5	25.14	39.56	11.1	45.4	300	0.35	156	59.7	0.82	76.0%
18	940	952	6.35	587	2031	0.99	149	404	0.00	0	0	0.00	0	357	736	2792	3.5	39.2	0.00	2.21	0.00	3.00	4.5	10.51	50.07	14.0	57.8	300	0.75	310	87.4	1.20	66.1%
19	942	944	7.25	670	670	4.70	705	705	0.00	0	0	0.00	0	0	1375	1375	3.7	20.6	0.00	0.00	12.67	12.67	11.0	34.19	34.19	9.6	41.2	250	0.90	516	58.9	1.16	70.0%
20	944	946	12.20	1127	1797	1.00	150	855	0.00	0	0	0.00	0	0	1277	2652	3.5	37.5	0.00	0.00	0.82	13.49	11.7	20.35	54.54	15.3	64.4	375	0.20	511	81.8	0.72	78.8%
21	946	948	4.15	383	2180	4.22	633	1488	0.00	0	0	0.00	0	0	1016	3668	3.4	50.0	0.00	0.00	3.87	17.36	15.1	17.22	71.76	20.1	85.2	375	0.50	243	129.3	1.13	65.9%
	948	950	0.00	0	2180	0.00	0	1488	0.00	0	0	0.00	0	0	0	3668	3.4	50.0	0.00	0.00	0.00	17.36	15.1	0.00	71.76	20.1	85.2	450	0.15	195	115.2	0.70	74.0%
22	950	952	5.05	467	2647	0.30	45	1533	0.00	0	0	0.00	0	0	512	4180	3.3	56.2	0.00	0.00	3.24	20.6	17.9	11.43	83.19	23.3	97.3	450	0.15	221	115.2	0.70	84.5%
23	952	972	4.15	383	5061	5.50	825	2762	0.00	0	0	0.00	0	357	1208	8180	3.0	100.8	0.00	2.21	0.00	23.60	22.4	22.72	155.98	43.7	166.8	450	0.54	282	218.6	1.33	76.3%
24	954	956	7.70	711	711	2.90	435	435	0.00	0	0	6.70	543	543	1689	1689	3.6	24.9	3.35	3.35	0.79	0.79	3.6	22.81	22.81	6.4	34.9	375	0.15	330	70.8	0.62	49.3%
25	956	958	10.70	989	1700	0.00	0	435	0.00	0	0	0.00	0	543	989	2678	3.5	37.8	0.00	3.35	6.27	7.06	9.0	23.45	46.26	13.0	59.8	450	0.20	411	133.0	0.81	44.9%
	958	960	0.00	0	1700	0.00	0	435	0.00	0	0	0.00	0	543	0	2678	3.5	37.8	0.00	3.35	0.00	7.06	9.0	0.00	46.26	13.0	59.8	450	0.15	177	115.2	0.70	51.9%
26	960	966	7.75	716	2416	0.00	0	435	0.00	0	0	0.00	0	543	716	3394	3.4	46.7	0.00	3.35	0.00	7.06	9.0	11.51	57.77	16.2	71.9	450	0.15	82	115.2	0.70	62.4%
27	962	964	2.55	236	236	4.70	705	705	5.04	680	680	0.00	0	0	1621	1621	3.7	24.0	0.00	0.00	0.00	0.00	0.0	20.97	20.97	5.9	29.9	250	0.35	479	36.7	0.72	81.4%
	964	966	0.00	0	236	0.00	0	705	0.00	0	680	0.00	0	0	0	1621	3.7	24.0	0.00	0.00	0.00	0.00	0.0	0.00	20.97	5.9	29.9	250	1.00	298	62.0	1.22	48.2%
28	966	970	1.80	166	2818	5.25	788	1928	0.00	0	680	0.00	0	543	954	5969	3.2	76.7	0.00	3.35	8.89	15.95	16.8	22.38	101.12	28.3	121.8	525	0.15	249	173.8	0.78	70.1%
29	968	970	6.90	638	638	0.00	0	0	0.00	0	0	0.00	0	0	638	638	3.9	10.1	0.00	0.00	0.99	0.99	0.9	11.03	11.03	3.1	14.1	200	0.32	82	19.4	0.60	72.7%
	970	972	0.00	0	3456	0.00	0	1928	0.00	0	680	0.00	0	543	0	6607	3.1	83.8	0.00	3.35	0.00	16.94	17.6	0.00	112.15	31.4	132.8	600	0.15	178	248.1	0.85	53.5%
	972	974	0.00	0	19446	0.00	0	8189	0.00	0	680	0.00	0	1854	0	30169	2.5	302.5	0.00	12.68	0.00	69.12	71.0	0.00	551.8	154.5	528.0	825	0.20	586	669.7	1.21	78.8%
	974	Ex	0.00	0	19446	0.00	0	8189	0.00	0	680	0.00	0	1854	0	30169	2.5	302.5	0.00	12.68	0.00	69.12	71.0	0.00	551.80	154.5	528.0	825	0.20	66	669.7	1.21	78.8%
			210.48			**54.57**			**5.04**			**22.89**																					

Design Parameters:

Avg Flow/Person =	350	l/day	Pipe Friction n = 0.013		**Units/Net ha**	**Pop/Unit**	
Comm./Inst. Flow =	50,000	l/ha/day	Residential Peaking Factor = Harmon Equation (max 4, min 2)	Low Density Residential =	28	3.30	
Infiltration =	0.28	l/s/ha	Peaking Factor Comm./Inst. = 1.5	Medium Density Residential =	60	2.50	(Multi Family Residential)
				High Density Residential =	75	1.80	
				Mixed Use =	90	1.80	(50% of mixed use area is residential)

Project: Fernbank CDP (101108)
Designed: KJM
Checked: MAB
Dwg. Reference: 101108-SAN
Date: May 8, 2009

IBI GROUP
400-333 Preston Street
Ottawa, Ontario K1S 5N4 Canada
tel 613 225 1311 fax 613 225 9868
ibigroup.com

SANITARY SEWER DESIGN SHEET

Davidson Lands
City of Ottawa
Name of Clien/Developer

LOCATION				RESIDENTIAL										ICI AREAS							INFILTRATION ALLOWANCE			FIXED FLOW	TOTAL FLOW	PROPOSED SEWER DESIGN						
				AREA	UNIT TYPES				AREA	POPULATION		PEAK	PEAK	AREA (Ha)						PEAK	AREA (Ha)		FLOW			CAPACITY	LENGTH	DIA	SLOPE	VELOCITY	AVAILABLE CAPACITY	
														INSTITUTIONAL		COMMERCIAL		INDUSTRIAL													
STREET	AREA ID	FROM MH	TO MH	w/ Units (Ha)	SF	SD	TH	APT	w/o Units (Ha)	IND	CUM	FACTOR	FLOW (L/s)	IND	CUM	IND	CUM	IND	CUM	FLOW (L/s)	IND	CUM	(L/s)	(L/s)	(L/s)	(L/s)	(m)	(mm)	(%)	(full) (m/s)	L/s	(%)
PHASE 2																																
Kayenta Street	142A	MH142A	MH143A	0.40	4	4				24.4	24.4	4.00	0.40								0.4	0.40	0.11		0.51	48.39	83.80	200	2.00	1.492	47.88	98.95%
Maygrass Way	146A	MH146A	MH143A	0.29	1	4				14.2	14.2	4.00	0.23								0.29	0.29	0.08		0.31	64.01	39.65	200	3.50	1.974	63.70	99.51%
Maygrass Way	143A	MH143A	MH144A	0.41		6	4			27.0	65.6	4.00	1.06								0.41	1.10	0.31		1.37	60.24	60.76	200	3.10	1.858	58.87	97.72%
Kayenta Street	139A	MH139A	MH140A	0.20		4				10.8	10.8	4.00	0.18								0.2	0.20	0.06		0.23	59.26	40.89	200	3.00	1.827	59.03	99.61%
	140A	MH140A	MH141A	0.07	1					3.4	14.2	4.00	0.23								0.07	0.27	0.08		0.31	51.89	9.57	200	2.30	1.600	51.59	99.41%
	141A	MH141A	MH144A	0.38		6	3			24.3	38.5	4.00	0.62								0.38	0.65	0.18		0.81	51.89	78.46	200	2.30	1.600	51.09	98.45%
Kayenta Street	144A	MH144A	MH145A	0.05			1			2.7	106.8	4.00	1.73								0.05	1.80	0.50		2.23	47.16	13.99	200	1.90	1.454	44.93	95.26%
PHASE 1																																
Kayenta Street	145A	MH145A	MH155A	0.24	1		4			14.2	121.0	4.00	1.96								0.24	2.04	0.57		2.53	47.16	54.00	200	1.90	1.454	44.63	94.63%
Kayenta Street	159A	MH159A	MH153A	0.35	1	2	5			22.3	22.3	4.00	0.36								0.35	0.35	0.10		0.46	51.89	35.93	200	2.30	1.600	51.43	99.11%
	153A	MH153A	MH154A	0.52	2	8	3			36.5	58.8	4.00	0.95								0.52	0.87	0.24		1.20	51.89	69.86	200	2.30	1.600	50.70	97.69%
	154A	MH154A	MH155A	0.25	2					6.8	65.6	4.00	1.06								0.25	1.12	0.31		1.38	54.10	13.93	200	2.50	1.668	52.72	97.46%
Block 159	155A	MH155A	MH156A	0.03						0.0	186.6	4.00	3.02								0.03	3.19	0.89		3.92	45.26	40.50	200	1.75	1.396	41.35	91.35%
	156A	MH156A	MH103A	0.03						0.0	186.6	4.00	3.02								0.03	3.22	0.90		3.93	45.26	41.32	200	1.75	1.396	41.34	91.33%
Edenwylde Drive	100A	MH100A	MH101A	0.63	3		16			53.4	53.4	4.00	0.87								0.63	0.63	0.18		1.04	43.28	68.32	200	1.60	1.335	42.24	97.59%
	101A	MH101A	MH102A	0.23	1		3			11.5	64.9	4.00	1.05								0.23	0.86	0.24		1.29	28.63	29.78	200	0.70	0.883	27.34	95.49%
	102A	MH102A	MH103A	0.34	2		8			28.4	93.3	4.00	1.51								0.34	1.20	0.34		1.85	48.39	43.19	200	2.00	1.492	46.54	96.18%
Edenwylde Drive	103A	MH103A	MH104A	0.23			7			18.9	298.8	4.00	4.84								0.23	4.65	1.30		6.14	45.26	30.98	200	1.75	1.396	39.12	86.43%
Jardiniere Street	122A	MH122A	MH120A	0.21			5			13.5	13.5	4.00	0.22								0.21	0.21	0.06		0.28	28.63	40.37	200	0.70	0.883	28.35	99.03%
	120A	MH120A	MH121A	0.05			1			2.7	16.2	4.00	0.26								0.05	0.26	0.07		0.34	28.63	9.56	200	0.70	0.883	28.29	98.83%
	121A	MH121A	MH126A	0.41			12			32.4	48.6	4.00	0.79								0.41	0.67	0.19		0.98	35.89	86.22	200	1.10	1.107	34.91	97.28%
Jardiniere Street	123A	MH123A	MH124A	0.36			11			29.7	29.7	4.00	0.48								0.36	0.36	0.10		0.58	32.46	67.99	200	0.90	1.001	31.88	98.21%
	124A	MH124A	MH125A	0.17			3			8.1	37.8	4.00	0.61								0.17	0.53	0.15		0.76	21.64	12.58	200	0.40	0.667	20.88	96.48%
	125A	MH125A	MH126A	0.31			10			27.0	64.8	4.00	1.05								0.31	0.84	0.24		1.29	21.64	43.85	200	0.40	0.667	20.36	94.06%
Jardiniere Street	126A	MH126A	MH127A	0.47			14			37.8	151.2	4.00	2.45								0.47	1.98	0.55		3.00	26.50	97.91	200	0.60	0.817	23.50	88.66%
External Commercial	135A	MH135A	MH127A							0.0	0.0	4.00	0.00			2.73	2.73			2.37	2.73	2.73	0.76		3.13	26.50	12.08	200	0.60	0.817	23.37	88.17%
Jardiniere Street	127A	MH127A	MH128A	0.02						0.0	151.2	4.00	2.45				2.73			2.37	0.02	4.73	1.32		6.14	20.24	11.48	200	0.35	0.624	14.10	69.65%
	128A	MH128A	MH129A	0.09						0.0	151.2	4.00	2.45				2.73			2.37	0.09	4.82	1.35		6.17	20.24	61.77	200	0.35	0.624	14.07	69.52%
	129A	MH129A	MH130A	0.03						0.0	151.2	4.00	2.45				2.73			2.37	0.03	4.85	1.36		6.18	20.24	11.48	200	0.35	0.624	14.07	69.48%
	130A	MH130A	MH131A	0.70			26			70.2	221.4	4.00	3.59				2.73			2.37	0.7	5.55	1.55		7.51	20.24	91.95	200	0.35	0.624	12.73	62.89%
	131A	MH131A	MH132A	0.48			15			40.5	261.9	4.00	4.24				2.73			2.37	0.48	6.03	1.69		8.30	20.24	71.17	200	0.35	0.624	11.94	58.99%
	132A	MH132A	MH104A	0.04						0.0	261.9	4.00	4.24				2.73			2.37	0.04	6.07	1.70		8.31	20.24	28.10	200	0.35	0.624	11.93	58.93%
Edenwylde Drive	104A	MH104A	MH105A	0.44			11			29.7	590.4	3.94	9.41				2.73			2.37	0.44	11.16	3.12		14.91	55.26	67.20	300	0.30	0.757	40.35	73.02%
	105A	MH105A	MH106A							0.0	590.4	3.94	9.41				2.73			2.37	0	11.16	3.12		14.91	55.26	11.41	300	0.30	0.757	40.35	73.02%
PHASE 2																																
Maygrass Way	147A	MH147A	CAP	0.43	7					23.8	23.8	4.00	0.39								0.43	0.43	0.12		0.51	56.95	60.75	200	2.77	1.756	56.45	99.11%
PHASE 1																																
Maygrass Way		CAP	MH148A							0.0	23.8	4.00	0.39								0	0.43	0.12		0.51	56.95	12.00	200	2.77	1.756	56.44	99.11%
	148B	MH148A	MH149A	0.40	6					20.4	44.2	4.00	0.72								0.4	0.83	0.23		0.95	50.75	69.93	200	2.20	1.565	49.80	98.13%
	149A	MH149A	MH150A	0.18	2					6.8	51.0	4.00	0.83								0.18	1.01	0.28		1.11	50.75	11.43	200	2.20	1.565	49.64	97.81%
	150A	MH150A	MH151A	0.51	1	1	12			38.5	89.5	4.00	1.45								0.51	1.52	0.43		1.88	41.91	68.53	200	1.50	1.292	40.03	95.52%
	151A	MH151A	MH152A	0.55		9	7			43.2	132.7	4.00	2.15								0.55	2.07	0.58		2.73	41.91	65.09	200	1.50	1.292	39.18	93.49%
	152A	MH152A	MH157A	0.63	1	10	5			43.9	176.6	4.00	2.86								0.63	2.70	0.76		3.62	37.48	87.29	200	1.20	1.156	33.86	90.35%
	---	MH157A	MH106A							0.0	176.6	4.00	2.86								0	2.70	0.76		3.62	100.85	8.35	300	1.00	1.382	97.24	96.41%
PHASE 2																																
Taliesin Crescent	200A	MH200A	MH201A	0.56			18			48.6	48.6	4.00	0.79								0.56	0.56	0.16		0.94	27.59	59.89	200	0.65	0.851	26.64	96.58%
	201A	MH201A	MH202A	0.46			16			43.2	91.8	4.00	1.49								0.46	1.02	0.29		1.77	21.64	63.75	200	0.40	0.667	19.87	91.81%
		MH202A	CAP106AE							0.0	91.8	4.00	1.49								0	1.02	0.29		1.77	21.64	9.65	200	0.40	0.667	19.87	91.81%
	202A	CAP106AE	MH106A	0.08			1			2.7	94.5	4.00	1.53								0.08	1.10	0.31		1.84	21.64	16.50	200	0.40	0.667	19.80	91.50%
PHASE 1																																
Edenwylde Drive	106A	MH106A	MH107A	0.28			6			16.2	877.7	3.84	13.64				2.73			2.37	0.28	15.24	4.27		20.28	50.44	79.17	300	0.25	0.691	30.17	59.80%
PHASE 2																																
Taliesin Crescent	203A	MH203A	MH204A	0.57			18			48.6	48.6	4.00	0.79								0.57	0.57	0.16		0.95	27.59	61.41	200	0.65	0.851	26.64	96.57%
	204A	MH204A	MH205A	0.37			14			37.8	86.4	4.00	1.40								0.37	0.94	0.26		1.66	21.64	50.66	200	0.40	0.667	19.98	92.31%
		MH205A	CAP 107AE							0.0	86.4	4.00	1.40								0	0.94	0.26		1.66	21.64	6.89	200	0.40	0.667	19.98	92.31%
	205A	CAP 107AE	MH107A	0.11			2			5.4	91.8	4.00	1.49								0.11	1.05	0.29		1.78	21.64	16.00	200	0.40	0.667	19.86	91.77%
PHASE 1																																
Edenwylde Drive	107A	MH107A	MH108A	0.39			11			29.7	999.2	3.80	15.38				2.73			2.37	0.39	16.68	4.67		22.42	50.44	81.58	300	0.25	0.691	28.02	55.55%

Design Parameters:

Residential			ICI Areas		
SF	3.4	p/p/u			Peak Factor
TH/SD	2.7	p/p/u	INST	50,000 L/Ha/day	1.5
APT	1.8	p/p/u	COM	50,000 L/Ha/day	1.5
Other	66	p/p/Ha	IND	35,000 L/Ha/day	MOE Chart
				17000 L/Ha/day	

Notes:
1. Mannings coefficient (n) = 0.013
2. Demand (per capita): 350 L/day 300 L/day
3. Infiltration allowance: 0.28 L/s/Ha
4. Residential Peaking Factor:
Harmon Formula = 1+(14/(4+P^0.5))
where P = population in thousands

Designed: LME

Checked:

Dwg. Reference: 37533-501

No.	Revision	Date
1.	City submission No. 1	2019-10-30
2.	City submission No. 2	2020-02-07
3.	City submission No. 3	2020-04-09

File Reference: 37533.5.7.1 **Date:** 2020-04-08 **Sheet No:** 1 of 2

IBI GROUP
400-333 Preston Street
Ottawa, Ontario K1S 5N4 Canada
tel 613 225 1311 fax 613 225 9868
ibigroup.com

SANITARY SEWER DESIGN SHEET

Davidson Lands
City of Ottawa
Name of Clien/Developer

LOCATION				RESIDENTIAL										ICI AREAS							INFILTRATION ALLOWANCE			FIXED FLOW	TOTAL FLOW	PROPOSED SEWER DESIGN						
				AREA w/ Units (Ha)	UNIT TYPES				AREA w/o Units (Ha)	POPULATION		PEAK FACTOR	PEAK FLOW (L/s)	AREA (Ha)						PEAK FLOW (L/s)	AREA (Ha)		FLOW (L/s)			CAPACITY (L/s)	LENGTH (m)	DIA (mm)	SLOPE (%)	VELOCITY (full) (m/s)	AVAILABLE CAPACITY	
														INSTITUTIONAL		COMMERCIAL		INDUSTRIAL													
STREET	AREA ID	FROM MH	TO MH		SF	SD	TH	APT		IND	CUM			IND	CUM	IND	CUM	IND	CUM		IND	CUM								L/s	(%)
PHASE 2																																
Block 170	320A	MH320A	MH186A						2.08	137.3	137.3	4.00	2.22								2.08	2.08	0.58		2.81	21.64	12.44	200	0.40	0.667	18.83	87.03%
Crosanti Drive	186A	MH186A	MH187A	0.10						0.0	137.3	4.00	2.22								0.1	2.18	0.61		2.83	20.24	45.53	200	0.35	0.624	17.41	86.00%
Maverick Crescent	300A	MH300A	MH301A	0.20			4			10.8	10.8	4.00	0.18								0.2	0.20	0.06		0.23	27.56	11.47	200	0.65	0.850	27.33	99.16%
	301A	MH301A	MH302A	1.01			31			83.7	94.5	4.00	1.53								1.01	1.21	0.34		1.87	20.24	116.48	200	0.35	0.624	18.37	90.76%
	302A	MH302A	MH303A	0.07			2			5.4	99.9	4.00	1.62								0.07	1.28	0.36		1.98	20.24	11.48	200	0.35	0.624	18.27	90.23%
	303A	MH303A	MH304A	0.35			9			24.3	124.2	4.00	2.01								0.35	1.63	0.46		2.47	20.24	61.29	200	0.35	0.624	17.77	87.80%
	304A	MH304A	MH305A	0.01						0.0	124.2	4.00	2.01								0.01	1.64	0.46		2.47	20.24	14.00	200	0.35	0.624	17.77	87.79%
Maverick Crescent	300A1	MH300A	MH306A	0.75			26			70.2	70.2	4.00	1.14								0.75	0.75	0.21		1.35	27.59	92.03	200	0.65	0.851	26.24	95.12%
	306A	MH306A	MH307A	0.08						0.0	70.2	4.00	1.14								0.08	0.83	0.23		1.37	20.24	12.96	200	0.35	0.624	18.87	93.23%
Ocala Street	307A	MH307A	MH308A	0.24			5			13.5	83.7	4.00	1.36								0.24	1.07	0.30		1.66	20.24	68.00	200	0.35	0.624	18.59	91.82%
	308A	MH308A	MH305A	0.26			7			18.9	102.6	4.00	1.66								0.26	1.33	0.37		2.03	20.24	59.95	200	0.35	0.624	18.21	89.95%
Ocala Street	305A	MH305A	MH187A	0.06						0.0	226.8	4.00	3.68								0.06	3.03	0.85		4.52	20.24	50.21	200	0.35	0.624	15.72	77.65%
Crosanti Drive	187A	MH187A	MH188A	0.19						0.0	364.1	4.00	5.90								0.19	5.40	1.51		7.41	20.24	89.74	200	0.35	0.624	12.83	63.39%
	188A	MH188A	MH189A	0.80			27			72.9	437.0	4.00	7.08								0.8	6.20	1.74		8.82	20.24	103.64	200	0.35	0.624	11.43	56.45%
		MH189A	CAP	0.12			2			5.4	442.4	4.00	7.17								0.12	6.32	1.77		8.94	21.64	7.33	200	0.40	0.667	12.70	58.70%
	189A	CAP	MH108A							0.0	442.4	4.00	7.17								0	6.32	1.77		8.94	21.64	16.00	200	0.40	0.667	12.70	58.70%
PHASE 1																																
Edenwylde Drive	108A	MH108A	MH109A	0.26			5			13.5	1455.1	3.69	21.74				2.73			2.37	0.26	23.26	6.51		30.63	50.44	75.91	300	0.25	0.691	19.81	39.28%
PHASE 2																																
Orvieto Way	211A	MH211A	CAP210AE	0.65			13			35.1	35.1	4.00	0.57								0.65	0.65	0.18		0.75	27.59	86.14	200	0.65	0.851	26.84	97.28%
		CAP210AE	MH210A							0.0	35.1	4.00	0.57								0	0.65	0.18		0.75	27.59	4.00	200	0.65	0.851	26.84	97.28%
		MH210A	MH109A							0.0	35.1	4.00	0.57								0	0.65	0.18		0.75	27.59	11.31	200	0.65	0.851	26.84	97.28%
PHASE 1																																
Hickstead Way	109A	MH109A	MH110A	0.32	5					17.0	1507.2	3.68	22.46				2.73			2.37	0.32	24.23	6.78		31.61	50.44	76.01	300	0.25	0.691	18.83	37.33%
PHASE 2																																
FRIENDLY CRESCENT	EXTERNAL	EXMH181	MH230A	4.66	70					238.0	238.0	4.00	3.86								4.66	4.66	1.30		5.16	49.58	10.88	200	2.10	1.529	44.42	89.59%
Block 169		MH230A	MH231A							0.0	238.0	4.00	3.86								0	4.66	1.30		5.16	49.58	45.03	200	2.10	1.529	44.42	89.59%
Sendero Way	231A	MH231A	MH221A	0.59	10					34.0	272.0	4.00	4.41								0.59	5.25	1.47		5.88	34.22	67.09	200	1.00	1.055	28.34	82.82%
	221A	MH221A	MH222A	0.64	15					51.0	323.0	4.00	5.23								0.64	5.89	1.65		6.88	26.50	80.39	200	0.60	0.817	19.62	74.03%
	222A	MH222A	MH223A	0.17	2					6.8	329.8	4.00	5.34								0.17	6.06	1.70		7.04	34.22	11.46	200	1.00	1.055	27.18	79.42%
	223A	MH223A	MH224A	0.40	8					27.2	357.0	4.00	5.78								0.4	6.46	1.81		7.59	21.64	69.88	200	0.40	0.667	14.05	64.91%
Sendero Way	235A	MH235A	MH232A	0.56	8					27.2	27.2	4.00	0.44								0.56	0.56	0.16		0.60	34.22	61.94	200	1.00	1.055	33.62	98.25%
	232A	MH232A	MH233A	0.13	1					3.4	30.6	4.00	0.50								0.13	0.69	0.19		0.69	48.39	11.34	200	2.00	1.492	47.70	98.58%
	233A	MH233A	MH234A	0.45	10					34.0	64.6	4.00	1.05								0.45	1.14	0.32		1.37	21.64	57.60	200	0.40	0.667	20.27	93.69%
	234A	MH234A	MH224A	0.59	13					44.2	108.8	4.00	1.76								0.59	1.73	0.48		2.25	21.64	83.39	200	0.40	0.667	19.39	89.61%
Sendero Way	224A	MH224A	CAP 225AN	0.17	3					10.2	476.0	3.99	7.68								0.17	8.36	2.34		10.03	26.50	37.03	200	0.60	0.817	16.48	62.18%
		CAP 225AN	MH225A							0.0	476.0	3.99	7.68								0	8.36	2.34		10.03	26.50	6.50	200	0.60	0.817	16.48	62.18%
	225A	MH225A	MH226A	0.03						0.0	476.0	3.99	7.68								0.03	8.39	2.35		10.03	26.50	15.56	200	0.60	0.817	16.47	62.14%
	226A	MH226A	MH110A	0.02						0.0	476.0	3.99	7.68								0.02	8.41	2.35		10.04	26.50	21.49	200	0.60	0.817	16.46	62.12%
Painted Sky Way	215A	MH215A	MH216A	0.62	14					47.6	47.6	4.00	0.77								0.62	0.62	0.17		0.94	24.19	83.61	200	0.50	0.746	23.25	96.09%
	216A	MH216A	CAP 110AE	0.75	18					61.2	108.8	4.00	1.76								0.75	1.37	0.38		2.15	49.58	84.93	200	2.10	1.529	47.44	95.67%
		CAP 110AE	MH110A							0.0	108.8	4.00	1.76								0	1.37	0.38		2.15	49.58	15.00	200	2.10	1.529	47.44	95.67%
Hickstead Way	110A	MH110A	MH111A	0.36	6					20.4	2112.4	3.57	30.52				2.73			2.37	0.36	34.37	9.62		42.52	50.44	78.00	300	0.25	0.691	7.92	15.71%
Hickstead Way	176A	MH176A	MH111A	0.36	6					20.4	20.4	4.00	0.33								0.36	0.36	0.10		0.43	34.22	64.00	200	1.00	1.055	33.79	98.74%
Aridus Crescent	111A	MH111A	MH112A	0.47	10					34.0	2166.8	3.56	31.23				2.73			2.37	0.47	35.20	9.86		43.46	91.46	68.97	375	0.25	0.802	48.00	52.48%
	112A	MH112A	MH113A	0.51	10					34.0	2200.8	3.55	31.68				2.73			2.37	0.51	35.71	10.00		44.05	91.46	66.19	375	0.25	0.802	47.41	51.84%
	113A	MH113A	MH114A	0.12	1					3.4	2204.2	3.55	31.72				2.73			2.37	0.12	35.83	10.03		44.12	91.46	13.49	375	0.25	0.802	47.33	51.75%
	114A	MH114A		0.52	9					30.6	2234.8	3.55	32.12				2.73			2.37	0.52	36.35	10.18		44.67	91.46	55.98	375	0.25	0.802	46.79	51.16%
		Structure - (325	MH148A																								12.00	200	2.77			
			EXMH181																								35.00	250	0.54			
		EXMH181																									16.74	250	0.54			
		MH189A	Structure - (328																								7.33	200	0.40			
WORKS DESIGNED BY NOVATECH																																
STITTSVILLE SOUTH	EXTERNAL			32.94						2182.0	2182.0										32.94	32.94									
	175A	111	109 (0)	0.23	3					10.2	2192.2	3.55	31.57								0.23	33.17	9.29		*40.85*	141.68	*115.7*	*375*	*0.60*	1.243	100.83	71.17%
STREET NO. 11	176B	109 (0)	107 (0)	0.54	11					37.4	2229.6	3.55	32.05								0.54	33.71	9.44		*41.49*	91.46	*71.7*	*375*	*0.25*	0.802	49.97	54.63%
STREET NO. 11	177A	107 (0)	105 (0)	0.49	10					34.0	2263.6	3.54	32.49								0.49	34.20	9.58		*42.07*	91.46	*62.1*	*375*	*0.25*	0.802	49.39	54.00%
STREET NO. 11	178A	105 (0)	MH115A	0.19	1					3.4	2267.0	3.54	32.54								0.19	34.39	9.63		*42.16*	258.68	*11.0*	*375*	*2.00*	2.269	216.51	83.70%
BLOCK 263		MH115A	99 (1800)							0.0	4501.8	3.29	59.94				2.73			2.37	0	70.74	19.81		82.12	320.35	*73.3*	*450*	*1.16*	1.951	238.23	74.37%
BLOCK 263		99 (1800)	PS							0.0	4501.8	3.29	59.94				2.73			2.37	0	70.74	19.81		82.12	474.96	*4.8*	*450*	*2.55*	2.893	392.84	82.71%

Design Parameters:

Residential			ICI Areas		
SF	3.4	p/p/u			Peak Factor
TH/SD	2.7	p/p/u	INST	50,000 L/Ha/day	1.5
APT	1.8	p/p/u	COM	50,000 L/Ha/day	1.5
Other	66	p/p/Ha	IND	35,000 L/Ha/day	MOE Chart
				17000 L/Ha/day	

Notes:
1. Mannings coefficient (n) = 0.013
2. Demand (per capita): 350 L/day 300 L/day
3. Infiltration allowance: 0.28 L/s/Ha
4. Residential Peaking Factor:
Harmon Formula = 1+(14/(4+P^0.5))
where P = population in thousands

Designed: LME

Checked:

Dwg. Reference: 37533-501

No.	Revision	Date
1.	City submission No. 1	2019-10-30
2.	City submission No. 2	2020-02-07
3.	City submission No. 3	2020-04-09

File Reference: 37533.5.7.1 **Date:** 2020-04-08 **Sheet No:** 2 of 2

velocity of approximately 1.4m/s (within MOE recommended forcemain velocities of 0.8 t 2.5m/s).

According to the *West Urban Community – Wastewater Collection System Master Servicing Plan by RV Anderson Associates Ltd., dated July 2012* monitored peak flows entering the Stittsville Pump Station were 39L/s in 2010. With a capacity of 108L/s, the remaining capacity is 69L/s. Based on the aforementioned, the Liard St. Pump Station can handle the majority of the development. It is recommended that the flows at the Liard St. Pump Station continue to be monitored until extension of the Fernbank Trunk is completed (see 6.1.5 for details regarding the Future Fernbank Trunk).

6.1.4 Friendly Crescent Pump Station

The Friendly Crescent Pump Station is a low lift station, which services the properties along Friendly Crescent. The flow is pumped west to the 250mm dia. sewer along Hartsmere Drive and has an overflow that is directed to a storm outlet east of Friendly Crescent.

Novatech Engineering produced the "Design Services and Stormwater Report" in May 2000 with a detailed design of the Friendly Crescent Pump Station. The station was designed to serve 70 dwellings that discharge to the Friendly Crescent Pump Station with a peak flow of 5.77 L/s using twin Flygt effluent pumps CP3085.182 that push 6.0 L/sec at 7.15 meters total dynamic head through a 100mm diameter, 230m long forcemain.

It is proposed that the sanitary sewer-shed of Friendly Crescent Pump Station be accounted for in the servicing alternatives, in order to provide a higher level of service, by providing a gravity outlet to avoid the costs of maintaining and operating the existing pump station.

6.1.5 Future Fernbank Trunk

The Future Fernbank Trunk will be built along the Hydro One easement to accommodate the future development of the Fernbank Community Design Plans as referenced in the Master Servicing Study for the Fernbank lands. Once constructed, the Liard Street Pump Station will be decommissioned, and all flows from the Liard Street Pump Station sewer-shed and the Area 6 lands will be directed to the Fernbank Trunk through a gravity sewer. The Fernbank Trunk will convey flows to the Hazeldean Pump Station. The decommissioning work will be undertaken by the City, based on the time frame provided in Infrastructure Master Plan.

The Fernbank Trunk was designed for a peak flow of 528L/s and has a capacity of 670L/s which leaves an excess capacity of 142L/s. As per section 6.1.3 of this report, the Liard Street Pump Station had a monitored flow of 39L/s in 2010, and proposed Area 6 peak design flows is 85L/s which summates to 124L/s. Based on these flows, there is adequate capacity in the Fernbank Trunk.

Based on coordination with the Landowners within the Fernbank CDP lands, the sewer depth and size will be accounted for at the proposed subdivisions within the Fernbank Lands CDP to provide the required capacity in order to eventually decommission the Liard Street Pump station and accumulate the Area 6 flows. The cost for over-sizing and over –depth of the sewers is discussed in Section 9.2.

Table ES 3: WUC summary of flow generation scenarios

PUMPING STATION OR TRUNK SEWER	FIRM CAPACITY	EXISTING CAPACITY	CURRENT SEWER CONFIGURATION						
			FLOW [1]	Scenario 1		Scenario 2		Scenario 3	
(Year)			2010	2031	2060	2031	2060	2031	2060
	(L/s)	(L/s)	(L/s)	(L/s)	(L/s)	(L/s)	(L/s)	(L/s)	(L/s)
Richmond Pump Station	360		151	340	340	314	314	407	407
Stittsville PS	108		39	106	506	77	300	91	353
Hazeldean Pump Station	1225		832	1537	1937	1373	1596	1741	2003
Kanata West Pump Station [2]	765		152	593	689	462	555	561	678
Signature Ridge Pump Station [3]	360		54	309	423	218	302	256	351
March Pump Station	490		326	771	941	668	814	820	1008
Acres Road Pump Station	4600		2119	4186	4966	3774	4320	4437	5099
Glen Cairn Trunk		2815 to 2988	1139	2512	3008	2192	2508	2758	3137
Stittsville Trunk		519 to 972	358	485	885	444	679	572	732
Main Street Sewer		307 to 739	138	330	444	237	321	342	399
Penfield Sewer		398 to 734	170	360	474	267	351	342	437
March Ridge Trunk (Above March Forcemain)		1223	245	434	548	339	423	428	523
March Ridge Trunk (Below March Forcemain)		1016	571	1205	1489	1007	1237	1248	1531
Watts Creek Siphon		1014	571	1205	1489	1007	1237	1248	1531
Tri-Township Collector		1595 to 1803	1705	3717	4497	3199	3745	4006	4668
March Wood Trunk		1100	230	574	705	502	616	608	752
East March Trunk		550	96	172	211	141	173	187	231
North Kanata Trunk - Phase I		4047 to 4640	1705	3717	4497	3199	3745	4006	4668
Nepean Collector		190	190	197	197	193	193	234	234
Watt's Creek Trunk		5418 to 6640	1891	3914	4694	3392	3938	4240	4902

The coloured cells in the table identify the component of the current sewer system that is under capacity by the time of the projected growth in 2031 or 2060.

[1] – flow results based on the dynamic model calculation;

APPENDIX C

WATER SUPPLY

STITTSVILLE SOUTH SUBDIVISION
CITY OF OTTAWA

DETAILED SERVICING & STORMWATER MANAGEMENT REPORT

Prepared For:

ROSS BRADLEY, CINQUE TERRE HOLDINGS INC. & STITTSVILLE SOUTH INC.

Prepared By:

NOVATECH
Suite 200, 240 Michael Cowpland Drive
Ottawa, Ontario
K2M 1P6

September 21, 2015
Revised July 18, 2016

Novatech File: 113004
Ref: R-2015-072

6.0 WATER SUPPLY SYSTEM

6.1 Background Information

The proposed development is located within the service area of Pressure Zone 3W of the City of Ottawa water distribution system. This zone is fed by the Glen Cairn and Campeau Drive Pump Stations. Balancing storage during peak and fire flow conditions is accomplished with use of the Stittsville Elevated Tank.

The existing water distribution system adjacent to the study area includes;

- 400mm diameter watermain on Fernbank Road
- 300mm diameter watermain on Arrowwood Drive
- 200mm diameter watermain on Hartsmere Drive
- 250mm diameter watermain on West Ridge Drive

The existing ground elevations within Area 6 are between 105m and 124m above sea level.

Novatech has retained Stantec Consulting Ltd.(Stantec) to undertake a hydraulic analysis using the City's most up to date model which had recently been updated for the 2013 Water Master Plan update. The analysis takes into account the future Fernbank CDP Lands. The Stantec findings and recommendations; '*Stittsville Area 6 - Potable Water Hydraulic Assessment Phase 1 &2'* dated September 2nd, 2015 can be found in **Appendix D**.

6.2 Previous Recommendations

As part of the *Area 6 MSR*, it was determined that the preferred water servicing alternative consists of a 250mm watermain spine, and 200mm diameter watermain feeding adjacent local roads. It was also recommended that a 300mm diameter watermain be extended from Arrowwood Drive into the proposed site as 200mm watermain for backbone continuity, and the 400mm diameter watermain on Fernbank Road be extended towards the East in order to meet the proposed 250mm diameter spine. Refer to **Figure 6.1**.

6.3 Overall Water Demand & Criteria

The water demands for Stittsville South would be estimated using the City of Ottawa's Water Distribution Design Guidelines.

6.3.1 Water Demand

The domestic demand design criteria used to determine the size of the watermains required to service the Stittsville South area are as follows:

Domestic Demand

Average Residential Domestic Flow per capita	350 L/cap/day
Capita per dwelling	3.4 persons per single 2.7 persons per townhouse 2.3 persons per stacked townhouse 2.1 persons per apartment
Maximum Day Demand	2.5 x Average Day Demand
Peak Hour Demand	2.2 x Maximum Day Demand

Commercial and Parks Demand

Commercial Capita	50,000 L/ha/day
Maximum Day Demand	1.5 x Average Day Demand
Peak Hour Demand	1.8 x Maximum Day Demand
Park Demand	1000 L/park/day

6.3.2 Fire Flow Demand

The City of Ottawa requires proposed watermain networks meet Fire Underwriters Survey fire flow requirements. However, Technical Bulletin ISDTP-2014-02 specifies that the fire flow requirement can be capped at 10,000 L/min for the following;

- Single detached dwellings, provided that there is a minimum rear yard separation of 10m between adjacent units.
- Town and row homes, provided that firewalls with a minimum of two hour fire-resistance rating that comply with OBC Div. B, Subsection 3.1.10 are used to separate home blocks into fire areas that comprise no more than the lesser of seven units, and 600m² of building area. Furthermore, there must be a minimum rear yard separation of 10m.

Based on the above, the watermain analysis has assessed the ability of the proposed network to attain a fire flow of 10,000 L/min at all locations. Fire Underwriters Survey fire flow calculations have also been included for reference in **Appendix D**.

6.3.3 Design Criteria

The design criteria used to determine the size of the watermains required to service the Stittsville South area are based on a conservative approach that considers three possible scenarios, as follows:

System Pressures

Maximum Allowable Pressure	551.6kPa (80psi)
Minimum Allowable Pressure (excluding fire flow conditions)	275.8kPa (40psi)
Minimum Allowable Pressure (including fire flow conditions)	137.9Kpa (20psi)

6.4 Watermain Analysis

Novatech has retained Stantec Consulting Ltd. to conduct a hydraulic analysis of the proposed development potential, and its effects on the City's water infrastructure. The hydraulic network model and memo 'Stittsville Area 6-Phase 1 & 2 - Potable Water Hydraulic Assessment' dated September 2nd, 2015 is included in **Appendix D**. The hydraulic network simulated average day, peak hour and maximum day plus fire flow conditions.

Stantec used the City's most up to date model that was recently updated for the 2013 Water Master Plan. Both current conditions and future conditions (anticipated 2031 conditions from the 2031 Water Master Plan model) were analyzed.

It is important to note that in the area of the proposed development, head losses under peak demands could reduce minimum pressures to below guideline requirements at higher

elevations. Future planned connections as per the Water Master Plan, within the Fernbank lands will mitigate this issue resulting in increased minimum pressures.

6.5 Discussion

6.5.1 Low Pressures

Under peak hour demands, ground elevations greater than 124m are susceptible to minimum pressures marginally below the required 40psi under 2013 existing conditions. In future 2013 conditions, minimum pressures everywhere within the proposed development are not expected to drop below required pressures.

Within the vicinity of the cul-de-sac at the end of Street Five, ground elevations are greater than 124m. In order to mitigate marginally low expected pressures, it is proposed that 25mm services be installed for Lots 23, 24, and 25 to alleviate low pressure concerns. The specifications and details of these mitigations will be provided in the detail design drawings of the Camplina Way, 113004-GP1.

It is also expected that buildings within Block 349 will experience marginally low pressures due to the ground elevations in this area. Within Block 349, jet pumps will be required where buildings are greater than two stories tall. The jet pumps will be owned and maintained by the condominium corporation. Such mitigation measures, including the jet pumps, will be finalized within servicing reports during detailed design in support of the site plan application.

Similarly, at Block 353 contains the potential for a 6 story condominium building that will likely require pressure boosting measures. Such measures include but are not limited to jet pumps within the mechanical room of the apartment block. These measures will be owned and maintained by the condominium corporation and will be finalized within servicing reports during detailed design in support of the site plan application.

Refer to the Legal Plan of Subdivision for the location of the aforementioned blocks.

6.5.2 High Pressures

Under average day demands (also known as basic day demands), ground elevations less than 106m will experience pressures greater than the required limit of 80psi. As Phase 1 and 2 of the Stittsville South subdivision do not have any finished grade elevations around residential units or street below elevation 106.00, high pressures are not a concern.

6.5.3 Fire Flow

As per Appendix B-5 through B-8 of the attached Stantec Potable Water Hydraulic Assessment, a 10,000L/min fire flow is attained in general throughout the proposed development as per ISDB-TB2014-01.However there are a few localized exceptions, where the criteria was not met as discussed below.

At node A95 (at the dead end of Campolina Way) the available fire flow is 8000L/min. The FUS long calculation for Lot 25 (worst case scenario) was calculated to be 8,000L/min; therefore, the fire demand is met. a second 250mm watermain loop (along Falabella, Campolina, Lipizzaner) was introduced to retain the minimum required fire flows of 8,000L/min.

As per ISD-TB 2014-01, at node 81, the residential configuration does not allow the 10,000 L/min fire demand to be utilized and requires the FUS long method to be utilized. As such, the fire demand at this location is 13,000 L/min. The available fire flow at residual pressure of 20 psi, is 18,000L/min; therefore, the fire demand is met.

6.6 Recommendations & Proposed Water Infrastructure

Based on the findings of 'Stittsville Area 6 - Potable Water Hydraulic Assessment' there is sufficient capacity to provide both the required domestic and emergency fire flows to the service area. In order to accomplish this, it is proposed that the 250mm diameter watermain existing west of the development would be extended through Area 6 and reconnected at Fernbank Road. This 250mm watermain would act as the spine, from which 200mm diameter watermain will feed adjacent roads. It is also recommended that an existing 300mm diameter watermain be extended as a 200mm watermain from Arrowwood Drive into the proposed site for backbone continuity, and the 400mm diameter watermain on Fernbank Road be extended towards the East in order to meet the proposed 250mm diameter spine. Elevations greater than 124m will require additional measures to increase peak hour pressures. Elevations less than 106m will require pressure reduction measures. Refer to **Figure 6.1** for sizing.

It is likely that the eastern portion of Parade (Lots 286 – 295) will be developed in advance of the Davidson Lands; hence the watermain within this portion will be deemed a dead-end. Is it anticipated that the Davidson Lands will advance within the next two years. As there are less than 50 units temporarily connected to this portion of the main, the City's guidelines are met.

HIGH DENSITY RESIDENTIAL
HYDRO CORRIDOR
COMMERCIAL
COMMUNITY FEATURE
MEDIUM DENSITY RESIDENTIAL
LOW DENSITY RESIDENTIAL
FUTURE DEVELOPMENT
SWMF

OWNERSHIP BOUNDARY
EXISTING 150mmØ WM
EXISTING 200mmØ WM
EXISTING 250mmØ WM
EXISTING 300mmØ WM
PROPOSED 50mmØ WM
PROPOSED 200mmØ WM
PROPOSED 250mmØ WM
PROPOSED 300mmØ WM
PROPOSED 400mmØ WM

FERNBANK CDP LANDS

LAYOUT TO BE CONFIRMED BY DAVIDSON PARCEL DRAFT PLAN PROCESS (BY OTHERS)

CONNECT TO EXISTING

FUTURE 400mmØ WM

400mmØ WM EXTENSION

COMMERCIAL WM CONNECTION

FERNBANK ROAD

EX. 200mmØ WM

EX. 150mmØ WM

WEST RIDGE DRIVE

STITTSVILLE MAIN STREET

SCHOOL

PARK

HARTSMERE DRIVE

FRIENDLY CRESCENT

CONNECT TO EXISTING

BELL WATER CONNECTION SUBJECT TO EASEMENT

CONNECT TO EXISTING

HYDRO CORRIDOR

SHEA ROAD

1 2 3 4 5 6

CONNECT TO EXISTING

EXTRA DEEP LOTS

MAINTAIN EXISTING TREES

CONNECTION TO PROPOSED DAVIDSON SUBDIVISION

LAYOUT TO BE CONFIRMED BY DAVIDSON PARCEL DRAFT PLAN PROCESS (BY OTHERS)

NOTE: DAVIDSON LANDS LAYOUT IS SUBJECT TO CHANGE (BY OTHERS). REFER TO CITY OF OTTAWA FILE NO. D07-16-15-0008.

SCALE 1:7000

NOVATECH
Engineers, Planners & Landscape Architects
Suite 200, 240 Michael Cowpland Drive
Ottawa, Ontario, Canada K2M 1P6
Telephone (613) 254-9643
Facsimile (613) 254-5867
Website www.novatech-eng.com

STITTSVILLE SOUTH AREA 6

WATERMAIN CONCEPT PLAN

DATE JULY 2016 | JOB 113004 | FIGURE FIGURE 6.1

SHT11X17.DWG - 279mmX432mm

M:\2013\113004\CAD\Design\Figures\Design Brief\May 2015\113005-Demo-figures.dwg, FIG 6.1, Jul 14, 2016 - 11:24am, bsweet

APPENDIX D

Hydraulic Analysis – Stantec (Retained by Novatech)

Stittsville Area 6 - Potable Water Hydraulic Assessment of Phase 1 & 2

Prepared for:
Novatech Engineering Consultants Limited

Prepared by:
Stantec Consulting Ltd.

September 2, 2015

Sign-off Sheet

This document entitled Stittsville Area 6 - Potable Water Hydraulic Assessment of Phase 1 & 2 was prepared by Stantec Consulting Ltd. ("Stantec") for the account of Novatech Engineering Consultants Ltd. (the "Client"). Any reliance on this document by any third party is strictly prohibited. The material in it reflects Stantec's professional judgment in light of the scope, schedule and other limitations stated in the document and in the contract between Stantec and the Client. The opinions in the document are based on conditions and information existing at the time the document was published and do not take into account any subsequent changes. In preparing the document, Stantec did not verify information supplied to it by others. Any use which a third party makes of this document is the responsibility of such third party. Such third party agrees that Stantec shall not be responsible for costs or damages of any kind, if any, suffered by it or any other third party as a result of decisions made or actions taken based on this document.

Prepared by _____
(Signature)
Val Hoang, M.A.Sc., Engineering Intern

Reviewed by _____
(Signature)
Kevin Alemany, M.A.Sc., P.Eng.

Table of Contents

EXECUTIVE SUMMARY I

1.0 BACKGROUND **1.1**
1.1 AREA OF DEVELOPMENT 1.1
1.2 GROUND ELEVATIONS 1.2
1.3 PREVIOUS STUDIES 1.3
1.4 PHASING & PROPOSED PIPING 1.4

2.0 SERVICEABILITY **2.8**
2.1 ALLOWABLE PRESSURES 2.8
2.2 FIRE FLOWS 2.8

3.0 WATER DEMANDS **3.1**

4.0 HYDRAULIC MODELLING RESULTS **4.1**
4.1 HYDRAULIC MODEL SET-UP 4.1
4.2 BASIC DAY AND PEAK HOUR DEMANDS 4.1
4.3 MAXIMUM DAY + FIRE FLOW 4.2

5.0 CONCLUSION **5.1**

LIST OF TABLES

Table 3-1: Estimated Residential Population based on Unit Types 3.1
Table 3-2: Non-Residential Areas 3.1
Table 3-3: Estimated Water Demand 3.1
Table 4-1: C-Factors Used for Applied Watermain Based on Pipe Diameter 4.1
Table 5-1: Residual Pressure during BSDY and PKHR Demands 4.2

LIST OF FIGURES

Figure 1-1: Location of Area 6 ..... 1.1
Figure 1-2: Ground Elevations (m) in Area of Proposed Development 1.2
Figure 1-3: Connection Points of Area 6 to Existing Watermains from Stantec 2014 Report 1.3
Figure 1-4: Phasing Plan 1.5
Figure 1-5: Connection Points to Existing System and Future Development 1.6
Figure 1-6: Proposed Piping Sizing and Alignment 1.7

LIST OF APPENDICES

APPENDIX A FUS FIRE FLOW CALCULATIONS A.1

APPENDIX B HYDRAULIC MODELLING RESULTS B.1

Executive Summary

Stantec Consulting Ltd. (Stantec) has carried out a detailed potable water hydraulic analysis for Phases 1 and 2 of the proposed Area 6 service area located in Stittsville on behalf of Novatech Engineering Consultants Ltd. The proposed Area 6 development is located between Stittsville Main Street and Shea Road along Fernbank Road and is adjacent to the boundaries of Pressure Zone 3W of the City of Ottawa water distribution system.

A hydraulic assessment was performed using the City's most up to date model (with permission) for existing conditions to simulate Phase 1 and 2. The spine of the network is proposed to be 250mm diameter piping (which connects to existing watermains) with 200mm diameter piping making up the remainder of the internal network.

The proposed watermain to service the mixed use development has sufficient capacity to provide the required domestic demands while maintaining the City's objective pressure in the development. However, additional consideration should be taken for buildings with more than two storeys in height as they are subject to experiencing low pressures (i.e. below 40 psi) on the higher floors during peak demands. Proposed building heights, ground elevations and minimum pressure constraints need to be considered accordingly.

A fire flow assessment under maximum day demand conditions was carried out and it was determined that fire flows greater than 10,000 L/min can be achieved while maintaining a residual pressure of 20 psi throughout the development except for one dead-end location. According to the latest site plans, this dead-end location is anticipated to service units that require 8,000 L/min of fire flow per the FUS calculation, which is deemed achievable according to model results presented herein.

1.0 BACKGROUND

1.1 AREA OF DEVELOPMENT

Stantec Consulting Ltd. (Stantec) has undertaken a hydraulic assessment of the potable water servicing area for the proposed Area 6 Stittsville development on behalf of Novatech Engineering Consultants Ltd. This analysis specifically reviews conditions of Phase 1 and 2 as they are currently in the detailed design stage. Area 6 is a mixed-use development that includes single homes, town houses, apartment buildings and a small commercial area.

The proposed development site is located between Stittsville Main Street and Shea Road along Fernbank Road (**Figure 1-1**). It is located within the service area of Pressure Zone 3W of the City of Ottawa water distribution system. Zone 3W is fed by the Glen Cairn and Campeau Drive Pump Stations with the Stittsville Elevated Tank providing balancing storage for peak flows as well it provides storage to meet emergency and fire flow conditions.

Figure 1-1: Location of Area 6

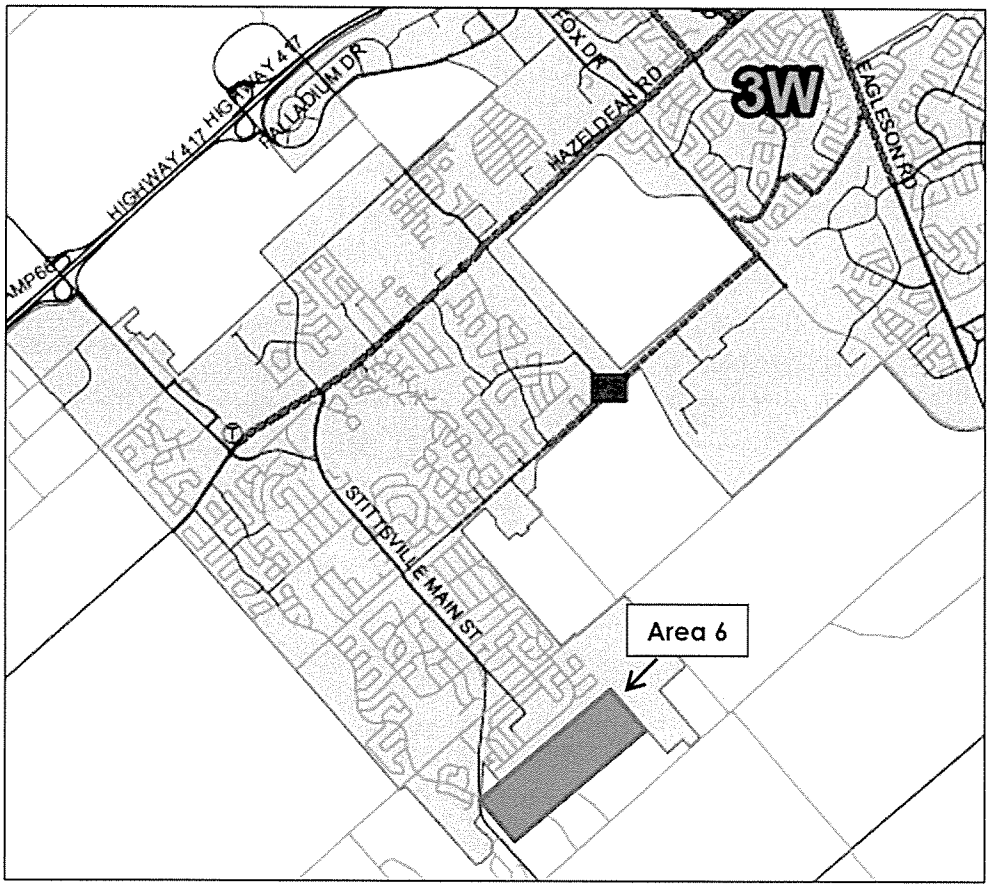

1.2 GROUND ELEVATIONS

The existing ground elevations of the proposed Area 6 development range from approximately 107m and 125m. The elevations shown on **Figure 1-2** were interpolated from an elevation topography file and assigned to the nodes in the hydraulic model.

Figure 1-2: Ground Elevations (m) in Area of Proposed Development

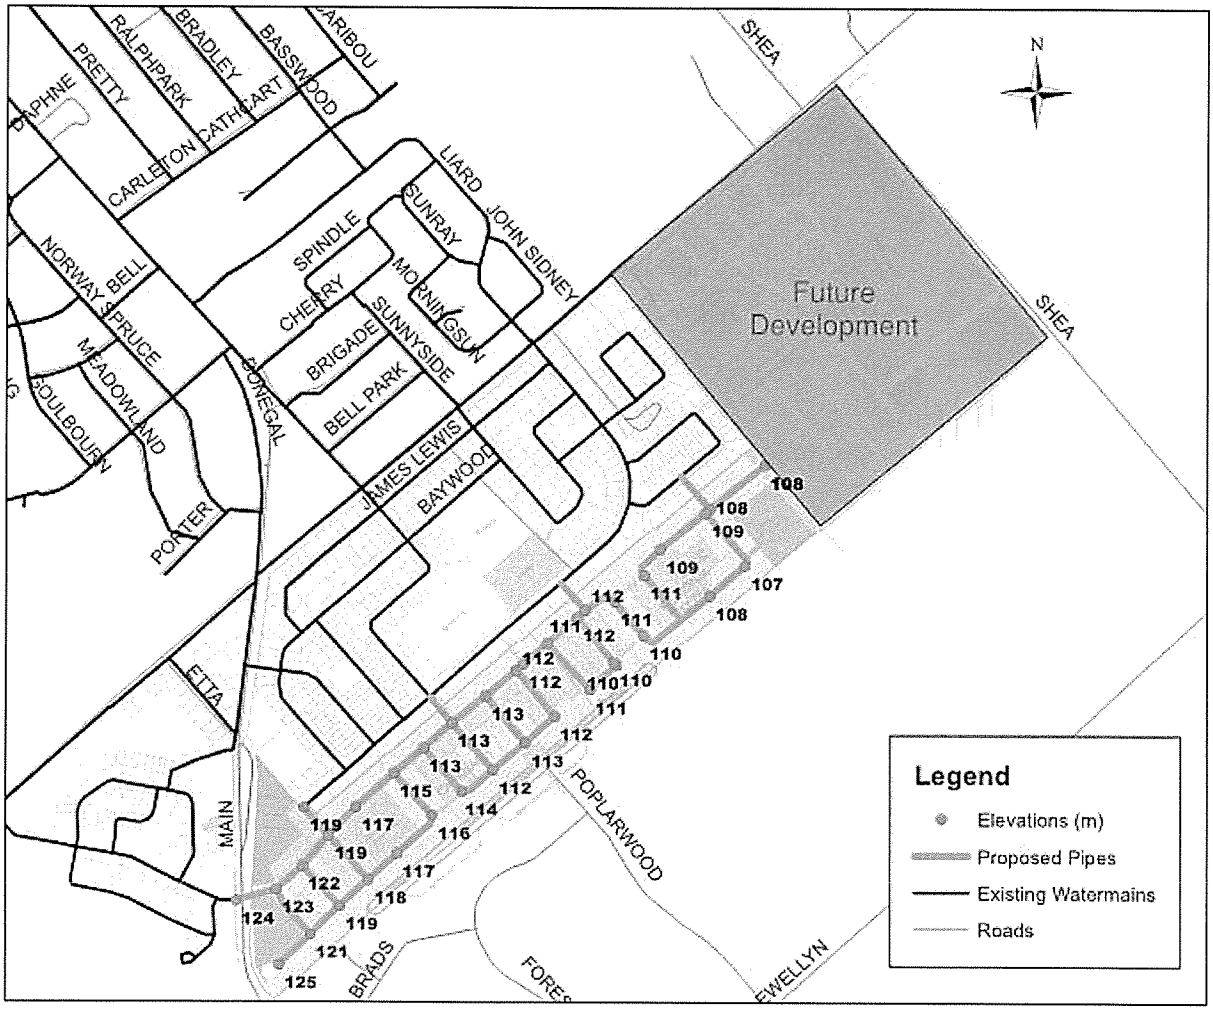

1.3 PREVIOUS STUDIES

In 2014, Stantec performed a Zone Level hydraulic analysis for Stittsville Area 6 where the criteria described in the 2013 Water Master Plan (WMP) was used to estimate water demands for the entire development. The resulting proposed watermain network is shown in **Figure 1-3** along with the connection points of Area 6 to the existing water distribution system. Pipes within the proposed network are made up of 305mm, 250mm and 203mm in diameter.

Figure 1-3: Connection Points of Area 6 to Existing Watermains from Stantec 2014 Report

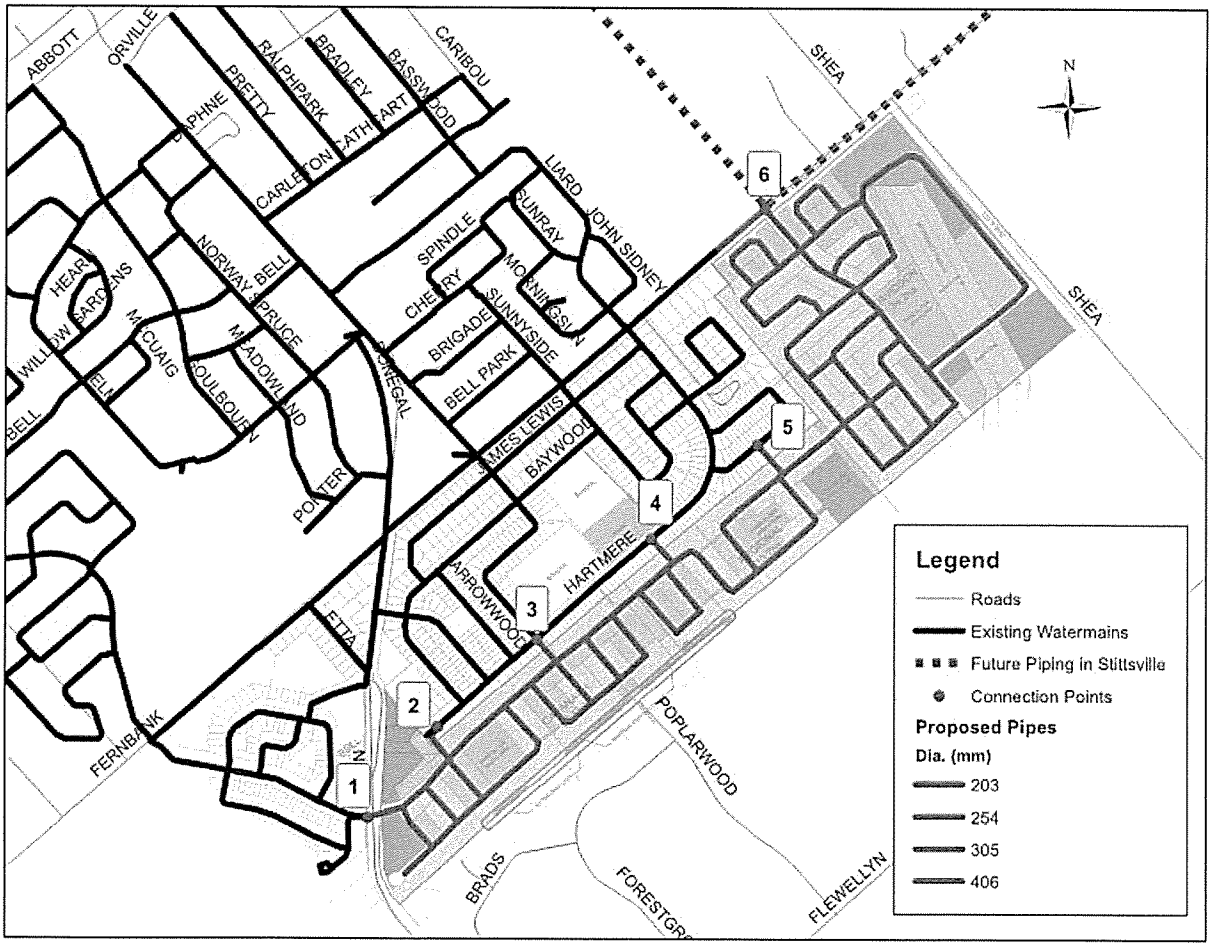

Hydraulic modelling showed that the proposed pipe sizing and alignment was capable of providing domestic demand and the City's Objective fire flow of 10,000 L/min while maintaining pressures in accordance to the City Guidelines except for one location. This location is the dead-end located in the southwest (cul-de-sac) of the development which was capable of achieving 7,000 L/min of flow. Additionally, since this location has a ground elevation greater than 124.5m, it resulted in minimum pressures slightly below the City's objective of 40 psi during peak hour demands. It was recommended that oversized services and plumbing be considered

for this location to achieve minimum pressures of 40 psi. Constraints of multi-storey buildings located in areas of high elevations should also be considered accordingly to avoid low pressure on the higher storeys.

During analysis of Phase 3 which was modeled under future 2031 conditions, it was noted that the typical operating pressures are anticipated to exceed the objective limit of 80 psi in the lands with lower elevations. Areas with ground elevations less than 106m are expected to experience pressures greater than 80 psi and require pressure reducing measures to be in accordance with the Ontario Plumbing.

1.4 PHASING & PROPOSED PIPING

Area 6 is currently proposed to be developed in 3 phases (**Figure 1-4**). Phase 1 and 2 are currently in the detailed design stage while Phase 3 is not expected to be developed in the short term and not included in this latest servicing analysis.

Phase 1 - the Cavanagh lands includes

- a connection to the existing 250mm diameter watermain on West Ridge Dr. (point 1);
- a connection the existing 203mm diameter watermain on Hartsmere Dr. (point 2).

Phase 2 - Regional lands and Bell Lands west of Cavanagh Lands includes

- an extension of 300mm diameter watermain along Arrowwood Dr. (point 3);
- a connection to the existing 203mm diameter watermain on Hartsmere Dr. (point 4); and
- a connection to the existing 203mm diameter watermain on Friendly Cres. (point 5).

Phase 3 - Davidson Lands (to be developed in future phases)

- construction of a small section of 400mm diameter pipe to connect point 6 to the existing watermain on Fernbank; this extension would represent a portion of the extended future 400mm diameter watermain along Fernbank Road towards Shea Road.

Figure 1-4: Phasing Plan

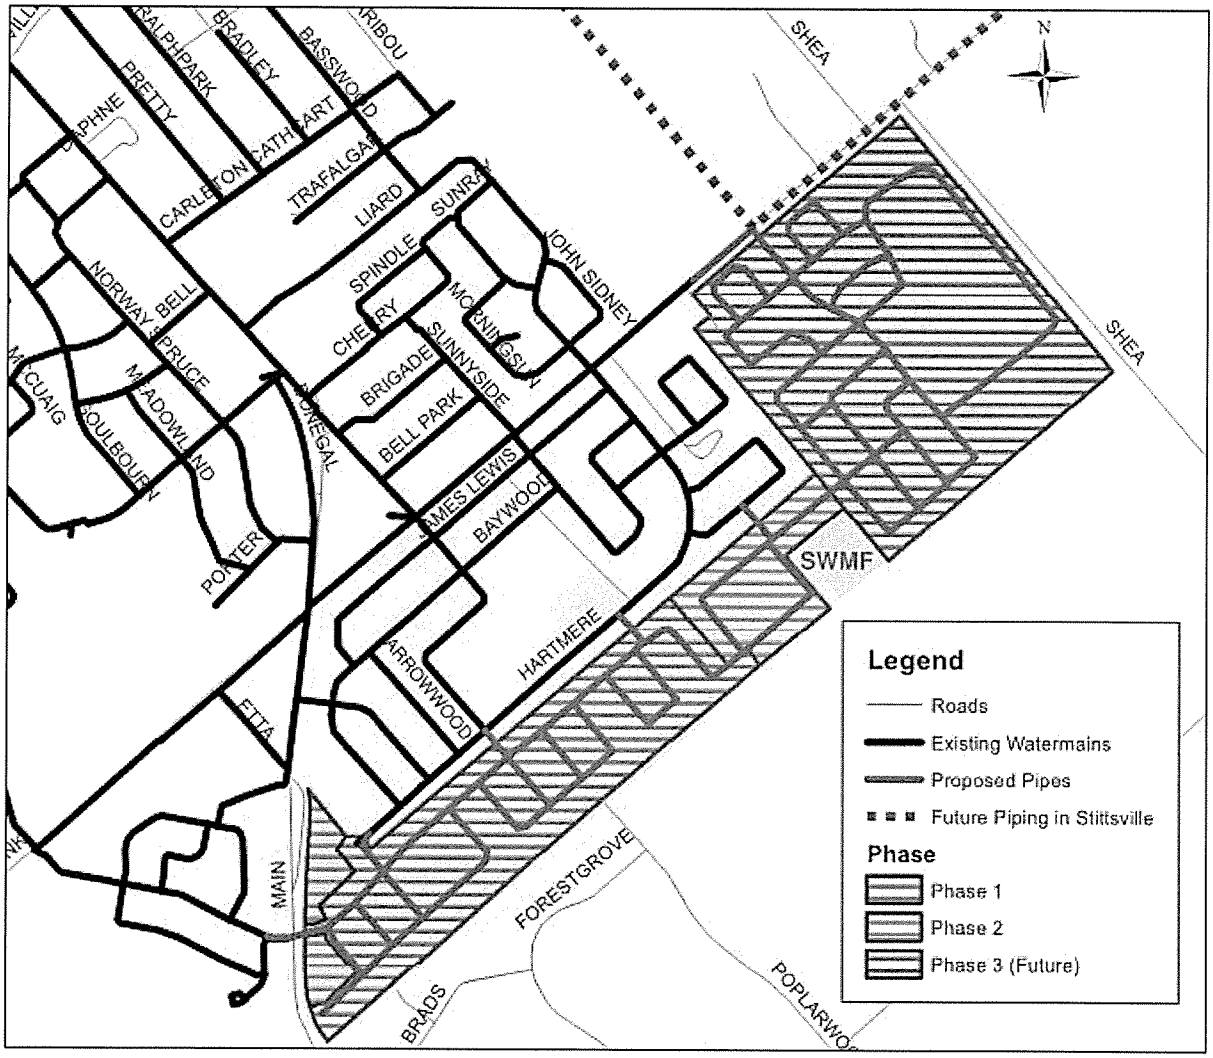

Figure 1-5 shows the connection points of the development to the existing watermain network and the connection from Phase 2 to the future development (Phase 3) on the east side of Area 6 (denoted as connection "F"). It should be noted that the watermain from connection 3 into the development (along Arrowwood Drive) as shown in **Figure 1-6** was previously proposed to be a 305mm diameter pipe (refer to **Figure 1-3**) but has been revised to 250mm and 203mm pipes to avoid oversized piping. Additionally, to increase the and minimum pressures during peak hour and fire flow at the cul-de-sac location, the surrounding pipes are recommended to be upsized from 203mm to 250mm diameter watermains.

Figure 1-5: Connection Points to Existing System and Future Development

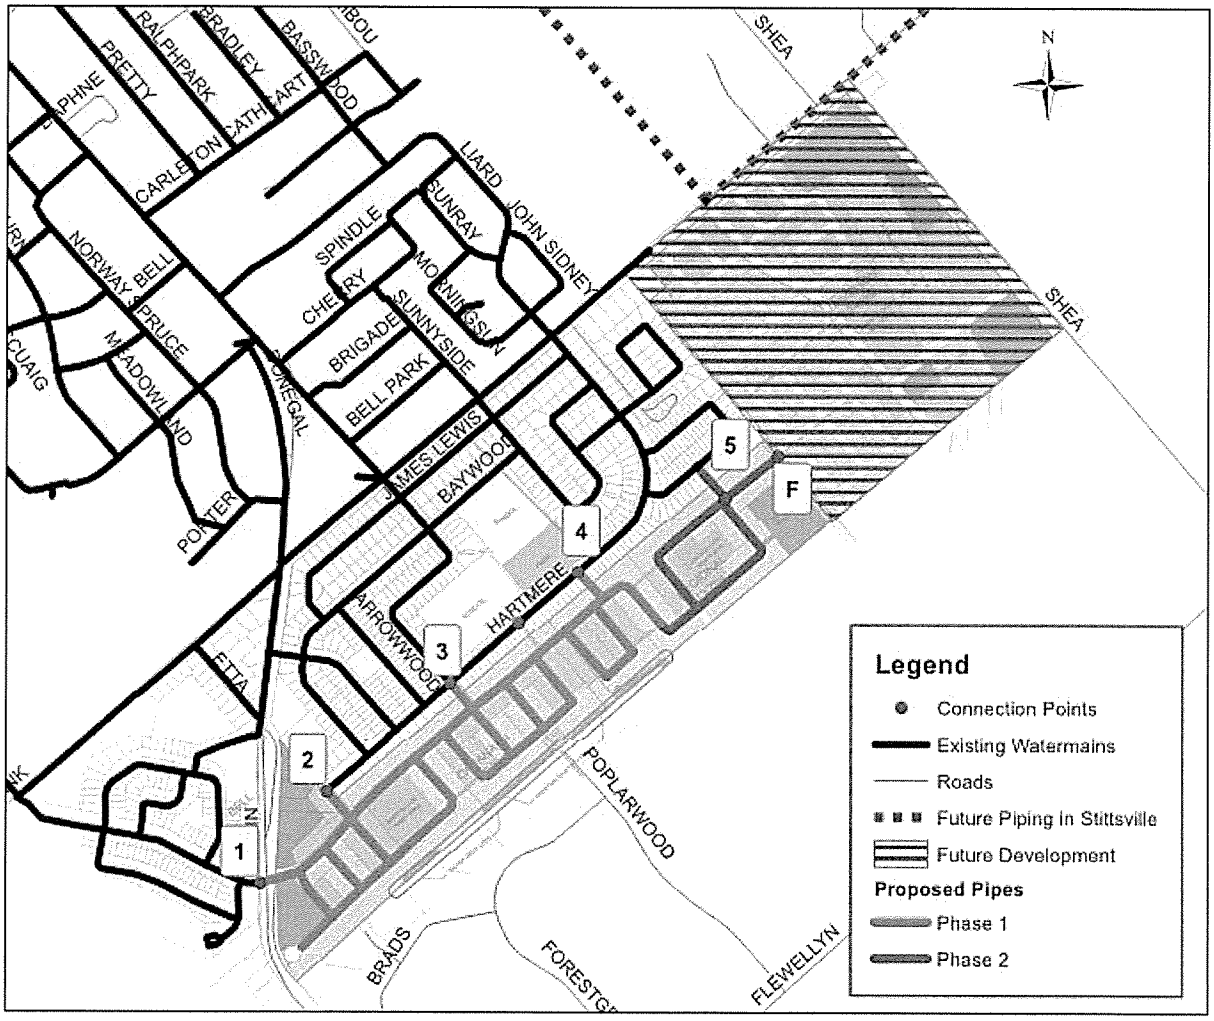

Figure 1-6: Proposed Piping Sizing and Alignment

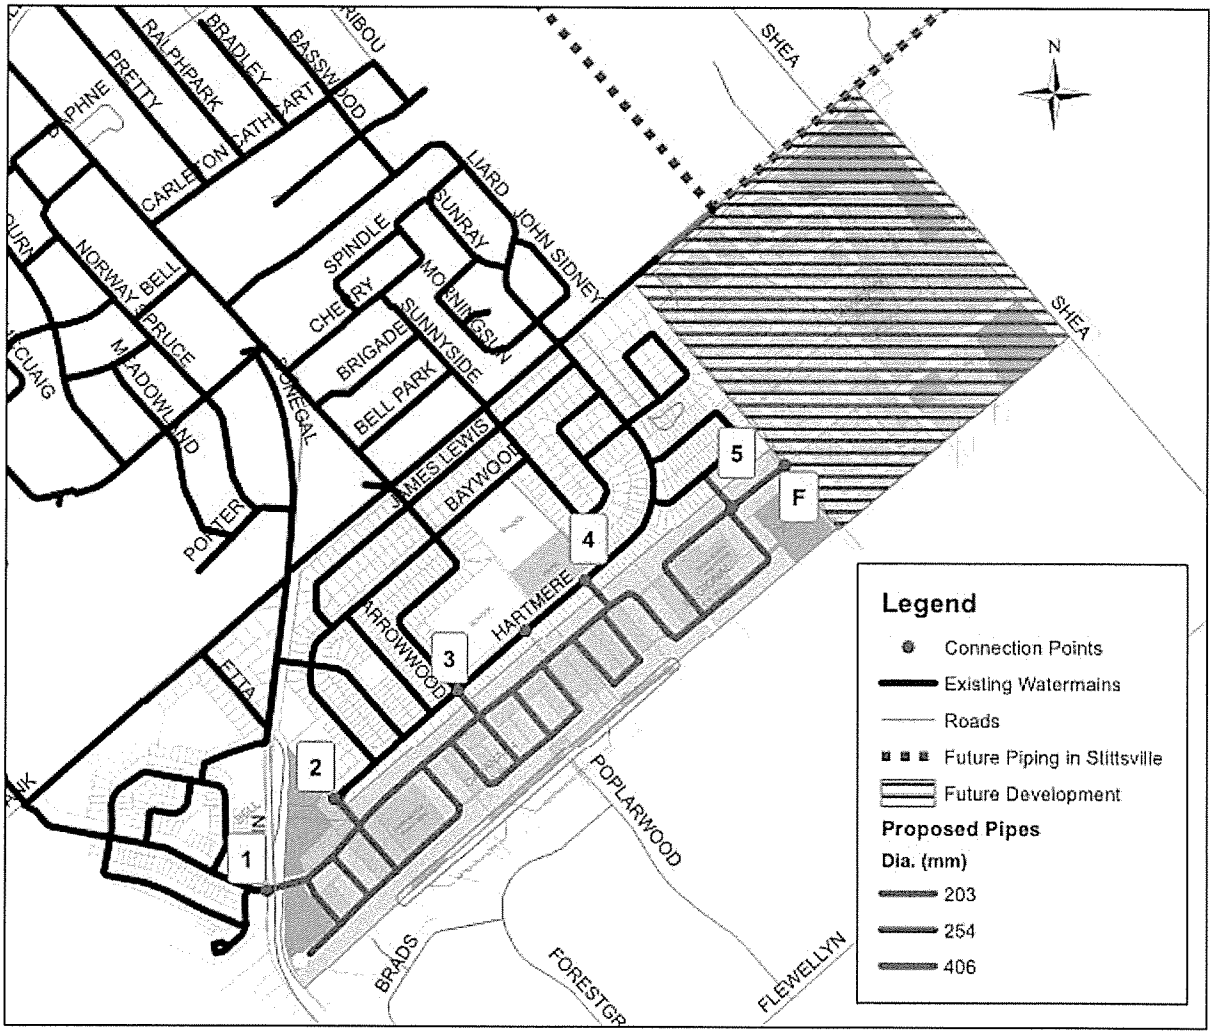

2.0 SERVICEABILITY

2.1 ALLOWABLE PRESSURES

The City of Ottawa Water Distribution Design Guidelines state that the design objective for system pressures under normal demand conditions (i.e. average day, maximum day and peak hour) is in the range of 40 to 80 psi at the ground elevation in the streets (i.e. at hydrant level). The maximum pressure at any point in the distribution system is 100 psi; however, as per the Ontario Building/Plumbing Code, pressure relief measures are required for services when pressures greater than 80 psi are anticipated. Under emergency fire flow conditions, the minimum pressure in the distribution system is allowed to drop to 20 psi.

Multi-storey residential buildings require an additional 5 psi for every additional storey over two storeys to account for the change in elevation head and some additional headloss. For example, the minimum pressure required for a two-storey building is 40 psi whereas a three-storey building requires at least 45 psi and a four-storey building requires at least 50 psi. This is to account for the difference in elevation and additional pipe headloss.

2.2 FIRE FLOWS

The City of Ottawa requires new developments to demonstrate that the proposed watermain network can achieve the Fire Underwriters Survey (FUS) fire flow objective (using the long form calculation). The City's Technical Bulletin ISDTB-2014-02 specifies the type of development and condition that allow fire flow requirements to be capped at 10,000L/min.

Novatech has confirmed that the maximum fire flow requirement that would be required based on the planned development is 10,000L/min. FUS calculations are presented in **Appendix A**. This report assesses the ability of the network to attain a fire flow of 10,000L/min throughout the network.

3.0 WATER DEMANDS

The City of Ottawa's Water Design Guidelines were used for estimate the water demands of Phase 1 and 2 as they are in the detailed design stage of development. The average day (AVDY) demands were estimated using a residential consumption rate of 350 L/cap/d and population densities based on various unit types. **Table 3-1** shows the unit count and estimated population. For parks, a water consumption rate of 1,000L/d was applied. **Table 3-2** shows the total park area for Phase 1 and 2 and its corresponding water demand.

Maximum day (MXDY) demands were estimated by multiplying AVDY demands by a factor of 2.5 and peak hourly (PKHR) demands were estimated by multiplying MXDY demands by a factor of 2.2. **Table 3-3** shows the estimated water demands for each phase where the latest plans for Phase 1 and 2 calls for a total **650** units and an estimated population of **1,903.**

Table 3-1: Estimated Residential Population based on Unit Types

Phase	Unit Type	Persons/Unit	Units	Population
1	Single Family	3.4	269	914
	Town Houses	2.7	126	341
	Phase 1 Total		***395***	***1,256***
2	Single Family	3.4	69	235
	Town Houses	2.7	34	92
	Apartments	2.1	152	320
	Phase 2 Total		***255***	***647***
			650	***1,903***

Table 3-2: Non-Residential Areas

Phase	Non-Residential	Area (ha)	Demand (L/s)
1	Park	1.33	0.77
2		0.82	0.47

Table 3-3: Estimated Water Demand

Phase	Population	BSDY (L/s)	MXDY (L/s)	PKHR (L/s)
1	1,256	5.08	12.71	27.96
2	1,903	7.70	19.25	42.34

4.0 HYDRAULIC MODELLING RESULTS

4.1 HYDRAULIC MODEL SET-UP

With the permission of the City, Stantec performed the hydraulic analysis using the City's 2013 Water Master Plan (WMP) model. Stantec assessed the anticipated pressures in the Area 6 development and reviewed potential upgrades/upsizing of existing watermains (if any) in order to meet minimum servicing requirements.

The software package used to carry out the analysis was H_2OMAP Water by Innovyze. The model was tested under three different domestic demand conditions: basic day (BSDY), peak hour (PKHR) and one emergency condition: maximum day plus fire (MXDY+FF). For the analysis herein, Stantec adjusted the previous model that was used for the 2014 hydraulic analysis to correspond to the updated changes of Phase 1 and 2.

New watermains were added to the hydraulic model to simulate the proposed distribution system. Hazen-Williams coefficients ("C-Factors") were applied to the new watermain in accordance with the City of Ottawa's Water Distribution Design Guidelines (**Table 4-1**):

Table 4-1: C-Factors Used for Applied Watermain Based on Pipe Diameter

Pipe Diameter (mm)	C-Factor
150	100
200 to 300	110
350 to 600	120
> 600	130

4.2 BASIC DAY AND PEAK HOUR DEMANDS

Steady-state modelling under 2013 (existing) conditions was used to model basic day and peak hour scenarios. **Table 4-2** shows the pressure observed during hydraulic modelling under BSDY and PKHR demands. It can be seen that maximum pressures do not exceed the City's objective of 80 psi in Phase 1 and 2.

During the previous 2014 study, one location within Area 6 with a ground elevation greater than 124m (cul-de-sac) was susceptible to minimum pressure marginally below 40 psi under peak hour. As such for this analysis herein, the pipes surrounding this area were upsized from 200mm to 250mm diameter watermains to increase the minimum pressures to the City's objective. Hydraulic modelling results show that in doing so, the minimum pressure at the cul-de-sac is at 40 psi and satisfies the City's guidelines. It is recommended that pressure testing be performed to confirm that pressures to not drop below 40 psi in this location.

Table 4-2: Residual Pressure during BSDY and PKHR Demands

Phase	BSDY	PKHR
	Max. Pressure (psi)	Min. Pressure (psi)
1	72	40
2	76	40

Multi-storey buildings require an additional 5 psi for every additional storey over two storeys to account for the change in elevation head and additional headloss. Based on a resulting minimum hydraulic gradeline of 153m under peak demand conditions in Area 6, the following are the "cut-off" elevations for various multiple storey buildings, above which, pressures would fall below the minimum pressure guideline objective:

Two storeys: ground elev. greater than 124.5m results in pressures less than 40 psi.
Three storeys: ground elev. greater than 121.0m results in equivalent pressures less than 40 psi.
Four storeys: ground elev. greater than 117.5m results in equivalent pressures less than 40 psi.

4.3 MAXIMUM DAY + FIRE FLOW

The City of Ottawa's design guidelines for water distribution systems require a minimum pressure of 20 psi to be maintained at all points in the distribution system under a condition of maximum day and fire flow demand. A hydraulic analysis was accomplished using a steady-state maximum day demand scenario along with the automated fire flow simulation feature of the software.

During 2013 conditions for Phase 1 and 2, the proposed network was able to supply fire flows greater than 10,000 L/min while maintaining a residual pressure of 20 psi at all locations in Area 6 except one location in the southwest of the development. This location was modelled as a dead-end and the available fire flow was approximately 8,000 L/min at a residual pressure of 20 psi. However, the latest site plan shows this area is anticipated to service single family homes and as per the FUS fire flow calculated for this unit type, the required fire flow is 8,000 L/min (**Appendix A**). See **Appendix B** for available fire flows as each location.

5.0 CONCLUSION

The proposed mixed residential development is located in an area of the City's water distribution system that has sufficient capacity to provide both the required domestic and emergency fire flows to the majority of the service area using the proposed piping alignment and sizing proposed.

During existing conditions, Phases 1 and 2 are expected to operate in objective range of 40 - 80 psi under BSDY and PKHR demands. It is recommended, however, that the dead-end location (cul-de-sac) located in the southwest portion of the development be checked for pressures to confirm minimum pressures do not drop below 40 psi.

A fire flow analysis was performed and it was determined that a fire flow greater than 10,000 L/min is achievable at all locations except for one dead-end located in the southwest portion of the development. Site plans show that location is anticipated to service single family homes and will require an FUS fire flow of 8,000L/min which is achievable.

Appendix A FUS FIRE FLOW CALCULATIONS

NOVATECH ENGINEERING CONSULTANTS LTD.
ENGINEERS & PLANNERS

Fire Flow Calculations - Towns (w/o Party Walls) (6 Unit Row)

As per Fire Underwriter's Survey Guidelines

PROJECT: Area 6 Lands **DATE: Aug 2015**
JOB#: 113004

		[yes/no]			
C	**Coefficient related to type of construction**				
	• Wood frame	y	1.5		
	• Ordinary construction		1		
	• Non-combustible construction		0.8		
	• Fire resistive construction (< 2 hrs)		0.7		
	• Fire resistive construction (> 2 hrs)		0.6		
	• Interpolation (Using FUS Tables)				
A	**Area of structure considered (m^2) ***	***1,200***	<==>	12,917 ft^2	
	(All floors excluding Basement, under 2-Storeys)				
F	**Required fire flow (L/min)**				
	$F = 220\ C\ (A)^{0.5}$			***11,432 L/min***	
	Occupancy hazard reduction of surcharge	[yes/no]			
	• Non-combustible	y	-25%		
	• Limited combustible		-15%		
	• Combustible		0%		
	• Free burning		15%		
	• Rapid burning		25%		
				8,574 L/min	(1)
	Sprinkler Reduction				
	• Non-combustible - Fire Resistive (3	no	50%	***0 L/min***	(2)
	Exposure surcharge (cumulative (%), 2 sides)	[yes/no]			
	0 - 3 m	yes	25%	2 side	50%
	3.1 - 10 m		20%		
	10.1 - 20 m	yes	15%	1 side	15%
	20.1 - 30 m	yes	10%	1 side	10%
	30.1- 45 m		5%		
			Cumulative Total		**75%**
				6,430 L/min	
	Fire Wall Separation	N/A			
	• Number of Party Walls * 1000 L/min				
	(As per City of Ottawa Standard)			***6,430 L/min***	(3)

REQUIRED FIRE FLOW [(1) - (2) + (3)]		***15,000 L/min***
(2,000 L/min < Fire Flow < 45,000 L/min)	***or***	***250 L/s***
	or	***3,303 IGPM***

BY: *Adam Lambros*

* Largest Block Size

NOVATECH
ENGINEERING
CONSULTANTS LTD.
ENGINEERS & PLANNERS

Fire Flow Calculations - Towns (w/o Party Walls) (Blocks 344&343)

As per Fire Underwriter's Survey Guidelines

PROJECT: Area 6 Lands **DATE: Aug 2015**

JOB#: 113004

		[yes/no]			
C	**Coefficient related to type of construction**				
	• Wood frame	y	1.5		
	• Ordinary construction		1		
	• Non-combustible construction		0.8		
	• Fire resistive construction (< 2 hrs)		0.7		
	• Fire resistive construction (> 2 hrs)		0.6		
	• Interpolation (Using FUS Tables)				
A	**Area of structure considered (m^2) ***	***1,000***	<==>	10,764 ft^2	
	(All floors excluding Basement, under 2-Storeys)				
F	**Required fire flow (L/min)**				
	$F = 220\ C\ (A)^{0.5}$			***10,436 L/min***	
	Occupancy hazard reduction of surcharge	[yes/no]			
	• Non-combustible	y	-25%		
	• Limited combustible		-15%		
	• Combustible		0%		
	• Free burning		15%		
	• Rapid burning		25%		
				7,827 L/min	(1)
	Sprinkler Reduction				
	• Non-combustible - Fire Resistive (3	no	50%	***0 L/min***	(2)
	Exposure surcharge (cumulative (%), 2 sides)	[yes/no]			
	0 - 3 m	yes	25%	1 side	25%
	3.1 - 10 m	yes	20%	1 side	20%
	10.1 - 20 m		15%		
	20.1 - 30 m	yes	10%	1 side	10%
	30.1- 45 m	yes	5%	1 side	5%
			Cumulative Total		**60%**
				4,696 L/min	
	Fire Wall Separation	N/A			
	• Number of Party Walls * 1000 L/min				
	(As per City of Ottawa Standard)			***4,696 L/min***	(3)
	REQUIRED FIRE FLOW [(1) - (2) + (3)]			***13,000 L/min***	
	(2,000 L/min < Fire Flow < 45,000 L/min)		***or***	***216.67 L/s***	
			or	***2,862 IGPM***	

BY: *Adam Lambros*

* Largest Block Size

NOVATECH ENGINEERING CONSULTANTS LTD.
ENGINEERS & PLANNERS

Fire Flow Calculations - Single Residential Unit (At Cul-De-Sac)

As per Fire Underwriter's Survey Guidelines

PROJECT: Area 6 Lands **DATE: Aug 2015**
JOB#: 113004

		[yes/no]			
C	**Coefficient related to type of construction**				
	• Wood frame	y	1.5		
	• Ordinary construction		1		
	• Non-combustible construction		0.8		
	• Fire resistive construction (< 2 hrs)		0.7		
	• Fire resistive construction (> 2 hrs)		0.6		
	• Interpolation (Using FUS Tables)				
A	**Area of structure considered (m^2) ***	***360***	<==>	3,875 ft^2	
	(All floors excluding Basement, under 2-Storeys)				
F	**Required fire flow (L/min)**				
	$F = 220\ C\ (A)^{0.5}$			***6,261 L/min***	
	Occupancy hazard reduction of surcharge	[yes/no]			
	• Non-combustible	y	-25%		
	• Limited combustible		-15%		
	• Combustible		0%		
	• Free burning		15%		
	• Rapid burning		25%		
				4,696 L/min	(1)
	Sprinkler Reduction				
	• Non-combustible - Fire Resistive (3	no	50%	***0 L/min***	(2)
	Exposure surcharge (cumulative (%), 2 sides)	[yes/no]			
	0 - 3 m	yes	25%	2 side	50%
	3.1 - 10 m		20%		
	10.1 - 20 m		15%		
	20.1 - 30 m		10%		
	30.1- 45 m	yes	5%	2 side	10%
			Cumulative Total		**60%**
				2,818 L/min	
	Fire Wall Separation	N/A			
	• Number of Party Walls * 1000 L/min				
	(As per City of Ottawa Standard)			***2,818 L/min***	(3)

REQUIRED FIRE FLOW [(1) - (2) + (3)]		***8,000 L/min***
(2,000 L/min < Fire Flow < 45,000 L/min)	***or***	***133.33 L/s***
	or	***1,761 IGPM***

BY: *Adam Lambros*
* Largest Size Unit

NOVATECH ENGINEERING CONSULTANTS LTD.
ENGINEERS & PLANNERS

Fire Flow Calculations - Single Residential Unit (3,000sqft +)

As per Fire Underwriter's Survey Guidelines

PROJECT: Area 6 Lands **DATE: Aug 2015**
JOB#: 113004

		[yes/no]			
C	**Coefficient related to type of construction**				
	• Wood frame	y	1.5		
	• Ordinary construction		1		
	• Non-combustible construction		0.8		
	• Fire resistive construction (< 2 hrs)		0.7		
	• Fire resistive construction (> 2 hrs)		0.6		
	• Interpolation (Using FUS Tables)				
A	**Area of structure considered (m^2) ***	***360***	<==>	3,875 ft^2	
	(All floors excluding Basement, under 2-Storeys)				
F	**Required fire flow (L/min)**				
	$F = 220\ C\ (A)^{0.5}$			***6,261 L/min***	
	Occupancy hazard reduction of surcharge	[yes/no]			
	• Non-combustible	y	-25%		
	• Limited combustible		-15%		
	• Combustible		0%		
	• Free burning		15%		
	• Rapid burning		25%		
				4,696 L/min	(1)
	Sprinkler Reduction				
	• Non-combustible - Fire Resistive (3	no	50%	***0 L/min***	(2)
	Exposure surcharge (cumulative (%), 2 sides)	[yes/no]			
	0 - 3 m	yes	25%	2 side	50%
	3.1 - 10 m		20%		
	10.1 - 20 m	yes	15%	1 side	15%
	20.1 - 30 m	yes	10%	1 side	10%
	30.1- 45 m		5%		
			Cumulative Total		**75%**
				3,522 L/min	
	Fire Wall Separation	N/A			
	• Number of Party Walls * 1000 L/min				
	(As per City of Ottawa Standard)			***3,522 L/min***	(3)

REQUIRED FIRE FLOW [(1) - (2) + (3)]		***8,000 L/min***
(2,000 L/min < Fire Flow < 45,000 L/min)	***or***	***133.33 L/s***
	or	***1,761 IGPM***

BY: *Adam Lambros*

* Largest Unit Size

Appendix B HYDRAULIC MODELLING RESULTS

Figure B-1: Node IDs

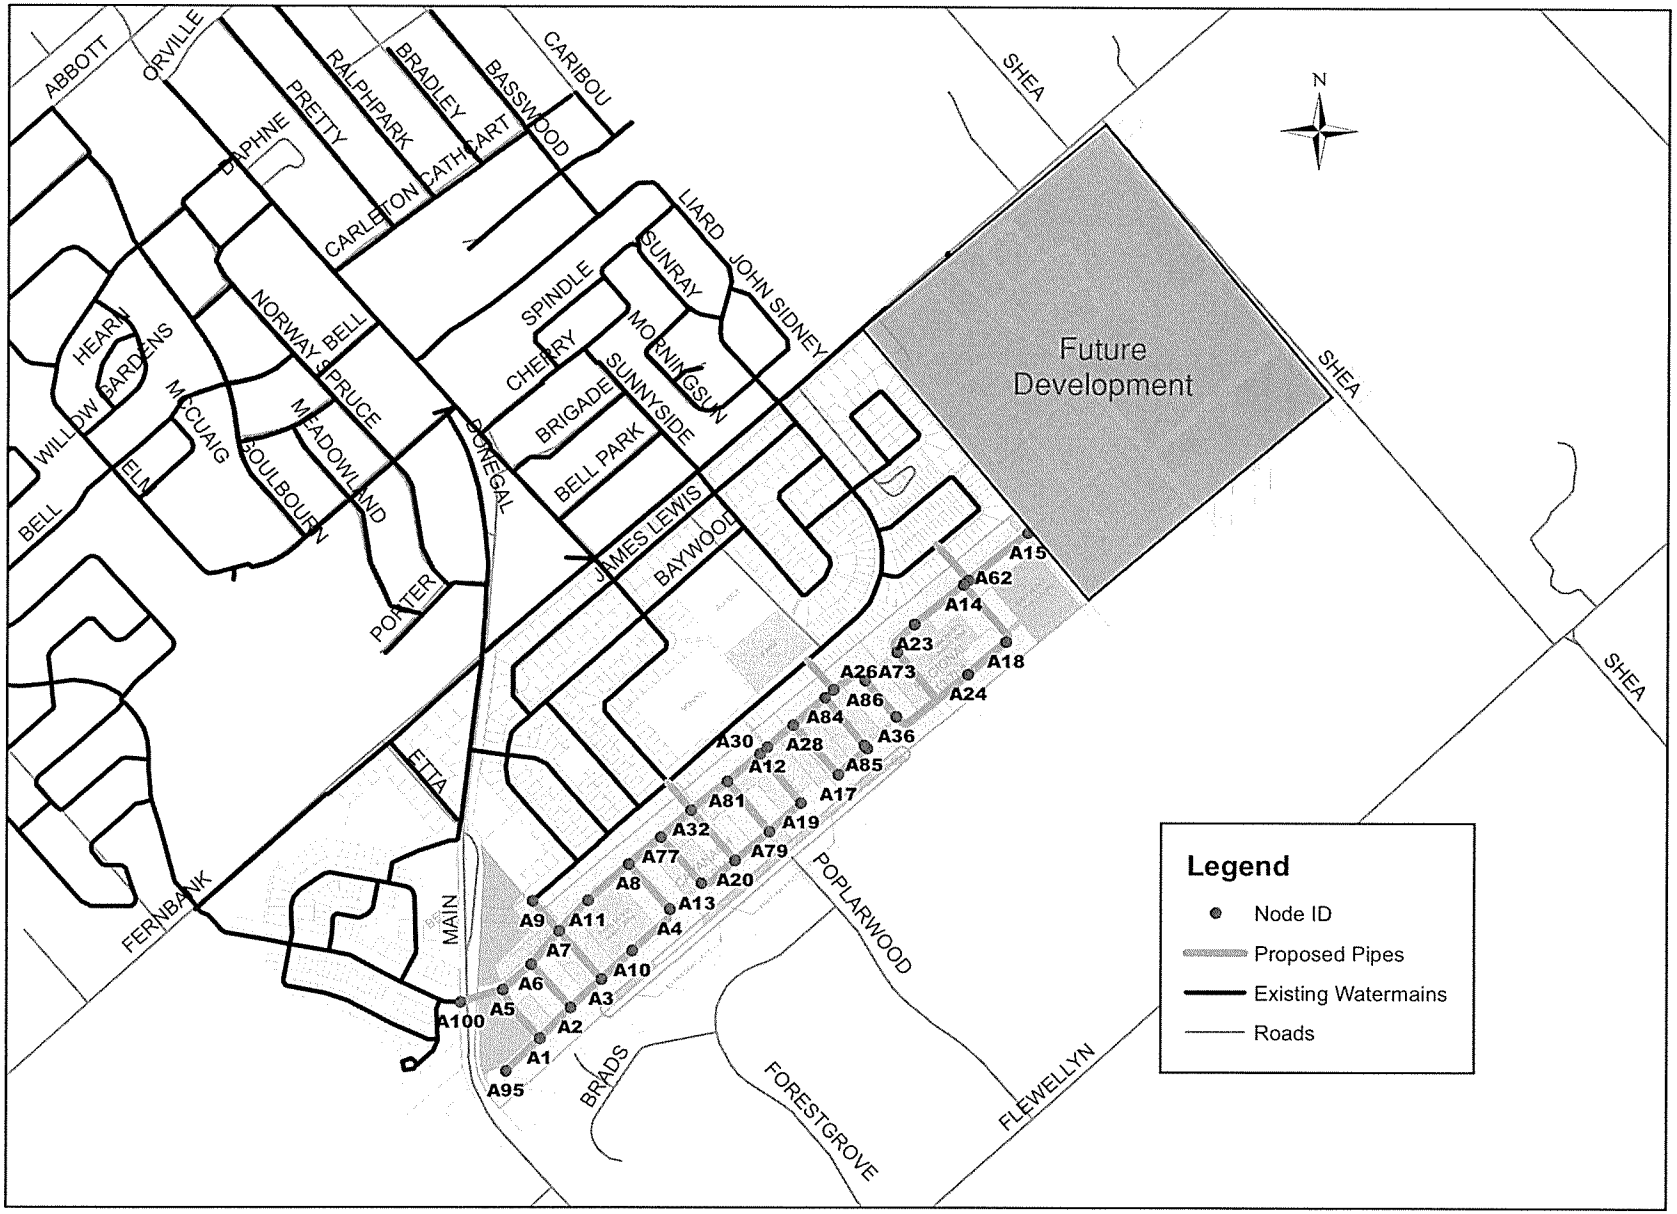

PHASE 1

	BSDY				PKHR			
ID	Demand (L/s)	Elevation (m)	Head (m)	Pressure (psi)	Demand (L/s)	Elevation (m)	Head (m)	Pressure (psi)
A100	0.195	124.0	160.7	52	1.075	124.0	153.3	42
A6	0.195	122.2	160.7	55	1.075	122.2	153.3	44
A3	0.195	118.3	160.7	60	1.075	118.3	153.3	50
A10	0.385	117.4	160.7	62	0.385	117.4	153.3	51
A7	0.195	119.0	160.7	59	1.075	119.0	153.3	49
A11	0.385	116.8	160.7	62	0.385	116.8	153.3	52
A4	0.195	115.9	160.7	64	1.075	115.9	153.3	53
A13	0.195	113.5	160.7	67	1.075	113.5	153.3	57
A8	0.195	114.6	160.7	66	1.075	114.6	153.3	55
A77	0.195	113.5	160.7	67	1.075	113.5	153.3	57
A20	0.195	112.5	160.7	69	1.075	112.5	153.3	58
A79	0.195	112.6	160.7	68	1.075	112.6	153.3	58
A19	0.195	111.8	160.7	70	1.075	111.8	153.3	59
A32	0.195	112.9	160.7	68	1.075	112.9	153.3	57
A81	0.195	112.7	160.7	68	1.075	112.7	153.3	58
A30	0.195	111.7	160.7	70	1.075	111.7	153.3	59
A28	0.195	110.9	160.7	71	1.075	110.9	153.3	60
A17	0.195	110.5	160.7	71	1.075	110.5	153.3	61
A22	0.195	110.2	160.7	72	1.075	110.2	153.3	61
A26	0.195	111.8	160.7	70	1.075	111.8	153.3	59
A84	0.195	111.8	160.7	70	1.075	111.8	153.3	59
A85	0.195	110.2	160.7	72	1.075	110.2	153.3	61
A86	0.195	111.0	160.7	71	1.075	111.0	153.3	60
A36*	0.195	110.0	160.7	72	1.075	110.0	153.3	62
A12	0.195	111.7	160.7	70	1.075	111.7	153.3	59
A1	0.195	121.0	160.7	56	1.075	121.0	153.3	46
A2	0.195	119.0	160.7	59	1.075	119.0	153.3	49
A95**	0.195	125.0	160.7	51	1.075	125.0	153.3	40
A5	0.055	123.2	160.7	53	0.056	123.2	153.3	43
A9	0.055	119.1	160.7	59	0.056	119.1	153.3	49

*Node A36 is a connection to Phase 2; does remain a dead-end

**Node A95 is a dead-end located southwest of the development

PHASE 1
MXDY+FF

ID	Static Demand (L/s)	Static Pressure (psi)	Static Head (m)	Fire-Flow Demand (Lpm)	Residual Pressure (psi)	Available Flow at Hydrant (Lpm)	Available Flow Pressure (psi)
A1	0.489	49	155.4	10,000	23	13,000	20
A10	0.385	54	155.4	10,000	27	13,000	20
A100	0.489	45	155.4	10,000	24	13,000	20
A11	0.385	55	155.4	10,000	35	16,000	20
A12	0.489	62	155.4	10,000	42	17,000	20
A13	0.489	60	155.4	10,000	35	15,000	20
A17	0.489	64	155.4	10,000	33	13,000	20
A19	0.489	62	155.4	10,000	37	15,000	20
A2	0.489	52	155.4	10,000	29	15,000	20
A20	0.489	61	155.4	10,000	40	16,000	20
A22	0.489	64	155.4	10,000	33	13,000	20
A26	0.489	62	155.4	10,000	40	16,000	20
A28	0.489	63	155.4	10,000	42	17,000	20
A3	0.489	53	155.4	10,000	30	15,000	20
A30	0.489	62	155.4	10,000	42	18,000	20
A32	0.489	60	155.4	10,000	43	19,000	20
A36*	0.489	65	155.4	10,000	17	12,000	20
A4	0.489	56	155.4	10,000	29	13,000	20
A5	0.056	46	155.4	10,000	26	13,000	20
A6	0.489	47	155.4	10,000	27	14,000	20
A7	0.489	52	155.4	10,000	33	16,000	20
A77	0.489	60	155.4	10,000	41	18,000	20
A79	0.489	61	155.4	10,000	39	16,000	20
A8	0.489	58	155.4	10,000	39	17,000	20
A81	0.489	61	155.4	10,000	42	18,000	20
A84	0.489	62	155.4	10,000	40	16,000	20
A85	0.489	64	155.4	10,000	34	13,000	20
A86	0.489	63	155.4	10,000	36	14,000	20
A9	0.056	52	155.4	10,000	31	15,000	20
A95**	0.489	43	155.4	10,000	-2	8,000	20

*Node A36 is a connection to Phase 2; does remain a dead-end
**Node A95 is a dead-end located southwest of the development

PHASE 2

	BSDY				PKHR			
ID	Demand (L/s)	Elevation (m)	Head (m)	Pressure (psi)	Demand (L/s)	Elevation (m)	Head (m)	Pressure (psi)
A100	0.195	124.0	160.7	52	1.075	124.0	152.9	41
A6	0.195	122.2	160.7	55	1.075	122.2	152.9	44
A3	0.195	118.3	160.7	60	1.075	118.3	152.9	49
A10	0.385	117.4	160.7	62	0.385	117.4	152.9	50
A7	0.195	119.0	160.7	59	1.075	119.0	152.9	48
A11	0.385	116.8	160.7	62	0.385	116.8	152.9	51
A4	0.195	115.9	160.7	64	1.075	115.9	152.9	53
A13	0.195	113.5	160.7	67	1.075	113.5	152.9	56
A8	0.195	114.6	160.7	66	1.075	114.6	152.9	54
A77	0.195	113.5	160.7	67	1.075	113.5	152.9	56
A20	0.195	112.5	160.7	69	1.075	112.5	152.9	57
A79	0.195	112.6	160.7	68	1.075	112.6	152.9	57
A19	0.195	111.8	160.7	69	1.075	111.8	152.9	58
A32	0.195	112.9	160.7	68	1.075	112.9	152.9	57
A81	0.195	112.7	160.7	68	1.075	112.7	152.9	57
A30	0.195	111.7	160.7	70	1.075	111.7	152.9	59
A28	0.195	110.9	160.7	71	1.075	110.9	152.9	60
A17	0.195	110.5	160.7	71	1.075	110.5	152.9	60
A22	0.195	110.2	160.7	72	1.075	110.2	152.9	61
A26	0.195	111.8	160.7	69	1.075	111.8	152.9	58
A84	0.195	111.8	160.7	69	1.075	111.8	152.9	58
A85	0.195	110.2	160.7	72	1.075	110.2	152.9	61
A86	0.195	111.0	160.7	71	1.075	111.0	152.9	59
A36	0.195	110.0	160.7	72	1.075	110.0	152.9	61
A12	0.195	111.7	160.7	70	1.075	111.7	152.9	59
A1	0.195	121.0	160.7	56	1.075	121.0	152.9	45
A2	0.195	119.0	160.7	59	1.075	119.0	152.9	48
A95**	0.195	125.0	160.7	51	1.075	125.0	152.9	40
A5	0.647	123.2	160.7	53	3.556	123.2	152.9	42
A9	0.647	119.1	160.7	59	3.556	119.1	152.9	48
A24	0.237	107.7	160.7	75	0.237	107.7	152.8	64
A73	0.264	110.6	160.7	71	1.454	110.6	152.8	60
A23	0.237	109.4	160.7	73	0.237	109.4	152.8	62
A18	0.264	107.0	160.7	76	1.454	107.0	152.8	65
A62	0.264	107.7	160.7	75	1.454	107.7	152.9	64
A14	0.264	108.9	160.7	74	1.454	108.9	152.9	62
A15	0	107.5	160.7	76	0.061	107.5	152.9	64
A21	0.264	109.6	160.7	73	1.454	109.6	152.8	61

**Node A95 is a dead-end located southwest of the development

PHASE 2
MXDY+FF

ID	Static Demand (L/s)	Static Pressure (psi)	Static Head (m)	Fire-Flow Demand (Lpm)	Residual Pressure (psi)	Available Flow at Hydrant (Lpm)	Available Flow Pressure (psi)
A1	0.489	49	155.3	10,000	30	13,000	20
A10	0.385	54	155.3	10,000	31	13,000	20
A100	0.489	44	155.3	10,000	27	12,000	20
A11	0.385	55	155.3	10,000	38	16,000	20
A12	0.489	62	155.2	10,000	45	17,000	20
A13	0.489	59	155.3	10,000	38	15,000	20
A14	0.661	66	155.2	10,000	42	15,000	20
A15	0	68	155.2	10,000	33	12,000	20
A17	0.489	64	155.2	10,000	37	13,000	20
A18	0.661	69	155.2	10,000	43	15,000	20
A19	0.489	62	155.2	10,000	40	15,000	20
A2	0.489	52	155.3	10,000	34	14,000	20
A20	0.489	61	155.3	10,000	43	16,000	20
A21	0.489	65	155.2	10,000	41	15,000	20
A22	0.237	64	155.2	10,000	37	13,000	20
A23	0.237	65	155.2	10,000	34	12,000	20
A24	0.489	68	155.2	10,000	42	15,000	20
A26	0.489	62	155.2	10,000	44	17,000	20
A28	0.489	63	155.2	10,000	45	17,000	20
A3	0.489	52	155.3	10,000	35	15,000	20
A30	0.489	62	155.2	10,000	45	18,000	20
A32	0.489	60	155.3	10,000	46	19,000	20
A36	0.489	64	155.2	10,000	42	15,000	20
A4	1.616	56	155.3	10,000	32	13,000	20
A5	0.489	46	155.3	10,000	29	13,000	20
A6	0.661	47	155.3	10,000	30	13,000	20
A62	0.489	68	155.2	10,000	44	15,000	20
A7	0.661	52	155.3	10,000	36	15,000	20
A73	0.489	63	155.2	10,000	32	12,000	20
A77	0.489	59	155.3	10,000	44	18,000	20
A79	0.489	61	155.3	10,000	42	16,000	20
A8	0.489	58	155.3	10,000	42	17,000	20
A81	0.489	61	155.3	10,000	45	18,000	20
A84	0.489	62	155.2	10,000	44	17,000	20
A85	0.489	64	155.2	10,000	37	13,000	20
A86	1.616	63	155.2	10,000	43	16,000	20
A9	0.489	51	155.3	10,000	34	14,000	20
A95**	0.489	43	155.3	10,000	5.1	8,000	20

**Node A95 is a dead-end located southwest of the development

2 WATER SUPPLY

2.1 Existing Conditions

The proposed development is located within the service area of Pressure Zone 3W of the City of Ottawa water distribution system. The zone is fed by the Glen Cairn and Campeau Drive Pump Stations, both of which are remote from the site. Balancing storage during peak and fire flow conditions is provided by the Stittsville Elevated Tank. There are several existing watermains adjacent to the site including 200 mm diameter watermains on both Fernbank Road and Friendly Crescent and a 200 mm diameter watermain in Fernbank Road, west of the site. As part of the development of the adjacent Stittsville South lands a 250 mm watermain will be extended along Hickstead Drive which extends to Street No. 3 in Phase 1. **Figure 2.1** shows the location of the existing Water Plan adjacent to the site.

2.2 Serviceability Study

A conceptual water plan for the Stittsville South Area 6 area was included in the 2013 MSR study. A copy of the recommended plan, Watermain Concept Plan – Figure 6.1 from that report is included in **Appendix A**. The main elements of the recommended plan for the subject site include an extension of the proposed 250 mm diameter main spine through the subject site from the west (Regional Lands) and connecting to the existing watermain on Fernbank Road to the north.

2.3 Design Criteria

2.3.1 Water Demands

Water demands have been calculated for the full development including Phase 1. Per unit population density and consumption rates are taken from Tables 4.1 and 4.2 at the Ottawa Design Guidelines – Water Distribution and are summarized as follows:

- Single Family 3.4 person per unit
- Townhouse and Semi-Detached 2.7 person per unit
- Average Apartment 1.8 person per unit
- Residential Average Day Demand 350 l/cap/day
- Residential Peak Daily Demand 875 l/cap/day
- Residential Peak Hour Demand 1,925 l/cap/day
- ICI Average Day Demand 50,000 l/gross ha/day
- ICI Peak Daily Demand 75,000 l/gross ha/day
- ICI Peak Hour Demand 135,000 l/gross ha/day

Residential units in Phase 1 consist of single family, semi-detached and street townhouses. A future commercial site which is not part of this development is located at the north corner of the site adjacent to Fernbank and Shea Roads, the water demands for this site is included in the design. A watermain demand calculation sheet is included in **Appendix A** and the total water demands are summarized as follows:

	Full Development	Phase 1
• Average Day	10.85 l/s	6.39 l/s
• Maximum Day	25.53 l/s	14.39 l/s
• Peak Hour	55.25 l/s	30.76 l/s

2.3.2 System Pressure

The Ottawa Design Guidelines – Water Distribution (WDG001), July 2010, City of Ottawa, Clause 4.2.2 states that the preferred practice for design of a new distribution system is to have normal operating pressures range between 345 kPa (50 psi) and 552 kPa (80 psi) under maximum daily flow conditions. Other pressure criteria identified in Clause 4.2.2 of the guidelines are as follows:

Minimum Pressure	Minimum system pressure under peak hour demand conditions shall not be less than 276 kPa (40 psi)
Fire Flow	During the period of maximum day demand, the system pressure shall not be less than 140 kPa (20 psi) during a fire flow event.
Maximum Pressure	Maximum pressure at any point in the distribution system shall not exceed 689 kPa (100 psi). In accordance with the Ontario Building/Plumbing Code, the maximum pressure should not exceed 552 kPa (80 psi). Pressure reduction controls will be required for buildings where it is not possible/feasible to maintain the system pressure below 552 kPa.

2.3.3 Fire Flow Rates

The Fire Underwriters Survey (FUS) method of calculating fire flow requirements is to be used in accordance with the Ottawa Design Guidelines – Water Distribution. In the FUS method, wood frame buildings with separations less than three meters are considered one fire area. Buildings in the Davidson Lands Development are wood frame buildings, with separation less than three meters. An example is on Street No. 11 between lots 73 and 81 in which the 9 single family lots all have separations less than three meters thus making one fire area. A FUS calculation for this area is included in **Appendix A.** The calculations predict that the fire flow requirement needs to be 22,000 l/min which is impractical to supply with local watermains.

In the recent Technical Bulletin 'ISDTB-2014-02, Revisions to Ottawa Design Guidelines – Water', the fire flow requirements for single detached dwellings and traditional town and row houses can be capped at 10,000 l/min provided that there is a minimum separation of 10 meters between the backs of adjacent units and that the town and row house blocks are limited to 600 square meters of building areas and seven dwelling units. Since the residential units in the Davidson Lands meet the requirements of ISDTB-2014-02, the fire flow rate of 10,000 l/min (166.7 l/s) is used in the fire flow analysis.

There are no details for the future commercial site at the north of the development. Since the site is bisected by the Hydro One corridor there is a limit on the size of the building that can be placed on the site therefore a fire flow rate of 12,000 l/min (200 l/s) for the external commercial development is used in our fire flow analysis.

2.3.4 Boundary Conditions

The City of Ottawa has provided hydraulic boundary conditions at two locations; one at the existing main on Fernbank Road at Hartsmere Drive and the other at the southwest intersection of Friendly Crescent and Hartsmere Drive. Two separate conditions were given for the max day plus fire

scenario, one for the 167 l/s residential fire flow and a separate one for the 200 l/s commercial fire flow. A copy of the boundary conditions is included in **Appendix A** and summarized as follows:

	CONNECTION 1 FERNBANK ROAD	CONNECTION 2 FRIENDLY CRESCENT
Max HGL (Basic Day)	160.4 m	160.4 m
Peak Hour	151.1 m	150.8 m
Max Day + Fire (167 l/s Fire Flow)	142.3 m	135.2 m
Max Day + Fire (200 l/s Fire Flow)	137.5m	127.8 m

2.3.5 Hydraulic Model

A computer model for the overall Davidson Lands along with a separate model 1 containing only Phase 1 has been developed using the H20 MAP Version 6.0 program produced by MWH Soft Inc. The model includes the existing watermains and boundary conditions at Fernbank Road and Friendly Crescent.

2.4 Proposed Water Plan

2.4.1 Modeling Results

The hydraulic model was run under basic day, maximum day with fire flows and under peak hour conditions for the overall development and Phase 1 only. Water pipes are sized to provide sufficient pressure and to deliver the required fire flows. During the design stage all mains are tested at the minimum 150 mm diameter size, while the pressure criteria is met with the minimum sized mains the fire flow requirement is not achieved at all locations. The main sizes are increased in an iterative process until the fire flow results are sufficient for both the overall sub-division and Phase 1.

Results of the hydraulic model are include in **Appendix A** and summarized as follows:

Scenario	**Overall**	**Phase 1 Only**
Basic Day (Max HGL) Pressure Range	454.5 to 534.8 kPa	459.5 to 535.9 kPa
Peak Hour Pressure Range	359.6 to 438.4 kPa	367.1 to 440.9 kPa
Max Day + 167 l/s Fire Flow Minimum Flow	163.9 l/s	150.5 l/s
Max Day + 200 l/s Fire Flow Minimum Flow	247.3 l/s	208.8 l/s

A comparison of the results and design criteria is summarized as follows:

Maximum Pressure	All notes in both analysis have basic day pressures under 552 kPa, therefore pressure reducing control is not required for this development.
Minimum Pressure	All nodes in the model exceed the minimum value of 276 kPa (40 psi).

Fire Flow

All residential nodes exceed the fire flow requirement of 166.7 l/s in the overall development. The fire flow for the commercial site exceeds the 200 l/s requirement using the boundary condition for the 200 l/s flow.

Under the Phase 1 analysis, there is one location at Node J24 at the south intersection of Maygrass Way and Kayenta Street where the fire flow is less than the requirement. The Phase 1 fire flow at Node 24 is 150.5 l/s which is within 90% of the 166.7 l/s requirement, the fire flow at this node increases to 204.0 l/s when the adjacent Phase 2 is constructed.

2.4.2 Watermain Layout

Figure 2.2 shows the proposed Water Plan for both Phase 1 and the balance of the sub-division.

In the 2013 MSR, a 400 mm watermain is proposed on Fernbank Road along the frontage of the Davidson Lands connecting to an existing 200 mm watermain that is shown on Figure 2.1. With the boundary conditions provided at Fernbank and Hartsmere Drive as shown in Section 2.3.4., the fire flows in the site range from 99.4 l/s to 146.4 l/s, in order to achieve the required fire flows the existing 200 mm watermain is required to be replaced and the 400 mm watermain will be extended to Hartsmere Drive.

A 250 mm watermain will be extended from the adjacent Stittsville South development along Hickstead Way and Edenwylde Drive to connect to the 400 mm main on Fernbank Road. For Phase 1 a second connection is required to the 400 mm main on Fernbank Road that will extend through Kayenta Street which is part of Phase 2. In order to service future Phases 2 and 3, a 250 mm watermain is required to connect to the 400 mm watermain on Fernbank Road at Jardiniere Street, this 250 mm main will, in a future phase cross the hydro corridor and a 250 mm main will be extended along Cosanti Drive connecting to the 250 mm main on Edenwylde Drive.

J:\37533-DavidsonLands\5.9 Drawings\59civil\current\Report Figures\Design Brief\Figure 2.2 Water.dwg Layout Name: Figure 2.2 Water Plot Style: AIA STANDARD COLOR-HALF.CTB Plot Scale: 1:25.4 Plotted At: 10/25/2017 12:40 PM Last Saved By: Chris.Cormier Last Saved At: Oct. 25, 17

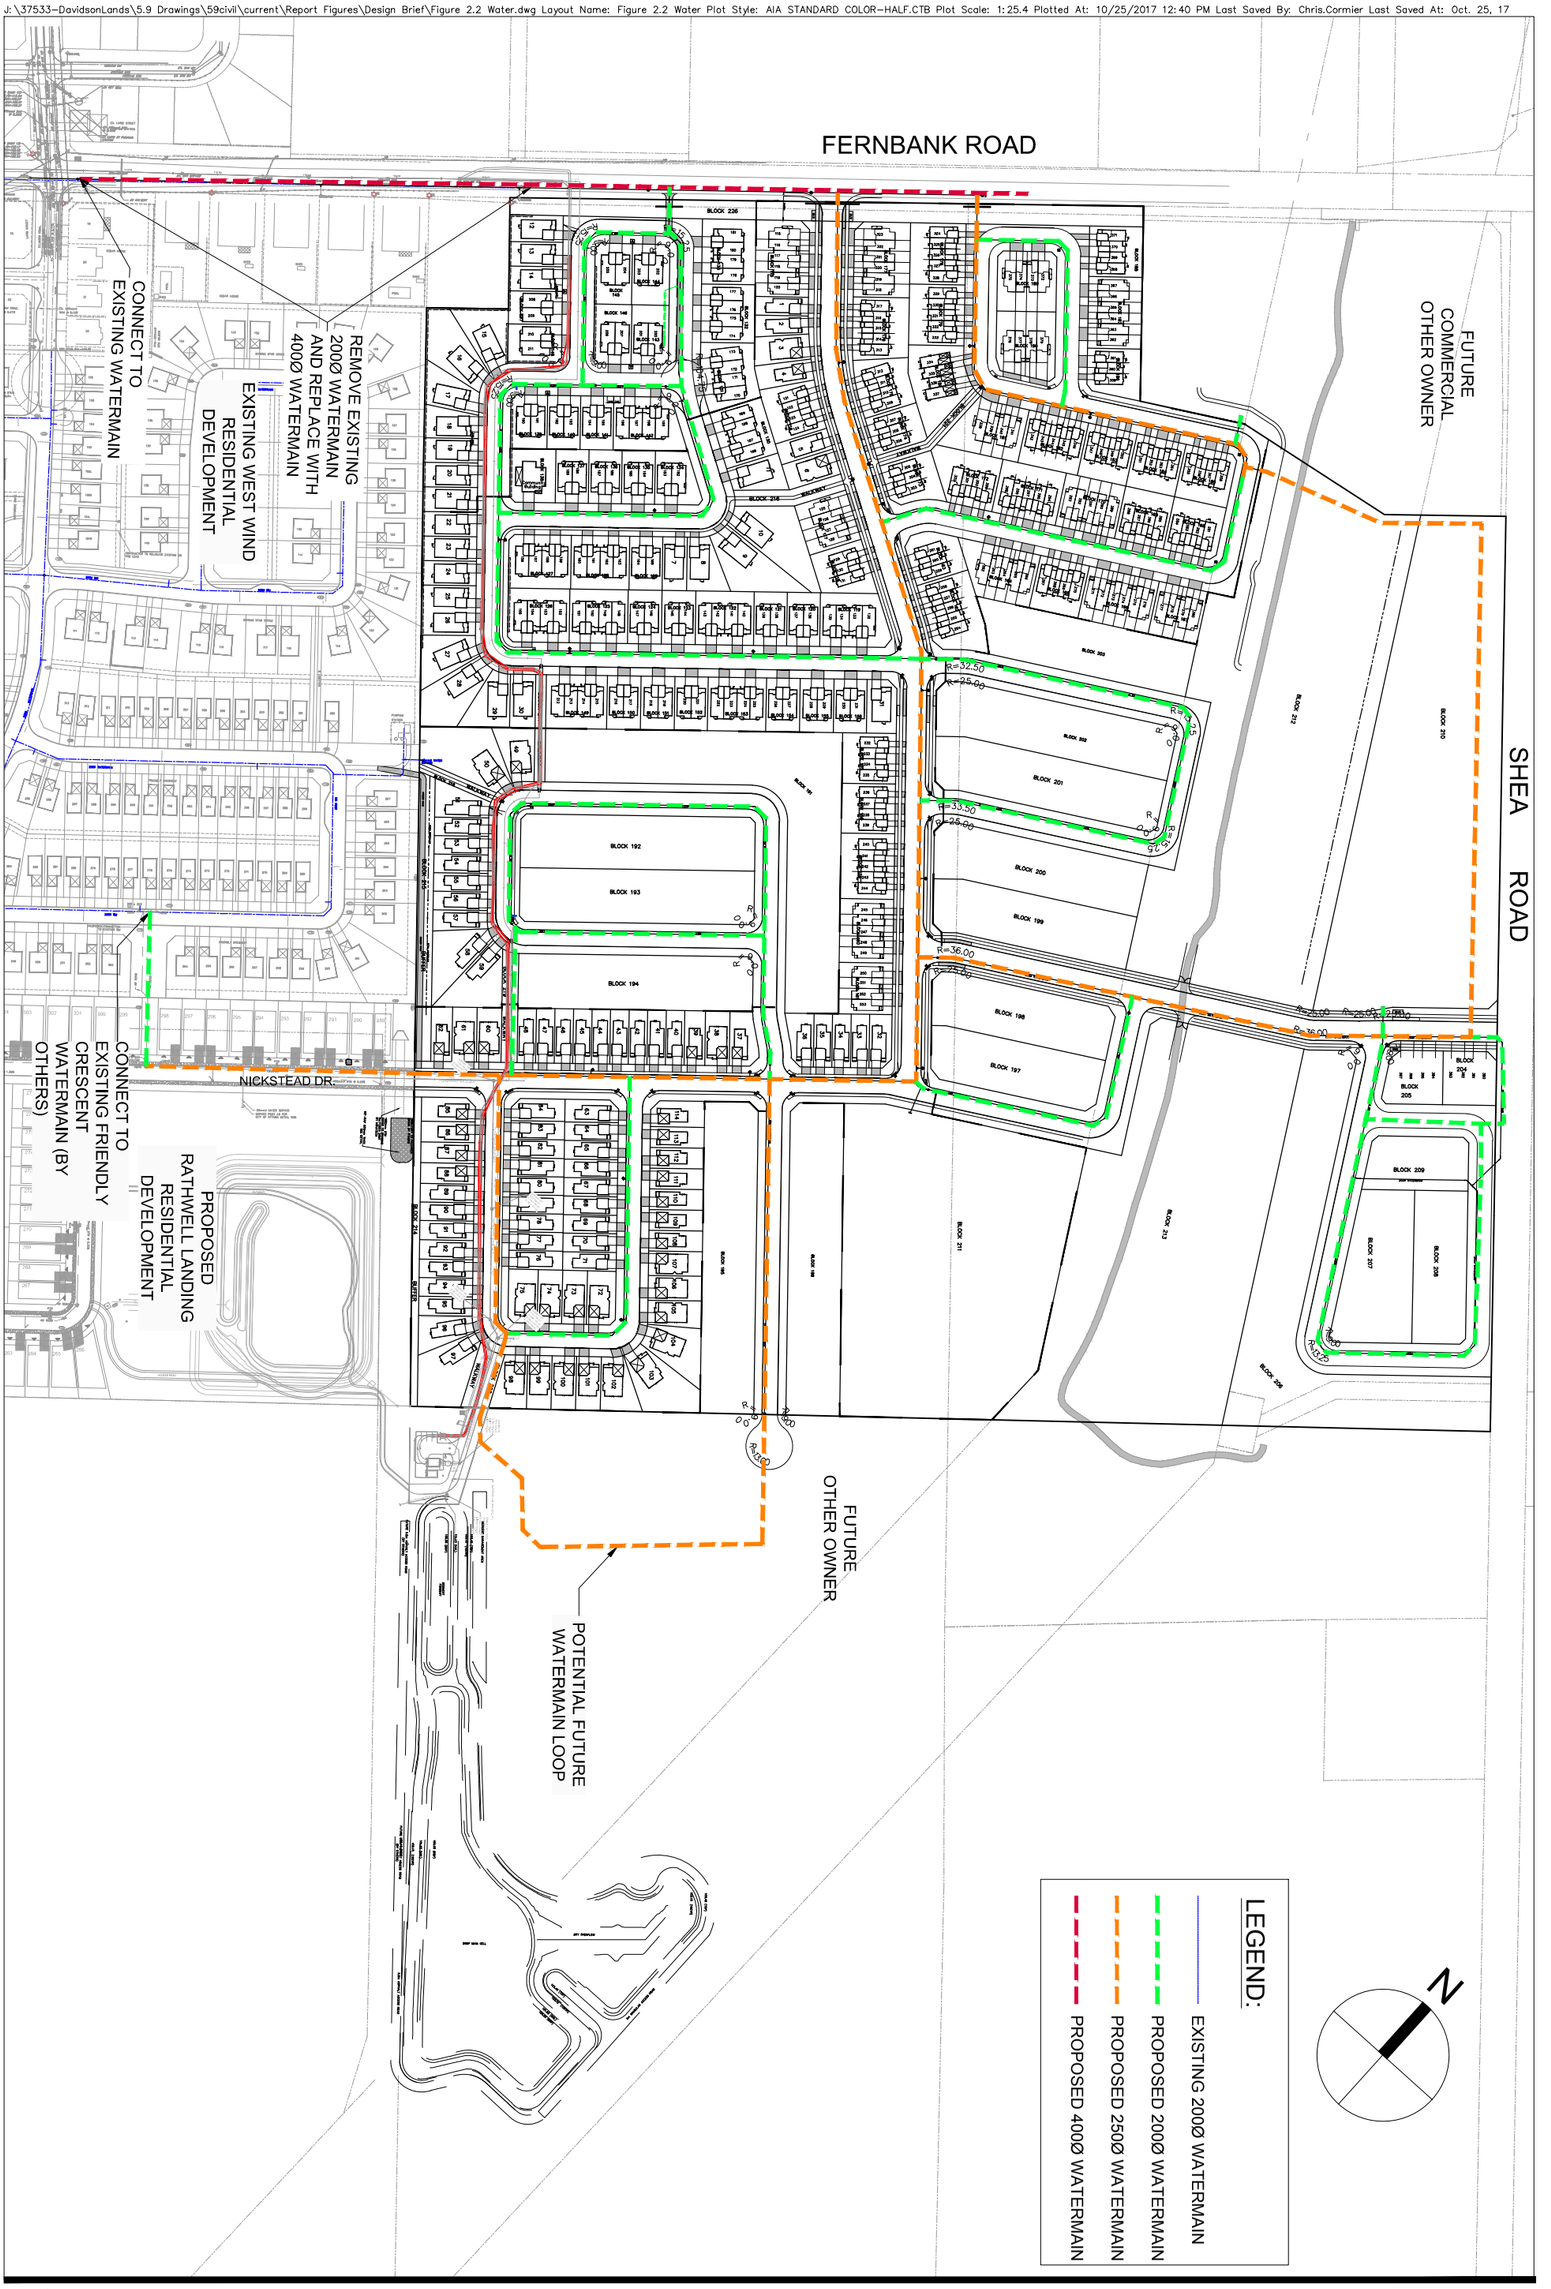

Sheet No.	Drawing Title	Project Title	Scale
FIGURE 2.2	PROPOSED WATER PLAN	DESIGN BRIEF DAVIDSON LANDS-OPA 76 AREA 6a PHASE 1 STITTSVILLE SOUTH	N.T.S.

IBI

APPENDIX D

STORMWATER

J.F. Sabourin and Associates Inc.
52 Springbrook Drive,
Ottawa, ON K2S 1B9
T 613-836-3884 F 613-836-0332

jfsa.com

Ottawa. ON
Paris. ON
Gatineau. QC
Montréal. QC
Québec. QC

January 30, 2023 Project Number: P2267

David Schaeffer Engineering Limited
120 Iber Road, Unit 103
Stittsville, ON
K2S 1E9

Attention: **Kevin Murphy, P.Eng.**

Subject: **Caivan – Stittsville Lands (5993, 6070 & 6115 Flewellyn Road): Pre-Development Hydraulic and Hydrologic Study**

Introduction

As set out in the Terms of References for the Caivan Stittsville Lands (5993, 6070 & 6115 Flewellyn Road), drafted by David Schaeffer Engineering Ltd (DSEL) on June 9, 2022, the pre-development hydraulic and hydrologic conditions of the proposed development site are required to be assessed. The following memo will assess the existing major flow patterns within and around the site, and outline the findings of a detailed pre-development water budget analysis based on hydrologic modelling using site-based soil data and historical rainfall data.

Site Overview

The subject lands are bound by Flewellyn Road to the south, Shea Road to the east, an existing urban subdivision development to the north (Stittsville South – Area 6) and an estate lot subdivision to the west. The area is also bisected by the Faulkner Municipal Drain and a Hydro One power transmission corridor. For this study, the overall development area has been broken into two sections (referred to as east and west) bisected by the municipal drain and hydro corridor. The property parcel of 5993 Flewellyn Road (east) is cleared of trees and vegetation, while the west parcels (comprising 6070 & 6115 Flewellyn Road) are treed with patches of grassed areas. **Figure 1** provides an overview of the development site relative to the Faulkner drain and major roads.

Pre-Development Drainage

1m LiDAR flown in 2020 by the City of Ottawa has been obtained to determine the existing primary flow patterns within the site. This topographic data was imported into GIS software with watershed delineation tools applied to determine the drainage areas and primary flow paths within the site. **Figure 2** provides an overview of the primary existing subwatersheds and flow paths within the site.

From this analysis, it is seen that for the eastern lands, the site primarily consists of 2 major drainage areas both of which discharge to the Faulkner Drain on Flewellyn Road. For the west property, the drainage patterns are slightly more complex but approximately half of the lands discharge to the Faulkner Drain on Flewellyn road, while the remaining half discharges to the Faulkner drain which divides the east and west properties. Note that there is no external drainage area that flows across either site.

N

Legend

Development Area

Municipal Drain

SCALE: 1:6000

0 100 200 300 m

J.F. Sabourin and Associates Inc.
WATER RESOURCES AND ENVIRONMENTAL CONSULTANTS
52 Springbrook Drive
Ottawa, ON, K2S 1B9
(613) 836-3884
www.jfsa.com

DSEL

Caivan - Stittsville Lands

Figure 1: Site Overview

PROJECT	P2267
DRAWN	TE
DATE	JAN 2023

C:\OneDrive\J.F. Sabourin and Associates Inc\JFSA-OTTAWA-SERVER - Documents\PROJ\2267-21\Design\GIS\20230125-Report Figures

Shea Rd

Shea Rd

Faulkner Municipal Drain

Flewellyn Rd

N

Legend

- Drainage Areas
- Development Area
- Municipal Drain
- Primary Flow Paths
- Drainage Pattern

SCALE: 1:6000

0 100 200 300 m

J.F. Sabourin and Associates Inc.
WATER RESOURCES AND ENVIRONMENTAL CONSULTANTS
52 Springbrook Drive
Ottawa, ON, K2S 1B9
(613) 836-3884
www.jfsa.com

DSEL

Caivan - Stittsville Lands

Figure 2: Existing Drainage Patterns

PROJECT	P2267
DRAWN	TE
DATE	JAN 2023

Pre-Development Water Budget Analysis

A continuous SWMHYMO model has been developed to assess the site's pre-development water budget. This model makes use of site-based infiltration testing results as well as local climatic conditions, the following sections outline each of these items in detail.

Soil Infiltration / CN

Paterson Group completed Guelph Permeameter testing throughout the site, to determine the site's soil infiltration rates. From this analysis, soils were tested at both shallow depths (approximately 0.3 m - 0.5 m below ground) and deeper depths (0.5 m >). Based on Paterson's site testing the majority of the site consist of Brown Silty Sand to Sandy Silt with some localized pockets of silty clay with sand. Overall the site was found to have soil infiltration rates in the range of **26 mm/hr** to **76 mm/hr.** The localized infiltration results of this testing have been mapped in GIS and an inverse distance weighting algorithm was applied to provide a complete infiltration map of the site, **Figure 3** provides an overview of this mapping. A full summary of Paterson's site infiltration testing can be found in **Attachment A**. Based on Paterson's Site investigation the soils present are considered a "Type C" hydrologic soil group.

The latest available (2021) aerial mapping for the City of Ottawa was used to discretize the various land use conditions throughout the development site. **Figure B1** in **Attachment B** provides a visual overview of the study area. This land use data was merged with the underlying soil types to derive a Curve Number (CN), based on applicable values outlined in Tables A2 and A3 in the SWMHYMO Manual. Each Curve Number was then weighted based on the total area within a given subcatchment to determine the weighted CN for that subcatchment, see **Table B1** in **Attachment B**. Based on this analysis the site has a CN* of **65** and **61** for the lands East and West of the Faulkner Drain respectively.

Time to Peak

The time-to-peak values have been calculated based on existing topography using the City of Ottawa LiDAR. Flow paths have been discretized based on the topographic data using GIS tools and the longest major flow path was identified; **Figure B2** in **Attachment B** outlines the flow path discretization. The upstream and downstream topographic elevations and flow lengths were identified and used in the calculations. For this natural subcatchment, the Federal Aviation Administration (FFA) method was determined to be the most appropriate method to calculate the Time to Peak. **Table B2 in Attachment B** provides full details of these calculations, along with other time-to-peak values using alternative t_p calculation methods.

Continuous Simulations

A continuous SWMHYMO model was developed to assess the site's water budget under pre-development conditions. This model was run using 36 years of hourly rainfall data from the Ottawa International Airport from 1967 to 2003 (excluding missing 2001 rainfall data), the average annual evaporation, infiltration and runoff volumes from the subject site were computed and compared. Note that this rain gauge is generally only operational for the months of April-November. Outside of this window precipitation is more likely to be in the form of snowfall and the soils are also more likely to be frozen, making it difficult to simulate such conditions with a hydrologic model using conventional City parameters, as such, this period has not been considered in the analysis.

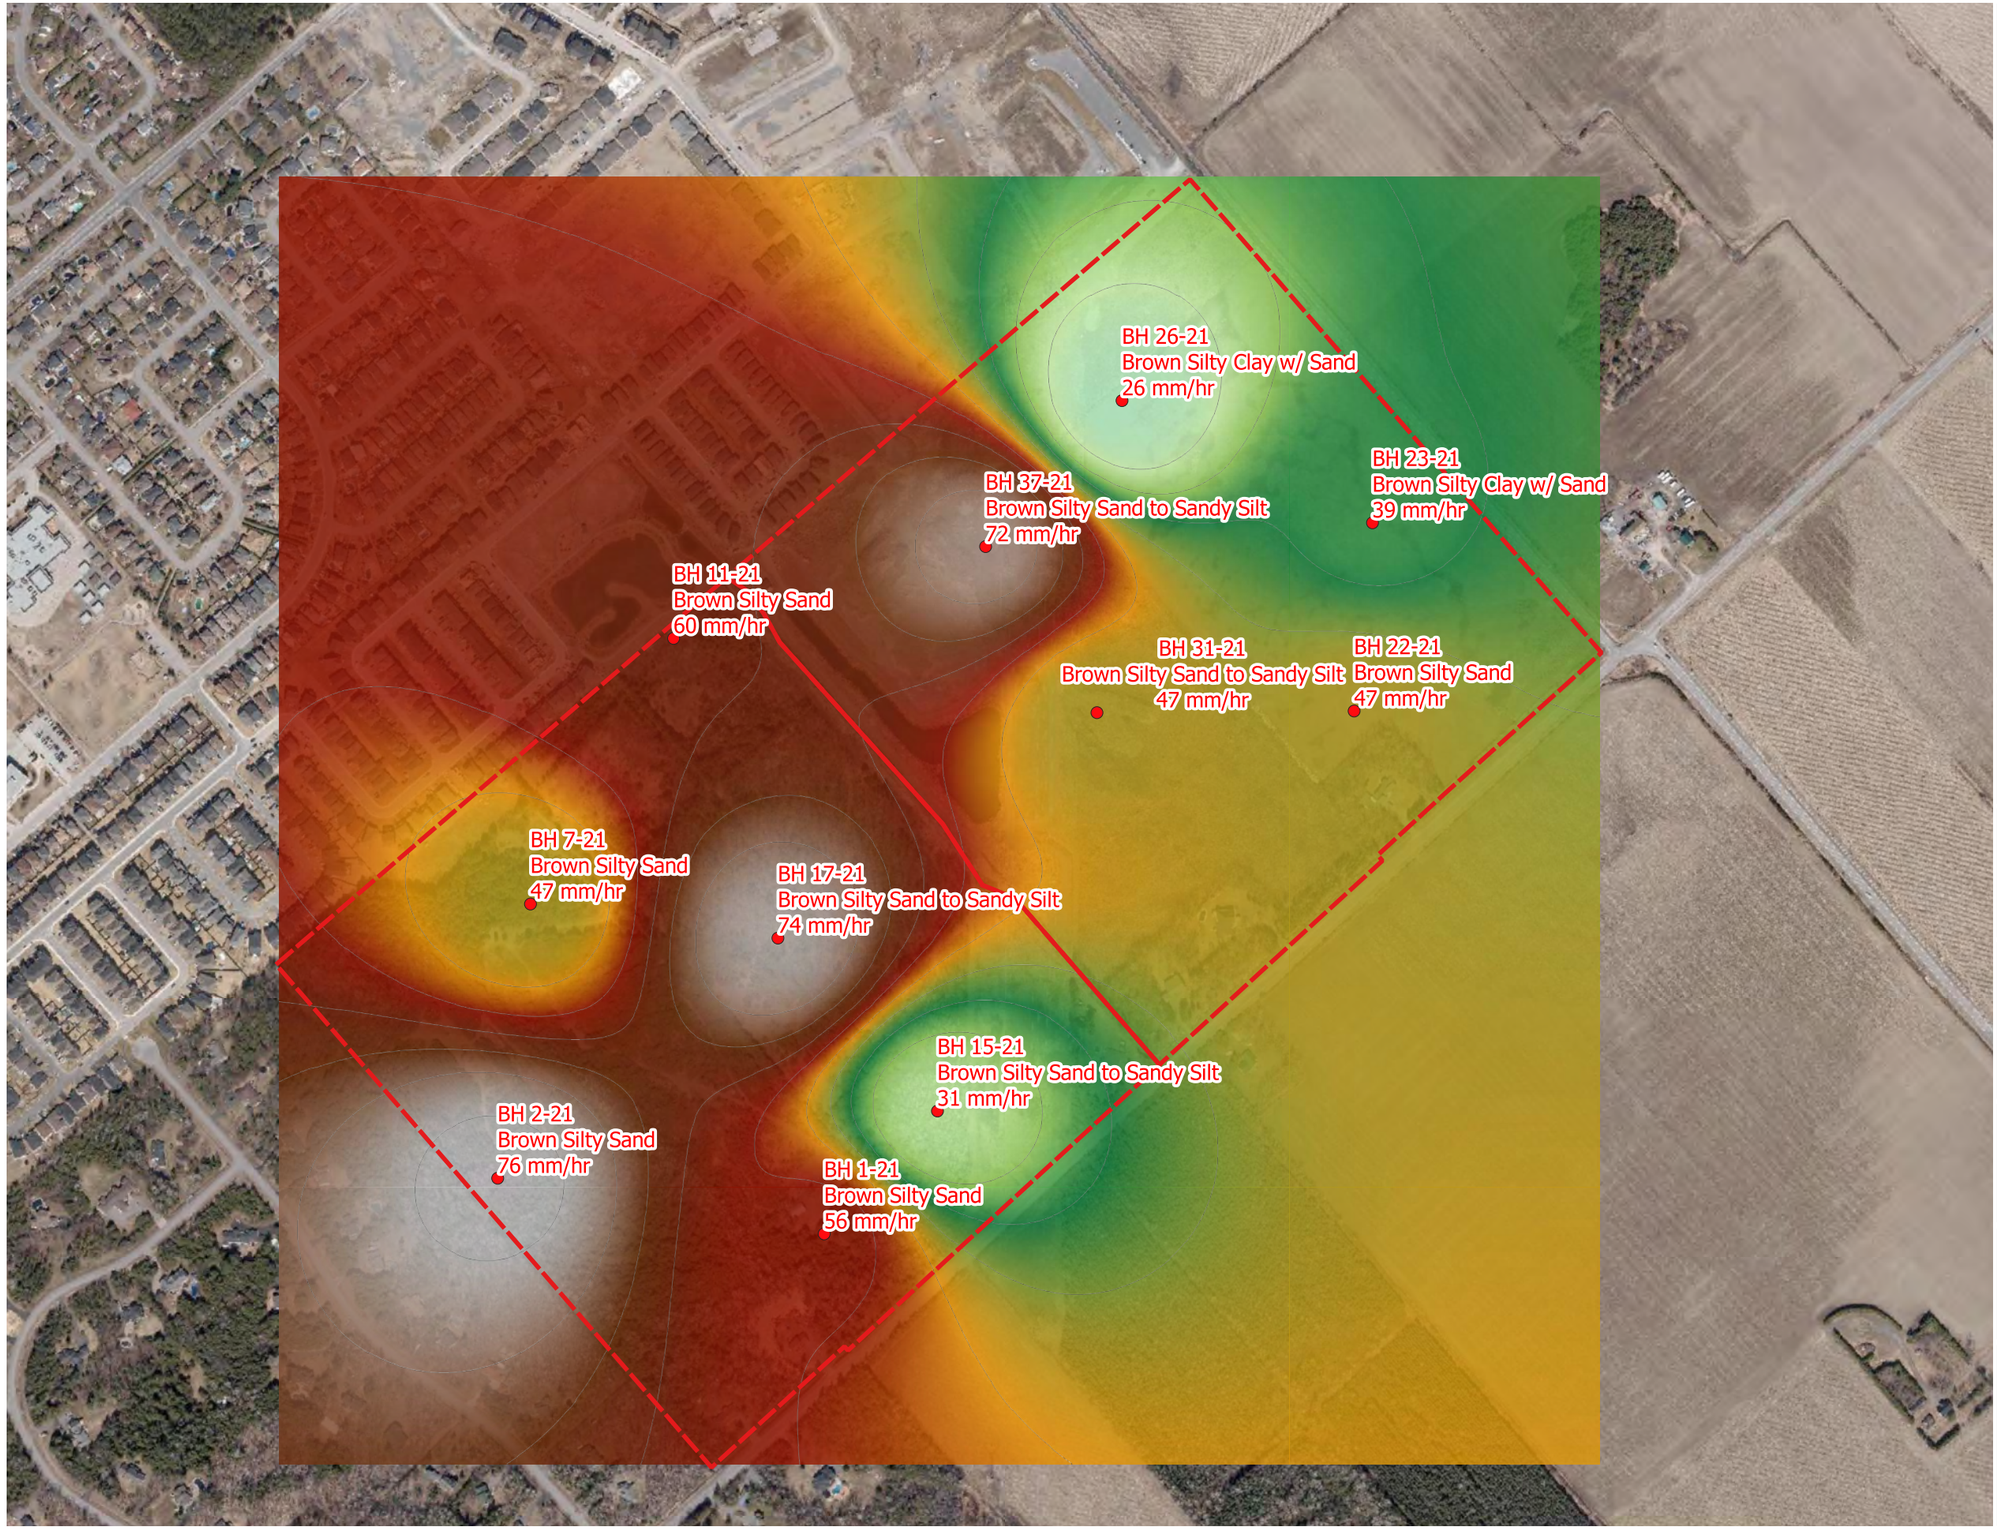

N

Legend

- Development Area
- Infiltration Locations

Infiltration (mm/hr)

- 25.00
- 30.00
- 35.00
- 40.00
- 45.00
- 50.00
- 55.00
- 60.00
- 65.00
- 70.00
- 75.00
- 80.00

SCALE: 1:6000

0 100 200 300 m

J.F. Sabourin and Associates Inc.
WATER RESOURCES AND ENVIRONMENTAL CONSULTANTS
52 Springbrook Drive
Ottawa, ON, K2S 1B9
(613) 836-3884
www.jfsa.com

DSEL

Caivan - Stittsville Lands

Figure 3: Infiltration

PROJECT	P2267
DRAWN	TE
DATE	JAN 2023

C:\OneDrive\J.F. Sabourin and Associates Inc\JFSA-OTTAWA-SERVER - Documents\PROJ\2267-21\Design\GIS\20230125-Report Figures

Simulation Results

The complete SWMHYMO modelling input and output files have been provided in **Attachment B**. **Table B3** provides the full summary of the SWMHYMO modelling, based on the 39 years of data, and outlines the maximum, minimum and average volumes and percentages of precipitation that evaporate infiltrate and runs off the site, **Table 1** below is an excerpt this summary.

Table 1: Pre-Development Water Budget based on Continuous Simulations

Precipitation	Evaporation		Infiltration		Runoff	
(mm)	(mm)	(%)	(mm)	(%)	(mm)	(%)
589.1	370.7	63%	116.9	20%	101.6	17%

Based on the continuous simulations using 39 years of historical rainfall data it was determined that for the total development site, approximately **17%** of the annual rainfall will result in runoff, **63%** will evaporate and **20%** will infiltrate.

Existing Hydraulic Conditions

Robinson Consulting Inc completed an updated hydraulic model of the Faulkner Drain as a part of their December 2020 *"Amendment to the Engineer's Report for the Faulkner Municipal Drain"*. As a part of this study, modifications were proposed to the existing Faulkner Municipal Drain which included relocating a portion of the drain, lowering the drain profile, and modifying the cross-section of the drain to increase the capacity and reduce the potential for erosion of the steep banks. This study also considered the upgrading/replacement of 3 culverts within the drain. At the time of drafting this memo, these updates are either completed or currently under construction, as such can be reflective of current conditions.

Based on Table 4.2 of the Robinsons report there are three existing culverts that act as residential entrances on Flewellyn Road (Culverts 4+882.90, 5+055.00 & 5+185.40) that are either close to or have slightly less than the required capacity to safely convey the full 100-year flow. The culverts are likely controlling water levels along this portion of Flewellyn Road, as such these culverts should be revisited in the future to ensure that peak water levels are contained within the Faulkner Municipal drain.

Conclusion

In summary, a detailed topographic study has been undertaken on the site to identify all major flow paths within the development under existing conditions. From this analysis, it was found that for the eastern lands, the site primarily consists of 2 major drainage areas both of which discharge to the Faulkner Drain on Flewellyn Road. For the western lands, the drainage patterns are slightly more complex but approximately half of the lands discharge to the Faulkner Drain on Flewellyn Road, while the remaining half discharges to the Faulkner Drain where it divides the east and west properties.

Continuous hydrologic modelling has been completed which has made use of soil infiltration testing completed by Paterson Group to determine the site's predevelopment water budget. Based on this analysis it was determined that for the total development site, approximately **17%** of the annual rainfall will result in runoff, **63%** will evaporate and **20%** will infiltrate.

Based on Table 4.2 of the Robinsons report there are three existing culverts that act as residential entrances on Flewellyn Road (Culverts 4+882.90, 5+055.00 & 5+185.40) that are either close to or have slightly less than the required capacity to safely convey the full 100-year flow. The culverts are likely controlling water levels along this portion of Flewellyn Road, as such these culverts should be revisited in the future to ensure that peak water levels are contained within the Faulkner Municipal drain.

Yours truly,
J.F Sabourin and Associates Inc.

Jonathon Burnett, B.Eng, P.Eng
Water Resources Engineer

cc: J.F Sabourin, M.Eng, P.Eng
Director of Water Resources Projects

Figures

Figure 1: Site Overview
Figure 2: Existing Drainage Patterns
Figure 3: Soil Infiltration Map

Tables

Table 1A: Existing Water Budget Summary

Attachments

Attachment A: Paterson Group Soil Infiltration Testing
Attachment B: Water Budget Analysis

J.F. Sabourin and Associates Inc.
52 Springbrook Drive,
Ottawa, ON K2S 1B9
T 613-836-3884 F 613-836-0332

jfsa.com

Ottawa. ON
Paris. ON
Gatineau. QC
Montréal. QC
Québec. QC

Attachment A

Paterson Group Soil infiltration Testing

Table 1 - Overburden Field Saturated Hydraulic Conductivity Results and Estimated Infiltration Rates				
Test Completed Adjacent to Borehole ID	**Infiltration Testing Elevation (m asl)**	**Material**	**K_{fs} (m/s)**	**Unfactored Infiltration Rate (mm/hr)***
BH1-21	103.90	Brown Silty Sand	2.10E-06	56
	103.63	Brown Silty Sand	1.90E-06	56
BH2-21	106.95	Brown Silty Sand	6.40E-06	76
	106.65	Brown Silty Sand	5.30E-07	39
BH7-21	106.74	Brown Silty Sand	1.10E-06	47
	106.44	Brown Silty Sand	1.60E-06	52
BH11-21	104.68	Brown Silty Sand	2.70E-06	60
	104.38	Brown Silty Sand	1.60E-06	52
BH15-21	102.70	Brown Silty Sand to Sandy Silt	2.10E-07	31
	102.48	Brown Silty Sand to Sandy Silt	≤ 8.1E-09	≤ 13
BH17-21	106.74	Brown Silty Sand to Sandy Silt	5.90E-06	74
	106.44	Brown Silty Sand to Sandy Silt	4.10E-06	67
BH22-21	102.58	Brown Silty Sand	1.10E-06	47
	102.28	Brown Silty Sand	1.60E-06	52
BH23-21	102.33	Brown Silty Clay w/ Sand	5.30E-07	39
	101.70	Brown Silty Clay	≤ 8.1E-09	≤ 13
BH26-21	102.74	Brown Silty Clay w/ Sand	1.10E-07	26
	102.44	Brown Silty Clay w/ Sand	1.10E-07	26
BH29-21	101.87	Brown Silty Sand to Sandy Silt	5.30E-07	39
	101.57	Brown Silty Sand to Sandy Silt	2.70E-07	33
BH31-21	103.19	Brown Silty Sand to Sandy Silt	1.10E-06	47
	102.89	Brown Silty Sand to Sandy Silt	1.35E-07	27
BH37-21	103.21	Brown Silty Sand to Sandy Silt	5.30E-06	72
	102.91	Brown Silty Sand to Sandy Silt	5.90E-06	74

***The infiltration rates do not include a safety correction factor. Based on our testing results, a safety correction factor can range between 2.5 to ≥ 3.5.**

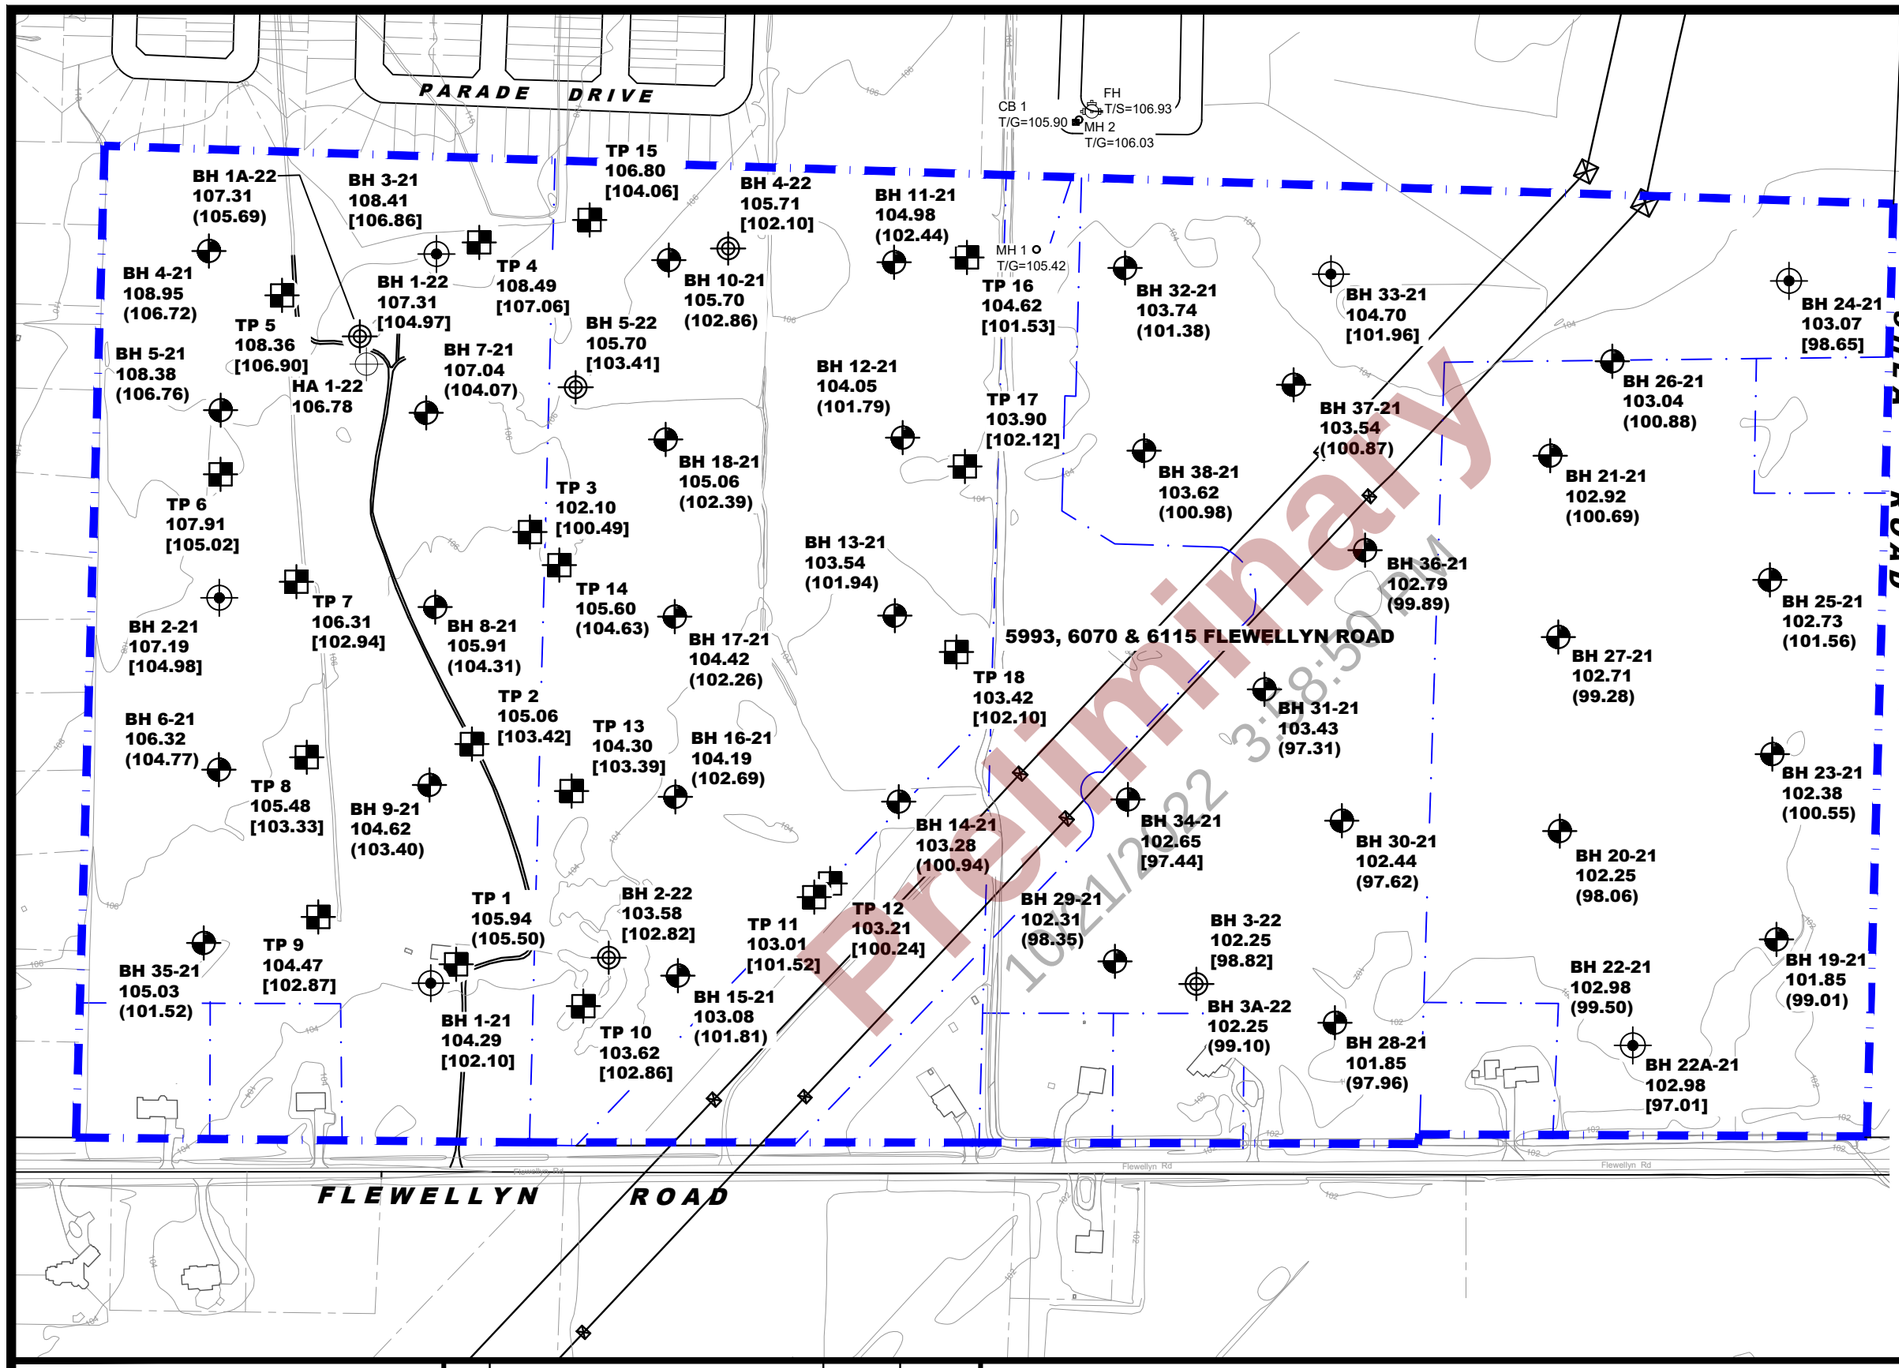

LEGEND:

- HAND AUGER LOCATION (CURRENT INVESTIGATION)
- BOREHOLE WITH MONITORING WELL LOCATION (CURRENT INVESTIGATION)
- BOREHOLE WITH PIEZOMETER LOCATION (PATERSON GROUP REPORT; PG5570-2, JAN 20, 2022)
- BOREHOLE WITH MONITORING WELL LOCATION (PATERSON GROUP REPORT; PG5570-2, JAN 20, 2022)
- TEST PIT LOCATION\ (PATERSON GROUP REPORT; PG5570-1, JAN 3, 2021)

104.29 GROUND SURFACE ELEVATION (m)

[102.10] BEDROCK SURFACE ELEVATION (m)

(102.39) PRACTICAL REFUSAL TO AUGERING / EXCAVATION ELEVATION (m)

BASE PLAN PROVIDED BY KILGOUR & ASSOCIATES.

GROUND SURFACE ELEVATIONS AT BOREHOLE LOCATIONS ARE REFERENCED TO A GEODETIC DATUM.

SCALE: 1:4000

0 50 100 150 200 250m

PATERSON GROUP
9 AURIGA DRIVE
OTTAWA, ON
K2E 7S9
TEL: (613) 226-7381

NO.	REVISIONS	DATE	INITIAL
2	BH 1-22 - BH 5-22 & HA1-22 ADDED TO PLAN	10/03/2022	KP
1	BH 1-21 - BH 38-21 ADDED TO PLAN	01/20/2022	OC

CAIVAN COMMUNITIES

GEOTECHNICAL INVESTIGATION
PROPOSED RESIDENTIAL DEVELOPMENT
5993, 6070 & 6115 FLEWELLYN ROAD

OTTAWA, ONTARIO

Title:

TEST HOLE LOCATION PLAN

Scale: 1:4000	Date: 01/2022
Drawn by: JM	Report No.: PG5570-2, REVISION 1
Checked by: KP	Dwg. No.: PG5570-1
Approved by: DJG	Revision No.: 2

p:\autocad drawings\geotechnical\pg55xx\pg5570\pg5570-1.tftp (rev.02) report rev.1.dwg

11x17

JFSA
WATER RESOURCES AND ENVIRONMENTAL CONSULTANTS

Ottawa. ON
Paris. ON
Gatineau. QC
Montréal. QC
Québec. QC

Attachment B

Water Budget Analysis

N

Legend

- Development Area
- Impervious (SWM)
- Mature Forest
- Pasture and Shrubs
- Urban Lawn/ Shallow Rooted Crops

SCALE: 1:6000

0 100 200 300 m

J.F. Sabourin and Associates Inc.
WATER RESOURCES AND ENVIRONMENTAL CONSULTANTS
52 Springbrook Drive
Ottawa, ON, K2S 1B9
(613) 836-3884
www.jfsa.com

DSEL

Caivan - Stittsville Lands

Figure B1: Land Use

PROJECT	P2267
DRAWN	TE
DATE	JAN 2023

C:\OneDrive\J.F. Sabourin and Associates Inc\JFSA-OTTAWA-SERVER - Documents\PROJ\2267-21\Design\GIS\20230125-Report Figures

N

Legend

- Development Area
- Flow Lengths

Terrain (m)

- 98
- 100
- 103
- 106
- 109
- 112
- 115
- 118
- 121
- 124

SCALE: 1:6000

0 100 200 300 m

J.F. Sabourin and Associates Inc.
WATER RESOURCES AND ENVIRONMENTAL CONSULTANTS
52 Springbrook Drive
Ottawa, ON, K2S 1B9
(613) 836-3884
www.jfsa.com

DSEL

Caivan - Stittsville Lands

Figure B2: Flow Lengths

PROJECT	P2267
DRAWN	TE
DATE	JAN 2023

C:\OneDrive\J.F. Sabourin and Associates Inc\JFSA-OTTAWA-SERVER - Documents\PROJ\2267-21\Design\GIS\20230125-Report Figures

Table B1: Calculation of SCS Curve Number (CN) and Modified Curve Number (CN*)

EAST (39.345 ha)							
Area (ha)	Land Type	Soil Name	Soil Condition	Soil Group	CN	% of Catchment	Weighted CN
15.625	Urban Lawn/Shallow Rooted Crops	Fine Sandy Loam	C	Fair	79	39.7%	31.4
22.565	Pasture and Shrubs	Fine Sandy Loam	C	Fair	70	57.4%	40.1
1.155	Impervious (SWM)	Fine Sandy Loam	C	Fair	99	2.9%	2.9
						CN	**74.4**
						CN*	**65**

WEST (39.847 ha)							
Area (ha)	Land Type	Soil Name	Soil Condition	Soil Group	CN	% of Catchment	Weighted CN
24.901	Mature Forest	Fine Sandy Loam	C	Fair	73	62.5%	45.6
14.946	Pasture and Shrubs	Fine Sandy Loam	C	Fair	70	37.5%	26.3
						CN	**71.9**
						CN*	**61**

Table B2: Time to Peak Calculations

Parameter	Units	East	West
Area	ha	39.35	39.85
CN*	-	65	61
Ptotal to calc C from CN, use 2 yr 3 hr Chicago stom	P(mm)	33.2	33.2
	Ia(mm)	4.67	4.67
	RV(mm)	4.8	4.3
Ptotal to calc C from CN, use 2 yr 24 hr SCS stom	P(mm)	52.77	52.77
	RV(mm)	12.3	11.0
C (From Chicago storm)	-	0.15	0.13
C (From SCS storm)	-	0.23	0.21
Length of Channel	m	1012	976
	ft	3320	3201
Elevation of Head Water	m	104.35	109.56
	ft	342	359
Elevation of Outlet	m	100.16	102.45
	ft	329	336
Average Slope	m/m	0.41%	0.73%
	ft/ft	0.41%	0.73%
Kirpich			
Time of Concentration	mins	33	26
Time to Peak	min	22	17
Time to Peak	Hours	0.37	0.29
FAA (From Chicago storm)			
Time of Concentration	mins	133	110
Time to Peak	mins	88	73
Time to Peak	Hours	1.47	1.22
FAA (From SCS storm)			
Time of Concentration	mins	121	101
Time to Peak	mins	80	67
Time to Peak	Hours	1.34	1.12
Barnsby Williams			
Time of Concentration	mins	48	41
Time to Peak	mins	32	28
Time to Peak	Hours	0.53	0.46
SCS			
Time of Concentration	mins	199	159
Time to Peak	mins	133	106
Time to Peak	Hours	2.21	1.77
Selected Method			
FAA (From Chicago storm)			
Time to Peak	min	88	73
Time to Peak	Hours	1.47	1.22

Note:

All methods calculated as per Appendix A of the SWMHYMO manual

Time to Peak calculated as 2/3 Time of concentration

```
20     Metric units / ID Numbers OFF
*#*************************************************************************
*#  SWMHYMO Ver:5.02/Jan 2001 <BETA> / INPUT DATA FILE
*#*************************************************************************
*#  Project Name  : [Caivan Stittsville West properties]
*#  Project Number: [2267]
*#  Date          : [2021/12/14]
*#  Modeller      : [JB]
*#  Company       : J.F. Sabourin and Associates
*#  License #     : 2549237
*#*************************************************************************
*#*************************************************************************
START               TZERO=[1967.0101],  METOUT=[2],  NSTORM=[0],  NRUN=[67]
*%                   [""] <--storm filename, one per line for NSTORM time
*%-----------------|-------------------------------------------------------|
*# Ottawa International Airport (1967 - 2003)
READ AES DATA       AES_FILENAME=["6106000.123"],
                    IELEM=[123], START_DATE=[0], END_DATE=[-364]
*%-----------------|-------------------------------------------------------|
COMPUTE API         APII=[50], APIK=[0.90]/day
*#########################################################################
*# Pre Development Condition - Using NASHHYD and CN
*#########################################################################
CONTINUOUS NASHYD   NHYD=["EastPre"], DT=[15]min, AREA=[39.35](ha),
                    DWF=[0](cms), CN/C=[65],IA=[5.5](mm),
                    N=[3], TP=[1.47]hrs,
                    Continuous simulation parameters:
                      IaRECper=[6](hrs),SMIN=[ -1 ](mm),  SMAX=[ -1 ](mm),
                      SK=[0.025]/(mm), InterEventTime=[ 12 ](hrs)
                    Baseflow simulation parameters:
                      BaseFlowOption=[1] , InitGWResVol=[ 0.0 ](mm), GWResK=[ 0.935
                      ](mm/day/mm)
                      VHydCond=[ 0.07  ](mm/hr), END=-1
*%-----------------|-------------------------------------------------------|
CONTINUOUS NASHYD   NHYD=["WestPre"], DT=[15]min, AREA=[39.85](ha),
                    DWF=[0](cms), CN/C=[61], IA=[5.5](mm),
                    N=[3], TP=[1.22]hrs,
                    Continuous simulation parameters:
                      IaRECper=[6](hrs),SMIN=[ -1 ](mm),  SMAX=[ -1 ](mm),
                      SK=[0.025]/(mm), InterEventTime=[ 12 ](hrs)
                    Baseflow simulation parameters:
                      BaseFlowOption=[1] , InitGWResVol=[ 0.0 ](mm), GWResK=[ 0.935
                      ](mm/day/mm)
                      VHydCond=[ 0.07  ](mm/hr), END=-1
*%-----------------|-------------------------------------------------------|
ADD HYD             NHYDsum=["Pre"], NHYDs to add=["WestPre"+"EastPre"]
*#########################################################################
*# Pre Development Condition - Using NASHHYD and CN - No INFILTRATION
*#########################################################################
CONTINUOUS NASHYD   NHYD=["InfEastPre"], DT=[15]min, AREA=[39.35](ha),
                    DWF=[0](cms), CN/C=[99.99],IA=[5.5](mm),
                    N=[3], TP=[1.47]hrs,
                    Continuous simulation parameters:
                      IaRECper=[6](hrs),SMIN=[ -1 ](mm),  SMAX=[ -1 ](mm),
                      SK=[0.025]/(mm), InterEventTime=[ 12 ](hrs)
                    Baseflow simulation parameters:
                      BaseFlowOption=[1] , InitGWResVol=[ 0.0 ](mm), GWResK=[ 0.935
                      ](mm/day/mm)
                      VHydCond=[ 0.07  ](mm/hr), END=-1
*%-----------------|-------------------------------------------------------|
CONTINUOUS NASHYD   NHYD=["InfWestPre"], DT=[15]min, AREA=[39.85](ha),
                    DWF=[0](cms), CN/C=[99.99], IA=[5.5](mm),
                    N=[3], TP=[1.22]hrs,
                    Continuous simulation parameters:
                      IaRECper=[6](hrs),SMIN=[ -1 ](mm),  SMAX=[ -1 ](mm),
                      SK=[0.025]/(mm), InterEventTime=[ 12 ](hrs)
                    Baseflow simulation parameters:
                      BaseFlowOption=[1] , InitGWResVol=[ 0.0 ](mm), GWResK=[ 0.935
                      ](mm/day/mm)
```

```
                      VHydCond=[ 0.07  ](mm/hr), END=-1
*%-----------------|---------------------------------------------------------|
ADD HYD             NHYDsum=["InfPre"], NHYDs to add=["InfWestPre"+"InfEastPre"]
*%-----------------|---------------------------------------------------------|
*#########################################################################
*# STORMS
*#########################################################################
START               TZERO=[1968.0101],  METOUT=[2],  NSTORM=[0],  NRUN=[68]
*%-----------------|---------------------------------------------------------|
START               TZERO=[1969.0101],  METOUT=[2],  NSTORM=[0],  NRUN=[69]
*%-----------------|---------------------------------------------------------|
START               TZERO=[1970.0101],  METOUT=[2],  NSTORM=[0],  NRUN=[70]
*%-----------------|---------------------------------------------------------|
START               TZERO=[1971.0101],  METOUT=[2],  NSTORM=[0],  NRUN=[71]
*%-----------------|---------------------------------------------------------|
START               TZERO=[1972.0101],  METOUT=[2],  NSTORM=[0],  NRUN=[72]
*%-----------------|---------------------------------------------------------|
START               TZERO=[1973.0101],  METOUT=[2],  NSTORM=[0],  NRUN=[73]
*%-----------------|---------------------------------------------------------|
START               TZERO=[1974.0101],  METOUT=[2],  NSTORM=[0],  NRUN=[74]
*%-----------------|---------------------------------------------------------|
START               TZERO=[1975.0101],  METOUT=[2],  NSTORM=[0],  NRUN=[75]
*%-----------------|---------------------------------------------------------|
START               TZERO=[1976.0101],  METOUT=[2],  NSTORM=[0],  NRUN=[76]
*%-----------------|---------------------------------------------------------|
START               TZERO=[1977.0101],  METOUT=[2],  NSTORM=[0],  NRUN=[77]
*%-----------------|---------------------------------------------------------|
START               TZERO=[1978.0101],  METOUT=[2],  NSTORM=[0],  NRUN=[78]
*%-----------------|---------------------------------------------------------|
START               TZERO=[1979.0101],  METOUT=[2],  NSTORM=[0],  NRUN=[79]
*%-----------------|---------------------------------------------------------|
START               TZERO=[1980.0101],  METOUT=[2],  NSTORM=[0],  NRUN=[80]
*%-----------------|---------------------------------------------------------|
START               TZERO=[1981.0101],  METOUT=[2],  NSTORM=[0],  NRUN=[81]
*%-----------------|---------------------------------------------------------|
START               TZERO=[1982.0101],  METOUT=[2],  NSTORM=[0],  NRUN=[82]
*%-----------------|---------------------------------------------------------|
START               TZERO=[1983.0101],  METOUT=[2],  NSTORM=[0],  NRUN=[83]
*%-----------------|---------------------------------------------------------|
START               TZERO=[1984.0101],  METOUT=[2],  NSTORM=[0],  NRUN=[84]
*%-----------------|---------------------------------------------------------|
START               TZERO=[1985.0101],  METOUT=[2],  NSTORM=[0],  NRUN=[85]
*%-----------------|---------------------------------------------------------|
START               TZERO=[1986.0101],  METOUT=[2],  NSTORM=[0],  NRUN=[86]
*%-----------------|---------------------------------------------------------|
START               TZERO=[1987.0101],  METOUT=[2],  NSTORM=[0],  NRUN=[87]
*%-----------------|---------------------------------------------------------|
START               TZERO=[1988.0101],  METOUT=[2],  NSTORM=[0],  NRUN=[88]
*%-----------------|---------------------------------------------------------|
START               TZERO=[1989.0101],  METOUT=[2],  NSTORM=[0],  NRUN=[89]
*%-----------------|---------------------------------------------------------|
START               TZERO=[1990.0101],  METOUT=[2],  NSTORM=[0],  NRUN=[90]
*%-----------------|---------------------------------------------------------|
START               TZERO=[1991.0101],  METOUT=[2],  NSTORM=[0],  NRUN=[91]
*%-----------------|---------------------------------------------------------|
START               TZERO=[1992.0101],  METOUT=[2],  NSTORM=[0],  NRUN=[92]
*%-----------------|---------------------------------------------------------|
START               TZERO=[1993.0101],  METOUT=[2],  NSTORM=[0],  NRUN=[93]
*%-----------------|---------------------------------------------------------|
START               TZERO=[1994.0101],  METOUT=[2],  NSTORM=[0],  NRUN=[94]
*%-----------------|---------------------------------------------------------|
START               TZERO=[1995.0101],  METOUT=[2],  NSTORM=[0],  NRUN=[95]
*%-----------------|---------------------------------------------------------|
START               TZERO=[1996.0101],  METOUT=[2],  NSTORM=[0],  NRUN=[96]
*%-----------------|---------------------------------------------------------|
START               TZERO=[1997.0101],  METOUT=[2],  NSTORM=[0],  NRUN=[97]
*%-----------------|---------------------------------------------------------|
START               TZERO=[1998.0101],  METOUT=[2],  NSTORM=[0],  NRUN=[98]
*%-----------------|---------------------------------------------------------|
```

```
START                TZERO=[1999.0101],  METOUT=[2],  NSTORM=[0],  NRUN=[99]
*%-----------------|-------------------------------------------------------|
START                TZERO=[2000.0101],  METOUT=[2],  NSTORM=[0],  NRUN=[100]
*%-----------------|-------------------------------------------------------|
*% MISSING FROM AES RAINFALL DATA
*%START                TZERO=[2001.0101],  METOUT=[2],  NSTORM=[0],  NRUN=[101]
*%-----------------|-------------------------------------------------------|
START                TZERO=[2002.0101],  METOUT=[2],  NSTORM=[0],  NRUN=[102]
*%-----------------|-------------------------------------------------------|
START                TZERO=[2003.0101],  METOUT=[2],  NSTORM=[0],  NRUN=[103]
*%-----------------|-------------------------------------------------------|
FINISH
```

```
00001>  ================================================================================
00002>
00003>  SSSSS   W   W   M   M   H   H   Y   Y   M   M    OOO          222     000    11   5555   =========
00004>  S       W   W   MM MM   H   H    Y Y    MM MM   O   O          2   2   0   0  11   5
00005>  SSSSS   W W W   M M M   HHHHH     Y     M M M   O   O          2   0   0  11   5       Ver 5.500
00006>      S   W W W   M   M   H   H     Y     M   M   O   O        222   0   0  11   555     FEB  2015
00007>  SSSSS    W W    M   M   H   H     Y     M   M    OOO        2     0   0  11     5     =========
00008>                                                              2     0   0  11     5     # 2549237
00009>          StormWater Management HYdrologic Model              222     000    11   555     =========
00010>
00011>  ********************************************************************************
00012>  ********************  SWMHYMO Ver 5.500  ***************************************
00013>  ********************  A single event and continuous hydrologic simulation model  ***
00014>  ********************     based on the principles of HYMO and its successors      ***
00015>  ********************          OTTHYMO-83 and OTTHYMO-89.                         ***
00016>  ********************************************************************************
00017>  ********************* Distributed by:  J.F. Sabourin and Associates Inc.          ***
00018>  ********************                  Ottawa,  Ontario: (613) 836-3884           ***
00019>  ********************                  Gatineau, Quebec: (819) 243-6858           ***
00020>  ********************                  E-Mail: swmhymo@jfsa.com                   ***
00021>  ********************************************************************************
00022>
00023>  ++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++
00024>  ++++++++++++++++++ Licensed user: JFSAinc.                    ++++++++++++++++++
00025>  ++++++++++++++++++          Ottawa                 SERIAL#:2549237            ++++++++++++++++++
00026>  ++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++
00027>
00028>  ********************************************************************************
00029>  ********************  ++++++ PROGRAM ARRAY DIMENSIONS ++++++  ********************
00030>  ********************  Maximum value for ID numbers  :    11  ********************
00031>  ********************  Max. number of rainfall points: 105408 ********************
00032>  ********************  Max. number of flow points   : 105408 ********************
00033>  ********************************************************************************
00034>
00035>
00036>  ******************************  S U M M A R Y   O U T P U T  ************************
00037>  ********************************************************************************
00038>  *                    RUN DATE: 2023-01-25     TIME: 12:51:43     RUN COUNTER: 000842  *
00039>  ********************************************************************************
00040>  * Input   file: C:\Temp\202301-Pre_Dev-WB\STIT-Pre_v01.1-WB.dat                  *
00041>  * Output  file: C:\Temp\202301-Pre_Dev-WB\STIT-Pre_v01.1-WB.out                  *
00042>  * Summary file: C:\Temp\202301-Pre_Dev-WB\STIT-Pre_v01.1-WB.sum                  *
00043>  * User comments:                                                                *
00044>  * 1:_____________________________________________________________________________*
00045>  * 2:_____________________________________________________________________________*
00046>  * 3:_____________________________________________________________________________*
00047>  ********************************************************************************
00048>
00049>
00050> #*******************************************************************************
00051> #  SWMHYMO Ver:5.02/Jan 2001 <BETA> / INPUT DATA FILE
00052> #*******************************************************************************
00053> #  Project Name  : [Caivan Stittsville West properties]
00054> #  Project Number: [2267]
00055> #  Date          : [2021/12/14]
00056> #  Modeller      : [JB]
00057> #  Company       : J.F. Sabourin and Associates
00058> #  License #     : 2549237
00059> #*******************************************************************************
00060> #*******************************************************************************
00061>   ** END OF RUN :   66
00062>
00063>  ********************************************************************************
00064>
00065>
00066>
00067>
00068>
00069>  RUN#:COMMAND#
00070> R0067:C00001-------------------------------------------------------------------
00071>      START
00072>       [TZERO =    .00 hrs on 19670101]
00073>       [METOUT=   2    (1=imperial, 2=metric output)]
00074>       [NSTORM=   0 ]
00075>       [NRUN  = 0067 ]
00076> #*******************************************************************************
00077> #  SWMHYMO Ver:5.02/Jan 2001 <BETA> / INPUT DATA FILE
00078> #*******************************************************************************
00079> #  Project Name  : [Caivan Stittsville West properties]
00080> #  Project Number: [2267]
00081> #  Date          : [2021/12/14]
00082> #  Modeller      : [JB]
00083> #  Company       : J.F. Sabourin and Associates
00084> #  License #     : 2549237
00085> #*******************************************************************************
00086> #*******************************************************************************
00087> # Ottawa International Airport (1967 - 2003)
00088> R0067:C00002-------------------------------------------------------------------
00089>  *  READ AES DATA
00090>       [Filename  = 6106000.123                                          ]
00091>       [Start_date= 1967.0101: End_date= 1967.1231]
00092>       [DT= 60.min: Length= 3984.hrs: WetHrs=  257: DryHrs= 3727: PTOT= 386.90)
00093>       Maximum average rainfall intensities over
00094>         1 hr    2 hrs    3 hrs    6 hrs   12 hrs   24 hrs   36 hrs   48 hrs   72 hrs
00095>        24.60    17.65    13.20     7.25     3.83     2.36     1.73     1.32      .90    mm/hr
00096>        24.60    35.20    39.60    43.50    46.00    56.60    62.30    63.20    64.90    mm
00097>      19670921 19670921 19670921 19670921 19670921 19670921 19670922 19670922 19670923 19670924  date
00098>      Number of rainfall events per following interevent time
00099>         1 hr    2 hrs    3 hrs    6 hrs   12 hrs   24 hrs   36 hrs   48 hrs   72 hrs
00100>          80       65       56       40       32       29       24       20       18
00101>      Number of events with at least the following durations
00102>         1 hr    2 hrs    3 hrs    6 hrs   12 hrs   24 hrs   36 hrs   48 hrs   72 hrs
00103>           79       42       29       14        3        0        0        0        0
00104> R0067:C00003-------------------------------------------------------------------
00105>      COMPUTE API
00106>       [APIini= 50.00: APIkdy= .9000: APIkdt= .9956]
00107>       [APImax= 76.77: APIavg= 24.81: APImin=  3.06)
00108> ###############################################################################
00109> # Pre Development Condition - Using NASHHYD and CN
00110> ###############################################################################
00111> R0067:C00004------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm-----RVmm-R.C.---DWFcms
00112>      CONTINUOUS NASHYD     15.0 01:EastPre      39.35     .238 1967.0921_19:30   86.42 .223     .000
00113>       [CN= 65.0: N= 3.00: Tp= 1.47]
00114>       [IaREC= 6.00: SMIN= 54.78: SMAX=365.23: SK= .025]
00115>       [InterEventTime=  12.00]
00116> R0067:C00005------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm-----RVmm-R.C.---DWFcms
00117>      CONTINUOUS NASHYD     15.0 01:WestPre      39.85     .231 1967.0921_19:00   84.65 .219     .000
00118>       [CN= 61.0: N= 3.00: Tp= 1.22]
00119>       [IaREC= 6.00: SMIN= 64.50: SMAX=430.01: SK= .025]
00120>       [InterEventTime=  12.00]
00121> R0067:C00006------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm-----RVmm-R.C.---DWFcms
00122>      ADD HYD               15.0 02:WestPre      39.85     .231 1967.0921_19:00   84.65  n/a     .000
00123>                        +    15.0 02:EastPre      39.35     .238 1967.0921_19:30   86.42  n/a     .000
00124>                    SUM=     15.0 01:Pre          79.20     .468 1967.0921_19:15   85.53  n/a     .000
00125> ###############################################################################
00126> # Pre Development Condition - Using NASHHYD and CN - No INFILTRATION
00127> ###############################################################################
00128> R0067:C00007------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm-----RVmm-R.C.---DWFcms
00129>      CONTINUOUS NASHYD     15.0 01:InfEastPre    39.35    1.023 1967.0921_18:45  173.24 .448     .000
00130>       [CN=100.0: N= 3.00: Tp= 1.47]
00131>       [IaREC= 6.00: SMIN=  1.39: SMAX=  9.24: SK= .025]
00132>       [InterEventTime=  12.00]
00133> R0067:C00008------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm-----RVmm-R.C.---DWFcms
00134>      CONTINUOUS NASHYD     15.0 01:InfWestPre    39.85    1.162 1967.0921_18:30  173.24 .448     .000
00135>       [CN=100.0: N= 3.00: Tp= 1.22]
00136>       [IaREC= 6.00: SMIN=  1.39: SMAX=  9.24: SK= .025]
00137>       [InterEventTime=  12.00]
00138> R0067:C00009------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm-----RVmm-R.C.---DWFcms
00139>      ADD HYD               15.0 02:InfWestPre    39.85    1.162 1967.0921_18:30  173.24  n/a     .000
00140>                        +    15.0 02:InfEastPre    39.35    1.023 1967.0921_18:45  173.24  n/a     .000
00141>                    SUM=     15.0 01:InfPre        79.20    2.176 1967.0921_18:30  173.24  n/a     .000
00142> ###############################################################################
00143> # STORMS
00144> ###############################################################################
00145>   ** END OF RUN :   67
00146>
00147>  ********************************************************************************
00148>
00149>
00150>
00151>
00152>
00153>  RUN#:COMMAND#
00154> R0068:C00001-------------------------------------------------------------------
00155>      START
00156>       [TZERO =    .00 hrs on 19680101]
00157>       [METOUT=   2    (1=imperial, 2=metric output)]
00158>       [NSTORM=   0 ]
00159>       [NRUN  = 0068 ]
00160> #*******************************************************************************
00161> #  SWMHYMO Ver:5.02/Jan 2001 <BETA> / INPUT DATA FILE
00162> #*******************************************************************************
00163> #  Project Name  : [Caivan Stittsville West properties]
00164> #  Project Number: [2267]
00165> #  Date          : [2021/12/14]
00166> #  Modeller      : [JB]
00167> #  Company       : J.F. Sabourin and Associates
00168> #  License #     : 2549237
00169> #*******************************************************************************
00170> #*******************************************************************************
00171> # Ottawa International Airport (1967 - 2003)
00172> R0068:C00002-------------------------------------------------------------------
00173>  *  READ AES DATA
00174>       [Filename  = 6106000.123                                          ]
00175>       [Start_date= 1968.0101: End_date= 1968.1230]
00176>       [DT= 60.min: Length= 8784.hrs: WetHrs=  413: DryHrs= 8371: PTOT= 592.80)
00177>       Maximum average rainfall intensities over
00178>         1 hr    2 hrs    3 hrs    6 hrs   12 hrs   24 hrs   36 hrs   48 hrs   72 hrs
00179>        33.30    17.05    11.37     6.23     3.74     1.87     1.26      .95      .70    mm/hr
00180>        33.30    34.10    34.10    37.40    44.90    44.90    45.40    45.40    50.20    mm
00181>      19680817 19680817 19680817 19680808 19680817 19680818 19680817 19680808 19680820  date
00182>      Number of rainfall events per following interevent time
00183>         1 hr    2 hrs    3 hrs    6 hrs   12 hrs   24 hrs   36 hrs   48 hrs   72 hrs
00184>          137      105       93       84       72       63       48       43       36
00185>      Number of events with at least the following durations
00186>         1 hr    2 hrs    3 hrs    6 hrs   12 hrs   24 hrs   36 hrs   48 hrs   72 hrs
00187>          136       76       49       18        5        0        0        0        0
00188> R0068:C00003-------------------------------------------------------------------
00189>      COMPUTE API
00190>       [APIini= 50.00: APIkdy= .9000: APIkdt= .9956]
00191>       [APImax= 67.52: APIavg= 16.69: APImin=  .27)
00192> ###############################################################################
00193> # Pre Development Condition - Using NASHHYD and CN
00194> ###############################################################################
00195> R0068:C00004------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm-----RVmm-R.C.---DWFcms
00196>      CONTINUOUS NASHYD     15.0 01:EastPre      39.35     .219 1968.0818_ 6:15  109.87 .185     .000
00197>       [CN= 65.0: N= 3.00: Tp= 1.47]
00198>       [IaREC= 6.00: SMIN= 54.78: SMAX=365.23: SK= .025]
00199>       [InterEventTime=  12.00]
00200> R0068:C00005------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm-----RVmm-R.C.---DWFcms
00201>      CONTINUOUS NASHYD     15.0 01:WestPre      39.85     .231 1968.0818_ 6:00  107.93 .182     .000
00202>       [CN= 61.0: N= 3.00: Tp= 1.22]
00203>       [IaREC= 6.00: SMIN= 64.50: SMAX=430.01: SK= .025]
00204>       [InterEventTime=  12.00]
00205> R0068:C00006------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm-----RVmm-R.C.---DWFcms
00206>      ADD HYD               15.0 02:WestPre      39.85     .231 1968.0818_ 6:00  107.93  n/a     .000
00207>                        +    15.0 02:EastPre      39.35     .219 1968.0818_ 6:15  109.87  n/a     .000
00208>                    SUM=     15.0 01:Pre          79.20     .450 1968.0818_ 6:00  108.89  n/a     .000
00209> ###############################################################################
00210> # Pre Development Condition - Using NASHHYD and CN - No INFILTRATION
00211> ###############################################################################
00212> R0068:C00007------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm-----RVmm-R.C.---DWFcms
00213>      CONTINUOUS NASHYD     15.0 01:InfEastPre    39.35    1.014 1968.0818_ 6:00  236.12 .398     .000
00214>       [CN=100.0: N= 3.00: Tp= 1.47]
00215>       [IaREC= 6.00: SMIN=  1.39: SMAX=  9.24: SK= .025]
00216>       [InterEventTime=  12.00]
00217> R0068:C00008------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm-----RVmm-R.C.---DWFcms
00218>      CONTINUOUS NASHYD     15.0 01:InfWestPre    39.85    1.224 1968.0818_ 5:45  236.12 .398     .000
00219>       [CN=100.0: N= 3.00: Tp= 1.22]
00220>       [IaREC= 6.00: SMIN=  1.39: SMAX=  9.24: SK= .025]
00221>       [InterEventTime=  12.00]
00222> R0068:C00009------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm-----RVmm-R.C.---DWFcms
00223>      ADD HYD               15.0 02:InfWestPre    39.85    1.224 1968.0818_ 5:45  236.12  n/a     .000
00224>                        +    15.0 02:InfEastPre    39.35    1.014 1968.0818_ 6:00  236.12  n/a     .000
00225>                    SUM=     15.0 01:InfPre        79.20    2.205 1968.0818_ 5:45  236.12  n/a     .000
00226> ###############################################################################
00227> # STORMS
00228> ###############################################################################
00229>   ** END OF RUN :   68
00230>
00231>  ********************************************************************************
00232>
00233>
00234>
00235>
00236>
00237>  RUN#:COMMAND#
00238> R0069:C00001-------------------------------------------------------------------
00239>      START
00240>       [TZERO =    .00 hrs on 19690101]
00241>       [METOUT=   2    (1=imperial, 2=metric output)]
00242>       [NSTORM=   0 ]
00243>       [NRUN  = 0069 ]
00244> #*******************************************************************************
00245> #  SWMHYMO Ver:5.02/Jan 2001 <BETA> / INPUT DATA FILE
00246> #*******************************************************************************
00247> #  Project Name  : [Caivan Stittsville West properties]
00248> #  Project Number: [2267]
00249> #  Date          : [2021/12/14]
00250> #  Modeller      : [JB]
00251> #  Company       : J.F. Sabourin and Associates
00252> #  License #     : 2549237
00253> #*******************************************************************************
00254> #*******************************************************************************
00255> # Ottawa International Airport (1967 - 2003)
00256> R0069:C00002-------------------------------------------------------------------
00257>  *  READ AES DATA
00258>       [Filename  = 6106000.123                                          ]
00259>       [Start_date= 1969.0101: End_date= 1969.1231]
00260>       [DT= 60.min: Length= 8760.hrs: WetHrs=  469: DryHrs= 8291: PTOT= 569.80)
00261>       Maximum average rainfall intensities over
00262>         1 hr    2 hrs    3 hrs    6 hrs   12 hrs   24 hrs   36 hrs   48 hrs   72 hrs
00263>        21.10    16.25    10.83     7.78     3.93     2.10     1.40     1.09      .75    mm/hr
00264>        21.10    32.50    32.50    46.70    47.20    50.30    50.30    52.10    54.00    mm
00265>      19690818 19690818 19690818 19690819 19690819 19690819 19690819 19690819 19690819  date
00266>      Number of rainfall events per following interevent time
00267>         1 hr    2 hrs    3 hrs    6 hrs   12 hrs   24 hrs   36 hrs   48 hrs   72 hrs
00268>          157      119      107       92       72       58       49       43       32
00269>      Number of events with at least the following durations
00270>         1 hr    2 hrs    3 hrs    6 hrs   12 hrs   24 hrs   36 hrs   48 hrs   72 hrs
00271>          156       84       58       21        5        0        0        0        0
00272> R0069:C00003-------------------------------------------------------------------
00273>      COMPUTE API
00274>       [APIini= 50.00: APIkdy= .9000: APIkdt= .9956]
00275>       [APImax= 56.77: APIavg= 16.04: APImin=  .06)
00276> ###############################################################################
00277> # Pre Development Condition - Using NASHHYD and CN
00278> ###############################################################################
00279> R0069:C00004------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm-----RVmm-R.C.---DWFcms
00280>      CONTINUOUS NASHYD     15.0 01:EastPre      39.35     .215 1969.0819_ 3:00   90.65 .159     .000
00281>       [CN= 65.0: N= 3.00: Tp= 1.47]
00282>       [IaREC= 6.00: SMIN= 54.78: SMAX=365.23: SK= .025]
00283>       [InterEventTime=  12.00]
00284> R0069:C00005------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm-----RVmm-R.C.---DWFcms
00285>      CONTINUOUS NASHYD     15.0 01:WestPre      39.85     .223 1969.0819_ 2:45   88.71 .156     .000
00286>       [CN= 61.0: N= 3.00: Tp= 1.22]
00287>       [IaREC= 6.00: SMIN= 64.50: SMAX=430.01: SK= .025]
00288>       [InterEventTime=  12.00]
00289> R0069:C00006------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm-----RVmm-R.C.---DWFcms
00290>      ADD HYD               15.0 02:WestPre      39.85     .223 1969.0819_ 2:45   88.71  n/a     .000
00291>                        +    15.0 02:EastPre      39.35     .215 1969.0819_ 3:00   90.65  n/a     .000
00292>                    SUM=     15.0 01:Pre          79.20     .436 1969.0819_ 3:00   89.68  n/a     .000
00293> ###############################################################################
00294> # Pre Development Condition - Using NASHHYD and CN - No INFILTRATION
00295> ###############################################################################
00296> R0069:C00007------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm-----RVmm-R.C.---DWFcms
00297>      CONTINUOUS NASHYD     15.0 01:InfEastPre    39.35     .890 1969.0818_23:00  210.71 .370     .000
00298>       [CN=100.0: N= 3.00: Tp= 1.47]
00299>       [IaREC= 6.00: SMIN=  1.39: SMAX=  9.24: SK= .025]
00300>       [InterEventTime=  12.00]
00301> R0069:C00008------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm-----RVmm-R.C.---DWFcms
00302>      CONTINUOUS NASHYD     15.0 01:InfWestPre    39.85    1.061 1969.0818_22:45  210.72 .370     .000
00303>       [CN=100.0: N= 3.00: Tp= 1.22]
00304>       [IaREC= 6.00: SMIN=  1.39: SMAX=  9.24: SK= .025]
00305>       [InterEventTime=  12.00]
00306> R0069:C00009------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm-----RVmm-R.C.---DWFcms
00307>      ADD HYD               15.0 02:InfWestPre    39.85    1.061 1969.0818_22:45  210.72  n/a     .000
00308>                        +    15.0 02:InfEastPre    39.35     .890 1969.0818_23:00  210.72  n/a     .000
00309>                    SUM=     15.0 01:InfPre        79.20    1.951 1969.0818_22:45  210.72  n/a     .000
00310> ###############################################################################
00311> # STORMS
00312> ###############################################################################
00313>   ** END OF RUN :   69
00314>
00315>  ********************************************************************************
00316>
00317>
00318>
00319>
00320>
00321>  RUN#:COMMAND#
00322> R0070:C00001-------------------------------------------------------------------
00323>      START
00324>       [TZERO =    .00 hrs on 19700101]
00325>       [METOUT=   2    (1=imperial, 2=metric output)]
00326>       [NSTORM=   0 ]
00327>       [NRUN  = 0070 ]
00328> #*******************************************************************************
00329> #  SWMHYMO Ver:5.02/Jan 2001 <BETA> / INPUT DATA FILE
00330> #*******************************************************************************
00331> #  Project Name  : [Caivan Stittsville West properties]
00332> #  Project Number: [2267]
00333> #  Date          : [2021/12/14]
00334> #  Modeller      : [JB]
00335> #  Company       : J.F. Sabourin and Associates
00336> #  License #     : 2549237
00337> #*******************************************************************************
00338> #*******************************************************************************
00339> # Ottawa International Airport (1967 - 2003)
00340> R0070:C00002-------------------------------------------------------------------
00341>  *  READ AES DATA
00342>       [Filename  = 6106000.123                                          ]
00343>       [Start_date= 1970.0101: End_date= 1970.1231]
00344>       [DT= 60.min: Length= 8016.hrs: WetHrs=  373: DryHrs= 7643: PTOT= 558.90)
00345>       Maximum average rainfall intensities over
00346>         1 hr    2 hrs    3 hrs    6 hrs   12 hrs   24 hrs   36 hrs   48 hrs   72 hrs
00347>        35.30    18.30    12.20     6.10     3.63     1.81     1.21     1.46      .99    mm/hr
00348>        35.30    36.60    36.60    36.60    43.50    43.50    43.50    69.90    71.20    mm
00349>      19700926 19700926 19700926 19700927 19700817 19700817 19700818 19700926 19700927  date
00350>      Number of rainfall events per following interevent time
00351>         1 hr    2 hrs    3 hrs    6 hrs   12 hrs   24 hrs   36 hrs   48 hrs   72 hrs
00352>          148      127      109       84       72       60       53       40       29
00353>      Number of events with at least the following durations
00354>         1 hr    2 hrs    3 hrs    6 hrs   12 hrs   24 hrs   36 hrs   48 hrs   72 hrs
00355>          147       79       40       15        3        0        0        0        0
00356> R0070:C00003-------------------------------------------------------------------
00357>      COMPUTE API
00358>       [APIini= 50.00: APIkdy= .9000: APIkdt= .9956]
00359>       [APImax= 76.00: APIavg= 17.31: APImin=  .23)
00360> ###############################################################################
```

```
# Pre Development Condition - Using NASHHYD and CN
############################################################################
R0070:C00004------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    CONTINUOUS NASHYD    15.0 01:EastPre       39.35     .295 1970.0926_22:15   89.80 .161     .000
      [CN= 65.0: N= 3.00: Tp= 1.47]
      [IaREC= 6.00: SMIN= 54.78: SMAX=365.23: SK= .025]
      [InterEventTime=  12.00]
R0070:C00005------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    CONTINUOUS NASHYD    15.0 01:WestPre       39.85     .311 1970.0926_22:00   88.22 .158     .000
      [CN= 61.0: N= 3.00: Tp= 1.22]
      [IaREC= 6.00: SMIN= 64.50: SMAX=430.01: SK= .025]
      [InterEventTime=  12.00]
R0070:C00006------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ADD HYD              15.0 02:WestPre       39.85     .311 1970.0926_22:00   88.22  n/a     .000
                    +    15.0 02:EastPre       39.35     .295 1970.0926_22:15   89.80  n/a     .000
                 SUM=    15.0 01:Pre           79.20     .600 1970.0926_22:00   89.00  n/a     .000
############################################################################
# Pre Development Condition - Using NASHHYD and CN - No INFILTRATION
############################################################################
R0070:C00007------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    CONTINUOUS NASHYD    15.0 01:InfEastPre    39.35    1.108 1970.0926_22:00  200.34 .358     .000
      [CN=100.0: N= 3.00: Tp= 1.47]
      [IaREC= 6.00: SMIN=  1.39: SMAX=  9.24: SK= .025]
      [InterEventTime=  12.00]
R0070:C00008------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    CONTINUOUS NASHYD    15.0 01:InfWestPre    39.85    1.329 1970.0926_21:45  200.34 .358     .000
      [CN=100.0: N= 3.00: Tp= 1.22]
      [IaREC= 6.00: SMIN=  1.39: SMAX=  9.24: SK= .025]
      [InterEventTime=  12.00]
R0070:C00009------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ADD HYD              15.0 02:InfWestPre    39.85    1.329 1970.0926_21:45  200.34  n/a     .000
                    +    15.0 02:InfEastPre    39.35    1.108 1970.0926_22:00  200.34  n/a     .000
                 SUM=    15.0 01:InfPre        79.20    2.409 1970.0926_22:00  200.34  n/a     .000
############################################################################
# STORMS
############################################################################
  ** END OF RUN :   70

*******************************************************************************************






 RUN#:COMMAND#
R0071:C00001-------------------------------------------------------------------------------------
     START
      [TZERO =    .00 hrs on 19710101]
      [METOUT=   2    (1=imperial, 2=metric output)]
      [NSTORM=   0 ]
      [NRUN  = 0071 ]
#***************************************************************************
#  SWMHYMO Ver:5.02/Jan 2001 <BETA> / INPUT DATA FILE
#***************************************************************************
#  Project Name  : [Caivan Stittsville West properties]
#  Project Number: [2267]
#  Date          : [2021/12/14]
#  Modeller      : [JB]
#  Company       : J.F. Sabourin and Associates
#  License #     : 2549237
#***************************************************************************
#***************************************************************************
# Ottawa International Airport (1967 - 2003)
R0071:C00002-------------------------------------------------------------------------------------
  *  READ AES DATA
      [Filename  = 6106000.123                                          ]
      [Start_date= 1971.0101: End_date= 1971.1231]
      {DT= 60.min: Length= 8760.hrs: WetHrs=  412: DryHrs= 8348: PTOT= 522.10}
      Maximum average rainfall intensities over
        1 hr    2 hrs    3 hrs    6 hrs   12 hrs   24 hrs   36 hrs   48 hrs   72 hrs
       24.60    16.60    11.67     6.13     3.09     1.56     1.06      .79      .54    mm/hr
       24.60    33.20    35.00    36.80    37.10    37.40    38.00    38.00    38.90    mm
      19710810 19710810 19710810 19710810 19710810 19710810 19710811 19710812 19710830  date
      Number of rainfall events per following interevent time
        1 hr    2 hrs    3 hrs    6 hrs   12 hrs   24 hrs   36 hrs   48 hrs   72 hrs
         156      123      113       93       72       61       52       42       33
      Number of events with at least the following durations
        1 hr    2 hrs    3 hrs    6 hrs   12 hrs   24 hrs   36 hrs   48 hrs   72 hrs
         155       81       59       21        2        0        0        0        0
R0071:C00003-------------------------------------------------------------------------------------
     COMPUTE API
      [APIini= 50.00: APIkdy= .9000: APIkdt= .9956]
      {APImax= 62.22: APIavg= 14.84: APImin=   .36}
############################################################################
# Pre Development Condition - Using NASHHYD and CN
############################################################################
R0071:C00004------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    CONTINUOUS NASHYD    15.0 01:EastPre       39.35     .216 1971.0810_16:45   68.80 .132     .000
      [CN= 65.0: N= 3.00: Tp= 1.47]
      [IaREC= 6.00: SMIN= 54.78: SMAX=365.23: SK= .025]
      [InterEventTime=  12.00]
R0071:C00005------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    CONTINUOUS NASHYD    15.0 01:WestPre       39.85     .220 1971.0810_16:30   67.79 .130     .000
      [CN= 61.0: N= 3.00: Tp= 1.22]
      [IaREC= 6.00: SMIN= 64.50: SMAX=430.01: SK= .025]
      [InterEventTime=  12.00]
R0071:C00006------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ADD HYD              15.0 02:WestPre       39.85     .220 1971.0810_16:30   67.79  n/a     .000
                    +    15.0 02:EastPre       39.35     .216 1971.0810_16:45   68.80  n/a     .000
                 SUM=    15.0 01:Pre           79.20     .433 1971.0810_16:30   68.29  n/a     .000
############################################################################
# Pre Development Condition - Using NASHHYD and CN - No INFILTRATION
############################################################################
R0071:C00007------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    CONTINUOUS NASHYD    15.0 01:InfEastPre    39.35    1.003 1971.0810_16:30  160.66 .308     .000
      [CN=100.0: N= 3.00: Tp= 1.47]
      [IaREC= 6.00: SMIN=  1.39: SMAX=  9.24: SK= .025]
      [InterEventTime=  12.00]
R0071:C00008------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    CONTINUOUS NASHYD    15.0 01:InfWestPre    39.85    1.162 1971.0810_16:15  160.66 .308     .000
      [CN=100.0: N= 3.00: Tp= 1.22]
      [IaREC= 6.00: SMIN=  1.39: SMAX=  9.24: SK= .025]
      [InterEventTime=  12.00]
R0071:C00009------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ADD HYD              15.0 02:InfWestPre    39.85    1.162 1971.0810_16:15  160.66  n/a     .000
                    +    15.0 02:InfEastPre    39.35    1.003 1971.0810_16:30  160.66  n/a     .000
                 SUM=    15.0 01:InfPre        79.20    2.161 1971.0810_16:15  160.66  n/a     .000
############################################################################
# STORMS
############################################################################
  ** END OF RUN :   71

*******************************************************************************************






 RUN#:COMMAND#
R0072:C00001-------------------------------------------------------------------------------------
     START
      [TZERO =    .00 hrs on 19720101]
      [METOUT=   2    (1=imperial, 2=metric output)]
      [NSTORM=   0 ]
      [NRUN  = 0072 ]
#***************************************************************************
#  SWMHYMO Ver:5.02/Jan 2001 <BETA> / INPUT DATA FILE
#***************************************************************************
#  Project Name  : [Caivan Stittsville West properties]
#  Project Number: [2267]
#  Date          : [2021/12/14]
#  Modeller      : [JB]
#  Company       : J.F. Sabourin and Associates
#  License #     : 2549237
#***************************************************************************
#***************************************************************************
# Ottawa International Airport (1967 - 2003)
R0072:C00002-------------------------------------------------------------------------------------
  *  READ AES DATA
      [Filename  = 6106000.123                                          ]
      [Start_date= 1972.0101: End_date= 1972.1230]
      {DT= 60.min: Length= 8760.hrs: WetHrs=  489: DryHrs= 8271: PTOT= 784.30}
      Maximum average rainfall intensities over
        1 hr    2 hrs    3 hrs    6 hrs   12 hrs   24 hrs   36 hrs   48 hrs   72 hrs
       37.30    19.15    12.97     8.15     4.50     2.53     2.00     1.71     1.17    mm/hr
       37.30    38.30    38.90    48.90    54.00    60.70    72.10    82.20    84.20    mm
      19720712 19720712 19720807 19720808 19720808 19720808 19720713 19720714 19720715  date
      Number of rainfall events per following interevent time
        1 hr    2 hrs    3 hrs    6 hrs   12 hrs   24 hrs   36 hrs   48 hrs   72 hrs
         170      133      122       86       76       60       45       41       31
      Number of events with at least the following durations
        1 hr    2 hrs    3 hrs    6 hrs   12 hrs   24 hrs   36 hrs   48 hrs   72 hrs
         169       96       58       21        5        0        0        0        0
R0072:C00003-------------------------------------------------------------------------------------
     COMPUTE API
      [APIini= 50.00: APIkdy= .9000: APIkdt= .9956]
      {APImax=108.88: APIavg= 21.70: APImin=   .00}
############################################################################
# Pre Development Condition - Using NASHHYD and CN
############################################################################
R0072:C00004------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    CONTINUOUS NASHYD    15.0 01:EastPre       39.35     .438 1972.0808_ 0:00  191.56 .244     .000
      [CN= 65.0: N= 3.00: Tp= 1.47]
      [IaREC= 6.00: SMIN= 54.78: SMAX=365.23: SK= .025]
      [InterEventTime=  12.00]
R0072:C00005------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    CONTINUOUS NASHYD    15.0 01:WestPre       39.85     .465 1972.0807_23:45  188.98 .241     .000
      [CN= 61.0: N= 3.00: Tp= 1.22]
      [IaREC= 6.00: SMIN= 64.50: SMAX=430.01: SK= .025]
      [InterEventTime=  12.00]
R0072:C00006------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ADD HYD              15.0 02:WestPre       39.85     .465 1972.0807_23:45  188.98  n/a     .000
                    +    15.0 02:EastPre       39.35     .438 1972.0808_ 0:00  191.56  n/a     .000
                 SUM=    15.0 01:Pre           79.20     .891 1972.0807_23:45  190.26  n/a     .000
############################################################################
# Pre Development Condition - Using NASHHYD and CN - No INFILTRATION
############################################################################
R0072:C00007------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    CONTINUOUS NASHYD    15.0 01:InfEastPre    39.35    1.280 1972.0807_23:45  342.97 .437     .000
      [CN=100.0: N= 3.00: Tp= 1.47]
      [IaREC= 6.00: SMIN=  1.39: SMAX=  9.24: SK= .025]
      [InterEventTime=  12.00]
R0072:C00008------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    CONTINUOUS NASHYD    15.0 01:InfWestPre    39.85    1.501 1972.0807_23:30  342.97 .437     .000
      [CN=100.0: N= 3.00: Tp= 1.22]
      [IaREC= 6.00: SMIN=  1.39: SMAX=  9.24: SK= .025]
      [InterEventTime=  12.00]
R0072:C00009------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ADD HYD              15.0 02:InfWestPre    39.85    1.501 1972.0807_23:30  342.97  n/a     .000
                    +    15.0 02:InfEastPre    39.35    1.280 1972.0807_23:45  342.97  n/a     .000
                 SUM=    15.0 01:InfPre        79.20    2.755 1972.0807_23:45  342.97  n/a     .000
############################################################################
# STORMS
############################################################################
  ** END OF RUN :   72

*******************************************************************************************






 RUN#:COMMAND#
R0073:C00001-------------------------------------------------------------------------------------
     START
      [TZERO =    .00 hrs on 19730101]
      [METOUT=   2    (1=imperial, 2=metric output)]
      [NSTORM=   0 ]
      [NRUN  = 0073 ]
#***************************************************************************
#  SWMHYMO Ver:5.02/Jan 2001 <BETA> / INPUT DATA FILE
#***************************************************************************
#  Project Name  : [Caivan Stittsville West properties]
#  Project Number: [2267]
#  Date          : [2021/12/14]
#  Modeller      : [JB]
#  Company       : J.F. Sabourin and Associates
#  License #     : 2549237
#***************************************************************************
#***************************************************************************
# Ottawa International Airport (1967 - 2003)
R0073:C00002-------------------------------------------------------------------------------------
  *  READ AES DATA
      [Filename  = 6106000.123                                          ]
      [Start_date= 1973.0101: End_date= 1973.1231]
      {DT= 60.min: Length= 8760.hrs: WetHrs=  549: DryHrs= 8211: PTOT= 744.90}
      Maximum average rainfall intensities over
        1 hr    2 hrs    3 hrs    6 hrs   12 hrs   24 hrs   36 hrs   48 hrs   72 hrs
       30.00    17.25    12.33     7.10     3.63     1.89     1.28      .96      .96    mm/hr
       30.00    34.50    37.00    42.60    43.60    45.40    46.00    46.00    69.20    mm
      19730611 19730808 19730808 19730808 19730808 19730616 19730616 19730616 19731005  date
      Number of rainfall events per following interevent time
        1 hr    2 hrs    3 hrs    6 hrs   12 hrs   24 hrs   36 hrs   48 hrs   72 hrs
         200      164      143      108       79       61       54       43       37
      Number of events with at least the following durations
        1 hr    2 hrs    3 hrs    6 hrs   12 hrs   24 hrs   36 hrs   48 hrs   72 hrs
         200      102       66       20        4        0        0        0        0
R0073:C00003-------------------------------------------------------------------------------------
     COMPUTE API
      [APIini= 50.00: APIkdy= .9000: APIkdt= .9956]
      {APImax= 78.26: APIavg= 20.56: APImin=   .06}
############################################################################
# Pre Development Condition - Using NASHHYD and CN
############################################################################
R0073:C00004------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    CONTINUOUS NASHYD    15.0 01:EastPre       39.35     .355 1973.0808_21:00  142.52 .191     .000
      [CN= 65.0: N= 3.00: Tp= 1.47]
      [IaREC= 6.00: SMIN= 54.78: SMAX=365.23: SK= .025]
      [InterEventTime=  12.00]
R0073:C00005------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    CONTINUOUS NASHYD    15.0 01:WestPre       39.85     .372 1973.0808_20:45  139.70 .188     .000
      [CN= 61.0: N= 3.00: Tp= 1.22]
      [IaREC= 6.00: SMIN= 64.50: SMAX=430.01: SK= .025]
      [InterEventTime=  12.00]
R0073:C00006------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ADD HYD              15.0 02:WestPre       39.85     .372 1973.0808_20:45  139.70  n/a     .000
                    +    15.0 02:EastPre       39.35     .355 1973.0808_21:00  142.52  n/a     .000
                 SUM=    15.0 01:Pre           79.20     .724 1973.0808_21:00  141.10  n/a     .000
############################################################################
# Pre Development Condition - Using NASHHYD and CN - No INFILTRATION
############################################################################
R0073:C00007------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    CONTINUOUS NASHYD    15.0 01:InfEastPre    39.35    1.261 1973.0808_20:45  309.11 .415     .000
      [CN=100.0: N= 3.00: Tp= 1.47]
      [IaREC= 6.00: SMIN=  1.39: SMAX=  9.24: SK= .025]
      [InterEventTime=  12.00]
R0073:C00008------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    CONTINUOUS NASHYD    15.0 01:InfWestPre    39.85    1.473 1973.0808_20:30  309.11 .415     .000
      [CN=100.0: N= 3.00: Tp= 1.22]
      [IaREC= 6.00: SMIN=  1.39: SMAX=  9.24: SK= .025]
      [InterEventTime=  12.00]
R0073:C00009------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ADD HYD              15.0 02:InfWestPre    39.85    1.473 1973.0808_20:30  309.11  n/a     .000
                    +    15.0 02:InfEastPre    39.35    1.261 1973.0808_20:45  309.11  n/a     .000
                 SUM=    15.0 01:InfPre        79.20    2.726 1973.0808_20:45  309.11  n/a     .000
############################################################################
# STORMS
############################################################################
  ** END OF RUN :   73

*******************************************************************************************






 RUN#:COMMAND#
R0074:C00001-------------------------------------------------------------------------------------
     START
      [TZERO =    .00 hrs on 19740101]
      [METOUT=   2    (1=imperial, 2=metric output)]
      [NSTORM=   0 ]
      [NRUN  = 0074 ]
#***************************************************************************
#  SWMHYMO Ver:5.02/Jan 2001 <BETA> / INPUT DATA FILE
#***************************************************************************
#  Project Name  : [Caivan Stittsville West properties]
#  Project Number: [2267]
#  Date          : [2021/12/14]
#  Modeller      : [JB]
#  Company       : J.F. Sabourin and Associates
#  License #     : 2549237
#***************************************************************************
#***************************************************************************
# Ottawa International Airport (1967 - 2003)
R0074:C00002-------------------------------------------------------------------------------------
  *  READ AES DATA
      [Filename  = 6106000.123                                          ]
      [Start_date= 1974.0101: End_date= 1974.1231]
      {DT= 60.min: Length= 8760.hrs: WetHrs=  320: DryHrs= 8440: PTOT= 386.20}
      Maximum average rainfall intensities over
        1 hr    2 hrs    3 hrs    6 hrs   12 hrs   24 hrs   36 hrs   48 hrs   72 hrs
       20.60    15.40    10.37     5.18     2.98     1.63     1.08      .81      .54    mm/hr
       20.60    30.80    31.10    31.10    35.70    39.00    39.00    39.00    39.00    mm
      19740718 19740719 19740719 19740719 19740305 19740305 19740306 19740306 19740307  date
      Number of rainfall events per following interevent time
        1 hr    2 hrs    3 hrs    6 hrs   12 hrs   24 hrs   36 hrs   48 hrs   72 hrs
         129      105       93       77       63       50       38       33       23
      Number of events with at least the following durations
        1 hr    2 hrs    3 hrs    6 hrs   12 hrs   24 hrs   36 hrs   48 hrs   72 hrs
         128       66       32       10        3        0        0        0        0
R0074:C00003-------------------------------------------------------------------------------------
     COMPUTE API
      [APIini= 50.00: APIkdy= .9000: APIkdt= .9956]
      {APImax= 52.93: APIavg= 11.36: APImin=   .00}
############################################################################
# Pre Development Condition - Using NASHHYD and CN
############################################################################
R0074:C00004------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    CONTINUOUS NASHYD    15.0 01:EastPre       39.35     .127 1974.0719_ 1:45   42.84 .111     .000
      [CN= 65.0: N= 3.00: Tp= 1.47]
      [IaREC= 6.00: SMIN= 54.78: SMAX=365.23: SK= .025]
      [InterEventTime=  12.00]
R0074:C00005------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    CONTINUOUS NASHYD    15.0 01:WestPre       39.85     .129 1974.0719_ 1:30   41.96 .109     .000
      [CN= 61.0: N= 3.00: Tp= 1.22]
      [IaREC= 6.00: SMIN= 64.50: SMAX=430.01: SK= .025]
      [InterEventTime=  12.00]
R0074:C00006------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ADD HYD              15.0 02:WestPre       39.85     .129 1974.0719_ 1:30   41.96  n/a     .000
                    +    15.0 02:EastPre       39.35     .127 1974.0719_ 1:45   42.84  n/a     .000
                 SUM=    15.0 01:Pre           79.20     .255 1974.0719_ 1:45   42.40  n/a     .000
############################################################################
# Pre Development Condition - Using NASHHYD and CN - No INFILTRATION
############################################################################
R0074:C00007------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    CONTINUOUS NASHYD    15.0 01:InfEastPre    39.35     .790 1974.0719_ 1:30  105.03 .272     .000
      [CN=100.0: N= 3.00: Tp= 1.47]
      [IaREC= 6.00: SMIN=  1.39: SMAX=  9.24: SK= .025]
      [InterEventTime=  12.00]
```

```
00721> R0074:c00008------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00722>      CONTINUOUS NASHYD    15.0 01:InfWestPre    39.85     .916 1974.0719_ 1:15  105.03 .272     .000
00723>        [CN=100.0: N= 3.00: Tp= 1.22]
00724>        [IaREC= 6.00: SMIN=  1.39: SMAX=  9.24: SK= .025]
00725>        [InterEventTime=  12.00]
00726> R0074:c00009------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00727>      ADD HYD              15.0 02:InfWestPre    39.85     .916 1974.0719_ 1:15  105.03  n/a     .000
00728>                       +   15.0 02:InfEastPre    39.35     .790 1974.0719_ 1:30  105.03  n/a     .000
00729>                     SUM=  15.0 01:InfPre       79.20    1.704 1974.0719_ 1:30  105.03  n/a     .000
00730> ##########################################################################
00731> # STORMS
00732> ##########################################################################
00733>   ** END OF RUN :   74
00734>
00735> **************************************************************************************************
00736>
00737>
00738>
00739>
00740>
00741>  RUN#:COMMAND#
00742> R0075:C00001------------------------------------------------------------------------------------------
00743>       START
00744>        [TZERO =    .00 hrs on 19750101]
00745>        [METOUT=   2     (1=imperial, 2=metric output)]
00746>        [NSTORM=   0 ]
00747>        [NRUN  = 0075 ]
00748> **************************************************************************
00749> #  SWMHYMO Ver:5.02/Jan 2001 <BETA> / INPUT DATA FILE
00750> **************************************************************************
00751> #  Project Name  : [Caivan Stittsville West properties]
00752> #  Project Number: [2267]
00753> #  Date          : [2021/12/14]
00754> #  Modeller      : [JB]
00755> #  Company       : J.F. Sabourin and Associates
00756> #  License #     : 2549237
00757> **************************************************************************
00758> ##########################################################################
00759> # Ottawa International Airport (1967 - 2003)
00760> R0075:C00002------------------------------------------------------------------------------------------
00761>   *  READ AES DATA
00762>        [Filename  = 6106000.123                                                    ]
00763>        [Start_date= 1975.0101: End_date= 1975.1231]
00764>        [DT= 60.min: Length= 8760.hrs: WetHrs=  344: DryHrs= 8416: PTOT= 535.50)
00765>        Maximum average rainfall intensities over
00766>          1 hr    2 hrs    3 hrs    6 hrs   12 hrs   24 hrs   36 hrs   48 hrs   72 hrs
00767>         34.80    18.40    12.53     6.32     3.33     1.73     1.15      .87      .62     mm/hr
00768>         34.80    36.00    37.60    37.90    40.00    41.50    41.50    41.80    44.40     mm
00769>        19750708 19750720 19750720 19750720 19750721 19750721 19750721 19750721 19750928  date
00770>        Number of rainfall events per following interevent time
00771>          1 hr    2 hrs    3 hrs    6 hrs   12 hrs   24 hrs   36 hrs   48 hrs   72 hrs
00772>           136      118       99       78       61       49       40       33       25
00773>        Number of events with at least the following durations
00774>          1 hr    2 hrs    3 hrs    6 hrs   12 hrs   24 hrs   36 hrs   48 hrs   72 hrs
00775>           135       70       40       17        1        0        0        0        0
00776> R0075:c00003------------------------------------------------------------------------------------------
00777>       COMPUTE API
00778>        [APIini= 50.00: APIkdy= .9000: APIkdt= .9956]
00779>        [APImax= 73.23: APIavg= 15.16: APImin=   .00]
00780> ##########################################################################
00781> # Pre Development Condition - Using NASHYD and CN
00782> ##########################################################################
00783> R0075:C00004------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00784>      CONTINUOUS NASHYD    15.0 01:EastPre       39.35     .226 1975.0720_18:00   89.74 .168     .000
00785>        [CN= 65.0: N= 3.00: Tp= 1.47]
00786>        [IaREC= 6.00: SMIN= 54.78: SMAX=365.23: SK= .025]
00787>        [InterEventTime=  12.00]
00788> R0075:C00005------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00789>      CONTINUOUS NASHYD    15.0 01:WestPre       39.85     .231 1975.0720_17:45   88.19 .165     .000
00790>        [CN= 61.0: N= 3.00: Tp= 1.22]
00791>        [IaREC= 6.00: SMIN= 64.50: SMAX=430.01: SK= .025]
00792>        [InterEventTime=  12.00]
00793> R0075:C00006------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00794>      ADD HYD              39.85     .231 1975.0720_17:45   88.19  n/a     .000
00795>                       +   15.0 02:EastPre       39.35     .226 1975.0720_18:00   89.74  n/a     .000
00796>                     SUM=  15.0 01:Pre          79.20     .457 1975.0720_17:45   88.96  n/a     .000
00797> ##########################################################################
00798> # Pre Development Condition - Using NASHYD and CN - No INFILTRATION
00799> ##########################################################################
00800> R0075:C00007------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00801>      CONTINUOUS NASHYD    15.0 01:InfEastPre    39.35    1.031 1975.0720_17:30  196.76 .367     .000
00802>        [CN=100.0: N= 3.00: Tp= 1.47]
00803>        [IaREC= 6.00: SMIN=  1.39: SMAX=  9.24: SK= .025]
00804>        [InterEventTime=  12.00]
00805> R0075:C00008------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00806>      CONTINUOUS NASHYD    15.0 01:InfWestPre    39.85    1.228 1975.0708_17:45  196.76 .367     .000
00807>        [CN=100.0: N= 3.00: Tp= 1.22]
00808>        [IaREC= 6.00: SMIN=  1.39: SMAX=  9.24: SK= .025]
00809>        [InterEventTime=  12.00]
00810> R0075:C00009------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00811>      ADD HYD              15.0 02:InfWestPre    39.85    1.228 1975.0708_17:45  196.76  n/a     .000
00812>                       +   15.0 02:InfEastPre    39.35    1.031 1975.0720_17:30  196.76  n/a     .000
00813>                     SUM=  15.0 01:InfPre       79.20    2.218 1975.0708_18:00  196.76  n/a     .000
00814> ##########################################################################
00815> # STORMS
00816> ##########################################################################
00817>   ** END OF RUN :   75
00818>
00819> **************************************************************************************************
00820>
00821>
00822>
00823>
00824>
00825>  RUN#:COMMAND#
00826> R0076:C00001------------------------------------------------------------------------------------------
00827>       START
00828>        [TZERO =    .00 hrs on 19760101]
00829>        [METOUT=   2     (1=imperial, 2=metric output)]
00830>        [NSTORM=   0 ]
00831>        [NRUN  = 0076 ]
00832> **************************************************************************
00833> #  SWMHYMO Ver:5.02/Jan 2001 <BETA> / INPUT DATA FILE
00834> **************************************************************************
00835> #  Project Name  : [Caivan Stittsville West properties]
00836> #  Project Number: [2267]
00837> #  Date          : [2021/12/14]
00838> #  Modeller      : [JB]
00839> #  Company       : J.F. Sabourin and Associates
00840> #  License #     : 2549237
00841> **************************************************************************
00842> **************************************************************************
00843> # Ottawa International Airport (1967 - 2003)
00844> R0076:C00002------------------------------------------------------------------------------------------
00845>   *  READ AES DATA
00846>        [Filename  = 6106000.123                                                    ]
00847>        [Start_date= 1976.0101: End_date= 1976.1230]
00848>        [DT= 60.min: Length= 8064.hrs: WetHrs=  389: DryHrs= 7675: PTOT= 492.40)
00849>        Maximum average rainfall intensities over
00850>          1 hr    2 hrs    3 hrs    6 hrs   12 hrs   24 hrs   36 hrs   48 hrs   72 hrs
00851>         14.00     8.90     6.43     4.65     2.35     1.39      .97      .80      .60     mm/hr
00852>         14.00    17.80    19.30    27.90    28.20    33.30    35.10    46.60    57.50     mm
00853>        19760828 19760828 19760828 19760828 19760828 19760920 19760519 19760520 19760921  date
00854>        Number of rainfall events per following interevent time
00855>          1 hr    2 hrs    3 hrs    6 hrs   12 hrs   24 hrs   36 hrs   48 hrs   72 hrs
00856>           173      139      123       96       76       59       44       38       28
00857>        Number of events with at least the following durations
00858>          1 hr    2 hrs    3 hrs    6 hrs   12 hrs   24 hrs   36 hrs   48 hrs   72 hrs
00859>           172       80       46       13        1        0        0        0        0
00860> R0076:C00003------------------------------------------------------------------------------------------
00861>       COMPUTE API
00862>        [APIini= 50.00: APIkdy= .9000: APIkdt= .9956]
00863>        [APImax= 59.67: APIavg= 15.32: APImin=   .02]
00864> ##########################################################################
00865> # Pre Development Condition - Using NASHYD and CN
00866> ##########################################################################
00867> R0076:C00004------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00868>      CONTINUOUS NASHYD    15.0 01:EastPre       39.35     .117 1976.0519_23:15   60.12 .122     .000
00869>        [CN= 65.0: N= 3.00: Tp= 1.47]
00870>        [IaREC= 6.00: SMIN= 54.78: SMAX=365.23: SK= .025]
00871>        [InterEventTime=  12.00]
00872> R0076:C00005------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00873>      CONTINUOUS NASHYD    15.0 01:WestPre       39.85     .112 1976.0519_23:15   58.79 .119     .000
00874>        [CN= 61.0: N= 3.00: Tp= 1.22]
00875>        [IaREC= 6.00: SMIN= 64.50: SMAX=430.01: SK= .025]
00876>        [InterEventTime=  12.00]
00877> R0076:C00006------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00878>      ADD HYD              15.0 02:WestPre       39.85     .112 1976.0519_23:15   58.79  n/a     .000
00879>                       +   15.0 02:EastPre       39.35     .117 1976.0519_23:15   60.12  n/a     .000
00880>                     SUM=  15.0 01:Pre          79.20     .229 1976.0519_23:15   59.45  n/a     .000
00881> ##########################################################################
00882> # Pre Development Condition - Using NASHYD and CN - No INFILTRATION
00883> ##########################################################################
00884> R0076:C00007------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00885>      CONTINUOUS NASHYD    15.0 01:InfEastPre    39.35     .391 1976.0828_23:00  143.78 .292     .000
00886>        [CN=100.0: N= 3.00: Tp= 1.47]
00887>        [IaREC= 6.00: SMIN=  1.39: SMAX=  9.24: SK= .025]
00888>        [InterEventTime=  12.00]
00889> R0076:C00008------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00890>      CONTINUOUS NASHYD    15.0 01:InfWestPre    39.85     .409 1976.0828_22:45  143.78 .292     .000
00891>        [CN=100.0: N= 3.00: Tp= 1.22]
00892>        [IaREC= 6.00: SMIN=  1.39: SMAX=  9.24: SK= .025]
00893>        [InterEventTime=  12.00]
00894> R0076:C00009------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00895>      ADD HYD              15.0 02:InfWestPre    39.85     .409 1976.0828_22:45  143.78  n/a     .000
00896>                       +   15.0 02:InfEastPre    39.35     .391 1976.0828_23:00  143.78  n/a     .000
00897>                     SUM=  15.0 01:InfPre       79.20     .798 1976.0828_22:45  143.78  n/a     .000
00898> ##########################################################################
00899> # STORMS
00900> ##########################################################################
00901>   ** END OF RUN :   76
00902>
00903> **************************************************************************************************
00904>
00905>
00906>
00907>
00908>
00909>  RUN#:COMMAND#
00910> R0077:C00001------------------------------------------------------------------------------------------
00911>       START
00912>        [TZERO =    .00 hrs on 19770101]
00913>        [METOUT=   2     (1=imperial, 2=metric output)]
00914>        [NSTORM=   0 ]
00915>        [NRUN  = 0077 ]
00916> **************************************************************************
00917> #  SWMHYMO Ver:5.02/Jan 2001 <BETA> / INPUT DATA FILE
00918> **************************************************************************
00919> #  Project Name  : [Caivan Stittsville West properties]
00920> #  Project Number: [2267]
00921> #  Date          : [2021/12/14]
00922> #  Modeller      : [JB]
00923> #  Company       : J.F. Sabourin and Associates
00924> #  License #     : 2549237
00925> **************************************************************************
00926> **************************************************************************
00927> # Ottawa International Airport (1967 - 2003)
00928> R0077:C00002------------------------------------------------------------------------------------------
00929>   *  READ AES DATA
00930>        [Filename  = 6106000.123                                                    ]
00931>        [Start_date= 1977.0101: End_date= 1977.1231]
00932>        [DT= 60.min: Length= 8016.hrs: WetHrs=  511: DryHrs= 7505: PTOT= 677.60)
00933>        Maximum average rainfall intensities over
00934>          1 hr    2 hrs    3 hrs    6 hrs   12 hrs   24 hrs   36 hrs   48 hrs   72 hrs
00935>         21.30    15.20    10.40     6.53     3.30     1.65     1.38     1.06      .73     mm/hr
00936>         21.30    30.40    31.20    39.20    39.60    39.60    49.60    51.00    52.40     mm
00937>        19770717 19770717 19770717 19770901 19770902 19770902 19770314 19770315 19770718  date
00938>        Number of rainfall events per following interevent time
00939>          1 hr    2 hrs    3 hrs    6 hrs   12 hrs   24 hrs   36 hrs   48 hrs   72 hrs
00940>           188      156      139      107       82       61       52       41       28
00941>        Number of events with at least the following durations
00942>          1 hr    2 hrs    3 hrs    6 hrs   12 hrs   24 hrs   36 hrs   48 hrs   72 hrs
00943>           187       89       58       21        5        1        0        0        0
00944> R0077:c00003------------------------------------------------------------------------------------------
00945>       COMPUTE API
00946>        [APIini= 50.00: APIkdy= .9000: APIkdt= .9956]
00947>        [APImax= 74.28: APIavg= 20.62: APImin=  1.62)
00948> ##########################################################################
00949> # Pre Development Condition - Using NASHYD and CN
00950> ##########################################################################
00951> R0077:c00004------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00952>      CONTINUOUS NASHYD    15.0 01:EastPre       39.35     .224 1977.0902_ 0:00  110.65 .163     .000
00953>        [CN= 65.0: N= 3.00: Tp= 1.47]
00954>        [IaREC= 6.00: SMIN= 54.78: SMAX=365.23: SK= .025]
00955>        [InterEventTime=  12.00]
00956> R0077:c00005------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00957>      CONTINUOUS NASHYD    15.0 01:WestPre       39.85     .233 1977.0901_23:45  108.42 .160     .000
00958>        [CN= 61.0: N= 3.00: Tp= 1.22]
00959>        [IaREC= 6.00: SMIN= 64.50: SMAX=430.01: SK= .025]
00960>        [InterEventTime=  12.00]
00961> R0077:c00006------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00962>      ADD HYD              15.0 02:WestPre       39.85     .233 1977.0901_23:45  108.42  n/a     .000
00963>                       +   15.0 02:EastPre       39.35     .224 1977.0902_ 0:00  110.65  n/a     .000
00964>                     SUM=  15.0 01:Pre          79.20     .451 1977.0901_23:45  109.53  n/a     .000
00965> ##########################################################################
00966> # Pre Development Condition - Using NASHYD and CN - No INFILTRATION
00967> ##########################################################################
00968> R0077:c00007------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00969>      CONTINUOUS NASHYD    15.0 01:InfEastPre    39.35     .943 1977.0901_23:45  247.00 .365     .000
00970>        [CN=100.0: N= 3.00: Tp= 1.47]
00971>        [IaREC= 6.00: SMIN=  1.39: SMAX=  9.24: SK= .025]
00972>        [InterEventTime=  12.00]
00973> R0077:c00008------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00974>      CONTINUOUS NASHYD    15.0 01:InfWestPre    39.85    1.083 1977.0901_23:30  247.00 .365     .000
00975>        [CN=100.0: N= 3.00: Tp= 1.22]
00976>        [IaREC= 6.00: SMIN=  1.39: SMAX=  9.24: SK= .025]
00977>        [InterEventTime=  12.00]
00978> R0077:c00009------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00979>      ADD HYD              15.0 02:InfWestPre    39.85    1.083 1977.0901_23:30  247.00  n/a     .000
00980>                       +   15.0 02:InfEastPre    39.35     .943 1977.0901_23:45  247.00  n/a     .000
00981>                     SUM=  15.0 01:InfPre       79.20    2.008 1977.0901_23:45  247.00  n/a     .000
00982> ##########################################################################
00983> # STORMS
00984> ##########################################################################
00985>   ** END OF RUN :   77
00986>
00987> **************************************************************************************************
00988>
00989>
00990>
00991>
00992>
00993>  RUN#:COMMAND#
00994> R0078:C00001------------------------------------------------------------------------------------------
00995>       START
00996>        [TZERO =    .00 hrs on 19780101]
00997>        [METOUT=   2     (1=imperial, 2=metric output)]
00998>        [NSTORM=   0 ]
00999>        [NRUN  = 0078 ]
01000> **************************************************************************
01001> #  SWMHYMO Ver:5.02/Jan 2001 <BETA> / INPUT DATA FILE
01002> **************************************************************************
01003> #  Project Name  : [Caivan Stittsville West properties]
01004> #  Project Number: [2267]
01005> #  Date          : [2021/12/14]
01006> #  Modeller      : [JB]
01007> #  Company       : J.F. Sabourin and Associates
01008> #  License #     : 2549237
01009> **************************************************************************
01010> **************************************************************************
01011> # Ottawa International Airport (1967 - 2003)
01012> R0078:C00002------------------------------------------------------------------------------------------
01013>   *  READ AES DATA
01014>        [Filename  = 6106000.123                                                    ]
01015>        [Start_date= 1978.0101: End_date= 1978.1231]
01016>        [DT= 60.min: Length= 8040.hrs: WetHrs=  407: DryHrs= 7633: PTOT= 638.80)
01017>        Maximum average rainfall intensities over
01018>          1 hr    2 hrs    3 hrs    6 hrs   12 hrs   24 hrs   36 hrs   48 hrs   72 hrs
01019>         36.00    18.15    12.10     6.05     3.04     1.62     1.13      .87      .58     mm/hr
01020>         36.00    36.30    36.30    36.30    36.50    38.80    40.60    41.60    41.60     mm
01021>        19780618 19780618 19780618 19780618 19780619 19780619 19780412 19780620 19780621  date
01022>        Number of rainfall events per following interevent time
01023>          1 hr    2 hrs    3 hrs    6 hrs   12 hrs   24 hrs   36 hrs   48 hrs   72 hrs
01024>           167      135      126      103       76       60       53       45       31
01025>        Number of events with at least the following durations
01026>          1 hr    2 hrs    3 hrs    6 hrs   12 hrs   24 hrs   36 hrs   48 hrs   72 hrs
01027>           166       78       48       17        1        0        0        0        0
01028> R0078:c00003------------------------------------------------------------------------------------------
01029>       COMPUTE API
01030>        [APIini= 50.00: APIkdy= .9000: APIkdt= .9956]
01031>        [APImax= 65.36: APIavg= 19.25: APImin=   .25)
01032> ##########################################################################
01033> # Pre Development Condition - Using NASHYD and CN
01034> ##########################################################################
01035> R0078:c00004------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
01036>      CONTINUOUS NASHYD    15.0 01:EastPre       39.35     .263 1978.0618_18:15   87.81 .137     .000
01037>        [CN= 65.0: N= 3.00: Tp= 1.47]
01038>        [IaREC= 6.00: SMIN= 54.78: SMAX=365.23: SK= .025]
01039>        [InterEventTime=  12.00]
01040> R0078:c00005------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
01041>      CONTINUOUS NASHYD    15.0 01:WestPre       39.85     .279 1978.0618_18:00   85.92 .135     .000
01042>        [CN= 61.0: N= 3.00: Tp= 1.22]
01043>        [IaREC= 6.00: SMIN= 64.50: SMAX=430.01: SK= .025]
01044>        [InterEventTime=  12.00]
01045> R0078:c00006------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
01046>      ADD HYD              15.0 02:WestPre       39.85     .279 1978.0618_18:00   85.92  n/a     .000
01047>                       +   15.0 02:EastPre       39.35     .263 1978.0618_18:15   87.81  n/a     .000
01048>                     SUM=  15.0 01:Pre          79.20     .540 1978.0618_18:00   86.86  n/a     .000
01049> ##########################################################################
01050> # Pre Development Condition - Using NASHYD and CN - No INFILTRATION
01051> ##########################################################################
01052> R0078:c00007------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
01053>      CONTINUOUS NASHYD    15.0 01:InfEastPre    39.35    1.103 1978.0618_18:00  230.33 .361     .000
01054>        [CN=100.0: N= 3.00: Tp= 1.47]
01055>        [IaREC= 6.00: SMIN=  1.39: SMAX=  9.24: SK= .025]
01056>        [InterEventTime=  12.00]
01057> R0078:c00008------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
01058>      CONTINUOUS NASHYD    15.0 01:InfWestPre    39.85    1.330 1978.0618_17:45  230.33 .361     .000
01059>        [CN=100.0: N= 3.00: Tp= 1.22]
01060>        [IaREC= 6.00: SMIN=  1.39: SMAX=  9.24: SK= .025]
01061>        [InterEventTime=  12.00]
01062> R0078:c00009------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
01063>      ADD HYD              15.0 02:InfWestPre    39.85    1.330 1978.0618_17:45  230.33  n/a     .000
01064>                       +   15.0 02:InfEastPre    39.35    1.103 1978.0618_18:00  230.33  n/a     .000
01065>                     SUM=  15.0 01:InfPre       79.20    2.395 1978.0618_18:00  230.33  n/a     .000
01066> ##########################################################################
01067> # STORMS
01068> ##########################################################################
01069>   ** END OF RUN :   78
01070>
01071> **************************************************************************************************
01072>
01073>
01074>
01075>
01076>
01077>  RUN#:COMMAND#
01078> R0079:C00001------------------------------------------------------------------------------------------
01079>       START
01080>        [TZERO =    .00 hrs on 19790101]
```

```
      [METOUT=   2    (1=imperial, 2=metric output)]
      [NSTORM=   0 ]
      [NRUN  = 0079 ]
#******************************************************************************
#  SWMHYMO Ver:5.02/Jan 2001 <BETA> / INPUT DATA FILE
#******************************************************************************
#  Project Name  : [Caivan Stittsville West properties]
#  Project Number: [2267]
#  Date          : [2021/12/14]
#  Modeller      : [JB]
#  Company       : J.F. Sabourin and Associates
#  License #     : 2549237
#******************************************************************************
#******************************************************************************
# Ottawa International Airport (1967 - 2003)
R0079:C00002------------------------------------------------------------------------------------------
  *  READ AES DATA
      [Filename  = 6106000.123                                            ]
      [Start_date= 1979.0101: End_date= 1979.1231]
      {DT= 60.min: Length= 8760.hrs: WetHrs=  546: DryHrs= 8214: PTOT= 866.50}
      Maximum average rainfall intensities over
        1 hr    2 hrs    3 hrs    6 hrs   12 hrs   24 hrs   36 hrs   48 hrs   72 hrs
       34.90    22.00    14.67     7.33     5.14     2.63     1.75     1.31      .88    mm/hr
       34.90    44.00    44.00    44.00    61.70    63.00    63.00    63.00    63.00    mm
      19790616 19790616 19790616 19790616 19790914 19790915 19790915 19790915 19790917  date
      Number of rainfall events per following interevent time
        1 hr    2 hrs    3 hrs    6 hrs   12 hrs   24 hrs   36 hrs   48 hrs   72 hrs
         205      160      140      114       92       61       52       43       35
      Number of events with at least the following durations
        1 hr    2 hrs    3 hrs    6 hrs   12 hrs   24 hrs   36 hrs   48 hrs   72 hrs
         204       98       68       23        4        0        0        0        0
R0079:C00003------------------------------------------------------------------------------------------
     COMPUTE API
      [APIini= 50.00: APIkdy= .9000: APIkdt= .9956]
      {APImax= 78.45: APIavg= 23.13: APImin=   .13}
###############################################################################
# Pre Development Condition - Using NASHHYD and CN
###############################################################################
R0079:C00004------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    CONTINUOUS NASHYD    15.0 01:EastPre       39.35     .382 1979.0616_15:00  198.36 .229     .000
      [CN= 65.0: N= 3.00: Tp= 1.47]
      [IaREC= 6.00: SMIN= 54.78: SMAX=365.23: SK= .025]
      [InterEventTime=  12.00]
R0079:C00005------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    CONTINUOUS NASHYD    15.0 01:WestPre       39.85     .406 1979.0616_14:45  194.39 .224     .000
      [CN= 61.0: N= 3.00: Tp= 1.22]
      [IaREC= 6.00: SMIN= 64.50: SMAX=430.01: SK= .025]
      [InterEventTime=  12.00]
R0079:C00006------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ADD HYD              15.0 02:WestPre       39.85     .406 1979.0616_14:45  194.39  n/a     .000
                    +    15.0 02:EastPre       39.35     .382 1979.0616_15:00  198.36  n/a     .000
                 SUM=    15.0 01:Pre           79.20     .785 1979.0616_15:00  196.37  n/a     .000
###############################################################################
# Pre Development Condition - Using NASHHYD and CN - No INFILTRATION
###############################################################################
R0079:C00007------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    CONTINUOUS NASHYD    15.0 01:InfEastPre    39.35    1.379 1979.0616_15:00  400.19 .462     .000
      [CN=100.0: N= 3.00: Tp= 1.47]
      [IaREC= 6.00: SMIN=  1.39: SMAX=  9.24: SK= .025]
      [InterEventTime=  12.00]
R0079:C00008------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    CONTINUOUS NASHYD    15.0 01:InfWestPre    39.85    1.653 1979.0616_14:45  400.19 .462     .000
      [CN=100.0: N= 3.00: Tp= 1.22]
      [IaREC= 6.00: SMIN=  1.39: SMAX=  9.24: SK= .025]
      [InterEventTime=  12.00]
R0079:C00009------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ADD HYD              15.0 02:InfWestPre    39.85    1.653 1979.0616_14:45  400.19  n/a     .000
                    +    15.0 02:InfEastPre    39.35    1.379 1979.0616_15:00  400.19  n/a     .000
                 SUM=    15.0 01:InfPre        79.20    3.018 1979.0616_14:45  400.19  n/a     .000
###############################################################################
# STORMS
###############################################################################
  ** END OF RUN :   79

*****************************************************************************************************

 RUN#:COMMAND#
R0080:C00001------------------------------------------------------------------------------------------
     START
      [TZERO =    .00 hrs on 19800101]
      [METOUT=   2    (1=imperial, 2=metric output)]
      [NSTORM=   0 ]
      [NRUN  = 0080 ]
#******************************************************************************
#  SWMHYMO Ver:5.02/Jan 2001 <BETA> / INPUT DATA FILE
#******************************************************************************
#  Project Name  : [Caivan Stittsville West properties]
#  Project Number: [2267]
#  Date          : [2021/12/14]
#  Modeller      : [JB]
#  Company       : J.F. Sabourin and Associates
#  License #     : 2549237
#******************************************************************************
#******************************************************************************
# Ottawa International Airport (1967 - 2003)
R0080:C00002------------------------------------------------------------------------------------------
  *  READ AES DATA
      [Filename  = 6106000.123                                            ]
      [Start_date= 1980.0101: End_date= 1980.1230]
      {DT= 60.min: Length= 8760.hrs: WetHrs=  427: DryHrs= 8333: PTOT= 622.00}
      Maximum average rainfall intensities over
        1 hr    2 hrs    3 hrs    6 hrs   12 hrs   24 hrs   36 hrs   48 hrs   72 hrs
       15.00     9.20     6.50     4.72     3.23     1.83     1.35     1.01      .86    mm/hr
       15.00    18.40    19.50    28.30    38.80    43.80    48.60    48.60    62.00    mm
      19800830 19800830 19801025 19801025 19800321 19800322 19801026 19801027 19800902  date
      Number of rainfall events per following interevent time
        1 hr    2 hrs    3 hrs    6 hrs   12 hrs   24 hrs   36 hrs   48 hrs   72 hrs
         175      141      129      107       91       64       47       42       25
      Number of events with at least the following durations
        1 hr    2 hrs    3 hrs    6 hrs   12 hrs   24 hrs   36 hrs   48 hrs   72 hrs
         174       88       50       13        3        0        0        0        0
R0080:C00003------------------------------------------------------------------------------------------
     COMPUTE API
      [APIini= 50.00: APIkdy= .9000: APIkdt= .9956]
      {APImax= 68.74: APIavg= 17.50: APImin=   .06}
###############################################################################
# Pre Development Condition - Using NASHHYD and CN
###############################################################################
R0080:C00004------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    CONTINUOUS NASHYD    15.0 01:EastPre       39.35     .113 1980.0901_21:30   88.71 .143     .000
      [CN= 65.0: N= 3.00: Tp= 1.47]
      [IaREC= 6.00: SMIN= 54.78: SMAX=365.23: SK= .025]
      [InterEventTime=  12.00]
R0080:C00005------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    CONTINUOUS NASHYD    15.0 01:WestPre       39.85     .115 1980.0901_21:15   86.82 .140     .000
      [CN= 61.0: N= 3.00: Tp= 1.22]
      [IaREC= 6.00: SMIN= 64.50: SMAX=430.01: SK= .025]
      [InterEventTime=  12.00]
R0080:C00006------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ADD HYD              15.0 02:WestPre       39.85     .115 1980.0901_21:15   86.82  n/a     .000
                    +    15.0 02:EastPre       39.35     .113 1980.0901_21:30   88.71  n/a     .000
                 SUM=    15.0 01:Pre           79.20     .227 1980.0901_21:30   87.76  n/a     .000
###############################################################################
# Pre Development Condition - Using NASHHYD and CN - No INFILTRATION
###############################################################################
R0080:C00007------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    CONTINUOUS NASHYD    15.0 01:InfEastPre    39.35     .454 1980.1025_18:15  210.11 .338     .000
      [CN=100.0: N= 3.00: Tp= 1.47]
      [IaREC= 6.00: SMIN=  1.39: SMAX=  9.24: SK= .025]
      [InterEventTime=  12.00]
R0080:C00008------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    CONTINUOUS NASHYD    15.0 01:InfWestPre    39.85     .494 1980.1025_17:45  210.11 .338     .000
      [CN=100.0: N= 3.00: Tp= 1.22]
      [IaREC= 6.00: SMIN=  1.39: SMAX=  9.24: SK= .025]
      [InterEventTime=  12.00]
R0080:C00009------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ADD HYD              15.0 02:InfWestPre    39.85     .494 1980.1025_17:45  210.11  n/a     .000
                    +    15.0 02:InfEastPre    39.35     .454 1980.1025_18:15  210.11  n/a     .000
                 SUM=    15.0 01:InfPre        79.20     .940 1980.1025_18:00  210.11  n/a     .000
###############################################################################
# STORMS
###############################################################################
  ** END OF RUN :   80

*****************************************************************************************************

 RUN#:COMMAND#
R0081:C00001------------------------------------------------------------------------------------------
     START
      [TZERO =    .00 hrs on 19810101]
      [METOUT=   2    (1=imperial, 2=metric output)]
      [NSTORM=   0 ]
      [NRUN  = 0081 ]
#******************************************************************************
#  SWMHYMO Ver:5.02/Jan 2001 <BETA> / INPUT DATA FILE
#******************************************************************************
#  Project Name  : [Caivan Stittsville West properties]
#  Project Number: [2267]
#  Date          : [2021/12/14]
#  Modeller      : [JB]
#  Company       : J.F. Sabourin and Associates
#  License #     : 2549237
#******************************************************************************
#******************************************************************************
# Ottawa International Airport (1967 - 2003)
R0081:C00002------------------------------------------------------------------------------------------
  *  READ AES DATA
      [Filename  = 6106000.123                                            ]
      [Start_date= 1981.0101: End_date= 1981.1231]
      {DT= 60.min: Length= 8760.hrs: WetHrs=  641: DryHrs= 8119: PTOT= 936.40}
      Maximum average rainfall intensities over
        1 hr    2 hrs    3 hrs    6 hrs   12 hrs   24 hrs   36 hrs   48 hrs   72 hrs
       35.30    31.85    25.23    15.70     8.03     4.58     3.22     2.41     1.61    mm/hr
       35.30    63.70    75.70    94.20    96.40   110.00   115.90   115.90   115.90    mm
      19810805 19810805 19810805 19810805 19810805 19810805 19810806 19810806 19810807  date
      Number of rainfall events per following interevent time
        1 hr    2 hrs    3 hrs    6 hrs   12 hrs   24 hrs   36 hrs   48 hrs   72 hrs
         242      188      156      122       93       70       57       45       27
      Number of events with at least the following durations
        1 hr    2 hrs    3 hrs    6 hrs   12 hrs   24 hrs   36 hrs   48 hrs   72 hrs
         241      129       79       29        4        0        0        0        0
R0081:C00003------------------------------------------------------------------------------------------
     COMPUTE API
      [APIini= 50.00: APIkdy= .9000: APIkdt= .9956]
      {APImax=116.15: APIavg= 25.69: APImin=   .26}
###############################################################################
# Pre Development Condition - Using NASHHYD and CN
###############################################################################
R0081:C00004------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    CONTINUOUS NASHYD    15.0 01:EastPre       39.35    1.216 1981.0805_ 4:15  226.21 .242     .000
      [CN= 65.0: N= 3.00: Tp= 1.47]
      [IaREC= 6.00: SMIN= 54.78: SMAX=365.23: SK= .025]
      [InterEventTime=  12.00]
R0081:C00005------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    CONTINUOUS NASHYD    15.0 01:WestPre       39.85    1.206 1981.0805_ 3:30  222.76 .238     .000
      [CN= 61.0: N= 3.00: Tp= 1.22]
      [IaREC= 6.00: SMIN= 64.50: SMAX=430.01: SK= .025]
      [InterEventTime=  12.00]
R0081:C00006------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ADD HYD              15.0 02:WestPre       39.85    1.206 1981.0805_ 3:30  222.76  n/a     .000
                    +    15.0 02:EastPre       39.35    1.216 1981.0805_ 4:15  226.21  n/a     .000
                 SUM=    15.0 01:Pre           79.20    2.402 1981.0805_ 4:15  224.48  n/a     .000
###############################################################################
# Pre Development Condition - Using NASHHYD and CN - No INFILTRATION
###############################################################################
R0081:C00007------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    CONTINUOUS NASHYD    15.0 01:InfEastPre    39.35    2.274 1981.0805_ 3:00  399.82 .427     .000
      [CN=100.0: N= 3.00: Tp= 1.47]
      [IaREC= 6.00: SMIN=  1.39: SMAX=  9.24: SK= .025]
      [InterEventTime=  12.00]
R0081:C00008------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    CONTINUOUS NASHYD    15.0 01:InfWestPre    39.85    2.577 1981.0805_ 2:45  399.82 .427     .000
      [CN=100.0: N= 3.00: Tp= 1.22]
      [IaREC= 6.00: SMIN=  1.39: SMAX=  9.24: SK= .025]
      [InterEventTime=  12.00]
R0081:C00009------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ADD HYD              15.0 02:InfWestPre    39.85    2.577 1981.0805_ 2:45  399.82  n/a     .000
                    +    15.0 02:InfEastPre    39.35    2.274 1981.0805_ 3:00  399.82  n/a     .000
                 SUM=    15.0 01:InfPre        79.20    4.809 1981.0805_ 2:45  399.82  n/a     .000
###############################################################################
# STORMS
###############################################################################
  ** END OF RUN :   81

*****************************************************************************************************

 RUN#:COMMAND#
R0082:C00001------------------------------------------------------------------------------------------
     START
      [TZERO =    .00 hrs on 19820101]
      [METOUT=   2    (1=imperial, 2=metric output)]
      [NSTORM=   0 ]
      [NRUN  = 0082 ]
#******************************************************************************
#  SWMHYMO Ver:5.02/Jan 2001 <BETA> / INPUT DATA FILE
#******************************************************************************
#  Project Name  : [Caivan Stittsville West properties]
#  Project Number: [2267]
#  Date          : [2021/12/14]
#  Modeller      : [JB]
#  Company       : J.F. Sabourin and Associates
#  License #     : 2549237
#******************************************************************************
#******************************************************************************
# Ottawa International Airport (1967 - 2003)
R0082:C00002------------------------------------------------------------------------------------------
  *  READ AES DATA
      [Filename  = 6106000.123                                            ]
      [Start_date= 1982.0101: End_date= 1982.1231]
      {DT= 60.min: Length= 8760.hrs: WetHrs=  436: DryHrs= 8324: PTOT= 596.10}
      Maximum average rainfall intensities over
        1 hr    2 hrs    3 hrs    6 hrs   12 hrs   24 hrs   36 hrs   48 hrs   72 hrs
       19.80    10.75     7.60     5.83     3.36     1.68     1.12     1.01      .80    mm/hr
       19.80    21.50    22.80    35.00    40.30    40.30    40.30    48.70    57.30    mm
      19820801 19820901 19820825 19820825 19820825 19820826 19820826 19820825 19820825  date
      Number of rainfall events per following interevent time
        1 hr    2 hrs    3 hrs    6 hrs   12 hrs   24 hrs   36 hrs   48 hrs   72 hrs
         154      122      112       89       74       58       47       41       32
      Number of events with at least the following durations
        1 hr    2 hrs    3 hrs    6 hrs   12 hrs   24 hrs   36 hrs   48 hrs   72 hrs
         153       84       59       16        4        1        0        0        0
R0082:C00003------------------------------------------------------------------------------------------
     COMPUTE API
      [APIini= 50.00: APIkdy= .9000: APIkdt= .9956]
      {APImax= 56.86: APIavg= 16.78: APImin=   .03}
###############################################################################
# Pre Development Condition - Using NASHHYD and CN
###############################################################################
R0082:C00004------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    CONTINUOUS NASHYD    15.0 01:EastPre       39.35     .173 1982.0825_12:30   74.40 .125     .000
      [CN= 65.0: N= 3.00: Tp= 1.47]
      [IaREC= 6.00: SMIN= 54.78: SMAX=365.23: SK= .025]
      [InterEventTime=  12.00]
R0082:C00005------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    CONTINUOUS NASHYD    15.0 01:WestPre       39.85     .166 1982.0825_12:15   72.84 .122     .000
      [CN= 61.0: N= 3.00: Tp= 1.22]
      [IaREC= 6.00: SMIN= 64.50: SMAX=430.01: SK= .025]
      [InterEventTime=  12.00]
R0082:C00006------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ADD HYD              15.0 02:WestPre       39.85     .166 1982.0825_12:15   72.84  n/a     .000
                    +    15.0 02:EastPre       39.35     .173 1982.0825_12:30   74.40  n/a     .000
                 SUM=    15.0 01:Pre           79.20     .339 1982.0825_12:30   73.62  n/a     .000
###############################################################################
# Pre Development Condition - Using NASHHYD and CN - No INFILTRATION
###############################################################################
R0082:C00007------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    CONTINUOUS NASHYD    15.0 01:InfEastPre    39.35     .741 1982.0825_11:45  188.40 .316     .000
      [CN=100.0: N= 3.00: Tp= 1.47]
      [IaREC= 6.00: SMIN=  1.39: SMAX=  9.24: SK= .025]
      [InterEventTime=  12.00]
R0082:C00008------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    CONTINUOUS NASHYD    15.0 01:InfWestPre    39.85     .817 1982.0825_11:30  188.40 .316     .000
      [CN=100.0: N= 3.00: Tp= 1.22]
      [IaREC= 6.00: SMIN=  1.39: SMAX=  9.24: SK= .025]
      [InterEventTime=  12.00]
R0082:C00009------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ADD HYD              15.0 02:InfWestPre    39.85     .817 1982.0825_11:30  188.40  n/a     .000
                    +    15.0 02:InfEastPre    39.35     .741 1982.0825_11:45  188.40  n/a     .000
                 SUM=    15.0 01:InfPre        79.20    1.550 1982.0825_11:45  188.40  n/a     .000
###############################################################################
# STORMS
###############################################################################
  ** END OF RUN :   82

*****************************************************************************************************

 RUN#:COMMAND#
R0083:C00001------------------------------------------------------------------------------------------
     START
      [TZERO =    .00 hrs on 19830101]
      [METOUT=   2    (1=imperial, 2=metric output)]
      [NSTORM=   0 ]
      [NRUN  = 0083 ]
#******************************************************************************
#  SWMHYMO Ver:5.02/Jan 2001 <BETA> / INPUT DATA FILE
#******************************************************************************
#  Project Name  : [Caivan Stittsville West properties]
#  Project Number: [2267]
#  Date          : [2021/12/14]
#  Modeller      : [JB]
#  Company       : J.F. Sabourin and Associates
#  License #     : 2549237
#******************************************************************************
#******************************************************************************
# Ottawa International Airport (1967 - 2003)
R0083:C00002------------------------------------------------------------------------------------------
  *  READ AES DATA
      [Filename  = 6106000.123                                            ]
      [Start_date= 1983.0101: End_date= 1983.1231]
      {DT= 60.min: Length= 8760.hrs: WetHrs=  461: DryHrs= 8299: PTOT= 587.30}
      Maximum average rainfall intensities over
        1 hr    2 hrs    3 hrs    6 hrs   12 hrs   24 hrs   36 hrs   48 hrs   72 hrs
       10.40     9.70     7.53     5.43     3.27     2.32     1.67     1.32      .92    mm/hr
       10.40    19.40    22.60    32.60    39.20    55.70    60.00    63.20    66.30    mm
```

```
      19831004 19830921 19830921 19831005 19831005 19831005 19831006 19831006 19831008  date
      Number of rainfall events per following interevent time
        1 hr    2 hrs    3 hrs    6 hrs   12 hrs   24 hrs   36 hrs   48 hrs   72 hrs
         169      130      114       97       78       53       48       44       34
      Number of events with at least the following durations
        1 hr    2 hrs    3 hrs    6 hrs   12 hrs   24 hrs   36 hrs   48 hrs   72 hrs
         168       88       54       24        4        0        0        0        0
R0083:C00003----------------------------------------------------------------------------------
     COMPUTE API
      [APIini= 50.00: APIkdy= .9000: APIkdt= .9956]
      {APImax= 79.30: APIavg= 16.56: APImin=   .05}
################################################################################
# Pre Development Condition - Using NASHHYD and CN
################################################################################
R0083:C00004------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    CONTINUOUS NASHYD    15.0 01:EastPre       39.35     .215 1983.1005_17:15   78.00 .133     .000
      [CN= 65.0: N= 3.00: Tp= 1.47]
      [IaREC= 6.00: SMIN= 54.78: SMAX=365.23: SK= .025]
      [InterEventTime=  12.00]
R0083:C00005------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    CONTINUOUS NASHYD    15.0 01:WestPre       39.85     .204 1983.1005_16:30   76.54 .130     .000
      [CN= 61.0: N= 3.00: Tp= 1.22]
      [IaREC= 6.00: SMIN= 64.50: SMAX=430.01: SK= .025]
      [InterEventTime=  12.00]
R0083:C00006------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ADD HYD              15.0 02:WestPre       39.85     .204 1983.1005_16:30   76.54  n/a     .000
                    +    15.0 02:EastPre       39.35     .215 1983.1005_17:15   78.00  n/a     .000
                 SUM=    15.0 01:Pre           79.20     .416 1983.1005_17:00   77.26  n/a     .000
################################################################################
# Pre Development Condition - Using NASHHYD and CN - No INFILTRATION
################################################################################
R0083:C00007------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    CONTINUOUS NASHYD    15.0 01:InfEastPre    39.35     .663 1983.1005_16:30  174.51 .297     .000
      [CN=100.0: N= 3.00: Tp= 1.47]
      [IaREC= 6.00: SMIN=  1.39: SMAX=  9.24: SK= .025]
      [InterEventTime=  12.00]
R0083:C00008------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    CONTINUOUS NASHYD    15.0 01:InfWestPre    39.85     .735 1983.1005_16:00  174.51 .297     .000
      [CN=100.0: N= 3.00: Tp= 1.22]
      [IaREC= 6.00: SMIN=  1.39: SMAX=  9.24: SK= .025]
      [InterEventTime=  12.00]
R0083:C00009------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ADD HYD              15.0 02:InfWestPre    39.85     .735 1983.1005_16:00  174.51  n/a     .000
                    +    15.0 02:InfEastPre    39.35     .663 1983.1005_16:30  174.51  n/a     .000
                 SUM=    15.0 01:InfPre        79.20    1.391 1983.1005_16:15  174.51  n/a     .000
################################################################################
# STORMS
################################################################################
  ** END OF RUN :   83

**********************************************************************************************

 RUN#:COMMAND#
R0084:C00001----------------------------------------------------------------------------------
     START
      [TZERO =    .00 hrs on 19840101]
      [METOUT=   2    (1=imperial, 2=metric output)]
      [NSTORM=   0 ]
      [NRUN  = 0084 ]
#******************************************************************************
#  SWMHYMO Ver:5.02/Jan 2001 <BETA> / INPUT DATA FILE
#******************************************************************************
#  Project Name  : [Caivan Stittsville West properties]
#  Project Number: [2267]
#  Date          : [2021/12/14]
#  Modeller      : [JB]
#  Company       : J.F. Sabourin and Associates
#  License #     : 2549237
#******************************************************************************
#******************************************************************************
# Ottawa International Airport (1967 - 2003)
R0084:C00002----------------------------------------------------------------------------------
  *  READ AES DATA
      [Filename  = 6106000.123                                                ]
      [Start_date= 1984.0101: End_date= 1984.1230]
      {DT= 60.min: Length= 8760.hrs: WetHrs=  308: DryHrs= 8452: PTOT= 459.40}
      Maximum average rainfall intensities over
        1 hr    2 hrs    3 hrs    6 hrs   12 hrs   24 hrs   36 hrs   48 hrs   72 hrs
       17.80     9.70     7.57     4.33     3.01     1.84     1.58     1.19     1.00    mm/hr
       17.80    19.40    22.70    26.00    36.10    44.10    56.80    57.00    72.00    mm
      19840812 19840812 19840812 19840806 19840812 19840813 19840813 19840814 19840813  date
      Number of rainfall events per following interevent time
        1 hr    2 hrs    3 hrs    6 hrs   12 hrs   24 hrs   36 hrs   48 hrs   72 hrs
         108       87       81       68       59       46       39       34       26
      Number of events with at least the following durations
        1 hr    2 hrs    3 hrs    6 hrs   12 hrs   24 hrs   36 hrs   48 hrs   72 hrs
         107       60       39       11        4        0        0        0        0
R0084:C00003----------------------------------------------------------------------------------
     COMPUTE API
      [APIini= 50.00: APIkdy= .9000: APIkdt= .9956]
      {APImax= 86.65: APIavg= 13.22: APImin=   .00}
################################################################################
# Pre Development Condition - Using NASHHYD and CN
################################################################################
R0084:C00004------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    CONTINUOUS NASHYD    15.0 01:EastPre       39.35     .173 1984.0813_ 7:45   82.99 .181     .000
      [CN= 65.0: N= 3.00: Tp= 1.47]
      [IaREC= 6.00: SMIN= 54.78: SMAX=365.23: SK= .025]
      [InterEventTime=  12.00]
R0084:C00005------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    CONTINUOUS NASHYD    15.0 01:WestPre       39.85     .177 1984.0813_ 7:15   81.76 .178     .000
      [CN= 61.0: N= 3.00: Tp= 1.22]
      [IaREC= 6.00: SMIN= 64.50: SMAX=430.01: SK= .025]
      [InterEventTime=  12.00]
R0084:C00006------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ADD HYD              15.0 02:WestPre       39.85     .177 1984.0813_ 7:15   81.76  n/a     .000
                    +    15.0 02:EastPre       39.35     .173 1984.0813_ 7:45   82.99  n/a     .000
                 SUM=    15.0 01:Pre           79.20     .348 1984.0813_ 7:30   82.37  n/a     .000
################################################################################
# Pre Development Condition - Using NASHHYD and CN - No INFILTRATION
################################################################################
R0084:C00007------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    CONTINUOUS NASHYD    15.0 01:InfEastPre    39.35     .595 1984.0812_ 8:00  178.56 .389     .000
      [CN=100.0: N= 3.00: Tp= 1.47]
      [IaREC= 6.00: SMIN=  1.39: SMAX=  9.24: SK= .025]
      [InterEventTime=  12.00]
R0084:C00008------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    CONTINUOUS NASHYD    15.0 01:InfWestPre    39.85     .713 1984.0812_ 7:45  178.56 .389     .000
      [CN=100.0: N= 3.00: Tp= 1.22]
      [IaREC= 6.00: SMIN=  1.39: SMAX=  9.24: SK= .025]
      [InterEventTime=  12.00]
R0084:C00009------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ADD HYD              15.0 02:InfWestPre    39.85     .713 1984.0812_ 7:45  178.56  n/a     .000
                    +    15.0 02:InfEastPre    39.35     .595 1984.0812_ 8:00  178.56  n/a     .000
                 SUM=    15.0 01:InfPre        79.20    1.292 1984.0812_ 7:45  178.56  n/a     .000
################################################################################
# STORMS
################################################################################
  ** END OF RUN :   84

**********************************************************************************************

 RUN#:COMMAND#
R0085:C00001----------------------------------------------------------------------------------
     START
      [TZERO =    .00 hrs on 19850101]
      [METOUT=   2    (1=imperial, 2=metric output)]
      [NSTORM=   0 ]
      [NRUN  = 0085 ]
#******************************************************************************
#  SWMHYMO Ver:5.02/Jan 2001 <BETA> / INPUT DATA FILE
#******************************************************************************
#  Project Name  : [Caivan Stittsville West properties]
#  Project Number: [2267]
#  Date          : [2021/12/14]
#  Modeller      : [JB]
#  Company       : J.F. Sabourin and Associates
#  License #     : 2549237
#******************************************************************************
#******************************************************************************
# Ottawa International Airport (1967 - 2003)
R0085:C00002----------------------------------------------------------------------------------
  *  READ AES DATA
      [Filename  = 6106000.123                                                ]
      [Start_date= 1985.0101: End_date= 1985.1231]
      {DT= 60.min: Length= 8760.hrs: WetHrs=  354: DryHrs= 8406: PTOT= 559.90}
      Maximum average rainfall intensities over
        1 hr    2 hrs    3 hrs    6 hrs   12 hrs   24 hrs   36 hrs   48 hrs   72 hrs
       19.00    13.60     9.07     5.27     2.63     1.35     1.10      .82      .60    mm/hr
       19.00    27.20    27.20    31.60    31.60    32.30    39.60    39.60    43.10    mm
      19850716 19850617 19850617 19850618 19850618 19850224 19850619 19850619 19850225  date
      Number of rainfall events per following interevent time
        1 hr    2 hrs    3 hrs    6 hrs   12 hrs   24 hrs   36 hrs   48 hrs   72 hrs
         124       99       96       85       77       57       49       41       31
      Number of events with at least the following durations
        1 hr    2 hrs    3 hrs    6 hrs   12 hrs   24 hrs   36 hrs   48 hrs   72 hrs
         123       70       40       14        5        0        0        0        0
R0085:C00003----------------------------------------------------------------------------------
     COMPUTE API
      [APIini= 50.00: APIkdy= .9000: APIkdt= .9956]
      {APImax= 52.83: APIavg= 15.86: APImin=   .20}
################################################################################
# Pre Development Condition - Using NASHHYD and CN
################################################################################
R0085:C00004------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    CONTINUOUS NASHYD    15.0 01:EastPre       39.35     .109 1985.0618_ 0:00   85.30 .152     .000
      [CN= 65.0: N= 3.00: Tp= 1.47]
      [IaREC= 6.00: SMIN= 54.78: SMAX=365.23: SK= .025]
      [InterEventTime=  12.00]
R0085:C00005------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    CONTINUOUS NASHYD    15.0 01:WestPre       39.85     .113 1985.0617_23:45   83.69 .149     .000
      [CN= 61.0: N= 3.00: Tp= 1.22]
      [IaREC= 6.00: SMIN= 64.50: SMAX=430.01: SK= .025]
      [InterEventTime=  12.00]
R0085:C00006------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ADD HYD              15.0 02:WestPre       39.85     .113 1985.0617_23:45   83.68  n/a     .000
                    +    15.0 02:EastPre       39.35     .109 1985.0618_ 0:00   85.30  n/a     .000
                 SUM=    15.0 01:Pre           79.20     .218 1985.0617_23:45   84.49  n/a     .000
################################################################################
# Pre Development Condition - Using NASHHYD and CN - No INFILTRATION
################################################################################
R0085:C00007------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    CONTINUOUS NASHYD    15.0 01:InfEastPre    39.35     .691 1985.0617_23:45  218.00 .389     .000
      [CN=100.0: N= 3.00: Tp= 1.47]
      [IaREC= 6.00: SMIN=  1.39: SMAX=  9.24: SK= .025]
      [InterEventTime=  12.00]
R0085:C00008------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    CONTINUOUS NASHYD    15.0 01:InfWestPre    39.85     .817 1985.0617_23:30  218.00 .389     .000
      [CN=100.0: N= 3.00: Tp= 1.22]
      [IaREC= 6.00: SMIN=  1.39: SMAX=  9.24: SK= .025]
      [InterEventTime=  12.00]
R0085:C00009------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ADD HYD              15.0 02:InfWestPre    39.85     .817 1985.0617_23:30  218.00  n/a     .000
                    +    15.0 02:InfEastPre    39.35     .691 1985.0617_23:45  218.00  n/a     .000
                 SUM=    15.0 01:InfPre        79.20    1.500 1985.0617_23:45  218.00  n/a     .000
################################################################################
# STORMS
################################################################################
  ** END OF RUN :   85

**********************************************************************************************

 RUN#:COMMAND#
R0086:C00001----------------------------------------------------------------------------------
     START
      [TZERO =    .00 hrs on 19860101]
      [METOUT=   2    (1=imperial, 2=metric output)]
      [NSTORM=   0 ]
      [NRUN  = 0086 ]
#******************************************************************************
#  SWMHYMO Ver:5.02/Jan 2001 <BETA> / INPUT DATA FILE
#******************************************************************************
#  Project Name  : [Caivan Stittsville West properties]
#  Project Number: [2267]
#  Date          : [2021/12/14]
#  Modeller      : [JB]
#  Company       : J.F. Sabourin and Associates
#  License #     : 2549237
#******************************************************************************
#******************************************************************************
# Ottawa International Airport (1967 - 2003)
R0086:C00002----------------------------------------------------------------------------------
  *  READ AES DATA
      [Filename  = 6106000.123                                                ]
      [Start_date= 1986.0101: End_date= 1986.1231]
      {DT= 60.min: Length= 8040.hrs: WetHrs=  520: DryHrs= 7520: PTOT= 849.40}
      Maximum average rainfall intensities over
        1 hr    2 hrs    3 hrs    6 hrs   12 hrs   24 hrs   36 hrs   48 hrs   72 hrs
       18.30    17.80    13.57     7.07     4.93     2.93     2.32     1.82     1.31    mm/hr
       18.30    35.60    40.70    42.40    59.20    70.40    83.50    87.20    94.40    mm
      19860729 19860729 19860729 19860729 19860912 19860912 19860912 19860912 19860913  date
      Number of rainfall events per following interevent time
        1 hr    2 hrs    3 hrs    6 hrs   12 hrs   24 hrs   36 hrs   48 hrs   72 hrs
         201      161      149      118       88       61       51       47       30
      Number of events with at least the following durations
        1 hr    2 hrs    3 hrs    6 hrs   12 hrs   24 hrs   36 hrs   48 hrs   72 hrs
         200      107       73       22        1        0        0        0        0
R0086:C00003----------------------------------------------------------------------------------
     COMPUTE API
      [APIini= 50.00: APIkdy= .9000: APIkdt= .9956]
      {APImax= 97.05: APIavg= 25.30: APImin=   .17}
################################################################################
# Pre Development Condition - Using NASHHYD and CN
################################################################################
R0086:C00004------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    CONTINUOUS NASHYD    15.0 01:EastPre       39.35     .462 1986.0912_ 0:15  187.30 .221     .000
      [CN= 65.0: N= 3.00: Tp= 1.47]
      [IaREC= 6.00: SMIN= 54.78: SMAX=365.23: SK= .025]
      [InterEventTime=  12.00]
R0086:C00005------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    CONTINUOUS NASHYD    15.0 01:WestPre       39.85     .483 1986.0912_ 6:30  184.33 .217     .000
      [CN= 61.0: N= 3.00: Tp= 1.22]
      [IaREC= 6.00: SMIN= 64.50: SMAX=430.01: SK= .025]
      [InterEventTime=  12.00]
R0086:C00006------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ADD HYD              15.0 02:WestPre       39.85     .483 1986.0912_ 6:30  184.33  n/a     .000
                    +    15.0 02:EastPre       39.35     .462 1986.0912_ 0:15  187.30  n/a     .000
                 SUM=    15.0 01:Pre           79.20     .933 1986.0912_ 6:30  185.80  n/a     .000
################################################################################
# Pre Development Condition - Using NASHHYD and CN - No INFILTRATION
################################################################################
R0086:C00007------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    CONTINUOUS NASHYD    15.0 01:InfEastPre    39.35    1.126 1986.0729_16:00  349.35 .411     .000
      [CN=100.0: N= 3.00: Tp= 1.47]
      [IaREC= 6.00: SMIN=  1.39: SMAX=  9.24: SK= .025]
      [InterEventTime=  12.00]
R0086:C00008------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    CONTINUOUS NASHYD    15.0 01:InfWestPre    39.85    1.285 1986.0729_15:45  349.35 .411     .000
      [CN=100.0: N= 3.00: Tp= 1.22]
      [IaREC= 6.00: SMIN=  1.39: SMAX=  9.24: SK= .025]
      [InterEventTime=  12.00]
R0086:C00009------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ADD HYD              15.0 02:InfWestPre    39.85    1.285 1986.0729_15:45  349.35  n/a     .000
                    +    15.0 02:InfEastPre    39.35    1.126 1986.0729_16:00  349.35  n/a     .000
                 SUM=    15.0 01:InfPre        79.20    2.396 1986.0729_15:45  349.35  n/a     .000
################################################################################
# STORMS
################################################################################
  ** END OF RUN :   86

**********************************************************************************************

 RUN#:COMMAND#
R0087:C00001----------------------------------------------------------------------------------
     START
      [TZERO =    .00 hrs on 19870101]
      [METOUT=   2    (1=imperial, 2=metric output)]
      [NSTORM=   0 ]
      [NRUN  = 0087 ]
#******************************************************************************
#  SWMHYMO Ver:5.02/Jan 2001 <BETA> / INPUT DATA FILE
#******************************************************************************
#  Project Name  : [Caivan Stittsville West properties]
#  Project Number: [2267]
#  Date          : [2021/12/14]
#  Modeller      : [JB]
#  Company       : J.F. Sabourin and Associates
#  License #     : 2549237
#******************************************************************************
#******************************************************************************
# Ottawa International Airport (1967 - 2003)
R0087:C00002----------------------------------------------------------------------------------
  *  READ AES DATA
      [Filename  = 6106000.123                                                ]
      [Start_date= 1987.0101: End_date= 1987.1231]
      {DT= 60.min: Length= 7344.hrs: WetHrs=  491: DryHrs= 6853: PTOT= 639.90}
      Maximum average rainfall intensities over
        1 hr    2 hrs    3 hrs    6 hrs   12 hrs   24 hrs   36 hrs   48 hrs   72 hrs
       20.00    13.90    14.03     7.05     4.83     2.44     1.77     1.34      .93    mm/hr
       20.00    27.80    42.10    42.30    58.00    58.60    63.60    64.20    67.00    mm
      19870724 19870724 19870724 19870724 19870724 19870725 19870725 19870726 19870727  date
      Number of rainfall events per following interevent time
        1 hr    2 hrs    3 hrs    6 hrs   12 hrs   24 hrs   36 hrs   48 hrs   72 hrs
         207      163      145      107       85       58       46       36       27
      Number of events with at least the following durations
        1 hr    2 hrs    3 hrs    6 hrs   12 hrs   24 hrs   36 hrs   48 hrs   72 hrs
         206      100       59       16        2        0        0        0        0
R0087:C00003----------------------------------------------------------------------------------
     COMPUTE API
      [APIini= 50.00: APIkdy= .9000: APIkdt= .9956]
      {APImax= 75.38: APIavg= 21.40: APImin=  1.18}
################################################################################
# Pre Development Condition - Using NASHHYD and CN
################################################################################
R0087:C00004------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    CONTINUOUS NASHYD    15.0 01:EastPre       39.35     .298 1987.0724_15:45   92.27 .144     .000
      [CN= 65.0: N= 3.00: Tp= 1.47]
      [IaREC= 6.00: SMIN= 54.78: SMAX=365.23: SK= .025]
      [InterEventTime=  12.00]
R0087:C00005------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    CONTINUOUS NASHYD    15.0 01:WestPre       39.85     .303 1987.0724_15:45   90.24 .141     .000
      [CN= 61.0: N= 3.00: Tp= 1.22]
      [IaREC= 6.00: SMIN= 64.50: SMAX=430.01: SK= .025]
      [InterEventTime=  12.00]
```

```
R0087:C00006------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ADD HYD              15.0 02:WestPre       39.85      .303 1987.0724_15:45   90.24  n/a      .000
                    +    15.0 02:EastPre       39.35      .298 1987.0724_15:45   92.27  n/a      .000
                 SUM=    15.0 01:Pre           79.20      .601 1987.0724_15:45   91.25  n/a      .000
################################################################################
# Pre Development Condition - Using NASHHYD and CN - No INFILTRATION
################################################################################
R0087:C00007------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    CONTINUOUS NASHYD    15.0 01:InfEastPre    39.35     1.041 1987.0724_15:30  198.26 .310      .000
      [CN=100.0: N= 3.00: Tp= 1.47]
      [IaREC= 6.00: SMIN=  1.39: SMAX=  9.24: SK= .025]
      [InterEventTime=  12.00]
R0087:C00008------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    CONTINUOUS NASHYD    15.0 01:InfWestPre    39.85     1.152 1987.0724_15:15  198.26 .310      .000
      [CN=100.0: N= 3.00: Tp= 1.22]
      [IaREC= 6.00: SMIN=  1.39: SMAX=  9.24: SK= .025]
      [InterEventTime=  12.00]
R0087:C00009------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ADD HYD              15.0 02:InfWestPre    39.85     1.152 1987.0724_15:15  198.26  n/a      .000
                    +    15.0 02:InfEastPre    39.35     1.041 1987.0724_15:30  198.26  n/a      .000
                 SUM=    15.0 01:InfPre        79.20     2.181 1987.0724_15:30  198.26  n/a      .000
################################################################################
# STORMS
################################################################################
  ** END OF RUN :   87
*********************************************************************************************
 RUN#:COMMAND#
R0088:C00001---------------------------------------------------------------------------------
     START
      [TZERO =    .00 hrs on 19880101]
      [METOUT=   2    (1=imperial, 2=metric output)]
      [NSTORM=   0 ]
      [NRUN  = 0088 ]
#*******************************************************************************
#  SWMHYMO Ver:5.02/Jan 2001 <BETA> / INPUT DATA FILE
#*******************************************************************************
#  Project Name  : [Caivan Stittsville West properties]
#  Project Number: [2267]
#  Date          : [2021/12/14]
#  Modeller      : [JB]
#  Company       : J.F. Sabourin and Associates
#  License #     : 2549237
#*******************************************************************************
#*******************************************************************************
# Ottawa International Airport (1967 - 2003)
R0088:C00002---------------------------------------------------------------------------------
  *  READ AES DATA
      [Filename  = 6106000.123                                                ]
      [Start_date= 1988.0101: End_date= 1988.1230]
      {DT= 60.min: Length= 8760.hrs: WetHrs=  486: DryHrs= 8274: PTOT= 643.20}
      Maximum average rainfall intensities over
        1 hr    2 hrs    3 hrs    6 hrs   12 hrs   24 hrs   36 hrs   48 hrs   72 hrs
       25.50    18.20    12.77     7.37     3.78     1.91     1.27      .95      .94    mm/hr
       25.50    36.40    38.30    44.20    45.40    45.80    45.80    45.80    67.40    mm
      19880917 19880726 19880625 19880625 19880625 19880625 19880625 19880626 19880625  date
      Number of rainfall events per following interevent time
        1 hr    2 hrs    3 hrs    6 hrs   12 hrs   24 hrs   36 hrs   48 hrs   72 hrs
         183      141      121       85       68       56       48       41       25
      Number of events with at least the following durations
        1 hr    2 hrs    3 hrs    6 hrs   12 hrs   24 hrs   36 hrs   48 hrs   72 hrs
         182      101       70       19        3        0        0        0        0
R0088:C00003---------------------------------------------------------------------------------
     COMPUTE API
      [APIini= 50.00: APIkdy= .9000: APIkdt= .9956]
      {APImax= 66.19: APIavg= 18.05: APImin=   .03}
################################################################################
# Pre Development Condition - Using NASHHYD and CN
################################################################################
R0088:C00004------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    CONTINUOUS NASHYD    15.0 01:EastPre       39.35      .366 1988.0625_14:00  106.79 .166      .000
      [CN= 65.0: N= 3.00: Tp= 1.47]
      [IaREC= 6.00: SMIN= 54.78: SMAX=365.23: SK= .025]
      [InterEventTime=  12.00]
R0088:C00005------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    CONTINUOUS NASHYD    15.0 01:WestPre       39.85      .383 1988.0625_13:45  104.72 .163      .000
      [CN= 61.0: N= 3.00: Tp= 1.22]
      [IaREC= 6.00: SMIN= 64.50: SMAX=430.01: SK= .025]
      [InterEventTime=  12.00]
R0088:C00006------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ADD HYD              15.0 02:WestPre       39.85      .383 1988.0625_13:45  104.72  n/a      .000
                    +    15.0 02:EastPre       39.35      .366 1988.0625_14:00  106.79  n/a      .000
                 SUM=    15.0 01:Pre           79.20      .747 1988.0625_13:45  105.75  n/a      .000
################################################################################
# Pre Development Condition - Using NASHHYD and CN - No INFILTRATION
################################################################################
R0088:C00007------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    CONTINUOUS NASHYD    15.0 01:InfEastPre    39.35     1.214 1988.0625_13:30  224.71 .349      .000
      [CN=100.0: N= 3.00: Tp= 1.47]
      [IaREC= 6.00: SMIN=  1.39: SMAX=  9.24: SK= .025]
      [InterEventTime=  12.00]
R0088:C00008------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    CONTINUOUS NASHYD    15.0 01:InfWestPre    39.85     1.397 1988.0625_13:30  224.71 .349      .000
      [CN=100.0: N= 3.00: Tp= 1.22]
      [IaREC= 6.00: SMIN=  1.39: SMAX=  9.24: SK= .025]
      [InterEventTime=  12.00]
R0088:C00009------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ADD HYD              15.0 02:InfWestPre    39.85     1.397 1988.0625_13:30  224.71  n/a      .000
                    +    15.0 02:InfEastPre    39.35     1.214 1988.0625_13:30  224.71  n/a      .000
                 SUM=    15.0 01:InfPre        79.20     2.611 1988.0625_13:30  224.71  n/a      .000
################################################################################
# STORMS
################################################################################
  ** END OF RUN :   88
*********************************************************************************************
 RUN#:COMMAND#
R0089:C00001---------------------------------------------------------------------------------
     START
      [TZERO =    .00 hrs on 19890101]
      [METOUT=   2    (1=imperial, 2=metric output)]
      [NSTORM=   0 ]
      [NRUN  = 0089 ]
#*******************************************************************************
#  SWMHYMO Ver:5.02/Jan 2001 <BETA> / INPUT DATA FILE
#*******************************************************************************
#  Project Name  : [Caivan Stittsville West properties]
#  Project Number: [2267]
#  Date          : [2021/12/14]
#  Modeller      : [JB]
#  Company       : J.F. Sabourin and Associates
#  License #     : 2549237
#*******************************************************************************
#*******************************************************************************
# Ottawa International Airport (1967 - 2003)
R0089:C00002---------------------------------------------------------------------------------
  *  READ AES DATA
      [Filename  = 6106000.123                                                ]
      [Start_date= 1989.0101: End_date= 1989.1231]
      {DT= 60.min: Length= 8040.hrs: WetHrs=  421: DryHrs= 7619: PTOT= 522.50}
      Maximum average rainfall intensities over
        1 hr    2 hrs    3 hrs    6 hrs   12 hrs   24 hrs   36 hrs   48 hrs   72 hrs
       22.70    12.60     8.93     5.75     3.03     1.67     1.14      .86      .59    mm/hr
       22.70    25.20    26.80    34.50    36.30    40.20    40.90    41.50    42.50    mm
      19890727 19890727 19890727 19890727 19890727 19891020 19891021 19891022 19891022  date
      Number of rainfall events per following interevent time
        1 hr    2 hrs    3 hrs    6 hrs   12 hrs   24 hrs   36 hrs   48 hrs   72 hrs
         170      137      120      101       71       52       40       36       29
      Number of events with at least the following durations
        1 hr    2 hrs    3 hrs    6 hrs   12 hrs   24 hrs   36 hrs   48 hrs   72 hrs
         169       81       49       17        4        0        0        0        0
R0089:C00003---------------------------------------------------------------------------------
     COMPUTE API
      [APIini= 50.00: APIkdy= .9000: APIkdt= .9956]
      {APImax= 54.64: APIavg= 16.01: APImin=   .02}
################################################################################
# Pre Development Condition - Using NASHHYD and CN
################################################################################
R0089:C00004------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    CONTINUOUS NASHYD    15.0 01:EastPre       39.35      .144 1989.0727_16:30   66.36 .127      .000
      [CN= 65.0: N= 3.00: Tp= 1.47]
      [IaREC= 6.00: SMIN= 54.78: SMAX=365.23: SK= .025]
      [InterEventTime=  12.00]
R0089:C00005------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    CONTINUOUS NASHYD    15.0 01:WestPre       39.85      .145 1989.0727_16:00   64.85 .124      .000
      [CN= 61.0: N= 3.00: Tp= 1.22]
      [IaREC= 6.00: SMIN= 64.50: SMAX=430.01: SK= .025]
      [InterEventTime=  12.00]
R0089:C00006------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ADD HYD              15.0 02:WestPre       39.85      .145 1989.0727_16:00   64.85  n/a      .000
                    +    15.0 02:EastPre       39.35      .144 1989.0727_16:30   66.36  n/a      .000
                 SUM=    15.0 01:Pre           79.20      .288 1989.0727_16:15   65.60  n/a      .000
################################################################################
# Pre Development Condition - Using NASHHYD and CN - No INFILTRATION
################################################################################
R0089:C00007------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    CONTINUOUS NASHYD    15.0 01:InfEastPre    39.35      .822 1989.0727_16:15  165.82 .317      .000
      [CN=100.0: N= 3.00: Tp= 1.47]
      [IaREC= 6.00: SMIN=  1.39: SMAX=  9.24: SK= .025]
      [InterEventTime=  12.00]
R0089:C00008------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    CONTINUOUS NASHYD    15.0 01:InfWestPre    39.85      .969 1989.0727_15:45  165.82 .317      .000
      [CN=100.0: N= 3.00: Tp= 1.22]
      [IaREC= 6.00: SMIN=  1.39: SMAX=  9.24: SK= .025]
      [InterEventTime=  12.00]
R0089:C00009------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ADD HYD              15.0 02:InfWestPre    39.85      .969 1989.0727_15:45  165.82  n/a      .000
                    +    15.0 02:InfEastPre    39.35      .822 1989.0727_16:15  165.82  n/a      .000
                 SUM=    15.0 01:InfPre        79.20     1.784 1989.0727_16:00  165.82  n/a      .000
################################################################################
# STORMS
################################################################################
  ** END OF RUN :   89
*********************************************************************************************
 RUN#:COMMAND#
R0090:C00001---------------------------------------------------------------------------------
     START
      [TZERO =    .00 hrs on 19900101]
      [METOUT=   2    (1=imperial, 2=metric output)]
      [NSTORM=   0 ]
      [NRUN  = 0090 ]
#*******************************************************************************
#  SWMHYMO Ver:5.02/Jan 2001 <BETA> / INPUT DATA FILE
#*******************************************************************************
#  Project Name  : [Caivan Stittsville West properties]
#  Project Number: [2267]
#  Date          : [2021/12/14]
#  Modeller      : [JB]
#  Company       : J.F. Sabourin and Associates
#  License #     : 2549237
#*******************************************************************************
#*******************************************************************************
# Ottawa International Airport (1967 - 2003)
R0090:C00002---------------------------------------------------------------------------------
  *  READ AES DATA
      [Filename  = 6106000.123                                                ]
      [Start_date= 1990.0101: End_date= 1990.1231]
      {DT= 60.min: Length= 7344.hrs: WetHrs=  618: DryHrs= 6726: PTOT= 727.80}
      Maximum average rainfall intensities over
        1 hr    2 hrs    3 hrs    6 hrs   12 hrs   24 hrs   36 hrs   48 hrs   72 hrs
       20.60    12.25     9.60     5.55     4.43     2.25     1.50     1.21     1.06    mm/hr
       20.60    24.50    28.80    33.30    53.20    54.00    54.00    58.30    76.10    mm
      19900720 19900720 19900828 19900828 19900720 19900720 19900720 19900722 19900723  date
      Number of rainfall events per following interevent time
        1 hr    2 hrs    3 hrs    6 hrs   12 hrs   24 hrs   36 hrs   48 hrs   72 hrs
         225      170      153      121       94       68       55       47       33
      Number of events with at least the following durations
        1 hr    2 hrs    3 hrs    6 hrs   12 hrs   24 hrs   36 hrs   48 hrs   72 hrs
         224      116       72       30        6        0        0        0        0
R0090:C00003---------------------------------------------------------------------------------
     COMPUTE API
      [APIini= 50.00: APIkdy= .9000: APIkdt= .9956]
      {APImax= 74.68: APIavg= 23.47: APImin=  3.11}
################################################################################
# Pre Development Condition - Using NASHHYD and CN
################################################################################
R0090:C00004------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    CONTINUOUS NASHYD    15.0 01:EastPre       39.35      .335 1990.0720_14:15  128.16 .176      .000
      [CN= 65.0: N= 3.00: Tp= 1.47]
      [IaREC= 6.00: SMIN= 54.78: SMAX=365.23: SK= .025]
      [InterEventTime=  12.00]
R0090:C00005------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    CONTINUOUS NASHYD    15.0 01:WestPre       39.85      .336 1990.0720_14:00  126.49 .174      .000
      [CN= 61.0: N= 3.00: Tp= 1.22]
      [IaREC= 6.00: SMIN= 64.50: SMAX=430.01: SK= .025]
      [InterEventTime=  12.00]
R0090:C00006------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ADD HYD              15.0 02:WestPre       39.85      .336 1990.0720_14:00  126.49  n/a      .000
                    +    15.0 02:EastPre       39.35      .335 1990.0720_14:15  128.16  n/a      .000
                 SUM=    15.0 01:Pre           79.20      .670 1990.0720_14:15  127.32  n/a      .000
################################################################################
# Pre Development Condition - Using NASHHYD and CN - No INFILTRATION
################################################################################
R0090:C00007------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    CONTINUOUS NASHYD    15.0 01:InfEastPre    39.35      .726 1990.0720_ 6:15  265.07 .364      .000
      [CN=100.0: N= 3.00: Tp= 1.47]
      [IaREC= 6.00: SMIN=  1.39: SMAX=  9.24: SK= .025]
      [InterEventTime=  12.00]
R0090:C00008------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    CONTINUOUS NASHYD    15.0 01:InfWestPre    39.85      .851 1990.0720_ 6:00  265.07 .364      .000
      [CN=100.0: N= 3.00: Tp= 1.22]
      [IaREC= 6.00: SMIN=  1.39: SMAX=  9.24: SK= .025]
      [InterEventTime=  12.00]
R0090:C00009------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ADD HYD              15.0 02:InfWestPre    39.85      .851 1990.0720_ 6:00  265.07  n/a      .000
                    +    15.0 02:InfEastPre    39.35      .726 1990.0720_ 6:15  265.07  n/a      .000
                 SUM=    15.0 01:InfPre        79.20     1.573 1990.0720_ 6:00  265.07  n/a      .000
################################################################################
# STORMS
################################################################################
  ** END OF RUN :   90
*********************************************************************************************
 RUN#:COMMAND#
R0091:C00001---------------------------------------------------------------------------------
     START
      [TZERO =    .00 hrs on 19910101]
      [METOUT=   2    (1=imperial, 2=metric output)]
      [NSTORM=   0 ]
      [NRUN  = 0091 ]
#*******************************************************************************
#  SWMHYMO Ver:5.02/Jan 2001 <BETA> / INPUT DATA FILE
#*******************************************************************************
#  Project Name  : [Caivan Stittsville West properties]
#  Project Number: [2267]
#  Date          : [2021/12/14]
#  Modeller      : [JB]
#  Company       : J.F. Sabourin and Associates
#  License #     : 2549237
#*******************************************************************************
#*******************************************************************************
# Ottawa International Airport (1967 - 2003)
R0091:C00002---------------------------------------------------------------------------------
  *  READ AES DATA
      [Filename  = 6106000.123                                                ]
      [Start_date= 1991.0101: End_date= 1991.1231]
      {DT= 60.min: Length= 8040.hrs: WetHrs=  485: DryHrs= 7555: PTOT= 555.80}
      Maximum average rainfall intensities over
        1 hr    2 hrs    3 hrs    6 hrs   12 hrs   24 hrs   36 hrs   48 hrs   72 hrs
       11.30     6.05     4.40     3.77     2.32     1.59     1.28     1.08      .79    mm/hr
       11.30    12.10    13.20    22.60    27.80    38.20    46.00    51.60    56.80    mm
      19910409 19910409 19910409 19910410 19911016 19910422 19910410 19910410 19910423  date
      Number of rainfall events per following interevent time
        1 hr    2 hrs    3 hrs    6 hrs   12 hrs   24 hrs   36 hrs   48 hrs   72 hrs
         192      153      142      113       90       60       51       44       34
      Number of events with at least the following durations
        1 hr    2 hrs    3 hrs    6 hrs   12 hrs   24 hrs   36 hrs   48 hrs   72 hrs
         191       92       57       19        4        0        0        0        0
R0091:C00003---------------------------------------------------------------------------------
     COMPUTE API
      [APIini= 50.00: APIkdy= .9000: APIkdt= .9956]
      {APImax= 71.51: APIavg= 16.87: APImin=   .26}
################################################################################
# Pre Development Condition - Using NASHHYD and CN
################################################################################
R0091:C00004------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    CONTINUOUS NASHYD    15.0 01:EastPre       39.35      .154 1991.0410_ 4:00   66.42 .120      .000
      [CN= 65.0: N= 3.00: Tp= 1.47]
      [IaREC= 6.00: SMIN= 54.78: SMAX=365.23: SK= .025]
      [InterEventTime=  12.00]
R0091:C00005------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    CONTINUOUS NASHYD    15.0 01:WestPre       39.85      .156 1991.0410_ 3:45   65.09 .117      .000
      [CN= 61.0: N= 3.00: Tp= 1.22]
      [IaREC= 6.00: SMIN= 64.50: SMAX=430.01: SK= .025]
      [InterEventTime=  12.00]
R0091:C00006------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ADD HYD              15.0 02:WestPre       39.85      .156 1991.0410_ 3:45   65.09  n/a      .000
                    +    15.0 02:EastPre       39.35      .154 1991.0410_ 4:00   66.42  n/a      .000
                 SUM=    15.0 01:Pre           79.20      .309 1991.0410_ 4:00   65.75  n/a      .000
################################################################################
# Pre Development Condition - Using NASHHYD and CN - No INFILTRATION
################################################################################
R0091:C00007------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    CONTINUOUS NASHYD    15.0 01:InfEastPre    39.35      .477 1991.0410_ 4:00  157.28 .283      .000
      [CN=100.0: N= 3.00: Tp= 1.47]
      [IaREC= 6.00: SMIN=  1.39: SMAX=  9.24: SK= .025]
      [InterEventTime=  12.00]
R0091:C00008------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    CONTINUOUS NASHYD    15.0 01:InfWestPre    39.85      .541 1991.0410_ 3:45  157.28 .283      .000
      [CN=100.0: N= 3.00: Tp= 1.22]
      [IaREC= 6.00: SMIN=  1.39: SMAX=  9.24: SK= .025]
      [InterEventTime=  12.00]
R0091:C00009------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ADD HYD              15.0 02:InfWestPre    39.85      .541 1991.0410_ 3:45  157.28  n/a      .000
                    +    15.0 02:InfEastPre    39.35      .477 1991.0410_ 4:00  157.28  n/a      .000
                 SUM=    15.0 01:InfPre        79.20     1.012 1991.0410_ 3:45  157.28  n/a      .000
################################################################################
# STORMS
################################################################################
```

```
  ** END OF RUN :   91

 RUN#:COMMAND#
R0092:C00001-------------------------------------------------------------------------------
     START
       [TZERO =     .00 hrs on 19920101]
       [METOUT=   2    (1=imperial, 2=metric output)]
       [NSTORM=   0 ]
       [NRUN  = 0092 ]
##############################################################################
#  SWMHYMO Ver:5.02/Jan 2001 <BETA> / INPUT DATA FILE
##############################################################################
#  Project Name  : [Caivan Stittsville West properties]
#  Project Number: [2267]
#  Date          : [2021/12/14]
#  Modeller      : [JB]
#  Company       : J.F. Sabourin and Associates
#  License #     : 2549237
##############################################################################
# Ottawa International Airport (1967 - 2003)
R0092:C00002-------------------------------------------------------------------------------
  *  READ AES DATA
       [Filename  = 6106000.123                                                ]
       [Start_date= 1992.0101: End_date= 1992.1230]
       [DT= 60.min: Length= 8760.hrs: WetHrs=  550: DryHrs= 8210: PTOT= 730.20]
       Maximum average rainfall intensities over
         1 hr    2 hrs    3 hrs    6 hrs   12 hrs   24 hrs   36 hrs   48 hrs   72 hrs
        31.50    18.00    13.30     7.22     4.14     2.26     1.51     1.51     1.02    mm/hr
        31.50    36.00    39.90    43.30    49.70    54.20    54.20    72.60    73.60    mm
       19920804 19920804 19920804 19920804 19920717 19920718 19920718 19920719 19920720  date
       Number of rainfall events per following interevent time
         1 hr    2 hrs    3 hrs    6 hrs   12 hrs   24 hrs   36 hrs   48 hrs   72 hrs
          221      171      154      116       95       69       52       45       36
       Number of events with at least the following durations
         1 hr    2 hrs    3 hrs    6 hrs   12 hrs   24 hrs   36 hrs   48 hrs   72 hrs
          220      113       73       18        4        0        0        0        0
R0092:C00003-------------------------------------------------------------------------------
     COMPUTE API
       [APIini= 50.00: APIkdy= .9000: APIkdt= .9956]
       [APImax= 97.88: APIavg= 20.27: APImin=  1.07]
##############################################################################
# Pre Development Condition - Using NASHHYD and CN
##############################################################################
R0092:C00004-----------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    CONTINUOUS NASHYD     15.0 01:EastPre       39.35      .519 1992.0717_19:30  137.55 .188     .000
       [CN= 65.0: N= 3.00: Tp= 1.47]
       [IaREC= 6.00: SMIN= 54.78: SMAX=365.23: SK= .025]
       [InterEventTime=  12.00]
R0092:C00005-----------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    CONTINUOUS NASHYD     15.0 01:WestPre       39.85      .528 1992.0717_19:30  135.51 .186     .000
       [CN= 61.0: N= 3.00: Tp= 1.22]
       [IaREC= 6.00: SMIN= 64.50: SMAX=430.01: SK= .025]
       [InterEventTime=  12.00]
R0092:C00006-----------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ADD HYD               15.0 02:WestPre       39.85      .528 1992.0717_19:30  135.51  n/a     .000
                    +     15.0 02:EastPre       39.35      .519 1992.0717_19:30  137.55  n/a     .000
                  SUM=    15.0 01:Pre           79.20     1.047 1992.0717_19:30  136.52  n/a     .000
##############################################################################
# Pre Development Condition - Using NASHHYD and CN - No INFILTRATION
##############################################################################
R0092:C00007-----------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    CONTINUOUS NASHYD     15.0 01:InfEastPre    39.35     1.280 1992.0717_19:15  273.86 .375     .000
       [CN=100.0: N= 3.00: Tp= 1.47]
       [IaREC= 6.00: SMIN=  1.39: SMAX=  9.24: SK= .025]
       [InterEventTime=  12.00]
R0092:C00008-----------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    CONTINUOUS NASHYD     15.0 01:InfWestPre    39.85     1.453 1992.0804_14:45  273.86 .375     .000
       [CN=100.0: N= 3.00: Tp= 1.22]
       [IaREC= 6.00: SMIN=  1.39: SMAX=  9.24: SK= .025]
       [InterEventTime=  12.00]
R0092:C00009-----------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ADD HYD               15.0 02:InfWestPre    39.85     1.453 1992.0804_14:45  273.86  n/a     .000
                    +     15.0 02:InfEastPre    39.35     1.280 1992.0717_19:15  273.86  n/a     .000
                  SUM=    15.0 01:InfPre        79.20     2.699 1992.0717_19:00  273.86  n/a     .000
##############################################################################
# STORMS
##############################################################################
  ** END OF RUN :   92

 RUN#:COMMAND#
R0093:C00001-------------------------------------------------------------------------------
     START
       [TZERO =     .00 hrs on 19930101]
       [METOUT=   2    (1=imperial, 2=metric output)]
       [NSTORM=   0 ]
       [NRUN  = 0093 ]
##############################################################################
#  SWMHYMO Ver:5.02/Jan 2001 <BETA> / INPUT DATA FILE
##############################################################################
#  Project Name  : [Caivan Stittsville West properties]
#  Project Number: [2267]
#  Date          : [2021/12/14]
#  Modeller      : [JB]
#  Company       : J.F. Sabourin and Associates
#  License #     : 2549237
##############################################################################
# Ottawa International Airport (1967 - 2003)
R0093:C00002-------------------------------------------------------------------------------
  *  READ AES DATA
       [Filename  = 6106000.123                                                ]
       [Start_date= 1993.0101: End_date= 1993.1231]
       [DT= 60.min: Length= 8760.hrs: WetHrs=  584: DryHrs= 8176: PTOT= 721.10]
       Maximum average rainfall intensities over
         1 hr    2 hrs    3 hrs    6 hrs   12 hrs   24 hrs   36 hrs   48 hrs   72 hrs
        12.60     6.60     4.83     3.72     3.58     2.31     1.61     1.21      .81    mm/hr
        12.60    13.20    14.50    22.30    43.00    55.50    58.10    58.10    58.10    mm
       19930703 19930703 19931127 19931128 19931128 19931128 19931128 19931128 19931129  date
       Number of rainfall events per following interevent time
         1 hr    2 hrs    3 hrs    6 hrs   12 hrs   24 hrs   36 hrs   48 hrs   72 hrs
          190      154      137      111       91       73       57       48       34
       Number of events with at least the following durations
         1 hr    2 hrs    3 hrs    6 hrs   12 hrs   24 hrs   36 hrs   48 hrs   72 hrs
          189      110       66       27        7        2        0        0        0
R0093:C00003-------------------------------------------------------------------------------
     COMPUTE API
       [APIini= 50.00: APIkdy= .9000: APIkdt= .9956]
       [APImax= 66.42: APIavg= 20.01: APImin=  .11]
##############################################################################
# Pre Development Condition - Using NASHHYD and CN
##############################################################################
R0093:C00004-----------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    CONTINUOUS NASHYD     15.0 01:EastPre       39.35      .194 1993.1128_ 8:45   94.79 .131     .000
       [CN= 65.0: N= 3.00: Tp= 1.47]
       [IaREC= 6.00: SMIN= 54.78: SMAX=365.23: SK= .025]
       [InterEventTime=  12.00]
R0093:C00005-----------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    CONTINUOUS NASHYD     15.0 01:WestPre       39.85      .188 1993.1128_ 8:30   92.42 .128     .000
       [CN= 61.0: N= 3.00: Tp= 1.22]
       [IaREC= 6.00: SMIN= 64.50: SMAX=430.01: SK= .025]
       [InterEventTime=  12.00]
R0093:C00006-----------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ADD HYD               15.0 02:WestPre       39.85      .188 1993.1128_ 8:30   92.42  n/a     .000
                    +     15.0 02:EastPre       39.35      .194 1993.1128_ 8:45   94.79  n/a     .000
                  SUM=    15.0 01:Pre           79.20      .380 1993.1128_ 8:30   93.60  n/a     .000
##############################################################################
# Pre Development Condition - Using NASHHYD and CN - No INFILTRATION
##############################################################################
R0093:C00007-----------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    CONTINUOUS NASHYD     15.0 01:InfEastPre    39.35      .458 1993.1128_ 8:30  235.03 .326     .000
       [CN=100.0: N= 3.00: Tp= 1.47]
       [IaREC= 6.00: SMIN=  1.39: SMAX=  9.24: SK= .025]
       [InterEventTime=  12.00]
R0093:C00008-----------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    CONTINUOUS NASHYD     15.0 01:InfWestPre    39.85      .485 1993.1128_ 8:15  235.03 .326     .000
       [CN=100.0: N= 3.00: Tp= 1.22]
       [IaREC= 6.00: SMIN=  1.39: SMAX=  9.24: SK= .025]
       [InterEventTime=  12.00]
R0093:C00009-----------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ADD HYD               15.0 02:InfWestPre    39.85      .485 1993.1128_ 8:15  235.03  n/a     .000
                    +     15.0 02:InfEastPre    39.35      .458 1993.1128_ 8:30  235.03  n/a     .000
                  SUM=    15.0 01:InfPre        79.20      .941 1993.1128_ 8:15  235.03  n/a     .000
##############################################################################
# STORMS
##############################################################################
  ** END OF RUN :   93

 RUN#:COMMAND#
R0094:C00001-------------------------------------------------------------------------------
     START
       [TZERO =     .00 hrs on 19940101]
       [METOUT=   2    (1=imperial, 2=metric output)]
       [NSTORM=   0 ]
       [NRUN  = 0094 ]
##############################################################################
#  SWMHYMO Ver:5.02/Jan 2001 <BETA> / INPUT DATA FILE
##############################################################################
#  Project Name  : [Caivan Stittsville West properties]
#  Project Number: [2267]
#  Date          : [2021/12/14]
#  Modeller      : [JB]
#  Company       : J.F. Sabourin and Associates
#  License #     : 2549237
##############################################################################
# Ottawa International Airport (1967 - 2003)
R0094:C00002-------------------------------------------------------------------------------
  *  READ AES DATA
       [Filename  = 6106000.123                                                ]
       [Start_date= 1994.0101: End_date= 1994.1231]
       [DT= 60.min: Length= 8576.hrs: WetHrs=  328: DryHrs= 8248: PTOT= 527.00]
       Maximum average rainfall intensities over
         1 hr    2 hrs    3 hrs    6 hrs   12 hrs   24 hrs   36 hrs   48 hrs   72 hrs
        22.60    11.90     8.43     5.42     2.92     1.79     1.19      .89     1.15    mm/hr
        22.60    23.80    25.30    32.50    35.00    42.90    42.90    42.90    82.60    mm
       19940629 19940629 19940627 19940625 19940625 19940625 19940626 19940626 19940628  date
       Number of rainfall events per following interevent time
         1 hr    2 hrs    3 hrs    6 hrs   12 hrs   24 hrs   36 hrs   48 hrs   72 hrs
          131      110       96       75       60       46       37       32       23
       Number of events with at least the following durations
         1 hr    2 hrs    3 hrs    6 hrs   12 hrs   24 hrs   36 hrs   48 hrs   72 hrs
          130       70       46       12        1        0        0        0        0
R0094:C00003-------------------------------------------------------------------------------
     COMPUTE API
       [APIini= 50.00: APIkdy= .9000: APIkdt= .9956]
       [APImax= 97.84: APIavg= 19.15: APImin=  .02]
##############################################################################
# Pre Development Condition - Using NASHHYD and CN
##############################################################################
R0094:C00004-----------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    CONTINUOUS NASHYD     15.0 01:EastPre       39.35      .179 1994.0627_13:00  105.31 .200     .000
       [CN= 65.0: N= 3.00: Tp= 1.47]
       [IaREC= 6.00: SMIN= 54.78: SMAX=365.23: SK= .025]
       [InterEventTime=  12.00]
R0094:C00005-----------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    CONTINUOUS NASHYD     15.0 01:WestPre       39.85      .173 1994.0627_12:30  103.78 .197     .000
       [CN= 61.0: N= 3.00: Tp= 1.22]
       [IaREC= 6.00: SMIN= 64.50: SMAX=430.01: SK= .025]
       [InterEventTime=  12.00]
R0094:C00006-----------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ADD HYD               15.0 02:WestPre       39.85      .173 1994.0627_12:30  103.78  n/a     .000
                    +     15.0 02:EastPre       39.35      .179 1994.0627_13:00  105.31  n/a     .000
                  SUM=    15.0 01:Pre           79.20      .349 1994.0627_12:45  104.54  n/a     .000
##############################################################################
# Pre Development Condition - Using NASHHYD and CN - No INFILTRATION
##############################################################################
R0094:C00007-----------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    CONTINUOUS NASHYD     15.0 01:InfEastPre    39.35      .696 1994.0627_12:15  204.63 .388     .000
       [CN=100.0: N= 3.00: Tp= 1.47]
       [IaREC= 6.00: SMIN=  1.39: SMAX=  9.24: SK= .025]
       [InterEventTime=  12.00]
R0094:C00008-----------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    CONTINUOUS NASHYD     15.0 01:InfWestPre    39.85      .769 1994.0627_12:00  204.63 .388     .000
       [CN=100.0: N= 3.00: Tp= 1.22]
       [IaREC= 6.00: SMIN=  1.39: SMAX=  9.24: SK= .025]
       [InterEventTime=  12.00]
R0094:C00009-----------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ADD HYD               15.0 02:InfWestPre    39.85      .769 1994.0627_12:00  204.63  n/a     .000
                    +     15.0 02:InfEastPre    39.35      .696 1994.0627_12:15  204.63  n/a     .000
                  SUM=    15.0 01:InfPre        79.20     1.455 1994.0627_12:00  204.63  n/a     .000
##############################################################################
# STORMS
##############################################################################
  ** END OF RUN :   94

 RUN#:COMMAND#
R0095:C00001-------------------------------------------------------------------------------
     START
       [TZERO =     .00 hrs on 19950101]
       [METOUT=   2    (1=imperial, 2=metric output)]
       [NSTORM=   0 ]
       [NRUN  = 0095 ]
##############################################################################
#  SWMHYMO Ver:5.02/Jan 2001 <BETA> / INPUT DATA FILE
##############################################################################
#  Project Name  : [Caivan Stittsville West properties]
#  Project Number: [2267]
#  Date          : [2021/12/14]
#  Modeller      : [JB]
#  Company       : J.F. Sabourin and Associates
#  License #     : 2549237
##############################################################################
# Ottawa International Airport (1967 - 2003)
R0095:C00002-------------------------------------------------------------------------------
  *  READ AES DATA
       [Filename  = 6106000.123                                                ]
       [Start_date= 1995.0101: End_date= 1995.1231]
       [DT= 60.min: Length= 5112.hrs: WetHrs=  228: DryHrs= 4884: PTOT= 321.60]
       Maximum average rainfall intensities over
         1 hr    2 hrs    3 hrs    6 hrs   12 hrs   24 hrs   36 hrs   48 hrs   72 hrs
        16.90    13.25    10.27     7.70     6.32     3.31     2.21     1.65     1.10    mm/hr
        16.90    26.50    30.80    46.20    75.80    79.40    79.40    79.40    79.40    mm
       19950603 19950603 19950603 19950603 19950603 19950603 19950603 19950604 19950604  date
       Number of rainfall events per following interevent time
         1 hr    2 hrs    3 hrs    6 hrs   12 hrs   24 hrs   36 hrs   48 hrs   72 hrs
           67       55       48       38       35       29       24       22       18
       Number of events with at least the following durations
         1 hr    2 hrs    3 hrs    6 hrs   12 hrs   24 hrs   36 hrs   48 hrs   72 hrs
           66       37       23       10        5        1        0        0        0
R0095:C00003-------------------------------------------------------------------------------
     COMPUTE API
       [APIini= 50.00: APIkdy= .9000: APIkdt= .9956]
       [APImax= 95.54: APIavg= 16.52: APImin=  .49]
##############################################################################
# Pre Development Condition - Using NASHHYD and CN
##############################################################################
R0095:C00004-----------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    CONTINUOUS NASHYD     15.0 01:EastPre       39.35      .640 1995.0603_ 9:45   93.16 .290     .000
       [CN= 65.0: N= 3.00: Tp= 1.47]
       [IaREC= 6.00: SMIN= 54.78: SMAX=365.23: SK= .025]
       [InterEventTime=  12.00]
R0095:C00005-----------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    CONTINUOUS NASHYD     15.0 01:WestPre       39.85      .660 1995.0603_ 9:30   91.61 .285     .000
       [CN= 61.0: N= 3.00: Tp= 1.22]
       [IaREC= 6.00: SMIN= 64.50: SMAX=430.01: SK= .025]
       [InterEventTime=  12.00]
R0095:C00006-----------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ADD HYD               15.0 02:WestPre       39.85      .660 1995.0603_ 9:30   91.61  n/a     .000
                    +     15.0 02:EastPre       39.35      .640 1995.0603_ 9:45   93.16  n/a     .000
                  SUM=    15.0 01:Pre           79.20     1.290 1995.0603_ 9:30   92.38  n/a     .000
##############################################################################
# Pre Development Condition - Using NASHHYD and CN - No INFILTRATION
##############################################################################
R0095:C00007-----------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    CONTINUOUS NASHYD     15.0 01:InfEastPre    39.35      .898 1995.0603_ 9:30  158.70 .493     .000
       [CN=100.0: N= 3.00: Tp= 1.47]
       [IaREC= 6.00: SMIN=  1.39: SMAX=  9.24: SK= .025]
       [InterEventTime=  12.00]
R0095:C00008-----------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    CONTINUOUS NASHYD     15.0 01:InfWestPre    39.85      .988 1995.0603_ 9:15  158.70 .493     .000
       [CN=100.0: N= 3.00: Tp= 1.22]
       [IaREC= 6.00: SMIN=  1.39: SMAX=  9.24: SK= .025]
       [InterEventTime=  12.00]
R0095:C00009-----------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ADD HYD               15.0 02:InfWestPre    39.85      .988 1995.0603_ 9:15  158.70  n/a     .000
                    +     15.0 02:InfEastPre    39.35      .898 1995.0603_ 9:30  158.70  n/a     .000
                  SUM=    15.0 01:InfPre        79.20     1.879 1995.0603_ 9:30  158.70  n/a     .000
##############################################################################
# STORMS
##############################################################################
  ** END OF RUN :   95

 RUN#:COMMAND#
R0096:C00001-------------------------------------------------------------------------------
     START
       [TZERO =     .00 hrs on 19960101]
       [METOUT=   2    (1=imperial, 2=metric output)]
       [NSTORM=   0 ]
       [NRUN  = 0096 ]
##############################################################################
#  SWMHYMO Ver:5.02/Jan 2001 <BETA> / INPUT DATA FILE
##############################################################################
#  Project Name  : [Caivan Stittsville West properties]
#  Project Number: [2267]
#  Date          : [2021/12/14]
#  Modeller      : [JB]
#  Company       : J.F. Sabourin and Associates
#  License #     : 2549237
```

```
#****************************************************************************
#****************************************************************************
# Ottawa International Airport (1967 - 2003)
R0096:C00002------------------------------------------------------------------------------------
  *  READ AES DATA
      [Filename  = 6106000.123                                              ]
      [Start_date= 1996.0101: End_date= 1996.1230]
      {DT= 60.min: Length= 6552.hrs: WetHrs=  387: DryHrs= 6165: PTOT= 512.20}
      Maximum average rainfall intensities over
        1 hr    2 hrs    3 hrs    6 hrs   12 hrs   24 hrs   36 hrs   48 hrs   72 hrs
       18.50    13.55     9.03     5.42     2.93     1.84     1.32     1.02      .70    mm/hr
       18.50    27.10    27.10    32.50    35.10    44.10    47.50    49.00    50.30    mm
      19960731 19960731 19960731 19960731 19960731 19961109 19961109 19961109 19961109  date
      Number of rainfall events per following interevent time
        1 hr    2 hrs    3 hrs    6 hrs   12 hrs   24 hrs   36 hrs   48 hrs   72 hrs
         132      104       93       71       59       43       36       31       24
      Number of events with at least the following durations
        1 hr    2 hrs    3 hrs    6 hrs   12 hrs   24 hrs   36 hrs   48 hrs   72 hrs
         131       72       50       19        2        1        0        0        0
R0096:C00003------------------------------------------------------------------------------------
     COMPUTE API
      [APIini= 50.00: APIkdy= .9000: APIkdt= .9956]
      {APImax= 63.22: APIavg= 19.39: APImin=   .71}
#############################################################################
# Pre Development Condition - Using NASHHYD and CN
#############################################################################
R0096:C00004------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    CONTINUOUS NASHYD    15.0 01:EastPre       39.35     .154 1996.0731_16:45   74.44 .145     .000
      [CN= 65.0: N= 3.00: Tp= 1.47]
      [IaREC= 6.00: SMIN= 54.78: SMAX=365.23: SK= .025]
      [InterEventTime=  12.00]
R0096:C00005------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    CONTINUOUS NASHYD    15.0 01:WestPre       39.85     .157 1996.0731_16:30   72.91 .142     .000
      [CN= 61.0: N= 3.00: Tp= 1.22]
      [IaREC= 6.00: SMIN= 64.50: SMAX=430.01: SK= .025]
      [InterEventTime=  12.00]
R0096:C00006------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ADD HYD              15.0 02:WestPre       39.85     .157 1996.0731_16:30   72.91  n/a     .000
                    +    15.0 02:EastPre       39.35     .154 1996.0731_16:45   74.44  n/a     .000
                 SUM=    15.0 01:Pre           79.20     .307 1996.0731_16:45   73.67  n/a     .000
#############################################################################
# Pre Development Condition - Using NASHHYD and CN - No INFILTRATION
#############################################################################
R0096:C00007------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    CONTINUOUS NASHYD    15.0 01:InfEastPre    39.35     .751 1996.0731_16:30  172.97 .338     .000
      [CN=100.0: N= 3.00: Tp= 1.47]
      [IaREC= 6.00: SMIN=  1.39: SMAX=  9.24: SK= .025]
      [InterEventTime=  12.00]
R0096:C00008------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    CONTINUOUS NASHYD    15.0 01:InfWestPre    39.85     .872 1996.0731_16:15  172.97 .338     .000
      [CN=100.0: N= 3.00: Tp= 1.22]
      [IaREC= 6.00: SMIN=  1.39: SMAX=  9.24: SK= .025]
      [InterEventTime=  12.00]
R0096:C00009------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ADD HYD              15.0 02:InfWestPre    39.85     .872 1996.0731_16:15  172.97  n/a     .000
                    +    15.0 02:InfEastPre    39.35     .751 1996.0731_16:30  172.97  n/a     .000
                 SUM=    15.0 01:InfPre        79.20    1.606 1996.0731_16:30  172.97  n/a     .000
#############################################################################
# STORMS
#############################################################################
  ** END OF RUN :   96

*********************************************************************************************





 RUN#:COMMAND#
R0097:C00001------------------------------------------------------------------------------------
     START
      [TZERO =    .00 hrs on 19970101]
      [METOUT=   2    (1=imperial, 2=metric output)]
      [NSTORM=   0 ]
      [NRUN  = 0097 ]
#****************************************************************************
#  SWMHYMO Ver:5.02/Jan 2001 <BETA> / INPUT DATA FILE
#****************************************************************************
#  Project Name  : [Caivan Stittsville West properties]
#  Project Number: [2267]
#  Date          : [2021/12/14]
#  Modeller      : [JB]
#  Company       : J.F. Sabourin and Associates
#  License #     : 2549237
#****************************************************************************
#****************************************************************************
# Ottawa International Airport (1967 - 2003)
R0097:C00002------------------------------------------------------------------------------------
  *  READ AES DATA
      [Filename  = 6106000.123                                              ]
      [Start_date= 1997.0101: End_date= 1997.1231]
      {DT= 60.min: Length= 8040.hrs: WetHrs=  379: DryHrs= 7661: PTOT= 433.20}
      Maximum average rainfall intensities over
        1 hr    2 hrs    3 hrs    6 hrs   12 hrs   24 hrs   36 hrs   48 hrs   72 hrs
       12.50     7.60     5.67     4.43     2.91     1.68     1.12      .84      .63    mm/hr
       12.50    15.20    17.00    26.60    34.90    40.40    40.40    40.40    45.30    mm
      19970622 19970622 19970622 19970221 19970222 19970222 19970222 19970222 19970222  date
      Number of rainfall events per following interevent time
        1 hr    2 hrs    3 hrs    6 hrs   12 hrs   24 hrs   36 hrs   48 hrs   72 hrs
         113       92       83       67       61       55       48       43       30
      Number of events with at least the following durations
        1 hr    2 hrs    3 hrs    6 hrs   12 hrs   24 hrs   36 hrs   48 hrs   72 hrs
         112       70       46       20        4        0        0        0        0
R0097:C00003------------------------------------------------------------------------------------
     COMPUTE API
      [APIini= 50.00: APIkdy= .9000: APIkdt= .9956]
      {APImax= 50.00: APIavg= 13.66: APImin=   .27}
#############################################################################
# Pre Development Condition - Using NASHHYD and CN
#############################################################################
R0097:C00004------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    CONTINUOUS NASHYD    15.0 01:EastPre       39.35     .103 1997.0221_21:45   51.06 .118     .000
      [CN= 65.0: N= 3.00: Tp= 1.47]
      [IaREC= 6.00: SMIN= 54.78: SMAX=365.23: SK= .025]
      [InterEventTime=  12.00]
R0097:C00005------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    CONTINUOUS NASHYD    15.0 01:WestPre       39.85     .100 1997.0222_ 1:45   49.93 .115     .000
      [CN= 61.0: N= 3.00: Tp= 1.22]
      [IaREC= 6.00: SMIN= 64.50: SMAX=430.01: SK= .025]
      [InterEventTime=  12.00]
R0097:C00006------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ADD HYD              15.0 02:WestPre       39.85     .100 1997.0222_ 1:45   49.93  n/a     .000
                    +    15.0 02:EastPre       39.35     .103 1997.0221_21:45   51.06  n/a     .000
                 SUM=    15.0 01:Pre           79.20     .201 1997.0221_21:45   50.49  n/a     .000
#############################################################################
# Pre Development Condition - Using NASHHYD and CN - No INFILTRATION
#############################################################################
R0097:C00007------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    CONTINUOUS NASHYD    15.0 01:InfEastPre    39.35     .515 1997.0221_21:30  142.50 .329     .000
      [CN=100.0: N= 3.00: Tp= 1.47]
      [IaREC= 6.00: SMIN=  1.39: SMAX=  9.24: SK= .025]
      [InterEventTime=  12.00]
R0097:C00008------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    CONTINUOUS NASHYD    15.0 01:InfWestPre    39.85     .549 1997.0221_21:15  142.50 .329     .000
      [CN=100.0: N= 3.00: Tp= 1.22]
      [IaREC= 6.00: SMIN=  1.39: SMAX=  9.24: SK= .025]
      [InterEventTime=  12.00]
R0097:C00009------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ADD HYD              15.0 02:InfWestPre    39.85     .549 1997.0221_21:15  142.50  n/a     .000
                    +    15.0 02:InfEastPre    39.35     .515 1997.0221_21:30  142.50  n/a     .000
                 SUM=    15.0 01:InfPre        79.20    1.064 1997.0221_21:15  142.50  n/a     .000
#############################################################################
# STORMS
#############################################################################
  ** END OF RUN :   97

*********************************************************************************************





 RUN#:COMMAND#
R0098:C00001------------------------------------------------------------------------------------
     START
      [TZERO =    .00 hrs on 19980101]
      [METOUT=   2    (1=imperial, 2=metric output)]
      [NSTORM=   0 ]
      [NRUN  = 0098 ]
#****************************************************************************
#  SWMHYMO Ver:5.02/Jan 2001 <BETA> / INPUT DATA FILE
#****************************************************************************
#  Project Name  : [Caivan Stittsville West properties]
#  Project Number: [2267]
#  Date          : [2021/12/14]
#  Modeller      : [JB]
#  Company       : J.F. Sabourin and Associates
#  License #     : 2549237
#****************************************************************************
#****************************************************************************
# Ottawa International Airport (1967 - 2003)
R0098:C00002------------------------------------------------------------------------------------
  *  READ AES DATA
      [Filename  = 6106000.123                                              ]
      [Start_date= 1998.0101: End_date= 1998.1231]
      {DT= 60.min: Length= 5088.hrs: WetHrs=  291: DryHrs= 4797: PTOT= 440.30}
      Maximum average rainfall intensities over
        1 hr    2 hrs    3 hrs    6 hrs   12 hrs   24 hrs   36 hrs   48 hrs   72 hrs
       15.80     8.90     7.60     4.00     2.54     1.82     1.27      .95      .76    mm/hr
       15.80    17.80    22.80    24.00    30.50    43.60    45.80    45.80    54.60    mm
      19980716 19980627 19980927 19980927 19980927 19980927 19980928 19980928 19980615  date
      Number of rainfall events per following interevent time
        1 hr    2 hrs    3 hrs    6 hrs   12 hrs   24 hrs   36 hrs   48 hrs   72 hrs
         126      104       95       78       63       42       37       32       21
      Number of events with at least the following durations
        1 hr    2 hrs    3 hrs    6 hrs   12 hrs   24 hrs   36 hrs   48 hrs   72 hrs
         125       64       43        8        1        0        0        0        0
R0098:C00003------------------------------------------------------------------------------------
     COMPUTE API
      [APIini= 50.00: APIkdy= .9000: APIkdt= .9956]
      {APImax= 57.22: APIavg= 21.28: APImin=  1.69}
#############################################################################
# Pre Development Condition - Using NASHHYD and CN
#############################################################################
R0098:C00004------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    CONTINUOUS NASHYD    15.0 01:EastPre       39.35     .099 1998.0927_15:15   59.11 .134     .000
      [CN= 65.0: N= 3.00: Tp= 1.47]
      [IaREC= 6.00: SMIN= 54.78: SMAX=365.23: SK= .025]
      [InterEventTime=  12.00]
R0098:C00005------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    CONTINUOUS NASHYD    15.0 01:WestPre       39.85     .103 1998.0927_15:00   58.17 .132     .000
      [CN= 61.0: N= 3.00: Tp= 1.22]
      [IaREC= 6.00: SMIN= 64.50: SMAX=430.01: SK= .025]
      [InterEventTime=  12.00]
R0098:C00006------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ADD HYD              15.0 02:WestPre       39.85     .103 1998.0927_15:00   58.17  n/a     .000
                    +    15.0 02:EastPre       39.35     .099 1998.0927_15:15   59.11  n/a     .000
                 SUM=    15.0 01:Pre           79.20     .202 1998.0927_15:15   58.64  n/a     .000
#############################################################################
# Pre Development Condition - Using NASHHYD and CN - No INFILTRATION
#############################################################################
R0098:C00007------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    CONTINUOUS NASHYD    15.0 01:InfEastPre    39.35     .500 1998.0927_ 3:30  142.49 .324     .000
      [CN=100.0: N= 3.00: Tp= 1.47]
      [IaREC= 6.00: SMIN=  1.39: SMAX=  9.24: SK= .025]
      [InterEventTime=  12.00]
R0098:C00008------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    CONTINUOUS NASHYD    15.0 01:InfWestPre    39.85     .547 1998.0627_ 1:45  142.49 .324     .000
      [CN=100.0: N= 3.00: Tp= 1.22]
      [IaREC= 6.00: SMIN=  1.39: SMAX=  9.24: SK= .025]
      [InterEventTime=  12.00]
R0098:C00009------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ADD HYD              15.0 02:InfWestPre    39.85     .547 1998.0627_ 1:45  142.49  n/a     .000
                    +    15.0 02:InfEastPre    39.35     .500 1998.0927_ 3:30  142.49  n/a     .000
                 SUM=    15.0 01:InfPre        79.20    1.038 1998.0927_ 3:15  142.49  n/a     .000
#############################################################################
# STORMS
#############################################################################
  ** END OF RUN :   98

*********************************************************************************************





 RUN#:COMMAND#
R0099:C00001------------------------------------------------------------------------------------
     START
      [TZERO =    .00 hrs on 19990101]
      [METOUT=   2    (1=imperial, 2=metric output)]
      [NSTORM=   0 ]
      [NRUN  = 0099 ]
#****************************************************************************
#  SWMHYMO Ver:5.02/Jan 2001 <BETA> / INPUT DATA FILE
#****************************************************************************
#  Project Name  : [Caivan Stittsville West properties]
#  Project Number: [2267]
#  Date          : [2021/12/14]
#  Modeller      : [JB]
#  Company       : J.F. Sabourin and Associates
#  License #     : 2549237
#****************************************************************************
#****************************************************************************
# Ottawa International Airport (1967 - 2003)
R0099:C00002------------------------------------------------------------------------------------
  *  READ AES DATA
      [Filename  = 6106000.123                                              ]
      [Start_date= 1999.0101: End_date= 1999.1231]
      {DT= 60.min: Length= 4440.hrs: WetHrs=  247: DryHrs= 4193: PTOT= 424.40}
      Maximum average rainfall intensities over
        1 hr    2 hrs    3 hrs    6 hrs   12 hrs   24 hrs   36 hrs   48 hrs   72 hrs
       17.50    10.10     9.03     6.57     3.31     1.65     1.45     1.22      .97    mm/hr
       17.50    20.20    27.10    39.40    39.70    39.70    52.20    58.60    69.50    mm
      19990717 19990717 19990906 19990906 19990906 19990906 19990907 19990908 19990908  date
      Number of rainfall events per following interevent time
        1 hr    2 hrs    3 hrs    6 hrs   12 hrs   24 hrs   36 hrs   48 hrs   72 hrs
         102       80       70       63       56       39       31       28       18
      Number of events with at least the following durations
        1 hr    2 hrs    3 hrs    6 hrs   12 hrs   24 hrs   36 hrs   48 hrs   72 hrs
         101       57       31       10        1        0        0        0        0
R0099:C00003------------------------------------------------------------------------------------
     COMPUTE API
      [APIini= 50.00: APIkdy= .9000: APIkdt= .9956]
      {APImax= 69.51: APIavg= 23.97: APImin=  1.93}
#############################################################################
# Pre Development Condition - Using NASHHYD and CN
#############################################################################
R0099:C00004------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    CONTINUOUS NASHYD    15.0 01:EastPre       39.35     .160 1999.0906_10:30   66.40 .156     .000
      [CN= 65.0: N= 3.00: Tp= 1.47]
      [IaREC= 6.00: SMIN= 54.78: SMAX=365.23: SK= .025]
      [InterEventTime=  12.00]
R0099:C00005------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    CONTINUOUS NASHYD    15.0 01:WestPre       39.85     .152 1999.0906_10:15   65.46 .154     .000
      [CN= 61.0: N= 3.00: Tp= 1.22]
      [IaREC= 6.00: SMIN= 64.50: SMAX=430.01: SK= .025]
      [InterEventTime=  12.00]
R0099:C00006------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ADD HYD              15.0 02:WestPre       39.85     .152 1999.0906_10:15   65.46  n/a     .000
                    +    15.0 02:EastPre       39.35     .160 1999.0906_10:30   66.40  n/a     .000
                 SUM=    15.0 01:Pre           79.20     .312 1999.0906_10:15   65.93  n/a     .000
#############################################################################
# Pre Development Condition - Using NASHHYD and CN - No INFILTRATION
#############################################################################
R0099:C00007------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    CONTINUOUS NASHYD    15.0 01:InfEastPre    39.35     .769 1999.0906_ 9:30  151.02 .356     .000
      [CN=100.0: N= 3.00: Tp= 1.47]
      [IaREC= 6.00: SMIN=  1.39: SMAX=  9.24: SK= .025]
      [InterEventTime=  12.00]
R0099:C00008------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    CONTINUOUS NASHYD    15.0 01:InfWestPre    39.85     .839 1999.0906_ 9:15  151.02 .356     .000
      [CN=100.0: N= 3.00: Tp= 1.22]
      [IaREC= 6.00: SMIN=  1.39: SMAX=  9.24: SK= .025]
      [InterEventTime=  12.00]
R0099:C00009------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ADD HYD              15.0 02:InfWestPre    39.85     .839 1999.0906_ 9:15  151.02  n/a     .000
                    +    15.0 02:InfEastPre    39.35     .769 1999.0906_ 9:30  151.02  n/a     .000
                 SUM=    15.0 01:InfPre        79.20    1.602 1999.0906_ 9:15  151.02  n/a     .000
#############################################################################
# STORMS
#############################################################################
  ** END OF RUN :   99

*********************************************************************************************





 RUN#:COMMAND#
R0100:C00001------------------------------------------------------------------------------------
     START
      [TZERO =    .00 hrs on 20000101]
      [METOUT=   2    (1=imperial, 2=metric output)]
      [NSTORM=   0 ]
      [NRUN  = 0100 ]
#****************************************************************************
#  SWMHYMO Ver:5.02/Jan 2001 <BETA> / INPUT DATA FILE
#****************************************************************************
#  Project Name  : [Caivan Stittsville West properties]
#  Project Number: [2267]
#  Date          : [2021/12/14]
#  Modeller      : [JB]
#  Company       : J.F. Sabourin and Associates
#  License #     : 2549237
#****************************************************************************
#****************************************************************************
# Ottawa International Airport (1967 - 2003)
R0100:C00002------------------------------------------------------------------------------------
  *  READ AES DATA
      [Filename  = 6106000.123                                              ]
      [Start_date= 2000.0101: End_date= 2000.1230]
      {DT= 60.min: Length= 5160.hrs: WetHrs=  401: DryHrs= 4759: PTOT= 535.90}
      Maximum average rainfall intensities over
        1 hr    2 hrs    3 hrs    6 hrs   12 hrs   24 hrs   36 hrs   48 hrs   72 hrs
       14.70     9.60     8.03     6.43     3.89     1.95     1.30     1.03      .84    mm/hr
       14.70    19.20    24.10    38.60    46.70    46.70    46.80    49.30    60.40    mm
      20000625 20000625 20000625 20000625 20000625 20000625 20000626 20000510 20000511  date
      Number of rainfall events per following interevent time
        1 hr    2 hrs    3 hrs    6 hrs   12 hrs   24 hrs   36 hrs   48 hrs   72 hrs
         156      125      110       86       67       46       34       30       23
      Number of events with at least the following durations
        1 hr    2 hrs    3 hrs    6 hrs   12 hrs   24 hrs   36 hrs   48 hrs   72 hrs
         155       82       49       16        2        0        0        0        0
R0100:C00003------------------------------------------------------------------------------------
     COMPUTE API
      [APIini= 50.00: APIkdy= .9000: APIkdt= .9956]
      {APImax= 76.65: APIavg= 25.66: APImin=  5.70}
#############################################################################
```

```
02881> # Pre Development Condition - Using NASHHYD and CN
02882> ##############################################################################
02883> R0100:C00004------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
02884>      CONTINUOUS NASHYD    15.0 01:EastPre       39.35     .359 2000.0625_11:00   85.69 .160     .000
02885>        [CN= 65.0: N= 3.00: Tp= 1.47]
02886>        [IaREC= 6.00: SMIN= 54.78: SMAX=365.23: SK= .025]
02887>        [InterEventTime=  12.00]
02888> R0100:C00005------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
02889>      CONTINUOUS NASHYD    15.0 01:WestPre       39.85     .369 2000.0625_10:45   84.05 .157     .000
02890>        [CN= 61.0: N= 3.00: Tp= 1.22]
02891>        [IaREC= 6.00: SMIN= 64.50: SMAX=430.01: SK= .025]
02892>        [InterEventTime=  12.00]
02893> R0100:C00006------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
02894>      ADD HYD              15.0 02:WestPre       39.85     .369 2000.0625_10:45   84.05  n/a     .000
02895>                       +   15.0 02:EastPre       39.35     .359 2000.0625_11:00   85.69  n/a     .000
02896>                     SUM=   15.0 01:Pre          79.20     .728 2000.0625_10:45   84.87  n/a     .000
02897> ##############################################################################
02898> # Pre Development Condition - Using NASHHYD and CN - No INFILTRATION
02899> ##############################################################################
02900> R0100:C00007------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
02901>      CONTINUOUS NASHYD    15.0 01:InfEastPre    39.35     .863 2000.0625_10:45  192.84 .360     .000
02902>        [CN=100.0: N= 3.00: Tp= 1.47]
02903>        [IaREC= 6.00: SMIN=  1.39: SMAX=  9.24: SK= .025]
02904>        [InterEventTime=  12.00]
02905> R0100:C00008------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
02906>      CONTINUOUS NASHYD    15.0 01:InfWestPre    39.85     .960 2000.0625_10:30  192.84 .360     .000
02907>        [CN=100.0: N= 3.00: Tp= 1.22]
02908>        [IaREC= 6.00: SMIN=  1.39: SMAX=  9.24: SK= .025]
02909>        [InterEventTime=  12.00]
02910> R0100:C00009------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
02911>      ADD HYD              15.0 02:InfWestPre    39.85     .960 2000.0625_10:30  192.84  n/a     .000
02912>                       +   15.0 02:InfEastPre    39.35     .863 2000.0625_10:45  192.84  n/a     .000
02913>                     SUM=   15.0 01:InfPre       79.20    1.820 2000.0625_10:30  192.84  n/a     .000
02914> ##############################################################################
02915> # STORMS
02916> ##############################################################################
02917>   ** END OF RUN :  101
02918>
02919> ******************************************************************************************************
02920>
02921>
02922>
02923>
02924>
02925>  RUN#:COMMAND#
02926> R0102:C00001------------------------------------------------------------------------------------------
02927>       START
02928>         [TZERO =    .00 hrs on 20020101]
02929>         [METOUT=   2    (1=imperial, 2=metric output)]
02930>         [NSTORM=   0 ]
02931>         [NRUN  = 0102 ]
02932> ##############################################################################
02933> #  SWMHYMO Ver:5.02/Jan 2001 <BETA> / INPUT DATA FILE
02934> ##############################################################################
02935> #  Project Name  : [Caivan Stittsville West properties]
02936> #  Project Number: [2267]
02937> #  Date          : [2021/12/14]
02938> #  Modeller      : [JB]
02939> #  Company       : J.F. Sabourin and Associates
02940> #  License #     : 2549237
02941> ##############################################################################
02942> ##############################################################################
02943> # Ottawa International Airport (1967 - 2003)
02944> R0102:C00002------------------------------------------------------------------------------------------
02945>   *  READ AES DATA
02946>         [Filename  = 6106000.123                                                 ]
02947>         [Start_date= 2002.0101: End_date= 2002.1231]
02948>         [DT= 60.min: Length= 5088.hrs: WetHrs=  304: DryHrs= 4784: PTOT= 551.50)
02949>         Maximum average rainfall intensities over
02950>           1 hr    2 hrs    3 hrs    6 hrs   12 hrs   24 hrs   36 hrs   48 hrs   72 hrs
02951>         45.00    26.75    18.40     9.48     4.74     2.48     2.08     1.56     1.04    mm/hr
02952>         45.00    53.50    55.20    56.90    56.90    59.50    74.90    74.90    74.90    mm
02953>       20020627 20020627 20020627 20020627 20020627 20020627 20020627 20020627 20020628 20020629  date
02954>       Number of rainfall events per following interevent time
02955>         1 hr    2 hrs    3 hrs    6 hrs   12 hrs   24 hrs   36 hrs   48 hrs   72 hrs
02956>          100       83       78       56       47       41       36       34       25
02957>       Number of events with at least the following durations
02958>         1 hr    2 hrs    3 hrs    6 hrs   12 hrs   24 hrs   36 hrs   48 hrs   72 hrs
02959>          100       59       33       13        5        0        0        0        0
02960> R0102:C00003------------------------------------------------------------------------------------------
02961>       COMPUTE API
02962>         [APIini= 50.00: APIkdt= .9000: APIkdt= .9956]
02963>         [APImax=114.06: APIavg= 26.37: APImin=  4.40]
02964> ##############################################################################
02965> # Pre Development Condition - Using NASHHYD and CN
02966> ##############################################################################
02967> R0102:C00004------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
02968>      CONTINUOUS NASHYD    15.0 01:EastPre       39.35     .783 2002.0627_15:15  159.97 .290     .000
02969>        [CN= 65.0: N= 3.00: Tp= 1.47]
02970>        [IaREC= 6.00: SMIN= 54.78: SMAX=365.23: SK= .025]
02971>        [InterEventTime=  12.00]
02972> R0102:C00005------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
02973>      CONTINUOUS NASHYD    15.0 01:WestPre       39.85     .844 2002.0627_15:00  158.24 .287     .000
02974>        [CN= 61.0: N= 3.00: Tp= 1.22]
02975>        [IaREC= 6.00: SMIN= 64.50: SMAX=430.01: SK= .025]
02976>        [InterEventTime=  12.00]
02977> R0102:C00006------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
02978>      ADD HYD              15.0 02:WestPre       39.85     .844 2002.0627_15:00  158.24  n/a     .000
02979>                       +   15.0 02:EastPre       39.35     .783 2002.0627_15:15  159.97  n/a     .000
02980>                     SUM=   15.0 01:Pre          79.20    1.625 2002.0627_15:00  159.10  n/a     .000
02981> ##############################################################################
02982> # Pre Development Condition - Using NASHHYD and CN - No INFILTRATION
02983> ##############################################################################
02984> R0102:C00007------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
02985>      CONTINUOUS NASHYD    15.0 01:InfEastPre    39.35    1.819 2002.0627_15:00  273.41 .496     .000
02986>        [CN=100.0: N= 3.00: Tp= 1.47]
02987>        [IaREC= 6.00: SMIN=  1.39: SMAX=  9.24: SK= .025]
02988>        [InterEventTime=  12.00]
02989> R0102:C00008------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
02990>      CONTINUOUS NASHYD    15.0 01:InfWestPre    39.85    2.169 2002.0627_14:45  273.41 .496     .000
02991>        [CN=100.0: N= 3.00: Tp= 1.22]
02992>        [IaREC= 6.00: SMIN=  1.39: SMAX=  9.24: SK= .025]
02993>        [InterEventTime=  12.00]
02994> R0102:C00009------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
02995>      ADD HYD              15.0 02:InfWestPre    39.85    2.169 2002.0627_14:45  273.41  n/a     .000
02996>                       +   15.0 02:InfEastPre    39.35    1.819 2002.0627_15:00  273.41  n/a     .000
02997>                     SUM=   15.0 01:InfPre       79.20    3.961 2002.0627_14:45  273.41  n/a     .000
02998> ##############################################################################
02999> # STORMS
03000> ##############################################################################
03001>   ** END OF RUN :  102
03002>
03003> ******************************************************************************************************
03004>
03005>
03006>
03007>
03008>
03009>  RUN#:COMMAND#
03010> R0103:C00001------------------------------------------------------------------------------------------
03011>       START
03012>         [TZERO =    .00 hrs on 20030101]
03013>         [METOUT=   2    (1=imperial, 2=metric output)]
03014>         [NSTORM=   0 ]
03015>         [NRUN  = 0103 ]
03016> ##############################################################################
03017> #  SWMHYMO Ver:5.02/Jan 2001 <BETA> / INPUT DATA FILE
03018> ##############################################################################
03019> #  Project Name  : [Caivan Stittsville West properties]
03020> #  Project Number: [2267]
03021> #  Date          : [2021/12/14]
03022> #  Modeller      : [JB]
03023> #  Company       : J.F. Sabourin and Associates
03024> #  License #     : 2549237
03025> ##############################################################################
03026> ##############################################################################
03027> # Ottawa International Airport (1967 - 2003)
03028> R0103:C00002------------------------------------------------------------------------------------------
03029>   *  READ AES DATA
03030>         [Filename  = 6106000.123                                                 ]
03031>         [Start_date= 2003.0101: End_date= 2003.1231]
03032>         [DT= 60.min: Length= 4440.hrs: WetHrs=  406: DryHrs= 4034: PTOT= 554.60)
03033>         Maximum average rainfall intensities over
03034>           1 hr    2 hrs    3 hrs    6 hrs   12 hrs   24 hrs   36 hrs   48 hrs   72 hrs
03035>         15.10    10.00     7.13     4.28     3.18     1.86     1.25      .94      .81    mm/hr
03036>         15.10    20.00    21.40    25.70    38.20    44.60    44.90    45.10    58.30    mm
03037>       20030711 20030711 20030711 20030711 20031021 20031015 20030525 20030526 20030527  date
03038>       Number of rainfall events per following interevent time
03039>         1 hr    2 hrs    3 hrs    6 hrs   12 hrs   24 hrs   36 hrs   48 hrs   72 hrs
03040>          145      127      109       86       64       45       38       25       15
03041>       Number of events with at least the following durations
03042>         1 hr    2 hrs    3 hrs    6 hrs   12 hrs   24 hrs   36 hrs   48 hrs   72 hrs
03043>          144       80       43       13        5        1        0        0        0
03044> R0103:C00003------------------------------------------------------------------------------------------
03045>       COMPUTE API
03046>         [APIini= 50.00: APIkdt= .9000: APIkdt= .9956]
03047>         [APImax= 72.10: APIavg= 28.54: APImin=  4.70]
03048> ##############################################################################
03049> # Pre Development Condition - Using NASHHYD and CN
03050> ##############################################################################
03051> R0103:C00004------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
03052>      CONTINUOUS NASHYD    15.0 01:EastPre       39.35     .235 2003.0711_18:00  111.68 .201     .000
03053>        [CN= 65.0: N= 3.00: Tp= 1.47]
03054>        [IaREC= 6.00: SMIN= 54.78: SMAX=365.23: SK= .025]
03055>        [InterEventTime=  12.00]
03056> R0103:C00005------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
03057>      CONTINUOUS NASHYD    15.0 01:WestPre       39.85     .244 2003.0711_17:45  109.00 .197     .000
03058>        [CN= 61.0: N= 3.00: Tp= 1.22]
03059>        [IaREC= 6.00: SMIN= 64.50: SMAX=430.01: SK= .025]
03060>        [InterEventTime=  12.00]
03061> R0103:C00006------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
03062>      ADD HYD              15.0 02:WestPre       39.85     .244 2003.0711_17:45  109.00  n/a     .000
03063>                       +   15.0 02:EastPre       39.35     .235 2003.0711_18:00  111.68  n/a     .000
03064>                     SUM=   15.0 01:Pre          79.20     .476 2003.0711_17:45  110.33  n/a     .000
03065> ##############################################################################
03066> # Pre Development Condition - Using NASHHYD and CN - No INFILTRATION
03067> ##############################################################################
03068> R0103:C00007------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
03069>      CONTINUOUS NASHYD    15.0 01:InfEastPre    39.35     .778 2003.0711_17:45  231.08 .417     .000
03070>        [CN=100.0: N= 3.00: Tp= 1.47]
03071>        [IaREC= 6.00: SMIN=  1.39: SMAX=  9.24: SK= .025]
03072>        [InterEventTime=  12.00]
03073> R0103:C00008------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
03074>      CONTINUOUS NASHYD    15.0 01:InfWestPre    39.85     .903 2003.0711_17:30  231.08 .417     .000
03075>        [CN=100.0: N= 3.00: Tp= 1.22]
03076>        [IaREC= 6.00: SMIN=  1.39: SMAX=  9.24: SK= .025]
03077>        [InterEventTime=  12.00]
03078> R0103:C00009------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
03079>      ADD HYD              15.0 02:InfWestPre    39.85     .903 2003.0711_17:30  231.08  n/a     .000
03080>                       +   15.0 02:InfEastPre    39.35     .778 2003.0711_17:45  231.08  n/a     .000
03081>                     SUM=   15.0 01:InfPre       79.20    1.663 2003.0711_17:45  231.08  n/a     .000
03082> ##############################################################################
03083> # STORMS
03084> ##############################################################################
03085> R0103:C00002------------------------------------------------------------------------------------------
03086>   FINISH
03087> ------------------------------------------------------------------------------------------------------
03088> ******************************************************************************************************
03089>      WARNINGS / ERRORS / NOTES
03090>      -------------------------
03091> R0067:C00002  READ AES DATA
03092> *** WARNING: Requested start date is less than start date in file.
03093> *** WARNING: Missing rainfall increments were set to 0.
03094> *** WARNING: Missing rainfall increments were set to 0.
03095> *** WARNING: Missing rainfall increments were set to 0.
03096> *** WARNING: Requested start date is less than start date in file.
03097> *** WARNING: Missing rainfall increments were set to 0.
03098> *** WARNING: Missing rainfall increments were set to 0.
03099> *** WARNING: Missing rainfall increments were set to 0.
03100> *** WARNING: Missing rainfall increments were set to 0.
03101> *** WARNING: Missing rainfall increments were set to 0.
03102> *** WARNING: Missing rainfall increments were set to 0.
03103> *** WARNING: Missing rainfall increments were set to 0.
03104> *** WARNING: Requested start date is less than start date in file.
03105> *** WARNING: Missing rainfall increments were set to 0.
03106> *** WARNING: Missing rainfall increments were set to 0.
03107> *** WARNING: Missing rainfall increments were set to 0.
03108> *** WARNING: Missing rainfall increments were set to 0.
03109> *** WARNING: Missing rainfall increments were set to 0.
03110> *** WARNING: Missing rainfall increments were set to 0.
03111> *** WARNING: Missing rainfall increments were set to 0.
03112> *** WARNING: Missing rainfall increments were set to 0.
03113> *** WARNING: Missing rainfall increments were set to 0.
03114> *** WARNING: Missing rainfall increments were set to 0.
03115> *** WARNING: Requested start date is less than start date in file.
03116> *** WARNING: Missing rainfall increments were set to 0.
03117> *** WARNING: Missing rainfall increments were set to 0.
03118> *** WARNING: Missing rainfall increments were set to 0.
03119> *** WARNING: Requested start date is less than start date in file.
03120> *** WARNING: Missing rainfall increments were set to 0.
03121> *** WARNING: Missing rainfall increments were set to 0.
03122> *** WARNING: Missing rainfall increments were set to 0.
03123> *** WARNING: Missing rainfall increments were set to 0.
03124> *** WARNING: Missing rainfall increments were set to 0.
03125> *** WARNING: Missing rainfall increments were set to 0.
03126> *** WARNING: Requested start date is less than start date in file.
03127> *** WARNING: Missing rainfall increments were set to 0.
03128> *** WARNING: Missing rainfall increments were set to 0.
03129> *** WARNING: Requested start date is less than start date in file.
03130> *** WARNING: Missing rainfall increments were set to 0.
03131> *** WARNING: Requested start date is less than start date in file.
03132> *** WARNING: Missing rainfall increments were set to 0.
03133> *** WARNING: Requested start date is less than start date in file.
03134> *** WARNING: Missing rainfall increments were set to 0.
03135> *** WARNING: Requested start date is less than start date in file.
03136> *** WARNING: Missing rainfall increments were set to 0.
03137> *** WARNING: Requested start date is less than start date in file.
03138> *** WARNING: Specified end date is beyond the end date in file.
03139> *** WARNING: Missing rainfall increments were set to 0.
03140>    Simulation ended on 2023-01-25     at 12:51:51
03141> ------------------------------------------------------------------------------------------------------
03142>
```

Table B3 - Pre Development Water Budget

Year	Precipitation (mm)	Evaporation (mm)	Evaporation (%)	Infiltration (mm)	Infiltration (%)	Runoff (mm)	Runoff (%)
1967	386.9	213.7	55%	87.7	23%	85.5	22%
1968	592.8	356.7	60%	127.2	21%	108.9	18%
1969	569.8	359.1	63%	121.0	21%	89.7	16%
1970	558.9	358.6	64%	111.3	20%	89.0	16%
1971	522.1	361.4	69%	92.4	18%	68.3	13%
1972	784.3	441.3	56%	152.7	19%	190.3	24%
1973	744.9	435.8	59%	168.0	23%	141.1	19%
1974	386.2	281.2	73%	62.6	16%	42.4	11%
1975	535.5	338.7	63%	107.8	20%	89.0	17%
1976	492.4	348.6	71%	84.3	17%	59.5	12%
1977	677.6	430.6	64%	137.5	20%	109.5	16%
1978	638.8	408.5	64%	143.5	22%	86.9	14%
1979	866.5	466.3	54%	203.8	24%	196.4	23%
1980	622	411.9	66%	122.4	20%	87.8	14%
1981	936.4	536.6	57%	175.3	19%	224.5	24%
1982	596.1	407.7	68%	114.8	19%	73.6	12%
1983	587.3	412.8	70%	97.3	17%	77.3	13%
1984	459.4	280.8	61%	96.2	21%	82.4	18%
1985	559.9	341.9	61%	133.5	24%	84.5	15%
1986	849.4	500.1	59%	163.6	19%	185.8	22%
1987	639.9	441.6	69%	107.0	17%	91.3	14%
1988	643.2	418.5	65%	119.0	18%	105.8	16%
1989	522.5	356.7	68%	100.2	19%	65.6	13%
1990	727.8	462.7	64%	137.8	19%	127.3	17%
1991	555.8	398.5	72%	91.5	16%	65.8	12%
1992	730.2	456.3	62%	137.3	19%	136.5	19%
1993	721.1	486.1	67%	141.4	20%	93.6	13%
1994	527	322.4	61%	100.1	19%	104.5	20%
1995	321.6	162.9	51%	66.3	21%	92.4	29%
1996	512.2	339.2	66%	99.3	19%	73.7	14%
1997	433.2	290.7	67%	92.0	21%	50.5	12%
1998	440.3	297.8	68%	83.9	19%	58.6	13%
1999	424.4	273.4	64%	85.1	20%	65.9	16%
2000	535.9	343.1	64%	108.0	20%	84.9	16%
2002	551.5	278.1	50%	114.3	21%	159.1	29%
2003	554.6	323.5	58%	120.8	22%	110.3	20%
Average	589.1	370.7	63%	116.9	20%	101.6	17%
Min	321.6	162.9	50%	62.6	16%	42.4	11%
Max	936.4	536.6	73%	203.8	24%	224.5	29%

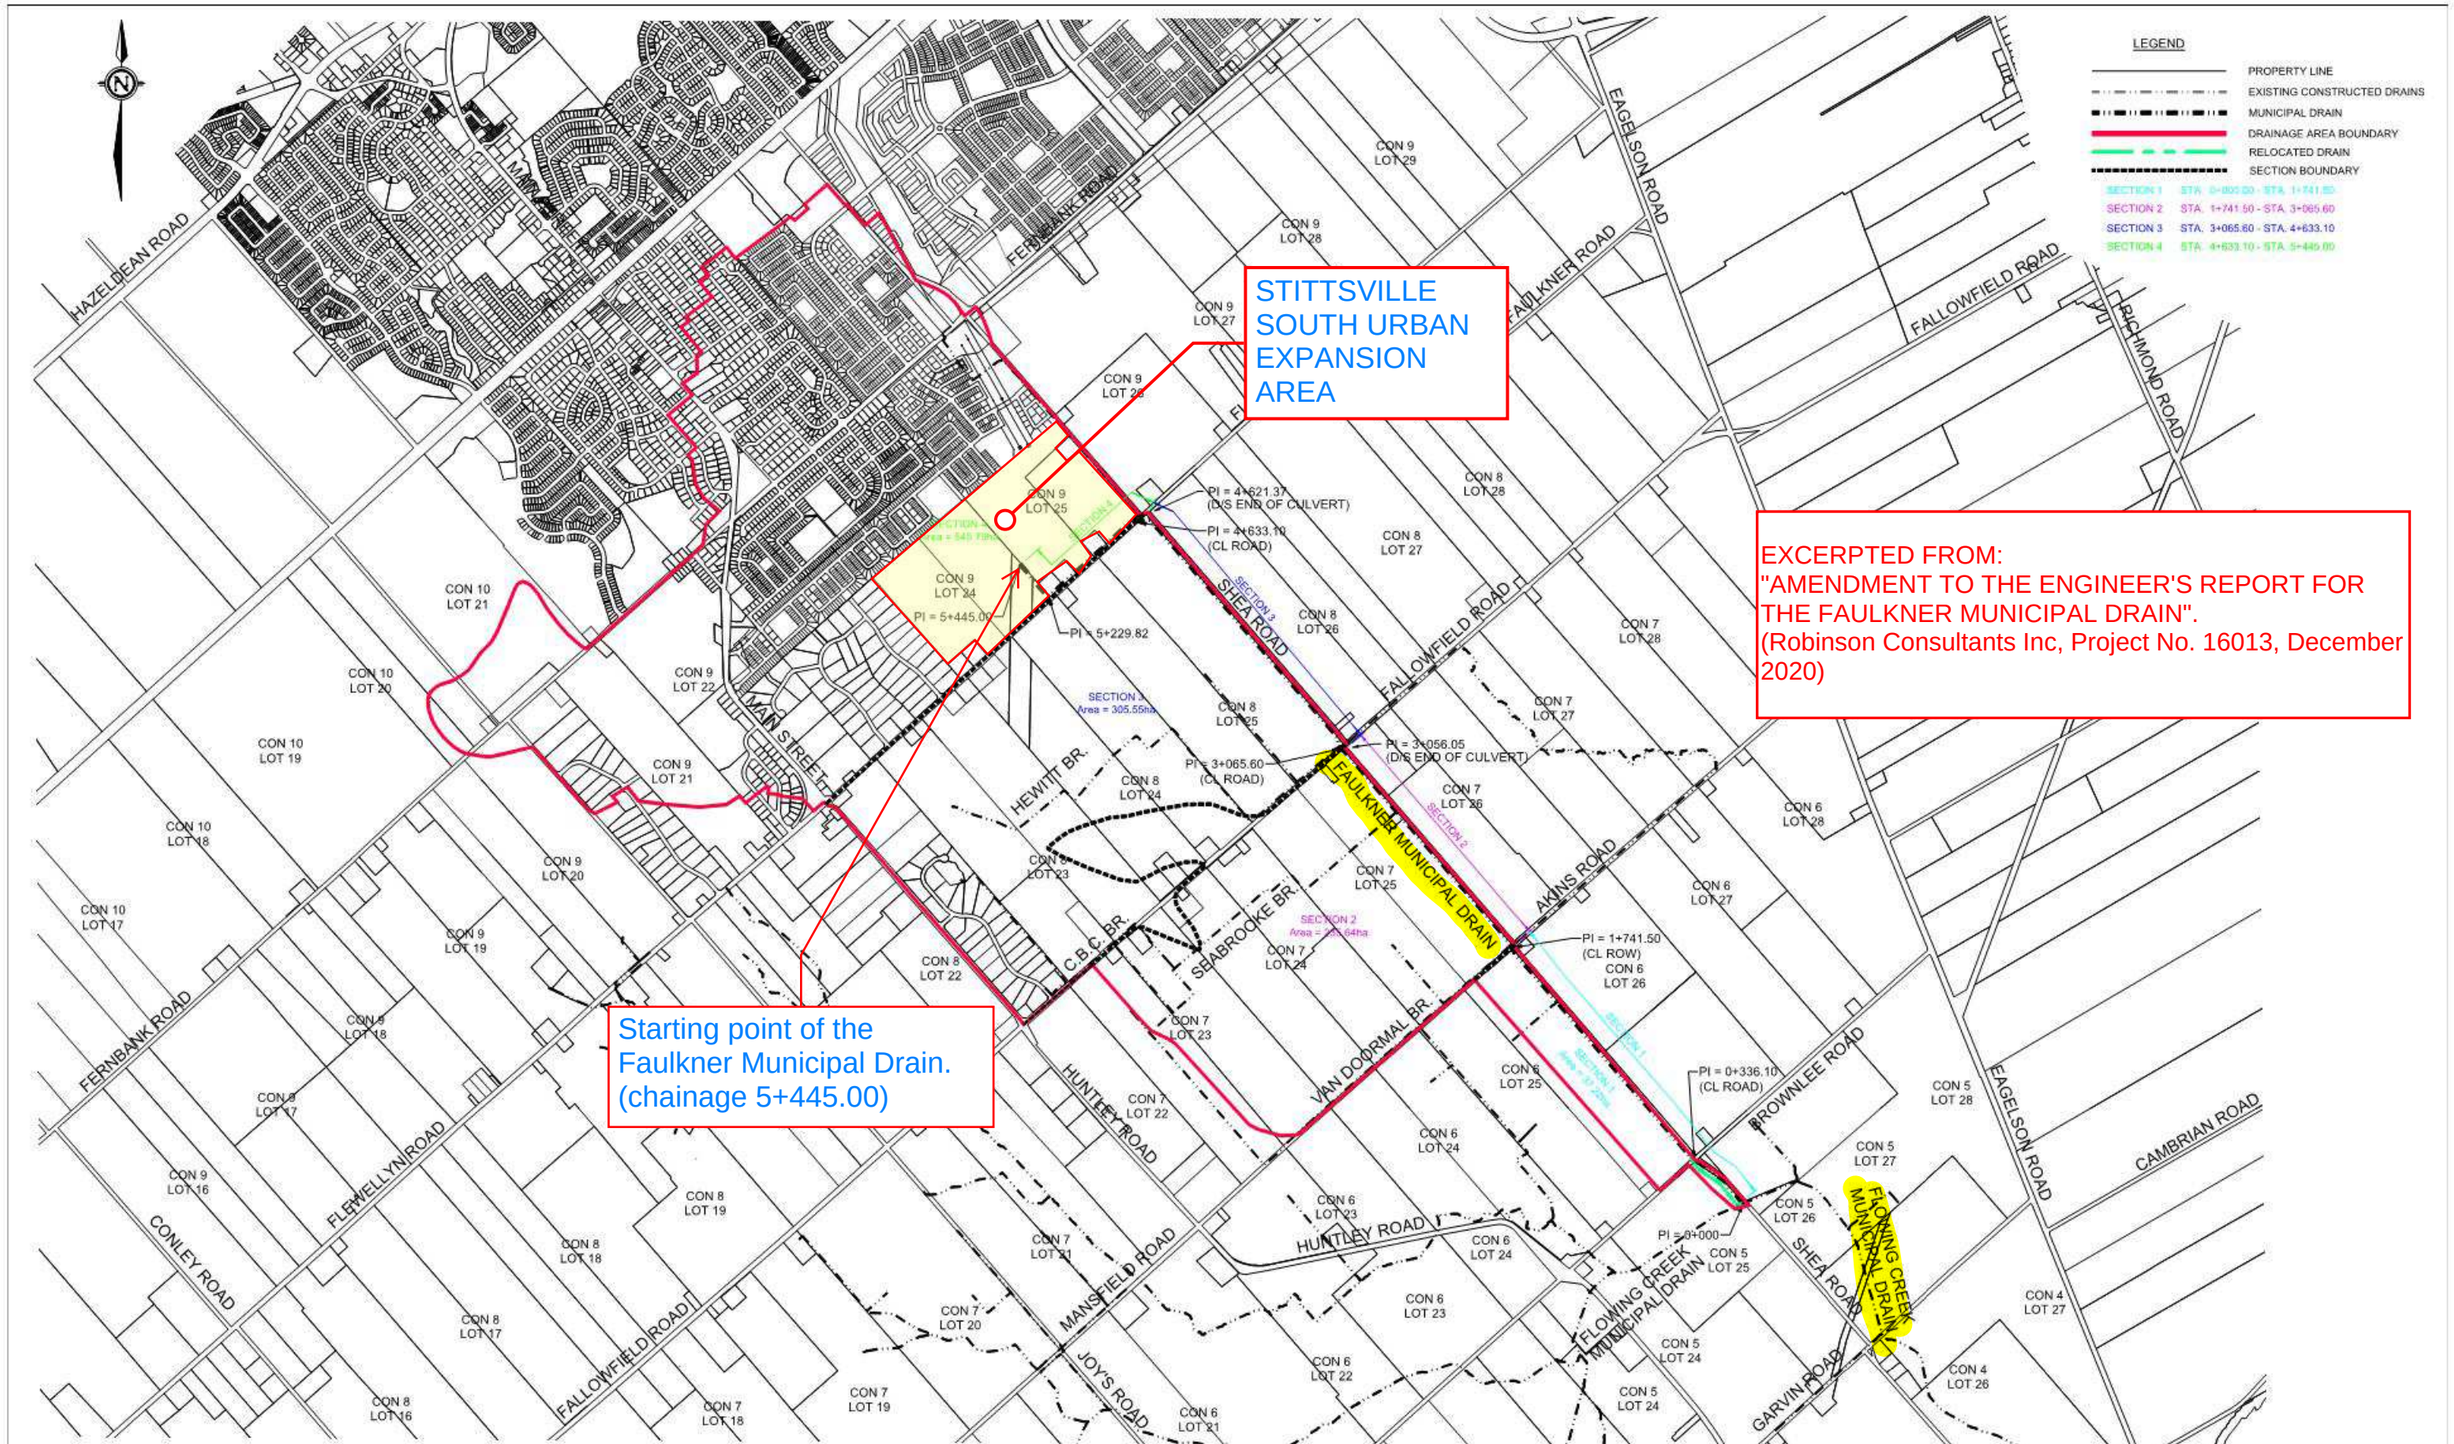

No.	DATE	REVISION	BY
1	15.04.20	ISSUED FOR MUNICIPAL REVIEW	AJR
2	27.05.20	ISSUED FOR AGENCY REVIEW	AJR
3	02.09.20	ISSUED FOR ECA APPLICATION	AJR
4	14.12.20	FINAL - ISSUED FOR DISTRIBUTION	AJR

LICENSED PROFESSIONAL ENGINEER A. J. ROBINSON 20/12/14 PROVINCE OF ONTARIO

Professional Engineers Ontario 20/12/14 Licensed Engineering Technologist Name: L Pavn/KLM Number: 100501332 Limitation: Pre-City plan, non-application of reports and other non-technical advice for submission under the Ontario Drainage Act. Association of Professional Engineers of Ontario

SCALES
150 0 300
HORIZONTAL

Robinson Consultants
350 Palladium Drive
Ottawa, Ontario K2V 1A8
(613) 592-6060 rcii.com

DESIGN	LF
CHECKED	AJR
DRAWN	JHB
CHECKED	LF
APPROVED	AJR

CITY OF OTTAWA

FAULKNER MUNICIPAL DRAIN

MAINTENANCE SECTIONS and SECTION DRAINAGE AREAS

PROJECT No. 16013
CONTRACT No.
DATED DEC. 2020
DWG. No: FIG 6.1

The record of site-specific information associated with RVCA's regulatory approval process since 2006 was checked. It was found that no site-specific work affects the flood risk lines.

Drawings FL-1 and FL-2 in Appendix F depict the delineated floodplain and areas of shallow flooding.

7.2 Areas of Shallow Flooding

At a few places (Drawing FL-1), it is expected that flood water would go overbank from the channel and identifiable floodplain into the adjacent areas. However, there is considerable uncertainty as to how this would manifest itself and which area would actually be inundated by overbank water under the regulatory flood event. Many factors appear to be in the play: stream hydraulics, volume of flood water, volume of channel and floodplain storage, flood water escaping the stream as spills, amount of flood water available for spilling, local (micro) topography, shallow (sheet) flow with wet/dry fronts, rain water collected in depressions and puddles, soil and vegetation characteristics, etc. etc., and their interaction with each other. Needless to say, this is a very complex phenomenon and does not lend itself to engineering computation. While we can visualize the existence of areas of shallow flooding and can tentatively identify their probable extent, we cannot calculate with any degree of accuracy relevant parameters such as flood elevation, water depth or velocity. We tentatively call them areas of shallow flooding[11]. Such areas of shallow flooding are prone to a lesser (lesser than identifiable floodplains) albeit unspecified degree of flood risk. Even though flood risk parameters cannot be estimated, the areas of shallow flooding are nonetheless hazardous to a certain extent. As such they fall –in our judgment – within the broad category of hazardous lands as defined

[11] Our concept of areas of shallow flooding is somewhat akin to that adopted by Credit Valley Conservation. A recent document (CVC 2010; Section 5.4.3) reads: "**Floodplain Spill Areas** – There are several areas within the CVC's jurisdiction where floodplain spills occur. Spill areas are portions of the floodplain where hydraulic modeling and mapping of the riverine flood hazard indicates that flood waters are not physically contained within the valleyland and may or may not exit the watershed or subwatershed into surrounding lands. It is important to note that floodplain spill areas do not include the flood fringe, regardless of its characteristics such as flood flows and depths. Generally, the depth of flooding in spill areas cannot be readily determined as the flood depths that occur depend on a number of factors such as local and down-gradient topography, storage volume and the amount of spill flow that occurs. In addition, spills typically occur during higher flow rates of the storm event where the volume and depth of flood water is also dependent on the duration of the storm event."

Drawing FL-1 Cross-sections and regulatory flood levels

- floodplain-areas of shallow flooding demarcation line
- Study Limit
- Cross Section
- 1m LiDAR-derived contours
- 100yr Floodline / La Crue Regulatrice
- areas of shallow flooding
- Floodplain

08 MAY 2017

The information in this drawing is for information purposes only. Authoritative information on flood hazard is maintained in RVCA's GIS system and is updated from time to time based on new data.

Shea Road (Faulkner Municipal Drain along western right-of-way)

Potential area of shallow flooding adjacent to Faulkner Municipal Drain

Study Limit

RIDEAU VALLEY CONSERVATION AUTHORITY

Projection note: U.T.M. Zone 18 - NAD 83 Datum

File name: Drawing FL-1

Date Modified: 05/08/2017

N

1:10,000

0 500 1,000

Meters

Base-mapping and GIS services provided courtesy of the Rideau Valley Conservation Authority, under License with the Ontario Ministry of Natural Resources and Forestry © Queen's Printer for Ontario, 2016.

These maps are the property of the RVCA, and the RVCA holds a copyright on them. These maps may be copied or reproduced by other parties provided that the RVCA is properly acknowledged as the original source of the information in any document, report or map in which this mapping is used, and provided that no fee is charged (other than to cover handling charges). While RVCA makes every effort to ensure that the information presented is sufficiently accurate for the intended uses of the map, there is an inherent margin of error in all mapping products, and the RVCA cannot guarantee the accuracy of the mapping for all possible uses. All end-users of the information contained herein must therefore determine for themselves if the information is of suitable accuracy for their purposes.

Table 1 - Groundwater Level Measurement Summary															
Well ID		**BH1-21**	**BH2-21**	**BH3-21**	**BH22A-21**	**BH24-21**	**BH33-21**	**HA1-22**	**BH1-22**	**BH1A-22**	**BH2-22**	**BH3-22**	**BH3A-22**	**BH4-22**	**BH5-22**
Ground Surface Elevation (m asl)		104.29	107.19	108.41	102.98	103.07	104.7	106.78	107.31	107.31	103.58	102.25	102.25	105.71	105.7
Groundwater (GW) Measurements															
11-Jan-22	**GW Level (m bgs)**	1.22	0.82	0.89	2.49	0.67	1.84	Wells Were Not Installed At This Time							
	GW Elevation (m asl)	103.07	106.37	107.52	100.49	102.40	102.86								
11-Oct-22	**GW Level (m bgs)**	1.12	1.16	0.90	2.61	0.60	2.12	0.31	1.33	1.44	1.52	0.84	0.81	3.62	1.62
	GW Elevation (m asl)	103.17	106.03	107.52	100.37	102.47	102.59	106.48	105.99	105.87	102.06	101.42	101.44	102.10	104.09
28-Oct-22	**GW Level (m bgs)**	1.01	0.95	0.92	N/A	0.46	1.98	0.28	1.35	1.43	1.52	0.61	0.40	3.65	1.64
	GW Elevation (m asl)	103.28	106.25	107.49	N/A	102.61	102.72	106.51	105.97	105.88	102.06	101.64	101.85	102.07	104.06

DRAFT

Table 2 - Single Well Response Test Results Summary		
Test Hole ID	**Screened Media**	**Hydraulic Conductivity (m/sec)***
HA1-22	Brown Silty Sand w/ Trace Gravel	1.51E-05
BH1-22	Bedrock	1.53E-05
BH1A-22	Brown Silty Sand/Glacial Till	Insufficient Water Volume to Conduct Test
BH2-22	Bedrock	8.99E-06
BH3-22	Bedrock	6.29E-05
BH3A-22	Brown Silty Sand/Glacial Till	4.48E-06
BH4-22	Bedrock	8.89E-07
BH5-22	Bedrock	1.52E-05
BH1-21	Bedrock	1.23E-04
BH2-21	Bedrock	3.99E-05
BH3-21	Bedrock	2.98E-06
BH22A-21	Bedrock	4.31E-07
BH24-21	Bedrock	6.19E-05
BH33-21	Bedrock	1.60E-04

*Average value from all tests conducted at each test location

DRAFT

Table 3 - Overburden Field Saturated Hydraulic Conductivity Results and Estimated Infiltration Rates

Test Completed Adjacent to Borehole ID	Infiltration Testing Elevation (m asl)	Material	K_{fs} (m/s)*	Unfactored Infiltration Rate (mm/hr)**
BH1-21	103.90	Brown Silty Sand	2.10E-06	56
	103.63	Brown Silty Sand	1.90E-06	56
BH2-21	106.95	Brown Silty Sand	6.40E-06	76
	106.65	Brown Silty Sand	5.30E-07	39
BH7-21	106.74	Brown Silty Sand	1.10E-06	47
	106.44	Brown Silty Sand	1.60E-06	52
BH11-21	104.68	Brown Silty Sand	2.70E-06	60
	104.38	Brown Silty Sand	1.60E-06	52
BH15-21	102.70	Brown Silty Sand to Sandy Silt	2.10E-07	31
	102.48	Brown Silty Sand to Sandy Silt	≤ 8.1E-09	≤ 13
BH17-21	106.74	Brown Silty Sand to Sandy Silt	5.90E-06	74
	106.44	Brown Silty Sand to Sandy Silt	4.10E-06	67
BH22-21	102.58	Brown Silty Sand	1.10E-06	47
	102.28	Brown Silty Sand	1.60E-06	52
BH23-21	102.33	Brown Silty Clay w/ Sand	5.30E-07	39
	101.70	Brown Silty Clay	≤ 8.1E-09	≤ 13
BH26-21	102.74	Brown Silty Clay w/ Sand	1.10E-07	26
	102.44	Brown Silty Clay w/ Sand	1.10E-07	26
BH29-21	101.87	Brown Silty Sand to Sandy Silt	5.30E-07	39
	101.57	Brown Silty Sand to Sandy Silt	2.70E-07	33
BH31-21	103.19	Brown Silty Sand to Sandy Silt	1.10E-06	47
	102.89	Brown Silty Sand to Sandy Silt	1.35E-07	27
BH37-21	103.21	Brown Silty Sand to Sandy Silt	5.30E-06	72
	102.91	Brown Silty Sand to Sandy Silt	5.90E-06	74

***Field hydrualic conductivity (Kfs)**

****The infiltration rates do not include a safety correction factor. Based on our testing results, a safety correction factor can range between 2.5 to ≥ 3.5.**

DRAFT

Table 4 - Horizontal Hydraulic Gradient Summary

Well 'A'		Well 'B'				
Well ID	**GW Elevation (m asl)**	**Well ID**	**GW Elevation (m asl)**	**Distance (m)**	**Hydraulic Gradient (m/m)***	**Date**
BH3-21	107.515	BH1-22	105.985	73	0.0208	October 11, 2022
BH3-21	107.515	BH1A-22	105.87	73	0.0224	October 11, 2022
BH3-21	107.515	BH5-22	104.085	131	0.0263	October 11, 2022
BH3-21	107.515	BH4-22	102.095	206	0.0263	October 11, 2022
BH1-22	105.985	BH2-21	106.03	197	-0.0002	October 11, 2022
BH1-22	105.985	BH1-21	103.17	442	0.0064	October 11, 2022
BH1-22	105.985	BH5-22	104.085	148	0.0128	October 11, 2022
BH1-22	105.985	BH2-22	102.06	447	0.0088	October 11, 2022
BH1A-22	105.87	BH2-21	106.03	197	-0.0008	October 11, 2022
BH1A-22	105.87	BH1-21	103.17	442	0.0061	October 11, 2022
BH1A-22	105.87	BH5-22	104.085	148	0.0120	October 11, 2022
BH1A-22	105.87	BH2-22	102.06	447	0.0085	October 11, 2022
BH1A-22	105.87	BH3A-22	101.44	708	0.0063	October 11, 2022
BH2-21	106.03	BH1-21	103.17	296	0.0097	October 11, 2022
BH2-21	106.03	BH2-22	102.06	358	0.0111	October 11, 2022
BH5-22	104.085	BH4-22	102.095	137	0.0145	October 11, 2022
BH5-22	104.085	BH2-22	102.06	330	0.0061	October 11, 2022
BH2-22	102.06	BH3-22	101.415	397	0.0016	October 11, 2022
BH2-22	102.06	BH3A-22	101.44	397	0.0016	October 11, 2022
BH33-21	102.585	BH3-22	101.415	485	0.0024	October 11, 2022
BH33-21	102.585	BH3A-22	101.44	485	0.0024	October 11, 2022
BH33-21	102.585	BH22A-21	100.37	549	0.0040	October 11, 2022
BH33-21	102.585	BH24-21	102.47	307	0.0004	October 11, 2022
BH3-22	101.415	BH22A-21	100.37	296	0.0035	October 11, 2022
BH3A-22	101.44	BH22A-21	100.37	296	0.0036	October 11, 2022
BH24-21	102.47	BH22A-21	100.37	524	0.0040	October 11, 2022
BH4-22	102.095	BH3-22	101.415	584	0.0012	October 11, 2022
BH4-22	102.095	BH3A-22	101.44	584	0.0011	October 11, 2022
BH4-22	102.095	BH33-21	102.585	404	-0.0012	October 11, 2022

**Hydraulic Gradient = (GW Elevation Well 'A' - GW Elevation Well 'B') / Distance

DRAFT

Table 5 - Vertical Hydraulic Gradient Summary							
Well 'A'			Well 'B'				
Well ID	GW Elevation (m asl)	Well Depth (m)	Well ID	GW Elevation (m asl)	Well Depth (m)	Hydraulic Gradient (m/m)*	Date
BH1-22	105.985	98.29	BH1A-22	105.87	105.69	-0.0155	October 11, 2022
BH3-22	101.415	93.13	BH3A-22	101.44	99.1	0.0042	October 11, 2022
BH1-22	105.965	98.29	BH1A-22	105.88	105.69	-0.0115	October 28, 2022
BH3-22	101.64	93.13	BH3A-22	101.85	99.1	0.0352	October 28, 2022

*Hydraulic Gradient = (GW Elevation Well 'A' - GW Elevation Well 'B') / (Well Depth Well 'A' - Well Depth Well 'B')

DRAFT

This map is for reference only.
No policies apply within the Significant Groundwater Recharge Areas. See section 2.2 of this plan for more information

Mississippi-Rideau Source Protection Plan 2013

Mississippi-Rideau Source Protection Region
Significant Groundwater Recharge Areas

Schedule M

STITTSVILLE SOUTH URBAN EXPANSION AREA

BONNECHERE VALLEY
ADMASTON/BROMLEY
HORTON
RENFREW
MCNAB/BRAESIDE
COUNTY OF RENFREW
GREATER MADAWASKA
MISSISSIPPI MILLS
CARLETON PLACE
COUNTY OF LANARK
LANARK HIGHLANDS
BECKWITH
MONTAGUE
SMITHS FALLS
PERTH
DRUMMOND/NORTH ELMSLEY
TAY VALLEY
MERRICKVILLE-WOLFORD
NORTH GRENVILLE
OTTA
RUSSELL
NORTH DUNDAS
SOUTH DUNDAS
AUGUSTA
ELIZABETHTOWN-KITLEY
UNITED COUNTIES OF LEEDS AND GRENVILLE
COUNTY OF LENNOX AND ADDINGTON
ADDINGTON HIGHLANDS
NORTH FRONTENAC
COUNTY OF FRONTENAC
CENTRAL FRONTENAC
SOUTH FRONTENAC
TWEED
STONE MILLS
ATHENS
BROCKVILLE
WESTPORT
RIDEAU LAKES
Québec
New York State
Ottawa River

Arnprior
Fitzroy Harbour
Galetta
Dunrobin
Kinburn
Marathon
Carp
Pakenham
Clarence Creek
Vars
Almonte
Appleton
Ashton
Munster
Richmond
Kars
Osgoode
North Gower
Carleton Place
Dwyer Hill
Lanark
Plevna
McDonalds Corner
Balderson
Perth
Glen Tay
Port Elmsley
Smiths Falls
Merrickville
Burritts Rapids
Oxford Mills
Kemptville
Bedell
Bishops Mills
Garretton
South Branch
De Witts Corners
Scotch Line
Maberly
Stanleyville
Sharbot Lake
Bolingbroke
Crow Lake
Oconto
Tichborne
Parham
Westport
Newboro
Crosby
Portland
Elgin
North Augusta
Greenbush
Addison
Fairfield
Farmton
Maitland
Brockville

17
417
416
43
7
36
15
42
38
401

LEGEND

- City/Town
- Major Road
- Lower/Single Tier Municipalities
- Upper Tier Municipalities
- Water
- Source Protection Area
- Significant Groundwater Recharge Areas

0 3 6 12 18
Kilometres

Projection: Universal Transverse Mercator, NAD83, Zone 18 North

Please refer to Mississippi and Rideau Valley Assessment Reports for information on data sources and specifications for source protection data.

Produced by the Mississippi-Rideau Source Protection Region, under License with the Ontario Ministry of Natural Resources © Queen's Printer for Ontario, 2012.

While the MRSPR makes every effort to ensure that the information presented is sufficiently accurate for the intended uses of the map, there is an inherent margin of error in all mapping products, and accuracy of the mapping cannot be guaranteed for all possible uses. All end-users must therefore determine for themselves if the information is suitable for their purposes.

MAP LOCATION: Z:\Mapping\MSRs\SPR\18 Plan\Schedules\Plan\Plan_Schd_M.mxd

APPENDIX E

TERMS OF REFERENCE

David Schaeffer Engineering Ltd.
120 Iber Road, Suite 103
Stittsville, ON K2S 1E9
613-836-0856
dsel.ca

MEMORANDUM

DATE:	June 9, 2022
TO:	**Christopher Rogers, P.Eng.**
FROM:	Kevin L. Murphy, P. Eng.
SUBJECT:	**Caivan – Stittsville Lands (5993, 6070 & 6115 Flewellyn Road)** **New Urban Expansion Development – Terms of Reference (REVISED PER CITY COMMENTS DATED MAY 6, 2022)**
DSEL Job No.	21-1247
ATTACHMENTS:	

Chris,
As per your request to Caivan at a pre-consultation meeting held (February 7/22), the following is a proposed summary of Terms of Reference (TOR) to document the servicing strategy approach for development of the above noted parcels of land located within Stittsville.

1.0 BACKGROUND

Fotenn Consultants Inc. ("Fotenn") has previously circulated a January 27, 2022 outline for the development of Concept Plans and processes related to the above noted subject lands. Caivan Communities ("Caivan") has ownership of land parcels that are currently located in the rural area and are designated to be brought within the urban boundary through the new Official Plan process.

1.1 Study Area & Objectives

The subject lands are bound by Flewellyn Road to south, Shea Road to the east, an existing urban subdivision development to the north (Stittsville South – Area 6) and an estate lot subdivision to the west. The area is also bisected by the Faulkner Municipal Drain and a Hydro One power transmission corridor.

The main objective of the servicing review is to develop an overall servicing strategy for the Stittsville Lands that will fulfill the requirements of municipal and provincial standards. The review will consider, evaluate and assess the servicing needs of the development area as it relates to geotechnical considerations, availability of service connections and stormwater management objectives. Several development alternatives for road network layouts, parks and unit mixes will be analyzed and assessed with respect to servicing strategies with a preferred overall servicing scheme identified.

The preferred internal servicing plan will be developed to meet regulatory requirements and will be free of conflicts between the various infrastructure components (water, wastewater, storm and stormwater infrastructure). The following sections present the anticipated scope of work to be completed:

- Task 1 (Agreement on Terms of Reference),
- Task 2 (Internal Concept Plan Review Process (Input Evaluation)),
- Task 3 (Functional Servicing Report and Master Infrastructure Review).

2.0 WORK PLAN

Task 1: Agreement on Terms of Reference

Preparation and finalizing of the TOR for the proposed servicing assessment approach guiding the Concept Plan development process. This draft TOR will be circulated to the City for review/comment on the proposed scope and will form the basis of the future servicability review.

Task 2: Internal Concept Plan Review Process (Input Evaluation)

From an Overall Servicing perspective, this task will include a thorough consolidation of the documents listed in Section 2.1, investigate and quantify residual capacities and servicing constraints while keeping in mind the environmental constraints identified as part of the Task 2 process. The scope of work to complete the Concept Plan Review Process will include the following components:

2.1 Review and Consolidate

As part of the Concept Plan Review Process, a review of background reports that are concerned with the study area will be completed. The review will, at minimum, include the following reports and guidelines being considered:

- City of Ottawa Sewer Design Guidelines (City of Ottawa, October 2012) & Technical Bulletins (ISDTB-2014-01, PIEDTB-2016-01, ISTB-2018-01, ISTB-2018-04 & ISTB-2019-02)
- City of Ottawa Water Distribution Guidelines (City of Ottawa, July 2010) & Technical Bulletins (ISD-2010-2, ISDTB-2014-2, ISTB-2018-02, & ISDTB-2021-03)
- Infrastructure Master Plan (City of Ottawa, 2013)
- Low Impact Development Technical Guidance Report, Implementation in Areas with Potential Hydrogeological Constraints (Dillon Consulting and Aquafor Beech, February 2021)
- Stormwater Planning and Design Manual (Ministry of the Environment, March 2003)
- Amendment to the Engineer's Report for the Faulkner Municipal Drain (Robinson, December 2020) & Addendum No. 1 (Robinson, March 2021)
- Stittsville South – Area 6, City of Ottawa, Master Servicing Report & Stormwater Management Design Plan (Novatech/DSEL, December 2013)
- Stittsville South Subdivision, City of Ottawa – Detailed Servicing & Stormwater Management Report (Novatech July 2016)
- Sanitary Pump Station Pre-Design Report, Stittsville South (Novatech, July 2015)
- Stittsville South Subdivision, City of Ottawa – Shea Road Sanitary Pump Station Design Brief (Novatech, May 2016)
- Design Brief, Davidson Lands – OPA 76 Area 6a, Phase 1 (5993 Flewellyn Road) (IBI Group, February 2018)
- Fernbank Community Design Plan, Master Servicing Study (Novatech, June 2009)

- Geotechnical Investigation, Proposed Residential Development 5993, 6070 & 6115 Flewellyn Road – Ottawa (Paterson (PG5570-2) January 2022)
- Low Impact Development Stormwater Management Guidance Manual (Ministry of the Environment, Conservation and Parks, Draft for Consultation – January 2022)

2.2 Hydrological Modelling

Based on a review of background reports and topographic information available, a hydrologic model will be developed to estimate peak flows and hydrographs under for the various outlets from the Study Area. The analysis will be conducted with SWMHYMO under the design storm types, return periods and hydrological parameters described in the Ottawa Sewer Design Guidelines. The analysis will consider the drainage features inventoried as part of the topographical survey (open ditch, culverts, etc.) as well as any drainage divides. Surface flows will be calculated based on the existing flow patterns for the various outlets; drainage ditches, culverts and storm sewers (if applicable).

2.3 Coordination and Liaise with Other Disciplines

The Concept Plan review process will discuss findings from other disciplines including geotechnical, hydrogeology, water budget, hydrology, ecology (aquatic resources and natural areas), etc., which will establish the existing environmental conditions. The coordination will ensure that the hydrologic analysis considers natural environmental inventories and constraints. Where required, drawings prepared will note existing conditions constraints and potential opportunities, which may impact storm and stormwater servicing or other municipal infrastructure.

2.3.1 Coordinate and Liaise with Geotechnical Engineer

In consultation with the geotechnical engineer, DSEL will:

- Review specific grade raise restrictions to better understand the potential grading constraints versus potential land use;
- Review the soil's characteristics to better understand whether they are conducive to infiltration measures;
- Review the soil's structural capabilities from a support/strength perspective;
- Review the areas of either recharge or discharge potential.

2.3.2 Coordinate with the Hydrogeologist

In consultation with the hydrogeologist, the existing conditions water budget analysis will be reviewed to identify the zones conducive to infiltration measures or other low impact development (LID) strategies. These measures could potentially be used to mitigate impacts on the water budget. As part of this task, LIDAlso strategies will be reviewed, at a conceptual level, to determine their viability and effectiveness in maintaining the existing conditions water budget and potential benefits to mitigating downstream impacts.

- Prepare a conceptual LID plan which illustrates the zones noted above and how the measures will be integrated into the overall plan(s);

2.3.3 Coordinate with Biologist

In consultation with the biologist, the environmental constraints will be further reviewed to better understand their sensitivity to various land uses and their proximity to Concept Plan elements. The objectives and targets from a storm discharge perspective will be based on the on-site environmental constraints as well as the limitations of the receiving watercourses.

2.3.4 Review Topographical Survey and Complete Inventory of Existing Infrastructure

Once all constraints have been compiled a further review of topographical surveys will be completed as well as the drainage patterns identified under current conditions. As part of this task, existing services and outlets will be inventoried for wastewater, water and stormwater. The assessment of residual capacities for existing services will also be reviewed. Any additional survey data will be obtained as required to supplement as-built information.

2.4 Evaluation and Assessment of Storm Design Criteria , Objectives and Pond Alternatives

Based on the findings of the natural resource inventories, storm criteria for both water quality and quantity will be established from a consensus with other disciplines and based on requirements prevalent in the Study Area. Once adopted by the consultant team, the storm criteria will be presented and confirmed by regulatory agencies. Review and comment on potential end-of-pipe solutions that would satisfy the storm criteria and the most suitable approach and siting (based on topography, soil type etc) for the Concept Plans. Based on the siting of the facilities, establish footprint of the end-of-pipe facilities in accordance with the guidance described in Section 4 of the MECP SWMPDM. This includes evaluation of potential capacity of the existing Area 6 SWM pond to optimize use of that infrastructure.

Pond sizing will be established conservatively and not be downsized based on the finding of LID options reviewed to establish water balance.

2.5 Coordination with Drainage Engineer for requirements relating to the Faulkner Municipal Drain.

Consulation will be undertaken with the City's Municipal Drain Group to assess any requirements under the Ontario Drainage Act for the Faulkner Municipal Drain in terms of drainage outlets and land use changes proposed. The consultation will serve as the basis for any amendments to the existing Engineer's Report that may be required.

2.6 Concept Plan Summary Discussions & Preferred Plan Selection

The preceding evaluations considered along with the Concept Plans reviewed will determine a preferred plan which will be brought forward for the more detailed review and assessment of servicing in Task 3.

Task 3: Functional Servicing Report and Master Infrastructure Review

After the completion of Task 2, the Consulting Team will have developed several Concept Plans based on the findings and any other discipline inputs compiled to date from the Team with a preferred option selected. This will include environmental, stormwater, geotechnical and transportation. For the preferred Concept Plan the municipal servicing constraints criteria (see Task 3.1) will be investigated for the preparation of the servicing analysis. Review will also include comment on suitable servicing routes via either servicing blocks and/or the establishment of right-of-way corridors that have appropriate cross-sections to accommodate the various elements of servicing infrastructure required.

3.1 Evaluation of Municipal Servicing Requirements for the Preferred Concept Plan

DSEL will evaluate infrastructure servicing alternatives for the Concept Plans prepared by considering each option and providing the Team with inputs using the general criteria outlined below in order to resolve the preferred Concept as described in the Fotenn outline memo previously circulated. The tasks envisioned to be included in a Site Servicing and Stormwater Management Report area as follows:

3.1.1 Grading

1. Develop a macro level Grading Plan for the Concept Plans based on the constraints identified by the geotechnical engineer. Grading will be developed in accordance with the criteria described in the Design Guidelines.

3.1.2 Identify and Assess Capacity of Existing Conveyance Systems

1. Based on topographical maps/surveys and servicing reports of existing developments adjacent to the limits of the Study Area, free flowing capacity of watercourses (i.e. Faulkner Drain), roadside ditches and water crossings (if any) will be reviewed.

3.1.3 Water Infrastructure

1. Confirm pressure objectives with the City along feedermains under both domestic and fire flow conditions. Connections will be to the development areas to the north of the Study Area. Coordination with the Water Master Plan to be undertaken with City staff.

2. Calculate domestic demands (average, maximum day and peak hour) based on “system level parameters” (expectation being there will be in excess of 3,000 persons) under the build-out condition of the proposed land use for the selected Concept Plans. The preferred parameters will be provided by the City.

3. Calculate required design fire flow for concurrence by City staff.

4. Calculate theoretical domestic demands for potential phases of development based on a phasing strategy. Develop and populate a base water model for the preferred Concept Plan.

5. Acquire hydraulic boundary conditions at each of the connection points of the existing water distribution system. Proposed connection locations to be concurred with by City Staff.

6. Evaluate the performance of the distribution system against municipal requirements under domestic demand conditions for the Concept Plan. Assess and identify deficiencies and develop system upgrades, if required, to meet municipal requirements from both pressure and demand criteria.

7. Evaluate the performance of the proposed distribution system under a maximum day plus fire flow conditions for the Concept Plans supply characteristics of the pressure zone in accordance with Technical Bulletins.

8. Prepare a Water Servicing Plan for the preferred Concept Plan.

3.1.4 Wastewater Infrastructure

1. Based on the sanitary sewer outlets inventoried as part of Task 2, assess residual capacities. Coordination Wasterwater Master Plan to be undertaken with City Staff.

2. Develop peak wastewater flows based on the land use and population projections for the different land uses associated with the Concept Plans as per the Sewer Design Guidelines.

3. Prepare a Sanitary Drainage Area Plan and Design Sheets for the preferred Concept Plan.

4. Review trunk sanitary sewer routes, establish preliminary invert elevations based on topography and existing outlets. Prepare Sanitary Servicing Plan and assess impact of phasing on infrastructure. Identify servicing constraints, potential crossing conflicts and adjust, as required once the Storm Servicing Plan has been completed.

5. Assess residual capacities, beyond the Study Area population.

6. Review Shea Road Sanitary Pump Station for capacity and potential upgrades. Coordination with the Wastewater Master Plan Project Manager to be undertaken in order to assess conceptual pumping upgrates that will be required to accommodate the expansion area.:

   a. Summarize the existing pump station parameters.

   b. Review of potential component upgrades as well as overflow requirements.

   c. Review electrical changes needed to accommodate higher HP pumps and high-level electrical overview.

d. Transient analysis review.

7. Summarize findings for Wastewater Component within reporting.

3.1.5 Storm Servicing and Stormwater Management

1. Based on the prior Task findings, confirm storm design criteria (quantity and quality) with the RVCA, MECP and the City and discuss potential impacts.

2. Review topographic survey and maps. Based on the storm sewer outlets inventoried as part of prior tasks, confirm outlet locations and inverts, and assess residual capacities and drainage patterns, etc.

3. Review existing conditions hydrological analysis to establish the baseline condition.

4. Finalize capacity assessment of existing surface outlets using desktop calculations.

5. Determine minor and major system drainage boundaries for the Concept Plans based on residual capacities of the existing outlets.

6. Carry out post-development Water Budget based on the Concept Plan. Identify and assess water budget deficits for the preferred Concept Plan.

7. In consultation with the hydrogeologist:

- Investigate, at the conceptual level, the integration of low impact development (LID) strategies within the Study Area based on inputs from the hydrogeologist
- evaluate potential infiltration measures, and
- assess conceptually the performance of the LID strategies and infiltration measures with respect to the potential water budget deficits.

8. Based on the minor and major system boundaries, prepare post-development Storm Drainage Area Plan and Servicing Layout for the preferred Concept Plan. Identify servicing constraints, potential crossing conflicts and adjust, as required.

9. Coordinate with the City Drainage Group regarding the Faulkner Drain and any requirements under the Ontario Drainage Act.

10. Prepare Storm Sewer Design Sheets and Drainage Area Plans for the preferred Concept Plan with appropriate runoff coefficients, assessment of trunk storm sewer inverts etc as per Sewer Design Guidelines.

11. Review and finalize potential end-of-pipe solutions that would satisfy the storm criteria (water quality and quantity) and the most suitable approach and siting (based on topography, soil type etc) for the preferred Concept Plan. Based on the siting of the facilities, establish footprint of the end-of-pipe facilities in accordance with the guidance described in Section 4 of the MECP SWMPDM.

12. Carry out a hydraulic grade line (HGL) analysis of the proposed storm sewer system to evaluate the freeboard between the potential underside of footings and the 1:100 year storm. The analysis is to include the evaluation under the climate change event in accordance with the OSDG.

13. Assess impact of phasing on proposed storm infrastructure.

14. Summarize findings for Stormwater Management within the reporting

3.1.6 Water Budget

1. In consultation with the hydrogeological/geotechnical engineer, JFSA/DSEL will prepare a pre- and post-development water balance review (infiltration, runoff and evapotranspiration) for the site in accordance with the methodology summarized in Section 3.2 of the MECP's "Stormwater Management Planning & Design Manual, March 2003". This will include consideration of *Table 3.1 – Hydrologic*

Cycle Component Values and evaluation of 39 years of historical rainfall data from the Ottawa Airport via continuous hydrologic SWMHYMO model simulations. As per 4.7.1 (3.b) of the draft Official Plan.

2. Findings above will also be correlated to the mitigation of potential downstream impacts of the development.

3.1.7 Opinion of Probable Cost and Phasing

1. Coordination with other disciplines to finalize phasing for the Concept Plan in regard to servicing constraints.
2. Prepare an opinion of probable cost for municipal servicing for the prefered Concept Plan.

Kevin L. Murphy, P.Eng.

DSEL

david schaeffer engineering ltd.

David Schaeffer Engineering Ltd.
120 Iber Road, Suite 103
Stittsville, ON K2S 1E9
613-836-0856
dsel.ca

APPENDIX B

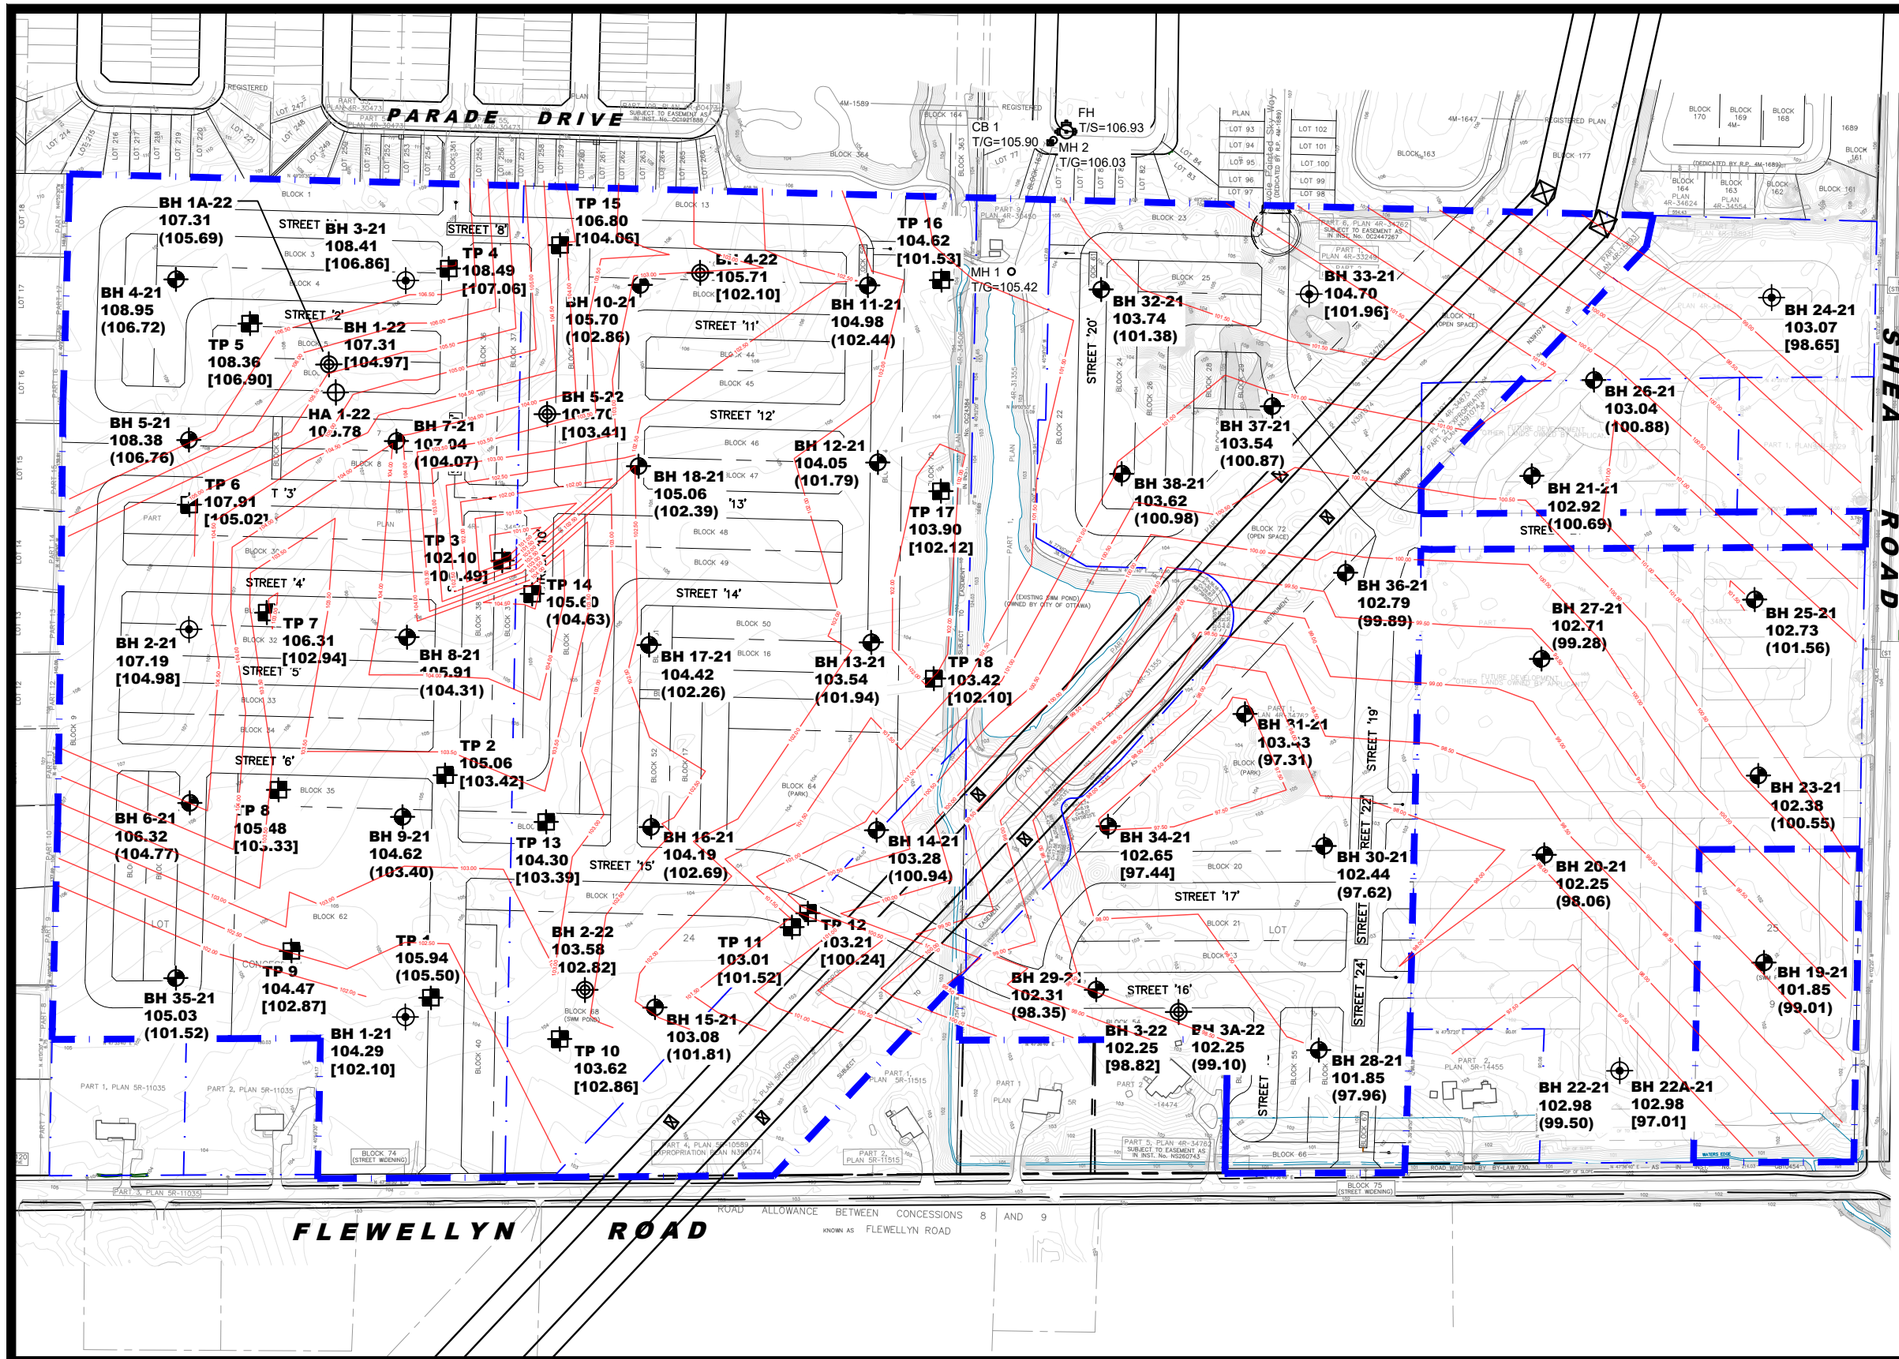

LEGEND:

- HAND AUGER LOCATION (CURRENT INVESTIGATION)
- BOREHOLE WITH MONITORING WELL LOCATION (CURRENT INVESTIGATION)
- BOREHOLE WITH PIEZOMETER LOCATION (PATERSON GROUP REPORT; PG5570-2, JAN 20, 2022)
- BOREHOLE WITH MONITORING WELL LOCATION (PATERSON GROUP REPORT; PG5570-2, JAN 20, 2022)
- TEST PIT LOCATION\ (PATERSON GROUP REPORT; PG5570-1, JAN 3, 2021)
- 97.50 — BEDROCK CONTOUR (m)
- 104.29 GROUND SURFACE ELEVATION (m)
- [102.10] BEDROCK SURFACE ELEVATION (m)
- (102.39) PRACTICAL REFUSAL TO AUGERING / EXCAVATION ELEVATION (m)

BASE PLAN PREPARED BY J.D. BARNES LIMITED.

GROUND SURFACE ELEVATIONS AT BOREHOLE LOCATIONS ARE REFERENCED TO A GEODETIC DATUM.

SCALE: 1:4000

0 50 100 150 200 250m

PATERSON GROUP
9 AURIGA DRIVE
OTTAWA, ON
K2E 7T9
TEL: (613) 226-7381

NO.	REVISIONS	DATE	INITIAL
6	UPDATED TO NEW CONCEPTUAL PLAN	03/07/2024	KP
5	UPDATED TO NEW CONCEPTUAL PLAN	28/08/2023	KP
4	UPDATED CLIENT'S NAME AND SITE ADDRESS	12/06/2023	KP
3	UPDATED SITE BOUNDARY	13/02/2023	KP
2	BH 1-22 - BH 5-22 & HA1-22 ADDED TO PLAN	10/03/2022	KP

CAIVAN (STITTSVILLE SOUTH) INC. & CAIVAN (STITTSVILLE WEST) LTD.

GEOTECHNICAL INVESTIGATION
PROPOSED RESIDENTIAL DEVELOPMENT
OTTAWA, 5993 & 6115 FLEWELLYN ROAD & 6030 & 6070 FERNBANK ROAD ONTARIO

Title:

BEDROCK CONTOUR PLAN

Scale: 1:4000	Date: 01/2022
Drawn by: YA	Report No.: PG5570-2, REVISION 1
Checked by: KP	Dwg. No.: PG5570-2
Approved by: DJG	Revision No.: 6

11x17

p:\autocad drawings\geotechnical\pg55xx\pg5570\pg5570-1 thlp (rev.06).dwg

David Schaeffer Engineering Ltd.
120 Iber Road, Suite 103
Stittsville, ON K2S 1E9
613-836-0856
dsel.ca

APPENDIX C

Hydraulic Capacity and Modeling Analysis Sittsville South Urban Expansion Area Development

Final Report

Prepared for:
David Schaeffer Engineering Ltd.
120 Iber Road, Unit 103
Stittsville, ON K2S 1E9

Prepared by:
GeoAdvice Engineering Inc.
Unit 203, 2502 St. John's Street
Port Moody, BC V3H 2B4

Submission Date: August 8, 2024

Contact: Mr. Werner de Schaetzen, Ph.D., P.Eng.
Project: 2022-018-DSE

Copyright © 2024 GeoAdvice Engineering Inc.

Document History and Version Control

Revision No.	Date	Document Description	Revised By	Reviewed By
R0	December 1, 2023	Draft	Ben Loewen	Werner de Schaetzen
R1	December 6, 2023	Updated Draft	Ben Loewen	Werner de Schaetzen
R2	August 8, 2024	Final	Ben Loewen	Werner de Schaetzen

Confidentiality and Copyright

This document was prepared by GeoAdvice Engineering Inc. for David Schaeffer Engineering Ltd. The material in this document reflects the best judgment of GeoAdvice in light of the information available to it at the time of preparation. Any use which a third party makes of this report, or any reliance on or decisions made based on it, are the responsibilities of such third parties. GeoAdvice accepts no responsibility for damages, if any, suffered by any third party as a result of decision made or actions based on this document. Information in this document is to be considered the intellectual property of GeoAdvice Engineering Inc. in accordance with Canadian copyright law.

Statement of Qualifications and Limitations

This document represents GeoAdvice Engineering Inc. best professional judgment based on the information available at the time of its completion and as appropriate for the project scope of work. Services performed in developing the content of this document have been conducted in a manner consistent with that level and skill ordinarily exercised by a member of the engineering profession currently practicing under similar conditions. No warranty, express or implied is made.

Contents

1 Introduction 4
2 Modeling Considerations 6
2.1 Water Main Configuration 6
2.2 Elevations 6
2.3 Consumer Demands 6
2.4 Fire Flow Demand 7
2.5 Boundary Conditions 8
3 Hydraulic Capacity Design Criteria 9
3.1 Pipe Characteristics 9
3.2 Pressure Requirements 9
4 Hydraulic Capacity Analysis 10
4.1 Development Pressure Analysis 10
4.2 Development Fire Flow Analysis 10
5 Other Servicing Considerations 12
5.1 Water Supply Security 12
5.2 Valves 12
5.3 Hydrants 13
5.4 Water Quality 13
6 Conclusions 14

Appendix A Domestic Water Demand Calculations and Allocation .....
Appendix B Required Fire Flow Allocation .....
Appendix C Boundary Conditions .....
Appendix D Pipe and Junction Model Inputs .....
Appendix E ADD and PHD Model Results .....
Appendix F MDD+FF Model Results .....

1 Introduction

GeoAdvice Engineering Inc. ("GeoAdvice") was retained by David Schaeffer Engineering Ltd. ("DSEL") to size the proposed trunk water main network for the Sittsville South Urban Expansion Area (SSUEA) development ("Development") in the City of Ottawa, ON ("City").

The development will have four (4) connections to the City's water distribution system on Parade Drive, Hickstead Way via Aridius Crescent, Hickstead Way via Painted Sky Way, and Ocaia Street that will feed the proposed development. The connections used for modeling the proposed development were based on the boundary conditions provided by the City on May 30, 2023 (refer to **Appendix C**).

The development site is shown in **Figure 1.1** on the following page, with the recommended trunk main pipe diameters.

This report describes the assumptions and results of the hydraulic modeling and capacity analysis using InfoWater (Innovyze), a GIS water distribution system modeling and management software application.

The results presented in this report are based on the analysis of steady state simulations. The predicted available fire flows, as calculated by the hydraulic model, represent the flow available in the water main while maintaining a residual pressure of 20 psi at the hydrant. No extended period simulations were completed in this analysis to assess the water quality or to assess the hydraulic impact on storage and pumping.

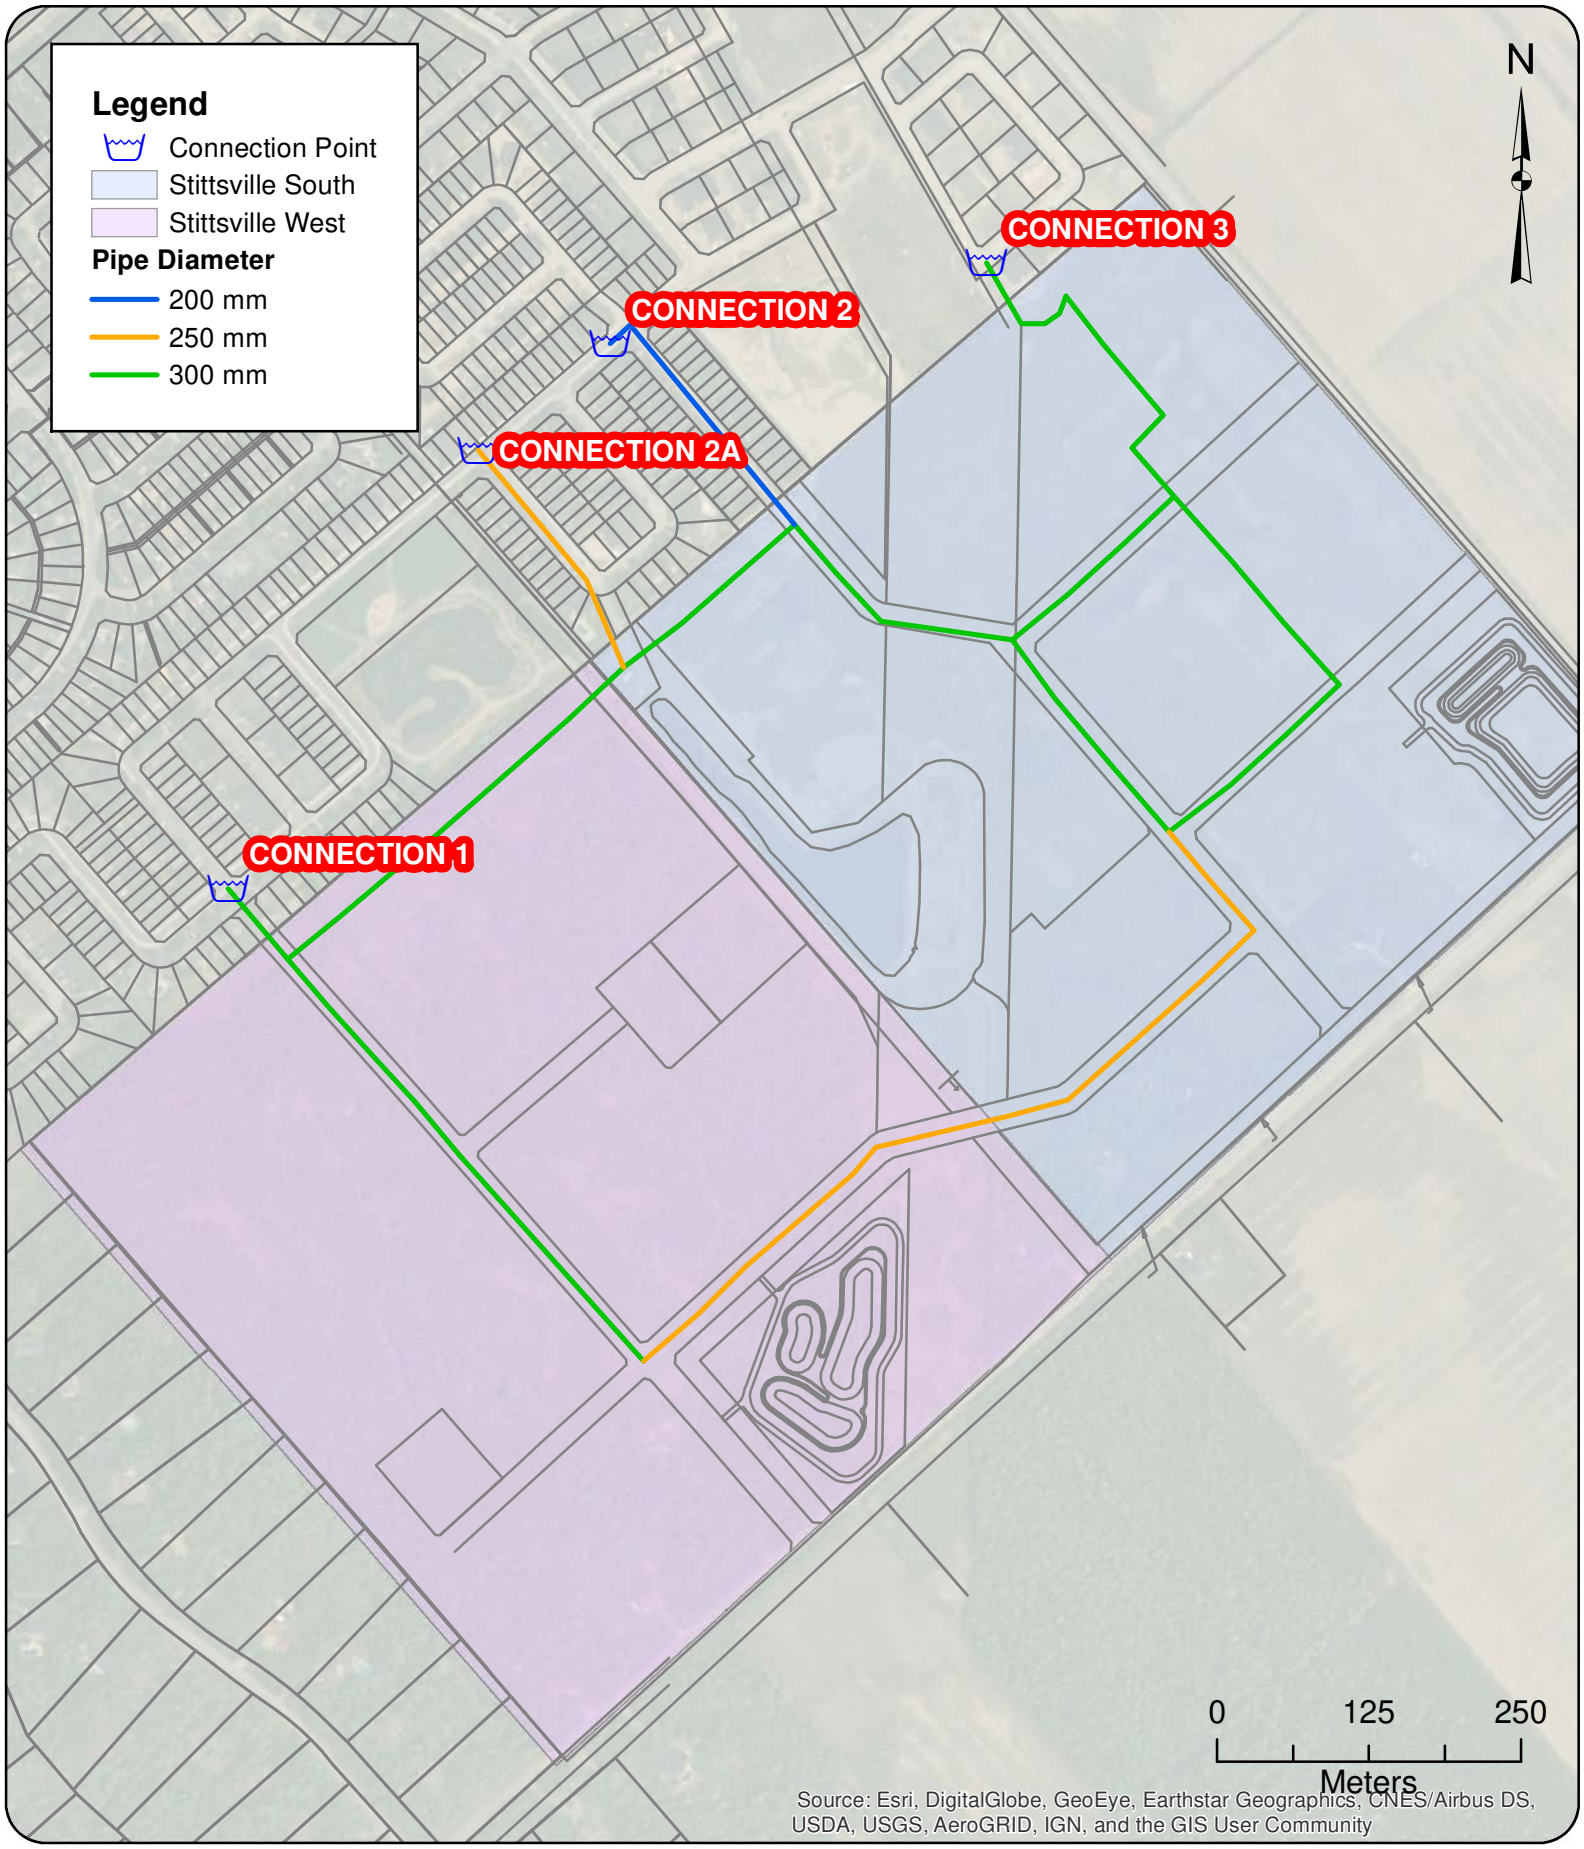

GeoAdvice Engineering Inc.

Project: **Hydraulic Capacity and Modeling Analysis SSUEA 2022-018-DSE**
Client: **David Schaeffer Engineering Ltd.**
Date: **December 2023**
Created by: **BL**
Reviewed by: **WdS**

DISCLAIMER: GeoAdvice does not warrant in any way the accuracy and completeness of the information shown on this map. Field verification of the accuracy and completeness of the information shown on this map is the sole responsibility of the user.

SSUEA
Site Layout and Connection Point

Figure 1.1

2 Modeling Considerations

2.1 Water Main Configuration

The trunk water main network was modeled based on drawings prepared by DSEL and provided to GeoAdvice on September 1, 2023, and November 17, 2023.

2.2 Elevations

Elevations of the modeled junctions were assigned according to a preliminary site grading plan at road level, which was prepared by DSEL and provided to GeoAdvice on September 1, 2023.

2.3 Consumer Demands

The proposed residential demands for the development were based on a demand rate of 280 L/cap/d as per City of Ottawa technical bulletin ISTB 2018-01. Demand factors used for this analysis were taken according to the Ministry of Environment (MOE) Design Guidelines for subdivision populations of 3,001 capita - 10,000 capita. A summary of these tables highlighting relevant data for this development is shown in **Table 2.1**.

Table 2.1: City of Ottawa Demand Factors

Demand Type	Amount	Units
Average Day Demand		
Residential	280	L/c/d
Park	28,000	L/ha/d
Maximum Daily Demand		
Residential	2.0 x avg. day	L/c/d
Park	1.5 x avg. day	L/ha/d
Peak Hour Demand		
Residential	3.0 x avg. day	L/c/d
Park	1.8 x avg. day	L/ha/d

Table 2.2 and **Table 2.3** summarize the water demand calculations for proposed development.

Table 2.2: Development Population and Demand Calculations - Residential

Dwelling Type	Number of Units	Persons Per Unit*	Population	Average Day Demand (L/s)	Maximum Day Demand (L/s)	Peak Hour Demand (L/s)
Single Detached	676	3.4	2,299	7.5	14.9	22.4
Back-to-back Townhome	462	2.3	1,063	3.4	6.9	10.3
Traditional Townhome	679	2.7	1,834	5.9	11.9	17.8
Total	**1,817**		**5,196**	**16.8**	**33.7**	**50.5**

*City of Ottawa Design Guidelines.

Table 2.3: Park Demand Calculations

Dwelling Type	Area (ha)	Average Day Demand (L/s)	Maximum Day Demand (L/s)	Peak Hour Demand (L/s)
Park	0.12	0.04	0.06	0.11

Table 2.4 summarizes the water demand calculations for the hold-out lands adjacent to the development**.**

Table 2.4: Holdout Lands Demand Calculations

Dwelling Type	Area (ha)	Average Day Demand (L/s)	Maximum Day Demand (L/s)	Peak Hour Demand (L/s)
Residential	4.75	1.4	2.8	4.2

Detailed calculations of demands are shown in **Appendix A**.

2.4 Fire Flow Demand

Fire flow demands are typically determined in accordance with the Fire Underwriters Survey's Water Supply for Public fire Protection guideline (2020). FUS calculations are based on the types of building, floor area, number of storeys, construction class, occupancy class and exposure factor. At this time, there is not enough information about the building construction details to complete FUS calculations. As such, the following required fire flow were assumed:

- Park: 167 L/s
- Single family: 167 L/s
- Multi-family/medium density: 217 L/s

FUS calculations should be completed once detailed drawings become available to validate the required fire flow assumption. The FUS fire flows may vary from those assumed in this report.

Fire flow simulations were completed at each model node under the most conservative required fire flow value. The locations of nodes do not necessarily represent hydrant locations. Detailed FUS fire flow calculations as well as the illustrated spatial allocation of the required fire flows are shown in **Appendix B**.

2.5 Boundary Conditions

The boundary conditions were provided by the City of Ottawa in the form of Hydraulic Grade Line (HGL) at the following locations:

- Connection 1: Parade Drive
- Connection 2: Hickstead Way via Painted Sky Way
- Connection 2A: Hickstead Way via Aridius Crescent
    - An additional connection was modeled with the assumption of identical HGL values to Connection 2 based on the location proximity
- Connection 3: Ocaia Street

The four connections to the proposed development are illustrated in **Figure 1.1**.

Boundary conditions were provided for Peak Hour (PHD), Maximum Day plus Fire (MDD+FF) and Average Day (high pressure check, ADD) demand conditions. The City boundary conditions were provided to GeoAdvice on May 30, 2023, and can be found in **Appendix C**.

Table 2.5 summarizes the City of Ottawa boundary conditions ("Scenario 3") used to size the water network.

Table 2.5: Boundary Conditions ("Scenario 3")

Condition	Connection 1 HGL (m)	Connection 2 HGL (m)	Connection 2A HGL (m)	Connection 3 HGL (m)
Average Day (max. pressure)	160.4	160.4	160.4	160.4
Peak Hour (min. pressure)	150.0	149.8	149.8	149.7
Max Day + Fire Flow (167 L/s)	142.8	140.4	140.4	136.1
Max Day + Fire Flow (217 L/s)	134.8	131.0	131.0	124.2

3 Hydraulic Capacity Design Criteria

3.1 Pipe Characteristics

Pipe characteristics of internal diameter (ID) and Hazen-Williams C factors were assigned in the model according to the City of Ottawa Design Guidelines for PVC water main material. Pipe characteristics used for the development are outlined in **Table 3.1** below.

Table 3.1: Model Pipe Characteristics

Nominal Diameter (mm)	ID PVC (mm)	Hazen Williams C-Factor (/)
250	250	110
300	297	120

3.2 Pressure Requirements

As outlined in the City of Ottawa Design Guidelines, the generally accepted best practice is to design new water distribution systems to operate between 350 kPa (50 psi) and 480 kPa (70 psi). The maximum pressure at any point in the distribution system in occupied areas outside of the public right-of-way shall not exceed 552 kPa (80 psi). Pressure requirements are outlined in **Table 3.2.**

Table 3.2: Pressure Requirements

Demand Condition	Minimum Pressure		Maximum Pressure	
	(kPa)	(psi)	(kPa)	(psi)
Normal Operating Pressure (maximum daily flow)	350	50	480	70
Peak Hour Demand (minimum allowable pressure)	276	40	-	-
Maximum Fixture Pressure (Ontario Building Code)	-	-	552	80
Maximum Distribution Pressure (minimum hour check)	-	-	552	80
Maximum Day Plus Fire	140	20	-	-

4 Hydraulic Capacity Analysis

The proposed trunk water mains within the development were sized to the minimum diameter which would satisfy the greater of maximum day plus fire and peak hour demand. Modeling was carried out for average day, peak hour and maximum day plus fire flow using InfoWater.

Detailed pipe and junction model input data can be found in **Appendix D**.

4.1 Development Pressure Analysis

Modeled service pressures for the development is summarized in **Table 4.1**.

Table 4.1: Summary of Available Service Pressures

Average Day Demand Maximum Pressure	Peak Hour Demand Minimum Pressure
78.7 psi (543 kPa)	58.4 psi (402 Pa)

As outlined in the City of Ottawa Design Guidelines, the generally accepted best practice is to design new water distribution systems to operate between 350 kPa (50 psi) and 480 kPa (70 psi). The maximum pressure at any point within the distribution system in occupied areas outside of the public right-of-way shall not exceed 552 kPa (80 psi) and the minimum pressure at any point within the distribution system shall not fall below 270 kPa (40 psi). As such, based on the City boundary conditions, pressure reducing valves are not predicted to be required throughout development.

Detailed result tables and figures can be found in **Appendix E**.

4.2 Development Fire Flow Analysis

Summaries of the minimum available fire flows in the development are shown in **Table 4.2**.

Table 4.2: Summary of the Minimum Available Fire Flows

Required Fire Flow	Minimum Available Flow*	Junction ID
167 L/s	273 L/s	JCT-STV-066
217 L/s	254 L/s	JCT-STV-048

*The predicted available fire flows, as calculated by the hydraulic model, represent the flow available in the water main while maintaining a residual pressure of 20 psi at the hydrant. High available fire flows (>500 L/s) are theoretical values. Actual available fire flow is limited by the hydraulic losses through the hydrant lateral and hydrant port sizes.

As shown in **Table 4.2**, the fire flow requirements can be met at all junctions within the development.

Summaries of the residual pressures in the development are shown in **Table 4.3**. The minimum allowable pressure under fire flow conditions is 140 kPa (20 psi) at the location of the fire.

Table 4.3: Summary of the Residual Pressures (MDD + FF)

Minimum Residual Pressure	Average Residual Pressure	Maximum Residual Pressure
23.8 psi (164 kPa)	40.5 psi (279 kPa)	47.2 psi (325 kPa)

As shown in **Table 4.3**, there is sufficient residual pressure at all the junctions within the development.

Detailed fire flow results and figures illustrating the fire flow results can be found in **Appendix F**.

Additional hydraulic modeling should be conducted once the internal water main network has been designed, in order to validate the proposed trunk main diameters discussed within this report.

5 Other Servicing Considerations

5.1 Water Supply Security

The City of Ottawa Design Guidelines allow single feed systems for developments up to a total average day demand of 50 m^3/day and require two (2) feeds if the development exceeds 50 m^3/day for supply security, according to Technical Bulletin ISDTB-2021-03.

The development services a total average day demand of 1,580 m^3/day; as such, two (2) feeds are required. The development has four (4) feeds, which were modeled as part of this analysis.

5.2 Valves

No comment has been made in this report with respect to exact placement of isolation valves within the distribution network for the development other than to summarize the City of Ottawa Design Guidelines for number, location, and spacing of isolation valves:

- Tee intersection – two (2) valves
- Cross intersection – three (3) valves
- Valves shall be located 2 m away from the intersection
- 300 m spacing for 150 mm to 400 mm diameter valves
- Gate valves for 100 mm to 300 mm diameter mains
- Butterfly valves for 400 mm and larger diameter mains

Drain valves are not strictly required under the City of Ottawa Design Guidelines for water mains under 600 mm in diameter. The Guidelines indicate that “small diameter water mains shall be drained through hydrant via pumping if needed.”

Air valves are not strictly required under the City of Ottawa Design Guidelines for water mains up to and including 400 mm in diameter. The Guidelines indicate that air removal “can be accomplished by the strategic positioning of hydrant at the high points to remove the air or by installing or utilizing available 50 mm chlorination nozzles in 300 mm and 400 mm chambers.”

The detailed engineering drawings for the development are expected to identify valves in accordance with the requirements noted above.

5.3 Hydrants

No additional comment has been made in this report with respect to exact placement of hydrants within the distribution network for the development other than to summarize the City of Ottawa Design Guidelines for maximum hydrant spacing:

- 125 m for single family unit residential areas on lots where frontage at the street line is 15 m or longer
- 110 m for single family unit residential areas on lots where frontage at the street line is less than 15 m and for residential areas zoned for row housing, doubles, or duplexes
- 90 m for institutional, commercial, industrial, apartments and high-density areas

The detailed engineering drawings for the development are expected to identify hydrant locations in accordance with the requirements noted above.

5.4 Water Quality

The turnover rate of the water within the development network only, calculated from the connections to the development is about 3 hours (ADD is 1,580 m^3/day).

The above rate is based on the volume of the development network and the development average day demand.

6 Conclusions

The hydraulic capacity and modeling analysis of the Sittsville South Urban Expansion Area development yielded the following conclusions:

- The proposed water main network can deliver all domestic flows under the ADD and the PHD conditions. Service pressures are expected to range between 58 psi (402 kPa) and 79 psi (543 kPa).
- The proposed trunk water main network is able to deliver fire flows at all junctions.

Submission

Prepared by:

August 8, 2024

Ben Loewen, P.Eng., GDBA, PMP.
Project Engineer / Project Manager

Approved by:

Werner de Schaetzen, Ph.D., P.Eng.
Senior Modeling Review

Appendix A Domestic Water Demand Calculations and Allocation

Consumer Water Demands

Stittsville West - Residential Demands

Dwelling Type	Number of Units	Population		Average Day Demand			Max Day 2.0 x Avg. Day (L/s)	Peak Hour 3 x Avg. Day (L/s)
		Persons per Unit	Population Per Dwelling Type	(L/c/d)	(L/d)	(L/s)		
Single Detached	449	3.4	1,527	280	427,560	4.95	9.90	14.85
Back-to-Back Townhome	162	2.3	373		104,440	1.21	2.42	3.63
Traditional Townhome	374	2.7	1,010		282,800	3.27	6.55	9.82
Subtotal	**985**		**2,910**		**814,800**	**9.43**	**18.86**	**28.29**

Stittsville West - Non Residential Demands

Property Type	Area (ha)			Average Day Demand			Max Day 1.5 x Avg. Day (L/s)	Peak Hour 1.8 x Max Day (L/s)
				(L/ha/d)	(L/d)	(L/s)		
Park	0.07			28,000	1,963	0.02	0.03	0.06
Subtotal	**0.07**				**1,963**	**0.02**	**0.03**	**0.06**

Future Development & Holdouts 1 - Residential Demands

Dwelling Type	Area (ha)	Population		Average Day Demand			Max Day 2.0 x Avg. Day (L/s)	Peak Hour 3 x Avg. Day (L/s)
		Persons per Ha	Population Per Dwelling Type	(L/c/d)	(L/d)	(L/s)		
Residential	2	90.0	150	280	42,000	0.49	0.97	1.46
Subtotal	**2**		**150**		**42,000**	**0.49**	**0.97**	**1.46**

Stittsville South - Residential Demands

Dwelling Type	Number of Units	Population		Average Day Demand			Max Day 2.0 x Avg. Day (L/s)	Peak Hour 3 x Avg. Day (L/s)
		Persons per Unit	Population Per Dwelling Type	(L/c/d)	(L/d)	(L/s)		
Single Detached	227	3.4	772	280	216,160	2.50	5.00	7.51
Back-to-Back Townhome	300	2.3	690		193,200	2.24	4.47	6.71
Traditional Townhome	305	2.7	824		230,720	2.67	5.34	8.01
Subtotal	**832**		**2,286**		**640,080**	**7.41**	**14.82**	**22.23**

Stittsville South - Non Residential Demands

Property Type	Area (ha)			Average Day Demand			Max Day 1.5 x Avg. Day (L/s)	Peak Hour 1.8 x Max Day (L/s)
				(L/ha/d)	(L/d)	(L/s)		
Park	0.12			28,000	3,405	0.04	0.06	0.11
Subtotal	**0.12**				**3,405**	**0.04**	**0.06**	**0.11**

Future Development & Holdouts 2 - Residential Demands

Dwelling Type	Area (ha)	Population		Average Day Demand			Max Day 2.0 x Avg. Day (L/s)	Peak Hour 3 x Avg. Day (L/s)
		Persons per Ha	Population Per Dwelling Type	(L/c/d)	(L/d)	(L/s)		
Residential	1.60	90.0	145	280	40,600	0.47	0.94	1.41
Subtotal			**145**		**40,600**	**0.47**	**0.94**	**1.41**

Future Development & Holdouts 3 - Residential Demands

Dwelling Type	Area (ha)	Population		Average Day Demand			Max Day 2.0 x Avg. Day (L/s)	Peak Hour 3 x Avg. Day (L/s)
		Persons per Ha	Population Per Dwelling Type	(L/c/d)	(L/d)	(L/s)		
Residential	0.67	90.0	61	280	17,080	0.20	0.40	0.59
Subtotal			**61**		**17,080**	**0.20**	**0.40**	**0.59**

Future Development & Holdouts 4 - Residential Demands

Dwelling Type	Area (ha)	Population		Average Day Demand			Max Day 2.0 x Avg. Day (L/s)	Peak Hour 3 x Avg. Day (L/s)
		Persons per Ha	Population Per Dwelling Type	(L/c/d)	(L/d)	(L/s)		
Residential	0.81	90.0	73	280	20,440	0.24	0.47	0.71
Subtotal			**73**		**20,440**	**0.24**	**0.47**	**0.71**

		Average Day	Max Day	Peak Hour
Stittsville West		**9.94**	**19.87**	**29.81**
Stittsville South		**8.35**	**16.68**	**25.04**

*Peaking factors based on development population of 3,001-10,000 capita from the MOE Design Guidelines

Demand Calculations and Allocation

Drummond Lands Domestic Demands

Demand Polygon	Junction ID	Dwelling Type	Number of Units	Population	Average Day Demand			Max Day 2.0 x Avg. Day (L/s)	Peak Hour 3.0 x Avg. Day (L/s)
					L/c/d	L/d	L/s		
1	JCT-STV-001	Single Detached	148	503	280	140,933	0.41	0.82	1.22
	JCT-STV-008						0.41	0.82	1.22
	JCT-STV-009						0.41	0.82	1.22
	JCT-STV-010						0.41	0.82	1.22
2	JCT-STV-015	Single Detached	165	561	280	157,121	0.45	0.91	1.36
	JCT-STV-019						0.45	0.91	1.36
	JCT-STV-020						0.45	0.91	1.36
	JCT-STV-021						0.45	0.91	1.36
3	JCT-STV-029	Traditional Townhouse	225	608	280	170,134	0.98	1.97	2.95
	JCT-STV-049						0.98	1.97	2.95
4	JCT-STV-053	Single Detached	116	395	280	110,461	0.62	1.24	1.86
	JCT-STV-054						0.62	1.24	1.86
	JCT-STV-066	Traditional Townhouse	66	178	280	49,906	0.62	1.24	1.86
5	JCT-STV-048	Single Detached	20	68	280	19,045	2.16	4.31	6.47
		Traditional Townhouse	83	224	280	62,760			
		Back-to-Back Townhouse	162	373	280	104,440			
6	JCT-STV-068	Single Detached	81	275	280	77,132	0.18	0.36	0.54
	JCT-STV-075						0.18	0.36	0.54
	JCT-STV-076						0.18	0.36	0.54
	JCT-STV-077						0.18	0.36	0.54
	JCT-STV-078						0.18	0.36	0.54
7	JCT-STV-083	Single Detached	66	224	280	62,848	0.18	0.36	0.55
	JCT-STV-086						0.18	0.36	0.55
	JCT-STV-087						0.18	0.36	0.55
	JCT-STV-088						0.18	0.36	0.55
8	JCT-STV-082	Single Detached	5	17	280	4,761	0.67	1.34	2.01
	JCT-STV-093						0.67	1.34	2.01
	JCT-STV-098	Traditional Townhouse	45	122	280	34,041	0.67	1.34	2.01
	JCT-STV-099	Back-to-Back Townhouse	300	690	280	193,200	0.67	1.34	2.01
9	JCT-STV-079	Single Detached	8	27	280	7,618	0.17	0.34	0.52
	JCT-STV-080						0.17	0.34	0.52
	JCT-STV-081						0.17	0.34	0.52
	JCT-STV-108	Traditional Townhouse	88	238	280	66,568	0.17	0.34	0.52
	JCT-STV-109						0.17	0.34	0.52
10	JCT-STV-067	Single Detached	67	228	280	63,801	0.25	0.51	0.76
	JCT-STV-110						0.25	0.51	0.76
	JCT-STV-114						0.25	0.51	0.76
	JCT-STV-115	Traditional Townhouse	61	165	280	46,144	0.25	0.51	0.76
	JCT-STV-117						0.25	0.51	0.76
11	JCT-STV-104	Traditional Townhouse	111	300	280	83,967	0.49	0.97	1.46
	JCT-STV-107						0.49	0.97	1.46
A1	JCT-STV-048	Residential	1.6658	150	280	42,000	0.49	0.97	1.46
A2	JCT-STV-067	Residential	1.6034	145	280	40,600	0.47	0.94	1.41
A3	JCT-STV-107	Residential	0.6690	61	280	17,080	0.20	0.40	0.59
A4	JCT-STV-082	Residential	0.8095	73	280	20,440	0.24	0.47	0.71
	Total:		**1,822**	**5,625**		**1,575,000**	**18.23**	**36.46**	**54.69**

Drummond Lands Non-Domestic Demands

Property Type	Junction ID	Phase	Area (ha)	Average Day Demand			Max Day 1.5 x Avg. Day (L/s)	Peak Hour 1.8 x Max Day (L/s)
				(L/ha/d)	(L/d)	(L/s)		
Park	JCT-STV-048	Stittsville West	0.04	28,000	1,025	0.01	0.02	0.03
Park	JCT-STV-029	Stittsville West	0.03	28,000	938	0.01	0.02	0.03
Park	JCT-STV-110	Stittsville South	0.04	28,000	991	0.01	0.02	0.03
Park	JCT-STV-076	Stittsville South	0.09	28,000	2,414	0.01	0.02	0.04
	JCT-STV-077					0.01	0.02	0.04
Total:			**0.19**		**5,368**	**0.06**	**0.09**	**0.17**

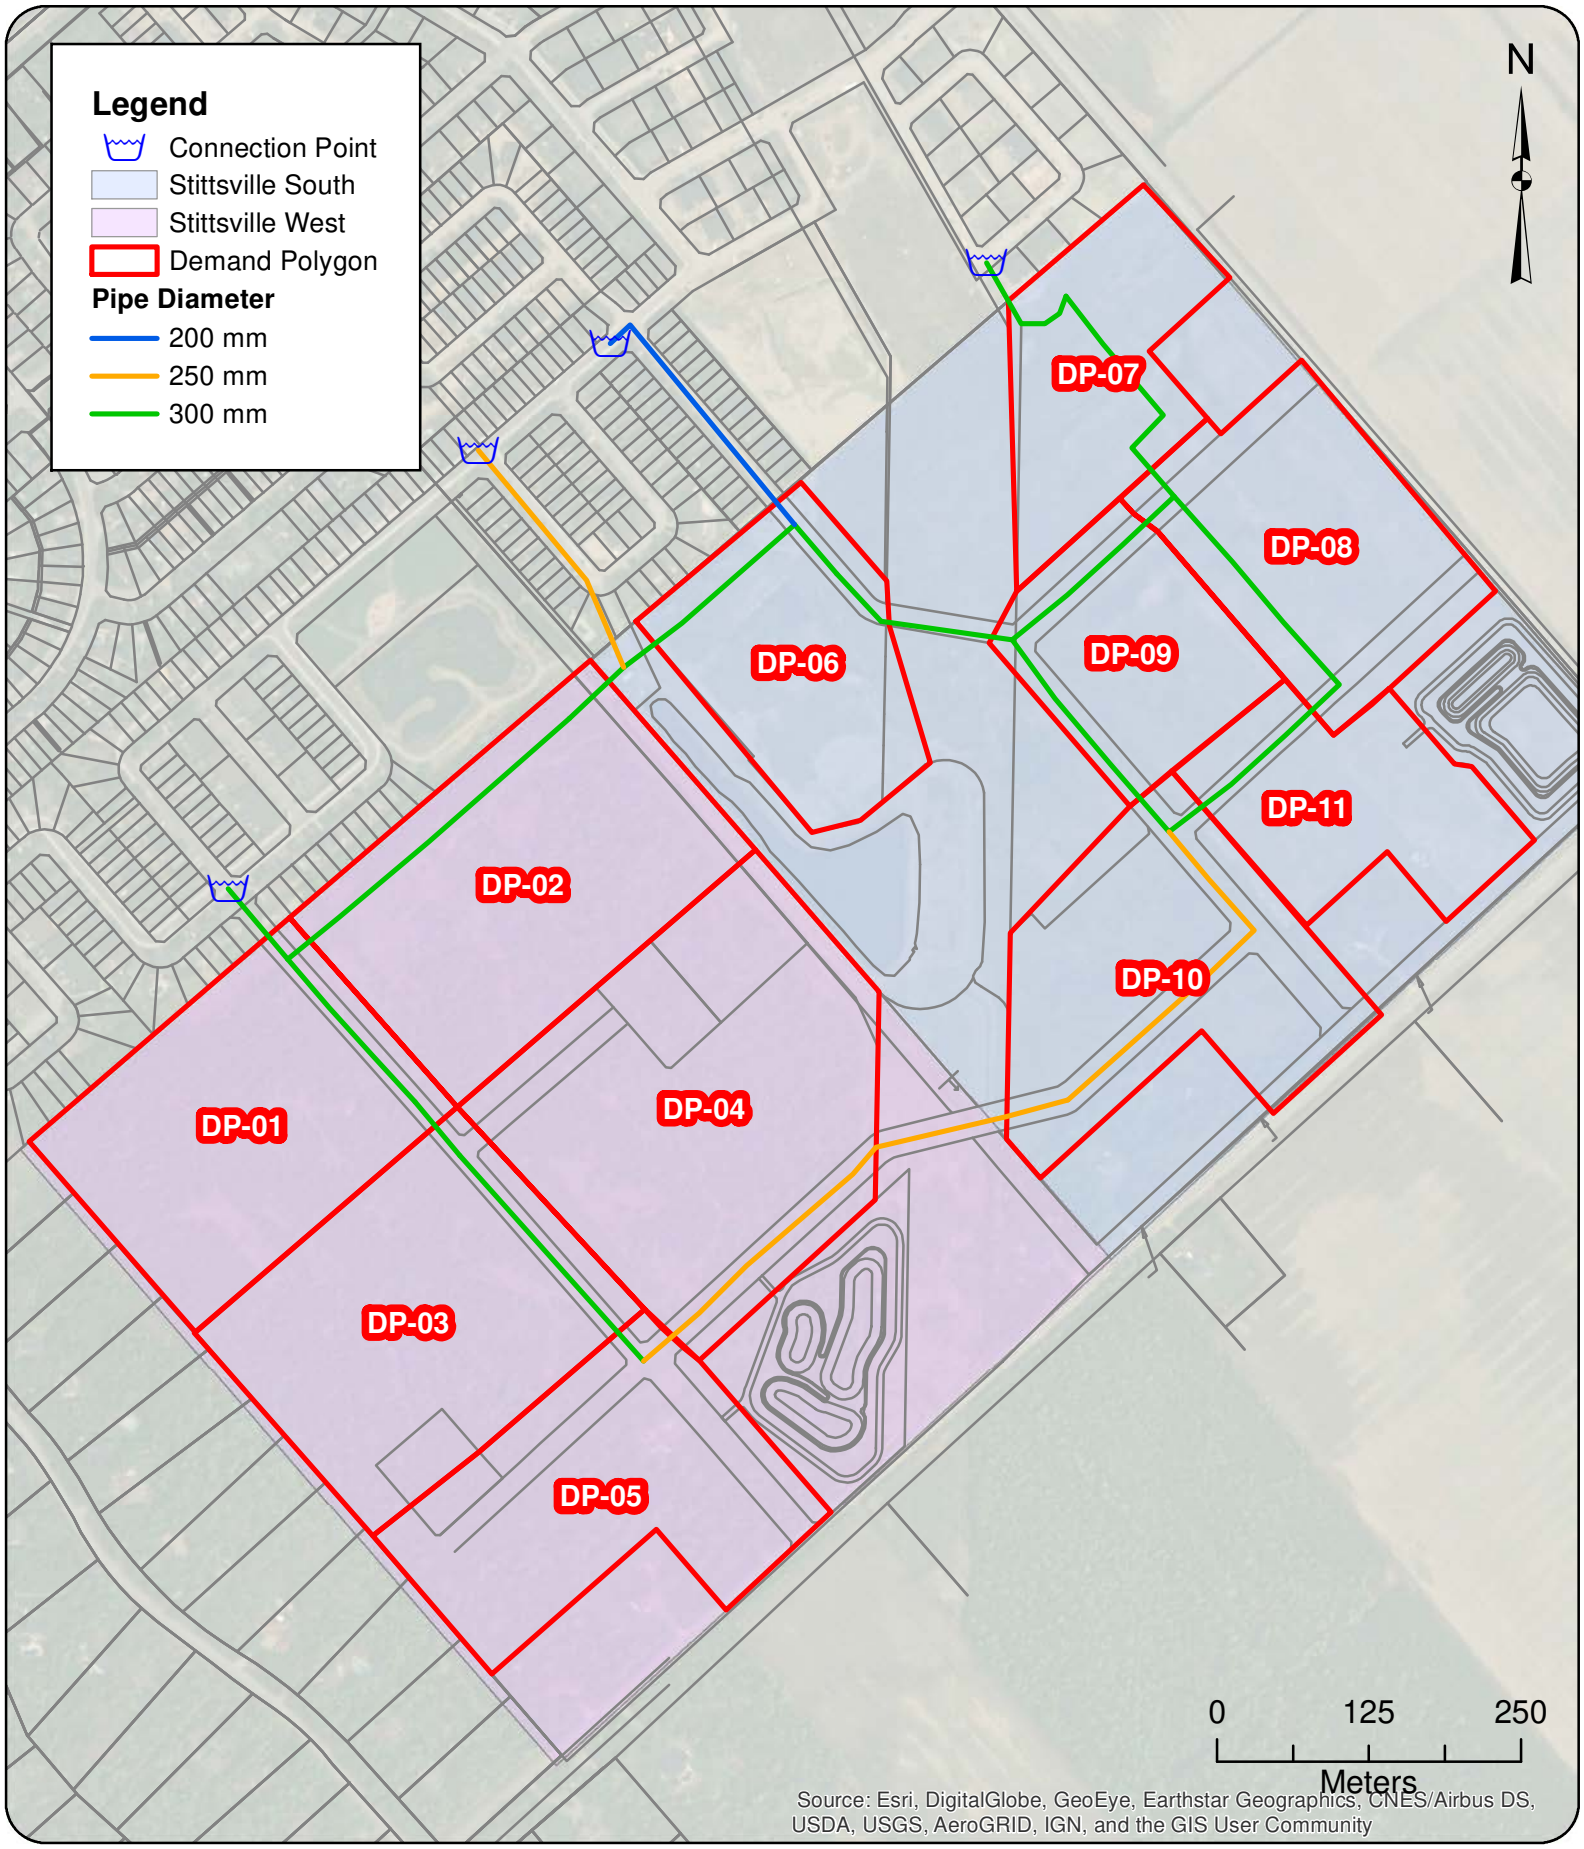

GeoAdvice Engineering Inc.

Project: **Hydraulic Capacity and Modeling Analysis**
SSUEA
2022-018-DSE
Client: **David Schaeffer Engineering Ltd.**
Date: **December 2023**
Created by: **BL**
Reviewed by: **WdS**

DISCLAIMER: GeoAdvice does not warrant in any way the accuracy and completeness of the information shown on this map. Field verification of the accuracy and completeness of the information shown on this map is the sole responsibility of the user.

Demand Allocation

Figure A.1

Appendix B Required Fire Flow Allocation

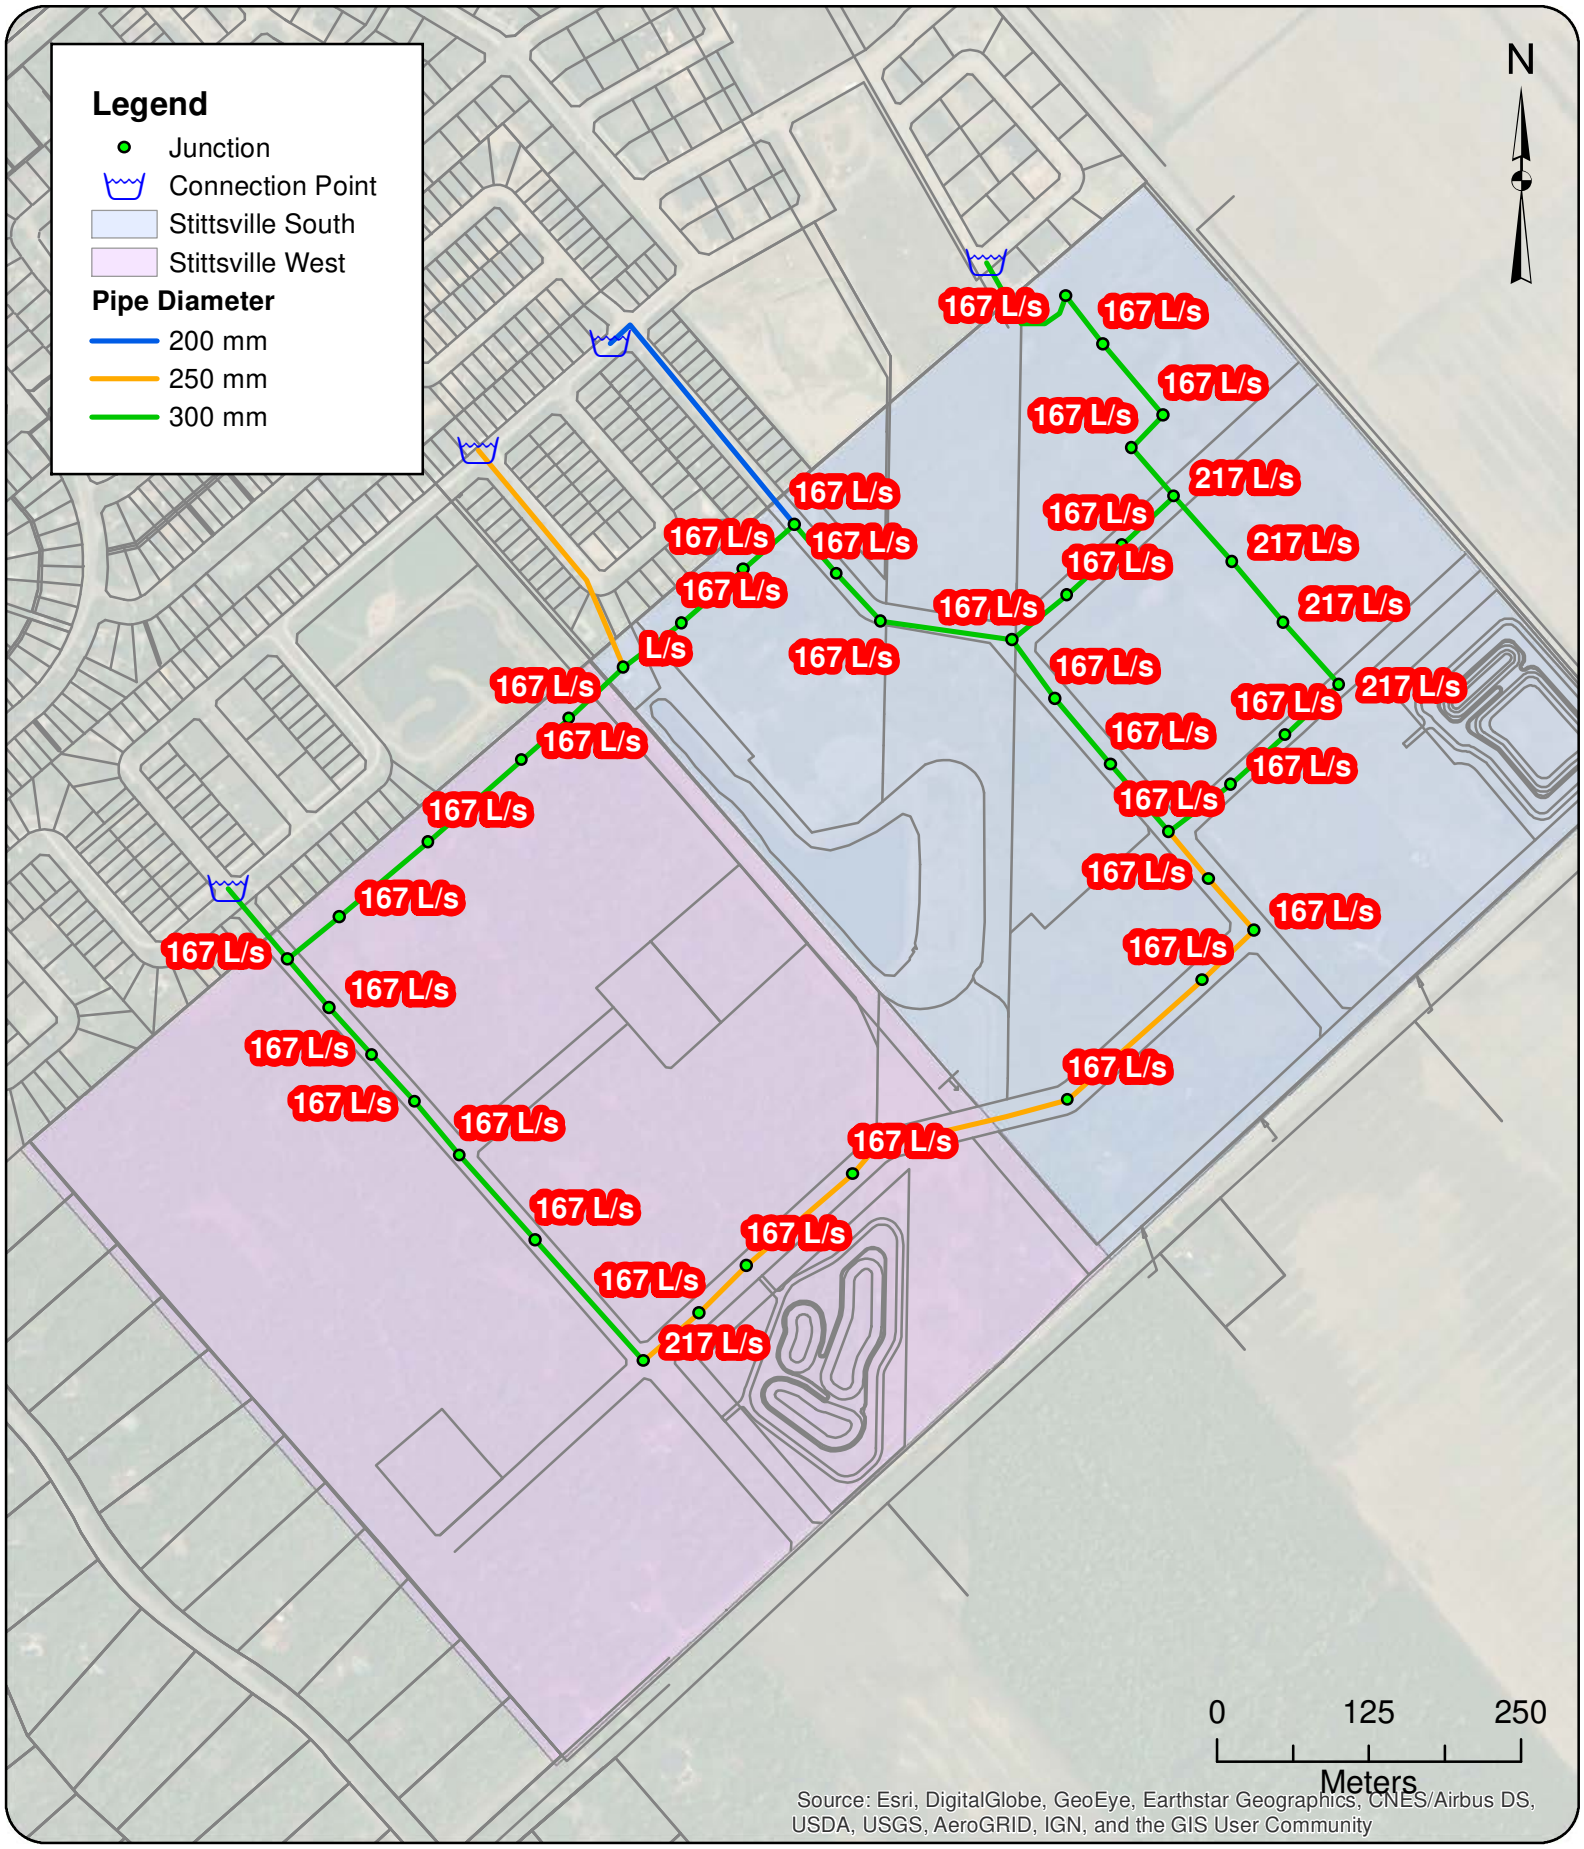

GeoAdvice Engineering Inc.

Project: **Hydraulic Capacity and Modeling Analysis SSUEA 2022-018-DSE**
Client: **David Schaeffer Engineering Ltd.**
Date: **December 2023**
Created by: **BL**
Reviewed by: **WdS**

DISCLAIMER: GeoAdvice does not warrant in any way the accuracy and completeness of the information shown on this map. Field verification of the accuracy and completeness of the information shown on this map is the sole responsibility of the user.

Required Fire Flow

Figure B.1

Appendix C Boundary Conditions

Boundary Conditions
Stittsville South Urban Expansion Area

Provided Information

Scenario	Demand	
	L/min	L/s
Average Daily Demand	1,043	17.39
Maximum Daily Demand	2,059	34.32
Peak Hour	3,114	51.90
Fire Flow Demand #1	10,020	167.00
Fire Flow Demand #2	13,020	217.00
Fire Flow Demand #3	16,980	283.00

Location

Existing Condition Model

Existing Condition with **Conceptual** Looping for Future Servicing Scenario 1

Existing Condition with **Conceptual** Looping for Future Servicing Scenario 2

Results

1. Existing Condition Model (No Future Demand)

Connection 1 - Parade Dr.

Demand Scenario	Head (m)	Pressure[1] (psi)
Maximum HGL	160.2	72.3
Peak Hour	155.2	65.2
Max Day plus Fire Flow #1	143.5	48.7
Max Day plus Fire Flow #2	135.7	37.7
Max Day plus Fire Flow #3	123.2	19.8
[1] Ground Elevation =	109.2	m

Connection 2 - Hickstead Way

Demand Scenario	Head (m)	Pressure[1] (psi)
Maximum HGL	160.2	77.9
Peak Hour	155.2	70.8
Max Day plus Fire Flow #1	139.7	48.8
Max Day plus Fire Flow #2	129.6	34.4
Max Day plus Fire Flow #3	113.1	11.0
[1] Ground Elevation =	105.4	m

Connection 3 - Ocaia St.

Demand Scenario	Head (m)	Pressure[1] (psi)
Maximum HGL	160.2	79.8
Peak Hour	155.2	72.7
Max Day plus Fire Flow #1	127.3	33.0
Max Day plus Fire Flow #2	109.3	7.5
Max Day plus Fire Flow #3	80.0	-34.3
[1] Ground Elevation =	104.1	m

2. Existing Condition Model with Future Demands

Connection 1 – Parade Dr.

Demand Scenario	Head (m)	Pressure[1] (psi)
Maximum HGL	160.4	72.8
Peak Hour	150.1	58.1
Max Day plus Fire Flow #1	142.3	47.1
Max Day plus Fire Flow #2	134.0	35.2

Max Day plus Fire Flow #3	120.7	16.4
[1] Ground Elevation =	109.2	m

Connection 2 – Hickstead Way

Demand Scenario	Head (m)	Pressure[1] (psi)
Maximum HGL	160.4	78.1
Peak Hour	149.6	62.8
Max Day plus Fire Flow #1	137.6	45.7
Max Day plus Fire Flow #2	126.7	30.2
Max Day plus Fire Flow #3	109.2	5.3
[1] Ground Elevation =	105.4	m

Connection 3 – Ocaia St.

Demand Scenario	Head (m)	Pressure[1] (psi)
Maximum HGL	160.4	80.0
Peak Hour	149.2	64.2
Max Day plus Fire Flow #1	123.8	28.0
Max Day plus Fire Flow #2	104.7	0.9
Max Day plus Fire Flow #3	74.0	-42.8
[1] Ground Elevation =	104.1	m

3. Existing Condition with 254 mm Looping for Future Servicing Scenario 1

Connection 1 - Parade Dr.

Demand Scenario	Head (m)	Pressure[1] (psi)
Maximum HGL	160.4	72.8
Peak Hour	150.0	58.0
Max Day plus Fire Flow #1	142.8	47.7
Max Day plus Fire Flow #2	134.8	36.3
Max Day plus Fire Flow #3	122.0	18.2
[1] Ground Elevation =	109.2	m

Connection 2 - Hickstead Way

Demand Scenario	Head (m)	Pressure[1] (psi)
Maximum HGL	160.4	78.2
Peak Hour	149.8	63.1
Max Day plus Fire Flow #1	140.4	49.7
Max Day plus Fire Flow #2	131.0	36.4
Max Day plus Fire Flow #3	116.1	15.2

[1] Ground Elevation = 105.4 m

Connection 3 - Ocaia St.

Demand Scenario	Head (m)	Pressure[1] (psi)
Maximum HGL	160.4	80.1
Peak Hour	149.7	64.9
Max Day plus Fire Flow #1	136.1	45.5
Max Day plus Fire Flow #2	124.2	28.7
Max Day plus Fire Flow #3	105.2	1.7

[1] Ground Elevation = 104.1 m

4. Existing Condition with 254 mm Looping for Future Servicing Scenario 2

Connection 1 - Parade Dr.

Demand Scenario	Head (m)	Pressure[1] (psi)
Maximum HGL	160.4	72.8
Peak Hour	150.0	58.0
Max Day plus Fire Flow #1	142.8	47.7
Max Day plus Fire Flow #2	134.8	36.3
Max Day plus Fire Flow #3	122.0	18.2

[1] Ground Elevation = 109.2 m

Connection 2 - Hickstead Way

Demand Scenario	Head (m)	Pressure[1] (psi)
Maximum HGL	160.4	78.2
Peak Hour	149.8	63.1
Max Day plus Fire Flow #1	140.4	49.7
Max Day plus Fire Flow #2	131.0	36.4
Max Day plus Fire Flow #3	116.1	15.3

[1] Ground Elevation = 105.4 m

Connection 3 - Ocaia St.

Demand Scenario	Head (m)	Pressure[1] (psi)
Maximum HGL	160.4	80.1
Peak Hour	149.7	64.9
Max Day plus Fire Flow #1	136.5	46.1
Max Day plus Fire Flow #2	124.9	29.6
Max Day plus Fire Flow #3	106.3	3.2

[1] Ground Elevation = 104.1 m

Disclaimer

The boundary condition information is based on current operation of the city water distribution system. The computer model simulation is based on the best information available at the time. The operation of the water distribution system can change on a regular basis, resulting in a variation in boundary conditions. The physical properties of watermains deteriorate over time, as such must be assumed in the absence of actual field test data. The variation in physical watermain properties can therefore alter the results of the computer model simulation. Fire Flow analysis is a reflection of available flow in the watermain; there may be additional restrictions that occur between the watermain and the hydrant that the model cannot take into account.

Appendix D Pipe and Junction Model Inputs

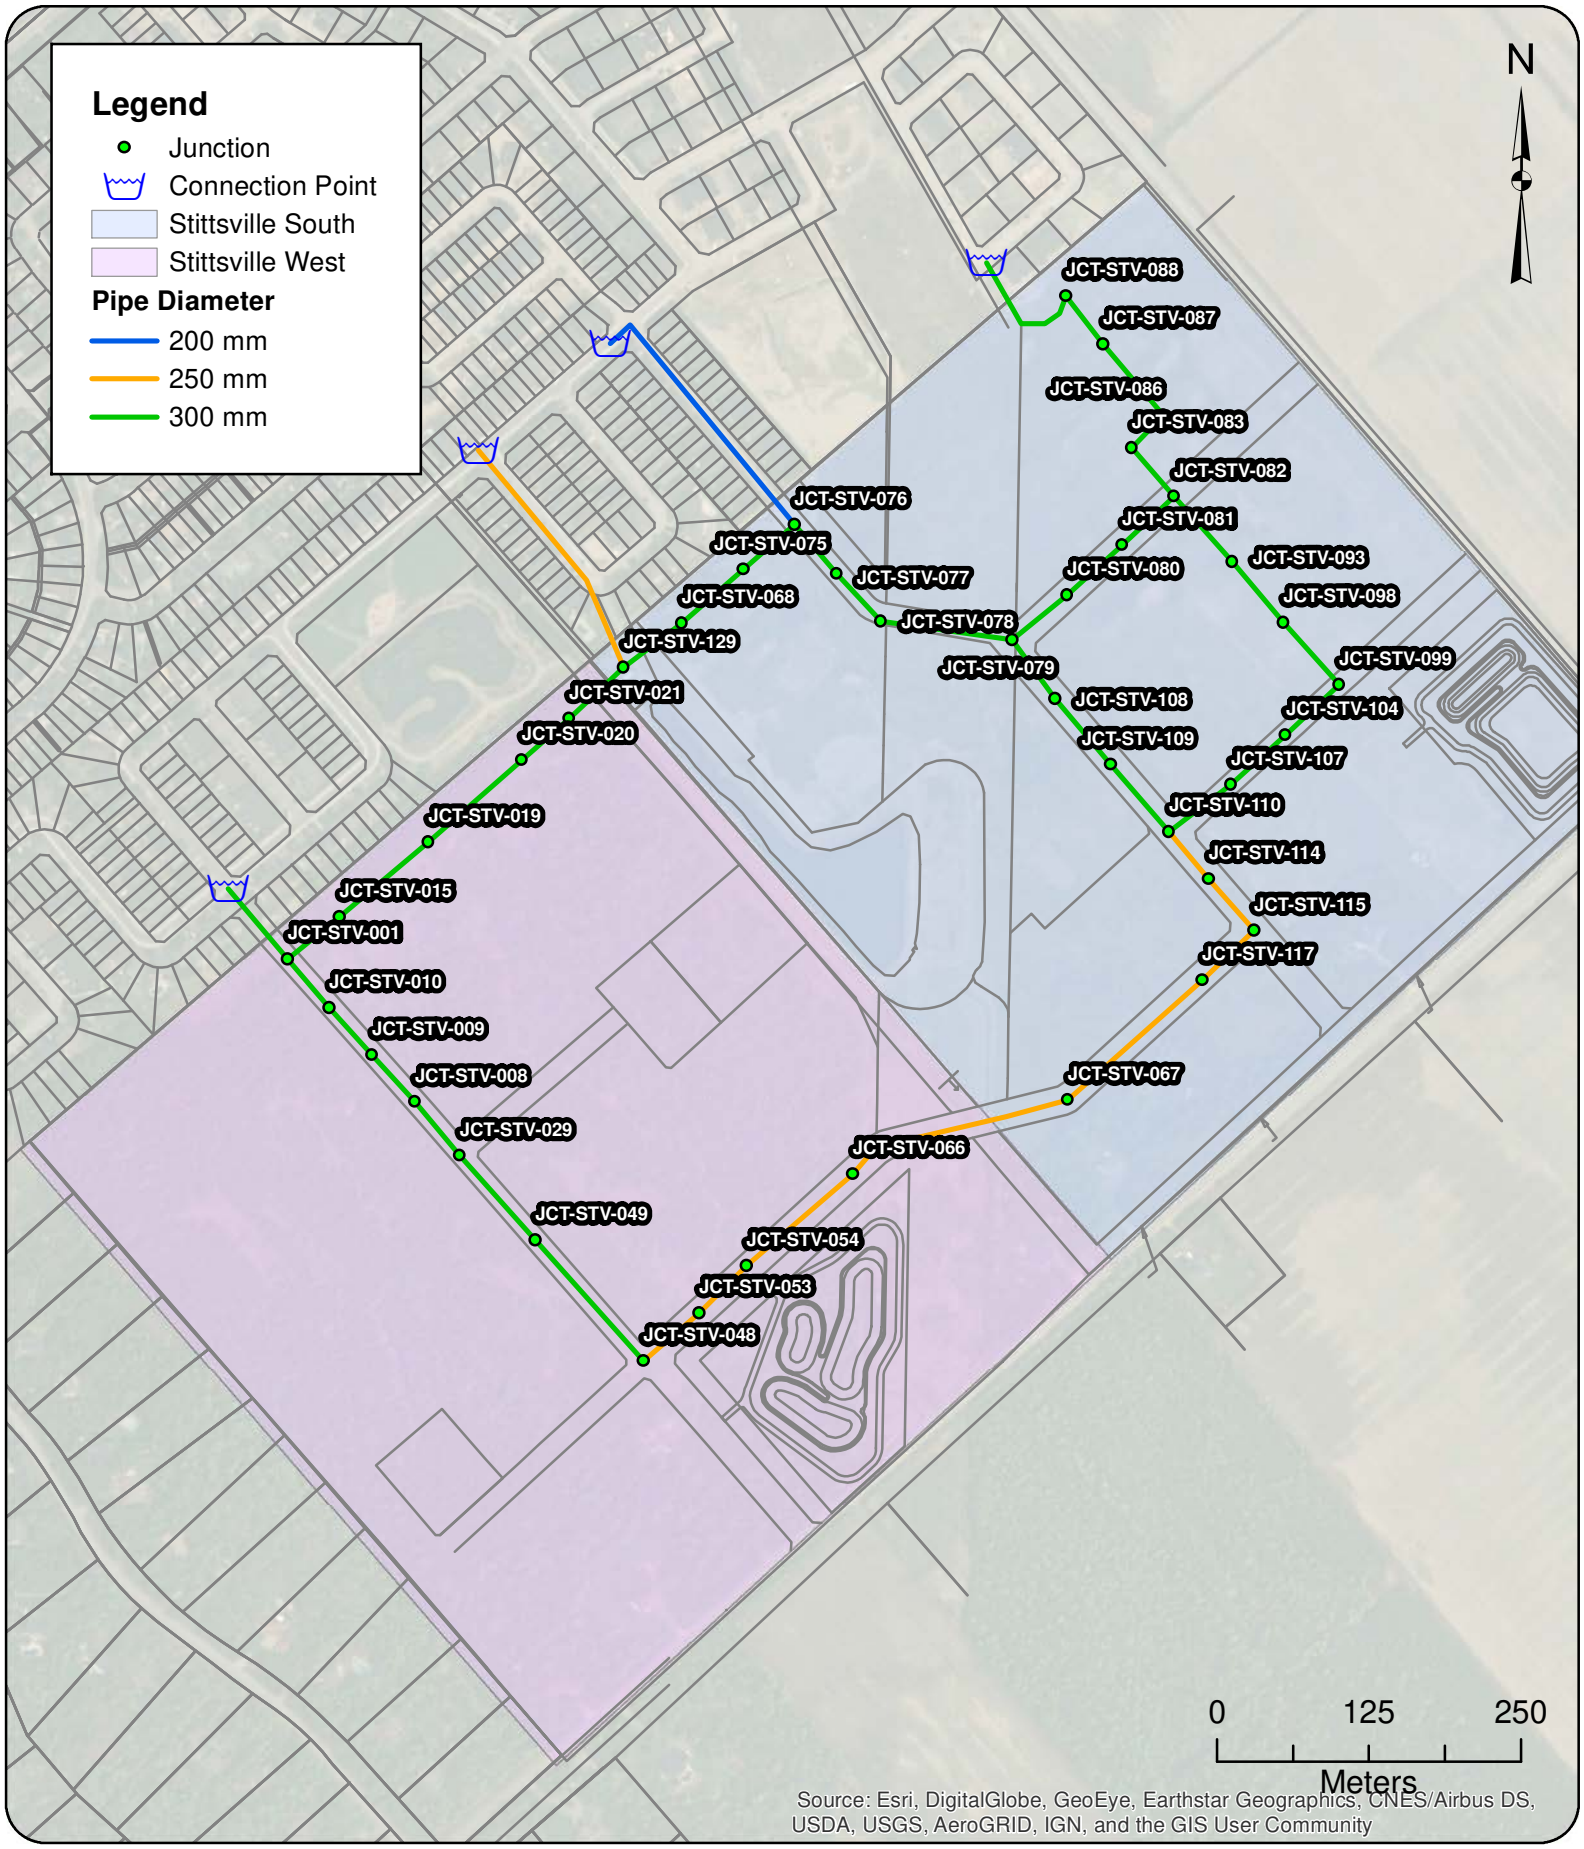

GeoAdvice Engineering Inc.

Project: **Hydraulic Capacity and Modeling Analysis SSUEA 2022-018-DSE**
Client: **David Schaeffer Engineering Ltd.**
Date: **December 2023**
Created by: **BL**
Reviewed by: **WdS**

DISCLAIMER: GeoAdvice does not warrant in any way the accuracy and completeness of the information shown on this map. Field verification of the accuracy and completeness of the information shown on this map is the sole responsibility of the user.

Junction IDs

Figure D.1

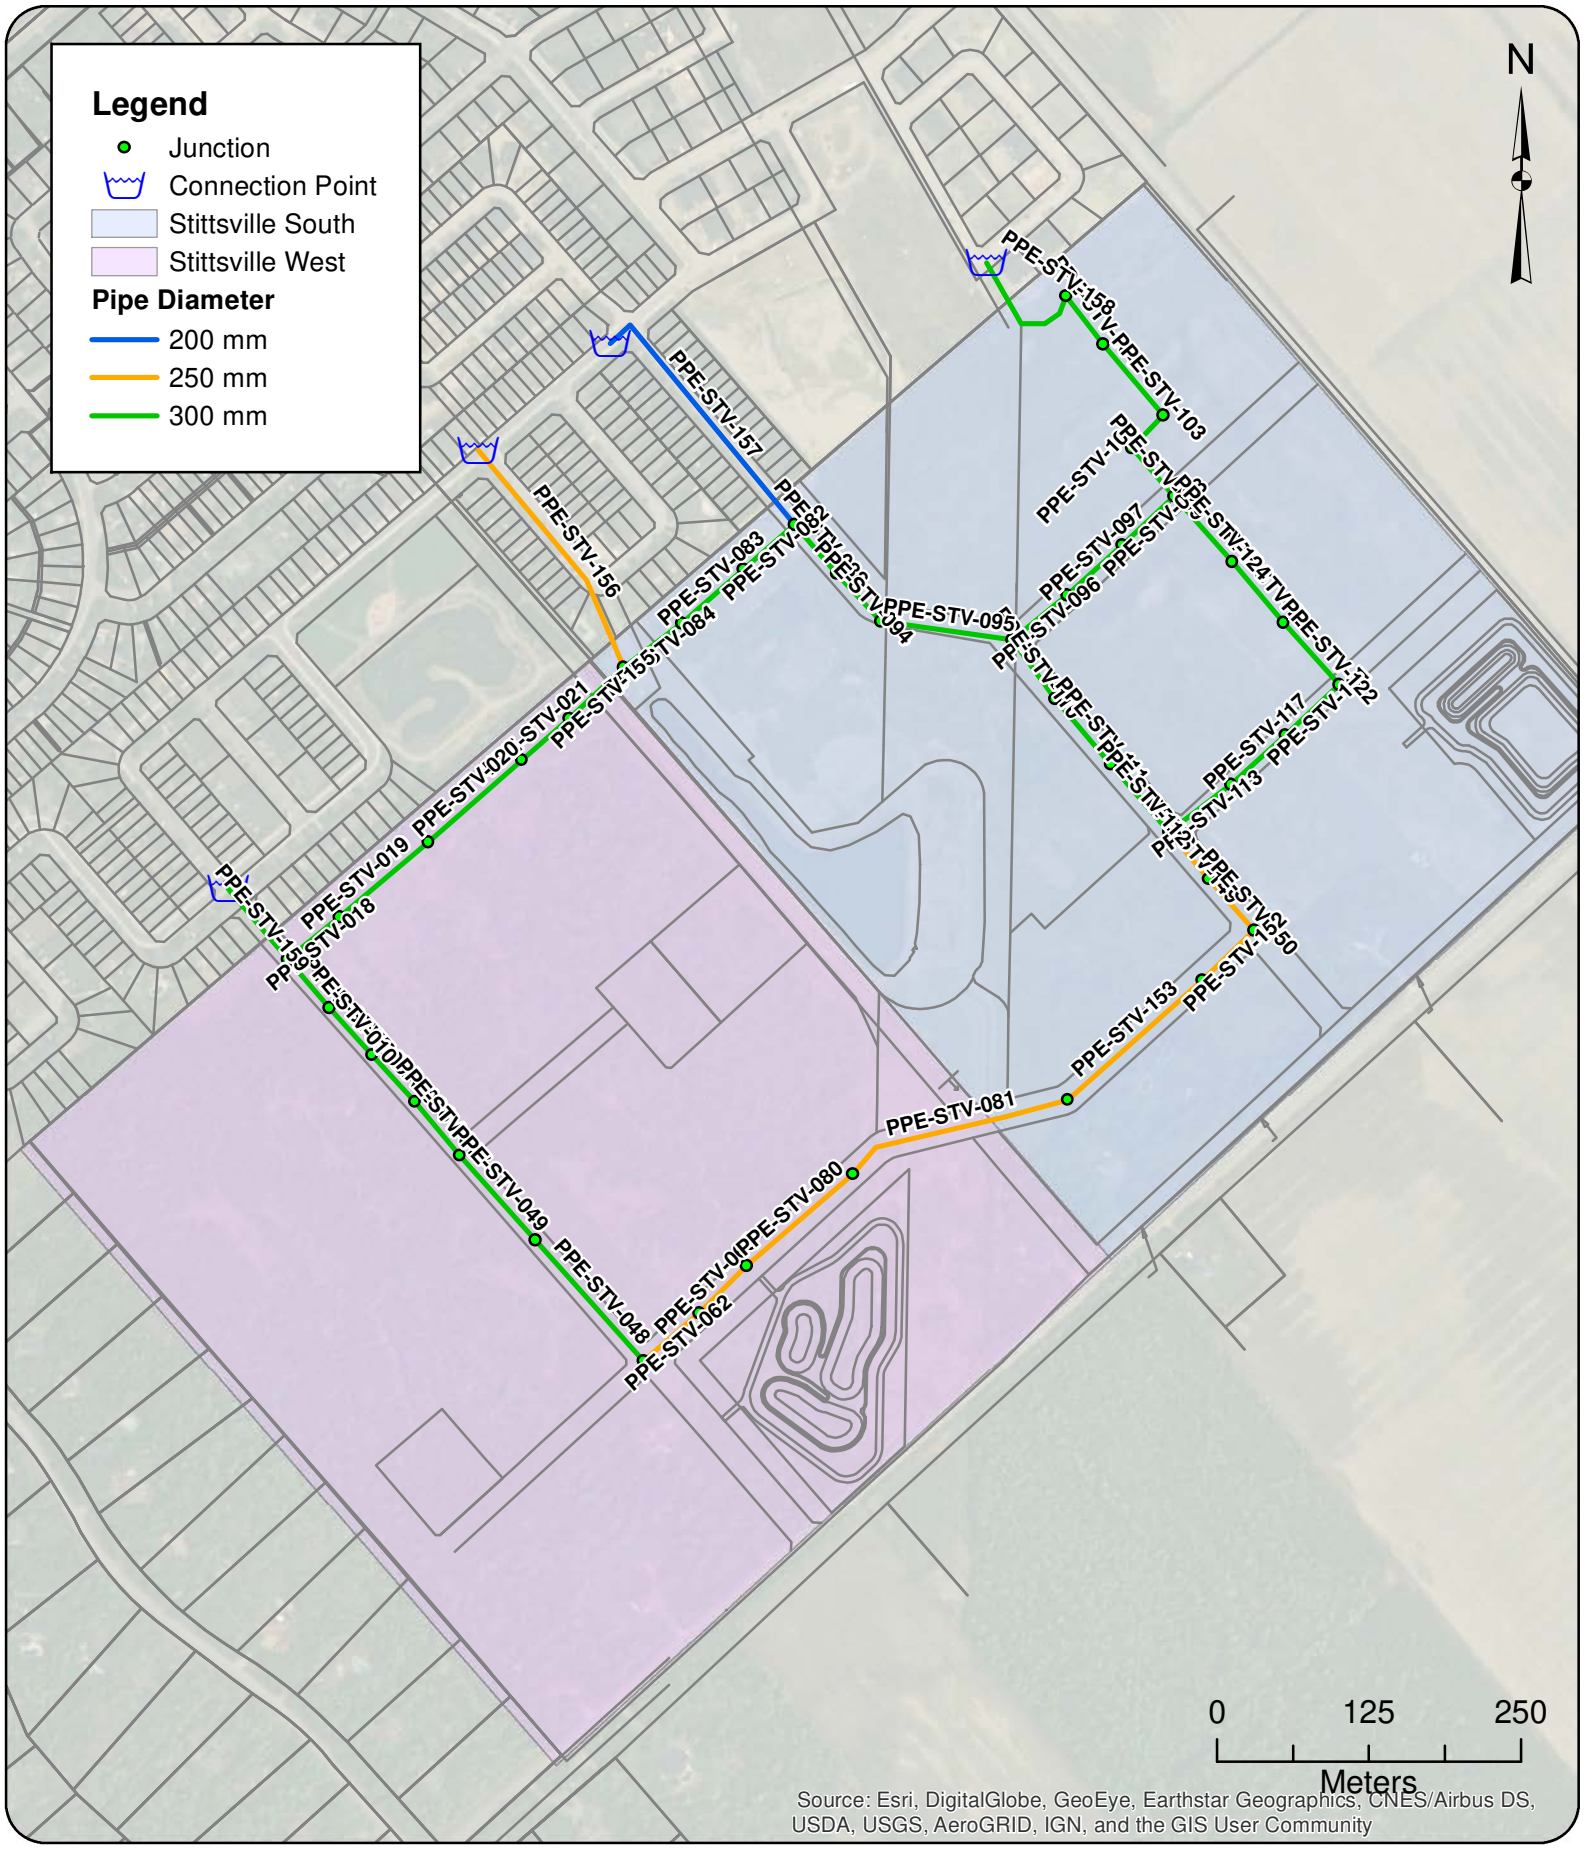

GeoAdvice Engineering Inc.

Project: **Hydraulic Capacity and Modeling Analysis SSUEA 2022-018-DSE**
Client: **David Schaeffer Engineering Ltd.**
Date: **December 2023**
Created by: **BL**
Reviewed by: **WdS**

DISCLAIMER: GeoAdvice does not warrant in any way the accuracy and completeness of the information shown on this map. Field verification of the accuracy and completeness of the information shown on this map is the sole responsibility of the user.

Pipe IDs

Figure D.2

Appendix E ADD and PHD Model Results

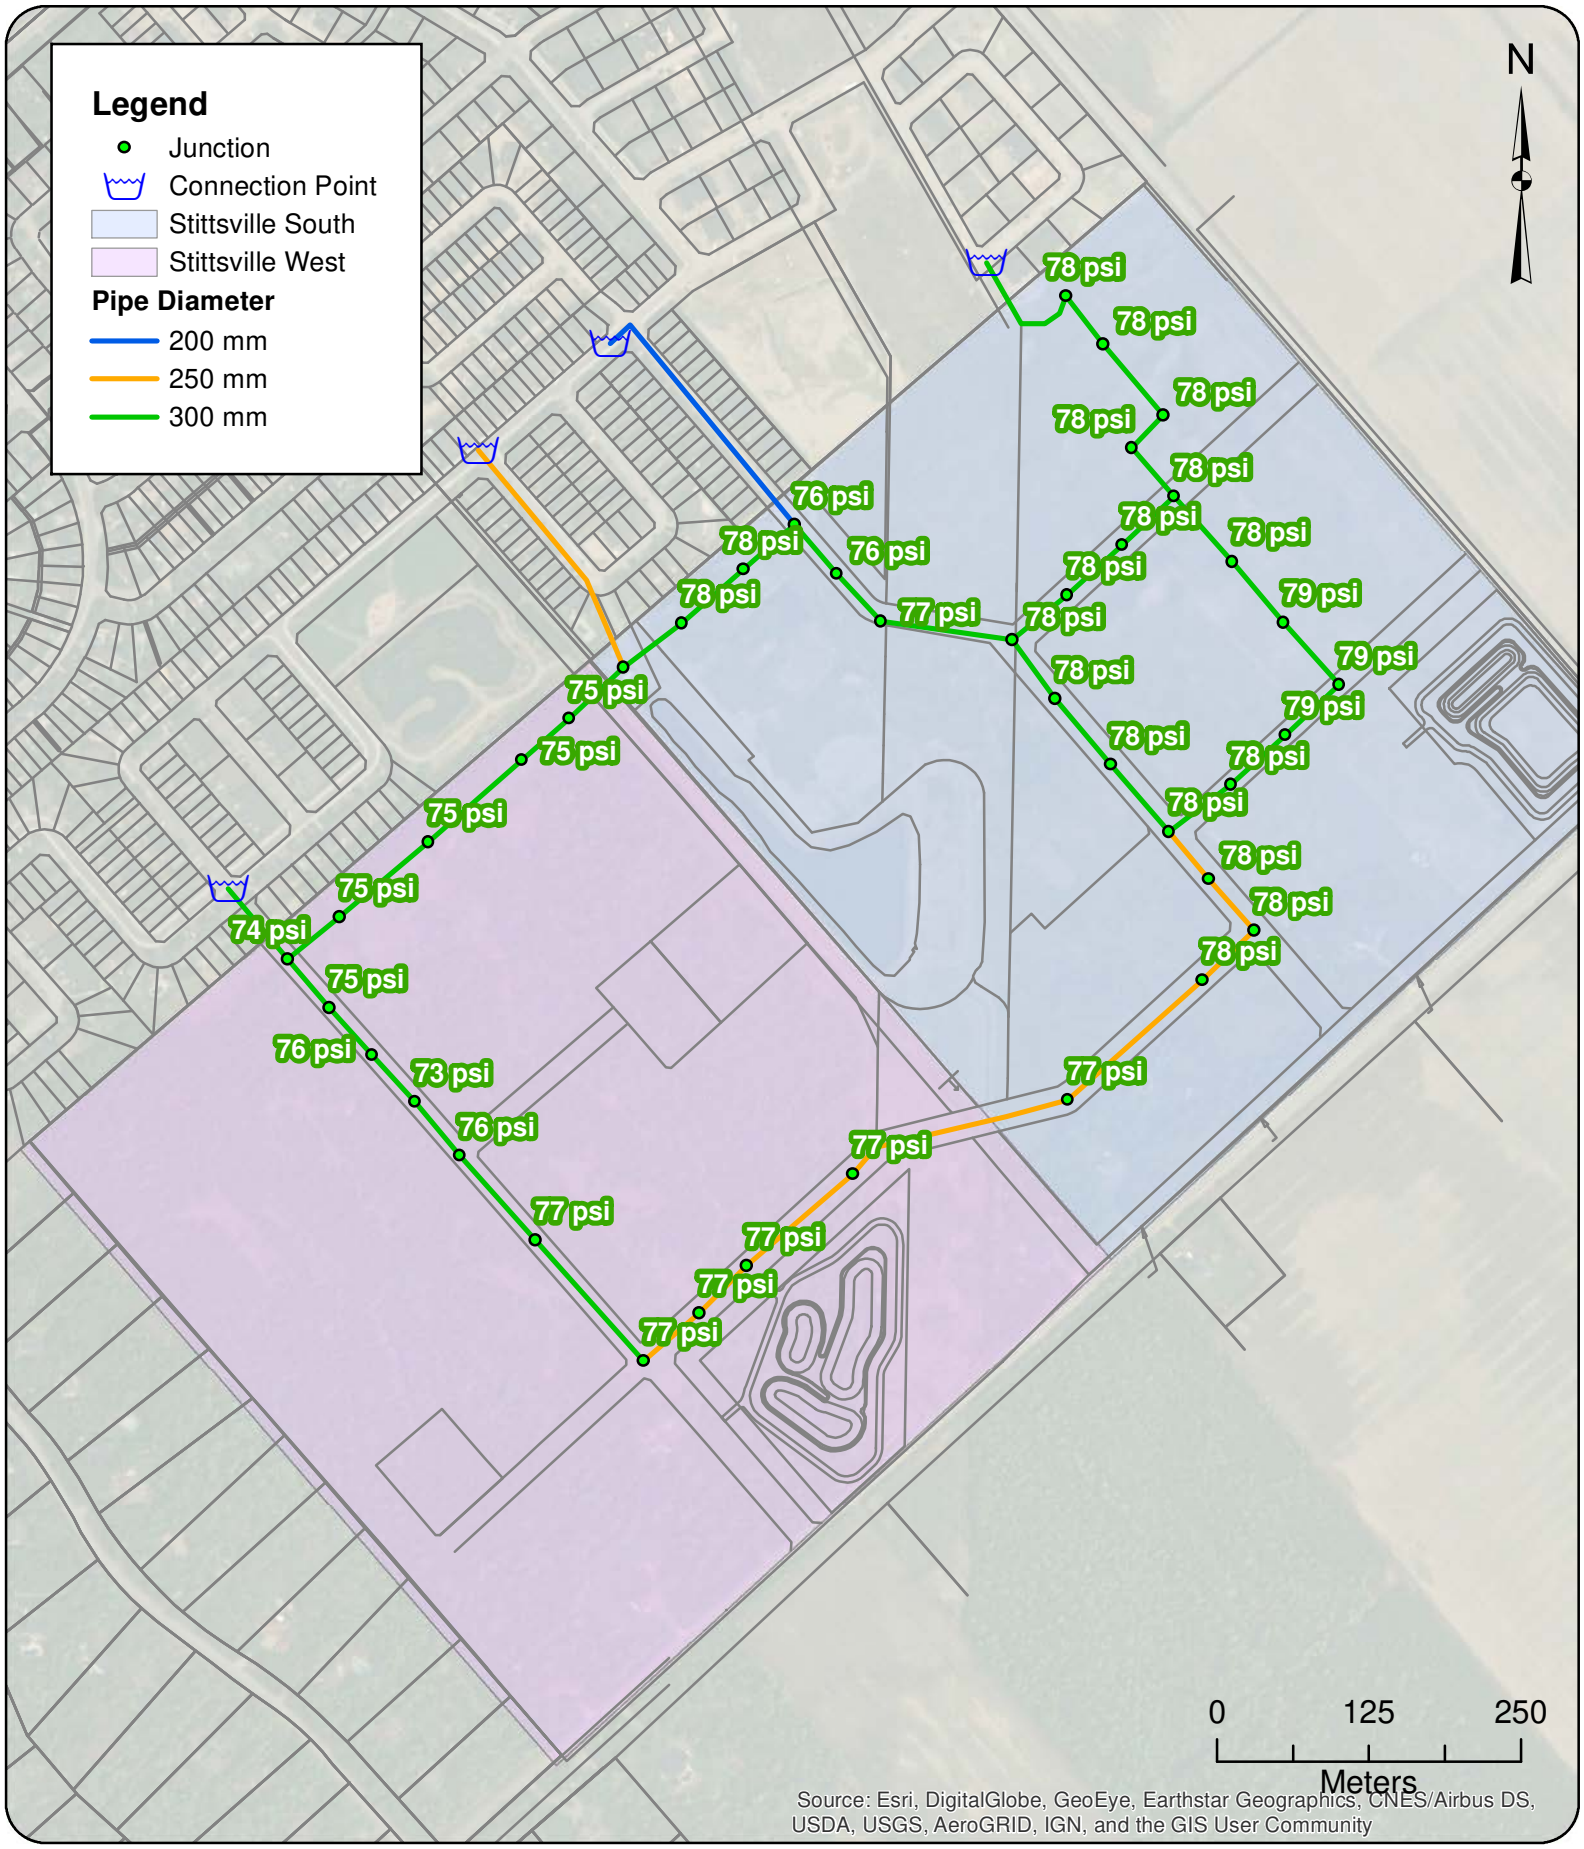

GeoAdvice Engineering Inc.

Project: **Hydraulic Capacity and Modeling Analysis SSUEA 2022-018-DSE**
Client: **David Schaeffer Engineering Ltd.**
Date: **December 2023**
Created by: **BL**
Reviewed by: **WdS**

DISCLAIMER: GeoAdvice does not warrant in any way the accuracy and completeness of the information shown on this map. Field verification of the accuracy and completeness of the information shown on this map is the sole responsibility of the user.

ADD Pressure Results SSUEA

Figure E.1

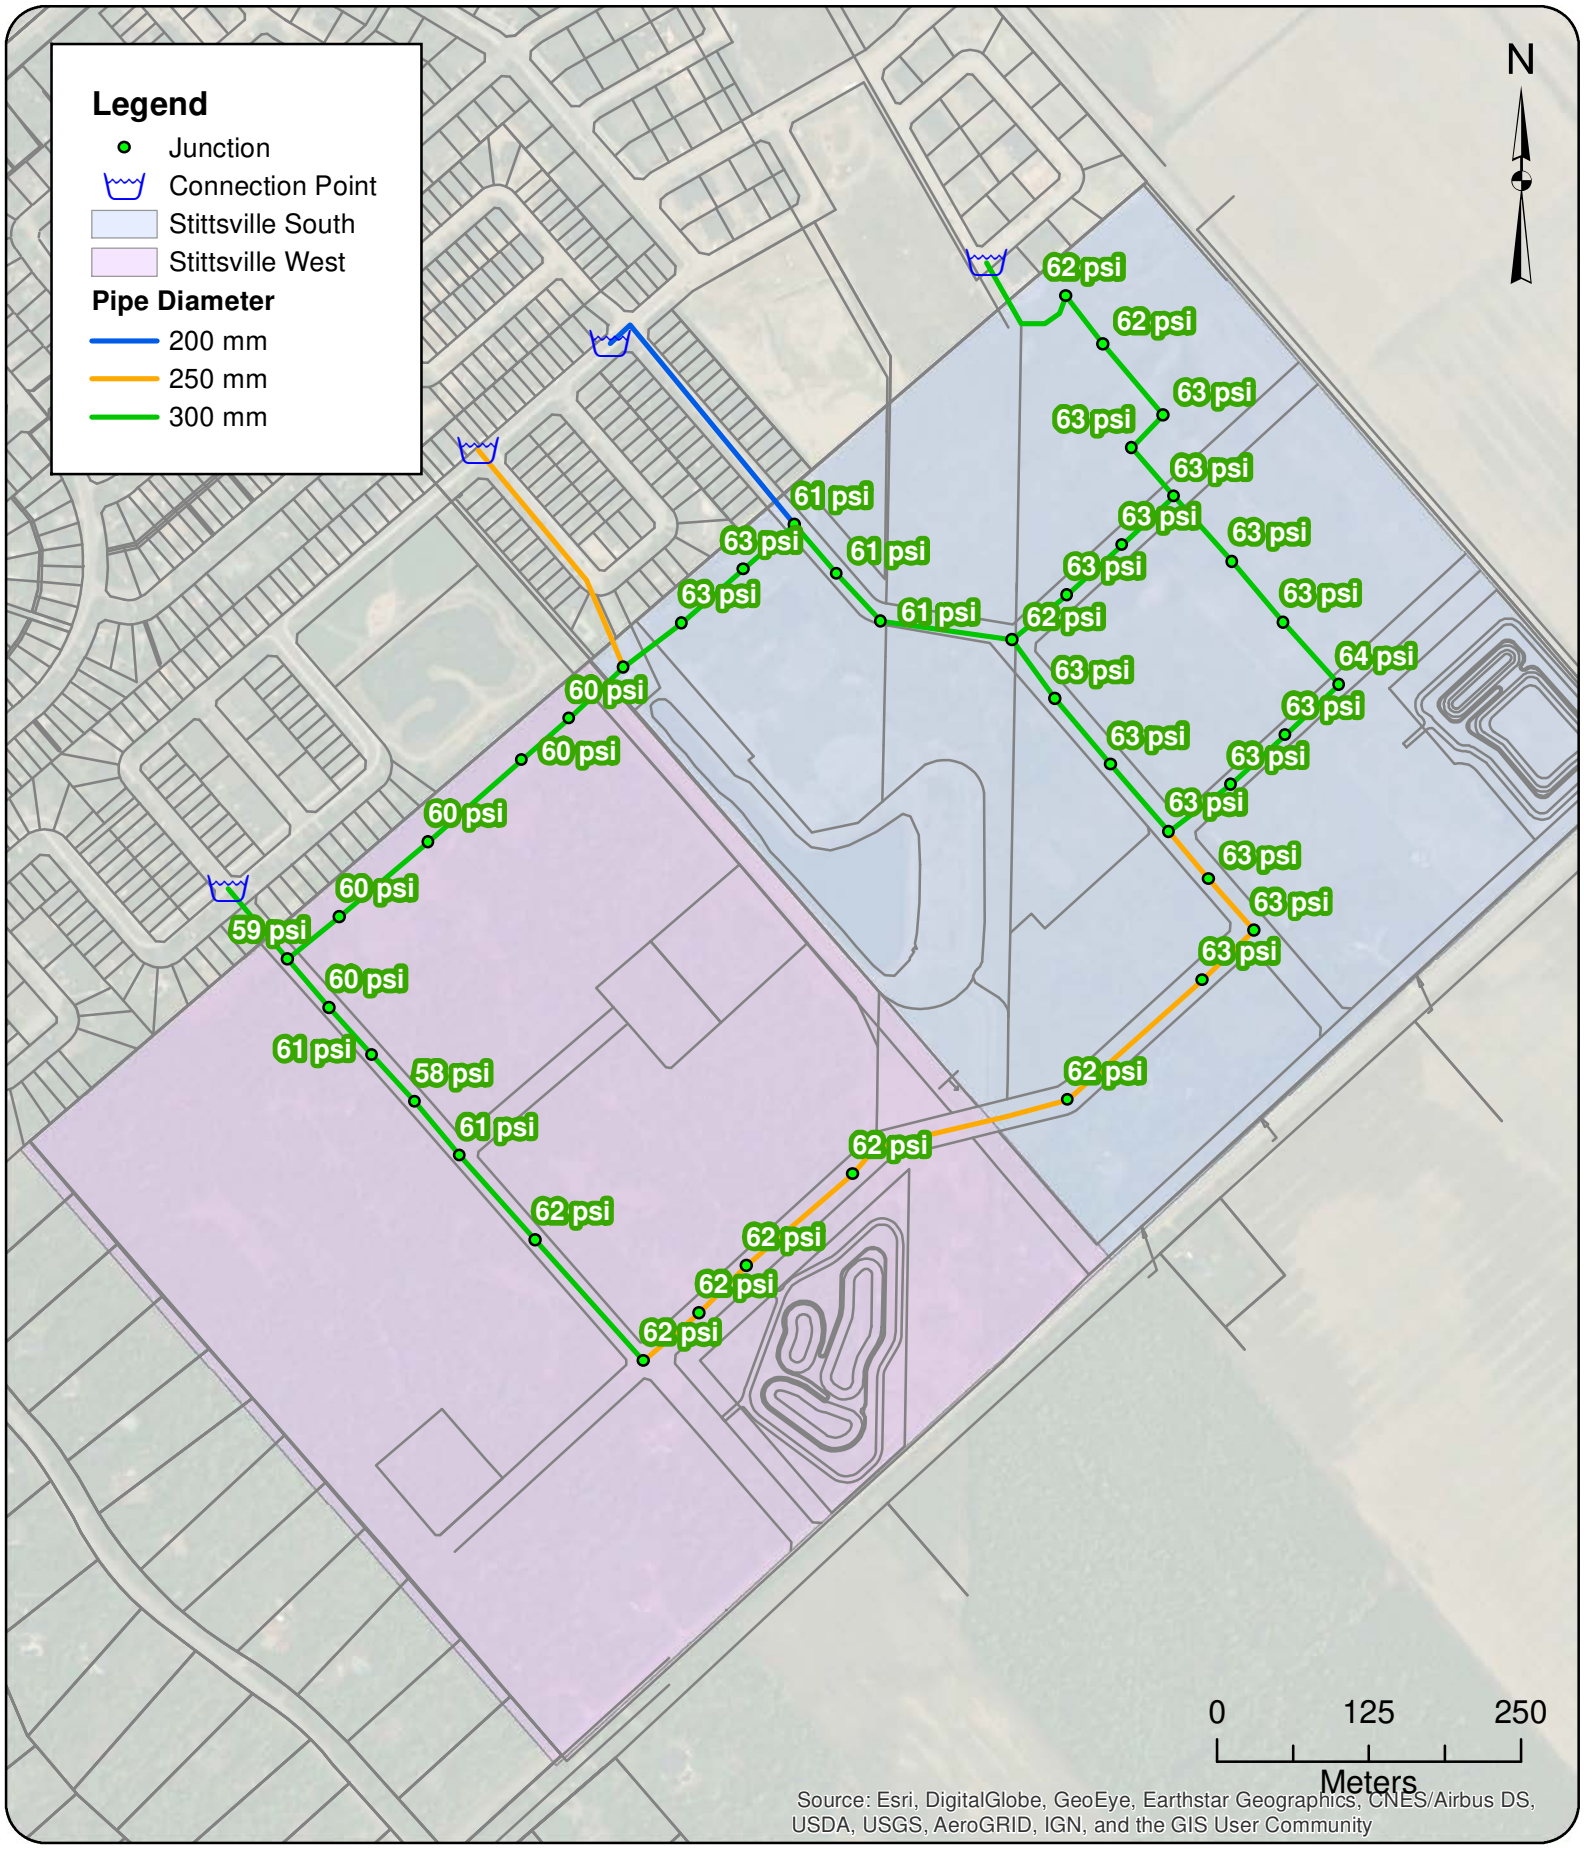

GeoAdvice Engineering Inc.

Project: **Hydraulic Capacity and Modeling Analysis SSUEA 2022-018-DSE**
Client: **David Schaeffer Engineering Ltd.**
Date: **December 2023**
Created by: **BL**
Reviewed by: **WdS**

DISCLAIMER: GeoAdvice does not warrant in any way the accuracy and completeness of the information shown on this map. Field verification of the accuracy and completeness of the information shown on this map is the sole responsibility of the user.

PHD Pressure Results SSUEA

Figure E.2

Appendix F MDD+FF Model Results

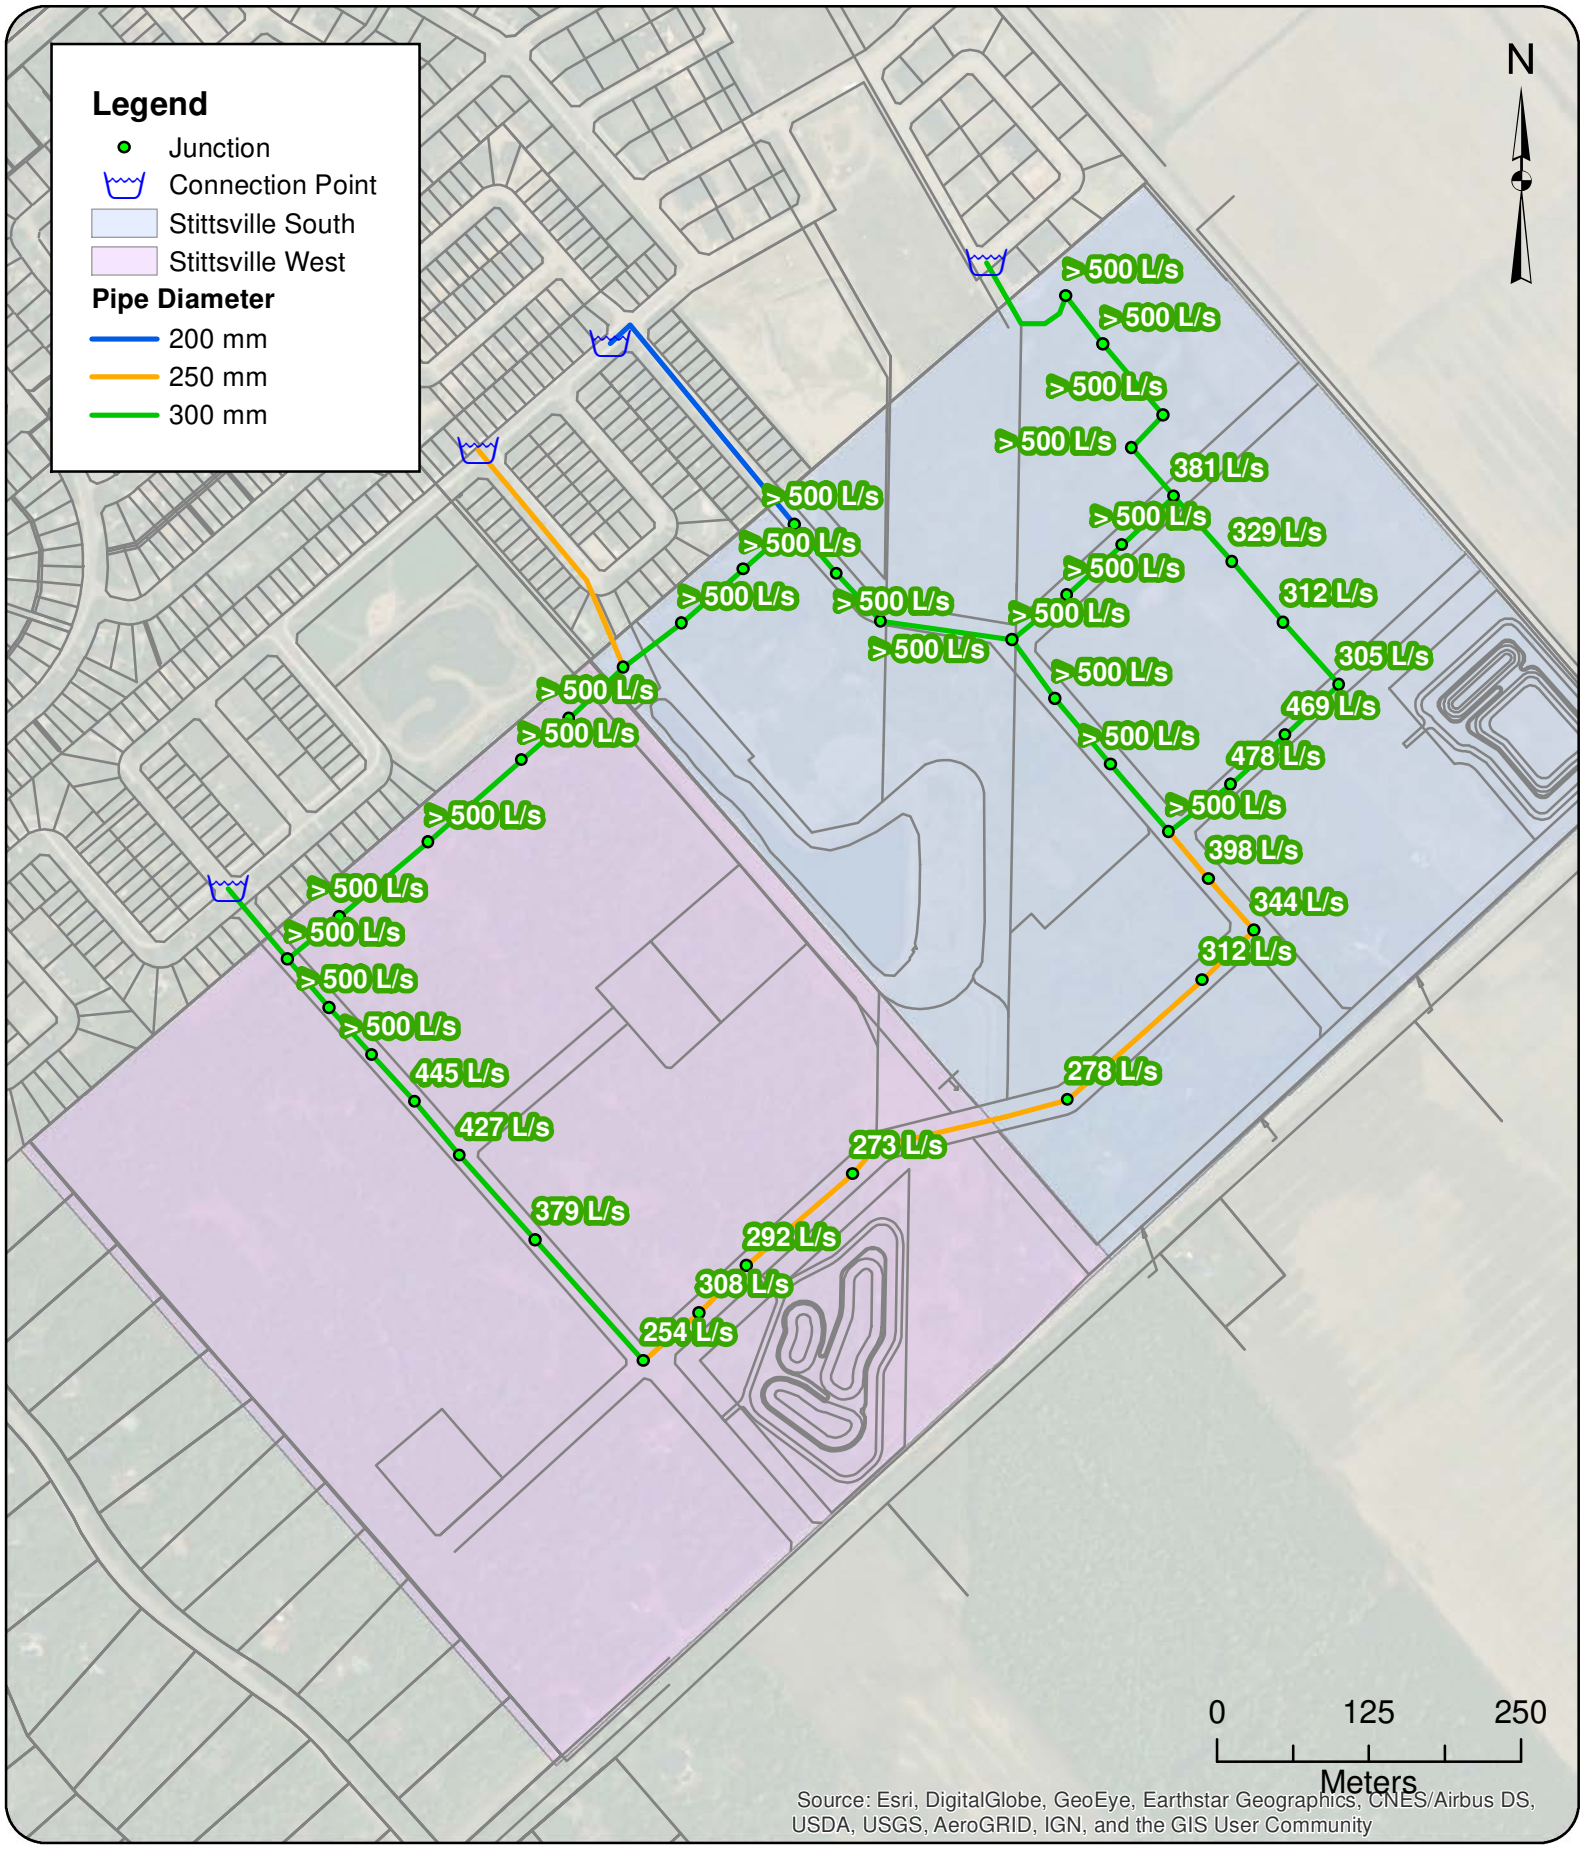

GeoAdvice Engineering Inc.

Project: **Hydraulic Capacity and Modeling Analysis SSUEA 2022-018-DSE**
Client: **David Schaeffer Engineering Ltd.**
Date: **December 2023**
Created by: **BL**
Reviewed by: **WdS**

DISCLAIMER: GeoAdvice does not warrant in any way the accuracy and completeness of the information shown on this map. Field verification of the accuracy and completeness of the information shown on this map is the sole responsibility of the user.

Available Fire Flow SSUEA

Figure F.1

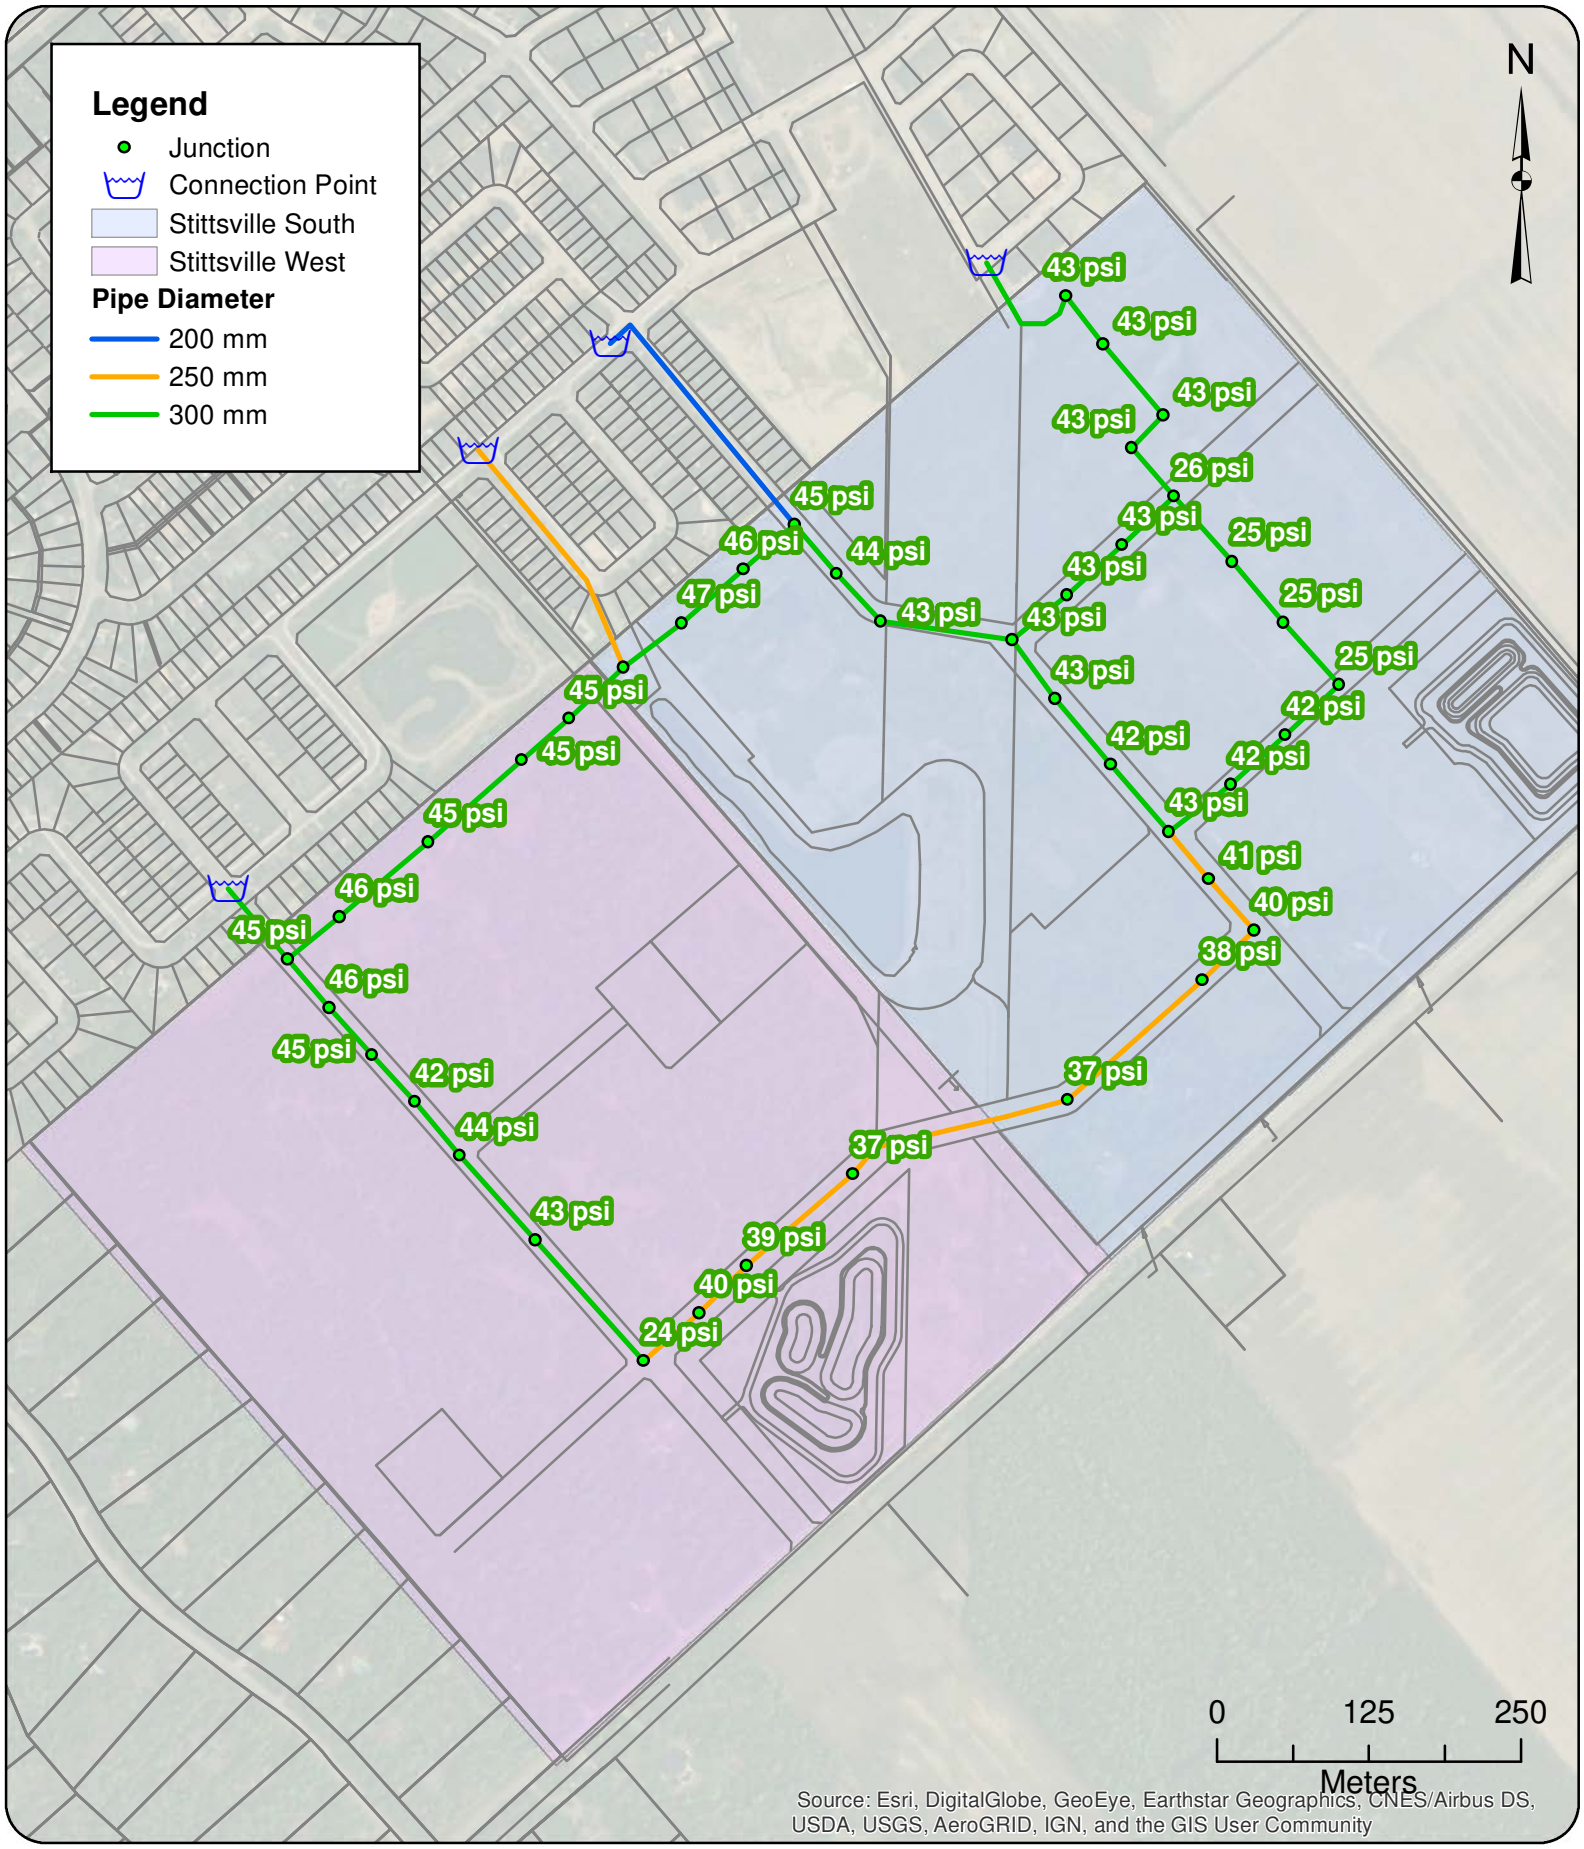

GeoAdvice Engineering Inc.

Project: **Hydraulic Capacity and Modeling Analysis SSUEA 2022-018-DSE**
Client: **David Schaeffer Engineering Ltd.**
Date: **December 2023**
Created by: **BL**
Reviewed by: **WdS**

DISCLAIMER: GeoAdvice does not warrant in any way the accuracy and completeness of the information shown on this map. Field verification of the accuracy and completeness of the information shown on this map is the sole responsibility of the user.

Residual Pressure @ Required Fire Flow SSUEA

Figure F.2

From: Bougadis, John <John.Bougadis@ottawa.ca>
Sent: July 19, 2024 9:47 AM
To: Peter Mott; van de Lande, Robin
Cc: Marc Pichette; Steve Pichette; Gong, Qiaoqiao
Subject: Re: Stittsville South - Urban Expansion area - Request for hydraulic boundary conditions
Attachments: DraftFinal_SystemLevelDemandParameters_24May2024(JB).xlsx

EXTERNAL E-MAIL - Do not click links or open attachments unless you recognize the sender.

Hi Peter

I have attached the water demand parameters to be used for expansion areas where the population exceeds 3000 persons. Please update the demand calculatioms for Stittsville South and resubmit your boundary conditions request.

Thanks,

John

From: Peter Mott <PMott@dsel.ca>
Sent: Friday, July 12, 2024 2:28 PM
To: van de Lande, Robin <Robin.vandeLande@ottawa.ca>
Cc: Marc Pichette <MPichette@dsel.ca>; Steve Pichette <spichette@dsel.ca>; Bougadis, John <John.Bougadis@ottawa.ca>
Subject: RE: Stittsville South - Urban Expansion area - Request for hydraulic boundary conditions

CAUTION: This email originated from an External Sender. Please do not click links or open attachments unless you recognize the source.
ATTENTION : Ce courriel provient d'un expéditeur externe. Ne cliquez sur aucun lien et n'ouvrez pas de pièce jointe, excepté si vous connaissez l'expéditeur.

Good afternoon Robin – In keeping consistent with previous requests, see previous correspondence below, I would like to request the updated hydraulic boundary conditions for the SSUEA. The density estimates for the development have increased which will require remodelling of the proposed supply network.

Could you please have this information provided as soon as possible as it will be used to inform our MSS and FSR design for the area. Please see the, request, attached from GeoAdvice Engineering Inc.

Please let me know if you have any questions or require additional information.

Thanks,

System Level Parameters for MSS (2024)	Consumption Rate[1]	Population Density cap/unit[3]	Average Day Demand (L/unit/day)	Residential Outdoor Water Demand (OWD) (L/unit/day)[4]	Maximum Day Demand (L/unit/day)	Peak Hour Demand
SFH	180	3.4	612	700	Average Day Demand + OWD	2.1 x Maximum Day Demand
MLT	198	2.7	535	350	Average Day Demand + OWD	2.1 x Maximum Day Demand
MLT without rear yards	198	2.7	535	0	Average Day Demand	1.6 x Maximum Day Demand
APT	219	1.8	394	0	Average Day Demand	1.6 x Maximum Day Demand
EMP[2]	138	1	138	N/A	1.5 x Average Day Demand[5]	1.8 x Maximum Day Demand
Water Loss per connection	N/A	N/A	80	N/A	Average Day Demand	Average Day Demand
Total Demand			**Sum above for Total Average Day**		**Sum above for Total Max Day**	**Sum above for Total Peak Hour**

[1] Values represent L/cap/day for residential land uses and L/emp/day for employment areas.

[2] Apply a rate of 17,000 l/h/day if employment totals are unknown. The rate represents the average demand for ICI areas at the 90th percentile.

[3] Occupancy factors should be chosen according to housing type. The values shown were extracted from Section 4.2.8 of the Ottawa Design Guidelines - Water Distribution (2010)

[4] Outdoor water demand is applied to single family, semi-detached and townhome units with rear yards.

[5] The 1.5 multiplier represents the additional outdoor water demand associated with employment areas.

July 24, 2024

Sent by email: PMott@dsel.ca

David Schaeffer Engineering Ltd.
120 Iber Road, Unit 103
Stittsville, ON K2S 1E9

Attention: **Peter Mott, M.Eng., P.Eng.**
Junior Project Manager

Re: Water Distribution Network Boundary Condition Request
Stittsville Properties Development
GeoAdvice Project ID: 2022-018-DSE

Dear Mr. Mott,

In order to carry out the watermain analysis and hydraulic modeling for the Stittsville Properties development in the City of Ottawa, we request the hydraulic boundary conditions (HGL) for the proposed connection points as shown on the attached schematic. Flow conditions are outlined in the attached consumer water demand calculations.

Boundary conditions at **Connections 1, 2, 3 and 4** are required for the following demand conditions:

- Average day demand = 16.72 L/s
- Maximum day demand = 26.21 L/s
- Maximum day demand + fire flow (167 L/s) = 193.21 L/s
- Maximum day demand + fire flow (217 L/s) = 243.21 L/s
- Maximum day demand + fire flow (283 L/s) = 309.21 L/s
- Peak hour demand = 52.24 L/s

NOTE: The above demands and fire flows should be **allocated and split equally to Connections 1, 2, 3 and 4**.

For the maximum day demand plus fire flow scenarios, the HGLs for the lowest (167 L/s) and highest (283 L/s) fire flow requirement scenarios should be provided. The HGLs for any intermediate fire flow scenarios will be interpolated. **Please confirm if any pumps turn on between the lowest (167 L/s) and highest (283 L/s) fire flow requirement scenarios**. If there are any pumps feeding the development area and any additional pumps turning on between the lowest and highest fire flow scenarios, the HGLs **cannot** be interpolated or extrapolated. In this case, boundary conditions should be provided for all fire flow scenarios listed above.

If you have any questions, please do not hesitate to contact me.

Yours truly,

GeoAdvice Engineering Inc.

Werner de Schaetzen, Ph.D., P.Eng.
President and Chief Executive Officer
werner@geoadvice.com
GeoAdvice Engineering Inc.

Attachments: Mark up for connection locations and demand calculations

Consumer Water Demands

Stittsville West - Residential Demands***

Dwelling Type	Number of Units	Population		Average Day Demand			OWL		Max Day	Peak Hour
		Persons per Unit	Population Per Dwelling Type	(L/unit/d)	(L/d)	(L/s)	(L/unit/d)	(L/s)		2.1 x Max Day (L/s)
Single Detached	317	3.4	1,078	612	219,364	2.54	700	2.57	5.11	10.40
Stacked	337	1.8	607	394	159,738	1.85	-	-	1.85	3.54
Traditional Townhome	578	2.7	1,561	535	355,470	4.11	350	2.34	6.46	12.97
Subtotal	**1,232**		**3,246**		**734,572**	**8.50**		**4.91**	**13.41**	**26.91**

Stittsville West - Non Residential Demands

Property Type	Area (ha)		Average Day Demand			OWL		Max Day	Peak Hour
			(L/ha/d)	(L/d)	(L/s)	(L/unit/d)	(L/s)	1.5 x Avg. Day (L/s)	1.8 x Max Day (L/s)
Park	0.91		28,000	25,480	0.29			0.44	0.80
Subtotal	**0.91**			**25,480**	**0.29**			**0.44**	**0.80**

Future Development & Holdouts 1 - Residential Demands***

Dwelling Type	Area (ha)	Population		Average Day Demand			OWL		Max Day	Peak Hour
		Persons per Ha	Population Per Dwelling Type	(L/unit/d)	(L/d)	(L/s)	(L/unit/d)	(L/s)		2.1 x Max Day (L/s)
Residential**	1.67	90.0	150	612	30,529	0.35	700	0.36	0.71	1.45
Subtotal	**1.67**		**150**		**30,529**	**0.35**		**0.36**	**0.71**	**1.45**

Stittsville South - Residential Demands***

Dwelling Type	Number of Units	Population		Average Day Demand			OWL		Max Day	Peak Hour
		Persons per Unit	Population Per Dwelling Type	(L/ha/d)	(L/d)	(L/s)	(L/unit/d)	(L/s)		2.1 x Max Day (L/s)
Single Detached	162	3.4	551	612	112,104	1.30	700	1.31	2.61	5.32
Stacked	337	1.8	607	394	159,738	1.85	-	-	1.85	3.54
Traditional Townhome	413	2.7	1,116	535	253,995	2.94	350	1.67	4.61	9.27
Subtotal	**912**		**2,274**		**525,837**	**6.09**		**2.99**	**9.07**	**18.12**

Stittsville South - Non Residential Demands

Property Type	Area (ha)		Average Day Demand			OWL		Max Day	Peak Hour
			(L/ha/d)	(L/d)	(L/s)	(L/unit/d)	(L/s)	1.5 x Avg. Day (L/s)	1.8 x Max Day (L/s)
Park	0.75		28,000	21,000	0.24			0.36	0.66
Park	1.85		28,000	51,800	0.60			0.90	1.62
Subtotal	**2.60**			**21,000**	**0.84**			**1.26**	**2.28**

Future Development & Holdouts 2 - Residential Demands***

Dwelling Type	Area (ha)	Population		Average Day Demand			OWL		Max Day	Peak Hour
		Persons per Ha	Population Per Dwelling Type	(L/unit/d)	(L/d)	(L/s)	(L/unit/d)	(L/s)		2.1 x Max Day (L/s)
Residential**	1.60	90.0	145	612	29,512	0.34	700	0.35	0.69	1.40
Subtotal			**145**		**29,512**	**0.34**		**0.35**	**0.69**	**1.40**

Future Development & Holdouts 3 - Residential Demands***

Dwelling Type	Area (ha)	Population		Average Day Demand			OWL		Max Day	Peak Hour
		Persons per Ha	Population Per Dwelling Type	(L/unit/d)	(L/d)	(L/s)	(L/unit/d)	(L/s)		2.1 x Max Day (L/s)
Residential**	0.67	90.0	61	612	10,980	0.13	700	0.15	0.27	0.59
Subtotal			**61**		**10,980**	**0.13**		**0.15**	**0.27**	**0.59**

Future Development & Holdouts 4 - Residential Demands***

Dwelling Type	Area (ha)	Population		Average Day Demand			OWL		Max Day	Peak Hour
		Persons per Ha	Population Per Dwelling Type	(L/unit/d)	(L/d)	(L/s)	(L/unit/d)	(L/s)		2.1 x Max Day (L/s)
Residential**	0.81	90.0	73	612	15,029	0.17	700	0.17	0.35	0.70
Subtotal			**73**		**15,029**	**0.17**		**0.17**	**0.35**	**0.70**

		Average Day	Max Day	Peak Hour
Stittsville West		**9.15**	**14.56**	**29.15**
Stittsville South		**7.57**	**11.64**	**23.09**

*Peaking factors based on the updated City water demand parameters

**Assumed to be single family, to be confirmed in detailed design by DSEL

***As requested by the City, a demand of 80 L/unit was added to each scenario (ADD, MDD, PHD) for residential demands, no peaking factor included

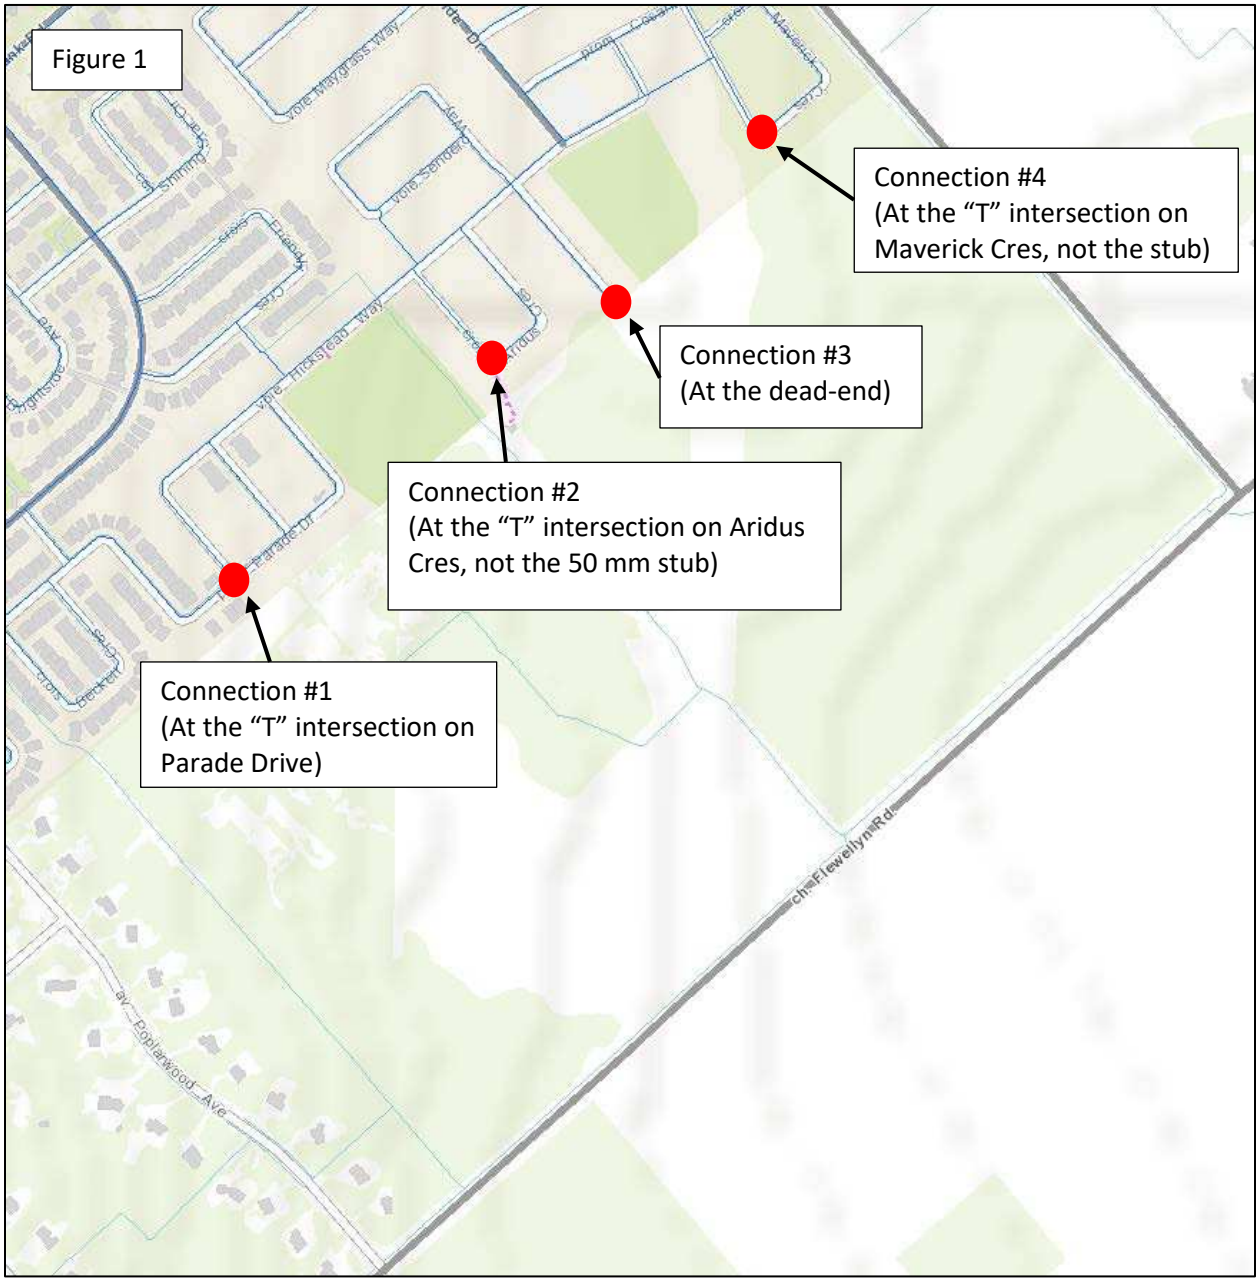
Figure 1
Connection #4
(At the "T" intersection on Maverick Cres, not the stub)
Connection #3
(At the dead-end)
Connection #2
(At the "T" intersection on Aridus Cres, not the 50 mm stub)
Connection #1
(At the "T" intersection on Parade Drive)

EXISTING 400mm WM. CONSTRUCTED AS PART OF THE EDENWYLDE SUBDIVISION.

FERNBANK ROAD

EXISTING RESIDENTIAL

EXISTING RURAL ESTATE LOT SUBDIVISION (WOODSIDE ACRES)

CAIVAN COMMUNITIES LANDHOLDINGS BOUNDARY

OVERALL SUBJECT AREA BOUNDARY

FAULKNER MUNICIPAL DRAIN

Hydro One Corridor

DSEL

120 Iber Road, Unit 103
Stittsville, Ontario, K2S 1E9
Tel. (613) 836-0856
Fax. (613) 836-7183
www.DSEL.ca

STITTSVILLE SOUTH URBAN EXPANSION AREA
WATERMAIN EXISTING CONDITIONS FIGURE
CITY OF OTTAWA

LEGEND

- EXISTING WATERMAIN
- OVERALL SUBJECT AREA BOUNDARY
- CAIVAN LANDHOLDINGS

PROJECT No.:	21-1247
DATE:	Jan 2023
SCALE:	1:2000
DRAWING:	3

Boundary Conditions
Stittsville South Urban Expansion Area

Provided Information

Scenario	Demand	
	L/min	L/s
Average Daily Demand	1,043	17.39
Maximum Daily Demand	2,059	34.32
Peak Hour	3,114	51.90
Fire Flow Demand #1	10,020	167.00
Fire Flow Demand #2	13,020	217.00
Fire Flow Demand #3	16,980	283.00

Location

Existing Condition Model

Existing Condition with **Conceptual** Looping for Future Servicing

Results

1. Existing Condition Model (No Future Demand)

Connection 1 - Parade Dr.

Demand Scenario	Head (m)	Pressure[1] (psi)
Maximum HGL	160.2	72.3
Peak Hour	155.2	65.2
Max Day plus Fire Flow #1	143.5	48.7
Max Day plus Fire Flow #2	135.7	37.7
Max Day plus Fire Flow #3	123.2	19.8

[1] Ground Elevation = 109.2 m

Connection 2 - Hickstead Way

Demand Scenario	Head (m)	Pressure[1] (psi)
Maximum HGL	160.2	77.9
Peak Hour	155.2	70.8
Max Day plus Fire Flow #1	139.7	48.8
Max Day plus Fire Flow #2	129.6	34.4
Max Day plus Fire Flow #3	113.1	11.0

[1] Ground Elevation = 105.4 m

Connection 3 - Ocaia St.

Demand Scenario	Head (m)	Pressure[1] (psi)
Maximum HGL	160.2	79.8
Peak Hour	155.2	72.7
Max Day plus Fire Flow #1	127.3	33.0
Max Day plus Fire Flow #2	109.3	7.5
Max Day plus Fire Flow #3	80.0	-34.3
[1] Ground Elevation =	104.1	m

2. Existing Condition Model with Future Demands

Connection 1 – Parade Dr.

Demand Scenario	Head (m)	Pressure[1] (psi)
Maximum HGL	160.4	72.8
Peak Hour	150.1	58.1
Max Day plus Fire Flow #1	142.3	47.1
Max Day plus Fire Flow #2	134.0	35.2
Max Day plus Fire Flow #3	120.7	16.4
[1] Ground Elevation =	109.2	m

Connection 2 – Hickstead Way

Demand Scenario	Head (m)	Pressure[1] (psi)
Maximum HGL	160.4	78.1
Peak Hour	149.6	62.8
Max Day plus Fire Flow #1	137.6	45.7
Max Day plus Fire Flow #2	126.7	30.2
Max Day plus Fire Flow #3	109.2	5.3
[1] Ground Elevation =	105.4	m

Connection 3 – Ocaia St.

Demand Scenario	Head (m)	Pressure[1] (psi)
Maximum HGL	160.4	80.0
Peak Hour	149.2	64.2
Max Day plus Fire Flow #1	123.8	28.0
Max Day plus Fire Flow #2	104.7	0.9
Max Day plus Fire Flow #3	74.0	-42.8
[1] Ground Elevation =	104.1	m

3. Existing Condition with 254 mm Looping for Future Servicing

Connection 1 - Parade Dr.

Demand Scenario	Head (m)	Pressure[1] (psi)
Maximum HGL	160.4	72.8
Peak Hour	150.0	58.0
Max Day plus Fire Flow #1	142.8	47.7
Max Day plus Fire Flow #2	134.8	36.3
Max Day plus Fire Flow #3	122.0	18.2
[1] Ground Elevation =	109.2	m

Connection 2 - Hickstead Way

Demand Scenario	Head (m)	Pressure[1] (psi)
Maximum HGL	160.4	78.2
Peak Hour	149.8	63.1
Max Day plus Fire Flow #1	140.4	49.7
Max Day plus Fire Flow #2	131.0	36.4
Max Day plus Fire Flow #3	116.1	15.2
[1] Ground Elevation =	105.4	m

Connection 3 - Ocaia St.

Demand Scenario	Head (m)	Pressure[1] (psi)
Maximum HGL	160.4	80.1
Peak Hour	149.7	64.9
Max Day plus Fire Flow #1	136.1	45.5
Max Day plus Fire Flow #2	124.2	28.7
Max Day plus Fire Flow #3	105.2	1.7
[1] Ground Elevation =	104.1	m

Disclaimer

The boundary condition information is based on current operation of the city water distribution system. The computer model simulation is based on the best information available at the time. The operation of the water distribution system can change on a regular basis, resulting in a variation in boundary conditions. The physical properties of watermains deteriorate over time, as such must be assumed in the absence of actual field test data. The variation in physical watermain properties can therefore alter the results of the computer model simulation. Fire Flow analysis is a reflection of available flow in the watermain; there may be additional restrictions that occur between the watermain and the hydrant that the model cannot take into account.

David Schaeffer Engineering Ltd.
120 Iber Road, Suite 103
Stittsville, ON K2S 1E9
613-836-0856
dsel.ca

APPENDIX D

ENVIRONMENTAL COMPLIANCE APPROVAL

NUMBER 3415-ADQLJG
Issue Date: September 21, 2016

Stittsville South Inc. and 1384341 Ontario Ltd.
1737 Woodward Drive, 2nd Floor
Ottawa, Ontario
K2C 0P9

Site Location: Stittsville South Area 6 Sanitary Pumping Station
5970 Fernbank Road and part of 5993 Flewellyn Road
City of Ottawa, Ontario

You have applied under section 20.2 of Part II.1 of the Environmental Protection Act, R.S.O. 1990, c. E. 19 (Environmental Protection Act) for approval of:

Sanitary Pump Station and Forcemain

- one (1) 3000 mm diameter and 8.65 metre deep wet well with provision for three (3) submersible non-clog wastewater pumps, each pump designed for 42 litres/second at a Total Dynamic Head (TDH) of 29 metres, complete with trash basket, pipe rails, level regulation, force air blower unit and appurtenances;

- two (2) pumps will be initially installed with each pump capable of delivering 42 litres/second at a TDH of 29 metres for an initial firm capacity of 42 litres/second;

- the third pump will be added through an amendment to the ECA once development flows approach 42 litres/second to bring the pump station to its ultimate firm capacity of 84 litres/second;

- approximately 870 metres of dual 200 mm diameter HDPE DR13.5 sanitary forcemains originating at the pump station control building and terminating at the existing sanitary sewer on Fernbank Road;

- one (1) 2400 mm x 1800 mm concrete discharge manhole, complete with Swab Catcher, replacing the existing sanitary MH 401 on Fernbank Road. Dual forcemains will discharge to this new manhole;

- pump station control building complete with mechanical and electrical systems, process piping, valves, control panels, SCADA system, odour control system, swab launchers and appurtenances;

- one (1) 170 KW self-enclosed diesel generator (to be registered under Environmental Activity and Sector Registry (EASR)) on a reinforced concrete pad adjustment to the pump station control building complete with diesel fuel tank, valves and controls;

- one (1) 2400 mm x 1800 mm concrete by-pass chamber complete with valves, couplings and appurtenances;

Sanitary Sewers Pump Station

- approximately 4.8 metres of 450 mm diameter sanitary sewer @ 2.55% from Sanitary MH 99 to wet well;

- approximately 18 metres of 200 mm diameter sanitary forcemain HDPE 13.5 from SAN MH 99 to By-pass Chamber;

- approximately 18.7 metres of 600 mm diameter sanitary sewer from SAN MH 99 to SAN MH 97;

Interim Emergency Sanitary Sewer Overflow

approximately 26.6 metres of 250 mm diameter sanitary sewer from sanitary MH 97 to the existing Faulkner Ditch. Elevation of emergency overflow in sanitary MH 97 is 104.27m;

Permanent Emergency Sanitary Sewer Overflow

the permanent Emergency Sanitary Sewer Overflow will discharge to the future Davidson Stormwater Management Facility which is anticipated to be constructed within the next 2-4 years;

- the permanent emergency sanitary sewer overflow will consist of 3 metres of 600 mm diameter sewer from sanitary MH 97 to the future stormwater management facility. The elevation of the emergency overflow in MH 97 is 103.40m;

- provision to adjust the elevation of the permanent emergency sanitary overflow in MH 97 within a range of 102.80m to 103.70m based on the final 100-year water level in the future Davidson Stormwater Management Facility;

- one (1) primary measuring device in MH 97 consisting of a broad crest weir complete with ultrasonic level recorder;

- once permanent emergency sanitary sewer overflow is established, the interim overflow will be abandoned;

including erosion/sedimentation control measures during construction and all other controls and appurtenances essential for the proper operation of the aforementioned Works;

all in accordance with the application from the Stittsville South Inc. and 1384341 Ontario Ltd., dated March 03, 2016, and all other supporting documents, final plans and specifications prepared by Novatech.

For the purpose of this environmental compliance approval, the following definitions apply:

"Approval" means this entire document including the application and any supporting documents listed in any schedules in this Approval;

"BOD5" (also known as TBOD5) means five day biochemical oxygen demand measured in an unfiltered sample and includes carbonaceous and nitrogenous oxygen demand;

"Director" means a person appointed by the Minister pursuant to section 5 of the Environmental Protection Act for the purposes of Part II.1 of the Environmental Protection Act;

"E. Coli" refers to the thermally tolerant forms of Escherichia that can survive at 44.5 degrees Celsius;

"Emergency Situation" means a structural, mechanical or electrical failure that causes a temporary reduction in the capacity of the sanitary sewage pumping station or an unforeseen flow condition that may result in:

a) danger to the health or safety of any person; or
b) injury or damage to any property, or serious risk of injury or damage to any property.

"EPA" means the Environmental Protection Act, R.S.O. 1990, c.E.19, as amended;

"Event" in the context the sanitary sewage pumping station located outside a Sewage Treatment Plant, means an action or occurrence, at the sanitary sewage pumping station that causes a Sewage Pumping Station Overflow. An Event ends when there is no recurrence of a Sewage Pumping Station Overflow in the 12-hour period following the last Sewage Pumping Station Overflow. Two Events are separated by at least 12 hours during which there has been no recurrence of a Sewage Pumping Station Overflow;

"Limited Operational Flexibility" (LOF) means the modifications that the Owner is permitted to make to the Works under this Approval;

"Ministry" means the ministry of the government of Ontario responsible for the Environmental Protection Act and the Ontario Water Resources Act and includes all officials, employees or other persons acting on its behalf;

"Notice of Modifications" means the form entitled “Notice of Modifications to Sewage Works” included in Schedule "A";

"Owner" means the Stittsville South Inc. and 1384341 Ontario Ltd., and includes their successors and assignees;

"Professional Engineer" means a person entitled to practise as a Professional Engineer in the Province of Ontario under a licence issued under the Professional Engineers Act;

"Sewage Pumping Station Overflow" means any discharge from a sanitary sewage pumping station located outside a Sewage Treatment Plant that does not undergo any treatment or only receives partial treatment before it is discharged to the environment;

"Substantial Completion" has the same meaning as “substantial performance” in the Construction Lien Act;

"Water Supervisor" means the person appointed as Water Supervisor of the Ottawa office of the Ministry;

"Works" means the sewage works described in the Owner's application(s) and this Approval.

You are hereby notified that this environmental compliance approval is issued to you subject to the terms and conditions outlined below:

TERMS AND CONDITIONS

1. GENERAL PROVISIONS

(1) The Owner shall ensure that any person authorized to carry out work on or operate any aspect of the Works is notified of this Approval and the Conditions herein and shall take all reasonable measures to ensure any such person complies with the same.

(2) The designation of the The City of Ottawa as the operating authority of the site on the application for approval of the Works does not relieve the Owner from the responsibility of complying with any and all of the Conditions of this Approval.

(3) Except as otherwise provided by these Conditions, the Owner shall design, build, install, operate and maintain the Works in accordance with the description given in this Approval, and the application for approval of the Works.

(4) Where there is a conflict between a provision of any submitted document referred to in this Approval and the Conditions of this Approval, the Conditions in this Approval shall take precedence, and where there is a conflict between the listed submitted documents, the document bearing the most recent date shall prevail.

(5) Where there is a conflict between the listed submitted documents, and the application, the application shall take precedence unless it is clear that the purpose of the document was to amend the application.

(6) The Conditions of this Approval are severable. If any Condition of this Approval, or the application of any requirement of this Approval to any circumstance, is held invalid or unenforceable, the application of such Condition to other circumstances and the remainder of this Approval shall not be affected thereby.

(7) The issuance of, and compliance with the Conditions of this Approval does not:

(a) relieve any person of any obligation to comply with any provision of any applicable statute, regulation or other legal requirement, including, but not limited to, the obligation to obtain approval from the local conservation authority necessary to construct or operate the sewage Works; or

(b) limit in any way the authority of the Ministry to require certain steps be taken to require the

Owner to furnish any further information related to compliance with this Approval.

2. EXPIRY OF APPROVAL

(1) This Approval will cease to apply to those parts of the new Works which have not been constructed within **five (5) years** of the date of this Approval.

3. CHANGE OF OWNER

(1) The Owner shall notify the Director, in writing, of any of the following changes within **thirty (30) days** of the change occurring:

(a) change of Owner;

(b) change of address of the Owner;

(c) change of partners where the Owner is or at any time becomes a partnership, and a copy of the most recent declaration filed under the Business Names Act, R.S.O. 1990, c. B17 shall be included in the notification to the Director;

(d) change of name of the corporation where the Owner is or at any time becomes a corporation, and a copy of the most current information filed under the Corporations Information Act, R.S.O. 1990, c. C39 shall be included in the notification to the Director.

4. UPON SUBSTANTIAL COMPLETION OF THE SEWAGE PUMPING STATION

(1) Upon Substantial Completion of the sewage pumping station, the Owner shall prepare a statement, certified by a Professional Engineer, that the sewage pumping station was constructed in accordance with this Approval, and shall make the written statement available to the Ministry, upon request.

(2) Within **one (1) year** of Substantial Completion of the sewage pumping station, a set of as-built drawings showing the sewage pumping station "as constructed" shall be prepared. These drawings shall be kept up to date through revisions undertaken from time to time and a copy shall be retained at the sewage pumping station for the operational life of the sewage pumping station.

5. SEWAGE PUMPING STATION OVERFLOW

(1) Any Sewage Pumping Station Overflow is prohibited, except:

(a) in an Emergency Situation;

(b) where the Sewage Pumping Station Overflow is a direct and unavoidable result of a planned maintenance procedure, the Owner notified the Water Supervisor **fifteen (15) days** prior to the Sewage Pumping Station Overflow and the Water Supervisor has given written consent of the Sewage Pumping Station Overflow; or,

(c) where the Sewage Pumping Station Overflow is planned for research or training purposes, the discharger notified the Water Supervisor **fifteen (15) days** prior to the Sewage Pumping Station Overflow and the Water Supervisor has given written consent of the Sewage Pumping Station Overflow.

(2) The Owner shall forthwith notify the Spills Action Centre (SAC) at 1-800-268-6060 or e-mail at moe.sac.moe@ontario.ca and the Medical Officer of Health of every Sewage Pumping Station Overflow Event. This notice shall include, at a minimum, the following information:

(a) the date and time at which the Event(s) started,

(b) duration of the Event(s);

(c) the location of the Event(s);

(d) the measured or estimated volume of the Event(s) (unless the Event(s) is/are ongoing); and

(e) the reason for the Event (s).

(3) The Owner shall submit Sewage Pumping Station Overflow Event Reports to the Ministry's local office on an Annual basis, no later than forty-five (45) days following the end of the calendar year. Event Reports shall be in an electronic format specified by the Ministry. In each Event Report the Owner shall include, at a minimum, the following information on any Event(s) that occurred during the preceding year:

(a) the date and time at which the Event(s) started,

(b) duration of the Event(s);

(c) the location of the Event**(s**);

(d) the measured or estimated volume of the Event(s) (unless the Event(s) is/are ongoing); and

(e) the reason for the Event(s).

(4) The Owner shall use best efforts to collect a representative sample consisting of a minimum of two (2) grab samples of the Sewage Pumping Station Overflow and have it analysed for parameters outlined in Table 1 of Condition 7 (2) using the protocols specified in Condition 7 (3), one at the beginning of the Event and the second approximately near the end of the Event, to best reflect the effluent quality of such Sewage Pumping Station Overflow.

(5) The Owner shall maintain a record of all Sewage Pumping Station Overflow(s), which shall contain, at a minimum, the types of information set out in Condition 5 (2 (a)) to 5 (2 (e)) in respect of each Sewage Pumping Station Overflow.

6. OPERATION AND MAINTENANCE

(1) The Owner shall exercise due diligence in ensuring that, at all times, the Works and the related equipment and appurtenances used to achieve compliance with this Approval are properly operated and maintained. Proper operation and maintenance shall include effective performance, adequate funding, adequate operator staffing and training, including training in all procedures and other requirements of this Approval and the Act and regulations, adequate laboratory facilities, process controls and alarms and the use of process chemicals and other substances used in the Works.

(2) The Owner shall prepare an operations manual within **six (6) months** of Substantial Completion of the sewage pumping station, that includes, but not necessarily limited to, the following information:

(a) operating procedures for routine operation of the sewage pumping station;

(b) inspection programs, including frequency of inspection, for the sewage pumping station and the methods or tests employed to detect when maintenance is necessary;

(c) repair and maintenance programs, including the frequency of repair and maintenance for the sewage pumping station;

(d) procedures for the inspection and calibration of monitoring equipment;

(e) a spill prevention control and countermeasures plan, consisting of contingency plans and procedures for dealing with equipment breakdowns, potential spills and any other abnormal situations, including notification of the Water Supervisor; and

(f) procedures for receiving, responding and recording public complaints, including recording any follow-up actions taken.

(3) The Owner shall maintain the operations manual current and retain a copy at the location of the sewage pumping station for the operational life of the sewage pumping station. The Owner shall make the manual available to the Ministry, upon request.

(4) The Owner shall make all manuals, plans, records, data, procedures and supporting documentation available to the Ministry, upon request.

7. MONITORING AND RECORDING

The Owner shall, upon the issuance of this Approval, carry out the following monitoring program:

(1) All samples and measurements taken for the purposes of this Approval are to be taken at a time and in a location characteristic of the quality and quantity of the effluent stream over the time period being monitored.

(2) Samples shall be collected at the following sampling points, at the frequency specified, by means of

the specified sample type and analysed for each parameter listed and all results recorded:

Table 1 - Monitoring during a Sewage Pumping Station Overflow Event (Samples to be collected from the Sewage Pumping Station Overflow sewer near the sewage pumping station)	
Sample Type	Grab
Parameters	BOD5, Total Suspended Solids, Total Phosphorus, E. Coli (E. Coli samples may be limited to overflows occurring between Apr 1 and Oct 31)

(3) The methods and protocols for sampling, analysis and recording shall conform, in order of precedence, to the methods and protocols specified in the following:

(a) the Ministry's Procedure F-10-1, "Procedures for Sampling and Analysis Requirements for Municipal and Private Sewage Treatment Works (Liquid Waste Streams Only), as amended from time to time by more recently published editions;

(b) the Ministry's publication "Protocol for the Sampling and Analysis of Industrial/Municipal Wastewater" (January 1999), ISBN 0-7778-1880-9, as amended from time to time by more recently published editions; and

(c) the publication "Standard Methods for the Examination of Water and Wastewater" (21st edition), as amended from time to time by more recently published editions.

8. REPORTING

(1) **Fifteen (15) days** prior to the date of a planned Sewage Pumping Station Overflow being conducted pursuant to Condition 5 and as soon as possible for an unplanned Sewage Pumping Station Overflow, the Owner shall notify the Water Supervisor in writing of the pending start date, in addition to an assessment of the potential adverse effects on the environment and the duration of the Sewage Pumping Station Overflow.

(2) In addition to the obligations under Part X of the Environmental Protection Act, (which includes contacting the Spills Action Centre (SAC) at 1-800-268-6060 or e-mail at moe.sac.moe@ontario.ca), the Owner shall, within **ten (10) working days** of the occurrence of any reportable spill as defined in Ontario Regulation 675/98, Bypass or loss of any product, by-product, intermediate product, oil, solvent, waste material or any other polluting substance into the environment, (with the exception of a sanitary sewage discharged during an Event), submit a full written report of the occurrence to the Water Supervisor describing the cause and discovery of the spill or loss, clean-up and recovery measures taken, preventative measures to be taken and schedule of implementation.

(3) The Owner shall prepare and submit a report to the Water Supervisor on an annual basis. The reports shall contain the following information:

(a) a copy of all Notice of Modifications submitted to the Water Supervisor as a result of Schedule A, Section 1 (Limited Operational Flexibility) with a status report on the implementation of each modification;

(b) a report summarizing all modifications completed as a result of Schedule A, Section 3.

9. LIMITED OPERATIONAL FLEXIBILITY

(1) The Owner may make modifications to the Works in accordance with the Terms and Conditions of this Approval and subject to the Ministry's "Limited Operational Flexibility Criteria for Modifications to Sewage Works", included under Schedule "A" of this Approval, as amended.

(2) The sewage pumping station works proposed under Limited Operational Flexibility shall adhere to the design guidelines contained within the Ministry's publication "Design Guidelines for Sewage Works 2008", as amended.

(3) The Owner shall ensure at all times, that the sewage pumping station works, related equipment and appurtenances which are installed or used to achieve compliance are operated in accordance with all Terms and Conditions of this Approval.

(4) For greater certainty, the following are not permitted as part of Limited Operational Flexibility:

(a) Modifications to the sewage pumping station works that result in an increase of the Rated Capacity of the sewage pumping station works;

(b) Modifications to the sewage pumping station works that may adversely affect the approved effluent quality criteria or the location of the discharge/outfall;

(c) Modifications to the sewage pumping station works approved under s.9 of the EPA, and

(d) Modifications to the sewage pumping station works pursuant to an order issued by the Ministry.

(5) Implementation of Limited Operational Flexibility is not intended to be used for piecemeal measures that result in major alterations or expansions.

(6) If the implementation of Limited Operational Flexibility requires changes to be made to the Emergency Response, Spill Reporting and Contingency Plan, the Owner shall, as deemed necessary in consultation with the Water Supervisor, provide a revised copy of this plan for approval to the local fire services authority prior to implementing Limited Operational Flexibility.

(7) For greater certainty, any alteration made under the Limited Operational Flexibility may only be carried out after other legal obligations have been complied with including those arising from the Environmental Protection Act, Niagara Escarpment Planning and Development Act, Oak Ridges Moraine Conservation Act, Lake Simcoe Protection Act and Greenbelt Act.

(8) Prior to implementing Limited Operational Flexibility, the Owner shall complete a Notice of Modifications describing any proposed modifications to the sewage pumping station works and submit it to the Water Supervisor.

10. TEMPORARY EROSION AND SEDIMENT CONTROL

(1) The Owner shall install and maintain temporary sediment and erosion control measures during construction and conduct inspections once every **two (2) weeks** and after each significant storm event (a significant storm event is defined as a minimum of 25 mm of rain in any 24 hours period). The inspections and maintenance of the temporary sediment and erosion control measures shall continue until they are no longer required and at which time they shall be removed and all disturbed areas reinstated properly.

(2) The Owner shall maintain records of inspections and maintenance which shall be made available for inspection by the Ministry, upon request. The record shall include the name of the inspector, date of inspection, and the remedial measures, if any, undertaken to maintain the temporary sediment and erosion control measures.

11. RECORD KEEPING

The Owner shall retain for a minimum of **five (5) years** from the date of their creation, all records and information related to or resulting from the operation and maintenance activities required by this Approval.

Schedule "A"

Limited Operational Flexibility Criteria for Modifications to Sewage Works

1. The modifications to a sewage pumping station approved under an Environmental Compliance Approval (Approval) that are permitted under the Limited Operational Flexibility (LOF), are outlined below and are subject to the LOF conditions in the Approval, and require the submission of the Notice of Modifications. If there is a conflict between the sewage pumping station works listed below and the Terms and Conditions in the Approval, the Terms and Conditions in the Approval shall take precedence.

1.1 Sewage Pumping Stations

a. Adding or replacing equipment where new equipment is located within an existing sewage pumping station site, provided that the facility Rated Capacity is not exceeded and the existing flow process and/or treatment train are maintained, as applicable.

1.2 Pilot Systems

a. Installation of pilot systems for new or existing technologies provided that:
   i. any effluent from the pilot system is discharged to the inlet of the sewage pumping station or hauled off-site for proper disposal,
   ii. any effluent from the pilot system discharged to the inlet of the sewage pumping station or sewage conveyance system does not significantly alter the composition/concentration of the influent sewage to be treated in the downstream process; and that it does not add any inhibiting substances to the downstream process, and
   iii. the pilot system's duration does not exceed a maximum of two years; and a report with results is submitted to the Director and Water Supervisor three months after completion of the pilot project.

2. Sewage works that are exempt from section 53 of the OWRA by O. Reg. 525/98 continue to be exempt and are not required to follow the notification process under this Limited Operational Flexibility.

3. Normal or emergency operational modifications, such as repairs, reconstructions, or other improvements that are part of maintenance activities, including cleaning, renovations to existing approved sewage works equipment, provided that the modification is made with Equivalent Equipment, are considered pre-approved.

4. The modifications noted in section (3) above are not required to follow the notification protocols under Limited Operational Flexibility, provided that the number of pieces and description of the equipment as described in the Approval does not change.

Ontario
Ministry of
the Environment

Notice of Modification to Sewage Works

RETAIN COPY OF COMPLETED FORM AS PART OF THE ECA AND SEND A COPY TO THE WATER SUPERVISOR (FOR MUNICIPAL) OR DISTRICT MANAGER (FOR NON-MUNICIPAL SYSTEMS)

Part 1 – Environmental Compliance Approval (ECA) with Limited Operational Flexibility

(Insert the ECA's owner, number, issuance date and notice number, which should start with "01" and consecutive numbers thereafter)

ECA Number	Issuance Date (mm/dd/yy)	Notice number (if applicable)

ECA Owner	Municipality

Part 2: Description of the modifications as part of the Limited Operational Flexibility

(Attach a detailed description of the sewage works)

Description shall include:
1. A detail description of the modifications and/or operations to the sewage works (e.g. sewage work component, location, size, equipment type/model, material, process name, etc.)
2. Confirmation that the anticipated environmental effects are negligible.
3. List of updated versions of, or amendments to, all relevant technical documents that are affected by the modifications as applicable, i.e. submission of documentation is not required, but the listing of updated documents is (design brief, drawings, emergency plan, etc.)

Part 3 – Declaration by Professional Engineer

I hereby declare that I have verified the scope and technical aspects of this modification and confirm that the design:
1. Has been prepared or reviewed by a Professional Engineer who is licensed to practice in the Province of Ontario;
2. Conforms with the Limited Operational Flexibility as per the ECA;
3. Has been designed consistent with Ministry's Design Guidelines, adhering to engineering standards, industry's best management practices, and demonstrating ongoing compliance with s.53 of the Ontario Water Resources Act; and other appropriate regulations.

I hereby declare that to the best of my knowledge, information and belief the information contained in this form is complete and accurate.

Name (Print)	PEO License Number

Signature	Date (mm/dd/yy)

Name of Employer

Part 4 – Declaration by Owner

I hereby declare that:
1. I am authorized by the Owner to complete this Declaration;

2. The Owner consents to the modification; and
3. These modifications to the sewage works are proposed in accordance with the Limited Operational Flexibility as described in the ECA.
4. The Owner has fulfilled all applicable requirements of the *Environmental Assessment Act*.
I hereby declare that to the best of my knowledge, information and belief the information contained in this form is complete and accurate.

Name of Owner Representative (Print)	Owner representative's title (Print)
Owner Representative's Signature	Date (mm/dd/yy)

The reasons for the imposition of these terms and conditions are as follows:

1. Condition 1 is imposed to ensure that the Works are built and operated in the manner in which they were described for review and upon which approval was granted. This Condition is also included to emphasize the precedence of Conditions in the Approval and the practice that the Approval is based on the most current document, if several conflicting documents are submitted for review.

2. Condition 2 is included to ensure that, when the Works are constructed, the Works will meet the standards that apply at the time of construction to ensure the ongoing protection of the environment.

3. Condition 3 is included to ensure that the Ministry records are kept accurate and current with respect to approved Works and to ensure that any subsequent Owner of the Works is made aware of the Approval and continue to operate the Works in compliance with it.

4. Condition 4 is included to ensure that the sewage pumping station is constructed in accordance with the Approval and that record drawings of the sewage pumping station "as constructed" are maintained for future reference.

5. Conditions 5 and 7 are included to indicate that Sewage Pumping Station Overflow of untreated and/or partially treated sewage to the environment is prohibited, save in certain limited circumstances where the failure to do so could result in greater injury to the public interest than the Sewage Pumping Station Overflow itself, or where the Sewage Pumping Station Overflow can be limited or otherwise mitigated by handling it in accordance with an approved contingency plan. The notification and documentation requirements allow the Ministry to take action in an informed manner and will ensure the Owner is aware of the extent and frequency of Sewage Pumping Station Overflow Event(s).

6. Condition 6 is included to require that the Works be properly operated, maintained, funded, staffed and equipped such that the environment is protected and deterioration, loss, injury or damage to any person or property is prevented. As well, the inclusion of a comprehensive operations manual for the sewage pumping station governing all significant areas of operation, maintenance and repair is prepared, implemented and kept up-to-date by the Owner and made available to the Ministry. Such a manual is an integral part of the operation of the sewage pumping station. Its compilation and use should assist the Owner in staff training, in proper plant operation and in identifying and planning for contingencies during possible abnormal conditions. The manual will also act as a benchmark for Ministry staff when reviewing the Owner's operation of the Works.

7. Condition 8 is included to provide a performance record for future references, to ensure that the Ministry is made aware of problems as they arise, so that the Ministry can work with the Owner in resolving any problems in a timely manner.

8. Condition 9 is included to ensure that the Works are operated in accordance with the application and supporting documentation submitted by the Owner, and not in a manner which the Director has not been asked to consider. These Conditions are also included to ensure that a Professional Engineer has reviewed the proposed Modifications and attests that the Modifications are in line with that of Limited Operational Flexibility, and provide assurance that the proposed Modifications comply with the Ministry's requirements stipulated in the Terms and Conditions of this Approval, Ministry policies, guidelines, and industry engineering standards and best management practices.

9. Condition 10 is included as installation, regular inspection and maintenance of the temporary sediment and erosion control measures is required to mitigate the impact on the downstream receiving watercourse during construction, until they are no longer required.

10. Condition 11 is included to require that all records are retained for a sufficient time period to adequately evaluate the long-term operation and maintenance of the Works.

In accordance with Section 139 of the Environmental Protection Act, you may by written Notice served upon me and the Environmental Review Tribunal within 15 days after receipt of this Notice, require a hearing by the Tribunal. Section 142 of the Environmental Protection Act provides that the Notice requiring the hearing shall state:

1. The portions of the environmental compliance approval or each term or condition in the environmental compliance approval in respect of which the hearing is required, and;
2. The grounds on which you intend to rely at the hearing in relation to each portion appealed.

The Notice should also include:

3. The name of the appellant;
4. The address of the appellant;
5. The environmental compliance approval number;
6. The date of the environmental compliance approval;
7. The name of the Director, and;
8. The municipality or municipalities within which the project is to be engaged in.

And the Notice should be signed and dated by the appellant.

This Notice must be served upon:

The Secretary*
Environmental Review Tribunal
655 Bay Street, Suite 1500
Toronto, Ontario
M5G 1E5

AND

The Director appointed for the purposes of
Part II.1 of the Environmental Protection Act
Ministry of the Environment and
Climate Change
135 St. Clair Avenue West, 1st Floor
Toronto, Ontario
M4V 1P5

*** Further information on the Environmental Review Tribunal's requirements for an appeal can be obtained directly from the Tribunal at: Tel: (416) 212-6349, Fax: (416) 326-5370 or www.ert.gov.on.ca**

The above noted activity is approved under s.20.3 of Part II.1 of the Environmental Protection Act.

DATED AT TORONTO this 21st day of September, 2016

Gregory Zimmer, P.Eng.
Director
appointed for the purposes of Part II.1 of the
Environmental Protection Act

MS/

c: District Manager, MOECC Ottawa office
Greg McDonald, Novatech
Charles Warnock, Program Manager, City of Ottawa, Development Review
Linda Carkner, Program Manager, City of Ottawa, Infrastructure Services

velocity of approximately 1.4m/s (within MOE recommended forcemain velocities of 0.8 t 2.5m/s).

According to the *West Urban Community – Wastewater Collection System Master Servicing Plan by RV Anderson Associates Ltd., dated July 2012* monitored peak flows entering the Stittsville Pump Station were 39L/s in 2010. With a capacity of 108L/s, the remaining capacity is 69L/s. Based on the aforementioned, the Liard St. Pump Station can handle the majority of the development. It is recommended that the flows at the Liard St. Pump Station continue to be monitored until extension of the Fernbank Trunk is completed (see 6.1.5 for details regarding the Future Fernbank Trunk).

6.1.4 Friendly Crescent Pump Station

The Friendly Crescent Pump Station is a low lift station, which services the properties along Friendly Crescent. The flow is pumped west to the 250mm dia. sewer along Hartsmere Drive and has an overflow that is directed to a storm outlet east of Friendly Crescent.

Novatech Engineering produced the "Design Services and Stormwater Report" in May 2000 with a detailed design of the Friendly Crescent Pump Station. The station was designed to serve 70 dwellings that discharge to the Friendly Crescent Pump Station with a peak flow of 5.77 L/s using twin Flygt effluent pumps CP3085.182 that push 6.0 L/sec at 7.15 meters total dynamic head through a 100mm diameter, 230m long forcemain.

It is proposed that the sanitary sewer-shed of Friendly Crescent Pump Station be accounted for in the servicing alternatives, in order to provide a higher level of service, by providing a gravity outlet to avoid the costs of maintaining and operating the existing pump station.

6.1.5 Future Fernbank Trunk

The Future Fernbank Trunk will be built along the Hydro One easement to accommodate the future development of the Fernbank Community Design Plans as referenced in the Master Servicing Study for the Fernbank lands. Once constructed, the Liard Street Pump Station will be decommissioned, and all flows from the Liard Street Pump Station sewer-shed and the Area 6 lands will be directed to the Fernbank Trunk through a gravity sewer. The Fernbank Trunk will convey flows to the Hazeldean Pump Station. The decommissioning work will be undertaken by the City, based on the time frame provided in Infrastructure Master Plan.

The Fernbank Trunk was designed for a peak flow of 528L/s and has a capacity of 670L/s which leaves an excess capacity of 142L/s. As per section 6.1.3 of this report, the Liard Street Pump Station had a monitored flow of 39L/s in 2010, and proposed Area 6 peak design flows is 85L/s which summates to 124L/s. Based on these flows, there is adequate capacity in the Fernbank Trunk.

Based on coordination with the Landowners within the Fernbank CDP lands, the sewer depth and size will be accounted for at the proposed subdivisions within the Fernbank Lands CDP to provide the required capacity in order to eventually decommission the Liard Street Pump station and accumulate the Area 6 flows. The cost for over-sizing and over –depth of the sewers is discussed in Section 9.2.

TABLE D-1: FERNBANK CDP LANDS - NEW TRUNK SEWER
SANITARY SEWER DESIGN SHEET (2031)

AREA			RESIDENTIAL																COMMERCIAL		INSTITUTIONAL		C+I	INFILTRATION				PIPE					
			LOW DENSITY			MEDIUM DENSITY			HIGH DENSITY			MIXED USE			TOTAL																	
ID	From	To	Area (ha)	Pop.	Accum. Pop.	Area (ha)	Pop.	Accum. Pop.	Area (ha)	Pop.	Accum. Pop.	Area (ha)	Pop.	Accum. Pop.	Pop.	Accum. Pop.	Peak Factor	Peak Flow (l/s)	Area (ha)	Accum. Area (ha)	Area (ha)	Accum. Area (ha)	Peak Flow (l/s)	Total Area (ha)	Accum. Area (ha)	Infilt. Flow (l/s)	Total Flow (l/s)	Size (mm)	Slope (%)	Length (m)	Capacity (l/s)	Full Flow Vel. (m/s)	Q/Q_{full} (%)
1	902	904	9.85	910	910	0.36	54	54	0.00	0	0	0.00	0	0	964	964	3.8	14.9	0.00	0.00	0.78	0.78	0.7	16.07	16.07	4.5	20.1	250	0.24	154	30.4	0.60	66.0%
2	904	908	11.65	1076	1986	3.10	465	519	0.00	0	0	0.00	0	0	1541	2505	3.5	35.6	0.00	0.00	0.91	1.69	1.5	22.29	38.36	10.7	47.8	300	0.24	306	49.4	0.68	96.7%
3	906	908	7.45	688	688	0.00	0	0	0.00	0	0	0.00	0	0	688	688	3.9	10.9	0.00	0.00	2.63	2.63	2.3	14.51	14.51	4.1	17.2	250	1.50	373	76.0	1.50	22.7%
4	908	912	4.45	411	3085	1.67	251	770	0.00	0	0	0.00	0	0	662	3855	3.3	52.3	0.63	0.63	0.00	4.32	4.3	16.43	69.30	19.4	76.0	300	0.61	396	78.8	1.08	96.4%
5	910	912	10.35	956	956	0.00	0	0	0.00	0	0	0.00	0	0	956	956	3.8	14.8	0.00	0.00	0.83	0.83	0.7	19.34	19.34	5.4	20.9	250	0.24	320	30.4	0.60	68.8%
6	912	920	11.15	1030	5071	0.00	0	770	0.00	0	0	0.00	0	0	1030	5841	3.2	75.3	0.00	0.63	2.50	7.65	7.2	18.11	106.75	29.9	112.4	450	0.15	207	115.2	0.70	97.5%
7	914	916	16.35	1511	1511	0.90	135	135	0.00	0	0	0.00	0	0	1646	1646	3.7	24.3	0.00	0.00	0.45	0.45	0.4	25.23	25.23	7.1	31.8	300	0.25	152	50.4	0.69	63.0%
8	916	920	10.45	966	2477	0.00	0	135	0.00	0	0	0.00	0	0	966	2612	3.5	37.0	0.00	0.00	0.85	1.30	1.1	15.69	40.92	11.5	49.5	375	0.20	314	81.8	0.72	60.6%
9	918	920	5.55	513	513	0.49	74	74	0.00	0	0	0.00	0	0	587	587	3.9	9.4	0.00	0.00	6.14	6.14	5.3	16.04	16.04	4.5	19.2	250	0.85	363	57.2	1.13	33.5%
	920	922	0.00	0	8061	0.00	0	979	0.00	0	0	0.00	0	0	0	9040	3.0	109.8	0.00	0.63	0.00	15.09	13.6	0.00	163.71	45.8	169.3	525	0.18	265	190.3	0.85	88.9%
10	922	924	12.20	1127	9188	0.09	14	993	0.00	0	0	0.00	0	0	1141	10181	2.9	121.5	0.00	0.63	1.52	16.61	15.0	27.31	191.02	53.5	190.0	525	0.23	290	215.2	0.96	88.3%
	924	934	0.00	0	9188	0.00	0	993	0.00	0	0	0.00	0	0	0	10181	2.9	121.5	0.00	0.63	0.00	16.61	15.0	0.00	191.02	53.5	190.0	525	0.79	669	398.8	1.78	47.6%
11	926	930	4.95	457	457	8.40	1260	1260	0.00	0	0	3.45	279	279	1996	1996	3.6	29.0	1.99	1.99	0.82	0.82	2.4	26.79	26.79	7.5	38.9	375	0.14	530	68.4	0.60	56.9%
12	928	930	9.35	864	864	3.55	533	533	0.00	0	0	0.00	0	0	1397	1397	3.7	20.9	0.00	0.00	3.85	3.85	3.3	22.72	22.72	6.4	30.7	200	7.00	55	90.5	2.79	33.9%
13	930	932	1.65	152	1473	2.95	443	2236	0.00	0	0	0.00	0	279	595	3988	3.3	53.9	0.34	2.33	0.80	5.47	6.8	10.54	60.05	16.8	77.4	450	0.11	308	99.1	0.60	78.2%
14	932	934	0.00	0	1473	0.00	0	2236	0.00	0	0	7.12	577	856	577	4565	3.3	60.7	3.56	5.89	6.10	11.57	15.2	17.52	77.57	21.7	97.6	525	0.10	455	141.9	0.63	68.8%
15	934	972	2.90	268	10929	1.80	270	3499	0.00	0	0	1.21	98	954	636	15382	2.8	172.4	0.61	7.12	0.40	28.58	31.0	15.08	283.67	79.4	282.8	600	0.26	1007	326.6	1.12	86.6%
16	936	938	7.58	700	700	0.70	105	105	0.00	0	0	0.00	0	0	805	805	3.9	12.6	0.00	0.00	2.17	2.17	1.9	14.42	14.42	4.0	18.5	250	1.00	108	62.0	1.22	29.8%
17	938	940	8.05	744	1444	1.00	150	255	0.00	0	0	4.41	357	357	1251	2056	3.6	29.8	2.21	2.21	0.83	3.00	4.5	25.14	39.56	11.1	45.4	300	0.35	156	59.7	0.82	76.0%
18	940	952	6.35	587	2031	0.99	149	404	0.00	0	0	0.00	0	357	736	2792	3.5	39.2	0.00	2.21	0.00	3.00	4.5	10.51	50.07	14.0	57.8	300	0.75	310	87.4	1.20	66.1%
19	942	944	7.25	670	670	4.70	705	705	0.00	0	0	0.00	0	0	1375	1375	3.7	20.6	0.00	0.00	12.67	12.67	11.0	34.19	34.19	9.6	41.2	250	0.90	516	58.9	1.16	70.0%
20	944	946	12.20	1127	1797	1.00	150	855	0.00	0	0	0.00	0	0	1277	2652	3.5	37.5	0.00	0.00	0.82	13.49	11.7	20.35	54.54	15.3	64.4	375	0.20	511	81.8	0.72	78.8%
21	946	948	4.15	383	2180	4.22	633	1488	0.00	0	0	0.00	0	0	1016	3668	3.4	50.0	0.00	0.00	3.87	17.36	15.1	17.22	71.76	20.1	85.2	375	0.50	243	129.3	1.13	65.9%
	948	950	0.00	0	2180	0.00	0	1488	0.00	0	0	0.00	0	0	0	3668	3.4	50.0	0.00	0.00	0.00	17.36	15.1	0.00	71.76	20.1	85.2	450	0.15	195	115.2	0.70	74.0%
22	950	952	5.05	467	2647	0.30	45	1533	0.00	0	0	0.00	0	0	512	4180	3.3	56.2	0.00	0.00	3.24	20.6	17.9	11.43	83.19	23.3	97.3	450	0.15	221	115.2	0.70	84.5%
23	952	972	4.15	383	5061	5.50	825	2762	0.00	0	0	0.00	0	357	1208	8180	3.0	100.8	0.00	2.21	0.00	23.60	22.4	22.72	155.98	43.7	166.8	450	0.54	282	218.6	1.33	76.3%
24	954	956	7.70	711	711	2.90	435	435	0.00	0	0	6.70	543	543	1689	1689	3.6	24.9	3.35	3.35	0.79	0.79	3.6	22.81	22.81	6.4	34.9	375	0.15	330	70.8	0.62	49.3%
25	956	958	10.70	989	1700	0.00	0	435	0.00	0	0	0.00	0	543	989	2678	3.5	37.8	0.00	3.35	6.27	7.06	9.0	23.45	46.26	13.0	59.8	450	0.20	411	133.0	0.81	44.9%
	958	960	0.00	0	1700	0.00	0	435	0.00	0	0	0.00	0	543	0	2678	3.5	37.8	0.00	3.35	0.00	7.06	9.0	0.00	46.26	13.0	59.8	450	0.15	177	115.2	0.70	51.9%
26	960	966	7.75	716	2416	0.00	0	435	0.00	0	0	0.00	0	543	716	3394	3.4	46.7	0.00	3.35	0.00	7.06	9.0	11.51	57.77	16.2	71.9	450	0.15	82	115.2	0.70	62.4%
27	962	964	2.55	236	236	4.70	705	705	5.04	680	680	0.00	0	0	1621	1621	3.7	24.0	0.00	0.00	0.00	0.00	0.0	20.97	20.97	5.9	29.9	250	0.35	479	36.7	0.72	81.4%
	964	966	0.00	0	236	0.00	0	705	0.00	0	680	0.00	0	0	0	1621	3.7	24.0	0.00	0.00	0.00	0.00	0.0	0.00	20.97	5.9	29.9	250	1.00	298	62.0	1.22	48.2%
28	966	970	1.80	166	2818	5.25	788	1928	0.00	0	680	0.00	0	543	954	5969	3.2	76.7	0.00	3.35	8.89	15.95	16.8	22.38	101.12	28.3	121.8	525	0.15	249	173.8	0.78	70.1%
29	968	970	6.90	638	638	0.00	0	0	0.00	0	0	0.00	0	0	638	638	3.9	10.1	0.00	0.00	0.99	0.99	0.9	11.03	11.03	3.1	14.1	200	0.32	82	19.4	0.60	72.7%
	970	972	0.00	0	3456	0.00	0	1928	0.00	0	680	0.00	0	543	0	6607	3.1	83.8	0.00	3.35	0.00	16.94	17.6	0.00	112.15	31.4	132.8	600	0.15	178	248.1	0.85	53.5%
	972	974	0.00	0	19446	0.00	0	8189	0.00	0	680	0.00	0	1854	0	30169	2.5	302.5	0.00	12.68	0.00	69.12	71.0	0.00	551.8	154.5	528.0	825	0.20	586	669.7	1.21	78.8%
	974	Ex	0.00	0	19446	0.00	0	8189	0.00	0	680	0.00	0	1854	0	30169	2.5	302.5	0.00	12.68	0.00	69.12	71.0	0.00	551.80	154.5	528.0	825	0.20	66	669.7	1.21	78.8%
			210.48			**54.57**			**5.04**			**22.89**																					

Design Parameters:

					Units/Net ha	Pop/Unit	
Avg Flow/Person =	350	l/day	Pipe Friction n = 0.013	Low Density Residential =	28	3.30	
Comm./Inst. Flow =	50,000	l/ha/day	Residential Peaking Factor = Harmon Equation (max 4, min 2)	Medium Density Residential =	60	2.50	(Multi Family Residential)
Infiltration =	0.28	l/s/ha	Peaking Factor Comm./Inst. = 1.5	High Density Residential =	75	1.80	
				Mixed Use =	90	1.80	(50% of mixed use area is residential)

Project: Fernbank CDP (101108)
Designed: KJM
Checked: MAB
Dwg. Reference: 101108-SAN
Date: May 8, 2009

SANITARY SEWER CALCULATION SHEET

Manning's n=0.013

LOCATION			RESIDENTIAL AREA AND POPULATION							COMM		INSTIT		PARK		C+I+I	INFILTRATION				PIPE						
STREET	FROM M.H.	TO M.H.	AREA (ha)	UNITS	POP.	CUMULATIVE AREA (ha)	CUMULATIVE POP.	PEAK FACT.	PEAK FLOW (l/s)	AREA (ha)	ACCU. AREA (ha)	AREA (ha)	ACCU. AREA (ha)	AREA (ha)	ACCU. AREA (ha)	PEAK FLOW (l/s)	TOTAL AREA (ha)	ACCU. AREA (ha)	INFILT. FLOW (l/s)	TOTAL FLOW (l/s)	DIST (m)	DIA (mm)	SLOPE (%)	CAP. (FULL) (l/s)	RATIO Q act/Q cap	VEL. (FULL) (m/s)	VEL. (ACT.) (m/s)
SAN TRUNK 1																											
			0.10		0	0.10	0				0.00		0.00	0.93	0.93		1.03	1.03									
			0.85		98	0.95	98				0.00		0.00		0.93		0.85	1.88									
			1.84		214	2.79	312				0.00		0.00		0.93		1.84	3.72									
			2.68		770	5.47	1082				0.00		0.00		0.93		2.68	6.40									
	120A	135A	2.96		221	8.43	1303	3.2	13.42		0.00		0.00		0.93	0.10	2.96	9.36	3.09	16.61	63.0	300	0.20	43.25	0.38	0.61	0.57
			0.20		23	8.63	1326				0.00		0.00		0.93		0.20	9.56									
			1.10		127	9.73	1453				0.00		0.00		0.93		1.10	10.66									
			1.30		152	11.03	1605				0.00		0.00		0.93		1.30	11.96									
			1.70		196	12.73	1801				0.00		0.00		0.93		1.70	13.66									
	135A	139A	2.43		184	15.16	1985	3.1	19.75		0.00		0.00		0.93	0.10	2.43	16.09	5.31	25.16	60.0	300	0.20	43.25	0.58	0.61	0.63
			0.23		27	15.39	2012				0.00		0.00		0.93		0.23	16.32									
			0.24		18	15.63	2030				0.00		0.00		0.93		0.24	16.56									
	139A	143A	1.28		148	16.91	2178	3.0	21.50		0.00		0.00		0.93	0.10	1.28	17.84	5.89	27.48	60.0	300	0.20	43.25	0.64	0.61	0.65
			0.20		23	17.11	2201				0.00		0.00		0.93		0.20	18.04									
			0.29		22	17.40	2223				0.00		0.00		0.93		0.29	18.33									
	143A	159A	1.28		148	18.68	2371	3.0	23.22		0.00		0.00		0.93	0.10	1.28	19.61	6.47	29.79	60.0	300	0.20	43.25	0.69	0.61	0.66
			0.20		23	18.88	2394				0.00		0.00		0.93		0.20	19.81									
			0.65		51	19.53	2445				0.00		0.00		0.93		0.65	20.46									
			1.36		101	20.89	2546				0.00		0.00		0.93		1.36	21.82									
	159A	166A	4.27		483	25.16	3029	3.0	28.97		0.00		0.00		0.93	0.10	4.27	26.09	8.61	37.68	60.0	300	0.20	43.25	0.87	0.61	0.69
			0.23		27	25.39	3056				0.00		0.00		0.93		0.23	26.32									
	166A	169A	2.26		171	27.65	3227	2.9	30.66		0.00		0.00		0.93	0.10	2.26	28.58	9.43	40.20	60.0	300	0.20	43.25	0.93	0.61	0.69
			0.20		23	27.85	3250				0.00		0.00		0.93		0.20	28.78									
	169A	172A	0.96		73	28.81	3323	2.9	31.48		0.00		0.00		0.93	0.10	0.96	29.74	9.81	41.40	60.0	300	0.20	43.25	0.96	0.61	0.70
			0.05		0	28.86	3323				0.00		0.00		0.93		0.05	29.79									
			0.20		15	29.06	3338				0.00		0.00		0.93		0.20	29.99									
	172A	173A	1.31		99	30.37	3437	2.9	32.45		0.00		0.00		0.93	0.10	1.31	31.30	10.33	42.88	60.0	375	0.20	78.41	0.55	0.71	0.72
	173A	174A	0.37		28	30.74	3465	2.9	32.69		0.00		0.00		0.93	0.10	0.37	31.67	10.45	43.24	72.5	375	0.20	78.41	0.55	0.71	0.73
	174A	175A	0.42		32	31.16	3497	2.9	32.96		0.00		0.00		0.93	0.10	0.42	32.09	10.59	43.65	70.5	375	0.20	78.41	0.56	0.71	0.73
	175A	176A	0.36		27	31.52	3524	2.9	33.18		0.00		0.00		0.93	0.10	0.36	32.45	10.71	43.99	61.0	375	0.20	78.41	0.56	0.71	0.73
	176A	177A	0.12		9	31.64	3533	2.9	33.26		0.00		0.00		0.93	0.10	0.12	32.57	10.75	44.11	9.5	375	0.20	78.41	0.56	0.71	0.73
	177A	178A	0.02		0	31.66	3533	2.9	33.26		0.00		0.00		0.93	0.10	0.02	32.59	10.75	44.11	60.0	375	0.20	78.41	0.56	0.71	0.73
	178A	179A				31.66	3533	2.9	33.26		0.00		0.00		0.93	0.10	0.00	32.59	10.75	44.11	24.5	375	0.20	78.41	0.56	0.71	0.73
	179A	180A				31.66	3533	2.9	33.26		0.00		0.00		0.93	0.10	0.00	32.59	10.75	44.11	16.5	375	0.20	78.41	0.56	0.71	0.73
	180A	283A				31.66	3533	2.9	33.26		0.00		0.00		0.93	0.10	0.00	32.59	10.75	44.11	11.0	375	0.20	78.41	0.56	0.71	0.73
To SAN TRUNK 2, Pipe 283A - 284A						31.66	3533				0.00		0.00		0.93			32.59									
SAN TRUNK 2																											
			0.04		0	0.04	0				0.00		0.00		0.00		0.04	0.04									
			0.28		33	0.32	33				0.00		0.00		0.00		0.28	0.32									
	203A	205A	0.43		50	0.75	83	3.6	0.97		0.00		0.00		0.00	0.00	0.43	0.75	0.25	1.22	60.0	200	0.35	19.40	0.06	0.62	0.34
			0.40		46	1.15	129				0.00		0.00		0.00		0.40	1.15									
	205A	206A	0.70		82	1.85	211	3.5	2.40		0.00		0.00		0.00	0.00	0.70	1.85	0.61	3.01	74.5	200	0.35	19.40	0.16	0.62	0.45
			0.38		44	2.23	255				0.00		0.00		0.00		0.38	2.23									
	206A	217A	0.68		79	2.91	334	3.4	3.73		0.00		0.00		0.00	0.00	0.68	2.91	0.96	4.69	81.0	200	0.35	19.40	0.24	0.62	0.50

DESIGN PARAMETERS

Park Flow =	9300	L/ha/da	0.10764	l/s/Ha			
Average Daily Flow =	280	l/p/day			Industrial Peak Factor = as per MOE Graph		
Comm/Inst Flow =	28000	L/ha/da	0.3241	l/s/Ha	Extraneous Flow =	0.330	L/s/ha
Industrial Flow =	35000	L/ha/da	0.40509	l/s/Ha	Minimum Velocity =	0.600	m/s
Max Res. Peak Factor =	4.00				Manning's n = (Conc)	0.013 (Pvc)	0.013
Commercial/Inst./Park Peak Factor =	1.00				Townhouse coeff=	2.7	
Institutional =	0.32	l/s/Ha			Single house coeff=	3.4	

Designed: V.W.

Checked: W.L.

Dwg. Reference: Sanitary Drainage Plan, Dwgs. No.

PROJECT: **1247- Stittsville South Uban Expansion Area**

LOCATION: **City of Ottawa**

File Ref:

Date: **31 Jul 2024**

Sheet No. 1 of 2

SANITARY SEWER CALCULATION SHEET

Manning's n=0.013

LOCATION				RESIDENTIAL AREA AND POPULATION							COMM		INSTIT		PARK		C+I+I	INFILTRATION				PIPE						
STREET		FROM M.H.	TO M.H.	AREA (ha)	UNITS	POP.	CUMULATIVE AREA (ha)	CUMULATIVE POP.	PEAK FACT.	PEAK FLOW (l/s)	AREA (ha)	ACCU. AREA (ha)	AREA (ha)	ACCU. AREA (ha)	AREA (ha)	ACCU. AREA (ha)	PEAK FLOW (l/s)	TOTAL AREA (ha)	ACCU. AREA (ha)	INFILT. FLOW (l/s)	TOTAL FLOW (l/s)	DIST (m)	DIA (mm)	SLOPE (%)	CAP. (FULL) (l/s)	RATIO Q act/Q cap	VEL. (FULL) (m/s)	VEL. (ACT.) (m/s)
				0.12		0	3.03	334				0.00		0.00		0.00		0.12	3.03									
				0.58		67	3.61	401				0.00		0.00		0.00		0.58	3.61									
				1.17		135	4.78	536				0.00		0.00		0.00		1.17	4.78									
		217A	226A	2.13		248	6.91	784	3.3	8.37		0.00		0.00		0.00	0.00	2.13	6.91	2.28	10.65	61.5	250	0.25	29.73	0.36	0.61	0.55
				0.12		0	7.03	784				0.00		0.00		0.00		0.12	7.03									
				0.72		83	7.75	867				0.00		0.00		0.00		0.72	7.75									
				1.15		134	8.90	1001				0.00		0.00		0.00		1.15	8.90									
		226A	228A	1.30		98	10.20	1099	3.2	11.46		0.00		0.00		0.00	0.00	1.30	10.20	3.37	14.83	60.0	250	0.25	29.73	0.50	0.61	0.60
		228A	229A	0.16		0	10.36	1099	3.2	11.46		0.00		0.00	1.85	1.85	0.20	2.01	12.21	4.03	15.69	69.5	250	0.30	32.57	0.48	0.66	0.65
		229A	230A	0.16		0	10.52	1099	3.2	11.46		0.00		0.00		1.85	0.20	0.16	12.37	4.08	15.74	67.5	300	0.20	43.25	0.36	0.61	0.56
		230A	231A	0.04		0	10.56	1099	3.2	11.46		0.00		0.00		1.85	0.20	0.04	12.41	4.10	15.76	15.5	300	0.20	43.25	0.36	0.61	0.56
				0.08		0	10.64	1099				0.00		0.00		1.85		0.08	12.49									
				0.81		61	11.45	1160				0.00		0.00		1.85		0.81	13.30									
				2.74		787	14.19	1947				0.00		0.00		1.85		2.74	16.04									
				3.34		244	17.53	2191				0.00		0.00		1.85		3.34	19.38									
		231A	265A	3.90		452	21.43	2643	3.0	25.62		0.00		0.00		1.85	0.20	3.90	23.28	7.68	33.50	39.0	300	0.20	43.25	0.77	0.61	0.68
		265A	266A	0.06		0	21.49	2643	3.0	25.62		0.00		0.00		1.85	0.20	0.06	23.34	7.70	33.52	34.5	300	0.20	43.25	0.78	0.61	0.68
		266A	267A	0.14		0	21.63	2643	3.0	25.62		0.00		0.00		1.85	0.20	0.14	23.48	7.75	33.57	80.0	300	0.20	43.25	0.78	0.61	0.68
		267A	268A	0.11		9	21.74	2652	3.0	25.70		0.00		0.00		1.85	0.20	0.11	23.59	7.78	33.68	21.0	300	0.20	43.25	0.78	0.61	0.68
				0.05		4	21.79	2656				0.00		0.00	0.73	2.58		0.78	24.37									
				0.06		5	21.85	2661				0.00		0.00		2.58		0.06	24.43									
		268A	269A	0.10		8	21.95	2669	3.0	25.85		0.00		0.00		2.58	0.28	0.10	24.53	8.09	34.22	80.0	300	0.20	43.25	0.79	0.61	0.68
		269A	270A	0.59		45	22.54	2714	3.0	26.24		0.00		0.00		2.58	0.28	0.59	25.12	8.29	34.81	114.0	300	0.20	43.25	0.80	0.61	0.68
		270A	280A	0.12		9	22.66	2723	3.0	26.32		0.00		0.00		2.58	0.28	0.12	25.24	8.33	34.92	14.5	300	0.20	43.25	0.81	0.61	0.68
				0.02		0	22.68	2723				0.00		0.00		2.58		0.02	25.26									
				0.16		12	22.84	2735				0.00		0.00		2.58		0.16	25.42									
		280A	281A	2.15		163	24.99	2898	3.0	27.84		0.00		0.00		2.58	0.28	2.15	27.57	9.10	37.21	37.5	300	0.20	43.25	0.86	0.61	0.69
		281A	282A				24.99	2898	3.0	27.84		0.00		0.00		2.58	0.28	0.00	27.57	9.10	37.21	8.5	300	0.20	43.25	0.86	0.61	0.69
		282A	283A				24.99	2898	3.0	27.84		0.00		0.00		2.58	0.28	0.00	27.57	9.10	37.21	2.5	450	2.50	450.79	0.08	2.83	1.69
Contribution From SAN TRUNK 1, Pipe 180A - 283A							31.66	3533				0.00		0.00		0.93		32.59	60.16									
		283A	284A				56.65	6431	2.7	56.55		0.00		0.00		3.51	0.38	0.00	60.16	19.85	76.79	2.3	450	2.50	450.79	0.17	2.83	2.10
SAN TRUNK 3																												
		6001A	6002A				0.00					0.00		0.00		0.00	0.00	0.00	0.00	0.00	0.00	12.0	375	0.35	103.73	0.00	0.94	0.05
		6002A	6003A				0.00	0				0.00		0.00		0.00	0.00	0.00	0.00	0.00	0.00	44.0	375	0.30	96.03	0.00	0.87	0.05
		6003A	6004A				0.00	0				0.00		0.00		0.00	0.00	0.00	0.00	0.00	0.00	17.0	375	0.35	103.73	0.00	0.94	0.05

DESIGN PARAMETERS

Park Flow =	9300	L/ha/da	0.10764	l/s/Ha				
Average Daily Flow =	280	l/p/day			Industrial Peak Factor = as per MOE Graph			
Comm/Inst Flow =	28000	L/ha/da	0.3241	l/s/Ha	Extraneous Flow =	0.330	L/s/ha	
Industrial Flow =	35000	L/ha/da	0.40509	l/s/Ha	Minimum Velocity =	0.600	m/s	
Max Res. Peak Factor =	4.00				Manning's n = (Conc)	0.013	(Pvc)	0.013
Commercial/Inst./Park Peak Factor =	1.00				Townhouse coeff=	2.7		
Institutional =	0.32	l/s/Ha			Single house coeff=	3.4		

Designed: V.W.	PROJECT: **1247- Stittsville South Uban Expansion Area**		
Checked: W.L.	LOCATION: **City of Ottawa**		
Dwg. Reference: Sanitary Drainage Plan, Dwgs. No.	File Ref:	Date: **31 Jul 2024**	Sheet No. 2 of 2

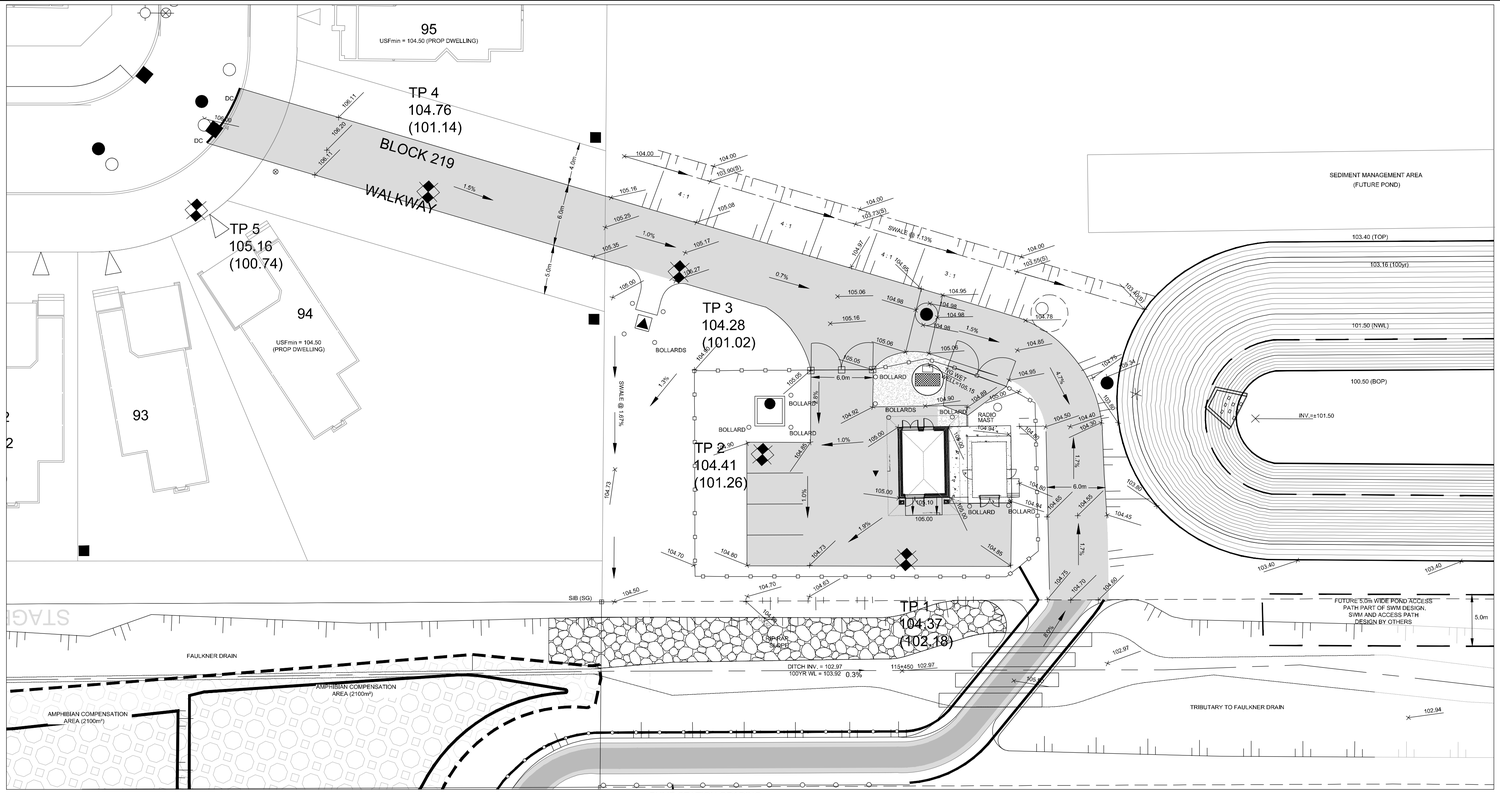

PUMP STATION GRADING

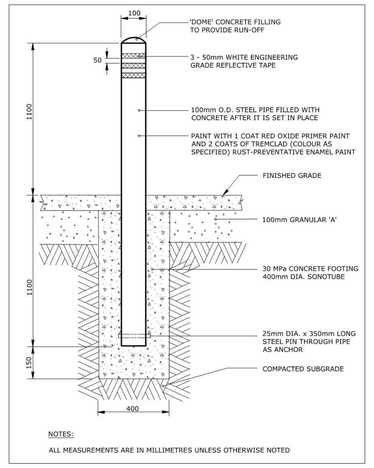

NOTES:

ALL MEASUREMENTS ARE IN MILLIMETRES UNLESS OTHERWISE NOTED

BOLLARD DETAIL

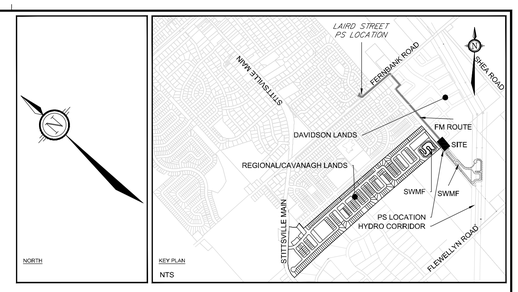



CONCRETE ENCASED HYDRO

SCALE: 1:20

LEGEND

- SANMH — PROPOSED SANITARY MH & SEWER
- 200mmØ — PROPOSED DUAL 200mmØ SANITARY FORCEMAIN
- STMMH — PROPOSED STORM MH & SEWER
- DIRECTION OF FLOW
- PROPOSED CONCRETE ENCASED 3Ø HYDRO SERVICE
- PROPOSED HYDRO TRANSFORMER
- PROPOSED FENCE LINE
- GAS — PROPOSED GAS
- TEST PIT (REFER TO HOULE CHEVRIER ENG. LTD. PROJECT No. 12-478 AND 14-420)
- BORE HOLES (REFER TO HOULE CHEVRIER ENG. LTD. PROJECT No. 64153.53)
- TEST PITS DUG OCTOBER 18TH, 2016

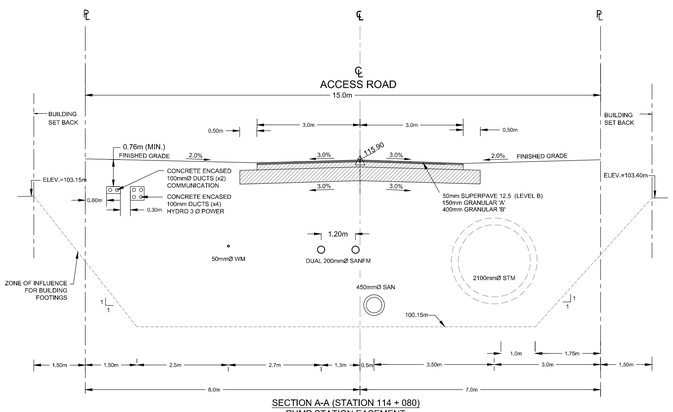

SECTION A-A (STATION 114 + 080)
PUMP STATION EASEMENT

SCALE: 1:75

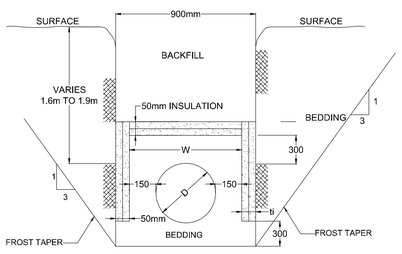

SANITARY FORCEMAIN
INSULATION DETAIL
STA 114+110 TO 114+156
N.T.S.

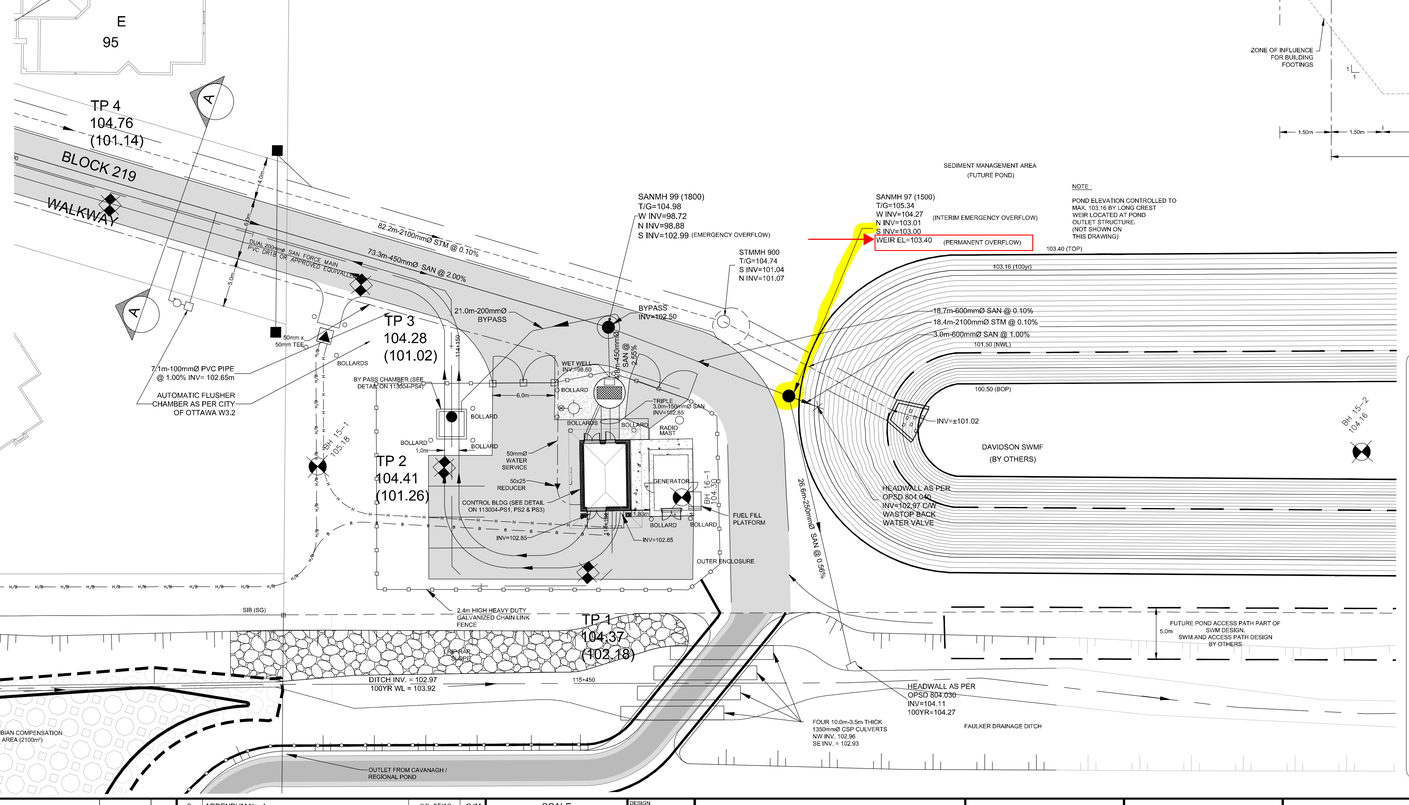

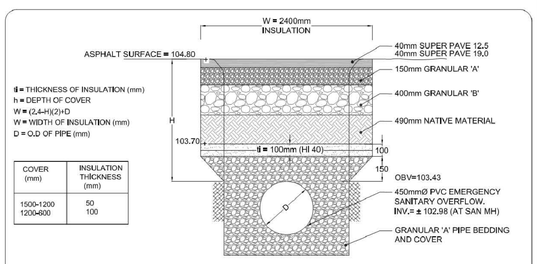

i = THICKNESS OF INSULATION (mm)
h = DEPTH OF COVER
W = (2.4+i)/(2)+D
W = WIDTH OF INSULATION (mm)
D = O.D OF PIPE (mm)

COVER (mm)	INSULATION THICKNESS (mm)
1500-1200	50
1200-600	100

NOTES:

1. INCREMENTS OF THICKNESS SHALL BE ADJUSTABLE TO 50mm
2. THICKNESS OF INSULATION IS 50mm (min.)
3. INSULATE ALL PIPES AS SPECIFIED WITH MIN 50mm (MIN) x 1200mm HI-40 INSULATION. PROVIDE 150mm CLEARANCE BETWEEN PIPE AND INSULATION. (SEE ABOVE DETAIL).
4. THE THICKNESS OF INSULATION SLAB SHALL BE THE EQUIVALENT OF 25mm FOR EVERY 300mm REDUCTION IN THE REQUIRED DEPTH OF COVER (ROUNDED TO THE NEAREST 25mm INCREMENT).

TYPICAL INSULATION DETAIL - SANITARY OVERFLOW

N.T.S.

NOTE:
THE POSITION OF ALL POLE LINES, CONDUITS, WATERMAINS, SEWERS AND OTHER UNDERGROUND AND OVERGROUND UTILITIES AND STRUCTURES IS NOT NECESSARILY SHOWN ON THE CONTRACT DRAWINGS, AND WHERE SHOWN, THE ACCURACY OF THE POSITION OF SUCH UTILITIES AND STRUCTURES IS NOT GUARANTEED. BEFORE STARTING WORK, DETERMINE THE EXACT LOCATION OF ALL SUCH UTILITIES AND STRUCTURES AND ASSUME ALL LIABILITY FOR DAMAGE TO THEM.

No.	REVISION	DATE	BY
14.	AS BUILT	SEP 06/18	GJM
13.	REVISED GRADES FROM SANMH 99 TO FAULKNER DRAIN	JUN 23/17	GJM
12.	ISSUED FOR MYLARS	FEB 23/17	GJM
11.	ISSUED FOR LAYOUT	JAN 13/17	GJM
10.	REVISED SANMH 99 AND 101 INVERTS	NOV 17/16	GJM
9.	AUTOMATIC FLUSHER CHAMBER ADDED	SEPT 09/16	BHB
8.	ADDENDUM No. 4	JUL 05/16	GJM
7.	REVISED MANHOLES 97 AND 99. 200mm BYPASS ADDED	JUN 22/16	GJM
6.	ISSUED FOR TENDER	MAY 25/16	GJM
5.	ISSUED FOR ENVIRONMENTAL COMPLIANCE APPROVAL	MAY 04/16	GJM
4.	ISSUED WITH MINOR ADJUSTMENTS	MAR 29/16	GJM
3.	ISSUED FOR 75% DESIGN	MAR 14/16	GJM
2.	50 % DESIGN	DEC 22/15	GJM
1.	ISSUED WITH PUMP STATION PRE-DESIGN REPORT	JUNE 24/15	GJM

SCALE
1 : 250
(UNLESS NOTED)

DESIGN GJM/BHB
CHECKED GJM
DRAWN MWC
CHECKED GJM
APPROVED GJM

NOVATECH
Engineers, Planners & Landscape Architects
Suite 200, 240 Michael Cowpland Drive
Ottawa, Ontario, Canada K2M 1P6
Telephone (613) 254-9643
Facsimile (613) 254-5867
Website www.novatech-eng.com

LOCATION
CITY OF OTTAWA
STITTSVILLE SOUTH - AREA 6

DRAWING NAME
SHEA ROAD SANITARY PUMP STATION - SITE SERVICING AND GRADING

PROJECT No. 113004-00
REV REV # 14
DRAWING No. 113004-PS-SVC

M:\2013\113004\CAD\Design\113004-PR[R2].dwg, PS-SVC, Sep 07, 2018 - 11:06am, bolam

PLAN01.DWG - SWSHeiw/SVNet

NOVATECH
Engineers, Planners & Landscape Architects

M E M O R A N D U M

DATE: **MAY 30, 2023**

TO: **KEVIN MURPHY**

FROM: **SAM BAHIA, BEN SWEET**

RE: **SHEA ROAD PUMP STATION & FERNBANK TRUNK CAPACITY REVIEW**
NOVATECH FILE NO.: 122163

CC: **CARL SCIUK**

Introduction

Under the New Official Plan two expansion areas were introduced to West Stittsville: W3 and W4 West Stittsville. Wastewater flows from these expansion areas were not previously considered as part of the Shea Road Pump Station (Shea PS) and Fernbank Trunk Sanitary (FTS) Sewer original designs.

As per David Schaeffer Engineering Limited's (DSEL) request, this memorandum summarizes the findings from the Shea PS and FTS Sewer capacity review, for both the current and future wastewater flows within the respective sewer sheds. The capacity review considers the introduction of the New Official Plan expansion areas – W4 West Stittsville (Subject Site), and an allowance for W3 West Stittsville, which would introduce additional flows to the FTS Sewer. Drawing 122163-SAN illustrates W3 and W4 West Stittsville.

The Subject Site is located at the North-West corner of Flewellyn Road and Shea Road, South of the Area 6 lands. As W4 West Stittsville is directly adjacent to the Shea PS, wastewater flows could be directed to the Shea PS through sanitary sewers, and ultimately to the FTS Sewer.

Background and Infrastructure Status

Upgrades to the Shea PS were completed in August 2022, which included the installation of a third pump. These upgrades increased the Shea PS firm capacity from 42 L/s to 84 L/s, accommodating further development of the Area 6 lands as well as the decommissioning of the Friendly Crescent Pump Station (Friendly PS). Currently, it is anticipated that full buildout of the Area 6 lands will be completed within the next five years (assumed to be prior to the development of W3 and W4 West Stittsville) and the decommissioning of the Friendly PS will be completed by July 2023.

Extension of the FTS Sewer from Goldhawk Drive to Edenwylde Drive was completed in December 2022, accommodating the above-mentioned increase in the Shea PS firm capacity as well as further development North of Fernbank Road. In the future, it is planned that the FTS Sewer will be extended to Liard Street to allow for the decommissioning of the Liard Street Pump Station (Liard PS). The future FTS Sewer extension and the Liard PS decommissioning will be completed by others.

Suite 200, 240 Michael Cowpland Drive, Ottawa ON K2M 1P6 Tel: 613.254.9643 www.novatech-eng.com

Although this work is being completed by others, it is anticipated that this work will be completed within the next five years.

It is important to note that the decommissioning of the Friendly and Liard PS were both considered as part of the Shea PS and FTS Sewer original designs. The wastewater flows from the Shea PS and FTS Sewer ultimately outlet to the Hazeldean Road Pump Station (Hazeldean PS).

Subject Site Development Potential

High-level development potential of the Subject Site has been provided to Novatech by DSEL, which comprises of a population potential and effective extraneous area of 5,760 persons and 64.2 ha (excluding HONI corridor and ponds), respectively, which would be developed in 2 stages (East and West of the Faulkner Municipal Drain). **The theoretical peaked flow for the Subject Site, not considering peaking factors from external areas, is approximately 70 L/s.**

Shea Road Pump Station Capacity Review

As mentioned previously, the Shea PS current firm capacity is 84 L/s.

For the purposes of the Shea PS capacity review, the development buildout has been broken down into four scenarios for construction staging. The stages are as follows:

- Stage 1 & 2 – Area 6 lands full buildout including MD blocks, Bell lands, and commercial lands
- Stage 3 – Friendly PS decommissioned with flows diverted to the Shea PS
- Stage 4 – W4 West Stittsville partial buildout (Maguire & Faulkner lands only)
- Stage 5 – W4 West Stittsville full buildout (Davidson & Eder lands added)

Tables 1 to 4 have been prepared to compare the Shea PS staged flow under different loading parameters. The different loading parameters are as follows:

- Condition 1 – Design Parameters for Occupied & Unoccupied
- Condition 2 – Annual Parameters for Occupied & Design Parameters for Unoccupied
- Condition 3 – Annual Parameters for Occupied & Unoccupied
- Condition 4 – Rare Parameters for Occupied & Unoccupied

The following table summarizes the Shea PS staged flows under different loading parameters.

Shea PS Staged Flow Summary

Scenario	Condition 1 (Design)	Condition 2 (Annual/Design)	Condition 3 (Annual)	Condition 4 (Rare)
Stage 1 & 2	64.13 L/s	47.48 L/s	44.50 L/s	60.08 L/s
Stage 3	67.45 L/s	49.81 L/s	46.85 L/s	63.60 L/s
Stage 4	101.59 L/s	84.25 L/s	69.38 L/s	94.73 L/s
Stage 5	128.45 L/s	111.46 L/s	87.44 L/s	120.24 L/s

Given the wastewater flows for the Stage 5 (full buildout) under each different loading parameter are all greater than the Shea PS current firm capacity, future upgrades to the pump station will be

Suite 200, 240 Michael Cowpland Drive, Ottawa ON K2M 1P6 Tel: 613.254.9643 www.novatech-eng.com

required if these lands are all to be directed to the Shea PS. If the future upgrades are based on the peaked design flows, the Shea PS proposed firm capacity would need to be upgraded to 130 L/s.

Shea Road Pump Station Potential Future Upgrades

Novatech has reviewed potential component upgrades to the Shea PS based on 130 L/s, which should accommodate the above.

The following outlines the potential future upgrades:

Certain Upgrades:
- Higher HP pumps;
- Starters; and
- Power to pumps.

More than Likely Upgrades:
- New generator.

Possible Upgrades:
- Primary power supply and 600V wiring; and
- Upsize 150mm piping between wet well and valve chamber and within basement.

Probably OK:
- Controls;
- 200mm forcemain (as long as it can be demonstrated that surge pressures will not be an issue due to higher velocities; the theoretical velocity will need to be confirmed by a transient analysis as part of the detailed design for the Shea PS future upgrades);
- Wet well (as long as new pumps fit and operating volumes are adjusted);
- Control room; and
- Bypass chamber.

Once DSEL has reviewed the sanitary servicing approach for W4 West Stittsville, the Shea PS future upgrades can be reviewed further.

Monitoring of the existing wastewater flows to the Shea PS will also need to be reviewed further during the Master Servicing Study / Draft Plan stage, prior to detailed design, to determine residual capacity and future upgrades. This will be completed under separate cover.

Fernbank Trunk Sanitary Sewer Capacity Review

For the purposes of the FTS Sewer capacity review, we have updated sanitary sewer design sheets of the downstream trunks which include the anticipated future growth to determine the impacts on the sewer system.

On a reach-by-reach basis, the sanitary sewer design sheets include the relevant population and areas based on the existing and anticipated future growth being directed to the respective sewers as well as the fixed wastewater flow allowances for the Shea PS (Areas 6 lands and W4 West Stittsville) and W3 West Stittsville. The existing and anticipated future growth includes the development lands owned by CRT Developments Inc., 1384341 Ontario Ltd. (Cavanagh-Fernbank), 2087875 Ontario

Suite 200, 240 Michael Cowpland Drive, Ottawa ON K2M 1P6 Tel: 613.254.9643 www.novatech-eng.com

Ltd. (Tartan-Fernbank) as well as the Liard PS sewer shed under the assumption that it will be decommissioned.

Sanitary Sewer Design Sheet 1 includes the sewers upstream of EX FT24 (MHSA72815). Sanitary Sewer Design Sheet 2 includes the sewers downstream of EX FT24 (MHSA72815).

The updates are as follows:

- Added fixed wastewater flow allowance to the relevant sections of the downstream trunk for the Shea PS Stage 5 (full buildout) = 130 L/s (as outlined above);
- Added fixed wastewater flow allowance to the relevant sections of the downstream trunk for W3 West Stittsville = 40 L/s (based on 45 ha of developable land at 0.9 L/s/ha); and
- Assumed the Liard PS decommissioning has been completed, thus, the Liard PS sewer shed and W3 West Stittsville are directed to the FTS Sewer.

Based on the foregoing and review of the impacts on the sewer system, it should be noted that there are minor surcharges. However, due to the depth of the trunk sewer and the isolated sections of trunk sewer surcharging under the peaked design flows, impact would be negligible.

Attachments

1. Table 1 – Shea PS Staged Flow Summary (Design Parameters for Occupied & Unoccupied)
2. Table 2 – Shea PS Staged Flow Summary (Annual Parameters for Occupied & Design Parameters for Unoccupied)
3. Table 3 – Shea PS Staged Flow Summary (Annual Parameters for Occupied & Unoccupied)
4. Table 4 – Shea PS Staged Flow Summary (Rare Parameters for Occupied & Unoccupied)
5. Sanitary Sewer Design Sheet 1 - Upstream of EX FT24
6. Sanitary Sewer Design Sheet 2 - Downstream of EX FT24
7. Drawing 122163-SAN
8. Drawing 108180-FT5

Suite 200, 240 Michael Cowpland Drive, Ottawa ON K2M 1P6 Tel: 613.254.9643 www.novatech-eng.com

Novatech
Suite 200 - 240 Michael Cowpland Drive
Ottawa, ON K2M 1P6
613-254-9643

TABLE 1 - SHEA PUMP STATION STAGED FLOW SUMMARY (DESIGN PARAMETERS FOR OCCUPIED AND UNOCCUPIED)

AREA	SCENARIO	TOTAL POPULATION OCCUPIED P	TOTAL POPULATION UNOCCUPIED P	TOTAL POPULATION P	ICI AREA CA (ha)	DRAINAGE AREA BUILT A (ha)	DRAINAGE AREA PROPOSED A (ha)	PRO-RATED POP. FLOW Q(A) (L/s)	PRO-RATED HARMON PEAKING FACTOR HP x k	PEAK POP. FLOW Q(pR) (L/s)	PEAK ICI FLOW Q(pC) (L/s)	EXTRANEOUS FLOW (I/I WET) Q(E) (L/s)	GROUND WATER INFILTRATION (I/I DRY) (L/s)	TOTAL FLOW Q(D) (L/s)	NOTES
Shea Pump Station Sewer Shed	**Stage 1 & 2 Full Buildout Incl. MD, Bell & ICI**	**3583.3**	**820.4**	**4403.7**	**2.6**	**57.73**	**4.60**	**14.27**	**2.64**	**37.63**	**0.73**	**20.05**	**5.72**	**64.13**	**84 L/s SHEA PUMP STATION CURRENT FIRM CAPACITY.**
	Stage 3 Friendly PS Decommissioned	**3821.3**	**820.4**	**4641.7**	**2.6**	**62.39**	**4.60**	**15.04**	**2.62**	**39.41**	**0.73**	**21.36**	**5.95**	**67.45**	
	Stage 4 W4 Partial Buildout (Maguire & Faulkner only)	3821.3	4023.4	7844.7	2.6	62.39	38.99	25.42	2.45	62.21	0.73	30.99	7.67	101.59	**130 L/s SHEA PUMP STATION PROPOSED FIRM CAPACITY**
	Stage 5 W4 Full Buildout (Davidson & Eder added)	3821.3	6580.4	10401.7	2.6	62.39	68.81	33.71	2.35	79.22	0.73	39.34	9.16	128.45	

UNIT	AVG. CAPITA FLOW q (L/person/d)	HARMON CORRECTION FACTOR K	ICI FLOW PARAMETER ICI (L/s/ha)	I/I WET E (L/s/ha)	I/I DRY (L/s/ha)	I/I TOTAL (L/s/ha)
OCCUPIED (Design)	280	0.8	0.28	0.28	0.05	0.33
UNOCCUPIED (Design)	280	0.8	0.28	0.28	0.05	0.33

EQUATIONs:

1) Q(A) = (P x q /86,400)
2) Q(pR) = Q(A) x HP x K
3) Q(C) = (CA x c /86,400)
4) Q(pC) = Q(C) x CP
5) Q(E) = (A x E)
6) Q(D) = Q(pR) + Q(pC) + Q(E)

DEFINITIONS/NOTES:

Q(A) = Average Residential Flow (L/sec)
Q(pR) = Peak Residential Flow (L/sec)
Q(C) = Average ICI Flow (L/sec)
Q(pC) = Peak ICI Flow (L/sec)
Q(E) = Extraneous Flow (L/sec)
Q(D) = Peak Design Flow (L/sec)

A = Residential Area
CA = ICI Area
P = Population
q = Avg. Residential Capita Flow Parameter
HP = Harmon Residential Peaking Factor
CP = ICI Peaking Factor
K = Harmon Correction Factor
E = Extraneous Flow Parameter

POPULATION:

Singles	**3.4**	
Semis/Towns	**2.7**	
Institutional eq	**14**	persons/ha

Novatech
Suite 200 - 240 Michael Cowpland Drive
Ottawa, ON K2M 1P6
613-254-9643

TABLE 2 - SHEA PUMP STATION STAGED FLOW SUMMARY (ANNUAL PARAMETERS FOR OCCUPIED AND DESIGN PARAMETERS FOR UNOCCUPIED)

AREA	SCENARIO	TOTAL POPULATION OCCUPIED P	TOTAL POPULATION UNOCCUPIED P	TOTAL POPULATION P	ICI AREA CA (ha)	DRAINAGE AREA BUILT A (ha)	DRAINAGE AREA PROPOSED A (ha)	PRO-RATED POP. FLOW Q(A) (L/s)	PRO-RATED HARMON PEAKING FACTOR HP x k	PEAK POP. FLOW Q(pR) (L/s)	PEAK ICI FLOW Q(pC) (L/s)	EXTRANEOUS FLOW (I/I WET) Q(E) (L/s)	GROUND WATER INFILTRATION (I/I DRY) (L/s)	TOTAL FLOW Q(D) (L/s)	NOTES
Shea Pump Station Sewer Shed	**Stage 1 & 2 Full Buildout Incl. MD, Bell & ICI**	**3583.3**	**820.4**	**4403.7**	**2.6**	**57.73**	**4.60**	**10.95**	**2.10**	**23.00**	**0.44**	**20.05**	**3.98**	**47.48**	
	Stage 3 Friendly PS Decommissioned	**3821.3**	**820.4**	**4641.7**	**2.6**	**62.39**	**4.60**	**11.50**	**2.08**	**23.94**	**0.44**	**21.36**	**4.08**	**49.81**	**84 L/s SHEA PUMP STATION CURRENT FIRM CAPACITY.**
	Stage 4 W4 Partial Buildout (Maguire & Faulkner only)	3821.3	4023.4	7844.7	2.6	62.39	38.99	21.88	2.15	47.03	0.44	30.99	5.80	84.25	
	Stage 5 W4 Full Buildout (Davidson & Eder added)	3821.3	6580.4	10401.7	2.6	62.39	68.81	30.17	2.13	64.39	0.44	39.34	7.29	111.46	**130 L/s SHEA PUMP STATION PROPOSED FIRM CAPACITY**

UNIT	AVG. CAPITA FLOW q (L/person/d)	HARMON CORRECTION FACTOR K	ICI FLOW PARAMETER ICI (L/s/ha)	I/I WET E (L/s/ha)	I/I DRY (L/s/ha)	I/I TOTAL (L/s/ha)
OCCUPIED (Annual)	200	0.6	0.17	0.28	0.02	0.30
UNOCCUPIED (Design)	280	0.8	0.28	0.28	0.05	0.33

EQUATIONs:

1) Q(A) = (P x q /86,400)
2) Q(pR) = Q(A) x HP x K
3) Q(C) = (CA x c /86,400)
4) Q(pC) = Q(C) x CP
5) Q(E) = (A x E)
6) Q(D) = Q(pR) + Q(pC) + Q(E)

DEFINITIONS/NOTES:

Q(A) = Average Residential Flow (L/sec)
Q(pR) = Peak Residential Flow (L/sec)
Q(C) = Average ICI Flow (L/sec)
Q(pC) = Peak ICI Flow (L/sec)
Q(E) = Extraneous Flow (L/sec)
Q(D) = Peak Design Flow (L/sec)

A = Residential Area
CA = ICI Area
P = Population
q = Avg. Residential Capita Flow Parameter
HP = Harmon Residential Peaking Factor
CP = ICI Peaking Factor
K = Harmon Correction Factor
E = Extraneous Flow Parameter

POPULATION:

Singles	**3.4**	
Semis/Towns	**2.7**	
Institutional eq	**14**	persons/ha

Novatech
Suite 200 - 240 Michael Cowpland Drive
Ottawa, ON K2M 1P6
613-254-9643

TABLE 3 - SHEA PUMP STATION STAGED FLOW SUMMARY (ANNUAL PARAMETERS FOR OCCUPIED AND UNOCCUPIED)

AREA	SCENARIO	TOTAL POPULATION OCCUPIED P	TOTAL POPULATION UNOCCUPIED P	TOTAL POPULATION P	ICI AREA CA (ha)	DRAINAGE AREA BUILT A (ha)	DRAINAGE AREA PROPOSED A (ha)	PRO-RATED POP. FLOW Q(A) (L/s)	PRO-RATED HARMON PEAKING FACTOR HP x k	PEAK POP. FLOW Q(pR) (L/s)	PEAK ICI FLOW Q(pC) (L/s)	EXTRANEOUS FLOW (I/I WET) Q(E) (L/s)	GROUND WATER INFILTRATION (I/I DRY) (L/s)	TOTAL FLOW Q(D) (L/s)	NOTES
Shea Pump Station Sewer Shed	**Stage 1 & 2 Full Buildout Incl. MD, Bell & ICI**	**3583.3**	**820.4**	**4403.7**	**2.6**	**57.73**	**4.60**	**10.19**	**1.98**	**20.16**	**0.44**	**20.05**	**3.85**	**44.50**	**84 L/s SHEA PUMP STATION CURRENT FIRM CAPACITY.**
	Stage 3 Friendly PS Decommissioned	**3821.3**	**820.4**	**4641.7**	**2.6**	**62.39**	**4.60**	**10.74**	**1.96**	**21.11**	**0.44**	**21.36**	**3.94**	**46.85**	**71L/s SHEA PUMP STATION REDUCED OPERATIONAL CAPACITY (15% REDUCTION OF FIRM).**
	Stage 4 W4 Partial Buildout (Maguire & Faulkner only)	3821.3	4023.4	7844.7	2.6	62.39	38.99	18.16	1.84	33.32	0.44	30.99	4.63	69.38	
	Stage 5 W4 Full Buildout (Davidson & Eder added)	3821.3	6580.4	10401.7	2.6	62.39	68.81	24.08	1.76	42.44	0.44	39.34	5.22	87.44	**130 L/s SHEA PUMP STATION PROPOSED FIRM CAPACITY**

UNIT	AVG. CAPITA FLOW q (L/person/d)	HARMON CORRECTION FACTOR K	ICI FLOW PARAMETER ICI (L/s/ha)	I/I WET E (L/s/ha)	I/I DRY (L/s/ha)	I/I TOTAL (L/s/ha)
OCCUPIED (Annual)	200	0.6	0.17	0.28	0.02	0.30
UNOCCUPIED (Annual)	200	0.6	0.17	0.28	0.02	0.30

EQUATIONs:
1) Q(A) = (P x q /86,400)
2) Q(pR) = Q(A) x HP x K
3) Q(C) = (CA x c /86,400)
4) Q(pC) = Q(C) x CP
5) Q(E) = (A x E)
6) Q(D) = Q(pR) + Q(pC) + Q(E)

DEFINITIONS/NOTES:
Q(A) = Average Residential Flow (L/sec)
Q(pR) = Peak Residential Flow (L/sec)
Q(C) = Average ICI Flow (L/sec)
Q(pC) = Peak ICI Flow (L/sec)
Q(E) = Extraneous Flow (L/sec)
Q(D) = Peak Design Flow (L/sec)

POPULATION:

Singles	**3.4**	
Semis/Towns	**2.7**	
Institutional eq	**14**	persons/ha

A = Residential Area
CA = ICI Area
P = Population
q = Avg. Residential Capita Flow Parameter
HP = Harmon Residential Peaking Factor
CP = ICI Peaking Factor
K = Harmon Correction Factor
E = Extraneous Flow Parameter

Novatech
Suite 200 - 240 Michael Cowpland Drive
Ottawa, ON K2M 1P6
613-254-9643

TABLE 4 - SHEA PUMP STATION STAGED FLOW SUMMARY (RARE PARAMETERS FOR OCCUPIED AND UNOCCUPIED)

AREA	SCENARIO	TOTAL POPULATION OCCUPIED P	TOTAL POPULATION UNOCCUPIED P	TOTAL POPULATION P	ICI AREA CA (ha)	DRAINAGE AREA BUILT A (ha)	DRAINAGE AREA PROPOSED A (ha)	PRO-RATED POP. FLOW Q(A) (L/s)	PRO-RATED HARMON PEAKING FACTOR HP x k	PEAK POP. FLOW Q(pR) (L/s)	PEAK ICI FLOW Q(pC) (L/s)	EXTRANEOUS FLOW (I/I WET) Q(E) (L/s)	GROUND WATER INFILTRATION (I/I DRY) (L/s)	TOTAL FLOW Q(D) (L/s)	NOTES (L/s)
Shea Pump Station Sewer Shed	**Stage 1 & 2 Full Buildout Incl. MD, Bell & ICI**	**3583.3**	**820.4**	**4403.7**	**2.6**	**57.73**	**4.60**	**10.19**	**1.98**	**20.16**	**0.44**	**35.64**	**3.85**	**60.08**	**84 L/s SHEA PUMP STATION CURRENT FIRM CAPACITY.**
	Stage 3 Friendly PS Decommissioned	**3821.3**	**820.4**	**4641.7**	**2.6**	**62.39**	**4.60**	**10.74**	**1.96**	**21.11**	**0.44**	**38.11**	**3.94**	**63.60**	
	Stage 4 W4 Partial Buildout (Maguire & Faulkner only)	3821.3	4023.4	7844.7	2.6	62.39	38.99	18.16	1.84	33.32	0.44	56.33	4.63	94.73	**130 L/s SHEA PUMP STATION PROPOSED FIRM CAPACITY**
	Stage 5 W4 Full Buildout (Davidson & Eder added)	3821.3	6580.4	10401.7	2.6	62.39	68.81	24.08	1.76	42.44	0.44	72.14	5.22	120.24	

UNIT	AVG. CAPITA FLOW q (L/person/d)	HARMON CORRECTION FACTOR K	ICI FLOW PARAMETER ICI (L/s/ha)	I/I WET E (L/s/ha)	I/I DRY (L/s/ha)	I/I TOTAL (L/s/ha)
OCCUPIED (Rare)	200	0.6	0.17	0.53	0.02	0.55
UNOCCUPIED (Rare)	200	0.6	0.17	0.53	0.02	0.55

EQUATIONs:

1) Q(A) = (P x q /86,400)
2) Q(pR) = Q(A) x HP x K
3) Q(C) = (CA x c /86,400)
4) Q(pC) = Q(C) x CP
5) Q(E) = (A x E)
6) Q(D) = Q(pR) + Q(pC) + Q(E)

DEFINITIONS/NOTES:

Q(A) = Average Residential Flow (L/sec)
Q(pR) = Peak Residential Flow (L/sec)
Q(C) = Average ICI Flow (L/sec)
Q(pC) = Peak ICI Flow (L/sec)
Q(E) = Extraneous Flow (L/sec)
Q(D) = Peak Design Flow (L/sec)

A = Residential Area
CA = ICI Area
P = Population
q = Avg. Residential Capita Flow Parameter
HP = Harmon Residential Peaking Factor
CP = ICI Peaking Factor
K = Harmon Correction Factor
E = Extraneous Flow Parameter

POPULATION:

Singles	**3.4**	
Semis/Towns	**2.7**	
Institutional eq	**14**	persons/ha

SANITARY SEWER DESIGN SHEET 1

Novatech Project #: 122163
Project Name: Fernbank Trunk Sanitary Sewer
Date Prepared: 5/26/2020
Date Revised: 5/29/2022
Input By: Ben Sweet
Reviewed By: Sam Bahia
Drawing Reference: 122163-SAN

Legend:
- PROJECT SPECIFIC INFO
- USER DESIGN INPUT
- CUMILATIVE CELL
- CALCULATED DESIGN CELL OUTPUT
- CALCULATED ANNUAL CELL OUTPUT
- CALCULATED RARE CELL OUTPUT
- USER AS-BUILT INPUT

NOVATECH
Engineers, Planners & Landscape Architects

LOCATION				DEMAND																			AS-BUILT CAPACITY							
				RESIDENTIAL FLOW								INDUSTRIAL / COMMERICAL / INSTITUTIONAL FLOW							EXTRANOUS FLOW AREA METHOD				TOTAL DESIGN FLOW			AS-BUILT SEWER PIPE SIZING / DESIGN VERIFICATION							
STREET	AREA	FROM MH	TO MH	POPULATION (in 1000's)	CUMULATIVE POPULATION (in 1000's)	PEAK FACTOR M	AVG POPULATION FLOW Q(q) (L/s)	PEAKED DESIGN POP FLOW Q(p) (L/s)	PEAK ANNUAL/RARE FACTOR M	PEAKED ANNUAL/RARE POP FLOW Q(AR - Res) (L/s)	RESIDENTIAL DRAINAGE AREA (ha.)	CUMULATIVE RES DRAINAGE AREA (ha.)	COMMERICAL / INSTITUTIONAL AREA (ha.)	CUMULATIVE COMMERICAL / INSTITUTIONAL AREA (ha.)	AVG DESIGN COMMERICAL / INSTITUTIONAL FLOW Q (ci) (L/s)	COMMERICAL / INSTITUTIONAL PEAK FACTOR	CUMULATIVE ICI DRAINAGE AREA (ha.)	PEAKED DESIGN ICI FLOW Q (CI) (L/s)	PEAKED ANNUAL/RARE POP FLOW Q(AR - ICI) (L/s)	CUMULATIVE EXTRANOUS DRAINAGE AREA (ha.)	DESIGN EXTRAN. FLOW Q(e) (L/s)	ANNUAL EXTRAN. FLOW Q(e) (L/s)	RARE EXTRAN. FLOW Q(e) (L/s)	TOTAL DESIGN FLOW Q(D) (L/s)	TOTAL ANNUAL FLOW Q(A) (L/s)	TOTAL RARE FLOW Q(R) (L/s)	AS-BUILT LENGTH (m)	AS-BUILT PIPE SIZE (mm) AND MATERIAL	PIPE ID ACTUAL (m)	ROUGH. (n)	AS-BUILT GRADE (%)	CAPACITY (L/s)	FULL FLOW VELOCITY (m/s)	Qpeak Design / Qcap
Future (By Others)																														
Fernbank Rd	A1 & A2, E1	24	23	4.339	4.339	2.84	14.06	39.95	2.38	23.91	143.270	143.270	5.000	5.000	1.62	1.00	5.000	1.62	0.98	148.270	48.93	44.48	81.55	130.50	97.38	143.446	31.3	450 PVC	0.457	0.013	0.25	148.7	0.91	87.8%
Fernbank Rd		23	22	0.000	4.339	2.84	14.06	39.95	2.38	23.91	0.000	143.270		5.000	1.62	1.00	5.000	1.62	0.98	148.270	48.93	44.48	81.55	130.50	97.38	143.446	97.1	450 PVC	0.457	0.013	0.25	148.7	0.91	87.8%
Fernbank Rd		22	21	0.000	4.339	2.84	14.06	39.95	2.38	23.91	0.000	143.270		5.000	1.62	1.00	5.000	1.62	0.98	148.270	48.93	44.48	81.55	130.50	97.38	143.446	97.1	450 PVC	0.457	0.013	0.25	148.7	0.91	87.8%
Fernbank Rd		21	20	0.000	4.339	2.84	14.06	39.95	2.38	23.91	0.000	143.270		5.000	1.62	1.00	5.000	1.62	0.98	148.270	48.93	44.48	81.55	130.50	97.38	143.446	93.5	450 PVC	0.457	0.013	0.25	148.7	0.91	87.8%
Novatech																														
Fernbank Rd	A3 & A4, D1-8	20	19	0.000	4.339	2.84	14.06	39.95	2.38	23.91	0.000	143.270		5.000	1.62	1.00	5.000	1.62	0.98	148.270	48.93	44.48	81.55	260.50	185.38	265.446	139.62	600 CONC	0.610	0.013	0.26	326.6	1.12	79.8%
Stantec																														
Future Cope Dr	B1	19	18	0.000	4.339	2.84	14.06	39.95	2.38	23.91	0.000	143.270		5.000	1.62	1.00	5.000	1.62	0.98	148.270	48.93	44.48	81.55	260.50	185.38	265.446	103.25	600 CONC	0.610	0.013	0.25	320.3	1.10	81.3%
Future Cope Dr		18	17	0.248	4.587	2.82	14.87	41.97	2.37	25.14	3.280	146.550		5.000	1.62	1.00	5.000	1.62	0.98	151.550	50.01	45.47	83.35	263.61	187.59	268.477	79.60	600 CONC	0.610	0.013	0.26	326.6	1.12	80.7%
Future Cope Dr	B2	17	16	0.853	5.440	2.77	17.63	48.81	2.33	29.30	11.320	157.870		5.000	1.62	1.00	5.000	1.62	0.98	162.870	53.75	48.86	89.58	274.18	195.14	278.859	115.78	600 CONC	0.610	0.013	0.25	320.3	1.10	85.6%
Future Cope Dr		16	15	0.000	5.440	2.77	17.63	48.81	2.33	29.30	0.000	157.870		5.000	1.62	1.00	5.000	1.62	0.98	162.870	53.75	48.86	89.58	274.18	195.14	278.859	118.77	600 CONC	0.610	0.013	0.24	313.8	1.08	87.4%
Future Cope Dr	B3	15	14	1.285	6.725	2.70	21.79	58.82	2.27	35.40	18.800	176.670		5.000	1.62	1.00	5.000	1.62	0.98	181.670	59.95	54.50	99.92	290.39	206.88	295.302	94.32	600 CONC	0.610	0.013	0.23	307.2	1.05	94.5%
Future Cope Dr		14	13	0.000	6.725	2.70	21.79	58.82	2.27	35.40	0.000	176.670		5.000	1.62	1.00	5.000	1.62	0.98	181.670	59.95	54.50	99.92	290.39	206.88	295.302	86.87	600 CONC	0.610	0.013	0.25	320.3	1.10	90.7%
Future Cope Dr		13	12	0.000	6.725	2.70	21.79	58.82	2.27	35.40	0.000	176.670		5.000	1.62	1.00	5.000	1.62	0.98	181.670	59.95	54.50	99.92	290.39	206.88	295.302	103.39	600 CONC	0.610	0.013	0.23	307.2	1.05	94.5%
		12	11	0.000	6.725	2.70	21.79	58.82	2.27	35.40	0.000	176.670		5.000	1.62	1.00	5.000	1.62	0.98	181.670	59.95	54.50	99.92	290.39	206.88	295.302	36.69	600 CONC	0.610	0.013	0.29	345.0	1.18	84.2%
Future Cope Dr	B4	11	10	0.373	7.098	2.68	23.00	61.66	2.26	37.14	6.020	182.690		5.000	1.62	1.00	5.000	1.62	0.98	187.690	61.94	56.31	103.23	295.22	210.43	300.354	44.62	600 CONC	0.610	0.013	0.22	300.4	1.03	98.3%
Future Cope Dr		10	9	0.000	7.098	2.68	23.00	61.66	2.26	37.14	0.000	182.690		5.000	1.62	1.00	5.000	1.62	0.98	187.690	61.94	56.31	103.23	295.22	210.43	300.354	33.62	600 CONC	0.610	0.013	0.24	313.8	1.08	94.1%
Future Cope Dr		9	8	0.000	7.098	2.68	23.00	61.66	2.26	37.14	0.000	182.690		5.000	1.62	1.00	5.000	1.62	0.98	187.690	61.94	56.31	103.23	295.22	210.43	300.354	41.40	600 CONC	0.610	0.013	0.24	313.8	1.08	94.1%
Future Cope Dr		8	7	0.000	7.098	2.68	23.00	61.66	2.26	37.14	0.000	182.690		5.000	1.62	1.00	5.000	1.62	0.98	187.690	61.94	56.31	103.23	295.22	210.43	300.354	78.56	600 CONC	0.610	0.013	0.25	320.3	1.10	92.2%
Future Cope Dr	B5, B6	7	6	0.265	7.363	2.67	23.86	63.67	2.25	38.37	3.720	186.410	2.950	7.950	2.58	1.00	7.950	2.58	1.56	194.360	64.14	58.31	106.90	300.38	214.24	305.832	139.72	600 CONC	0.610	0.013	0.25	320.3	1.10	93.8%
Novatech																														
Future Cope Dr		6	5	0.000	7.363	2.67	23.86	63.67	2.25	38.37	0.000	186.410		7.950	2.58	1.00	7.950	2.58	1.56	194.360	64.14	58.31	106.90	300.38	214.24	305.832	102.50	600 CONC	0.610	0.013	0.22	300.4	1.03	100.0%
Future Cope Dr	B7	5	4	0.381	7.744	2.65	25.10	66.54	2.24	40.13	6.950	193.360	0.900	8.850	2.87	1.00	8.850	2.87	1.74	202.210	66.73	60.66	111.22	306.13	218.53	312.083	115.13	600 CONC	0.610	0.013	0.27	332.8	1.14	92.0%
Future Cope Dr		4	3	0.000	7.744	2.65	25.10	66.54	2.24	40.13	0.000	193.360		8.850	2.87	1.00	8.850	2.87	1.74	202.210	66.73	60.66	111.22	306.13	218.53	312.083	118.86	600 CONC	0.610	0.013	0.23	307.2	1.05	99.7%
Future Cope Dr	B10, C2	3	2	1.204	8.948	2.60	29.00	75.45	2.20	45.60	26.340	219.700		8.850	2.87	1.00	8.850	2.87	1.74	228.550	75.42	68.57	125.70	323.74	231.90	332.042	40.06	600 CONC	0.610	0.013	0.37	389.6	1.33	83.1%
Future Cope Dr		2	1	0.000	8.948	2.60	29.00	75.45	2.20	45.60	0.000	219.700		8.850	2.87	1.00	8.850	2.87	1.74	228.550	75.42	68.57	125.70	323.74	231.90	332.042	122.40	600 CONC	0.610	0.013	0.22	300.4	1.03	107.8%
Future Cope Dr		1	EX 110A	0.000	8.948	2.60	29.00	75.45	2.20	45.60	0.000	219.700		8.850	2.87	1.00	8.850	2.87	1.74	228.550	75.42	68.57	125.70	323.74	231.90	332.042	81.40	600 CONC	0.610	0.013	0.29	345.0	1.18	93.9%
IBI																														
Goldhawk Dr		*EX 110A*	*EX 109A*	*0.000*	*12.330*	*2.49*	*39.96*	*99.54*	*2.12*	*60.46*	*0.000*	*277.420*	*3.130*	*18.260*	*5.92*	*1.00*	*18.260*	*5.92*	*3.59*	*295.680*	*97.57*	*88.70*	*162.62*	*373.03*	*268.75*	*385.675*	*61.28*	*600 CONC*	*0.610*	*0.013*	*0.35*	*379.0*	*1.30*	*98.4%*
Goldhawk Dr		*EX 109A*	*EX 108A*	*0.003*	*12.333*	*2.49*	*39.97*	*99.56*	*2.12*	*60.47*	*0.180*	*277.600*		*18.260*	*5.92*	*1.00*	*18.260*	*5.92*	*3.59*	*295.860*	*97.63*	*88.76*	*162.72*	*373.11*	*268.82*	*385.788*	*57.50*	*600 CONC*	*0.610*	*0.013*	*0.35*	*379.0*	*1.30*	*98.5%*
Goldhawk Dr		*EX 108A*	*EX 107A*	*0.017*	*12.349*	*2.49*	*40.02*	*99.67*	*2.12*	*60.54*	*0.320*	*277.920*		*18.260*	*5.92*	*1.00*	*18.260*	*5.92*	*3.59*	*296.180*	*97.74*	*88.85*	*162.90*	*373.33*	*268.99*	*386.035*	*53.32*	*600 CONC*	*0.610*	*0.013*	*0.35*	*379.0*	*1.30*	*98.5%*
Goldhawk Dr		*EX 107A*	*EX 106A*	*0.013*	*12.363*	*2.49*	*40.06*	*99.77*	*2.12*	*60.60*	*0.300*	*278.220*		*18.260*	*5.92*	*1.00*	*18.260*	*5.92*	*3.59*	*296.480*	*97.84*	*88.94*	*163.06*	*373.52*	*269.14*	*386.257*	*62.94*	*600 CONC*	*0.610*	*0.013*	*0.35*	*379.0*	*1.30*	*98.6%*
Goldhawk Dr		*EX 106A*	*EX 105A*	*0.023*	*12.386*	*2.49*	*40.14*	*99.93*	*2.12*	*60.70*	*0.310*	*278.530*		*18.260*	*5.92*	*1.00*	*18.260*	*5.92*	*3.59*	*296.790*	*97.94*	*89.04*	*163.23*	*373.78*	*269.33*	*386.526*	*60.09*	*600 CONC*	*0.610*	*0.013*	*0.35*	*379.0*	*1.30*	*98.6%*
Goldhawk Dr		*EX 105A*	*EX 104A*	*0.007*	*13.108*	*2.47*	*42.48*	*104.91*	*2.10*	*63.79*	*0.240*	*291.300*		*18.260*	*5.92*	*1.00*	*18.260*	*5.92*	*3.59*	*309.560*	*102.15*	*92.87*	*170.26*	*382.99*	*276.25*	*396.641*	*72.85*	*600 CONC*	*0.610*	*0.013*	*0.37*	*389.6*	*1.33*	*98.3%*
Goldhawk Dr		*EX 104A*	*EX 103A*	*0.023*	*13.131*	*2.47*	*42.56*	*105.07*	*2.10*	*63.89*	*0.450*	*291.750*		*18.260*	*5.92*	*1.00*	*18.260*	*5.92*	*3.59*	*310.010*	*102.30*	*93.00*	*170.51*	*383.29*	*276.48*	*396.987*	*48.77*	*600 CONC*	*0.610*	*0.013*	*0.37*	*389.6*	*1.33*	*98.4%*
Goldhawk Dr		*EX 103A*	*EX 102A*	*0.030*	*13.161*	*2.47*	*42.65*	*105.28*	*2.10*	*64.02*	*0.470*	*292.220*		*18.260*	*5.92*	*1.00*	*18.260*	*5.92*	*3.59*	*310.480*	*102.46*	*93.14*	*170.76*	*383.65*	*276.75*	*397.372*	*45.00*	*600 CONC*	*0.610*	*0.013*	*0.37*	*389.6*	*1.33*	*98.5%*
Goldhawk Dr		*EX 102A*	*EX FT24*	*0.020*	*13.181*	*2.47*	*42.72*	*105.41*	*2.10*	*64.10*	*2.130*	*294.350*		*18.260*	*5.92*	*1.00*	*18.260*	*5.92*	*3.59*	*312.610*	*103.16*	*93.78*	*171.94*	*384.49*	*277.48*	*398.628*	*102.59*	*600 CONC*	*0.610*	*0.013*	*0.37*	*389.6*	*1.33*	*98.7%*

DEMAND EQUATION

Design Parameters:

1. Q(D), Q(A), Q(R) = Q(p) + Q(fd) + Q(ici) + Q(e)
2. Q(p) = (P x q x M x K / 86,400)
3. q Avg capita flow = 280 L/per/day (design)
   (L/per/day)= 200 L/per/day (annual and rare)
4. M = Harmon Formula (maximum of 4.0)
5. K = 0.8 (design)
   0.6 (annual and rare)
6. Park flow is considered equivalent to a single unit / ha
   Park Demand = 1 Single Unit Equivalent / Park ha
7. Foundation Drains 0.45 L/s/unit
8. Q(ici) = ICI Area x ICI Flow x ICI Peak
9. Q(e) = 0.33 L/sec/ha (design)
   0.30 L/sec/ha (annual)
   0.55 L/sec/ha (rare)

Definitions:

Q(D) = Peak Design Flow (L/sec)
Q(e) = Extraneous Flow (L/sec)
Q(p) = Population Flow (L/sec)
K = Harmon Correction Factor
P = Residential Population
Typ Service Diameter (mm)
Typ Service Length (m)
I/I Pipe Rate (L/mm dia/m/hr) =
Q(fd) = Foundation Flow (L/sec)
Q(ici) = Industrial / Commercial / Institutional Flow (L/sec
Q(A) = Peak Annual Flow (L/sec)
Q(R) = Peak Rare Flow (L/sec)

	Singles	Semis/Towns	Apts (2-BR)
	3.4	2.7	2.1
	135		
	15	15	
	0.007		

Institutional / Commercial / Industria

		Industrial	Commercial / Institutional	
Design =		35000	28000	L/gHa/d
Annual / Rare =		10000	17000	L/gHa/d
ICI Peak * Design =	Std ICI -->	1.0	1.5	* ICI Peak = 1.0 Default, 1.5 if ICI in contributing area is >20% (design only
Annual / Rare =		1.0		

ALLOWANCES				
(L/S)	Area E-1	W3 West Stittsville	40	28	37
	Areas D1-D8	Shea PS Current Capacity + Upgrade (Area 6 - 84L/s; W4 West Stittsville- 46L/s	130	88	122

CAPACITY EQUATION

Q full= (1/n) A R^(2/3)So^(1/2)
Where : Q full = Capacity (L/s)
n = Manning coefficient of roughness (0.013)
A = Flow area (m^2)
R = Wetter perimeter (m)
So = Pipe Slope/gradient

NOTE(S)

1. Future (by others) sewer sections included for conceptual design purposes only - design and construction by others
2. Novatech and Stantec sewer sections based on asbuilts.
3. *IBI sewer sections based on design.*
4. Red text depicts fixed allowances for the above areas within the design sheet.
5. Residential flows for the sewers downstream of MH6 updated based on the conceptual sanitary servicing approach outlined within CRT Lands Phase 4, Adequacy of Public Servicing Report (May 2022).
6. Refer to Sanitary Sewer Design Sheet 2, prepared by Novatech, dated May 17, 2023, for analysis of sewers downstream of EX FT24.

SANITARY SEWER DESIGN SHEET 2

AREA			RESIDENTIAL												MIXED USE		COMMERCIAL		INSTITUTIONAL		C+I	INFILTRATION				PIPE							
			LOW DENSITY		MEDIUM DENSITY		HIGH DENSITY		MIXED USE		TOTAL																					
ID	From	To	Area (ha)	Pop.	Area (ha)	Pop.	Area (ha)	Pop.	Area (ha)	Pop.	Pop.	Accum. Pop.	Peak Factor	Peak Flow (l/s)	Area (ha)	Accum. Area (ha)	Area (ha)	Accum. Area (ha)	Area (ha)	Accum. Area (ha)	Peak Flow (l/s)	Total Area (ha)	Accum. Area (ha)	Infilt. Flow (l/s)	Total Flow (l/s)	Size (mm)	Type	Slope (%)	Length (m)	Capacity (l/s)	Full Flow Vel. (m/s)	Q/Q_{full} (%)	Actual Vel. (m/s)
Shea PS Current Capacity + Upgrade (Area 6 - 84 L/s; W 4 West Stittsville - 46 L/s), W3 West Stittsville (40 L/s)																									170.0							
F1											13181	13181	2.5	105.4	0.0	0.00	18.26	18.26		0.00	8.9	312.61	312.61	103.2	217.5							
	FT24	FT23									0	13181	2.5	105.4		0.00		18.26		0.00	8.9		312.61	103.2	387.5	600	C 100-D	0.34	108.9	373.5	1.28	103.7%	1.49
	FT23	FT22									0	13181	2.5	105.4		0.00		18.26		0.00	8.9		312.61	103.2	387.5	600	C 100-D	0.39	106.2	400.0	1.37	96.9%	1.59
	FT22	FT21									0	13181	2.5	105.4		0.00		18.26		0.00	8.9		312.61	103.2	387.5	600	C 100-D	0.36	108.6	384.3	1.32	100.8%	1.53
	FT21	FT20									0	13181	2.5	105.4		0.00		18.26		0.00	8.9		312.61	103.2	387.5	600	C 100-D	0.45	106.3	429.7	1.47	90.2%	1.69
	FT20	FT19									0	13181	2.5	105.4		0.00		18.26		0.00	8.9		312.61	103.2	387.5	600	C 100-D	0.45	103.6	429.7	1.47	90.2%	1.69
	FT19	FT18									0	13181	2.5	105.4		0.00		18.26		0.00	8.9		312.61	103.2	387.5	600	C 100-D	0.91	124.5	611.1	2.09	63.4%	2.22
F2			2.90	268	1.80	270	0.00	0	0.00	0	538	538	3.4	5.9	0.00	0.00	0.00	0.00	0.40	0.40	0.2	13.19	13.19	4.4	10.4							
F3			15.95	1474	14.90	2235	0.00	0	10.57	856	4565	4565	2.8	41.8	10.57	10.57	0.60	0.60	11.57	11.57	8.5	77.57	77.57	25.6	75.9							
	FT18	FT17									0	18284	2.4	139.4		10.57		18.86		11.97	17.6		403.37	133.1	460.1	750	C 100-D	0.20	88.5	519.4	1.14	88.6%	1.30
	FT17	FT16									0	18284	2.4	139.4		10.57		18.86		11.97	17.6		403.37	133.1	460.1	750	C 100-D	0.23	126.4	557.0	1.22	82.6%	1.37
	FT16	FT15									0	18284	2.4	139.4		10.57		18.86		11.97	17.6		403.37	133.1	460.1	750	C 100-D	0.25	110.6	580.7	1.27	79.2%	1.42
	FT15	FT14									0	18284	2.4	139.4		10.57		18.86		11.97	17.6		403.37	133.1	460.1	750	C 100-D	0.18	118.1	492.7	1.08	93.4%	1.24
	FT14	FT13									0	18284	2.4	139.4		10.57		18.86		11.97	17.6		403.37	133.1	460.1	750	C 100-D	0.17	115.3	478.9	1.05	96.1%	1.22
	FT13	FT12									0	18284	2.4	139.4		10.57		18.86		11.97	17.6		403.37	133.1	460.1	750	C 100-D	0.22	129.2	544.8	1.19	84.5%	1.35
	FT12	FT11									0	18284	2.4	139.4		10.57		18.86		11.97	17.6		403.37	133.1	460.1	750	C 100-D	0.18	108.6	492.7	1.08	93.4%	1.24
	FT11	FT10									0	18284	2.4	139.4		10.57		18.86		11.97	17.6		403.37	133.1	460.1	750	C 100-D	0.18	100.8	492.7	1.08	93.4%	1.24
Stittsville Trunk																									379.0							
	FT10	FT09									0	18284	2.4	139.4		10.57		18.86		11.97	17.6		403.37	133.1	839.1	750	C 100-D	0.45	84.1	779.1	1.71	107.7%	1.97
	FT09	FT08									0	18284	2.4	139.4		10.57		18.86		11.97	17.6		403.37	133.1	839.1	750	C 100-D	0.56	40.9	869.1	1.91	96.5%	2.21
F4			60.08	5551	16.71	2506	0.00	0	5.62	455	8512	8512	2.6	72.3	5.62	5.62	0.00	0.00	19.62	19.62	10.9	164.76	164.76	54.4	137.5							
F5			7.70	711	2.90	435	0.00	0	6.70	543	1689	1689	3.1	17.0	6.70	6.70	0.00	0.00	0.79	0.79	2.0	22.81	22.81	7.5	26.6							
F6			29.70	2744	9.95	1493	5.04	680	0.00	0	4917	4917	2.8	44.6	0.00	0.00	0.00	0.00	16.15	16.15	7.9	89.34	89.34	29.5	82.0							
	FT08	FT07									0	33403	2.1	232.2		22.89		18.86		48.53	38.3		680.28	224.5	1044.0	1200	C 100-D	0.22	77.5	1907.7	1.63	54.7%	1.67
	FT07	FT06									0	33403	2.1	232.2		22.89		18.86		48.53	38.3		680.28	224.5	1044.0	1200	C 100-D	0.13	83.5	1466.5	1.26	71.2%	1.37
	FT06	FT05									0	33403	2.1	232.2		22.89		18.86		48.53	38.3		680.28	224.5	1044.0	1200	C 100-D	0.20	24.6	1819.0	1.56	57.4%	1.60
	FT05	FT04									0	33403	2.1	232.2		22.89		18.86		48.53	38.3		680.28	224.5	1044.0	1200	C 100-D	0.16	89.0	1626.9	1.39	64.2%	1.49
	FT04	FT03									0	33403	2.1	232.2		22.89		18.86		48.53	38.3		680.28	224.5	1044.0	1200	C 100-D	0.19	95.0	1772.9	1.52	58.9%	1.58
	FT03	FT02									0	33403	2.1	232.2		22.89		18.86		48.53	38.3		680.28	224.5	1044.0	1200	C 100-D	0.25	107.5	2033.7	1.74	51.3%	1.74
	FT02	FT01									0	33403	2.1	232.2		22.89		18.86		48.53	38.3		680.28	224.5	1044.0	1200	C 100-D	0.17	107.5	1677.0	1.44	62.3%	1.52
	FT01	OTT1									0	33403	2.1	232.2		22.89		18.86		48.53	38.3		680.28	224.5	1044.0	1200	C 100-D	0.22	61.4	1907.7	1.63	54.7%	1.67
	OTT1	GC									0	33403	2.1	232.2		22.89		18.86		48.53	38.3		680.28	224.5	1044.0	1200	C 100-D	0.20	19.1	1819.0	1.56	57.4%	1.60

Design Parameters:

Avg Flow/Person =	280	l/day	Pipe Friction n = 0.013			
Comm./Inst. Flow =	28,000	l/ha/day	Residential Peaking Factor = Harmon Equation (max 4, min 2)			
Infiltration =	0.33	l/s/ha	Peaking Factor Comm./Inst. = 1.5			

Units/Net ha	Pop/Unit	
Low Density Residential = 28	3.30	
Medium Density Residential = 60	2.50	(Multi Family Residential)
High Density Residential = 75	1.80	
Mixed Use = 90	1.80	(50% of mixed use area is residential)

Project: Fernbank Trunk Sanitary Sewer
Designed: KJM
Checked: MAB
Revised: BCS/BHB
Dwg. Reference: 108180-FT5
Date: February 3, 2015
Revised: May 29, 2023

Note(s):

Sewer sections based on asbuilts.

Red text depicts fixed allowances for the above areas within the design sheet.

Refer to Sanitary Sewer Design Sheet 1, prepared by Novatech, dated May 17, 2023, for analysis of sewers upstream of FT24.

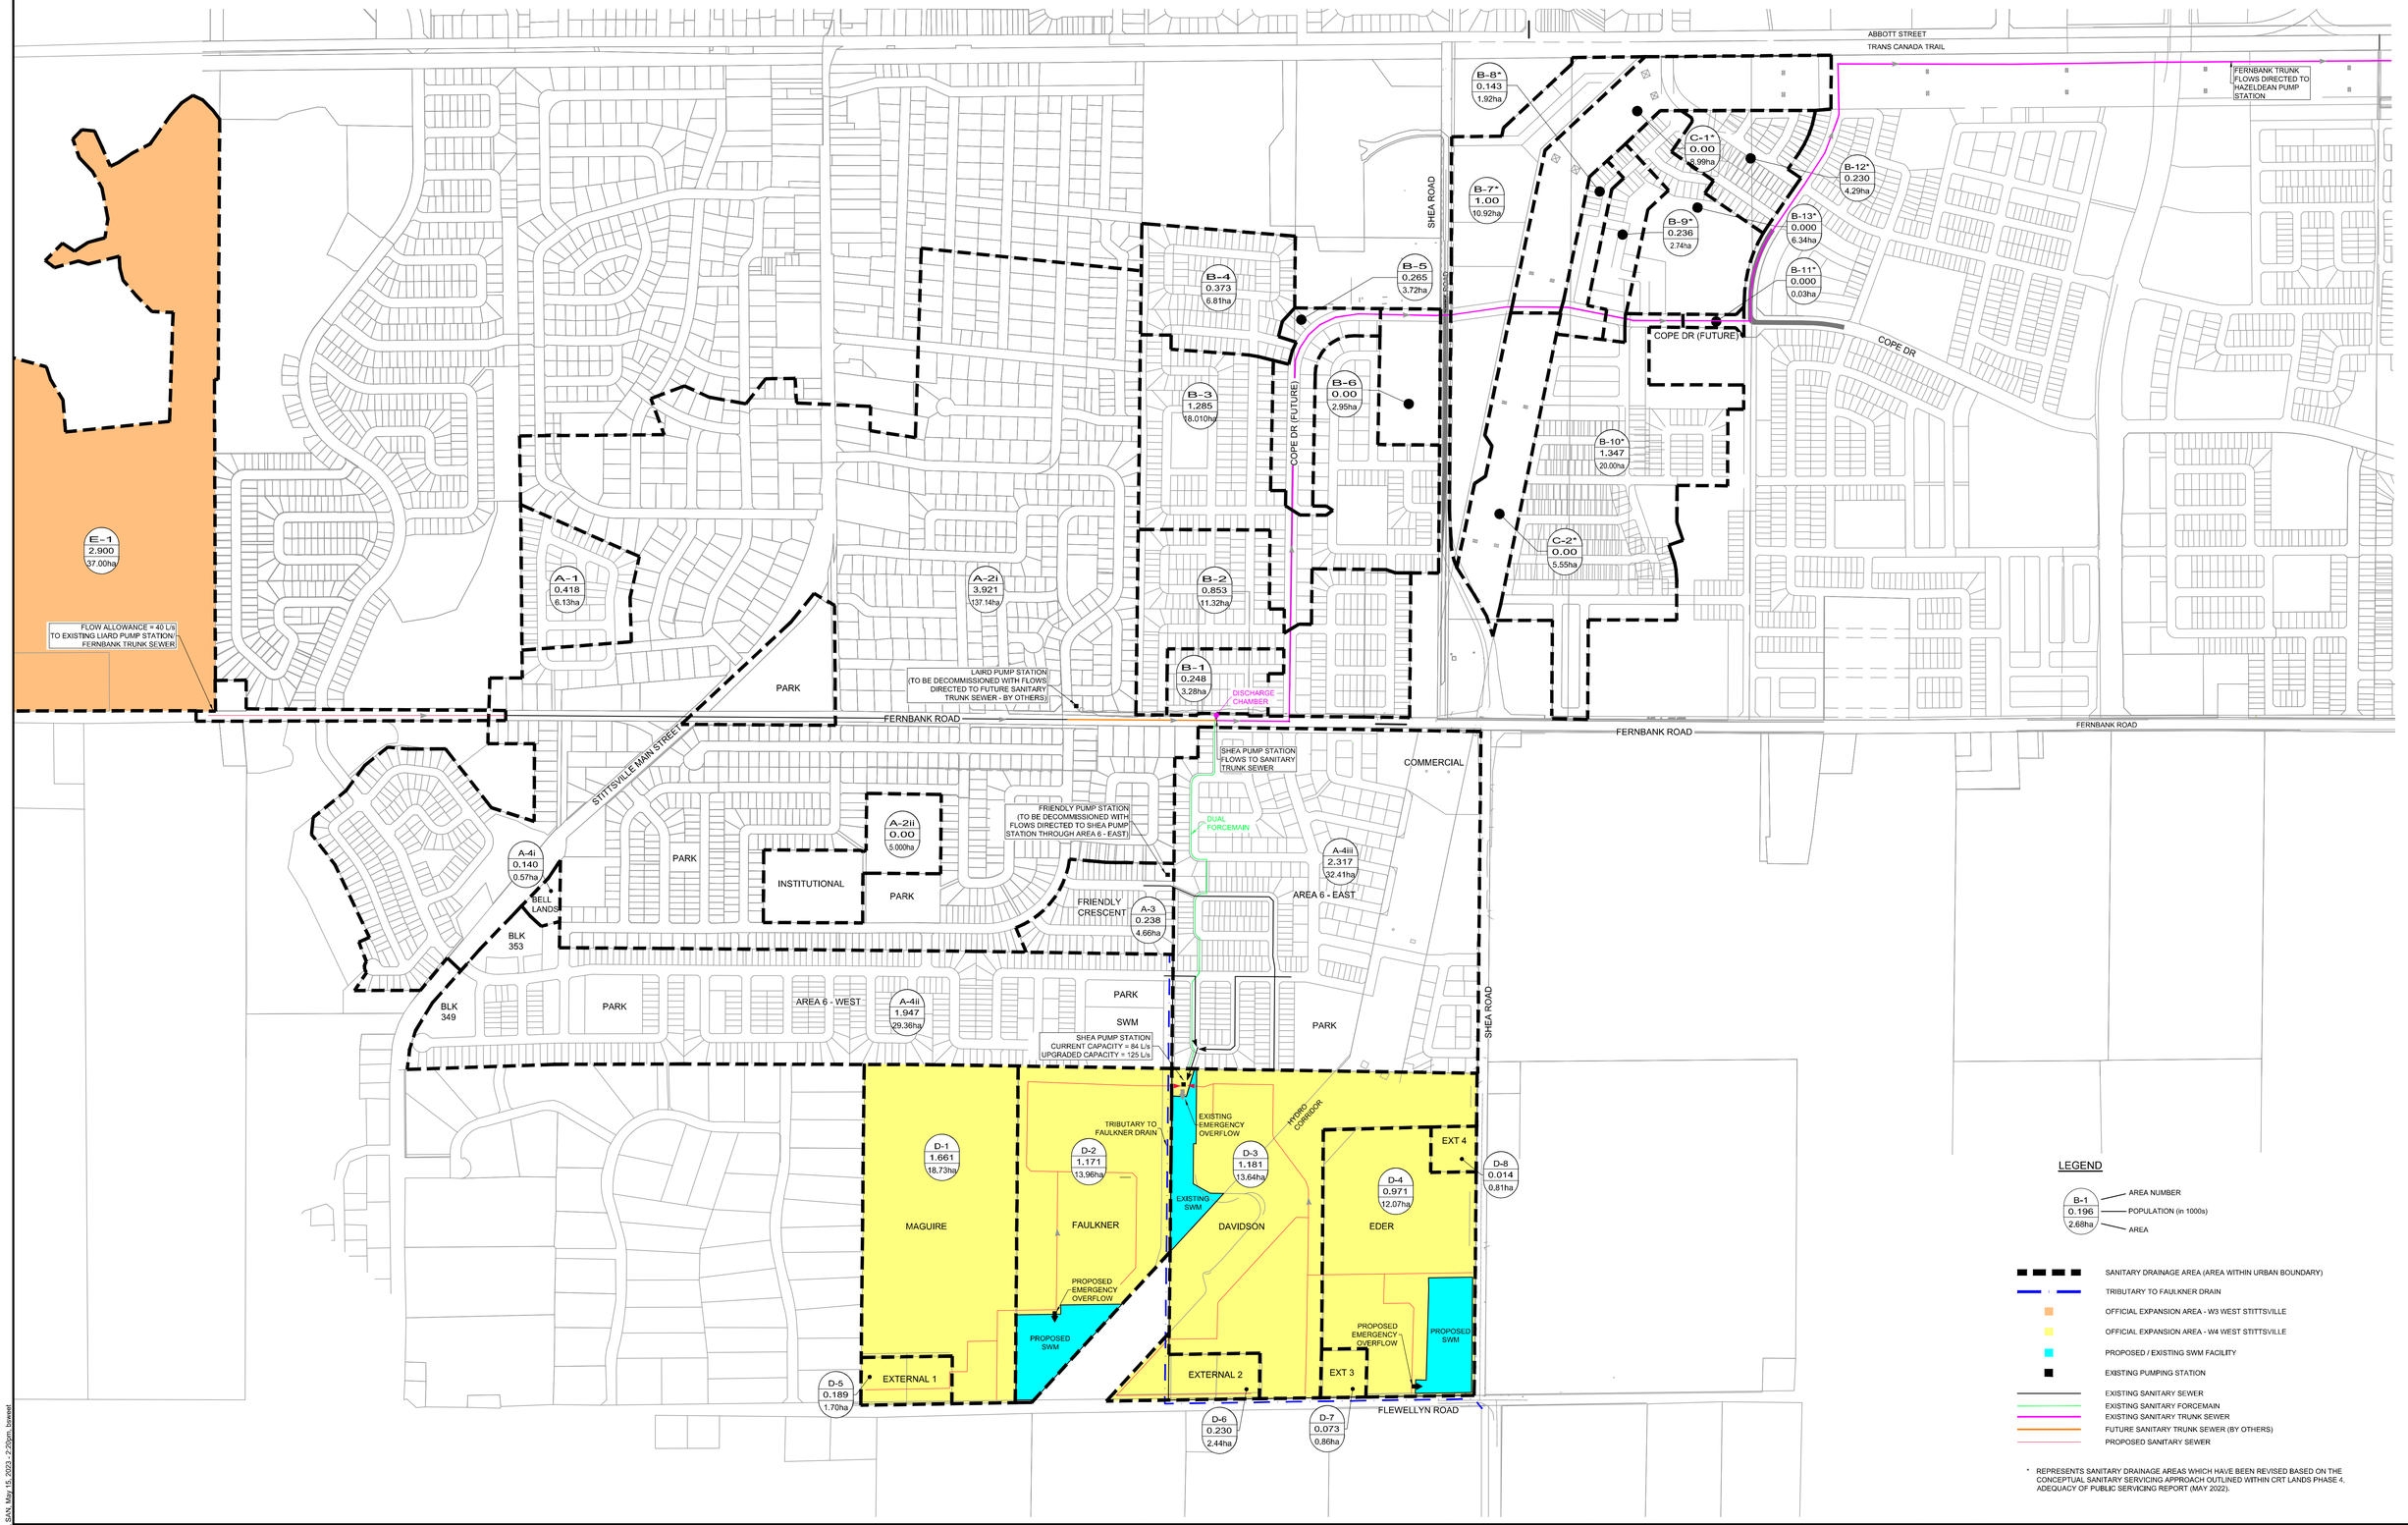

LEGEND

B-1 | 0.196 | 2.68ha — AREA NUMBER / POPULATION (in 1000s) / AREA

- SANITARY DRAINAGE AREA (AREA WITHIN URBAN BOUNDARY)
- TRIBUTARY TO FAULKNER DRAIN
- OFFICIAL EXPANSION AREA - W3 WEST STITTSVILLE
- OFFICIAL EXPANSION AREA - W4 WEST STITTSVILLE
- PROPOSED / EXISTING SWM FACILITY
- EXISTING PUMPING STATION
- EXISTING SANITARY SEWER
- EXISTING SANITARY FORCEMAIN
- EXISTING SANITARY TRUNK SEWER
- FUTURE SANITARY TRUNK SEWER (BY OTHERS)
- PROPOSED SANITARY SEWER

* REPRESENTS SANITARY DRAINAGE AREAS WHICH HAVE BEEN REVISED BASED ON THE CONCEPTUAL SANITARY SERVICING APPROACH OUTLINED WITHIN CRT LANDS PHASE 4, ADEQUACY OF PUBLIC SERVICING REPORT (MAY 2022).

NOTE:
THE POSITION OF ALL POLE LINES, CONDUITS, WATERMAINS, SEWERS AND OTHER UNDERGROUND AND OVERGROUND UTILITIES AND STRUCTURES IS NOT NECESSARILY SHOWN ON THE CONTRACT DRAWINGS, AND WHERE SHOWN, THE ACCURACY OF THE POSITION OF SUCH UTILITIES AND STRUCTURES IS NOT GUARANTEED. BEFORE STARTING WORK, DETERMINE THE EXACT LOCATION OF ALL SUCH UTILITIES AND STRUCTURES AND ASSUME ALL LIABILITY FOR DAMAGE TO THEM.

No.	REVISION	DATE	BY
1.	ISSUED IN SUPPORT OF MEMORANDUM	MAY 11/23	BCS

SCALE 1:5000

1:5000
0 50 100 150 200

DESIGN DJC
CHECKED BCS
DRAWN DJC
CHECKED BCS
APPROVED BHB

FOR REVIEW ONLY

NOVATECH
Engineers, Planners & Landscape Architects
Suite 200, 240 Michael Cowpland Drive
Ottawa, Ontario, Canada K2M 1P6
Telephone (613) 254-9643
Facsimile (613) 254-5867
Website www.novatech-eng.com

LOCATION
CITY OF OTTAWA
SHEA PUMP STATION UPGRADES FOR UEA

DRAWING NAME
SANITARY DRAINAGE AREA PLAN

PROJECT No. 122163
REV REV # 1
DRAWING No. 122163-SAN

M:\2022\122163\CAD\Civil\122163-SAN.dwg, SAN, May 16, 2023 - 2:29pm, tbrewer

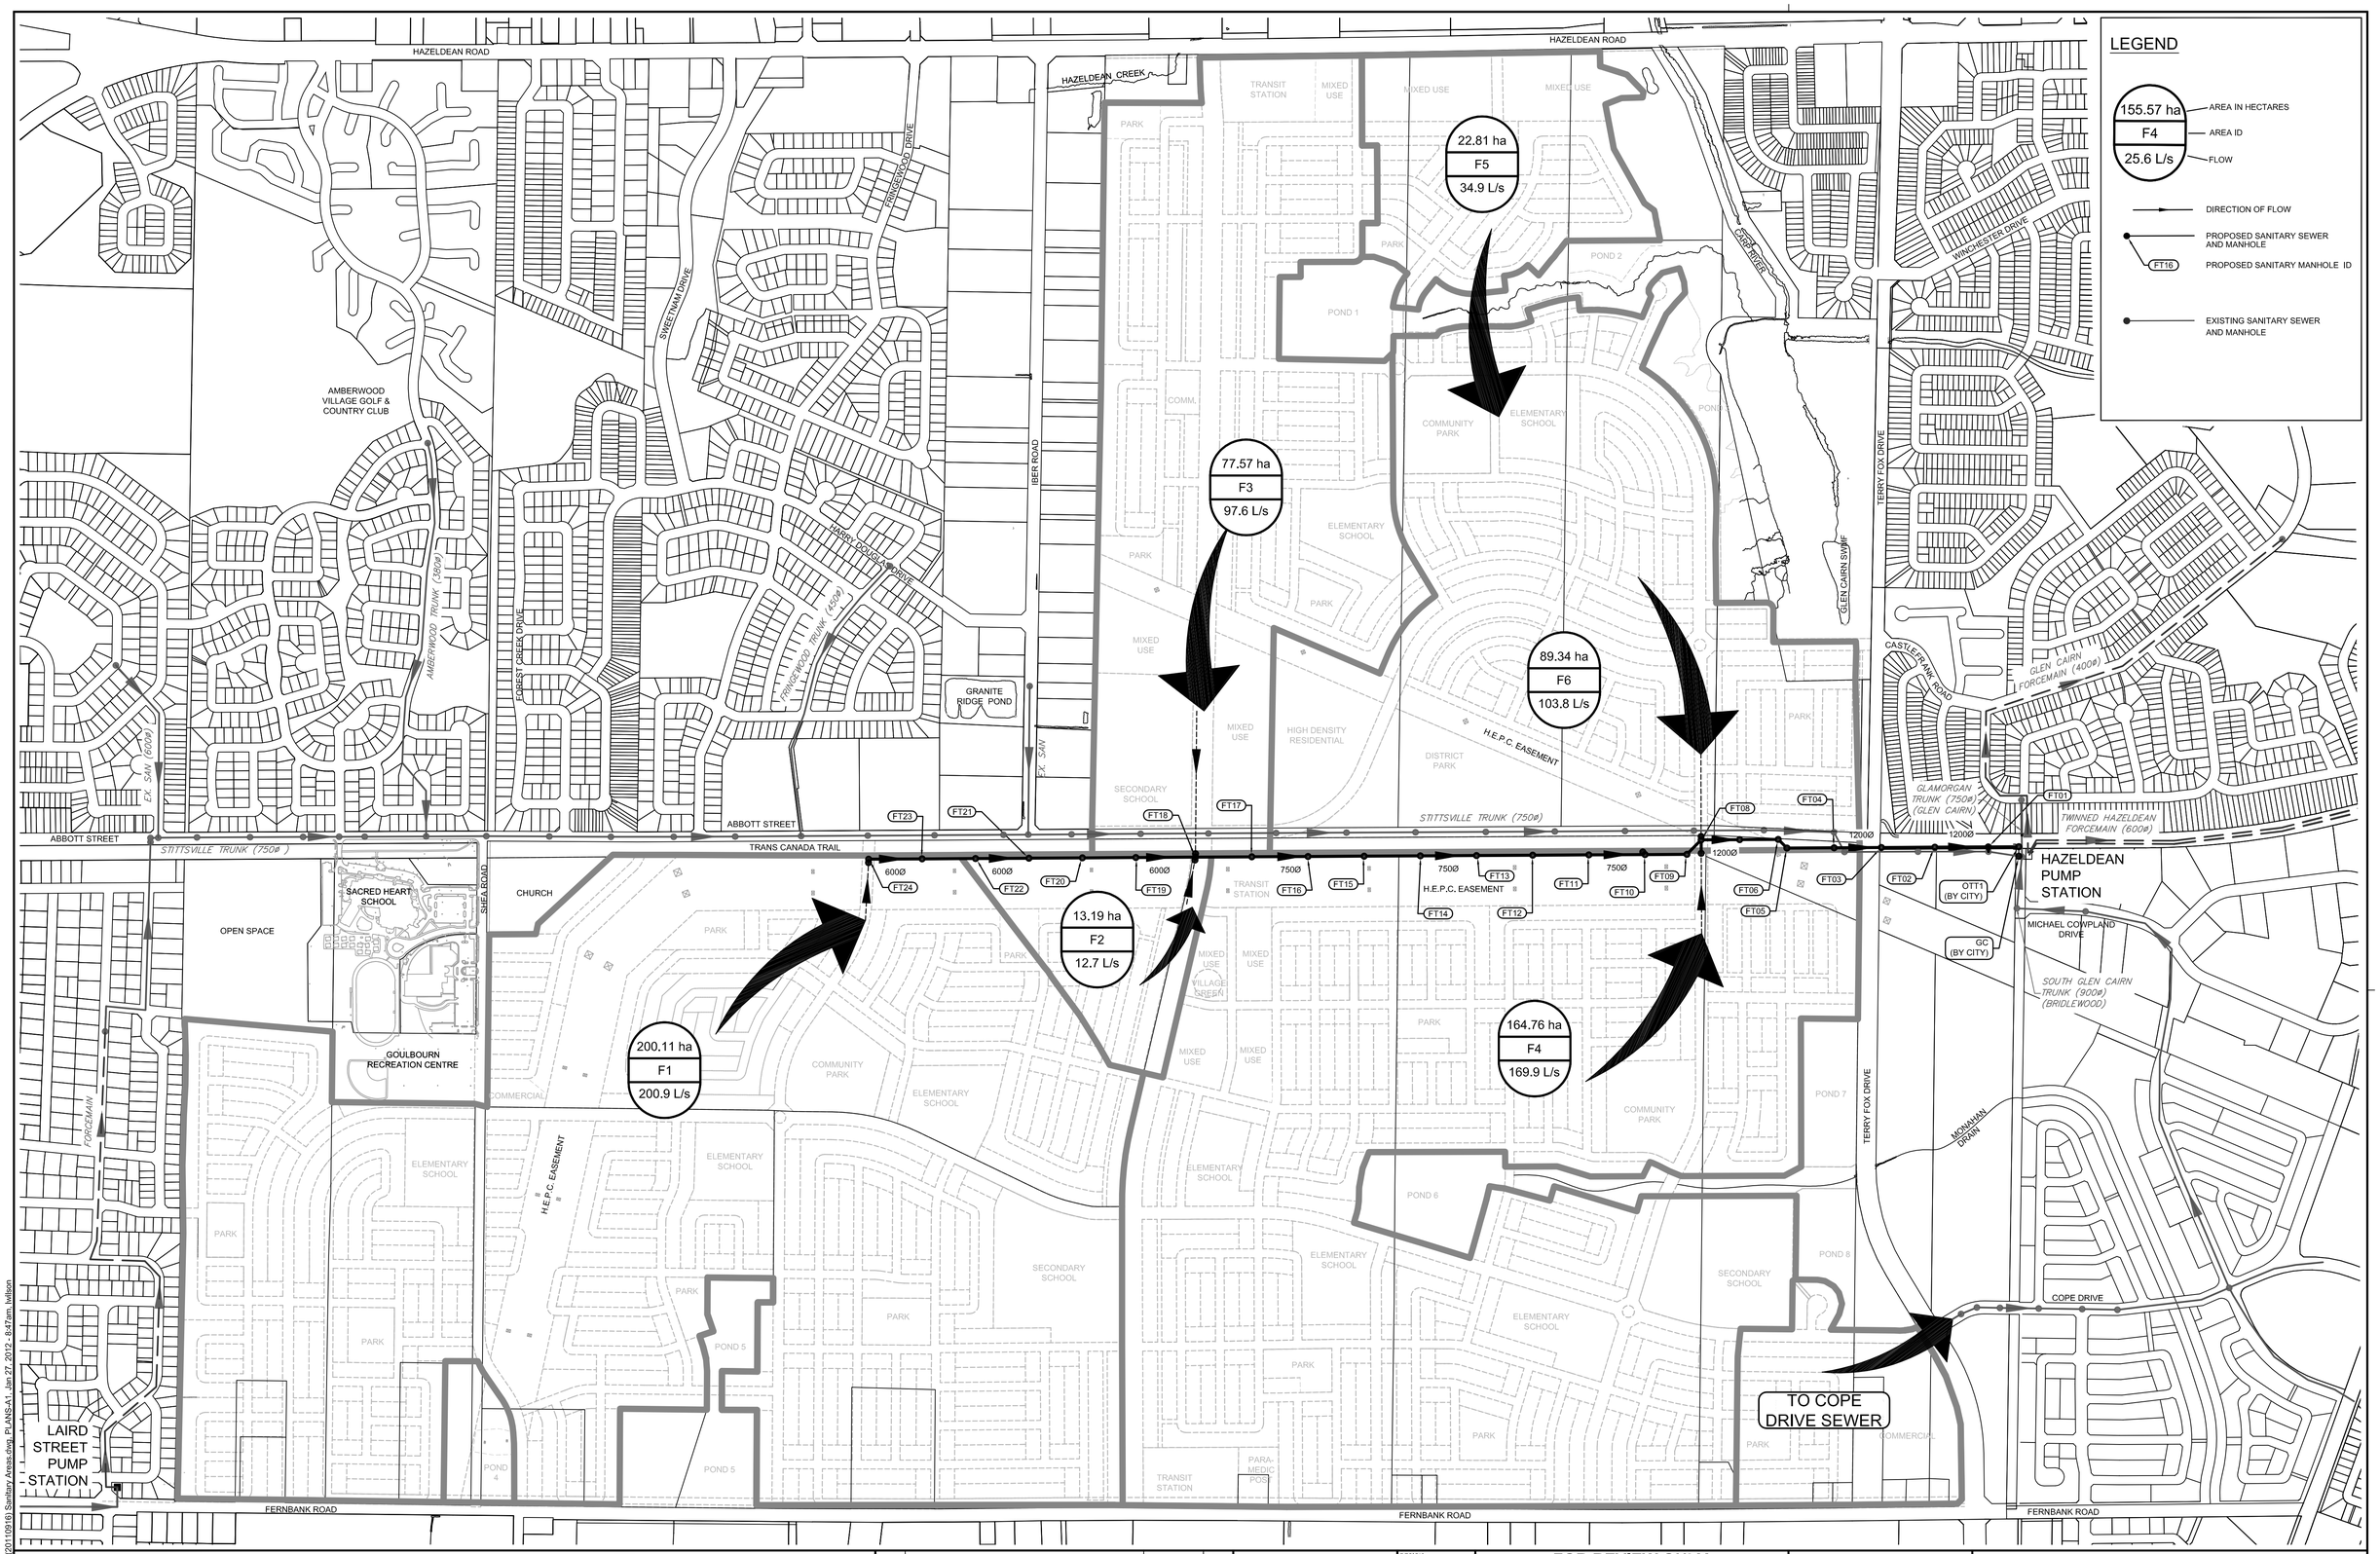

NOTE:
THE POSITION OF ALL POLE LINES, CONDUITS, WATERMAINS, SEWERS AND OTHER UNDERGROUND AND OVERGROUND UTILITIES AND STRUCTURES IS NOT NECESSARILY SHOWN ON THE CONTRACT DRAWINGS, AND WHERE SHOWN, THE ACCURACY OF THE POSITION OF SUCH UTILITIES AND STRUCTURES IS NOT GUARANTEED. BEFORE STARTING WORK, DETERMINE THE EXACT LOCATION OF ALL SUCH UTILITIES AND STRUCTURES AND ASSUME ALL LIABILITY FOR DAMAGE TO THEM.

No.	REVISION	DATE	BY
5.	ISSUED FOR TENDER	JAN 26/12	MAB
4.	ISSUED FOR MOE APPROVAL	JAN 27/11	MAB
3.	MINOR DESIGN REVISION	NOV 14/11	MAB
2.	REVISED PER CITY AND LANDOWNER COMMENTS	OCT 20/11	MAB
1.	ISSUED WITH SANITARY TRUNK SEWER REPORT	SEPT 16/11	MAB

SCALE 1:6000
0 60 120 180 240

DESIGN KJM
CHECKED MAB
DRAWN KJM
CHECKED MAB
APPROVED JGR

FOR REVIEW ONLY

LICENSED PROFESSIONAL ENGINEER — K. J. MURPHY — 100123021 — JAN. 26/12 — PROVINCE OF ONTARIO

LICENSED PROFESSIONAL ENGINEER — M.A. BISSETT — Jan. 26/12 — PROVINCE OF ONTARIO

NOVATECH ENGINEERING CONSULTANTS LTD.
ENGINEERS & PLANNERS
Suite 200, 240 Michael Cowpland Drive
Ottawa, Ontario, Canada
K2M 1P6
Telephone (613) 254-9643
Facsimile (613) 254-5867
Email: novainfo@novatech-eng.com

LOCATION
CITY of OTTAWA
FERNBANK COMMUNITY

DRAWING NAME
SANITARY TRUNK SEWER
DRAINAGE AREA PLAN

PROJECT No. 108180-08
REV REV # 5
DRAWING No. 108180-FT5

M:\2008\108180\CAD\design\Sanitary_Trunk\(20110916) Sanitary Areas.dwg, PLANS:A1 - Jan 27, 2012 - 8:47am, Nelson

PLANA1.DWG - 841mmx594mm

Note:
1) This figure forms part of the Infrastructure Master Plan of the City of Ottawa and should be read in conjunction with the text.
2) This figure is intended as a schematic representation of existing and/or proposed works; consequently alignments and locations of facilities are approximate.

Note:
1) Cette figure fait partie intégrante du Plan directeur de l'infrastructure de la Ville d'Ottawa et devrait être lue conjointement avec le texte.
2) Cette figure se veut être une représentation schématique des travaux actuels et proposés; en conséquence, les tracés et les emplacements des installations sont approximatifs.

1

City of / Ville de GATINEAU

W-1 W-2 W-3 W-4

S-1 S-2 S-3 S-4 S-5

E-1 E-2 E-3 E-4 E-5

Tewin

MARCH · TERRY FOX · CARP · CARLING · HIGHWAY 417 · MOODIE · HAZELDEAN · EAGLESON · SITTSVILLE MAIN · ROBERTSON · BASELINE · OLD RICHMOND · HOPE SIDE · FALLOWFIELD · HUNTLEY · FRANKTOWN · TRAIL · HIGHWAY 416 · GREENBANK · WOODROFFE · MERIVALE · FISHER · BROADVIEW · BANK · MAIN · SCOTT · SOMERSET · CATHERINE · ELGIN · RIDEAU · SUSSEX · ROCKCLIFFE · BEECHWOOD · VANIER · MCARTHUR · ST LAURENT · AVIATION · MONTREAL · BLAIR · OGILVIE · INDUSTRIAL · SMYTH · INNES · HERON · MEADOWLANDS · WALKLEY · RIVERSIDE · HUNT CLUB · PRINCE OF WALES · UPLANDS · AIRPORT · CONROY · HAWTHORNE · RUSSELL · RAMSAYVILLE · ANDERSON · HIGHWAY 417 · LESTER · ALBION · LEITRIM · RIVER · REGIONAL ROAD 174 · ST JOSEPH · JEANNE D'ARC · ORLEANS · TRIM · OLD MONTREAL · Centrum · TENTH LINE · NIVAN · COLONIAL · MILTON · BOUNDARY · RUSSELL

N

URBAN EXPANSION AREAS / ZONES D'EXPANSION URBAINE

- Future Neighbourhood / Futur quartier
- Industrial and Logistics / Industrie et Logistique
- Urban Boundary / Périmètre d'urbanisation
- Expansion Areas added and then rescinded by MMHA / Zones d'expansion ajoutées puis annulées par MMHA

TRANSECT POLICY AREAS / SECTEURS STRATÉGIQUES DU TRANSECT

- Downtown Core / Centre-ville
- Inner Urban / Urbain intérieur
- Outer Urban / Urbain extérieur
- Greenbelt / Ceinture de verdure
- Suburban / Suburbain
- Rural / Rural

Ottawa

INFRASTRUCTURE MASTER PLAN - Schedule 1

Urban Expansion Areas as defined in the Official Plan

PLAN DIRECTEUR DE L'INFRASTRUCTURE - Annexe 1

Zones d'expansion urbaine comme défini dans le Plan officiel

0 1.25 2.5 5 7.5 10 km

Planning, Development and Building Services, Geospatial Analytics, Technology and Solutions
Direction générale des sevices de planification, de l'aménagement se du bâtiment, Analyse géospatiale, technologie et solutions

8

Note:
1) This figure forms part of the Infrastructure Master Plan of the City of Ottawa and should be read in conjunction with the text.
2) This figure is intended as a schematic representation of existing and/or proposed works; consequently alignments and locations of facilities are approximate.

Note:
1) Cette figure fait partie intégrante du Plan directeur de l'infrastructure de la Ville d'Ottawa et devrait être lue conjointement avec le texte.
2) Cette figure se veut être une représentation schématique des travaux actuels et proposés; en conséquence, les tracés et les emplacements des installations sont approximatives.

City of / Ville de GATINEAU

Rivière des Outaouais / Ottawa River

Station de pompage Carp Pump Station
Station de pompage Briar Ridge Pump Station
Station de pompage March Pump Station
Station de pompage Signature Ridge Pump Station
Station de pompage Kanata West Pump Station
Station de pompage Hazeldean Pump Station
Station de pompage Stittsville Pump Station
Station de pompage Shea Road Pump Station
Station de pompage Munster Pump Station
Station de pompage de Richmond Pump Station
Station de pompage de dérivation Crystal Beach Diversion Pump Station
Station de pompage Acres Pump Station
Station de pompage de Woodroffe Diversion Pump Station
Station de pompage Tartan Pump Station
Station de pompage Manotick Pump Station
Station de pompage Mahogany Pump Station
Station de pompage Hemlock Pump Station
RCMP Pump Station / Station de pompage de la GRC
RCAF Pump Station / Station de pompage de l'ARC
Centre environnemental R.O. Pickard Environmental Centre (ROPEC) / Centre environnemental Robert-O.-Pickard (CEROP)
Réservoir de stockage Sandy Hill Storage Tank
Chambre d'égout de Walkley Chamber
Station de pompage de Leitrim Pump Station
Station de pompage Forest Valley Pump Station
Station de pompage Tenth Line Pump Station

CARP, MARCH, CARLING, HIGHWAY 417, PALLADIUM, TERRY FOX, EAGLESON, ROBERTSON, HAZELDEAN, STITTSVILLE MAIN, ABBOTT, HOPE SIDE, OLD RICHMOND, WEST HUNT CLUB, HIGHWAY 416, GREENBANK, FALLOWFIELD, HUNTLEY, MOODIE, RICHMOND, BASELINE, MEADOWLANDS, WOODROFFE, BRIDLE PATH, FISHER, PARKDALE, SCOTT, SOMERSET, BRONSON, BANK, RIDEAU, LAURIER, ELGIN, KING EDWARD, HEMLOCK, MONTREAL, MCARTHUR, ROCKCLIFFE, ST LAURENT, RIVERSIDE, COVENTRY, CARLING, ALTA VISTA, INDUSTRIAL, SMYTH, HERON, WALKLEY, RUSSELL, CONNAUGHT, HAWTHORNE, ANDERSON, HUNT CLUB, AIRPORT, LESTER, ALBION, LEITRIM, HIGHWAY 417, BLAIR, INNES, BLACKBURN HAMLET, REGIONAL ROAD 174, ST JOSEPH, JEANNE D'ARC, ORLEANS, OLD MONTREAL, TRIM, TENTH LINE, JEAN, COLONIAL, MILTON, BOUNDARY, RUSSELL, PINE GROVE, RIVER, BORDER OF VALES

EXISTING INFRASTRUCTURE / INFRASTRUCTURES EXISTANTES

- Combined Sewage Storage Tunnel / Tunnel de stockage des égouts unitaires
- Combined Trunk Sewer / Égout unitaire collecteur
- Sanitary Trunk Sewer / Égout sanitaire collecteur
- Forcemain / Conduite de refoulement
- Chamber / Chambre
- Storage Tank / Réservoir de stockage
- Treatment Plant / Usine de traitement
- Main Pump Station / Station de pompage principale
- Local Pump Station / Station de pompage locale

- Urban Boundary / Périmètre d'urbanisation
- Greenbelt / Ceinture de verdure
- Public Service Area / Zone de desserte

URBAN EXPANSION AREAS / ZONES D'EXPANSION URBAINE

- Future Neighbourhood / Futur quartier
- Industrial and Logistics / Industrie et Logistique

Ottawa

INFRASTRUCTURE MASTER PLAN - Schedule 8

Existing Wastewater Collection System

PLAN DIRECTEUR DE L'INFRASTRUCTURE - Annexe 8

Réseau de collecte des eaux usées existant

0 1.25 2.5 5 7.5 10 km

Planning, Development and Building Services, Geospatial Analytics, Technology and Solutions
Direction générale des sevices de planification, de l'aménagement se du bâtiment, Analyse géospatiale, technologie et solutions

Note:
1) This figure forms part of the Infrastructure Master Plan of the City of Ottawa and should be read in conjunction with the text.
2) This figure is intended as a schematic representation of existing and/or proposed works; consequently alignments and locations of facilities are approximate.

Note:
1) Cette figure fait partie intégrante du Plan directeur de l'infrastructure de la Ville d'Ottawa et devrait être lue conjointement avec le texte.
2) Cette figure se veut être une représentation schématique des travaux actuels et proposés; en conséquence, les tracés et les emplacements des installations sont approximatifs.

9

City of / Ville de GATINEAU

Rivière des Outaouais / Ottawa River

CARP PS CAPACITY UPGRADE AND FORCEMAIN/ AUGMENTATION DE LA CAPACITÉ DE LA SP DE CARP ET CONDUITE DE REFOULEMENT

MARCH PS CAPACITY UPGRADE / AUGMENTATION DE LA CAPACITÉ DE LA SP DU CHEMIN MARCH

CRYSTAL BEACH DIVERSION PS UPGRADE AND FORCEMAIN PHASES 1 AND 2/ CONDUITE DE REFOULEMENT ET MODERNISATION DE LA SP POUR LE DÉTOURNEMENT DES EAUX USÉES DE LA PLAGE CRYSTAL PHASES 1 ET 2

PINECREST TRUNK SEWER UPGRADE / MISE À NIVEAU DE L'ÉGOUT PRINCIPAL DE PINECREST

WOODROFFE DIVERSION PS UPGRADE AND FORCEMAIN / CONDUITE DE REFOULEMENT ET MODERNISATION DE LA SP POUR LE DÉTOURNEMENT DES EAUX USÉES DE WOODROFFE

MERIVALE NORTH TRUNK SEWER DIVERSION, REPLACEMENT AND OVERSIZING / DÉTOURNEMENT, REMPLACEMENT ET SURDIMENSIONNEMENT DE L'ÉGOUT PRINCIPAL DE MERIVALE NORD

O'CONNOR FLOOD CONTROL WORKS / INONDATION O'CONNOR TRAVAUX DE CONTRÔLE

Centre environnemental R.O. Pickard Environmental Centre (ROPEC) / Centre environnemental Robert-O.-Pickard (CEROP)

PENFIELD TRUNK SEWER UPGRADE / MISE À NIVEAU DE L'ÉGOUT PRINCIPAL DE PENFIELD

SIGNATURE RIDGE FORCEMAIN / CONDUITE DE REFOULEMENT DE SIGNATURE RIDGE

KANATA WEST DIVERSION SEWER AND OVERSIZING / ÉGOUT DE DÉCHARGE ET SURDIMENSIONNEMENT DE KANATA-OUEST

RIDEAU RIVER COLLECTOR TWINNING / JUMELAGE DU COLLECTEUR DE LA RIVIÈRE RIDEAU

ROBERTSON ACRES PS RISK MITIGATION, CAPACITY UPGRADE & OVERFLOW PHASES 2 TO 4 / ATTÉNUATION DES RISQUES LIÉS À LA SP ACRES, AMÉLIORATION DE LA CAPACITÉ ET CONDUITE DE DÉBORDEMENT PHASES 2 À 4

PINECREST TRUNK FLOW REDUCTION / ÉCOULEMENT DU TRONC DE PINECREST RÉDUCTION

MERIVALE ROAD SOUTH SEWER UPGRADE AND EXTENSION / MISE À NIVEAU DES ÉGOUTS ET PROLONGEMENT DE L'ÉGOUT SUD DU CHEMIN MERIVALE

AIRPORT PARKWAY DIVERSION SEWER / ÉGOUT DE DÉCHARGE DE LA PROMENADE DE L'AÉROPORT

WALKLEY SEWER UPGRADE / MISE À NIVEAU DE L'ÉGOUT PRINCIPAL DEWALKLEY

PRINCE OF WALES DIVERSION SEWER/ ÉGOUT DE DÉCHARGE DE PRINCE OF WALES

TEWIN COLLECTOR SEWER / ÉGOUT COLLECTEUR DE TEWIN

CONROY TRUNK SEWER UPGRADES PHASES 1 AND 2 / MISE À NIVEAU DE L'ÉGOUT PRINCIPAL DE LA CHEMIN CONROY PHASES 1 ET 2

FOREST VALLEY PS CAPACITY UPGRADE PHASES 1 AND 2 / AUGMENTATION DE LA CAPACITÉ DE LA SP DE FOREST VALLEY PHASES 1 ET 2

TENTH LINE PS CAPACITY AND FORCEMAIN / CAPACITÉ PS ET FORCE PRINCIPALE DU CHEMIN TENTH LINE

KANATA WEST PS CAPACITY UPGRADE / AUGMENTATION DE LA CAPACITÉ DE LA SP DU KANATA OUEST

STITTSVILLE PS DECOMMISSIONING AND GRAVITY SEWER / MISE HORS SERVICE DE LA SP DE STITTSVILLE ET ÉGOUT GRAVITAIRE

SHEA ROAD PS CAPACITY UPGRADE AND FORCEMAIN / AUGMENTATION DE LA CAPACITÉ DE LA SP DU CHEMIN SHEA ET CONDUITE DE REFOULEMENT

RICHMOND FORCEMAIN TWINNING PHASE 4 / CONDUITE DE FORCE DE RICHMOND JUMELAGE PHASE 4

SPRATT ROAD TRUNK SEWER UPGRADE/ MISE À NIVEAU DE L'ÉGOUT PRINCIPAL DE LA CHEMIN SPRATT

RICHMOND KING STREET SEWER UPGRADE PHASE 4A / MISE À NIVEAU DES ÉGOUTS DE LA RUE KING PHASE 4A

MANOTICK MAIN PS CAPACITY UPGRADE PHASES 1 AND 2 / AUGMENTATION DE LA CAPACITÉ DE LA SP DE MANOTICK MAIN PHASES 1 ET 2

MAHOGANY PS CAPACITY UPGRADE AUGMENTATION DE LA CAPACITÉ DE LA SP DE MAHOGANY

NEW PROJECTS / DE NOUVEAUX PROJETS

- New Diversion Sewer / Nouvel égout de décharge
- New Sewer Upgrade / Nouvelle modernisation de l'égout
- New Forcemain / Nouvelle conduite de refoulement
- New Sanitary Sewer / Nouvel égout sanitaire
- Wastewater Pump Station Upgrade / Modernisation de la station de pompage des eaux usées
- Diversion Pump Station Upgrade / Modernisation de la station de pompage de détournement

EXISTING INFRASTRUCTURE / INFRASTRUCTURES EXISTANTES

- Combined Sewage Storage Tunnel / Tunnel de stockage des égouts unitaires
- Combined Trunk Sewer / Égout unitaire collecteur
- Sanitary Trunk Sewer / Égout sanitaire collecteur
- Forcemain / Conduite de refoulement
- Trunk Flow Removal Area / Zone d'élimination du débit de l'égout principal
- Chamber / Chambre
- Storage Tank / Réservoir de stockage
- Treatment Plant / Usine de traitement
- Main Pump Station / Station de pompage principale
- Local Pump Station / Station de pompage locale
- Public Service Area / Zone de desserte

URBAN EXPANSION AREAS / ZONES D'EXPANSION URBAINE

- Future Neighbourhood / Futur quartier
- Industrial and Logistics / Industrie et Logistique
- Urban Boundary / Périmètre d'urbanisation
- Greenbelt / Ceinture de verdure

Ottawa

INFRASTRUCTURE MASTER PLAN - Schedule 9

Growth Projects 2024-2046 - Wastewater Collection System

PLAN DIRECTEUR DE L'INFRASTRUCTURE - Annexe 9

Projets de croissance 2013-2031 - Réseau de collecte des eaux usées

0 1.25 2.5 5 7.5 10 km

Planning, Real Estate and Economic Development Department, Geospatial Analytics, Technology and Solutions
Services de la planification, de l'immobilier et du développement économique, Analyse géospatiale, technologie et solutions

Wastewater Master Plan (Collection) – Capital Program

Project Name	Area	Identified in 2013 IMP	Timing	Total Capital Cost Estimate	Per cent Growth funded
Richmond King Street Trunk Sewer Upgrade (Phase 4a)	Rural	No	2024-2029	$6.6	75%
Carp PS Capacity Upgrade and Forcemain	Rural	Yes	2029-2034	$30.1	75%
Richmond Forcemain Twinning (Phase 4)	Rural	Yes	2024-2029	$38.6	75%
Manotick Main PS Capacity Upgrade (Phase 1)	Rural	Yes	2024-2029	$2.5	64%
Manotick Main PS Capacity Upgrade (Phase 2)	Rural	Yes	2044-2046	$4.3	5%
Mahogany PS Capacity Upgrade	Rural	No	2024-2029	$3.3	90%
Penfield Trunk Sewer Upgrade	Suburban West	No	2029-2034	$7.8	95%
Kanata West Diversion Sewer	Suburban West	No	2029-2034	$3.0	95%
Kanata West Sewer Oversizing	Suburban West	No	2029-2034	$1.8	100%
Kanata West PS Capacity Upgrade	Suburban West	Yes	2029-2034	$3.3	100%
March PS Capacity Upgrade	Suburban West	Yes	2039-2044	$2.8	70%
Signature Ridge Forcemain	Suburban West	Yes	2029-2034	$5.9	75%
Stittsville PS Decommissioning and Gravity Sewer	Suburban West	Yes	2024-2029	$6.5	30%
Shea Road PS Capacity Upgrade and Forcemain	Suburban West	No	2029-2034	$7.8	100%
Acres PS Risk Mitigation (Phase 2)	Suburban West	Yes	2024-2029	$25.5	48%
Acres PS Capacity Upgrade(Phase 3)	Suburban West	Yes	2029-2034	$34.1	39%
Acres PS Overflow (Phase 4)	Suburban West	Yes	2034-2039	$26.3	80%
Spratt Road Trunk Sewer Upgrade	Suburban South West	No	2029-2034	$13.8	95%
Conroy Trunk Sewer Upgrade (Phase 1)	Suburban South East	Yes	2029-2034	$12.3	95%
Conroy Trunk Sewer Upgrade (Phase 2)	Suburban South East	No	2029-2034	$8.8	95%
Walkley Sewer Upgrades	Suburban South East	No	2034-2039	$2.7	95%
Forest Valley PS Capacity Upgrade (Phase 1)	Suburban East	Yes	2029-2034	$2.6	4%

Shea Road Pump Station Capacity Upgrade and Forcemain

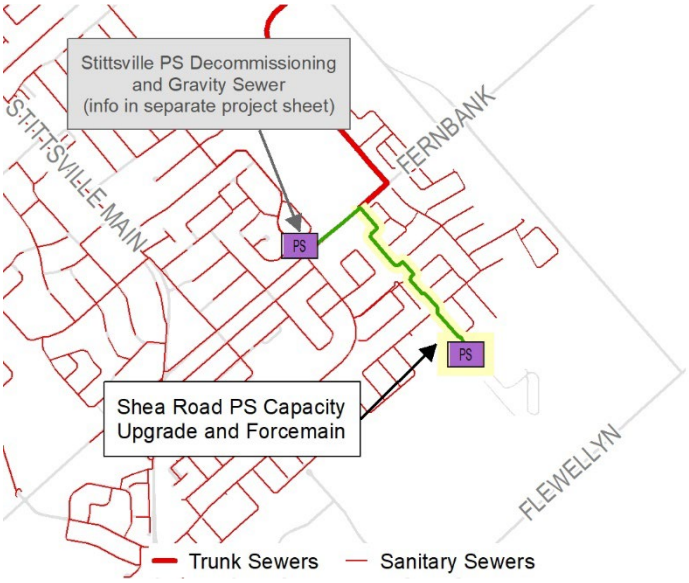

PROJECT RATIONALE

What: The project involves a capacity increase at Shea Road Pump Station to 110 L/s, along with the replacement of one of the existing 200mm diameter forcemain with a larger diameter.

Why: The purpose of this project is to accommodate 2046 population growth demands in Stittsville South.

PROJECT SCHEDULE	
Budget Authority	2029-2034

PROJECT FUNDING	
Total Capital Estimate	$7.8 M
% Development Charge Funded	100%
% Rate Funded	0%
% Other Source Funded	0%

APPROVALS AND FOLLOW-UP ACTIONS	
EA Requirements	This project is exempt from the requirements of the Municipal Engineers Class EA
Follow-up Actions	The following actions are required to pursue implementation of this project: 1. Confirm preferred solution through Master Servicing Study for upstream expansion area 2. Review flow monitoring and confirm timeline requirements for project 3. Functional, preliminary, and detailed design 4. Implementation (tender and construction)

David Schaeffer Engineering Ltd.
120 Iber Road, Suite 103
Stittsville, ON K2S 1E9
613-836-0856
dsel.ca

APPENDIX E

J.F. Sabourin and Associates Inc.
52 Springbrook Drive,
Ottawa, ON K2S 1B9
T 613-836-3884 F 613-836-0332

jfsa.com

November 30, 2023 Project Number: P2267

David Schaeffer Engineering Limited
120 Iber Road, Unit 103
Stittsville, ON
K2S 1E9

Attention: **Kevin Murphy, P.Eng.**

Subject: **Caivan – Stittsville Lands (5993, 6070 & 6115 Flewellyn Road): Conceptual SWM Ponds Sizing and Preliminary HGL Analysis**

DRAFT

Introduction

J.F Sabourin and Associates Inc. (JFSA) was retained by David Schaeffer Engineering Ltd. (DSEL) to prepare a memorandum (memo) to present a conceptual SWM ponds sizing and HGL analysis for the development of the Caivan Stittsville Lands (5993, 6070 & 6115 Flewellyn Road) in support of the Master Servicing Study (MSS) currently being prepared by DSEL. The present memo presents the following:

- A conceptual sizing of two SWM ponds (referred to hereon as East and West SWM Ponds) based on the existing stormwater conditions within the subject site.
- The impacts of discharging a portion of the development to the existing Davidson Pond SWM facility.
- A preliminary storm HGL analysis within the proposed development based on the estimated 100-year water level in the SWM ponds and a conceptual stormwater trunk sewer network.
- A preliminary sanitary HGL analysis within the proposed development based on the estimated 100-year water level in the SWM ponds and a conceptual sanitary trunk sewer network.

Site Overview

The subject lands are bound by Flewellyn Road to the south, Shea Road to the east, an existing urban subdivision development to the north (Stittsville South – Area 6) and an estate lot subdivision to the west. The area is also bisected by the Faulkner Municipal Drain and a Hydro One power transmission corridor. For this study, the overall development area has been broken into two sections (referred to simply as east and west) bisected by the municipal drain and hydro corridor. The property parcel of 5993 Flewellyn Road (east) is predominantly agricultural land and grassed areas, while the west parcels (comprising 6070 & 6115 Flewellyn Road) are treed with patches of grassed areas. **Figure 1** provides an overview of the development site relative to the Faulkner drain and major roads.

Existing Stormwater/Pre-Development Conditions

A memo titled ***"Caivan-Stittsville Lands (5993, 6070 & 6115 Flewellyn Road) – Pre-Development Hydraulic and Hydrologic Study"*** assessing the existing major flow patterns within and around the site and outlining the findings of a detailed pre-development water budget analysis based on modelling using site-based soil data and historical rainfall data was prepared by JFSA on January 30, 2023. Note that a minor adjustment was made to the existing conditions/pre-development drainage areas to reflect an additional portion of the existing Hydro One power transmission corridor within the existing Davidson Lands subdivision, located northeast of the subject site that was identified to drain uncontrolled towards the Faulkner Municipal Drain after the preparation of the January 2023 memo referred to above.

A post- to pre-development approach was taken to size the conceptual SWM ponds and the drainage areas within the subject site were subdivided accordingly. **Figure 2** shows an overview of the existing conditions/pre-development drainage areas within the subject site. From this figure, it can be seen that for the eastern lands, the site primarily consists of **3** (**three**) drainage areas discharging to the Faulkner Municipal Drain, with subcatchment **East_2** corresponding to the pre-development drainage area used to assess the conceptual East SWM Pond. For the westerly lands, the site primarily consists of **2** (**two**) drainage areas discharging to the Faulkner Municipal Drain, with subcatchment **West_1** corresponding to the pre-development drainage area used to assess the conceptual West SWM Pond. The remaining **3** (**three**) subcatchments (**East_1, East_3 & West_2**) remain draining uncontrolled to the Faulkner Municipal Drain.

A SWMHYMO model has been developed to assess the site's pre-development flows and determine the allowable release rates for the conceptual SWM ponds and it can be found in **Attachment B,** with pre-development CN and TP calculations.

DRAFT

N

Legend

Development Area

Municipal Drain

SCALE: 1:6000

0 100 200 300 m

JFSA CANADA INC.
WATER RESOURCE ENGINEERING, ENVIRONMENTAL MANAGEMENT AND LAND PLANNING CONSULTANTS

DSEL

Caivan - Stittsville Lands

Figure 1: Site Overview

PROJECT	P2267
DRAWN	PP
DATE	NOV 2023

C:\Users\PauloPickart\J.F. Sabourin and Associates Inc\JFSA-OTTAWA-SERVER - Documents\PROJ\2267-21\Design\GIS\20231130-Memo Figures

N

Legend

- Drainage Areas
- Development Area
- Municipal Drain
- Flow Paths

SCALE: 1:6000

0 100 200 300 m

JFSA CANADA INC.
WATER RESOURCE ENGINEERING, ENVIRONMENTAL MANAGEMENT AND LAND PLANNING CONSULTANTS

DSEL

Caivan - Stittsville Lands

Figure 2: Existing/Pre-Development Conditions Overview

PROJECT	P2267
DRAWN	PP
DATE	NOV 2023

C:\Users\PauloPickart\J.F. Sabourin and Associates Inc\JFSA-OTTAWA-SERVER - Documents\PROJ\2267-21\Design\GIS\20231123-Caivan Pre&Post-Dev Workspace

Proposed Stormwater/Post-Development Conditions

Based on the existing topography of the site the SWM ponds of this development will be located in the southeast most corners of the respective blocks. It has been assumed that the site will have an average imperviousness of **71%** (RC=0.7) to ensure a conservative representation of a typical residential development. Approximately **36.55 ha** of the development will drain to the West SWM pond, approximately **25.81 ha** will drain to the East SWM Pond and **4.13 ha** of development, will drain to the existing Davidson SWM Pond. The remaining lands will remain unchanged from existing conditions and freely drain to the Faulkner drain.

Figure 3 shows an overview of the post-development conditions and shows the location of both East and West SWM Ponds. Note that the location of the proposed conceptual SWM ponds is based on grading constraints and both ponds will outlet to the existing Faulkner Municipal Drain.

Based on a preliminary analysis, minor adjustments to the existing Davidson Pond outlet structure can be made to maximize the storage capacity of the pond and accommodate the additional flows from the proposed development. Details of this preliminary analysis have also been provided in this report.

SWMHYMO Post-Development Simulations

A SWMHYMO model has been developed to assess the proposed East and West SWM Pond outflows under post-development conditions to ensure that they do not exceed the target/pre-development release rates. Conceptual outflow-storage curves based on the pre-development release rates were applied to the model for both the East and West SWM ponds. Note that the simulations presented in this memo are limited to the subject site only and a detailed assessment of the impacts of the proposed development on the Faulkner Municipal Drain will be prepared at a later date when more details regarding the development are solidified. At this time, to alleviate erosion concerns within the existing Faulkner Municipal Drain, a “sensitivity test” was prepared by halving the target/pre-development release rates for all design storm events, therefore increasing the required volumes to be stored in the proposed conceptual SWM ponds. Preliminary stage-storage curves for both East and West SWM Ponds were prepared by DSEL and used in this analysis. Tables with details and calculations for both conceptual SWM ponds, including the preliminary stage-storage curve used in the analysis can be found in **Attachment C**.

Post-Development Simulation Results

The complete SWMHYMO modelling input and output files have been provided in **Attachment C**, with a full summary of the modelling results and calculations. **Table 1** below is an excerpt of this summary.

Table 1: Summary of Target Release Rates & Required Volumes (100-year 24-hr SCS Type II Storm)

SWM Pond ID	100-year Target Release Rate (Full) (m^3/s)	Required 100-year Volume (m^3)	100-year Target Release Rate (Halved) (m^3/s)	Required 100-year Volume (m^3)
West	0.960	19,310	0.480	21,300
East	0.926	12,850	0.463	14,460

DRAFT

Based on **Table 1**, by halving the target release rates for all storm design events, the increase in the required 100-year storage volume would be approximately **10%** and **13%** for the West and East SWM Ponds respectively. The approximate footprint area required to accommodate a SWM facility with these storage volumes would be approximately **3.0 ha** and **2.5 ha** for the west and east ponds respectively. The "sensitivity test" gives an idea of the increase in the required 100-year storage volumes in both SWM ponds to alleviate erosion concerns in the Faulkner Municipal Drain, however, a more detailed flooding and erosion assessment will be prepared when more information is available for the subdivision to verify and mitigate any impacts the development may have on the municipal drain.

DRAFT

N

Legend

- Drainage Areas
- Development Area
- Municipal Drain
- Conceptual Site Plan

SCALE: 1:6000

0 100 200 300 m

JFSA CANADA INC.
WATER RESOURCE ENGINEERING, ENVIRONMENTAL MANAGEMENT AND LAND PLANNING CONSULTANTS

DSEL

Caivan - Stittsville Lands

Figure 3: Proposed/Post-Development Conditions Overview

PROJECT	P2267
DRAWN	PP
DATE	NOV 2023

C:\Users\PauloPickart\J.F. Sabourin and Associates Inc\JFSA-OTTAWA-SERVER - Documents\PROJ\2267-21\Design\GIS\20231130-Memo Figures

Preliminary Stormwater Hydraulic Grade Line Analysis

A preliminary stormwater hydraulic grade line (HGL) analysis was prepared to verify the freeboard between the HGL and the proposed top of manhole elevations within the subject site (as underside of footing (USF) elevations are not available at this time) to verify the feasibility of gravity storm servicing connections for the units within the proposed development.

Storm HGL Analysis Approach

Preliminary hydraulic grade line calculations for the proposed development were completed using PCSWMM modelling software. The proposed storm sewer infrastructure data was extracted from DSEL's compiled storm sewer design sheets and incorporated into a PCSWMM model, with flows derived from DSEL's Rational Method calculations applied to each Maintenance Hole (MH) in the model as steady flows (using the baseflow option). Exit losses were applied to all storm sewer pipes in the system based on the angle of the downstream connection. **Figure 4** provides an overview of the model. The preliminary HGL analysis assumes the use of the typical City of Ottawa circular ICDs throughout the proposed development, therefore, to simulate the flow in the storm sewers during the 100-year event, the Rational Method flows from DSEL's storm design sheets were increased by 14%, to account for the additional head on the ICDs during the 100-year event. Refer to **Attachment A** for DSEL's storm design sheets. Additionally, the analysis assumes the highest estimated 100-year water levels in the West and East SWM Ponds (**103.80m** and **102.20m** respectively) as per **Tables C-4W** and **C-4E** of **Attachment C**. The 100-year water level in the existing Davidson SWM Pond with the adjustment of the pond controls to accommodate the additional drainage area mentioned earlier in this memo was estimated to be approximately **103.32m** and was used in the preliminary storm HGL assessment for this site.

Preliminary Storm HGL Results

Table D-1 of **Attachment D** shows the maximum storm HGL elevation results and the calculated freeboard between the HGL and the top of the manhole elevation. As can be seen, the average freeboard was found to be **2.40m**, which is considered to be sufficient to provide a minimum of 0.30m freeboard between the HGL and future USF elevations for units serviced by gravity storm connections, assuming that the typical USF elevation would be approximately 1.80m below the assumed top of manhole elevations. USF elevations may have to be slightly raised in some localized areas of the subject site due to grading constraints to maintain a minimum of 0.30m freeboard, however, this analysis shows that gravity service connections to the storm sewer are feasible.

DRAFT

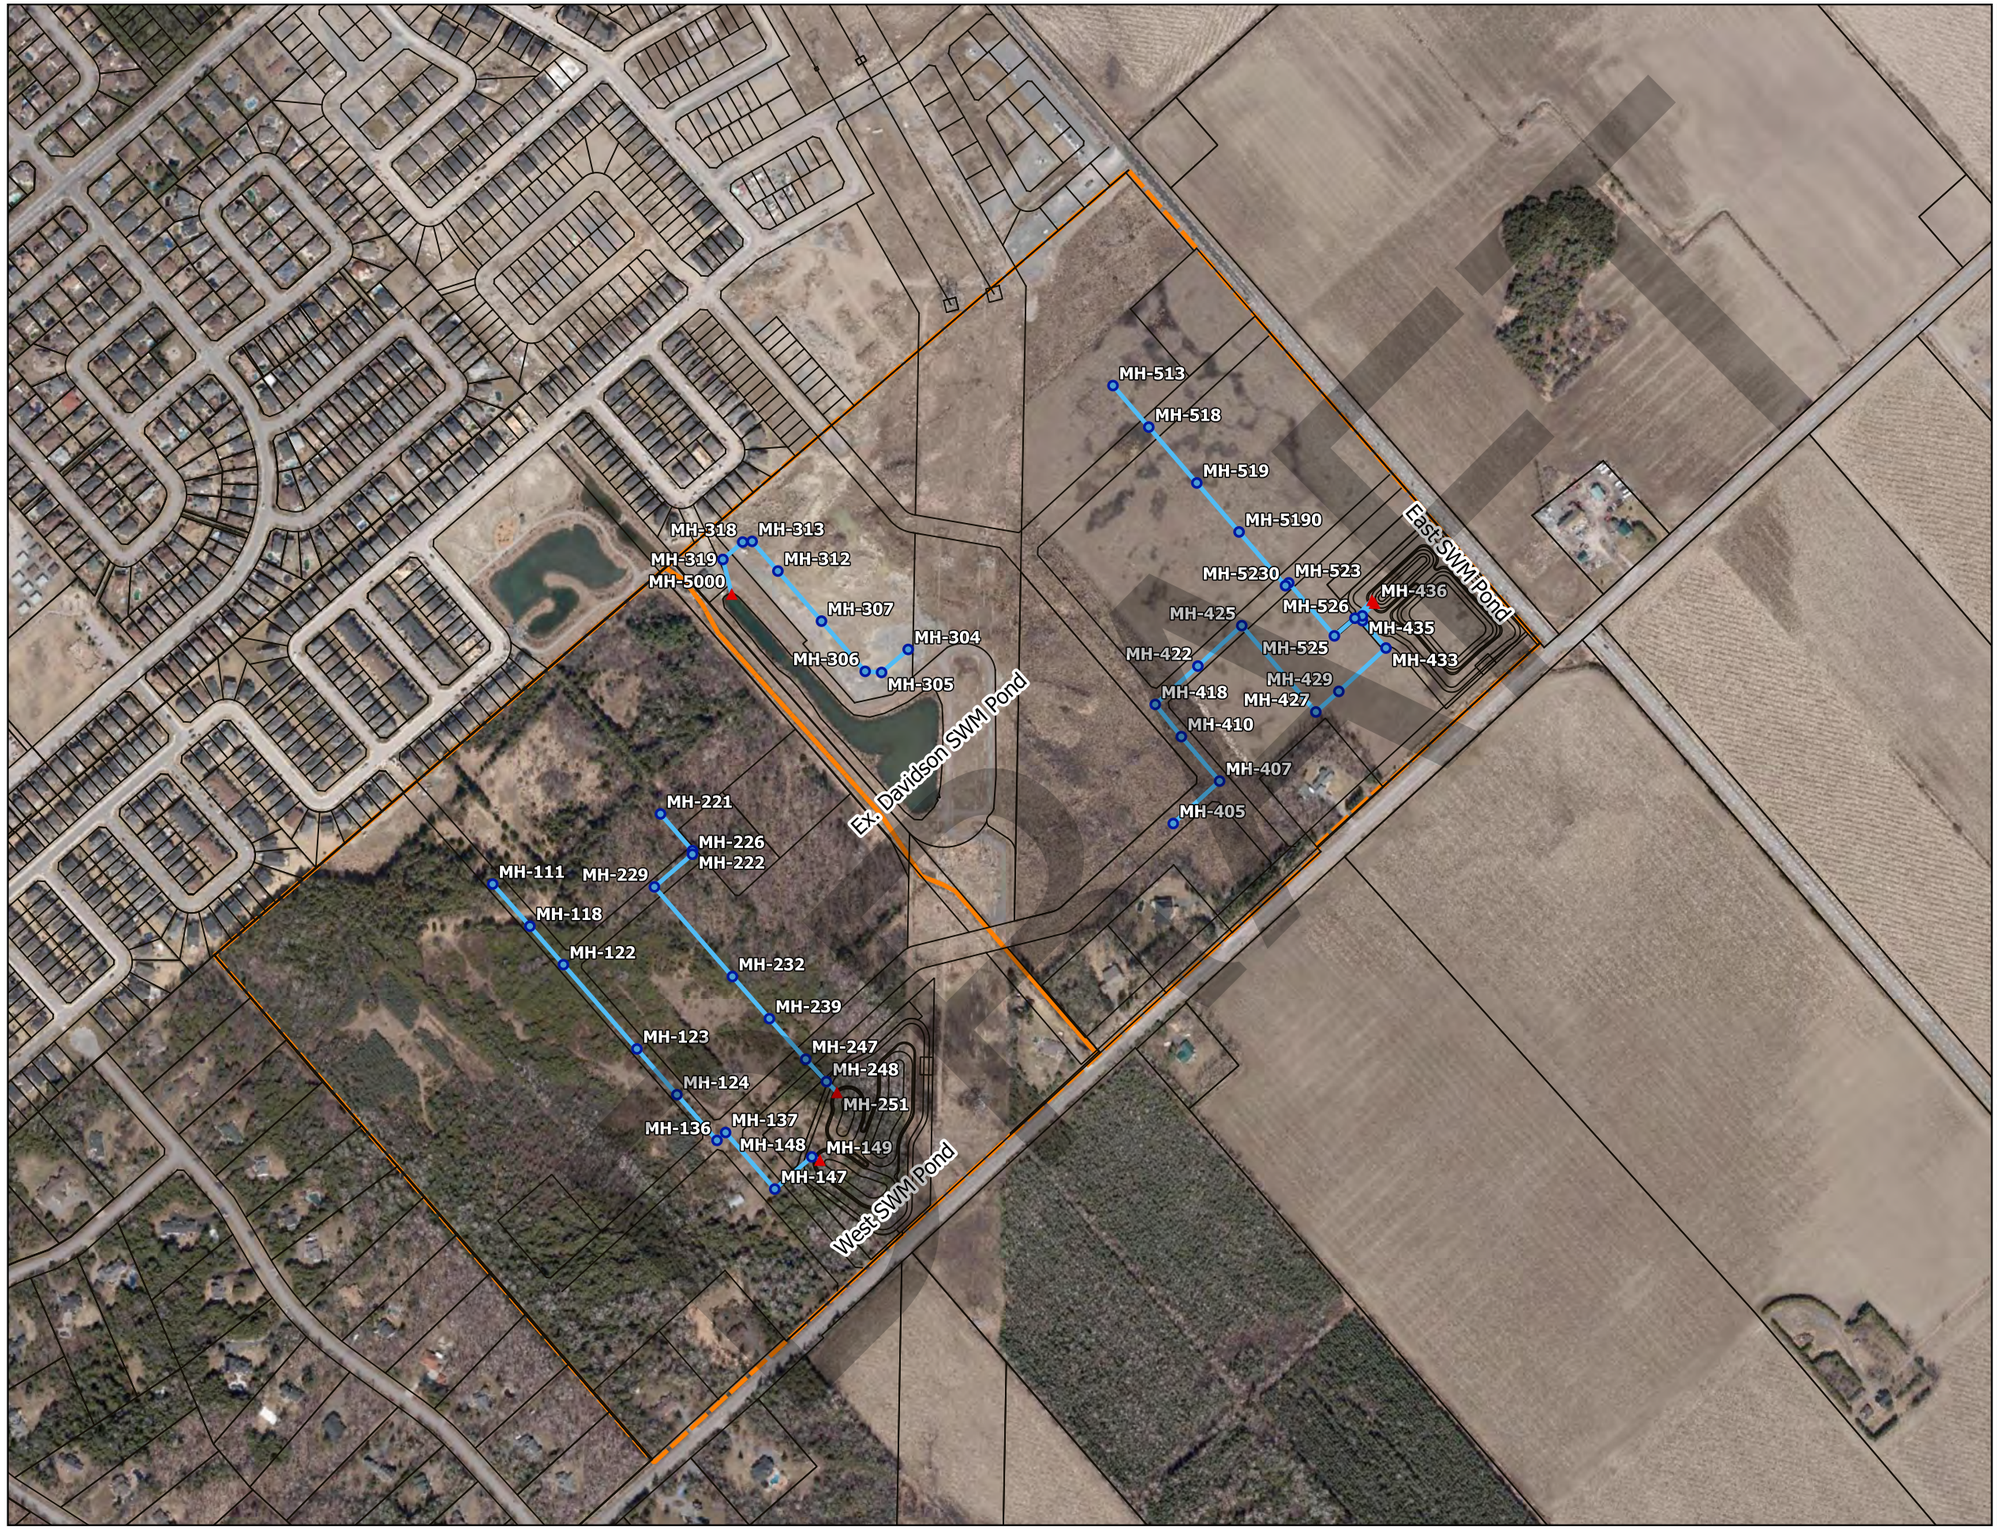

Legend

- Manholes
- Outfalls
- Conduits
- Conceptual Site Plan
- Development Area

SCALE: 1:6000

0 100 200 300 m

JFSA CANADA INC.
WATER RESOURCE ENGINEERING, ENVIRONMENTAL MANAGEMENT AND LAND PLANNING CONSULTANTS

DSEL

Caivan - Stittsville Lands

Figure 4: PCSWMM Storm Model Overview

PROJECT	P2267
DRAWN	PP
DATE	NOV 2023

C:\Users\PauloPickart\J.F. Sabourin and Associates Inc\JFSA-OTTAWA-SERVER - Documents\PROJ\2267-21\Design\GIS\20231130-Memo Figures

Existing Davidson Pond Updates

As mentioned above it is assumed that approximately **4.13 ha** of development will drain to the existing Davidson SWM Pond. This additional area was added to the Davidson Pond SWMHYMO model with minor modifications to the existing pond controls to accommodate the additional drainage area. With these modifications in place, the Davidson SWM facility has sufficient storage volume to provide quality and quantity control to accommodate the additional drainage area. The pond's maximum 100-year storage volume used increased from **23,600 m^3** to **26,610 m^3** and the 100-year water level has increased from **103.17 m** to **103.32 m**. A detailed analysis of the pond operation to assess the release rates, pond water levels and HGL elevations within the proposed and existing development will be prepared when more details of the subdivision become available. Refer to **Attachment F** for preliminary model results and details.

Preliminary Sanitary Hydraulic Grade Line Analysis

The sanitary flows from the proposed development discharge into the existing Shea Road Pumping Station (SRPS) and a sanitary HGL assessment has been prepared to ensure that the proposed sanitary system within the development is adequately sized to safely convey flows to the existing pumping station under emergency pump failure scenario.

Scenarios Analyzed

As per the City of Ottawa ISTB-2018-01, the site was assessed under Annual and Rare conditions. The following outlines the assumptions for both scenarios:

Rare Flows:

- Flow contributions based on Rare Event parameters set out in the City of Ottawa design guidelines and ISTB-2018-01.
- Pumping station operating at a maximum capacity of **71.5 L/s** – assumed a safety factor of 15% reduction of the firm capacity of 84 L/s as per information provided by Novatech to DSEL by email on August 18, 2023.
- Emergency overflow locations that discharge to the existing Davidson SWM Pond and proposed East SWM Pond are assumed to be flapped, with a downstream water level of **103.32m** and **102.20m** respectively based on the 100-year water level in the SWM ponds.

Annual Flows:

- Flow contributions based on Annual event parameters set out in the City of Ottawa design guidelines and ISTB-2018-01.
- Complete pumping station failure (**0 L/s**).
- Emergency overflow locations that discharge to the existing Davidson SWM Pond and proposed East SWM Pond are assumed to be flapped, with a downstream water level of **103.32m** and **102.20m** respectively based on the 100-year water level in the SWM ponds.

Note that a new sanitary emergency overflow at an invert of **102.344 m** is proposed to be installed and discharge to the proposed East SWM Pond. The existing sanitary overflow infrastructure to the Davidson SWM Pond will be maintained, however, modifications to the emergency overflow weir dimensions and crest/invert elevation in **SANMH 97** are proposed. The analysis assumes that the existing emergency overflow weir (sharp-crested weir) will be modified from an approximately 500mm long by 300mm high weir (assumed existing dimensions based on photos from the site as actual dimensions could not be obtained during the preparation of this memo) with a crest/invert elevation of 103.40 m will be modified to a **900mm** long by **500mm** high emergency overflow weir with a crest/invert elevation of **103.05 m** (above the estimated 25-year water level in the Davidson SWM Pond).

DRAFT

Sanitary HGL Analysis Approach

Preliminary hydraulic grade line calculations for the proposed development were completed using PCSWMM modelling software. The proposed sanitary sewer infrastructure data was extracted from DSEL's compiled sanitary design sheets and incorporated into a PCSWMM model, with flows derived from DSEL's sanitary calculations applied to each Maintenance Hole (MH) in the model as steady flows (using the baseflow option). Exit losses were applied to all sanitary sewer pipes in the system based on the angle of the downstream connection. **Figure 5** provides an overview of the model.

Preliminary Sanitary HGL Results

Tables E-1 and E-2 of **Attachment E** show the maximum sanitary HGL elevation results and the calculated freeboard between the HGL and the top of the manhole elevation. As can be seen, the minimum freeboard was found to be **2.33 m** and **1.96 m** for the Rare and Annual scenarios respectively, which is considered to be sufficient to provide a minimum of 0.30m freeboard between the HGL and future USF elevations under the Rare flows scenario and maintaining the HGL below the USF under the pumping station failure scenario (Annual flows), assuming that the typical USF elevation would be approximately 1.80m below the assumed top of manhole elevations. USF elevations may have to be slightly raised in some localized areas of the subject site due to grading constraints to maintain the minimum required freeboard, however, this analysis shows that the preliminary sanitary sewer system for the proposed development is adequately sized.

DRAFT

N

Legend

- Manholes
- Outfalls
- Conduits
- Conceptual Site Plan
- Development Area

SCALE: 1:5000

0 100 200 m

JFSA CANADA INC.
WATER RESOURCE ENGINEERING, ENVIRONMENTAL MANAGEMENT AND LAND PLANNING CONSULTANTS

DSEL

Caivan - Stittsville Lands

Figure 5: PCSWMM Sanitary Model Overview

PROJECT	P2267
DRAWN	PP
DATE	NOV 2023

C:\Users\PauloPickart\J.F. Sabourin and Associates Inc\JFSA-OTTAWA-SERVER - Documents\PROJ\2267-21\Design\GIS\20231130-Memo Figures

Conclusion

In summary, a pre- to post-development approach was taken to preliminarily size the conceptual West and East SWM ponds within the subject site that will outlet into the Faulkner Municipal Drain. At this time, the simulations presented in this memo are limited to the subject site only and to alleviate erosion concerns within the existing Faulkner Municipal Drain, a “sensitivity test” was prepared by halving the target/pre-development release rates for all design storm events, however, a detailed assessment of the impacts of the proposed development on the Faulkner Municipal Drain will be completed at a later date when site plan details become solidified.

PCSWMM modelling has been completed to analyze the storm HGL elevations within the proposed development based on the flow details provided by DSEL. Based on this analysis, it was determined that according to the resulting freeboards between the HGL and the top of manhole elevations, it is feasible to have units serviced by gravity storm connections, assuming that the typical USF elevation would be approximately 1.80m below the assumed top of manhole elevations.

A preliminary analysis of the existing Davidson Pond has also been completed to assess the impact of draining approximately **4.13 ha** of the proposed development to this facility. It was seen that the pond outlet structure would need to be modified, but with these modifications, the pond is expected to accommodate the additional drainage area from the proposed development. A detailed analysis of the pond operation to assess the release rates, pond water levels and HGL elevations within the proposed and existing development will be completed at a later date when more details of the subdivision become solidified.

PCSWMM modelling has been completed to analyze the sanitary HGL elevations within the proposed development based on the flow details provided by DSEL. From this analysis, it was found that the proposed existing sanitary sewer infrastructure is sufficiently sized to safely convey sanitary flows away from the proposed development under various extreme conditions.

Yours truly,
J.F Sabourin and Associates Inc.

Paulo Pickart, B.Eng., P.Eng.
Water Resources Project Engineer

Jonathon Burnett, B.Eng., P.Eng.
Senior Water Resources Engineer

DRAFT

cc: J.F Sabourin, M.Eng., P.Eng.
Director of Water Resources Projects

Figures

Figure 1: Site Overview
Figure 2: Existing/ Pre-Development Conditions Overview
Figure 3: Proposed/ Post-Development Conditions Overview
Figure 4: PCSWMM Storm Model Overview
Figure 5: PCSWMM Sanitary Model Overview

Tables

Table 1: Summary of Target Release Rates & Required Volumes (100-year 24-hr SCS Type II Storm)

Attachments

Attachment A: Storm and Sanitary Design Sheets (as per DSEL)
Attachment B: Existing/Pre-Development Conditions Simulations
Attachment C: Proposed/Post-Development Conditions Simulations
Attachment D: Preliminary Storm Hydraulic Grade Line Analysis
Attachment E: Preliminary Sanitary Hydraulic Grade Line Analysis
Attachment F: Existing Davidson SWM Pond Preliminary Analysis

DRAFT

J.F. Sabourin and Associates Inc.
52 Springbrook Drive,
Ottawa, ON K2S 1B9
T 613-836-3884 F 613-836-0332

jfsa.com

Attachment A

Storm and Sanitary Design Sheets

(As per DSEL)

DRAFT

STORM SEWER CALCULATION SHEET (RATIONAL METHOD)

Local Roads Return Frequency = 2 years
Collector Roads Return Frequency = 5 years
Manning 0.013 Arterial Roads Return Frequency = 10 years

LOCATION			AREA (Ha)														FLOW							SEWER DATA							
			2 YEAR				5 YEAR				10 YEAR				100 YEAR				Time of	Intensity	Intensity	Intensity	Intensity	Peak Flow	**Peak Flow + 14%**	DIA. (mm)	DIA. (mm)	TYPE	SLOPE	LENGTH	CAPACITY	VELOCITY	TIME OF	RATIO
			AREA	R	Indiv.	Accum.	AREA	R	Indiv.	Accum.	AREA	R	Indiv.	Accum.	AREA	R	Indiv.	Accum.	Conc.	2 Year	5 Year	10 Year	100 Year										
Location	From Node	To Node	(Ha)		2.78 AC	2.78 AC	(Ha)		2.78 AC	2.78 AC	(Ha)		2.78 AC	2.78 AC	(Ha)		2.78 AC	2.78 AC	(min)	(mm/h)	(mm/h)	(mm/h)	(mm/h)	Q (l/s)	Q (l/s)	(actual)	(nominal)		(%)	(m)	(l/s)	(m/s)	LOW (min	Q/Q full
STM TRUNK 1																																	
					0.00	0.00	0.00	0.00	0.00	0.00			0.00	0.00			0.00	0.00	14.21														
					0.00	0.00	0.00	0.00	0.00	0.00			0.00	0.00			0.00	0.00	15.14														
	111	118	3.73	0.74	7.67	7.67			0.00	0.00			0.00	0.00			0.00	0.00	15.14	61.45	83.12	97.33	142.13	471	**538**	825	825	CONC	0.20	56.5	641.9463	1.2009	0.7841	0.734
					0.00	7.67	0.00	0.00	0.00	0.00			0.00	0.00			0.00	0.00	15.50														
					0.00	7.67	0.00	0.00	0.00	0.00			0.00	0.00			0.00	0.00	10.60														
	118	122	2.30	0.74	4.73	12.40			0.00	0.00			0.00	0.00			0.00	0.00	15.92	59.68	80.69	94.48	137.95	740	**844**	975	975	CONC	0.20	51.5	1002.2295	1.3424	0.6394	0.739
					0.00	12.40	0.00	0.00	0.00	0.00			0.00	0.00			0.00	0.00	13.87														
	122	123	2.00	0.68	3.78	16.19			0.00	0.00			0.00	0.00			0.00	0.00	16.56	58.31	78.83	92.30	134.74	944	**1076**	1200	1200	CONC	0.15	112.5	1509.9717	1.3351	1.4044	0.625
	123	124	0.37	0.68	0.70	16.89			0.00	0.00			0.00	0.00			0.00	0.00	17.97	55.55	75.06	87.86	128.24	938	**1069**	1200	1200	CONC	0.15	61.0	1509.9717	1.3351	0.7615	0.621
	124	136	0.32	0.68	0.60	17.49			0.00	0.00			0.00	0.00			0.00	0.00	18.73	54.17	73.18	85.65	124.99	948	**1080**	1350	1350	CONC	0.15	61.0	2067.1669	1.4442	0.7040	0.458
					0.00	17.49	0.00	0.00	0.00	0.00			0.00	0.00			0.00	0.00	16.81														
					0.00	17.49	0.55	0.40	0.61	0.61			0.00	0.00			0.00	0.00															
			0.97	0.90	2.43	19.92			0.00	0.61			0.00	0.00			0.00	0.00															
	136	137	3.20	0.68	6.05	25.97			0.00	0.61			0.00	0.00			0.00	0.00	19.43	52.97	71.53	83.71	122.15	1419	**1618**	1500	1500	CONC	0.15	12.0	2737.7609	1.5493	0.1291	0.518
	137	147			0.00	25.97	0.24	0.74	0.49	1.11			0.00	0.00			0.00	0.00	19.56	52.75	71.23	83.36	121.64	1448	**1651**	1500	1500	CONC	0.15	75.5	2737.7609	1.5493	0.8122	0.529
					0.00	25.97	0.00	0.00	0.00	1.11			0.00	0.00			0.00	0.00	11.77														
					0.00	25.97	0.00	0.00	0.00	1.11			0.00	0.00			0.00	0.00	19.27														
					0.00	25.97	0.69	0.74	1.42	2.52			0.00	0.00			0.00	0.00															
			0.86	0.90	2.15	28.12			0.00	2.52			0.00	0.00			0.00	0.00															
	147	148	4.18	0.68	7.90	36.02			0.00	2.52			0.00	0.00			0.00	0.00	20.37	51.44	69.45	81.26	118.56	2028	**2312**	1500	1500	CONC	0.15	49.5	2737.7609	1.5493	0.5325	0.741
	148	149			0.00	36.02			0.00	2.52			0.00	0.00			0.00	0.00	20.90	50.62	68.33	79.95	116.64	1996	**2275**	1500	1500	CONC	0.15	8.5	2737.7609	1.5493	0.0914	0.729
STM TRUNK 2																																	
					0.00	0.00	0.00	0.00	0.00	0.00			0.00	0.00			0.00	0.00	19.64														
					0.00	0.00	0.00	0.00	0.00	0.00			0.00	0.00			0.00	0.00	18.05														
	221	222	6.31	0.74	12.98	12.98			0.00	0.00			0.00	0.00			0.00	0.00	19.64	52.62	71.06	83.16	121.35	683	**779**	975	975	CONC	0.20	49.0	1002.2295	1.3424	0.6084	0.682
	222	226	0.03	0.74	0.06	13.04			0.00	0.00			0.00	0.00			0.00	0.00	20.24	51.64	69.72	81.59	119.04	674	**768**	1050	1050	CONC	0.20	3.5	1221.2174	1.4103	0.0414	0.552
					0.00	13.04	0.00	0.00	0.00	0.00			0.00	0.00			0.00	0.00	12.38														
			0.18	0.68	0.34	13.38			0.00	0.00			0.00	0.00			0.00	0.00															
			0.44	0.74	0.91	14.29			0.00	0.00			0.00	0.00			0.00	0.00															
	226	229			0.00	14.29	0.52	0.40	0.58	0.58			0.00	0.00			0.00	0.00	20.29	51.58	69.63	81.48	118.88	777	**886**	1050	1050	CONC	0.15	50.5	1057.6053	1.2214	0.6891	0.735
					0.00	14.29	0.00	0.00	0.00	0.58			0.00	0.00			0.00	0.00	12.10														
			0.42	0.68	0.79	15.08			0.00	0.58			0.00	0.00			0.00	0.00															
	229	232	0.53	0.74	1.09	16.17			0.00	0.58			0.00	0.00			0.00	0.00	20.97	50.51	68.18	79.78	116.39	856	**976**	1200	1200	CONC	0.15	119.5	1509.9717	1.3351	1.4918	0.567
					0.00	16.17	0.00	0.00	0.00	0.58			0.00	0.00			0.00	0.00	13.38														
	232	239	1.08	0.74	2.22	18.39			0.00	0.58			0.00	0.00			0.00	0.00	22.47	48.37	65.26	76.35	111.36	928	**1057**	1200	1200	CONC	0.15	56.5	1509.9717	1.3351	0.7053	0.614
					0.00	18.39	0.00	0.00	0.00	0.58			0.00	0.00			0.00	0.00	16.55														
					0.00	18.39	0.84	0.40	0.93	1.51			0.00	0.00			0.00	0.00															
	239	247	1.61	0.74	3.31	21.71			0.00	1.51			0.00	0.00			0.00	0.00	23.17	47.43	63.98	74.84	109.15	1126	**1284**	1200	1200	CONC	0.15	55.0	1509.9717	1.3351	0.6866	0.746
					0.00	21.71	0.00	0.00	0.00	1.51			0.00	0.00			0.00	0.00	12.38														
					0.00	21.71	0.00	0.00	0.00	1.51			0.00	0.00			0.00	0.00	15.00														
			1.27	0.68	2.40	24.11			0.00	1.51			0.00	0.00			0.00	0.00															
	247	248			0.00	24.11	1.30	0.74	2.67	4.19			0.00	0.00			0.00	0.00	23.86	46.55	62.78	73.44	107.09	1385	**1579**	1350	1350	CONC	0.25	30.5	2668.7010	1.8644	0.2727	0.519
	248	251			0.00	24.11			0.00	4.19			0.00	0.00			0.00	0.00	24.13	46.21	62.32	72.89	106.30	1375	**1567**	1350	1350	CONC	0.30	15.0	2923.4155	2.0424	0.1224	0.470
STM TRUNK 3																																	
					0.00	0.00	0.00	0.00	0.00	0.00			0.00	0.00			0.00	0.00	12.83														
					0.00	0.00	0.06	0.40	0.07	0.07			0.00	0.00			0.00	0.00															
	304	305	0.93	0.74	1.91	1.91			0.00	0.07			0.00	0.00			0.00	0.00	12.83	67.42	91.31	106.97	156.28	135	**154**	600	600	CONC	0.15	35.5	237.8056	0.8411	0.7035	0.568
	305	306	0.11	0.74	0.23	2.14			0.00	0.07			0.00	0.00			0.00	0.00	13.53	65.47	88.63	103.82	151.65	146	**166**	600	600	CONC	0.15	16.5	237.8056	0.8411	0.3270	0.614
	306	307	0.38	0.74	0.78	2.92			0.00	0.07			0.00	0.00			0.00	0.00	13.86	64.60	87.44	102.42	149.60	195	**222**	675	675	CONC	0.15	67.0	325.5584	0.9098	1.2274	0.598
	307	312	0.32	0.74	0.66	3.58			0.00	0.07			0.00	0.00			0.00	0.00	15.08	61.57	83.29	97.53	142.42	226	**258**	675	675	CONC	0.15	67.0	325.5584	0.9098	1.2274	0.694
					0.00	3.58	0.00	0.00	0.00	0.07			0.00	0.00			0.00	0.00	13.15														
	312	313	1.02	0.74	2.10	5.68			0.00	0.07			0.00	0.00			0.00	0.00	16.31	58.83	79.54	93.13	135.97	339	**387**	675	675	CONC	0.30	39.5	460.4091	1.2866	0.5117	0.737
	313	318			0.00	5.68			0.00	0.07			0.00	0.00			0.00	0.00	16.82	57.77	78.09	91.43	133.47	333	**380**	750	750	CONC	0.20	9.5	497.8726	1.1270	0.1405	0.669

Definitions:
Q = 2.78 AIR, where
Q = Peak Flow in Litres per second (L/s)
A = Areas in hectares (ha)
I = Rainfall Intensity (mm/h)
R = Runoff Coefficient

Notes:
1) Ottawa Rainfall-Intensity Curve
2) Min. Velocity = 0.80 m/s

Designed:
Checked:
Dwg. Reference:

PROJECT: **1247 - STITTSVILLE SOUTH URBAN EXPANSION AREA**
LOCATION: **City of Ottawa**
File Ref:
Date: 24 Nov 2023
Sheet No. SHEET 1 OF 3

DRAFT

STORM SEWER CALCULATION SHEET (RATIONAL METHOD)

Local Roads Return Frequency = 2 years
Collector Roads Return Frequency = 5 years
Manning 0.013 Arterial Roads Return Frequency = 10 years

LOCATION			AREA (Ha)																FLOW							SEWER DATA								
			2 YEAR				5 YEAR				10 YEAR				100 YEAR				Time of	Intensity	Intensity	Intensity	Intensity	Peak Flow	**Peak Flow + 14%**	DIA. (mm)	DIA. (mm)	TYPE	SLOPE	LENGTH	CAPACITY	VELOCITY	TIME OF	RATIO
			AREA	R	Indiv.	Accum.	AREA	R	Indiv.	Accum.	AREA	R	Indiv.	Accum.	AREA	R	Indiv.	Accum.	Conc.	2 Year	5 Year	10 Year	100 Year											
					2.78 AC	2.78 AC			2.78 AC	2.78 AC			2.78 AC	2.78 AC			2.78 AC	2.78 AC																
Location	From Node	To Node	(Ha)				(Ha)				(Ha)				(Ha)				(min)	(mm/h)	(mm/h)	(mm/h)	(mm/h)	Q (l/s)	Q (l/s)	(actual)	(nominal)		(%)	(m)	(l/s)	(m/s)	LOW (min	Q/Q full
					0.00	5.68	0.00	0.00	0.00	0.07			0.00	0.00			0.00	0.00	12.24															
					0.00	5.68	0.54	0.40	0.60	0.67			0.00	0.00			0.00	0.00																
	318	319	0.77	0.74	1.58	7.26			0.00	0.67			0.00	0.00			0.00	0.00	16.96	57.49	77.71	90.97	132.80	469	**535**	825	825	CONC	0.20	26.5	641.9463	1.2009	0.3678	0.731
	319	5000			0.00	7.26			0.00	0.67			0.00	0.00			0.00	0.00	17.33	56.76	76.71	89.80	131.08	463	**528**	900	900	CONC	0.15	36.0	701.1305	1.1021	0.5444	0.661
STM TRUNK 4																																	
					0.00	0.00	0.00	0.00	0.00	0.00			0.00	0.00			0.00	0.00	13.28															
					0.00	0.00	0.00	0.00	0.00	0.00			0.00	0.00			0.00	0.00	11.23															
					0.00	0.00	0.00	0.00	0.00	0.00			0.00	0.00			0.00	0.00	13.28															
			0.50	0.74	1.03	1.03			0.00	0.00			0.00	0.00			0.00	0.00																
					0.00	1.03	0.79	0.68	1.49	1.49			0.00	0.00			0.00	0.00																
					0.00	1.03	0.85	0.74	1.75	3.24			0.00	0.00			0.00	0.00																
	405	407	1.17	0.68	2.21	3.24			0.00	3.24			0.00	0.00			0.00	0.00	13.28	66.16	89.58	104.93	153.29	505	**575**	825	825	CONC	0.25	63.0	717.7178	1.3426	0.7820	0.703
					0.00	3.24	0.00	0.00	0.00	3.24			0.00	0.00			0.00	0.00	11.47															
	407	410			0.00	3.24	0.88	0.68	1.66	4.91			0.00	0.00			0.00	0.00	14.06	64.08	86.73	101.58	148.37	633	**722**	975	975	CONC	0.15	59.0	867.9562	1.1625	0.8459	0.729
					0.00	3.24	0.00	0.00	0.00	4.91			0.00	0.00			0.00	0.00	13.33															
					0.00	3.24	0.16	0.68	0.30	5.21			0.00	0.00			0.00	0.00																
	410	418	0.81	0.74	1.67	4.91			0.00	5.21			0.00	0.00			0.00	0.00	14.90	62.00	83.87	98.22	143.43	741	**845**	1200	1200	CONC	0.15	41.5	1509.9717	1.3351	0.5181	0.491
					0.00	4.91	0.00	0.00	0.00	5.21			0.00	0.00			0.00	0.00	13.48															
					0.00	4.91	0.00	0.00	0.00	5.21			0.00	0.00			0.00	0.00																
			0.09	0.68	0.17	5.08			0.00	5.21			0.00	0.00			0.00	0.00																
					0.00	5.08	0.85	0.68	1.61	6.81			0.00	0.00			0.00	0.00																
			0.96	0.74	1.97	7.05			0.00	6.81			0.00	0.00			0.00	0.00																
	418	422			0.00	7.05	1.31	0.40	1.46	8.27			0.00	0.00			0.00	0.00	15.42	60.79	82.22	96.28	140.58	1109	**1264**	1200	1200	CONC	0.15	57.5	1509.9717	1.3351	0.7178	0.734
					0.00	7.05	0.00	0.00	0.00	8.27			0.00	0.00			0.00	0.00	13.63															
	422	425	1.40	0.68	2.65	9.70			0.00	8.27			0.00	0.00			0.00	0.00	16.14	59.20	80.05	93.72	136.84	1236	**1409**	1350	1350	CONC	0.15	60.0	2067.1669	1.4442	0.6924	0.598
					0.00	9.70	0.00	0.00	0.00	8.27			0.00	0.00			0.00	0.00	13.63															
					0.00	9.70	0.00	0.00	0.00	8.27			0.00	0.00			0.00	0.00	13.63															
			0.61	0.68	1.15	10.85			0.00	8.27			0.00	0.00			0.00	0.00																
	425	427	1.12	0.68	2.12	12.97			0.00	8.27			0.00	0.00			0.00	0.00	16.83	57.76	78.07	91.40	133.43	1395	**1590**	1350	1350	CONC	0.15	114.5	2067.1669	1.4442	1.3214	0.675
					0.00	12.97	0.00	0.00	0.00	8.27			0.00	0.00			0.00	0.00	12.55															
	427	429	1.31	0.68	2.48	15.45			0.00	8.27			0.00	0.00			0.00	0.00	18.15	55.20	74.58	87.30	127.42	1470	**1675**	1350	1350	CONC	0.15	31.0	2067.1669	1.4442	0.3578	0.711
					0.00	15.45	0.00	0.00	0.00	8.27			0.00	0.00			0.00	0.00	10.71															
	429	433	0.44	0.68	0.83	16.28			0.00	8.27			0.00	0.00			0.00	0.00	18.51	54.56	73.70	86.26	125.89	1498	**1707**	1350	1350	CONC	0.15	64.5	2067.1669	1.4442	0.7444	0.724
					0.00	16.28	0.00	0.00	0.00	8.27			0.00	0.00			0.00	0.00	12.15															
	433	434	0.43	0.68	0.81	17.09			0.00	8.27			0.00	0.00			0.00	0.00	19.26	53.26	71.93	84.18	122.84	1505	**1716**	1350	1350	CONC	0.15	36.5	2067.1669	1.4442	0.4212	0.728
	434	435			0.00	17.09			0.00	8.27			0.00	0.00			0.00	0.00	19.68	52.56	70.97	83.05	121.19	1485	**1693**	1350	1350	CONC	0.15	5.0	2067.1669	1.4442	0.0577	0.718
	435	436			0.00	17.09			0.00	8.27			0.00	0.00			0.00	0.00	19.73	52.46	70.84	82.90	120.96	1483	**1690**	1350	1350	CONC	0.15	18.0	2067.1669	1.4442	0.2077	0.717
STM TRUNK 5																																	
					0.00	0.00	0.00	0.00	0.00	0.00			0.00	0.00			0.00	0.00	14.09															
	513	518	3.35	0.74	6.89	6.89			0.00	0.00			0.00	0.00			0.00	0.00	14.09	64.01	86.63	101.47	148.20	441	**503**	900	900	CONC	0.15	55.0	701.1305	1.1021	0.8317	0.629
					0.00	6.89	0.00	0.00	0.00	0.00			0.00	0.00			0.00	0.00	12.35															
					0.00	6.89	0.00	0.00	0.00	0.00			0.00	0.00			0.00	0.00	12.68															
			0.19	0.68	0.36	7.25			0.00	0.00			0.00	0.00			0.00	0.00																
			0.25	0.68	0.47	7.72			0.00	0.00			0.00	0.00			0.00	0.00																
					0.00	7.72	0.45	0.74	0.93	0.93			0.00	0.00			0.00	0.00																
					0.00	7.72	0.65	0.74	1.34	2.26			0.00	0.00			0.00	0.00																
			0.81	0.74	1.67	9.39			0.00	2.26			0.00	0.00			0.00	0.00																
	518	519			0.00	9.39			0.00	2.26			0.00	0.00	2.35	0.25	1.63	1.63	14.92	61.96	83.82	98.16	143.35	1006	**1146**	1200	1200	CONC	0.15	74.0	1509.9717	1.3351	0.9238	0.666
			0.25	0.68	0.47	9.86			0.00	2.26			0.00	0.00			0.00	1.63																
	519	5190	1.32	0.90	3.30	13.16			0.00	2.26			0.00	0.00			0.00	1.63	15.84	59.85	80.93	94.76	138.36	1197	**1365**	1350	1350	CONC	0.15	65.0	2067.1669	1.4442	0.7501	0.579
			0.25	0.68	0.47	13.64			0.00	2.26			0.00	0.00			0.00	1.63																
	5190	5230	1.33	0.90	3.33	16.97			0.00	2.26			0.00	0.00			0.00	1.63	16.59	58.25	78.74	92.19	134.59	1386	**1580**	1350	1350	CONC	0.15	71.5	2067.1669	1.4442	0.8252	0.671
	5230	523	0.10	0.68	0.19	17.15			0.00	2.26			0.00	0.00			0.00	1.63	17.42	56.59	76.48	89.53	130.69	1357	**1547**	1350	1350	CONC	0.15	4.5	2067.1669	1.4442	0.0519	0.657
					0.00	17.15	0.00	0.00	0.00	2.26			0.00	0.00			0.00	1.63	12.92															
	523	525	0.90	0.68	1.70	18.86			0.00	2.26			0.00	0.00			0.00	1.63	17.47	56.49	76.34	89.37	130.45	1451	**1654**	1350	1350	CONC	0.15	70.5	2067.1669	1.4442	0.8136	0.702

Definitions:
Q = 2.78 AIR, where
Q = Peak Flow in Litres per second (L/s)
A = Areas in hectares (ha)
I = Rainfall Intensity (mm/h)
R = Runoff Coefficient

Notes:
1) Ottawa Rainfall-Intensity Curve
2) Min. Velocity = 0.80 m/s

Designed:
Checked:
Dwg. Reference:

PROJECT: **1247 - STITTSVILLE SOUTH URBAN EXPANSION AREA**
LOCATION: **City of Ottawa**
File Ref:
Date: 24 Nov 2023
Sheet No. SHEET 2 OF 3

DRAFT

STORM SEWER CALCULATION SHEET (RATIONAL METHOD)

Local Roads Return Frequency = 2 years
Collector Roads Return Frequency = 5 years
Manning 0.013 Arterial Roads Return Frequency = 10 years

	LOCATION		AREA (Ha)														FLOW							SEWER DATA								
			2 YEAR				5 YEAR				10 YEAR				100 YEAR				Time of	Intensity	Intensity	Intensity	Intensity	Peak Flow	**Peak Flow + 14%**	DIA. (mm)	DIA. (mm)	TYPE	SLOPE	LENGTH	CAPACITY	VELOCITY	TIME OF	RATIO
			AREA	R	Indiv.	Accum.	AREA	R	Indiv.	Accum.	AREA	R	Indiv.	Accum.	AREA	R	Indiv.	Accum.	Conc.	2 Year	5 Year	10 Year	100 Year											
Location	From Node	To Node	(Ha)		2.78 AC	2.78 AC	(Ha)		2.78 AC	2.78 AC	(Ha)		2.78 AC	2.78 AC	(Ha)		2.78 AC	2.78 AC	(min)	(mm/h)	(mm/h)	(mm/h)	(mm/h)	Q (l/s)	Q (l/s)	(actual)	(nominal)		(%)	(m)	(l/s)	(m/s)	LOW (min	Q/Q full
					0.00	18.86	0.00	0.00	0.00	2.26			0.00	0.00			0.00	1.63	10.66														
	525	526	0.23	0.68	0.43	19.29			0.00	2.26			0.00	0.00			0.00	1.63	18.28	54.97	74.26	86.92	126.86	1436	**1637**	1350	1350	CONC	0.15	27.0	2067.1669	1.4442	0.3116	0.694
	526	527			0.00	19.29			0.00	2.26			0.00	0.00			0.00	1.63	18.59	54.41	73.50	86.02	125.54	1421	**1620**	1350	1350	CONC	0.15	25.0	2067.1669	1.4442	0.2885	0.687

DRAFT

Definitions:
Q = 2.78 AIR, where
Q = Peak Flow in Litres per second (L/s)
A = Areas in hectares (ha)
I = Rainfall Intensity (mm/h)
R = Runoff Coefficient

Notes:
1) Ottawa Rainfall-Intensity Curve
2) Min. Velocity = 0.80 m/s

Designed:
Checked:
Dwg. Reference:

PROJECT: **1247 - STITTSVILLE SOUTH URBAN EXPANSION AREA**
LOCATION: **City of Ottawa**
File Ref:
Date: 24 Nov 2023
Sheet No. SHEET 3 OF 3

SANITARY SEWER CALCULATION SHEET (RARE FLOWS)

Manning's n=0.013

LOCATION			RESIDENTIAL AREA AND POPULATION							COMM		INSTIT		PARK		C+I+I	INFILTRATION				PIPE						
STREET	FROM M.H.	TO M.H.	AREA (ha)	UNITS	POP.	CUMULATIVE AREA (ha)	CUMULATIVE POP.	PEAK FACT.	PEAK FLOW (l/s)	AREA (ha)	ACCU. AREA (ha)	AREA (ha)	ACCU. AREA (ha)	AREA (ha)	ACCU. AREA (ha)	PEAK FLOW (l/s)	TOTAL AREA (ha)	ACCU. AREA (ha)	INFILT. FLOW (l/s)	TOTAL FLOW (l/s)	DIST (m)	DIA (mm)	SLOPE (%)	CAP. (FULL) (l/s)	RATIO Q act/Q cap	VEL. (FULL) (m/s)	VEL. (ACT.) (m/s)
SAN TRUNK 1																											
			0.68		53	0.68	53				0.00		0.00		0.00		0.68	0.68									
	126A	127A	3.23		272	3.91	325	2.8	2.14		0.00		0.00		0.00	0.00	3.23	3.91	2.15	4.29	74.0	300	0.20	43.25	0.10	0.61	0.39
			1.26		105	5.17	430				0.00		0.00		0.00		1.26	5.17									
	127A	141A	1.60		126	6.77	556	2.8	3.57		0.00		0.00		0.00	0.00	1.60	6.77	3.72	7.29	7.0	300	0.20	43.25	0.17	0.61	0.45
			1.85		412	8.62	968				0.00		0.00	0.55	0.55		2.40	9.17									
	141A	142A	4.42		372	13.04	1340	2.6	8.15		0.00		0.00		0.55	0.06	4.42	13.59	7.47	15.69	60.0	300	0.20	43.25	0.36	0.61	0.56
	142A	143A	0.36		30	13.40	1370	2.6	8.32		0.00		0.00		0.55	0.06	0.36	13.95	7.67	16.06	60.0	300	0.20	43.25	0.37	0.61	0.57
	143A	152A	0.57		48	13.97	1418	2.6	8.59		0.00		0.00		0.55	0.06	0.57	14.52	7.99	16.64	110.0	300	0.20	43.25	0.38	0.61	0.57
			0.09		7	14.06	1425				0.00		0.00	1.36	1.91		1.45	15.97									
			0.58		50	14.64	1475				0.00		0.00		1.91		0.58	16.55									
			1.43		120	16.07	1595				0.00		0.00		1.91		1.43	17.98									
	152A	175A	3.51		279	19.58	1874	2.6	11.12		0.00		0.00		1.91	0.21	3.51	21.49	11.82	23.15	56.0	300	0.20	43.25	0.54	0.61	0.62
	175A	180A	7.10		560	26.68	2434	2.5	14.15		0.00		0.00		1.91	0.21	7.10	28.59	15.72	30.08	52.0	300	0.20	43.25	0.70	0.61	0.66
	180A	183A	1.48		117	28.16	2551	2.5	14.77		0.00		0.00		1.91	0.21	1.48	30.07	16.54	31.51	52.0	300	0.20	43.25	0.73	0.61	0.67
	183A	186A	1.02		80	29.18	2631	2.5	15.19		0.00		0.00		1.91	0.21	1.02	31.09	17.10	32.49	52.0	300	0.20	43.25	0.75	0.61	0.67
	186A	187A	1.54		121	30.72	2752	2.5	15.83		0.00		0.00		1.91	0.21	1.54	32.63	17.95	33.98	116.5	375	0.20	78.41	0.43	0.71	0.68
	187A	188A	0.34		27	31.06	2779	2.5	15.97		0.00		0.00		1.91	0.21	0.34	32.97	18.13	34.31	64.5	375	0.20	78.41	0.44	0.71	0.68
	188A	190A	0.35		27	31.41	2806	2.5	16.11		0.00		0.00		1.91	0.21	0.35	33.32	18.33	34.64	71.5	375	0.20	78.41	0.44	0.71	0.69
	190A	191A	0.29		23	31.70	2829	2.5	16.23		0.00		0.00		1.91	0.21	0.29	33.61	18.49	34.92	44.5	375	0.20	78.41	0.45	0.71	0.69
	191A	192A	0.11		9	31.81	2838	2.5	16.28		0.00		0.00		1.91	0.21	0.11	33.72	18.55	35.03	8.5	375	0.20	78.41	0.45	0.71	0.69
	192A	193A	0.01		1	31.82	2839	2.5	16.28		0.00		0.00		1.91	0.21	0.01	33.73	18.55	35.04	26.0	375	0.20	78.41	0.45	0.71	0.69
	193A	194A				31.82	2839	2.5	16.28		0.00		0.00		1.91	0.21	0.00	33.73	18.55	35.04	27.0	375	0.20	78.41	0.45	0.71	0.69
	194A	195A				31.82	2839	2.5	16.28		0.00		0.00		1.91	0.21	0.00	33.73	18.55	35.04	16.5	375	0.20	78.41	0.45	0.71	0.69
	195A	196A				31.82	2839	2.5	16.28		0.00		0.00		1.91	0.21	0.00	33.73	18.55	35.04	11.0	375	0.20	78.41	0.45	0.71	0.69
To SAN TRUNK 2, Pipe 196A - 282A						31.82	2839				0.00		0.00		1.91			33.73									
SAN TRUNK 2																											
	207A	208A	0.51		44	0.51	44	3.0	0.31		0.00		0.00		0.00	0.00	0.51	0.51	0.28	0.59	11.5	200	0.35	19.40	0.03	0.62	0.27
	208A	203A	0.08		7	0.59	51	3.0	0.35		0.00		0.00		0.00	0.00	0.08	0.59	0.32	0.68	52.0	200	0.35	19.40	0.03	0.62	0.29
	203A	221A	1.09		92	1.68	143	2.9	0.97		0.00		0.00		0.00	0.00	1.09	1.68	0.92	1.89	91.5	200	0.35	19.40	0.10	0.62	0.39
	221A	223A				1.68	143	2.9	0.97		0.00		0.00		0.00	0.00	0.00	1.68	0.92	1.89	119.0	200	0.35	19.40	0.10	0.62	0.39
			0.67		56	2.35	199				0.00		0.00		0.00		0.67	2.35									
	223A	224A	3.70		312	6.05	511	2.8	3.29		0.00		0.00		0.00	0.00	3.70	6.05	3.33	6.62	56.0	250	0.30	32.57	0.20	0.66	0.52
	224A	240A				6.05	511	2.8	3.29		0.00		0.00		0.00	0.00	0.00	6.05	3.33	6.62	9.5	250	0.30	32.57	0.20	0.66	0.52
			0.53		44	6.58	555				0.00		0.00	1.31	1.31		1.84	7.89									
			1.50		126	8.08	681				0.00		0.00		1.31		1.50	9.39									
			1.86		156	9.94	837				0.00		0.00		1.31		1.86	11.25									
	240A	241A	3.01		237	12.95	1074	2.7	6.63		0.00		0.00		1.31	0.14	3.01	14.26	7.84	14.62	98.0	300	0.20	43.25	0.34	0.61	0.55
	241A	260A	0.43		36	13.38	1110	2.7	6.84		0.00		0.00		1.31	0.14	0.43	14.69	8.08	15.06	102.0	300	0.20	43.25	0.35	0.61	0.56
			0.43		37	13.81	1147				0.00		0.00		1.31		0.43	15.12									
			0.74		62	14.55	1209				0.00		0.00		1.31		0.74	15.86									
			2.96		656	17.51	1865				0.00		0.00		1.31		2.96	18.82									
	260A	261A	5.02		398	22.53	2263	2.5	13.23		0.00		0.00		1.31	0.14	5.02	23.84	13.11	26.49	13.0	300	0.20	43.25	0.61	0.61	0.64
	261A	262A	0.18		14	22.71	2277	2.5	13.31		0.00		0.00		1.31	0.14	0.18	24.02	13.21	26.66	108.5	300	0.20	43.25	0.62	0.61	0.64
	262A	264A	0.14		11	22.85	2288	2.5	13.37		0.00		0.00		1.31	0.14	0.14	24.16	13.29	26.80	42.5	300	0.20	43.25	0.62	0.61	0.64
	264A	265A	0.46		37	23.31	2325	2.5	13.56		0.00		0.00	0.54	1.85	0.20	1.00	25.16	13.84	27.60	63.0	300	0.20	43.25	0.64	0.61	0.65
	265A	274A	0.26		21	23.57	2346	2.5	13.68		0.00		0.00		1.85	0.20	0.26	25.42	13.98	27.86	63.0	300	0.20	43.25	0.64	0.61	0.65

DESIGN PARAMETERS

Park Flow =	9300	L/ha/da	0.10764	l/s/Ha
Average Daily Flow =	200	l/p/day		
Comm/Inst Flow =	17000	L/ha/da	0.1968	l/s/Ha
Industrial Flow =	10000	L/ha/da	0.11574	l/s/Ha
Max Res. Peak Factor =	4.00			
Commercial/Inst./Park Peak Factor =	1.00			
Institutional =	0.20	l/s/Ha		

Industrial Peak Factor = as per MOE Graph

Extraneous Flow = 0.550 L/s/ha

Minimum Velocity = 0.600 m/s

Manning's n = (Conc) 0.013 (Pvc) 0.013

Townhouse coeff= 2.7

Single house coeff= 3.4

Designed:

Checked:

Dwg. Reference:

Sanitary Drainage Plan, Dwgs. No.

PROJECT: **1247 - STITTSVILLE SOUTH URBAN EXPANSION AREA**

LOCATION: **City of Ottawa**

File Ref:

Date: **28 Nov 2023**

Sheet No 1 of 2

DRAFT

SANITARY SEWER CALCULATION SHEET (RARE FLOWS)

Manning's n=0.013

LOCATION				RESIDENTIAL AREA AND POPULATION							COMM		INSTIT		PARK		C+I+I		INFILTRATION			PIPE						
STREET		FROM M.H.	TO M.H.	AREA (ha)	UNITS	POP.	CUMULATIVE AREA (ha)	CUMULATIVE POP.	PEAK FACT.	PEAK FLOW (l/s)	AREA (ha)	ACCU. AREA (ha)	AREA (ha)	ACCU. AREA (ha)	AREA (ha)	ACCU. AREA (ha)	PEAK FLOW (l/s)	TOTAL AREA (ha)	ACCU. AREA (ha)	INFILT. FLOW (l/s)	TOTAL FLOW (l/s)	DIST (m)	DIA (mm)	SLOPE (%)	CAP. (FULL) (l/s)	RATIO Q act/Q cap	VEL. (FULL) (m/s)	VEL. (ACT.) (m/s)
		274A	275A	1.85		147	25.42	2493	2.5	14.46		0.00		0.00	0.06	1.91	0.21	1.91	27.33	15.03	29.70	41.5	300	0.20	43.25	0.69	0.61	0.66
		275A	279A	0.01		1	25.43	2494	2.5	14.47		0.00		0.00		1.91	0.21	0.01	27.34	15.04	29.71	12.5	300	0.20	43.25	0.69	0.61	0.66
		279A	280A	0.78		61	26.21	2555	2.5	14.79		0.00		0.00		1.91	0.21	0.78	28.12	15.47	30.46	22.5	300	0.20	43.25	0.70	0.61	0.66
		280A	281A				26.21	2555	2.5	14.79		0.00		0.00		1.91	0.21	0.00	28.12	15.47	30.46	16.0	300	0.20	43.25	0.70	0.61	0.66
		281A	196A				26.21	2555	2.5	14.79		0.00		0.00		1.91	0.21	0.00	28.12	15.47	30.46	2.5	450	2.50	450.79	0.07	2.83	1.61
Contribution From SAN TRUNK 1, Pipe 195A - 196A							31.82	2839				0.00		0.00		1.91		33.73	61.85									
		196A	282A				58.03	5394	2.3	29.08		0.00		0.00		3.82	0.41	0.00	61.85	34.02	63.50	2.3	450	2.50	450.79	0.14	2.83	1.99
SAN TRUNK 3																												
		6001A	6002A				0.00					0.00		0.00		0.00	0.00	0.00	0.00	0.00	0.00	13.0	375	0.35	103.73	0.00	0.94	0.05
		6002A	6003A				0.00	0				0.00		0.00		0.00	0.00	0.00	0.00	0.00	0.00	47.0	375	0.35	103.73	0.00	0.94	0.05
		6003A	6004A				0.00	0				0.00		0.00		0.00	0.00	0.00	0.00	0.00	0.00	12.5	375	0.35	103.73	0.00	0.94	0.05

DESIGN PARAMETERS

Park Flow =	9300	L/ha/da	0.10764	l/s/Ha			
Average Daily Flow =	200	l/p/day			Industrial Peak Factor = as per MOE Graph		
Comm/Inst Flow =	17000	L/ha/da	0.1968	l/s/Ha	Extraneous Flow =	0.550	L/s/ha
Industrial Flow =	10000	L/ha/da	0.11574	l/s/Ha	Minimum Velocity =	0.600	m/s
Max Res. Peak Factor =	4.00				Manning's n = (Conc)	0.013 (Pvc)	0.013
Commercial/Inst./Park Peak Factor =	1.00				Townhouse coeff=	2.7	
Institutional =	0.20	l/s/Ha			Single house coeff=	3.4	

Designed:

Checked:

Dwg. Reference:
Sanitary Drainage Plan, Dwgs. No.

PROJECT:
1247 - STITTSVILLE SOUTH URBAN EXPANSION AREA

LOCATION:
City of Ottawa

File Ref:

Date:
28 Nov 2023

Sheet No. 2
of 2

DRAFT

SANITARY SEWER CALCULATION SHEET (ANNUAL FLOWS)

Manning's n=0.013

LOCATION			RESIDENTIAL AREA AND POPULATION							COMM		INSTIT		PARK		C+I+I	INFILTRATION				PIPE						
STREET	FROM M.H.	TO M.H.	AREA (ha)	UNITS	POP.	CUMULATIVE AREA (ha)	CUMULATIVE POP.	PEAK FACT.	PEAK FLOW (l/s)	AREA (ha)	ACCU. AREA (ha)	AREA (ha)	ACCU. AREA (ha)	AREA (ha)	ACCU. AREA (ha)	PEAK FLOW (l/s)	TOTAL AREA (ha)	ACCU. AREA (ha)	INFILT. FLOW (l/s)	TOTAL FLOW (l/s)	DIST (m)	DIA (mm)	SLOPE (%)	CAP. (FULL) (l/s)	RATIO Q act/Q cap	VEL. (FULL) (m/s)	VEL. (ACT.) (m/s)
SAN TRUNK 1																											
			0.68		53	0.68	53				0.00		0.00		0.00		0.68	0.68									
	126A	127A	3.23		272	3.91	325	2.8	2.14		0.00		0.00		0.00	0.00	3.23	3.91	1.17	3.31	74.0	300	0.20	43.25	0.08	0.61	0.36
			1.26		105	5.17	430				0.00		0.00		0.00		1.26	5.17									
	127A	141A	1.60		126	6.77	556	2.8	3.57		0.00		0.00		0.00	0.00	1.60	6.77	2.03	5.60	7.0	300	0.20	43.25	0.13	0.61	0.42
			1.85		412	8.62	968				0.00		0.00	0.55	0.55		2.40	9.17									
	141A	142A	4.42		372	13.04	1340	2.6	8.15		0.00		0.00		0.55	0.06	4.42	13.59	4.08	12.29	60.0	300	0.20	43.25	0.28	0.61	0.52
	142A	143A	0.36		30	13.40	1370	2.6	8.32		0.00		0.00		0.55	0.06	0.36	13.95	4.19	12.57	60.0	300	0.20	43.25	0.29	0.61	0.53
	143A	152A	0.57		48	13.97	1418	2.6	8.59		0.00		0.00		0.55	0.06	0.57	14.52	4.36	13.01	110.0	300	0.20	43.25	0.30	0.61	0.53
			0.09		7	14.06	1425				0.00		0.00	1.36	1.91		1.45	15.97									
			0.58		50	14.64	1475				0.00		0.00		1.91		0.58	16.55									
			1.43		120	16.07	1595				0.00		0.00		1.91		1.43	17.98									
	152A	175A	3.51		279	19.58	1874	2.6	11.12		0.00		0.00		1.91	0.21	3.51	21.49	6.45	17.78	56.0	300	0.20	43.25	0.41	0.61	0.58
	175A	180A	7.10		560	26.68	2434	2.5	14.15		0.00		0.00		1.91	0.21	7.10	28.59	8.58	22.93	52.0	300	0.20	43.25	0.53	0.61	0.62
	180A	183A	1.48		117	28.16	2551	2.5	14.77		0.00		0.00		1.91	0.21	1.48	30.07	9.02	23.99	52.0	300	0.20	43.25	0.55	0.61	0.63
	183A	186A	1.02		80	29.18	2631	2.5	15.19		0.00		0.00		1.91	0.21	1.02	31.09	9.33	24.72	52.0	300	0.20	43.25	0.57	0.61	0.63
	186A	187A	1.54		121	30.72	2752	2.5	15.83		0.00		0.00		1.91	0.21	1.54	32.63	9.79	25.82	116.5	375	0.20	78.41	0.33	0.71	0.64
	187A	188A	0.34		27	31.06	2779	2.5	15.97		0.00		0.00		1.91	0.21	0.34	32.97	9.89	26.06	64.5	375	0.20	78.41	0.33	0.71	0.64
	188A	190A	0.35		27	31.41	2806	2.5	16.11		0.00		0.00		1.91	0.21	0.35	33.32	10.00	26.31	71.5	375	0.20	78.41	0.34	0.71	0.64
	190A	191A	0.29		23	31.70	2829	2.5	16.23		0.00		0.00		1.91	0.21	0.29	33.61	10.08	26.52	44.5	375	0.20	78.41	0.34	0.71	0.64
	191A	192A	0.11		9	31.81	2838	2.5	16.28		0.00		0.00		1.91	0.21	0.11	33.72	10.12	26.60	8.5	375	0.20	78.41	0.34	0.71	0.64
	192A	193A	0.01		1	31.82	2839	2.5	16.28		0.00		0.00		1.91	0.21	0.01	33.73	10.12	26.61	26.0	375	0.20	78.41	0.34	0.71	0.64
	193A	194A				31.82	2839	2.5	16.28		0.00		0.00		1.91	0.21	0.00	33.73	10.12	26.61	27.0	375	0.20	78.41	0.34	0.71	0.64
	194A	195A				31.82	2839	2.5	16.28		0.00		0.00		1.91	0.21	0.00	33.73	10.12	26.61	16.5	375	0.20	78.41	0.34	0.71	0.64
	195A	196A				31.82	2839	2.5	16.28		0.00		0.00		1.91	0.21	0.00	33.73	10.12	26.61	11.0	375	0.20	78.41	0.34	0.71	0.64
To SAN TRUNK 2, Pipe 196A - 282A						31.82	2839				0.00		0.00		1.91			33.73									
SAN TRUNK 2																											
	207A	208A	0.51		44	0.51	44	3.0	0.31		0.00		0.00		0.00	0.00	0.51	0.51	0.15	0.46	11.5	200	0.35	19.40	0.02	0.62	0.26
	208A	203A	0.08		7	0.59	51	3.0	0.35		0.00		0.00		0.00	0.00	0.08	0.59	0.18	0.53	52.0	200	0.35	19.40	0.03	0.62	0.26
	203A	221A	1.09		92	1.68	143	2.9	0.97		0.00		0.00		0.00	0.00	1.09	1.68	0.50	1.47	91.5	200	0.35	19.40	0.08	0.62	0.36
	221A	223A				1.68	143	2.9	0.97		0.00		0.00		0.00	0.00	0.00	1.68	0.50	1.47	119.0	200	0.35	19.40	0.08	0.62	0.36
			0.67		56	2.35	199				0.00		0.00		0.00		0.67	2.35									
	223A	224A	3.70		312	6.05	511	2.8	3.29		0.00		0.00		0.00	0.00	3.70	6.05	1.82	5.11	56.0	250	0.30	32.57	0.16	0.66	0.48
	224A	240A				6.05	511	2.8	3.29		0.00		0.00		0.00	0.00	0.00	6.05	1.82	5.11	9.5	250	0.30	32.57	0.16	0.66	0.48
			0.53		44	6.58	555				0.00		0.00	1.31	1.31		1.84	7.89									
			1.50		126	8.08	681				0.00		0.00		1.31		1.50	9.39									
			1.86		156	9.94	837				0.00		0.00		1.31		1.86	11.25									
	240A	241A	3.01		237	12.95	1074	2.7	6.63		0.00		0.00		1.31	0.14	3.01	14.26	4.28	11.05	98.0	300	0.20	43.25	0.26	0.61	0.51
	241A	260A	0.43		36	13.38	1110	2.7	6.84		0.00		0.00		1.31	0.14	0.43	14.69	4.41	11.39	102.0	300	0.20	43.25	0.26	0.61	0.52
			0.43		37	13.81	1147				0.00		0.00		1.31		0.43	15.12									
			0.74		62	14.55	1209				0.00		0.00		1.31		0.74	15.86									
			2.96		656	17.51	1865				0.00		0.00		1.31		2.96	18.82									
	260A	261A	5.02		398	22.53	2263	2.5	13.23		0.00		0.00		1.31	0.14	5.02	23.84	7.15	20.53	13.0	300	0.20	43.25	0.47	0.61	0.60
	261A	262A	0.18		14	22.71	2277	2.5	13.31		0.00		0.00		1.31	0.14	0.18	24.02	7.21	20.65	108.5	300	0.20	43.25	0.48	0.61	0.60
	262A	264A	0.14		11	22.85	2288	2.5	13.37		0.00		0.00		1.31	0.14	0.14	24.16	7.25	20.76	42.5	300	0.20	43.25	0.48	0.61	0.60
	264A	265A	0.46		37	23.31	2325	2.5	13.56		0.00		0.00	0.54	1.85	0.20	1.00	25.16	7.55	21.31	63.0	300	0.20	43.25	0.49	0.61	0.61
	265A	274A	0.26		21	23.57	2346	2.5	13.68		0.00		0.00		1.85	0.20	0.26	25.42	7.63	21.50	63.0	300	0.20	43.25	0.50	0.61	0.61

DESIGN PARAMETERS

Park Flow =	9300	L/ha/da	0.10764	l/s/Ha			
Average Daily Flow =	200	l/p/day			Industrial Peak Factor = as per MOE Graph		
Comm/Inst Flow =	17000	L/ha/da	0.1968	l/s/Ha	Extraneous Flow =	0.300	L/s/ha
Industrial Flow =	10000	L/ha/da	0.11574	l/s/Ha	Minimum Velocity =	0.600	m/s
Max Res. Peak Factor =	4.00				Manning's n = (Conc)	0.013 (Pvc)	0.013
Commercial/Inst./Park Peak Factor =	1.00				Townhouse coeff=	2.7	
Institutional =	0.20	l/s/Ha			Single house coeff=	3.4	

Designed:

Checked:

Dwg. Reference:
Sanitary Drainage Plan, Dwgs. No.

PROJECT:
1247 - STITTSVILLE SOUTH URBAN EXPANSION AREA

LOCATION:
City of Ottawa

File Ref:

Date:
28 Nov 2023

Sheet No 1
of 2

DRAFT

SANITARY SEWER CALCULATION SHEET (ANNUAL FLOWS)

Manning's n=0.013

LOCATION				RESIDENTIAL AREA AND POPULATION							COMM		INSTIT		PARK		C+I+I		INFILTRATION			PIPE						
STREET		FROM M.H.	TO M.H.	AREA (ha)	UNITS	POP.	CUMULATIVE AREA (ha)	CUMULATIVE POP.	PEAK FACT.	PEAK FLOW (l/s)	AREA (ha)	ACCU. AREA (ha)	AREA (ha)	ACCU. AREA (ha)	AREA (ha)	ACCU. AREA (ha)	PEAK FLOW (l/s)	TOTAL AREA (ha)	ACCU. AREA (ha)	INFILT. FLOW (l/s)	TOTAL FLOW (l/s)	DIST (m)	DIA (mm)	SLOPE (%)	CAP. (FULL) (l/s)	RATIO Q act/Q cap	VEL. (FULL) (m/s)	VEL. (ACT.) (m/s)
		274A	275A	1.85		147	25.42	2493	2.5	14.46		0.00		0.00	0.06	1.91	0.21	1.91	27.33	8.20	22.86	41.5	300	0.20	43.25	0.53	0.61	0.62
		275A	279A	0.01		1	25.43	2494	2.5	14.47		0.00		0.00		1.91	0.21	0.01	27.34	8.20	22.87	12.5	300	0.20	43.25	0.53	0.61	0.62
		279A	280A	0.78		61	26.21	2555	2.5	14.79		0.00		0.00		1.91	0.21	0.78	28.12	8.44	23.43	22.5	300	0.20	43.25	0.54	0.61	0.62
		280A	281A				26.21	2555	2.5	14.79		0.00		0.00		1.91	0.21	0.00	28.12	8.44	23.43	16.0	300	0.20	43.25	0.54	0.61	0.62
		281A	196A				26.21	2555	2.5	14.79		0.00		0.00		1.91	0.21	0.00	28.12	8.44	23.43	2.5	450	2.50	450.79	0.05	2.83	1.46
Contribution From SAN TRUNK 1, Pipe 195A - 196A							31.82	2839				0.00		0.00		1.91		33.73	61.85									
		196A	282A				58.03	5394	2.3	29.08		0.00		0.00		3.82	0.41	0.00	61.85	18.56	48.04	2.3	450	2.50	450.79	0.11	2.83	1.84
SAN TRUNK 3																												
		6001A	6002A				0.00					0.00		0.00		0.00	0.00	0.00	0.00	0.00	0.00	13.0	375	0.35	103.73	0.00	0.94	0.05
		6002A	6003A				0.00	0				0.00		0.00		0.00	0.00	0.00	0.00	0.00	0.00	47.0	375	0.35	103.73	0.00	0.94	0.05
		6003A	6004A				0.00	0				0.00		0.00		0.00	0.00	0.00	0.00	0.00	0.00	12.5	375	0.35	103.73	0.00	0.94	0.05

DESIGN PARAMETERS

Park Flow =	9300	L/ha/da	0.10764	l/s/Ha			
Average Daily Flow =	200	l/p/day			Industrial Peak Factor = as per MOE Graph		
Comm/Inst Flow =	17000	L/ha/da	0.1968	l/s/Ha	Extraneous Flow =	0.300	L/s/ha
Industrial Flow =	10000	L/ha/da	0.11574	l/s/Ha	Minimum Velocity =	0.600	m/s
Max Res. Peak Factor =	4.00				Manning's n = (Conc)	0.013 (Pvc)	0.013
Commercial/Inst./Park Peak Factor =	1.00				Townhouse coeff=	2.7	
Institutional =	0.20	l/s/Ha			Single house coeff=	3.4	

Designed:

Checked:

Dwg. Reference:
Sanitary Drainage Plan, Dwgs. No.

PROJECT:
1247 - STITTSVILLE SOUTH URBAN EXPANSION AREA

LOCATION:
City of Ottawa

File Ref:

Date:
28 Nov 2023

Sheet No. 2 of 2

DRAFT

J.F. Sabourin and Associates Inc.
52 Springbrook Drive,
Ottawa, ON K2S 1B9
T 613-836-3884 F 613-836-0332

jfsa.com

Attachment B

Existing/Pre-Development Conditions Simulations

DRAFT

Table B1: Calculation of SCS Curve Number (CN) and Modified Curve Number (CN*)

East_2 (25.453 ha)							
Area (ha)	Land Type	Soil Name	Soil Condition	Soil Group	CN	% of Catchment	Weighted CN
15.221	Urban Lawn/Shallow Rooted Crops	Fine Sandy Loam	C	Fair	79	59.8%	47.2
10.232	Pasture and Shrubs	Fine Sandy Loam	C	Fair	70	40.2%	28.1
						CN	**75.4**
						CN*	**66**

West_1 (36.153 ha)							
Area (ha)	Land Type	Soil Name	Soil Condition	Soil Group	CN	% of Catchment	Weighted CN
24.995	Mature Forest	Fine Sandy Loam	C	Fair	73	69.1%	50.5
11.158	Pasture and Shrubs	Fine Sandy Loam	C	Fair	70	30.9%	21.6
						CN	**72.1**
						CN*	**61**

DRAFT

Table B2: Time to Peak Calculations

Parameter	Units	East_2	West_1
Area	ha	25.45	36.15
CN*	-	66	61
Ptotal to calc C from CN, use 2 yr 3 hr Chicago stom	P(mm)	33.2	33.2
	Ia(mm)	4.67	4.67
	RV(mm)	5.1	4.3
Ptotal to calc C from CN, use 2 yr 24 hr SCS stom	P(mm)	52.77	52.77
	RV(mm)	12.9	11.1
C (From Chicago storm)	-	0.15	0.13
C (From SCS storm)	-	0.24	0.21
Length of Channel	m	513	1003
	ft	1682	3291
Elevation of Head Water	m	102.78	109.56
	ft	337	359
Elevation of Outlet	m	100.16	102.19
	ft	329	335
Average Slope	m/m	0.0051	0.0073
	ft/ft	0.51%	0.73%
Kirpich			
Time of Concentration	mins	18	26
Time to Peak	min	12	18
Time to Peak	Hours	0.20	0.29
FAA (From Chicago storm)			
Time of Concentration	mins	87	111
Time to Peak	mins	58	74
Time to Peak	Hours	0.97	1.23
FAA (From SCS storm)			
Time of Concentration	mins	79	102
Time to Peak	mins	53	68
Time to Peak	Hours	0.88	1.13
Bransby Williams			
Time of Concentration	mins	24	43
Time to Peak	mins	16	29
Time to Peak	Hours	0.27	0.48
SCS			
Time of Concentration	mins	100	161
Time to Peak	mins	67	107
Time to Peak	Hours	1.12	1.79
Selected Method			
FAA (From Chicago storm)			
Time to Peak	min	58	74
Time to Peak	Hours	0.97	1.23

Note:

All methods calculated as per Appendix A of the SWMHYMO manual

Time to Peak calculated as 2/3 Time of concentration

DRAFT

Table B3: West Pre-Development Peak Flows (36.15 ha; CN* 61)

Event	Pre-Dev Flows [(1)] (m^3/s)	Runoff Volume (m^3)
25mm CHI 3Hr	0.079	817
2-Year CHI 3Hr	0.138	1,410
5-Year CHI 3Hr	0.255	2,585
10-Year CHI 3Hr	0.347	3,507
25-Year CHI 3Hr	0.477	4,801
50-Year CHI 3Hr	0.585	5,874
100-Year CHI 3Hr	0.706	7,075
2-Year SCS 24 Hr	0.218	3,362
5-Year SCS 24 Hr	0.379	5,755
10-Year SCS 24 Hr	0.501	7,563
25-Year SCS 24 Hr	0.667	9,988
50-Year SCS 24 Hr	0.805	11,998
100-Year SCS 24 Hr	0.960	14,239

[(1)] Target flows based on peak pre-development flows

DRAFT

Table B4: East Pre-Development Peak Flows (25.45 ha; CN* 66)

Event	Pre-Dev Flows [(1)] (m^3/s)	Runoff Volume (m^3)
25mm CHI 3Hr	0.079	695
2-Year CHI 3Hr	0.137	1,191
5-Year CHI 3Hr	0.252	2,161
10-Year CHI 3Hr	0.342	2,911
25-Year CHI 3Hr	0.468	3,957
50-Year CHI 3Hr	0.572	4,820
100-Year CHI 3Hr	0.688	5,775
2-Year SCS 24 Hr	0.218	2,794
5-Year SCS 24 Hr	0.375	4,724
10-Year SCS 24 Hr	0.493	6,161
25-Year SCS 24 Hr	0.651	8,073
50-Year SCS 24 Hr	0.781	9,643
100-Year SCS 24 Hr	0.926	11,381

[(1)] Target flows based on peak pre-development flows

DRAFT

```
00001> 20     Metric units / ID Numbers OFF
00002> *$**************************************************************************
00003> *#  SWMHYMO Ver:5.500/Feb 2015 / INPUT DATA FILE
00004> *$**************************************************************************
00005> *#  Project Name  : [Caivan Stittsville West properties]
00006> *#  Project Number: [2267]
00007> *#  Date          : [2023/11/27]
00008> *#  Modeller      : [PP]
00009> *#  Company       : J.F. Sabourin and Associates
00010> *#  License #     : 2549237
00011> *$**************************************************************************
00012> *%  25 mm Storm based on 2-Year, 3-Hour Chicago Storm
00013> START               TZERO=[0.0],  METOUT=[2],  NSTORM=[1],  NRUN=[001]
00014> *%                   ["25MMC3H.stm"] <--storm filename, one per line for NSTORM time
00015> *%-----------------|-------------------------------------------------------------|
00016> READ STORM          STORM_FILENAME=["storm.001"]
00017> *%-----------------|-------------------------------------------------------------|
00018> DEFAULT VALUES      ICASEdef=[1],  read and print values
00019>                     DEFVAL_FILENAME=["Ottawa.val"]
00020> *%-----------------|-------------------------------------------------------------|
00021> *##############################################################################
00022> *# Pre Development Condition
00023> *##############################################################################
00024> *# West Area
00025> DESIGN NASHYD        NHYD=["West_1"], DT=[1]min, AREA=[36.15](ha),
00026>                     DWF=[0](cms), CN/C=[61], TP=[1.23]hrs,
00027>                     RAINFALL=[ ,  ,  ,  , ](mm/hr), END=-1
00028> *%-----------------|-------------------------------------------------------------|
00029> *##############################################################################
00030> *# East Area
00031> DESIGN NASHYD        NHYD=["East_2"], DT=[1]min, AREA=[25.45](ha),
00032>                     DWF=[0](cms), CN/C=[66], TP=[0.97]hrs,
00033>                     RAINFALL=[ ,  ,  ,  , ](mm/hr), END=-1
00034> *%-----------------|-------------------------------------------------------------|
00035> *##############################################################################
00036> *# STORMS
00037> *##############################################################################
00038> *%  25 mm Storm based on 2-Year, 3-Hour Chicago Storm
00039> *%START               TZERO=[0.0],  METOUT=[2],  NSTORM=[1],  NRUN=[001]
00040> *%                   ["25MMC3H.stm"] <--storm filename, one per line for NSTORM time
00041> *%-----------------|-------------------------------------------------------------|
00042> *%  2-Year, 3-Hour Chicago Storm
00043> START               TZERO=[0.0],  METOUT=[2],  NSTORM=[1],  NRUN=[002]
00044>                     ["002YC3H.stm"] <--storm filename, one per line for NSTORM time
00045> *%-----------------|-------------------------------------------------------------|
00046> *%  5-Year, 3-Hour Chicago Storm
00047> START               TZERO=[0.0],  METOUT=[2],  NSTORM=[1],  NRUN=[005]
00048>                     ["005YC3H.stm"] <--storm filename, one per line for NSTORM time
00049> *%-----------------|-------------------------------------------------------------|
00050> *%  10-Year, 3-Hour Chicago Storm
00051> START               TZERO=[0.0],  METOUT=[2],  NSTORM=[1],  NRUN=[010]
00052>                     ["010YC3H.stm"] <--storm filename, one per line for NSTORM time
00053> *%-----------------|-------------------------------------------------------------|
00054> *%  25-Year, 3-Hour Chicago Storm
00055> START               TZERO=[0.0],  METOUT=[2],  NSTORM=[1],  NRUN=[025]
00056>                     ["025YC3H.stm"] <--storm filename, one per line for NSTORM time
00057> *%-----------------|-------------------------------------------------------------|
00058> *%  50-Year, 3-Hour Chicago Storm
00059> START               TZERO=[0.0],  METOUT=[2],  NSTORM=[1],  NRUN=[050]
00060>                     ["050YC3H.stm"] <--storm filename, one per line for NSTORM time
00061> *%-----------------|-------------------------------------------------------------|
00062> *%  100-Year, 3-Hour Chicago Storm
00063> START               TZERO=[0.0],  METOUT=[2],  NSTORM=[1],  NRUN=[099]
00064>                     ["100YC3H.stm"] <--storm filename, one per line for NSTORM time
00065> *%-----------------|-------------------------------------------------------------|
00066> *%  2-Year, 24-Hour SCS Storm
00067> START               TZERO=[0.0],  METOUT=[2],  NSTORM=[1],  NRUN=[102]
00068>                     ["SC24002x.stm"] <--storm filename, one per line for NSTORM time
00069> *%-----------------|-------------------------------------------------------------|
00070> *%  5-Year, 24-Hour SCS Storm
00071> START               TZERO=[0.0],  METOUT=[2],  NSTORM=[1],  NRUN=[105]
00072>                     ["SC24005x.stm"] <--storm filename, one per line for NSTORM time
00073> *%-----------------|-------------------------------------------------------------|
00074> *%  10-Year, 24-Hour SCS Storm
00075> START               TZERO=[0.0],  METOUT=[2],  NSTORM=[1],  NRUN=[110]
00076>                     ["SC24010x.stm"] <--storm filename, one per line for NSTORM time
00077> *%-----------------|-------------------------------------------------------------|
00078> *%  25-Year, 24-Hour SCS Storm
00079> START               TZERO=[0.0],  METOUT=[2],  NSTORM=[1],  NRUN=[125]
00080>                     ["SC24025x.stm"] <--storm filename, one per line for NSTORM time
00081> *%-----------------|-------------------------------------------------------------|
00082> *%  50-Year, 24-Hour SCS Storm
00083> START               TZERO=[0.0],  METOUT=[2],  NSTORM=[1],  NRUN=[150]
00084>                     ["SC24050x.stm"] <--storm filename, one per line for NSTORM time
00085> *%-----------------|-------------------------------------------------------------|
00086> *%  100-Year, 24-Hour SCS Storm
00087> START               TZERO=[0.0],  METOUT=[2],  NSTORM=[1],  NRUN=[199]
00088>                     ["SC24100x.stm"] <--storm filename, one per line for NSTORM time
00089> *%-----------------|-------------------------------------------------------------|
00090> *%  2-Year, 12-Hour SCS Storm (per City of Ottawa Carp River PCSWMM model)
00091> *START               TZERO=[0.0],  METOUT=[2],  NSTORM=[1],  NRUN=[202]
00092> *                   ["SC12002c.stm"] <--storm filename, one per line for NSTORM time
00093> *%-----------------|-------------------------------------------------------------|
00094> *%  5-Year, 12-Hour SCS Storm (per City of Ottawa Carp River PCSWMM model)
00095> *START               TZERO=[0.0],  METOUT=[2],  NSTORM=[1],  NRUN=[205]
00096> *                   ["SC12005c.stm"] <--storm filename, one per line for NSTORM time
00097> *%-----------------|-------------------------------------------------------------|
00098> *%  10-Year, 12-Hour SCS Storm (per City of Ottawa Carp River PCSWMM model)
00099> *START               TZERO=[0.0],  METOUT=[2],  NSTORM=[1],  NRUN=[210]
00100> *                   ["SC12010c.stm"] <--storm filename, one per line for NSTORM time
00101> *%-----------------|-------------------------------------------------------------|
00102> *%  25-Year, 12-Hour SCS Storm (per City of Ottawa Carp River PCSWMM model)
00103> *START               TZERO=[0.0],  METOUT=[2],  NSTORM=[1],  NRUN=[225]
00104> *                   ["SC12025c.stm"] <--storm filename, one per line for NSTORM time
00105> *%-----------------|-------------------------------------------------------------|
00106> *%  50-Year, 12-Hour SCS Storm (per City of Ottawa Carp River PCSWMM model)
00107> *START               TZERO=[0.0],  METOUT=[2],  NSTORM=[1],  NRUN=[250]
00108> *                   ["SC12050c.stm"] <--storm filename, one per line for NSTORM time
00109> *%-----------------|-------------------------------------------------------------|
00110> *%  100-Year, 12-Hour SCS Storm (per City of Ottawa Carp River PCSWMM model)
00111> *START               TZERO=[0.0],  METOUT=[2],  NSTORM=[1],  NRUN=[299]
00112> *                   ["SC12100c.stm"] <--storm filename, one per line for NSTORM time
00113> *%-----------------|-------------------------------------------------------------|
00114> *%  July 1st, 1979 Storm - Ottawa International Airport
00115> *START               TZERO=[0.0],  METOUT=[2],  NSTORM=[1],  NRUN=[979]
00116> *                   ["19790701.stm"] <--storm filename, one per line for NSTORM time
00117> *%-----------------|-------------------------------------------------------------|
00118> *%  August 4th, 1988 Storm - Ottawa International Airport
00119> *START               TZERO=[0.0],  METOUT=[2],  NSTORM=[1],  NRUN=[988]
00120> *                   ["19880804.stm"] <--storm filename, one per line for NSTORM time
00121> *%-----------------|-------------------------------------------------------------|
00122> *%  August 8th, 1996 Storm - Ottawa International Airport
00123> *START               TZERO=[0.0],  METOUT=[2],  NSTORM=[1],  NRUN=[996]
00124> *                   ["19960808.stm"] <--storm filename, one per line for NSTORM time
00125> *%-----------------|-------------------------------------------------------------|
00126> *%  100-Year, 3-Hour Chicago Storm + 20%
00127> *START               TZERO=[0.0],  METOUT=[2],  NSTORM=[1],  NRUN=[999]
00128> *                   ["100YC3H+.stm"] <--storm filename, one per line for NSTORM time
00129> *%-----------------|-------------------------------------------------------------|
00130> FINISH
```

DRAFT

```
SSSSS   W   W   M   M   H   H   Y   Y   M   M    OOO          222    000    11   5555   ========
S       W W W   MM MM   H   H    Y Y    MM MM   O   O          2   0   0   11   5
SSSSS   W W W   M M M   HHHHH     Y     M M M   O   O          2   0   0   11   5       Ver 5.500
    S   W W W   M   M   H   H     Y     M   M   O   O        222   0   0   11   555    FEB  2015
SSSSS    W W    M   M   H   H     Y     M   M    OOO         2     0   0   11     5   ========
        StormWater Management HYdrologic Model               222    000    11   555    ========

 ************************************************************************************************
 ************************************************  SWMHYMO Ver 5.500  ***************************
 ************************  A single event and continuous hydrologic simulation model  ***********
 ************************      based on the principles of HYMO and its successors     ***********
 ************************              OTTHYMO-83 and OTTHYMO-89.                     ***********
 ************************************************************************************************
 ************************ Distributed by:  J.F. Sabourin and Associates Inc.          ***********
 ************************                 Ottawa, Ontario: (613) 836-3884             ***********
 ************************                 Gatineau, Quebec: (819) 243-6858            ***********
 ************************                 E-Mail: swmhymo@jfsa.com                    ***********
 ************************************************************************************************

 ++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++
 ++++++++++++++++++ Licensed user: JFSAinc.                                  ++++++++++++++++++++
 ++++++++++++++++++                 Ottawa                  SERIAL#:2549237  ++++++++++++++++++++
 ++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++

 ************************************************************************************************
 ************************  S U M M A R Y   O U T P U T  ***********************************
 ************************************************************************************************
 *                    RUN DATE: 2023-11-28      TIME: 09:32:38      RUN COUNTER: 007600           *
 ************************************************************************************************
 * Input   file: C:\Temp\P2267-Stittsville FSR\20231127-Pre-Dev SWMHYMO\STIT-Pre_v04.dat          *
 * Output  file: C:\Temp\P2267-Stittsville FSR\20231127-Pre-Dev SWMHYMO\STIT-Pre_v04.out          *
 * Summary file: C:\Temp\P2267-Stittsville FSR\20231127-Pre-Dev SWMHYMO\STIT-Pre_v04.sum          *
 * User comments:                                                                                *
 * 1:_____________________________________________________________________________________________*
 * 2:_____________________________________________________________________________________________*
 * 3:_____________________________________________________________________________________________*
 ************************************************************************************************

#*************************************************************************
#  SWMHYMO Ver:5.500/Feb 2015 / INPUT DATA FILE
#*************************************************************************
#  Project Name  : [Caivan Stittsville West properties]
#  Project Number: [2267]
#  Date          : [2023/11/27]
#  Modeller      : [PP]
#  Company       : J.F. Sabourin and Associates
#  License #     : 2549237
#*************************************************************************
 RUN#:COMMAND#
R0001:C00001------------------------------------------------------------------------------------
      START
       [TZERO =      .00 hrs on       0]
       [METOUT=   2     (1=imperial, 2=metric output)]
       [NSTORM=   1 ]
       [NRUN  = 0001 ]
R0001:C00002------------------------------------------------------------------------------------
      READ STORM
       Filename = storm.001
       Comment  = 25 MM BASED ON CHICAGO STORM 2 Year, 3 Hours
       [SDT=10.00:SDUR=   3.00:PTOT=  25.00]
R0001:C00003------------------------------------------------------------------------------------
      DEFAULT VALUES
       Filename = C:\Temp\P2267-Stittsville FSR\20231127-Pre-Dev SWMHYMO\Ottawa.val
       ICASEdv  = 1 (read and print data)
       FileTitle= File comment: [Parameters for City of Ottawa Projects]
                  THE FOLLOWING PARAMETERS ARE USED IN THE DESIGN STANDHYD COM
       Horton's infiltration equation parameters:
       [Fo= 76.20 mm/hr] [Fc=13.20 mm/hr] [DCAY= 4.14 /hr] [F=  .00 mm]
       Parameters for PERVIOUS surfaces in STANDHYD:
       [IAper=   4.67 mm] [LGP=40.00 m] [MNP= .250]
       Parameters for IMPERVIOUS surfaces in STANDHYD:
       [IAimp=   1.57 mm] [CLI= 1.50]   [MNI= .013]
       Parameters used in NASHYD:
       [Ia=   4.67 mm] [N= 3.00]
       Average monthly Pan Evaporation data in    (mm)
    JAN   FEB   MAR   APR   MAY   JUN   JUL   AUG   SEP   OCT   NOV   DEC
   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00
       Average monthly Potential Evapotranspiration in    (mm)
    JAN   FEB   MAR   APR   MAY   JUN   JUL   AUG   SEP   OCT   NOV   DEC
   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00
#*************************************************************************
# Pre Development Condition
#*************************************************************************
# West Area
R0001:C00004------------DTmin-ID:NHYD--------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    DESIGN NASHYD         1.0 01:West_1        36.15     .079 No_date   2:45     2.26 .090     .000
       [CN= 61.0: N= 3.00: Tp= 1.23]
#*************************************************************************
# East Area
R0001:C00005------------DTmin-ID:NHYD--------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    DESIGN NASHYD         1.0 01:East_2        25.45     .079 No_date   2:23     2.73 .109     .000
       [CN= 66.0: N= 3.00: Tp=  .97]
#*************************************************************************
# STORMS
#*************************************************************************
   ** END OF RUN :    1
************************************************************************************************

 RUN#:COMMAND#
R0002:C00001------------------------------------------------------------------------------------
      START
       [TZERO =      .00 hrs on       0]
       [METOUT=   2     (1=imperial, 2=metric output)]
       [NSTORM=   1 ]
       [NRUN  = 0002 ]
#*************************************************************************
#  SWMHYMO Ver:5.500/Feb 2015 / INPUT DATA FILE
#*************************************************************************
#  Project Name  : [Caivan Stittsville West properties]
#  Project Number: [2267]
#  Date          : [2023/11/27]
#  Modeller      : [PP]
#  Company       : J.F. Sabourin and Associates
#  License #     : 2549237
#*************************************************************************
R0002:C00002------------------------------------------------------------------------------------
      READ STORM
       Filename = storm.001
       Comment  = CHICAGO STORM 2 Year, 3 Hours
       [SDT=10.00:SDUR=   3.00:PTOT=  31.86]
R0002:C00003------------------------------------------------------------------------------------
      DEFAULT VALUES
       Filename = C:\Temp\P2267-Stittsville FSR\20231127-Pre-Dev SWMHYMO\Ottawa.val
       ICASEdv  = 1 (read and print data)
       FileTitle= File comment: [Parameters for City of Ottawa Projects]
                  THE FOLLOWING PARAMETERS ARE USED IN THE DESIGN STANDHYD COM
       Horton's infiltration equation parameters:
       [Fo= 76.20 mm/hr] [Fc=13.20 mm/hr] [DCAY= 4.14 /hr] [F=  .00 mm]
       Parameters for PERVIOUS surfaces in STANDHYD:
       [IAper=   4.67 mm] [LGP=40.00 m] [MNP= .250]
       Parameters for IMPERVIOUS surfaces in STANDHYD:
       [IAimp=   1.57 mm] [CLI= 1.50]   [MNI= .013]
       Parameters used in NASHYD:
       [Ia=   4.67 mm] [N= 3.00]
       Average monthly Pan Evaporation data in    (mm)
    JAN   FEB   MAR   APR   MAY   JUN   JUL   AUG   SEP   OCT   NOV   DEC
   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00
       Average monthly Potential Evapotranspiration in    (mm)
    JAN   FEB   MAR   APR   MAY   JUN   JUL   AUG   SEP   OCT   NOV   DEC
   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00
#*************************************************************************
# Pre Development Condition
#*************************************************************************
# West Area
R0002:C00004------------DTmin-ID:NHYD--------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    DESIGN NASHYD         1.0 01:West_1        36.15     .138 No_date   2:42     3.90 .122     .000
       [CN= 61.0: N= 3.00: Tp= 1.23]
#*************************************************************************
# East Area
R0002:C00005------------DTmin-ID:NHYD--------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    DESIGN NASHYD         1.0 01:East_2        25.45     .137 No_date   2:20     4.68 .147     .000
       [CN= 66.0: N= 3.00: Tp=  .97]
#*************************************************************************
# STORMS
#*************************************************************************
   ** END OF RUN :    4
************************************************************************************************

 RUN#:COMMAND#
R0001:C00001------------------------------------------------------------------------------------
      START
       [TZERO =      .00 hrs on       0]
       [METOUT=   2     (1=imperial, 2=metric output)]
       [NSTORM=   1 ]
       [NRUN  = 0003 ]
R0001:C00002------------------------------------------------------------------------------------
      READ STORM
       Filename = storm.001
       Comment  = CHICAGO STORM 10 Year, 3 Hours
       [SDT=10.00:SDUR=   3.00:PTOT=  49.50]
R0001:C00003------------------------------------------------------------------------------------
      DEFAULT VALUES
       Filename = C:\Temp\P2267-Stittsville FSR\20231127-Pre-Dev SWMHYMO\Ottawa.val
       ICASEdv  = 1 (read and print data)
       FileTitle= File comment: [Parameters for City of Ottawa Projects]
                  THE FOLLOWING PARAMETERS ARE USED IN THE DESIGN STANDHYD COM
       Horton's infiltration equation parameters:
       [Fo= 76.20 mm/hr] [Fc=13.20 mm/hr] [DCAY= 4.14 /hr] [F=  .00 mm]
       Parameters for PERVIOUS surfaces in STANDHYD:
       [IAper=   4.67 mm] [LGP=40.00 m] [MNP= .250]
       Parameters for IMPERVIOUS surfaces in STANDHYD:
       [IAimp=   1.57 mm] [CLI= 1.50]   [MNI= .013]
       Parameters used in NASHYD:
       [Ia=   4.67 mm] [N= 3.00]
       Average monthly Pan Evaporation data in    (mm)
    JAN   FEB   MAR   APR   MAY   JUN   JUL   AUG   SEP   OCT   NOV   DEC
   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00
       Average monthly Potential Evapotranspiration in    (mm)
    JAN   FEB   MAR   APR   MAY   JUN   JUL   AUG   SEP   OCT   NOV   DEC
   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00
#*************************************************************************
# Pre Development Condition
#*************************************************************************
# West Area
R0010:C00004------------DTmin-ID:NHYD--------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    DESIGN NASHYD         1.0 01:West_1        36.15     .190 No_date   2:18     5.70 .147     .000
       [CN= 61.0: N= 3.00: Tp= 1.23]
#*************************************************************************
# East Area
R0010:C00005------------DTmin-ID:NHYD--------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    DESIGN NASHYD         1.0 01:East_2        25.45     .189 No_date   2:17     6.53 .169     .000
       [CN= 66.0: N= 3.00: Tp=  .97]
#*************************************************************************
# STORMS
#*************************************************************************
   ** END OF RUN :    9
************************************************************************************************


 RUN#:COMMAND#
R0010:C00001------------------------------------------------------------------------------------
      START
       [TZERO =      .00 hrs on       0]
       [METOUT=   2     (1=imperial, 2=metric output)]
       [NSTORM=   1 ]
       [NRUN  = 0010 ]
#*************************************************************************
#  SWMHYMO Ver:5.500/Feb 2015 / INPUT DATA FILE
#*************************************************************************
#  Project Name  : [Caivan Stittsville West properties]
#  Project Number: [2267]
#  Date          : [2023/11/27]
#  Modeller      : [PP]
#  Company       : J.F. Sabourin and Associates
#  License #     : 2549237
#*************************************************************************
R0010:C00002------------------------------------------------------------------------------------
      READ STORM
       Filename = storm.001
       Comment  = CHICAGO STORM 10 Year, 3 Hours
       [SDT=10.00:SDUR=   3.00:PTOT=  49.50]
R0010:C00003------------------------------------------------------------------------------------
      DEFAULT VALUES
       Filename = C:\Temp\P2267-Stittsville FSR\20231127-Pre-Dev SWMHYMO\Ottawa.val
       ICASEdv  = 1 (read and print data)
       FileTitle= File comment: [Parameters for City of Ottawa Projects]
                  THE FOLLOWING PARAMETERS ARE USED IN THE DESIGN STANDHYD COM
       Horton's infiltration equation parameters:
       [Fo= 76.20 mm/hr] [Fc=13.20 mm/hr] [DCAY= 4.14 /hr] [F=  .00 mm]
       Parameters for PERVIOUS surfaces in STANDHYD:
       [IAper=   4.67 mm] [LGP=40.00 m] [MNP= .250]
       Parameters for IMPERVIOUS surfaces in STANDHYD:
       [IAimp=   1.57 mm] [CLI= 1.50]   [MNI= .013]
       Parameters used in NASHYD:
       [Ia=   4.67 mm] [N= 3.00]
       Average monthly Pan Evaporation data in    (mm)
    JAN   FEB   MAR   APR   MAY   JUN   JUL   AUG   SEP   OCT   NOV   DEC
   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00
       Average monthly Potential Evapotranspiration in    (mm)
    JAN   FEB   MAR   APR   MAY   JUN   JUL   AUG   SEP   OCT   NOV   DEC
   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00
#*************************************************************************
# Pre Development Condition
#*************************************************************************
# West Area
R0010:C00004------------DTmin-ID:NHYD--------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    DESIGN NASHYD         1.0 01:West_1        36.15     .347 No_date   2:38     9.70 .196     .000
       [CN= 61.0: N= 3.00: Tp= 1.23]
#*************************************************************************
# East Area
R0010:C00005------------DTmin-ID:NHYD--------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    DESIGN NASHYD         1.0 01:East_2        25.45     .342 No_date   2:16    11.44 .231     .000
       [CN= 66.0: N= 3.00: Tp=  .97]
#*************************************************************************
# STORMS
#*************************************************************************
   ** END OF RUN :   24


 RUN#:COMMAND#
R0025:C00001------------------------------------------------------------------------------------
      START
       [TZERO =      .00 hrs on       0]
       [METOUT=   2     (1=imperial, 2=metric output)]
       [NSTORM=   1 ]
       [NRUN  = 0025 ]
#*************************************************************************
#  SWMHYMO Ver:5.500/Feb 2015 / INPUT DATA FILE
#*************************************************************************
#  Project Name  : [Caivan Stittsville West properties]
#  Project Number: [2267]
#  Date          : [2023/11/27]
#  Modeller      : [PP]
#  Company       : J.F. Sabourin and Associates
#  License #     : 2549237
#*************************************************************************
R0025:C00002------------------------------------------------------------------------------------
      READ STORM
       Filename = storm.001
       Comment  = CHICAGO STORM  25 Year, 3 Hours
       [SDT=10.00:SDUR=   3.00:PTOT=  58.23]
R0025:C00003------------------------------------------------------------------------------------
      DEFAULT VALUES
       Filename = C:\Temp\P2267-Stittsville FSR\20231127-Pre-Dev SWMHYMO\Ottawa.val
       ICASEdv  = 1 (read and print data)
       FileTitle= File comment: [Parameters for City of Ottawa Projects]
                  THE FOLLOWING PARAMETERS ARE USED IN THE DESIGN STANDHYD COM
       Horton's infiltration equation parameters:
       [Fo= 76.20 mm/hr] [Fc=13.20 mm/hr] [DCAY= 4.14 /hr] [F=  .00 mm]
       Parameters for PERVIOUS surfaces in STANDHYD:
       [IAper=   4.67 mm] [LGP=40.00 m] [MNP= .250]
       Parameters for IMPERVIOUS surfaces in STANDHYD:
       [IAimp=   1.57 mm] [CLI= 1.50]   [MNI= .013]
       Parameters used in NASHYD:
       [Ia=   4.67 mm] [N= 3.00]
       Average monthly Pan Evaporation data in    (mm)
    JAN   FEB   MAR   APR   MAY   JUN   JUL   AUG   SEP   OCT   NOV   DEC
   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00
       Average monthly Potential Evapotranspiration in    (mm)
    JAN   FEB   MAR   APR   MAY   JUN   JUL   AUG   SEP   OCT   NOV   DEC
   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00
#*************************************************************************
# Pre Development Condition
#*************************************************************************
# West Area
R0025:C00004------------DTmin-ID:NHYD--------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    DESIGN NASHYD         1.0 01:West_1        36.15     .477 No_date   2:36    13.28 .228     .000
       [CN= 61.0: N= 3.00: Tp= 1.23]
#*************************************************************************
# East Area
```

```
00361> R0025:C00005------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00362>      DESIGN NASHYD          1.0 01:East_2        25.45     .468 No_date   2:15   15.55 .267     .000
00363>        [CN= 66.0: N= 3.00: Tp=  .97]
00364> ##############################################################################
00365> # STORMS
00366> ##############################################################################
00367>   ** END OF RUN :   49
00368>
00369> ********************************************************************************************************
00370>
00371>
00372>
00373>
00374>
00375>  RUN#:COMMAND#
00376> R0050:C00001------------------------------------------------------------------------------------------
00377>       START
00378>        [TZERO =    .00 hrs on        0]
00379>        [METOUT=   2    (1=imperial, 2=metric output)]
00380>        [NSTORM=   1 ]
00381>        [NRUN  = 0050 ]
00382> ******************************************************************************
00383> #  SWMHYMO Ver:5.500/Feb 2015 / INPUT DATA FILE
00384> ******************************************************************************
00385> #  Project Name  : [Caivan Stittsville West properties]
00386> #  Project Number: [2267]
00387> #  Date          : [2023/11/27]
00388> #  Modeller      : [PP]
00389> #  Company       : J.F. Sabourin and Associates
00390> #  License #     : 2549237
00391> ******************************************************************************
00392> R0050:C00002------------------------------------------------------------------------------------------
00393>       READ STORM
00394>        Filename = storm.001
00395>        Comment  = CHICAGO STORM  50 Year, 3 Hours
00396>        [SDT=10.00:SDUR=   3.00:PTOT=  64.81]
00397> R0050:C00003------------------------------------------------------------------------------------------
00398>       DEFAULT VALUES
00399>        Filename = C:\Temp\P2267-Stittsville FSR\20231127-Pre-Dev SWMHYMO\Ottawa.val
00400>        ICASEdv  = 1 (read and print data)
00401>        FileTitle= File comment: [Parameters for City of Ottawa Projects]
00402>                   THE FOLLOWING PARAMETERS ARE USED IN THE DESIGN STANDHYD COM
00403>        Horton's infiltration equation parameters:
00404>        [Fo= 76.20 mm/hr] [Fc=13.20 mm/hr] [DCAY= 4.14 /hr] [F=  .00 mm]
00405>        Parameters for PERVIOUS surfaces in STANDHYD:
00406>        [IAper=   4.67 mm] [LGP=40.00 m] [MNP= .250]
00407>        Parameters for IMPERVIOUS surfaces in STANDHYD:
00408>        [IAimp=   1.57 mm] [CLI= 1.50]   [MNI= .013]
00409>        Parameters used in NASHYD:
00410>        [Ia=   4.67 mm] [N= 3.00]
00411>        Average monthly Pan Evaporation data in    (mm)
00412>     JAN   FEB   MAR   APR   MAY   JUN   JUL   AUG   SEP   OCT   NOV   DEC
00413>    .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00
00414>        Average monthly Potential Evapotranspiration in    (mm)
00415>     JAN   FEB   MAR   APR   MAY   JUN   JUL   AUG   SEP   OCT   NOV   DEC
00416>    .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00
00417> ##############################################################################
00418> # Pre Development Condition
00419> ##############################################################################
00420> # West Area
00421> R0050:C00004------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00422>      DESIGN NASHYD          1.0 01:West_1        36.15     .585 No_date   2:35   16.25 .251     .000
00423>        [CN= 61.0: N= 3.00: Tp= 1.23]
00424> ##############################################################################
00425> # East Area
00426> R0050:C00005------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00427>      DESIGN NASHYD          1.0 01:East_2        25.45     .572 No_date   2:14   18.94 .292     .000
00428>        [CN= 66.0: N= 3.00: Tp=  .97]
00429> ##############################################################################
00430> # STORMS
00431> ##############################################################################
00432>   ** END OF RUN :   98
00433>
00434> ********************************************************************************************************
00435>
00436>
00437>
00438>
00439>
00440>  RUN#:COMMAND#
00441> R0099:C00001------------------------------------------------------------------------------------------
00442>       START
00443>        [TZERO =    .00 hrs on        0]
00444>        [METOUT=   2    (1=imperial, 2=metric output)]
00445>        [NSTORM=   1 ]
00446>        [NRUN  = 0099 ]
00447> ******************************************************************************
00448> #  SWMHYMO Ver:5.500/Feb 2015 / INPUT DATA FILE
00449> ******************************************************************************
00450> #  Project Name  : [Caivan Stittsville West properties]
00451> #  Project Number: [2267]
00452> #  Date          : [2023/11/27]
00453> #  Modeller      : [PP]
00454> #  Company       : J.F. Sabourin and Associates
00455> #  License #     : 2549237
00456> ******************************************************************************
00457> R0099:C00002------------------------------------------------------------------------------------------
00458>       READ STORM
00459>        Filename = storm.001
00460>        Comment  = CHICAGO STORM   100 Year, 3 Hours
00461>        [SDT=10.00:SDUR=   3.00:PTOT=  71.66]
00462> R0099:C00003------------------------------------------------------------------------------------------
00463>       DEFAULT VALUES
00464>        Filename = C:\Temp\P2267-Stittsville FSR\20231127-Pre-Dev SWMHYMO\Ottawa.val
00465>        ICASEdv  = 1 (read and print data)
00466>        FileTitle= File comment: [Parameters for City of Ottawa Projects]
00467>                   THE FOLLOWING PARAMETERS ARE USED IN THE DESIGN STANDHYD COM
00468>        Horton's infiltration equation parameters:
00469>        [Fo= 76.20 mm/hr] [Fc=13.20 mm/hr] [DCAY= 4.14 /hr] [F=  .00 mm]
00470>        Parameters for PERVIOUS surfaces in STANDHYD:
00471>        [IAper=   4.67 mm] [LGP=40.00 m] [MNP= .250]
00472>        Parameters for IMPERVIOUS surfaces in STANDHYD:
00473>        [IAimp=   1.57 mm] [CLI= 1.50]   [MNI= .013]
00474>        Parameters used in NASHYD:
00475>        [Ia=   4.67 mm] [N= 3.00]
00476>        Average monthly Pan Evaporation data in    (mm)
00477>     JAN   FEB   MAR   APR   MAY   JUN   JUL   AUG   SEP   OCT   NOV   DEC
00478>    .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00
00479>        Average monthly Potential Evapotranspiration in    (mm)
00480>     JAN   FEB   MAR   APR   MAY   JUN   JUL   AUG   SEP   OCT   NOV   DEC
00481>    .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00
00482> ##############################################################################
00483> # Pre Development Condition
00484> ##############################################################################
00485> # West Area
00486> R0099:C00004------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00487>      DESIGN NASHYD          1.0 01:West_1        36.15     .706 No_date   2:35   19.57 .273     .000
00488>        [CN= 61.0: N= 3.00: Tp= 1.23]
00489> ##############################################################################
00490> # East Area
00491> R0099:C00005------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00492>      DESIGN NASHYD          1.0 01:East_2        25.45     .688 No_date   2:14   22.69 .317     .000
00493>        [CN= 66.0: N= 3.00: Tp=  .97]
00494> ##############################################################################
00495> # STORMS
00496> ##############################################################################
00497>   ** END OF RUN :  101
00498>
00499> ********************************************************************************************************
00500>
00501>
00502>
00503>
00504>
00505>  RUN#:COMMAND#
00506> R0102:C00001------------------------------------------------------------------------------------------
00507>       START
00508>        [TZERO =    .00 hrs on        0]
00509>        [METOUT=   2    (1=imperial, 2=metric output)]
00510>        [NSTORM=   1 ]
00511>        [NRUN  = 0102 ]
00512> ******************************************************************************
00513> #  SWMHYMO Ver:5.500/Feb 2015 / INPUT DATA FILE
00514> ******************************************************************************
00515> #  Project Name  : [Caivan Stittsville West properties]
00516> #  Project Number: [2267]
00517> #  Date          : [2023/11/27]
00518> #  Modeller      : [PP]
00519> #  Company       : J.F. Sabourin and Associates
00520> #  License #     : 2549237
00521> ******************************************************************************
00522> R0102:C00002------------------------------------------------------------------------------------------
00523>       READ STORM
00524>        Filename = storm.001
00525>        Comment  = 2 years SCS Type 2 Storm 24 Hours step 10 min, City of Ottawa
00526>        [SDT=10.00:SDUR=  24.00:PTOT=  48.46]
00527> R0102:C00003------------------------------------------------------------------------------------------
00528>       DEFAULT VALUES
00529>        Filename = C:\Temp\P2267-Stittsville FSR\20231127-Pre-Dev SWMHYMO\Ottawa.val
00530>        ICASEdv  = 1 (read and print data)
00531>        FileTitle= File comment: [Parameters for City of Ottawa Projects]
00532>                   THE FOLLOWING PARAMETERS ARE USED IN THE DESIGN STANDHYD COM
00533>        Horton's infiltration equation parameters:
00534>        [Fo= 76.20 mm/hr] [Fc=13.20 mm/hr] [DCAY= 4.14 /hr] [F=  .00 mm]
00535>        Parameters for PERVIOUS surfaces in STANDHYD:
00536>        [IAper=   4.67 mm] [LGP=40.00 m] [MNP= .250]
00537>        Parameters for IMPERVIOUS surfaces in STANDHYD:
00538>        [IAimp=   1.57 mm] [CLI= 1.50]   [MNI= .013]
00539>        Parameters used in NASHYD:
00540>        [Ia=   4.67 mm] [N= 3.00]
00541>        Average monthly Pan Evaporation data in    (mm)
00542>     JAN   FEB   MAR   APR   MAY   JUN   JUL   AUG   SEP   OCT   NOV   DEC
00543>    .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00
00544>        Average monthly Potential Evapotranspiration in    (mm)
00545>     JAN   FEB   MAR   APR   MAY   JUN   JUL   AUG   SEP   OCT   NOV   DEC
00546>    .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00
00547> ##############################################################################
00548> # Pre Development Condition
00549> ##############################################################################
00550> # West Area
00551> R0102:C00004------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00552>      DESIGN NASHYD          1.0 01:West_1        36.15     .218 No_date   13:20    9.30 .192     .000
00553>        [CN= 61.0: N= 3.00: Tp= 1.23]
00554> ##############################################################################
00555> # East Area
00556> R0102:C00005------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00557>      DESIGN NASHYD          1.0 01:East_2        25.45     .218 No_date   13:01   10.98 .227     .000
00558>        [CN= 66.0: N= 3.00: Tp=  .97]
00559> ##############################################################################
00560> # STORMS
00561> ##############################################################################
00562>   ** END OF RUN :  104
00563>
00564> ********************************************************************************************************
00565>
00566>
00567>
00568>
00569>
00570>  RUN#:COMMAND#
00571> R0105:C00001------------------------------------------------------------------------------------------
00572>       START
00573>        [TZERO =    .00 hrs on        0]
00574>        [METOUT=   2    (1=imperial, 2=metric output)]
00575>        [NSTORM=   1 ]
00576>        [NRUN  = 0105 ]
00577> ******************************************************************************
00578> #  SWMHYMO Ver:5.500/Feb 2015 / INPUT DATA FILE
00579> ******************************************************************************
00580> #  Project Name  : [Caivan Stittsville West properties]
00581> #  Project Number: [2267]
00582> #  Date          : [2023/11/27]
00583> #  Modeller      : [PP]
00584> #  Company       : J.F. Sabourin and Associates
00585> #  License #     : 2549237
00586> ******************************************************************************
00587> R0105:C00002------------------------------------------------------------------------------------------
00588>       READ STORM
00589>        Filename = storm.001
00590>        Comment  = 5 years SCS Type 2 Storm 24 Hours step 10 min, City of Ottawa
00591>        [SDT=10.00:SDUR=  24.00:PTOT=  64.11]
00592> R0105:C00003------------------------------------------------------------------------------------------
00593>       DEFAULT VALUES
00594>        Filename = C:\Temp\P2267-Stittsville FSR\20231127-Pre-Dev SWMHYMO\Ottawa.val
00595>        ICASEdv  = 1 (read and print data)
00596>        FileTitle= File comment: [Parameters for City of Ottawa Projects]
00597>                   THE FOLLOWING PARAMETERS ARE USED IN THE DESIGN STANDHYD COM
00598>        Horton's infiltration equation parameters:
00599>        [Fo= 76.20 mm/hr] [Fc=13.20 mm/hr] [DCAY= 4.14 /hr] [F=  .00 mm]
00600>        Parameters for PERVIOUS surfaces in STANDHYD:
00601>        [IAper=   4.67 mm] [LGP=40.00 m] [MNP= .250]
00602>        Parameters for IMPERVIOUS surfaces in STANDHYD:
00603>        [IAimp=   1.57 mm] [CLI= 1.50]   [MNI= .013]
00604>        Parameters used in NASHYD:
00605>        [Ia=   4.67 mm] [N= 3.00]
00606>        Average monthly Pan Evaporation data in    (mm)
00607>     JAN   FEB   MAR   APR   MAY   JUN   JUL   AUG   SEP   OCT   NOV   DEC
00608>    .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00
00609>        Average monthly Potential Evapotranspiration in    (mm)
00610>     JAN   FEB   MAR   APR   MAY   JUN   JUL   AUG   SEP   OCT   NOV   DEC
00611>    .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00
00612> ##############################################################################
00613> # Pre Development Condition
00614> ##############################################################################
00615> # West Area
00616> R0105:C00004------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00617>      DESIGN NASHYD          1.0 01:West_1        36.15     .379 No_date   13:19   15.92 .248     .000
00618>        [CN= 61.0: N= 3.00: Tp= 1.23]
00619> ##############################################################################
00620> # East Area
00621> R0105:C00005------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00622>      DESIGN NASHYD          1.0 01:East_2        25.45     .375 No_date   13:00   18.56 .290     .000
00623>        [CN= 66.0: N= 3.00: Tp=  .97]
00624> ##############################################################################
00625> # STORMS
00626> ##############################################################################
00627>   ** END OF RUN :  109
00628>
00629> ********************************************************************************************************
00630>
00631>
00632>
00633>
00634>
00635>  RUN#:COMMAND#
00636> R0110:C00001------------------------------------------------------------------------------------------
00637>       START
00638>        [TZERO =    .00 hrs on        0]
00639>        [METOUT=   2    (1=imperial, 2=metric output)]
00640>        [NSTORM=   1 ]
00641>        [NRUN  = 0110 ]
00642> ******************************************************************************
00643> #  SWMHYMO Ver:5.500/Feb 2015 / INPUT DATA FILE
00644> ******************************************************************************
00645> #  Project Name  : [Caivan Stittsville West properties]
00646> #  Project Number: [2267]
00647> #  Date          : [2023/11/27]
00648> #  Modeller      : [PP]
00649> #  Company       : J.F. Sabourin and Associates
00650> #  License #     : 2549237
00651> ******************************************************************************
00652> R0110:C00002------------------------------------------------------------------------------------------
00653>       READ STORM
00654>        Filename = storm.001
00655>        Comment  = 10 years SCS Type 2 Storm 24 Hours step 10 min, City of Ottawa
00656>        [SDT=10.00:SDUR=  24.00:PTOT=  74.35]
00657> R0110:C00003------------------------------------------------------------------------------------------
00658>       DEFAULT VALUES
00659>        Filename = C:\Temp\P2267-Stittsville FSR\20231127-Pre-Dev SWMHYMO\Ottawa.val
00660>        ICASEdv  = 1 (read and print data)
00661>        FileTitle= File comment: [Parameters for City of Ottawa Projects]
00662>                   THE FOLLOWING PARAMETERS ARE USED IN THE DESIGN STANDHYD COM
00663>        Horton's infiltration equation parameters:
00664>        [Fo= 76.20 mm/hr] [Fc=13.20 mm/hr] [DCAY= 4.14 /hr] [F=  .00 mm]
00665>        Parameters for PERVIOUS surfaces in STANDHYD:
00666>        [IAper=   4.67 mm] [LGP=40.00 m] [MNP= .250]
00667>        Parameters for IMPERVIOUS surfaces in STANDHYD:
00668>        [IAimp=   1.57 mm] [CLI= 1.50]   [MNI= .013]
00669>        Parameters used in NASHYD:
00670>        [Ia=   4.67 mm] [N= 3.00]
00671>        Average monthly Pan Evaporation data in    (mm)
00672>     JAN   FEB   MAR   APR   MAY   JUN   JUL   AUG   SEP   OCT   NOV   DEC
00673>    .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00
00674>        Average monthly Potential Evapotranspiration in    (mm)
00675>     JAN   FEB   MAR   APR   MAY   JUN   JUL   AUG   SEP   OCT   NOV   DEC
00676>    .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00
00677> ##############################################################################
00678> # Pre Development Condition
00679> ##############################################################################
00680> # West Area
00681> R0110:C00004------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00682>      DESIGN NASHYD          1.0 01:West_1        36.15     .501 No_date   13:18   20.92 .281     .000
00683>        [CN= 61.0: N= 3.00: Tp= 1.23]
00684> ##############################################################################
00685> # East Area
00686> R0110:C00005------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00687>      DESIGN NASHYD          1.0 01:East_2        25.45     .493 No_date   12:59   24.21 .326     .000
00688>        [CN= 66.0: N= 3.00: Tp=  .97]
00689> ##############################################################################
00690> # STORMS
00691> ##############################################################################
00692>   ** END OF RUN :  124
00693>
00694> ********************************************************************************************************
00695>
00696>
00697>
00698>
00699>
00700>  RUN#:COMMAND#
00701> R0125:C00001------------------------------------------------------------------------------------------
00702>       START
00703>        [TZERO =    .00 hrs on        0]
00704>        [METOUT=   2    (1=imperial, 2=metric output)]
00705>        [NSTORM=   1 ]
00706>        [NRUN  = 0125 ]
00707> ******************************************************************************
00708> #  SWMHYMO Ver:5.500/Feb 2015 / INPUT DATA FILE
00709> ******************************************************************************
00710> #  Project Name  : [Caivan Stittsville West properties]
00711> #  Project Number: [2267]
00712> #  Date          : [2023/11/27]
00713> #  Modeller      : [PP]
00714> #  Company       : J.F. Sabourin and Associates
00715> #  License #     : 2549237
00716> ******************************************************************************
00717> R0125:C00002------------------------------------------------------------------------------------------
00718>       READ STORM
00719>        Filename = storm.001
00720>        Comment  = 25 years SCS Type 2 Storm 24 Hours step 10 min, City of Ottawa
```

DRAFT

```
00721>       [SDT=10.00:SDUR=  24.00:PTOT=  86.89]
00722> R0125:C00003------------------------------------------------------------------------------------------
00723>      DEFAULT VALUES
00724>       Filename = C:\Temp\P2267-Stittsville FSR\20231127-Pre-Dev SWMHYMO\Ottawa.val
00725>       ICASEdv  = 1 (read and print data)
00726>       FileTitle= File comment: [Parameters for City of Ottawa Projects]
00727>                  THE FOLLOWING PARAMETERS ARE USED IN THE DESIGN STANDHYD COM
00728>       Horton's infiltration equation parameters:
00729>       [Fo= 76.20 mm/hr] [Fc=13.20 mm/hr] [DCAY= 4.14 /hr] [F=  .00 mm]
00730>       Parameters for PERVIOUS surfaces in STANDHYD:
00731>       [IAper=   4.67 mm] [LGP=40.00 m] [MNP= .250]
00732>       Parameters for IMPERVIOUS surfaces in STANDHYD:
00733>       [IAimp=   1.57 mm] [CLI= 1.50]   [MNI= .013]
00734>       Parameters used in NASHYD:
00735>       [Ia=   4.67 mm] [N= 3.00]
00736>       Average monthly Pan Evaporation data in    (mm)
00737>    JAN   FEB   MAR   APR   MAY   JUN   JUL   AUG   SEP   OCT   NOV   DEC
00738>   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00
00739>       Average monthly Potential Evapotranspiration in    (mm)
00740>    JAN   FEB   MAR   APR   MAY   JUN   JUL   AUG   SEP   OCT   NOV   DEC
00741>   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00
00742> ##############################################################################
00743> # Pre Development Condition
00744> ##############################################################################
00745> # West Area
00746> R0125:C00004------------DTmin-ID:NHYD--------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00747>      DESIGN NASHYD         1.0 01:West_1        36.15     .667 No_date   13:17   27.63 .318     .000
00748>       [CN= 61.0: N= 3.00: Tp= 1.23]
00749> ##############################################################################
00750> # East Area
00751> R0125:C00005------------DTmin-ID:NHYD--------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00752>      DESIGN NASHYD         1.0 01:East_2        25.45     .651 No_date   12:59   31.72 .365     .000
00753>       [CN= 66.0: N= 3.00: Tp=  .97]
00754> ##############################################################################
00755> # STORMS
00756> ##############################################################################
00757>   ** END OF RUN :  149
00758>
00759> ******************************************************************************************************
00760>
00761>
00762>
00763>
00764>
00765>  RUN#:COMMAND#
00766> R0150:C00001------------------------------------------------------------------------------------------
00767>      START
00768>       [TZERO =    .00 hrs on       0]
00769>       [METOUT=   2    (1=imperial, 2=metric output)]
00770>       [NSTORM=   1 ]
00771>       [NRUN  = 0150 ]
00772> ##############################################################################
00773> #  SWMHYMO Ver:5.500/Feb 2015 / INPUT DATA FILE
00774> ##############################################################################
00775> #  Project Name  : [Caivan Stittsville West properties]
00776> #  Project Number: [2267]
00777> #  Date          : [2023/11/27]
00778> #  Modeller      : [PP]
00779> #  Company       : J.F. Sabourin and Associates
00780> #  License #     : 2549237
00781> ##############################################################################
00782> R0150:C00002------------------------------------------------------------------------------------------
00783>      READ STORM
00784>       Filename = storm.001
00785>       Comment  = 50 years SCS Type 2 Storm 24 Hours step 10 min, City of Ottawa
00786>       [SDT=10.00:SDUR=  24.00:PTOT=  96.53]
00787> R0150:C00003------------------------------------------------------------------------------------------
00788>      DEFAULT VALUES
00789>       Filename = C:\Temp\P2267-Stittsville FSR\20231127-Pre-Dev SWMHYMO\Ottawa.val
00790>       ICASEdv  = 1 (read and print data)
00791>       FileTitle= File comment: [Parameters for City of Ottawa Projects]
00792>                  THE FOLLOWING PARAMETERS ARE USED IN THE DESIGN STANDHYD COM
00793>       Horton's infiltration equation parameters:
00794>       [Fo= 76.20 mm/hr] [Fc=13.20 mm/hr] [DCAY= 4.14 /hr] [F=  .00 mm]
00795>       Parameters for PERVIOUS surfaces in STANDHYD:
00796>       [IAper=   4.67 mm] [LGP=40.00 m] [MNP= .250]
00797>       Parameters for IMPERVIOUS surfaces in STANDHYD:
00798>       [IAimp=   1.57 mm] [CLI= 1.50]   [MNI= .013]
00799>       Parameters used in NASHYD:
00800>       [Ia=   4.67 mm] [N= 3.00]
00801>       Average monthly Pan Evaporation data in    (mm)
00802>    JAN   FEB   MAR   APR   MAY   JUN   JUL   AUG   SEP   OCT   NOV   DEC
00803>   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00
00804>       Average monthly Potential Evapotranspiration in    (mm)
00805>    JAN   FEB   MAR   APR   MAY   JUN   JUL   AUG   SEP   OCT   NOV   DEC
00806>   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00
00807> ##############################################################################
00808> # Pre Development Condition
00809> ##############################################################################
00810> # West Area
00811> R0150:C00004------------DTmin-ID:NHYD--------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00812>      DESIGN NASHYD         1.0 01:West_1        36.15     .805 No_date   13:17   33.19 .344     .000
00813>       [CN= 61.0: N= 3.00: Tp= 1.23]
00814> ##############################################################################
00815> # East Area
00816> R0150:C00005------------DTmin-ID:NHYD--------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00817>      DESIGN NASHYD         1.0 01:East_2        25.45     .781 No_date   12:58   37.89 .393     .000
00818>       [CN= 66.0: N= 3.00: Tp=  .97]
00819> ##############################################################################
00820> # STORMS
00821> ##############################################################################
00822>   ** END OF RUN :  198
00823>
00824> ******************************************************************************************************
00825>
00826>
00827>
00828>
00829>
00830>  RUN#:COMMAND#
00831> R0199:C00001------------------------------------------------------------------------------------------
00832>      START
00833>       [TZERO =    .00 hrs on       0]
00834>       [METOUT=   2    (1=imperial, 2=metric output)]
00835>       [NSTORM=   1 ]
00836>       [NRUN  = 0199 ]
00837> ##############################################################################
00838> #  SWMHYMO Ver:5.500/Feb 2015 / INPUT DATA FILE
00839> ##############################################################################
00840> #  Project Name  : [Caivan Stittsville West properties]
00841> #  Project Number: [2267]
00842> #  Date          : [2023/11/27]
00843> #  Modeller      : [PP]
00844> #  Company       : J.F. Sabourin and Associates
00845> #  License #     : 2549237
00846> ##############################################################################
00847> R0199:C00002------------------------------------------------------------------------------------------
00848>      READ STORM
00849>       Filename = storm.001
00850>       Comment  = 100 years SCS Type 2 Storm 24 Hours step 10 min, City of Ottawa
00851>       [SDT=10.00:SDUR=  24.00:PTOT= 106.73]
00852> R0199:C00003------------------------------------------------------------------------------------------
00853>      DEFAULT VALUES
00854>       Filename = C:\Temp\P2267-Stittsville FSR\20231127-Pre-Dev SWMHYMO\Ottawa.val
00855>       ICASEdv  = 1 (read and print data)
00856>       FileTitle= File comment: [Parameters for City of Ottawa Projects]
00857>                  THE FOLLOWING PARAMETERS ARE USED IN THE DESIGN STANDHYD COM
00858>       Horton's infiltration equation parameters:
00859>       [Fo= 76.20 mm/hr] [Fc=13.20 mm/hr] [DCAY= 4.14 /hr] [F=  .00 mm]
00860>       Parameters for PERVIOUS surfaces in STANDHYD:
00861>       [IAper=   4.67 mm] [LGP=40.00 m] [MNP= .250]
00862>       Parameters for IMPERVIOUS surfaces in STANDHYD:
00863>       [IAimp=   1.57 mm] [CLI= 1.50]   [MNI= .013]
00864>       Parameters used in NASHYD:
00865>       [Ia=   4.67 mm] [N= 3.00]
00866>       Average monthly Pan Evaporation data in    (mm)
00867>    JAN   FEB   MAR   APR   MAY   JUN   JUL   AUG   SEP   OCT   NOV   DEC
00868>   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00
00869>       Average monthly Potential Evapotranspiration in    (mm)
00870>    JAN   FEB   MAR   APR   MAY   JUN   JUL   AUG   SEP   OCT   NOV   DEC
00871>   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00
00872> ##############################################################################
00873> # Pre Development Condition
00874> ##############################################################################
00875> # West Area
00876> R0199:C00004------------DTmin-ID:NHYD--------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00877>      DESIGN NASHYD         1.0 01:West_1        36.15     .960 No_date   13:17   39.39 .369     .000
00878>       [CN= 61.0: N= 3.00: Tp= 1.23]
00879> ##############################################################################
00880> # East Area
00881> R0199:C00005------------DTmin-ID:NHYD--------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00882>      DESIGN NASHYD         1.0 01:East_2        25.45     .926 No_date   12:58   44.72 .419     .000
00883>       [CN= 66.0: N= 3.00: Tp=  .97]
00884> ##############################################################################
00885> # STORMS
00886> ##############################################################################
00887> R0199:C00002------------------------------------------------------------------------------------------
00888>        FINISH
00889> ------------------------------------------------------------------------------------------------------
00890> ******************************************************************************************************
00891>      WARNINGS / ERRORS / NOTES
00892>      -------------------------
00893>    Simulation ended on 2023-11-28     at 09:32:39
00894> ======================================================================================================
00895>
```

DRAFT

J.F. Sabourin and Associates Inc.
52 Springbrook Drive,
Ottawa, ON K2S 1B9
T 613-836-3884 F 613-836-0332

jfsa.com

Attachment C

Proposed/Post-Development Conditions Simulations

DRAFT

West SWM Pond Preliminary Stage Storage

Elevation (m)	Volume (m^3)	Volume above PP @ 90% (m^3)	Area (m^2)	Demarcation
99.80	0.000		3020.15	Pond Bottom
99.85	154.104		3144.03	
99.90	314.431		3269.02	
99.95	481.036		3395.2	
100.00	653.980		3522.56	
100.05	833.321		3651.08	
100.10	1019.117		3780.78	
100.15	1211.428		3911.65	
100.20	1410.311		4043.7	
100.25	1615.827		4176.92	
100.30	1828.033		4311.34	
100.35	2046.989		4446.91	
100.40	2272.753		4583.66	
100.45	2505.384		4721.58	
100.50	2744.941		4860.68	
100.55	2991.481		5000.95	
100.60	3245.066		5142.42	
100.65	3505.752		5285.04	
100.70	3773.599		5428.84	
100.75	4048.665		5573.81	
100.80	4331.010		5719.96	
100.85	4620.691		5867.28	
100.90	4917.768		6015.81	
100.95	5222.300		6165.48	
101.00	5534.346		6316.33	
101.05	5853.963		6468.35	
101.10	6181.210		6621.55	
101.15	6516.147		6775.92	
101.20	6858.832		6931.49	
101.25	7209.325		7088.22	
101.30	7567.684		7246.12	
101.35	7933.966		7405.19	
101.40	8308.232		7565.44	
101.45	8690.540		7726.86	
101.50	9081.105		7895.73	
101.55	9479.858		8054.41	
101.60	9886.703		8219.4	
101.65	10301.827		8385.56	
101.70	10725.289		8552.9	
101.75	11157.147		8721.42	

DRAFT

West SWM Pond Preliminary Stage Storage

Elevation (m)	Volume (m^3)	Volume above PP @ 90% (m^3)	Area (m^2)	Demarcation
101.80	**11597.620**	**0.000**	**8897.52**	**Permanent Pool**
101.85	12045.777	403.341	9028.75	
101.90	12500.648	812.725	9166.12	
101.95	12962.407	1228.308	9304.24	
102.00	13431.091	1650.124	9443.11	
102.05	13906.737	2078.205	9582.73	
102.10	14389.542	2512.730	9729.49	
102.15	14901.470	2973.465	10747.63	
102.20	15441.536	3459.524	10854.97	
102.25	15986.982	3950.426	10962.87	
102.30	16537.839	4446.197	11071.41	
102.35	17094.139	4946.867	11180.6	
102.40	17655.912	5452.463	11290.33	
102.45	18223.191	5963.014	11400.84	
102.50	18796.007	6478.548	11511.76	
102.55	19374.387	6999.090	11623.45	
102.60	19958.368	7524.673	11735.8	
102.65	20547.977	8055.321	11848.56	
102.70	21143.245	8591.062	11962.16	
102.75	21744.207	9131.928	12076.31	
102.80	22350.889	9677.942	12190.95	
102.85	22963.324	10229.134	12306.47	
102.90	23581.551	10785.538	12422.58	
102.95	24205.591	11347.174	12539.04	
103.00	24835.475	11914.069	12656.31	
103.05	25471.239	12486.257	12774.27	
103.10	26112.912	13063.763	12892.63	
103.15	26760.520	13646.610	13011.69	
103.20	27414.100	14234.832	13131.51	
103.25	28073.683	14828.457	13251.84	
103.30	28739.300	15427.512	13372.81	
103.35	29410.982	16032.026	13494.48	
103.40	30088.758	16642.024	13616.55	
103.45	30772.660	17257.536	13739.53	
103.50	31462.724	17878.594	13863.02	
103.55	32158.978	18505.222	13987.14	
103.60	32861.450	19137.447	14111.74	
103.65	33570.173	19775.298	14237.2	
103.70	34285.182	20418.806	14363.13	
103.75	35006.502	21067.994	14489.69	

DRAFT

West SWM Pond Preliminary Stage Storage

Elevation (m)	Volume (m^3)	Volume above PP @ 90% (m^3)	Area (m^2)	Demarcation
103.80	35734.166	21722.891	14616.85	
103.85	36468.205	22383.526	14744.73	
103.90	37208.652	23049.929	14873.14	
103.95	37955.532	23722.121	15002.07	
104.00	38708.883	24400.137	15131.94	
104.05	39468.737	25084.005	15262.25	
104.10	40235.121	25773.751	15393.1	
104.15	41008.066	26469.401	15524.7	
104.20	41787.609	27170.990	15657.03	
104.25	42573.776	27878.540	15789.64	
104.30	**43366.647**	28592.124	**15925.22**	**Top of Pond**

DRAFT

Table C-1W: West Pond Criteria for Required Storage Volumes

Pond	Area [1] (ha)	Imperviousness (%)	Storage Volume for Impervious Level [2] (m^3/ha)
N/A	N/A	70	225
West SWM Pond	36.55	71	227
N/A	N/A	85	250

[1] Refer to Appendix C for drainage areas to the SWM facility.

[2] Protection Level for Wet Pond: Enhanced 80% long-term S.S. removal.
SWM Planning & Design Manual, Table 3.2, p.3-10 (March 2003).

Table C-2W: Required Storage Volumes for West SWM Facility

Pond Component	Required Volume (m^3)	Allowable Release Rate (m^3/s)
Permanent Pool (PP) [1]	6,835	-
Quality Control [2]	1,462	0.017
Forebay (20% PP)	1,367	-
PP - Forebay	5,468	-

(1) Required PP volume based on Table C-1W (227 - 40).

[2] Required quality control volume based on 40 m3/ha

[3] Quality control release rate based on 48 hour drawdown time

DRAFT

Table C-3W: Summary of West SWM - Pond Operating Characteristics

Pond Components	Pre Dev Flows[1] (m^3/s)	Pond Release Rate (m^3/s)	Pond Volume (m^3)	Preliminary Pond Water Level (m)
Permanent Pool[2]	-	-	6,835	101.80
Quality Control[3]	-	0.017	1,462	102.00
25mm 3-hr Chicago	0.079	0.079	5,296	102.40
2-year 3-hr Chicago	0.138	0.138	7,024	102.60
5-year 3-hr Chicago	0.255	0.255	9,627	102.80
10-year 3-hr Chicago	0.347	0.347	11,410	103.00
25-year 3-hr Chicago	0.477	0.477	13,670	103.20
50-year 3-hr Chicago	0.585	0.585	15,370	103.30
100-year 3-hr Chicago	0.706	0.706	17,140	103.45
2-year 24-hr SCS	0.218	0.218	8,331	102.70
5-year 24-hr SCS	0.379	0.344	11,340	102.95
10-year 24-hr SCS	0.501	0.455	13,290	103.15
25-year 24-hr SCS	0.667	0.667	15,670	103.35
50-year 24-hr SCS	0.805	0.805	17,480	103.50
100-year 24-hr SCS	0.960	0.960	19,310	103.65

(1) Target flows based on peak pre development flows

(2) Required permanent pool volume based on MOE SWMPD Manual Table 3.2, enhanced 80% TSS Removal for wet pond.

(3) Required quality control volume based on 40 m^3/ha released over 48 hours

DRAFT

Table C-4W: Summary of West SWM - Pond Operating Characteristics (Sensitivity Test)

Pond Components	Halved Pre Dev Flows[1] (m^3/s)	Pond Release Rate (m^3/s)	Pond Volume (m^3)	Preliminary Pond Water Level (m)
Permanent Pool[2]	-	-	6,835	101.80
Quality Control[3]	-	0.017	1,462	102.00
25mm 3-hr Chicago	0.040	0.040	5,561	102.45
2-year 3-hr Chicago	0.069	0.069	7,467	102.60
5-year 3-hr Chicago	0.128	0.128	10,440	102.90
10-year 3-hr Chicago	0.174	0.174	12,430	103.05
25-year 3-hr Chicago	0.239	0.239	14,920	103.30
50-year 3-hr Chicago	0.293	0.293	16,780	103.45
100-year 3-hr Chicago	0.353	0.353	18,700	103.60
2-year 24-hr SCS	0.109	0.109	9,110	102.75
5-year 24-hr SCS	0.190	0.174	12,420	103.05
10-year 24-hr SCS	0.251	0.230	14,570	103.25
25-year 24-hr SCS	0.334	0.334	17,190	103.45
50-year 24-hr SCS	0.403	0.403	19,210	103.65
100-year 24-hr SCS	0.480	0.480	21,300	103.80

(1) Target flows based on halved peak pre development flows

(2) Required permanent pool volume based on MOE SWMPD Manual Table 3.2, enhanced 80% TSS Removal for wet pond.

(3) Required quality control volume based on 40 m^3/ha released over 48 hours

DRAFT

East SWM Pond Preliminary Stage Storage

Elevation (m)	Volume (m^3)	Volume above PP @ 90% (m^3)	Area (m^2)	Demarcation
98.50	0.000		3246.88	Pond Bottom
98.55	163.757		3303.4	
98.60	330.412		3362.79	
98.65	500.056		3422.98	
98.70	672.727		3483.84	
98.75	848.449		3545.07	
98.80	1027.259		3607.31	
98.85	1209.194		3670.1	
98.90	1394.295		3733.93	
98.95	1582.588		3797.82	
99.00	1774.104		3862.8	
99.05	1968.891		3928.66	
99.10	2166.989		3995.26	
99.15	2368.428		4062.31	
99.20	2573.239		4130.15	
99.25	2781.448		4198.21	
99.30	2993.088		4267.38	
99.35	3208.210		4337.5	
99.40	3426.851		4408.12	
99.45	3649.043		4479.56	
99.50	3874.868		4553.44	
99.55	4148.700		5529.72	
99.60	4427.975		5641.25	
99.65	4712.865		5754.37	
99.70	5003.442		5868.73	
99.75	5299.753		5983.68	
99.80	5601.864		6100.78	
99.85	5909.873		6219.57	
99.90	6223.838		6339.04	
99.95	6543.820		6460.25	
100.00	6869.903		6583.04	
100.05	7202.148		6706.77	
100.10	7540.620		6832.12	
100.15	7885.389		6958.63	
100.20	8236.510		7086.22	
100.25	8594.048		7215.32	
100.30	8958.096		7346.59	
100.35	9328.723		7478.51	
100.40	9705.984		7611.9	
100.45	10089.947		7746.64	

DRAFT

East SWM Pond Preliminary Stage Storage

Elevation (m)	Volume (m^3)	Volume above PP @ 90% (m^3)	Area (m^2)	Demarcation
100.50	**10480.785**	**0.000**	**7886.88**	**Permanent Pool**
100.55	10877.687	357.212	7989.2	
100.60	11279.831	719.141	8096.54	
100.65	11687.349	1085.908	8204.2	
100.70	12100.263	1457.530	8312.36	
100.75	12518.616	1834.048	8421.74	
100.80	12942.548	2215.587	8535.53	
100.85	13379.456	2608.804	8940.79	
100.90	13828.524	3012.965	9021.95	
100.95	14281.662	3420.789	9103.59	
101.00	14738.893	3832.297	9185.63	
101.05	15200.229	4247.500	9267.8	
101.10	15665.680	4666.406	9350.25	
101.15	16135.281	5089.046	9433.8	
101.20	16609.069	5515.456	9517.7	
101.25	17087.054	5945.642	9601.71	
101.30	17569.243	6379.612	9685.86	
101.35	18055.656	6817.384	9770.65	
101.40	18546.334	7258.994	9856.48	
101.45	19041.288	7704.453	9941.69	
101.50	19540.526	8153.767	10027.81	
101.55	20044.078	8606.964	10114.28	
101.60	20551.961	9064.058	10201.04	
101.65	21064.211	9525.083	10288.95	
101.70	21580.846	9990.055	10376.46	
101.75	22101.868	10458.975	10464.4	
101.80	22627.306	10931.869	10553.14	
101.85	23157.199	11408.773	10642.6	
101.90	23691.564	11889.701	10731.99	
101.95	24230.410	12374.663	10821.84	
102.00	24773.763	12863.680	10912.32	
102.05	25321.656	13356.784	11003.39	
102.10	25874.112	13853.994	11094.85	
102.15	26431.146	14355.325	11186.5	
102.20	26992.764	14860.781	11278.23	
102.25	27558.982	15370.377	11370.49	
102.30	28129.837	15884.147	11463.72	
102.35	28705.361	16402.118	11557.23	
102.40	29285.568	16924.305	11651.05	
102.45	29870.467	17450.714	11744.91	
102.50	30460.077	17981.363	11839.51	

DRAFT

East SWM Pond Preliminary Stage Storage

Elevation (m)	Volume (m^3)	Volume above PP @ 90% (m^3)	Area (m^2)	Demarcation
102.55	31054.434	18516.284	11934.79	
102.60	31653.556	19055.494	12030.05	
102.65	32257.446	19598.995	12125.57	
102.70	32866.140	20146.820	12222.19	
102.75	33479.665	20698.992	12318.84	
102.80	34098.053	21255.541	12416.68	
102.85	34721.317	21816.479	12513.86	
102.90	35349.455	22381.803	12611.67	
102.95	35982.506	22951.549	12710.37	
103.00	**36620.544**	23525.783	**12811.15**	**Top of Pond**

DRAFT

Table C-1E: East Pond Criteria for Required Storage Volumes

Pond	Area [1] (ha)	Imperviousness (%)	Storage Volume for Impervious Level [2] (m^3/ha)
N/A	N/A	70	225
East SWM Pond	25.81	71	227
N/A	N/A	85	250

[1] Refer to Appendix C for drainage areas to the SWM facility.

[2] Protection Level for Wet Pond: Enhanced 80% long-term S.S. removal.
SWM Planning & Design Manual, Table 3.2, p.3-10 (March 2003).

Table C-2E: Required Storage Volumes for West SWM Facility

Pond Component	Required Volume (m^3)	Allowable Release Rate (m^3/s)
Permanent Pool (PP) [1]	4,826	-
Quality Control [2]	1,032	0.012
Forebay (20% PP)	965	-
PP - Forebay	3,861	-

(1) Required PP volume based on Table C-1E (227 - 40).

[2] Required quality control volume based on 40 m3/ha

[3] Quality control release rate based on 48 hour drawdown time

DRAFT

Table C-3E: Summary of East SWM - Pond Operating Characteristics

Pond Components	Pre Dev Flows[1] (m^3/s)	Pond Release Rate (m^3/s)	Pond Volume (m^3)	Preliminary Pond Water Level (m)
Permanent Pool[2]	-	-	4,826	100.50
Quality Control[3]	-	0.012	1,032	100.65
25mm 3-hr Chicago	0.079	0.079	3,586	101.00
2-year 3-hr Chicago	0.137	0.137	4,710	101.15
5-year 3-hr Chicago	0.252	0.252	6,460	101.35
10-year 3-hr Chicago	0.342	0.342	7,672	101.45
25-year 3-hr Chicago	0.468	0.468	9,205	101.65
50-year 3-hr Chicago	0.572	0.572	10,360	101.75
100-year 3-hr Chicago	0.688	0.688	11,570	101.90
2-year 24-hr SCS	0.218	0.218	5,564	101.25
5-year 24-hr SCS	0.375	0.335	7,576	101.45
10-year 24-hr SCS	0.493	0.441	8,882	101.60
25-year 24-hr SCS	0.651	0.585	10,490	101.80
50-year 24-hr SCS	0.781	0.712	11,700	101.90
100-year 24-hr SCS	0.926	0.926	12,850	102.00

(1) Target flows based on peak pre development flows

(2) Required permanent pool volume based on MOE SWMPD Manual Table 3.2, enhanced 80% TSS Removal for wet pond.

(3) Required quality control volume based on 40 m^3/ha released over 48 hours

DRAFT

Table C-4E: Summary of East SWM - Pond Operating Characteristics (Sensitivity Test)

Pond Components	Halved Pre Dev Flows[1] (m^3/s)	Pond Release Rate (m^3/s)	Pond Volume (m^3)	Preliminary Pond Water Level (m)
Permanent Pool[2]	-	-	4,826	100.50
Quality Control[3]	-	0.012	1,032	100.65
25mm 3-hr Chicago	0.040	0.040	3,851	101.05
2-year 3-hr Chicago	0.069	0.069	5,146	101.20
5-year 3-hr Chicago	0.126	0.126	7,133	101.40
10-year 3-hr Chicago	0.171	0.171	8,459	101.55
25-year 3-hr Chicago	0.234	0.234	10,120	101.75
50-year 3-hr Chicago	0.286	0.286	11,380	101.85
100-year 3-hr Chicago	0.344	0.344	12,720	102.00
2-year 24-hr SCS	0.109	0.109	6,171	101.30
5-year 24-hr SCS	0.188	0.170	8,419	101.55
10-year 24-hr SCS	0.247	0.225	9,877	101.70
25-year 24-hr SCS	0.326	0.300	11,700	101.90
50-year 24-hr SCS	0.391	0.368	13,070	102.05
100-year 24-hr SCS	0.463	0.463	14,460	102.20

(1) Target flows based on halved peak pre development flows

(2) Required permanent pool volume based on MOE SWMPD Manual Table 3.2, enhanced 80% TSS Removal for wet pond.

(3) Required quality control volume based on 40 m^3/ha released over 48 hours

DRAFT

```
00001> 20     Metric units / ID Numbers OFF
00002> *$*************************************************************************
00003> *#  SWMHYMO Ver:5.500/Feb 2015 / INPUT DATA FILE
00004> *$*************************************************************************
00005> *#  Project Name  : [Caivan Stittsville West properties]
00006> *#  Project Number: [2267]
00007> *#  Date          : [2023/11/28]
00008> *#  Modeller      : [PP]
00009> *#  Company       : J.F. Sabourin and Associates
00010> *#  License #     : 2549237
00011> *$*************************************************************************
00012> *%  25 mm Storm based on 2-Year, 3-Hour Chicago Storm
00013> START               TZERO=[0.0],  METOUT=[2],  NSTORM=[1],  NRUN=[001]
00014> *%                   ["25MMC3H.stm"] <--storm filename, one per line for NSTORM time
00015> *%-----------------|-------------------------------------------------------|
00016> READ STORM          STORM_FILENAME=["storm.001"]
00017> *%-----------------|-------------------------------------------------------|
00018> DEFAULT VALUES      ICASEdef=[1],  read and print values
00019>                     DEFVAL_FILENAME=["Ottawa.val"]
00020> *%-----------------|-------------------------------------------------------|
00021> *#######################################################################
00022> *# Post Development Conditions
00023> *#######################################################################
00024> *# West Development
00025> *#######################################################################
00026> *# Post-development drainage area to West SWM Pond
00027> CALIB STANDHYD       NHYD=["W_Pond"], DT=[1](min), AREA=[36.55](ha), XIMP=[0.66], TIMP=[0.71], DWF=[0.](cms),
00028>                     LOSS=[1] Horton Equ: Fo=[76.2](mm/hr), Fc=[13.2](mm/hr), DCAY=[4.14](/hr), F=[0.00](mm),
00029>                     Pervious   areas: IAper=[4.67](mm), SLPP=[2.0](%), LGP=[40](m), MNP=[0.25], SCP=[0](min),
00030>                     Impervious areas: IAimp=[1.57](mm), SLPI=[0.5](%), LGI=[494](m), MNI=[0.013], SCI=[0](min),
00031>                     RAINFALL=[ ,  ,  -1](mm/hr)
00032> *%-----------------|-------------------------------------------------------|
00033> *#######################################################################
00034> *# West Pond Routing
00035> *#######################################################################
00036> ROUTE RESERVOIR     NHYDout=["W_Pond-Out"], NHYDin=["W_Pond"], RDT=[1](min),
00037>                         TABLE Of ( OUTFLOW-STORAGE ) Values
00038>                                 (cms) - (ha-m)
00039>                                 [ 0 , 0 ]
00040>                                 [ 0.017 , 0.017 ]
00041>                                 [ 0.079 , 0.52966 ]
00042>                                 [    0.138 , 0.7024    ]  (max twenty pts)
00043>                                 [    0.218 , 0.8331    ]  (max twenty pts)
00044>                                 [    0.255 , 0.96263   ]  (max twenty pts)
00045>                                 [    0.347 , 1.141     ]  (max twenty pts)
00046>                                 [    0.477 , 1.367     ]  (max twenty pts)
00047>                                 [    0.585 , 1.53738   ]  (max twenty pts)
00048>                                 [    0.667 , 1.567     ]  (max twenty pts)
00049>                                 [    0.706 , 1.714     ]  (max twenty pts)
00050>                                 [    0.805 , 1.748     ]  (max twenty pts)
00051>                                 [    0.96 , 1.931      ]  (max twenty pts)
00052>                                 [    -1 , -1           ]  (max twenty pts)
00053>                               NHYDovf=["W_Pond-Ovf"],
00054> *%-----------------|-------------------------------------------------------|
00055> *#######################################################################
00056> *# Total post-development flows from West development
00057> *#######################################################################
00058> ADD HYD             NHYDsum=["West"], NHYDs to add=["W_Pond-Out" + "W_Pond-Ovf"]
00059> *%-----------------|-------------------------------------------------------|
00060> *#######################################################################
00061> *# East Development
00062> *#######################################################################
00063> *# Post-development drainage area to East SWM Pond
00064> CALIB STANDHYD       NHYD=["E_Pond"], DT=[1](min), AREA=[25.81](ha), XIMP=[0.66], TIMP=[0.71], DWF=[0.](cms),
00065>                     LOSS=[1] Horton Equ: Fo=[76.2](mm/hr), Fc=[13.2](mm/hr), DCAY=[4.14](/hr), F=[0.00](mm),
00066>                     Pervious   areas: IAper=[4.67](mm), SLPP=[2.0](%), LGP=[40](m), MNP=[0.25], SCP=[0](min),
00067>                     Impervious areas: IAimp=[1.57](mm), SLPI=[0.5](%), LGI=[415](m), MNI=[0.013], SCI=[0](min),
00068>                     RAINFALL=[ ,  ,  -1](mm/hr)FALL=[ ,  ,  -1](mm/hr)
00069> *%-----------------|-------------------------------------------------------|
00070> *#######################################################################
00071> *# East Pond Routing
00072> *#######################################################################
00073> ROUTE RESERVOIR     NHYDout=["E_Pond-Out"], NHYDin=["E_Pond"], RDT=[1](min),
00074>                         TABLE Of ( OUTFLOW-STORAGE ) Values
00075>                                 (cms) - (ha-m)
00076>                                 [ 0 , 0 ]
00077>                                 [ 0.012 , 0.012 ]
00078>                                 [ 0.079 , 0.35863 ]
00079>                                 [    0.137 , 0.47102   ]  (max twenty pts)
00080>                                 [    0.218 , 0.55643   ]  (max twenty pts)
00081>                                 [    0.252 , 0.646     ]  (max twenty pts)
00082>                                 [    0.342 , 0.7672    ]  (max twenty pts)
00083>                                 [    0.468 , 0.92057   ]  (max twenty pts)
00084>                                 [    0.572 , 1.03539   ]  (max twenty pts)
00085>                                 [    0.688 , 1.157     ]  (max twenty pts)
00086>                                 [    0.926 , 1.2855    ]  (max twenty pts)
00087>                                 [    -1 , -1           ]  (max twenty pts)
00088>                               NHYDovf=["E_Pond-Ovf"],
00089> *%-----------------|-------------------------------------------------------|
00090> *#######################################################################
00091> *# Total post-development flows from East development
00092> *#######################################################################
00093> ADD HYD             NHYDsum=["East"], NHYDs to add=["E_Pond-Out" + "E_Pond-Ovf"]
00094> *%-----------------|-------------------------------------------------------|
00095> *#######################################################################
00096> *# STORMS
00097> *#######################################################################
00098> *%  25 mm Storm based on 2-Year, 3-Hour Chicago Storm
00099> *START               TZERO=[0.0],  METOUT=[2],  NSTORM=[1],  NRUN=[001]
00100> *%                   ["25MMC3H.stm"] <--storm filename, one per line for NSTORM time
00101> *%-----------------|-------------------------------------------------------|
00102> *%  2-Year, 3-Hour Chicago Storm
00103> START               TZERO=[0.0],  METOUT=[2],  NSTORM=[1],  NRUN=[002]
00104>                     ["002YC3H.stm"] <--storm filename, one per line for NSTORM time
00105> *%-----------------|-------------------------------------------------------|
00106> *%  5-Year, 3-Hour Chicago Storm
00107> START               TZERO=[0.0],  METOUT=[2],  NSTORM=[1],  NRUN=[005]
00108>                     ["005YC3H.stm"] <--storm filename, one per line for NSTORM time
00109> *%-----------------|-------------------------------------------------------|
00110> *%  10-Year, 3-Hour Chicago Storm
00111> START               TZERO=[0.0],  METOUT=[2],  NSTORM=[1],  NRUN=[010]
00112>                     ["010YC3H.stm"] <--storm filename, one per line for NSTORM time
00113> *%-----------------|-------------------------------------------------------|
00114> *%  25-Year, 3-Hour Chicago Storm
00115> START               TZERO=[0.0],  METOUT=[2],  NSTORM=[1],  NRUN=[025]
00116>                     ["025YC3H.stm"] <--storm filename, one per line for NSTORM time
00117> *%-----------------|-------------------------------------------------------|
00118> *%  50-Year, 3-Hour Chicago Storm
00119> START               TZERO=[0.0],  METOUT=[2],  NSTORM=[1],  NRUN=[050]
00120>                     ["050YC3H.stm"] <--storm filename, one per line for NSTORM time
00121> *%-----------------|-------------------------------------------------------|
00122> *%  100-Year, 3-Hour Chicago Storm
00123> START               TZERO=[0.0],  METOUT=[2],  NSTORM=[1],  NRUN=[099]
00124>                     ["100YC3H.stm"] <--storm filename, one per line for NSTORM time
00125> *%-----------------|-------------------------------------------------------|
00126> *%  2-Year, 24-Hour SCS Storm
00127> START               TZERO=[0.0],  METOUT=[2],  NSTORM=[1],  NRUN=[102]
00128>                     ["SC24002x.stm"] <--storm filename, one per line for NSTORM time
00129> *%-----------------|-------------------------------------------------------|
00130> *%  5-Year, 24-Hour SCS Storm
00131> START               TZERO=[0.0],  METOUT=[2],  NSTORM=[1],  NRUN=[105]
00132>                     ["SC24005x.stm"] <--storm filename, one per line for NSTORM time
00133> *%-----------------|-------------------------------------------------------|
00134> *%  10-Year, 24-Hour SCS Storm
00135> START               TZERO=[0.0],  METOUT=[2],  NSTORM=[1],  NRUN=[110]
00136>                     ["SC24010x.stm"] <--storm filename, one per line for NSTORM time
00137> *%-----------------|-------------------------------------------------------|
00138> *%  25-Year, 24-Hour SCS Storm
00139> START               TZERO=[0.0],  METOUT=[2],  NSTORM=[1],  NRUN=[125]
00140>                     ["SC24025x.stm"] <--storm filename, one per line for NSTORM time
00141> *%-----------------|-------------------------------------------------------|
00142> *%  50-Year, 24-Hour SCS Storm
00143> START               TZERO=[0.0],  METOUT=[2],  NSTORM=[1],  NRUN=[150]
00144>                     ["SC24050x.stm"] <--storm filename, one per line for NSTORM time
00145> *%-----------------|-------------------------------------------------------|
00146> *%  100-Year, 24-Hour SCS Storm
00147> START               TZERO=[0.0],  METOUT=[2],  NSTORM=[1],  NRUN=[199]
00148>                     ["SC24100x.stm"] <--storm filename, one per line for NSTORM time
00149> *%-----------------|-------------------------------------------------------|
00150> *%  2-Year, 12-Hour SCS Storm (per City of Ottawa Carp River PCSWMM model)
00151> *START               TZERO=[0.0],  METOUT=[2],  NSTORM=[1],  NRUN=[202]
00152> *                   ["SC12002c.stm"] <--storm filename, one per line for NSTORM time
00153> *%-----------------|-------------------------------------------------------|
00154> *%  5-Year, 12-Hour SCS Storm (per City of Ottawa Carp River PCSWMM model)
00155> *START               TZERO=[0.0],  METOUT=[2],  NSTORM=[1],  NRUN=[205]
00156> *                   ["SC12005c.stm"] <--storm filename, one per line for NSTORM time
00157> *%-----------------|-------------------------------------------------------|
00158> *%  10-Year, 12-Hour SCS Storm (per City of Ottawa Carp River PCSWMM model)
00159> *START               TZERO=[0.0],  METOUT=[2],  NSTORM=[1],  NRUN=[210]
00160> *                   ["SC12010c.stm"] <--storm filename, one per line for NSTORM time
00161> *%-----------------|-------------------------------------------------------|
00162> *%  25-Year, 12-Hour SCS Storm (per City of Ottawa Carp River PCSWMM model)
00163> *START               TZERO=[0.0],  METOUT=[2],  NSTORM=[1],  NRUN=[225]
00164> *                   ["SC12025c.stm"] <--storm filename, one per line for NSTORM time
00165> *%-----------------|-------------------------------------------------------|
00166> *%  50-Year, 12-Hour SCS Storm (per City of Ottawa Carp River PCSWMM model)
00167> *START               TZERO=[0.0],  METOUT=[2],  NSTORM=[1],  NRUN=[250]
00168> *                   ["SC12050c.stm"] <--storm filename, one per line for NSTORM time
00169> *%-----------------|-------------------------------------------------------|
00170> *%  100-Year, 12-Hour SCS Storm (per City of Ottawa Carp River PCSWMM model)
00171> *START               TZERO=[0.0],  METOUT=[2],  NSTORM=[1],  NRUN=[299]
00172> *                   ["SC12100c.stm"] <--storm filename, one per line for NSTORM time
00173> *%-----------------|-------------------------------------------------------|
00174> *%  July 1st, 1979 Storm - Ottawa International Airport
00175> *START               TZERO=[0.0],  METOUT=[2],  NSTORM=[1],  NRUN=[979]
00176> *                   ["19790701.stm"] <--storm filename, one per line for NSTORM time
00177> *%-----------------|-------------------------------------------------------|
00178> *%  August 4th, 1988 Storm - Ottawa International Airport
00179> *START               TZERO=[0.0],  METOUT=[2],  NSTORM=[1],  NRUN=[988]
00180> *                   ["19880804.stm"] <--storm filename, one per line for NSTORM time
00181> *%-----------------|-------------------------------------------------------|
00182> *%  August 8th, 1996 Storm - Ottawa International Airport
00183> *START               TZERO=[0.0],  METOUT=[2],  NSTORM=[1],  NRUN=[996]
00184> *                   ["19960808.stm"] <--storm filename, one per line for NSTORM time
00185> *%-----------------|-------------------------------------------------------|
00186> *%  100-Year, 3-Hour Chicago Storm + 20%
00187> *START               TZERO=[0.0],  METOUT=[2],  NSTORM=[1],  NRUN=[999]
00188> *                   ["100YC3H+.stm"] <--storm filename, one per line for NSTORM time
00189> *%-----------------|-------------------------------------------------------|
00190> FINISH
```

DRAFT

```
00001>  ================================================================================
00002>
00003>  SSSSS   W   W   M   M   H   H   Y   Y   M   M    OOO          222    000   11   5555   ========
00004>  S       W W W   MM MM   H   H    Y Y    MM MM   O   O           2   0   0  11   5
00005>  SSSSS   W W W   M M M   HHHHH     Y     M M M   O   O          2    0   0  11   5       Ver 5.500
00006>      S   W W W   M   M   H   H     Y     M   M   O   O        222    0   0  11     555   FEB  2015
00007>  SSSSS    W W    M   M   H   H     Y     M   M    OOO         2      0   0  11       5   ========
00008>                                                               2      0   0  11       5   # 2549237
00009>         StormWater Management HYdrologic Model                222    000   11   555    ========
00010>
00011>  ***************************************************************************************************
00012>  ********************************************  SWMHYMO Ver 5.500  ********************************
00013>  ********************  A single event and continuous hydrologic simulation model  ********************
00014>  ********************       based on the principles of HYMO and its successors    ********************
00015>  ********************                 OTTHYMO-83 and OTTHYMO-89.                  ********************
00016>  ***************************************************************************************************
00017>  ********************* Distributed by:  J.F. Sabourin and Associates Inc.          ********************
00018>  ********************                  Ottawa, Ontario: (613) 836-3884            ********************
00019>  ********************                  Gatineau, Quebec: (819) 243-6858           ********************
00020>  ********************                  E-Mail: swmhymo@jfsa.com                   ********************
00021>  ***************************************************************************************************
00022>
00023>  ++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++
00024>  ++++++++++++++++++  Licensed user: JFSAinc.                                  ++++++++++++++++++++
00025>  ++++++++++++++++++                  Ottawa                  SERIAL#:2549237  ++++++++++++++++++++
00026>  ++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++
00027>
00028>  ********************                                                          ********************
00029>  ********************                ++++++ PROGRAM ARRAY DIMENSIONS ++++++     ********************
00030>  ********************           Maximum value for ID numbers  :    11          ********************
00031>  ********************           Max. number of rainfall points: 105408        ********************
00032>  ********************           Max. number of flow points   : 105408         ********************
00033>  ***************************************************************************************************
00034>
00035>
00036>  ******************************  S U M M A R Y   O U T P U T  ******************************************
00037>  ***************************************************************************************************
00038>  *                    RUN DATE: 2023-11-28      TIME: 13:41:04      RUN COUNTER: 009488               *
00039>  ***************************************************************************************************
00040>  * Input   file: C:\Temp\P2267-Stittsville FSR\20231128-MSS Pond Sizing\STIT-Post_v06.dat              *
00041>  * Output  file: C:\Temp\P2267-Stittsville FSR\20231128-MSS Pond Sizing\STIT-Post_v06.out              *
00042>  * Summary file: C:\Temp\P2267-Stittsville FSR\20231128-MSS Pond Sizing\STIT-Post_v06.sum              *
00043>  * User comments:                                                                                    *
00044>  * 1:_____________________________________________________________________________________________*
00045>  * 2:_____________________________________________________________________________________________*
00046>  * 3:_____________________________________________________________________________________________*
00047>  ***************************************************************************************************
00048>
00049>
00050>  ##########################################################################
00051>  #  SWMHYMO Ver:5.500/Feb 2015 / INPUT DATA FILE
00052>  ##########################################################################
00053>  #  Project Name  : [Caivan Stittsville West properties]
00054>  #  Project Number: [2267]
00055>  #  Date          : [2023/11/28]
00056>  #  Modeller      : [PP]
00057>  #  Company       : J.F. Sabourin and Associates
00058>  #  License #     : 2549237]
00059>  ##########################################################################
00060>   RUN#:COMMAND#
00061> R0001:C00001------------------------------------------------------------------------------------------
00062>       START
00063>         [TZERO =      .00 hrs on       0]
00064>         [METOUT=   2     (1=imperial, 2=metric output)]
00065>         [NSTORM=   1 ]
00066>         [NRUN  = 0001 ]
00067> R0001:C00002------------------------------------------------------------------------------------------
00068>       READ STORM
00069>         Filename = storm.001
00070>         Comment  = 25 MM BASED ON CHICAGO STORM 2 Year, 3 Hours
00071>         [SDT=10.00:SDUR=   3.00:PTOT=  25.00]
00072> R0001:C00003------------------------------------------------------------------------------------------
00073>       DEFAULT VALUES
00074>         Filename = C:\Temp\P2267-Stittsville FSR\20231128-MSS Pond Sizing\Ottawa.val
00075>         ICASEdv  = 1 (read and print data)
00076>         FileTitle= File comment: [Parameters for City of Ottawa Projects]
00077>                    THE FOLLOWING PARAMETERS ARE USED IN THE DESIGN STANDHYD COM
00078>         Horton's infiltration equation parameters:
00079>         [Fo= 76.20 mm/hr] [Fc=13.20 mm/hr] [DCAY= 4.14 /hr] [F=  .00 mm]
00080>         Parameters for PERVIOUS surfaces in STANDHYD:
00081>         [IAper=  4.67 mm] [LGP=40.00 m] [MNP= .250]
00082>         Parameters for IMPERVIOUS surfaces in STANDHYD:
00083>         [IAimp=  1.57 mm] [CLI= 1.50]   [MNI= .013]
00084>         Parameters used in NASHYD:
00085>         [Ia=   4.67 mm] [N= 3.00]
00086>         Average monthly Pan Evaporation data in    (mm)
00087>      JAN   FEB   MAR   APR   MAY   JUN   JUL   AUG   SEP   OCT   NOV   DEC
00088>     .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00
00089>         Average monthly Potential Evapotranspiration in    (mm)
00090>      JAN   FEB   MAR   APR   MAY   JUN   JUL   AUG   SEP   OCT   NOV   DEC
00091>     .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00
00092>  ##########################################################################
00093>  # Post Development Conditions
00094>  ##########################################################################
00095>  # West Development
00096>  ##########################################################################
00097>  # Post-development drainage area to West SWM Pond
00098> R0001:C00004------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00099>       CALIB STANDHYD          1.0 01:W_Pond       36.55    2.502 No_date    1:06   16.15 .646     .000
00100>         [XIMP=.66:TIMP=.71]
00101>         [Horton parameters: Fo= 76.20:Fc= 13.20:DCAY=4.14:  F= .00]
00102>         [Pervious      area: IAper= 4.67:SLPP=2.00:LGP=  40.:MNP=.250:SCP=   .0]
00103>         [Impervious    area: IAimp= 1.57:SLPI= .50:LGI= 494.:MNI=.013:SCI=   .0]
00104>  ##########################################################################
00105>  # West Pond Routing
00106>  ##########################################################################
00107> R0001:C00005------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00108>       ROUTE RESERVOIR ->     1.0 02:W_Pond       36.55    2.502 No_date    1:06   16.15  n/a     .000
00109>                        out <=   1.0 01:W_Pond-Out   36.55     .079 No_date    3:11   16.15  n/a     .000
00110>                   overflow <=   1.0 03:W_Pond-Ovf     .00     .000 No_date    0:00     .00  n/a     .000
00111>        (MxStoUsed=.5296E+00  m3, TotOvfVol=.0000E+00  m3, N-Ovf=    0, TotDurOvf=    0.hrs)
00112>  ##########################################################################
00113>  # Total post-development flows from West development
00114>  ##########################################################################
00115> R0001:C00006------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00116>       ADD HYD                 1.0 02:W_Pond-Out   36.55     .079 No_date    3:11   16.15  n/a     .000
00117>                          +    1.0 02:W_Pond-Ovf     .00     .000 No_date    0:00     .00  n/a     .000
00118>                        SUM=   1.0 01:West        36.55     .079 No_date    3:11   16.15  n/a     .000
00119>  ##########################################################################
00120>  # East Development
00121>  ##########################################################################
00122>  # Post-development drainage area to East SWM Pond
00123> R0001:C00007------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00124>       CALIB STANDHYD          1.0 01:E_Pond       25.81    1.864 No_date    1:05   16.15 .646     .000
00125>         [XIMP=.66:TIMP=.71]
00126>         [Horton parameters: Fo= 76.20:Fc= 13.20:DCAY=4.14:  F= .00]
00127>         [Pervious      area: IAper= 4.67:SLPP=2.00:LGP=  40.:MNP=.250:SCP=   .0]
00128>         [Impervious    area: IAimp= 1.57:SLPI= .50:LGI= 415.:MNI=.013:SCI=   .0]
00129>  ##########################################################################
00130>  # East Pond Routing
00131>  ##########################################################################
00132> R0001:C00008------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00133>       ROUTE RESERVOIR ->     1.0 02:E_Pond       25.81    1.864 No_date    1:05   16.15  n/a     .000
00134>                        out <=   1.0 01:E_Pond-Out   25.81     .079 No_date    3:06   16.15  n/a     .000
00135>                   overflow <=   1.0 03:E_Pond-Ovf     .00     .000 No_date    0:00     .00  n/a     .000
00136>        (MxStoUsed=.3386E+00  m3, TotOvfVol=.0000E+00  m3, N-Ovf=    0, TotDurOvf=    0.hrs)
00137>  ##########################################################################
00138>  # Total post-development flows from East development
00139>  ##########################################################################
00140> R0001:C00009------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00141>       ADD HYD                 1.0 02:E_Pond-Out   25.81     .079 No_date    3:06   16.15  n/a     .000
00142>                          +    1.0 02:E_Pond-Ovf     .00     .000 No_date    0:00     .00  n/a     .000
00143>                        SUM=   1.0 01:East        25.81     .079 No_date    3:06   16.15  n/a     .000
00144>  ##########################################################################
00145>  # STORMS
00146>  ##########################################################################
00147>   ** END OF RUN :   1
00148>
00149>  ***************************************************************************************************
00150>
00151>
00152>
00153>
00154>
00155>  RUN#:COMMAND#
00156> R0002:C00001------------------------------------------------------------------------------------------
00157>       START
00158>         [TZERO =      .00 hrs on       0]
00159>         [METOUT=   2     (1=imperial, 2=metric output)]
00160>         [NSTORM=   1 ]
00161>         [NRUN  = 0002 ]
00162>  ##########################################################################
00163>  #  SWMHYMO Ver:5.500/Feb 2015 / INPUT DATA FILE
00164>  ##########################################################################
00165>  #  Project Name  : [Caivan Stittsville West properties]
00166>  #  Project Number: [2267]
00167>  #  Date          : [2023/11/28]
00168>  #  Modeller      : [PP]
00169>  #  Company       : J.F. Sabourin and Associates
00170>  #  License #     : 2549237
00171>  ##########################################################################
00172> R0002:C00002------------------------------------------------------------------------------------------
00173>       READ STORM
00174>         Filename = storm.001
00175>         Comment  = CHICAGO STORM 2 Year, 3 Hours
00176>         [SDT=10.00:SDUR=   3.00:PTOT=  31.86]
00177> R0002:C00003------------------------------------------------------------------------------------------
00178>       DEFAULT VALUES
00179>         Filename = C:\Temp\P2267-Stittsville FSR\20231128-MSS Pond Sizing\Ottawa.val
00180>         ICASEdv  = 1 (read and print data)
00181>         FileTitle= File comment: [Parameters for City of Ottawa Projects]
00182>                    THE FOLLOWING PARAMETERS ARE USED IN THE DESIGN STANDHYD COM
00183>         Horton's infiltration equation parameters:
00184>         [Fo= 76.20 mm/hr] [Fc=13.20 mm/hr] [DCAY= 4.14 /hr] [F=  .00 mm]
00185>         Parameters for PERVIOUS surfaces in STANDHYD:
00186>         [IAper=  4.67 mm] [LGP=40.00 m] [MNP= .250]
00187>         Parameters for IMPERVIOUS surfaces in STANDHYD:
00188>         [IAimp=  1.57 mm] [CLI= 1.50]   [MNI= .013]
00189>         Parameters used in NASHYD:
00190>         [Ia=   4.67 mm] [N= 3.00]
00191>         Average monthly Pan Evaporation data in    (mm)
00192>      JAN   FEB   MAR   APR   MAY   JUN   JUL   AUG   SEP   OCT   NOV   DEC
00193>     .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00
00194>         Average monthly Potential Evapotranspiration in    (mm)
00195>      JAN   FEB   MAR   APR   MAY   JUN   JUL   AUG   SEP   OCT   NOV   DEC
00196>     .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00
00197>  ##########################################################################
00198>  # Post Development Conditions
00199>  ##########################################################################
00200>  # West Development
00201>  ##########################################################################
00202>  # Post-development drainage area to West SWM Pond
00203> R0002:C00004------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00204>       CALIB STANDHYD          1.0 01:W_Pond       36.55    3.459 No_date    1:05   21.79 .684     .000
00205>         [XIMP=.66:TIMP=.71]
00206>         [Horton parameters: Fo= 76.20:Fc= 13.20:DCAY=4.14:  F= .00]
00207>         [Pervious      area: IAper= 4.67:SLPP=2.00:LGP=  40.:MNP=.250:SCP=   .0]
00208>         [Impervious    area: IAimp= 1.57:SLPI= .50:LGI= 494.:MNI=.013:SCI=   .0]
00209>  ##########################################################################
00210>  # West Pond Routing
00211>  ##########################################################################
00212> R0002:C00005------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00213>       ROUTE RESERVOIR ->     1.0 02:W_Pond       36.55    3.459 No_date    1:05   21.79  n/a     .000
00214>                        out <=   1.0 01:W_Pond-Out   36.55     .138 No_date    3:06   21.79  n/a     .000
00215>                   overflow <=   1.0 03:W_Pond-Ovf     .00     .000 No_date    0:00     .00  n/a     .000
00216>        (MxStoUsed=.7024E+00  m3, TotOvfVol=.0000E+00  m3, N-Ovf=    0, TotDurOvf=    0.hrs)
00217>  ##########################################################################
00218>  # Total post-development flows from West development
00219>  ##########################################################################
00220> R0002:C00006------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00221>       ADD HYD                 1.0 02:W_Pond-Out   36.55     .138 No_date    3:06   21.79  n/a     .000
00222>                          +    1.0 02:W_Pond-Ovf     .00     .000 No_date    0:00     .00  n/a     .000
00223>                        SUM=   1.0 01:West        36.55     .139 No_date    3:06   21.79  n/a     .000
00224>  ##########################################################################
00225>  # East Development
00226>  ##########################################################################
00227>  # Post-development drainage area to East SWM Pond
00228> R0002:C00007------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00229>       CALIB STANDHYD          1.0 01:E_Pond       25.81    2.569 No_date    1:04   21.79 .684     .000
00230>         [XIMP=.66:TIMP=.71]
00231>         [Horton parameters: Fo= 76.20:Fc= 13.20:DCAY=4.14:  F= .00]
00232>         [Pervious      area: IAper= 4.67:SLPP=2.00:LGP=  40.:MNP=.250:SCP=   .0]
00233>         [Impervious    area: IAimp= 1.57:SLPI= .50:LGI= 415.:MNI=.013:SCI=   .0]
00234>  ##########################################################################
00235>  # East Pond Routing
00236>  ##########################################################################
00237> R0002:C00008------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00238>       ROUTE RESERVOIR ->     1.0 02:E_Pond       25.81    2.569 No_date    1:04   21.79  n/a     .000
00239>                        out <=   1.0 01:E_Pond-Out   25.81     .137 No_date    2:44   21.79  n/a     .000
00240>                   overflow <=   1.0 03:E_Pond-Ovf     .00     .000 No_date    0:00     .00  n/a     .000
00241>        (MxStoUsed=.4710E+00  m3, TotOvfVol=.0000E+00  m3, N-Ovf=    0, TotDurOvf=    0.hrs)
00242>  ##########################################################################
00243>  # Total post-development flows from East development
00244>  ##########################################################################
00245> R0002:C00009------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00246>       ADD HYD                 1.0 02:E_Pond-Out   25.81     .137 No_date    2:44   21.79  n/a     .000
00247>                          +    1.0 02:E_Pond-Ovf     .00     .000 No_date    0:00     .00  n/a     .000
00248>                        SUM=   1.0 01:East        25.81     .137 No_date    2:44   21.79  n/a     .000
00249>  ##########################################################################
00250>  # STORMS
00251>  ##########################################################################
00252>   ** END OF RUN :   4
00253>
00254>  ***************************************************************************************************
00255>
00256>
00257>
00258>
00259>
00260>  RUN#:COMMAND#
00261> R0005:C00001------------------------------------------------------------------------------------------
00262>       START
00263>         [TZERO =      .00 hrs on       0]
00264>         [METOUT=   2     (1=imperial, 2=metric output)]
00265>         [NSTORM=   1 ]
00266>         [NRUN  = 0005 ]
00267>  ##########################################################################
00268>  #  SWMHYMO Ver:5.500/Feb 2015 / INPUT DATA FILE
00269>  ##########################################################################
00270>  #  Project Name  : [Caivan Stittsville West properties]
00271>  #  Project Number: [2267]
00272>  #  Date          : [2023/11/28]
00273>  #  Modeller      : [PP]
00274>  #  Company       : J.F. Sabourin and Associates
00275>  #  License #     : 2549237
00276>  ##########################################################################
00277> R0005:C00002------------------------------------------------------------------------------------------
00278>       READ STORM
00279>         Filename = storm.001
00280>         Comment  = CHICAGO STORM  5 Year, 3 Hours
00281>         [SDT=10.00:SDUR=   3.00:PTOT=  42.51]
00282> R0005:C00003------------------------------------------------------------------------------------------
00283>       DEFAULT VALUES
00284>         Filename = C:\Temp\P2267-Stittsville FSR\20231128-MSS Pond Sizing\Ottawa.val
00285>         ICASEdv  = 1 (read and print data)
00286>         FileTitle= File comment: [Parameters for City of Ottawa Projects]
00287>                    THE FOLLOWING PARAMETERS ARE USED IN THE DESIGN STANDHYD COM
00288>         Horton's infiltration equation parameters:
00289>         [Fo= 76.20 mm/hr] [Fc=13.20 mm/hr] [DCAY= 4.14 /hr] [F=  .00 mm]
00290>         Parameters for PERVIOUS surfaces in STANDHYD:
00291>         [IAper=  4.67 mm] [LGP=40.00 m] [MNP= .250]
00292>         Parameters for IMPERVIOUS surfaces in STANDHYD:
00293>         [IAimp=  1.57 mm] [CLI= 1.50]   [MNI= .013]
00294>         Parameters used in NASHYD:
00295>         [Ia=   4.67 mm] [N= 3.00]
00296>         Average monthly Pan Evaporation data in    (mm)
00297>      JAN   FEB   MAR   APR   MAY   JUN   JUL   AUG   SEP   OCT   NOV   DEC
00298>     .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00
00299>         Average monthly Potential Evapotranspiration in    (mm)
00300>      JAN   FEB   MAR   APR   MAY   JUN   JUL   AUG   SEP   OCT   NOV   DEC
00301>     .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00
00302>  ##########################################################################
00303>  # Post Development Conditions
00304>  ##########################################################################
00305>  # West Development
00306>  ##########################################################################
00307>  # Post-development drainage area to West SWM Pond
00308> R0005:C00004------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00309>       CALIB STANDHYD          1.0 01:W_Pond       36.55    5.214 No_date    1:04   31.01 .729     .000
00310>         [XIMP=.66:TIMP=.71]
00311>         [Horton parameters: Fo= 76.20:Fc= 13.20:DCAY=4.14:  F= .00]
00312>         [Pervious      area: IAper= 4.67:SLPP=2.00:LGP=  40.:MNP=.250:SCP=   .0]
00313>         [Impervious    area: IAimp= 1.57:SLPI= .50:LGI= 494.:MNI=.013:SCI=   .0]
00314>  ##########################################################################
00315>  # West Pond Routing
00316>  ##########################################################################
00317> R0005:C00005------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00318>       ROUTE RESERVOIR ->     1.0 02:W_Pond       36.55    5.214 No_date    1:04   31.01  n/a     .000
00319>                        out <=   1.0 01:W_Pond-Out   36.55     .255 No_date    2:42   31.01  n/a     .000
00320>                   overflow <=   1.0 03:W_Pond-Ovf     .00     .000 No_date    0:00     .00  n/a     .000
00321>        (MxStoUsed=.9627E+00  m3, TotOvfVol=.0000E+00  m3, N-Ovf=    0, TotDurOvf=    0.hrs)
00322>  ##########################################################################
00323>  # Total post-development flows from West development
00324>  ##########################################################################
00325> R0005:C00006------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00326>       ADD HYD                 1.0 02:W_Pond-Out   36.55     .255 No_date    2:42   31.01  n/a     .000
00327>                          +    1.0 02:W_Pond-Ovf     .00     .000 No_date    0:00     .00  n/a     .000
00328>                        SUM=   1.0 01:West        36.55     .255 No_date    2:42   31.01  n/a     .000
00329>  ##########################################################################
00330>  # East Development
00331>  ##########################################################################
00332>  # Post-development drainage area to East SWM Pond
00333> R0005:C00007------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00334>       CALIB STANDHYD          1.0 01:E_Pond       25.81    3.863 No_date    1:03   31.01 .729     .000
00335>         [XIMP=.66:TIMP=.71]
00336>         [Horton parameters: Fo= 76.20:Fc= 13.20:DCAY=4.14:  F= .00]
00337>         [Pervious      area: IAper= 4.67:SLPP=2.00:LGP=  40.:MNP=.250:SCP=   .0]
00338>         [Impervious    area: IAimp= 1.57:SLPI= .50:LGI= 415.:MNI=.013:SCI=   .0]
00339>  ##########################################################################
00340>  # East Pond Routing
00341>  ##########################################################################
00342> R0005:C00008------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00343>       ROUTE RESERVOIR ->     1.0 02:E_Pond       25.81    3.863 No_date    1:03   31.01  n/a     .000
00344>                        out <=   1.0 01:E_Pond-Out   25.81     .252 No_date    2:16   31.01  n/a     .000
00345>                   overflow <=   1.0 03:E_Pond-Ovf     .00     .000 No_date    0:00     .00  n/a     .000
00346>        (MxStoUsed=.6460E+00  m3, TotOvfVol=.0000E+00  m3, N-Ovf=    0, TotDurOvf=    0.hrs)
00347>  ##########################################################################
00348>  # Total post-development flows from East development
00349>  ##########################################################################
00350> R0005:C00009------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00351>       ADD HYD                 1.0 02:E_Pond-Out   25.81     .252 No_date    2:16   31.01  n/a     .000
00352>                          +    1.0 02:E_Pond-Ovf     .00     .000 No_date    0:00     .00  n/a     .000
00353>                        SUM=   1.0 01:East        25.81     .252 No_date    2:16   31.01  n/a     .000
00354>  ##########################################################################
00355>  # STORMS
00356>  ##########################################################################
00357>   ** END OF RUN :   9
00358>
00359>  ***************************************************************************************************
00360>
```

DRAFT

```
00361>
00362>
00363>
00364>
00365>  RUN#:COMMAND#
00366> R0010:C00001------------------------------------------------------------------------------
00367>       START
00368>       [TZERO =    .00 hrs on        0]
00369>       [METOUT=   2    (1=imperial, 2=metric output)]
00370>       [NSTORM=   1 ]
00371>       [NRUN  = 0010 ]
00372> ********************************************************************************
00373> #  SWMHYMO Ver:5.500/Feb 2015 / INPUT DATA FILE
00374> ********************************************************************************
00375> #  Project Name  : [Caivan Stittsville West properties]
00376> #  Project Number: [2267]
00377> #  Date          : [2023/11/28]
00378> #  Modeller      : [PP]
00379> #  Company       : J.F. Sabourin and Associates
00380> #  License #     : 2549237
00381> ********************************************************************************
00382> R0010:C00002------------------------------------------------------------------------------
00383>       READ STORM
00384>       Filename = storm.001
00385>       Comment  = CHICAGO STORM 10 Year, 3 Hours
00386>       [SDT=10.00:SDUR=   3.00:PTOT=  49.50]
00387> R0010:C00003------------------------------------------------------------------------------
00388>       DEFAULT VALUES
00389>       Filename = C:\Temp\P2267-Stittsville FSR\20231128-MSS Pond Sizing\Ottawa.val
00390>       ICASEdv  = 1 (read and print data)
00391>       FileTitle= File comment: [Parameters for City of Ottawa Projects]
00392>                  THE FOLLOWING PARAMETERS ARE USED IN THE DESIGN STANDHYD COM
00393>       Horton's infiltration equation parameters:
00394>       [Fo= 76.20 mm/hr] [Fc=13.20 mm/hr] [DCAY= 4.14 /hr] [F=  .00 mm]
00395>       Parameters for PERVIOUS surfaces in STANDHYD:
00396>       [IAper=   4.67 mm] [LGP=40.00 m] [MNP= .250]
00397>       Parameters for IMPERVIOUS surfaces in STANDHYD:
00398>       [IAimp=   1.57 mm] [CLI= 1.50]   [MNI= .013]
00399>       Parameters used in NASHYD:
00400>       [Ia=   4.67 mm] [N= 3.00]
00401>       Average monthly Pan Evaporation data in    (mm)
00402>    JAN   FEB   MAR   APR   MAY   JUN   JUL   AUG   SEP   OCT   NOV   DEC
00403>   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00
00404>       Average monthly Potential Evapotranspiration in    (mm)
00405>    JAN   FEB   MAR   APR   MAY   JUN   JUL   AUG   SEP   OCT   NOV   DEC
00406>   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00
00407> ##################################################################################
00408> # Post Development Conditions
00409> ##################################################################################
00410> # West Development
00411> ##################################################################################
00412> # Post-development drainage area to West SWM Pond
00413> R0010:C00004------------DTmin-ID:NHYD--------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00414>      CALIB STANDHYD         1.0 01:W_Pond        36.55    6.460 No_date    1:05   37.25 .752     .000
00415>           [XIMP=.66:TIMP=.71]
00416>           [Horton parameters: Fo= 76.20:Fc= 13.20:DCAY=4.14:  F= .00]
00417>           [Pervious     area: IAper= 4.67:SLPP=2.00:LGP=  40.:MNP=.250:SCP=   .0]
00418>           [Impervious   area: IAimp= 1.57:SLPI= .50:LGI= 494.:MNI=.013:SCI=   .0]
00419> ##################################################################################
00420> # West Pond Routing
00421> ##################################################################################
00422> R0010:C00005------------DTmin-ID:NHYD--------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00423>      ROUTE RESERVOIR ->     1.0 02:W_Pond        36.55    6.460 No_date    1:05   37.25  n/a     .000
00424>                        out <=    1.0 01:W_Pond-Out    36.55    .347 No_date    2:27   37.25  n/a     .000
00425>                     overflow <=    1.0 03:W_Pond-Ovf       .00    .000 No_date    0:00    .00  n/a     .000
00426>        (MxStoUsed=.1141E+01  m3, TotOvfVol=.0000E+00  m3, N-Ovf=    0, TotDurOvf=    0.hrs)
00427> ##################################################################################
00428> # Total post-development flows from West development
00429> ##################################################################################
00430> R0010:C00006------------DTmin-ID:NHYD--------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00431>      ADD HYD                1.0 02:W_Pond-Out    36.55    .347 No_date    2:27   37.25  n/a     .000
00432>                        +     1.0 02:W_Pond-Ovf       .00    .000 No_date    0:00    .00  n/a     .000
00433>                     SUM=     1.0 01:West          36.55    .347 No_date    2:27   37.25  n/a     .000
00434> ##################################################################################
00435> # East Development
00436> ##################################################################################
00437> # Post-development drainage area to East SWM Pond
00438> R0010:C00007------------DTmin-ID:NHYD--------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00439>      CALIB STANDHYD         1.0 01:E_Pond        25.81    4.783 No_date    1:04   37.25 .752     .000
00440>           [XIMP=.66:TIMP=.71]
00441>           [Horton parameters: Fo= 76.20:Fc= 13.20:DCAY=4.14:  F= .00]
00442>           [Pervious     area: IAper= 4.67:SLPP=2.00:LGP=  40.:MNP=.250:SCP=   .0]
00443>           [Impervious   area: IAimp= 1.57:SLPI= .50:LGI= 415.:MNI=.013:SCI=   .0]
00444> ##################################################################################
00445> # East Pond Routing
00446> ##################################################################################
00447> R0010:C00008------------DTmin-ID:NHYD--------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00448>      ROUTE RESERVOIR ->     1.0 02:E_Pond        25.81    4.783 No_date    1:04   37.25  n/a     .000
00449>                        out <=    1.0 01:E_Pond-Out    25.81    .342 No_date    2:06   37.25  n/a     .000
00450>                     overflow <=    1.0 03:E_Pond-Ovf       .00    .000 No_date    0:00    .00  n/a     .000
00451>        (MxStoUsed=.7672E+00  m3, TotOvfVol=.0000E+00  m3, N-Ovf=    0, TotDurOvf=    0.hrs)
00452> ##################################################################################
00453> # Total post-development flows from East development
00454> ##################################################################################
00455> R0010:C00009------------DTmin-ID:NHYD--------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00456>      ADD HYD                1.0 02:E_Pond-Out    25.81    .342 No_date    2:06   37.25  n/a     .000
00457>                        +     1.0 02:E_Pond-Ovf       .00    .000 No_date    0:00    .00  n/a     .000
00458>                     SUM=     1.0 01:East          25.81    .342 No_date    2:06   37.25  n/a     .000
00459> ##################################################################################
00460> # STORMS
00461> ##################################################################################
00462>  ** END OF RUN :   24
00463>
00464> ********************************************************************************
00465>
00466>
00467>
00468>
00469>
00470>  RUN#:COMMAND#
00471> R0025:C00001------------------------------------------------------------------------------
00472>       START
00473>       [TZERO =    .00 hrs on        0]
00474>       [METOUT=   2    (1=imperial, 2=metric output)]
00475>       [NSTORM=   1 ]
00476>       [NRUN  = 0025 ]
00477> ********************************************************************************
00478> #  SWMHYMO Ver:5.500/Feb 2015 / INPUT DATA FILE
00479> ********************************************************************************
00480> #  Project Name  : [Caivan Stittsville West properties]
00481> #  Project Number: [2267]
00482> #  Date          : [2023/11/28]
00483> #  Modeller      : [PP]
00484> #  Company       : J.F. Sabourin and Associates
00485> #  License #     : 2549237
00486> ********************************************************************************
00487> R0025:C00002------------------------------------------------------------------------------
00488>       READ STORM
00489>       Filename = storm.001
00490>       Comment  = CHICAGO STORM  25 Year, 3 Hours
00491>       [SDT=10.00:SDUR=   3.00:PTOT=  58.23]
00492> R0025:C00003------------------------------------------------------------------------------
00493>       DEFAULT VALUES
00494>       Filename = C:\Temp\P2267-Stittsville FSR\20231128-MSS Pond Sizing\Ottawa.val
00495>       ICASEdv  = 1 (read and print data)
00496>       FileTitle= File comment: [Parameters for City of Ottawa Projects]
00497>                  THE FOLLOWING PARAMETERS ARE USED IN THE DESIGN STANDHYD COM
00498>       Horton's infiltration equation parameters:
00499>       [Fo= 76.20 mm/hr] [Fc=13.20 mm/hr] [DCAY= 4.14 /hr] [F=  .00 mm]
00500>       Parameters for PERVIOUS surfaces in STANDHYD:
00501>       [IAper=   4.67 mm] [LGP=40.00 m] [MNP= .250]
00502>       Parameters for IMPERVIOUS surfaces in STANDHYD:
00503>       [IAimp=   1.57 mm] [CLI= 1.50]   [MNI= .013]
00504>       Parameters used in NASHYD:
00505>       [Ia=   4.67 mm] [N= 3.00]
00506>       Average monthly Pan Evaporation data in    (mm)
00507>    JAN   FEB   MAR   APR   MAY   JUN   JUL   AUG   SEP   OCT   NOV   DEC
00508>   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00
00509>       Average monthly Potential Evapotranspiration in    (mm)
00510>    JAN   FEB   MAR   APR   MAY   JUN   JUL   AUG   SEP   OCT   NOV   DEC
00511>   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00
00512> ##################################################################################
00513> # Post Development Conditions
00514> ##################################################################################
00515> # West Development
00516> ##################################################################################
00517> # Post-development drainage area to West SWM Pond
00518> R0025:C00004------------DTmin-ID:NHYD--------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00519>      CALIB STANDHYD         1.0 01:W_Pond        36.55    8.208 No_date    1:04   45.23 .777     .000
00520>           [XIMP=.66:TIMP=.71]
00521>           [Horton parameters: Fo= 76.20:Fc= 13.20:DCAY=4.14:  F= .00]
00522>           [Pervious     area: IAper= 4.67:SLPP=2.00:LGP=  40.:MNP=.250:SCP=   .0]
00523>           [Impervious   area: IAimp= 1.57:SLPI= .50:LGI= 494.:MNI=.013:SCI=   .0]
00524> ##################################################################################
00525> # West Pond Routing
00526> ##################################################################################
00527> R0025:C00005------------DTmin-ID:NHYD--------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00528>      ROUTE RESERVOIR ->     1.0 02:W_Pond        36.55    8.208 No_date    1:04   45.23  n/a     .000
00529>                        out <=    1.0 01:W_Pond-Out    36.55    .477 No_date    2:15   45.23  n/a     .000
00530>                     overflow <=    1.0 03:W_Pond-Ovf       .00    .000 No_date    0:00    .00  n/a     .000
00531>        (MxStoUsed=.1367E+01  m3, TotOvfVol=.0000E+00  m3, N-Ovf=    0, TotDurOvf=    0.hrs)
00532> ##################################################################################
00533> # Total post-development flows from West development
00534> ##################################################################################
00535> R0025:C00006------------DTmin-ID:NHYD--------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00536>      ADD HYD                1.0 02:W_Pond-Out    36.55    .477 No_date    2:15   45.23  n/a     .000
00537>                        +     1.0 02:W_Pond-Ovf       .00    .000 No_date    0:00    .00  n/a     .000
00538>                     SUM=     1.0 01:West          36.55    .477 No_date    2:15   45.23  n/a     .000
00539> ##################################################################################
00540> # East Development
00541> ##################################################################################
00542> # Post-development drainage area to East SWM Pond
00543> R0025:C00007------------DTmin-ID:NHYD--------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00544>      CALIB STANDHYD         1.0 01:E_Pond        25.81    6.082 No_date    1:03   45.23 .777     .000
00545>           [XIMP=.66:TIMP=.71]
00546>           [Horton parameters: Fo= 76.20:Fc= 13.20:DCAY=4.14:  F= .00]
00547>           [Pervious     area: IAper= 4.67:SLPP=2.00:LGP=  40.:MNP=.250:SCP=   .0]
00548>           [Impervious   area: IAimp= 1.57:SLPI= .50:LGI= 415.:MNI=.013:SCI=   .0]
00549> ##################################################################################
00550> # East Pond Routing
00551> ##################################################################################
00552> R0025:C00008------------DTmin-ID:NHYD--------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00553>      ROUTE RESERVOIR ->     1.0 02:E_Pond        25.81    6.082 No_date    1:03   45.23  n/a     .000
00554>                        out <=    1.0 01:E_Pond-Out    25.81    .468 No_date    1:57   45.23  n/a     .000
00555>                     overflow <=    1.0 03:E_Pond-Ovf       .00    .000 No_date    0:00    .00  n/a     .000
00556>        (MxStoUsed=.9205E+00  m3, TotOvfVol=.0000E+00  m3, N-Ovf=    0, TotDurOvf=    0.hrs)
00557> ##################################################################################
00558> # Total post-development flows from East development
00559> ##################################################################################
00560> R0025:C00009------------DTmin-ID:NHYD--------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00561>      ADD HYD                1.0 02:E_Pond-Out    25.81    .468 No_date    1:57   45.23  n/a     .000
00562>                        +     1.0 02:E_Pond-Ovf       .00    .000 No_date    0:00    .00  n/a     .000
00563>                     SUM=     1.0 01:East          25.81    .468 No_date    1:57   45.23  n/a     .000
00564> ##################################################################################
00565> # STORMS
00566> ##################################################################################
00567>  ** END OF RUN :   49
00568>
00569> ********************************************************************************
00570>
00571>
00572>
00573>
00574>
00575>  RUN#:COMMAND#
00576> R0050:C00001------------------------------------------------------------------------------
00577>       START
00578>       [TZERO =    .00 hrs on        0]
00579>       [METOUT=   2    (1=imperial, 2=metric output)]
00580>       [NSTORM=   1 ]
00581>       [NRUN  = 0050 ]
00582> ********************************************************************************
00583> #  SWMHYMO Ver:5.500/Feb 2015 / INPUT DATA FILE
00584> ********************************************************************************
00585> #  Project Name  : [Caivan Stittsville West properties]
00586> #  Project Number: [2267]
00587> #  Date          : [2023/11/28]
00588> #  Modeller      : [PP]
00589> #  Company       : J.F. Sabourin and Associates
00590> #  License #     : 2549237
00591> ********************************************************************************
00592> R0050:C00002------------------------------------------------------------------------------
00593>       READ STORM
00594>       Filename = storm.001
00595>       Comment  = CHICAGO STORM  50 Year, 3 Hours
00596>       [SDT=10.00:SDUR=   3.00:PTOT=  64.81]
00597> R0050:C00003------------------------------------------------------------------------------
00598>       DEFAULT VALUES
00599>       Filename = C:\Temp\P2267-Stittsville FSR\20231128-MSS Pond Sizing\Ottawa.val
00600>       ICASEdv  = 1 (read and print data)
00601>       FileTitle= File comment: [Parameters for City of Ottawa Projects]
00602>                  THE FOLLOWING PARAMETERS ARE USED IN THE DESIGN STANDHYD COM
00603>       Horton's infiltration equation parameters:
00604>       [Fo= 76.20 mm/hr] [Fc=13.20 mm/hr] [DCAY= 4.14 /hr] [F=  .00 mm]
00605>       Parameters for PERVIOUS surfaces in STANDHYD:
00606>       [IAper=   4.67 mm] [LGP=40.00 m] [MNP= .250]
00607>       Parameters for IMPERVIOUS surfaces in STANDHYD:
00608>       [IAimp=   1.57 mm] [CLI= 1.50]   [MNI= .013]
00609>       Parameters used in NASHYD:
00610>       [Ia=   4.67 mm] [N= 3.00]
00611>       Average monthly Pan Evaporation data in    (mm)
00612>    JAN   FEB   MAR   APR   MAY   JUN   JUL   AUG   SEP   OCT   NOV   DEC
00613>   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00
00614>       Average monthly Potential Evapotranspiration in    (mm)
00615>    JAN   FEB   MAR   APR   MAY   JUN   JUL   AUG   SEP   OCT   NOV   DEC
00616>   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00
00617> ##################################################################################
00618> # Post Development Conditions
00619> ##################################################################################
00620> # West Development
00621> ##################################################################################
00622> # Post-development drainage area to West SWM Pond
00623> R0050:C00004------------DTmin-ID:NHYD--------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00624>      CALIB STANDHYD         1.0 01:W_Pond        36.55    9.525 No_date    1:04   51.30 .792     .000
00625>           [XIMP=.66:TIMP=.71]
00626>           [Horton parameters: Fo= 76.20:Fc= 13.20:DCAY=4.14:  F= .00]
00627>           [Pervious     area: IAper= 4.67:SLPP=2.00:LGP=  40.:MNP=.250:SCP=   .0]
00628>           [Impervious   area: IAimp= 1.57:SLPI= .50:LGI= 494.:MNI=.013:SCI=   .0]
00629> ##################################################################################
00630> # West Pond Routing
00631> ##################################################################################
00632> R0050:C00005------------DTmin-ID:NHYD--------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00633>      ROUTE RESERVOIR ->     1.0 02:W_Pond        36.55    9.525 No_date    1:04   51.30  n/a     .000
00634>                        out <=    1.0 01:W_Pond-Out    36.55    .585 No_date    2:09   51.30  n/a     .000
00635>                     overflow <=    1.0 03:W_Pond-Ovf       .00    .000 No_date    0:00    .00  n/a     .000
00636>        (MxStoUsed=.1537E+01  m3, TotOvfVol=.0000E+00  m3, N-Ovf=    0, TotDurOvf=    0.hrs)
00637> ##################################################################################
00638> # Total post-development flows from West development
00639> ##################################################################################
00640> R0050:C00006------------DTmin-ID:NHYD--------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00641>      ADD HYD                1.0 02:W_Pond-Out    36.55    .585 No_date    2:09   51.30  n/a     .000
00642>                        +     1.0 02:W_Pond-Ovf       .00    .000 No_date    0:00    .00  n/a     .000
00643>                     SUM=     1.0 01:West          36.55    .585 No_date    2:09   51.30  n/a     .000
00644> ##################################################################################
00645> # East Development
00646> ##################################################################################
00647> # Post-development drainage area to East SWM Pond
00648> R0050:C00007------------DTmin-ID:NHYD--------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00649>      CALIB STANDHYD         1.0 01:E_Pond        25.81    7.057 No_date    1:03   51.30 .792     .000
00650>           [XIMP=.66:TIMP=.71]
00651>           [Horton parameters: Fo= 76.20:Fc= 13.20:DCAY=4.14:  F= .00]
00652>           [Pervious     area: IAper= 4.67:SLPP=2.00:LGP=  40.:MNP=.250:SCP=   .0]
00653>           [Impervious   area: IAimp= 1.57:SLPI= .50:LGI= 415.:MNI=.013:SCI=   .0]
00654> ##################################################################################
00655> # East Pond Routing
00656> ##################################################################################
00657> R0050:C00008------------DTmin-ID:NHYD--------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00658>      ROUTE RESERVOIR ->     1.0 02:E_Pond        25.81    7.057 No_date    1:03   51.30  n/a     .000
00659>                        out <=    1.0 01:E_Pond-Out    25.81    .572 No_date    1:54   51.30  n/a     .000
00660>                     overflow <=    1.0 03:E_Pond-Ovf       .00    .000 No_date    0:00    .00  n/a     .000
00661>        (MxStoUsed=.1036E+01  m3, TotOvfVol=.0000E+00  m3, N-Ovf=    0, TotDurOvf=    0.hrs)
00662> ##################################################################################
00663> # Total post-development flows from East development
00664> ##################################################################################
00665> R0050:C00009------------DTmin-ID:NHYD--------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00666>      ADD HYD                1.0 02:E_Pond-Out    25.81    .572 No_date    1:54   51.30  n/a     .000
00667>                        +     1.0 02:E_Pond-Ovf       .00    .000 No_date    0:00    .00  n/a     .000
00668>                     SUM=     1.0 01:East          25.81    .572 No_date    1:54   51.30  n/a     .000
00669> ##################################################################################
00670> # STORMS
00671> ##################################################################################
00672>  ** END OF RUN :   98
00673>
00674> ********************************************************************************
00675>
00676>
00677>
00678>
00679>
00680>  RUN#:COMMAND#
00681> R0099:C00001------------------------------------------------------------------------------
00682>       START
00683>       [TZERO =    .00 hrs on        0]
00684>       [METOUT=   2    (1=imperial, 2=metric output)]
00685>       [NSTORM=   1 ]
00686>       [NRUN  = 0099 ]
00687> ********************************************************************************
00688> #  SWMHYMO Ver:5.500/Feb 2015 / INPUT DATA FILE
00689> ********************************************************************************
00690> #  Project Name  : [Caivan Stittsville West properties]
00691> #  Project Number: [2267]
00692> #  Date          : [2023/11/28]
00693> #  Modeller      : [PP]
00694> #  Company       : J.F. Sabourin and Associates
00695> #  License #     : 2549237
00696> ********************************************************************************
00697> R0099:C00002------------------------------------------------------------------------------
00698>       READ STORM
00699>       Filename = storm.001
00700>       Comment  = CHICAGO STORM   100 Year, 3 Hours
00701>       [SDT=10.00:SDUR=   3.00:PTOT=  71.66]
00702> R0099:C00003------------------------------------------------------------------------------
00703>       DEFAULT VALUES
00704>       Filename = C:\Temp\P2267-Stittsville FSR\20231128-MSS Pond Sizing\Ottawa.val
00705>       ICASEdv  = 1 (read and print data)
00706>       FileTitle= File comment: [Parameters for City of Ottawa Projects]
00707>                  THE FOLLOWING PARAMETERS ARE USED IN THE DESIGN STANDHYD COM
00708>       Horton's infiltration equation parameters:
00709>       [Fo= 76.20 mm/hr] [Fc=13.20 mm/hr] [DCAY= 4.14 /hr] [F=  .00 mm]
00710>       Parameters for PERVIOUS surfaces in STANDHYD:
00711>       [IAper=   4.67 mm] [LGP=40.00 m] [MNP= .250]
00712>       Parameters for IMPERVIOUS surfaces in STANDHYD:
00713>       [IAimp=   1.57 mm] [CLI= 1.50]   [MNI= .013]
00714>       Parameters used in NASHYD:
00715>       [Ia=   4.67 mm] [N= 3.00]
00716>       Average monthly Pan Evaporation data in    (mm)
00717>    JAN   FEB   MAR   APR   MAY   JUN   JUL   AUG   SEP   OCT   NOV   DEC
00718>   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00
00719>       Average monthly Potential Evapotranspiration in    (mm)
00720>    JAN   FEB   MAR   APR   MAY   JUN   JUL   AUG   SEP   OCT   NOV   DEC
```

DRAFT

```
00721>    .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00
00722> ###############################################################################
00723> # Post Development Conditions
00724> ###############################################################################
00725> # West Development
00726> ###############################################################################
00727> # Post-development drainage area to West SWM Pond
00728> R0099:C00004------------DTmin-ID:NHYD--------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00729>      CALIB STANDHYD       1.0 01:W_Pond       36.55   10.788 No_date    1:04   57.75 .806     .000
00730>        [XIMP=.66:TIMP=.71]
00731>        [Horton parameters: Fo= 76.20:Fc= 13.20:DCAY=4.14:  F= .00]
00732>        [Pervious     area: IAper= 4.67:SLPP=2.00:LGP=  40.:MNP=.250:SCP=   .0]
00733>        [Impervious   area: IAimp= 1.57:SLPI= .50:LGI= 494.:MNI=.013:SCI=   .0]
00734> ###############################################################################
00735> # West Pond Routing
00736> ###############################################################################
00737> R0099:C00005------------DTmin-ID:NHYD--------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00738>      ROUTE RESERVOIR ->     1.0 02:W_Pond       36.55   10.788 No_date    1:04   57.75 n/a      .000
00739>                      out <=    1.0 01:W_Pond-Out    36.55     .706 No_date    2:05   57.75 n/a      .000
00740>                overflow <=     1.0 03:W_Pond-Ovf     .00     .000 No_date    0:00     .00 n/a      .000
00741>      (MxStoUsed=.1714E+01  m3, TotOvfVol=.0000E+00  m3, N-Ovf=     0, TotDurOvf=    0.hrs)
00742> ###############################################################################
00743> # Total post-development flows from West development
00744> ###############################################################################
00745> R0099:C00006------------DTmin-ID:NHYD--------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00746>      ADD HYD              1.0 02:W_Pond-Out    36.55     .706 No_date    2:05   57.75 n/a      .000
00747>                         +    1.0 02:W_Pond-Ovf     .00     .000 No_date    0:00     .00 n/a      .000
00748>                       SUM=    1.0 01:West         36.55     .706 No_date    2:05   57.75 n/a      .000
00749> ###############################################################################
00750> # East Pond Development
00751> ###############################################################################
00752> # Post-development drainage area to East SWM Pond
00753> R0099:C00007------------DTmin-ID:NHYD--------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00754>      CALIB STANDHYD       1.0 01:E_Pond       25.81    7.988 No_date    1:03   57.75 .806     .000
00755>        [XIMP=.66:TIMP=.71]
00756>        [Horton parameters: Fo= 76.20:Fc= 13.20:DCAY=4.14:  F= .00]
00757>        [Pervious     area: IAper= 4.67:SLPP=2.00:LGP=  40.:MNP=.250:SCP=   .0]
00758>        [Impervious   area: IAimp= 1.57:SLPI= .50:LGI= 415.:MNI=.013:SCI=   .0]
00759> ###############################################################################
00760> # East Pond Routing
00761> ###############################################################################
00762> R0099:C00008------------DTmin-ID:NHYD--------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00763>      ROUTE RESERVOIR ->     1.0 02:E_Pond       25.81    7.988 No_date    1:03   57.75 n/a      .000
00764>                      out <=    1.0 01:E_Pond-Out    25.81    .688 No_date    1:52   57.75 n/a      .000
00765>                overflow <=     1.0 03:E_Pond-Ovf     .00     .000 No_date    0:00     .00 n/a      .000
00766>      (MxStoUsed=.1157E+01  m3, TotOvfVol=.0000E+00  m3, N-Ovf=     0, TotDurOvf=    0.hrs)
00767> ###############################################################################
00768> # Total post-development flows from East development
00769> ###############################################################################
00770> R0099:C00009------------DTmin-ID:NHYD--------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00771>      ADD HYD              1.0 02:E_Pond-Out    25.81     .688 No_date    1:52   57.75 n/a      .000
00772>                         +    1.0 02:E_Pond-Ovf     .00     .000 No_date    0:00     .00 n/a      .000
00773>                       SUM=    1.0 01:East         25.81     .688 No_date    1:52   57.75 n/a      .000
00774> ###############################################################################
00775> # STORMS
00776> ###############################################################################
00777>   ** END OF RUN :  101
00778>
00779> ********************************************************************************
00780>
00781>
00782>
00783>
00784>
00785>  RUN#:COMMAND#
00786> R0102:C00001------------------------------------------------------------------------
00787>       START
00788>         [TZERO =    .00 hrs on       0]
00789>         [METOUT=   2   (1=imperial, 2=metric output)]
00790>         [NSTORM=   1 ]
00791>         [NRUN   = 0102 ]
00792> ********************************************************************************
00793> #  SWMHYMO Ver:5.500/Feb 2015 / INPUT DATA FILE
00794> ********************************************************************************
00795> #  Project Name  : [Caivan Stittsville West properties]
00796> #  Project Number: [2267]
00797> #  Date          : [2023/11/28]
00798> #  Modeller      : [PP]
00799> #  Company       : J.F. Sabourin and Associates
00800> #  License #     : 2549237
00801> ********************************************************************************
00802> R0102:C00002------------------------------------------------------------------------
00803>       READ STORM
00804>         Filename = storm.001
00805>         Comment  = 2 years SCS Type 2 Storm 24 Hours step 10 min, City of Ottawa
00806>         [SDT=10.00:SDUR=  24.00:PTOT=  48.46]
00807> R0102:C00003------------------------------------------------------------------------
00808>       DEFAULT VALUES
00809>         Filename = C:\Temp\P2267-Stittsville FSR\20231128-MSS Pond Sizing\Ottawa.val
00810>         ICASEdv  = 1 (read and print data)
00811>         FileTitle= File comment: [Parameters for City of Ottawa Projects]
00812>                    THE FOLLOWING PARAMETERS ARE USED IN THE DESIGN STANDHYD COM
00813>         Horton's infiltration equation parameters:
00814>         [Fo= 76.20 mm/hr] [Fc=13.20 mm/hr] [DCAY= 4.14 /hr] [F=  .00 mm]
00815>         Parameters for PERVIOUS surfaces in STANDHYD:
00816>         [IAper=   4.67 mm] [LGP=40.00 m] [MNP=.250]
00817>         Parameters for IMPERVIOUS surfaces in STANDHYD:
00818>         [IAimp=   1.57 mm] [CLI= 1.50]   [MNI= .013]
00819>         Parameters used in NASHYD:
00820>         [Ia=    4.67 mm] [N= 3.00]
00821>         Average monthly Fan Evaporation data in    (mm)
00822>      JAN   FEB   MAR   APR   MAY   JUN   JUL   AUG   SEP   OCT   NOV   DEC
00823>      .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00
00824>         Average monthly Potential Evapotranspiration in    (mm)
00825>      JAN   FEB   MAR   APR   MAY   JUN   JUL   AUG   SEP   OCT   NOV   DEC
00826>      .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00
00827> ###############################################################################
00828> # Post Development Conditions
00829> ###############################################################################
00830> # West Development
00831> ###############################################################################
00832> # Post-development  drainage area to West SWM Pond
00833> R0102:C00004------------DTmin-ID:NHYD--------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00834>      CALIB STANDHYD       1.0 01:W_Pond       36.55    3.191 No_date   12:04   34.35 .709     .000
00835>        [XIMP=.66:TIMP=.71]
00836>        [Horton parameters: Fo= 76.20:Fc= 13.20:DCAY=4.14:  F= .00]
00837>        [Pervious     area: IAper= 4.67:SLPP=2.00:LGP=  40.:MNP=.250:SCP=   .0]
00838>        [Impervious   area: IAimp= 1.57:SLPI= .50:LGI= 494.:MNI=.013:SCI=   .0]
00839> ###############################################################################
00840> # West Pond Routing
00841> ###############################################################################
00842> R0102:C00005------------DTmin-ID:NHYD--------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00843>      ROUTE RESERVOIR ->     1.0 02:W_Pond       36.55    3.191 No_date   12:04   34.35 n/a      .000
00844>                      out <=    1.0 01:W_Pond-Out    36.55     .218 No_date   13:22   34.35 n/a      .000
00845>                overflow <=     1.0 03:W_Pond-Ovf     .00     .000 No_date    0:00     .00 n/a      .000
00846>      (MxStoUsed=.8331E+00  m3, TotOvfVol=.0000E+00  m3, N-Ovf=     0, TotDurOvf=    0.hrs)
00847> ###############################################################################
00848> # Total post-development flows from West development
00849> ###############################################################################
00850> R0102:C00006------------DTmin-ID:NHYD--------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00851>      ADD HYD              1.0 02:W_Pond-Out    36.55     .218 No_date   13:22   34.35 n/a      .000
00852>                         +    1.0 02:W_Pond-Ovf     .00     .000 No_date    0:00     .00 n/a      .000
00853>                       SUM=    1.0 01:West         36.55     .218 No_date   13:22   34.35 n/a      .000
00854> ###############################################################################
00855> # East Development
00856> ###############################################################################
00857> # Post-development drainage area to East SWM Pond
00858> R0102:C00007------------DTmin-ID:NHYD--------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00859>      CALIB STANDHYD       1.0 01:E_Pond       25.81    2.355 No_date   12:04   34.35 .709     .000
00860>        [XIMP=.66:TIMP=.71]
00861>        [Horton parameters: Fo= 76.20:Fc= 13.20:DCAY=4.14:  F= .00]
00862>        [Pervious     area: IAper= 4.67:SLPP=2.00:LGP=  40.:MNP=.250:SCP=   .0]
00863>        [Impervious   area: IAimp= 1.57:SLPI= .50:LGI= 415.:MNI=.013:SCI=   .0]
00864> ###############################################################################
00865> # East Pond Routing
00866> ###############################################################################
00867> R0102:C00008------------DTmin-ID:NHYD--------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00868>      ROUTE RESERVOIR ->     1.0 02:E_Pond       25.81    2.355 No_date   12:04   34.35 n/a      .000
00869>                      out <=    1.0 01:E_Pond-Out    25.81     .218 No_date   13:03   34.35 n/a      .000
00870>                overflow <=     1.0 03:E_Pond-Ovf     .00     .000 No_date    0:00     .00 n/a      .000
00871>      (MxStoUsed=.5564E+00  m3, TotOvfVol=.0000E+00  m3, N-Ovf=     0, TotDurOvf=    0.hrs)
00872> ###############################################################################
00873> # Total post-development  flows from East development
00874> ###############################################################################
00875> R0102:C00009------------DTmin-ID:NHYD--------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00876>      ADD HYD              1.0 02:E_Pond-Out    25.81     .218 No_date   13:03   34.35 n/a      .000
00877>                         +    1.0 02:E_Pond-Ovf     .00     .000 No_date    0:00     .00 n/a      .000
00878>                       SUM=    1.0 01:East         25.81     .218 No_date   13:03   34.35 n/a      .000
00879> ###############################################################################
00880> # STORMS
00881> ###############################################################################
00882>   ** END OF RUN :  104
00883>
00884> ********************************************************************************
00885>
00886>
00887>
00888>
00889>
00890>  RUN#:COMMAND#
00891> R0105:C00001------------------------------------------------------------------------
00892>       START
00893>         [TZERO =    .00 hrs on       0]
00894>         [METOUT=   2   (1=imperial, 2=metric output)]
00895>         [NSTORM=   1 ]
00896>         [NRUN   = 0105 ]
00897> ********************************************************************************
00898> #  SWMHYMO Ver:5.500/Feb 2015 / INPUT DATA FILE
00899> ********************************************************************************
00900> #  Project Name  : [Caivan Stittsville West properties]
00901> #  Project Number: [2267]
00902> #  Date          : [2023/11/28]
00903> #  Modeller      : [PP]
00904> #  Company       : J.F. Sabourin and Associates
00905> #  License #     : 2549237
00906> ********************************************************************************
00907> R0105:C00002------------------------------------------------------------------------
00908>       READ STORM
00909>         Filename = storm.001
00910>         Comment  = 5 years SCS Type 2 Storm 24 Hours step 10 min, City of Ottawa
00911>         [SDT=10.00:SDUR=  24.00:PTOT=  64.11]
00912> R0105:C00003------------------------------------------------------------------------
00913>       DEFAULT VALUES
00914>         Filename = C:\Temp\P2267-Stittsville FSR\20231128-MSS Pond Sizing\Ottawa.val
00915>         ICASEdv  = 1 (read and print data)
00916>         FileTitle= File comment: [Parameters for City of Ottawa Projects]
00917>                    THE FOLLOWING PARAMETERS ARE USED IN THE DESIGN STANDHYD COM
00918>         Horton's infiltration equation parameters:
00919>         [Fo= 76.20 mm/hr] [Fc=13.20 mm/hr] [DCAY= 4.14 /hr] [F=  .00 mm]
00920>         Parameters for PERVIOUS surfaces in STANDHYD:
00921>         [IAper=   4.67 mm] [LGP=40.00 m] [MNP=.250]
00922>         Parameters for IMPERVIOUS surfaces in STANDHYD:
00923>         [IAimp=   1.57 mm] [CLI= 1.50]   [MNI= .013]
00924>         Parameters used in NASHYD:
00925>         [Ia=    4.67 mm] [N= 3.00]
00926>         Average monthly Fan Evaporation data in    (mm)
00927>      JAN   FEB   MAR   APR   MAY   JUN   JUL   AUG   SEP   OCT   NOV   DEC
00928>      .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00
00929>         Average monthly Potential Evapotranspiration in    (mm)
00930>      JAN   FEB   MAR   APR   MAY   JUN   JUL   AUG   SEP   OCT   NOV   DEC
00931>      .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00
00932> ###############################################################################
00933> # Post Development Conditions
00934> ###############################################################################
00935> # West Development
00936> ###############################################################################
00937> # Post-development drainage area to West SWM Pond
00938> R0105:C00004------------DTmin-ID:NHYD--------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00939>      CALIB STANDHYD       1.0 01:W_Pond       36.55    4.705 No_date   12:04   46.90 .732     .000
00940>        [XIMP=.66:TIMP=.71]
00941>        [Horton parameters: Fo= 76.20:Fc= 13.20:DCAY=4.14:  F= .00]
00942>        [Pervious     area: IAper= 4.67:SLPP=2.00:LGP=  40.:MNP=.250:SCP=   .0]
00943>        [Impervious   area: IAimp= 1.57:SLPI= .50:LGI= 494.:MNI=.013:SCI=   .0]
00944> ###############################################################################
00945> # West Pond Routing
00946> ###############################################################################
00947> R0105:C00005------------DTmin-ID:NHYD--------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00948>      ROUTE RESERVOIR ->     1.0 02:W_Pond       36.55    4.705 No_date   12:04   46.90 n/a      .000
00949>                      out <=    1.0 01:W_Pond-Out    36.55     .344 No_date   13:09   46.90 n/a      .000
00950>                overflow <=     1.0 03:W_Pond-Ovf     .00     .000 No_date    0:00     .00 n/a      .000
00951>      (MxStoUsed=.1134E+01  m3, TotOvfVol=.0000E+00  m3, N-Ovf=     0, TotDurOvf=    0.hrs)
00952> ###############################################################################
00953> # Total post-development flows from West development
00954> ###############################################################################
00955> R0105:C00006------------DTmin-ID:NHYD--------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00956>      ADD HYD              1.0 02:W_Pond-Out    36.55     .344 No_date   13:09   46.90 n/a      .000
00957>                         +    1.0 02:W_Pond-Ovf     .00     .000 No_date    0:00     .00 n/a      .000
00958>                       SUM=    1.0 01:West         36.55     .344 No_date   13:09   46.90 n/a      .000
00959> ###############################################################################
00960> # East Development
00961> ###############################################################################
00962> # Post-development drainage area to East SWM Pond
00963> R0105:C00002------------DTmin-ID:NHYD--------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00964>      CALIB STANDHYD       1.0 01:E_Pond       25.81    3.469 No_date   12:03   46.90 .732     .000
00965>        [XIMP=.66:TIMP=.71]
00966>        [Horton parameters: Fo= 76.20:Fc= 13.20:DCAY=4.14:  F= .00]
00967>        [Pervious     area: IAper= 4.67:SLPP=2.00:LGP=  40.:MNP=.250:SCP=   .0]
00968>        [Impervious   area: IAimp= 1.57:SLPI= .50:LGI= 415.:MNI=.013:SCI=   .0]
00969> ###############################################################################
00970> # East Pond Routing
00971> ###############################################################################
00972> R0105:C00008------------DTmin-ID:NHYD--------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00973>      ROUTE RESERVOIR ->     1.0 02:E_Pond       25.81    3.469 No_date   12:03   46.90 n/a      .000
00974>                      out <=    1.0 01:E_Pond-Out    25.81     .335 No_date   12:51   46.90 n/a      .000
00975>                overflow <=     1.0 03:E_Pond-Ovf     .00     .000 No_date    0:00     .00 n/a      .000
00976>      (MxStoUsed=.7576E+00  m3, TotOvfVol=.0000E+00  m3, N-Ovf=     0, TotDurOvf=    0.hrs)
00977> ###############################################################################
00978> # Total post-development flows from East development
00979> ###############################################################################
00980> R0105:C00009------------DTmin-ID:NHYD--------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00981>      ADD HYD              1.0 02:E_Pond-Out    25.81     .335 No_date   12:51   46.90 n/a      .000
00982>                         +    1.0 02:E_Pond-Ovf     .00     .000 No_date    0:00     .00 n/a      .000
00983>                       SUM=    1.0 01:East         25.81     .335 No_date   12:51   46.90 n/a      .000
00984> ###############################################################################
00985> # STORMS
00986> ###############################################################################
00987>   ** END OF RUN :  109
00988>
00989> ********************************************************************************
00990>
00991>
00992>
00993>
00994>
00995>  RUN#:COMMAND#
00996> R0110:C00001------------------------------------------------------------------------
00997>       START
00998>         [TZERO =    .00 hrs on       0]
00999>         [METOUT=   2   (1=imperial, 2=metric output)]
01000>         [NSTORM=   1 ]
01001>         [NRUN   = 0110 ]
01002> ********************************************************************************
01003> #  SWMHYMO Ver:5.500/Feb 2015 / INPUT DATA FILE
01004> ********************************************************************************
01005> #  Project Name  : [Caivan Stittsville West properties]
01006> #  Project Number: [2267]
01007> #  Date          : [2023/11/28]
01008> #  Modeller      : [PP]
01009> #  Company       : J.F. Sabourin and Associates
01010> #  License #     : 2549237
01011> ********************************************************************************
01012> R0110:C00002------------------------------------------------------------------------
01013>       READ STORM
01014>         Filename = storm.001
01015>         Comment  = 10 years SCS Type 2 Storm 24 Hours step 10 min, City of Ottawa
01016>         [SDT=10.00:SDUR=  24.00:PTOT=  74.35]
01017> R0110:C00003------------------------------------------------------------------------
01018>       DEFAULT VALUES
01019>         Filename = C:\Temp\P2267-Stittsville FSR\20231128-MSS Pond Sizing\Ottawa.val
01020>         ICASEdv  = 1 (read and print data)
01021>         FileTitle= File comment: [Parameters for City of Ottawa Projects]
01022>                    THE FOLLOWING PARAMETERS ARE USED IN THE DESIGN STANDHYD COM
01023>         Horton's infiltration equation parameters:
01024>         [Fo= 76.20 mm/hr] [Fc=13.20 mm/hr] [DCAY= 4.14 /hr] [F=  .00 mm]
01025>         Parameters for PERVIOUS surfaces in STANDHYD:
01026>         [IAper=   4.67 mm] [LGP=40.00 m] [MNP=.250]
01027>         Parameters for IMPERVIOUS surfaces in STANDHYD:
01028>         [IAimp=   1.57 mm] [CLI= 1.50]   [MNI= .013]
01029>         Parameters used in NASHYD:
01030>         [Ia=    4.67 mm] [N= 3.00]
01031>         Average monthly Fan Evaporation data in    (mm)
01032>      JAN   FEB   MAR   APR   MAY   JUN   JUL   AUG   SEP   OCT   NOV   DEC
01033>      .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00
01034>         Average monthly Potential Evapotranspiration in    (mm)
01035>      JAN   FEB   MAR   APR   MAY   JUN   JUL   AUG   SEP   OCT   NOV   DEC
01036>      .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00
01037> ###############################################################################
01038> # Post Development Conditions
01039> ###############################################################################
01040> # West Development
01041> ###############################################################################
01042> # Post-development drainage area to West SWM Pond
01043> R0110:C00004------------DTmin-ID:NHYD--------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
01044>      CALIB STANDHYD       1.0 01:W_Pond       36.55    5.757 No_date   12:04   55.24 .743     .000
01045>        [XIMP=.66:TIMP=.71]
01046>        [Horton parameters: Fo= 76.20:Fc= 13.20:DCAY=4.14:  F= .00]
01047>        [Pervious     area: IAper= 4.67:SLPP=2.00:LGP=  40.:MNP=.250:SCP=   .0]
01048>        [Impervious   area: IAimp= 1.57:SLPI= .50:LGI= 494.:MNI=.013:SCI=   .0]
01049> ###############################################################################
01050> # West Pond Routing
01051> ###############################################################################
01052> R0110:C00005------------DTmin-ID:NHYD--------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
01053>      ROUTE RESERVOIR ->     1.0 02:W_Pond       36.55    5.757 No_date   12:04   55.24 n/a      .000
01054>                      out <=    1.0 01:W_Pond-Out    36.55     .455 No_date   13:01   55.24 n/a      .000
01055>                overflow <=     1.0 03:W_Pond-Ovf     .00     .000 No_date    0:00     .00 n/a      .000
01056>      (MxStoUsed=.1329E+01  m3, TotOvfVol=.0000E+00  m3, N-Ovf=     0, TotDurOvf=    0.hrs)
01057> ###############################################################################
01058> # Total post-development flows from West development
01059> ###############################################################################
01060> R0110:C00006------------DTmin-ID:NHYD--------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
01061>      ADD HYD              1.0 02:W_Pond-Out    36.55     .455 No_date   13:01   55.24 n/a      .000
01062>                         +    1.0 02:W_Pond-Ovf     .00     .000 No_date    0:00     .00 n/a      .000
01063>                       SUM=    1.0 01:West         36.55     .455 No_date   13:01   55.24 n/a      .000
01064> ###############################################################################
01065> # East Development
01066> ###############################################################################
01067> # Post-development drainage area to East SWM Pond
01068> R0110:C00007------------DTmin-ID:NHYD--------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
01069>      CALIB STANDHYD       1.0 01:E_Pond       25.81    4.243 No_date   12:03   55.24 .743     .000
01070>        [XIMP=.66:TIMP=.71]
01071>        [Horton parameters: Fo= 76.20:Fc= 13.20:DCAY=4.14:  F= .00]
01072>        [Pervious     area: IAper= 4.67:SLPP=2.00:LGP=  40.:MNP=.250:SCP=   .0]
01073>        [Impervious   area: IAimp= 1.57:SLPI= .50:LGI= 415.:MNI=.013:SCI=   .0]
01074> ###############################################################################
01075> # East Pond Routing
01076> ###############################################################################
01077> R0110:C00008------------DTmin-ID:NHYD--------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
01078>      ROUTE RESERVOIR ->     1.0 02:E_Pond       25.81    4.243 No_date   12:03   55.24 n/a      .000
01079>                      out <=    1.0 01:E_Pond-Out    25.81     .441 No_date   12:45   55.24 n/a      .000
01080>                overflow <=     1.0 03:E_Pond-Ovf     .00     .000 No_date    0:00     .00 n/a      .000
```

DRAFT

```
01081>      (MxStoUsed=.8882E+00  m3, TotOvfVol=.0000E+00  m3, N-Ovf=    0, TotDurOvf=    0.hrs)
01082> ##############################################################################
01083> # Total post-development flows from East development
01084> ##############################################################################
01085> R0110:C00009------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
01086>     ADD HYD                1.0 02:E_Pond-Out    25.81     .441 No_date   12:45   55.24  n/a     .000
01087>                  +         1.0 02:E_Pond-Ovf       .00     .000 No_date    0:00     .00  n/a     .000
01088>                SUM=        1.0 01:East          25.81     .441 No_date   12:45   55.24  n/a     .000
01089> ##############################################################################
01090> # STORMS
01091> ##############################################################################
01092>   ** END OF RUN :  124
01093>
01094> ******************************************************************************************************
01095>
01096>
01097>
01098>
01099>
01100>  RUN#:COMMAND#
01101> R0125:C00001------------------------------------------------------------------------------------------
01102>      START
01103>        [TZERO =    .00 hrs on        0]
01104>        [METOUT=   2    (1=imperial, 2=metric output)]
01105>        [NSTORM=   1 ]
01106>        [NRUN  = 0125 ]
01107> *****************************************************************************
01108> #  SWMHYMO Ver:5.500/Feb 2015 / INPUT DATA FILE
01109> *****************************************************************************
01110> #  Project Name  : [Caivan Stittsville West properties]
01111> #  Project Number: [2267]
01112> #  Date          : [2023/11/28]
01113> #  Modeller      : [PP]
01114> #  Company       : J.F. Sabourin and Associates
01115> #  License #     : 2549237
01116> *****************************************************************************
01117> R0125:C00002------------------------------------------------------------------------------------------
01118>      READ STORM
01119>        Filename = storm.001
01120>        Comment  = 25 years SCS Type 2 Storm 24 Hours step 10 min, City of Ottawa
01121>        [SDT=10.00:SDUR=  24.00:PTOT=  86.89]
01122> R0125:C00003------------------------------------------------------------------------------------------
01123>      DEFAULT VALUES
01124>        Filename = C:\Temp\P2267-Stittsville FSR\20231128-MSS Pond Sizing\Ottawa.val
01125>        ICASEdv  = 1 (read and print data)
01126>        FileTitle= File comment: [Parameters for City of Ottawa Projects]
01127>                   THE FOLLOWING PARAMETERS ARE USED IN THE DESIGN STANDHYD COM
01128>        Horton's infiltration equation parameters:
01129>        [Fo= 76.20 mm/hr] [Fc=13.20 mm/hr] [DCAY= 4.14 /hr] [F=  .00 mm]
01130>        Parameters for PERVIOUS surfaces in STANDHYD:
01131>        [IAperm=   4.67 mm] [LGP=40.00 m] [MNP= .250]
01132>        Parameters for IMPERVIOUS surfaces in STANDHYD:
01133>        [IAimp=   1.57 mm] [CLI= 1.50]   [MNI= .013]
01134>        Parameters used in NASHYD:
01135>        [Ia=   4.67 mm] [N= 3.00]
01136>        Average monthly Fan Evaporation data in    (mm)
01137>     JAN   FEB   MAR   APR   MAY   JUN   JUL   AUG   SEP   OCT   NOV   DEC
01138>    .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00
01139>        Average monthly Potential Evapotranspiration in    (mm)
01140>     JAN   FEB   MAR   APR   MAY   JUN   JUL   AUG   SEP   OCT   NOV   DEC
01141>    .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00
01142> ##############################################################################
01143> # Post Development Conditions
01144> ##############################################################################
01145> # West Development
01146> ##############################################################################
01147> # Post-development drainage area to West SWM Pond
01148> R0125:C00004------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
01149>     CALIB STANDHYD         1.0 01:W_Pond        36.55    7.086 No_date   12:03   65.62 .755     .000
01150>        [XIMP=.66:TIMP=.71]
01151>        [Horton parameters: Fo= 76.20:Fc= 13.20:DCAY=4.14:  F= .00]
01152>        [Pervious     area: IAper= 4.67:SLPP=2.00:LGP=  40.:MNP=.250:SCP=   .0]
01153>        [Impervious   area: IAimp= 1.57:SLPI= .50:LGI= 494.:MNI=.013:SCI=   .0]
01154> ##############################################################################
01155> # West Pond Routing
01156> ##############################################################################
01157> R0125:C00005------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
01158>     ROUTE RESERVOIR ->     1.0 02:W_Pond        36.55    7.086 No_date   12:03   65.62  n/a     .000
01159>                   out <=   1.0 01:W_Pond-Out    36.55    .667 No_date   12:50   65.62  n/a     .000
01160>              overflow <=   1.0 03:W_Pond-Ovf       .00     .000 No_date    0:00     .00  n/a     .000
01161>     (MxStoUsed=.1567E+01  m3, TotOvfVol=.0000E+00  m3, N-Ovf=    0, TotDurOvf=    0.hrs)
01162> ##############################################################################
01163> # Total post-development flows from West development
01164> ##############################################################################
01165> R0125:C00006------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
01166>     ADD HYD                1.0 02:W_Pond-Out    36.55     .667 No_date   12:50   65.62  n/a     .000
01167>                  +         1.0 02:W_Pond-Ovf       .00     .000 No_date    0:00     .00  n/a     .000
01168>                SUM=        1.0 01:West          36.55     .667 No_date   12:50   65.62  n/a     .000
01169> ##############################################################################
01170> # East Development
01171> ##############################################################################
01172> # Post-development drainage area to East SWM Pond
01173> R0125:C00007------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
01174>     CALIB STANDHYD         1.0 01:E_Pond        25.81    5.212 No_date   12:02   65.62 .755     .000
01175>        [XIMP=.66:TIMP=.71]
01176>        [Horton parameters: Fo= 76.20:Fc= 13.20:DCAY=4.14:  F= .00]
01177>        [Pervious     area: IAper= 4.67:SLPP=2.00:LGP=  40.:MNP=.250:SCP=   .0]
01178>        [Impervious   area: IAimp= 1.57:SLPI= .50:LGI= 415.:MNI=.013:SCI=   .0]
01179> ##############################################################################
01180> # East Pond Routing
01181> ##############################################################################
01182> R0125:C00008------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
01183>     ROUTE RESERVOIR ->     1.0 02:E_Pond        25.81    5.212 No_date   12:02   65.62  n/a     .000
01184>                   out <=   1.0 01:E_Pond-Out    25.81     .585 No_date   12:42   65.62  n/a     .000
01185>              overflow <=   1.0 03:E_Pond-Ovf       .00     .000 No_date    0:00     .00  n/a     .000
01186>     (MxStoUsed=.1049E+01  m3, TotOvfVol=.0000E+00  m3, N-Ovf=    0, TotDurOvf=    0.hrs)
01187> ##############################################################################
01188> # Total post-development flows from East development
01189> ##############################################################################
01190> R0125:C00009------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
01191>     ADD HYD                1.0 02:E_Pond-Out    25.81     .585 No_date   12:42   65.62  n/a     .000
01192>                  +         1.0 02:E_Pond-Ovf       .00     .000 No_date    0:00     .00  n/a     .000
01193>                SUM=        1.0 01:East          25.81     .585 No_date   12:42   65.62  n/a     .000
01194> ##############################################################################
01195> # STORMS
01196> ##############################################################################
01197>   ** END OF RUN :  149
01198>
01199> ******************************************************************************************************
01200>
01201>
01202>
01203>
01204>
01205>  RUN#:COMMAND#
01206> R0150:C00001------------------------------------------------------------------------------------------
01207>      START
01208>        [TZERO =    .00 hrs on        0]
01209>        [METOUT=   2    (1=imperial, 2=metric output)]
01210>        [NSTORM=   1 ]
01211>        [NRUN  = 0150 ]
01212> *****************************************************************************
01213> #  SWMHYMO Ver:5.500/Feb 2015 / INPUT DATA FILE
01214> *****************************************************************************
01215> #  Project Name  : [Caivan Stittsville West properties]
01216> #  Project Number: [2267]
01217> #  Date          : [2023/11/28]
01218> #  Modeller      : [PP]
01219> #  Company       : J.F. Sabourin and Associates
01220> #  License #     : 2549237
01221> *****************************************************************************
01222> R0150:C00002------------------------------------------------------------------------------------------
01223>      READ STORM
01224>        Filename = storm.001
01225>        Comment  = 50 years SCS Type 2 Storm 24 Hours step 10 min, City of Ottawa
01226>        [SDT=10.00:SDUR=  24.00:PTOT=  96.53]
01227> R0150:C00003------------------------------------------------------------------------------------------
01228>      DEFAULT VALUES
01229>        Filename = C:\Temp\P2267-Stittsville FSR\20231128-MSS Pond Sizing\Ottawa.val
01230>        ICASEdv  = 1 (read and print data)
01231>        FileTitle= File comment: [Parameters for City of Ottawa Projects]
01232>                   THE FOLLOWING PARAMETERS ARE USED IN THE DESIGN STANDHYD COM
01233>        Horton's infiltration equation parameters:
01234>        [Fo= 76.20 mm/hr] [Fc=13.20 mm/hr] [DCAY= 4.14 /hr] [F=  .00 mm]
01235>        Parameters for PERVIOUS surfaces in STANDHYD:
01236>        [IAperm=   4.67 mm] [LGP=40.00 m] [MNP= .250]
01237>        Parameters for IMPERVIOUS surfaces in STANDHYD:
01238>        [IAimp=   1.57 mm] [CLI= 1.50]   [MNI= .013]
01239>        Parameters used in NASHYD:
01240>        [Ia=   4.67 mm] [N= 3.00]
01241>        Average monthly Fan Evaporation data in    (mm)
01242>     JAN   FEB   MAR   APR   MAY   JUN   JUL   AUG   SEP   OCT   NOV   DEC
01243>    .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00
01244>        Average monthly Potential Evapotranspiration in    (mm)
01245>     JAN   FEB   MAR   APR   MAY   JUN   JUL   AUG   SEP   OCT   NOV   DEC
01246>    .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00
01247> ##############################################################################
01248> # Post Development Conditions
01249> ##############################################################################
01250> # West Development
01251> ##############################################################################
01252> # Post-development drainage area to West SWM Pond
01253> R0150:C00004------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
01254>     CALIB STANDHYD         1.0 01:W_Pond        36.55    8.099 No_date   12:03   73.59 .762     .000
01255>        [XIMP=.66:TIMP=.71]
01256>        [Horton parameters: Fo= 76.20:Fc= 13.20:DCAY=4.14:  F= .00]
01257>        [Pervious     area: IAper= 4.67:SLPP=2.00:LGP=  40.:MNP=.250:SCP=   .0]
01258>        [Impervious   area: IAimp= 1.57:SLPI= .50:LGI= 494.:MNI=.013:SCI=   .0]
01259> ##############################################################################
01260> # West Pond Routing
01261> ##############################################################################
01262> R0150:C00005------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
01263>     ROUTE RESERVOIR ->     1.0 02:W_Pond        36.55    8.099 No_date   12:03   73.59  n/a     .000
01264>                   out <=   1.0 01:W_Pond-Out    36.55     .805 No_date   12:47   73.59  n/a     .000
01265>              overflow <=   1.0 03:W_Pond-Ovf       .00     .000 No_date    0:00     .00  n/a     .000
01266>     (MxStoUsed=.1748E+01  m3, TotOvfVol=.0000E+00  m3, N-Ovf=    0, TotDurOvf=    0.hrs)
01267> ##############################################################################
01268> # Total post-development flows from West development
01269> ##############################################################################
01270> R0150:C00006------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
01271>     ADD HYD                1.0 02:W_Pond-Out    36.55     .805 No_date   12:47   73.59  n/a     .000
01272>                  +         1.0 02:W_Pond-Ovf       .00     .000 No_date    0:00     .00  n/a     .000
01273>                SUM=        1.0 01:West          36.55     .805 No_date   12:47   73.59  n/a     .000
01274> ##############################################################################
01275> # East Development
01276> ##############################################################################
01277> # Post-development drainage area to East SWM Pond
01278> R0150:C00007------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
01279>     CALIB STANDHYD         1.0 01:E_Pond        25.81    5.902 No_date   12:02   73.59 .762     .000
01280>        [XIMP=.66:TIMP=.71]
01281>        [Horton parameters: Fo= 76.20:Fc= 13.20:DCAY=4.14:  F= .00]
01282>        [Pervious     area: IAper= 4.67:SLPP=2.00:LGP=  40.:MNP=.250:SCP=   .0]
01283>        [Impervious   area: IAimp= 1.57:SLPI= .50:LGI= 415.:MNI=.013:SCI=   .0]
01284> ##############################################################################
01285> # East Pond Routing
01286> ##############################################################################
01287> R0150:C00008------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
01288>     ROUTE RESERVOIR ->     1.0 02:E_Pond        25.81    5.902 No_date   12:02   73.58  n/a     .000
01289>                   out <=   1.0 01:E_Pond-Out    25.81     .712 No_date   12:40   73.59  n/a     .000
01290>              overflow <=   1.0 03:E_Pond-Ovf       .00     .000 No_date    0:00     .00  n/a     .000
01291>     (MxStoUsed=.1170E+01  m3, TotOvfVol=.0000E+00  m3, N-Ovf=    0, TotDurOvf=    0.hrs)
01292> ##############################################################################
01293> # Total post-development flows from East development
01294> ##############################################################################
01295> R0150:C00009------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
01296>     ADD HYD                1.0 02:E_Pond-Out    25.81     .712 No_date   12:40   73.59  n/a     .000
01297>                  +         1.0 02:E_Pond-Ovf       .00     .000 No_date    0:00     .00  n/a     .000
01298>                SUM=        1.0 01:East          25.81     .712 No_date   12:40   73.59  n/a     .000
01299> ##############################################################################
01300> # STORMS
01301> ##############################################################################
01302>   ** END OF RUN :  198
01303>
01304> ******************************************************************************************************
01305>
01306>
01307>
01308>
01309>
01310>  RUN#:COMMAND#
01311> R0199:C00001------------------------------------------------------------------------------------------
01312>      START
01313>        [TZERO =    .00 hrs on        0]
01314>        [METOUT=   2    (1=imperial, 2=metric output)]
01315>        [NSTORM=   1 ]
01316>        [NRUN  = 0199 ]
01317> *****************************************************************************
01318> #  SWMHYMO Ver:5.500/Feb 2015 / INPUT DATA FILE
01319> *****************************************************************************
01320> #  Project Name  : [Caivan Stittsville West properties]
01321> #  Project Number: [2267]
01322> #  Date          : [2023/11/28]
01323> #  Modeller      : [PP]
01324> #  Company       : J.F. Sabourin and Associates
01325> #  License #     : 2549237
01326> *****************************************************************************
01327> R0199:C00002------------------------------------------------------------------------------------------
01328>      READ STORM
01329>        Filename = storm.001
01330>        Comment  = 100 years SCS Type 2 Storm 24 Hours step 10 min, City of Ottawa
01331>        [SDT=10.00:SDUR=  24.00:PTOT= 106.73]
01332> R0199:C00003------------------------------------------------------------------------------------------
01333>      DEFAULT VALUES
01334>        Filename = C:\Temp\P2267-Stittsville FSR\20231128-MSS Pond Sizing\Ottawa.val
01335>        ICASEdv  = 1 (read and print data)
01336>        FileTitle= File comment: [Parameters for City of Ottawa Projects]
01337>                   THE FOLLOWING PARAMETERS ARE USED IN THE DESIGN STANDHYD COM
01338>        Horton's infiltration equation parameters:
01339>        [Fo= 76.20 mm/hr] [Fc=13.20 mm/hr] [DCAY= 4.14 /hr] [F=  .00 mm]
01340>        Parameters for PERVIOUS surfaces in STANDHYD:
01341>        [IAperm=   4.67 mm] [LGP=40.00 m] [MNP= .250]
01342>        Parameters for IMPERVIOUS surfaces in STANDHYD:
01343>        [IAimp=   1.57 mm] [CLI= 1.50]   [MNI= .013]
01344>        Parameters used in NASHYD:
01345>        [Ia=   4.67 mm] [N= 3.00]
01346>        Average monthly Fan Evaporation data in    (mm)
01347>     JAN   FEB   MAR   APR   MAY   JUN   JUL   AUG   SEP   OCT   NOV   DEC
01348>    .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00
01349>        Average monthly Potential Evapotranspiration in    (mm)
01350>     JAN   FEB   MAR   APR   MAY   JUN   JUL   AUG   SEP   OCT   NOV   DEC
01351>    .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00
01352> ##############################################################################
01353> # Post Development Conditions
01354> ##############################################################################
01355> # West Development
01356> ##############################################################################
01357> # Post-development drainage area to West SWM Pond
01358> R0199:C00004------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
01359>     CALIB STANDHYD         1.0 01:W_Pond        36.55    9.165 No_date   12:02   81.94 .768     .000
01360>        [XIMP=.66:TIMP=.71]
01361>        [Horton parameters: Fo= 76.20:Fc= 13.20:DCAY=4.14:  F= .00]
01362>        [Pervious     area: IAper= 4.67:SLPP=2.00:LGP=  40.:MNP=.250:SCP=   .0]
01363>        [Impervious   area: IAimp= 1.57:SLPI= .50:LGI= 494.:MNI=.013:SCI=   .0]
01364> ##############################################################################
01365> # West Pond Routing
01366> ##############################################################################
01367> R0199:C00005------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
01368>     ROUTE RESERVOIR ->     1.0 02:W_Pond        36.55    9.165 No_date   12:02   81.94  n/a     .000
01369>                   out <=   1.0 01:W_Pond-Out    36.55     .960 No_date   12:44   81.94  n/a     .000
01370>              overflow <=   1.0 03:W_Pond-Ovf       .00     .000 No_date    0:00     .00  n/a     .000
01371>     (MxStoUsed=.1931E+01  m3, TotOvfVol=.0000E+00  m3, N-Ovf=    0, TotDurOvf=    0.hrs)
01372> ##############################################################################
01373> # Total post-development flows from West development
01374> ##############################################################################
01375> R0199:C00006------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
01376>     ADD HYD                1.0 02:W_Pond-Out    36.55     .960 No_date   12:44   81.94  n/a     .000
01377>                  +         1.0 02:W_Pond-Ovf       .00     .000 No_date    0:00     .00  n/a     .000
01378>                SUM=        1.0 01:West          36.55     .960 No_date   12:44   81.94  n/a     .000
01379> ##############################################################################
01380> # East Development
01381> ##############################################################################
01382> # Post-development drainage area to East SWM Pond
01383> R0199:C00007------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
01384>     CALIB STANDHYD         1.0 01:E_Pond        25.81    6.693 No_date   12:02   81.94 .768     .000
01385>        [XIMP=.66:TIMP=.71]
01386>        [Horton parameters: Fo= 76.20:Fc= 13.20:DCAY=4.14:  F= .00]
01387>        [Pervious     area: IAper= 4.67:SLPP=2.00:LGP=  40.:MNP=.250:SCP=   .0]
01388>        [Impervious   area: IAimp= 1.57:SLPI= .50:LGI= 415.:MNI=.013:SCI=   .0]
01389> ##############################################################################
01390> # East Pond Routing
01391> ##############################################################################
01392> R0199:C00008------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
01393>     ROUTE RESERVOIR ->     1.0 02:E_Pond        25.81    6.693 No_date   12:02   81.94  n/a     .000
01394>                   out <=   1.0 01:E_Pond-Out    25.81     .926 No_date   12:37   81.94  n/a     .000
01395>              overflow <=   1.0 03:E_Pond-Ovf       .00     .000 No_date    0:00     .00  n/a     .000
01396>     (MxStoUsed=.1285E+01  m3, TotOvfVol=.0000E+00  m3, N-Ovf=    0, TotDurOvf=    0.hrs)
01397> ##############################################################################
01398> # Total post-development flows from East development
01399> ##############################################################################
01400> R0199:C00009------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
01401>     ADD HYD                1.0 02:E_Pond-Out    25.81     .926 No_date   12:37   81.94  n/a     .000
01402>                  +         1.0 02:E_Pond-Ovf       .00     .000 No_date    0:00     .00  n/a     .000
01403>                SUM=        1.0 01:East          25.81     .926 No_date   12:37   81.94  n/a     .000
01404> ##############################################################################
01405> # STORMS
01406> ##############################################################################
01407> R0199:C00002------------------------------------------------------------------------------------------
01408>    FINISH
01409> ------------------------------------------------------------------------------------------------------
01410> ******************************************************************************************************
01411>      WARNINGS / ERRORS / NOTES
01412>      -------------------------
01413>   Simulation ended on 2023-11-28     at 13:41:06
01414> ======================================================================================================
01415>
```

DRAFT

```
00001> 20     Metric units / ID Numbers OFF
00002> *$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$
00003> *$  SWMHYMO Ver:5.500/Feb 2015 / INPUT DATA FILE
00004> *$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$
00005> *$  Project Name  : [Caivan Stittsville West properties]
00006> *$  Project Number: [2267]
00007> *$  Date          : [2023/11/28]
00008> *$  Modeller      : [PP]
00009> *$  Company       : J.F. Sabourin and Associates
00010> *$  License #     : 2549237
00011> *$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$$
00012> *%  25 mm Storm based on 2-Year, 3-Hour Chicago Storm
00013> START               TZERO=[0.0],  METOUT=[2],  NSTORM=[1],  NRUN=[001]
00014> *%                   ["25MMC3H.stm"] <--storm filename, one per line for NSTORM time
00015> *%-----------------|-------------------------------------------------------|
00016> READ STORM          STORM_FILENAME=["storm.001"]
00017> *%-----------------|-------------------------------------------------------|
00018> DEFAULT VALUES      ICASEdef=[1],  read and print values
00019>                     DEFVAL_FILENAME=["Ottawa.val"]
00020> *%-----------------|-------------------------------------------------------|
00021> *#########################################################################
00022> *# Post Development Conditions
00023> *#########################################################################
00024> *# West Development
00025> *#########################################################################
00026> *# Post-development drainage area to West SWM Pond
00027> CALIB STANDHYD       NHYD=["W_Pond"], DT=[1](min), AREA=[36.55](ha), XIMP=[0.66], TIMP=[0.71], DWF=[0.](cms),
00028>                     LOSS=[1] Horton Equ: Fo=[76.2](mm/hr), Fc=[13.2](mm/hr), DCAY=[4.14](/hr), F=[0.00](mm),
00029>                     Pervious   areas: IAper=[4.67](mm), SLPP=[2.0](%), LGP=[40](m), MNP=[0.25], SCP=[0](min),
00030>                     Impervious areas: IAimp=[1.57](mm), SLPI=[0.5](%), LGI=[494](m), MNI=[0.013], SCI=[0](min),
00031>                     RAINFALL=[ ,  ,  -1](mm/hr)
00032> *%-----------------|-------------------------------------------------------|
00033> *#########################################################################
00034> *# West Pond Routing
00035> *#########################################################################
00036> ROUTE RESERVOIR     NHYDout=["W_Pond-Out"], NHYDin=["W_Pond"], RDT=[1](min),
00037>                         TABLE Of ( OUTFLOW-STORAGE ) Values
00038>                                 (cms) - (ha-m)
00039>                                 [ 0 , 0 ]
00040>                                 [ 0.017 , 0.017 ]
00041>                                 [ 0.04 , 0.55611 ]
00042>                                 [    0.069 , 0.7467    ]  (max twenty pts)
00043>                                 [    0.109 , 0.91101   ]  (max twenty pts)
00044>                                 [    0.128 , 1.044     ]  (max twenty pts)
00045>                                 [    0.174 , 1.24311   ]  (max twenty pts)
00046>                                 [    0.239 , 1.492     ]  (max twenty pts)
00047>                                 [    0.293 , 1.678     ]  (max twenty pts)
00048>                                 [    0.334 , 1.71909   ]  (max twenty pts)
00049>                                 [    0.353 , 1.87027   ]  (max twenty pts)
00050>                                 [    0.403 , 1.921     ]  (max twenty pts)
00051>                                 [    0.48 , 2.131      ]  (max twenty pts)
00052>                                 [    -1 , -1           ]  (max twenty pts)
00053>                               NHYDovf=["W_Pond-Ovf"],
00054> *%-----------------|-------------------------------------------------------|
00055> *#########################################################################
00056> *# Total post-development flows from West development
00057> *#########################################################################
00058> ADD HYD             NHYDsum=["West"], NHYDs to add=["W_Pond-Out" + "W_Pond-Ovf"]
00059> *%-----------------|-------------------------------------------------------|
00060> *#########################################################################
00061> *# East Development
00062> *#########################################################################
00063> *# Post-development drainage area to East SWM Pond
00064> CALIB STANDHYD       NHYD=["E_Pond"], DT=[1](min), AREA=[25.81](ha), XIMP=[0.66], TIMP=[0.71], DWF=[0.](cms),
00065>                     LOSS=[1] Horton Equ: Fo=[76.2](mm/hr), Fc=[13.2](mm/hr), DCAY=[4.14](/hr), F=[0.00](mm),
00066>                     Pervious   areas: IAper=[4.67](mm), SLPP=[2.0](%), LGP=[40](m), MNP=[0.25], SCP=[0](min),
00067>                     Impervious areas: IAimp=[1.57](mm), SLPI=[0.5](%), LGI=[415](m), MNI=[0.013], SCI=[0](min),
00068>                     RAINFALL=[ ,  ,  -1](mm/hr)FALL=[ ,  ,  -1](mm/hr)
00069> *%-----------------|-------------------------------------------------------|
00070> *#########################################################################
00071> *# East Pond Routing
00072> *#########################################################################
00073> ROUTE RESERVOIR     NHYDout=["E_Pond-Out"], NHYDin=["E_Pond"], RDT=[1](min),
00074>                         TABLE Of ( OUTFLOW-STORAGE ) Values
00075>                                 (cms) - (ha-m)
00076>                                 [ 0 , 0 ]
00077>                                 [ 0.012 , 0.012 ]
00078>                                 [ 0.04 , 0.38503 ]
00079>                                 [    0.069 , 0.51455   ]  (max twenty pts)
00080>                                 [    0.109 , 0.6171    ]  (max twenty pts)
00081>                                 [    0.126 , 0.7133    ]  (max twenty pts)
00082>                                 [    0.171 , 0.8459    ]  (max twenty pts)
00083>                                 [    0.234 , 1.01215   ]  (max twenty pts)
00084>                                 [    0.286 , 1.13817   ]  (max twenty pts)
00085>                                 [    0.344 , 1.27214   ]  (max twenty pts)
00086>                                 [    0.463 , 1.446     ]  (max twenty pts)
00087>                                 [    -1 , -1           ]  (max twenty pts)
00088>                               NHYDovf=["E_Pond-Ovf"],
00089> *%-----------------|-------------------------------------------------------|
00090> *#########################################################################
00091> *# Total post-development flows from East development
00092> *#########################################################################
00093> ADD HYD             NHYDsum=["East"], NHYDs to add=["E_Pond-Out" + "E_Pond-Ovf"]
00094> *%-----------------|-------------------------------------------------------|
00095> *#########################################################################
00096> *# STORMS
00097> *#########################################################################
00098> *%  25 mm Storm based on 2-Year, 3-Hour Chicago Storm
00099> *START               TZERO=[0.0],  METOUT=[2],  NSTORM=[1],  NRUN=[001]
00100> *%                   ["25MMC3H.stm"] <--storm filename, one per line for NSTORM time
00101> *%-----------------|-------------------------------------------------------|
00102> *%  2-Year, 3-Hour Chicago Storm
00103> START               TZERO=[0.0],  METOUT=[2],  NSTORM=[1],  NRUN=[002]
00104>                     ["002YC3H.stm"] <--storm filename, one per line for NSTORM time
00105> *%-----------------|-------------------------------------------------------|
00106> *%  5-Year, 3-Hour Chicago Storm
00107> START               TZERO=[0.0],  METOUT=[2],  NSTORM=[1],  NRUN=[005]
00108>                     ["005YC3H.stm"] <--storm filename, one per line for NSTORM time
00109> *%-----------------|-------------------------------------------------------|
00110> *%  10-Year, 3-Hour Chicago Storm
00111> START               TZERO=[0.0],  METOUT=[2],  NSTORM=[1],  NRUN=[010]
00112>                     ["010YC3H.stm"] <--storm filename, one per line for NSTORM time
00113> *%-----------------|-------------------------------------------------------|
00114> *%  25-Year, 3-Hour Chicago Storm
00115> START               TZERO=[0.0],  METOUT=[2],  NSTORM=[1],  NRUN=[025]
00116>                     ["025YC3H.stm"] <--storm filename, one per line for NSTORM time
00117> *%-----------------|-------------------------------------------------------|
00118> *%  50-Year, 3-Hour Chicago Storm
00119> START               TZERO=[0.0],  METOUT=[2],  NSTORM=[1],  NRUN=[050]
00120>                     ["050YC3H.stm"] <--storm filename, one per line for NSTORM time
00121> *%-----------------|-------------------------------------------------------|
00122> *%  100-Year, 3-Hour Chicago Storm
00123> START               TZERO=[0.0],  METOUT=[2],  NSTORM=[1],  NRUN=[099]
00124>                     ["100YC3H.stm"] <--storm filename, one per line for NSTORM time
00125> *%-----------------|-------------------------------------------------------|
00126> *%  2-Year, 24-Hour SCS Storm
00127> START               TZERO=[0.0],  METOUT=[2],  NSTORM=[1],  NRUN=[102]
00128>                     ["SC24002x.stm"] <--storm filename, one per line for NSTORM time
00129> *%-----------------|-------------------------------------------------------|
00130> *%  5-Year, 24-Hour SCS Storm
00131> START               TZERO=[0.0],  METOUT=[2],  NSTORM=[1],  NRUN=[105]
00132>                     ["SC24005x.stm"] <--storm filename, one per line for NSTORM time
00133> *%-----------------|-------------------------------------------------------|
00134> *%  10-Year, 24-Hour SCS Storm
00135> START               TZERO=[0.0],  METOUT=[2],  NSTORM=[1],  NRUN=[110]
00136>                     ["SC24010x.stm"] <--storm filename, one per line for NSTORM time
00137> *%-----------------|-------------------------------------------------------|
00138> *%  25-Year, 24-Hour SCS Storm
00139> START               TZERO=[0.0],  METOUT=[2],  NSTORM=[1],  NRUN=[125]
00140>                     ["SC24025x.stm"] <--storm filename, one per line for NSTORM time
00141> *%-----------------|-------------------------------------------------------|
00142> *%  50-Year, 24-Hour SCS Storm
00143> START               TZERO=[0.0],  METOUT=[2],  NSTORM=[1],  NRUN=[150]
00144>                     ["SC24050x.stm"] <--storm filename, one per line for NSTORM time
00145> *%-----------------|-------------------------------------------------------|
00146> *%  100-Year, 24-Hour SCS Storm
00147> START               TZERO=[0.0],  METOUT=[2],  NSTORM=[1],  NRUN=[199]
00148>                     ["SC24100x.stm"] <--storm filename, one per line for NSTORM time
00149> *%-----------------|-------------------------------------------------------|
00150> *%  2-Year, 12-Hour SCS Storm (per City of Ottawa Carp River PCSWMM model)
00151> *START               TZERO=[0.0],  METOUT=[2],  NSTORM=[1],  NRUN=[202]
00152> *                   ["SC12002c.stm"] <--storm filename, one per line for NSTORM time
00153> *%-----------------|-------------------------------------------------------|
00154> *%  5-Year, 12-Hour SCS Storm (per City of Ottawa Carp River PCSWMM model)
00155> *START               TZERO=[0.0],  METOUT=[2],  NSTORM=[1],  NRUN=[205]
00156> *                   ["SC12005c.stm"] <--storm filename, one per line for NSTORM time
00157> *%-----------------|-------------------------------------------------------|
00158> *%  10-Year, 12-Hour SCS Storm (per City of Ottawa Carp River PCSWMM model)
00159> *START               TZERO=[0.0],  METOUT=[2],  NSTORM=[1],  NRUN=[210]
00160> *                   ["SC12010c.stm"] <--storm filename, one per line for NSTORM time
00161> *%-----------------|-------------------------------------------------------|
00162> *%  25-Year, 12-Hour SCS Storm (per City of Ottawa Carp River PCSWMM model)
00163> *START               TZERO=[0.0],  METOUT=[2],  NSTORM=[1],  NRUN=[225]
00164> *                   ["SC12025c.stm"] <--storm filename, one per line for NSTORM time
00165> *%-----------------|-------------------------------------------------------|
00166> *%  50-Year, 12-Hour SCS Storm (per City of Ottawa Carp River PCSWMM model)
00167> *START               TZERO=[0.0],  METOUT=[2],  NSTORM=[1],  NRUN=[250]
00168> *                   ["SC12050c.stm"] <--storm filename, one per line for NSTORM time
00169> *%-----------------|-------------------------------------------------------|
00170> *%  100-Year, 12-Hour SCS Storm (per City of Ottawa Carp River PCSWMM model)
00171> *START               TZERO=[0.0],  METOUT=[2],  NSTORM=[1],  NRUN=[299]
00172> *                   ["SC12100c.stm"] <--storm filename, one per line for NSTORM time
00173> *%-----------------|-------------------------------------------------------|
00174> *%  July 1st, 1979 Storm - Ottawa International Airport
00175> *START               TZERO=[0.0],  METOUT=[2],  NSTORM=[1],  NRUN=[979]
00176> *                   ["19790701.stm"] <--storm filename, one per line for NSTORM time
00177> *%-----------------|-------------------------------------------------------|
00178> *%  August 4th, 1988 Storm - Ottawa International Airport
00179> *START               TZERO=[0.0],  METOUT=[2],  NSTORM=[1],  NRUN=[988]
00180> *                   ["19880804.stm"] <--storm filename, one per line for NSTORM time
00181> *%-----------------|-------------------------------------------------------|
00182> *%  August 8th, 1996 Storm - Ottawa International Airport
00183> *START               TZERO=[0.0],  METOUT=[2],  NSTORM=[1],  NRUN=[996]
00184> *                   ["19960808.stm"] <--storm filename, one per line for NSTORM time
00185> *%-----------------|-------------------------------------------------------|
00186> *%  100-Year, 3-Hour Chicago Storm + 20%
00187> *START               TZERO=[0.0],  METOUT=[2],  NSTORM=[1],  NRUN=[999]
00188> *                   ["100YC3H+.stm"] <--storm filename, one per line for NSTORM time
00189> *%-----------------|-------------------------------------------------------|
00190> FINISH
```

DRAFT

```
00001>  ================================================================================
00002>
00003>  SSSSS   W   W   M   M   H   H   Y   Y   M   M    OOO          222    000   11   5555   ========
00004>  S       W W W   MM MM   H   H    Y Y    MM MM   O   O          2   0   0  11   5
00005>  SSSSS   W W W   M M M   HHHHH     Y     M M M   O   O          2   0   0  11   5       Ver 5.500
00006>      S   W W W   M   M   H   H     Y     M   M   O   O        222   0   0  11     5     FEB  2015
00007>  SSSSS    W W    M   M   H   H     Y     M   M    OOO         2     0   0  11     5    ========
00008>
00009>         StormWater Management HYdrologic Model                222    000   11   555    ========
00010>
00011>  ************************************************************************************************
00012>  ************************************  SWMHYMO Ver 5.500  ***************************************
00013>  ***************************  A single event and continuous hydrologic simulation model  ***********
00014>  ***************************       based on the principles of HYMO and its successors    ***********
00015>  ***************************                 OTTHYMO-83 and OTTHYMO-89.                   ***********
00016>  ************************************************************************************************
00017>  ***************************** Distributed by:  J.F. Sabourin and Associates Inc.          ***********
00018>  *****************************                  Ottawa, Ontario: (613) 836-3884             ***********
00019>  *****************************                  Gatineau, Quebec: (819) 243-6858            ***********
00020>  *****************************                  E-Mail: swmhymo@jfsa.com                    ***********
00021>  ************************************************************************************************
00022>
00023>  ++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++
00024>  ++++++++++++++++++  Licensed user: JFSAinc.                                  ++++++++++++++++++
00025>  ++++++++++++++++++                 Ottawa                  SERIAL#:2549237  ++++++++++++++++++
00026>  ++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++
00027>
00028>  ***************************                                                  ***********
00029>  ***************************          ++++++ PROGRAM ARRAY DIMENSIONS ++++++   ***********
00030>  ***************************      Maximum value for ID numbers  :    11       ***********
00031>  ***************************      Max. number of rainfall points: 105408      ***********
00032>  ***************************      Max. number of flow points    : 105408      ***********
00033>  ************************************************************************************************
00034>
00035>  ********************************  S U M M A R Y   O U T P U T  ********************************
00036>  ************************************************************************************************
00037>  *                                                                              *
00038>  *                    RUN DATE: 2023-11-28      TIME: 13:58:47      RUN COUNTER: 009568         *
00039>  ********************************************************************************
00040>  * Input   file: C:\Temp\P2267-Stittsville FSR\20231128-MSS Pond Sizing\STIT-Post_v06-S.dat       *
00041>  * Output  file: C:\Temp\P2267-Stittsville FSR\20231128-MSS Pond Sizing\STIT-Post_v06-S.out       *
00042>  * Summary file: C:\Temp\P2267-Stittsville FSR\20231128-MSS Pond Sizing\STIT-Post_v06-S.sum       *
00043>  * User comments:                                                               *
00044>  * 1:_____________________________________________________________________________*
00045>  * 2:_____________________________________________________________________________*
00046>  * 3:_____________________________________________________________________________*
00047>  ********************************************************************************
00048>
00049>
00050>  ###############################################################################
00051>  #  SWMHYMO Ver:5.500/Feb 2015 / INPUT DATA FILE                               #
00052>  ###############################################################################
00053>  #  Project Name  : [Caivan Stittsville West properties]                       #
00054>  #  Project Number: [2267]                                                     #
00055>  #  Date          : [2023/11/28]                                               #
00056>  #  Modeller      : [PP]                                                       #
00057>  #  Company       : J.F. Sabourin and Associates                               #
00058>  #  License #     : 2549237                                                    #
00059>  ###############################################################################
00060>  RUN#:COMMAND#
00061> R0001:C00001------------------------------------------------------------------------------
00062>       START
00063>         [TZERO =      .00 hrs on       0]
00064>         [METOUT=   2     (1=imperial, 2=metric output)]
00065>         [NSTORM=   1 ]
00066>         [NRUN  = 0001 ]
00067> R0001:C00002------------------------------------------------------------------------------
00068>       READ STORM
00069>         Filename = storm.001
00070>         Comment  = 25 MM BASED ON CHICAGO STORM 2 Year, 3 Hours
00071>         [SDT=10.00:SDUR=   3.00:PTOT=  25.00]
00072> R0001:C00003------------------------------------------------------------------------------
00073>       DEFAULT VALUES
00074>         Filename = C:\Temp\P2267-Stittsville FSR\20231128-MSS Pond Sizing\Ottawa.val
00075>         ICASEdv  = 1 (read and print data)
00076>         FileTitle= File comment: [Parameters for City of Ottawa Projects]
00077>                    THE FOLLOWING PARAMETERS ARE USED IN THE DESIGN STANDHYD COM
00078>         Horton's infiltration equation parameters:
00079>         [Fo= 76.20 mm/hr] [Fc=13.20 mm/hr] [DCAY= 4.14 /hr] [F=  .00 mm]
00080>         Parameters for PERVIOUS surfaces in STANDHYD:
00081>         [IAper=  4.67 mm] [LGP=40.00 m] [MNP= .250]
00082>         Parameters for IMPERVIOUS surfaces in STANDHYD:
00083>         [IAimp=  1.57 mm] [CLI= 1.50]   [MNI= .013]
00084>         Parameters used in NASHYD:
00085>         [Ia=   4.67 mm] [N= 3.00]
00086>         Average monthly Pan Evaporation data in    (mm)
00087>      JAN   FEB   MAR   APR   MAY   JUN   JUL   AUG   SEP   OCT   NOV   DEC
00088>     .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00
00089>         Average monthly Potential Evapotranspiration in    (mm)
00090>      JAN   FEB   MAR   APR   MAY   JUN   JUL   AUG   SEP   OCT   NOV   DEC
00091>     .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00
00092>  ###############################################################################
00093>  # Post Development Conditions                                                 #
00094>  ###############################################################################
00095>  # West Development                                                            #
00096>  ###############################################################################
00097>  # Post-development drainage area to West SWM Pond                             #
00098> R0001:C00004------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00099>       CALIB STANDHYD         1.0 01:W_Pond       36.55    2.502 No_date    1:06   16.15  n/a     .000
00100>         [XIMP=.66:TIMP=.71]
00101>         [Horton parameters: Fo= 76.20:Fc= 13.20:DCAY=4.14:  F= .00]
00102>         [Pervious      area: IAper= 4.67:SLPP=2.00:LGP=  40.:MNP=.250:SCP=   .0]
00103>         [Impervious    area: IAimp= 1.57:SLPI= .50:LGI= 494.:MNI=.013:SCI=   .0]
00104>  ###############################################################################
00105>  # West Pond Routing                                                           #
00106>  ###############################################################################
00107> R0001:C00005------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00108>       ROUTE RESERVOIR ->     1.0 02:W_Pond       36.55    2.502 No_date    1:06   16.15  n/a     .000
00109>                          out <=    1.0 01:W_Pond-Out    36.55     .040 No_date    3:18   16.15  n/a     .000
00110>                     overflow <=    1.0 03:W_Pond-Ovf     .00     .000 No_date    0:00     .00  n/a     .000
00111>        (MxStoUsed=.5561E+00  m3, TotOvfVol=.0000E+00  m3, N-Ovf=    0, TotDurOvf=    0.hrs)
00112>  ###############################################################################
00113>  # Total post-development flows from West development                          #
00114>  ###############################################################################
00115> R0001:C00006------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00116>       ADD HYD                1.0 02:W_Pond-Out    36.55     .040 No_date    3:18   16.15  n/a     .000
00117>                         +    1.0 02:W_Pond-Ovf     .00     .000 No_date    0:00     .00  n/a     .000
00118>                    SUM=    1.0 01:West          36.55     .040 No_date    3:18   16.15  n/a     .000
00119>  ###############################################################################
00120>  # East Development                                                            #
00121>  ###############################################################################
00122>  # Post-development drainage area to East SWM Pond                             #
00123> R0001:C00007------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00124>       CALIB STANDHYD         1.0 01:E_Pond       25.81    1.864 No_date    1:05   16.15  n/a     .000
00125>         [XIMP=.66:TIMP=.71]
00126>         [Horton parameters: Fo= 76.20:Fc= 13.20:DCAY=4.14:  F= .00]
00127>         [Pervious      area: IAper= 4.67:SLPP=2.00:LGP=  40.:MNP=.250:SCP=   .0]
00128>         [Impervious    area: IAimp= 1.57:SLPI= .50:LGI= 415.:MNI=.013:SCI=   .0]
00129>  ###############################################################################
00130>  # East Pond Routing                                                           #
00131>  ###############################################################################
00132> R0001:C00008------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00133>       ROUTE RESERVOIR ->     1.0 02:E_Pond       25.81    1.864 No_date    1:05   16.15  n/a     .000
00134>                          out <=    1.0 01:E_Pond-Out    25.81     .040 No_date    3:13   16.15  n/a     .000
00135>                     overflow <=    1.0 03:E_Pond-Ovf     .00     .000 No_date    0:00     .00  n/a     .000
00136>        (MxStoUsed=.3951E+00  m3, TotOvfVol=.0000E+00  m3, N-Ovf=    0, TotDurOvf=    0.hrs)
00137>  ###############################################################################
00138>  # Total post-development flows from East development                          #
00139>  ###############################################################################
00140> R0001:C00009------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00141>       ADD HYD                1.0 02:E_Pond-Out    25.81     .040 No_date    3:13   16.15  n/a     .000
00142>                         +    1.0 02:E_Pond-Ovf     .00     .000 No_date    0:00     .00  n/a     .000
00143>                    SUM=    1.0 01:East          25.81     .040 No_date    3:13   16.15  n/a     .000
00144>  ###############################################################################
00145>  # STORMS                                                                      #
00146>  ###############################################################################
00147>   ** END OF RUN :   1
00148>
00149>  ********************************************************************************
00150>
00151>
00152>
00153>
00154>
00155>  RUN#:COMMAND#
00156> R0002:C00001------------------------------------------------------------------------------
00157>       START
00158>         [TZERO =      .00 hrs on       0]
00159>         [METOUT=   2     (1=imperial, 2=metric output)]
00160>         [NSTORM=   1 ]
00161>         [NRUN  = 0002 ]
00162>  ###############################################################################
00163>  #  SWMHYMO Ver:5.500/Feb 2015 / INPUT DATA FILE                               #
00164>  ###############################################################################
00165>  #  Project Name  : [Caivan Stittsville West properties]                       #
00166>  #  Project Number: [2267]                                                     #
00167>  #  Date          : [2023/11/28]                                               #
00168>  #  Modeller      : [PP]                                                       #
00169>  #  Company       : J.F. Sabourin and Associates                               #
00170>  #  License #     : 2549237                                                    #
00171>  ###############################################################################
00172> R0002:C00002------------------------------------------------------------------------------
00173>       READ STORM
00174>         Filename = storm.001
00175>         Comment  = CHICAGO STORM 2 Year, 3 Hours
00176>         [SDT=10.00:SDUR=   3.00:PTOT=  31.86]
00177> R0002:C00003------------------------------------------------------------------------------
00178>       DEFAULT VALUES
00179>         Filename = C:\Temp\P2267-Stittsville FSR\20231128-MSS Pond Sizing\Ottawa.val
00180>         ICASEdv  = 1 (read and print data)
00181>         FileTitle= File comment: [Parameters for City of Ottawa Projects]
00182>                    THE FOLLOWING PARAMETERS ARE USED IN THE DESIGN STANDHYD COM
00183>         Horton's infiltration equation parameters:
00184>         [Fo= 76.20 mm/hr] [Fc=13.20 mm/hr] [DCAY= 4.14 /hr] [F=  .00 mm]
00185>         Parameters for PERVIOUS surfaces in STANDHYD:
00186>         [IAper=  4.67 mm] [LGP=40.00 m] [MNP= .250]
00187>         Parameters for IMPERVIOUS surfaces in STANDHYD:
00188>         [IAimp=  1.57 mm] [CLI= 1.50]   [MNI= .013]
00189>         Parameters used in NASHYD:
00190>         [Ia=   4.67 mm] [N= 3.00]
00191>         Average monthly Pan Evaporation data in    (mm)
00192>      JAN   FEB   MAR   APR   MAY   JUN   JUL   AUG   SEP   OCT   NOV   DEC
00193>     .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00
00194>         Average monthly Potential Evapotranspiration in    (mm)
00195>      JAN   FEB   MAR   APR   MAY   JUN   JUL   AUG   SEP   OCT   NOV   DEC
00196>     .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00
00197>  ###############################################################################
00198>  # Post Development Conditions                                                 #
00199>  ###############################################################################
00200>  # West Development                                                            #
00201>  ###############################################################################
00202>  # Post-development drainage area to West SWM Pond                             #
00203> R0002:C00004------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00204>       CALIB STANDHYD         1.0 01:W_Pond       36.55    3.459 No_date    1:05   21.79  .684     .000
00205>         [XIMP=.66:TIMP=.71]
00206>         [Horton parameters: Fo= 76.20:Fc= 13.20:DCAY=4.14:  F= .00]
00207>         [Pervious      area: IAper= 4.67:SLPP=2.00:LGP=  40.:MNP=.250:SCP=   .0]
00208>         [Impervious    area: IAimp= 1.57:SLPI= .50:LGI= 494.:MNI=.013:SCI=   .0]
00209>  ###############################################################################
00210>  # West Pond Routing                                                           #
00211>  ###############################################################################
00212> R0002:C00005------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00213>       ROUTE RESERVOIR ->     1.0 02:W_Pond       36.55    3.459 No_date    1:05   21.79  n/a     .000
00214>                          out <=    1.0 01:W_Pond-Out    36.55     .069 No_date    3:13   21.79  n/a     .000
00215>                     overflow <=    1.0 03:W_Pond-Ovf     .00     .000 No_date    0:00     .00  n/a     .000
00216>        (MxStoUsed=.7467E+00  m3, TotOvfVol=.0000E+00  m3, N-Ovf=    0, TotDurOvf=    0.hrs)
00217>  ###############################################################################
00218>  # Total post-development flows from West development                          #
00219>  ###############################################################################
00220> R0002:C00006------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00221>       ADD HYD                1.0 02:W_Pond-Out    36.55     .069 No_date    3:13   21.79  n/a     .000
00222>                         +    1.0 02:W_Pond-Ovf     .00     .000 No_date    0:00     .00  n/a     .000
00223>                    SUM=    1.0 01:West          36.55     .069 No_date    3:13   21.79  n/a     .000
00224>  ###############################################################################
00225>  # East Development                                                            #
00226>  ###############################################################################
00227>  # Post-development drainage area to East SWM Pond                             #
00228> R0002:C00007------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00229>       CALIB STANDHYD         1.0 01:E_Pond       25.81    2.569 No_date    1:04   21.79  .684     .000
00230>         [XIMP=.66:TIMP=.71]
00231>         [Horton parameters: Fo= 76.20:Fc= 13.20:DCAY=4.14:  F= .00]
00232>         [Pervious      area: IAper= 4.67:SLPP=2.00:LGP=  40.:MNP=.250:SCP=   .0]
00233>         [Impervious    area: IAimp= 1.57:SLPI= .50:LGI= 415.:MNI=.013:SCI=   .0]
00234>  ###############################################################################
00235>  # East Pond Routing                                                           #
00236>  ###############################################################################
00237> R0002:C00008------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00238>       ROUTE RESERVOIR ->     1.0 02:E_Pond       25.81    2.569 No_date    1:04   21.79  n/a     .000
00239>                          out <=    1.0 01:E_Pond-Out    25.81     .069 No_date    3:08   21.79  n/a     .000
00240>                     overflow <=    1.0 03:E_Pond-Ovf     .00     .000 No_date    0:00     .00  n/a     .000
00241>        (MxStoUsed=.5146E+00  m3, TotOvfVol=.0000E+00  m3, N-Ovf=    0, TotDurOvf=    0.hrs)
00242>  ###############################################################################
00243>  # Total post-development flows from East development                          #
00244>  ###############################################################################
00245> R0002:C00009------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00246>       ADD HYD                1.0 02:E_Pond-Out    25.81     .069 No_date    3:08   21.79  n/a     .000
00247>                         +    1.0 02:E_Pond-Ovf     .00     .000 No_date    0:00     .00  n/a     .000
00248>                    SUM=    1.0 01:East          25.81     .069 No_date    3:08   21.79  n/a     .000
00249>  ###############################################################################
00250>  # STORMS                                                                      #
00251>  ###############################################################################
00252>   ** END OF RUN :   4
00253>
00254>  ********************************************************************************
00255>
00256>
00257>
00258>
00259>
00260>  RUN#:COMMAND#
00261> R0005:C00001------------------------------------------------------------------------------
00262>       START
00263>         [TZERO =      .00 hrs on       0]
00264>         [METOUT=   2     (1=imperial, 2=metric output)]
00265>         [NSTORM=   1 ]
00266>         [NRUN  = 0005 ]
00267>  ###############################################################################
00268>  #  SWMHYMO Ver:5.500/Feb 2015 / INPUT DATA FILE                               #
00269>  ###############################################################################
00270>  #  Project Name  : [Caivan Stittsville West properties]                       #
00271>  #  Project Number: [2267]                                                     #
00272>  #  Date          : [2023/11/28]                                               #
00273>  #  Modeller      : [PP]                                                       #
00274>  #  Company       : J.F. Sabourin and Associates                               #
00275>  #  License #     : 2549237                                                    #
00276>  ###############################################################################
00277> R0005:C00002------------------------------------------------------------------------------
00278>       READ STORM
00279>         Filename = storm.001
00280>         Comment  = CHICAGO STORM  5 Year, 3 Hours
00281>         [SDT=10.00:SDUR=   3.00:PTOT=  42.51]
00282> R0005:C00003------------------------------------------------------------------------------
00283>       DEFAULT VALUES
00284>         Filename = C:\Temp\P2267-Stittsville FSR\20231128-MSS Pond Sizing\Ottawa.val
00285>         ICASEdv  = 1 (read and print data)
00286>         FileTitle= File comment: [Parameters for City of Ottawa Projects]
00287>                    THE FOLLOWING PARAMETERS ARE USED IN THE DESIGN STANDHYD COM
00288>         Horton's infiltration equation parameters:
00289>         [Fo= 76.20 mm/hr] [Fc=13.20 mm/hr] [DCAY= 4.14 /hr] [F=  .00 mm]
00290>         Parameters for PERVIOUS surfaces in STANDHYD:
00291>         [IAper=  4.67 mm] [LGP=40.00 m] [MNP= .250]
00292>         Parameters for IMPERVIOUS surfaces in STANDHYD:
00293>         [IAimp=  1.57 mm] [CLI= 1.50]   [MNI= .013]
00294>         Parameters used in NASHYD:
00295>         [Ia=   4.67 mm] [N= 3.00]
00296>         Average monthly Pan Evaporation data in    (mm)
00297>      JAN   FEB   MAR   APR   MAY   JUN   JUL   AUG   SEP   OCT   NOV   DEC
00298>     .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00
00299>         Average monthly Potential Evapotranspiration in    (mm)
00300>      JAN   FEB   MAR   APR   MAY   JUN   JUL   AUG   SEP   OCT   NOV   DEC
00301>     .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00
00302>  ###############################################################################
00303>  # Post Development Conditions                                                 #
00304>  ###############################################################################
00305>  # West Development                                                            #
00306>  ###############################################################################
00307>  # Post-development drainage area to West SWM Pond                             #
00308> R0005:C00004------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00309>       CALIB STANDHYD         1.0 01:W_Pond       36.55    5.214 No_date    1:04   31.01  .729     .000
00310>         [XIMP=.66:TIMP=.71]
00311>         [Horton parameters: Fo= 76.20:Fc= 13.20:DCAY=4.14:  F= .00]
00312>         [Pervious      area: IAper= 4.67:SLPP=2.00:LGP=  40.:MNP=.250:SCP=   .0]
00313>         [Impervious    area: IAimp= 1.57:SLPI= .50:LGI= 494.:MNI=.013:SCI=   .0]
00314>  ###############################################################################
00315>  # West Pond Routing                                                           #
00316>  ###############################################################################
00317> R0005:C00005------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00318>       ROUTE RESERVOIR ->     1.0 02:W_Pond       36.55    5.214 No_date    1:04   31.01  n/a     .000
00319>                          out <=    1.0 01:W_Pond-Out    36.55     .128 No_date    3:08   31.01  n/a     .000
00320>                     overflow <=    1.0 03:W_Pond-Ovf     .00     .000 No_date    0:00     .00  n/a     .000
00321>        (MxStoUsed=.1044E+01  m3, TotOvfVol=.0000E+00  m3, N-Ovf=    0, TotDurOvf=    0.hrs)
00322>  ###############################################################################
00323>  # Total post-development flows from West development                          #
00324>  ###############################################################################
00325> R0005:C00006------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00326>       ADD HYD                1.0 02:W_Pond-Out    36.55     .128 No_date    3:08   31.01  n/a     .000
00327>                         +    1.0 02:W_Pond-Ovf     .00     .000 No_date    0:00     .00  n/a     .000
00328>                    SUM=    1.0 01:West          36.55     .128 No_date    3:08   31.01  n/a     .000
00329>  ###############################################################################
00330>  # East Development                                                            #
00331>  ###############################################################################
00332>  # Post-development drainage area to East SWM Pond                             #
00333> R0005:C00007------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00334>       CALIB STANDHYD         1.0 01:E_Pond       25.81    3.863 No_date    1:03   31.01  .729     .000
00335>         [XIMP=.66:TIMP=.71]
00336>         [Horton parameters: Fo= 76.20:Fc= 13.20:DCAY=4.14:  F= .00]
00337>         [Pervious      area: IAper= 4.67:SLPP=2.00:LGP=  40.:MNP=.250:SCP=   .0]
00338>         [Impervious    area: IAimp= 1.57:SLPI= .50:LGI= 415.:MNI=.013:SCI=   .0]
00339>  ###############################################################################
00340>  # East Pond Routing                                                           #
00341>  ###############################################################################
00342> R0005:C00008------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00343>       ROUTE RESERVOIR ->     1.0 02:E_Pond       25.81    3.863 No_date    1:03   31.01  n/a     .000
00344>                          out <=    1.0 01:E_Pond-Out    25.81     .126 No_date    3:04   31.01  n/a     .000
00345>                     overflow <=    1.0 03:E_Pond-Ovf     .00     .000 No_date    0:00     .00  n/a     .000
00346>        (MxStoUsed=.7133E+00  m3, TotOvfVol=.0000E+00  m3, N-Ovf=    0, TotDurOvf=    0.hrs)
00347>  ###############################################################################
00348>  # Total post-development flows from East development                          #
00349>  ###############################################################################
00350> R0005:C00009------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00351>       ADD HYD                1.0 02:E_Pond-Out    25.81     .126 No_date    3:04   31.01  n/a     .000
00352>                         +    1.0 02:E_Pond-Ovf     .00     .000 No_date    0:00     .00  n/a     .000
00353>                    SUM=    1.0 01:East          25.81     .126 No_date    3:04   31.01  n/a     .000
00354>  ###############################################################################
00355>  # STORMS                                                                      #
00356>  ###############################################################################
00357>   ** END OF RUN :   9
00358>
00359>  ********************************************************************************
00360>
```

DRAFT

```
00361>
00362>
00363>
00364>
00365>  RUN#:COMMAND#
00366> R0010:C00001------------------------------------------------------------------------------
00367>       START
00368>       [TZERO =    .00 hrs on        0]
00369>       [METOUT=   2    (1=imperial, 2=metric output)]
00370>       [NSTORM=   1 ]
00371>       [NRUN  = 0010 ]
00372> ********************************************************************************
00373> #  SWMHYMO Ver:5.500/Feb 2015 /  INPUT DATA FILE
00374> ********************************************************************************
00375> #  Project Name  : [Caivan Stittsville West properties]
00376> #  Project Number: [2267]
00377> #  Date          : [2023/11/28]
00378> #  Modeller      : [PP]
00379> #  Company       : J.F. Sabourin and Associates
00380> #  License #     : 2549237
00381> ********************************************************************************
00382> R0010:C00002------------------------------------------------------------------------------
00383>       READ STORM
00384>       Filename = storm.001
00385>       Comment  = CHICAGO STORM 10 Year, 3 Hours
00386>       [SDT=10.00:SDUR=   3.00:PTOT=  49.50]
00387> R0010:C00003------------------------------------------------------------------------------
00388>       DEFAULT VALUES
00389>       Filename = C:\Temp\P2267-Stittsville FSR\20231128-MSS Pond Sizing\Ottawa.val
00390>       ICASEdv  = 1 (read and print data)
00391>       FileTitle= File comment: [Parameters for City of Ottawa Projects]
00392>                  THE FOLLOWING PARAMETERS ARE USED IN THE DESIGN STANDHYD COM
00393>       Horton's infiltration equation parameters:
00394>       [Fo= 76.20 mm/hr] [Fc=13.20 mm/hr] [DCAY= 4.14 /hr] [F=  .00 mm]
00395>       Parameters for PERVIOUS surfaces in STANDHYD:
00396>       [IAper=   4.67 mm] [LGP=40.00 m] [MNP= .250]
00397>       Parameters for IMPERVIOUS surfaces in STANDHYD:
00398>       [IAimp=   1.57 mm] [CLI= 1.50]   [MNI= .013]
00399>       Parameters used in NASHYD:
00400>       [Ia=   4.67 mm] [N= 3.00]
00401>       Average monthly Pan Evaporation data in    (mm)
00402>    JAN   FEB   MAR   APR   MAY   JUN   JUL   AUG   SEP   OCT   NOV   DEC
00403>   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00
00404>       Average monthly Potential Evapotranspiration in    (mm)
00405>    JAN   FEB   MAR   APR   MAY   JUN   JUL   AUG   SEP   OCT   NOV   DEC
00406>   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00
00407> ##############################################################################
00408> # Post Development Conditions
00409> ##############################################################################
00410> # West Development
00411> ##############################################################################
00412> # Post-development drainage area to West SWM Pond
00413> R0010:C00004-----------DTmin-ID:NHYD--------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00414>      CALIB STANDHYD         1.0 01:W_Pond        36.55     6.460 No_date    1:05   37.25 .752     .000
00415>           [XIMP=.66:TIMP=.71]
00416>           [Horton parameters: Fo= 76.20:Fc= 13.20:DCAY=4.14:  F= .00]
00417>           [Pervious     area: IAper= 4.67:SLPP=2.00:LGP=  40.:MNP=.250:SCP=   .0]
00418>           [Impervious   area: IAimp= 1.57:SLPI= .50:LGI= 494.:MNI=.013:SCI=   .0]
00419> ##############################################################################
00420> # West Pond Routing
00421> ##############################################################################
00422> R0010:C00005-----------DTmin-ID:NHYD--------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00423>      ROUTE RESERVOIR ->     1.0 02:W_Pond        36.55     6.460 No_date    1:05   37.25  n/a     .000
00424>                        out <=    1.0 01:W_Pond-Out    36.55     .174 No_date    3:07   37.25  n/a     .000
00425>                   overflow <=    1.0 03:W_Pond-Ovf       .00     .000 No_date    0:00     .00  n/a     .000
00426>     (MxStoUsed=.1243E+01  m3, TotOvfVol=.0000E+00  m3, N-Ovf=    0, TotDurOvf=    0.hrs)
00427> ##############################################################################
00428> # Total post-development  flows from West development
00429> ##############################################################################
00430> R0010:C00006-----------DTmin-ID:NHYD--------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00431>      ADD HYD                1.0 02:W_Pond-Out    36.55     .174 No_date    3:07   37.25  n/a     .000
00432>                        +    1.0 02:W_Pond-Ovf       .00     .000 No_date    0:00     .00  n/a     .000
00433>                   SUM=    1.0 01:West          36.55     .174 No_date    3:07   37.25  n/a     .000
00434> ##############################################################################
00435> # East Development
00436> ##############################################################################
00437> # Post-development drainage area to East SWM Pond
00438> R0010:C00007-----------DTmin-ID:NHYD--------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00439>      CALIB STANDHYD         1.0 01:E_Pond        25.81     4.783 No_date    1:04   37.25 .752     .000
00440>           [XIMP=.66:TIMP=.71]
00441>           [Horton parameters: Fo= 76.20:Fc= 13.20:DCAY=4.14:  F= .00]
00442>           [Pervious     area: IAper= 4.67:SLPP=2.00:LGP=  40.:MNP=.250:SCP=   .0]
00443>           [Impervious   area: IAimp= 1.57:SLPI= .50:LGI= 415.:MNI=.013:SCI=   .0]
00444> ##############################################################################
00445> # East Pond Routing
00446> ##############################################################################
00447> R0010:C00008-----------DTmin-ID:NHYD--------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00448>      ROUTE RESERVOIR ->     1.0 02:E_Pond        25.81     4.783 No_date    1:04   37.25  n/a     .000
00449>                        out <=    1.0 01:E_Pond-Out    25.81     .171 No_date    3:00   37.25  n/a     .000
00450>                   overflow <=    1.0 03:E_Pond-Ovf       .00     .000 No_date    0:00     .00  n/a     .000
00451>     (MxStoUsed=.8459E+00  m3, TotOvfVol=.0000E+00  m3, N-Ovf=    0, TotDurOvf=    0.hrs)
00452> ##############################################################################
00453> # Total post-development  flows from East development
00454> ##############################################################################
00455> R0010:C00009-----------DTmin-ID:NHYD--------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00456>      ADD HYD                1.0 02:E_Pond-Out    25.81     .171 No_date    3:00   37.25  n/a     .000
00457>                        +    1.0 02:E_Pond-Ovf       .00     .000 No_date    0:00     .00  n/a     .000
00458>                   SUM=    1.0 01:East          25.81     .171 No_date    3:00   37.25  n/a     .000
00459> ##############################################################################
00460> # STORMS
00461> ##############################################################################
00462>  ** END OF RUN :   24
00463>
00464> ********************************************************************************
00465>
00466>
00467>
00468>
00469>
00470>  RUN#:COMMAND#
00471> R0025:C00001------------------------------------------------------------------------------
00472>       START
00473>       [TZERO =    .00 hrs on        0]
00474>       [METOUT=   2    (1=imperial, 2=metric output)]
00475>       [NSTORM=   1 ]
00476>       [NRUN  = 0025 ]
00477> ********************************************************************************
00478> #  SWMHYMO Ver:5.500/Feb 2015 /  INPUT DATA FILE
00479> ********************************************************************************
00480> #  Project Name  : [Caivan Stittsville West properties]
00481> #  Project Number: [2267]
00482> #  Date          : [2023/11/28]
00483> #  Modeller      : [PP]
00484> #  Company       : J.F. Sabourin and Associates
00485> #  License #     : 2549237
00486> ********************************************************************************
00487> R0025:C00002------------------------------------------------------------------------------
00488>       READ STORM
00489>       Filename = storm.001
00490>       Comment  = CHICAGO STORM  25 Year, 3 Hours
00491>       [SDT=10.00:SDUR=   3.00:PTOT=  58.23]
00492> R0025:C00003------------------------------------------------------------------------------
00493>       DEFAULT VALUES
00494>       Filename = C:\Temp\P2267-Stittsville FSR\20231128-MSS Pond Sizing\Ottawa.val
00495>       ICASEdv  = 1 (read and print data)
00496>       FileTitle= File comment: [Parameters for City of Ottawa Projects]
00497>                  THE FOLLOWING PARAMETERS ARE USED IN THE DESIGN STANDHYD COM
00498>       Horton's infiltration equation parameters:
00499>       [Fo= 76.20 mm/hr] [Fc=13.20 mm/hr] [DCAY= 4.14 /hr] [F=  .00 mm]
00500>       Parameters for PERVIOUS surfaces in STANDHYD:
00501>       [IAper=   4.67 mm] [LGP=40.00 m] [MNP= .250]
00502>       Parameters for IMPERVIOUS surfaces in STANDHYD:
00503>       [IAimp=   1.57 mm] [CLI= 1.50]   [MNI= .013]
00504>       Parameters used in NASHYD:
00505>       [Ia=   4.67 mm] [N= 3.00]
00506>       Average monthly Pan Evaporation data in    (mm)
00507>    JAN   FEB   MAR   APR   MAY   JUN   JUL   AUG   SEP   OCT   NOV   DEC
00508>   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00
00509>       Average monthly Potential Evapotranspiration in    (mm)
00510>    JAN   FEB   MAR   APR   MAY   JUN   JUL   AUG   SEP   OCT   NOV   DEC
00511>   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00
00512> ##############################################################################
00513> # Post Development Conditions
00514> ##############################################################################
00515> # West Development
00516> ##############################################################################
00517> # Post-development drainage area to West SWM Pond
00518> R0025:C00004-----------DTmin-ID:NHYD--------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00519>      CALIB STANDHYD         1.0 01:W_Pond        36.55     8.208 No_date    1:04   45.23 .777     .000
00520>           [XIMP=.66:TIMP=.71]
00521>           [Horton parameters: Fo= 76.20:Fc= 13.20:DCAY=4.14:  F= .00]
00522>           [Pervious     area: IAper= 4.67:SLPP=2.00:LGP=  40.:MNP=.250:SCP=   .0]
00523>           [Impervious   area: IAimp= 1.57:SLPI= .50:LGI= 494.:MNI=.013:SCI=   .0]
00524> ##############################################################################
00525> # West Pond Routing
00526> ##############################################################################
00527> R0025:C00005-----------DTmin-ID:NHYD--------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00528>      ROUTE RESERVOIR ->     1.0 02:W_Pond        36.55     8.208 No_date    1:04   45.23  n/a     .000
00529>                        out <=    1.0 01:W_Pond-Out    36.55     .239 No_date    3:04   45.23  n/a     .000
00530>                   overflow <=    1.0 03:W_Pond-Ovf       .00     .000 No_date    0:00     .00  n/a     .000
00531>     (MxStoUsed=.1492E+01  m3, TotOvfVol=.0000E+00  m3, N-Ovf=    0, TotDurOvf=    0.hrs)
00532> ##############################################################################
00533> # Total post-development flows from West development
00534> ##############################################################################
00535> R0025:C00006-----------DTmin-ID:NHYD--------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00536>      ADD HYD                1.0 02:W_Pond-Out    36.55     .239 No_date    3:04   45.23  n/a     .000
00537>                        +    1.0 02:W_Pond-Ovf       .00     .000 No_date    0:00     .00  n/a     .000
00538>                   SUM=    1.0 01:West          36.55     .239 No_date    3:04   45.23  n/a     .000
00539> ##############################################################################
00540> # East Development
00541> ##############################################################################
00542> # Post-development drainage area to East SWM Pond
00543> R0025:C00007-----------DTmin-ID:NHYD--------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00544>      CALIB STANDHYD         1.0 01:E_Pond        25.81     6.082 No_date    1:03   45.23 .777     .000
00545>           [XIMP=.66:TIMP=.71]
00546>           [Horton parameters: Fo= 76.20:Fc= 13.20:DCAY=4.14:  F= .00]
00547>           [Pervious     area: IAper= 4.67:SLPP=2.00:LGP=  40.:MNP=.250:SCP=   .0]
00548>           [Impervious   area: IAimp= 1.57:SLPI= .50:LGI= 415.:MNI=.013:SCI=   .0]
00549> ##############################################################################
00550> # East Pond Routing
00551> ##############################################################################
00552> R0025:C00008-----------DTmin-ID:NHYD--------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00553>      ROUTE RESERVOIR ->     1.0 02:E_Pond        25.81     6.082 No_date    1:03   45.23  n/a     .000
00554>                        out <=    1.0 01:E_Pond-Out    25.81     .234 No_date    2:40   45.23  n/a     .000
00555>                   overflow <=    1.0 03:E_Pond-Ovf       .00     .000 No_date    0:00     .00  n/a     .000
00556>     (MxStoUsed=.1012E+01  m3, TotOvfVol=.0000E+00  m3, N-Ovf=    0, TotDurOvf=    0.hrs)
00557> ##############################################################################
00558> # Total post-development flows from East development
00559> ##############################################################################
00560> R0025:C00009-----------DTmin-ID:NHYD--------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00561>      ADD HYD                1.0 02:E_Pond-Out    25.81     .234 No_date    2:40   45.23  n/a     .000
00562>                        +    1.0 02:E_Pond-Ovf       .00     .000 No_date    0:00     .00  n/a     .000
00563>                   SUM=    1.0 01:East          25.81     .234 No_date    2:40   45.23  n/a     .000
00564> ##############################################################################
00565> # STORMS
00566> ##############################################################################
00567>  ** END OF RUN :   49
00568>
00569> ********************************************************************************
00570>
00571>
00572>
00573>
00574>
00575>  RUN#:COMMAND#
00576> R0050:C00001------------------------------------------------------------------------------
00577>       START
00578>       [TZERO =    .00 hrs on        0]
00579>       [METOUT=   2    (1=imperial, 2=metric output)]
00580>       [NSTORM=   1 ]
00581>       [NRUN  = 0050 ]
00582> ********************************************************************************
00583> #  SWMHYMO Ver:5.500/Feb 2015 /  INPUT DATA FILE
00584> ********************************************************************************
00585> #  Project Name  : [Caivan Stittsville West properties]
00586> #  Project Number: [2267]
00587> #  Date          : [2023/11/28]
00588> #  Modeller      : [PP]
00589> #  Company       : J.F. Sabourin and Associates
00590> #  License #     : 2549237
00591> ********************************************************************************
00592> R0050:C00002------------------------------------------------------------------------------
00593>       READ STORM
00594>       Filename = storm.001
00595>       Comment  = CHICAGO STORM  50 Year, 3 Hours
00596>       [SDT=10.00:SDUR=   3.00:PTOT=  64.81]
00597> R0050:C00003------------------------------------------------------------------------------
00598>       DEFAULT VALUES
00599>       Filename = C:\Temp\P2267-Stittsville FSR\20231128-MSS Pond Sizing\Ottawa.val
00600>       ICASEdv  = 1 (read and print data)
00601>       FileTitle= File comment: [Parameters for City of Ottawa Projects]
00602>                  THE FOLLOWING PARAMETERS ARE USED IN THE DESIGN STANDHYD COM
00603>       Horton's infiltration equation parameters:
00604>       [Fo= 76.20 mm/hr] [Fc=13.20 mm/hr] [DCAY= 4.14 /hr] [F=  .00 mm]
00605>       Parameters for PERVIOUS surfaces in STANDHYD:
00606>       [IAper=   4.67 mm] [LGP=40.00 m] [MNP= .250]
00607>       Parameters for IMPERVIOUS surfaces in STANDHYD:
00608>       [IAimp=   1.57 mm] [CLI= 1.50]   [MNI= .013]
00609>       Parameters used in NASHYD:
00610>       [Ia=   4.67 mm] [N= 3.00]
00611>       Average monthly Pan Evaporation data in    (mm)
00612>    JAN   FEB   MAR   APR   MAY   JUN   JUL   AUG   SEP   OCT   NOV   DEC
00613>   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00
00614>       Average monthly Potential Evapotranspiration in    (mm)
00615>    JAN   FEB   MAR   APR   MAY   JUN   JUL   AUG   SEP   OCT   NOV   DEC
00616>   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00
00617> ##############################################################################
00618> # Post Development Conditions
00619> ##############################################################################
00620> # West Development
00621> ##############################################################################
00622> # Post-development drainage area to West SWM Pond
00623> R0050:C00004-----------DTmin-ID:NHYD--------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00624>      CALIB STANDHYD         1.0 01:W_Pond        36.55     9.525 No_date    1:04   51.30 .792     .000
00625>           [XIMP=.66:TIMP=.71]
00626>           [Horton parameters: Fo= 76.20:Fc= 13.20:DCAY=4.14:  F= .00]
00627>           [Pervious     area: IAper= 4.67:SLPP=2.00:LGP=  40.:MNP=.250:SCP=   .0]
00628>           [Impervious   area: IAimp= 1.57:SLPI= .50:LGI= 494.:MNI=.013:SCI=   .0]
00629> ##############################################################################
00630> # West Pond Routing
00631> ##############################################################################
00632> R0050:C00005-----------DTmin-ID:NHYD--------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00633>      ROUTE RESERVOIR ->     1.0 02:W_Pond        36.55     9.525 No_date    1:04   51.30  n/a     .000
00634>                        out <=    1.0 01:W_Pond-Out    36.55     .293 No_date    3:02   51.30  n/a     .000
00635>                   overflow <=    1.0 03:W_Pond-Ovf       .00     .000 No_date    0:00     .00  n/a     .000
00636>     (MxStoUsed=.1678E+01  m3, TotOvfVol=.0000E+00  m3, N-Ovf=    0, TotDurOvf=    0.hrs)
00637> ##############################################################################
00638> # Total post-development flows from West development
00639> ##############################################################################
00640> R0050:C00006-----------DTmin-ID:NHYD--------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00641>      ADD HYD                1.0 02:W_Pond-Out    36.55     .293 No_date    3:02   51.30  n/a     .000
00642>                        +    1.0 02:W_Pond-Ovf       .00     .000 No_date    0:00     .00  n/a     .000
00643>                   SUM=    1.0 01:West          36.55     .293 No_date    3:02   51.30  n/a     .000
00644> ##############################################################################
00645> # East Development
00646> ##############################################################################
00647> # Post-development drainage area to East SWM Pond
00648> R0050:C00007-----------DTmin-ID:NHYD--------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00649>      CALIB STANDHYD         1.0 01:E_Pond        25.81     7.057 No_date    1:03   51.30 .792     .000
00650>           [XIMP=.66:TIMP=.71]
00651>           [Horton parameters: Fo= 76.20:Fc= 13.20:DCAY=4.14:  F= .00]
00652>           [Pervious     area: IAper= 4.67:SLPP=2.00:LGP=  40.:MNP=.250:SCP=   .0]
00653>           [Impervious   area: IAimp= 1.57:SLPI= .50:LGI= 415.:MNI=.013:SCI=   .0]
00654> ##############################################################################
00655> # East Pond Routing
00656> ##############################################################################
00657> R0050:C00008-----------DTmin-ID:NHYD--------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00658>      ROUTE RESERVOIR ->     1.0 02:E_Pond        25.81     7.057 No_date    1:03   51.30  n/a     .000
00659>                        out <=    1.0 01:E_Pond-Out    25.81     .286 No_date    2:31   51.30  n/a     .000
00660>                   overflow <=    1.0 03:E_Pond-Ovf       .00     .000 No_date    0:00     .00  n/a     .000
00661>     (MxStoUsed=.1138E+01  m3, TotOvfVol=.0000E+00  m3, N-Ovf=    0, TotDurOvf=    0.hrs)
00662> ##############################################################################
00663> # Total post-development flows from East development
00664> ##############################################################################
00665> R0050:C00009-----------DTmin-ID:NHYD--------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00666>      ADD HYD                1.0 02:E_Pond-Out    25.81     .286 No_date    2:31   51.30  n/a     .000
00667>                        +    1.0 02:E_Pond-Ovf       .00     .000 No_date    0:00     .00  n/a     .000
00668>                   SUM=    1.0 01:East          25.81     .286 No_date    2:31   51.30  n/a     .000
00669> ##############################################################################
00670> # STORMS
00671> ##############################################################################
00672>  ** END OF RUN :   98
00673>
00674> ********************************************************************************
00675>
00676>
00677>
00678>
00679>
00680>  RUN#:COMMAND#
00681> R0099:C00001------------------------------------------------------------------------------
00682>       START
00683>       [TZERO =    .00 hrs on        0]
00684>       [METOUT=   2    (1=imperial, 2=metric output)]
00685>       [NSTORM=   1 ]
00686>       [NRUN  = 0099 ]
00687> ********************************************************************************
00688> #  SWMHYMO Ver:5.500/Feb 2015 /  INPUT DATA FILE
00689> ********************************************************************************
00690> #  Project Name  : [Caivan Stittsville West properties]
00691> #  Project Number: [2267]
00692> #  Date          : [2023/11/28]
00693> #  Modeller      : [PP]
00694> #  Company       : J.F. Sabourin and Associates
00695> #  License #     : 2549237
00696> ********************************************************************************
00697> R0099:C00002------------------------------------------------------------------------------
00698>       READ STORM
00699>       Filename = storm.001
00700>       Comment  = CHICAGO STORM   100 Year, 3 Hours
00701>       [SDT=10.00:SDUR=   3.00:PTOT=  71.66]
00702> R0099:C00003------------------------------------------------------------------------------
00703>       DEFAULT VALUES
00704>       Filename = C:\Temp\P2267-Stittsville FSR\20231128-MSS Pond Sizing\Ottawa.val
00705>       ICASEdv  = 1 (read and print data)
00706>       FileTitle= File comment: [Parameters for City of Ottawa Projects]
00707>                  THE FOLLOWING PARAMETERS ARE USED IN THE DESIGN STANDHYD COM
00708>       Horton's infiltration equation parameters:
00709>       [Fo= 76.20 mm/hr] [Fc=13.20 mm/hr] [DCAY= 4.14 /hr] [F=  .00 mm]
00710>       Parameters for PERVIOUS surfaces in STANDHYD:
00711>       [IAper=   4.67 mm] [LGP=40.00 m] [MNP= .250]
00712>       Parameters for IMPERVIOUS surfaces in STANDHYD:
00713>       [IAimp=   1.57 mm] [CLI= 1.50]   [MNI= .013]
00714>       Parameters used in NASHYD:
00715>       [Ia=   4.67 mm] [N= 3.00]
00716>       Average monthly Pan Evaporation data in    (mm)
00717>    JAN   FEB   MAR   APR   MAY   JUN   JUL   AUG   SEP   OCT   NOV   DEC
00718>   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00
00719>       Average monthly Potential Evapotranspiration in    (mm)
00720>    JAN   FEB   MAR   APR   MAY   JUN   JUL   AUG   SEP   OCT   NOV   DEC
```

DRAFT

```
00721>    .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00
00722> ###############################################################################
00723> # Post Development Conditions
00724> ###############################################################################
00725> # West Development
00726> ###############################################################################
00727> # Post-development drainage area to West SWM Pond
00728> R0099:C00004------------DTmin-ID:NHYD--------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00729>      CALIB STANDHYD         1.0 01:W_Pond        36.55   10.788 No_date    1:04   57.75 .806     .000
00730>        [XIMP=.66:TIMP=.71]
00731>        [Horton parameters: Fo= 76.20:Fc= 13.20:DCAY=4.14:  F= .00]
00732>        [Pervious      area: IAper= 4.67:SLPP=2.00:LGP=  40.:MNP=.250:SCP=   .0]
00733>        [Impervious    area: IAimp= 1.57:SLPI= .50:LGI= 494.:MNI=.013:SCI=   .0]
00734> ###############################################################################
00735> # West Pond Routing
00736> ###############################################################################
00737> R0099:C00005------------DTmin-ID:NHYD--------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00738>      ROUTE RESERVOIR ->     1.0 02:W_Pond        36.55   10.788 No_date    1:04   57.75 n/a      .000
00739>                        out <=    1.0 01:W_Pond-Out    36.55     .353 No_date    2:56   57.75 n/a      .000
00740>                   overflow <=    1.0 03:W_Pond-Ovf     .00     .000 No_date    0:00     .00 n/a      .000
00741>      (MxStoUsed=.1870E+01  m3, TotOvfVol=.0000E+00  m3, N-Ovf=     0, TotDurOvf=    0.hrs)
00742> ###############################################################################
00743> # Total post-development flows from West development
00744> ###############################################################################
00745> R0099:C00006------------DTmin-ID:NHYD--------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00746>      ADD HYD                1.0 02:W_Pond-Out    36.55     .353 No_date    2:56   57.75 n/a      .000
00747>                       +    1.0 02:W_Pond-Ovf     .00     .000 No_date    0:00     .00 n/a      .000
00748>                     SUM=     1.0 01:West          36.55     .353 No_date    2:56   57.75 n/a      .000
00749> ###############################################################################
00750> # East Development
00751> ###############################################################################
00752> # Post-development drainage area to East SWM Pond
00753> R0099:C00007------------DTmin-ID:NHYD--------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00754>      CALIB STANDHYD         1.0 01:E_Pond        25.81    7.988 No_date    1:03   57.75 .806     .000
00755>        [XIMP=.66:TIMP=.71]
00756>        [Horton parameters: Fo= 76.20:Fc= 13.20:DCAY=4.14:  F= .00]
00757>        [Pervious      area: IAper= 4.67:SLPP=2.00:LGP=  40.:MNP=.250:SCP=   .0]
00758>        [Impervious    area: IAimp= 1.57:SLPI= .50:LGI= 415.:MNI=.013:SCI=   .0]
00759> ###############################################################################
00760> # East Pond Routing
00761> ###############################################################################
00762> R0099:C00008------------DTmin-ID:NHYD--------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00763>      ROUTE RESERVOIR ->     1.0 02:E_Pond        25.81    7.988 No_date    1:03   57.75 n/a      .000
00764>                        out <=    1.0 01:E_Pond-Out    25.81     .344 No_date    2:24   57.75 n/a      .000
00765>                   overflow <=    1.0 03:E_Pond-Ovf     .00     .000 No_date    0:00     .00 n/a      .000
00766>      (MxStoUsed=.1272E+01  m3, TotOvfVol=.0000E+00  m3, N-Ovf=     0, TotDurOvf=    0.hrs)
00767> ###############################################################################
00768> # Total post-development flows from East development
00769> ###############################################################################
00770> R0099:C00009------------DTmin-ID:NHYD--------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00771>      ADD HYD                1.0 02:E_Pond-Out    25.81     .344 No_date    2:24   57.75 n/a      .000
00772>                       +    1.0 02:E_Pond-Ovf     .00     .000 No_date    0:00     .00 n/a      .000
00773>                     SUM=     1.0 01:East          25.81     .344 No_date    2:24   57.75 n/a      .000
00774> ###############################################################################
00775> # STORMS
00776> ###############################################################################
00777>   ** END OF RUN :  101
00778>
00779> *******************************************************************************************************
00780>
00781>
00782>
00783>
00784>
00785>  RUN#:COMMAND#
00786> R0102:C00001------------------------------------------------------------------------------------------
00787>       START
00788>         [TZERO =    .00 hrs on       0]
00789>         [METOUT=   2   (1=imperial, 2=metric output)]
00790>         [NSTORM=   1 ]
00791>         [NRUN   = 0102 ]
00792> *******************************************************************
00793> #  SWMHYMO Ver:5.500/Feb 2015 / INPUT DATA FILE
00794> *******************************************************************
00795> #  Project Name  : [Caivan Stittsville West properties]
00796> #  Project Number: [2267]
00797> #  Date          : [2023/11/28]
00798> #  Modeller      : [PP]
00799> #  Company       : J.F. Sabourin and Associates
00800> #  License #     : 2549237
00801> *******************************************************************
00802> R0102:C00002------------------------------------------------------------------------------------------
00803>       READ STORM
00804>         Filename = storm.001
00805>         Comment  = 2 years SCS Type 2 Storm 24 Hours step 10 min, City of Ottawa
00806>         [SDT=10.00:SDUR=  24.00:PTOT=  48.46]
00807> R0102:C00003------------------------------------------------------------------------------------------
00808>       DEFAULT VALUES
00809>         Filename = C:\Temp\P2267-Stittsville FSR\20231128-MSS Pond Sizing\Ottawa.val
00810>         ICASEdv  = 1 (read and print data)
00811>         FileTitle= File comment: [Parameters for City of Ottawa Projects]
00812>                    THE FOLLOWING PARAMETERS ARE USED IN THE DESIGN STANDHYD COM
00813>         Horton's infiltration equation parameters:
00814>         [Fo= 76.20 mm/hr] [Fc=13.20 mm/hr] [DCAY= 4.14 /hr] [F=  .00 mm]
00815>         Parameters for PERVIOUS surfaces in STANDHYD:
00816>         [IAper=   4.67 mm] [LGP=40.00 m] [MNP=.250]
00817>         Parameters for IMPERVIOUS surfaces in STANDHYD:
00818>         [IAimp=   1.57 mm] [CLI= 1.50]   [MNI= .013]
00819>         Parameters used in NASHYD:
00820>         [Ia=    4.67 mm] [N= 3.00]
00821>         Average monthly Fan Evaporation data in    (mm)
00822>      JAN   FEB   MAR   APR   MAY   JUN   JUL   AUG   SEP   OCT   NOV   DEC
00823>      .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00
00824>         Average monthly Potential Evapotranspiration in    (mm)
00825>      JAN   FEB   MAR   APR   MAY   JUN   JUL   AUG   SEP   OCT   NOV   DEC
00826>      .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00
00827> ###############################################################################
00828> # Post Development Conditions
00829> ###############################################################################
00830> # West Development
00831> ###############################################################################
00832> # Post-development drainage area to West SWM Pond
00833> R0102:C00004------------DTmin-ID:NHYD--------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00834>      CALIB STANDHYD         1.0 01:W_Pond        36.55    3.191 No_date   12:04   34.35 .709     .000
00835>        [XIMP=.66:TIMP=.71]
00836>        [Horton parameters: Fo= 76.20:Fc= 13.20:DCAY=4.14:  F= .00]
00837>        [Pervious      area: IAper= 4.67:SLPP=2.00:LGP=  40.:MNP=.250:SCP=   .0]
00838>        [Impervious    area: IAimp= 1.57:SLPI= .50:LGI= 494.:MNI=.013:SCI=   .0]
00839> ###############################################################################
00840> # West Pond Routing
00841> ###############################################################################
00842> R0102:C00005------------DTmin-ID:NHYD--------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00843>      ROUTE RESERVOIR ->     1.0 02:W_Pond        36.55    3.191 No_date   12:04   34.35 n/a      .000
00844>                        out <=    1.0 01:W_Pond-Out    36.55     .109 No_date   14:20   34.35 n/a      .000
00845>                   overflow <=    1.0 03:W_Pond-Ovf     .00     .000 No_date    0:00     .00 n/a      .000
00846>      (MxStoUsed=.9110E+00  m3, TotOvfVol=.0000E+00  m3, N-Ovf=     0, TotDurOvf=    0.hrs)
00847> ###############################################################################
00848> # Total post-development flows from West development
00849> ###############################################################################
00850> R0102:C00006------------DTmin-ID:NHYD--------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00851>      ADD HYD                1.0 02:W_Pond-Out    36.55     .109 No_date   14:20   34.35 n/a      .000
00852>                       +    1.0 02:W_Pond-Ovf     .00     .000 No_date    0:00     .00 n/a      .000
00853>                     SUM=     1.0 01:West          36.55     .109 No_date   14:20   34.35 n/a      .000
00854> ###############################################################################
00855> # East Development
00856> ###############################################################################
00857> # Post-development drainage area to East SWM Pond
00858> R0102:C00007------------DTmin-ID:NHYD--------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00859>      CALIB STANDHYD         1.0 01:E_Pond        25.81    2.355 No_date   12:04   34.35 .709     .000
00860>        [XIMP=.66:TIMP=.71]
00861>        [Horton parameters: Fo= 76.20:Fc= 13.20:DCAY=4.14:  F= .00]
00862>        [Pervious      area: IAper= 4.67:SLPP=2.00:LGP=  40.:MNP=.250:SCP=   .0]
00863>        [Impervious    area: IAimp= 1.57:SLPI= .50:LGI= 415.:MNI=.013:SCI=   .0]
00864> ###############################################################################
00865> # East Pond Routing
00866> ###############################################################################
00867> R0102:C00008------------DTmin-ID:NHYD--------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00868>      ROUTE RESERVOIR ->     1.0 02:E_Pond        25.81    2.355 No_date   12:04   34.35 n/a      .000
00869>                        out <=    1.0 01:E_Pond-Out    25.81     .109 No_date   13:46   34.35 n/a      .000
00870>                   overflow <=    1.0 03:E_Pond-Ovf     .00     .000 No_date    0:00     .00 n/a      .000
00871>      (MxStoUsed=.6171E+00  m3, TotOvfVol=.0000E+00  m3, N-Ovf=     0, TotDurOvf=    0.hrs)
00872> ###############################################################################
00873> # Total post-development flows from East development
00874> ###############################################################################
00875> R0102:C00009------------DTmin-ID:NHYD--------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00876>      ADD HYD                1.0 02:E_Pond-Out    25.81     .109 No_date   13:46   34.35 n/a      .000
00877>                       +    1.0 02:E_Pond-Ovf     .00     .000 No_date    0:00     .00 n/a      .000
00878>                     SUM=     1.0 01:East          25.81     .109 No_date   13:46   34.35 n/a      .000
00879> ###############################################################################
00880> # STORMS
00881> ###############################################################################
00882>   ** END OF RUN :  104
00883>
00884> *******************************************************************************************************
00885>
00886>
00887>
00888>
00889>
00890>  RUN#:COMMAND#
00891> R0105:C00001------------------------------------------------------------------------------------------
00892>       START
00893>         [TZERO =    .00 hrs on       0]
00894>         [METOUT=   2   (1=imperial, 2=metric output)]
00895>         [NSTORM=   1 ]
00896>         [NRUN   = 0105 ]
00897> *******************************************************************
00898> #  SWMHYMO Ver:5.500/Feb 2015 / INPUT DATA FILE
00899> *******************************************************************
00900> #  Project Name  : [Caivan Stittsville West properties]
00901> #  Project Number: [2267]
00902> #  Date          : [2023/11/28]
00903> #  Modeller      : [PP]
00904> #  Company       : J.F. Sabourin and Associates
00905> #  License #     : 2549237
00906> *******************************************************************
00907> R0105:C00002------------------------------------------------------------------------------------------
00908>       READ STORM
00909>         Filename = storm.001
00910>         Comment  = 5 years SCS Type 2 Storm 24 Hours step 10 min, City of Ottawa
00911>         [SDT=10.00:SDUR=  24.00:PTOT=  64.11]
00912> R0105:C00003------------------------------------------------------------------------------------------
00913>       DEFAULT VALUES
00914>         Filename = C:\Temp\P2267-Stittsville FSR\20231128-MSS Pond Sizing\Ottawa.val
00915>         ICASEdv  = 1 (read and print data)
00916>         FileTitle= File comment: [Parameters for City of Ottawa Projects]
00917>                    THE FOLLOWING PARAMETERS ARE USED IN THE DESIGN STANDHYD COM
00918>         Horton's infiltration equation parameters:
00919>         [Fo= 76.20 mm/hr] [Fc=13.20 mm/hr] [DCAY= 4.14 /hr] [F=  .00 mm]
00920>         Parameters for PERVIOUS surfaces in STANDHYD:
00921>         [IAper=   4.67 mm] [LGP=40.00 m] [MNP= .250]
00922>         Parameters for IMPERVIOUS surfaces in STANDHYD:
00923>         [IAimp=   1.57 mm] [CLI= 1.50]   [MNI= .013]
00924>         Parameters used in NASHYD:
00925>         [Ia=    4.67 mm] [N= 3.00]
00926>         Average monthly Fan Evaporation data in    (mm)
00927>      JAN   FEB   MAR   APR   MAY   JUN   JUL   AUG   SEP   OCT   NOV   DEC
00928>      .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00
00929>         Average monthly Potential Evapotranspiration in    (mm)
00930>      JAN   FEB   MAR   APR   MAY   JUN   JUL   AUG   SEP   OCT   NOV   DEC
00931>      .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00
00932> ###############################################################################
00933> # Post Development Conditions
00934> ###############################################################################
00935> # West Development
00936> ###############################################################################
00937> # Post-development drainage area to West SWM Pond
00938> R0105:C00004------------DTmin-ID:NHYD--------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00939>      CALIB STANDHYD         1.0 01:W_Pond        36.55    4.705 No_date   12:04   46.90 .732     .000
00940>        [XIMP=.66:TIMP=.71]
00941>        [Horton parameters: Fo= 76.20:Fc= 13.20:DCAY=4.14:  F= .00]
00942>        [Pervious      area: IAper= 4.67:SLPP=2.00:LGP=  40.:MNP=.250:SCP=   .0]
00943>        [Impervious    area: IAimp= 1.57:SLPI= .50:LGI= 494.:MNI=.013:SCI=   .0]
00944> ###############################################################################
00945> # West Pond Routing
00946> ###############################################################################
00947> R0105:C00005------------DTmin-ID:NHYD--------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00948>      ROUTE RESERVOIR ->     1.0 02:W_Pond        36.55    4.705 No_date   12:04   46.90 n/a      .000
00949>                        out <=    1.0 01:W_Pond-Out    36.55     .174 No_date   14:06   46.90 n/a      .000
00950>                   overflow <=    1.0 03:W_Pond-Ovf     .00     .000 No_date    0:00     .00 n/a      .000
00951>      (MxStoUsed=.1242E+01  m3, TotOvfVol=.0000E+00  m3, N-Ovf=     0, TotDurOvf=    0.hrs)
00952> ###############################################################################
00953> # Total post-development flows from West development
00954> ###############################################################################
00955> R0105:C00006------------DTmin-ID:NHYD--------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00956>      ADD HYD                1.0 02:W_Pond-Out    36.55     .174 No_date   14:06   46.90 n/a      .000
00957>                       +    1.0 02:W_Pond-Ovf     .00     .000 No_date    0:00     .00 n/a      .000
00958>                     SUM=     1.0 01:West          36.55     .174 No_date   14:06   46.90 n/a      .000
00959> ###############################################################################
00960> # East Development
00961> ###############################################################################
00962> # Post-development drainage area to East SWM Pond
00963> R0105:C00002------------DTmin-ID:NHYD--------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00964>      CALIB STANDHYD         1.0 01:E_Pond        25.81    3.469 No_date   12:03   46.90 .732     .000
00965>        [XIMP=.66:TIMP=.71]
00966>        [Horton parameters: Fo= 76.20:Fc= 13.20:DCAY=4.14:  F= .00]
00967>        [Pervious      area: IAper= 4.67:SLPP=2.00:LGP=  40.:MNP=.250:SCP=   .0]
00968>        [Impervious    area: IAimp= 1.57:SLPI= .50:LGI= 415.:MNI=.013:SCI=   .0]
00969> ###############################################################################
00970> # East Pond Routing
00971> ###############################################################################
00972> R0105:C00008------------DTmin-ID:NHYD--------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00973>      ROUTE RESERVOIR ->     1.0 02:E_Pond        25.81    3.469 No_date   12:03   46.90 n/a      .000
00974>                        out <=    1.0 01:E_Pond-Out    25.81     .170 No_date   13:33   46.90 n/a      .000
00975>                   overflow <=    1.0 03:E_Pond-Ovf     .00     .000 No_date    0:00     .00 n/a      .000
00976>      (MxStoUsed=.8419E+00  m3, TotOvfVol=.0000E+00  m3, N-Ovf=     0, TotDurOvf=    0.hrs)
00977> ###############################################################################
00978> # Total post-development flows from East development
00979> ###############################################################################
00980> R0105:C00009------------DTmin-ID:NHYD--------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
00981>      ADD HYD                1.0 02:E_Pond-Out    25.81     .170 No_date   13:33   46.90 n/a      .000
00982>                       +    1.0 02:E_Pond-Ovf     .00     .000 No_date    0:00     .00 n/a      .000
00983>                     SUM=     1.0 01:East          25.81     .170 No_date   13:33   46.90 n/a      .000
00984> ###############################################################################
00985> # STORMS
00986> ###############################################################################
00987>   ** END OF RUN :  109
00988>
00989> *******************************************************************************************************
00990>
00991>
00992>
00993>
00994>
00995>  RUN#:COMMAND#
00996> R0110:C00001------------------------------------------------------------------------------------------
00997>       START
00998>         [TZERO =    .00 hrs on       0]
00999>         [METOUT=   2   (1=imperial, 2=metric output)]
01000>         [NSTORM=   1 ]
01001>         [NRUN   = 0110 ]
01002> *******************************************************************
01003> #  SWMHYMO Ver:5.500/Feb 2015 / INPUT DATA FILE
01004> *******************************************************************
01005> #  Project Name  : [Caivan Stittsville West properties]
01006> #  Project Number: [2267]
01007> #  Date          : [2023/11/28]
01008> #  Modeller      : [PP]
01009> #  Company       : J.F. Sabourin and Associates
01010> #  License #     : 2549237
01011> *******************************************************************
01012> R0110:C00002------------------------------------------------------------------------------------------
01013>       READ STORM
01014>         Filename = storm.001
01015>         Comment  = 10 years SCS Type 2 Storm 24 Hours step 10 min, City of Ottawa
01016>         [SDT=10.00:SDUR=  24.00:PTOT=  74.35]
01017> R0110:C00003------------------------------------------------------------------------------------------
01018>       DEFAULT VALUES
01019>         Filename = C:\Temp\P2267-Stittsville FSR\20231128-MSS Pond Sizing\Ottawa.val
01020>         ICASEdv  = 1 (read and print data)
01021>         FileTitle= File comment: [Parameters for City of Ottawa Projects]
01022>                    THE FOLLOWING PARAMETERS ARE USED IN THE DESIGN STANDHYD COM
01023>         Horton's infiltration equation parameters:
01024>         [Fo= 76.20 mm/hr] [Fc=13.20 mm/hr] [DCAY= 4.14 /hr] [F=  .00 mm]
01025>         Parameters for PERVIOUS surfaces in STANDHYD:
01026>         [IAper=   4.67 mm] [LGP=40.00 m] [MNP= .250]
01027>         Parameters for IMPERVIOUS surfaces in STANDHYD:
01028>         [IAimp=   1.57 mm] [CLI= 1.50]   [MNI= .013]
01029>         Parameters used in NASHYD:
01030>         [Ia=    4.67 mm] [N= 3.00]
01031>         Average monthly Fan Evaporation data in    (mm)
01032>      JAN   FEB   MAR   APR   MAY   JUN   JUL   AUG   SEP   OCT   NOV   DEC
01033>      .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00
01034>         Average monthly Potential Evapotranspiration in    (mm)
01035>      JAN   FEB   MAR   APR   MAY   JUN   JUL   AUG   SEP   OCT   NOV   DEC
01036>      .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00
01037> ###############################################################################
01038> # Post Development Conditions
01039> ###############################################################################
01040> # West Development
01041> ###############################################################################
01042> # Post-development drainage area to West SWM Pond
01043> R0110:C00004------------DTmin-ID:NHYD--------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
01044>      CALIB STANDHYD         1.0 01:W_Pond        36.55    5.757 No_date   12:04   55.24 .743     .000
01045>        [XIMP=.66:TIMP=.71]
01046>        [Horton parameters: Fo= 76.20:Fc= 13.20:DCAY=4.14:  F= .00]
01047>        [Pervious      area: IAper= 4.67:SLPP=2.00:LGP=  40.:MNP=.250:SCP=   .0]
01048>        [Impervious    area: IAimp= 1.57:SLPI= .50:LGI= 494.:MNI=.013:SCI=   .0]
01049> ###############################################################################
01050> # West Pond Routing
01051> ###############################################################################
01052> R0110:C00005------------DTmin-ID:NHYD--------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
01053>      ROUTE RESERVOIR ->     1.0 02:W_Pond        36.55    5.757 No_date   12:04   55.24 n/a      .000
01054>                        out <=    1.0 01:W_Pond-Out    36.55     .230 No_date   13:46   55.24 n/a      .000
01055>                   overflow <=    1.0 03:W_Pond-Ovf     .00     .000 No_date    0:00     .00 n/a      .000
01056>      (MxStoUsed=.1457E+01  m3, TotOvfVol=.0000E+00  m3, N-Ovf=     0, TotDurOvf=    0.hrs)
01057> ###############################################################################
01058> # Total post-development flows from West development
01059> ###############################################################################
01060> R0110:C00006------------DTmin-ID:NHYD--------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
01061>      ADD HYD                1.0 02:W_Pond-Out    36.55     .230 No_date   13:46   55.24 n/a      .000
01062>                       +    1.0 02:W_Pond-Ovf     .00     .000 No_date    0:00     .00 n/a      .000
01063>                     SUM=     1.0 01:West          36.55     .230 No_date   13:46   55.24 n/a      .000
01064> ###############################################################################
01065> # East Development
01066> ###############################################################################
01067> # Post-development drainage area to East SWM Pond
01068> R0110:C00007------------DTmin-ID:NHYD--------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
01069>      CALIB STANDHYD         1.0 01:E_Pond        25.81    4.243 No_date   12:03   55.24 .743     .000
01070>        [XIMP=.66:TIMP=.71]
01071>        [Horton parameters: Fo= 76.20:Fc= 13.20:DCAY=4.14:  F= .00]
01072>        [Pervious      area: IAper= 4.67:SLPP=2.00:LGP=  40.:MNP=.250:SCP=   .0]
01073>        [Impervious    area: IAimp= 1.57:SLPI= .50:LGI= 415.:MNI=.013:SCI=   .0]
01074> ###############################################################################
01075> # East Pond Routing
01076> ###############################################################################
01077> R0110:C00008------------DTmin-ID:NHYD--------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
01078>      ROUTE RESERVOIR ->     1.0 02:E_Pond        25.81    4.243 No_date   12:03   55.24 n/a      .000
01079>                        out <=    1.0 01:E_Pond-Out    25.81     .225 No_date   13:15   55.24 n/a      .000
01080>                   overflow <=    1.0 03:E_Pond-Ovf     .00     .000 No_date    0:00     .00 n/a      .000
```

DRAFT

```
01081>      (MxStoUsed=.9877E+00  m3, TotOvfVol=.0000E+00  m3, N-Ovf=    0, TotDurOvf=    0.hrs)
01082> ##############################################################################
01083> # Total post-development flows from East development
01084> ##############################################################################
01085> R0110:C00009------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
01086>     ADD HYD                 1.0 02:E_Pond-Out    25.81     .225 No_date   13:15   55.24  n/a     .000
01087>                   +         1.0 02:E_Pond-Ovf       .00     .000 No_date   0:00     .00  n/a     .000
01088>                 SUM=        1.0 01:East          25.81     .225 No_date   13:15   55.24  n/a     .000
01089> ##############################################################################
01090> # STORMS
01091> ##############################################################################
01092>   ** END OF RUN :  124
01093>
01094> ********************************************************************************************************
01095>
01096>
01097>
01098>
01099>
01100>  RUN#:COMMAND#
01101> R0125:C00001------------------------------------------------------------------------------------------
01102>      START
01103>        [TZERO =    .00 hrs on        0]
01104>        [METOUT=  2    (1=imperial, 2=metric output)]
01105>        [NSTORM=  1 ]
01106>        [NRUN  = 0125 ]
01107> *****************************************************************************
01108> #  SWMHYMO Ver:5.500/Feb 2015 / INPUT DATA FILE
01109> *****************************************************************************
01110> #  Project Name  : [Caivan Stittsville West properties]
01111> #  Project Number: [2267]
01112> #  Date          : [2023/11/28]
01113> #  Modeller      : [PP]
01114> #  Company       : J.F. Sabourin and Associates
01115> #  License #     : 2549237
01116> *****************************************************************************
01117> R0125:C00002------------------------------------------------------------------------------------------
01118>      READ STORM
01119>        Filename = storm.001
01120>        Comment  = 25 years SCS Type 2 Storm 24 Hours step 10 min, City of Ottawa
01121>        [SDT=10.00:SDUR=  24.00:PTOT=  86.89]
01122> R0125:C00003------------------------------------------------------------------------------------------
01123>      DEFAULT VALUES
01124>        Filename = C:\Temp\P2267-Stittsville FSR\20231128-MSS Pond Sizing\Ottawa.val
01125>        ICASEdv  = 1 (read and print data)
01126>        FileTitle= File comment: [Parameters for City of Ottawa Projects]
01127>                   THE FOLLOWING PARAMETERS ARE USED IN THE DESIGN STANDHYD COM
01128>        Horton's infiltration equation parameters:
01129>        [Fo= 76.20 mm/hr] [Fc=13.20 mm/hr] [DCAY= 4.14 /hr] [F=  .00 mm]
01130>        Parameters for PERVIOUS surfaces in STANDHYD:
01131>        [IAperm=  4.67 mm] [LGP=40.00 m] [MNP= .250]
01132>        Parameters for IMPERVIOUS surfaces in STANDHYD:
01133>        [IAimp=   1.57 mm] [CLI= 1.50]   [MNI= .013]
01134>        Parameters used in NASHYD:
01135>        [Ia=   4.67 mm] [N= 3.00]
01136>        Average monthly Fan Evaporation data in    (mm)
01137>     JAN   FEB   MAR   APR   MAY   JUN   JUL   AUG   SEP   OCT   NOV   DEC
01138>    .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00
01139>        Average monthly Potential Evapotranspiration in    (mm)
01140>     JAN   FEB   MAR   APR   MAY   JUN   JUL   AUG   SEP   OCT   NOV   DEC
01141>    .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00
01142> ##############################################################################
01143> # Post Development Conditions
01144> ##############################################################################
01145> # West Development
01146> ##############################################################################
01147> # Post-development drainage area to West SWM Pond
01148> R0125:C00004------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
01149>     CALIB STANDHYD          1.0 01:W_Pond        36.55    7.086 No_date   12:03   65.62 .755     .000
01150>        [XIMP=.66:TIMP=.71]
01151>        [Horton parameters: Fo= 76.20:Fc= 13.20:DCAY=4.14:  F= .00]
01152>        [Pervious     area: IAper= 4.67:SLPP=2.00:LGP=  40.:MNP=.250:SCP=   .0]
01153>        [Impervious   area: IAimp= 1.57:SLPI= .50:LGI= 494.:MNI=.013:SCI=   .0]
01154> ##############################################################################
01155> # West Pond Routing
01156> ##############################################################################
01157> R0125:C00005------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
01158>     ROUTE RESERVOIR ->      1.0 02:W_Pond        36.55    7.086 No_date   12:03   65.62  n/a     .000
01159>                   out <=    1.0 01:W_Pond-Out    36.55     .334 No_date   13:28   65.62  n/a     .000
01160>             overflow <=     1.0 03:W_Pond-Ovf       .00     .000 No_date   0:00     .00  n/a     .000
01161>     (MxStoUsed=.1719E+01  m3, TotOvfVol=.0000E+00  m3, N-Ovf=    0, TotDurOvf=    0.hrs)
01162> ##############################################################################
01163> # Total post-development flows from West development
01164> ##############################################################################
01165> R0125:C00006------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
01166>     ADD HYD                 1.0 02:W_Pond-Out    36.55     .334 No_date   13:28   65.62  n/a     .000
01167>                   +         1.0 02:W_Pond-Ovf       .00     .000 No_date   0:00     .00  n/a     .000
01168>                 SUM=        1.0 01:West          36.55     .334 No_date   13:28   65.62  n/a     .000
01169> ##############################################################################
01170> # East Development
01171> ##############################################################################
01172> # Post-development drainage area to East SWM Pond
01173> R0125:C00007------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
01174>     CALIB STANDHYD          1.0 01:E_Pond        25.81    5.212 No_date   12:02   65.62 .755     .000
01175>        [XIMP=.66:TIMP=.71]
01176>        [Horton parameters: Fo= 76.20:Fc= 13.20:DCAY=4.14:  F= .00]
01177>        [Pervious     area: IAper= 4.67:SLPP=2.00:LGP=  40.:MNP=.250:SCP=   .0]
01178>        [Impervious   area: IAimp= 1.57:SLPI= .50:LGI= 415.:MNI=.013:SCI=   .0]
01179> ##############################################################################
01180> # East Pond Routing
01181> ##############################################################################
01182> R0125:C00008------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
01183>     ROUTE RESERVOIR ->      1.0 02:E_Pond        25.81    5.212 No_date   12:02   65.62  n/a     .000
01184>                   out <=    1.0 01:E_Pond-Out    25.81     .300 No_date   13:08   65.62  n/a     .000
01185>             overflow <=     1.0 03:E_Pond-Ovf       .00     .000 No_date   0:00     .00  n/a     .000
01186>     (MxStoUsed=.1170E+01  m3, TotOvfVol=.0000E+00  m3, N-Ovf=    0, TotDurOvf=    0.hrs)
01187> ##############################################################################
01188> # Total post-development flows from East development
01189> ##############################################################################
01190> R0125:C00009------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
01191>     ADD HYD                 1.0 02:E_Pond-Out    25.81     .300 No_date   13:08   65.62  n/a     .000
01192>                   +         1.0 02:E_Pond-Ovf       .00     .000 No_date   0:00     .00  n/a     .000
01193>                 SUM=        1.0 01:East          25.81     .300 No_date   13:08   65.62  n/a     .000
01194> ##############################################################################
01195> # STORMS
01196> ##############################################################################
01197>   ** END OF RUN :  149
01198>
01199> ********************************************************************************************************
01200>
01201>
01202>
01203>
01204>
01205>  RUN#:COMMAND#
01206> R0150:C00001------------------------------------------------------------------------------------------
01207>      START
01208>        [TZERO =    .00 hrs on        0]
01209>        [METOUT=  2    (1=imperial, 2=metric output)]
01210>        [NSTORM=  1 ]
01211>        [NRUN  = 0150 ]
01212> *****************************************************************************
01213> #  SWMHYMO Ver:5.500/Feb 2015 / INPUT DATA FILE
01214> *****************************************************************************
01215> #  Project Name  : [Caivan Stittsville West properties]
01216> #  Project Number: [2267]
01217> #  Date          : [2023/11/28]
01218> #  Modeller      : [PP]
01219> #  Company       : J.F. Sabourin and Associates
01220> #  License #     : 2549237
01221> *****************************************************************************
01222> R0150:C00002------------------------------------------------------------------------------------------
01223>      READ STORM
01224>        Filename = storm.001
01225>        Comment  = 50 years SCS Type 2 Storm 24 Hours step 10 min, City of Ottawa
01226>        [SDT=10.00:SDUR=  24.00:PTOT=  96.53]
01227> R0150:C00003------------------------------------------------------------------------------------------
01228>      DEFAULT VALUES
01229>        Filename = C:\Temp\P2267-Stittsville FSR\20231128-MSS Pond Sizing\Ottawa.val
01230>        ICASEdv  = 1 (read and print data)
01231>        FileTitle= File comment: [Parameters for City of Ottawa Projects]
01232>                   THE FOLLOWING PARAMETERS ARE USED IN THE DESIGN STANDHYD COM
01233>        Horton's infiltration equation parameters:
01234>        [Fo= 76.20 mm/hr] [Fc=13.20 mm/hr] [DCAY= 4.14 /hr] [F=  .00 mm]
01235>        Parameters for PERVIOUS surfaces in STANDHYD:
01236>        [IAperm=  4.67 mm] [LGP=40.00 m] [MNP= .250]
01237>        Parameters for IMPERVIOUS surfaces in STANDHYD:
01238>        [IAimp=   1.57 mm] [CLI= 1.50]   [MNI= .013]
01239>        Parameters used in NASHYD:
01240>        [Ia=   4.67 mm] [N= 3.00]
01241>        Average monthly Fan Evaporation data in    (mm)
01242>     JAN   FEB   MAR   APR   MAY   JUN   JUL   AUG   SEP   OCT   NOV   DEC
01243>    .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00
01244>        Average monthly Potential Evapotranspiration in    (mm)
01245>     JAN   FEB   MAR   APR   MAY   JUN   JUL   AUG   SEP   OCT   NOV   DEC
01246>    .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00
01247> ##############################################################################
01248> # Post Development Conditions
01249> ##############################################################################
01250> # West Development
01251> ##############################################################################
01252> # Post-development drainage area to West SWM Pond
01253> R0150:C00004------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
01254>     CALIB STANDHYD          1.0 01:W_Pond        36.55    8.099 No_date   12:03   73.59 .762     .000
01255>        [XIMP=.66:TIMP=.71]
01256>        [Horton parameters: Fo= 76.20:Fc= 13.20:DCAY=4.14:  F= .00]
01257>        [Pervious     area: IAper= 4.67:SLPP=2.00:LGP=  40.:MNP=.250:SCP=   .0]
01258>        [Impervious   area: IAimp= 1.57:SLPI= .50:LGI= 494.:MNI=.013:SCI=   .0]
01259> ##############################################################################
01260> # West Pond Routing
01261> ##############################################################################
01262> R0150:C00005------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
01263>     ROUTE RESERVOIR ->      1.0 02:W_Pond        36.55    8.099 No_date   12:03   73.59  n/a     .000
01264>                   out <=    1.0 01:W_Pond-Out    36.55     .403 No_date   13:17   73.58  n/a     .000
01265>             overflow <=     1.0 03:W_Pond-Ovf       .00     .000 No_date   0:00     .00  n/a     .000
01266>     (MxStoUsed=.1921E+01  m3, TotOvfVol=.0000E+00  m3, N-Ovf=    0, TotDurOvf=    0.hrs)
01267> ##############################################################################
01268> # Total post-development flows from West development
01269> ##############################################################################
01270> R0150:C00006------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
01271>     ADD HYD                 1.0 02:W_Pond-Out    36.55     .403 No_date   13:17   73.58  n/a     .000
01272>                   +         1.0 02:W_Pond-Ovf       .00     .000 No_date   0:00     .00  n/a     .000
01273>                 SUM=        1.0 01:West          36.55     .403 No_date   13:17   73.58  n/a     .000
01274> ##############################################################################
01275> # East Development
01276> ##############################################################################
01277> # Post-development drainage area to East SWM Pond
01278> R0150:C00007------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
01279>     CALIB STANDHYD          1.0 01:E_Pond        25.81    5.902 No_date   12:02   73.59 .762     .000
01280>        [XIMP=.66:TIMP=.71]
01281>        [Horton parameters: Fo= 76.20:Fc= 13.20:DCAY=4.14:  F= .00]
01282>        [Pervious     area: IAper= 4.67:SLPP=2.00:LGP=  40.:MNP=.250:SCP=   .0]
01283>        [Impervious   area: IAimp= 1.57:SLPI= .50:LGI= 415.:MNI=.013:SCI=   .0]
01284> ##############################################################################
01285> # East Pond Routing
01286> ##############################################################################
01287> R0150:C00008------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
01288>     ROUTE RESERVOIR ->      1.0 02:E_Pond        25.81    5.902 No_date   12:02   73.58  n/a     .000
01289>                   out <=    1.0 01:E_Pond-Out    25.81     .368 No_date   13:08   73.59  n/a     .000
01290>             overflow <=     1.0 03:E_Pond-Ovf       .00     .000 No_date   0:00     .00  n/a     .000
01291>     (MxStoUsed=.1307E+01  m3, TotOvfVol=.0000E+00  m3, N-Ovf=    0, TotDurOvf=    0.hrs)
01292> ##############################################################################
01293> # Total post-development flows from East development
01294> ##############################################################################
01295> R0150:C00009------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
01296>     ADD HYD                 1.0 02:E_Pond-Out    25.81     .368 No_date   13:04   73.59  n/a     .000
01297>                   +         1.0 02:E_Pond-Ovf       .00     .000 No_date   0:00     .00  n/a     .000
01298>                 SUM=        1.0 01:East          25.81     .368 No_date   13:04   73.59  n/a     .000
01299> ##############################################################################
01300> # STORMS
01301> ##############################################################################
01302>   ** END OF RUN :  198
01303>
01304> ********************************************************************************************************
01305>
01306>
01307>
01308>
01309>
01310>  RUN#:COMMAND#
01311> R0199:C00001------------------------------------------------------------------------------------------
01312>      START
01313>        [TZERO =    .00 hrs on        0]
01314>        [METOUT=  2    (1=imperial, 2=metric output)]
01315>        [NSTORM=  1 ]
01316>        [NRUN  = 0199 ]
01317> *****************************************************************************
01318> #  SWMHYMO Ver:5.500/Feb 2015 / INPUT DATA FILE
01319> *****************************************************************************
01320> #  Project Name  : [Caivan Stittsville West properties]
01321> #  Project Number: [2267]
01322> #  Date          : [2023/11/28]
01323> #  Modeller      : [PP]
01324> #  Company       : J.F. Sabourin and Associates
01325> #  License #     : 2549237
01326> *****************************************************************************
01327> R0199:C00002------------------------------------------------------------------------------------------
01328>      READ STORM
01329>        Filename = storm.001
01330>        Comment  = 100 years SCS Type 2 Storm 24 Hours step 10 min, City of Ottawa
01331>        [SDT=10.00:SDUR=  24.00:PTOT= 106.73]
01332> R0199:C00003------------------------------------------------------------------------------------------
01333>      DEFAULT VALUES
01334>        Filename = C:\Temp\P2267-Stittsville FSR\20231128-MSS Pond Sizing\Ottawa.val
01335>        ICASEdv  = 1 (read and print data)
01336>        FileTitle= File comment: [Parameters for City of Ottawa Projects]
01337>                   THE FOLLOWING PARAMETERS ARE USED IN THE DESIGN STANDHYD COM
01338>        Horton's infiltration equation parameters:
01339>        [Fo= 76.20 mm/hr] [Fc=13.20 mm/hr] [DCAY= 4.14 /hr] [F=  .00 mm]
01340>        Parameters for PERVIOUS surfaces in STANDHYD:
01341>        [IAperm=  4.67 mm] [LGP=40.00 m] [MNP= .250]
01342>        Parameters for IMPERVIOUS surfaces in STANDHYD:
01343>        [IAimp=   1.57 mm] [CLI= 1.50]   [MNI= .013]
01344>        Parameters used in NASHYD:
01345>        [Ia=   4.67 mm] [N= 3.00]
01346>        Average monthly Fan Evaporation data in    (mm)
01347>     JAN   FEB   MAR   APR   MAY   JUN   JUL   AUG   SEP   OCT   NOV   DEC
01348>    .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00
01349>        Average monthly Potential Evapotranspiration in    (mm)
01350>     JAN   FEB   MAR   APR   MAY   JUN   JUL   AUG   SEP   OCT   NOV   DEC
01351>    .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00
01352> ##############################################################################
01353> # Post Development Conditions
01354> ##############################################################################
01355> # West Development
01356> ##############################################################################
01357> # Post-development drainage area to West SWM Pond
01358> R0199:C00004------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
01359>     CALIB STANDHYD          1.0 01:W_Pond        36.55    9.165 No_date   12:02   81.94 .768     .000
01360>        [XIMP=.66:TIMP=.71]
01361>        [Horton parameters: Fo= 76.20:Fc= 13.20:DCAY=4.14:  F= .00]
01362>        [Pervious     area: IAper= 4.67:SLPP=2.00:LGP=  40.:MNP=.250:SCP=   .0]
01363>        [Impervious   area: IAimp= 1.57:SLPI= .50:LGI= 494.:MNI=.013:SCI=   .0]
01364> ##############################################################################
01365> # West Pond Routing
01366> ##############################################################################
01367> R0199:C00005------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
01368>     ROUTE RESERVOIR ->      1.0 02:W_Pond        36.55    9.165 No_date   12:02   81.94  n/a     .000
01369>                   out <=    1.0 01:W_Pond-Out    36.55     .480 No_date   13:11   81.94  n/a     .000
01370>             overflow <=     1.0 03:W_Pond-Ovf       .00     .000 No_date   0:00     .00  n/a     .000
01371>     (MxStoUsed=.2130E+01  m3, TotOvfVol=.0000E+00  m3, N-Ovf=    0, TotDurOvf=    0.hrs)
01372> ##############################################################################
01373> # Total post-development flows from West development
01374> ##############################################################################
01375> R0199:C00006------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
01376>     ADD HYD                 1.0 02:W_Pond-Out    36.55     .480 No_date   13:11   81.94  n/a     .000
01377>                   +         1.0 02:W_Pond-Ovf       .00     .000 No_date   0:00     .00  n/a     .000
01378>                 SUM=        1.0 01:West          36.55     .480 No_date   13:11   81.94  n/a     .000
01379> ##############################################################################
01380> # East Development
01381> ##############################################################################
01382> # Post-development drainage area to East SWM Pond
01383> R0199:C00007------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
01384>     CALIB STANDHYD          1.0 01:E_Pond        25.81    6.693 No_date   12:02   81.94 .768     .000
01385>        [XIMP=.66:TIMP=.71]
01386>        [Horton parameters: Fo= 76.20:Fc= 13.20:DCAY=4.14:  F= .00]
01387>        [Pervious     area: IAper= 4.67:SLPP=2.00:LGP=  40.:MNP=.250:SCP=   .0]
01388>        [Impervious   area: IAimp= 1.57:SLPI= .50:LGI= 415.:MNI=.013:SCI=   .0]
01389> ##############################################################################
01390> # East Pond Routing
01391> ##############################################################################
01392> R0199:C00008------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
01393>     ROUTE RESERVOIR ->      1.0 02:E_Pond        25.81    6.693 No_date   12:02   81.94  n/a     .000
01394>                   out <=    1.0 01:E_Pond-Out    25.81     .463 No_date   12:55   81.94  n/a     .000
01395>             overflow <=     1.0 03:E_Pond-Ovf       .00     .000 No_date   0:00     .00  n/a     .000
01396>     (MxStoUsed=.1446E+01  m3, TotOvfVol=.0000E+00  m3, N-Ovf=    0, TotDurOvf=    0.hrs)
01397> ##############################################################################
01398> # Total post-development flows from East development
01399> ##############################################################################
01400> R0199:C00009------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
01401>     ADD HYD                 1.0 02:E_Pond-Out    25.81     .463 No_date   12:55   81.94  n/a     .000
01402>                   +         1.0 02:E_Pond-Ovf       .00     .000 No_date   0:00     .00  n/a     .000
01403>                 SUM=        1.0 01:East          25.81     .463 No_date   12:55   81.94  n/a     .000
01404> ##############################################################################
01405> # STORMS
01406> ##############################################################################
01407> R0199:C00002------------------------------------------------------------------------------------------
01408>    FINISH
01409> ------------------------------------------------------------------------------------------------------
01410> ********************************************************************************************************
01411>      WARNINGS / ERRORS / NOTES
01412>      -------------------------
01413>    Simulation ended on 2023-11-28     at 13:58:49
01414> ========================================================================================================
01415>
```

DRAFT

J.F. Sabourin and Associates Inc.
52 Springbrook Drive,
Ottawa, ON K2S 1B9
T 613-836-3884 F 613-836-0332

jfsa.com

Attachment D

Preliminary Storm Hydraulic Grade Line Analysis

DRAFT

Table D-1: Caivan Stittsville Lands - MSS
Preliminary 100 Year HGL Analysis

SWM Pond	MH-ID	Invert Elevation (m)	Top of MH (m)	Max HGL (m)	Top of MH Freeboard (m)
Trunk 1 West SWM Pond	MH-111	103.46	106.85	104.45	2.40
	MH-118	103.20	106.74	104.37	2.37
	MH-122	102.87	106.63	104.29	2.34
	MH-123	102.68	106.41	104.20	2.21
	MH-124	102.44	106.29	104.16	2.13
	MH-136	102.20	106.17	104.09	2.08
	MH-137	102.12	106.15	104.03	2.12
	MH-147	101.95	106.00	103.93	2.07
	MH-148	101.81	106.00	103.81	2.19
	West SWM Pond	-	-	103.80	-
Trunk 2 West SWM Pond	MH-221	103.24	106.87	104.26	2.61
	MH-222	103.07	106.64	104.18	2.46
	MH-226	103.00	106.62	104.16	2.46
	MH-229	102.78	106.46	104.03	2.43
	MH-232	102.58	106.22	103.95	2.27
	MH-239	102.46	106.11	103.91	2.20
	MH-247	102.06	106.00	103.84	2.16
	MH-248	101.96	106.00	103.82	2.19
	West SWM Pond	-	-	103.80	-
Trunk 3 Davidson SWM Pond	MH-304	102.99	106.17	103.73	2.44
	MH-305	102.91	106.11	103.70	2.41
	MH-306	102.81	106.08	103.68	2.40
	MH-307	102.69	105.95	103.64	2.32
	MH-312	102.56	105.82	103.56	2.26
	MH-313	102.37	105.74	103.45	2.29
	MH-318	101.68	105.74	103.43	2.31
	MH-319	101.55	105.74	103.35	2.39
	Davidson SWM Pond	-	-	103.32	-
Trunk 4 East SWM Pond	MH-405	102.25	105.68	103.17	2.51
	MH-407	101.94	105.56	102.99	2.57
	MH-410	101.63	105.45	102.93	2.53
	MH-418	101.50	105.36	102.86	2.50
	MH-422	101.27	105.24	102.81	2.43
	MH-425	101.12	105.12	102.70	2.42
	MH-427	100.88	105.03	102.51	2.52
	MH-429	100.81	104.97	102.48	2.49
	MH-433	100.65	104.85	102.32	2.53
	MH-434	100.57	104.85	102.26	2.60
	MH-435	100.53	104.85	102.22	2.63
	East SWM Pond	-	-	102.20	-

DRAFT

Table D-1: Caivan Stittsville Lands - MSS
Preliminary 100 Year HGL Analysis

SWM Pond	MH-ID	Invert Elevation (m)	Top of MH (m)	Max HGL (m)	Top of MH Freeboard (m)
Trunk 5 East SWM Pond	MH-513	101.86	105.52	102.81	2.71
	MH-518	101.39	105.41	102.77	2.64
	MH-519	101.13	105.26	102.70	2.56
	MH-5190	101.01	105.13	102.66	2.47
	MH-523	100.78	104.99	102.43	2.56
	MH-5230	100.84	104.99	102.51	2.48
	MH-525	100.61	104.85	102.26	2.59
	MH-526	100.54	104.79	102.23	2.56
	East SWM Pond	-	-	102.20	-
				Min	2.07
				Max	2.71
				Average	2.40

Notes:

(1) Analysis assumes the use of ICDs throughout the development (s), therefore the Rational Method flows as per DSEL's storm design sheets were increased by 14% to account for additional head on the ICDs during the 100-year event.

(2) Analysis assumes the following preliminary 100-year water level in the West and East SWM Ponds:
West SWM Pond: 103.80m
East SWM Pond: 102.20m

(3) Analysis assumes a preliminary 100-year water level of 103.32m in the Davidson SWM Pond as per recent analysis prepared by JFSA with the inclusion of the total proposed drainage area of 4.13 ha (~71% imperviousness) of Caivan Stittsville lands that is proposed to drain to the Davidson SWM Pond.

(4) Model Name: STIT-STM-MSS_v02.0.inp.

DRAFT

J.F. Sabourin and Associates Inc.
52 Springbrook Drive,
Ottawa, ON K2S 1B9
T 613-836-3884 F 613-836-0332

jfsa.com

Attachment E

Preliminary Sanitary Hydraulic Grade Line Analysis

DRAFT

Table E-1: Caivan Stittsville Lands - MSS
Preliminary Sanitary HGL Analysis
Rare Flows
(Pumping station capacity of 71.5 L/s)

Location	MH-ID	Invert Elevation (m)	Top of MH (m)	Max HGL (m)	Top of MH Freeboard (m)
Trunk 1 West Development	MH-126A	101.11	106.01	101.18	4.83
	MH-127A	100.90	106.16	100.99	5.17
	MH-141A	100.82	106.17	100.95	5.22
	MH-142A	100.68	106.29	100.81	5.48
	MH-143A	100.54	106.41	100.67	5.74
	MH-152A	100.30	106.63	100.46	6.17
	MH-175A	100.17	106.74	100.36	6.38
	MH-180A	100.05	106.85	100.24	6.61
	MH-183A	99.92	107.60	100.14	7.46
	MH-186A	99.75	108.64	99.93	8.71
	MH-187A	99.49	107.82	99.67	8.15
	MH-188A	99.34	107.69	99.52	8.17
	MH-190A	99.18	107.54	99.36	8.18
	MH-191A	99.06	107.46	99.23	8.23
	MH-192A	99.01	107.45	99.18	8.27
	MH-193A	98.93	107.45	99.11	8.34
	MH-194A	98.85	107.45	99.04	8.41
	MH-195A	98.76	107.45	98.96	8.50
	MH-196A	98.66	105.74	98.78	6.96
Trunk 2 East Development	MH-203A	101.51	104.96	101.56	3.40
	MH-207A	101.81	104.88	101.84	3.04
	MH-208A	101.71	104.86	101.74	3.12
	MH-221A	101.13	105.15	101.18	3.97
	MH-223A	100.65	105.24	100.73	4.51
	MH-224A	100.46	105.35	100.54	4.82
	MH-240A	100.37	105.38	100.50	4.88
	MH-241A	100.15	105.57	100.27	5.30
	MH-260A	99.93	105.77	100.10	5.67
	MH-261A	99.87	105.80	100.04	5.76
	MH-262A	99.62	106.52	99.82	6.70
	MH-264A	99.48	106.60	99.65	6.95
	MH-265A	99.33	105.95	99.53	6.42
	MH-274A	99.15	105.82	99.34	6.48
	MH-275A	99.03	105.74	99.21	6.53
	MH-279A	98.98	105.74	99.15	6.59
	MH-280A	98.90	105.74	99.07	6.67
	MH-281A	98.72	105.74	98.81	6.93

DRAFT

Table E-1: Caivan Stittsville Lands - MSS
Preliminary Sanitary HGL Analysis
Rare Flows
(Pumping station capacity of 71.5 L/s)

Location	MH-ID	Invert Elevation (m)	Top of MH (m)	Max HGL (m)	Top of MH Freeboard (m)
	MH-282A_PS	98.60	105.74	98.72	7.02
	SANMH97	103.01	105.34	103.01	2.33
	Davidson_Pond_Ovf	102.97	103.57	103.32	-
	MH-6002A	102.28	104.88	102.28	2.60
	MH-6003A	102.06	104.88	102.06	2.82
	MH-6004A-East_Pond_Ovf	102.02	104.88	102.20	-
				Min	2.33
				Max	8.71
				Average	6.04

Notes:

(1) Analysis assumes rare event parameters/flows as per DSEL's sanitary design sheets.

(2) Analysis assumes pumping station operating at a maximum capacity of 71.5 L/s.

(3) Emergency sanitary overflows that discharge to the SWM ponds are assumed to be flapped.

(4) Assumed emergency sanitary overflows (above the 25-year water level in the SWM ponds):
West: Existing emergency overflow to Davidson SWM Pond; 900 x 500mm sharp crested weir in SANMH97, invert elevation = 103.05m (modified weir dimensions and invert).
East: Proposed emergency overflow to East SWM Pond; Reversed 375mm dia. sanitary pipe between MH-207A and MH-6002A, invert elevation = 102.344m.

(5) Assumed 100-year water level in the SWM Ponds:
Davidson SWM Pond = 103.32m
East SWM Pond: 102.20m

(6) Model Name: STIT-SAN-MSS-Rare_v02.0.inp.

DRAFT

Table E-2: Caivan Stittsville Lands - MSS
Preliminary Sanitary HGL Analysis
Annual Flows
(Pumping Station Failure)

Location	MH-ID	Invert Elevation (m)	Top of MH (m)	Max HGL (m)	Top of MH Freeboard (m)
Trunk 1 West Development	MH-126A	101.11	106.01	103.59	2.42
	MH-127A	100.90	106.16	103.59	2.57
	MH-141A	100.82	106.17	103.58	2.59
	MH-142A	100.68	106.29	103.57	2.72
	MH-143A	100.54	106.41	103.56	2.85
	MH-152A	100.30	106.63	103.54	3.09
	MH-175A	100.17	106.74	103.52	3.22
	MH-180A	100.05	106.85	103.50	3.35
	MH-183A	99.92	107.60	103.46	4.14
	MH-186A	99.75	108.64	103.43	5.21
	MH-187A	99.49	107.82	103.40	4.42
	MH-188A	99.34	107.69	103.38	4.31
	MH-190A	99.18	107.54	103.37	4.17
	MH-191A	99.06	107.46	103.35	4.11
	MH-192A	99.01	107.45	103.35	4.10
	MH-193A	98.93	107.45	103.34	4.11
	MH-194A	98.85	107.45	103.34	4.11
	MH-195A	98.76	107.45	103.34	4.12
	MH-196A	98.66	105.74	103.33	2.41
Trunk 2 East Development	MH-203A	101.51	104.96	102.68	2.28
	MH-207A	101.81	104.88	102.48	2.40
	MH-208A	101.71	104.86	102.53	2.33
	MH-221A	101.13	105.15	102.95	2.20
	MH-223A	100.65	105.24	103.28	1.96
	MH-224A	100.46	105.35	103.32	2.04
	MH-240A	100.37	105.38	103.32	2.06
	MH-241A	100.15	105.57	103.33	2.24
	MH-260A	99.93	105.77	103.33	2.44
	MH-261A	99.87	105.80	103.33	2.47
	MH-262A	99.62	106.52	103.33	3.19
	MH-264A	99.48	106.60	103.33	3.27
	MH-265A	99.33	105.95	103.33	2.62
	MH-274A	99.15	105.82	103.33	2.49
	MH-275A	99.03	105.74	103.32	2.42
	MH-279A	98.98	105.74	103.33	2.41
	MH-280A	98.90	105.74	103.32	2.42
	MH-281A	98.72	105.74	103.32	2.42

DRAFT

Table E-2: Caivan Stittsville Lands - MSS
Preliminary Sanitary HGL Analysis
Annual Flows
(Pumping Station Failure)

Location	MH-ID	Invert Elevation (m)	Top of MH (m)	Max HGL (m)	Top of MH Freeboard (m)
	MH-282A_PS	98.60	105.74	103.33	2.41
	SANMH97	103.01	105.34	103.32	2.02
	Davidson_Pond_Ovf	102.97	103.57	103.32	-
	MH-6002A	102.28	104.88	102.40	2.48
	MH-6003A	102.06	104.88	102.20	2.68
	MH-6004A-East_Pond_Ovf	102.02	104.88	102.20	-
				Min	1.96
				Max	5.21
				Average	2.96

Notes:

(1) Analysis assumes annual event parameters/flows as per DSEL's sanitary design sheets.

(2) Analysis assumes complete pumping station failure (0 L/s).

(3) Emergency sanitary overflows that discharge to the SWM ponds are assumed to be flapped.

(4) Assumed emergency sanitary overflows (above the 25-year water level in the SWM ponds):
West: Existing emergency overflow to Davidson SWM Pond; 900 x 500mm sharp crested weir in SANMH97, invert elevation = 103.05m (modified weir dimensions and invert).
East: Proposed emergency overflow to East SWM Pond; Reversed 375mm dia. sanitary pipe between MH-207A and MH-6002A, invert elevation = 102.344m.

(5) Assumed 100-year water level in the SWM Ponds:
Davidson SWM Pond = 103.32m
East SWM Pond: 102.20m

(6) Model Name: STIT-SAN-MSS-Annual_v02.0.inp.

DRAFT

J.F. Sabourin and Associates Inc.
52 Springbrook Drive,
Ottawa, ON K2S 1B9
T 613-836-3884 F 613-836-0332

jfsa.com

Attachment F

Existing Davidson SWM Pond Preliminary Analysis

DRAFT

Table F-1: Criteria for Required Storage Volumes

Pond	Area [1] (ha)	Imperviousness (%)	Storage Volume for Impervious Level [2] (m^3/ha)
N/A	N/A	55	190
Davidson Co-Tenancy	44.751	58	197
N/A	N/A	70	225

(1) Includes the additional 4.13 ha to the SWM facility.

(2) Protection Level for Wet Pond: Enhanced 80% long-term S.S. removal.

SWM Planning & Design Manual, Table 3.2, p.3-10 (March 2003).

Table F-2: Required Storage Volumes for SWM Facility

Pond Component	Required Volume (m^3)	Provided Volume [4] (m^3)	Volume Ratio
Permanent Pool (PP) [1]	7026	9054	1.29
Quality Control [2]	1790	1790	1.00
Extended Detention [3]	6688	7058	1.06
Forebay (20% PP)	1405	N/A	N/A
PP - Forebay	5621	N/A	N/A

(1) Required PP volume based on Table B-1 (197 - 40 = 157 m3/ha).

(2) Required quality control volume based on 40 m3/ha.

(3) Required extended detention volume based on the detention of the 25 mm storm for a 72 hour drawdown time.

(4) Provided volume based on stage-storage curve and extended detention

(5) Based on grading plan provided by DSEL.

(6) As per MOE, Maximum Forebay Area: 33% of Total Permanent Pool.

DRAFT

Table F-3: Davidson SWM Pond Level and Storage Summary
(Restrictive Downstream Conditions)

Event	Pond Level (m)	Max Storage Used [1] (m^3)
100yr/24hr Chicago	103.16	23,360
100yr/24hr SCS Type II	103.27	25,440
100yr/12hr SCS Type II	103.32	26,610

[1] Active storage volume only.

DRAFT

```
00001> 20     Metric units / ID Numbers OFF
00002> *$*************************************************************************
00003> *#  SWMHYMO Ver:5.02/Jan 2001 <BETA> / INPUT DATA FILE
00004> *$*************************************************************************
00005> *#  Project Name  : [Stittsville South - Davidson Co-Tenancy]
00006> *#  Project Number: [1123-13]
00007> *#  Date          : 2015/05/06
00008> *#  Modeller      : Laura Pipkins, P.Eng.
00009> *#  Updated       : 2016/08/24 [LP]
00010> *#  Updated       : 2017/02/13 [LP]
00011> *#  Updated       : 2017/03/22 [LP]
00012> *#  Updated       : 2017/09/13 [LP]
00013> *#  Updated       : 2017/09/18 [LP]
00014> *#  Updated       : 2023/07/04 [LP]
00015> *#  Updated       : 2023/07/12 [LP]
00016> *#  Updated       : 2023/09/25 [LP]
00017> *#  Company       : J.F. Sabourin and Associates
00018> *#  License #     : 2582634
00019> *$*************************************************************************
00020> *%  25 mm Storm based on 2-Year, 3-Hour Chicago Storm
00021> START              TZERO=[0.0],  METOUT=[2],  NSTORM=[1],  NRUN=[001]
00022> *%                   ["25MMC3H.stm"] <--storm filename, one per line for NSTORM time
00023> *%-----------------|-------------------------------------------------------|
00024> READ STORM          STORM_FILENAME=["storm.001"]
00025> *%-----------------|-------------------------------------------------------|
00026> DEFAULT VALUES      ICASEdef=[1],  read and print values
00027>                     DEFVAL_FILENAME=["Ottawa.val"]
00028> *%-----------------|-------------------------------------------------------|
00029> *#
00030> *#########################################################################
00031> *# PROPOSED DEVELOPMENT - FREE OUTFALL HYDROGRAPHS
00032> *#########################################################################
00033> *# Minor system hydrograph provided September 2017 by IBI Group
00034> READ HYD            NHYD=["Min"],
00035>                     HYD_FILENAME=["Min"]
00036> *%-----------------|-------------------------------------------------------|
00037> *# Major system hydrograph provided September 2017 by IBI Group
00038> READ HYD            NHYD=["Maj"],
00039>                     HYD_FILENAME=["Maj"]
00040> *%-----------------|-------------------------------------------------------|
00041> *#########################################################################
00042> *# PROPOSED POND BLOCK
00043> *#########################################################################
00044> *# Drainage area characteristics as per base plan provided by DSEL
00045> DESIGN STANDHYD     NHYD=["Pond"], DT=[1](min), AREA=[3.071](ha),
00046>                     XIMP=[0.45], TIMP=[0.45], DWF=[0](cms), LOSS=[1],
00047>                     SLOPE=[0.5](%), RAINFALL=[ , , , , ](mm/hr), END=-1
00048> *%-----------------|-------------------------------------------------------|
00049> *# Proposed Additional Area Requested by DSEL, September 2023
00050> DESIGN STANDHYD     NHYD=["Addl"], DT=[1](min), AREA=[4.13](ha),
00051>                     XIMP=[0.66], TIMP=[0.71], DWF=[0](cms), LOSS=[1],
00052>                     SLOPE=[0.5](%), RAINFALL=[ , , , , ](mm/hr), END=-1
00053> *%-----------------|-------------------------------------------------------|
00054> *#########################################################################
00055> *# TOTAL INFLOWS TO SWM FACILITY
00056> *#########################################################################
00057> ADD HYD             NHYDsum=["Pin"], NHYDs to add=["Min"+"Maj"+"Pond"+"Addl"]
00058> *%-----------------|-------------------------------------------------------|
00059> *#########################################################################
00060> *# SWM FACILITY
00061> *#########################################################################
00062> *# Quality control and permanent pool requirements based on MOE guidelines
00063> *# for enhanced quality control for wet ponds. Extended detention of the 25 mm
00064> *# runoff volume for 72 hours estimated for unknown erosion control requirements.
00065> *# 2-, 5- and 100-year target release rates as per Table 3 of the April 2016
00066> *# "Faulkner Drain Hydrotechnical Update" by Novatech.
00067> *%-----------------|-------------------------------------------------------|
00068> *# Free Outfall Conditions
00069> ROUTE RESERVOIR     NHYDout=["PFout"] ,NHYDin=["Pin"] ,
00070>                     RDT=[1](min),
00071>                         TABLE of ( OUTFLOW-STORAGE ) values
00072>                                  (cms) - (ha-m)
00073>                                [    0 ,  0    ]
00074>                                [ 0.011 ,  0.102 ]
00075>                                [ 0.021 ,  0.206 ]
00076>                                [ 0.029 ,  0.313 ]
00077>                                [ 0.035 ,  0.422 ]
00078>                                [ 0.04 ,  0.534 ]
00079>                                [ 0.045 ,  0.648 ]
00080>                                [ 0.047 ,  0.706 ]
00081>                                [ 0.054 ,  0.824 ]
00082>                                [ 0.059 ,  0.946 ]
00083>                                [ 0.062 ,  1.009 ]
00084>                                [ 0.064 ,  1.074 ]
00085>                                [ 0.074 ,  1.143 ]
00086>                                [ 0.109 ,  1.299 ]
00087>                                [ 0.153 ,  1.474 ]
00088>                                [ 0.201 ,  1.653 ]
00089>                                [ 0.25 ,  1.836 ]
00090>                                [ 0.298 ,  2.024 ]
00091>                                [ 0.343 ,  2.216 ]
00092>                                [ 0.545 ,  2.313 ]
00093>                                [ 0.609 ,  2.512 ]
00094>                                [ 0.666 ,  2.714 ]
00095>                                [ 0.693 ,  2.818 ]
00096>                                [ 0.825 ,  2.922 ]
00097>                                [ 1.318 ,  3.133 ]
00098>                                [ 1.998 ,  3.348 ]
00099>                                [ 3.366 ,  3.568 ]
00100>                                [ 6.429 ,  3.912 ]
00101>                                [   -1 ,  -1     ]  (max twenty pts)
00102>                    NHYDovf=["PFovf"] ,
00103> *%-----------------|-------------------------------------------------------|
00104> *# Restrictive Downstream Conditions (100-Year D/S Water Level = 102.77 m)
00105> ROUTE RESERVOIR     NHYDout=["PRout"] ,NHYDin=["Pin"] ,
00106>                     RDT=[1](min),
00107>                         TABLE of ( OUTFLOW-STORAGE ) values
00108>                                  (cms) - (ha-m)
00109>                                [    0 ,  0    ]
00110>                                 [ 0 ,  1.563 ]
00111>                                [ 0.016 ,  1.653 ]
00112>                                [ 0.05 ,  1.836 ]
00113>                                [ 0.086 ,  2.024 ]
00114>                                [ 0.123 ,  2.216 ]
00115>                                [ 0.14 ,  2.313 ]
00116>                                [ 0.174 ,  2.512 ]
00117>                                [ 0.559 ,  2.714 ]
00118>                                [ 0.582 ,  2.818 ]
00119>                                [ 0.711 ,  2.922 ]
00120>                                [ 1.199 ,  3.133 ]
00121>                                [ 1.873 ,  3.348 ]
00122>                                [ 3.236 ,  3.568 ]
00123>                                [ 6.291 ,  3.912 ]
00124>                                [   -1 ,  -1     ]  (max twenty pts)
00125>                    NHYDovf=["PRovf"] ,
00126> *%-----------------|-------------------------------------------------------|
00127> *# Restrictive Downstream Conditions (100-Year D/S Water Level = 102.77 m)
00128> *# 100% Blockage of Drop Inlet Structure
00129> ROUTE RESERVOIR     NHYDout=["PRBout"] ,NHYDin=["Pin"] ,
00130>                     RDT=[1](min),
00131>                         TABLE of ( OUTFLOW-STORAGE ) values
00132>                                  (cms) - (ha-m)
00133>                                [    0 ,  0    ]
00134>                                [ 0.000 ,  2.818 ]
00135>                                [ 0.106 ,  2.922 ]
00136>                                [ 0.551 ,  3.133 ]
00137>                                [ 1.185 ,  3.348 ]
00138>                                [ 1.963 ,  3.568 ]
00139>                                [ 3.352 ,  3.912 ]
00140>                                [   -1 ,  -1     ]  (max twenty pts)
00141>                    NHYDovf=["PRBovf"] ,
00142> *%-----------------|-------------------------------------------------------|
00143> *#########################################################################
00144> *# SAVE HYDs
00145> *#########################################################################
00146> *# Save Pond Inflow Hydrograph For Use In Preparing Pond Stage-Time Curves
00147> *# For Use in IBI Group's HGL Analysis of the Upstream Subdivision
00148> *#SAVE HYD           NHYD=["Pin"],  # OF PCYCLES=[-1],  ICASEsh=[1]
00149> *#                   HYD_COMMENT=["Pond Inflow"]
00150> *%-----------------|-------------------------------------------------------|
00151> *# Save Pond Outflow Hydrograph For Use In Calculating Average Velocity in the
00152> *# Forebay During the 10-Year Storm
00153> *#SAVE HYD           NHYD=["PFout"],  # OF PCYCLES=[-1],  ICASEsh=[1]
00154> *#                   HYD_COMMENT=["Pond Outfow - Free Outfall Conditions"]
00155> *%-----------------|-------------------------------------------------------|
00156> *# Save Pond Outflow Hydrograph For Use In Preparing Pond Stage-Time Curves
00157> *# For Use in IBI Group's HGL Analysis of the Upstream Subdivision
00158> *#SAVE HYD           NHYD=["PRout"],  # OF PCYCLES=[-1],  ICASEsh=[1]
00159> *#                   HYD_COMMENT=["Pond Outfow - Restrictive D/S Conditions"]
00160> *%-----------------|-------------------------------------------------------|
00161> *#########################################################################
00162> *# CHECK CAPACITIES OF OVERLAND FLOW ROUTE INTO POND AND OUTLET CHANNEL FROM POND
00163> *#########################################################################
00164> *# Overland Flow Route Capacity
00165> ROUTE CHANNEL       NHYDout=["OVL_FR"], NHYDin=["Maj"],  RDT=[1](min),
00166>                     CHLGTH=[10](m),  CHSLOPE=[0.7](%), FPSLOPE=[0.7](%),
00167>                     SECNUM=[1.0],          NSEG=[1]
00168>                     ( SEGROUGH, SEGDIST (m))=[0.03 9.2] NSEG times
00169>                     ( DISTANCE (m), ELEVATION (m))=
00170>                                  [ -15.8 , 105.60 ]
00171>                                  [ -10.8 , 105.45 ]
00172>                                  [  -6.0 , 105.35 ]
00173>                                  [   0.0 , 105.16 ]
00174>                                  [  4.20 , 105.65 ]
00175>                                  [  9.20 , 106.23 ]
00176> *%-----------------|-------------------------------------------------------|
00177> *# Outlet Channel Capacity
00178> ROUTE CHANNEL       NHYDout=["PFchan"], NHYDin=["PFout"],  RDT=[1](min),
00179>                     CHLGTH=[10](m),  CHSLOPE=[0.10](%), FPSLOPE=[0.10](%),
00180>                     SECNUM=[1.0],          NSEG=[3]
00181>                     ( SEGROUGH, SEGDIST (m))= [0.08 -0.25, -0.035 0.25, 0.08 2.80] NSEG times
00182>                     ( DISTANCE (m), ELEVATION (m))=
00183>                                  [ -2.80 , 102.23 ]
00184>                                  [ -0.25 , 101.38 ]
00185>                                  [  0.00 , 101.38 ]
00186>                                  [  0.25 , 101.38 ]
00187>                                  [  2.80 , 102.23 ]
00188> *%-----------------|-------------------------------------------------------|
00189> *#########################################################################
00190> *# STORMS
00191> *#########################################################################
00192> *%  25 mm Storm based on 2-Year, 3-Hour Chicago Storm
00193> *%START              TZERO=[0.0],  METOUT=[2],  NSTORM=[1],  NRUN=[001]
00194> *%                   ["25MMC3H.stm"] <--storm filename, one per line for NSTORM time
00195> *%-----------------|-------------------------------------------------------|
00196> *%  2-Year, 3-Hour Chicago Storm
00197> START              TZERO=[0.0],  METOUT=[2],  NSTORM=[1],  NRUN=[002]
00198> *%                   ["002YC3H.stm"] <--storm filename, one per line for NSTORM time
00199> *%-----------------|-------------------------------------------------------|
00200> *%  5-Year, 3-Hour Chicago Storm
00201> START              TZERO=[0.0],  METOUT=[2],  NSTORM=[1],  NRUN=[005]
00202> *%                   ["005YC3H.stm"] <--storm filename, one per line for NSTORM time
00203> *%-----------------|-------------------------------------------------------|
00204> *%  10-Year, 3-Hour Chicago Storm
00205> *%START              TZERO=[0.0],  METOUT=[2],  NSTORM=[1],  NRUN=[010]
00206> *%                   ["010YC3H.stm"] <--storm filename, one per line for NSTORM time
00207> *%-----------------|-------------------------------------------------------|
00208> *%  25-Year, 3-Hour Chicago Storm
00209> *%START              TZERO=[0.0],  METOUT=[2],  NSTORM=[1],  NRUN=[025]
00210> *%                   ["025YC3H.stm"] <--storm filename, one per line for NSTORM time
00211> *%-----------------|-------------------------------------------------------|
00212> *%  50-Year, 3-Hour Chicago Storm
00213> *%START              TZERO=[0.0],  METOUT=[2],  NSTORM=[1],  NRUN=[050]
00214> *%                   ["050YC3H.stm"] <--storm filename, one per line for NSTORM time
00215> *%-----------------|-------------------------------------------------------|
00216> *%  100-Year, 3-Hour Chicago Storm
00217> START              TZERO=[0.0],  METOUT=[2],  NSTORM=[1],  NRUN=[099]
00218> *%                   ["100YC3H.stm"] <--storm filename, one per line for NSTORM time
00219> *%-----------------|-------------------------------------------------------|
00220> *%  2-Year, 24-Hour SCS Storm
00221> START              TZERO=[0.0],  METOUT=[2],  NSTORM=[1],  NRUN=[102]
00222> *%                   ["SC24002x.stm"] <--storm filename, one per line for NSTORM time
00223> *%-----------------|-------------------------------------------------------|
00224> *%  5-Year, 24-Hour SCS Storm
00225> START              TZERO=[0.0],  METOUT=[2],  NSTORM=[1],  NRUN=[105]
00226> *%                   ["SC24005x.stm"] <--storm filename, one per line for NSTORM time
00227> *%-----------------|-------------------------------------------------------|
00228> *%  10-Year, 24-Hour SCS Storm
00229> *%START              TZERO=[0.0],  METOUT=[2],  NSTORM=[1],  NRUN=[110]
00230> *%                   ["SC24010x.stm"] <--storm filename, one per line for NSTORM time
00231> *%-----------------|-------------------------------------------------------|
00232> *%  25-Year, 24-Hour SCS Storm
00233> *%START              TZERO=[0.0],  METOUT=[2],  NSTORM=[1],  NRUN=[125]
00234> *%                   ["SC24025x.stm"] <--storm filename, one per line for NSTORM time
00235> *%-----------------|-------------------------------------------------------|
00236> *%  50-Year, 24-Hour SCS Storm
00237> *%START              TZERO=[0.0],  METOUT=[2],  NSTORM=[1],  NRUN=[150]
00238> *%                   ["SC24050x.stm"] <--storm filename, one per line for NSTORM time
00239> *%-----------------|-------------------------------------------------------|
00240> *%  100-Year, 24-Hour SCS Storm
00241> START              TZERO=[0.0],  METOUT=[2],  NSTORM=[1],  NRUN=[199]
00242> *%                   ["SC24100x.stm"] <--storm filename, one per line for NSTORM time
00243> *%-----------------|-------------------------------------------------------|
00244> *%  2-Year, 12-Hour SCS Storm (per City of Ottawa Carp River PCSWMM model)
00245> START              TZERO=[0.0],  METOUT=[2],  NSTORM=[1],  NRUN=[202]
00246> *%                   ["SC12002c.stm"] <--storm filename, one per line for NSTORM time
00247> *%-----------------|-------------------------------------------------------|
00248> *%  5-Year, 12-Hour SCS Storm (per City of Ottawa Carp River PCSWMM model)
00249> START              TZERO=[0.0],  METOUT=[2],  NSTORM=[1],  NRUN=[205]
00250> *%                   ["SC12005c.stm"] <--storm filename, one per line for NSTORM time
00251> *%-----------------|-------------------------------------------------------|
00252> *%  10-Year, 12-Hour SCS Storm (per City of Ottawa Carp River PCSWMM model)
00253> START              TZERO=[0.0],  METOUT=[2],  NSTORM=[1],  NRUN=[210]
00254> *%                   ["SC12010c.stm"] <--storm filename, one per line for NSTORM time
00255> *%-----------------|-------------------------------------------------------|
00256> *%  25-Year, 12-Hour SCS Storm (per City of Ottawa Carp River PCSWMM model)
00257> START              TZERO=[0.0],  METOUT=[2],  NSTORM=[1],  NRUN=[225]
00258> *%                   ["SC12025c.stm"] <--storm filename, one per line for NSTORM time
00259> *%-----------------|-------------------------------------------------------|
00260> *%  50-Year, 12-Hour SCS Storm (per City of Ottawa Carp River PCSWMM model)
00261> START              TZERO=[0.0],  METOUT=[2],  NSTORM=[1],  NRUN=[250]
00262> *%                   ["SC12050c.stm"] <--storm filename, one per line for NSTORM time
00263> *%-----------------|-------------------------------------------------------|
00264> *%  100-Year, 12-Hour SCS Storm (per City of Ottawa Carp River PCSWMM model)
00265> START              TZERO=[0.0],  METOUT=[2],  NSTORM=[1],  NRUN=[299]
00266> *%                   ["SC12100c.stm"] <--storm filename, one per line for NSTORM time
00267> *%-----------------|-------------------------------------------------------|
00268> *%  July 1st, 1979 Storm - Ottawa International Airport
00269> START              TZERO=[0.0],  METOUT=[2],  NSTORM=[1],  NRUN=[979]
00270> *%                   ["19790701.stm"] <--storm filename, one per line for NSTORM time
00271> *%-----------------|-------------------------------------------------------|
00272> *%  August 4th, 1988 Storm - Ottawa International Airport
00273> START              TZERO=[0.0],  METOUT=[2],  NSTORM=[1],  NRUN=[988]
00274> *%                   ["19880804.stm"] <--storm filename, one per line for NSTORM time
00275> *%-----------------|-------------------------------------------------------|
00276> *%  August 8th, 1996 Storm - Ottawa International Airport
00277> START              TZERO=[0.0],  METOUT=[2],  NSTORM=[1],  NRUN=[996]
00278> *%                   ["19960808.stm"] <--storm filename, one per line for NSTORM time
00279> *%-----------------|-------------------------------------------------------|
00280> *%  100-Year, 3-Hour Chicago Storm + 20%
00281> START              TZERO=[0.0],  METOUT=[2],  NSTORM=[1],  NRUN=[998]
00282> *%                   ["100YC3H+.stm"] <--storm filename, one per line for NSTORM time
00283> *%-----------------|-------------------------------------------------------|
00284> *%  100-Year, 24-Hour SCS Storm + 20%
00285> START              TZERO=[0.0],  METOUT=[2],  NSTORM=[1],  NRUN=[999]
00286> *%                   ["SC24100x+.stm"] <--storm filename, one per line for NSTORM time
00287> *%-----------------|-------------------------------------------------------|
00288> *%-----------------|-------------------------------------------------------|
00289> FINISH
```

DRAFT

DRAFT

```
===============================================================================================

SSSSS   W   W   M   M   H   H   Y   Y   M   M    OOO          222     000    11   333    =========
S        W W W   MM MM   H   H    Y Y    MM MM   O   O           2    0   0   11     3
SSSSS    W W W   M M M   HHHHH     Y     M M M   O   O           2    0   0   11     3   Ver 5.500
    S     W W    M   M   H   H     Y     M   M   O   O         222    0   0   11   333   OCT 2013
SSSSS     W W    M   M   H   H     Y     M   M    OOO          2      0   0   11     3   =========
                                                               2      0   0   11     3   # 2549237
      StormWater Management HYdrologic Model                   222     000    11   333   =========

*********************************************************************************************
*************************************  SWMHYMO Ver/5.500  **************************************
******************  A single event and continuous hydrologic simulation model  ******************
******************     based on the principles of HYMO and its successors      ******************
******************                 OTTHYMO-83 and OTTHYMO-89.                   ******************
*********************************************************************************************
****************** Distributed by:  J.F. Sabourin and Associates Inc.          ******************
******************                  Ottawa,  Ontario: (613) 836-3884           ******************
******************                  Gatineau, Quebec: (819) 243-6858           ******************
******************                  E-Mail: swmhymo@jfsa.Com                   ******************
*********************************************************************************************

+++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++
+++++++++++++++++ Licensed user: JFSA inc                                      +++++++++++++++++++
+++++++++++++++++                in any City          SERIAL#:2549237          +++++++++++++++++++
+++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++++

*********************************************************************************************
******************            ++++++ PROGRAM ARRAY DIMENSIONS ++++++           ******************
******************            Maximum value for ID numbers  :     11           ******************
******************            Max. number of rainfall points: 105408           ******************
******************            Max. number of flow points    : 105408           ******************
*********************************************************************************************


******************************   S U M M A R Y   O U T P U T   ******************************
*********************************************************************************************
*                 RUN DATE: 2023-09-25     TIME: 23:41:59     RUN COUNTER: 002810              *
*********************************************************************************************
* Input   file: T:\PROJ\1123-13\201709 PDB Subm2\Design\SWMHYMO\202309 Add Area\David_Kf.dat     *
* Output  file: T:\PROJ\1123-13\201709 PDB Subm2\Design\SWMHYMO\202309 Add Area\David_Kf.out     *
* Summary file: T:\PROJ\1123-13\201709 PDB Subm2\Design\SWMHYMO\202309 Add Area\David_Kf.sum     *
* User comments:                                                                               *
* 1:___________________________________________________________________________________________*
* 2:___________________________________________________________________________________________*
* 3:___________________________________________________________________________________________*
*********************************************************************************************


#***************************************************************************
#  SWMHYMO Ver:5.02/Jan 2001 <BETA> / INPUT DATA FILE
#***************************************************************************
#  Project Name  : [Stittsville South - Davidson Co-Tenancy]
#  Project Number: [1123-13]
#  Date          : 2015/05/06
#  Modeller      : Laura Pipkins, P.Eng.
#  Updated       : 2016/08/24 [LP]
#  Updated       : 2017/02/13 [LP]
#  Updated       : 2017/03/22 [LP]
#  Updated       : 2017/09/13 [LP]
#  Updated       : 2017/09/18 [LP]
#  Updated       : 2023/07/04 [LP]
#  Updated       : 2023/07/12 [LP]
#  Updated       : 2023/09/25 [LP]
#  Company       : J.F. Sabourin and Associates
#  License #     : 2582634
#***************************************************************************
 RUN#:COMMAND#
R0001:C00001---------------------------------------------------------------------------------
     START
      [TZERO =    .00 hrs on        0]
      [METOUT=   2    (1=imperial, 2=metric output)]
      [NSTORM=   1 ]
      [NRUN  = 0001 ]
R0001:C00002---------------------------------------------------------------------------------
     READ STORM
      Filename = storm.001
      Comment  = 25 MM BASED ON CHICAGO STORM 2 Year, 3 Hours
      [SDT=10.00:SDUR=   3.00:PTOT=  25.00]
R0001:C00003---------------------------------------------------------------------------------
     DEFAULT VALUES
      Filename = T:\PROJ\1123-13\201709 PDB Subm2\Design\SWMHYMO\202309 Add Area\Ottawa.val
      ICASEdv  = 1 (read and print data)
      FileTitle= File comment: [Parameters for City of Ottawa Projects]
                 THE FOLLOWING PARAMETERS ARE USED IN THE DESIGN STANDHYD COM
      Horton's infiltration equation parameters:
      [Fo= 76.20 mm/hr] [Fc=13.20 mm/hr] [DCAY= 4.14 /hr] [F=  .00 mm]
      Parameters for PERVIOUS surfaces in STANDHYD:
      [IAper=   4.67 mm] [LGP=40.00 m] [MNP= .250]
      Parameters for IMPERVIOUS surfaces in STANDHYD:
      [IAimp=   1.57 mm] [CLI= 1.50]   [MNI= .013]
      Parameters used in NASHYD:
      [Ia=   4.67 mm] [N= 3.00]
      Average monthly Pan Evaporation data in    (mm)
   JAN   FEB   MAR   APR   MAY   JUN   JUL   AUG   SEP   OCT   NOV   DEC
   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00
      Average monthly Potential Evapotranspiration in    (mm)
   JAN   FEB   MAR   APR   MAY   JUN   JUL   AUG   SEP   OCT   NOV   DEC
   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00
#
############################################################################
# PROPOSED DEVELOPMENT - FREE OUTFALL HYDROGRAPHS
############################################################################
# Minor system hydrograph provided September 2017 by IBI Group
R0001:C00004------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    READ HYD            1.0 01:Min            37.55    2.508 No_date    1:09   15.14  n/a     .000
      Filename = T:\PROJ\1123-13\201709 PDB Subm2\Design\SWMHYMO\202309 Add Area\Min
      Comment  = MINOR SYSTEM FLOW FROM DAVIDSON CO-TENANCY (SEPTEMBER 2017,
# Major system hydrograph provided September 2017 by IBI Group
R0001:C00005------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    READ HYD           10.0 01:Maj              .00     .000 No_date    0:00     .00  n/a     .000
      Filename = T:\PROJ\1123-13\201709 PDB Subm2\Design\SWMHYMO\202309 Add Area\Maj
      Comment  = MAJOR SYSTEM FLOW FROM DAVIDSON CO-TENANCY (SEPTEMBER 2017,
############################################################################
# PROPOSED POND BLOCK
############################################################################
# Drainage area characteristics as per base plan provided by DSEL
R0001:C00006------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    DESIGN STANDHYD     1.0 01:Pond            3.07     .197 No_date    1:01   10.93 .437     .000
      [XIMP=.45:TIMP=.45]
      [SLP= .50:DT= 1.00]
      [LOSS= 1 : HORTONS]
# Proposed Additional Area Requested by DSEL, September 2023
R0001:C00007------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    DESIGN STANDHYD     1.0 01:Addl            4.13     .379 No_date    1:01   16.15 .646     .000
      [XIMP=.66:TIMP=.71]
      [SLP= .50:DT= 1.00]
      [LOSS= 1 : HORTONS]
############################################################################
# TOTAL INFLOWS TO SWM FACILITY
############################################################################
R0001:C00008------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ADD HYD             1.0 02:Min            37.55    2.508 No_date    1:09   15.14  n/a     .000
                   +   10.0 02:Maj              .00     .000 No_date    0:00     .00  n/a     .000
                   +    1.0 02:Pond            3.07     .197 No_date    1:01   10.93  n/a     .000
                   +    1.0 02:Addl            4.13     .379 No_date    1:01   16.15  n/a     .000
                SUM=    1.0 01:Pin            44.75    2.841 No_date    1:08   14.94  n/a     .000
############################################################################
# SWM FACILITY
############################################################################
# Quality control and permanent pool requirements based on MOE guidelines
# for enhanced quality control for wet ponds. Extended detention of the 25 mm
# runoff volume for 72 hours estimated for unknown erosion control requirements.
# 2-, 5- and 100-year target release rates as per Table 3 of the April 2016
# "Faulkner Drain Hydrotechnical Update" by Novatech.
# Free Outfall Conditions
R0001:C00009------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ROUTE RESERVOIR ->    1.0 02:Pin          44.75    2.841 No_date    1:08   14.94  n/a     .000
               out <=    1.0 01:PFout         44.75     .043 No_date    4:07   14.94  n/a     .000
          overflow <=    1.0 03:PFovf           .00     .000 No_date    0:00     .00  n/a     .000
     {MxStoUsed=.6063E+00  m3, TotOvfVol=.0000E+00  m3, N-Ovf=    0, TotDurOvf=    0.hrs}
# Restrictive Downstream Conditions (100-Year D/S Water Level = 102.77 m)
R0001:C00010------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ROUTE RESERVOIR ->    1.0 02:Pin          44.75    2.841 No_date    1:08   14.94  n/a     .000
 *             out <=    1.0 01:PRout         44.75     .000 No_date    0:00     .00  n/a     .000
          overflow <=    1.0 03:PRovf           .00     .000 No_date    0:00     .00  n/a     .000
     {MxStoUsed=.6688E+00  m3, TotOvfVol=.0000E+00  m3, N-Ovf=    0, TotDurOvf=    0.hrs}
# Restrictive Downstream Conditions (100-Year D/S Water Level = 102.77 m)
# 100% Blockage of Drop Inlet Structure
R0001:C00011------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ROUTE RESERVOIR ->    1.0 02:Pin          44.75    2.841 No_date    1:08   14.94  n/a     .000
 *             out <=    1.0 01:PRBout        44.75     .000 No_date    0:00     .00  n/a     .000
          overflow <=    1.0 03:PRBovf          .00     .000 No_date    0:00     .00  n/a     .000
     {MxStoUsed=.6688E+00  m3, TotOvfVol=.0000E+00  m3, N-Ovf=    0, TotDurOvf=    0.hrs}
############################################################################
# SAVE HYDs
############################################################################
# Save Pond Inflow Hydrograph For Use In Preparing Pond Stage-Time Curves
# For Use in IBI Group's HGL Analysis of the Upstream Subdivision
#SAVE HYD            NHYD=["Pin"],  # OF PCYCLES=[-1],  ICASEsh=[1]
#                    HYD_COMMENT=["Pond Inflow"]
# Save Pond Outflow Hydrograph For Use In Calculating Average Velocity in the
# Forebay During the 10-Year Storm
#SAVE HYD            NHYD=["PFout"],  # OF PCYCLES=[-1],  ICASEsh=[1]
#                    HYD_COMMENT=["Pond Outfow - Free Outfall Conditions"]
# Save Pond Outflow Hydrograph For Use In Preparing Pond Stage-Time Curves
# For Use in IBI Group's HGL Analysis of the Upstream Subdivision
#SAVE HYD            NHYD=["PRout"],  # OF PCYCLES=[-1],  ICASEsh=[1]
#                    HYD_COMMENT=["Pond Outfow - Restrictive D/S Conditions"]
############################################################################
# CHECK CAPACITIES OF OVERLAND FLOW ROUTE INTO POND AND OUTLET CHANNEL FROM POND
############################################################################
# Overland Flow Route Capacity
R0001:C00012------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ROUTE CHANNEL   ->   10.0 02:Maj            .00     .000 No_date    0:00     .00  n/a     .000
 *   [RDT= 1.00] out<-    1.0 01:OVL_FR         .00     .000 No_date    0:00     .00  n/a     .000
      [L/S/n=   10./ .700/.030]
      {Vmax=  .000:Dmax=  .000}
# Outlet Channel Capacity
R0001:C00013------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ROUTE CHANNEL   ->    1.0 02:PFout        44.75     .043 No_date    4:07   14.94  n/a     .000
 *   [RDT= 1.00] out<-    1.0 01:PFchan       44.75     .043 No_date    4:08   14.94  n/a     .000
      [L/S/n=   10./ .100/.035]
      {Vmax=  .186:Dmax=  .205}
############################################################################
# STORMS
############################################################################
  ** END OF RUN :    1

*********************************************************************************************





 RUN#:COMMAND#
R0002:C00001---------------------------------------------------------------------------------
     START
      [TZERO =    .00 hrs on        0]
      [METOUT=   2    (1=imperial, 2=metric output)]
      [NSTORM=   1 ]
      [NRUN  = 0002 ]
#***************************************************************************
#  SWMHYMO Ver:5.02/Jan 2001 <BETA> / INPUT DATA FILE
#***************************************************************************
#  Project Name  : [Stittsville South - Davidson Co-Tenancy]
#  Project Number: [1123-13]
#  Date          : 2015/05/06
#  Modeller      : Laura Pipkins, P.Eng.
#  Updated       : 2016/08/24 [LP]
#  Updated       : 2017/02/13 [LP]
#  Updated       : 2017/03/22 [LP]
#  Updated       : 2017/09/13 [LP]
#  Updated       : 2017/09/18 [LP]
#  Updated       : 2023/07/04 [LP]
#  Updated       : 2023/07/12 [LP]
#  Updated       : 2023/09/25 [LP]
#  Company       : J.F. Sabourin and Associates
#  License #     : 2582634
#***************************************************************************
R0002:C00002---------------------------------------------------------------------------------
     READ STORM
      Filename = storm.001
      Comment  = CHICAGO STORM 2 Year, 3 Hours
      [SDT=10.00:SDUR=   3.00:PTOT=  31.86]
R0002:C00003---------------------------------------------------------------------------------
     DEFAULT VALUES
      Filename = T:\PROJ\1123-13\201709 PDB Subm2\Design\SWMHYMO\202309 Add Area\Ottawa.val
      ICASEdv  = 1 (read and print data)
      FileTitle= File comment: [Parameters for City of Ottawa Projects]
                 THE FOLLOWING PARAMETERS ARE USED IN THE DESIGN STANDHYD COM
      Horton's infiltration equation parameters:
      [Fo= 76.20 mm/hr] [Fc=13.20 mm/hr] [DCAY= 4.14 /hr] [F=  .00 mm]
      Parameters for PERVIOUS surfaces in STANDHYD:
      [IAper=   4.67 mm] [LGP=40.00 m] [MNP= .250]
      Parameters for IMPERVIOUS surfaces in STANDHYD:
      [IAimp=   1.57 mm] [CLI= 1.50]   [MNI= .013]
      Parameters used in NASHYD:
      [Ia=   4.67 mm] [N= 3.00]
      Average monthly Pan Evaporation data in    (mm)
   JAN   FEB   MAR   APR   MAY   JUN   JUL   AUG   SEP   OCT   NOV   DEC
   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00
      Average monthly Potential Evapotranspiration in    (mm)
   JAN   FEB   MAR   APR   MAY   JUN   JUL   AUG   SEP   OCT   NOV   DEC
   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00
#
############################################################################
# PROPOSED DEVELOPMENT - FREE OUTFALL HYDROGRAPHS
############################################################################
# Minor system hydrograph provided September 2017 by IBI Group
R0002:C00004------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    READ HYD            1.0 01:Min            37.55    3.227 No_date    1:09   18.36  n/a     .000
      Filename = T:\PROJ\1123-13\201709 PDB Subm2\Design\SWMHYMO\202309 Add Area\Min
      Comment  = MINOR SYSTEM FLOW FROM DAVIDSON CO-TENANCY (SEPTEMBER 2017,
# Major system hydrograph provided September 2017 by IBI Group
R0002:C00005------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    READ HYD           10.0 01:Maj              .00     .000 No_date    0:00     .00  n/a     .000
      Filename = T:\PROJ\1123-13\201709 PDB Subm2\Design\SWMHYMO\202309 Add Area\Maj
      Comment  = MAJOR SYSTEM FLOW FROM DAVIDSON CO-TENANCY (SEPTEMBER 2017,
############################################################################
# PROPOSED POND BLOCK
############################################################################
# Drainage area characteristics as per base plan provided by DSEL
R0002:C00006------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    DESIGN STANDHYD     1.0 01:Pond            3.07     .262 No_date    1:00   15.59 .489     .000
      [XIMP=.45:TIMP=.45]
      [SLP= .50:DT= 1.00]
      [LOSS= 1 : HORTONS]
# Proposed Additional Area Requested by DSEL, September 2023
R0002:C00007------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    DESIGN STANDHYD     1.0 01:Addl            4.13     .501 No_date    1:01   21.79 .684     .000
      [XIMP=.66:TIMP=.71]
      [SLP= .50:DT= 1.00]
      [LOSS= 1 : HORTONS]
############################################################################
# TOTAL INFLOWS TO SWM FACILITY
############################################################################
R0002:C00008------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ADD HYD             1.0 02:Min            37.55    3.227 No_date    1:09   18.36  n/a     .000
                   +   10.0 02:Maj              .00     .000 No_date    0:00     .00  n/a     .000
                   +    1.0 02:Pond            3.07     .262 No_date    1:00   15.59  n/a     .000
                   +    1.0 02:Addl            4.13     .501 No_date    1:01   21.79  n/a     .000
                SUM=    1.0 01:Pin            44.75    3.665 No_date    1:08   18.48  n/a     .000
############################################################################
# SWM FACILITY
############################################################################
# Quality control and permanent pool requirements based on MOE guidelines
# for enhanced quality control for wet ponds. Extended detention of the 25 mm
# runoff volume for 72 hours estimated for unknown erosion control requirements.
# 2-, 5- and 100-year target release rates as per Table 3 of the April 2016
# "Faulkner Drain Hydrotechnical Update" by Novatech.
# Free Outfall Conditions
R0002:C00009------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ROUTE RESERVOIR ->    1.0 02:Pin          44.75    3.665 No_date    1:08   18.48  n/a     .000
               out <=    1.0 01:PFout         44.75     .051 No_date    3:29   18.48  n/a     .000
          overflow <=    1.0 03:PFovf           .00     .000 No_date    0:00     .00  n/a     .000
     {MxStoUsed=.7790E+00  m3, TotOvfVol=.0000E+00  m3, N-Ovf=    0, TotDurOvf=    0.hrs}
# Restrictive Downstream Conditions (100-Year D/S Water Level = 102.77 m)
R0002:C00010------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ROUTE RESERVOIR ->    1.0 02:Pin          44.75    3.665 No_date    1:08   18.48  n/a     .000
 *             out <=    1.0 01:PRout         44.75     .000 No_date    0:00     .00  n/a     .000
          overflow <=    1.0 03:PRovf           .00     .000 No_date    0:00     .00  n/a     .000
     {MxStoUsed=.8272E+00  m3, TotOvfVol=.0000E+00  m3, N-Ovf=    0, TotDurOvf=    0.hrs}
# Restrictive Downstream Conditions (100-Year D/S Water Level = 102.77 m)
# 100% Blockage of Drop Inlet Structure
R0002:C00011------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ROUTE RESERVOIR ->    1.0 02:Pin          44.75    3.665 No_date    1:08   18.48  n/a     .000
 *             out <=    1.0 01:PRBout        44.75     .000 No_date    0:00     .00  n/a     .000
          overflow <=    1.0 03:PRBovf          .00     .000 No_date    0:00     .00  n/a     .000
     {MxStoUsed=.8272E+00  m3, TotOvfVol=.0000E+00  m3, N-Ovf=    0, TotDurOvf=    0.hrs}
############################################################################
# SAVE HYDs
############################################################################
# Save Pond Inflow Hydrograph For Use In Preparing Pond Stage-Time Curves
# For Use in IBI Group's HGL Analysis of the Upstream Subdivision
#SAVE HYD            NHYD=["Pin"],  # OF PCYCLES=[-1],  ICASEsh=[1]
#                    HYD_COMMENT=["Pond Inflow"]
# Save Pond Outflow Hydrograph For Use In Calculating Average Velocity in the
# Forebay During the 10-Year Storm
#SAVE HYD            NHYD=["PFout"],  # OF PCYCLES=[-1],  ICASEsh=[1]
#                    HYD_COMMENT=["Pond Outfow - Free Outfall Conditions"]
# Save Pond Outflow Hydrograph For Use In Preparing Pond Stage-Time Curves
# For Use in IBI Group's HGL Analysis of the Upstream Subdivision
#SAVE HYD            NHYD=["PRout"],  # OF PCYCLES=[-1],  ICASEsh=[1]
#                    HYD_COMMENT=["Pond Outfow - Restrictive D/S Conditions"]
############################################################################
# CHECK CAPACITIES OF OVERLAND FLOW ROUTE INTO POND AND OUTLET CHANNEL FROM POND
############################################################################
# Overland Flow Route Capacity
R0002:C00012------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ROUTE CHANNEL   ->   10.0 02:Maj            .00     .000 No_date    0:00     .00  n/a     .000
 *   [RDT= 1.00] out<-    1.0 01:OVL_FR         .00     .000 No_date    0:00     .00  n/a     .000
      [L/S/n=   10./ .700/.030]
      {Vmax=  .000:Dmax=  .000}
# Outlet Channel Capacity
R0002:C00013------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ROUTE CHANNEL   ->    1.0 02:PFout        44.75     .051 No_date    3:29   18.48  n/a     .000
 *   [RDT= 1.00] out<-    1.0 01:PFchan       44.75     .051 No_date    3:31   18.48  n/a     .000
      [L/S/n=   10./ .100/.035]
      {Vmax=  .193:Dmax=  .225}
############################################################################
# STORMS
############################################################################
  ** END OF RUN :    4

*********************************************************************************************
```

DRAFT

```

 RUN#:COMMAND#
R0005:C00001-------------------------------------------------------------------------------------
      START
       [TZERO =    .00 hrs on        0]
       [METOUT=   2    (1=imperial, 2=metric output)]
       [NSTORM=   1 ]
       [NRUN  = 0005 ]
#******************************************************************************
#  SWMHYMO Ver:5.02/Jan 2001 <BETA> / INPUT DATA FILE
#******************************************************************************
#  Project Name  : [Stittsville South - Davidson Co-Tenancy]
#  Project Number: [1123-13]
#  Date          : 2015/05/06
#  Modeller      : Laura Pipkins, P.Eng.
#  Updated       : 2016/08/24 [LP]
#  Updated       : 2017/02/13 [LP]
#  Updated       : 2017/03/22 [LP]
#  Updated       : 2017/09/13 [LP]
#  Updated       : 2017/09/18 [LP]
#  Updated       : 2023/07/04 [LP]
#  Updated       : 2023/07/12 [LP]
#  Updated       : 2023/09/25 [LP]
#  Company       : J.F. Sabourin and Associates
#  License #     : 2582634
#******************************************************************************
R0005:C00002-------------------------------------------------------------------------------------
      READ STORM
       Filename = storm.001
       Comment  = CHICAGO STORM  5 Year, 3 Hours
       [SDT=10.00:SDUR=   3.00:PTOT=  42.51]
R0005:C00003-------------------------------------------------------------------------------------
      DEFAULT VALUES
       Filename = T:\PROJ\1123-13\201709 PDB Subm2\Design\SWMHYMO\202309 Add Area\Ottawa.val
       ICASEdv  = 1 (read and print data)
       FileTitle= File comment: [Parameters for City of Ottawa Projects]
                  THE FOLLOWING PARAMETERS ARE USED IN THE DESIGN STANDHYD COM
       Horton's infiltration equation parameters:
       [Fo= 76.20 mm/hr] [Fc=13.20 mm/hr] [DCAY= 4.14 /hr] [F=  .00 mm]
       Parameters for PERVIOUS surfaces in STANDHYD:
       [IAper=   4.67 mm] [LGP=40.00 m] [MNP= .250]
       Parameters for IMPERVIOUS surfaces in STANDHYD:
       [IAimp=   1.57 mm] [CLI= 1.50]   [MNI= .013]
       Parameters used in NASHYD:
       [Ia=   4.67 mm] [N= 3.00]
       Average monthly Pan Evaporation data in    (mm)
    JAN   FEB   MAR   APR   MAY   JUN   JUL   AUG   SEP   OCT   NOV   DEC
    .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00
       Average monthly Potential Evapotranspiration in    (mm)
    JAN   FEB   MAR   APR   MAY   JUN   JUL   AUG   SEP   OCT   NOV   DEC
    .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00
#
################################################################################
# PROPOSED DEVELOPMENT - FREE OUTFALL HYDROGRAPHS
################################################################################
# Minor system hydrograph provided September 2017 by IBI Group
R0005:C00004------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
     READ HYD              1.0 01:Min           37.55    4.623 No_date    1:10   26.67  n/a     .000
       Filename = T:\PROJ\1123-13\201709 PDB Subm2\Design\SWMHYMO\202309 Add Area\Min
       Comment  = MINOR SYSTEM FLOW FROM DAVIDSON CO-TENANCY (SEPTEMBER 2017,
# Major system hydrograph provided September 2017 by IBI Group
R0005:C00005------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
     READ HYD             10.0 01:Maj             .00     .000 No_date    0:00     .00  n/a     .000
       Filename = T:\PROJ\1123-13\201709 PDB Subm2\Design\SWMHYMO\202309 Add Area\Maj
       Comment  = MAJOR SYSTEM FLOW FROM DAVIDSON CO-TENANCY (SEPTEMBER 2017,
################################################################################
# PROPOSED POND BLOCK
################################################################################
# Drainage area characteristics as per base plan provided by DSEL
R0005:C00006------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
     DESIGN STANDHYD       1.0 01:Pond           3.07     .379 No_date    1:00   23.46 .552     .000
       [XIMP=.45:TIMP=.45]
       [SLP= .50:DT= 1.00]
       [LOSS= 1 : HORTONS]
# Proposed Additional Area Requested by DSEL, September 2023
R0005:C00007------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
     DESIGN STANDHYD       1.0 01:Addl           4.13     .726 No_date    1:01   31.01 .729     .000
       [XIMP=.66:TIMP=.71]
       [SLP= .50:DT= 1.00]
       [LOSS= 1 : HORTONS]
################################################################################
# TOTAL INFLOWS TO SWM FACILITY
################################################################################
R0005:C00008------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
     ADD HYD               1.0 02:Min           37.55    4.623 No_date    1:10   26.67  n/a     .000
                     +    10.0 02:Maj             .00     .000 No_date    0:00     .00  n/a     .000
                     +     1.0 02:Pond           3.07     .379 No_date    1:00   23.46  n/a     .000
                     +     1.0 02:Addl           4.13     .726 No_date    1:01   31.01  n/a     .000
                  SUM=     1.0 01:Pin           44.75    5.215 No_date    1:09   26.85  n/a     .000
################################################################################
# SWM FACILITY
################################################################################
# Quality control and permanent pool requirements based on MOE guidelines
# for enhanced quality control for wet ponds. Extended detention of the 25 mm
# runoff volume for 72 hours estimated for unknown erosion control requirements.
# 2-, 5- and 100-year target release rates as per Table 3 of the April 2016
# "Faulkner Drain Hydrotechnical Update" by Novatech.
# Free Outfall Conditions
R0005:C00009------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
     ROUTE RESERVOIR ->    1.0 02:Pin           44.75    5.215 No_date    1:09   26.85  n/a     .000
                 out <=    1.0 01:PFout         44.75     .073 No_date    3:25   26.85  n/a     .000
            overflow <=    1.0 03:PFovf           .00     .000 No_date    0:00     .00  n/a     .000
      {MxStoUsed=.1139E+01  m3, TotOvfVol=.0000E+00  m3, N-Ovf=    0, TotDurOvf=    0.hrs}
# Restrictive Downstream Conditions (100-Year D/S Water Level = 102.77 m)
R0005:C00010------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
     ROUTE RESERVOIR ->    1.0 02:Pin           44.75    5.215 No_date    1:09   26.85  n/a     .000
 *               out <=    1.0 01:PRout         44.75     .000 No_date    0:00     .00  n/a     .000
            overflow <=    1.0 03:PRovf           .00     .000 No_date    0:00     .00  n/a     .000
      {MxStoUsed=.1202E+01  m3, TotOvfVol=.0000E+00  m3, N-Ovf=    0, TotDurOvf=    0.hrs}
# Restrictive Downstream Conditions (100-Year D/S Water Level = 102.77 m)
# 100% Blockage of Drop Inlet Structure
R0005:C00011------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
     ROUTE RESERVOIR ->    1.0 02:Pin           44.75    5.215 No_date    1:09   26.85  n/a     .000
 *               out <=    1.0 01:PRBout        44.75     .000 No_date    0:00     .00  n/a     .000
            overflow <=    1.0 03:PRBovf          .00     .000 No_date    0:00     .00  n/a     .000
      {MxStoUsed=.1202E+01  m3, TotOvfVol=.0000E+00  m3, N-Ovf=    0, TotDurOvf=    0.hrs}
################################################################################
# SAVE HYDs
################################################################################
# Save Pond Inflow Hydrograph For Use In Preparing Pond Stage-Time Curves
# For Use in IBI Group's HGL Analysis of the Upstream Subdivision
#SAVE HYD             NHYD=["Pin"],  # OF PCYCLES=[-1],  ICASEsh=[1]
#                     HYD_COMMENT=["Pond Inflow"]
# Save Pond Outflow Hydrograph For Use In Calculating Average Velocity in the
# Forebay During the 10-Year Storm
#SAVE HYD             NHYD=["PFout"],  # OF PCYCLES=[-1],  ICASEsh=[1]
#                     HYD_COMMENT=["Pond Outfow - Free Outfall Conditions"]
# Save Pond Outflow Hydrograph For Use In Preparing Pond Stage-Time Curves
# For Use in IBI Group's HGL Analysis of the Upstream Subdivision
#SAVE HYD             NHYD=["PRout"],  # OF PCYCLES=[-1],  ICASEsh=[1]
#                     HYD_COMMENT=["Pond Outfow - Restrictive D/S Conditions"]
################################################################################
# CHECK CAPACITIES OF OVERLAND FLOW ROUTE INTO POND AND OUTLET CHANNEL FROM POND
################################################################################
# Overland Flow Route Capacity
R0005:C00012------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
     ROUTE CHANNEL   ->   10.0 02:Maj             .00     .000 No_date    0:00     .00  n/a     .000
 *   [RDT= 1.00] out<-    1.0 01:OVL_FR          .00     .000 No_date    0:00     .00  n/a     .000
       [L/S/n=   10./ .700/.030]
       {Vmax=  .000:Dmax=  .000}
# Outlet Channel Capacity
R0005:C00013------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
     ROUTE CHANNEL   ->    1.0 02:PFout         44.75     .073 No_date    3:25   26.85  n/a     .000
 *   [RDT= 1.00] out<-    1.0 01:PFchan        44.75     .073 No_date    3:20   26.85  n/a     .000
       [L/S/n=   10./ .100/.035]
       {Vmax=  .206:Dmax=  .271}
################################################################################
# STORMS
################################################################################
   ** END OF RUN :   98

*********************************************************************************************






 RUN#:COMMAND#
R0099:C00001-------------------------------------------------------------------------------------
      START
       [TZERO =    .00 hrs on        0]
       [METOUT=   2    (1=imperial, 2=metric output)]
       [NSTORM=   1 ]
       [NRUN  = 0099 ]
#******************************************************************************
#  SWMHYMO Ver:5.02/Jan 2001 <BETA> / INPUT DATA FILE
#******************************************************************************
#  Project Name  : [Stittsville South - Davidson Co-Tenancy]
#  Project Number: [1123-13]
#  Date          : 2015/05/06
#  Modeller      : Laura Pipkins, P.Eng.
#  Updated       : 2016/08/24 [LP]
#  Updated       : 2017/02/13 [LP]
#  Updated       : 2017/03/22 [LP]
#  Updated       : 2017/09/13 [LP]
#  Updated       : 2017/09/18 [LP]
#  Updated       : 2023/07/04 [LP]
#  Updated       : 2023/07/12 [LP]
#  Updated       : 2023/09/25 [LP]
#  Company       : J.F. Sabourin and Associates
#  License #     : 2582634
#******************************************************************************
R0099:C00002-------------------------------------------------------------------------------------
      READ STORM
       Filename = storm.001
       Comment  = CHICAGO STORM   100 Year, 3 Hours
       [SDT=10.00:SDUR=   3.00:PTOT=  71.66]
R0099:C00003-------------------------------------------------------------------------------------
      DEFAULT VALUES
       Filename = T:\PROJ\1123-13\201709 PDB Subm2\Design\SWMHYMO\202309 Add Area\Ottawa.val
       ICASEdv  = 1 (read and print data)
       FileTitle= File comment: [Parameters for City of Ottawa Projects]
                  THE FOLLOWING PARAMETERS ARE USED IN THE DESIGN STANDHYD COM
       Horton's infiltration equation parameters:
       [Fo= 76.20 mm/hr] [Fc=13.20 mm/hr] [DCAY= 4.14 /hr] [F=  .00 mm]
       Parameters for PERVIOUS surfaces in STANDHYD:
       [IAper=   4.67 mm] [LGP=40.00 m] [MNP= .250]
       Parameters for IMPERVIOUS surfaces in STANDHYD:
       [IAimp=   1.57 mm] [CLI= 1.50]   [MNI= .013]
       Parameters used in NASHYD:
       [Ia=   4.67 mm] [N= 3.00]
       Average monthly Pan Evaporation data in    (mm)
    JAN   FEB   MAR   APR   MAY   JUN   JUL   AUG   SEP   OCT   NOV   DEC
    .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00
       Average monthly Potential Evapotranspiration in    (mm)
    JAN   FEB   MAR   APR   MAY   JUN   JUL   AUG   SEP   OCT   NOV   DEC
    .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00
#
################################################################################
# PROPOSED DEVELOPMENT - FREE OUTFALL HYDROGRAPHS
################################################################################
# Minor system hydrograph provided September 2017 by IBI Group
R0099:C00004------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
     READ HYD              1.0 01:Min           37.55    7.326 No_date    1:14   51.70  n/a     .000
       Filename = T:\PROJ\1123-13\201709 PDB Subm2\Design\SWMHYMO\202309 Add Area\Min
       Comment  = MINOR SYSTEM FLOW FROM DAVIDSON CO-TENANCY (SEPTEMBER 2017,
# Major system hydrograph provided September 2017 by IBI Group
R0099:C00005------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
     READ HYD             10.0 01:Maj             .00     .141 No_date    1:10********  n/a     .000
       Filename = T:\PROJ\1123-13\201709 PDB Subm2\Design\SWMHYMO\202309 Add Area\Maj
       Comment  = MAJOR SYSTEM FLOW FROM DAVIDSON CO-TENANCY (SEPTEMBER 2017,
################################################################################
# PROPOSED POND BLOCK
################################################################################
# Drainage area characteristics as per base plan provided by DSEL
R0099:C00006------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
     DESIGN STANDHYD       1.0 01:Pond           3.07     .793 No_date    1:01   47.88 .668     .000
       [XIMP=.45:TIMP=.45]
       [SLP= .50:DT= 1.00]
       [LOSS= 1 : HORTONS]
# Proposed Additional Area Requested by DSEL, September 2023
R0099:C00007------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
     DESIGN STANDHYD       1.0 01:Addl           4.13    1.403 No_date    1:00   57.75 .806     .000
       [XIMP=.66:TIMP=.71]
       [SLP= .50:DT= 1.00]
       [LOSS= 1 : HORTONS]
################################################################################
# TOTAL INFLOWS TO SWM FACILITY
################################################################################
R0099:C00008------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
     ADD HYD               1.0 02:Min           37.55    7.326 No_date    1:14   51.70  n/a     .000
                     +    10.0 02:Maj             .00     .141 No_date    1:10********  n/a     .000
                     +     1.0 02:Pond           3.07     .793 No_date    1:01   47.88  n/a     .000
                     +     1.0 02:Addl           4.13    1.403 No_date    1:00   57.75  n/a     .000
                  SUM=     1.0 01:Pin           44.75    8.514 No_date    1:10   52.20  n/a     .000
################################################################################
# SWM FACILITY
################################################################################
# Quality control and permanent pool requirements based on MOE guidelines
# for enhanced quality control for wet ponds. Extended detention of the 25 mm
# runoff volume for 72 hours estimated for unknown erosion control requirements.
# 2-, 5- and 100-year target release rates as per Table 3 of the April 2016
# "Faulkner Drain Hydrotechnical Update" by Novatech.
# Free Outfall Conditions
R0099:C00009------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
     ROUTE RESERVOIR ->    1.0 02:Pin           44.75    8.514 No_date    1:10   52.20  n/a     .000
                 out <=    1.0 01:PFout         44.75     .325 No_date    2:38   52.20  n/a     .000
            overflow <=    1.0 03:PFovf           .00     .000 No_date    0:00     .00  n/a     .000
      {MxStoUsed=.2140E+01  m3, TotOvfVol=.0000E+00  m3, N-Ovf=    0, TotDurOvf=    0.hrs}
# Restrictive Downstream Conditions (100-Year D/S Water Level = 102.77 m)
R0099:C00010------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
     ROUTE RESERVOIR ->    1.0 02:Pin           44.75    8.514 No_date    1:10   52.20  n/a     .000
 *               out <=    1.0 01:PRout         44.75     .130 No_date    3:07   17.46  n/a     .000
            overflow <=    1.0 03:PRovf           .00     .000 No_date    0:00     .00  n/a     .000
      {MxStoUsed=.2255E+01  m3, TotOvfVol=.0000E+00  m3, N-Ovf=    0, TotDurOvf=    0.hrs}
# Restrictive Downstream Conditions (100-Year D/S Water Level = 102.77 m)
# 100% Blockage of Drop Inlet Structure
R0099:C00011------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
     ROUTE RESERVOIR ->    1.0 02:Pin           44.75    8.514 No_date    1:10   52.20  n/a     .000
 *               out <=    1.0 01:PRBout        44.75     .000 No_date    0:00     .00  n/a     .000
            overflow <=    1.0 03:PRBovf          .00     .000 No_date    0:00     .00  n/a     .000
      {MxStoUsed=.2336E+01  m3, TotOvfVol=.0000E+00  m3, N-Ovf=    0, TotDurOvf=    0.hrs}
################################################################################
# SAVE HYDs
################################################################################
# Save Pond Inflow Hydrograph For Use In Preparing Pond Stage-Time Curves
# For Use in IBI Group's HGL Analysis of the Upstream Subdivision
#SAVE HYD             NHYD=["Pin"],  # OF PCYCLES=[-1],  ICASEsh=[1]
#                     HYD_COMMENT=["Pond Inflow"]
# Save Pond Outflow Hydrograph For Use In Calculating Average Velocity in the
# Forebay During the 10-Year Storm
#SAVE HYD             NHYD=["PFout"],  # OF PCYCLES=[-1],  ICASEsh=[1]
#                     HYD_COMMENT=["Pond Outfow - Free Outfall Conditions"]
# Save Pond Outflow Hydrograph For Use In Preparing Pond Stage-Time Curves
# For Use in IBI Group's HGL Analysis of the Upstream Subdivision
#SAVE HYD             NHYD=["PRout"],  # OF PCYCLES=[-1],  ICASEsh=[1]
#                     HYD_COMMENT=["Pond Outfow - Restrictive D/S Conditions"]
################################################################################
# CHECK CAPACITIES OF OVERLAND FLOW ROUTE INTO POND AND OUTLET CHANNEL FROM POND
################################################################################
# Overland Flow Route Capacity
R0099:C00012------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
     ROUTE CHANNEL   ->   10.0 02:Maj             .00     .141 No_date    1:10********  n/a     .000
 *   [RDT= 1.00] out<-    1.0 01:OVL_FR          .00     .139 No_date    1:1093928.98  n/a     .000
       [L/S/n=   10./ .700/.030]
       {Vmax=  .437:Dmax=  .125}
# Outlet Channel Capacity
R0099:C00013------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
     ROUTE CHANNEL   ->    1.0 02:PFout         44.75     .325 No_date    2:38   52.20  n/a     .000
 *   [RDT= 1.00] out<-    1.0 01:PFchan        44.75     .325 No_date    2:39   52.20  n/a     .000
       [L/S/n=   10./ .100/.035]
       {Vmax=  .266:Dmax=  .559}
################################################################################
# STORMS
################################################################################
   ** END OF RUN :  101

*********************************************************************************************






 RUN#:COMMAND#
R0102:C00001-------------------------------------------------------------------------------------
      START
       [TZERO =    .00 hrs on        0]
       [METOUT=   2    (1=imperial, 2=metric output)]
       [NSTORM=   1 ]
       [NRUN  = 0102 ]
#******************************************************************************
#  SWMHYMO Ver:5.02/Jan 2001 <BETA> / INPUT DATA FILE
#******************************************************************************
#  Project Name  : [Stittsville South - Davidson Co-Tenancy]
#  Project Number: [1123-13]
#  Date          : 2015/05/06
#  Modeller      : Laura Pipkins, P.Eng.
#  Updated       : 2016/08/24 [LP]
#  Updated       : 2017/02/13 [LP]
#  Updated       : 2017/03/22 [LP]
#  Updated       : 2017/09/13 [LP]
#  Updated       : 2017/09/18 [LP]
#  Updated       : 2023/07/04 [LP]
#  Updated       : 2023/07/12 [LP]
#  Updated       : 2023/09/25 [LP]
#  Company       : J.F. Sabourin and Associates
#  License #     : 2582634
#******************************************************************************
R0102:C00002-------------------------------------------------------------------------------------
      READ STORM
       Filename = storm.001
       Comment  = 2 years SCS Type 2 Storm 24 Hours step 10 min, City of Ottawa
       [SDT=10.00:SDUR=  24.00:PTOT=  48.46]
R0102:C00003-------------------------------------------------------------------------------------
      DEFAULT VALUES
       Filename = T:\PROJ\1123-13\201709 PDB Subm2\Design\SWMHYMO\202309 Add Area\Ottawa.val
       ICASEdv  = 1 (read and print data)
       FileTitle= File comment: [Parameters for City of Ottawa Projects]
                  THE FOLLOWING PARAMETERS ARE USED IN THE DESIGN STANDHYD COM
       Horton's infiltration equation parameters:
       [Fo= 76.20 mm/hr] [Fc=13.20 mm/hr] [DCAY= 4.14 /hr] [F=  .00 mm]
       Parameters for PERVIOUS surfaces in STANDHYD:
       [IAper=   4.67 mm] [LGP=40.00 m] [MNP= .250]
       Parameters for IMPERVIOUS surfaces in STANDHYD:
       [IAimp=   1.57 mm] [CLI= 1.50]   [MNI= .013]
       Parameters used in NASHYD:
       [Ia=   4.67 mm] [N= 3.00]
       Average monthly Pan Evaporation data in    (mm)
    JAN   FEB   MAR   APR   MAY   JUN   JUL   AUG   SEP   OCT   NOV   DEC
    .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00
```

```
      Average monthly Potential Evapotranspiration in    (mm)
    JAN   FEB   MAR   APR   MAY   JUN   JUL   AUG   SEP   OCT   NOV   DEC
    .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00
#
################################################################################
# PROPOSED DEVELOPMENT - FREE OUTFALL HYDROGRAPHS
################################################################################
# Minor system hydrograph provided September 2017 by IBI Group
R0102:C00004------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    READ HYD             1.0 01:Min           37.55    2.924 No_date  11:57   27.82  n/a     .000
      Filename = T:\PROJ\1123-13\201709 PDB Subm2\Design\SWMHYMO\202309 Add Area\Min
      Comment  = MINOR SYSTEM FLOW FROM DAVIDSON CO-TENANCY (SEPTEMBER 2017,
# Major system hydrograph provided September 2017 by IBI Group
R0102:C00005------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    READ HYD            10.0 01:Maj             .00     .000 No_date   0:00     .00  n/a     .000
      Filename = T:\PROJ\1123-13\201709 PDB Subm2\Design\SWMHYMO\202309 Add Area\Maj
      Comment  = MAJOR SYSTEM FLOW FROM DAVIDSON CO-TENANCY (SEPTEMBER 2017,
################################################################################
# PROPOSED POND BLOCK
################################################################################
# Drainage area characteristics as per base plan provided by DSEL
R0102:C00006------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    DESIGN STANDHYD      1.0 01:Pond           3.07     .220 No_date  12:01   25.12 .518     .000
      [XIMP=.45:TIMP=.45]
      [SLP= .50:DT= 1.00]
      [LOSS= 1 : HORTONS]
# Proposed Additional Area Requested by DSEL, September 2023
R0102:C00007------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    DESIGN STANDHYD      1.0 01:Addl           4.13     .430 No_date  12:01   34.35 .709     .000
      [XIMP=.66:TIMP=.71]
      [SLP= .50:DT= 1.00]
      [LOSS= 1 : HORTONS]
################################################################################
# TOTAL INFLOWS TO SWM FACILITY
################################################################################
R0102:C00008------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ADD HYD              1.0 02:Min           37.55    2.924 No_date  11:57   27.82  n/a     .000
                    +   10.0 02:Maj             .00     .000 No_date   0:00     .00  n/a     .000
                    +    1.0 02:Pond           3.07     .220 No_date  12:01   25.12  n/a     .000
                    +    1.0 02:Addl           4.13     .430 No_date  12:01   34.35  n/a     .000
                 SUM=    1.0 01:Pin           44.75    3.509 No_date  11:58   28.24  n/a     .000
################################################################################
# SWM FACILITY
################################################################################
# Quality control and permanent pool requirements based on MOE guidelines
# for enhanced quality control for wet ponds. Extended detention of the 25 mm
# runoff volume for 72 hours estimated for unknown erosion control requirements.
# 2-, 5- and 100-year target release rates as per Table 3 of the April 2016
# "Faulkner Drain Hydrotechnical Update" by Novatech.
# Free Outfall Conditions
R0102:C00009------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ROUTE RESERVOIR ->    1.0 02:Pin           44.75    3.509 No_date  11:58   28.24  n/a     .000
                out <=    1.0 01:PFout         44.75     .061 No_date  17:08   28.23  n/a     .000
           overflow <=    1.0 03:PFovf           .00     .000 No_date   0:00     .00  n/a     .000
     {MxStoUsed=.9922E+00  m3, TotOvfVol=.0000E+00  m3, N-Ovf=    0, TotDurOvf=    0.hrs}
# Restrictive Downstream Conditions (100-Year D/S Water Level = 102.77 m)
R0102:C00010------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ROUTE RESERVOIR ->    1.0 02:Pin           44.75    3.509 No_date  11:58   28.24  n/a     .000
 *              out <=    1.0 01:PRout         44.75     .000 No_date   0:00     .00  n/a     .000
           overflow <=    1.0 03:PRovf           .00     .000 No_date   0:00     .00  n/a     .000
     {MxStoUsed=.1264E+01  m3, TotOvfVol=.0000E+00  m3, N-Ovf=    0, TotDurOvf=    0.hrs}
# Restrictive Downstream Conditions (100-Year D/S Water Level = 102.77 m)
# 100% Blockage of Drop Inlet Structure
R0102:C00011------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ROUTE RESERVOIR ->    1.0 02:Pin           44.75    3.509 No_date  11:58   28.24  n/a     .000
 *              out <=    1.0 01:PRBout        44.75     .000 No_date   0:00     .00  n/a     .000
           overflow <=    1.0 03:PRBovf          .00     .000 No_date   0:00     .00  n/a     .000
     {MxStoUsed=.1264E+01  m3, TotOvfVol=.0000E+00  m3, N-Ovf=    0, TotDurOvf=    0.hrs}
################################################################################
# SAVE HYDs
################################################################################
# Save Pond Inflow Hydrograph For Use In Preparing Pond Stage-Time Curves
# For Use in IBI Group's HGL Analysis of the Upstream Subdivision
#SAVE HYD             NHYD=["Pin"],  # OF PCYCLES=[-1],  ICASEsh=[1]
#                     HYD_COMMENT=["Pond Inflow"]
# Save Pond Outflow Hydrograph For Use In Calculating Average Velocity in the
# Forebay During the 10-Year Storm
#SAVE HYD             NHYD=["PFout"],  # OF PCYCLES=[-1],  ICASEsh=[1]
#                     HYD_COMMENT=["Pond Outfow - Free Outfall Conditions"]
# Save Pond Outflow Hydrograph For Use In Preparing Pond Stage-Time Curves
# For Use in IBI Group's HGL Analysis of the Upstream Subdivision
#SAVE HYD             NHYD=["PRout"],  # OF PCYCLES=[-1],  ICASEsh=[1]
#                     HYD_COMMENT=["Pond Outfow - Restrictive D/S Conditions"]
################################################################################
# CHECK CAPACITIES OF OVERLAND FLOW ROUTE INTO POND AND OUTLET CHANNEL FROM POND
################################################################################
# Overland Flow Route Capacity
R0102:C00012------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ROUTE CHANNEL   ->   10.0 02:Maj             .00     .000 No_date   0:00     .00  n/a     .000
 *   [RDT= 1.00] out<-    1.0 01:OVL_FR          .00     .000 No_date   0:00     .00  n/a     .000
      [L/S/n=   10./ .700/.030]
      {Vmax=  .000:Dmax=  .000}
# Outlet Channel Capacity
R0102:C00013------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ROUTE CHANNEL   ->    1.0 02:PFout         44.75     .061 No_date  17:08   28.23  n/a     .000
 *   [RDT= 1.00] out<-    1.0 01:PFchan        44.75     .061 No_date  17:10   28.23  n/a     .000
      [L/S/n=   10./ .100/.035]
      {Vmax=  .199:Dmax=  .246}
################################################################################
# STORMS
################################################################################
  ** END OF RUN :  104

*****************************************************************************************************





 RUN#:COMMAND#
R0105:C00001----------------------------------------------------------------------------------------
     START
      [TZERO =    .00 hrs on        0]
      [METOUT=   2    (1=imperial, 2=metric output)]
      [NSTORM=   1 ]
      [NRUN  = 0105 ]
#*******************************************************************************
#  SWMHYMO Ver:5.02/Jan 2001 <BETA> / INPUT DATA FILE
#*******************************************************************************
#  Project Name  : [Stittsville South - Davidson Co-Tenancy]
#  Project Number: [1123-13]
#  Date          : 2015/05/06
#  Modeller      : Laura Pipkins, P.Eng.
#  Updated       : 2016/08/24 [LP]
#  Updated       : 2017/02/13 [LP]
#  Updated       : 2017/03/22 [LP]
#  Updated       : 2017/09/13 [LP]
#  Updated       : 2017/09/18 [LP]
#  Updated       : 2023/07/04 [LP]
#  Updated       : 2023/07/12 [LP]
#  Updated       : 2023/09/25 [LP]
#  Company       : J.F. Sabourin and Associates
#  License #     : 2582634
#*******************************************************************************
R0105:C00002----------------------------------------------------------------------------------------
     READ STORM
      Filename = storm.001
      Comment  = 5 years SCS Type 2 Storm 24 Hours step 10 min, City of Ottawa
      [SDT=10.00:SDUR=  24.00:PTOT=  64.11]
R0105:C00003----------------------------------------------------------------------------------------
     DEFAULT VALUES
      Filename = T:\PROJ\1123-13\201709 PDB Subm2\Design\SWMHYMO\202309 Add Area\Ottawa.val
      ICASEdv  = 1 (read and print data)
      FileTitle= File comment: [Parameters for City of Ottawa Projects]
                 THE FOLLOWING PARAMETERS ARE USED IN THE DESIGN STANDHYD COM
      Horton's infiltration equation parameters:
      [Fo= 76.20 mm/hr] [Fc=13.20 mm/hr] [DCAY= 4.14 /hr] [F=  .00 mm]
      Parameters for PERVIOUS surfaces in STANDHYD:
      [IAper=   4.67 mm] [LGP=40.00 m] [MNP= .250]
      Parameters for IMPERVIOUS surfaces in STANDHYD:
      [IAimp=   1.57 mm] [CLI= 1.50]   [MNI= .013]
      Parameters used in NASHYD:
      [Ia=   4.67 mm] [N= 3.00]
      Average monthly Pan Evaporation data in    (mm)
    JAN   FEB   MAR   APR   MAY   JUN   JUL   AUG   SEP   OCT   NOV   DEC
    .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00
      Average monthly Potential Evapotranspiration in    (mm)
    JAN   FEB   MAR   APR   MAY   JUN   JUL   AUG   SEP   OCT   NOV   DEC
    .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00
#
################################################################################
# PROPOSED DEVELOPMENT - FREE OUTFALL HYDROGRAPHS
################################################################################
# Minor system hydrograph provided September 2017 by IBI Group
R0105:C00004------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    READ HYD             1.0 01:Min           37.55    4.413 No_date  11:57   39.85  n/a     .000
      Filename = T:\PROJ\1123-13\201709 PDB Subm2\Design\SWMHYMO\202309 Add Area\Min
      Comment  = MINOR SYSTEM FLOW FROM DAVIDSON CO-TENANCY (SEPTEMBER 2017,
# Major system hydrograph provided September 2017 by IBI Group
R0105:C00005------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    READ HYD            10.0 01:Maj             .00     .000 No_date   0:00     .00  n/a     .000
      Filename = T:\PROJ\1123-13\201709 PDB Subm2\Design\SWMHYMO\202309 Add Area\Maj
      Comment  = MAJOR SYSTEM FLOW FROM DAVIDSON CO-TENANCY (SEPTEMBER 2017,
################################################################################
# PROPOSED POND BLOCK
################################################################################
# Drainage area characteristics as per base plan provided by DSEL
R0105:C00006------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    DESIGN STANDHYD      1.0 01:Pond           3.07     .347 No_date  12:01   36.23 .565     .000
      [XIMP=.45:TIMP=.45]
      [SLP= .50:DT= 1.00]
      [LOSS= 1 : HORTONS]
# Proposed Additional Area Requested by DSEL, September 2023
R0105:C00007------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    DESIGN STANDHYD      1.0 01:Addl           4.13     .615 No_date  12:01   46.90 .732     .000
      [XIMP=.66:TIMP=.71]
      [SLP= .50:DT= 1.00]
      [LOSS= 1 : HORTONS]
################################################################################
# TOTAL INFLOWS TO SWM FACILITY
################################################################################
R0105:C00008------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ADD HYD              1.0 02:Min           37.55    4.413 No_date  11:57   39.85  n/a     .000
                    +   10.0 02:Maj             .00     .000 No_date   0:00     .00  n/a     .000
                    +    1.0 02:Pond           3.07     .347 No_date  12:01   36.23  n/a     .000
                    +    1.0 02:Addl           4.13     .615 No_date  12:01   46.90  n/a     .000
                 SUM=    1.0 01:Pin           44.75    5.267 No_date  11:57   40.25  n/a     .000
################################################################################
# SWM FACILITY
################################################################################
# Quality control and permanent pool requirements based on MOE guidelines
# for enhanced quality control for wet ponds. Extended detention of the 25 mm
# runoff volume for 72 hours estimated for unknown erosion control requirements.
# 2-, 5- and 100-year target release rates as per Table 3 of the April 2016
# "Faulkner Drain Hydrotechnical Update" by Novatech.
# Free Outfall Conditions
R0105:C00009------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ROUTE RESERVOIR ->    1.0 02:Pin           44.75    5.267 No_date  11:57   40.25  n/a     .000
                out <=    1.0 01:PFout         44.75     .127 No_date  16:03   40.25  n/a     .000
           overflow <=    1.0 03:PFovf           .00     .000 No_date   0:00     .00  n/a     .000
     {MxStoUsed=.1371E+01  m3, TotOvfVol=.0000E+00  m3, N-Ovf=    0, TotDurOvf=    0.hrs}
# Restrictive Downstream Conditions (100-Year D/S Water Level = 102.77 m)
R0105:C00010------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ROUTE RESERVOIR ->    1.0 02:Pin           44.75    5.267 No_date  11:57   40.25  n/a     .000
 *              out <=    1.0 01:PRout         44.75     .030 No_date  24:25    5.50  n/a     .000
           overflow <=    1.0 03:PRovf           .00     .000 No_date   0:00     .00  n/a     .000
     {MxStoUsed=.1728E+01  m3, TotOvfVol=.0000E+00  m3, N-Ovf=    0, TotDurOvf=    0.hrs}
# Restrictive Downstream Conditions (100-Year D/S Water Level = 102.77 m)
# 100% Blockage of Drop Inlet Structure
R0105:C00011------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ROUTE RESERVOIR ->    1.0 02:Pin           44.75    5.267 No_date  11:57   40.25  n/a     .000
 *              out <=    1.0 01:PRBout        44.75     .000 No_date   0:00     .00  n/a     .000
           overflow <=    1.0 03:PRBovf          .00     .000 No_date   0:00     .00  n/a     .000
     {MxStoUsed=.1801E+01  m3, TotOvfVol=.0000E+00  m3, N-Ovf=    0, TotDurOvf=    0.hrs}
################################################################################
# SAVE HYDs
################################################################################
# Save Pond Inflow Hydrograph For Use In Preparing Pond Stage-Time Curves
# For Use in IBI Group's HGL Analysis of the Upstream Subdivision
#SAVE HYD             NHYD=["Pin"],  # OF PCYCLES=[-1],  ICASEsh=[1]
#                     HYD_COMMENT=["Pond Inflow"]
# Save Pond Outflow Hydrograph For Use In Calculating Average Velocity in the
# Forebay During the 10-Year Storm
#SAVE HYD             NHYD=["PFout"],  # OF PCYCLES=[-1],  ICASEsh=[1]
#                     HYD_COMMENT=["Pond Outfow - Free Outfall Conditions"]
# Save Pond Outflow Hydrograph For Use In Preparing Pond Stage-Time Curves
# For Use in IBI Group's HGL Analysis of the Upstream Subdivision
#SAVE HYD             NHYD=["PRout"],  # OF PCYCLES=[-1],  ICASEsh=[1]
#                     HYD_COMMENT=["Pond Outfow - Restrictive D/S Conditions"]
################################################################################
# CHECK CAPACITIES OF OVERLAND FLOW ROUTE INTO POND AND OUTLET CHANNEL FROM POND
################################################################################
# Overland Flow Route Capacity
R0105:C00012------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ROUTE CHANNEL   ->   10.0 02:Maj             .00     .000 No_date   0:00     .00  n/a     .000
 *   [RDT= 1.00] out<-    1.0 01:OVL_FR          .00     .000 No_date   0:00     .00  n/a     .000
      [L/S/n=   10./ .700/.030]
      {Vmax=  .000:Dmax=  .000}
# Outlet Channel Capacity
R0105:C00013------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ROUTE CHANNEL   ->    1.0 02:PFout         44.75     .127 No_date  16:03   40.25  n/a     .000
 *   [RDT= 1.00] out<-    1.0 01:PFchan        44.75     .127 No_date  16:04   40.25  n/a     .000
      [L/S/n=   10./ .100/.035]
      {Vmax=  .227:Dmax=  .356}
################################################################################
# STORMS
################################################################################
  ** END OF RUN :  198

*****************************************************************************************************





 RUN#:COMMAND#
R0199:C00001----------------------------------------------------------------------------------------
     START
      [TZERO =    .00 hrs on        0]
      [METOUT=   2    (1=imperial, 2=metric output)]
      [NSTORM=   1 ]
      [NRUN  = 0199 ]
#*******************************************************************************
#  SWMHYMO Ver:5.02/Jan 2001 <BETA> / INPUT DATA FILE
#*******************************************************************************
#  Project Name  : [Stittsville South - Davidson Co-Tenancy]
#  Project Number: [1123-13]
#  Date          : 2015/05/06
#  Modeller      : Laura Pipkins, P.Eng.
#  Updated       : 2016/08/24 [LP]
#  Updated       : 2017/02/13 [LP]
#  Updated       : 2017/03/22 [LP]
#  Updated       : 2017/09/13 [LP]
#  Updated       : 2017/09/18 [LP]
#  Updated       : 2023/07/04 [LP]
#  Updated       : 2023/07/12 [LP]
#  Updated       : 2023/09/25 [LP]
#  Company       : J.F. Sabourin and Associates
#  License #     : 2582634
#*******************************************************************************
R0199:C00002----------------------------------------------------------------------------------------
     READ STORM
      Filename = storm.001
      Comment  = 100 years SCS Type 2 Storm 24 Hours step 10 min, City of Ottawa
      [SDT=10.00:SDUR=  24.00:PTOT= 106.73]
R0199:C00003----------------------------------------------------------------------------------------
     DEFAULT VALUES
      Filename = T:\PROJ\1123-13\201709 PDB Subm2\Design\SWMHYMO\202309 Add Area\Ottawa.val
      ICASEdv  = 1 (read and print data)
      FileTitle= File comment: [Parameters for City of Ottawa Projects]
                 THE FOLLOWING PARAMETERS ARE USED IN THE DESIGN STANDHYD COM
      Horton's infiltration equation parameters:
      [Fo= 76.20 mm/hr] [Fc=13.20 mm/hr] [DCAY= 4.14 /hr] [F=  .00 mm]
      Parameters for PERVIOUS surfaces in STANDHYD:
      [IAper=   4.67 mm] [LGP=40.00 m] [MNP= .250]
      Parameters for IMPERVIOUS surfaces in STANDHYD:
      [IAimp=   1.57 mm] [CLI= 1.50]   [MNI= .013]
      Parameters used in NASHYD:
      [Ia=   4.67 mm] [N= 3.00]
      Average monthly Pan Evaporation data in    (mm)
    JAN   FEB   MAR   APR   MAY   JUN   JUL   AUG   SEP   OCT   NOV   DEC
    .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00
      Average monthly Potential Evapotranspiration in    (mm)
    JAN   FEB   MAR   APR   MAY   JUN   JUL   AUG   SEP   OCT   NOV   DEC
    .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00
#
################################################################################
# PROPOSED DEVELOPMENT - FREE OUTFALL HYDROGRAPHS
################################################################################
# Minor system hydrograph provided September 2017 by IBI Group
R0199:C00004------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    READ HYD             1.0 01:Min           37.55    7.024 No_date  11:58   61.42  n/a     .000
      Filename = T:\PROJ\1123-13\201709 PDB Subm2\Design\SWMHYMO\202309 Add Area\Min
      Comment  = MINOR SYSTEM FLOW FROM DAVIDSON CO-TENANCY (SEPTEMBER 2017,
# Major system hydrograph provided September 2017 by IBI Group
R0199:C00005------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    READ HYD            10.0 01:Maj             .00    1.014 No_date  11:50********  n/a     .000
      Filename = T:\PROJ\1123-13\201709 PDB Subm2\Design\SWMHYMO\202309 Add Area\Maj
      Comment  = MAJOR SYSTEM FLOW FROM DAVIDSON CO-TENANCY (SEPTEMBER 2017,
################################################################################
# PROPOSED POND BLOCK
################################################################################
# Drainage area characteristics as per base plan provided by DSEL
R0199:C00006------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    DESIGN STANDHYD      1.0 01:Pond           3.07     .724 No_date  12:00   66.30 .621     .000
      [XIMP=.45:TIMP=.45]
      [SLP= .50:DT= 1.00]
      [LOSS= 1 : HORTONS]
# Proposed Additional Area Requested by DSEL, September 2023
R0199:C00007------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    DESIGN STANDHYD      1.0 01:Addl           4.13    1.154 No_date  12:00   81.94 .768     .000
      [XIMP=.66:TIMP=.71]
      [SLP= .50:DT= 1.00]
      [LOSS= 1 : HORTONS]
################################################################################
# TOTAL INFLOWS TO SWM FACILITY
################################################################################
R0199:C00008------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ADD HYD              1.0 02:Min           37.55    7.024 No_date  11:58   61.42  n/a     .000
                    +   10.0 02:Maj             .00    1.014 No_date  11:50********  n/a     .000
                    +    1.0 02:Pond           3.07     .724 No_date  12:00   66.30  n/a     .000
                    +    1.0 02:Addl           4.13    1.154 No_date  12:00   81.94  n/a     .000
                 SUM=    1.0 01:Pin           44.75    8.850 No_date  12:00   64.39  n/a     .000
################################################################################
# SWM FACILITY
################################################################################
# Quality control and permanent pool requirements based on MOE guidelines
# for enhanced quality control for wet ponds. Extended detention of the 25 mm
# runoff volume for 72 hours estimated for unknown erosion control requirements.
# 2-, 5- and 100-year target release rates as per Table 3 of the April 2016
```

DRAFT

```
# "Faulkner Drain Hydrotechnical Update" by Novatech.
# Free Outfall Conditions
R0199:C00009------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ROUTE RESERVOIR ->    1.0 02:Pin           44.75    8.850 No_date   12:00   64.39  n/a     .000
                out <=    1.0 01:PFout         44.75     .558 No_date   12:53   64.39  n/a     .000
           overflow <=    1.0 03:PFovf           .00     .000 No_date    0:00     .00  n/a     .000
     {MxStoUsed=.2352E+01  m3, TotOvfVol=.0000E+00  m3, N-Ovf=    0, TotDurOvf=    0.hrs}
# Restrictive Downstream Conditions (100-Year D/S Water Level = 102.77 m)
R0199:C00010------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ROUTE RESERVOIR ->    1.0 02:Pin           44.75    8.850 No_date   12:00   64.39  n/a     .000
 *              out <=    1.0 01:PRout         44.75     .235 No_date   13:18   29.64  n/a     .000
           overflow <=    1.0 03:PRovf           .00     .000 No_date    0:00     .00  n/a     .000
     {MxStoUsed=.2544E+01  m3, TotOvfVol=.0000E+00  m3, N-Ovf=    0, TotDurOvf=    0.hrs}
# Restrictive Downstream Conditions (100-Year D/S Water Level = 102.77 m)
# 100% Blockage of Drop Inlet Structure
R0199:C00011------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ROUTE RESERVOIR ->    1.0 02:Pin           44.75    8.850 No_date   12:00   64.39  n/a     .000
 *              out <=    1.0 01:PRBout        44.75     .029 No_date   24:04    1.81  n/a     .000
           overflow <=    1.0 03:PRBovf          .00     .000 No_date    0:00     .00  n/a     .000
     {MxStoUsed=.2846E+01  m3, TotOvfVol=.0000E+00  m3, N-Ovf=    0, TotDurOvf=    0.hrs}
################################################################################
# SAVE HYDs
################################################################################
# Save Pond Inflow Hydrograph For Use In Preparing Pond Stage-Time Curves
# For Use in IBI Group's HGL Analysis of the Upstream Subdivision
#SAVE HYD            NHYD=["Pin"],  # OF PCYCLES=[-1],  ICASEsh=[1]
#                    HYD_COMMENT=["Pond Inflow"]
# Save Pond Outflow Hydrograph For Use In Calculating Average Velocity in the
# Forebay During the 10-Year Storm
#SAVE HYD            NHYD=["PFout"],  # OF PCYCLES=[-1],  ICASEsh=[1]
#                    HYD_COMMENT=["Pond Outfow - Free Outfall Conditions"]
# Save Pond Outflow Hydrograph For Use In Preparing Pond Stage-Time Curves
# For Use in IBI Group's HGL Analysis of the Upstream Subdivision
#SAVE HYD            NHYD=["PRout"],  # OF PCYCLES=[-1],  ICASEsh=[1]
#                    HYD_COMMENT=["Pond Outfow - Restrictive D/S Conditions"]
################################################################################
# CHECK CAPACITIES OF OVERLAND FLOW ROUTE INTO POND AND OUTLET CHANNEL FROM POND
################################################################################
# Overland Flow Route Capacity
R0199:C00012------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ROUTE CHANNEL   ->   10.0 02:Maj             .00    1.014 No_date   11:50********  n/a     .000
 *   [RDT= 1.00] out<-    1.0 01:OVL_FR          .00     .994 No_date   11:50********  n/a     .000
      [L/S/n=   10./ .700/.030]
      {Vmax=  .688:Dmax=  .266}
# Outlet Channel Capacity
R0199:C00013------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ROUTE CHANNEL   ->    1.0 02:PFout         44.75     .558 No_date   12:53   64.39  n/a     .000
 *   [RDT= 1.00] out<-    1.0 01:PFchan        44.75     .558 No_date   12:55   64.39  n/a     .000
      [L/S/n=   10./ .100/.035]
      {Vmax=  .293:Dmax=  .718}
################################################################################
# STORMS
################################################################################
  ** END OF RUN :  201

****************************************************************************************************






 RUN#:COMMAND#
R0202:C00001----------------------------------------------------------------------------------------
     START
      [TZERO =    .00 hrs on        0]
      [METOUT=   2    (1=imperial, 2=metric output)]
      [NSTORM=   1 ]
      [NRUN  = 0202 ]
#*******************************************************************************
#  SWMHYMO Ver:5.02/Jan 2001 <BETA> / INPUT DATA FILE
#*******************************************************************************
#  Project Name  : [Stittsville South - Davidson Co-Tenancy]
#  Project Number: [1123-13]
#  Date          : 2015/05/06
#  Modeller      : Laura Pipkins, P.Eng.
#  Updated       : 2016/08/24 [LP]
#  Updated       : 2017/02/13 [LP]
#  Updated       : 2017/03/22 [LP]
#  Updated       : 2017/09/13 [LP]
#  Updated       : 2017/09/18 [LP]
#  Updated       : 2023/07/04 [LP]
#  Updated       : 2023/07/12 [LP]
#  Updated       : 2023/09/25 [LP]
#  Company       : J.F. Sabourin and Associates
#  License #     : 2582634
#*******************************************************************************
R0202:C00002----------------------------------------------------------------------------------------
     READ STORM
      Filename = storm.001
      Comment  = 2 years SCS Type 2 Storm 12 Hours step 15 min, as per Carp River Ul
      [SDT=15.00:SDUR=  12.00:PTOT=  43.20]
R0202:C00003----------------------------------------------------------------------------------------
     DEFAULT VALUES
      Filename = T:\PROJ\1123-13\201709 PDB Subm2\Design\SWMHYMO\202309 Add Area\Ottawa.val
      ICASEdv  = 1 (read and print data)
      FileTitle= File comment: [Parameters for City of Ottawa Projects]
                 THE FOLLOWING PARAMETERS ARE USED IN THE DESIGN STANDHYD COM
      Horton's infiltration equation parameters:
      [Fo= 76.20 mm/hr] [Fc=13.20 mm/hr] [DCAY= 4.14 /hr] [F=  .00 mm]
      Parameters for PERVIOUS surfaces in STANDHYD:
      [IAper=   4.67 mm] [LGP=40.00 m] [MNP= .250]
      Parameters for IMPERVIOUS surfaces in STANDHYD:
      [IAimp=   1.57 mm] [CLI= 1.50]   [MNI= .013]
      Parameters used in NASHYD:
      [Ia=   4.67 mm] [N= 3.00]
      Average monthly Pan Evaporation data in    (mm)
   JAN   FEB   MAR   APR   MAY   JUN   JUL   AUG   SEP   OCT   NOV   DEC
   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00
      Average monthly Potential Evapotranspiration in    (mm)
   JAN   FEB   MAR   APR   MAY   JUN   JUL   AUG   SEP   OCT   NOV   DEC
   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00
#
################################################################################
# PROPOSED DEVELOPMENT - FREE OUTFALL HYDROGRAPHS
################################################################################
# Minor system hydrograph provided September 2017 by IBI Group
R0202:C00004------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    READ HYD              1.0 01:Min           37.55    2.778 No_date    5:53   25.64  n/a     .000
      Filename = T:\PROJ\1123-13\201709 PDB Subm2\Design\SWMHYMO\202309 Add Area\Min
      Comment  = MINOR SYSTEM FLOW FROM DAVIDSON CO-TENANCY (SEPTEMBER 2017,
# Major system hydrograph provided September 2017 by IBI Group
R0202:C00005------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    READ HYD             15.0 01:Maj             .00     .000 No_date    0:00     .00  n/a     .000
      Filename = T:\PROJ\1123-13\201709 PDB Subm2\Design\SWMHYMO\202309 Add Area\Maj
      Comment  = MAJOR SYSTEM FLOW FROM DAVIDSON CO-TENANCY (SEPTEMBER 2017,
################################################################################
# PROPOSED POND BLOCK
################################################################################
# Drainage area characteristics as per base plan provided by DSEL
R0202:C00006------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    DESIGN STANDHYD       1.0 01:Pond           3.07     .219 No_date    6:00   22.33 .517     .000
      [XIMP=.45:TIMP=.45]
      [SLP= .50:DT= 1.00]
      [LOSS= 1 : HORTONS]
# Proposed Additional Area Requested by DSEL, September 2023
R0202:C00007------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    DESIGN STANDHYD       1.0 01:Addl           4.13     .422 No_date    6:00   30.35 .703     .000
      [XIMP=.66:TIMP=.71]
      [SLP= .50:DT= 1.00]
      [LOSS= 1 : HORTONS]
################################################################################
# TOTAL INFLOWS TO SWM FACILITY
################################################################################
R0202:C00008------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ADD HYD               1.0 02:Min           37.55    2.778 No_date    5:53   25.64  n/a     .000
                   +     15.0 02:Maj             .00     .000 No_date    0:00     .00  n/a     .000
                   +      1.0 02:Pond           3.07     .219 No_date    6:00   22.33  n/a     .000
                   +      1.0 02:Addl           4.13     .422 No_date    6:00   30.35  n/a     .000
                SUM=      1.0 01:Pin           44.75    3.312 No_date    5:54   25.85  n/a     .000
################################################################################
# SWM FACILITY
################################################################################
# Quality control and permanent pool requirements based on MOE guidelines
# for enhanced quality control for wet ponds. Extended detention of the 25 mm
# runoff volume for 72 hours estimated for unknown erosion control requirements.
# 2-, 5- and 100-year target release rates as per Table 3 of the April 2016
# "Faulkner Drain Hydrotechnical Update" by Novatech.
# Free Outfall Conditions
R0202:C00009------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ROUTE RESERVOIR ->    1.0 02:Pin           44.75    3.312 No_date    5:54   25.85  n/a     .000
                out <=    1.0 01:PFout         44.75     .061 No_date   11:11   25.85  n/a     .000
           overflow <=    1.0 03:PFovf           .00     .000 No_date    0:00     .00  n/a     .000
     {MxStoUsed=.9912E+00  m3, TotOvfVol=.0000E+00  m3, N-Ovf=    0, TotDurOvf=    0.hrs}
# Restrictive Downstream Conditions (100-Year D/S Water Level = 102.77 m)
R0202:C00010------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ROUTE RESERVOIR ->    1.0 02:Pin           44.75    3.312 No_date    5:54   25.85  n/a     .000
 *              out <=    1.0 01:PRout         44.75     .000 No_date    0:00     .00  n/a     .000
           overflow <=    1.0 03:PRovf           .00     .000 No_date    0:00     .00  n/a     .000
     {MxStoUsed=.1157E+01  m3, TotOvfVol=.0000E+00  m3, N-Ovf=    0, TotDurOvf=    0.hrs}
# Restrictive Downstream Conditions (100-Year D/S Water Level = 102.77 m)
# 100% Blockage of Drop Inlet Structure
R0202:C00011------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ROUTE RESERVOIR ->    1.0 02:Pin           44.75    3.312 No_date    5:54   25.85  n/a     .000
 *              out <=    1.0 01:PRBout        44.75     .000 No_date    0:00     .00  n/a     .000
           overflow <=    1.0 03:PRBovf          .00     .000 No_date    0:00     .00  n/a     .000
     {MxStoUsed=.1157E+01  m3, TotOvfVol=.0000E+00  m3, N-Ovf=    0, TotDurOvf=    0.hrs}
################################################################################
# SAVE HYDs
################################################################################
# Save Pond Inflow Hydrograph For Use In Preparing Pond Stage-Time Curves
# For Use in IBI Group's HGL Analysis of the Upstream Subdivision
#SAVE HYD            NHYD=["Pin"],  # OF PCYCLES=[-1],  ICASEsh=[1]
#                    HYD_COMMENT=["Pond Inflow"]
# Save Pond Outflow Hydrograph For Use In Calculating Average Velocity in the
# Forebay During the 10-Year Storm
#SAVE HYD            NHYD=["PFout"],  # OF PCYCLES=[-1],  ICASEsh=[1]
#                    HYD_COMMENT=["Pond Outfow - Free Outfall Conditions"]
# Save Pond Outflow Hydrograph For Use In Preparing Pond Stage-Time Curves
# For Use in IBI Group's HGL Analysis of the Upstream Subdivision
#SAVE HYD            NHYD=["PRout"],  # OF PCYCLES=[-1],  ICASEsh=[1]
#                    HYD_COMMENT=["Pond Outfow - Restrictive D/S Conditions"]
################################################################################
# CHECK CAPACITIES OF OVERLAND FLOW ROUTE INTO POND AND OUTLET CHANNEL FROM POND
################################################################################
# Overland Flow Route Capacity
R0202:C00012------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ROUTE CHANNEL   ->   15.0 02:Maj             .00     .000 No_date    0:00     .00  n/a     .000
 *   [RDT= 1.00] out<-    1.0 01:OVL_FR          .00     .000 No_date    0:00     .00  n/a     .000
      [L/S/n=   10./ .700/.030]
      {Vmax=  .000:Dmax=  .000}
# Outlet Channel Capacity
R0202:C00013------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ROUTE CHANNEL   ->    1.0 02:PFout         44.75     .061 No_date   11:11   25.85  n/a     .000
 *   [RDT= 1.00] out<-    1.0 01:PFchan        44.75     .061 No_date   11:12   25.85  n/a     .000
      [L/S/n=   10./ .100/.035]
      {Vmax=  .199:Dmax=  .246}
################################################################################
# STORMS
################################################################################
  ** END OF RUN :  204

****************************************************************************************************






 RUN#:COMMAND#
R0205:C00001----------------------------------------------------------------------------------------
     START
      [TZERO =    .00 hrs on        0]
      [METOUT=   2    (1=imperial, 2=metric output)]
      [NSTORM=   1 ]
      [NRUN  = 0205 ]
#*******************************************************************************
#  SWMHYMO Ver:5.02/Jan 2001 <BETA> / INPUT DATA FILE
#*******************************************************************************
#  Project Name  : [Stittsville South - Davidson Co-Tenancy]
#  Project Number: [1123-13]
#  Date          : 2015/05/06
#  Modeller      : Laura Pipkins, P.Eng.
#  Updated       : 2016/08/24 [LP]
#  Updated       : 2017/02/13 [LP]
#  Updated       : 2017/03/22 [LP]
#  Updated       : 2017/09/13 [LP]
#  Updated       : 2017/09/18 [LP]
#  Updated       : 2023/07/04 [LP]
#  Updated       : 2023/07/12 [LP]
#  Updated       : 2023/09/25 [LP]
#  Company       : J.F. Sabourin and Associates
#  License #     : 2582634
#*******************************************************************************
R0205:C00002----------------------------------------------------------------------------------------
     READ STORM
      Filename = storm.001
      Comment  = 5 years SCS Type 2 Storm 12 Hours step 15 min, as per Carp River Ul
      [SDT=15.00:SDUR=  12.00:PTOT=  57.60]
R0205:C00003----------------------------------------------------------------------------------------
     DEFAULT VALUES
      Filename = T:\PROJ\1123-13\201709 PDB Subm2\Design\SWMHYMO\202309 Add Area\Ottawa.val
      ICASEdv  = 1 (read and print data)
      FileTitle= File comment: [Parameters for City of Ottawa Projects]
                 THE FOLLOWING PARAMETERS ARE USED IN THE DESIGN STANDHYD COM
      Horton's infiltration equation parameters:
      [Fo= 76.20 mm/hr] [Fc=13.20 mm/hr] [DCAY= 4.14 /hr] [F=  .00 mm]
      Parameters for PERVIOUS surfaces in STANDHYD:
      [IAper=   4.67 mm] [LGP=40.00 m] [MNP= .250]
      Parameters for IMPERVIOUS surfaces in STANDHYD:
      [IAimp=   1.57 mm] [CLI= 1.50]   [MNI= .013]
      Parameters used in NASHYD:
      [Ia=   4.67 mm] [N= 3.00]
      Average monthly Pan Evaporation data in    (mm)
   JAN   FEB   MAR   APR   MAY   JUN   JUL   AUG   SEP   OCT   NOV   DEC
   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00
      Average monthly Potential Evapotranspiration in    (mm)
   JAN   FEB   MAR   APR   MAY   JUN   JUL   AUG   SEP   OCT   NOV   DEC
   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00
#
################################################################################
# PROPOSED DEVELOPMENT - FREE OUTFALL HYDROGRAPHS
################################################################################
# Minor system hydrograph provided September 2017 by IBI Group
R0205:C00004------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    READ HYD              1.0 01:Min           37.55    3.994 No_date    5:53   36.67  n/a     .000
      Filename = T:\PROJ\1123-13\201709 PDB Subm2\Design\SWMHYMO\202309 Add Area\Min
      Comment  = MINOR SYSTEM FLOW FROM DAVIDSON CO-TENANCY (SEPTEMBER 2017,
# Major system hydrograph provided September 2017 by IBI Group
R0205:C00005------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    READ HYD             15.0 01:Maj             .00     .000 No_date    0:00     .00  n/a     .000
      Filename = T:\PROJ\1123-13\201709 PDB Subm2\Design\SWMHYMO\202309 Add Area\Maj
      Comment  = MAJOR SYSTEM FLOW FROM DAVIDSON CO-TENANCY (SEPTEMBER 2017,
################################################################################
# PROPOSED POND BLOCK
################################################################################
# Drainage area characteristics as per base plan provided by DSEL
R0205:C00006------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    DESIGN STANDHYD       1.0 01:Pond           3.07     .333 No_date    6:00   32.70 .568     .000
      [XIMP=.45:TIMP=.45]
      [SLP= .50:DT= 1.00]
      [LOSS= 1 : HORTONS]
# Proposed Additional Area Requested by DSEL, September 2023
R0205:C00007------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    DESIGN STANDHYD       1.0 01:Addl           4.13     .612 No_date    6:00   42.33 .735     .000
      [XIMP=.66:TIMP=.71]
      [SLP= .50:DT= 1.00]
      [LOSS= 1 : HORTONS]
################################################################################
# TOTAL INFLOWS TO SWM FACILITY
################################################################################
R0205:C00008------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ADD HYD               1.0 02:Min           37.55    3.994 No_date    5:53   36.67  n/a     .000
                   +     15.0 02:Maj             .00     .000 No_date    0:00     .00  n/a     .000
                   +      1.0 02:Pond           3.07     .333 No_date    6:00   32.70  n/a     .000
                   +      1.0 02:Addl           4.13     .612 No_date    6:00   42.33  n/a     .000
                SUM=      1.0 01:Pin           44.75    4.768 No_date    5:54   36.92  n/a     .000
################################################################################
# SWM FACILITY
################################################################################
# Quality control and permanent pool requirements based on MOE guidelines
# for enhanced quality control for wet ponds. Extended detention of the 25 mm
# runoff volume for 72 hours estimated for unknown erosion control requirements.
# 2-, 5- and 100-year target release rates as per Table 3 of the April 2016
# "Faulkner Drain Hydrotechnical Update" by Novatech.
# Free Outfall Conditions
R0205:C00009------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ROUTE RESERVOIR ->    1.0 02:Pin           44.75    4.768 No_date    5:54   36.92  n/a     .000
                out <=    1.0 01:PFout         44.75     .128 No_date   10:05   36.92  n/a     .000
           overflow <=    1.0 03:PFovf           .00     .000 No_date    0:00     .00  n/a     .000
     {MxStoUsed=.1376E+01  m3, TotOvfVol=.0000E+00  m3, N-Ovf=    0, TotDurOvf=    0.hrs}
# Restrictive Downstream Conditions (100-Year D/S Water Level = 102.77 m)
R0205:C00010------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ROUTE RESERVOIR ->    1.0 02:Pin           44.75    4.768 No_date    5:54   36.92  n/a     .000
 *              out <=    1.0 01:PRout         44.75     .013 No_date   13:32    2.18  n/a     .000
           overflow <=    1.0 03:PRovf           .00     .000 No_date    0:00     .00  n/a     .000
     {MxStoUsed=.1635E+01  m3, TotOvfVol=.0000E+00  m3, N-Ovf=    0, TotDurOvf=    0.hrs}
# Restrictive Downstream Conditions (100-Year D/S Water Level = 102.77 m)
# 100% Blockage of Drop Inlet Structure
R0205:C00011------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ROUTE RESERVOIR ->    1.0 02:Pin           44.75    4.768 No_date    5:54   36.92  n/a     .000
 *              out <=    1.0 01:PRBout        44.75     .000 No_date    0:00     .00  n/a     .000
           overflow <=    1.0 03:PRBovf          .00     .000 No_date    0:00     .00  n/a     .000
     {MxStoUsed=.1652E+01  m3, TotOvfVol=.0000E+00  m3, N-Ovf=    0, TotDurOvf=    0.hrs}
################################################################################
# SAVE HYDs
################################################################################
# Save Pond Inflow Hydrograph For Use In Preparing Pond Stage-Time Curves
# For Use in IBI Group's HGL Analysis of the Upstream Subdivision
#SAVE HYD            NHYD=["Pin"],  # OF PCYCLES=[-1],  ICASEsh=[1]
#                    HYD_COMMENT=["Pond Inflow"]
# Save Pond Outflow Hydrograph For Use In Calculating Average Velocity in the
# Forebay During the 10-Year Storm
#SAVE HYD            NHYD=["PFout"],  # OF PCYCLES=[-1],  ICASEsh=[1]
#                    HYD_COMMENT=["Pond Outfow - Free Outfall Conditions"]
# Save Pond Outflow Hydrograph For Use In Preparing Pond Stage-Time Curves
# For Use in IBI Group's HGL Analysis of the Upstream Subdivision
#SAVE HYD            NHYD=["PRout"],  # OF PCYCLES=[-1],  ICASEsh=[1]
#                    HYD_COMMENT=["Pond Outfow - Restrictive D/S Conditions"]
################################################################################
# CHECK CAPACITIES OF OVERLAND FLOW ROUTE INTO POND AND OUTLET CHANNEL FROM POND
################################################################################
# Overland Flow Route Capacity
R0205:C00012------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ROUTE CHANNEL   ->   15.0 02:Maj             .00     .000 No_date    0:00     .00  n/a     .000
 *   [RDT= 1.00] out<-    1.0 01:OVL_FR          .00     .000 No_date    0:00     .00  n/a     .000
      [L/S/n=   10./ .700/.030]
      {Vmax=  .000:Dmax=  .000}
# Outlet Channel Capacity
R0205:C00013------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ROUTE CHANNEL   ->    1.0 02:PFout         44.75     .128 No_date   10:05   36.92  n/a     .000
 *   [RDT= 1.00] out<-    1.0 01:PFchan        44.75     .128 No_date   10:07   36.92  n/a     .000
```

DRAFT

```
      [L/S/n=   10./ .100/.035]
      {Vmax=  .227:Dmax=  .358}
##########################################################################
# STORMS
##########################################################################
  ** END OF RUN :  209

*******************************************************************************************





 RUN#:COMMAND#
R0210:C00001-------------------------------------------------------------------------------------
     START
      [TZERO =    .00 hrs on        0]
      [METOUT=   2    (1=imperial, 2=metric output)]
      [NSTORM=   1 ]
      [NRUN  = 0210 ]
#*************************************************************************
#  SWMHYMO Ver:5.02/Jan 2001 <BETA> / INPUT DATA FILE
#*************************************************************************
#  Project Name  : [Stittsville South - Davidson Co-Tenancy]
#  Project Number: [1123-13]
#  Date          : 2015/05/06
#  Modeller      : Laura Pipkins, P.Eng.
#  Updated       : 2016/08/24 [LP]
#  Updated       : 2017/02/13 [LP]
#  Updated       : 2017/03/22 [LP]
#  Updated       : 2017/09/13 [LP]
#  Updated       : 2017/09/18 [LP]
#  Updated       : 2023/07/04 [LP]
#  Updated       : 2023/07/12 [LP]
#  Updated       : 2023/09/25 [LP]
#  Company       : J.F. Sabourin and Associates
#  License #     : 2582634
#*************************************************************************
R0210:C00002-------------------------------------------------------------------------------------
     READ STORM
      Filename = storm.001
      Comment  = 10 years SCS Type 2 Storm 12 Hours step 15 min, as per Carp River U
      [SDT=15.00:SDUR=  12.00:PTOT=  67.20]
R0210:C00003-------------------------------------------------------------------------------------
     DEFAULT VALUES
      Filename = T:\PROJ\1123-13\201709 PDB Subm2\Design\SWMHYMO\202309 Add Area\Ottawa.val
      ICASEdv  = 1 (read and print data)
      FileTitle= File comment: [Parameters for City of Ottawa Projects]
                 THE FOLLOWING PARAMETERS ARE USED IN THE DESIGN STANDHYD COM
      Horton's infiltration equation parameters:
      [Fo= 76.20 mm/hr] [Fc=13.20 mm/hr] [DCAY= 4.14 /hr] [F=  .00 mm]
      Parameters for PERVIOUS surfaces in STANDHYD:
      [IAper=   4.67 mm] [LGP=40.00 m] [MNP= .250]
      Parameters for IMPERVIOUS surfaces in STANDHYD:
      [IAimp=   1.57 mm] [CLI= 1.50]   [MNI= .013]
      Parameters used in NASHYD:
      [Ia=   4.67 mm] [N= 3.00]
      Average monthly Pan Evaporation data in    (mm)
   JAN   FEB   MAR   APR   MAY   JUN   JUL   AUG   SEP   OCT   NOV   DEC
   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00
      Average monthly Potential Evapotranspiration in    (mm)
   JAN   FEB   MAR   APR   MAY   JUN   JUL   AUG   SEP   OCT   NOV   DEC
   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00
#
##########################################################################
# PROPOSED DEVELOPMENT - FREE OUTFALL HYDROGRAPHS
##########################################################################
# Minor system hydrograph provided September 2017 by IBI Group
R0210:C00004------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    READ HYD              1.0 01:Min           37.55    4.990 No_date    5:52   43.60  n/a     .000
      Filename = T:\PROJ\1123-13\201709 PDB Subm2\Design\SWMHYMO\202309 Add Area\Min
      Comment  = MINOR SYSTEM FLOW FROM DAVIDSON CO-TENANCY (SEPTEMBER 2017,
# Major system hydrograph provided September 2017 by IBI Group
R0210:C00005------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    READ HYD             15.0 01:Maj             .00     .000 No_date    0:00     .00  n/a     .000
      Filename = T:\PROJ\1123-13\201709 PDB Subm2\Design\SWMHYMO\202309 Add Area\Maj
      Comment  = MAJOR SYSTEM FLOW FROM DAVIDSON CO-TENANCY (SEPTEMBER 2017,
##########################################################################
# PROPOSED POND BLOCK
##########################################################################
# Drainage area characteristics as per base plan provided by DSEL
R0210:C00006------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    DESIGN STANDHYD       1.0 01:Pond           3.07     .429 No_date    6:01   39.54 .588     .000
      [XIMP=.45:TIMP=.45]
      [SLP= .50:DT= 1.00]
      [LOSS= 1 : HORTONS]
# Proposed Additional Area Requested by DSEL, September 2023
R0210:C00007------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    DESIGN STANDHYD       1.0 01:Addl           4.13     .756 No_date    6:00   50.51 .752     .000
      [XIMP=.66:TIMP=.71]
      [SLP= .50:DT= 1.00]
      [LOSS= 1 : HORTONS]
##########################################################################
# TOTAL INFLOWS TO SWM FACILITY
##########################################################################
R0210:C00008------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ADD HYD               1.0 02:Min           37.55    4.990 No_date    5:52   43.60  n/a     .000
                     +   15.0 02:Maj             .00     .000 No_date    0:00     .00  n/a     .000
                     +    1.0 02:Pond           3.07     .429 No_date    6:01   39.54  n/a     .000
                     +    1.0 02:Addl           4.13     .756 No_date    6:00   50.51  n/a     .000
                  SUM=    1.0 01:Pin           44.75    5.938 No_date    5:54   43.96  n/a     .000
##########################################################################
# SWM FACILITY
##########################################################################
# Quality control and permanent pool requirements based on MOE guidelines
# for enhanced quality control for wet ponds. Extended detention of the 25 mm
# runoff volume for 72 hours estimated for unknown erosion control requirements.
# 2-, 5- and 100-year target release rates as per Table 3 of the April 2016
# "Faulkner Drain Hydrotechnical Update" by Novatech.
# Free Outfall Conditions
R0210:C00009------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ROUTE RESERVOIR ->    1.0 02:Pin           44.75    5.938 No_date    5:54   43.96  n/a     .000
                out <=    1.0 01:PFout         44.75     .193 No_date    8:17   43.96  n/a     .000
           overflow <=    1.0 03:PFovf           .00     .000 No_date    0:00     .00  n/a     .000
      {MxStoUsed=.1624E+01  m3, TotOvfVol=.0000E+00  m3, N-Ovf=    0, TotDurOvf=    0.hrs}
# Restrictive Downstream Conditions (100-Year D/S Water Level = 102.77 m)
R0210:C00010------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ROUTE RESERVOIR ->    1.0 02:Pin           44.75    5.938 No_date    5:54   43.96  n/a     .000
 *              out <=    1.0 01:PRout         44.75     .055 No_date   12:09    9.21  n/a     .000
           overflow <=    1.0 03:PRovf           .00     .000 No_date    0:00     .00  n/a     .000
      {MxStoUsed=.1865E+01  m3, TotOvfVol=.0000E+00  m3, N-Ovf=    0, TotDurOvf=    0.hrs}
# Restrictive Downstream Conditions (100-Year D/S Water Level = 102.77 m)
# 100% Blockage of Drop Inlet Structure
R0210:C00011------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ROUTE RESERVOIR ->    1.0 02:Pin           44.75    5.938 No_date    5:54   43.96  n/a     .000
 *              out <=    1.0 01:PRBout        44.75     .000 No_date    0:00     .00  n/a     .000
           overflow <=    1.0 03:PRBovf          .00     .000 No_date    0:00     .00  n/a     .000
      {MxStoUsed=.1967E+01  m3, TotOvfVol=.0000E+00  m3, N-Ovf=    0, TotDurOvf=    0.hrs}
##########################################################################
# SAVE HYDs
##########################################################################
# Save Pond Inflow Hydrograph For Use In Preparing Pond Stage-Time Curves
# For Use in IBI Group's HGL Analysis of the Upstream Subdivision
#SAVE HYD            NHYD=["Pin"],  # OF PCYCLES=[-1],  ICASEsh=[1]
#                    HYD_COMMENT=["Pond Inflow"]
# Save Pond Outflow Hydrograph For Use In Calculating Average Velocity in the
# Forebay During the 10-Year Storm
#SAVE HYD            NHYD=["PFout"],  # OF PCYCLES=[-1],  ICASEsh=[1]
#                    HYD_COMMENT=["Pond Outfow - Free Outfall Conditions"]
# Save Pond Outflow Hydrograph For Use In Preparing Pond Stage-Time Curves
# For Use in IBI Group's HGL Analysis of the Upstream Subdivision
#SAVE HYD            NHYD=["PRout"],  # OF PCYCLES=[-1],  ICASEsh=[1]
#                    HYD_COMMENT=["Pond Outfow - Restrictive D/S Conditions"]
##########################################################################
# CHECK CAPACITIES OF OVERLAND FLOW ROUTE INTO POND AND OUTLET CHANNEL FROM POND
##########################################################################
# Overland Flow Route Capacity
R0210:C00012------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ROUTE CHANNEL   ->   15.0 02:Maj             .00     .000 No_date    0:00     .00  n/a     .000
 *   [RDT= 1.00] out<-    1.0 01:OVL_FR          .00     .000 No_date    0:00     .00  n/a     .000
      [L/S/n=   10./ .700/.030]
      {Vmax=  .000:Dmax=  .000}
# Outlet Channel Capacity
R0210:C00013------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ROUTE CHANNEL   ->    1.0 02:PFout         44.75     .193 No_date    8:17   43.96  n/a     .000
 *   [RDT= 1.00] out<-    1.0 01:PFchan        44.75     .193 No_date    8:18   43.96  n/a     .000
      [L/S/n=   10./ .100/.035]
      {Vmax=  .244:Dmax=  .437}
##########################################################################
# STORMS
##########################################################################
  ** END OF RUN :  224

*******************************************************************************************





 RUN#:COMMAND#
R0225:C00001-------------------------------------------------------------------------------------
     START
      [TZERO =    .00 hrs on        0]
      [METOUT=   2    (1=imperial, 2=metric output)]
      [NSTORM=   1 ]
      [NRUN  = 0225 ]
#*************************************************************************
#  SWMHYMO Ver:5.02/Jan 2001 <BETA> / INPUT DATA FILE
#*************************************************************************
#  Project Name  : [Stittsville South - Davidson Co-Tenancy]
#  Project Number: [1123-13]
#  Date          : 2015/05/06
#  Modeller      : Laura Pipkins, P.Eng.
#  Updated       : 2016/08/24 [LP]
#  Updated       : 2017/02/13 [LP]
#  Updated       : 2017/03/22 [LP]
#  Updated       : 2017/09/13 [LP]
#  Updated       : 2017/09/18 [LP]
#  Updated       : 2023/07/04 [LP]
#  Updated       : 2023/07/12 [LP]
#  Updated       : 2023/09/25 [LP]
#  Company       : J.F. Sabourin and Associates
#  License #     : 2582634
#*************************************************************************
R0225:C00002-------------------------------------------------------------------------------------
     READ STORM
      Filename = storm.001
      Comment  = 25 years SCS Type 2 Storm 12 Hours step 15 min, calculated as per C
      [SDT=15.00:SDUR=  12.00:PTOT=  78.64]
R0225:C00003-------------------------------------------------------------------------------------
     DEFAULT VALUES
      Filename = T:\PROJ\1123-13\201709 PDB Subm2\Design\SWMHYMO\202309 Add Area\Ottawa.val
      ICASEdv  = 1 (read and print data)
      FileTitle= File comment: [Parameters for City of Ottawa Projects]
                 THE FOLLOWING PARAMETERS ARE USED IN THE DESIGN STANDHYD COM
      Horton's infiltration equation parameters:
      [Fo= 76.20 mm/hr] [Fc=13.20 mm/hr] [DCAY= 4.14 /hr] [F=  .00 mm]
      Parameters for PERVIOUS surfaces in STANDHYD:
      [IAper=   4.67 mm] [LGP=40.00 m] [MNP= .250]
      Parameters for IMPERVIOUS surfaces in STANDHYD:
      [IAimp=   1.57 mm] [CLI= 1.50]   [MNI= .013]
      Parameters used in NASHYD:
      [Ia=   4.67 mm] [N= 3.00]
      Average monthly Pan Evaporation data in    (mm)
   JAN   FEB   MAR   APR   MAY   JUN   JUL   AUG   SEP   OCT   NOV   DEC
   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00
      Average monthly Potential Evapotranspiration in    (mm)
   JAN   FEB   MAR   APR   MAY   JUN   JUL   AUG   SEP   OCT   NOV   DEC
   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00
#
##########################################################################
# PROPOSED DEVELOPMENT - FREE OUTFALL HYDROGRAPHS
##########################################################################
# Minor system hydrograph provided September 2017 by IBI Group
R0225:C00004------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    READ HYD              1.0 01:Min           37.55    5.883 No_date    5:53   49.89  n/a     .000
      Filename = T:\PROJ\1123-13\201709 PDB Subm2\Design\SWMHYMO\202309 Add Area\Min
      Comment  = MINOR SYSTEM FLOW FROM DAVIDSON CO-TENANCY (SEPTEMBER 2017,
# Major system hydrograph provided September 2017 by IBI Group
R0225:C00005------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    READ HYD             15.0 01:Maj             .00     .034 No_date    5:4530599.65  n/a     .000
      Filename = T:\PROJ\1123-13\201709 PDB Subm2\Design\SWMHYMO\202309 Add Area\Maj
      Comment  = MAJOR SYSTEM FLOW FROM DAVIDSON CO-TENANCY (SEPTEMBER 2017,
##########################################################################
# PROPOSED POND BLOCK
##########################################################################
# Drainage area characteristics as per base plan provided by DSEL
R0225:C00006------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    DESIGN STANDHYD       1.0 01:Pond           3.07     .558 No_date    6:01   48.27 .614     .000
      [XIMP=.45:TIMP=.45]
      [SLP= .50:DT= 1.00]
      [LOSS= 1 : HORTONS]
# Proposed Additional Area Requested by DSEL, September 2023
R0225:C00007------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    DESIGN STANDHYD       1.0 01:Addl           4.13     .920 No_date    6:00   60.44 .769     .000
      [XIMP=.66:TIMP=.71]
      [SLP= .50:DT= 1.00]
      [LOSS= 1 : HORTONS]
##########################################################################
# TOTAL INFLOWS TO SWM FACILITY
##########################################################################
R0225:C00008------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ADD HYD               1.0 02:Min           37.55    5.883 No_date    5:53   49.89  n/a     .000
                     +   15.0 02:Maj             .00     .034 No_date    5:4530599.65  n/a     .000
                     +    1.0 02:Pond           3.07     .558 No_date    6:01   48.27  n/a     .000
                     +    1.0 02:Addl           4.13     .920 No_date    6:00   60.44  n/a     .000
                  SUM=    1.0 01:Pin           44.75    7.108 No_date    5:55   50.79  n/a     .000
##########################################################################
# SWM FACILITY
##########################################################################
# Quality control and permanent pool requirements based on MOE guidelines
# for enhanced quality control for wet ponds. Extended detention of the 25 mm
# runoff volume for 72 hours estimated for unknown erosion control requirements.
# 2-, 5- and 100-year target release rates as per Table 3 of the April 2016
# "Faulkner Drain Hydrotechnical Update" by Novatech.
# Free Outfall Conditions
R0225:C00009------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ROUTE RESERVOIR ->    1.0 02:Pin           44.75    7.108 No_date    5:55   50.79  n/a     .000
                out <=    1.0 01:PFout         44.75     .273 No_date    7:17   50.79  n/a     .000
           overflow <=    1.0 03:PFovf           .00     .000 No_date    0:00     .00  n/a     .000
      {MxStoUsed=.1925E+01  m3, TotOvfVol=.0000E+00  m3, N-Ovf=    0, TotDurOvf=    0.hrs}
# Restrictive Downstream Conditions (100-Year D/S Water Level = 102.77 m)
R0225:C00010------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ROUTE RESERVOIR ->    1.0 02:Pin           44.75    7.108 No_date    5:55   50.79  n/a     .000
 *              out <=    1.0 01:PRout         44.75     .098 No_date   10:05   16.04  n/a     .000
           overflow <=    1.0 03:PRovf           .00     .000 No_date    0:00     .00  n/a     .000
      {MxStoUsed=.2088E+01  m3, TotOvfVol=.0000E+00  m3, N-Ovf=    0, TotDurOvf=    0.hrs}
# Restrictive Downstream Conditions (100-Year D/S Water Level = 102.77 m)
# 100% Blockage of Drop Inlet Structure
R0225:C00011------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ROUTE RESERVOIR ->    1.0 02:Pin           44.75    7.108 No_date    5:55   50.79  n/a     .000
 *              out <=    1.0 01:PRBout        44.75     .000 No_date    0:00     .00  n/a     .000
           overflow <=    1.0 03:PRBovf          .00     .000 No_date    0:00     .00  n/a     .000
      {MxStoUsed=.2273E+01  m3, TotOvfVol=.0000E+00  m3, N-Ovf=    0, TotDurOvf=    0.hrs}
##########################################################################
# SAVE HYDs
##########################################################################
# Save Pond Inflow Hydrograph For Use In Preparing Pond Stage-Time Curves
# For Use in IBI Group's HGL Analysis of the Upstream Subdivision
#SAVE HYD            NHYD=["Pin"],  # OF PCYCLES=[-1],  ICASEsh=[1]
#                    HYD_COMMENT=["Pond Inflow"]
# Save Pond Outflow Hydrograph For Use In Calculating Average Velocity in the
# Forebay During the 10-Year Storm
#SAVE HYD            NHYD=["PFout"],  # OF PCYCLES=[-1],  ICASEsh=[1]
#                    HYD_COMMENT=["Pond Outfow - Free Outfall Conditions"]
# Save Pond Outflow Hydrograph For Use In Preparing Pond Stage-Time Curves
# For Use in IBI Group's HGL Analysis of the Upstream Subdivision
#SAVE HYD            NHYD=["PRout"],  # OF PCYCLES=[-1],  ICASEsh=[1]
#                    HYD_COMMENT=["Pond Outfow - Restrictive D/S Conditions"]
##########################################################################
# CHECK CAPACITIES OF OVERLAND FLOW ROUTE INTO POND AND OUTLET CHANNEL FROM POND
##########################################################################
# Overland Flow Route Capacity
R0225:C00012------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ROUTE CHANNEL   ->   15.0 02:Maj             .00     .034 No_date    5:4530599.65  n/a     .000
 *   [RDT= 1.00] out<-    1.0 01:OVL_FR          .00     .033 No_date    5:4516319.82  n/a     .000
      [L/S/n=   10./ .700/.030]
      {Vmax=  .305:Dmax=  .073}
# Outlet Channel Capacity
R0225:C00013------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ROUTE CHANNEL   ->    1.0 02:PFout         44.75     .273 No_date    7:17   50.79  n/a     .000
 *   [RDT= 1.00] out<-    1.0 01:PFchan        44.75     .273 No_date    7:18   50.79  n/a     .000
      [L/S/n=   10./ .100/.035]
      {Vmax=  .258:Dmax=  .515}
##########################################################################
# STORMS
##########################################################################
  ** END OF RUN :  249

*******************************************************************************************





 RUN#:COMMAND#
R0250:C00001-------------------------------------------------------------------------------------
     START
      [TZERO =    .00 hrs on        0]
      [METOUT=   2    (1=imperial, 2=metric output)]
      [NSTORM=   1 ]
      [NRUN  = 0250 ]
#*************************************************************************
#  SWMHYMO Ver:5.02/Jan 2001 <BETA> / INPUT DATA FILE
#*************************************************************************
#  Project Name  : [Stittsville South - Davidson Co-Tenancy]
#  Project Number: [1123-13]
#  Date          : 2015/05/06
#  Modeller      : Laura Pipkins, P.Eng.
#  Updated       : 2016/08/24 [LP]
#  Updated       : 2017/02/13 [LP]
#  Updated       : 2017/03/22 [LP]
#  Updated       : 2017/09/13 [LP]
#  Updated       : 2017/09/18 [LP]
#  Updated       : 2023/07/04 [LP]
#  Updated       : 2023/07/12 [LP]
#  Updated       : 2023/09/25 [LP]
#  Company       : J.F. Sabourin and Associates
#  License #     : 2582634
#*************************************************************************
R0250:C00002-------------------------------------------------------------------------------------
     READ STORM
      Filename = storm.001
      Comment  = 50 years SCS Type 2 Storm 12 Hours step 15 min, as per Carp River U
      [SDT=15.00:SDUR=  12.00:PTOT=  87.60]
R0250:C00003-------------------------------------------------------------------------------------
     DEFAULT VALUES
      Filename = T:\PROJ\1123-13\201709 PDB Subm2\Design\SWMHYMO\202309 Add Area\Ottawa.val
      ICASEdv  = 1 (read and print data)
      FileTitle= File comment: [Parameters for City of Ottawa Projects]
```

DRAFT

```
              THE FOLLOWING PARAMETERS ARE USED IN THE DESIGN STANDHYD COM
      Horton's infiltration equation parameters:
      [Fo= 76.20 mm/hr] [Fc=13.20 mm/hr] [DCAY= 4.14 /hr] [F=  .00 mm]
      Parameters for PERVIOUS surfaces in STANDHYD:
      [IAper=   4.67 mm] [LGP=40.00 m] [MNP= .250]
      Parameters for IMPERVIOUS surfaces in STANDHYD:
      [IAimp=   1.57 mm] [CLI= 1.50]   [MNI= .013]
      Parameters used in NASHYD:
      [Ia=   4.67 mm] [N= 3.00]
      Average monthly Pan Evaporation data in    (mm)
   JAN   FEB   MAR   APR   MAY   JUN   JUL   AUG   SEP   OCT   NOV   DEC
   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00
      Average monthly Potential Evapotranspiration in    (mm)
   JAN   FEB   MAR   APR   MAY   JUN   JUL   AUG   SEP   OCT   NOV   DEC
   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00
#
###############################################################################
# PROPOSED DEVELOPMENT - FREE OUTFALL HYDROGRAPHS
###############################################################################
# Minor system hydrograph provided September 2017 by IBI Group
R0250:C00004------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    READ HYD             1.0 01:Min           37.55    6.523 No_date    5:54   56.80  n/a     .000
      Filename = T:\PROJ\1123-13\201709 PDB Subm2\Design\SWMHYMO\202309 Add Area\Min
      Comment  = MINOR SYSTEM FLOW FROM DAVIDSON CO-TENANCY (SEPTEMBER 2017,
# Major system hydrograph provided September 2017 by IBI Group
R0250:C00005------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    READ HYD            15.0 01:Maj             .00     .070 No_date    5:4565699.26  n/a     .000
      Filename = T:\PROJ\1123-13\201709 PDB Subm2\Design\SWMHYMO\202309 Add Area\Maj
      Comment  = MAJOR SYSTEM FLOW FROM DAVIDSON CO-TENANCY (SEPTEMBER 2017,
###############################################################################
# PROPOSED POND BLOCK
###############################################################################
# Drainage area characteristics as per base plan provided by DSEL
R0250:C00006------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    DESIGN STANDHYD      1.0 01:Pond           3.07     .654 No_date    6:01   55.42 .633     .000
      [XIMP=.45:TIMP=.45]
      [SLP= .50:DT= 1.00]
      [LOSS= 1 : HORTONS]
# Proposed Additional Area Requested by DSEL, September 2023
R0250:C00007------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    DESIGN STANDHYD      1.0 01:Addl           4.13    1.058 No_date    6:00   68.58 .783     .000
      [XIMP=.66:TIMP=.71]
      [SLP= .50:DT= 1.00]
      [LOSS= 1 : HORTONS]
###############################################################################
# TOTAL INFLOWS TO SWM FACILITY
###############################################################################
R0250:C00008------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ADD HYD              1.0 02:Min           37.55    6.523 No_date    5:54   56.80  n/a     .000
                    +   15.0 02:Maj             .00     .070 No_date    5:4565699.26  n/a     .000
                    +    1.0 02:Pond           3.07     .654 No_date    6:01   55.42  n/a     .000
                    +    1.0 02:Addl           4.13    1.058 No_date    6:00   68.58  n/a     .000
                 SUM=    1.0 01:Pin           44.75    8.056 No_date    5:58   57.93  n/a     .000
###############################################################################
# SWM FACILITY
###############################################################################
# Quality control and permanent pool requirements based on MOE guidelines
# for enhanced quality control for wet ponds. Extended detention of the 25 mm
# runoff volume for 72 hours estimated for unknown erosion control requirements.
# 2-, 5- and 100-year target release rates as per Table 3 of the April 2016
# "Faulkner Drain Hydrotechnical Update" by Novatech.
# Free Outfall Conditions
R0250:C00009------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ROUTE RESERVOIR ->    1.0 02:Pin          44.75    8.056 No_date    5:58   57.93  n/a     .000
                 out <=    1.0 01:PFout        44.75     .342 No_date    7:08   57.93  n/a     .000
            overflow <=    1.0 03:PFovf          .00     .000 No_date    0:00     .00  n/a     .000
     {MxStoUsed=.2213E+01  m3, TotOvfVol=.0000E+00  m3, N-Ovf=    0, TotDurOvf=    0.hrs}
# Restrictive Downstream Conditions (100-Year D/S Water Level = 102.77 m)
R0250:C00010------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ROUTE RESERVOIR ->    1.0 02:Pin          44.75    8.056 No_date    5:58   57.93  n/a     .000
 *               out <=    1.0 01:PRout        44.75     .148 No_date    8:20   23.18  n/a     .000
            overflow <=    1.0 03:PRovf          .00     .000 No_date    0:00     .00  n/a     .000
     {MxStoUsed=.2361E+01  m3, TotOvfVol=.0000E+00  m3, N-Ovf=    0, TotDurOvf=    0.hrs}
# Restrictive Downstream Conditions (100-Year D/S Water Level = 102.77 m)
# 100% Blockage of Drop Inlet Structure
R0250:C00011------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ROUTE RESERVOIR ->    1.0 02:Pin          44.75    8.056 No_date    5:58   57.93  n/a     .000
 *               out <=    1.0 01:PRBout       44.75     .000 No_date    0:00     .00  n/a     .000
            overflow <=    1.0 03:PRBovf         .00     .000 No_date    0:00     .00  n/a     .000
     {MxStoUsed=.2593E+01  m3, TotOvfVol=.0000E+00  m3, N-Ovf=    0, TotDurOvf=    0.hrs}
###############################################################################
# SAVE HYDs
###############################################################################
# Save Pond Inflow Hydrograph For Use In Preparing Pond Stage-Time Curves
# For Use in IBI Group's HGL Analysis of the Upstream Subdivision
#SAVE HYD            NHYD=["Pin"],  # OF PCYCLES=[-1],  ICASEsh=[1]
#                    HYD_COMMENT=["Pond Inflow"]
# Save Pond Outflow Hydrograph For Use In Calculating Average Velocity in the
# Forebay During the 10-Year Storm
#SAVE HYD            NHYD=["PFout"],  # OF PCYCLES=[-1],  ICASEsh=[1]
#                    HYD_COMMENT=["Pond Outfow - Free Outfall Conditions"]
# Save Pond Outflow Hydrograph For Use In Preparing Pond Stage-Time Curves
# For Use in IBI Group's HGL Analysis of the Upstream Subdivision
#SAVE HYD            NHYD=["PRout"],  # OF PCYCLES=[-1],  ICASEsh=[1]
#                    HYD_COMMENT=["Pond Outfow - Restrictive D/S Conditions"]
###############################################################################
# CHECK CAPACITIES OF OVERLAND FLOW ROUTE INTO POND AND OUTLET CHANNEL FROM POND
###############################################################################
# Overland Flow Route Capacity
R0250:C00012------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ROUTE CHANNEL   ->   15.0 02:Maj             .00     .070 No_date    5:4565699.26  n/a     .000
     [RDT= 1.00] out<-    1.0 01:OVL_FR          .00     .068 No_date    5:4564439.27  n/a     .000
      [L/S/n=   10./ .700/.030]
      {Vmax=  .367:Dmax=  .096}
# Outlet Channel Capacity
R0250:C00013------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ROUTE CHANNEL   ->    1.0 02:PFout        44.75     .342 No_date    7:08   57.93  n/a     .000
 *   [RDT= 1.00] out<-    1.0 01:PFchan       44.75     .342 No_date    7:11   57.93  n/a     .000
      [L/S/n=   10./ .100/.035]
      {Vmax=  .269:Dmax=  .573}
###############################################################################
# STORMS
###############################################################################
  ** END OF RUN :  298

***********************************************************************************************

 RUN#:COMMAND#
R0299:C00001-----------------------------------------------------------------------------------
     START
      [TZERO =    .00 hrs on        0]
      [METOUT=   2    (1=imperial, 2=metric output)]
      [NSTORM=   1 ]
      [NRUN  = 0299 ]
#******************************************************************************
#  SWMHYMO Ver:5.02/Jan 2001 <BETA> / INPUT DATA FILE
#******************************************************************************
#  Project Name  : [Stittsville South - Davidson Co-Tenancy]
#  Project Number: [1123-13]
#  Date          : 2015/05/06
#  Modeller      : Laura Pipkins, P.Eng.
#  Updated       : 2016/08/24 [LP]
#  Updated       : 2017/02/13 [LP]
#  Updated       : 2017/03/22 [LP]
#  Updated       : 2017/09/13 [LP]
#  Updated       : 2017/09/18 [LP]
#  Updated       : 2023/07/04 [LP]
#  Updated       : 2023/07/12 [LP]
#  Updated       : 2023/09/25 [LP]
#  Company       : J.F. Sabourin and Associates
#  License #     : 2582634
#******************************************************************************
R0299:C00002-----------------------------------------------------------------------------------
     READ STORM
      Filename = storm.001
      Comment  = 100 years SCS Type 2 Storm 12 Hours step 15 min, as per Carp River
      [SDT=15.00:SDUR=  12.00:PTOT=  96.00]
R0299:C00003-----------------------------------------------------------------------------------
     DEFAULT VALUES
      Filename = T:\PROJ\1123-13\201709 PDB Subm2\Design\SWMHYMO\202309 Add Area\Ottawa.val
      ICASEdv  = 1 (read and print data)
      FileTitle= File comment: [Parameters for City of Ottawa Projects]
              THE FOLLOWING PARAMETERS ARE USED IN THE DESIGN STANDHYD COM
      Horton's infiltration equation parameters:
      [Fo= 76.20 mm/hr] [Fc=13.20 mm/hr] [DCAY= 4.14 /hr] [F=  .00 mm]
      Parameters for PERVIOUS surfaces in STANDHYD:
      [IAper=   4.67 mm] [LGP=40.00 m] [MNP= .250]
      Parameters for IMPERVIOUS surfaces in STANDHYD:
      [IAimp=   1.57 mm] [CLI= 1.50]   [MNI= .013]
      Parameters used in NASHYD:
      [Ia=   4.67 mm] [N= 3.00]
      Average monthly Pan Evaporation data in    (mm)
   JAN   FEB   MAR   APR   MAY   JUN   JUL   AUG   SEP   OCT   NOV   DEC
   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00
      Average monthly Potential Evapotranspiration in    (mm)
   JAN   FEB   MAR   APR   MAY   JUN   JUL   AUG   SEP   OCT   NOV   DEC
   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00
#
###############################################################################
# PROPOSED DEVELOPMENT - FREE OUTFALL HYDROGRAPHS
###############################################################################
# Minor system hydrograph provided September 2017 by IBI Group
R0299:C00004------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    READ HYD             1.0 01:Min           37.55    6.910 No_date    5:56   64.31  n/a     .000
      Filename = T:\PROJ\1123-13\201709 PDB Subm2\Design\SWMHYMO\202309 Add Area\Min
      Comment  = MINOR SYSTEM FLOW FROM DAVIDSON CO-TENANCY (SEPTEMBER 2017,
# Major system hydrograph provided September 2017 by IBI Group
R0299:C00005------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    READ HYD            15.0 01:Maj             .00     .609 No_date    5:45********  n/a     .000
      Filename = T:\PROJ\1123-13\201709 PDB Subm2\Design\SWMHYMO\202309 Add Area\Maj
      Comment  = MAJOR SYSTEM FLOW FROM DAVIDSON CO-TENANCY (SEPTEMBER 2017,
###############################################################################
# PROPOSED POND BLOCK
###############################################################################
# Drainage area characteristics as per base plan provided by DSEL
R0299:C00006------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    DESIGN STANDHYD      1.0 01:Pond           3.07     .733 No_date    6:00   61.89 .645     .000
      [XIMP=.45:TIMP=.45]
      [SLP= .50:DT= 1.00]
      [LOSS= 1 : HORTONS]
# Proposed Additional Area Requested by DSEL, September 2023
R0299:C00007------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    DESIGN STANDHYD      1.0 01:Addl           4.13    1.184 No_date    6:00   75.84 .790     .000
      [XIMP=.66:TIMP=.71]
      [SLP= .50:DT= 1.00]
      [LOSS= 1 : HORTONS]
###############################################################################
# TOTAL INFLOWS TO SWM FACILITY
###############################################################################
R0299:C00008------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ADD HYD              1.0 02:Min           37.55    6.910 No_date    5:56   64.31  n/a     .000
                    +   15.0 02:Maj             .00     .609 No_date    5:45********  n/a     .000
                    +    1.0 02:Pond           3.07     .733 No_date    6:00   61.89  n/a     .000
                    +    1.0 02:Addl           4.13    1.184 No_date    6:00   75.84  n/a     .000
                 SUM=    1.0 01:Pin           44.75    9.193 No_date    5:59   67.35  n/a     .000
###############################################################################
# SWM FACILITY
###############################################################################
# Quality control and permanent pool requirements based on MOE guidelines
# for enhanced quality control for wet ponds. Extended detention of the 25 mm
# runoff volume for 72 hours estimated for unknown erosion control requirements.
# 2-, 5- and 100-year target release rates as per Table 3 of the April 2016
# "Faulkner Drain Hydrotechnical Update" by Novatech.
# Free Outfall Conditions
R0299:C00009------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ROUTE RESERVOIR ->    1.0 02:Pin          44.75    9.193 No_date    5:59   67.35  n/a     .000
                 out <=    1.0 01:PFout        44.75     .615 No_date    6:52   67.35  n/a     .000
            overflow <=    1.0 03:PFovf          .00     .000 No_date    0:00     .00  n/a     .000
     {MxStoUsed=.2534E+01  m3, TotOvfVol=.0000E+00  m3, N-Ovf=    0, TotDurOvf=    0.hrs}
# Restrictive Downstream Conditions (100-Year D/S Water Level = 102.77 m)
R0299:C00010------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ROUTE RESERVOIR ->    1.0 02:Pin          44.75    9.193 No_date    5:59   67.35  n/a     .000
 *               out <=    1.0 01:PRout        44.75     .458 No_date    7:02   32.43  n/a     .000
            overflow <=    1.0 03:PRovf          .00     .000 No_date    0:00     .00  n/a     .000
     {MxStoUsed=.2661E+01  m3, TotOvfVol=.0000E+00  m3, N-Ovf=    0, TotDurOvf=    0.hrs}
# Restrictive Downstream Conditions (100-Year D/S Water Level = 102.77 m)
# 100% Blockage of Drop Inlet Structure
R0299:C00011------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ROUTE RESERVOIR ->    1.0 02:Pin          44.75    9.193 No_date    5:59   67.35  n/a     .000
 *               out <=    1.0 01:PRBout       44.75     .084 No_date   10:10    4.77  n/a     .000
            overflow <=    1.0 03:PRBovf         .00     .000 No_date    0:00     .00  n/a     .000
     {MxStoUsed=.2901E+01  m3, TotOvfVol=.0000E+00  m3, N-Ovf=    0, TotDurOvf=    0.hrs}
###############################################################################
# SAVE HYDs
###############################################################################
# Save Pond Inflow Hydrograph For Use In Preparing Pond Stage-Time Curves
# For Use in IBI Group's HGL Analysis of the Upstream Subdivision
#SAVE HYD            NHYD=["Pin"],  # OF PCYCLES=[-1],  ICASEsh=[1]
#                    HYD_COMMENT=["Pond Inflow"]
# Save Pond Outflow Hydrograph For Use In Calculating Average Velocity in the
# Forebay During the 10-Year Storm
#SAVE HYD            NHYD=["PFout"],  # OF PCYCLES=[-1],  ICASEsh=[1]
#                    HYD_COMMENT=["Pond Outfow - Free Outfall Conditions"]
# Save Pond Outflow Hydrograph For Use In Preparing Pond Stage-Time Curves
# For Use in IBI Group's HGL Analysis of the Upstream Subdivision
#SAVE HYD            NHYD=["PRout"],  # OF PCYCLES=[-1],  ICASEsh=[1]
#                    HYD_COMMENT=["Pond Outfow - Restrictive D/S Conditions"]
###############################################################################
# CHECK CAPACITIES OF OVERLAND FLOW ROUTE INTO POND AND OUTLET CHANNEL FROM POND
###############################################################################
# Overland Flow Route Capacity
R0299:C00012------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ROUTE CHANNEL   ->   15.0 02:Maj             .00     .609 No_date    5:45********  n/a     .000
 *   [RDT= 1.00] out<-    1.0 01:OVL_FR          .00     .604 No_date    5:46********  n/a     .000
      [L/S/n=   10./ .700/.030]
      {Vmax=  .619:Dmax=  .220}
# Outlet Channel Capacity
R0299:C00013------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ROUTE CHANNEL   ->    1.0 02:PFout        44.75     .615 No_date    6:52   67.35  n/a     .000
 *   [RDT= 1.00] out<-    1.0 01:PFchan       44.75     .615 No_date    6:55   67.35  n/a     .000
      [L/S/n=   10./ .100/.035]
      {Vmax=  .298:Dmax=  .750}
###############################################################################
# STORMS
###############################################################################
  ** END OF RUN :  978

***********************************************************************************************

 RUN#:COMMAND#
R0979:C00001-----------------------------------------------------------------------------------
     START
      [TZERO =    .00 hrs on        0]
      [METOUT=   2    (1=imperial, 2=metric output)]
      [NSTORM=   1 ]
      [NRUN  = 0979 ]
#******************************************************************************
#  SWMHYMO Ver:5.02/Jan 2001 <BETA> / INPUT DATA FILE
#******************************************************************************
#  Project Name  : [Stittsville South - Davidson Co-Tenancy]
#  Project Number: [1123-13]
#  Date          : 2015/05/06
#  Modeller      : Laura Pipkins, P.Eng.
#  Updated       : 2016/08/24 [LP]
#  Updated       : 2017/02/13 [LP]
#  Updated       : 2017/03/22 [LP]
#  Updated       : 2017/09/13 [LP]
#  Updated       : 2017/09/18 [LP]
#  Updated       : 2023/07/04 [LP]
#  Updated       : 2023/07/12 [LP]
#  Updated       : 2023/09/25 [LP]
#  Company       : J.F. Sabourin and Associates
#  License #     : 2582634
#******************************************************************************
R0979:C00002-----------------------------------------------------------------------------------
     READ STORM
      Filename = storm.001
      Comment  = July 1st, 1979 Storm (3H) - Ottawa International Airport step 5 min
      [SDT= 5.00:SDUR=   3.00:PTOT=  83.99]
R0979:C00003-----------------------------------------------------------------------------------
     DEFAULT VALUES
      Filename = T:\PROJ\1123-13\201709 PDB Subm2\Design\SWMHYMO\202309 Add Area\Ottawa.val
      ICASEdv  = 1 (read and print data)
      FileTitle= File comment: [Parameters for City of Ottawa Projects]
              THE FOLLOWING PARAMETERS ARE USED IN THE DESIGN STANDHYD COM
      Horton's infiltration equation parameters:
      [Fo= 76.20 mm/hr] [Fc=13.20 mm/hr] [DCAY= 4.14 /hr] [F=  .00 mm]
      Parameters for PERVIOUS surfaces in STANDHYD:
      [IAper=   4.67 mm] [LGP=40.00 m] [MNP= .250]
      Parameters for IMPERVIOUS surfaces in STANDHYD:
      [IAimp=   1.57 mm] [CLI= 1.50]   [MNI= .013]
      Parameters used in NASHYD:
      [Ia=   4.67 mm] [N= 3.00]
      Average monthly Pan Evaporation data in    (mm)
   JAN   FEB   MAR   APR   MAY   JUN   JUL   AUG   SEP   OCT   NOV   DEC
   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00
      Average monthly Potential Evapotranspiration in    (mm)
   JAN   FEB   MAR   APR   MAY   JUN   JUL   AUG   SEP   OCT   NOV   DEC
   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00
#
###############################################################################
# PROPOSED DEVELOPMENT - FREE OUTFALL HYDROGRAPHS
###############################################################################
# Minor system hydrograph provided September 2017 by IBI Group
R0979:C00004------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    READ HYD             1.0 01:Min           37.55    7.092 No_date    1:38   67.33  n/a     .000
      Filename = T:\PROJ\1123-13\201709 PDB Subm2\Design\SWMHYMO\202309 Add Area\Min
      Comment  = MINOR SYSTEM FLOW FROM DAVIDSON CO-TENANCY (SEPTEMBER 2017,
# Major system hydrograph provided September 2017 by IBI Group
R0979:C00005------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    READ HYD             5.0 01:Maj             .00     .112 No_date    1:30********  n/a     .000
      Filename = T:\PROJ\1123-13\201709 PDB Subm2\Design\SWMHYMO\202309 Add Area\Maj
      Comment  = MAJOR SYSTEM FLOW FROM DAVIDSON CO-TENANCY (SEPTEMBER 2017,
###############################################################################
# PROPOSED POND BLOCK
###############################################################################
# Drainage area characteristics as per base plan provided by DSEL
R0979:C00006------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    DESIGN STANDHYD      1.0 01:Pond           3.07     .572 No_date    1:32   60.35 .719     .000
      [XIMP=.45:TIMP=.45]
      [SLP= .50:DT= 1.00]
      [LOSS= 1 : HORTONS]
# Proposed Additional Area Requested by DSEL, September 2023
R0979:C00007------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    DESIGN STANDHYD      1.0 01:Addl           4.13     .938 No_date    1:31   70.42 .838     .000
      [XIMP=.66:TIMP=.71]
      [SLP= .50:DT= 1.00]
      [LOSS= 1 : HORTONS]
###############################################################################
# TOTAL INFLOWS TO SWM FACILITY
###############################################################################
R0979:C00008------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
```

DRAFT

```
    ADD HYD               1.0 02:Min           37.55    7.092 No_date    1:38   67.33  n/a     .000
                   +      5.0 02:Maj             .00     .112 No_date    1:30********  n/a     .000
                   +      1.0 02:Pond           3.07     .572 No_date    1:32   60.35  n/a     .000
                   +      1.0 02:Addl           4.13     .938 No_date    1:31   70.42  n/a     .000
                SUM=      1.0 01:Pin           44.75    8.536 No_date    1:33   67.36  n/a     .000
################################################################################
# SWM FACILITY
################################################################################
# Quality control and permanent pool requirements based on MOE guidelines
# for enhanced quality control for wet ponds. Extended detention of the 25 mm
# runoff volume for 72 hours estimated for unknown erosion control requirements.
# 2-, 5- and 100-year target release rates as per Table 3 of the April 2016
# "Faulkner Drain Hydrotechnical Update" by Novatech.
# Free Outfall Conditions
R0979:C00009------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ROUTE RESERVOIR ->    1.0 02:Pin           44.75    8.536 No_date    1:33   67.36  n/a     .000
               out <=     1.0 01:PFout         44.75     .673 No_date    2:23   67.36  n/a     .000
          overflow <=     1.0 03:PFovf           .00     .000 No_date    0:00     .00  n/a     .000
     {MxStoUsed=.2740E+01  m3, TotOvfVol=.0000E+00  m3, N-Ovf=    0, TotDurOvf=    0.hrs}
# Restrictive Downstream Conditions (100-Year D/S Water Level = 102.77 m)
R0979:C00010------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ROUTE RESERVOIR ->    1.0 02:Pin           44.75    8.536 No_date    1:33   67.36  n/a     .000
 *             out <=     1.0 01:PRout         44.75     .582 No_date    2:26   32.44  n/a     .000
          overflow <=     1.0 03:PRovf           .00     .000 No_date    0:00     .00  n/a     .000
     {MxStoUsed=.2816E+01  m3, TotOvfVol=.0000E+00  m3, N-Ovf=    0, TotDurOvf=    0.hrs}
# Restrictive Downstream Conditions (100-Year D/S Water Level = 102.77 m)
# 100% Blockage of Drop Inlet Structure
R0979:C00011------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ROUTE RESERVOIR ->    1.0 02:Pin           44.75    8.536 No_date    1:33   67.36  n/a     .000
 *             out <=     1.0 01:PRBout        44.75     .159 No_date    2:56    4.78  n/a     .000
          overflow <=     1.0 03:PRBovf          .00     .000 No_date    0:00     .00  n/a     .000
     {MxStoUsed=.2947E+01  m3, TotOvfVol=.0000E+00  m3, N-Ovf=    0, TotDurOvf=    0.hrs}
################################################################################
# SAVE HYDs
################################################################################
# Save Pond Inflow Hydrograph For Use In Preparing Pond Stage-Time Curves
# For Use in IBI Group's HGL Analysis of the Upstream Subdivision
#SAVE HYD            NHYD=["Pin"],  # OF PCYCLES=[-1],  ICASEsh=[1]
#                    HYD_COMMENT=["Pond Inflow"]
# Save Pond Outflow Hydrograph For Use In Calculating Average Velocity in the
# Forebay During the 10-Year Storm
#SAVE HYD            NHYD=["PFout"],  # OF PCYCLES=[-1],  ICASEsh=[1]
#                    HYD_COMMENT=["Pond Outfow - Free Outfall Conditions"]
# Save Pond Outflow Hydrograph For Use In Preparing Pond Stage-Time Curves
# For Use in IBI Group's HGL Analysis of the Upstream Subdivision
#SAVE HYD            NHYD=["PRout"],  # OF PCYCLES=[-1],  ICASEsh=[1]
#                    HYD_COMMENT=["Pond Outfow - Restrictive D/S Conditions"]
################################################################################
# CHECK CAPACITIES OF OVERLAND FLOW ROUTE INTO POND AND OUTLET CHANNEL FROM POND
################################################################################
# Overland Flow Route Capacity
R0979:C00012------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ROUTE CHANNEL   ->    5.0 02:Maj             .00     .112 No_date    1:30********  n/a     .000
     [RDT= 1.00] out<-    1.0 01:OVL_FR          .00     .112 No_date    1:26********  n/a     .000
      [L/S/n=   10./ .700/.030]
      {Vmax=  .417:Dmax=  .116}
# Outlet Channel Capacity
R0979:C00013------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ROUTE CHANNEL   ->    1.0 02:PFout         44.75     .673 No_date    2:23   67.36  n/a     .000
 *   [RDT= 1.00] out<-    1.0 01:PFchan        44.75     .673 No_date    2:24   67.36  n/a     .000
      [L/S/n=   10./ .100/.035]
      {Vmax=  .303:Dmax=  .781}
################################################################################
# STORMS
################################################################################
  ** END OF RUN :  987

*******************************************************************************************






 RUN#:COMMAND#
R0988:C00001-------------------------------------------------------------------------------------
     START
      [TZERO =    .00 hrs on        0]
      [METOUT=   2    (1=imperial, 2=metric output)]
      [NSTORM=   1 ]
      [NRUN  = 0988 ]
#******************************************************************************
#  SWMHYMO Ver:5.02/Jan 2001 <BETA> / INPUT DATA FILE
#******************************************************************************
#  Project Name  : [Stittsville South - Davidson Co-Tenancy]
#  Project Number: [1123-13]
#  Date          : 2015/05/06
#  Modeller      : Laura Pipkins, P.Eng.
#  Updated       : 2016/08/24 [LP]
#  Updated       : 2017/02/13 [LP]
#  Updated       : 2017/03/22 [LP]
#  Updated       : 2017/09/13 [LP]
#  Updated       : 2017/09/18 [LP]
#  Updated       : 2023/07/04 [LP]
#  Updated       : 2023/07/12 [LP]
#  Updated       : 2023/09/25 [LP]
#  Company       : J.F. Sabourin and Associates
#  License #     : 2582634
#******************************************************************************
R0988:C00002-------------------------------------------------------------------------------------
     READ STORM
      Filename = storm.001
      Comment  = August 4th, 1988 Storm (5H+) - Ottawa International Airport step 5
      [SDT= 5.00:SDUR=   5.58:PTOT=  80.59]
R0988:C00003-------------------------------------------------------------------------------------
     DEFAULT VALUES
      Filename = T:\PROJ\1123-13\201709 PDB Subm2\Design\SWMHYMO\202309 Add Area\Ottawa.val
      ICASEdv  = 1 (read and print data)
      FileTitle= File comment: [Parameters for City of Ottawa Projects]
                 THE FOLLOWING PARAMETERS ARE USED IN THE DESIGN STANDHYD COM
      Horton's infiltration equation parameters:
      [Fo= 76.20 mm/hr] [Fc=13.20 mm/hr] [DCAY= 4.14 /hr] [F=  .00 mm]
      Parameters for PERVIOUS surfaces in STANDHYD:
      [IAper=   4.67 mm] [LGP=40.00 m] [MNP= .250]
      Parameters for IMPERVIOUS surfaces in STANDHYD:
      [IAimp=   1.57 mm] [CLI= 1.50]   [MNI= .013]
      Parameters used in NASHYD:
      [Ia=   4.67 mm] [N= 3.00]
      Average monthly Pan Evaporation data in    (mm)
   JAN   FEB   MAR   APR   MAY   JUN   JUL   AUG   SEP   OCT   NOV   DEC
   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00
      Average monthly Potential Evapotranspiration in    (mm)
   JAN   FEB   MAR   APR   MAY   JUN   JUL   AUG   SEP   OCT   NOV   DEC
   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00
#
################################################################################
# PROPOSED DEVELOPMENT - FREE OUTFALL HYDROGRAPHS
################################################################################
# Minor system hydrograph provided September 2017 by IBI Group
R0988:C00004------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    READ HYD              1.0 01:Min           37.55    6.869 No_date    2:02   56.69  n/a     .000
      Filename = T:\PROJ\1123-13\201709 PDB Subm2\Design\SWMHYMO\202309 Add Area\Min
      Comment  = MINOR SYSTEM FLOW FROM DAVIDSON CO-TENANCY (SEPTEMBER 2017,
# Major system hydrograph provided September 2017 by IBI Group
R0988:C00005------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    READ HYD              5.0 01:Maj             .00     .118 No_date    1:5563599.29  n/a     .000
      Filename = T:\PROJ\1123-13\201709 PDB Subm2\Design\SWMHYMO\202309 Add Area\Maj
      Comment  = MAJOR SYSTEM FLOW FROM DAVIDSON CO-TENANCY (SEPTEMBER 2017,
################################################################################
# PROPOSED POND BLOCK
################################################################################
# Drainage area characteristics as per base plan provided by DSEL
R0988:C00006------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    DESIGN STANDHYD       1.0 01:Pond           3.07     .685 No_date    2:00   56.24 .698     .000
      [XIMP=.45:TIMP=.45]
      [SLP= .50:DT= 1.00]
      [LOSS= 1 : HORTONS]
# Proposed Additional Area Requested by DSEL, September 2023
R0988:C00007------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    DESIGN STANDHYD       1.0 01:Addl           4.13    1.110 No_date    2:01   66.53 .826     .000
      [XIMP=.66:TIMP=.71]
      [SLP= .50:DT= 1.00]
      [LOSS= 1 : HORTONS]
################################################################################
# TOTAL INFLOWS TO SWM FACILITY
################################################################################
R0988:C00008------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ADD HYD               1.0 02:Min           37.55    6.869 No_date    2:02   56.69  n/a     .000
                   +      5.0 02:Maj             .00     .118 No_date    1:5563599.29  n/a     .000
                   +      1.0 02:Pond           3.07     .685 No_date    2:00   56.24  n/a     .000
                   +      1.0 02:Addl           4.13    1.110 No_date    2:01   66.53  n/a     .000
                SUM=      1.0 01:Pin           44.75    8.615 No_date    2:01   57.68  n/a     .000
################################################################################
# SWM FACILITY
################################################################################
# Quality control and permanent pool requirements based on MOE guidelines
# for enhanced quality control for wet ponds. Extended detention of the 25 mm
# runoff volume for 72 hours estimated for unknown erosion control requirements.
# 2-, 5- and 100-year target release rates as per Table 3 of the April 2016
# "Faulkner Drain Hydrotechnical Update" by Novatech.
# Free Outfall Conditions
R0988:C00009------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ROUTE RESERVOIR ->    1.0 02:Pin           44.75    8.615 No_date    2:01   57.68  n/a     .000
               out <=     1.0 01:PFout         44.75     .506 No_date    2:37   57.68  n/a     .000
          overflow <=     1.0 03:PFovf           .00     .000 No_date    0:00     .00  n/a     .000
     {MxStoUsed=.2294E+01  m3, TotOvfVol=.0000E+00  m3, N-Ovf=    0, TotDurOvf=    0.hrs}
# Restrictive Downstream Conditions (100-Year D/S Water Level = 102.77 m)
R0988:C00010------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ROUTE RESERVOIR ->    1.0 02:Pin           44.75    8.615 No_date    2:01   57.68  n/a     .000
 *             out <=     1.0 01:PRout         44.75     .159 No_date    3:36   22.93  n/a     .000
          overflow <=     1.0 03:PRovf           .00     .000 No_date    0:00     .00  n/a     .000
     {MxStoUsed=.2425E+01  m3, TotOvfVol=.0000E+00  m3, N-Ovf=    0, TotDurOvf=    0.hrs}
# Restrictive Downstream Conditions (100-Year D/S Water Level = 102.77 m)
# 100% Blockage of Drop Inlet Structure
R0988:C00011------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ROUTE RESERVOIR ->    1.0 02:Pin           44.75    8.615 No_date    2:01   57.68  n/a     .000
 *             out <=     1.0 01:PRBout        44.75     .000 No_date    0:00     .00  n/a     .000
          overflow <=     1.0 03:PRBovf          .00     .000 No_date    0:00     .00  n/a     .000
     {MxStoUsed=.2581E+01  m3, TotOvfVol=.0000E+00  m3, N-Ovf=    0, TotDurOvf=    0.hrs}
################################################################################
# SAVE HYDs
################################################################################
# Save Pond Inflow Hydrograph For Use In Preparing Pond Stage-Time Curves
# For Use in IBI Group's HGL Analysis of the Upstream Subdivision
#SAVE HYD            NHYD=["Pin"],  # OF PCYCLES=[-1],  ICASEsh=[1]
#                    HYD_COMMENT=["Pond Inflow"]
# Save Pond Outflow Hydrograph For Use In Calculating Average Velocity in the
# Forebay During the 10-Year Storm
#SAVE HYD            NHYD=["PFout"],  # OF PCYCLES=[-1],  ICASEsh=[1]
#                    HYD_COMMENT=["Pond Outfow - Free Outfall Conditions"]
# Save Pond Outflow Hydrograph For Use In Preparing Pond Stage-Time Curves
# For Use in IBI Group's HGL Analysis of the Upstream Subdivision
#SAVE HYD            NHYD=["PRout"],  # OF PCYCLES=[-1],  ICASEsh=[1]
#                    HYD_COMMENT=["Pond Outfow - Restrictive D/S Conditions"]
################################################################################
# CHECK CAPACITIES OF OVERLAND FLOW ROUTE INTO POND AND OUTLET CHANNEL FROM POND
################################################################################
# Overland Flow Route Capacity
R0988:C00012------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ROUTE CHANNEL   ->    5.0 02:Maj             .00     .118 No_date    1:5563599.29  n/a     .000
 *   [RDT= 1.00] out<-    1.0 01:OVL_FR          .00     .114 No_date    1:5654962.35  n/a     .000
      [L/S/n=   10./ .700/.030]
      {Vmax=  .421:Dmax=  .118}
# Outlet Channel Capacity
R0988:C00013------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ROUTE CHANNEL   ->    1.0 02:PFout         44.75     .506 No_date    2:37   57.68  n/a     .000
 *   [RDT= 1.00] out<-    1.0 01:PFchan        44.75     .506 No_date    2:39   57.68  n/a     .000
      [L/S/n=   10./ .100/.035]
      {Vmax=  .288:Dmax=  .686}
################################################################################
# STORMS
################################################################################
  ** END OF RUN :  995

*******************************************************************************************






 RUN#:COMMAND#
R0996:C00001-------------------------------------------------------------------------------------
     START
      [TZERO =    .00 hrs on        0]
      [METOUT=   2    (1=imperial, 2=metric output)]
      [NSTORM=   1 ]
      [NRUN  = 0996 ]
#******************************************************************************
#  SWMHYMO Ver:5.02/Jan 2001 <BETA> / INPUT DATA FILE
#******************************************************************************
#  Project Name  : [Stittsville South - Davidson Co-Tenancy]
#  Project Number: [1123-13]
#  Date          : 2015/05/06
#  Modeller      : Laura Pipkins, P.Eng.
#  Updated       : 2016/08/24 [LP]
#  Updated       : 2017/02/13 [LP]
#  Updated       : 2017/03/22 [LP]
#  Updated       : 2017/09/13 [LP]
#  Updated       : 2017/09/18 [LP]
#  Updated       : 2023/07/04 [LP]
#  Updated       : 2023/07/12 [LP]
#  Updated       : 2023/09/25 [LP]
#  Company       : J.F. Sabourin and Associates
#  License #     : 2582634
#******************************************************************************
R0996:C00002-------------------------------------------------------------------------------------
     READ STORM
      Filename = storm.001
      Comment  = August 8th, 1996 Storm (5H+) - Ottawa International Airport step 5
      [SDT= 5.00:SDUR=   5.75:PTOT=  73.90]
R0996:C00003-------------------------------------------------------------------------------------
     DEFAULT VALUES
      Filename = T:\PROJ\1123-13\201709 PDB Subm2\Design\SWMHYMO\202309 Add Area\Ottawa.val
      ICASEdv  = 1 (read and print data)
      FileTitle= File comment: [Parameters for City of Ottawa Projects]
                 THE FOLLOWING PARAMETERS ARE USED IN THE DESIGN STANDHYD COM
      Horton's infiltration equation parameters:
      [Fo= 76.20 mm/hr] [Fc=13.20 mm/hr] [DCAY= 4.14 /hr] [F=  .00 mm]
      Parameters for PERVIOUS surfaces in STANDHYD:
      [IAper=   4.67 mm] [LGP=40.00 m] [MNP= .250]
      Parameters for IMPERVIOUS surfaces in STANDHYD:
      [IAimp=   1.57 mm] [CLI= 1.50]   [MNI= .013]
      Parameters used in NASHYD:
      [Ia=   4.67 mm] [N= 3.00]
      Average monthly Pan Evaporation data in    (mm)
   JAN   FEB   MAR   APR   MAY   JUN   JUL   AUG   SEP   OCT   NOV   DEC
   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00
      Average monthly Potential Evapotranspiration in    (mm)
   JAN   FEB   MAR   APR   MAY   JUN   JUL   AUG   SEP   OCT   NOV   DEC
   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00
#
################################################################################
# PROPOSED DEVELOPMENT - FREE OUTFALL HYDROGRAPHS
################################################################################
# Minor system hydrograph provided September 2017 by IBI Group
R0996:C00004------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    READ HYD              1.0 01:Min           37.55    5.931 No_date    1:30   37.83  n/a     .000
      Filename = T:\PROJ\1123-13\201709 PDB Subm2\Design\SWMHYMO\202309 Add Area\Min
      Comment  = MINOR SYSTEM FLOW FROM DAVIDSON CO-TENANCY (SEPTEMBER 2017,
# Major system hydrograph provided September 2017 by IBI Group
R0996:C00005------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    READ HYD              5.0 01:Maj             .00     .052 No_date    1:2518899.79  n/a     .000
      Filename = T:\PROJ\1123-13\201709 PDB Subm2\Design\SWMHYMO\202309 Add Area\Maj
      Comment  = MAJOR SYSTEM FLOW FROM DAVIDSON CO-TENANCY (SEPTEMBER 2017,
################################################################################
# PROPOSED POND BLOCK
################################################################################
# Drainage area characteristics as per base plan provided by DSEL
R0996:C00006------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    DESIGN STANDHYD       1.0 01:Pond           3.07     .446 No_date    1:28   51.12 .692     .000
      [XIMP=.45:TIMP=.45]
      [SLP= .50:DT= 1.00]
      [LOSS= 1 : HORTONS]
# Proposed Additional Area Requested by DSEL, September 2023
R0996:C00007------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    DESIGN STANDHYD       1.0 01:Addl           4.13     .825 No_date    1:28   60.68 .821     .000
      [XIMP=.66:TIMP=.71]
      [SLP= .50:DT= 1.00]
      [LOSS= 1 : HORTONS]
################################################################################
# TOTAL INFLOWS TO SWM FACILITY
################################################################################
R0996:C00008------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ADD HYD               1.0 02:Min           37.55    5.931 No_date    1:30   37.83  n/a     .000
                   +      5.0 02:Maj             .00     .052 No_date    1:2518899.79  n/a     .000
                   +      1.0 02:Pond           3.07     .446 No_date    1:28   51.12  n/a     .000
                   +      1.0 02:Addl           4.13     .825 No_date    1:28   60.68  n/a     .000
                SUM=      1.0 01:Pin           44.75    7.187 No_date    1:30   40.89  n/a     .000
################################################################################
# SWM FACILITY
################################################################################
# Quality control and permanent pool requirements based on MOE guidelines
# for enhanced quality control for wet ponds. Extended detention of the 25 mm
# runoff volume for 72 hours estimated for unknown erosion control requirements.
# 2-, 5- and 100-year target release rates as per Table 3 of the April 2016
# "Faulkner Drain Hydrotechnical Update" by Novatech.
# Free Outfall Conditions
R0996:C00009------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ROUTE RESERVOIR ->    1.0 02:Pin           44.75    7.187 No_date    1:30   40.89  n/a     .000
               out <=     1.0 01:PFout         44.75     .201 No_date    4:00   40.88  n/a     .000
          overflow <=     1.0 03:PFovf           .00     .000 No_date    0:00     .00  n/a     .000
     {MxStoUsed=.1655E+01  m3, TotOvfVol=.0000E+00  m3, N-Ovf=    0, TotDurOvf=    0.hrs}
# Restrictive Downstream Conditions (100-Year D/S Water Level = 102.77 m)
R0996:C00010------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ROUTE RESERVOIR ->    1.0 02:Pin           44.75    7.187 No_date    1:30   40.89  n/a     .000
 *             out <=     1.0 01:PRout         44.75     .042 No_date    5:11    6.14  n/a     .000
          overflow <=     1.0 03:PRovf           .00     .000 No_date    0:00     .00  n/a     .000
     {MxStoUsed=.1793E+01  m3, TotOvfVol=.0000E+00  m3, N-Ovf=    0, TotDurOvf=    0.hrs}
# Restrictive Downstream Conditions (100-Year D/S Water Level = 102.77 m)
# 100% Blockage of Drop Inlet Structure
R0996:C00011------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ROUTE RESERVOIR ->    1.0 02:Pin           44.75    7.187 No_date    1:30   40.89  n/a     .000
 *             out <=     1.0 01:PRBout        44.75     .000 No_date    0:00     .00  n/a     .000
          overflow <=     1.0 03:PRBovf          .00     .000 No_date    0:00     .00  n/a     .000
     {MxStoUsed=.1830E+01  m3, TotOvfVol=.0000E+00  m3, N-Ovf=    0, TotDurOvf=    0.hrs}
################################################################################
# SAVE HYDs
################################################################################
# Save Pond Inflow Hydrograph For Use In Preparing Pond Stage-Time Curves
# For Use in IBI Group's HGL Analysis of the Upstream Subdivision
#SAVE HYD            NHYD=["Pin"],  # OF PCYCLES=[-1],  ICASEsh=[1]
#                    HYD_COMMENT=["Pond Inflow"]
# Save Pond Outflow Hydrograph For Use In Calculating Average Velocity in the
# Forebay During the 10-Year Storm
#SAVE HYD            NHYD=["PFout"],  # OF PCYCLES=[-1],  ICASEsh=[1]
#                    HYD_COMMENT=["Pond Outfow - Free Outfall Conditions"]
# Save Pond Outflow Hydrograph For Use In Preparing Pond Stage-Time Curves
# For Use in IBI Group's HGL Analysis of the Upstream Subdivision
#SAVE HYD            NHYD=["PRout"],  # OF PCYCLES=[-1],  ICASEsh=[1]
#                    HYD_COMMENT=["Pond Outfow - Restrictive D/S Conditions"]
################################################################################
```

DRAFT

DRAFT

```
# CHECK CAPACITIES OF OVERLAND FLOW ROUTE INTO POND AND OUTLET CHANNEL FROM POND
################################################################################
# Overland Flow Route Capacity
R0996:C00012------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ROUTE CHANNEL   ->    5.0 02:Maj             .00     .052 No_date    1:2518899.79  n/a     .000
     [RDT= 1.00] out<-    1.0 01:OVL_FR          .00     .048 No_date    1:2517578.54  n/a     .000
      [L/S/n=   10./ .700/.030]
      {Vmax=  .338:Dmax=  .086}
# Outlet Channel Capacity
R0996:C00013------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ROUTE CHANNEL   ->    1.0 02:PFout         44.75     .201 No_date    4:00   40.88  n/a     .000
 *   [RDT= 1.00] out<-    1.0 01:PFchan        44.75     .201 No_date    4:02   40.88  n/a     .000
      [L/S/n=   10./ .100/.035]
      {Vmax=  .246:Dmax=  .446}
################################################################################
# STORMS
################################################################################
  ** END OF RUN :  997

*********************************************************************************************





 RUN#:COMMAND#
R0998:C00001---------------------------------------------------------------------------------------
     START
      [TZERO =    .00 hrs on        0]
      [METOUT=   2    (1=imperial, 2=metric output)]
      [NSTORM=   1 ]
      [NRUN  = 0998 ]
#******************************************************************************
#  SWMHYMO Ver:5.02/Jan 2001 <BETA> / INPUT DATA FILE
#******************************************************************************
#  Project Name  : [Stittsville South - Davidson Co-Tenancy]
#  Project Number: [1123-13]
#  Date          : 2015/05/06
#  Modeller      : Laura Pipkins, P.Eng.
#  Updated       : 2016/08/24 [LP]
#  Updated       : 2017/02/13 [LP]
#  Updated       : 2017/03/22 [LP]
#  Updated       : 2017/09/13 [LP]
#  Updated       : 2017/09/18 [LP]
#  Updated       : 2023/07/04 [LP]
#  Updated       : 2023/07/12 [LP]
#  Updated       : 2023/09/25 [LP]
#  Company       : J.F. Sabourin and Associates
#  License #     : 2582634
#******************************************************************************
R0998:C00002---------------------------------------------------------------------------------------
     READ STORM
      Filename = storm.001
      Comment  = CHICAGO STORM + 20% Stress Test  100 Year, 3 Hours
      [SDT=10.00:SDUR=   3.00:PTOT=  86.00]
R0998:C00003---------------------------------------------------------------------------------------
     DEFAULT VALUES
      Filename = T:\PROJ\1123-13\201709 PDB Subm2\Design\SWMHYMO\202309 Add Area\Ottawa.val
      ICASEdv  = 1 (read and print data)
      FileTitle= File comment: [Parameters for City of Ottawa Projects]
                 THE FOLLOWING PARAMETERS ARE USED IN THE DESIGN STANDHYD COM
      Horton's infiltration equation parameters:
      [Fo= 76.20 mm/hr] [Fc=13.20 mm/hr] [DCAY= 4.14 /hr] [F=  .00 mm]
      Parameters for PERVIOUS surfaces in STANDHYD:
      [IAper=   4.67 mm] [LGP=40.00 m] [MNP= .250]
      Parameters for IMPERVIOUS surfaces in STANDHYD:
      [IAimp=   1.57 mm] [CLI= 1.50]   [MNI= .013]
      Parameters used in NASHYD:
      [Ia=   4.67 mm] [N= 3.00]
      Average monthly Pan Evaporation data in     (mm)
   JAN   FEB   MAR   APR   MAY   JUN   JUL   AUG   SEP   OCT   NOV   DEC
   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00
      Average monthly Potential Evapotranspiration in     (mm)
   JAN   FEB   MAR   APR   MAY   JUN   JUL   AUG   SEP   OCT   NOV   DEC
   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00
#
################################################################################
# PROPOSED DEVELOPMENT - FREE OUTFALL HYDROGRAPHS
################################################################################
# Minor system hydrograph provided September 2017 by IBI Group
R0998:C00004------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    READ HYD              1.0 01:Min           37.55    8.192 No_date    1:14   63.89  n/a     .000
      Filename = T:\PROJ\1123-13\201709 PDB Subm2\Design\SWMHYMO\202309 Add Area\Min
      Comment  = MINOR SYSTEM FLOW FROM DAVIDSON CO-TENANCY (SEPTEMBER 2017,
# Major system hydrograph provided September 2017 by IBI Group
R0998:C00005------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    READ HYD             10.0 01:Maj             .00     .718 No_date    1:10********  n/a     .000
      Filename = T:\PROJ\1123-13\201709 PDB Subm2\Design\SWMHYMO\202309 Add Area\Maj
      Comment  = MAJOR SYSTEM FLOW FROM DAVIDSON CO-TENANCY (SEPTEMBER 2017,
################################################################################
# PROPOSED POND BLOCK
################################################################################
# Drainage area characteristics as per base plan provided by DSEL
R0998:C00006------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    DESIGN STANDHYD       1.0 01:Pond           3.07    1.019 No_date    1:01   60.68 .706     .000
      [XIMP=.45:TIMP=.45]
      [SLP= .50:DT= 1.00]
      [LOSS= 1 : HORTONS]
# Proposed Additional Area Requested by DSEL, September 2023
R0998:C00007------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    DESIGN STANDHYD       1.0 01:Addl           4.13    1.779 No_date    1:00   71.34 .830     .000
      [XIMP=.66:TIMP=.71]
      [SLP= .50:DT= 1.00]
      [LOSS= 1 : HORTONS]
################################################################################
# TOTAL INFLOWS TO SWM FACILITY
################################################################################
R0998:C00008------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ADD HYD               1.0 02:Min           37.55    8.192 No_date    1:14   63.89  n/a     .000
                     +   10.0 02:Maj             .00     .718 No_date    1:10********  n/a     .000
                     +    1.0 02:Pond           3.07    1.019 No_date    1:01   60.68  n/a     .000
                     +    1.0 02:Addl           4.13    1.779 No_date    1:00   71.34  n/a     .000
                  SUM=    1.0 01:Pin           44.75   10.148 No_date    1:12   66.52  n/a     .000
################################################################################
# SWM FACILITY
################################################################################
# Quality control and permanent pool requirements based on MOE guidelines
# for enhanced quality control for wet ponds. Extended detention of the 25 mm
# runoff volume for 72 hours estimated for unknown erosion control requirements.
# 2-, 5- and 100-year target release rates as per Table 3 of the April 2016
# "Faulkner Drain Hydrotechnical Update" by Novatech.
# Free Outfall Conditions
R0998:C00009------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ROUTE RESERVOIR ->    1.0 02:Pin           44.75   10.148 No_date    1:12   66.52  n/a     .000
                out <=    1.0 01:PFout         44.75     .647 No_date    2:26   66.51  n/a     .000
           overflow <=    1.0 03:PFovf           .00     .000 No_date    0:00     .00  n/a     .000
     {MxStoUsed=.2647E+01  m3, TotOvfVol=.0000E+00  m3, N-Ovf=    0, TotDurOvf=    0.hrs}
# Restrictive Downstream Conditions (100-Year D/S Water Level = 102.77 m)
R0998:C00010------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ROUTE RESERVOIR ->    1.0 02:Pin           44.75   10.148 No_date    1:12   66.52  n/a     .000
 *              out <=    1.0 01:PRout         44.75     .565 No_date    2:32   31.59  n/a     .000
           overflow <=    1.0 03:PRovf           .00     .000 No_date    0:00     .00  n/a     .000
     {MxStoUsed=.2740E+01  m3, TotOvfVol=.0000E+00  m3, N-Ovf=    0, TotDurOvf=    0.hrs}
# Restrictive Downstream Conditions (100-Year D/S Water Level = 102.77 m)
# 100% Blockage of Drop Inlet Structure
R0998:C00011------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ROUTE RESERVOIR ->    1.0 02:Pin           44.75   10.148 No_date    1:12   66.52  n/a     .000
 *              out <=    1.0 01:PRBout        44.75     .131 No_date    3:11    3.93  n/a     .000
           overflow <=    1.0 03:PRBovf          .00     .000 No_date    0:00     .00  n/a     .000
     {MxStoUsed=.2934E+01  m3, TotOvfVol=.0000E+00  m3, N-Ovf=    0, TotDurOvf=    0.hrs}
################################################################################
# SAVE HYDs
################################################################################
# Save Pond Inflow Hydrograph For Use In Preparing Pond Stage-Time Curves
# For Use in IBI Group's HGL Analysis of the Upstream Subdivision
#SAVE HYD            NHYD=["Pin"],  # OF PCYCLES=[-1],  ICASEsh=[1]
#                    HYD_COMMENT=["Pond Inflow"]
# Save Pond Outflow Hydrograph For Use In Calculating Average Velocity in the
# Forebay During the 10-Year Storm
#SAVE HYD            NHYD=["PFout"],  # OF PCYCLES=[-1],  ICASEsh=[1]
#                    HYD_COMMENT=["Pond Outfow - Free Outfall Conditions"]
# Save Pond Outflow Hydrograph For Use In Preparing Pond Stage-Time Curves
# For Use in IBI Group's HGL Analysis of the Upstream Subdivision
#SAVE HYD            NHYD=["PRout"],  # OF PCYCLES=[-1],  ICASEsh=[1]
#                    HYD_COMMENT=["Pond Outfow - Restrictive D/S Conditions"]
################################################################################
# CHECK CAPACITIES OF OVERLAND FLOW ROUTE INTO POND AND OUTLET CHANNEL FROM POND
################################################################################
# Overland Flow Route Capacity
R0998:C00012------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ROUTE CHANNEL   ->   10.0 02:Maj             .00     .718 No_date    1:10********  n/a     .000
 *   [RDT= 1.00] out<-    1.0 01:OVL_FR          .00     .713 No_date    1:10********  n/a     .000
      [L/S/n=   10./ .700/.030]
      {Vmax=  .641:Dmax=  .234}
# Outlet Channel Capacity
R0998:C00013------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ROUTE CHANNEL   ->    1.0 02:PFout         44.75     .647 No_date    2:26   66.51  n/a     .000
 *   [RDT= 1.00] out<-    1.0 01:PFchan        44.75     .647 No_date    2:34   66.51  n/a     .000
      [L/S/n=   10./ .100/.035]
      {Vmax=  .301:Dmax=  .767}
################################################################################
# STORMS
################################################################################
  ** END OF RUN :  998

*********************************************************************************************





 RUN#:COMMAND#
R0999:C00001---------------------------------------------------------------------------------------
     START
      [TZERO =    .00 hrs on        0]
      [METOUT=   2    (1=imperial, 2=metric output)]
      [NSTORM=   1 ]
      [NRUN  = 0999 ]
#******************************************************************************
#  SWMHYMO Ver:5.02/Jan 2001 <BETA> / INPUT DATA FILE
#******************************************************************************
#  Project Name  : [Stittsville South - Davidson Co-Tenancy]
#  Project Number: [1123-13]
#  Date          : 2015/05/06
#  Modeller      : Laura Pipkins, P.Eng.
#  Updated       : 2016/08/24 [LP]
#  Updated       : 2017/02/13 [LP]
#  Updated       : 2017/03/22 [LP]
#  Updated       : 2017/09/13 [LP]
#  Updated       : 2017/09/18 [LP]
#  Updated       : 2023/07/04 [LP]
#  Updated       : 2023/07/12 [LP]
#  Updated       : 2023/09/25 [LP]
#  Company       : J.F. Sabourin and Associates
#  License #     : 2582634
#******************************************************************************
R0999:C00002---------------------------------------------------------------------------------------
     READ STORM
      Filename = storm.001
      Comment  = 100 years SCS Type 2 Storm 24 Hours + 20% Stress Test step 10 min,
      [SDT=10.00:SDUR=  24.00:PTOT= 128.06]
R0999:C00003---------------------------------------------------------------------------------------
     DEFAULT VALUES
      Filename = T:\PROJ\1123-13\201709 PDB Subm2\Design\SWMHYMO\202309 Add Area\Ottawa.val
      ICASEdv  = 1 (read and print data)
      FileTitle= File comment: [Parameters for City of Ottawa Projects]
                 THE FOLLOWING PARAMETERS ARE USED IN THE DESIGN STANDHYD COM
      Horton's infiltration equation parameters:
      [Fo= 76.20 mm/hr] [Fc=13.20 mm/hr] [DCAY= 4.14 /hr] [F=  .00 mm]
      Parameters for PERVIOUS surfaces in STANDHYD:
      [IAper=   4.67 mm] [LGP=40.00 m] [MNP= .250]
      Parameters for IMPERVIOUS surfaces in STANDHYD:
      [IAimp=   1.57 mm] [CLI= 1.50]   [MNI= .013]
      Parameters used in NASHYD:
      [Ia=   4.67 mm] [N= 3.00]
      Average monthly Pan Evaporation data in     (mm)
   JAN   FEB   MAR   APR   MAY   JUN   JUL   AUG   SEP   OCT   NOV   DEC
   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00
      Average monthly Potential Evapotranspiration in     (mm)
   JAN   FEB   MAR   APR   MAY   JUN   JUL   AUG   SEP   OCT   NOV   DEC
   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00   .00
#
################################################################################
# PROPOSED DEVELOPMENT - FREE OUTFALL HYDROGRAPHS
################################################################################
# Minor system hydrograph provided September 2017 by IBI Group
R0999:C00004------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    READ HYD              1.0 01:Min           37.55    7.815 No_date   11:59   74.80  n/a     .000
      Filename = T:\PROJ\1123-13\201709 PDB Subm2\Design\SWMHYMO\202309 Add Area\Min
      Comment  = MINOR SYSTEM FLOW FROM DAVIDSON CO-TENANCY (SEPTEMBER 2017,
# Major system hydrograph provided September 2017 by IBI Group
R0999:C00005------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    READ HYD             10.0 01:Maj             .00    1.873 No_date   11:50********  n/a     .000
      Filename = T:\PROJ\1123-13\201709 PDB Subm2\Design\SWMHYMO\202309 Add Area\Maj
      Comment  = MAJOR SYSTEM FLOW FROM DAVIDSON CO-TENANCY (SEPTEMBER 2017,
################################################################################
# PROPOSED POND BLOCK
################################################################################
# Drainage area characteristics as per base plan provided by DSEL
R0999:C00006------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    DESIGN STANDHYD       1.0 01:Pond           3.07     .917 No_date   12:00   81.43 .636     .000
      [XIMP=.45:TIMP=.45]
      [SLP= .50:DT= 1.00]
      [LOSS= 1 : HORTONS]
# Proposed Additional Area Requested by DSEL, September 2023
R0999:C00007------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    DESIGN STANDHYD       1.0 01:Addl           4.13    1.437 No_date   12:00   99.47 .777     .000
      [XIMP=.66:TIMP=.71]
      [SLP= .50:DT= 1.00]
      [LOSS= 1 : HORTONS]
################################################################################
# TOTAL INFLOWS TO SWM FACILITY
################################################################################
R0999:C00008------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ADD HYD               1.0 02:Min           37.55    7.815 No_date   11:59   74.80  n/a     .000
                     +   10.0 02:Maj             .00    1.873 No_date   11:50********  n/a     .000
                     +    1.0 02:Pond           3.07     .917 No_date   12:00   81.43  n/a     .000
                     +    1.0 02:Addl           4.13    1.437 No_date   12:00   99.47  n/a     .000
                  SUM=    1.0 01:Pin           44.75   10.516 No_date   11:56   80.07  n/a     .000
################################################################################
# SWM FACILITY
################################################################################
# Quality control and permanent pool requirements based on MOE guidelines
# for enhanced quality control for wet ponds. Extended detention of the 25 mm
# runoff volume for 72 hours estimated for unknown erosion control requirements.
# 2-, 5- and 100-year target release rates as per Table 3 of the April 2016
# "Faulkner Drain Hydrotechnical Update" by Novatech.
# Free Outfall Conditions
R0999:C00009------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ROUTE RESERVOIR ->    1.0 02:Pin           44.75   10.516 No_date   11:56   80.07  n/a     .000
                out <=    1.0 01:PFout         44.75     .781 No_date   12:48   80.07  n/a     .000
           overflow <=    1.0 03:PFovf           .00     .000 No_date    0:00     .00  n/a     .000
     {MxStoUsed=.2887E+01  m3, TotOvfVol=.0000E+00  m3, N-Ovf=    0, TotDurOvf=    0.hrs}
# Restrictive Downstream Conditions (100-Year D/S Water Level = 102.77 m)
R0999:C00010------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ROUTE RESERVOIR ->    1.0 02:Pin           44.75   10.516 No_date   11:56   80.07  n/a     .000
 *              out <=    1.0 01:PRout         44.75     .891 No_date   12:45   45.14  n/a     .000
           overflow <=    1.0 03:PRovf           .00     .000 No_date    0:00     .00  n/a     .000
     {MxStoUsed=.3000E+01  m3, TotOvfVol=.0000E+00  m3, N-Ovf=    0, TotDurOvf=    0.hrs}
# Restrictive Downstream Conditions (100-Year D/S Water Level = 102.77 m)
# 100% Blockage of Drop Inlet Structure
R0999:C00011------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ROUTE RESERVOIR ->    1.0 02:Pin           44.75   10.516 No_date   11:56   80.07  n/a     .000
 *              out <=    1.0 01:PRBout        44.75     .531 No_date   13:02   17.48  n/a     .000
           overflow <=    1.0 03:PRBovf          .00     .000 No_date    0:00     .00  n/a     .000
     {MxStoUsed=.3124E+01  m3, TotOvfVol=.0000E+00  m3, N-Ovf=    0, TotDurOvf=    0.hrs}
################################################################################
# SAVE HYDs
################################################################################
# Save Pond Inflow Hydrograph For Use In Preparing Pond Stage-Time Curves
# For Use in IBI Group's HGL Analysis of the Upstream Subdivision
#SAVE HYD            NHYD=["Pin"],  # OF PCYCLES=[-1],  ICASEsh=[1]
#                    HYD_COMMENT=["Pond Inflow"]
# Save Pond Outflow Hydrograph For Use In Calculating Average Velocity in the
# Forebay During the 10-Year Storm
#SAVE HYD            NHYD=["PFout"],  # OF PCYCLES=[-1],  ICASEsh=[1]
#                    HYD_COMMENT=["Pond Outfow - Free Outfall Conditions"]
# Save Pond Outflow Hydrograph For Use In Preparing Pond Stage-Time Curves
# For Use in IBI Group's HGL Analysis of the Upstream Subdivision
#SAVE HYD            NHYD=["PRout"],  # OF PCYCLES=[-1],  ICASEsh=[1]
#                    HYD_COMMENT=["Pond Outfow - Restrictive D/S Conditions"]
################################################################################
# CHECK CAPACITIES OF OVERLAND FLOW ROUTE INTO POND AND OUTLET CHANNEL FROM POND
################################################################################
# Overland Flow Route Capacity
R0999:C00012------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ROUTE CHANNEL   ->   10.0 02:Maj             .00    1.873 No_date   11:50********  n/a     .000
 *   [RDT= 1.00] out<-    1.0 01:OVL_FR          .00    1.844 No_date   11:50********  n/a     .000
      [L/S/n=   10./ .700/.030]
      {Vmax=  .805:Dmax=  .329}
# Outlet Channel Capacity
R0999:C00013------------DTmin-ID:NHYD---------AREAha-QPEAKcms-TpeakDate_hh:mm----RVmm-R.C.---DWFcms
    ROUTE CHANNEL   ->    1.0 02:PFout         44.75     .781 No_date   12:48   80.07  n/a     .000
 *   [RDT= 1.00] out<-    1.0 01:PFchan        44.75     .781 No_date   12:50   80.07  n/a     .000
      [L/S/n=   10./ .100/.035]
      {Vmax=  .311:Dmax=  .835}
################################################################################
# STORMS
################################################################################
R0999:C00002---------------------------------------------------------------------------------------
    FINISH
---------------------------------------------------------------------------------------------------
***************************************************************************************************
     WARNINGS / ERRORS / NOTES
     -------------------------
R0001:C00005  READ HYD
*** NOTE: The hydrograph which was read is dry.
R0001:C00010  ROUTE RESERVOIR
*** WARNING: Outflow volume is less than inflow volume.
R0001:C00011  ROUTE RESERVOIR
*** WARNING: Outflow volume is less than inflow volume.
R0001:C00012  ROUTE CHANNEL   ->
*** WARNING: Inflow hydrograph is dry!  Routing not done!
R0002:C00005  READ HYD
*** NOTE: The hydrograph which was read is dry.
R0002:C00010  ROUTE RESERVOIR
*** WARNING: Outflow volume is less than inflow volume.
R0002:C00011  ROUTE RESERVOIR
*** WARNING: Outflow volume is less than inflow volume.
R0002:C00012  ROUTE CHANNEL   ->
*** WARNING: Inflow hydrograph is dry!  Routing not done!
R0005:C00005  READ HYD
*** NOTE: The hydrograph which was read is dry.
R0005:C00010  ROUTE RESERVOIR
*** WARNING: Outflow volume is less than inflow volume.
R0005:C00011  ROUTE RESERVOIR
*** WARNING: Outflow volume is less than inflow volume.
R0005:C00012  ROUTE CHANNEL   ->
*** WARNING: Inflow hydrograph is dry!  Routing not done!
R0099:C00010  ROUTE RESERVOIR
```

```
02881> *** WARNING: Outflow volume is less than inflow volume.
02882> R0099:C00011  ROUTE RESERVOIR
02883> *** WARNING: Outflow volume is less than inflow volume.
02884> R0102:C00005  READ HYD
02885> *** NOTE: The hydrograph which was read is dry.
02886> R0102:C00010  ROUTE RESERVOIR
02887> *** WARNING: Outflow volume is less than inflow volume.
02888> R0102:C00011  ROUTE RESERVOIR
02889> *** WARNING: Outflow volume is less than inflow volume.
02890> R0102:C00012  ROUTE CHANNEL   ->
02891> *** WARNING: Inflow hydrograph is dry!  Routing not done!
02892> R0105:C00005  READ HYD
02893> *** NOTE: The hydrograph which was read is dry.
02894> R0105:C00010  ROUTE RESERVOIR
02895> *** WARNING: Outflow volume is less than inflow volume.
02896> R0105:C00011  ROUTE RESERVOIR
02897> *** WARNING: Outflow volume is less than inflow volume.
02898> R0105:C00012  ROUTE CHANNEL   ->
02899> *** WARNING: Inflow hydrograph is dry!  Routing not done!
02900> R0199:C00010  ROUTE RESERVOIR
02901> *** WARNING: Outflow volume is less than inflow volume.
02902> R0199:C00011  ROUTE RESERVOIR
02903> *** WARNING: Outflow volume is less than inflow volume.
02904> R0202:C00005  READ HYD
02905> *** NOTE: The hydrograph which was read is dry.
02906> R0202:C00010  ROUTE RESERVOIR
02907> *** WARNING: Outflow volume is less than inflow volume.
02908> R0202:C00011  ROUTE RESERVOIR
02909> *** WARNING: Outflow volume is less than inflow volume.
02910> R0202:C00012  ROUTE CHANNEL   ->
02911> *** WARNING: Inflow hydrograph is dry!  Routing not done!
02912> R0205:C00005  READ HYD
02913> *** NOTE: The hydrograph which was read is dry.
02914> R0205:C00010  ROUTE RESERVOIR
02915> *** WARNING: Outflow volume is less than inflow volume.
02916> R0205:C00011  ROUTE RESERVOIR
02917> *** WARNING: Outflow volume is less than inflow volume.
02918> R0205:C00012  ROUTE CHANNEL   ->
02919> *** WARNING: Inflow hydrograph is dry!  Routing not done!
02920> R0210:C00005  READ HYD
02921> *** NOTE: The hydrograph which was read is dry.
02922> R0210:C00010  ROUTE RESERVOIR
02923> *** WARNING: Outflow volume is less than inflow volume.
02924> R0210:C00011  ROUTE RESERVOIR
02925> *** WARNING: Outflow volume is less than inflow volume.
02926> R0210:C00012  ROUTE CHANNEL   ->
02927> *** WARNING: Inflow hydrograph is dry!  Routing not done!
02928> R0225:C00010  ROUTE RESERVOIR
02929> *** WARNING: Outflow volume is less than inflow volume.
02930> R0225:C00011  ROUTE RESERVOIR
02931> *** WARNING: Outflow volume is less than inflow volume.
02932> R0250:C00010  ROUTE RESERVOIR
02933> *** WARNING: Outflow volume is less than inflow volume.
02934> R0250:C00011  ROUTE RESERVOIR
02935> *** WARNING: Outflow volume is less than inflow volume.
02936> R0299:C00010  ROUTE RESERVOIR
02937> *** WARNING: Outflow volume is less than inflow volume.
02938> R0299:C00011  ROUTE RESERVOIR
02939> *** WARNING: Outflow volume is less than inflow volume.
02940> R0979:C00010  ROUTE RESERVOIR
02941> *** WARNING: Outflow volume is less than inflow volume.
02942> R0979:C00011  ROUTE RESERVOIR
02943> *** WARNING: Outflow volume is less than inflow volume.
02944> R0988:C00010  ROUTE RESERVOIR
02945> *** WARNING: Outflow volume is less than inflow volume.
02946> R0988:C00011  ROUTE RESERVOIR
02947> *** WARNING: Outflow volume is less than inflow volume.
02948> R0996:C00010  ROUTE RESERVOIR
02949> *** WARNING: Outflow volume is less than inflow volume.
02950> R0996:C00011  ROUTE RESERVOIR
02951> *** WARNING: Outflow volume is less than inflow volume.
02952> R0998:C00010  ROUTE RESERVOIR
02953> *** WARNING: Outflow volume is less than inflow volume.
02954> R0998:C00011  ROUTE RESERVOIR
02955> *** WARNING: Outflow volume is less than inflow volume.
02956> R0999:C00010  ROUTE RESERVOIR
02957> *** WARNING: Outflow volume is less than inflow volume.
02958> R0999:C00011  ROUTE RESERVOIR
02959> *** WARNING: Outflow volume is less than inflow volume.
02960>    Simulation ended on 2023-09-25     at 23:42:11
02961> ================================================================================
02962>
```

DRAFT

STORM SEWER CALCULATION SHEET (RATIONAL METHOD)

Local Roads Return Frequency = 2 years
Collector Roads Return Frequency = 5 years
Manning 0.013 Arterial Roads Return Frequency = 10 years

	LOCATION		AREA (Ha)														FLOW						SEWER DATA								
			2 YEAR				5 YEAR				10 YEAR				100 YEAR				Time of	Intensity	Intensity	Intensity	Intensity	Peak Flow	DIA. (mm)	DIA. (mm)	TYPE	SLOPE	LENGTH	CAPACITY	VELOCITY	TIME OF	RATIO
			AREA	R	Indiv.	Accum.	AREA	R	Indiv.	Accum.	AREA	R	Indiv.	Accum.	AREA	R	Indiv.	Accum.	Conc.	2 Year	5 Year	10 Year	100 Year										
Location	From Node	To Node	(Ha)		2.78 AC	2.78 AC	(Ha)		2.78 AC	2.78 AC	(Ha)		2.78 AC	2.78 AC	(Ha)		2.78 AC	2.78 AC	(min)	(mm/h)	(mm/h)	(mm/h)	(mm/h)	Q (l/s)	(actual)	(nominal)		(%)	(m)	(l/s)	(m/s)	LOW (min	Q/Q full
STM TRUNK 1																																
					0.00	0.00	0.00	0.00	0.00	0.00			0.00	0.00			0.00	0.00	15.17														
	112	116	5.24	0.68	9.91	9.91			0.00	0.00			0.00	0.00			0.00	0.00	15.17	61.37	83.01	97.21	141.96	608	825	825	CONC	0.30	56.0	786.2205	1.4708	0.6346	0.773
					0.00	9.91	0.00	0.00	0.00	0.00			0.00	0.00			0.00	0.00	12.91														
	116	120	1.62	0.68	3.06	12.97			0.00	0.00			0.00	0.00			0.00	0.00	15.80	59.93	81.05	94.90	138.56	777	975	975	CONC	0.20	60.0	#######	1.3424	0.7450	0.775
					0.00	12.97	0.00	0.00	0.00	0.00			0.00	0.00			0.00	0.00	14.26														
	120	124	1.80	0.68	3.40	16.37			0.00	0.00			0.00	0.00			0.00	0.00	16.55	58.34	78.87	92.34	134.80	955	1200	1200	CONC	0.15	60.0	#######	1.3351	0.7490	0.632
					0.00	16.37	0.00	0.00	0.00	0.00			0.00	0.00			0.00	0.00	14.23														
	124	139	1.73	0.68	3.27	19.64			0.00	0.00			0.00	0.00			0.00	0.00	17.30	56.83	76.80	89.91	131.24	1116	1200	1200	CONC	0.15	64.0	#######	1.3351	0.7989	0.739
					0.00	19.64	0.00	0.00	0.00	0.00			0.00	0.00			0.00	0.00	16.78														
	139	140	4.93	0.68	9.32	28.96			0.00	0.00			0.00	0.00			0.00	0.00	18.10	55.31	74.73	87.47	127.66	1602	1350	1350	CONC	0.15	59.0	#######	1.4442	0.6809	0.775
	140	143			0.00	28.96	0.08	0.68	0.15	0.15			0.00	0.00			0.00	0.00	18.78	54.08	73.05	85.50	124.78	1577	1500	1500	CONC	0.15	40.0	#######	1.5493	0.4303	0.576
					0.00	28.96	0.00	0.00	0.00	0.15			0.00	0.00			0.00	0.00	12.77														
					0.00	28.96	0.78	0.68	1.47	1.63			0.00	0.00			0.00	0.00															
			1.70	0.68	3.21	32.17			0.00	1.63			0.00	0.00			0.00	0.00															
	143	1002	2.70	0.80	6.00	38.18			0.00	1.63			0.00	0.00			0.00	0.00	19.21	53.34	72.04	84.31	123.03	2154	1500	1500	CONC	0.15	52.0	#######	1.5493	0.5594	0.787
	1002	HW1			0.00	38.18			0.00	1.63			0.00	0.00			0.00	0.00	19.77	52.41	70.77	82.82	120.84	2116	1500	1500	CONC	0.15	17.0	#######	1.5493	0.1829	0.773
STM TRUNK 2																																
					0.00	0.00	0.00	0.00	0.00	0.00			0.00	0.00			0.00	0.00	14.82														
	231	232	4.38	0.68	8.28	8.28			0.00	0.00			0.00	0.00			0.00	0.00	14.82	62.20	84.15	98.55	143.91	515	975	975	CONC	0.20	54.5	#######	1.3424	0.6767	0.514
	232	235	0.02	0.68	0.04	8.32			0.00	0.00			0.00	0.00			0.00	0.00	15.50	60.62	81.99	96.01	140.19	504	1050	1050	CONC	0.15	15.0	#######	1.2214	0.2047	0.477
					0.00	8.32	0.00	0.00	0.00	0.00			0.00	0.00			0.00	0.00	12.53														
	235	236	0.90	0.68	1.70	10.02			0.00	0.00			0.00	0.00			0.00	0.00	15.70	60.16	81.36	95.27	139.11	603	1050	1050	CONC	0.15	15.5	#######	1.2214	0.2115	0.570
	236	237	0.54	0.68	1.02	11.04			0.00	0.00			0.00	0.00			0.00	0.00	15.91	59.70	80.72	94.52	138.00	659	1050	1050	CONC	0.15	82.0	#######	1.2214	1.1189	0.623
	237	240	0.42	0.68	0.79	11.83			0.00	0.00			0.00	0.00			0.00	0.00	17.03	57.36	77.52	90.76	132.49	679	1050	1050	CONC	0.15	86.0	#######	1.2214	1.1735	0.642
					0.00	11.83	0.00	0.00	0.00	0.00			0.00	0.00			0.00	0.00	23.09														
					0.00	11.83	0.00	0.00	0.00	0.00			0.00	0.00			0.00	0.00															
					0.00	11.83	0.93	0.40	1.03	1.03			0.00	0.00			0.00	0.00															
					0.00	11.83	1.38	0.68	2.61	3.64			0.00	0.00			0.00	0.00															
	240	HW2	3.47	0.68	6.56	18.39			0.00	3.64			0.00	0.00			0.00	0.00	23.09	47.54	64.12	75.01	109.40	1108	1350	1350	CONC	0.25	58.0	#######	1.8644	0.5185	0.415
STM TRUNK 3																																
					0.00	0.00	0.00	0.00	0.00	0.00			0.00	0.00			0.00	0.00	14.35														
	306	307	1.79	0.68	3.38	3.38			0.00	0.00			0.00	0.00			0.00	0.00	14.35	63.34	85.70	100.38	146.60	214	675	675	CONC	0.15	84.0	325.5584	0.9098	1.5389	0.658
	307	308	0.51	0.68	0.96	4.35			0.00	0.00			0.00	0.00			0.00	0.00	15.89	59.74	80.78	94.59	138.10	260	675	675	CONC	0.20	84.0	375.9224	1.0505	1.3327	0.691
	308	313			0.00	4.35			0.00	0.00			0.00	0.00			0.00	0.00	17.23	56.97	76.99	90.14	131.57	248	750	750	CONC	0.20	5.0	497.8726	1.1270	0.0739	0.498
					0.00	4.35	0.00	0.00	0.00	0.00			0.00	0.00			0.00	0.00	13.71														
					0.00	4.35	0.73	0.40	0.81	0.81			0.00	0.00			0.00	0.00															
	313	314	1.06	0.68	2.00	6.35			0.00	0.81			0.00	0.00			0.00	0.00	17.30	56.82	76.80	89.90	131.23	423	825	825	CONC	0.20	37.5	641.9463	1.2009	0.5205	0.659
	314	HW3			0.00	6.35			0.00	0.81			0.00	0.00			0.00	0.00	17.82	55.82	75.43	88.30	128.88	416	900	900	CONC	0.15	25.0	701.1305	1.1021	0.3781	0.593
STM TRUNK 4																																
					0.00	0.00	0.00	0.00	0.00	0.00			0.00	0.00			0.00	0.00	13.54														
			0.40	0.68	0.76	0.76			0.00	0.00			0.00	0.00			0.00	0.00															
					0.00	0.76	0.48	0.68	0.91	0.91			0.00	0.00			0.00	0.00															
			1.53	0.80	3.40	4.16			0.00	0.91			0.00	0.00			0.00	0.00															
	405	406			0.00	4.16	1.91	0.40	2.12	3.03			0.00	0.00			0.00	0.00	13.54	65.43	88.58	103.76	151.57	541	825	825	CONC	0.20	39.0	641.9463	1.2009	0.5413	0.842
	406	412			0.00	4.16	0.04	0.68	0.08	3.11			0.00	0.00			0.00	0.00	14.08	64.02	86.64	101.47	148.21	535	825	825	CONC	0.20	21.0	641.9463	1.2009	0.2915	0.834
					0.00	4.16	0.00	0.00	0.00	3.11			0.00	0.00			0.00	0.00	14.34														
					0.00	4.16	0.11	0.68	0.21	3.31			0.00	0.00			0.00	0.00															
	412	413	1.66	0.68	3.14	7.30			0.00	3.31			0.00	0.00			0.00	0.00	14.38	63.28	85.63	100.29	146.47	746	1200	1200	CONC	0.15	73.5	#######	1.3351	0.9175	0.494
	413	414	0.44	0.68	0.83	8.13			0.00	3.31			0.00	0.00			0.00	0.00	15.29	61.08	82.62	96.75	141.28	770	1200	1200	CONC	0.15	74.0	#######	1.3351	0.9238	0.510
	414	415	0.15	0.68	0.28	8.41			0.00	3.31			0.00	0.00			0.00	0.00	16.22	59.04	79.82	93.46	136.45	761	1200	1200	CONC	0.15	9.5	#######	1.3351	0.1186	0.504
	415	430	0.18	0.68	0.34	8.75			0.00	3.31			0.00	0.00			0.00	0.00	16.34	58.78	79.48	93.05	135.85	778	1200	1200	CONC	0.15	48.5	#######	1.3351	0.6054	0.515

Definitions:
Q = 2.78 AIR, where
Q = Peak Flow in Litres per second (L/s)
A = Areas in hectares (ha)
I = Rainfall Intensity (mm/h)
R = Runoff Coefficient

Notes:
1) Ottawa Rainfall-Intensity Curve
2) Min. Velocity = 0.80 m/s

Designed: V.W.
Checked: W.L.
Dwg. Reference:

PROJECT: **1247- Stittsville South Uban Expansion Area**
LOCATION: **City of Ottawa**
File Ref: | Date: 31 Jul 2024 | Sheet No. SHEET 1 OF 2

STORM SEWER CALCULATION SHEET (RATIONAL METHOD)

Local Roads Return Frequency = 2 years
Collector Roads Return Frequency = 5 years
Manning 0.013 Arterial Roads Return Frequency = 10 years

	LOCATION		AREA (Ha)														FLOW						SEWER DATA								
			2 YEAR				5 YEAR				10 YEAR				100 YEAR				Time of	Intensity	Intensity	Intensity	Intensity	Peak Flow	DIA. (mm)	DIA. (mm)	TYPE	SLOPE	LENGTH	CAPACITY	VELOCITY	TIME OF	RATIO
			AREA	R	Indiv.	Accum.	AREA	R	Indiv.	Accum.	AREA	R	Indiv.	Accum.	AREA	R	Indiv.	Accum.	Conc.	2 Year	5 Year	10 Year	100 Year										
Location	From Node	To Node	(Ha)		2.78 AC	2.78 AC	(Ha)		2.78 AC	2.78 AC	(Ha)		2.78 AC	2.78 AC	(Ha)		2.78 AC	2.78 AC	(min)	(mm/h)	(mm/h)	(mm/h)	(mm/h)	Q (l/s)	(actual)	(nominal)		(%)	(m)	(l/s)	(m/s)	LOW (min	Q/Q full
					0.00	8.75	0.00	0.00	0.00	3.31			0.00	0.00			0.00	0.00	16.48														
					0.00	8.75	0.00	0.00	0.00	3.31			0.00	0.00			0.00	0.00	16.48														
					0.00	8.75	0.00	0.00	0.00	3.31			0.00	0.00			0.00	0.00															
			1.77	0.68	3.35	12.10			0.00	3.31			0.00	0.00			0.00	0.00															
			1.80	0.68	3.40	15.50			0.00	3.31			0.00	0.00			0.00	0.00															
	430	434			0.00	15.50	2.45	0.68	4.63	7.95			0.00	0.00			0.00	0.00	16.94	57.54	77.77	91.05	132.91	1510	1350	1350	CONC	0.15	64.5	#######	1.4442	0.7444	0.730
					0.00	15.50	0.00	0.00	0.00	7.95			0.00	0.00			0.00	0.00	11.45														
	434	435	0.98	0.68	1.85	17.35			0.00	7.95			0.00	0.00			0.00	0.00	17.69	56.08	75.78	88.71	129.47	1575	1350	1350	CONC	0.15	45.0	#######	1.4442	0.5193	0.762
	435	HW4			0.00	17.35			0.00	7.95			0.00	0.00			0.00	0.00	18.20	55.11	74.45	87.15	127.19	1548	1350	1350	CONC	0.15	26.5	#######	1.4442	0.3058	0.749
STM TRUNK 5																																	
					0.00	0.00	0.00	0.00	0.00	0.00			0.00	0.00			0.00	0.00	13.45														
	519	522	1.52	0.68	2.87	2.87			0.00	0.00			0.00	0.00			0.00	0.00	13.45	65.69	88.93	104.17	152.17	189	900	900	CONC	0.15	67.5	701.1305	1.1021	1.0208	0.269
					0.00	2.87	0.00	0.00	0.00	0.00			0.00	0.00			0.00	0.00	12.08														
					0.00	2.87	0.00	0.00	0.00	0.00			0.00	0.00			0.00	0.00	12.08														
					0.00	2.87	0.00	0.00	0.00	0.00			0.00	0.00			0.00	0.00	12.08														
					0.00	2.87	0.00	0.00	0.00	0.00			0.00	0.00			0.00	0.00	12.08														
					0.00	2.87	0.00	0.00	0.00	0.00			0.00	0.00			0.00	0.00	18.32														
					0.00	2.87	0.00	0.00	0.00	0.00			0.00	0.00			0.00	0.00	18.32														
			0.20	0.68	0.38	3.25			0.00	0.00			0.00	0.00			0.00	0.00															
			0.26	0.68	0.49	3.74			0.00	0.00			0.00	0.00			0.00	0.00															
					0.00	3.74	0.50	0.68	0.95	0.95			0.00	0.00			0.00	0.00															
					0.00	3.74	0.74	0.68	1.40	2.34			0.00	0.00			0.00	0.00															
			0.81	0.68	1.53	5.27			0.00	2.34			0.00	0.00			0.00	0.00															
	522	524	1.86	0.68	3.52	8.79			0.00	2.34			0.00	0.00			0.00	0.00	18.32	54.91	74.18	86.83	126.72	657	1200	1200	CONC	0.15	58.5	#######	1.3351	0.7303	0.435
					0.00	8.79	0.00	0.00	0.00	2.34			0.00	0.00			0.00	0.00	11.69														
	524	528	0.74	0.68	1.40	10.19			0.00	2.34			0.00	0.00			0.00	0.00	19.05	53.62	72.42	84.76	123.68	716	1200	1200	CONC	0.15	64.0	#######	1.3351	0.7989	0.474
					0.00	10.19	0.00	0.00	0.00	2.34			0.00	0.00			0.00	0.00	12.84														
	528	5320	0.84	0.68	1.59	11.78			0.00	2.34			0.00	0.00			0.00	0.00	19.84	52.28	70.59	82.61	120.54	781	1200	1200	CONC	0.15	61.0	#######	1.3351	0.7615	0.517
			0.34	0.68	0.64	12.42			0.00	2.34			0.00	0.00			0.00	0.00															
	5320	532	1.21	0.80	2.69	15.11			0.00	2.34			0.00	0.00			0.00	0.00	20.61	51.08	68.95	80.68	117.71	933	1200	1200	CONC	0.15	4.5	#######	1.3351	0.0562	0.618
					0.00	15.11	0.00	0.00	0.00	2.34			0.00	0.00			0.00	0.00	12.13														
	532	533	0.97	0.68	1.83	16.94			0.00	2.34			0.00	0.00			0.00	0.00	20.66	50.99	68.83	80.54	117.50	1025	1350	1350	CONC	0.15	68.5	#######	1.4442	0.7905	0.496
	533	HW5			0.00	16.94			0.00	2.34			0.00	0.00			0.00	0.00	21.45	49.81	67.22	78.64	114.72	1001	1350	1350	CONC	0.15	26.0	#######	1.4442	0.3001	0.484

Definitions:
Q = 2.78 AIR, where
Q = Peak Flow in Litres per second (L/s)
A = Areas in hectares (ha)
I = Rainfall Intensity (mm/h)
R = Runoff Coefficient

Notes:
1) Ottawa Rainfall-Intensity Curve
2) Min. Velocity = 0.80 m/s

Designed: V.W.
Checked: W.L.
Dwg. Reference:

PROJECT: **1247- Stittsville South Uban Expansion Area**
LOCATION: **City of Ottawa**
File Ref: Date: 31 Jul 2024 Sheet No. SHEET 2 OF 2