



Engineers, Planners & Landscape Architects

### Engineering

- Land/Site Development
- Municipal Infrastructure
- Environmental/Water Resources
- Traffic/Transportation
- Recreational

### Planning

- Land/Site Development
- Planning Application Management
- Municipal Planning
- Urban Design
- Expert Witness (LPAT)
- Wireless Industry

### Landscape Architecture

- Streetscapes & Public Amenities
- Open Space, Parks & Recreation
- Community & Residential
- Commercial & Institutional
- Environmental Restoration

## 2510 St. Laurent Boulevard, Ottawa

### Noise Impact Feasibility Report

Engineering excellence.

Planning progress.

Liveable landscapes.

2510 St. Laurent Boulevard

City of Ottawa

## **Noise Impact Feasibility Report**

Prepared By:

**NOVATECH**

Suite 200, 240 Michael Cowpland Drive  
Ottawa, Ontario  
K2M 1P6

Novatech File: 122040

Ref: R-2022-190

Submitted: November 1, 2022

Revised: September 29, 2023

Revised: October 31, 2025

October 31, 2025

City of Ottawa  
Planning and Infrastructure Approvals  
110 Laurier Street West, 4<sup>th</sup> Floor  
Ottawa, ON, K1P 1J1

**Attention: Kelby Lodoen Unseth, Planner II**

**Reference: 2510 St. Laurent Blvd  
Noise Impact Feasibility Report  
Our File No.: 122040**

---

Please find enclosed the 'Noise Impact Feasibility Report' for the above-noted development located in the City of Ottawa. This report is being submitted in support of the site plan application for the proposed development.

This report evaluates the environmental impact of noise from traffic and assesses the feasibility of mitigation measures to attenuate noise to acceptable levels.

Please contact the undersigned should you have any questions or comments pertaining to the enclosed report.

Yours truly,

**NOVATECH**



Greg MacDonald, P. Eng.  
Director, Land Development and Public Sector Infrastructure

cc: Vincent Denomme, Claridge

## Table of Contents

|            |                                               |          |
|------------|-----------------------------------------------|----------|
| <b>1.0</b> | <b>INTRODUCTION .....</b>                     | <b>1</b> |
| <b>2.0</b> | <b>NOISE CRITERIA AND NOISE SOURCES .....</b> | <b>2</b> |
| <b>3.0</b> | <b>PREDICTED NOISE LEVELS .....</b>           | <b>7</b> |
| <b>4.0</b> | <b>CONCLUSION .....</b>                       | <b>9</b> |

### Appendices

Appendix A: Excerpt From the City Of Ottawa Environmental Noise Control Guidelines, MOE's NPC-300, the City of Ottawa's Transportation Master Plan and Official Plan

Appendix B: Sound Level Calculations

### Tables

|                                                                                              |   |
|----------------------------------------------------------------------------------------------|---|
| Table 1: Permitted Noise Levels .....                                                        | 2 |
| Table 2: Noise Attenuation Requirements .....                                                | 5 |
| Table 3: Noise Sources .....                                                                 | 6 |
| Table 4. Predicted Noise Levels and Proposed Mitigation Measures -Outdoor Living Areas ..... | 7 |
| Table 5. Predicted Noise Levels and Proposed Mitigation Measures -Plan Of Windows .....      | 8 |

### Figures

|                                 |   |
|---------------------------------|---|
| Figure 1: Key Plan .....        | 1 |
| Figure 2: Node Location Plan    |   |
| Figure 3: Noise Mitigation Plan |   |

## 1.0 INTRODUCTION

This report is submitted on behalf of the developer, Claridge Homes, as part of Zoning By-Law Amendment, Site Plan Control, and Draft Plan of Condominium applications for the property located at 1900-1920 Walkley Road, 2425 Don Reid Drive, 2510 St. Laurent Boulevard, and 2990-3000 Conroy Road (referred to as 2510 St. Laurent Boulevard in this report). This report assesses the environmental impact of noise on the proposed development and outlines the recommended mitigation measures.

The subject site 5.89ha and is surrounded by the following roads:

- Walkley Road to the north,
- St. Laurent Boulevard to the south,
- Conroy Road to the east, and
- Don Reid Drive to the west.


An aerial of the subject site is provided in **Figure 1 – Key Plan – 2510 St. Laurent.**

**Figure 1: Key Plan – St. Laurent**



The proposed development is 4.61ha and consists of 155 townhouse units including seventy-one (66) - 3 storey town homes and eighty-nine (89) - standard 2 storey town homes. The locations of all nodes used to confirm the noise levels are included in **Figure 2 – Node Location Plan.**

M:\2022\122040\CAD\Civil\Figures\Noise\122040-NC.dwg, Fig 2, Aug 15, 2025 - 9:50am, mfang

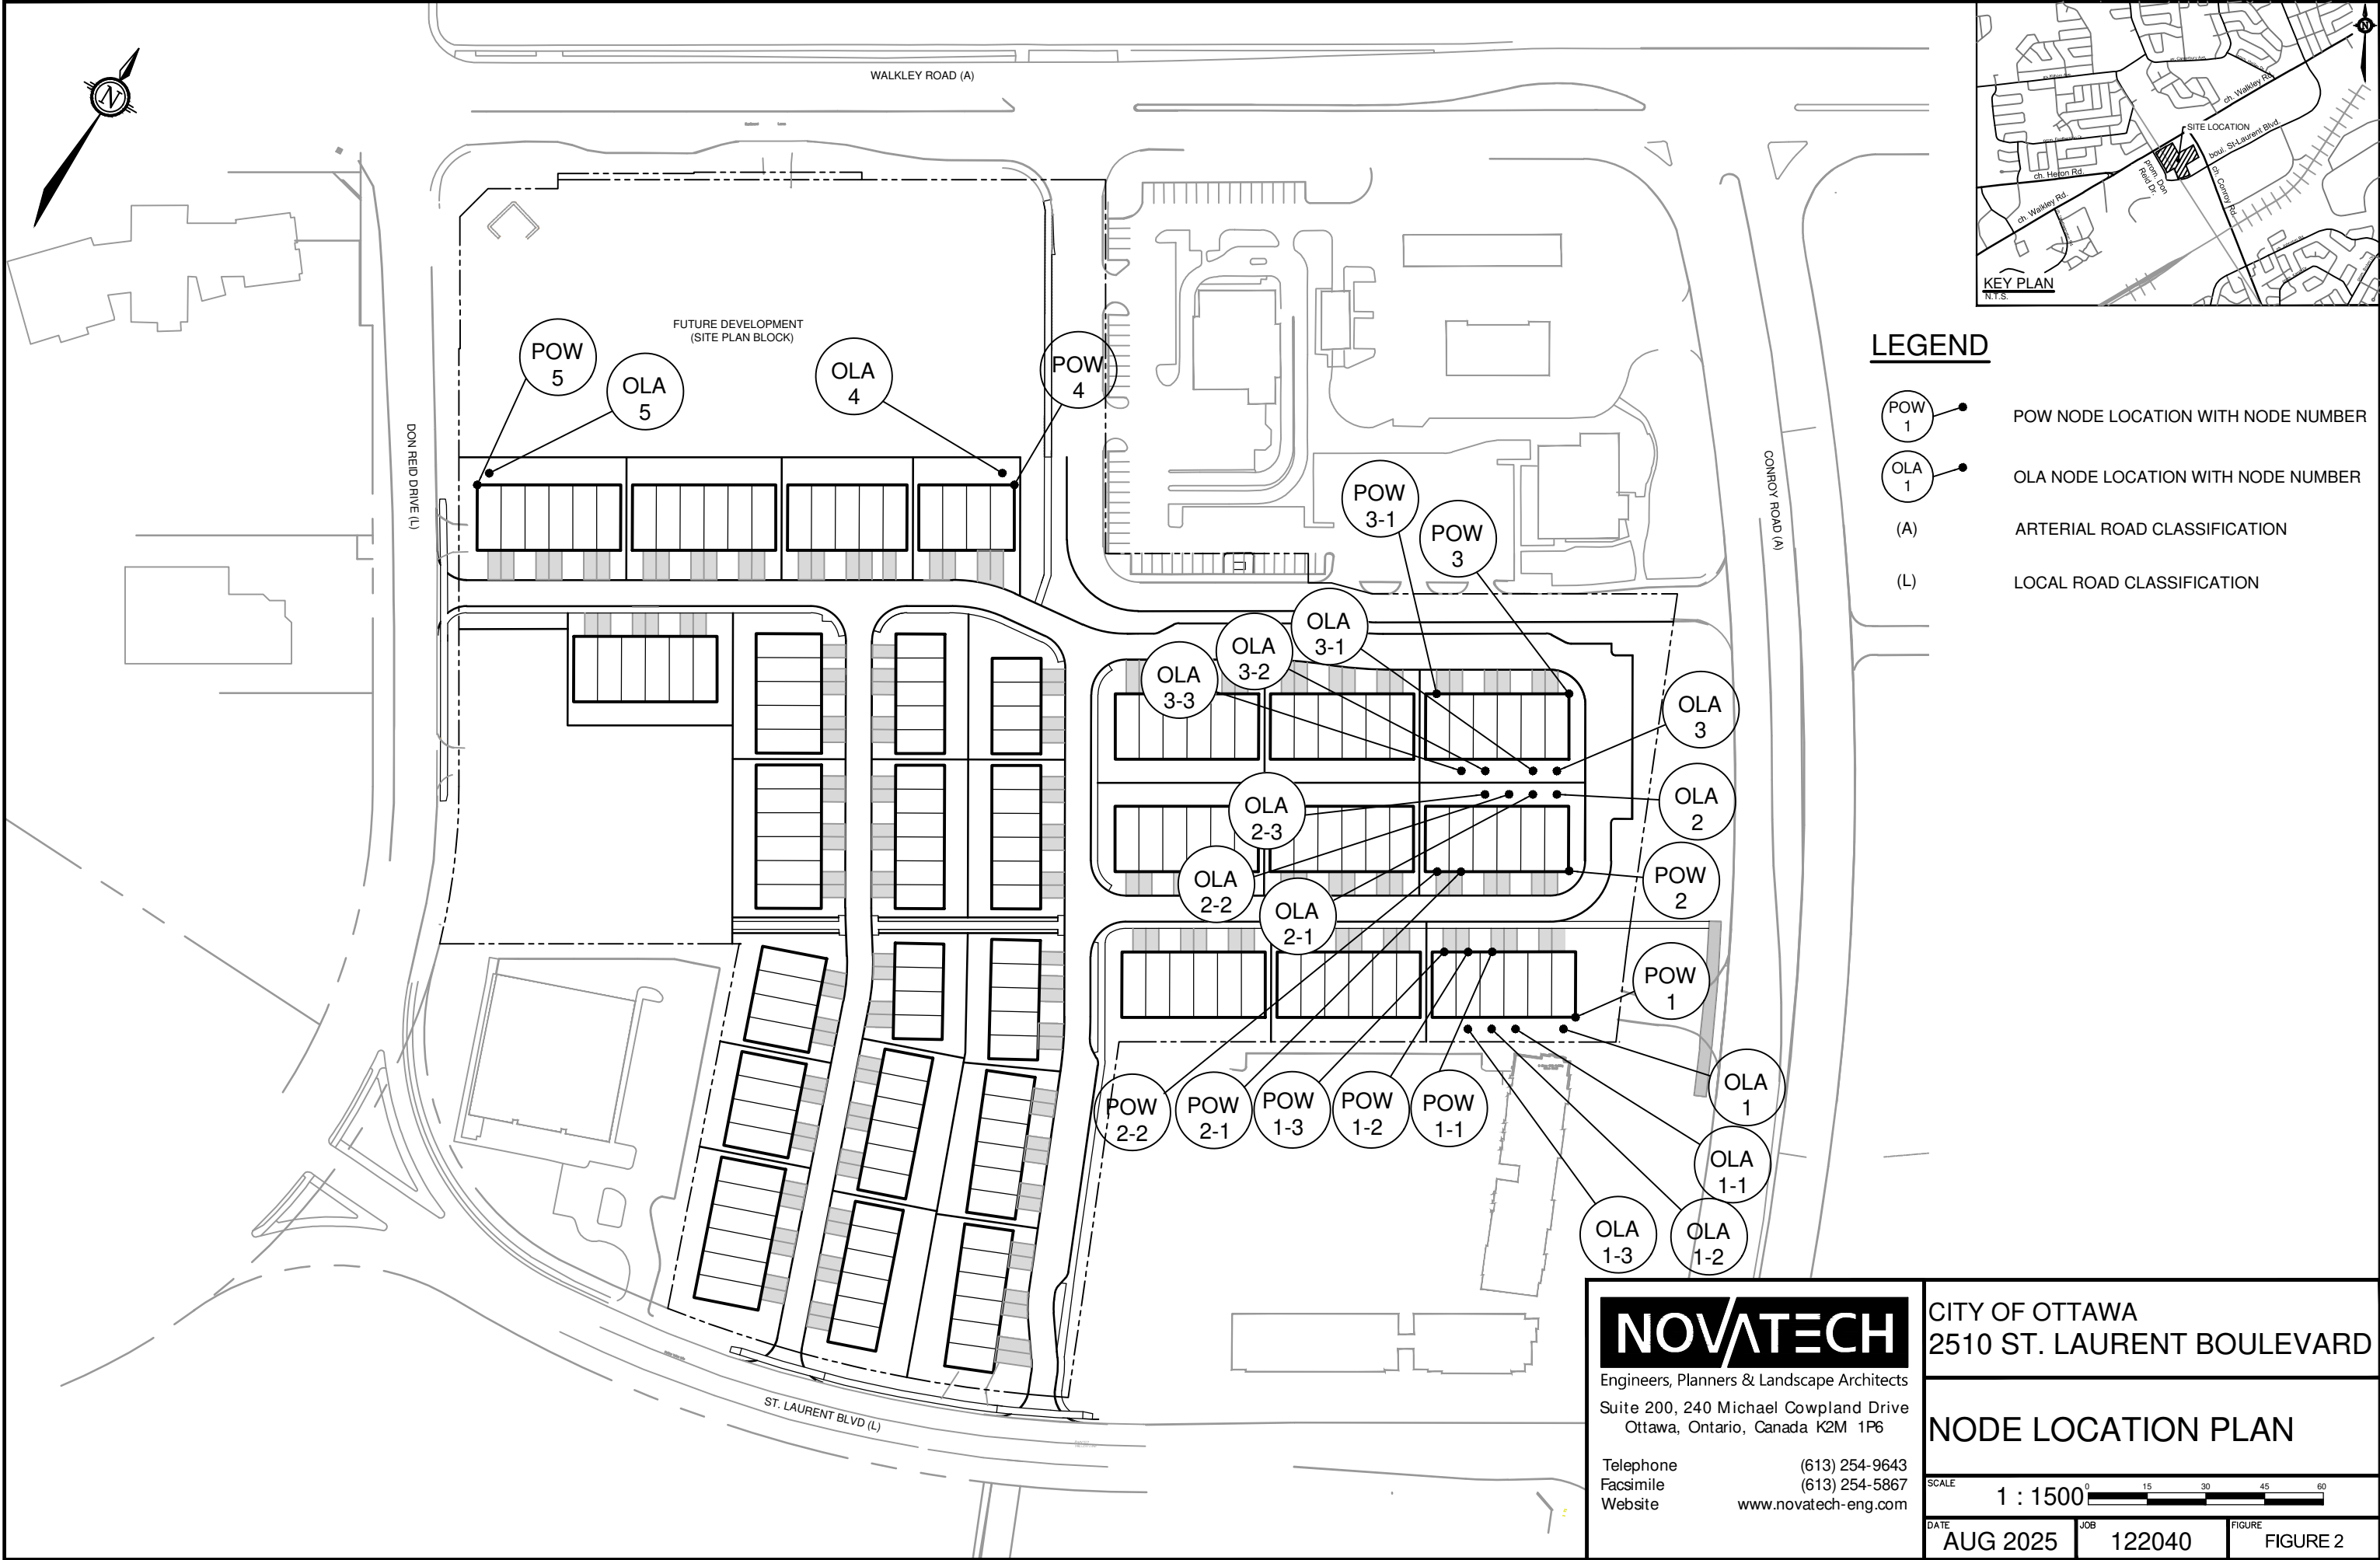

This report follows recommendations of the City of Ottawa's Environmental Noise Control Guidelines (ENCG) and MOEE NPC-300 Environmental Noise Guideline.

## 2.0 NOISE CRITERIA AND NOISE SOURCES

The permitted sound levels for the subject site are per Tables 2.2a and 2.2b of the ENCG and are summarized in **Table 1** below. Refer to **Appendix A** for all ENCG excerpts.

**Table 1: Permitted Noise Levels**

| Time Period            | Receiver Location                                 | Noise Level Criteria (Leq) |
|------------------------|---------------------------------------------------|----------------------------|
| Daytime (7:00-23:00)   | Outdoor Living Area (OLA)                         | 55 dBA                     |
| Daytime (7:00-23:00)   | Plane of Window (POW)<br>Living/Dining Room       | 45 dBA                     |
| Nighttime (23:00-7:00) | Plane of Window (POW)<br>Bedroom/Sleeping Quarter | 40 dBA                     |

The outdoor living area (OLA) is defined as the outdoor amenity provided for quiet enjoyment of the outdoor environment during the daytime (i.e., backyards, terraces, and patios). OLA noise levels are considered 3.0m from the building façade, 1.5m above grade.

The plane of window (POW) is defined as the center of the window of a noise sensitive place (i.e., living room or bedroom). POW noise levels are considered inside the building, 1.5m above the ground for the daytime and 4.5m above the ground for nighttime.

When sound levels are predicted to be less than the specified criteria listed in **Table 1**, no attenuation measures are required. As the noise criteria is exceeded, noise attenuation measures are recommended. These attenuation measures may include:

- Distance setback with soft ground;
- Insertion of noise insensitive land uses between the source and sensitive receptor;
- Orientation of building to provide sheltered zones;
- Construction of sound or acoustic barriers;
- Installation of air conditioning and ventilation; and
- Enhanced construction techniques and construction quality.

Due to site density, adjusting the setback, the insertion of noise insensitive lands, and reorienting the building are not feasible. Therefore, excessive noise for the subject site will be mitigated through the installation of acoustic barriers and air conditioning and enhanced construction techniques.

When predicted noise levels exceed the specified criteria, the City of Ottawa and the MOE recommend warning clauses be registered as a notice on title and incorporated into the lease/rental/sale agreements to warn potential purchaser/buyers/tenants of the possible elevated noise levels.

Typical warning clauses should be registered as shown below. Warning clauses are extracted from Part 4, Appendix A of the City of Ottawa ENCG and excerpts have been provided in **Appendix A** of this report. As stated in the City of Ottawa ENCG, due to the variation of noise impacts for any given site, it may be necessary to amend the example warning clauses to recognize the site conditions in each development.

#### Type A

“Purchasers/tenants are advised that sound levels due to increasing road traffic may occasionally interfere with some outdoor activities as the sound levels may exceed the sound level limits of the City and Ministry of the Environment.”

“To help address the need for sound attenuation this development has been designed so as to provide an outdoor amenity area and indoor environment that is within provincial guidelines. Measures for sound attenuation include:

- An acoustic barrier”

“To ensure that provincial sound level limits are not exceeded it is important to maintain sound attenuation features.”

“The acoustic barrier shall be maintained and kept in good repair by the property owner. Any maintenance, repair or replacement is the responsibility of the owner and shall be with the same material or to the same standards, having the same colour, appearance and function of the original.”

Additionally, if a tolerance of 5 dBA is being considered in some areas, it is recommended an additional noise clause be registered on title and incorporated into the agreement of purchase and sales:

#### Type B

“Purchasers/tenants are advised that despite the inclusion of noise control features in the development and within the building units, sound levels due to increasing road/rail/Light Rail/transitway traffic may, on occasion, interfere with some activities of the dwelling occupants as the sound levels exceed the sound level limits of the City and the Ministry of the Environment by up to 5 dBA.”

“To help address the need for sound attenuation this development has been designed so as to provide an outdoor amenity area and indoor environment that is within provincial guidelines. Measures for sound attenuation include:

- An acoustic barrier”

“To ensure that provincial sound level limits are not exceeded it is important to maintain sound attenuation features.”

“The acoustic barrier shall be maintained and kept in good repair by the property owner. Any maintenance, repair or replacement is the responsibility of the owner and shall be with the same material or to the same standards, having the same colour, appearance and function of the original.”

### Type C

“Purchasers/tenants are advised that sound levels due to increasing road traffic may occasionally interfere with some outdoor activities as the sound levels may exceed the sound level limits of the City and Ministry of the Environment.”

“To help address the need for sound attenuation this development has been designed so as to provide an outdoor amenity area and indoor environment that is within provincial guidelines. Measures for sound attenuation may include:

- Multi-pane glass
- Double brick veneer”

“To ensure that provincial sound level limits are not exceeded it is important to maintain sound attenuation features.”

“This dwelling unit has also been designed with the provision for adding central air conditioning at the occupant’s discretion. Installation of central air conditioning will allow windows and exterior doors to remain closed, thereby ensuring that the indoor sound levels are within the sound level limits of the City and the Ministry of the Environment”

### Type D

“Purchasers/tenants are advised that sound levels due to increasing road traffic may occasionally interfere with some outdoor activities as the sound levels may exceed the sound level limits of the City and Ministry of the Environment.”

“To help address the need for sound attenuation this development has been designed so as to provide an outdoor amenity area and indoor environment that is within provincial guidelines. Measures for sound attenuation may include:

- Multi-pane glass
- Double brick veneer
- High sound transmission class walls”

“To ensure that provincial sound level limits are not exceeded it is important to maintain sound attenuation features.”

“This dwelling unit has also been supplied with a central air conditioning system and other measures which will allow windows and exterior doors to remain closed, thereby ensuring that the indoor sound levels are within the sound level limits of the City and the Ministry of the Environment”

For units with multiple types of warning clauses, similar/identical wording can be combined as to not duplicate wording/information.

**Table 2** outlines the noise mitigation requirements when noise levels are calculated to be more than the levels stated in **Table 1**.

**Table 2: Noise Attenuation Requirements**

| Assessment Location               | L <sub>eq</sub> (dBA) | Outdoor Control Measures                                                 | Indoor Control Measures                                        |                                                                     | Warning Clause                                                           |
|-----------------------------------|-----------------------|--------------------------------------------------------------------------|----------------------------------------------------------------|---------------------------------------------------------------------|--------------------------------------------------------------------------|
|                                   |                       |                                                                          | Ventilation Requirements                                       | Building Components                                                 |                                                                          |
| Outdoor Living Area (OLA)         | Less than 55          | None required                                                            | N/A                                                            | N/A                                                                 | None required                                                            |
|                                   | Between 55 and 60     | Control measures (barriers) may not be required but should be considered | N/A                                                            | N/A                                                                 | Required if resultant L <sub>eq</sub> exceeds 55 dBA Type A* or Type B** |
|                                   | More than 60          | Barriers required                                                        | N/A                                                            | N/A                                                                 | Required if resultant L <sub>eq</sub> exceeds 55 dBA Type A* or Type B*  |
| Plane of Living Room Window (POW) | Less than 55          | N/A                                                                      | None Required                                                  | None Required                                                       | None Required                                                            |
|                                   | Between 55 and 65     | N/A                                                                      | Forced air heating with provision for central air conditioning | None Required                                                       | Required Type C                                                          |
|                                   | More Than 65          | N/A                                                                      | Central Air Conditioning                                       | Acoustical performance of the windows and walls should be specified | Required Type D                                                          |
| Plane of Bedroom Window (POW)     | Less than 50          | N/A                                                                      | None Required                                                  | None Required                                                       | None Required                                                            |
|                                   | Between 50 and 60     | N/A                                                                      | Forced air heating with provision for central air conditioning | None Required                                                       | Required Type C                                                          |
|                                   | More than 60          | N/A                                                                      | Central Air Conditioning                                       | Acoustical performance of the windows and walls should be specified | Required Type D                                                          |

\* Type A warning clause refers to units requiring a noise barrier that mitigates noise below 55dBA

\*\*Type B warning clause refers to units requiring a noise barrier but is technically or economically not feasible to reduce levels below 55dBA and a tolerance of up to 5dBA can be granted by the City

The City of Ottawa Official Plan stipulates that a noise study shall be prepared when a new development is proposed within 100 metres of an arterial, major collector or collector roadway, or a rapid-transit corridor. There are no railway, airport, or stationary noise sources that affect this site. **Table 3** confirms the road noise sources for the site.

**Table 3: Noise Sources**

| Roadway Classification |                |                       |            |        |       |             |
|------------------------|----------------|-----------------------|------------|--------|-------|-------------|
| Name                   | Classification | Lane                  | Identifier | AADT   | Lanes | Speed Limit |
| Walkley Road           | Arterial       | Eastbound & Westbound | 4-UAD      | 35,000 | 4     | 50 KPM      |
| Conroy* Road           | Arterial       | Southbound            | 4-UAD      | 35,000 | 2     | 60 KPM      |
|                        | Arterial       | Northbound            | 6-UAD      | 50,000 | 3     | 60 KPH      |

\* The average Conroy Road AADT assumed in this report is the average of the northbound and southbound lanes, AADT = 42,500.

The northbound and southbound lanes of Conroy Road are different and can not be best identified as any one road type in Appendix B: Table of Traffic and Road Parameters to Be Used for Sound Predictions of the ENCG. This report assumes the southbound lane is best classified as 4 Lane Urban Arterial Divided (4-UAD) with an AADT of 35,000 vehicles and the northbound lane is best described as 6 Lane-Urban Arterial-divided (6-UAD) with an AADT of 50,000 vehicles. This report assumes the average AADT of the Conroy Road southbound and northbound lanes, 42,500 vehicles.

St. Laurent Boulevard, a major collector, was not considered in this report because the expected AADT is anticipated to be on par with a local road, rather than 12,000 vehicles per day the ENCG predicts for a 2-lane urban major collector. The portion of St. Laurent nearest the site is approximately 300m long, is located between Don Reid Dr and Conroy Road and includes accesses to 4 small parking lots. Most of the St. Laurent Boulevard traffic is likely to come from the residents using the St. Laurent Boulevard as a thruway between Don Reid Drive and Conroy Rd. The portion on St. Laurent Boulevard nearest the site functions as an extension of the Don Reid Drive, a local road, and does not warrant a collector designation.

### 3.0 PREDICTED NOISE LEVELS

Noise levels were analyzed using Version 5.03 of the STAMSON computer program. The predicted noise levels are listed in **Table 4 & 5**.

**Table 4: Predicted Noise Levels and Proposed Mitigation Measures – Outdoor Living Areas**

| Receiver Location* | Calculated Noise Level (dBA)<br>7:00-23:00 |            | Outdoor Mitigation Method              |
|--------------------|--------------------------------------------|------------|----------------------------------------|
|                    | Un-attenuated                              | Attenuated |                                        |
| OLA 1              | 62.20                                      | 59.95      | 2.5m Noise Wall, Warning Clause Type B |
| OLA 1-1            | -                                          | 56.08      | 2.5m Noise Wall, Warning Clause Type B |
| OLA 1-2            | 55.62                                      | 54.29      | 2.5m Noise Wall, Warning Clause Type A |
| OLA 1-3            | 54.03                                      | -          | N/A                                    |
| OLA 2              | 62.17                                      | 56.01      | 2.5m Noise Wall, Warning Clause Type B |
| OLA 2-1            | -                                          | 53.99      | 2.5m Noise Wall, Warning Clause Type A |
| OLA 2-2            | 55.11                                      | 52.35      | 2.5m Noise Wall, Warning Clause Type A |
| OLA 2-3            | 53.33                                      | -          | N/A                                    |
| OLA 3              | 62.17                                      | 56.09      | 2.5m Noise Wall, Warning Clause Type B |
| OLA 3-1            | -                                          | 54.16      | 2.5m Noise Wall, Warning Clause Type A |
| OLA 3-2            | 55.33                                      | 49.22      | 2.5m Noise Wall, Warning Clause Type A |
| OLA 3-3            | 53.97                                      | -          | N/A                                    |
| OLA 4              | 55.62                                      | -          | Warning Clause Type B (Revised)        |
| OLA 5              | 55.50                                      | -          | Warning Clause Type B (Revised)        |

Locations correspond to receivers found in **Figure 2 – Receiver Location Plan**

The predicted noise levels for OLA4 and OLA5 may require noise mitigation (noise barrier), but because the noise levels are very close to the permitted 55dBA, and considering the future development of the site plan block will act as a noise barrier, we recommend noise barrier is not required, but a revised Warning Clause Type B is registered and addressed that the noise may need reassessment when the future site plan block is detailed proposed.

As per C7.1.1 of the NPC-300, OLA noise levels up to 60dBA are permitted if noise control measures are not feasible to reduce noise level below 55dBA. Increasing the size of the noise barrier to reduce OLA 1,2, &3 noise levels below 55dBA was considered but deemed not feasible, due to the excessive height of at least 5.5m.

**Table 5. Predicted Noise Levels and Proposed Mitigation Measures – Plain of Windows**



| Receiver Location* | Noise Level(dBA)     |                        | Mitigation Method                                       |
|--------------------|----------------------|------------------------|---------------------------------------------------------|
|                    | Daytime (7:00-23:00) | Nighttime (23:00-7:00) |                                                         |
| POW1               | 63.67                | 56.72                  | Forced Air Ventilation, Warning Clause Type C           |
| POW1-1             | 56.58                | 49.86                  | Forced Air Ventilation, Warning Clause Type C           |
| POW1-2             | 55.14                | 48.54                  | Forced Air Ventilation, Warning Clause Type C           |
| POW1-3             | 54.17                | 47.62                  | N/A                                                     |
| POW2               | 63.36                | 56.46                  | Forced Air Ventilation, Warning Clause Type C           |
| POW2-1             | 55.15                | 49.14                  | Forced Air Ventilation, Warning Clause Type C           |
| POW2-2             | 54.10                | 48.31                  | N/A                                                     |
| POW3               | 63.44                | 56.49                  | Forced Air Ventilation, Warning Clause Type C           |
| POW3-1             | 55.08                | 48.73                  | Forced Air Ventilation, Warning Clause Type C           |
| POW4               | 55.53                | 50.32                  | Forced Air Ventilation, Warning Clause Type C (Revised) |
| POW5               | 55.23                | 49.70                  | Forced Air Ventilation, Warning Clause Type C (Revised) |

Locations correspond to receivers found in **Figure 2 – Receiver Location Plan**

Based on the results above, we recommend Forced Air Ventilation and the inclusion of Noise Clause Type C be registered as a notice on title and incorporated into the lease/rental/sale agreements of the effected units. The noise levels for POW 4&5 are close to the permitted 55 dBA (Daytime) and 50 dBA (Nighttime), and the future development of the site plan block will act as a noise barrier. Therefore, we recommend a revised Warning Clause Type C is registered and addressed that the noise level may need reassessment when the future site plan block is detailed proposed.

Refer to **Figure 3 – Noise Mitigation Plan** for all proposed noise mitigation measures. Refer to **Appendix B** for all noise calculations.

M:\2022\122040\CAD\Civil\Figures\Noise\122040-NC.dwg, Fig 3, Aug 15, 2025 - 9:50am, mfang

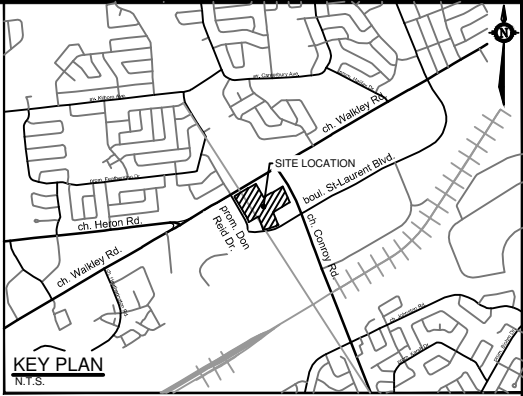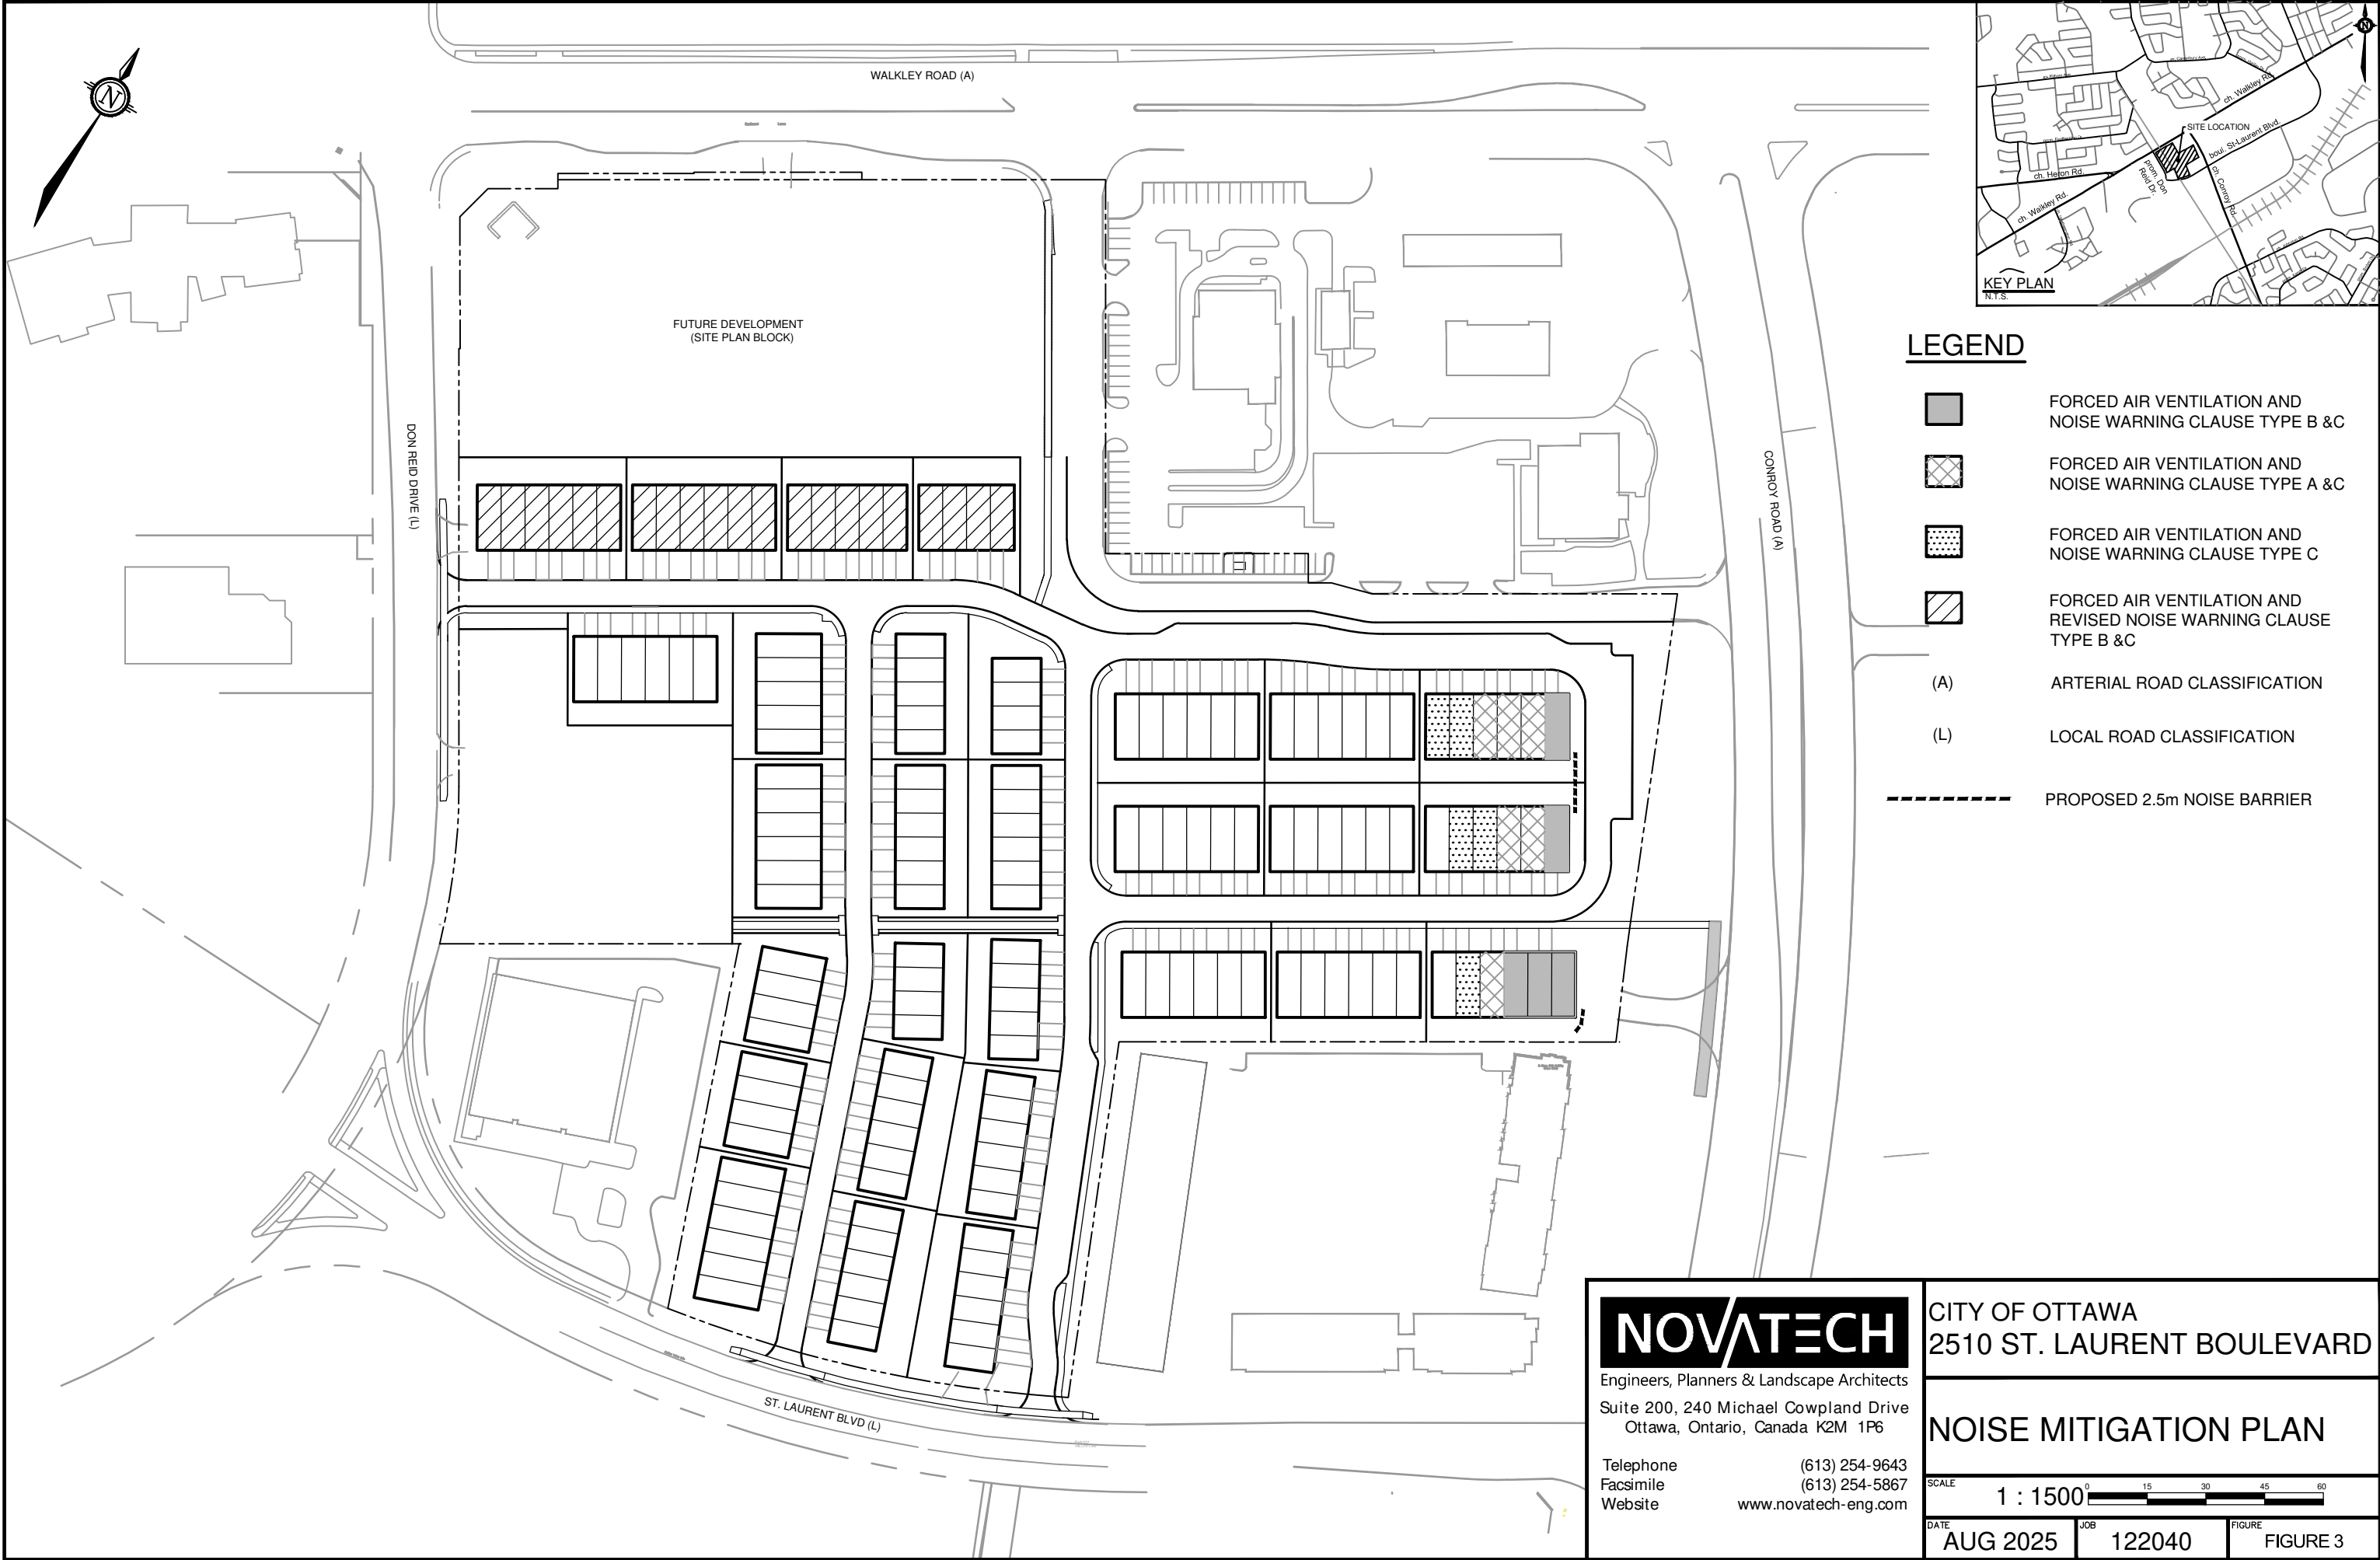

LEGEND

- FORCED AIR VENTILATION AND NOISE WARNING CLAUSE TYPE B & C
- FORCED AIR VENTILATION AND NOISE WARNING CLAUSE TYPE A & C
- FORCED AIR VENTILATION AND NOISE WARNING CLAUSE TYPE C
- FORCED AIR VENTILATION AND REVISED NOISE WARNING CLAUSE TYPE B & C
- (A) ARTERIAL ROAD CLASSIFICATION
- (L) LOCAL ROAD CLASSIFICATION
- PROPOSED 2.5m NOISE BARRIER

**NOVATECH**

Engineers, Planners & Landscape Architects  
Suite 200, 240 Michael Cowpland Drive  
Ottawa, Ontario, Canada K2M 1P6

Telephone (613) 254-9643  
Facsimile (613) 254-5867  
Website [www.novatech-eng.com](http://www.novatech-eng.com)

CITY OF OTTAWA  
2510 ST. LAURENT BOULEVARD

NOISE MITIGATION PLAN

SCALE 1 : 1500

DATE AUG 2025 JOB 122040 FIGURE FIGURE 3

## 4.0 CONCLUSION

This report recommends:

1. Installation of 2.5m high noise walls between the 3 row easternmost town homes and the Conroy Road as outlined in **Figure 3– Noise Mitigation Plan**.
2. Installation of forced air ventilation and the inclusion of Noise Clause Type A, or B, or C to be registered as a notice on title and incorporated into the lease/rental/sale agreements of some of the units the 3 row easternmost town homes. The exact units and mitigation methods refer to **Figure 3– Noise Mitigation Plan**.
3. Installation of forced air ventilation and the inclusion of revised Noise Clause Type B and C to be registered as a notice on title and incorporated into the lease/rental/sale agreements of all the 4 row northernmost town homes. (Refer to **Figure 3– Noise Mitigation Plan**)

## NOVATECH

Report By:




**Mark Bowen, B. Eng.**  
Project Manager  
Land Development Engineering

Revised By:



**Ming Fang, C.E.T., B. Eng.**  
Design Technologist

Reviewed By:



**Greg MacDonald, P. Eng.**  
Director - Land Development and  
Public Sector Infrastructure

## **APPENDIX A:**

EXCERPTS FROM THE CITY OF OTTAWA ENVIRONMENTAL NOISE CONTROL  
GUIDELINES, THE MOE'S NPC-300, THE CITY OF OTTAWA'S TRANSPORTATION  
MASTER PLAN AND OFFICIAL PLAN

# **ENVIRONMENTAL NOISE CONTROL GUIDELINES: Introduction and Glossary**

January 2016

**Table 2.2a: Sound Level Limit for Outdoor Living Areas - Road and Rail**

(from NPC-300, 2013 Table C-1)

| Time Period            | Required<br>Leq (16) (dBA) |
|------------------------|----------------------------|
| 16-hour, 07:00 – 23:00 | 55                         |

**Table 2.2b: Sound Level Limit for Indoor Living Areas Road and Rail**

(from NPC-300, 2013 Table C-2)

| Type of Space                                                                                              | Time Period   | Required Leq (dBA) |      |
|------------------------------------------------------------------------------------------------------------|---------------|--------------------|------|
|                                                                                                            |               | Road               | Rail |
| Living/dining, den areas of residences, hospitals, nursing homes, schools, daycare centres, etc.           | 07:00 – 23:00 | 45                 | 40   |
| Living/dining, den areas of residences, hospitals, nursing homes, etc. (except schools or daycare centres) | 23:00 – 07:00 | 45                 | 40   |
| Sleeping quarters                                                                                          | 07:00 – 23:00 | 45                 | 40   |
|                                                                                                            | 23:00 – 07:00 | 40                 | 35   |

The Province also provides for supplementary indoor sound level limits for land uses not generally considered noise sensitive (see Table 2.2c below). These good practice design objectives should be addressed in any noise study prepared for the City. These supplementary sound level limits are based on the windows and doors to an indoor space being closed.

**Table 2.2c: Supplementary Sound Level Limits for Indoor Spaces - Road and Rail (adapted from NPC-300 Table C-9)**

| Type of Space                                                                                                     | Time Period                    | Required Leq (dBA) |      |
|-------------------------------------------------------------------------------------------------------------------|--------------------------------|--------------------|------|
|                                                                                                                   |                                | Road               | Rail |
| General offices, reception areas, retail stores, etc.                                                             | 16 hours between 07:00 – 23:00 | 50                 | 45   |
| Theatres, places of worship, libraries, individual or semi-private offices, conference rooms, reading rooms, etc. | 16 hours between 07:00 – 23:00 | 45                 | 40   |
| Sleeping quarters of hotels/motels                                                                                | 8 hours between 23:00 – 07:00  | 45                 | 40   |
| Sleeping quarters of residences, hospitals, nursing/retirement homes, etc.                                        | 8 hours between 23:00 – 07:00  | 40                 | 35   |

## Appendix B: Table of Traffic and Road Parameters To Be Used For Sound Level Predictions

**Table B1 Traffic And Road Parameters To Be Used For Sound Level Predictions**

| Row Width (m)   | Implied Roadway Class                                                  | AADT Vehicles/Day | Posted Speed Km/Hr | Day/Night Split % | Medium Trucks % | Heavy Trucks % <sup>1</sup> |
|-----------------|------------------------------------------------------------------------|-------------------|--------------------|-------------------|-----------------|-----------------------------|
| NA <sup>2</sup> | Freeway, Queensway, Highway                                            | 18,333 per lane   | 100                | 92/8              | 7               | 5                           |
| 37.5-44.5       | 6-Lane Urban Arterial-Divided (6-UAD)                                  | 50,000            | 50-80              | 92/8              | 7               | 5                           |
| 34-37.5         | 4-Lane Urban Arterial-Divided (4-UAD)                                  | 35,000            | 50-80              | 92/8              | 7               | 5                           |
| 23-34           | 4-Lane Urban Arterial-Undivided (4-UAU)                                | 30,000            | 50-80              | 92/8              | 7               | 5                           |
| 23-34           | 4-Lane Major Collector (4-UMCU)                                        | 24,000            | 40-60              | 92/8              | 7               | 5                           |
| 30-35.5         | 2-Lane Rural Arterial (2-RAU)                                          | 15,000            | 50-80              | 92/8              | 7               | 5                           |
| 20-30           | 2-Lane Urban Arterial (2-UAU)                                          | 15,000            | 50-80              | 92/8              | 7               | 5                           |
| 20-30           | 2-Lane Major Collector (2-UMCU)                                        | 12,000            | 40-60              | 92/8              | 7               | 5                           |
| 30-35.5         | 2-Lane Outer Rural Arterial (near the extremities of the City) (2-RAU) | 10,000            | 50-80              | 92/8              | 7               | 5                           |
| 20-30           | 2-Lane Urban Collector (2-UCU)                                         | 8,000             | 40-50              | 92/8              | 7               | 5                           |

<sup>1</sup> The MOE Vehicle Classification definitions should be used to estimate automobiles, medium trucks and heavy trucks.

<sup>2</sup> The number of lanes is determined by the future mature state of the roadway.

| Road                                        | From                   | To                   | ROW to be Protected                                                                                                    | Classification  | Sector  |
|---------------------------------------------|------------------------|----------------------|------------------------------------------------------------------------------------------------------------------------|-----------------|---------|
| Colonnade                                   | Merivale               | Prince of Wales      | 26                                                                                                                     | major collector | urban   |
| Colonnade S.                                | Colonnade N.           | Colonnade N.         | 24                                                                                                                     | collector       | urban   |
| Conroy                                      | Walkley                | Greenbelt boundary   | 44.5                                                                                                                   | arterial        | urban   |
| Conroy                                      | Greenbelt boundary     | Bank                 | G                                                                                                                      | arterial        | urban   |
| Constance Bay                               | Dunrobin               | Bayview              | 20                                                                                                                     | arterial        | village |
| Constellation                               | Centrepointhe          | Baseline             | 24                                                                                                                     | collector       | urban   |
| Cope                                        | Entire Length          |                      | 24                                                                                                                     | collector       | urban   |
| Cordova                                     | Withrow                | Baseline             | 24                                                                                                                     | collector       | urban   |
| Corkstown                                   | March                  | Moodie               | G                                                                                                                      | arterial        | urban   |
| Corkstown                                   | Moodie                 | Carling              | 24                                                                                                                     | collector       | urban   |
| Cousineau                                   | East-west segment only |                      | 18                                                                                                                     | local           | urban   |
| Coventry                                    | Vanier Parkway         | Belfast              | 30                                                                                                                     | arterial        | urban   |
| Coventry                                    | Belfast                | St. Laurent          | 30                                                                                                                     | arterial        | urban   |
| Cresthaven                                  | Strandherd             | Crestway             | 26                                                                                                                     | major collector | urban   |
| Crystal Beach                               | Corkstown              | Carling              | 24                                                                                                                     | collector       | urban   |
| Cumberland                                  | George                 | Rideau               | 20                                                                                                                     | local           | urban   |
| Cumberland                                  | Rideau                 | Besserer             | 20<br>Note: Maximum land requirement from property abutting existing ROW (1.0 m). Subject to widening/easement policy. | arterial        | urban   |
| Cummings                                    | Montreal               | Donald               | 24                                                                                                                     | collector       | urban   |
| Cummings                                    | Donald                 | Ogilvie              | 26                                                                                                                     | major collector | urban   |
| Cummings                                    | Ogilvie                | Cyrville             | 37.5                                                                                                                   | arterial        | urban   |
| Cyrville                                    | Cummings               | 100m north of Maxime | 37.5                                                                                                                   | arterial        | urban   |
| Cyrville                                    | 100m north of Maxime   | Innes                | 37.5<br>Note: Subject to unequal widening: North side 15.0 m, South side 22.5 m                                        | arterial        | urban   |
| Cyrville<br>[Amendment #113, July 30, 2013] | St. Laurent            | Cummings             | 26                                                                                                                     | collector       | urban   |

| Road        | From                                          | To                               | ROW to be Protected                                                                                     | Classification  | Sector  |
|-------------|-----------------------------------------------|----------------------------------|---------------------------------------------------------------------------------------------------------|-----------------|---------|
| Trim        | Innes                                         | East Urban Community-south limit | 37.5<br>Note: An additional 5.0 m on the rural side may be required to construct a rural cross-section. | arterial        | urban   |
| Trim        | Hydro corridor/Frank Kenny extension          | Existing Trim                    | 37.5                                                                                                    | arterial        | urban   |
| Trim        | Ottawa Road 174                               | Frank Kenny extension            | 46                                                                                                      | arterial        | urban   |
| Trim        | South of hydro corridor/Frank Kenny extension | Innes                            | 37.5<br>Note: Refer to North South Link ESR                                                             | arterial        | urban   |
| Trim        | North Service                                 | Ottawa Road 174                  | 26                                                                                                      | major collector | urban   |
| Triole      | North of Tremblay                             |                                  | 20                                                                                                      | local           | urban   |
| Triole      | All sections south of Tremblay                |                                  | 18                                                                                                      | local           | urban   |
| Vaan        | Entire length                                 |                                  | 24                                                                                                      | collector       | urban   |
| Valin       | Charlemagne                                   | Trim                             | 26                                                                                                      | major collector | urban   |
| Varley      | Beaverbrook                                   | Beaverbrook                      | 24                                                                                                      | collector       | urban   |
| Vaughn      | Crichton                                      | Mackay                           | 15                                                                                                      | local           | urban   |
| Victoria    | Glen                                          | Glenwood                         | 23                                                                                                      | arterial        | village |
| Viewmount   | Meadowlands                                   | Fisher                           | 24                                                                                                      | collector       | urban   |
| Virgil      | Stinson                                       | Lynhar                           | 24                                                                                                      | collector       | urban   |
| Viseneau    | Boyer                                         | Innes                            | 26                                                                                                      | collector       | urban   |
| Walkley     | Riverside                                     | Bank                             | 26                                                                                                      | arterial        | urban   |
| Walkley     | Bank                                          | Heron                            | 37.5                                                                                                    | arterial        | urban   |
| Walkley     | Heron                                         | Greenbelt boundary               | 44.5                                                                                                    | arterial        | urban   |
| Walkley     | Greenbelt boundary                            | Ramsayville                      | G                                                                                                       | arterial        | urban   |
| Waller      | Rideau                                        | Laurier East                     | 23<br>Note: Maximum land requirement from property abutting existing ROW (1.54 m).                      | arterial        | urban   |
| Waterbridge | Cresthaven                                    | Prince of Wales                  | 24                                                                                                      | collector       | urban   |

# Environmental Noise Guideline

Stationary and Transportation Sources –  
Approval and Planning

Publication NPC-300

**Table C-10**  
**Supplementary Indoor Aircraft Noise Limits**  
**(Applicable over 24-hour period)**

| Type of Space                                                                                                                                 | Indoor NEF/NEP* |
|-----------------------------------------------------------------------------------------------------------------------------------------------|-----------------|
| General offices, reception areas, retail stores, etc.                                                                                         | 15              |
| Individual or semi-private offices, conference rooms, etc.                                                                                    | 10              |
| Living/dining areas of residences, sleeping quarters of hotels/motels, theatres, libraries, schools, daycare centres, places of worship, etc. | 5               |
| Sleeping quarters of residences, hospitals, nursing/retirement homes, etc.                                                                    | 0               |

\* The indoor NEF/NEP values listed in Table C-10 are not obtained from NEF/NEP contour maps. The values are representative of the indoor sound levels and are used as assessment criteria for the evaluation of acoustical insulation requirements.

## C7 Noise Control Measures

The following sections provide MOE guidance for appropriate noise control measures. These sections constitute requirements that are applied to MOE approvals for stationary sources. This information is also provided as guidance which land use planning authorities may consider adopting.

The definition in Part A describes the various types and application of noise control measures. All the noise control measures described in the definition are appropriate to address the impact of noise of transportation sources (road, rail and aircraft) on planned sensitive land uses. Only some of the noise control measures described in the definition are appropriate to address the noise impact of stationary sources on planned sensitive land uses.

### C7.1 Road Noise Control Measures

#### C7.1.1 Outdoor Living Areas

If the 16-Hour Equivalent Sound Level,  $L_{eq}(16)$  in the OLA is greater than 55 dBA and less than or equal to 60 dBA, noise control measures may be applied to reduce the sound level to 55 dBA. If measures are not provided, prospective purchasers or tenants should be informed of potential noise problems by a warning clause Type A.

If the 16-Hour Equivalent Sound Level,  $L_{eq}(16)$  in the OLA is greater than 60 dBA, noise control measures should be implemented to reduce the level to 55 dBA. Only in cases where the required noise control measures are not feasible for technical, economic or administrative reasons would an excess above the limit (55 dBA) be acceptable with a warning clause Type B. In the above situations, any excess above the limit will not be acceptable if it exceeds 5 dBA.

### **C7.1.2 Plane of a Window – Ventilation Requirements**

#### **C7.1.2.1 Daytime Period, 07:00 – 23:00 Hours**

Noise control measures may not be required if the  $L_{eq}$  (16) daytime sound level in the plane of a bedroom or living/dining room window is less than or equal to 55 dBA. If the sound level in the plane of a bedroom or living/dining room window is greater than 55 dBA and less than or equal to 65 dBA, the dwelling should be designed with a provision for the installation of central air conditioning in the future, at the occupant's discretion. Warning clause Type C is also recommended.

If the daytime sound level in the plane of a bedroom or living/dining room window is greater than 65 dBA, installation of central air conditioning should be implemented with a warning clause Type D. In addition, building components including windows, walls and doors, where applicable, should be designed so that the indoor sound levels comply with the sound level limits in Table C-2. The location and installation of the outdoor air conditioning device should comply with sound level limits of Publication NPC-216, Reference [32], and guidelines contained in Environmental Noise Guidelines for Installation of Residential Air Conditioning Devices, Reference [6], or should comply with other criteria specified by the municipality.

#### **C7.1.2.2 Nighttime Period, 23:00 – 07:00 Hours**

Noise control measures may not be required if the  $L_{eq}$  (8) nighttime sound level in the plane of a bedroom or living/dining room window is less than or equal to 50 dBA. If the sound level in the plane of a bedroom or living/dining room window is greater than 50 dBA and less than or equal to 60 dBA, the dwelling should be designed with a provision for the installation of central air conditioning in the future, at the occupant's discretion. Warning clause Type C is also recommended.

If the nighttime sound level in the plane of a bedroom or living/dining room window is greater than 60 dBA, installation of central air conditioning should be implemented, with a warning clause Type D. In addition, building components including windows, walls and doors, where applicable, should be designed so that the indoor sound levels comply with the sound level limits in Table C-2. The location and installation of the outdoor air conditioning device should comply with sound level limits of Publication NPC-216, Reference [32], and guidelines contained in Environmental Noise Guidelines for Installation of Residential Air Conditioning Devices, Reference [6], or should comply with other criteria specified by the municipality.

### **C7.1.3 Indoor Living Areas – Building Components**

If the nighttime sound level outside the bedroom or living/dining room windows exceeds 60 dBA or the daytime sound level outside the bedroom or living/dining area windows exceeds 65 dBA, building components including windows, walls and doors, where applicable, should be designed so that the indoor sound levels comply with the

sound level limits in Table C-2. The acoustical performance of the building components (windows, doors and walls) should be specified.

## **C7.2 Rail Noise Control Measures**

### **C7.2.1 Outdoor Living Areas**

Whistle noise is not included in the determination of the outdoor daytime sound level due to railway trains. All the provisions of Section C7.1.1 apply also to noise control requirements for rail noise.

### **C7.2.2 Plane of a Window – Ventilation Requirements**

Whistle noise is not included in the determination of the sound level in the plane of a window. All the provisions of Section C7.1.2 apply also to noise control requirements for rail noise.

### **C7.2.3 Indoor Living Areas – Building Components**

The sound level,  $L_{eq}$ , during the daytime (16-hour) and nighttime (8-hour) periods is determined using the prediction method STEAM, Reference [34], immediately outside the dwelling envelope. Whistle noise is included in the determination of the sound level.

If the nighttime sound level outside the bedroom or living/dining room windows exceeds 55 dBA or the daytime sound level outside the bedroom or living/dining area windows exceeds 60 dBA, building components including windows, walls and doors, where applicable, need to be designed so that the indoor sound levels comply with the sound level limits in Table C-2. The acoustical performance of the building components (windows, doors and walls) needs to be specified.

In addition, the exterior walls of the first row of dwellings next to railway tracks are to be built to a minimum of brick veneer or masonry equivalent construction, from the foundation to the rafters when the rail traffic  $L_{eq}$  (24-hour), estimated at a location of a nighttime receptor, is greater than 60 dBA, and when the first row of dwellings is within 100 metres of the tracks.

## **C7.3 Combination of Road and Rail Noise**

The noise impact in the OLA and in the plane of a window, and the requirements for outdoor measures, ventilation measures and warning clauses, should be determined by combining road and rail traffic sound levels.

The assessment of the indoor sound levels and the resultant requirement for the acoustical descriptors of the building components should be done separately for road

In Class 4 areas, where windows for noise sensitive spaces are assumed to be closed, the use of central air conditioning may be acceptable if it forms an essential part of the overall building designs.

### **C7.9 Verification of Noise Control Measures**

It is recommended that the implementation of noise control measures be verified by qualified individuals with experience in environmental acoustics.

## **C8 Warning Clauses**

The use of warning clauses or easements in respect of noise are recommended when circumstances warrant. Noise warning clauses may be used to warn of potential annoyance due to an existing source of noise and/or to warn of excesses above the sound level limits. Direction on the use of warning clauses should be included in agreements that are registered on title to the lands in question. The warning clauses would be included in agreements of Offers of Purchase and Sale, lease/rental agreements and condominium declarations. Alternatively, the use of easements in respect of noise may be appropriate in some circumstances. Additional guidance on the use of noise warning clauses is provided in Section C7.1.1, Section C7.1.2.1, Section C7.1.2.2, Section C7.3 and Section C7.4.

### **C8.1 Transportation Sources**

The following warning clauses may be used individually or in combination:

TYPE A: (see Section C7.1.1)

“Purchasers/tenants are advised that sound levels due to increasing road traffic (rail traffic) (air traffic) may occasionally interfere with some activities of the dwelling occupants as the sound levels exceed the sound level limits of the Municipality and the Ministry of the Environment.”

TYPE B: (see Section C7.1.1 and Section C7.4)

“Purchasers/tenants are advised that despite the inclusion of noise control features in the development and within the building units, sound levels due to increasing road traffic (rail traffic) (air traffic) may on occasions interfere with some activities of the dwelling occupants as the sound levels exceed the sound level limits of the Municipality and the Ministry of the Environment.”

TYPE C: (see Section C7.1.2.1, Section C7.1.2.2 and Section C7.4)

“This dwelling unit has been designed with the provision for adding central air conditioning at the occupant’s discretion. Installation of

central air conditioning by the occupant in low and medium density developments will allow windows and exterior doors to remain closed, thereby ensuring that the indoor sound levels are within the sound level limits of the Municipality and the Ministry of the Environment.”

TYPE D: (see Section C7.1.2.1, Section C7.1.2.2 and Section C7.4)

“This dwelling unit has been supplied with a central air conditioning system which will allow windows and exterior doors to remain closed, thereby ensuring that the indoor sound levels are within the sound level limits of the Municipality and the Ministry of the Environment.”

## **C8.2 Stationary Sources**

It is not acceptable to use warning clauses in place of physical noise control measures to identify an excess over the MOE sound level limits. Warning clause (Type E) for stationary sources may identify a potential concern due to the proximity of the facility but it is not acceptable to justify exceeding the sound level limits.

TYPE E: (see Section C7.6)

“Purchasers/tenants are advised that due to the proximity of the adjacent industry (facility) (utility), noise from the industry (facility) (utility) may at times be audible.”

## **C8.3 Class 4 Area Notification**

TYPE F: (see Section B9.2 and Section C4.4.2)

“Purchasers/tenants are advised that sound levels due to the adjacent industry (facility) (utility) are required to comply with sound level limits that are protective of indoor areas and are based on the assumption that windows and exterior doors are closed. This dwelling unit has been supplied with a ventilation/air conditioning system which will allow windows and exterior doors to remain closed.”

## Appendix A: Warning Clauses

Under the Official Plan and this guideline warning clauses may be required to be incorporated into development through development agreements, registration on title and inclusion in Agreements of Purchase and Sale. This requirement may be included in any development, regardless of whether it is considered a noise sensitive land use.

A warning clause provides recognition for the City, Province landowner or tenants that noise may be a concern, that noise may be audible at times or even quite loud, and, depending on the type of development, provincial guidelines for noise may be exceeded. Warning clauses also recognize that environmental noise is a potential health hazard that does impact people and neighbourhoods. It is for this reason that, unless a non-noise sensitive land use is established, a warning clause should also include noise mitigation.

A warning clause is not considered a form of noise mitigation. It is not acceptable therefore to use warning clauses in place of physical noise control measures to identify an excess over the MOE or City noise limits. The reason for a warning clause on all development is twofold. Firstly, it is important to note that a land use that although the development may not be considered noise sensitive it may include employees or tenants that are personally sensitive to noise. A warning clause provides protection against complaints to the ministry of Environment should provincial guidelines be exceeded. Secondly, a warning clause on title could obviate the need for a new noise study in the future. In a redevelopment scenario the warning clause would provide recognition of the extent noise conditions.

Given the variation in potential intensity and impact of noise it will often be necessary to amend warning clauses to recognize the site specific conditions in each development. Final wording of any warning clause is to be approved by the City.

The following subsections provide example text to be adapted into warning clauses.

## Surface Transportation Warning Clauses

*Table A1 Surface Transportation Warning Clauses*

| Type                               | Example                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                  | Notes                                                                                                                                                                                                                                                                                                                                          |
|------------------------------------|------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| Generic                            | <p><i>Purchasers/tenants are advised that sound levels due to increasing road/rail/Light Rail/transitway traffic may occasionally interfere with some outdoor activities as the sound levels may exceed the sound level limits of the City and the Ministry of the Environment.</i></p> <p><i>To help address the need for sound attenuation this development has been designed so as to provide an outdoor amenity area that is within provincial guidelines. Measures for sound attenuation include:</i></p> <ul style="list-style-type: none"> <li><i>• A setback of buildings from the noise source and</i></li> <li><i>• An acoustic barrier.</i></li> </ul> <p><i>To ensure that provincial sound level limits are not exceeded it is important to maintain sound attenuation features.</i></p> <p><i>The acoustic barrier shall be maintained and kept in good repair by the property owner. Any maintenance, repair or replacement is the responsibility of the owner and shall be with the same material or to the same standards, having the same colour, appearance and function of the original.</i></p> <p><i>Additionally this development includes trees and shrubs to screen the source of noise from occupants.</i></p> | <p>The generic warning clause outlines that MOE sound levels may be exceeded but the indoor environment and outdoor amenity areas are within guidelines.</p> <p>Mitigation measures are described including urban design features.</p> <p>Mention is also made of landscaping to screen the development visually from the source of noise.</p> |
| Extensive mitigation of indoor and | <p><i>“Purchasers/tenants are advised that despite the inclusion of noise control features in the development and within the building units,</i></p>                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                     | <p>The warning clause makes reference to MOE sound levels</p>                                                                                                                                                                                                                                                                                  |

**Table A1 Surface Transportation Warning Clauses**

| Type                 | Example                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                            | Notes                                                                                                                                                                                                                                                        |
|----------------------|----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| outdoor amenity area | <p><i>sound levels due to increasing road/rail/Light Rail/transitway traffic may, on occasion, interfere with some activities of the dwelling occupants as the sound levels exceed the sound level limits of the City and the Ministry of the Environment.</i></p> <p><i>To help address the need for sound attenuation this development includes:</i></p> <ul style="list-style-type: none"> <li>• <i>multi-pane glass;</i></li> <li>• <i>double brick veneer;</i></li> <li>• <i>an earth berm; and</i></li> <li>• <i>an acoustic barrier.</i></li> </ul> <p><i>To ensure that provincial sound level limits are not exceeded it is important to maintain these sound attenuation features.</i></p> <p><i>The acoustic barrier shall be maintained and kept in good repair by the property owner. Any maintenance, repair or replacement is the responsibility of the owner and shall be with the same material or to the same standards, having the same colour, appearance and function of the original.</i></p> <p><i>This dwelling unit has also been designed with the provision for adding central air conditioning at the occupant's discretion. Installation of central air conditioning will allow windows and exterior doors to remain closed, thereby ensuring that the indoor sound levels are within the sound level limits of the City and the Ministry of the Environment.</i></p> | <p>being exceeded from time to time and that there are sound attenuation features and landscaping within the development that should be maintained.</p> <p>An option for air conditioning is noted as well as landscaping to screen the source of noise.</p> |

**Table A1 Surface Transportation Warning Clauses**

| Type                    | Example                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                               | Notes                                                                            |
|-------------------------|-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|----------------------------------------------------------------------------------|
|                         | <i>Additionally this development includes trees and shrubs to screen the source of noise from occupants.</i>                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                          |                                                                                  |
| No outdoor amenity area | <p><i>Purchasers/tenants are advised that sound levels due to increasing road/rail/Light Rail/transitway traffic will interfere with outdoor activities as the sound levels exceed the sound level limits of the City and the Ministry of the Environment.</i></p> <p><i>To help address the need for sound attenuation this development includes:</i></p> <ul style="list-style-type: none"> <li>• multi-pane glass;</li> <li>• double brick veneer;</li> <li>• high sound transmission class walls.</li> </ul> <p><i>To ensure that provincial sound level limits are not exceeded it is important to maintain these sound attenuation features.</i></p> <p><i>This dwelling unit has been supplied with a central air conditioning system and other measures which will allow windows and exterior doors to remain closed, thereby ensuring that the indoor sound levels are within the sound level limits of the City and the Ministry of the Environment</i></p> | This warning clause notes that only an indoor environment is being provided for. |


## Stationary Source Warning Clauses

The Province notes that it is not acceptable to use warning clauses in place of physical noise control measures to identify an excess over the MOE sound level limits for stationary sources. The generic warning clause for stationary sources (called Type E in NPC-300) may identify a potential concern due to the proximity of the facility but it is not possible to justify exceeding the sound level limits.

The wording of the generic stationary noise warning clause may also be used as the basis for new development adjacent to areas licensed for mineral aggregate extraction.

Note:  
1) This map forms part of the Transportation Master Plan of the City of Ottawa and must be read in conjunction with the text.  
2) This map is intended as a framework for planning and design; consequently alignments of proposed roads are approximate and subject to detailed study.  
3) The road network shown in the Kanata West to Fernbank Road area is subject to confirmation.

Note:  
1) La présente carte fait partie du Plan directeur de transports de la Ville d'Ottawa et doit être consultée en se reportant au texte même du Plan officiel.  
2) La présente carte doit servir de guide en matière de planification et de conception; il s'ensuit que le tracé des routes proposées n'est qu'approximatif et donnera lieu à une étude plus approfondie.  
3) Le réseau routier dans le secteur de Kanata Ouest au chemin Fernbank est provisoire et sujet à l'approbation.

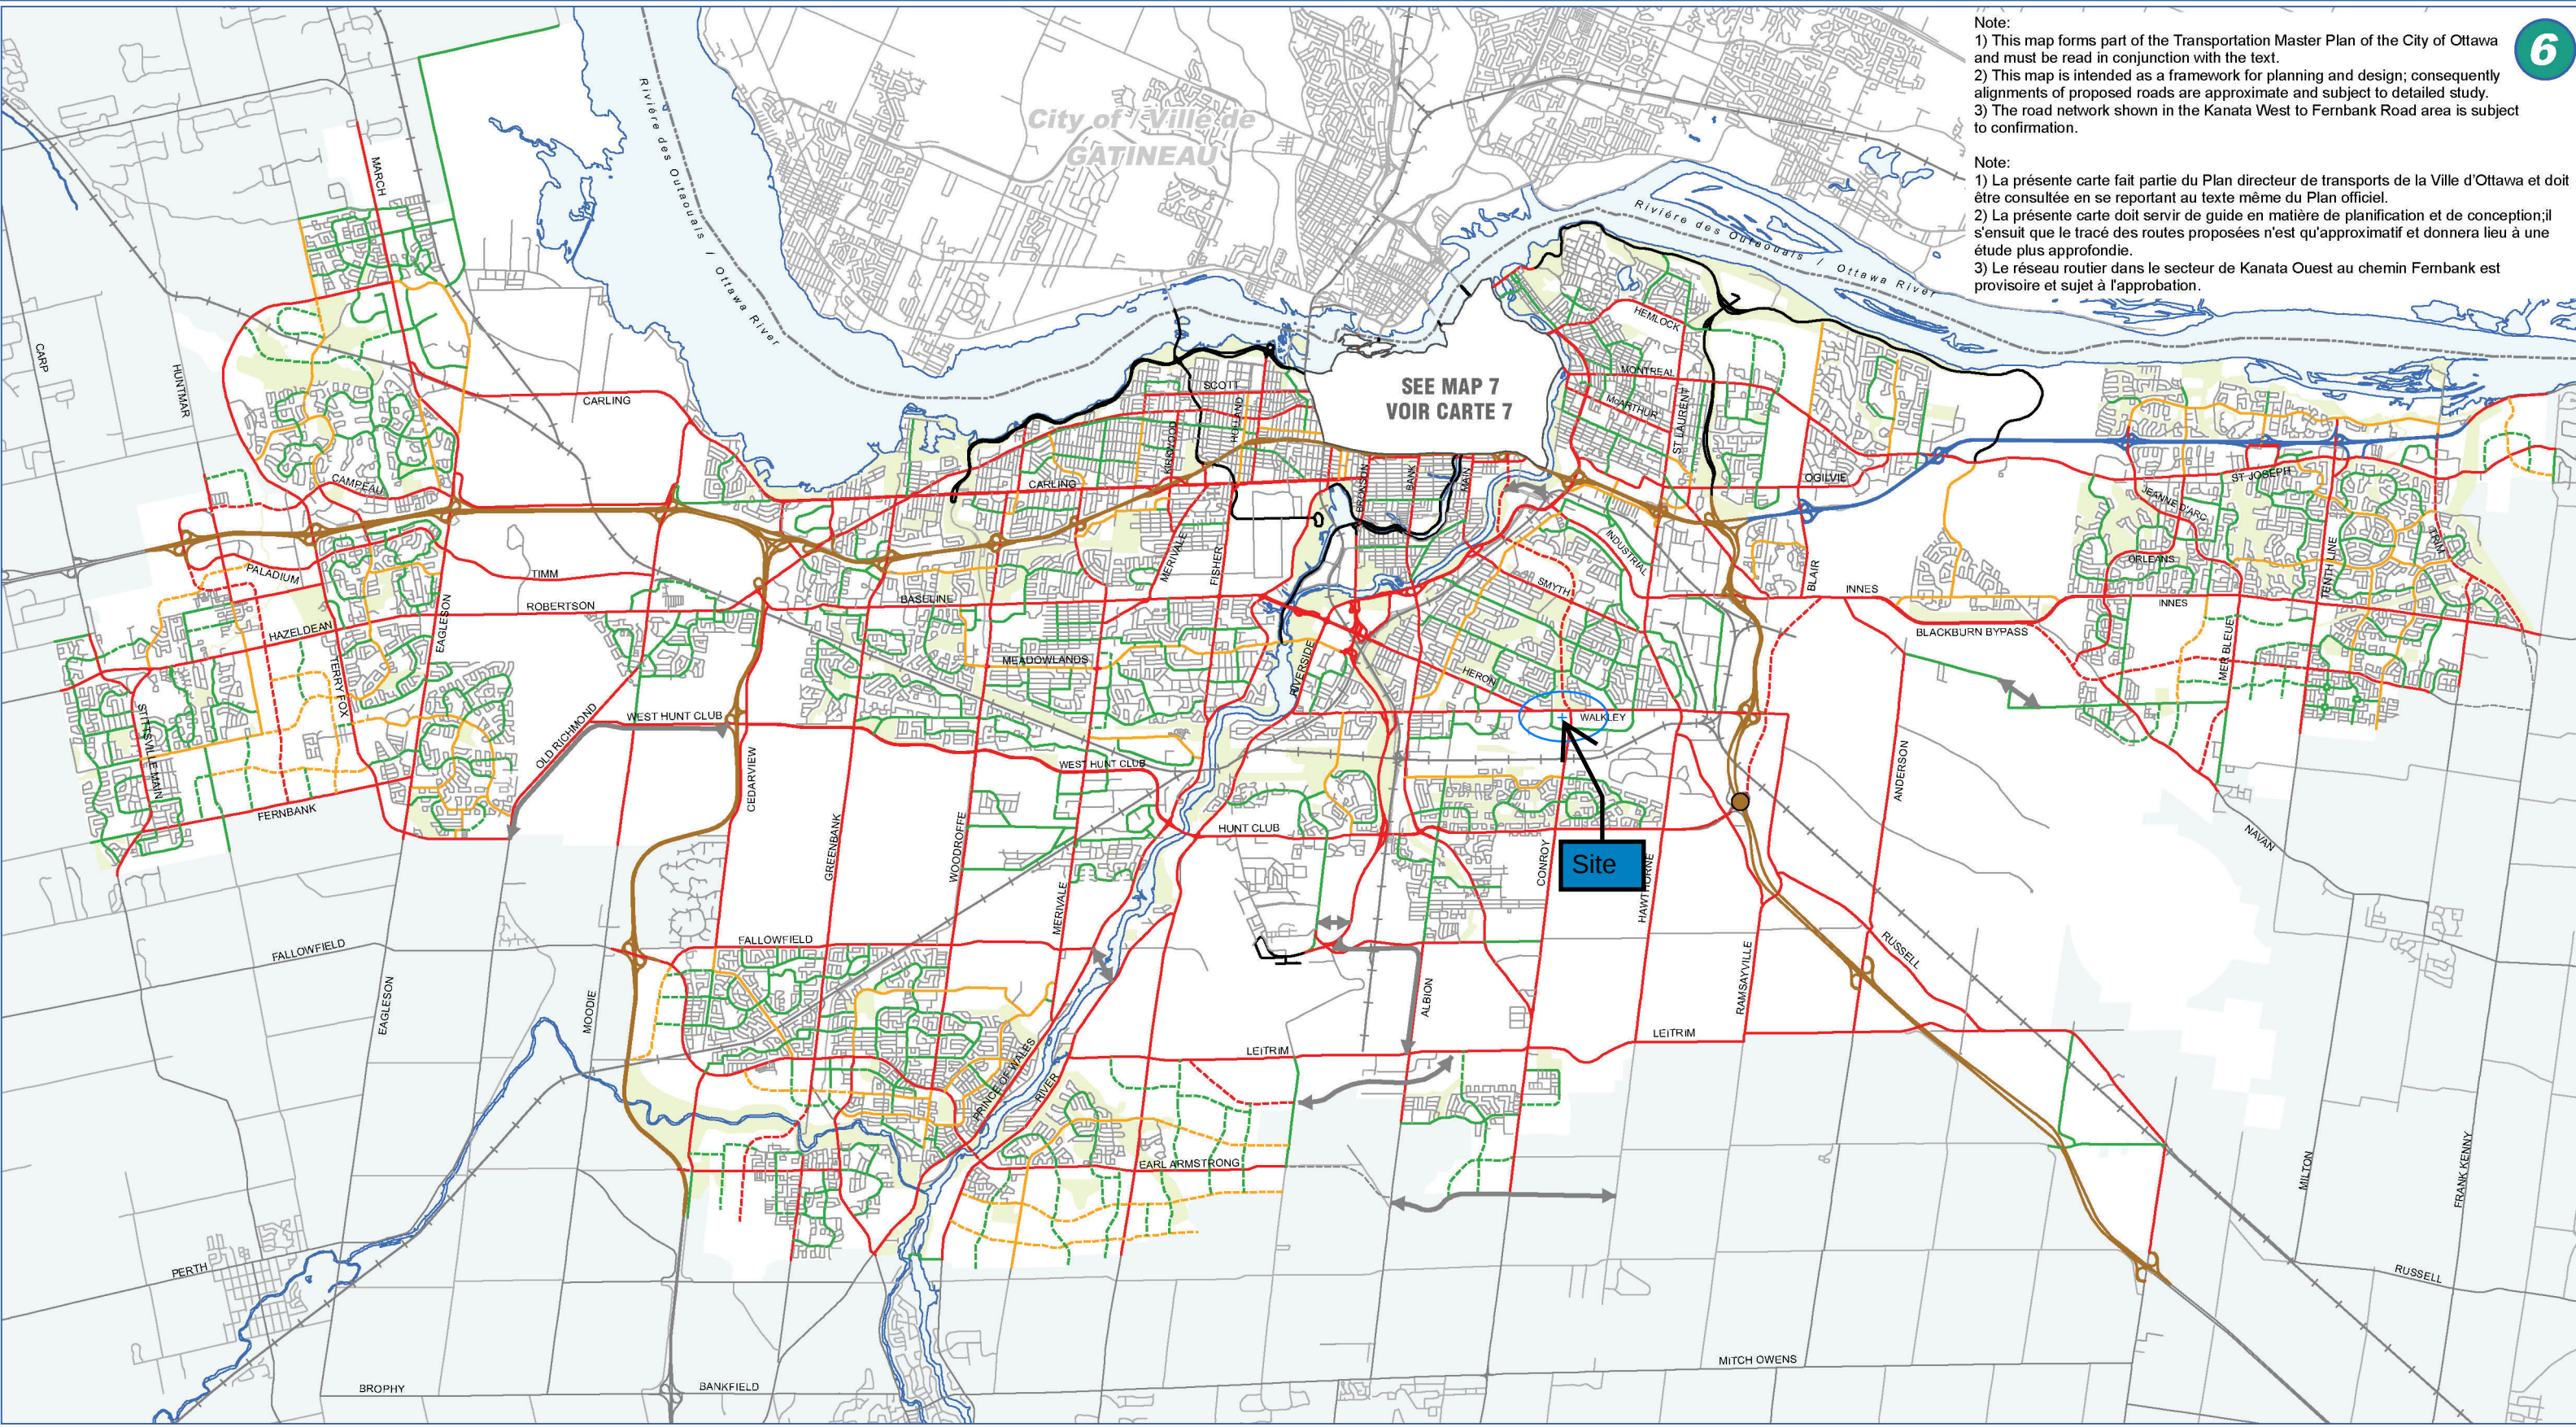

SEE MAP 7  
VOIR CARTE 7

|                      |                              |                                             |                                                 |
|----------------------|------------------------------|---------------------------------------------|-------------------------------------------------|
| Provincial Highway   | Chemins de propriété fédéral | Arterial - Existing                         | Artère - Établie                                |
| Federally Owned Road | Route provinciale            | Arterial - Proposed (alignment defined)     | Artère - Proposé (alignement déterminée)        |
| City Freeway         | Autoroute de ville           | Arterial - Conceptual (alignment undefined) | Artère - Conceptuelle (alignement à déterminer) |
|                      |                              | Major Collector - Existing                  | Grande collectrice - Établie                    |
|                      |                              | Major Collector - Proposed                  | Grande collectrice - Proposé                    |
|                      |                              | Collector - Existing                        | Collectrice - Établie                           |
|                      |                              | Collector - Proposed                        | Collectrice - Proposé                           |
|                      |                              | New Interchange                             | Nouvel échangeur                                |

## **APPENDIX B**

### Sound Level Calculations

Filename: ola1.te                      Time Period: Day/Night 16/8 hours  
Description: Outdoor Living Area

Road data, segment # 1: Conroy (day/night)

-----  
Car traffic volume : 34408/2992 veh/TimePeriod \*  
Medium truck volume : 2737/238 veh/TimePeriod \*  
Heavy truck volume : 1955/170 veh/TimePeriod \*  
Posted speed limit : 60 km/h  
Road gradient : 1 %  
Road pavement : 1 (Typical asphalt or concrete)

\* Refers to calculated road volumes based on the following input:

24 hr Traffic Volume (AADT or SADT): 42500  
Percentage of Annual Growth : 0.00  
Number of Years of Growth : 0.00  
Medium Truck % of Total Volume : 7.00  
Heavy Truck % of Total Volume : 5.00  
Day (16 hrs) % of Total Volume : 92.00

Data for Segment # 1: Conroy (day/night)

-----  
Angle1 Angle2 : -84.00 deg 66.00 deg  
Wood depth : 0 (No woods.)  
No of house rows : 0 / 0  
Surface : 1 (Absorptive ground surface)  
Receiver source distance : 59.00 / 59.00 m  
Receiver height : 1.50 / 1.50 m  
Topography : 2 (Flat/gentle slope; with barrier)  
Barrier angle1 : -84.00 deg Angle2 : -48.00 deg  
Barrier height : 6.00 m  
Barrier receiver distance : 3.00 / 3.00 m  
Source elevation : 85.10 m  
Receiver elevation : 85.55 m  
Barrier elevation : 86.22 m  
Reference angle : 0.00

↑

Road data, segment # 2: Conroy (day/night)

-----  
Car traffic volume : 34408/2992 veh/TimePeriod \*  
Medium truck volume : 2737/238 veh/TimePeriod \*  
Heavy truck volume : 1955/170 veh/TimePeriod \*  
Posted speed limit : 60 km/h  
Road gradient : 1 %

Road pavement : 1 (Typical asphalt or concrete)

\* Refers to calculated road volumes based on the following input:

24 hr Traffic Volume (AADT or SADT): 42500  
Percentage of Annual Growth : 0.00  
Number of Years of Growth : 0.00  
Medium Truck % of Total Volume : 7.00  
Heavy Truck % of Total Volume : 5.00  
Day (16 hrs) % of Total Volume : 92.00

Data for Segment # 2: Conroy (day/night)

-----  
Angle1 Angle2 : 66.00 deg 90.00 deg  
Wood depth : 0 (No woods.)  
No of house rows : 0 / 0  
Surface : 1 (Absorptive ground surface)  
Receiver source distance : 59.00 / 59.00 m  
Receiver height : 1.50 / 1.50 m  
Topography : 2 (Flat/gentle slope; with barrier)  
Barrier angle1 : 66.00 deg Angle2 : 90.00 deg  
Barrier height : 6.00 m  
Barrier receiver distance : 3.00 / 3.00 m  
Source elevation : 85.10 m  
Receiver elevation : 85.55 m  
Barrier elevation : 85.80 m  
Reference angle : 0.00

↑  
Result summary (day)

-----  
! source ! Road ! Total  
! height ! Leq ! Leq  
! (m) ! (dBA) ! (dBA)  
-----  
1.Conroy ! 1.50 ! 62.15 ! 62.15  
2.Conroy ! 1.50 ! 42.80 ! 42.80  
-----  
Total 62.20 dBA

↑  
Result summary (night)

-----  
! source ! Road ! Total  
! height ! Leq ! Leq  
! (m) ! (dBA) ! (dBA)  
-----  
1.Conroy ! 1.50 ! 54.55 ! 54.55

|                         |   |      |   |           |   |       |
|-------------------------|---|------|---|-----------|---|-------|
| 2.Conroy                | ! | 1.50 | ! | 35.21     | ! | 35.21 |
| -----+-----+-----+----- |   |      |   |           |   |       |
| Total                   |   |      |   | 54.60 dBA |   |       |

↑

TOTAL Leq FROM ALL SOURCES (DAY): 62.20  
(NIGHT): 54.60

↑

↑

Filename: ollw.te                      Time Period: Day/Night 16/8 hours  
Description: OLA1 - 2.5m Wall

Road data, segment # 1: Conroy (day/night)

-----  
Car traffic volume : 34408/2992 veh/TimePeriod \*  
Medium truck volume : 2737/238 veh/TimePeriod \*  
Heavy truck volume : 1955/170 veh/TimePeriod \*  
Posted speed limit : 60 km/h  
Road gradient : 1 %  
Road pavement : 1 (Typical asphalt or concrete)

\* Refers to calculated road volumes based on the following input:

24 hr Traffic Volume (AADT or SADT): 42500  
Percentage of Annual Growth : 0.00  
Number of Years of Growth : 0.00  
Medium Truck % of Total Volume : 7.00  
Heavy Truck % of Total Volume : 5.00  
Day (16 hrs) % of Total Volume : 92.00

Data for Segment # 1: Conroy (day/night)

-----  
Angle1 Angle2 : -84.00 deg -48.00 deg  
Wood depth : 0 (No woods.)  
No of house rows : 0 / 0  
Surface : 1 (Absorptive ground surface)  
Receiver source distance : 59.00 / 59.00 m  
Receiver height : 1.50 / 1.50 m  
Topography : 2 (Flat/gentle slope; with barrier)  
Barrier angle1 : -84.00 deg Angle2 : -48.00 deg  
Barrier height : 6.00 m  
Barrier receiver distance : 3.00 / 3.00 m  
Source elevation : 85.10 m  
Receiver elevation : 85.60 m  
Barrier elevation : 86.72 m  
Reference angle : 0.00

↑

Road data, segment # 2: Conroy (day/night)

-----  
Car traffic volume : 34408/2992 veh/TimePeriod \*  
Medium truck volume : 2737/238 veh/TimePeriod \*  
Heavy truck volume : 1955/170 veh/TimePeriod \*  
Posted speed limit : 60 km/h  
Road gradient : 1 %

Road pavement : 1 (Typical asphalt or concrete)

\* Refers to calculated road volumes based on the following input:

24 hr Traffic Volume (AADT or SADT): 42500  
Percentage of Annual Growth : 0.00  
Number of Years of Growth : 0.00  
Medium Truck % of Total Volume : 7.00  
Heavy Truck % of Total Volume : 5.00  
Day (16 hrs) % of Total Volume : 92.00

Data for Segment # 2: Conroy (day/night)

-----  
Angle1 Angle2 : -48.00 deg -18.00 deg  
Wood depth : 0 (No woods.)  
No of house rows : 0 / 0  
Surface : 1 (Absorptive ground surface)  
Receiver source distance : 59.00 / 59.00 m  
Receiver height : 1.50 / 1.50 m  
Topography : 2 (Flat/gentle slope; with barrier)  
Barrier angle1 : -48.00 deg Angle2 : -18.00 deg  
Barrier height : 2.50 m  
Barrier receiver distance : 4.30 / 4.30 m  
Source elevation : 85.10 m  
Receiver elevation : 85.60 m  
Barrier elevation : 85.60 m  
Reference angle : 0.00

↑

Road data, segment # 3: Conroy (day/night)

-----  
Car traffic volume : 34408/2992 veh/TimePeriod \*  
Medium truck volume : 2737/238 veh/TimePeriod \*  
Heavy truck volume : 1955/170 veh/TimePeriod \*  
Posted speed limit : 60 km/h  
Road gradient : 1 %  
Road pavement : 1 (Typical asphalt or concrete)

\* Refers to calculated road volumes based on the following input:

24 hr Traffic Volume (AADT or SADT): 42500  
Percentage of Annual Growth : 0.00  
Number of Years of Growth : 0.00  
Medium Truck % of Total Volume : 7.00  
Heavy Truck % of Total Volume : 5.00  
Day (16 hrs) % of Total Volume : 92.00

Data for Segment # 3: Conroy (day/night)

-----  
Angle1 Angle2 : -18.00 deg 72.00 deg

Wood depth : 0 (No woods.)  
 No of house rows : 0 / 0  
 Surface : 1 (Absorptive ground surface)  
 Receiver source distance : 59.00 / 59.00 m  
 Receiver height : 1.50 / 1.50 m  
 Topography : 2 (Flat/gentle slope; with barrier)  
 Barrier angle1 : -18.00 deg Angle2 : 7.00 deg  
 Barrier height : 2.50 m  
 Barrier receiver distance : 3.00 / 3.00 m  
 Source elevation : 85.10 m  
 Receiver elevation : 85.60 m  
 Barrier elevation : 85.55 m  
 Reference angle : 0.00

↑

#### Road data, segment # 4: Conroy (day/night)

-----  
 Car traffic volume : 34408/2992 veh/TimePeriod \*  
 Medium truck volume : 2737/238 veh/TimePeriod \*  
 Heavy truck volume : 1955/170 veh/TimePeriod \*  
 Posted speed limit : 60 km/h  
 Road gradient : 1 %  
 Road pavement : 1 (Typical asphalt or concrete)

\* Refers to calculated road volumes based on the following input:

24 hr Traffic Volume (AADT or SADT): 42500  
 Percentage of Annual Growth : 0.00  
 Number of Years of Growth : 0.00  
 Medium Truck % of Total Volume : 7.00  
 Heavy Truck % of Total Volume : 5.00  
 Day (16 hrs) % of Total Volume : 92.00

#### Data for Segment # 4: Conroy (day/night)

-----  
 Angle1 Angle2 : 72.00 deg 90.00 deg  
 Wood depth : 0 (No woods.)  
 No of house rows : 0 / 0  
 Surface : 1 (Absorptive ground surface)  
 Receiver source distance : 59.00 / 59.00 m  
 Receiver height : 1.50 / 1.50 m  
 Topography : 2 (Flat/gentle slope; with barrier)  
 Barrier angle1 : 72.00 deg Angle2 : 90.00 deg  
 Barrier height : 6.00 m  
 Barrier receiver distance : 3.00 / 3.00 m  
 Source elevation : 85.10 m  
 Receiver elevation : 85.60 m  
 Barrier elevation : 85.80 m  
 Reference angle : 0.00



### Result summary (day)

-----

|                         | ! | source | ! | Road  | ! | Total     |
|-------------------------|---|--------|---|-------|---|-----------|
|                         | ! | height | ! | Leq   | ! | Leq       |
|                         | ! | (m)    | ! | (dBA) | ! | (dBA)     |
| -----+-----+-----+----- |   |        |   |       |   |           |
| 1.Conroy                | ! | 1.50   | ! | 40.39 | ! | 40.39     |
| 2.Conroy                | ! | 1.50   | ! | 48.28 | ! | 48.28     |
| 3.Conroy                | ! | 1.50   | ! | 59.51 | ! | 59.51     |
| 4.Conroy                | ! | 1.50   | ! | 42.10 | ! | 42.10     |
| -----+-----+-----+----- |   |        |   |       |   |           |
|                         |   | Total  |   |       |   | 59.95 dBA |



### Result summary (night)

-----

|                         | ! | source | ! | Road  | ! | Total     |
|-------------------------|---|--------|---|-------|---|-----------|
|                         | ! | height | ! | Leq   | ! | Leq       |
|                         | ! | (m)    | ! | (dBA) | ! | (dBA)     |
| -----+-----+-----+----- |   |        |   |       |   |           |
| 1.Conroy                | ! | 1.50   | ! | 32.79 | ! | 32.79     |
| 2.Conroy                | ! | 1.50   | ! | 40.68 | ! | 40.68     |
| 3.Conroy                | ! | 1.50   | ! | 51.92 | ! | 51.92     |
| 4.Conroy                | ! | 1.50   | ! | 34.51 | ! | 34.51     |
| -----+-----+-----+----- |   |        |   |       |   |           |
|                         |   | Total  |   |       |   | 52.36 dBA |



TOTAL Leq FROM ALL SOURCES (DAY): 59.95  
(NIGHT): 52.36



Filename: ol11w.te                      Time Period: Day/Night 16/8 hours  
Description: OLA1-1 - 2.5m Wall

Road data, segment # 1: Conroy (day/night)

-----  
Car traffic volume : 34408/2992 veh/TimePeriod \*  
Medium truck volume : 2737/238 veh/TimePeriod \*  
Heavy truck volume : 1955/170 veh/TimePeriod \*  
Posted speed limit : 60 km/h  
Road gradient : 1 %  
Road pavement : 1 (Typical asphalt or concrete)

\* Refers to calculated road volumes based on the following input:

24 hr Traffic Volume (AADT or SADT): 42500  
Percentage of Annual Growth : 0.00  
Number of Years of Growth : 0.00  
Medium Truck % of Total Volume : 7.00  
Heavy Truck % of Total Volume : 5.00  
Day (16 hrs) % of Total Volume : 92.00

Data for Segment # 1: Conroy (day/night)

-----  
Angle1 Angle2 : -81.00 deg -16.00 deg  
Wood depth : 0 (No woods.)  
No of house rows : 0 / 0  
Surface : 1 (Absorptive ground surface)  
Receiver source distance : 70.00 / 70.00 m  
Receiver height : 1.50 / 1.50 m  
Topography : 2 (Flat/gentle slope; with barrier)  
Barrier angle1 : -81.00 deg Angle2 : -16.00 deg  
Barrier height : 6.00 m  
Barrier receiver distance : 3.00 / 3.00 m  
Source elevation : 85.10 m  
Receiver elevation : 85.60 m  
Barrier elevation : 86.72 m  
Reference angle : 0.00

↑

Road data, segment # 2: Conroy (day/night)

-----  
Car traffic volume : 34408/2992 veh/TimePeriod \*  
Medium truck volume : 2737/238 veh/TimePeriod \*  
Heavy truck volume : 1955/170 veh/TimePeriod \*  
Posted speed limit : 60 km/h  
Road gradient : 1 %

Road pavement : 1 (Typical asphalt or concrete)

\* Refers to calculated road volumes based on the following input:

24 hr Traffic Volume (AADT or SADT): 42500  
Percentage of Annual Growth : 0.00  
Number of Years of Growth : 0.00  
Medium Truck % of Total Volume : 7.00  
Heavy Truck % of Total Volume : 5.00  
Day (16 hrs) % of Total Volume : 92.00

Data for Segment # 2: Conroy (day/night)

-----  
Angle1 Angle2 : -16.00 deg -9.00 deg  
Wood depth : 0 (No woods.)  
No of house rows : 0 / 0  
Surface : 1 (Absorptive ground surface)  
Receiver source distance : 70.00 / 70.00 m  
Receiver height : 1.50 / 1.50 m  
Topography : 2 (Flat/gentle slope; with barrier)  
Barrier angle1 : -16.00 deg Angle2 : -9.00 deg  
Barrier height : 2.50 m  
Barrier receiver distance : 16.00 / 16.00 m  
Source elevation : 85.10 m  
Receiver elevation : 85.60 m  
Barrier elevation : 85.60 m  
Reference angle : 0.00

↑

Road data, segment # 3: Conroy (day/night)

-----  
Car traffic volume : 34408/2992 veh/TimePeriod \*  
Medium truck volume : 2737/238 veh/TimePeriod \*  
Heavy truck volume : 1955/170 veh/TimePeriod \*  
Posted speed limit : 60 km/h  
Road gradient : 1 %  
Road pavement : 1 (Typical asphalt or concrete)

\* Refers to calculated road volumes based on the following input:

24 hr Traffic Volume (AADT or SADT): 42500  
Percentage of Annual Growth : 0.00  
Number of Years of Growth : 0.00  
Medium Truck % of Total Volume : 7.00  
Heavy Truck % of Total Volume : 5.00  
Day (16 hrs) % of Total Volume : 92.00

Data for Segment # 3: Conroy (day/night)

-----  
Angle1 Angle2 : -9.00 deg 25.00 deg

Wood depth : 0 (No woods.)  
 No of house rows : 0 / 0  
 Surface : 1 (Absorptive ground surface)  
 Receiver source distance : 70.00 / 70.00 m  
 Receiver height : 1.50 / 1.50 m  
 Topography : 2 (Flat/gentle slope; with barrier)  
 Barrier angle1 : -9.00 deg Angle2 : -3.00 deg  
 Barrier height : 2.50 m  
 Barrier receiver distance : 3.00 / 3.00 m  
 Source elevation : 85.10 m  
 Receiver elevation : 85.60 m  
 Barrier elevation : 85.55 m  
 Reference angle : 0.00

↑

Road data, segment # 4: Conroy (day/night)

-----  
 Car traffic volume : 34408/2992 veh/TimePeriod \*  
 Medium truck volume : 2737/238 veh/TimePeriod \*  
 Heavy truck volume : 1955/170 veh/TimePeriod \*  
 Posted speed limit : 60 km/h  
 Road gradient : 1 %  
 Road pavement : 1 (Typical asphalt or concrete)

\* Refers to calculated road volumes based on the following input:

24 hr Traffic Volume (AADT or SADT): 42500  
 Percentage of Annual Growth : 0.00  
 Number of Years of Growth : 0.00  
 Medium Truck % of Total Volume : 7.00  
 Heavy Truck % of Total Volume : 5.00  
 Day (16 hrs) % of Total Volume : 92.00

Data for Segment # 4: Conroy (day/night)

-----  
 Angle1 Angle2 : 25.00 deg 90.00 deg  
 Wood depth : 0 (No woods.)  
 No of house rows : 0 / 0  
 Surface : 1 (Absorptive ground surface)  
 Receiver source distance : 70.00 / 70.00 m  
 Receiver height : 1.50 / 1.50 m  
 Topography : 2 (Flat/gentle slope; with barrier)  
 Barrier angle1 : 25.00 deg Angle2 : 90.00 deg  
 Barrier height : 6.00 m  
 Barrier receiver distance : 3.00 / 3.00 m  
 Source elevation : 85.10 m  
 Receiver elevation : 85.60 m  
 Barrier elevation : 85.80 m  
 Reference angle : 0.00



### Result summary (day)

|          | ! | source | ! | Road  | ! | Total     |
|----------|---|--------|---|-------|---|-----------|
|          | ! | height | ! | Leq   | ! | Leq       |
|          | ! | (m)    | ! | (dBA) | ! | (dBA)     |
| 1.Conroy | ! | 1.50   | ! | 41.46 | ! | 41.46     |
| 2.Conroy | ! | 1.50   | ! | 43.09 | ! | 43.09     |
| 3.Conroy | ! | 1.50   | ! | 55.36 | ! | 55.36     |
| 4.Conroy | ! | 1.50   | ! | 44.45 | ! | 44.45     |
| Total    |   |        |   |       |   | 56.08 dBA |



### Result summary (night)

|          | ! | source | ! | Road  | ! | Total     |
|----------|---|--------|---|-------|---|-----------|
|          | ! | height | ! | Leq   | ! | Leq       |
|          | ! | (m)    | ! | (dBA) | ! | (dBA)     |
| 1.Conroy | ! | 1.50   | ! | 33.86 | ! | 33.86     |
| 2.Conroy | ! | 1.50   | ! | 35.50 | ! | 35.50     |
| 3.Conroy | ! | 1.50   | ! | 47.77 | ! | 47.77     |
| 4.Conroy | ! | 1.50   | ! | 36.85 | ! | 36.85     |
| Total    |   |        |   |       |   | 48.49 dBA |



TOTAL Leq FROM ALL SOURCES (DAY): 56.08  
(NIGHT): 48.49



Filename: ol12.te                      Time Period: Day/Night 16/8 hours  
Description: OLA 1-2 No Wall

Road data, segment # 1: Conroy (day/night)

-----  
Car traffic volume : 34408/2992 veh/TimePeriod \*  
Medium truck volume : 2737/238 veh/TimePeriod \*  
Heavy truck volume : 1955/170 veh/TimePeriod \*  
Posted speed limit : 60 km/h  
Road gradient : 1 %  
Road pavement : 1 (Typical asphalt or concrete)

\* Refers to calculated road volumes based on the following input:

24 hr Traffic Volume (AADT or SADT): 42500  
Percentage of Annual Growth : 0.00  
Number of Years of Growth : 0.00  
Medium Truck % of Total Volume : 7.00  
Heavy Truck % of Total Volume : 5.00  
Day (16 hrs) % of Total Volume : 92.00

Data for Segment # 1: Conroy (day/night)

-----  
Angle1 Angle2 : -81.00 deg -14.00 deg  
Wood depth : 0 (No woods.)  
No of house rows : 3 / 0  
Surface : 1 (Absorptive ground surface)  
Receiver source distance : 75.00 / 75.00 m  
Receiver height : 1.50 / 4.50 m  
Topography : 2 (Flat/gentle slope; with barrier)  
Barrier angle1 : -81.00 deg Angle2 : -14.00 deg  
Barrier height : 6.00 m  
Barrier receiver distance : 3.00 / 3.00 m  
Source elevation : 85.10 m  
Receiver elevation : 85.55 m  
Barrier elevation : 86.72 m  
Reference angle : 0.00

↑

Road data, segment # 2: Conroy (day/night)

-----  
Car traffic volume : 34408/2992 veh/TimePeriod \*  
Medium truck volume : 2737/238 veh/TimePeriod \*  
Heavy truck volume : 1955/170 veh/TimePeriod \*  
Posted speed limit : 60 km/h  
Road gradient : 1 %

Road pavement : 1 (Typical asphalt or concrete)

\* Refers to calculated road volumes based on the following input:

24 hr Traffic Volume (AADT or SADT): 42500  
Percentage of Annual Growth : 0.00  
Number of Years of Growth : 0.00  
Medium Truck % of Total Volume : 7.00  
Heavy Truck % of Total Volume : 5.00  
Day (16 hrs) % of Total Volume : 92.00

Data for Segment # 2: Conroy (day/night)

-----  
Angle1 Angle2 : -14.00 deg 90.00 deg  
Wood depth : 0 (No woods.)  
No of house rows : 0 / 0  
Surface : 1 (Absorptive ground surface)  
Receiver source distance : 75.00 / 75.00 m  
Receiver height : 1.50 / 4.50 m  
Topography : 2 (Flat/gentle slope; with barrier)  
Barrier angle1 : 16.00 deg Angle2 : 90.00 deg  
Barrier height : 6.00 m  
Barrier receiver distance : 3.00 / 3.00 m  
Source elevation : 85.10 m  
Receiver elevation : 85.55 m  
Barrier elevation : 85.80 m  
Reference angle : 0.00

↑

Result summary (day)

-----  
! source ! Road ! Total  
! height ! Leq ! Leq  
! (m) ! (dBA) ! (dBA)  
-----  
1.Conroy ! 1.50 ! 41.19 ! 41.19  
2.Conroy ! 1.50 ! 55.46 ! 55.46  
-----  
Total 55.62 dBA

↑

Result summary (night)

-----  
! source ! Road ! Total  
! height ! Leq ! Leq  
! (m) ! (dBA) ! (dBA)  
-----  
1.Conroy ! 1.50 ! 38.13 ! 38.13

|                         |   |      |   |       |           |       |
|-------------------------|---|------|---|-------|-----------|-------|
| 2.Conroy                | ! | 1.50 | ! | 49.20 | !         | 49.20 |
| -----+-----+-----+----- |   |      |   |       |           |       |
| Total                   |   |      |   |       | 49.53 dBA |       |

↑

TOTAL Leq FROM ALL SOURCES (DAY): 55.62  
(NIGHT): 49.53

↑

↑

Filename: ol12w.te                      Time Period: Day/Night 16/8 hours  
Description: OLA1-2 - 2.5m Wall

Road data, segment # 1: Conroy (day/night)

-----  
Car traffic volume : 34408/2992 veh/TimePeriod \*  
Medium truck volume : 2737/238 veh/TimePeriod \*  
Heavy truck volume : 1955/170 veh/TimePeriod \*  
Posted speed limit : 60 km/h  
Road gradient : 1 %  
Road pavement : 1 (Typical asphalt or concrete)

\* Refers to calculated road volumes based on the following input:

24 hr Traffic Volume (AADT or SADT): 42500  
Percentage of Annual Growth : 0.00  
Number of Years of Growth : 0.00  
Medium Truck % of Total Volume : 7.00  
Heavy Truck % of Total Volume : 5.00  
Day (16 hrs) % of Total Volume : 92.00

Data for Segment # 1: Conroy (day/night)

-----  
Angle1 Angle2 : -80.00 deg -13.00 deg  
Wood depth : 0 (No woods.)  
No of house rows : 0 / 0  
Surface : 1 (Absorptive ground surface)  
Receiver source distance : 77.00 / 77.00 m  
Receiver height : 1.50 / 1.50 m  
Topography : 2 (Flat/gentle slope; with barrier)  
Barrier angle1 : -80.00 deg Angle2 : -13.00 deg  
Barrier height : 6.00 m  
Barrier receiver distance : 3.00 / 3.00 m  
Source elevation : 85.10 m  
Receiver elevation : 85.67 m  
Barrier elevation : 86.72 m  
Reference angle : 0.00

↑

Road data, segment # 2: Conroy (day/night)

-----  
Car traffic volume : 34408/2992 veh/TimePeriod \*  
Medium truck volume : 2737/238 veh/TimePeriod \*  
Heavy truck volume : 1955/170 veh/TimePeriod \*  
Posted speed limit : 60 km/h  
Road gradient : 1 %

Road pavement : 1 (Typical asphalt or concrete)

\* Refers to calculated road volumes based on the following input:

24 hr Traffic Volume (AADT or SADT): 42500  
Percentage of Annual Growth : 0.00  
Number of Years of Growth : 0.00  
Medium Truck % of Total Volume : 7.00  
Heavy Truck % of Total Volume : 5.00  
Day (16 hrs) % of Total Volume : 92.00

Data for Segment # 2: Conroy (day/night)

-----  
Angle1 Angle2 : -13.00 deg -7.00 deg  
Wood depth : 0 (No woods.)  
No of house rows : 0 / 0  
Surface : 1 (Absorptive ground surface)  
Receiver source distance : 77.00 / 77.00 m  
Receiver height : 1.50 / 1.50 m  
Topography : 2 (Flat/gentle slope; with barrier)  
Barrier angle1 : -13.00 deg Angle2 : -7.00 deg  
Barrier height : 2.50 m  
Barrier receiver distance : 22.00 / 22.00 m  
Source elevation : 85.10 m  
Receiver elevation : 85.67 m  
Barrier elevation : 85.60 m  
Reference angle : 0.00

↑

Road data, segment # 3: Conroy (day/night)

-----  
Car traffic volume : 34408/2992 veh/TimePeriod \*  
Medium truck volume : 2737/238 veh/TimePeriod \*  
Heavy truck volume : 1955/170 veh/TimePeriod \*  
Posted speed limit : 60 km/h  
Road gradient : 1 %  
Road pavement : 1 (Typical asphalt or concrete)

\* Refers to calculated road volumes based on the following input:

24 hr Traffic Volume (AADT or SADT): 42500  
Percentage of Annual Growth : 0.00  
Number of Years of Growth : 0.00  
Medium Truck % of Total Volume : 7.00  
Heavy Truck % of Total Volume : 5.00  
Day (16 hrs) % of Total Volume : 92.00

Data for Segment # 3: Conroy (day/night)

-----  
Angle1 Angle2 : -7.00 deg 17.00 deg

Wood depth : 0 (No woods.)  
 No of house rows : 0 / 0  
 Surface : 1 (Absorptive ground surface)  
 Receiver source distance : 77.00 / 77.00 m  
 Receiver height : 1.50 / 1.50 m  
 Topography : 2 (Flat/gentle slope; with barrier)  
 Barrier angle1 : -7.00 deg Angle2 : -3.00 deg  
 Barrier height : 2.50 m  
 Barrier receiver distance : 3.00 / 3.00 m  
 Source elevation : 85.10 m  
 Receiver elevation : 85.67 m  
 Barrier elevation : 85.55 m  
 Reference angle : 0.00

↑

#### Road data, segment # 4: Conroy (day/night)

-----  
 Car traffic volume : 34408/2992 veh/TimePeriod \*  
 Medium truck volume : 2737/238 veh/TimePeriod \*  
 Heavy truck volume : 1955/170 veh/TimePeriod \*  
 Posted speed limit : 60 km/h  
 Road gradient : 1 %  
 Road pavement : 1 (Typical asphalt or concrete)

\* Refers to calculated road volumes based on the following input:

24 hr Traffic Volume (AADT or SADT): 42500  
 Percentage of Annual Growth : 0.00  
 Number of Years of Growth : 0.00  
 Medium Truck % of Total Volume : 7.00  
 Heavy Truck % of Total Volume : 5.00  
 Day (16 hrs) % of Total Volume : 92.00

#### Data for Segment # 4: Conroy (day/night)

-----  
 Angle1 Angle2 : 17.00 deg 90.00 deg  
 Wood depth : 0 (No woods.)  
 No of house rows : 0 / 0  
 Surface : 1 (Absorptive ground surface)  
 Receiver source distance : 77.00 / 77.00 m  
 Receiver height : 1.50 / 1.50 m  
 Topography : 2 (Flat/gentle slope; with barrier)  
 Barrier angle1 : 17.00 deg Angle2 : 90.00 deg  
 Barrier height : 6.00 m  
 Barrier receiver distance : 3.00 / 3.00 m  
 Source elevation : 85.10 m  
 Receiver elevation : 85.67 m  
 Barrier elevation : 85.80 m  
 Reference angle : 0.00



### Result summary (day)

-----

|                         | ! | source | ! | Road  | ! | Total     |
|-------------------------|---|--------|---|-------|---|-----------|
|                         | ! | height | ! | Leq   | ! | Leq       |
|                         | ! | (m)    | ! | (dBA) | ! | (dBA)     |
| -----+-----+-----+----- |   |        |   |       |   |           |
| 1.Conroy                | ! | 1.50   | ! | 41.02 | ! | 41.02     |
| 2.Conroy                | ! | 1.50   | ! | 42.26 | ! | 42.26     |
| 3.Conroy                | ! | 1.50   | ! | 53.26 | ! | 53.26     |
| 4.Conroy                | ! | 1.50   | ! | 44.31 | ! | 44.31     |
| -----+-----+-----+----- |   |        |   |       |   |           |
|                         |   | Total  |   |       |   | 54.29 dBA |



### Result summary (night)

-----

|                         | ! | source | ! | Road  | ! | Total     |
|-------------------------|---|--------|---|-------|---|-----------|
|                         | ! | height | ! | Leq   | ! | Leq       |
|                         | ! | (m)    | ! | (dBA) | ! | (dBA)     |
| -----+-----+-----+----- |   |        |   |       |   |           |
| 1.Conroy                | ! | 1.50   | ! | 33.42 | ! | 33.42     |
| 2.Conroy                | ! | 1.50   | ! | 34.67 | ! | 34.67     |
| 3.Conroy                | ! | 1.50   | ! | 45.67 | ! | 45.67     |
| 4.Conroy                | ! | 1.50   | ! | 36.71 | ! | 36.71     |
| -----+-----+-----+----- |   |        |   |       |   |           |
|                         |   | Total  |   |       |   | 46.69 dBA |



TOTAL Leq FROM ALL SOURCES (DAY): 54.29  
(NIGHT): 46.69



Filename: ol13.te                      Time Period: Day/Night 16/8 hours  
Description: OLA 1-3 No Wall

Road data, segment # 1: Conroy (day/night)

-----  
Car traffic volume : 34408/2992 veh/TimePeriod \*  
Medium truck volume : 2737/238 veh/TimePeriod \*  
Heavy truck volume : 1955/170 veh/TimePeriod \*  
Posted speed limit : 60 km/h  
Road gradient : 1 %  
Road pavement : 1 (Typical asphalt or concrete)

\* Refers to calculated road volumes based on the following input:

24 hr Traffic Volume (AADT or SADT): 42500  
Percentage of Annual Growth : 0.00  
Number of Years of Growth : 0.00  
Medium Truck % of Total Volume : 7.00  
Heavy Truck % of Total Volume : 5.00  
Day (16 hrs) % of Total Volume : 92.00

Data for Segment # 1: Conroy (day/night)

-----  
Angle1 Angle2 : -80.00 deg -12.00 deg  
Wood depth : 0 (No woods.)  
No of house rows : 3 / 0  
Surface : 1 (Absorptive ground surface)  
Receiver source distance : 82.00 / 82.00 m  
Receiver height : 1.50 / 1.50 m  
Topography : 2 (Flat/gentle slope; with barrier)  
Barrier angle1 : -80.00 deg Angle2 : -12.00 deg  
Barrier height : 6.00 m  
Barrier receiver distance : 3.00 / 3.00 m  
Source elevation : 85.10 m  
Receiver elevation : 85.68 m  
Barrier elevation : 86.72 m  
Reference angle : 0.00

↑

Road data, segment # 2: Conroy (day/night)

-----  
Car traffic volume : 34408/2992 veh/TimePeriod \*  
Medium truck volume : 2737/238 veh/TimePeriod \*  
Heavy truck volume : 1955/170 veh/TimePeriod \*  
Posted speed limit : 60 km/h  
Road gradient : 1 %

Road pavement : 1 (Typical asphalt or concrete)

\* Refers to calculated road volumes based on the following input:

24 hr Traffic Volume (AADT or SADT): 42500  
Percentage of Annual Growth : 0.00  
Number of Years of Growth : 0.00  
Medium Truck % of Total Volume : 7.00  
Heavy Truck % of Total Volume : 5.00  
Day (16 hrs) % of Total Volume : 92.00

Data for Segment # 2: Conroy (day/night)

-----  
Angle1 Angle2 : -12.00 deg 90.00 deg  
Wood depth : 0 (No woods.)  
No of house rows : 0 / 0  
Surface : 1 (Absorptive ground surface)  
Receiver source distance : 82.00 / 82.00 m  
Receiver height : 1.50 / 1.50 m  
Topography : 2 (Flat/gentle slope; with barrier)  
Barrier angle1 : 11.00 deg Angle2 : 90.00 deg  
Barrier height : 6.00 m  
Barrier receiver distance : 3.00 / 3.00 m  
Source elevation : 85.10 m  
Receiver elevation : 85.68 m  
Barrier elevation : 85.80 m  
Reference angle : 0.00

↑

Result summary (day)

-----  
! source ! Road ! Total  
! height ! Leq ! Leq  
! (m) ! (dBA) ! (dBA)  
-----  
1.Conroy ! 1.50 ! 40.74 ! 40.74  
2.Conroy ! 1.50 ! 53.82 ! 53.82  
-----  
Total 54.03 dBA

↑

Result summary (night)

-----  
! source ! Road ! Total  
! height ! Leq ! Leq  
! (m) ! (dBA) ! (dBA)  
-----  
1.Conroy ! 1.50 ! 33.14 ! 33.14

|                         |   |      |   |       |           |       |
|-------------------------|---|------|---|-------|-----------|-------|
| 2.Conroy                | ! | 1.50 | ! | 46.22 | !         | 46.22 |
| -----+-----+-----+----- |   |      |   |       |           |       |
| Total                   |   |      |   |       | 46.43 dBA |       |

↑

TOTAL Leq FROM ALL SOURCES (DAY): 54.03  
(NIGHT): 46.43

↑

↑

Filename: ola2.te                      Time Period: Day/Night 16/8 hours  
Description: Outdoor Living Area

Road data, segment # 1: Conroy (day/night)

-----  
Car traffic volume : 34408/2992 veh/TimePeriod \*  
Medium truck volume : 2737/238 veh/TimePeriod \*  
Heavy truck volume : 1955/170 veh/TimePeriod \*  
Posted speed limit : 60 km/h  
Road gradient : 1 %  
Road pavement : 1 (Typical asphalt or concrete)

\* Refers to calculated road volumes based on the following input:

24 hr Traffic Volume (AADT or SADT): 42500  
Percentage of Annual Growth : 0.00  
Number of Years of Growth : 0.00  
Medium Truck % of Total Volume : 7.00  
Heavy Truck % of Total Volume : 5.00  
Day (16 hrs) % of Total Volume : 92.00

Data for Segment # 1: Conroy (day/night)

-----  
Angle1 Angle2 : -75.00 deg 45.00 deg  
Wood depth : 0 (No woods.)  
No of house rows : 0 / 0  
Surface : 1 (Absorptive ground surface)  
Receiver source distance : 59.00 / 59.00 m  
Receiver height : 1.50 / 1.50 m  
Topography : 2 (Flat/gentle slope; with barrier)  
Barrier angle1 : -75.00 deg Angle2 : -70.00 deg  
Barrier height : 6.00 m  
Barrier receiver distance : 3.00 / 3.00 m  
Source elevation : 85.10 m  
Receiver elevation : 85.96 m  
Barrier elevation : 86.89 m  
Reference angle : 0.00

↑

Road data, segment # 2: Conroy (day/night)

-----  
Car traffic volume : 34408/2992 veh/TimePeriod \*  
Medium truck volume : 2737/238 veh/TimePeriod \*  
Heavy truck volume : 1955/170 veh/TimePeriod \*  
Posted speed limit : 60 km/h  
Road gradient : 1 %

Road pavement : 1 (Typical asphalt or concrete)

\* Refers to calculated road volumes based on the following input:

24 hr Traffic Volume (AADT or SADT): 42500  
Percentage of Annual Growth : 0.00  
Number of Years of Growth : 0.00  
Medium Truck % of Total Volume : 7.00  
Heavy Truck % of Total Volume : 5.00  
Day (16 hrs) % of Total Volume : 92.00

Data for Segment # 2: Conroy (day/night)

-----  
Angle1 Angle2 : 45.00 deg 90.00 deg  
Wood depth : 0 (No woods.)  
No of house rows : 2 / 0  
Surface : 1 (Absorptive ground surface)  
Receiver source distance : 59.00 / 59.00 m  
Receiver height : 1.50 / 1.50 m  
Topography : 2 (Flat/gentle slope; with barrier)  
Barrier angle1 : 45.00 deg Angle2 : 90.00 deg  
Barrier height : 6.00 m  
Barrier receiver distance : 3.00 / 3.00 m  
Source elevation : 85.10 m  
Receiver elevation : 85.96 m  
Barrier elevation : 86.74 m  
Reference angle : 0.00

↑

Result summary (day)

-----  
! source ! Road ! Total  
! height ! Leq ! Leq  
! (m) ! (dBA) ! (dBA)  
-----  
1.Conroy ! 1.50 ! 62.11 ! 62.11  
2.Conroy ! 1.50 ! 43.83 ! 43.83  
-----  
Total 62.17 dBA

↑

Result summary (night)

-----  
! source ! Road ! Total  
! height ! Leq ! Leq  
! (m) ! (dBA) ! (dBA)  
-----  
1.Conroy ! 1.50 ! 54.51 ! 54.51

|                         |   |      |   |           |   |       |
|-------------------------|---|------|---|-----------|---|-------|
| 2.Conroy                | ! | 1.50 | ! | 36.24     | ! | 36.24 |
| -----+-----+-----+----- |   |      |   |           |   |       |
| Total                   |   |      |   | 54.57 dBA |   |       |

↑

TOTAL Leq FROM ALL SOURCES (DAY): 62.17  
(NIGHT): 54.57

↑

↑

Filename: ol2w.te                      Time Period: Day/Night 16/8 hours  
Description: OLA2 - 2.5m Wall

Road data, segment # 1: Conroy (day/night)

-----  
Car traffic volume : 34408/2992 veh/TimePeriod \*  
Medium truck volume : 2737/238 veh/TimePeriod \*  
Heavy truck volume : 1955/170 veh/TimePeriod \*  
Posted speed limit : 60 km/h  
Road gradient : 1 %  
Road pavement : 1 (Typical asphalt or concrete)

\* Refers to calculated road volumes based on the following input:

24 hr Traffic Volume (AADT or SADT): 42500  
Percentage of Annual Growth : 0.00  
Number of Years of Growth : 0.00  
Medium Truck % of Total Volume : 7.00  
Heavy Truck % of Total Volume : 5.00  
Day (16 hrs) % of Total Volume : 92.00

Data for Segment # 1: Conroy (day/night)

-----  
Angle1 Angle2 : -75.00 deg -70.00 deg  
Wood depth : 0 (No woods.)  
No of house rows : 0 / 0  
Surface : 1 (Absorptive ground surface)  
Receiver source distance : 60.00 / 60.00 m  
Receiver height : 1.50 / 1.50 m  
Topography : 2 (Flat/gentle slope; with barrier)  
Barrier angle1 : -75.00 deg Angle2 : -70.00 deg  
Barrier height : 6.00 m  
Barrier receiver distance : 3.00 / 3.00 m  
Source elevation : 85.10 m  
Receiver elevation : 86.04 m  
Barrier elevation : 87.06 m  
Reference angle : 0.00

↑

Road data, segment # 2: Conroy (day/night)

-----  
Car traffic volume : 34408/2992 veh/TimePeriod \*  
Medium truck volume : 2737/238 veh/TimePeriod \*  
Heavy truck volume : 1955/170 veh/TimePeriod \*  
Posted speed limit : 60 km/h  
Road gradient : 1 %

Road pavement : 1 (Typical asphalt or concrete)

\* Refers to calculated road volumes based on the following input:

24 hr Traffic Volume (AADT or SADT): 42500  
Percentage of Annual Growth : 0.00  
Number of Years of Growth : 0.00  
Medium Truck % of Total Volume : 7.00  
Heavy Truck % of Total Volume : 5.00  
Day (16 hrs) % of Total Volume : 92.00

Data for Segment # 2: Conroy (day/night)

-----  
Angle1 Angle2 : -70.00 deg 45.00 deg  
Wood depth : 0 (No woods.)  
No of house rows : 0 / 0  
Surface : 1 (Absorptive ground surface)  
Receiver source distance : 60.00 / 60.00 m  
Receiver height : 1.50 / 1.50 m  
Topography : 2 (Flat/gentle slope; with barrier)  
Barrier angle1 : -65.00 deg Angle2 : 45.00 deg  
Barrier height : 2.50 m  
Barrier receiver distance : 4.70 / 4.70 m  
Source elevation : 85.10 m  
Receiver elevation : 86.04 m  
Barrier elevation : 85.78 m  
Reference angle : 0.00

↑

Road data, segment # 3: Conroy (day/night)

-----  
Car traffic volume : 34408/2992 veh/TimePeriod \*  
Medium truck volume : 2737/238 veh/TimePeriod \*  
Heavy truck volume : 1955/170 veh/TimePeriod \*  
Posted speed limit : 60 km/h  
Road gradient : 1 %  
Road pavement : 1 (Typical asphalt or concrete)

\* Refers to calculated road volumes based on the following input:

24 hr Traffic Volume (AADT or SADT): 42500  
Percentage of Annual Growth : 0.00  
Number of Years of Growth : 0.00  
Medium Truck % of Total Volume : 7.00  
Heavy Truck % of Total Volume : 5.00  
Day (16 hrs) % of Total Volume : 92.00

Data for Segment # 3: Conroy (day/night)

-----  
Angle1 Angle2 : 45.00 deg 90.00 deg

Wood depth : 0 (No woods.)  
 No of house rows : 2 / 0  
 Surface : 1 (Absorptive ground surface)  
 Receiver source distance : 60.00 / 60.00 m  
 Receiver height : 1.50 / 1.50 m  
 Topography : 2 (Flat/gentle slope; with barrier)  
 Barrier angle1 : 45.00 deg Angle2 : 90.00 deg  
 Barrier height : 6.00 m  
 Barrier receiver distance : 3.00 / 3.00 m  
 Source elevation : 85.10 m  
 Receiver elevation : 86.04 m  
 Barrier elevation : 87.05 m  
 Reference angle : 0.00

↑

#### Result summary (day)

-----

|                         | ! | source | ! | Road  | ! | Total     |
|-------------------------|---|--------|---|-------|---|-----------|
|                         | ! | height | ! | Leq   | ! | Leq       |
|                         | ! | (m)    | ! | (dBA) | ! | (dBA)     |
| 1.Conroy                | ! | 1.50   | ! | 31.56 | ! | 31.56     |
| 2.Conroy                | ! | 1.50   | ! | 55.74 | ! | 55.74     |
| 3.Conroy                | ! | 1.50   | ! | 43.55 | ! | 43.55     |
| -----+-----+-----+----- |   |        |   |       |   |           |
|                         |   | Total  |   |       |   | 56.01 dBA |

↑

#### Result summary (night)

-----

|                         | ! | source | ! | Road  | ! | Total     |
|-------------------------|---|--------|---|-------|---|-----------|
|                         | ! | height | ! | Leq   | ! | Leq       |
|                         | ! | (m)    | ! | (dBA) | ! | (dBA)     |
| 1.Conroy                | ! | 1.50   | ! | 23.97 | ! | 23.97     |
| 2.Conroy                | ! | 1.50   | ! | 48.14 | ! | 48.14     |
| 3.Conroy                | ! | 1.50   | ! | 35.96 | ! | 35.96     |
| -----+-----+-----+----- |   |        |   |       |   |           |
|                         |   | Total  |   |       |   | 48.41 dBA |

↑

TOTAL Leq FROM ALL SOURCES (DAY): 56.01  
 (NIGHT): 48.41

↑

↑

Filename: ol21w.te                      Time Period: Day/Night 16/8 hours  
Description: OLA2-1 - 2.5m Wall

Road data, segment # 1: Conroy (day/night)

-----  
Car traffic volume : 34408/2992 veh/TimePeriod \*  
Medium truck volume : 2737/238 veh/TimePeriod \*  
Heavy truck volume : 1955/170 veh/TimePeriod \*  
Posted speed limit : 60 km/h  
Road gradient : 1 %  
Road pavement : 1 (Typical asphalt or concrete)

\* Refers to calculated road volumes based on the following input:

24 hr Traffic Volume (AADT or SADT): 42500  
Percentage of Annual Growth : 0.00  
Number of Years of Growth : 0.00  
Medium Truck % of Total Volume : 7.00  
Heavy Truck % of Total Volume : 5.00  
Day (16 hrs) % of Total Volume : 92.00

Data for Segment # 1: Conroy (day/night)

-----  
Angle1 Angle2 : -74.00 deg -44.00 deg  
Wood depth : 0 (No woods.)  
No of house rows : 0 / 0  
Surface : 1 (Absorptive ground surface)  
Receiver source distance : 66.00 / 66.00 m  
Receiver height : 1.50 / 1.50 m  
Topography : 2 (Flat/gentle slope; with barrier)  
Barrier angle1 : -74.00 deg Angle2 : -44.00 deg  
Barrier height : 6.00 m  
Barrier receiver distance : 3.00 / 3.00 m  
Source elevation : 85.10 m  
Receiver elevation : 86.11 m  
Barrier elevation : 87.06 m  
Reference angle : 0.00

↑

Road data, segment # 2: Conroy (day/night)

-----  
Car traffic volume : 34408/2992 veh/TimePeriod \*  
Medium truck volume : 2737/238 veh/TimePeriod \*  
Heavy truck volume : 1955/170 veh/TimePeriod \*  
Posted speed limit : 60 km/h  
Road gradient : 1 %

Road pavement : 1 (Typical asphalt or concrete)

\* Refers to calculated road volumes based on the following input:

24 hr Traffic Volume (AADT or SADT): 42500  
Percentage of Annual Growth : 0.00  
Number of Years of Growth : 0.00  
Medium Truck % of Total Volume : 7.00  
Heavy Truck % of Total Volume : 5.00  
Day (16 hrs) % of Total Volume : 92.00

Data for Segment # 2: Conroy (day/night)

-----  
Angle1 Angle2 : -44.00 deg 18.00 deg  
Wood depth : 0 (No woods.)  
No of house rows : 0 / 0  
Surface : 1 (Absorptive ground surface)  
Receiver source distance : 66.00 / 66.00 m  
Receiver height : 1.50 / 1.50 m  
Topography : 2 (Flat/gentle slope; with barrier)  
Barrier angle1 : -44.00 deg Angle2 : 18.00 deg  
Barrier height : 2.50 m  
Barrier receiver distance : 10.80 / 10.80 m  
Source elevation : 85.10 m  
Receiver elevation : 86.11 m  
Barrier elevation : 85.78 m  
Reference angle : 0.00

↑

Road data, segment # 3: Conroy (day/night)

-----  
Car traffic volume : 34408/2992 veh/TimePeriod \*  
Medium truck volume : 2737/238 veh/TimePeriod \*  
Heavy truck volume : 1955/170 veh/TimePeriod \*  
Posted speed limit : 60 km/h  
Road gradient : 1 %  
Road pavement : 1 (Typical asphalt or concrete)

\* Refers to calculated road volumes based on the following input:

24 hr Traffic Volume (AADT or SADT): 42500  
Percentage of Annual Growth : 0.00  
Number of Years of Growth : 0.00  
Medium Truck % of Total Volume : 7.00  
Heavy Truck % of Total Volume : 5.00  
Day (16 hrs) % of Total Volume : 92.00

Data for Segment # 3: Conroy (day/night)

-----  
Angle1 Angle2 : 18.00 deg 90.00 deg

Wood depth : 0 (No woods.)  
 No of house rows : 2 / 0  
 Surface : 1 (Absorptive ground surface)  
 Receiver source distance : 66.00 / 66.00 m  
 Receiver height : 1.50 / 1.50 m  
 Topography : 2 (Flat/gentle slope; with barrier)  
 Barrier angle1 : 18.00 deg Angle2 : 90.00 deg  
 Barrier height : 6.00 m  
 Barrier receiver distance : 3.00 / 3.00 m  
 Source elevation : 85.10 m  
 Receiver elevation : 86.11 m  
 Barrier elevation : 87.05 m  
 Reference angle : 0.00

↑

#### Result summary (day)

-----

|                         | ! | source | ! | Road  | ! | Total     |
|-------------------------|---|--------|---|-------|---|-----------|
|                         | ! | height | ! | Leq   | ! | Leq       |
|                         | ! | (m)    | ! | (dBA) | ! | (dBA)     |
| 1.Conroy                | ! | 1.50   | ! | 38.01 | ! | 38.01     |
| 2.Conroy                | ! | 1.50   | ! | 53.35 | ! | 53.35     |
| 3.Conroy                | ! | 1.50   | ! | 44.46 | ! | 44.46     |
| -----+-----+-----+----- |   |        |   |       |   |           |
|                         |   | Total  |   |       |   | 53.99 dBA |

↑

#### Result summary (night)

-----

|                         | ! | source | ! | Road  | ! | Total     |
|-------------------------|---|--------|---|-------|---|-----------|
|                         | ! | height | ! | Leq   | ! | Leq       |
|                         | ! | (m)    | ! | (dBA) | ! | (dBA)     |
| 1.Conroy                | ! | 1.50   | ! | 30.41 | ! | 30.41     |
| 2.Conroy                | ! | 1.50   | ! | 45.75 | ! | 45.75     |
| 3.Conroy                | ! | 1.50   | ! | 36.87 | ! | 36.87     |
| -----+-----+-----+----- |   |        |   |       |   |           |
|                         |   | Total  |   |       |   | 46.39 dBA |

↑

TOTAL Leq FROM ALL SOURCES (DAY): 53.99  
 (NIGHT): 46.39

↑

↑

Filename: ola22.te                      Time Period: Day/Night 16/8 hours  
Description: OLA2-2 No Wall

Road data, segment # 1: Conroy (day/night)

-----  
Car traffic volume : 34408/2992 veh/TimePeriod \*  
Medium truck volume : 2737/238 veh/TimePeriod \*  
Heavy truck volume : 1955/170 veh/TimePeriod \*  
Posted speed limit : 60 km/h  
Road gradient : 1 %  
Road pavement : 1 (Typical asphalt or concrete)

\* Refers to calculated road volumes based on the following input:

24 hr Traffic Volume (AADT or SADT): 42500  
Percentage of Annual Growth : 0.00  
Number of Years of Growth : 0.00  
Medium Truck % of Total Volume : 7.00  
Heavy Truck % of Total Volume : 5.00  
Day (16 hrs) % of Total Volume : 92.00

Data for Segment # 1: Conroy (day/night)

-----  
Angle1 Angle2 : -72.00 deg -30.00 deg  
Wood depth : 0 (No woods.)  
No of house rows : 0 / 0  
Surface : 1 (Absorptive ground surface)  
Receiver source distance : 70.00 / 70.00 m  
Receiver height : 1.50 / 1.50 m  
Topography : 2 (Flat/gentle slope; with barrier)  
Barrier angle1 : -72.00 deg Angle2 : -30.00 deg  
Barrier height : 6.00 m  
Barrier receiver distance : 3.00 / 3.00 m  
Source elevation : 85.10 m  
Receiver elevation : 85.96 m  
Barrier elevation : 86.89 m  
Reference angle : 0.00

↑

Road data, segment # 2: Conroy (day/night)

-----  
Car traffic volume : 34408/2992 veh/TimePeriod \*  
Medium truck volume : 2737/238 veh/TimePeriod \*  
Heavy truck volume : 1955/170 veh/TimePeriod \*  
Posted speed limit : 60 km/h  
Road gradient : 1 %

Road pavement : 1 (Typical asphalt or concrete)

\* Refers to calculated road volumes based on the following input:

24 hr Traffic Volume (AADT or SADT): 42500  
Percentage of Annual Growth : 0.00  
Number of Years of Growth : 0.00  
Medium Truck % of Total Volume : 7.00  
Heavy Truck % of Total Volume : 5.00  
Day (16 hrs) % of Total Volume : 92.00

Data for Segment # 2: Conroy (day/night)

-----  
Angle1 Angle2 : -30.00 deg 90.00 deg  
Wood depth : 0 (No woods.)  
No of house rows : 2 / 0  
Surface : 1 (Absorptive ground surface)  
Receiver source distance : 70.00 / 70.00 m  
Receiver height : 1.50 / 1.50 m  
Topography : 2 (Flat/gentle slope; with barrier)  
Barrier angle1 : 12.00 deg Angle2 : 90.00 deg  
Barrier height : 6.00 m  
Barrier receiver distance : 3.00 / 3.00 m  
Source elevation : 85.10 m  
Receiver elevation : 85.96 m  
Barrier elevation : 86.74 m  
Reference angle : 0.00

↑

Result summary (day)

-----  
! source ! Road ! Total  
! height ! Leq ! Leq  
! (m) ! (dBA) ! (dBA)  
-----  
1.Conroy ! 1.50 ! 39.12 ! 39.12  
2.Conroy ! 1.50 ! 55.00 ! 55.00  
-----  
Total 55.11 dBA

↑

Result summary (night)

-----  
! source ! Road ! Total  
! height ! Leq ! Leq  
! (m) ! (dBA) ! (dBA)  
-----  
1.Conroy ! 1.50 ! 31.53 ! 31.53

|                         |   |      |   |       |           |       |
|-------------------------|---|------|---|-------|-----------|-------|
| 2.Conroy                | ! | 1.50 | ! | 49.63 | !         | 49.63 |
| -----+-----+-----+----- |   |      |   |       |           |       |
| Total                   |   |      |   |       | 49.70 dBA |       |

↑

TOTAL Leq FROM ALL SOURCES (DAY): 55.11  
(NIGHT): 49.70

↑

↑

Filename: ol22w.te                      Time Period: Day/Night 16/8 hours  
Description: OLA2-2 - 2.5m Wall

Road data, segment # 1: Conroy (day/night)

-----  
Car traffic volume : 34408/2992 veh/TimePeriod \*  
Medium truck volume : 2737/238 veh/TimePeriod \*  
Heavy truck volume : 1955/170 veh/TimePeriod \*  
Posted speed limit : 60 km/h  
Road gradient : 1 %  
Road pavement : 1 (Typical asphalt or concrete)

\* Refers to calculated road volumes based on the following input:

24 hr Traffic Volume (AADT or SADT): 42500  
Percentage of Annual Growth : 0.00  
Number of Years of Growth : 0.00  
Medium Truck % of Total Volume : 7.00  
Heavy Truck % of Total Volume : 5.00  
Day (16 hrs) % of Total Volume : 92.00

Data for Segment # 1: Conroy (day/night)

-----  
Angle1 Angle2 : -72.00 deg -30.00 deg  
Wood depth : 0 (No woods.)  
No of house rows : 0 / 0  
Surface : 1 (Absorptive ground surface)  
Receiver source distance : 72.00 / 72.00 m  
Receiver height : 1.50 / 1.50 m  
Topography : 2 (Flat/gentle slope; with barrier)  
Barrier angle1 : -72.00 deg Angle2 : -30.00 deg  
Barrier height : 6.00 m  
Barrier receiver distance : 3.00 / 3.00 m  
Source elevation : 85.10 m  
Receiver elevation : 86.15 m  
Barrier elevation : 87.06 m  
Reference angle : 0.00

↑

Road data, segment # 2: Conroy (day/night)

-----  
Car traffic volume : 34408/2992 veh/TimePeriod \*  
Medium truck volume : 2737/238 veh/TimePeriod \*  
Heavy truck volume : 1955/170 veh/TimePeriod \*  
Posted speed limit : 60 km/h  
Road gradient : 1 %

Road pavement : 1 (Typical asphalt or concrete)

\* Refers to calculated road volumes based on the following input:

24 hr Traffic Volume (AADT or SADT): 42500  
Percentage of Annual Growth : 0.00  
Number of Years of Growth : 0.00  
Medium Truck % of Total Volume : 7.00  
Heavy Truck % of Total Volume : 5.00  
Day (16 hrs) % of Total Volume : 92.00

Data for Segment # 2: Conroy (day/night)

-----  
Angle1 Angle2 : -30.00 deg 11.00 deg  
Wood depth : 0 (No woods.)  
No of house rows : 0 / 0  
Surface : 1 (Absorptive ground surface)  
Receiver source distance : 72.00 / 72.00 m  
Receiver height : 1.50 / 1.50 m  
Topography : 2 (Flat/gentle slope; with barrier)  
Barrier angle1 : -30.00 deg Angle2 : 11.00 deg  
Barrier height : 2.50 m  
Barrier receiver distance : 17.00 / 17.00 m  
Source elevation : 85.10 m  
Receiver elevation : 86.15 m  
Barrier elevation : 85.78 m  
Reference angle : 0.00

↑

Road data, segment # 3: Conroy (day/night)

-----  
Car traffic volume : 34408/2992 veh/TimePeriod \*  
Medium truck volume : 2737/238 veh/TimePeriod \*  
Heavy truck volume : 1955/170 veh/TimePeriod \*  
Posted speed limit : 60 km/h  
Road gradient : 1 %  
Road pavement : 1 (Typical asphalt or concrete)

\* Refers to calculated road volumes based on the following input:

24 hr Traffic Volume (AADT or SADT): 42500  
Percentage of Annual Growth : 0.00  
Number of Years of Growth : 0.00  
Medium Truck % of Total Volume : 7.00  
Heavy Truck % of Total Volume : 5.00  
Day (16 hrs) % of Total Volume : 92.00

Data for Segment # 3: Conroy (day/night)

-----  
Angle1 Angle2 : 11.00 deg 90.00 deg

Wood depth : 0 (No woods.)  
 No of house rows : 2 / 0  
 Surface : 1 (Absorptive ground surface)  
 Receiver source distance : 72.00 / 72.00 m  
 Receiver height : 1.50 / 1.50 m  
 Topography : 2 (Flat/gentle slope; with barrier)  
 Barrier angle1 : 11.00 deg Angle2 : 90.00 deg  
 Barrier height : 6.00 m  
 Barrier receiver distance : 3.00 / 3.00 m  
 Source elevation : 85.10 m  
 Receiver elevation : 86.15 m  
 Barrier elevation : 87.05 m  
 Reference angle : 0.00

↑

#### Result summary (day)

-----

|                         | ! | source | ! | Road  | ! | Total     |
|-------------------------|---|--------|---|-------|---|-----------|
|                         | ! | height | ! | Leq   | ! | Leq       |
|                         | ! | (m)    | ! | (dBA) | ! | (dBA)     |
| 1.Conroy                | ! | 1.50   | ! | 38.97 | ! | 38.97     |
| 2.Conroy                | ! | 1.50   | ! | 51.37 | ! | 51.37     |
| 3.Conroy                | ! | 1.50   | ! | 44.30 | ! | 44.30     |
| -----+-----+-----+----- |   |        |   |       |   |           |
|                         |   | Total  |   |       |   | 52.35 dBA |

↑

#### Result summary (night)

-----

|                         | ! | source | ! | Road  | ! | Total     |
|-------------------------|---|--------|---|-------|---|-----------|
|                         | ! | height | ! | Leq   | ! | Leq       |
|                         | ! | (m)    | ! | (dBA) | ! | (dBA)     |
| 1.Conroy                | ! | 1.50   | ! | 31.37 | ! | 31.37     |
| 2.Conroy                | ! | 1.50   | ! | 43.77 | ! | 43.77     |
| 3.Conroy                | ! | 1.50   | ! | 36.70 | ! | 36.70     |
| -----+-----+-----+----- |   |        |   |       |   |           |
|                         |   | Total  |   |       |   | 44.75 dBA |

↑

TOTAL Leq FROM ALL SOURCES (DAY): 52.35  
 (NIGHT): 44.75

↑

↑

Filename: ola23.te                      Time Period: Day/Night 16/8 hours  
Description: OLA 2-3 - No Wall

Road data, segment # 1: Conroy (day/night)

-----  
Car traffic volume : 34408/2992 veh/TimePeriod \*  
Medium truck volume : 2737/238 veh/TimePeriod \*  
Heavy truck volume : 1955/170 veh/TimePeriod \*  
Posted speed limit : 60 km/h  
Road gradient : 1 %  
Road pavement : 1 (Typical asphalt or concrete)

\* Refers to calculated road volumes based on the following input:

24 hr Traffic Volume (AADT or SADT): 42500  
Percentage of Annual Growth : 0.00  
Number of Years of Growth : 0.00  
Medium Truck % of Total Volume : 7.00  
Heavy Truck % of Total Volume : 5.00  
Day (16 hrs) % of Total Volume : 92.00

Data for Segment # 1: Conroy (day/night)

-----  
Angle1 Angle2 : -70.00 deg -22.00 deg  
Wood depth : 0 (No woods.)  
No of house rows : 0 / 0  
Surface : 1 (Absorptive ground surface)  
Receiver source distance : 76.00 / 76.00 m  
Receiver height : 1.50 / 1.50 m  
Topography : 2 (Flat/gentle slope; with barrier)  
Barrier angle1 : -70.00 deg Angle2 : -22.00 deg  
Barrier height : 6.00 m  
Barrier receiver distance : 3.00 / 3.00 m  
Source elevation : 85.10 m  
Receiver elevation : 86.17 m  
Barrier elevation : 87.05 m  
Reference angle : 0.00

↑

Road data, segment # 2: Conroy (day/night)

-----  
Car traffic volume : 34408/2992 veh/TimePeriod \*  
Medium truck volume : 2737/238 veh/TimePeriod \*  
Heavy truck volume : 1955/170 veh/TimePeriod \*  
Posted speed limit : 60 km/h  
Road gradient : 1 %

Road pavement : 1 (Typical asphalt or concrete)

\* Refers to calculated road volumes based on the following input:

24 hr Traffic Volume (AADT or SADT): 42500  
Percentage of Annual Growth : 0.00  
Number of Years of Growth : 0.00  
Medium Truck % of Total Volume : 7.00  
Heavy Truck % of Total Volume : 5.00  
Day (16 hrs) % of Total Volume : 92.00

Data for Segment # 2: Conroy (day/night)

-----  
Angle1 Angle2 : -22.00 deg 90.00 deg  
Wood depth : 0 (No woods.)  
No of house rows : 2 / 0  
Surface : 1 (Absorptive ground surface)  
Receiver source distance : 76.00 / 76.00 m  
Receiver height : 1.50 / 1.50 m  
Topography : 2 (Flat/gentle slope; with barrier)  
Barrier angle1 : 8.00 deg Angle2 : 90.00 deg  
Barrier height : 6.00 m  
Barrier receiver distance : 3.00 / 3.00 m  
Source elevation : 85.10 m  
Receiver elevation : 86.17 m  
Barrier elevation : 87.06 m  
Reference angle : 0.00

↑

Result summary (day)

-----  
! source ! Road ! Total  
! height ! Leq ! Leq  
! (m) ! (dBA) ! (dBA)  
-----  
1.Conroy ! 1.50 ! 39.25 ! 39.25  
2.Conroy ! 1.50 ! 53.16 ! 53.16  
-----  
Total 53.33 dBA

↑

Result summary (night)

-----  
! source ! Road ! Total  
! height ! Leq ! Leq  
! (m) ! (dBA) ! (dBA)  
-----  
1.Conroy ! 1.50 ! 31.65 ! 31.65

|                         |   |      |   |       |           |       |
|-------------------------|---|------|---|-------|-----------|-------|
| 2.Conroy                | ! | 1.50 | ! | 47.73 | !         | 47.73 |
| -----+-----+-----+----- |   |      |   |       |           |       |
| Total                   |   |      |   |       | 47.84 dBA |       |

⤴

TOTAL Leq FROM ALL SOURCES (DAY): 53.33  
(NIGHT): 47.84

⤴

⤴

Filename: ola3.te                      Time Period: Day/Night 16/8 hours  
Description: Backyard OLA

Road data, segment # 1: Conroy (day/night)

-----  
Car traffic volume : 34408/2992 veh/TimePeriod \*  
Medium truck volume : 2737/238 veh/TimePeriod \*  
Heavy truck volume : 1955/170 veh/TimePeriod \*  
Posted speed limit : 60 km/h  
Road gradient : 1 %  
Road pavement : 1 (Typical asphalt or concrete)

\* Refers to calculated road volumes based on the following input:

24 hr Traffic Volume (AADT or SADT): 42500  
Percentage of Annual Growth : 0.00  
Number of Years of Growth : 0.00  
Medium Truck % of Total Volume : 7.00  
Heavy Truck % of Total Volume : 5.00  
Day (16 hrs) % of Total Volume : 92.00

Data for Segment # 1: Conroy (day/night)

-----  
Angle1 Angle2 : -74.00 deg 72.00 deg  
Wood depth : 0 (No woods.)  
No of house rows : 0 / 0  
Surface : 1 (Absorptive ground surface)  
Receiver source distance : 59.00 / 59.00 m  
Receiver height : 1.50 / 1.50 m  
Topography : 2 (Flat/gentle slope; with barrier)  
Barrier angle1 : -74.00 deg Angle2 : -44.00 deg  
Barrier height : 6.00 m  
Barrier receiver distance : 3.00 / 3.00 m  
Source elevation : 85.10 m  
Receiver elevation : 86.10 m  
Barrier elevation : 86.89 m  
Reference angle : 0.00

↑

Road data, segment # 2: Conroy (day/night)

-----  
Car traffic volume : 34408/2992 veh/TimePeriod \*  
Medium truck volume : 2737/238 veh/TimePeriod \*  
Heavy truck volume : 1955/170 veh/TimePeriod \*  
Posted speed limit : 60 km/h  
Road gradient : 1 %

Road pavement : 1 (Typical asphalt or concrete)

\* Refers to calculated road volumes based on the following input:

24 hr Traffic Volume (AADT or SADT): 42500  
Percentage of Annual Growth : 0.00  
Number of Years of Growth : 0.00  
Medium Truck % of Total Volume : 7.00  
Heavy Truck % of Total Volume : 5.00  
Day (16 hrs) % of Total Volume : 92.00

Data for Segment # 2: Conroy (day/night)

-----  
Angle1 Angle2 : 72.00 deg 90.00 deg  
Wood depth : 0 (No woods.)  
No of house rows : 3 / 0  
Surface : 1 (Absorptive ground surface)  
Receiver source distance : 59.00 / 59.00 m  
Receiver height : 1.50 / 1.50 m  
Topography : 2 (Flat/gentle slope; with barrier)  
Barrier angle1 : 72.00 deg Angle2 : 90.00 deg  
Barrier height : 6.00 m  
Barrier receiver distance : 3.00 / 3.00 m  
Source elevation : 85.10 m  
Receiver elevation : 86.10 m  
Barrier elevation : 86.74 m  
Reference angle : 0.00

↑  
Result summary (day)

-----  
! source ! Road ! Total  
! height ! Leq ! Leq  
! (m) ! (dBA) ! (dBA)  
-----  
1.Conroy ! 1.50 ! 62.13 ! 62.13  
2.Conroy ! 1.50 ! 41.64 ! 41.64  
-----  
Total 62.17 dBA

↑  
Result summary (night)

-----  
! source ! Road ! Total  
! height ! Leq ! Leq  
! (m) ! (dBA) ! (dBA)  
-----  
1.Conroy ! 1.50 ! 54.54 ! 54.54

|                         |   |      |   |           |   |       |
|-------------------------|---|------|---|-----------|---|-------|
| 2.Conroy                | ! | 1.50 | ! | 34.04     | ! | 34.04 |
| -----+-----+-----+----- |   |      |   |           |   |       |
| Total                   |   |      |   | 54.58 dBA |   |       |

↑

TOTAL Leq FROM ALL SOURCES (DAY): 62.17  
(NIGHT): 54.58

↑

↑

Filename: ol3w.te                      Time Period: Day/Night 16/8 hours  
Description: OLA3 - 2.5m Wall

Road data, segment # 1: Conroy (day/night)

-----  
Car traffic volume : 34408/2992 veh/TimePeriod \*  
Medium truck volume : 2737/238 veh/TimePeriod \*  
Heavy truck volume : 1955/170 veh/TimePeriod \*  
Posted speed limit : 60 km/h  
Road gradient : 1 %  
Road pavement : 1 (Typical asphalt or concrete)

\* Refers to calculated road volumes based on the following input:

24 hr Traffic Volume (AADT or SADT): 42500  
Percentage of Annual Growth : 0.00  
Number of Years of Growth : 0.00  
Medium Truck % of Total Volume : 7.00  
Heavy Truck % of Total Volume : 5.00  
Day (16 hrs) % of Total Volume : 92.00

Data for Segment # 1: Conroy (day/night)

-----  
Angle1 Angle2 : -75.00 deg -44.00 deg  
Wood depth : 0 (No woods.)  
No of house rows : 0 / 0  
Surface : 1 (Absorptive ground surface)  
Receiver source distance : 59.00 / 59.00 m  
Receiver height : 1.50 / 1.50 m  
Topography : 2 (Flat/gentle slope; with barrier)  
Barrier angle1 : -75.00 deg Angle2 : -44.00 deg  
Barrier height : 6.00 m  
Barrier receiver distance : 3.00 / 3.00 m  
Source elevation : 85.10 m  
Receiver elevation : 86.08 m  
Barrier elevation : 87.06 m  
Reference angle : 0.00

↑

Road data, segment # 2: Conroy (day/night)

-----  
Car traffic volume : 34408/2992 veh/TimePeriod \*  
Medium truck volume : 2737/238 veh/TimePeriod \*  
Heavy truck volume : 1955/170 veh/TimePeriod \*  
Posted speed limit : 60 km/h  
Road gradient : 1 %

Road pavement : 1 (Typical asphalt or concrete)

\* Refers to calculated road volumes based on the following input:

24 hr Traffic Volume (AADT or SADT): 42500  
Percentage of Annual Growth : 0.00  
Number of Years of Growth : 0.00  
Medium Truck % of Total Volume : 7.00  
Heavy Truck % of Total Volume : 5.00  
Day (16 hrs) % of Total Volume : 92.00

Data for Segment # 2: Conroy (day/night)

-----  
Angle1 Angle2 : -44.00 deg 66.00 deg  
Wood depth : 0 (No woods.)  
No of house rows : 0 / 0  
Surface : 1 (Absorptive ground surface)  
Receiver source distance : 59.00 / 59.00 m  
Receiver height : 1.50 / 1.50 m  
Topography : 2 (Flat/gentle slope; with barrier)  
Barrier angle1 : -44.00 deg Angle2 : 66.00 deg  
Barrier height : 2.50 m  
Barrier receiver distance : 4.70 / 4.70 m  
Source elevation : 85.10 m  
Receiver elevation : 86.08 m  
Barrier elevation : 85.78 m  
Reference angle : 0.00

↑

Road data, segment # 3: Conroy (day/night)

-----  
Car traffic volume : 34408/2992 veh/TimePeriod \*  
Medium truck volume : 2737/238 veh/TimePeriod \*  
Heavy truck volume : 1955/170 veh/TimePeriod \*  
Posted speed limit : 60 km/h  
Road gradient : 1 %  
Road pavement : 1 (Typical asphalt or concrete)

\* Refers to calculated road volumes based on the following input:

24 hr Traffic Volume (AADT or SADT): 42500  
Percentage of Annual Growth : 0.00  
Number of Years of Growth : 0.00  
Medium Truck % of Total Volume : 7.00  
Heavy Truck % of Total Volume : 5.00  
Day (16 hrs) % of Total Volume : 92.00

Data for Segment # 3: Conroy (day/night)

-----  
Angle1 Angle2 : 66.00 deg 90.00 deg

Wood depth : 0 (No woods.)  
 No of house rows : 2 / 0  
 Surface : 1 (Absorptive ground surface)  
 Receiver source distance : 59.00 / 59.00 m  
 Receiver height : 1.50 / 1.50 m  
 Topography : 2 (Flat/gentle slope; with barrier)  
 Barrier angle1 : 72.00 deg Angle2 : 90.00 deg  
 Barrier height : 6.00 m  
 Barrier receiver distance : 3.00 / 3.00 m  
 Source elevation : 85.10 m  
 Receiver elevation : 86.08 m  
 Barrier elevation : 87.05 m  
 Reference angle : 0.00

↑

#### Result summary (day)

-----

|          | ! | source | ! | Road  | ! | Total     |
|----------|---|--------|---|-------|---|-----------|
|          | ! | height | ! | Leq   | ! | Leq       |
|          | ! | (m)    | ! | (dBA) | ! | (dBA)     |
| 1.Conroy | ! | 1.50   | ! | 38.80 | ! | 38.80     |
| 2.Conroy | ! | 1.50   | ! | 55.52 | ! | 55.52     |
| 3.Conroy | ! | 1.50   | ! | 46.24 | ! | 46.24     |
| -----    |   |        |   |       |   |           |
|          | + |        | + |       | + |           |
|          |   | Total  |   |       |   | 56.09 dBA |

↑

#### Result summary (night)

-----

|          | ! | source | ! | Road  | ! | Total     |
|----------|---|--------|---|-------|---|-----------|
|          | ! | height | ! | Leq   | ! | Leq       |
|          | ! | (m)    | ! | (dBA) | ! | (dBA)     |
| 1.Conroy | ! | 1.50   | ! | 31.20 | ! | 31.20     |
| 2.Conroy | ! | 1.50   | ! | 47.92 | ! | 47.92     |
| 3.Conroy | ! | 1.50   | ! | 40.39 | ! | 40.39     |
| -----    |   |        |   |       |   |           |
|          | + |        | + |       | + |           |
|          |   | Total  |   |       |   | 48.70 dBA |

↑

TOTAL Leq FROM ALL SOURCES (DAY): 56.09  
 (NIGHT): 48.70

↑

↑

Filename: ol31w.te                      Time Period: Day/Night 16/8 hours  
Description: OLA3-1 - 2.5m Wall

Road data, segment # 1: Conroy (day/night)

-----  
Car traffic volume : 34408/2992 veh/TimePeriod \*  
Medium truck volume : 2737/238 veh/TimePeriod \*  
Heavy truck volume : 1955/170 veh/TimePeriod \*  
Posted speed limit : 60 km/h  
Road gradient : 1 %  
Road pavement : 1 (Typical asphalt or concrete)

\* Refers to calculated road volumes based on the following input:

24 hr Traffic Volume (AADT or SADT): 42500  
Percentage of Annual Growth : 0.00  
Number of Years of Growth : 0.00  
Medium Truck % of Total Volume : 7.00  
Heavy Truck % of Total Volume : 5.00  
Day (16 hrs) % of Total Volume : 92.00

Data for Segment # 1: Conroy (day/night)

-----  
Angle1 Angle2 : -74.00 deg -18.00 deg  
Wood depth : 0 (No woods.)  
No of house rows : 0 / 0  
Surface : 1 (Absorptive ground surface)  
Receiver source distance : 66.00 / 66.00 m  
Receiver height : 1.50 / 1.50 m  
Topography : 2 (Flat/gentle slope; with barrier)  
Barrier angle1 : -74.00 deg Angle2 : -18.00 deg  
Barrier height : 6.00 m  
Barrier receiver distance : 3.00 / 3.00 m  
Source elevation : 85.10 m  
Receiver elevation : 86.17 m  
Barrier elevation : 87.06 m  
Reference angle : 0.00

↑

Road data, segment # 2: Conroy (day/night)

-----  
Car traffic volume : 34408/2992 veh/TimePeriod \*  
Medium truck volume : 2737/238 veh/TimePeriod \*  
Heavy truck volume : 1955/170 veh/TimePeriod \*  
Posted speed limit : 60 km/h  
Road gradient : 1 %

Road pavement : 1 (Typical asphalt or concrete)

\* Refers to calculated road volumes based on the following input:

24 hr Traffic Volume (AADT or SADT): 42500  
Percentage of Annual Growth : 0.00  
Number of Years of Growth : 0.00  
Medium Truck % of Total Volume : 7.00  
Heavy Truck % of Total Volume : 5.00  
Day (16 hrs) % of Total Volume : 92.00

Data for Segment # 2: Conroy (day/night)

-----  
Angle1 Angle2 : -18.00 deg 45.00 deg  
Wood depth : 0 (No woods.)  
No of house rows : 0 / 0  
Surface : 1 (Absorptive ground surface)  
Receiver source distance : 66.00 / 66.00 m  
Receiver height : 1.50 / 1.50 m  
Topography : 2 (Flat/gentle slope; with barrier)  
Barrier angle1 : -18.00 deg Angle2 : 45.00 deg  
Barrier height : 2.50 m  
Barrier receiver distance : 10.70 / 10.70 m  
Source elevation : 85.10 m  
Receiver elevation : 86.17 m  
Barrier elevation : 85.78 m  
Reference angle : 0.00

↑

Road data, segment # 3: Conroy (day/night)

-----  
Car traffic volume : 34408/2992 veh/TimePeriod \*  
Medium truck volume : 2737/238 veh/TimePeriod \*  
Heavy truck volume : 1955/170 veh/TimePeriod \*  
Posted speed limit : 60 km/h  
Road gradient : 1 %  
Road pavement : 1 (Typical asphalt or concrete)

\* Refers to calculated road volumes based on the following input:

24 hr Traffic Volume (AADT or SADT): 42500  
Percentage of Annual Growth : 0.00  
Number of Years of Growth : 0.00  
Medium Truck % of Total Volume : 7.00  
Heavy Truck % of Total Volume : 5.00  
Day (16 hrs) % of Total Volume : 92.00

Data for Segment # 3: Conroy (day/night)

-----  
Angle1 Angle2 : 45.00 deg 90.00 deg

Wood depth : 0 (No woods.)  
 No of house rows : 2 / 0  
 Surface : 1 (Absorptive ground surface)  
 Receiver source distance : 66.00 / 66.00 m  
 Receiver height : 1.50 / 1.50 m  
 Topography : 2 (Flat/gentle slope; with barrier)  
 Barrier angle1 : 45.00 deg Angle2 : 90.00 deg  
 Barrier height : 6.00 m  
 Barrier receiver distance : 3.00 / 3.00 m  
 Source elevation : 85.10 m  
 Receiver elevation : 86.17 m  
 Barrier elevation : 87.05 m  
 Reference angle : 0.00

↑

#### Result summary (day)

-----

|          | ! | source | ! | Road  | ! | Total     |
|----------|---|--------|---|-------|---|-----------|
|          | ! | height | ! | Leq   | ! | Leq       |
|          | ! | (m)    | ! | (dBA) | ! | (dBA)     |
| 1.Conroy | ! | 1.50   | ! | 40.83 | ! | 40.83     |
| 2.Conroy | ! | 1.50   | ! | 53.58 | ! | 53.58     |
| 3.Conroy | ! | 1.50   | ! | 43.14 | ! | 43.14     |
|          | + |        | + |       | + |           |
|          |   | Total  |   |       |   | 54.16 dBA |

↑

#### Result summary (night)

-----

|          | ! | source | ! | Road  | ! | Total     |
|----------|---|--------|---|-------|---|-----------|
|          | ! | height | ! | Leq   | ! | Leq       |
|          | ! | (m)    | ! | (dBA) | ! | (dBA)     |
| 1.Conroy | ! | 1.50   | ! | 33.23 | ! | 33.23     |
| 2.Conroy | ! | 1.50   | ! | 45.99 | ! | 45.99     |
| 3.Conroy | ! | 1.50   | ! | 35.54 | ! | 35.54     |
|          | + |        | + |       | + |           |
|          |   | Total  |   |       |   | 46.57 dBA |

↑

TOTAL Leq FROM ALL SOURCES (DAY): 54.16  
 (NIGHT): 46.57

↑

↑

Filename: ol32.te                      Time Period: Day/Night 16/8 hours  
Description: OLA3-2 No Wall

Road data, segment # 1: Conroy (day/night)

-----  
Car traffic volume : 34408/2992 veh/TimePeriod \*  
Medium truck volume : 2737/238 veh/TimePeriod \*  
Heavy truck volume : 1955/170 veh/TimePeriod \*  
Posted speed limit : 60 km/h  
Road gradient : 1 %  
Road pavement : 1 (Typical asphalt or concrete)

\* Refers to calculated road volumes based on the following input:

24 hr Traffic Volume (AADT or SADT): 42500  
Percentage of Annual Growth : 0.00  
Number of Years of Growth : 0.00  
Medium Truck % of Total Volume : 7.00  
Heavy Truck % of Total Volume : 5.00  
Day (16 hrs) % of Total Volume : 92.00

Data for Segment # 1: Conroy (day/night)

-----  
Angle1 Angle2 : -70.00 deg -7.00 deg  
Wood depth : 0 (No woods.)  
No of house rows : 0 / 0  
Surface : 1 (Absorptive ground surface)  
Receiver source distance : 77.00 / 77.00 m  
Receiver height : 1.50 / 1.50 m  
Topography : 2 (Flat/gentle slope; with barrier)  
Barrier angle1 : -70.00 deg Angle2 : -7.00 deg  
Barrier height : 6.00 m  
Barrier receiver distance : 3.00 / 3.00 m  
Source elevation : 85.10 m  
Receiver elevation : 86.23 m  
Barrier elevation : 87.06 m  
Reference angle : 0.00

↑

Road data, segment # 2: Conroy (day/night)

-----  
Car traffic volume : 34408/2992 veh/TimePeriod \*  
Medium truck volume : 2737/238 veh/TimePeriod \*  
Heavy truck volume : 1955/170 veh/TimePeriod \*  
Posted speed limit : 60 km/h  
Road gradient : 1 %

Road pavement : 1 (Typical asphalt or concrete)

\* Refers to calculated road volumes based on the following input:

24 hr Traffic Volume (AADT or SADT): 42500  
Percentage of Annual Growth : 0.00  
Number of Years of Growth : 0.00  
Medium Truck % of Total Volume : 7.00  
Heavy Truck % of Total Volume : 5.00  
Day (16 hrs) % of Total Volume : 92.00

Data for Segment # 2: Conroy (day/night)

-----  
Angle1 Angle2 : -7.00 deg 90.00 deg  
Wood depth : 0 (No woods.)  
No of house rows : 0 / 0  
Surface : 1 (Absorptive ground surface)  
Receiver source distance : 77.00 / 77.00 m  
Receiver height : 1.50 / 1.50 m  
Topography : 2 (Flat/gentle slope; with barrier)  
Barrier angle1 : 23.00 deg Angle2 : 90.00 deg  
Barrier height : 6.00 m  
Barrier receiver distance : 3.00 / 3.00 m  
Source elevation : 85.10 m  
Receiver elevation : 86.23 m  
Barrier elevation : 87.05 m  
Reference angle : 0.00

↑

Result summary (day)

-----  
! source ! Road ! Total  
! height ! Leq ! Leq  
! (m) ! (dBA) ! (dBA)  
-----  
1.Conroy ! 1.50 ! 40.45 ! 40.45  
2.Conroy ! 1.50 ! 55.19 ! 55.19  
-----  
Total 55.33 dBA

↑

Result summary (night)

-----  
! source ! Road ! Total  
! height ! Leq ! Leq  
! (m) ! (dBA) ! (dBA)  
-----  
1.Conroy ! 1.50 ! 32.86 ! 32.86

|                         |   |      |   |       |           |       |
|-------------------------|---|------|---|-------|-----------|-------|
| 2.Conroy                | ! | 1.50 | ! | 47.59 | !         | 47.59 |
| -----+-----+-----+----- |   |      |   |       |           |       |
| Total                   |   |      |   |       | 47.73 dBA |       |

↑

TOTAL Leq FROM ALL SOURCES (DAY): 55.33  
(NIGHT): 47.73

↑

↑

Filename: ol32w.te                      Time Period: Day/Night 16/8 hours  
Description: OLA3-2 - 2.5m Wall

Road data, segment # 1: Conroy (day/night)

-----  
Car traffic volume : 34408/2992 veh/TimePeriod \*  
Medium truck volume : 2737/238 veh/TimePeriod \*  
Heavy truck volume : 1955/170 veh/TimePeriod \*  
Posted speed limit : 60 km/h  
Road gradient : 1 %  
Road pavement : 1 (Typical asphalt or concrete)

\* Refers to calculated road volumes based on the following input:

24 hr Traffic Volume (AADT or SADT): 42500  
Percentage of Annual Growth : 0.00  
Number of Years of Growth : 0.00  
Medium Truck % of Total Volume : 7.00  
Heavy Truck % of Total Volume : 5.00  
Day (16 hrs) % of Total Volume : 92.00

Data for Segment # 1: Conroy (day/night)

-----  
Angle1 Angle2 : -70.00 deg -8.00 deg  
Wood depth : 0 (No woods.)  
No of house rows : 0 / 0  
Surface : 1 (Absorptive ground surface)  
Receiver source distance : 78.00 / 78.00 m  
Receiver height : 1.50 / 1.50 m  
Topography : 2 (Flat/gentle slope; with barrier)  
Barrier angle1 : -70.00 deg Angle2 : -8.00 deg  
Barrier height : 6.00 m  
Barrier receiver distance : 3.00 / 3.00 m  
Source elevation : 85.10 m  
Receiver elevation : 86.24 m  
Barrier elevation : 87.06 m  
Reference angle : 0.00

↑

Road data, segment # 2: Conroy (day/night)

-----  
Car traffic volume : 34408/2992 veh/TimePeriod \*  
Medium truck volume : 2737/238 veh/TimePeriod \*  
Heavy truck volume : 1955/170 veh/TimePeriod \*  
Posted speed limit : 60 km/h  
Road gradient : 1 %

Road pavement : 1 (Typical asphalt or concrete)

\* Refers to calculated road volumes based on the following input:

24 hr Traffic Volume (AADT or SADT): 42500  
Percentage of Annual Growth : 0.00  
Number of Years of Growth : 0.00  
Medium Truck % of Total Volume : 7.00  
Heavy Truck % of Total Volume : 5.00  
Day (16 hrs) % of Total Volume : 92.00

Data for Segment # 2: Conroy (day/night)

-----  
Angle1 Angle2 : -8.00 deg 23.00 deg  
Wood depth : 0 (No woods.)  
No of house rows : 0 / 0  
Surface : 1 (Absorptive ground surface)  
Receiver source distance : 78.00 / 78.00 m  
Receiver height : 1.50 / 1.50 m  
Topography : 2 (Flat/gentle slope; with barrier)  
Barrier angle1 : -8.00 deg Angle2 : 23.00 deg  
Barrier height : 2.50 m  
Barrier receiver distance : 23.00 / 23.00 m  
Source elevation : 85.10 m  
Receiver elevation : 86.24 m  
Barrier elevation : 86.78 m  
Reference angle : 0.00

↑

Road data, segment # 3: Conroy (day/night)

-----  
Car traffic volume : 34408/2992 veh/TimePeriod \*  
Medium truck volume : 2737/238 veh/TimePeriod \*  
Heavy truck volume : 1955/170 veh/TimePeriod \*  
Posted speed limit : 60 km/h  
Road gradient : 1 %  
Road pavement : 1 (Typical asphalt or concrete)

\* Refers to calculated road volumes based on the following input:

24 hr Traffic Volume (AADT or SADT): 42500  
Percentage of Annual Growth : 0.00  
Number of Years of Growth : 0.00  
Medium Truck % of Total Volume : 7.00  
Heavy Truck % of Total Volume : 5.00  
Day (16 hrs) % of Total Volume : 92.00

Data for Segment # 3: Conroy (day/night)

-----  
Angle1 Angle2 : 23.00 deg 90.00 deg

Wood depth : 0 (No woods.)  
 No of house rows : 3 / 0  
 Surface : 1 (Absorptive ground surface)  
 Receiver source distance : 78.00 / 78.00 m  
 Receiver height : 1.50 / 1.50 m  
 Topography : 2 (Flat/gentle slope; with barrier)  
 Barrier angle1 : 23.00 deg Angle2 : 90.00 deg  
 Barrier height : 6.00 m  
 Barrier receiver distance : 3.00 / 3.00 m  
 Source elevation : 85.10 m  
 Receiver elevation : 86.24 m  
 Barrier elevation : 87.05 m  
 Reference angle : 0.00

↑

#### Result summary (day)

-----

|                         | ! | source | ! | Road  | ! | Total     |
|-------------------------|---|--------|---|-------|---|-----------|
|                         | ! | height | ! | Leq   | ! | Leq       |
|                         | ! | (m)    | ! | (dBA) | ! | (dBA)     |
| 1.Conroy                | ! | 1.50   | ! | 40.31 | ! | 40.31     |
| 2.Conroy                | ! | 1.50   | ! | 47.06 | ! | 47.06     |
| 3.Conroy                | ! | 1.50   | ! | 43.42 | ! | 43.42     |
| -----+-----+-----+----- |   |        |   |       |   |           |
|                         |   | Total  |   |       |   | 49.22 dBA |

↑

#### Result summary (night)

-----

|                         | ! | source | ! | Road  | ! | Total     |
|-------------------------|---|--------|---|-------|---|-----------|
|                         | ! | height | ! | Leq   | ! | Leq       |
|                         | ! | (m)    | ! | (dBA) | ! | (dBA)     |
| 1.Conroy                | ! | 1.50   | ! | 32.71 | ! | 32.71     |
| 2.Conroy                | ! | 1.50   | ! | 39.46 | ! | 39.46     |
| 3.Conroy                | ! | 1.50   | ! | 35.82 | ! | 35.82     |
| -----+-----+-----+----- |   |        |   |       |   |           |
|                         |   | Total  |   |       |   | 41.62 dBA |

↑

TOTAL Leq FROM ALL SOURCES (DAY): 49.22  
 (NIGHT): 41.62

↑

↑

Filename: ol33.te                      Time Period: Day/Night 16/8 hours  
Description: OLA3-3 No Wall

Road data, segment # 1: Conroy (day/night)

-----  
Car traffic volume : 34408/2992 veh/TimePeriod \*  
Medium truck volume : 2737/238 veh/TimePeriod \*  
Heavy truck volume : 1955/170 veh/TimePeriod \*  
Posted speed limit : 60 km/h  
Road gradient : 1 %  
Road pavement : 1 (Typical asphalt or concrete)

\* Refers to calculated road volumes based on the following input:

24 hr Traffic Volume (AADT or SADT): 42500  
Percentage of Annual Growth : 0.00  
Number of Years of Growth : 0.00  
Medium Truck % of Total Volume : 7.00  
Heavy Truck % of Total Volume : 5.00  
Day (16 hrs) % of Total Volume : 92.00

Data for Segment # 1: Conroy (day/night)

-----  
Angle1 Angle2 : -67.00 deg -5.00 deg  
Wood depth : 0 (No woods.)  
No of house rows : 0 / 0  
Surface : 1 (Absorptive ground surface)  
Receiver source distance : 83.00 / 83.00 m  
Receiver height : 1.50 / 1.50 m  
Topography : 2 (Flat/gentle slope; with barrier)  
Barrier angle1 : -67.00 deg Angle2 : -5.00 deg  
Barrier height : 6.00 m  
Barrier receiver distance : 3.00 / 3.00 m  
Source elevation : 85.10 m  
Receiver elevation : 86.27 m  
Barrier elevation : 87.06 m  
Reference angle : 0.00

↑

Road data, segment # 2: Conroy (day/night)

-----  
Car traffic volume : 34408/2992 veh/TimePeriod \*  
Medium truck volume : 2737/238 veh/TimePeriod \*  
Heavy truck volume : 1955/170 veh/TimePeriod \*  
Posted speed limit : 60 km/h  
Road gradient : 1 %

Road pavement : 1 (Typical asphalt or concrete)

\* Refers to calculated road volumes based on the following input:

24 hr Traffic Volume (AADT or SADT): 42500  
Percentage of Annual Growth : 0.00  
Number of Years of Growth : 0.00  
Medium Truck % of Total Volume : 7.00  
Heavy Truck % of Total Volume : 5.00  
Day (16 hrs) % of Total Volume : 92.00

Data for Segment # 2: Conroy (day/night)

-----  
Angle1 Angle2 : -5.00 deg 90.00 deg  
Wood depth : 0 (No woods.)  
No of house rows : 0 / 0  
Surface : 1 (Absorptive ground surface)  
Receiver source distance : 83.00 / 83.00 m  
Receiver height : 1.50 / 1.50 m  
Topography : 2 (Flat/gentle slope; with barrier)  
Barrier angle1 : 19.00 deg Angle2 : 90.00 deg  
Barrier height : 6.00 m  
Barrier receiver distance : 3.00 / 3.00 m  
Source elevation : 85.10 m  
Receiver elevation : 86.27 m  
Barrier elevation : 87.05 m  
Reference angle : 0.00

↑

Result summary (day)

-----  
! source ! Road ! Total  
! height ! Leq ! Leq  
! (m) ! (dBA) ! (dBA)  
-----  
1.Conroy ! 1.50 ! 39.94 ! 39.94  
2.Conroy ! 1.50 ! 53.80 ! 53.80  
-----  
Total 53.97 dBA

↑

Result summary (night)

-----  
! source ! Road ! Total  
! height ! Leq ! Leq  
! (m) ! (dBA) ! (dBA)  
-----  
1.Conroy ! 1.50 ! 32.35 ! 32.35

|                         |   |      |   |       |           |       |
|-------------------------|---|------|---|-------|-----------|-------|
| 2.Conroy                | ! | 1.50 | ! | 46.20 | !         | 46.20 |
| -----+-----+-----+----- |   |      |   |       |           |       |
| Total                   |   |      |   |       | 46.38 dBA |       |

↑

TOTAL Leq FROM ALL SOURCES (DAY): 53.97  
(NIGHT): 46.38

↑

↑

Filename: ola4.te                      Time Period: Day/Night 16/8 hours  
Description: Backyard OLA

Road data, segment # 1: Walkley (day/night)

-----  
Car traffic volume : 28336/2464 veh/TimePeriod \*  
Medium truck volume : 2254/196 veh/TimePeriod \*  
Heavy truck volume : 1610/140 veh/TimePeriod \*  
Posted speed limit : 50 km/h  
Road gradient : 1 %  
Road pavement : 1 (Typical asphalt or concrete)

\* Refers to calculated road volumes based on the following input:

24 hr Traffic Volume (AADT or SADT): 35000  
Percentage of Annual Growth : 0.00  
Number of Years of Growth : 0.00  
Medium Truck % of Total Volume : 7.00  
Heavy Truck % of Total Volume : 5.00  
Day (16 hrs) % of Total Volume : 92.00

Data for Segment # 1: Walkley (day/night)

-----  
Angle1 Angle2 : -90.00 deg -69.00 deg  
Wood depth : 0 (No woods.)  
No of house rows : 1 / 0  
Surface : 1 (Absorptive ground surface)  
Receiver source distance : 97.00 / 97.00 m  
Receiver height : 1.50 / 1.50 m  
Topography : 2 (Flat/gentle slope; with barrier)  
Barrier angle1 : -82.00 deg Angle2 : -69.00 deg  
Barrier height : 6.00 m  
Barrier receiver distance : 32.00 / 32.00 m  
Source elevation : 85.80 m  
Receiver elevation : 86.36 m  
Barrier elevation : 86.40 m  
Reference angle : 0.00

↑

Road data, segment # 2: Walkley (day/night)

-----  
Car traffic volume : 28336/2464 veh/TimePeriod \*  
Medium truck volume : 2254/196 veh/TimePeriod \*  
Heavy truck volume : 1610/140 veh/TimePeriod \*  
Posted speed limit : 50 km/h  
Road gradient : 1 %

Road pavement : 1 (Typical asphalt or concrete)

\* Refers to calculated road volumes based on the following input:

24 hr Traffic Volume (AADT or SADT): 35000  
Percentage of Annual Growth : 0.00  
Number of Years of Growth : 0.00  
Medium Truck % of Total Volume : 7.00  
Heavy Truck % of Total Volume : 5.00  
Day (16 hrs) % of Total Volume : 92.00

Data for Segment # 2: Walkley (day/night)

-----  
Angle1 Angle2 : -69.00 deg 90.00 deg  
Wood depth : 0 (No woods.)  
No of house rows : 1 / 0  
Surface : 1 (Absorptive ground surface)  
Receiver source distance : 97.00 / 97.00 m  
Receiver height : 1.50 / 1.50 m  
Topography : 2 (Flat/gentle slope; with barrier)  
Barrier angle1 : 47.00 deg Angle2 : 90.00 deg  
Barrier height : 4.50 m  
Barrier receiver distance : 3.00 / 3.00 m  
Source elevation : 85.80 m  
Receiver elevation : 86.36 m  
Barrier elevation : 86.00 m  
Reference angle : 0.00

↑

Result summary (day)

-----  
! source ! Road ! Total  
! height ! Leq ! Leq  
! (m) ! (dBA) ! (dBA)  
-----  
1.Walkley ! 1.50 ! 40.88 ! 40.88  
2.Walkley ! 1.50 ! 55.47 ! 55.47  
-----  
Total 55.62 dBA

↑

Result summary (night)

-----  
! source ! Road ! Total  
! height ! Leq ! Leq  
! (m) ! (dBA) ! (dBA)  
-----  
1.Walkley ! 1.50 ! 33.63 ! 33.63

|                         |   |      |   |       |           |       |
|-------------------------|---|------|---|-------|-----------|-------|
| 2.Walkley               | ! | 1.50 | ! | 48.74 | !         | 48.74 |
| -----+-----+-----+----- |   |      |   |       |           |       |
| Total                   |   |      |   |       | 48.87 dBA |       |

↑

TOTAL Leq FROM ALL SOURCES (DAY): 55.62  
(NIGHT): 48.87

↑

↑

Filename: ola5.te                      Time Period: Day/Night 16/8 hours  
Description: Backyard OLA

Road data, segment # 1: Walkley (day/night)

-----  
Car traffic volume : 28336/2464 veh/TimePeriod \*  
Medium truck volume : 2254/196 veh/TimePeriod \*  
Heavy truck volume : 1610/140 veh/TimePeriod \*  
Posted speed limit : 50 km/h  
Road gradient : 1 %  
Road pavement : 1 (Typical asphalt or concrete)

\* Refers to calculated road volumes based on the following input:

24 hr Traffic Volume (AADT or SADT): 35000  
Percentage of Annual Growth : 0.00  
Number of Years of Growth : 0.00  
Medium Truck % of Total Volume : 7.00  
Heavy Truck % of Total Volume : 5.00  
Day (16 hrs) % of Total Volume : 92.00

Data for Segment # 1: Walkley (day/night)

-----  
Angle1 Angle2 : -90.00 deg -36.00 deg  
Wood depth : 0 (No woods.)  
No of house rows : 1 / 0  
Surface : 1 (Absorptive ground surface)  
Receiver source distance : 97.00 / 97.00 m  
Receiver height : 1.50 / 1.50 m  
Topography : 2 (Flat/gentle slope; with barrier)  
Barrier angle1 : -74.00 deg Angle2 : -36.00 deg  
Barrier height : 6.00 m  
Barrier receiver distance : 32.00 / 32.00 m  
Source elevation : 85.80 m  
Receiver elevation : 86.63 m  
Barrier elevation : 86.40 m  
Reference angle : 0.00

↑

Road data, segment # 2: Walkley (day/night)

-----  
Car traffic volume : 28336/2464 veh/TimePeriod \*  
Medium truck volume : 2254/196 veh/TimePeriod \*  
Heavy truck volume : 1610/140 veh/TimePeriod \*  
Posted speed limit : 50 km/h  
Road gradient : 1 %

Road pavement : 1 (Typical asphalt or concrete)

\* Refers to calculated road volumes based on the following input:

24 hr Traffic Volume (AADT or SADT): 35000  
Percentage of Annual Growth : 0.00  
Number of Years of Growth : 0.00  
Medium Truck % of Total Volume : 7.00  
Heavy Truck % of Total Volume : 5.00  
Day (16 hrs) % of Total Volume : 92.00

Data for Segment # 2: Walkley (day/night)

-----  
Angle1 Angle2 : -36.00 deg 90.00 deg  
Wood depth : 0 (No woods.)  
No of house rows : 1 / 0  
Surface : 1 (Absorptive ground surface)  
Receiver source distance : 97.00 / 97.00 m  
Receiver height : 1.50 / 1.50 m  
Topography : 2 (Flat/gentle slope; with barrier)  
Barrier angle1 : 75.00 deg Angle2 : 90.00 deg  
Barrier height : 4.50 m  
Barrier receiver distance : 3.00 / 3.00 m  
Source elevation : 85.80 m  
Receiver elevation : 86.63 m  
Barrier elevation : 86.00 m  
Reference angle : 0.00

↑

Result summary (day)

-----  
! source ! Road ! Total  
! height ! Leq ! Leq  
! (m) ! (dBA) ! (dBA)  
-----  
1.Walkley ! 1.50 ! 44.84 ! 44.84  
2.Walkley ! 1.50 ! 55.11 ! 55.11  
-----  
Total 55.50 dBA

↑

Result summary (night)

-----  
! source ! Road ! Total  
! height ! Leq ! Leq  
! (m) ! (dBA) ! (dBA)  
-----  
1.Walkley ! 1.50 ! 37.68 ! 37.68

|                         |   |      |   |       |           |       |
|-------------------------|---|------|---|-------|-----------|-------|
| 2.Walkley               | ! | 1.50 | ! | 48.40 | !         | 48.40 |
| -----+-----+-----+----- |   |      |   |       |           |       |
| Total                   |   |      |   |       | 48.75 dBA |       |

↑

TOTAL Leq FROM ALL SOURCES (DAY): 55.50  
(NIGHT): 48.75

↑

↑

Filename: pow1w.te                      Time Period: Day/Night 16/8 hours  
Description: POW1 - 2.5m Wall

Road data, segment # 1: Conroy (day/night)

-----  
Car traffic volume : 34408/2992 veh/TimePeriod \*  
Medium truck volume : 2737/238 veh/TimePeriod \*  
Heavy truck volume : 1955/170 veh/TimePeriod \*  
Posted speed limit : 60 km/h  
Road gradient : 1 %  
Road pavement : 1 (Typical asphalt or concrete)

\* Refers to calculated road volumes based on the following input:

24 hr Traffic Volume (AADT or SADT): 42500  
Percentage of Annual Growth : 0.00  
Number of Years of Growth : 0.00  
Medium Truck % of Total Volume : 7.00  
Heavy Truck % of Total Volume : 5.00  
Day (16 hrs) % of Total Volume : 92.00

Data for Segment # 1: Conroy (day/night)

-----  
Angle1 Angle2 : -84.00 deg 90.00 deg  
Wood depth : 0 (No woods.)  
No of house rows : 0 / 0  
Surface : 1 (Absorptive ground surface)  
Receiver source distance : 55.00 / 55.00 m  
Receiver height : 1.50 / 4.50 m  
Topography : 2 (Flat/gentle slope; with barrier)  
Barrier angle1 : -48.00 deg Angle2 : 87.00 deg  
Barrier height : 2.50 m  
Barrier receiver distance : 3.00 / 3.00 m  
Source elevation : 85.10 m  
Receiver elevation : 86.72 m  
Barrier elevation : 85.58 m  
Reference angle : 0.00

↑  
Result summary (day)

-----  
! source ! Road ! Total  
! height ! Leq ! Leq  
! (m) ! (dBA) ! (dBA)  
-----+-----+-----+-----

|          |   |      |   |       |           |       |   |
|----------|---|------|---|-------|-----------|-------|---|
| 1.Conroy | ! | 1.50 | ! | 63.67 | !         | 63.67 | * |
|          |   |      |   | Total | 63.67 dBA |       |   |

\* Bright Zone !



# Result summary (night)

|          |   |        |   |       |           |         |
|----------|---|--------|---|-------|-----------|---------|
|          | ! | source | ! | Road  | !         | Total   |
|          | ! | height | ! | Leq   | !         | Leq     |
|          | ! | (m)    | ! | (dBA) | !         | (dBA)   |
| 1.Conroy | ! | 1.50   | ! | 56.72 | !         | 56.72 * |
|          |   |        |   | Total | 56.72 dBA |         |

\* Bright Zone !



TOTAL Leq FROM ALL SOURCES (DAY): 63.67  
(NIGHT): 56.72



Filename: pow11.te                      Time Period: Day/Night 16/8 hours  
Description: POW1-1 - 2.5m Wall

Road data, segment # 1: Conroy (day/night)

-----  
Car traffic volume : 34408/2992 veh/TimePeriod \*  
Medium truck volume : 2737/238 veh/TimePeriod \*  
Heavy truck volume : 1955/170 veh/TimePeriod \*  
Posted speed limit : 60 km/h  
Road gradient : 1 %  
Road pavement : 1 (Typical asphalt or concrete)

\* Refers to calculated road volumes based on the following input:

24 hr Traffic Volume (AADT or SADT): 42500  
Percentage of Annual Growth : 0.00  
Number of Years of Growth : 0.00  
Medium Truck % of Total Volume : 7.00  
Heavy Truck % of Total Volume : 5.00  
Day (16 hrs) % of Total Volume : 92.00

Data for Segment # 1: Conroy (day/night)

-----  
Angle1 Angle2 : -78.00 deg -6.00 deg  
Wood depth : 0 (No woods.)  
No of house rows : 0 / 0  
Surface : 1 (Absorptive ground surface)  
Receiver source distance : 75.00 / 75.00 m  
Receiver height : 1.50 / 4.50 m  
Topography : 2 (Flat/gentle slope; with barrier)  
Barrier angle1 : -78.00 deg Angle2 : -52.00 deg  
Barrier height : 6.00 m  
Barrier receiver distance : 3.00 / 3.00 m  
Source elevation : 85.10 m  
Receiver elevation : 86.72 m  
Barrier elevation : 87.05 m  
Reference angle : 0.00

↑  
Result summary (day)

-----  
! source ! Road ! Total  
! height ! Leq ! Leq  
! (m) ! (dBA) ! (dBA)  
-----+-----+-----+-----

|                         |   |       |   |       |   |           |
|-------------------------|---|-------|---|-------|---|-----------|
| 1.Conroy                | ! | 1.50  | ! | 56.58 | ! | 56.58     |
| -----+-----+-----+----- |   |       |   |       |   |           |
|                         |   | Total |   |       |   | 56.58 dBA |

↑

Result summary (night)

|                         |   |        |   |       |   |           |
|-------------------------|---|--------|---|-------|---|-----------|
|                         | ! | source | ! | Road  | ! | Total     |
|                         | ! | height | ! | Leq   | ! | Leq       |
|                         | ! | (m)    | ! | (dBA) | ! | (dBA)     |
| -----+-----+-----+----- |   |        |   |       |   |           |
| 1.Conroy                | ! | 1.50   | ! | 49.86 | ! | 49.86     |
| -----+-----+-----+----- |   |        |   |       |   |           |
|                         |   | Total  |   |       |   | 49.86 dBA |

↑

TOTAL Leq FROM ALL SOURCES (DAY): 56.58  
(NIGHT): 49.86

↑

↑

Filename: pow12.te                      Time Period: Day/Night 16/8 hours  
 Description: POW1-2 - 2.5m Wall

Road data, segment # 1: Conroy (day/night)

-----  
 Car traffic volume : 34408/2992 veh/TimePeriod \*  
 Medium truck volume : 2737/238 veh/TimePeriod \*  
 Heavy truck volume : 1955/170 veh/TimePeriod \*  
 Posted speed limit : 60 km/h  
 Road gradient : 1 %  
 Road pavement : 1 (Typical asphalt or concrete)

\* Refers to calculated road volumes based on the following input:

24 hr Traffic Volume (AADT or SADT): 42500  
 Percentage of Annual Growth : 0.00  
 Number of Years of Growth : 0.00  
 Medium Truck % of Total Volume : 7.00  
 Heavy Truck % of Total Volume : 5.00  
 Day (16 hrs) % of Total Volume : 92.00

Data for Segment # 1: Conroy (day/night)

-----  
 Angle1 Angle2 : -78.00 deg -7.00 deg  
 Wood depth : 0 (No woods.)  
 No of house rows : 0 / 0  
 Surface : 1 (Absorptive ground surface)  
 Receiver source distance : 82.00 / 82.00 m  
 Receiver height : 1.50 / 4.50 m  
 Topography : 2 (Flat/gentle slope; with barrier)  
 Barrier angle1 : -78.00 deg Angle2 : -44.00 deg  
 Barrier height : 6.00 m  
 Barrier receiver distance : 3.00 / 3.00 m  
 Source elevation : 85.10 m  
 Receiver elevation : 86.72 m  
 Barrier elevation : 87.05 m  
 Reference angle : 0.00

↑  
 Result summary (day)

-----  

|   |        |   |       |   |       |
|---|--------|---|-------|---|-------|
| ! | source | ! | Road  | ! | Total |
| ! | height | ! | Leq   | ! | Leq   |
| ! | (m)    | ! | (dBA) | ! | (dBA) |

 -----+-----+-----+-----

|                         |   |       |   |       |   |           |
|-------------------------|---|-------|---|-------|---|-----------|
| 1.Conroy                | ! | 1.50  | ! | 55.14 | ! | 55.14     |
| -----+-----+-----+----- |   |       |   |       |   |           |
|                         |   | Total |   |       |   | 55.14 dBA |

↑

Result summary (night)

|                         |   |        |   |       |   |           |
|-------------------------|---|--------|---|-------|---|-----------|
|                         | ! | source | ! | Road  | ! | Total     |
|                         | ! | height | ! | Leq   | ! | Leq       |
|                         | ! | (m)    | ! | (dBA) | ! | (dBA)     |
| -----+-----+-----+----- |   |        |   |       |   |           |
| 1.Conroy                | ! | 1.50   | ! | 48.54 | ! | 48.54     |
| -----+-----+-----+----- |   |        |   |       |   |           |
|                         |   | Total  |   |       |   | 48.54 dBA |

↑

TOTAL Leq FROM ALL SOURCES (DAY): 55.14  
(NIGHT): 48.54

↑

↑

Filename: pow13.te                      Time Period: Day/Night 16/8 hours  
 Description: POW1-3 - 2.5m Wall

Road data, segment # 1: Conroy (day/night)

```
-----
Car traffic volume   : 34408/2992   veh/TimePeriod  *
Medium truck volume : 2737/238    veh/TimePeriod  *
Heavy truck volume  : 1955/170    veh/TimePeriod  *
Posted speed limit  :    60 km/h
Road gradient       :    1 %
Road pavement       :    1 (Typical asphalt or concrete)
```

\* Refers to calculated road volumes based on the following input:

```
24 hr Traffic Volume (AADT or SADT): 42500
Percentage of Annual Growth         : 0.00
Number of Years of Growth           : 0.00
Medium Truck % of Total Volume      : 7.00
Heavy Truck % of Total Volume       : 5.00
Day (16 hrs) % of Total Volume      : 92.00
```

Data for Segment # 1: Conroy (day/night)

```
-----
Angle1   Angle2       : -74.00 deg   -3.00 deg
Wood depth      :    0           (No woods.)
No of house rows :    0 / 0
Surface         :    1           (Absorptive ground surface)
Receiver source distance : 88.00 / 88.00 m
Receiver height  : 1.50 / 4.50 m
Topography      :    2           (Flat/gentle slope; with barrier)
Barrier angle1   : -74.00 deg   Angle2 : -35.00 deg
Barrier height   : 6.00 m
Barrier receiver distance : 3.00 / 3.00 m
Source elevation : 85.10 m
Receiver elevation : 86.72 m
Barrier elevation : 87.05 m
Reference angle  : 0.00
```

↑  
 Result summary (day)

```
-----
! source ! Road ! Total
! height ! Leq  ! Leq
! (m)    ! (dBA) ! (dBA)
-----+-----+-----+-----
```

|                         |   |       |   |       |   |           |
|-------------------------|---|-------|---|-------|---|-----------|
| 1.Conroy                | ! | 1.50  | ! | 54.17 | ! | 54.17     |
| -----+-----+-----+----- |   |       |   |       |   |           |
|                         |   | Total |   |       |   | 54.17 dBA |

↑

Result summary (night)

|                         |   |        |   |       |   |           |
|-------------------------|---|--------|---|-------|---|-----------|
|                         | ! | source | ! | Road  | ! | Total     |
|                         | ! | height | ! | Leq   | ! | Leq       |
|                         | ! | (m)    | ! | (dBA) | ! | (dBA)     |
| -----+-----+-----+----- |   |        |   |       |   |           |
| 1.Conroy                | ! | 1.50   | ! | 47.62 | ! | 47.62     |
| -----+-----+-----+----- |   |        |   |       |   |           |
|                         |   | Total  |   |       |   | 47.62 dBA |

↑

TOTAL Leq FROM ALL SOURCES (DAY): 54.17  
(NIGHT): 47.62

↑

↑

Filename: pow2w.te                      Time Period: Day/Night 16/8 hours  
Description: POW2 - 2.5m Wall

Road data, segment # 1: Conroy (day/night)

-----  
Car traffic volume : 34408/2992 veh/TimePeriod \*  
Medium truck volume : 2737/238 veh/TimePeriod \*  
Heavy truck volume : 1955/170 veh/TimePeriod \*  
Posted speed limit : 60 km/h  
Road gradient : 1 %  
Road pavement : 1 (Typical asphalt or concrete)

\* Refers to calculated road volumes based on the following input:

24 hr Traffic Volume (AADT or SADT): 42500  
Percentage of Annual Growth : 0.00  
Number of Years of Growth : 0.00  
Medium Truck % of Total Volume : 7.00  
Heavy Truck % of Total Volume : 5.00  
Day (16 hrs) % of Total Volume : 92.00

Data for Segment # 1: Conroy (day/night)

-----  
Angle1 Angle2 : -81.00 deg 82.00 deg  
Wood depth : 0 (No woods.)  
No of house rows : 0 / 0  
Surface : 1 (Absorptive ground surface)  
Receiver source distance : 57.00 / 57.00 m  
Receiver height : 1.50 / 4.50 m  
Topography : 2 (Flat/gentle slope; with barrier)  
Barrier angle1 : 81.00 deg Angle2 : 82.00 deg  
Barrier height : 2.50 m  
Barrier receiver distance : 6.00 / 6.00 m  
Source elevation : 85.10 m  
Receiver elevation : 87.05 m  
Barrier elevation : 85.58 m  
Reference angle : 0.00

↑

Road data, segment # 2: Conroy (day/night)

-----  
Car traffic volume : 34408/2992 veh/TimePeriod \*  
Medium truck volume : 2737/238 veh/TimePeriod \*  
Heavy truck volume : 1955/170 veh/TimePeriod \*  
Posted speed limit : 60 km/h  
Road gradient : 1 %

Road pavement : 1 (Typical asphalt or concrete)

\* Refers to calculated road volumes based on the following input:

24 hr Traffic Volume (AADT or SADT): 42500  
Percentage of Annual Growth : 0.00  
Number of Years of Growth : 0.00  
Medium Truck % of Total Volume : 7.00  
Heavy Truck % of Total Volume : 5.00  
Day (16 hrs) % of Total Volume : 92.00

Data for Segment # 2: Conroy (day/night)

-----  
Angle1 Angle2 : 82.00 deg 90.00 deg  
Wood depth : 0 (No woods.)  
No of house rows : 0 / 0  
Surface : 1 (Absorptive ground surface)  
Receiver source distance : 57.00 / 57.00 m  
Receiver height : 1.50 / 4.50 m  
Topography : 2 (Flat/gentle slope; with barrier)  
Barrier angle1 : 82.00 deg Angle2 : 90.00 deg  
Barrier height : 6.00 m  
Barrier receiver distance : 3.00 / 3.00 m  
Source elevation : 85.10 m  
Receiver elevation : 87.05 m  
Barrier elevation : 86.72 m  
Reference angle : 0.00

↑  
Result summary (day)

-----  
! source ! Road ! Total  
! height ! Leq ! Leq  
! (m) ! (dBA) ! (dBA)  
-----  
1.Conroy ! 1.50 ! 63.34 ! 63.34 \*  
2.Conroy ! 1.50 ! 40.33 ! 40.33  
-----  
Total 63.36 dBA

↑  
Result summary (night)

-----  
! source ! Road ! Total  
! height ! Leq ! Leq  
! (m) ! (dBA) ! (dBA)  
-----  
1.Conroy ! 1.50 ! 56.40 ! 56.40 \*

|                         |   |      |   |       |           |       |
|-------------------------|---|------|---|-------|-----------|-------|
| 2.Conroy                | ! | 1.50 | ! | 37.66 | !         | 37.66 |
| -----+-----+-----+----- |   |      |   |       |           |       |
| Total                   |   |      |   |       | 56.46 dBA |       |

↑

TOTAL Leq FROM ALL SOURCES (DAY): 63.36  
(NIGHT): 56.46

↑

↑

Filename: pow21.te                      Time Period: Day/Night 16/8 hours  
Description: POW2-1 - 2.5m Wall

Road data, segment # 1: Conroy (day/night)

-----  
Car traffic volume : 34408/2992 veh/TimePeriod \*  
Medium truck volume : 2737/238 veh/TimePeriod \*  
Heavy truck volume : 1955/170 veh/TimePeriod \*  
Posted speed limit : 60 km/h  
Road gradient : 1 %  
Road pavement : 1 (Typical asphalt or concrete)

\* Refers to calculated road volumes based on the following input:

24 hr Traffic Volume (AADT or SADT): 42500  
Percentage of Annual Growth : 0.00  
Number of Years of Growth : 0.00  
Medium Truck % of Total Volume : 7.00  
Heavy Truck % of Total Volume : 5.00  
Day (16 hrs) % of Total Volume : 92.00

Data for Segment # 1: Conroy (day/night)

-----  
Angle1 Angle2 : -2.00 deg 90.00 deg  
Wood depth : 0 (No woods.)  
No of house rows : 0 / 0  
Surface : 1 (Absorptive ground surface)  
Receiver source distance : 84.00 / 84.00 m  
Receiver height : 1.50 / 4.50 m  
Topography : 2 (Flat/gentle slope; with barrier)  
Barrier angle1 : 33.00 deg Angle2 : 90.00 deg  
Barrier height : 6.00 m  
Barrier receiver distance : 3.00 / 3.00 m  
Source elevation : 85.10 m  
Receiver elevation : 87.05 m  
Barrier elevation : 86.72 m  
Reference angle : 0.00

↑  
Result summary (day)

-----  
! source ! Road ! Total  
! height ! Leq ! Leq  
! (m) ! (dBA) ! (dBA)  
-----+-----+-----+-----

|                         |   |       |   |       |   |           |
|-------------------------|---|-------|---|-------|---|-----------|
| 1.Conroy                | ! | 1.50  | ! | 55.15 | ! | 55.15     |
| -----+-----+-----+----- |   |       |   |       |   |           |
|                         |   | Total |   |       |   | 55.15 dBA |

↑

Result summary (night)

|                         |   |        |   |       |   |           |
|-------------------------|---|--------|---|-------|---|-----------|
|                         | ! | source | ! | Road  | ! | Total     |
|                         | ! | height | ! | Leq   | ! | Leq       |
|                         | ! | (m)    | ! | (dBA) | ! | (dBA)     |
| -----+-----+-----+----- |   |        |   |       |   |           |
| 1.Conroy                | ! | 1.50   | ! | 49.14 | ! | 49.14     |
| -----+-----+-----+----- |   |        |   |       |   |           |
|                         |   | Total  |   |       |   | 49.14 dBA |

↑

TOTAL Leq FROM ALL SOURCES (DAY): 55.15  
(NIGHT): 49.14

↑

↑

Filename: pow22.te                      Time Period: Day/Night 16/8 hours  
Description: POW2-2 - 2.5m Wall

Road data, segment # 1: Conroy (day/night)

-----  
Car traffic volume : 34408/2992 veh/TimePeriod \*  
Medium truck volume : 2737/238 veh/TimePeriod \*  
Heavy truck volume : 1955/170 veh/TimePeriod \*  
Posted speed limit : 60 km/h  
Road gradient : 1 %  
Road pavement : 1 (Typical asphalt or concrete)

\* Refers to calculated road volumes based on the following input:

24 hr Traffic Volume (AADT or SADT): 42500  
Percentage of Annual Growth : 0.00  
Number of Years of Growth : 0.00  
Medium Truck % of Total Volume : 7.00  
Heavy Truck % of Total Volume : 5.00  
Day (16 hrs) % of Total Volume : 92.00

Data for Segment # 1: Conroy (day/night)

-----  
Angle1 Angle2 : -2.00 deg 90.00 deg  
Wood depth : 0 (No woods.)  
No of house rows : 0 / 0  
Surface : 1 (Absorptive ground surface)  
Receiver source distance : 90.00 / 90.00 m  
Receiver height : 1.50 / 4.50 m  
Topography : 2 (Flat/gentle slope; with barrier)  
Barrier angle1 : 28.00 deg Angle2 : 90.00 deg  
Barrier height : 6.00 m  
Barrier receiver distance : 3.00 / 3.00 m  
Source elevation : 85.10 m  
Receiver elevation : 87.05 m  
Barrier elevation : 86.72 m  
Reference angle : 0.00

↑  
Result summary (day)

-----  
! source ! Road ! Total  
! height ! Leq ! Leq  
! (m) ! (dBA) ! (dBA)  
-----+-----+-----+-----

|                         |   |       |   |       |   |           |
|-------------------------|---|-------|---|-------|---|-----------|
| 1.Conroy                | ! | 1.50  | ! | 54.10 | ! | 54.10     |
| -----+-----+-----+----- |   |       |   |       |   |           |
|                         |   | Total |   |       |   | 54.10 dBA |

↑

Result summary (night)

|                         |   |        |   |       |   |           |
|-------------------------|---|--------|---|-------|---|-----------|
|                         | ! | source | ! | Road  | ! | Total     |
|                         | ! | height | ! | Leq   | ! | Leq       |
|                         | ! | (m)    | ! | (dBA) | ! | (dBA)     |
| -----+-----+-----+----- |   |        |   |       |   |           |
| 1.Conroy                | ! | 1.50   | ! | 48.31 | ! | 48.31     |
| -----+-----+-----+----- |   |        |   |       |   |           |
|                         |   | Total  |   |       |   | 48.31 dBA |

↑

TOTAL Leq FROM ALL SOURCES (DAY): 54.10  
(NIGHT): 48.31

↑

↑

Filename: pow3w.te                      Time Period: Day/Night 16/8 hours  
Description: POW3 - 2.5m Wall

Road data, segment # 1: Conroy (day/night)

-----  
Car traffic volume : 34408/2992 veh/TimePeriod \*  
Medium truck volume : 2737/238 veh/TimePeriod \*  
Heavy truck volume : 1955/170 veh/TimePeriod \*  
Posted speed limit : 60 km/h  
Road gradient : 1 %  
Road pavement : 1 (Typical asphalt or concrete)

\* Refers to calculated road volumes based on the following input:

24 hr Traffic Volume (AADT or SADT): 42500  
Percentage of Annual Growth : 0.00  
Number of Years of Growth : 0.00  
Medium Truck % of Total Volume : 7.00  
Heavy Truck % of Total Volume : 5.00  
Day (16 hrs) % of Total Volume : 92.00

Data for Segment # 1: Conroy (day/night)

-----  
Angle1 Angle2 : -75.00 deg 90.00 deg  
Wood depth : 0 (No woods.)  
No of house rows : 0 / 0  
Surface : 1 (Absorptive ground surface)  
Receiver source distance : 56.00 / 56.00 m  
Receiver height : 1.50 / 4.50 m  
Topography : 2 (Flat/gentle slope; with barrier)  
Barrier angle1 : 84.00 deg Angle2 : 88.00 deg  
Barrier height : 2.50 m  
Barrier receiver distance : 3.00 / 3.00 m  
Source elevation : 85.10 m  
Receiver elevation : 87.06 m  
Barrier elevation : 85.94 m  
Reference angle : 0.00

↑  
Result summary (day)

-----  
! source ! Road ! Total  
! height ! Leq ! Leq  
! (m) ! (dBA) ! (dBA)  
-----+-----+-----+-----

|          |   |      |   |       |           |       |   |
|----------|---|------|---|-------|-----------|-------|---|
| 1.Conroy | ! | 1.50 | ! | 63.44 | !         | 63.44 | * |
|          |   |      |   | Total | 63.44 dBA |       |   |

\* Bright Zone !



# Result summary (night)

|          |   |        |   |       |           |         |
|----------|---|--------|---|-------|-----------|---------|
|          | ! | source | ! | Road  | !         | Total   |
|          | ! | height | ! | Leq   | !         | Leq     |
|          | ! | (m)    | ! | (dBA) | !         | (dBA)   |
| 1.Conroy | ! | 1.50   | ! | 56.49 | !         | 56.49 * |
|          |   |        |   | Total | 56.49 dBA |         |

\* Bright Zone !



TOTAL Leq FROM ALL SOURCES (DAY): 63.44  
(NIGHT): 56.49



Filename: pow31.te                      Time Period: Day/Night 16/8 hours  
Description: POW3-1 - 2.5m Wall

Road data, segment # 1: Conroy (day/night)

-----  
Car traffic volume : 34408/2992 veh/TimePeriod \*  
Medium truck volume : 2737/238 veh/TimePeriod \*  
Heavy truck volume : 1955/170 veh/TimePeriod \*  
Posted speed limit : 60 km/h  
Road gradient : 1 %  
Road pavement : 1 (Typical asphalt or concrete)

\* Refers to calculated road volumes based on the following input:

24 hr Traffic Volume (AADT or SADT): 42500  
Percentage of Annual Growth : 0.00  
Number of Years of Growth : 0.00  
Medium Truck % of Total Volume : 7.00  
Heavy Truck % of Total Volume : 5.00  
Day (16 hrs) % of Total Volume : 92.00

Data for Segment # 1: Conroy (day/night)

-----  
Angle1 Angle2 : -62.00 deg -39.00 deg  
Wood depth : 0 (No woods.)  
No of house rows : 0 / 0  
Surface : 1 (Absorptive ground surface)  
Receiver source distance : 89.00 / 89.00 m  
Receiver height : 1.50 / 4.50 m  
Topography : 2 (Flat/gentle slope; with barrier)  
Barrier angle1 : -62.00 deg Angle2 : -39.00 deg  
Barrier height : 6.00 m  
Barrier receiver distance : 24.00 / 24.00 m  
Source elevation : 85.10 m  
Receiver elevation : 87.06 m  
Barrier elevation : 85.92 m  
Reference angle : 0.00

↑

Road data, segment # 2: Conroy (day/night)

-----  
Car traffic volume : 34408/2992 veh/TimePeriod \*  
Medium truck volume : 2737/238 veh/TimePeriod \*  
Heavy truck volume : 1955/170 veh/TimePeriod \*  
Posted speed limit : 60 km/h  
Road gradient : 1 %

Road pavement : 1 (Typical asphalt or concrete)

\* Refers to calculated road volumes based on the following input:

24 hr Traffic Volume (AADT or SADT): 42500  
Percentage of Annual Growth : 0.00  
Number of Years of Growth : 0.00  
Medium Truck % of Total Volume : 7.00  
Heavy Truck % of Total Volume : 5.00  
Day (16 hrs) % of Total Volume : 92.00

Data for Segment # 2: Conroy (day/night)

-----  
Angle1 Angle2 : -39.00 deg 0.00 deg  
Wood depth : 0 (No woods.)  
No of house rows : 0 / 0  
Surface : 1 (Absorptive ground surface)  
Receiver source distance : 89.00 / 89.00 m  
Receiver height : 1.50 / 4.50 m  
Topography : 1 (Flat/gentle slope; no barrier)  
Reference angle : 0.00

↑

Result summary (day)

-----  
! source ! Road ! Total  
! height ! Leq ! Leq  
! (m) ! (dBA) ! (dBA)  
-----+-----+-----  
1.Conroy ! 1.50 ! 42.82 ! 42.82  
2.Conroy ! 1.50 ! 54.81 ! 54.81  
-----+-----+-----  
Total 55.08 dBA

↑

Result summary (night)

-----  
! source ! Road ! Total  
! height ! Leq ! Leq  
! (m) ! (dBA) ! (dBA)  
-----+-----+-----  
1.Conroy ! 1.50 ! 40.95 ! 40.95  
2.Conroy ! 1.50 ! 47.94 ! 47.94  
-----+-----+-----  
Total 48.73 dBA

↑

TOTAL Leq FROM ALL SOURCES (DAY): 55.08  
(NIGHT): 48.73



Filename: pow4.te                      Time Period: Day/Night 16/8 hours  
Description: Daytime 1.5m Nighttime 4.5m

Road data, segment # 1: Walkley (day/night)

-----  
Car traffic volume : 28336/2464 veh/TimePeriod \*  
Medium truck volume : 2254/196 veh/TimePeriod \*  
Heavy truck volume : 1610/140 veh/TimePeriod \*  
Posted speed limit : 50 km/h  
Road gradient : 1 %  
Road pavement : 1 (Typical asphalt or concrete)

\* Refers to calculated road volumes based on the following input:

24 hr Traffic Volume (AADT or SADT): 35000  
Percentage of Annual Growth : 0.00  
Number of Years of Growth : 0.00  
Medium Truck % of Total Volume : 7.00  
Heavy Truck % of Total Volume : 5.00  
Day (16 hrs) % of Total Volume : 92.00

Data for Segment # 1: Walkley (day/night)

-----  
Angle1 Angle2 : -90.00 deg -68.00 deg  
Wood depth : 0 (No woods.)  
No of house rows : 1 / 0  
Surface : 1 (Absorptive ground surface)  
Receiver source distance : 100.00 / 100.00 m  
Receiver height : 1.50 / 4.50 m  
Topography : 2 (Flat/gentle slope; with barrier)  
Barrier angle1 : -81.00 deg Angle2 : -68.00 deg  
Barrier height : 6.00 m  
Barrier receiver distance : 35.00 / 35.00 m  
Source elevation : 85.80 m  
Receiver elevation : 97.34 m  
Barrier elevation : 86.40 m  
Reference angle : 0.00

↑

Road data, segment # 2: Walkley (day/night)

-----  
Car traffic volume : 28336/2464 veh/TimePeriod \*  
Medium truck volume : 2254/196 veh/TimePeriod \*  
Heavy truck volume : 1610/140 veh/TimePeriod \*  
Posted speed limit : 50 km/h  
Road gradient : 1 %

Road pavement : 1 (Typical asphalt or concrete)

\* Refers to calculated road volumes based on the following input:

24 hr Traffic Volume (AADT or SADT): 35000  
Percentage of Annual Growth : 0.00  
Number of Years of Growth : 0.00  
Medium Truck % of Total Volume : 7.00  
Heavy Truck % of Total Volume : 5.00  
Day (16 hrs) % of Total Volume : 92.00

Data for Segment # 2: Walkley (day/night)

-----  
Angle1 Angle2 : -68.00 deg 90.00 deg  
Wood depth : 0 (No woods.)  
No of house rows : 1 / 0  
Surface : 1 (Absorptive ground surface)  
Receiver source distance : 100.00 / 100.00 m  
Receiver height : 1.50 / 4.50 m  
Topography : 2 (Flat/gentle slope; with barrier)  
Barrier angle1 : 44.00 deg Angle2 : 90.00 deg  
Barrier height : 4.50 m  
Barrier receiver distance : 3.00 / 3.00 m  
Source elevation : 85.80 m  
Receiver elevation : 87.34 m  
Barrier elevation : 86.00 m  
Reference angle : 0.00

↑

Result summary (day)

-----  
! source ! Road ! Total  
! height ! Leq ! Leq  
! (m) ! (dBA) ! (dBA)  
-----  
1.Walkley ! 1.50 ! 43.48 ! 43.48 \*  
2.Walkley ! 1.50 ! 55.25 ! 55.25  
-----  
Total 55.53 dBA

↑

Result summary (night)

-----  
! source ! Road ! Total  
! height ! Leq ! Leq  
! (m) ! (dBA) ! (dBA)  
-----  
1.Walkley ! 1.50 ! 38.14 ! 38.14 \*

|                         |   |      |   |       |   |           |   |
|-------------------------|---|------|---|-------|---|-----------|---|
| 2.Walkley               | ! | 1.50 | ! | 50.05 | ! | 50.05     | * |
| -----+-----+-----+----- |   |      |   |       |   |           |   |
| Total                   |   |      |   |       |   | 50.32 dBA |   |

\* Bright Zone !



TOTAL Leq FROM ALL SOURCES (DAY): 55.53  
(NIGHT): 50.32



Filename: pow5.te                      Time Period: Day/Night 16/8 hours  
Description: Daytime 1.5m Nighttime 4.5m

Road data, segment # 1: Walkley (day/night)

-----  
Car traffic volume : 28336/2464 veh/TimePeriod \*  
Medium truck volume : 2254/196 veh/TimePeriod \*  
Heavy truck volume : 1610/140 veh/TimePeriod \*  
Posted speed limit : 50 km/h  
Road gradient : 1 %  
Road pavement : 1 (Typical asphalt or concrete)

\* Refers to calculated road volumes based on the following input:

24 hr Traffic Volume (AADT or SADT): 35000  
Percentage of Annual Growth : 0.00  
Number of Years of Growth : 0.00  
Medium Truck % of Total Volume : 7.00  
Heavy Truck % of Total Volume : 5.00  
Day (16 hrs) % of Total Volume : 92.00

Data for Segment # 1: Walkley (day/night)

-----  
Angle1 Angle2 : -90.00 deg -30.00 deg  
Wood depth : 0 (No woods.)  
No of house rows : 1 / 0  
Surface : 1 (Absorptive ground surface)  
Receiver source distance : 100.00 / 100.00 m  
Receiver height : 1.50 / 4.50 m  
Topography : 2 (Flat/gentle slope; with barrier)  
Barrier angle1 : -68.00 deg Angle2 : -30.00 deg  
Barrier height : 6.00 m  
Barrier receiver distance : 35.00 / 35.00 m  
Source elevation : 85.80 m  
Receiver elevation : 87.29 m  
Barrier elevation : 86.40 m  
Reference angle : 0.00

↑

Road data, segment # 2: Walkley (day/night)

-----  
Car traffic volume : 28336/2464 veh/TimePeriod \*  
Medium truck volume : 2254/196 veh/TimePeriod \*  
Heavy truck volume : 1610/140 veh/TimePeriod \*  
Posted speed limit : 50 km/h  
Road gradient : 1 %

Road pavement : 1 (Typical asphalt or concrete)

\* Refers to calculated road volumes based on the following input:

24 hr Traffic Volume (AADT or SADT): 35000  
Percentage of Annual Growth : 0.00  
Number of Years of Growth : 0.00  
Medium Truck % of Total Volume : 7.00  
Heavy Truck % of Total Volume : 5.00  
Day (16 hrs) % of Total Volume : 92.00

Data for Segment # 2: Walkley (day/night)

-----  
Angle1 Angle2 : -30.00 deg 90.00 deg  
Wood depth : 0 (No woods.)  
No of house rows : 1 / 0  
Surface : 1 (Absorptive ground surface)  
Receiver source distance : 100.00 / 100.00 m  
Receiver height : 1.50 / 4.50 m  
Topography : 2 (Flat/gentle slope; with barrier)  
Barrier angle1 : 75.00 deg Angle2 : 90.00 deg  
Barrier height : 4.50 m  
Barrier receiver distance : 3.00 / 3.00 m  
Source elevation : 85.80 m  
Receiver elevation : 87.29 m  
Barrier elevation : 86.00 m  
Reference angle : 0.00

↑

Result summary (day)

-----  
! source ! Road ! Total  
! height ! Leq ! Leq  
! (m) ! (dBA) ! (dBA)  
-----  
1.Walkley ! 1.50 ! 46.05 ! 46.05  
2.Walkley ! 1.50 ! 54.67 ! 54.67  
-----  
Total 55.23 dBA

↑

Result summary (night)

-----  
! source ! Road ! Total  
! height ! Leq ! Leq  
! (m) ! (dBA) ! (dBA)  
-----  
1.Walkley ! 1.50 ! 41.98 ! 41.98

|                         |   |        |         |           |
|-------------------------|---|--------|---------|-----------|
| 2.Walkley               | ! | 1.50 ! | 48.89 ! | 48.89 *   |
| -----+-----+-----+----- |   |        |         |           |
|                         |   | Total  |         | 49.70 dBA |

\* Bright Zone !


↑

TOTAL Leq FROM ALL SOURCES (DAY): 55.23  
(NIGHT): 49.70


↑

↑

M:\2022\122040\CAD\Civil\Figures\Noise\122040-NC.dwg, Fig. Jul 17, 2023 - 11:42am, mfang

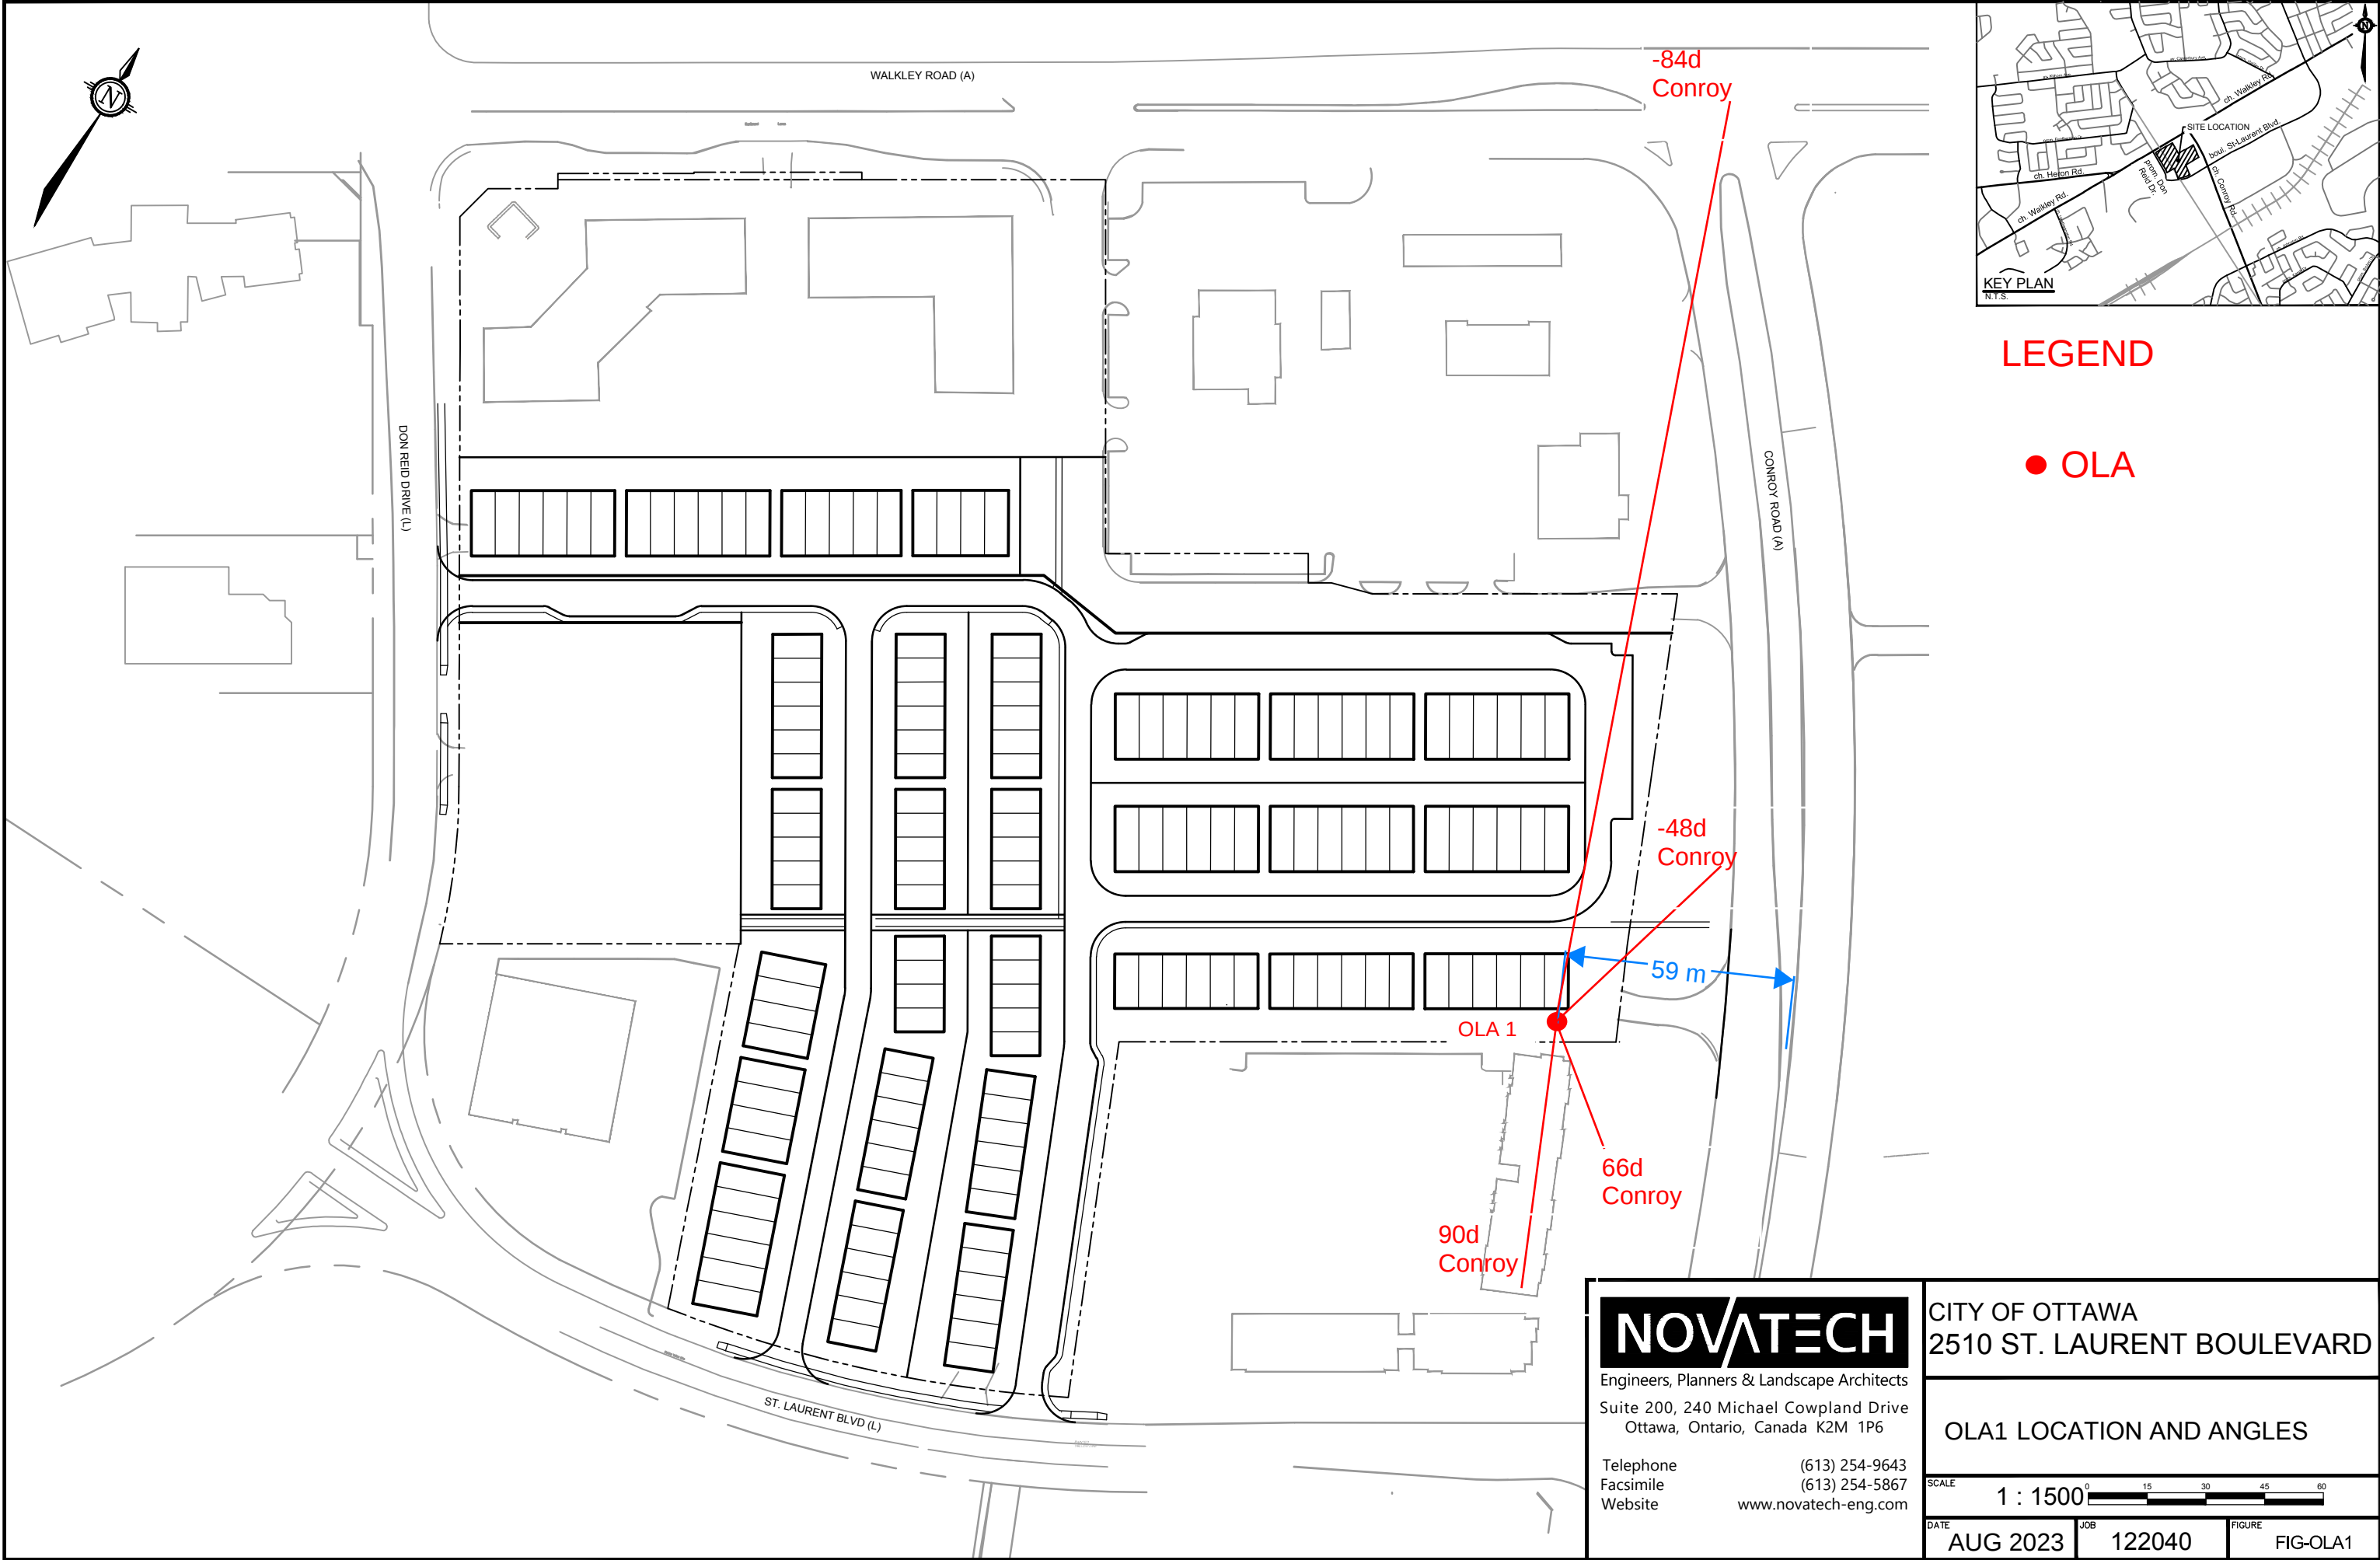

M:\2022\122040\CAD\Civil\Figures\Noise\122040-NC.dwg, Fig (W), Nov 29, 2024 - 8:47am, mfang

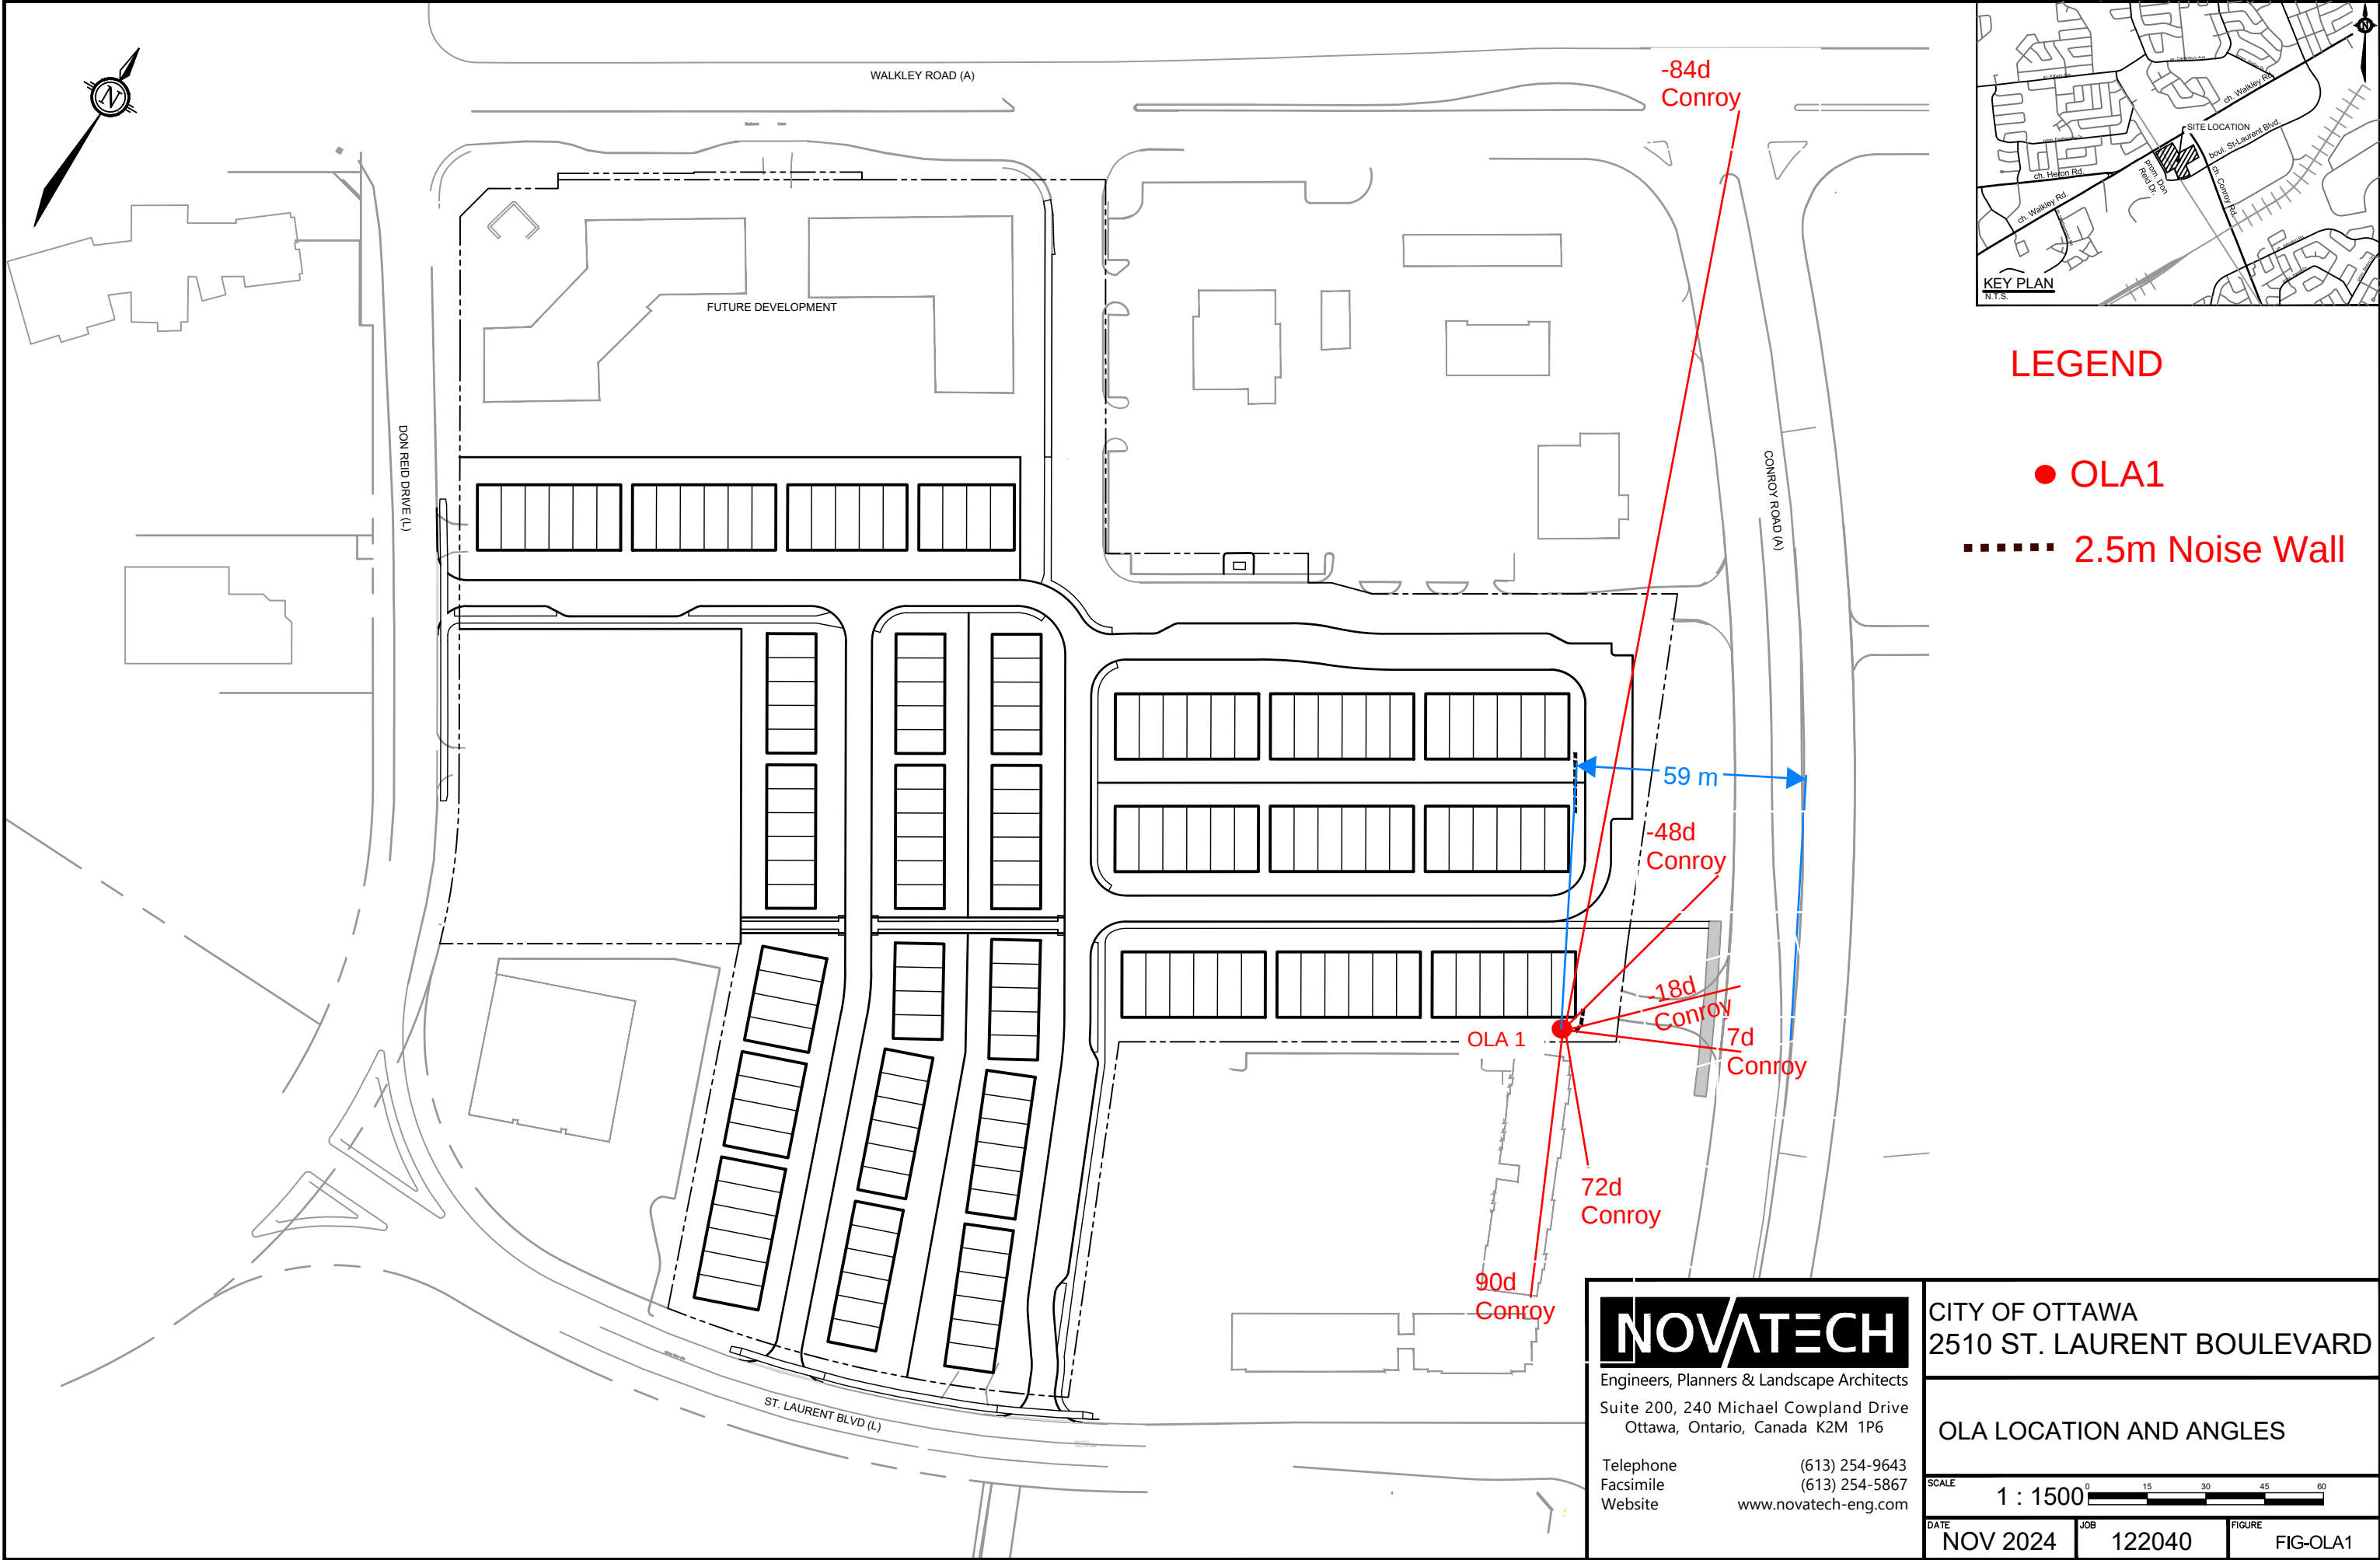


LEGEND


- OLA1
- ..... 2.5m Noise Wall

|                                                                                                                                                                                                                                   |               |                    |                                              |  |  |
|-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|---------------|--------------------|----------------------------------------------|--|--|
| <b>NOVATECH</b><br>Engineers, Planners & Landscape Architects<br>Suite 200, 240 Michael Cowpland Drive<br>Ottawa, Ontario, Canada K2M 1P6<br>Telephone (613) 254-9643<br>Facsimile (613) 254-5867<br>Website www.novatech-eng.com |               |                    | CITY OF OTTAWA<br>2510 ST. LAURENT BOULEVARD |  |  |
| OLA LOCATION AND ANGLES                                                                                                                                                                                                           |               |                    |                                              |  |  |
| SCALE<br>1 : 1500                                                                                                                                                                                                                 |               |                    |                                              |  |  |
| DATE<br>NOV 2024                                                                                                                                                                                                                  | JOB<br>122040 | FIGURE<br>FIG-OLA1 |                                              |  |  |

M:\2022\122040\CAD\Civil\Figures\Noise\122040-NC.dwg, Fig (W), Nov 29, 2024 - 8:47am, mfang

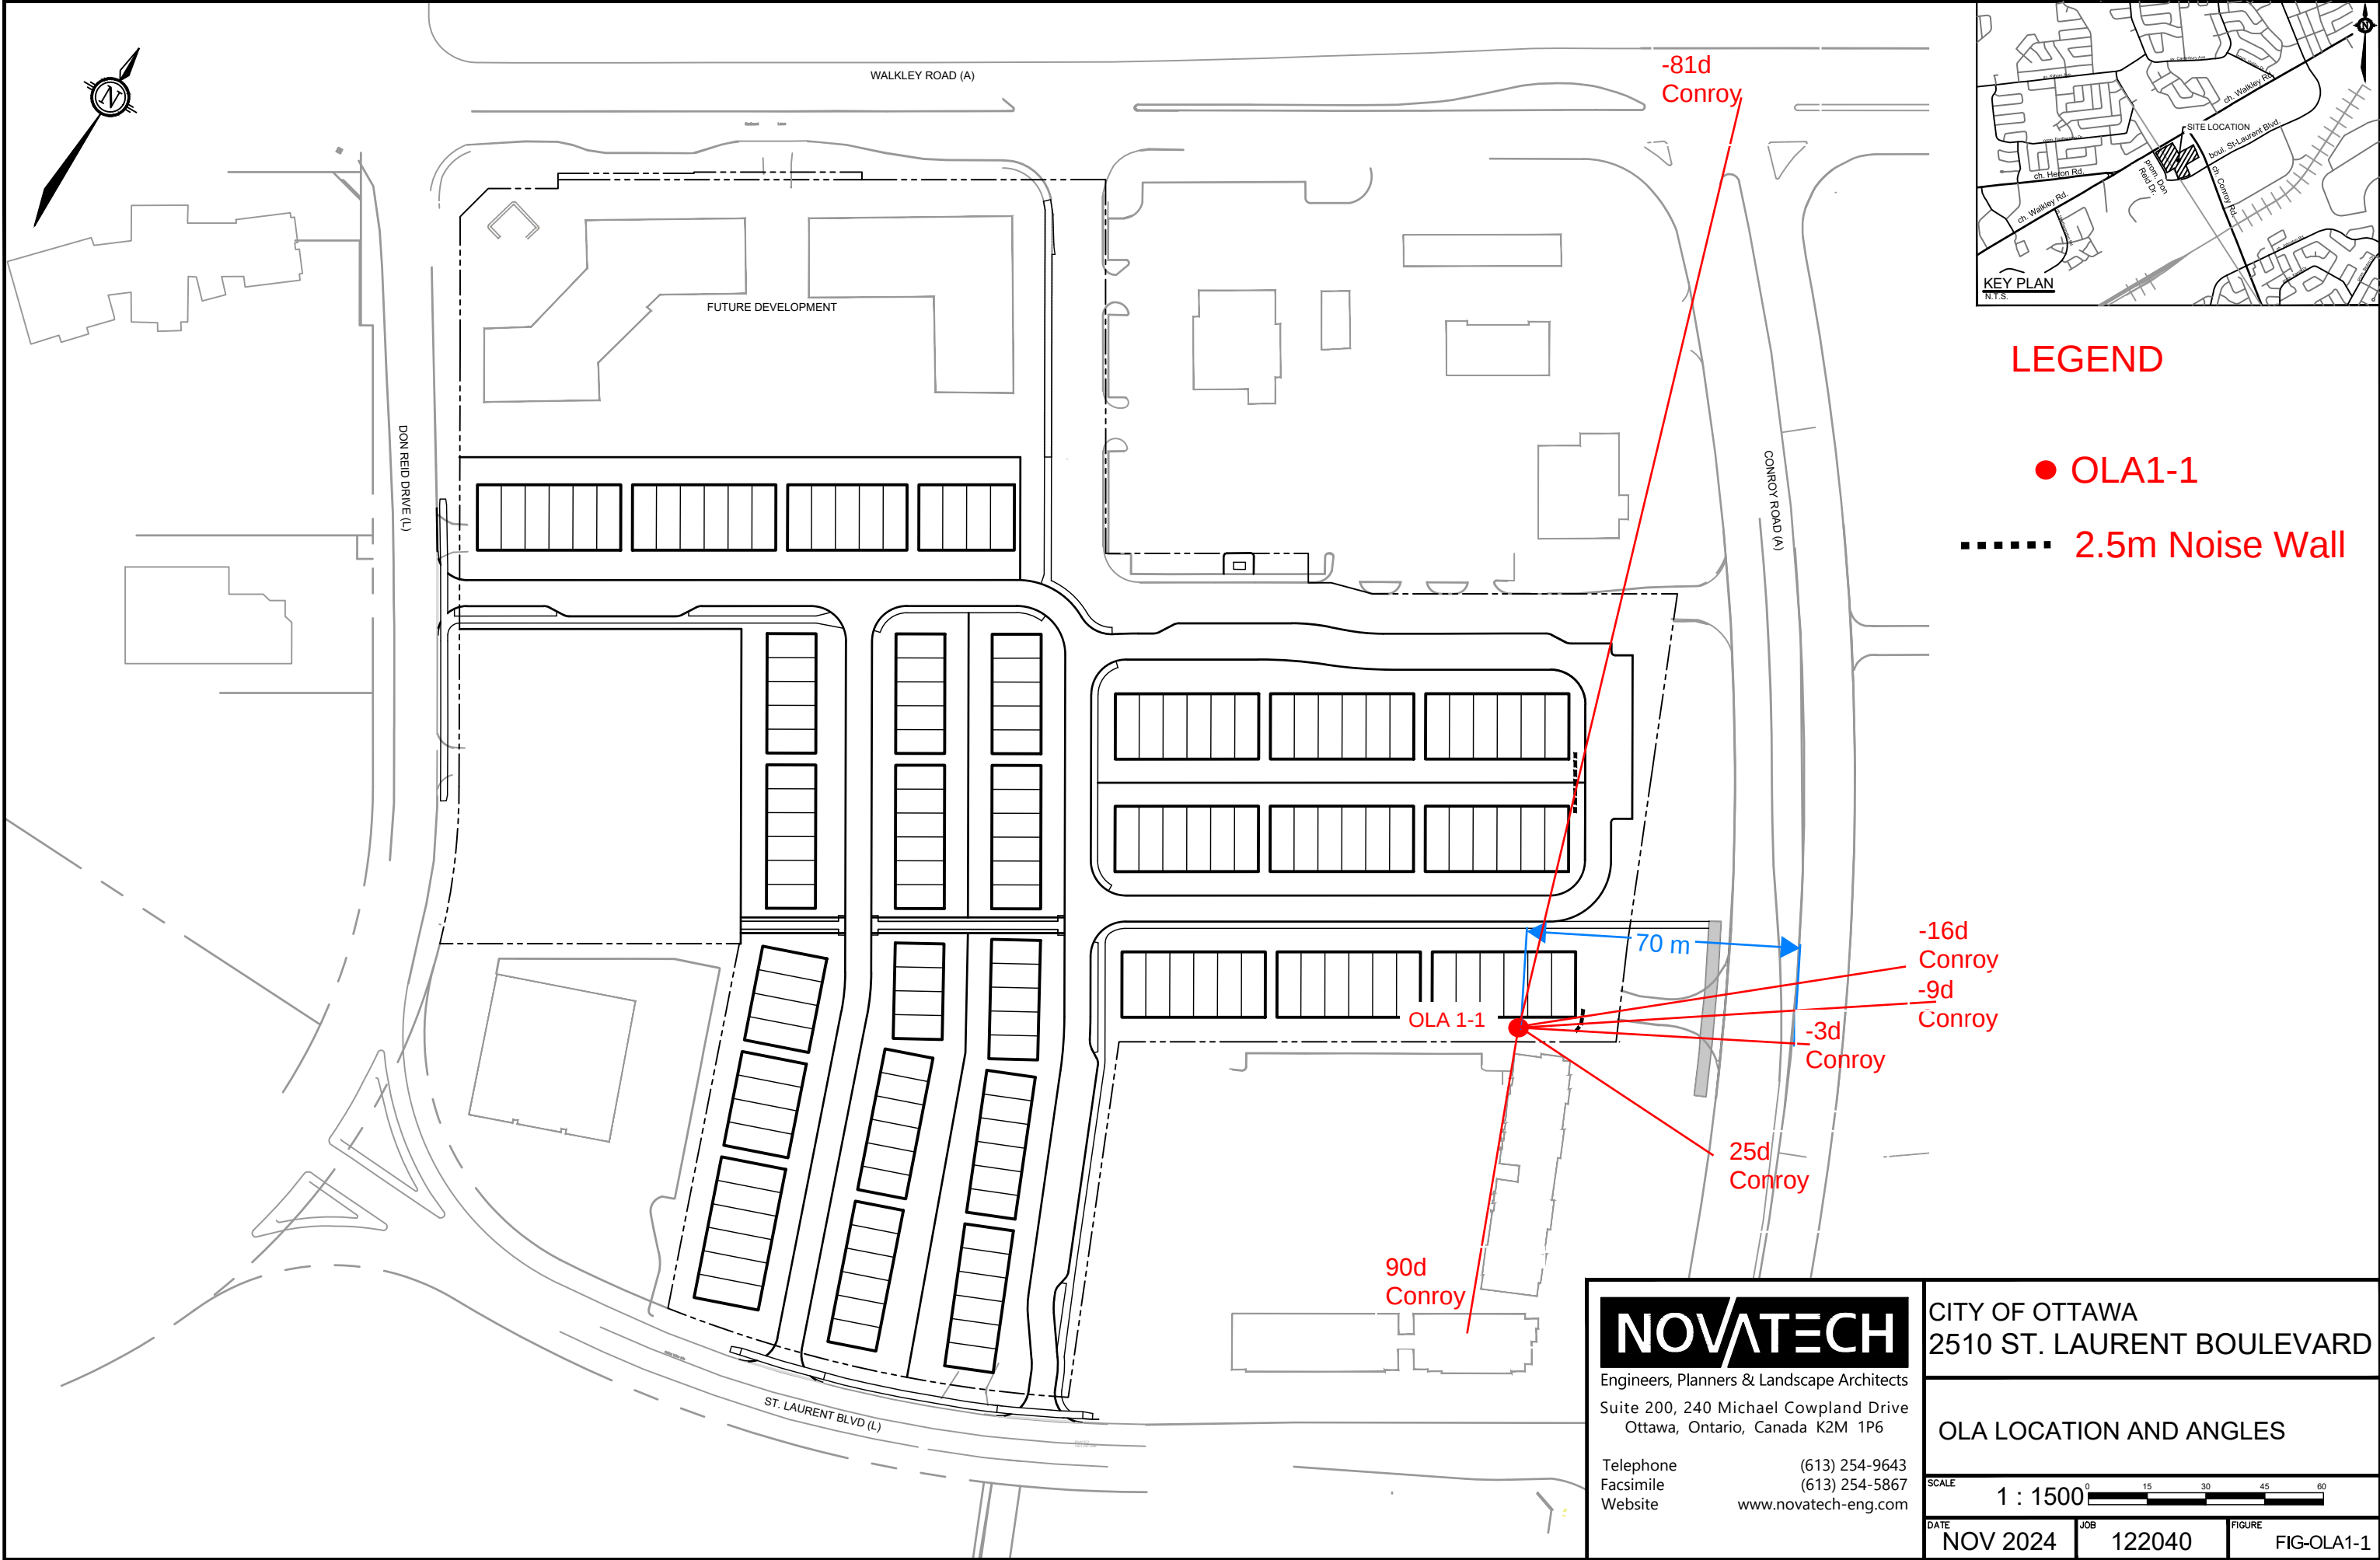


M:\2022\122040\CAD\Civil\Figures\Noise\122040-NC.dwg, Fig. Jul 17, 2023 - 11:42am, mfang

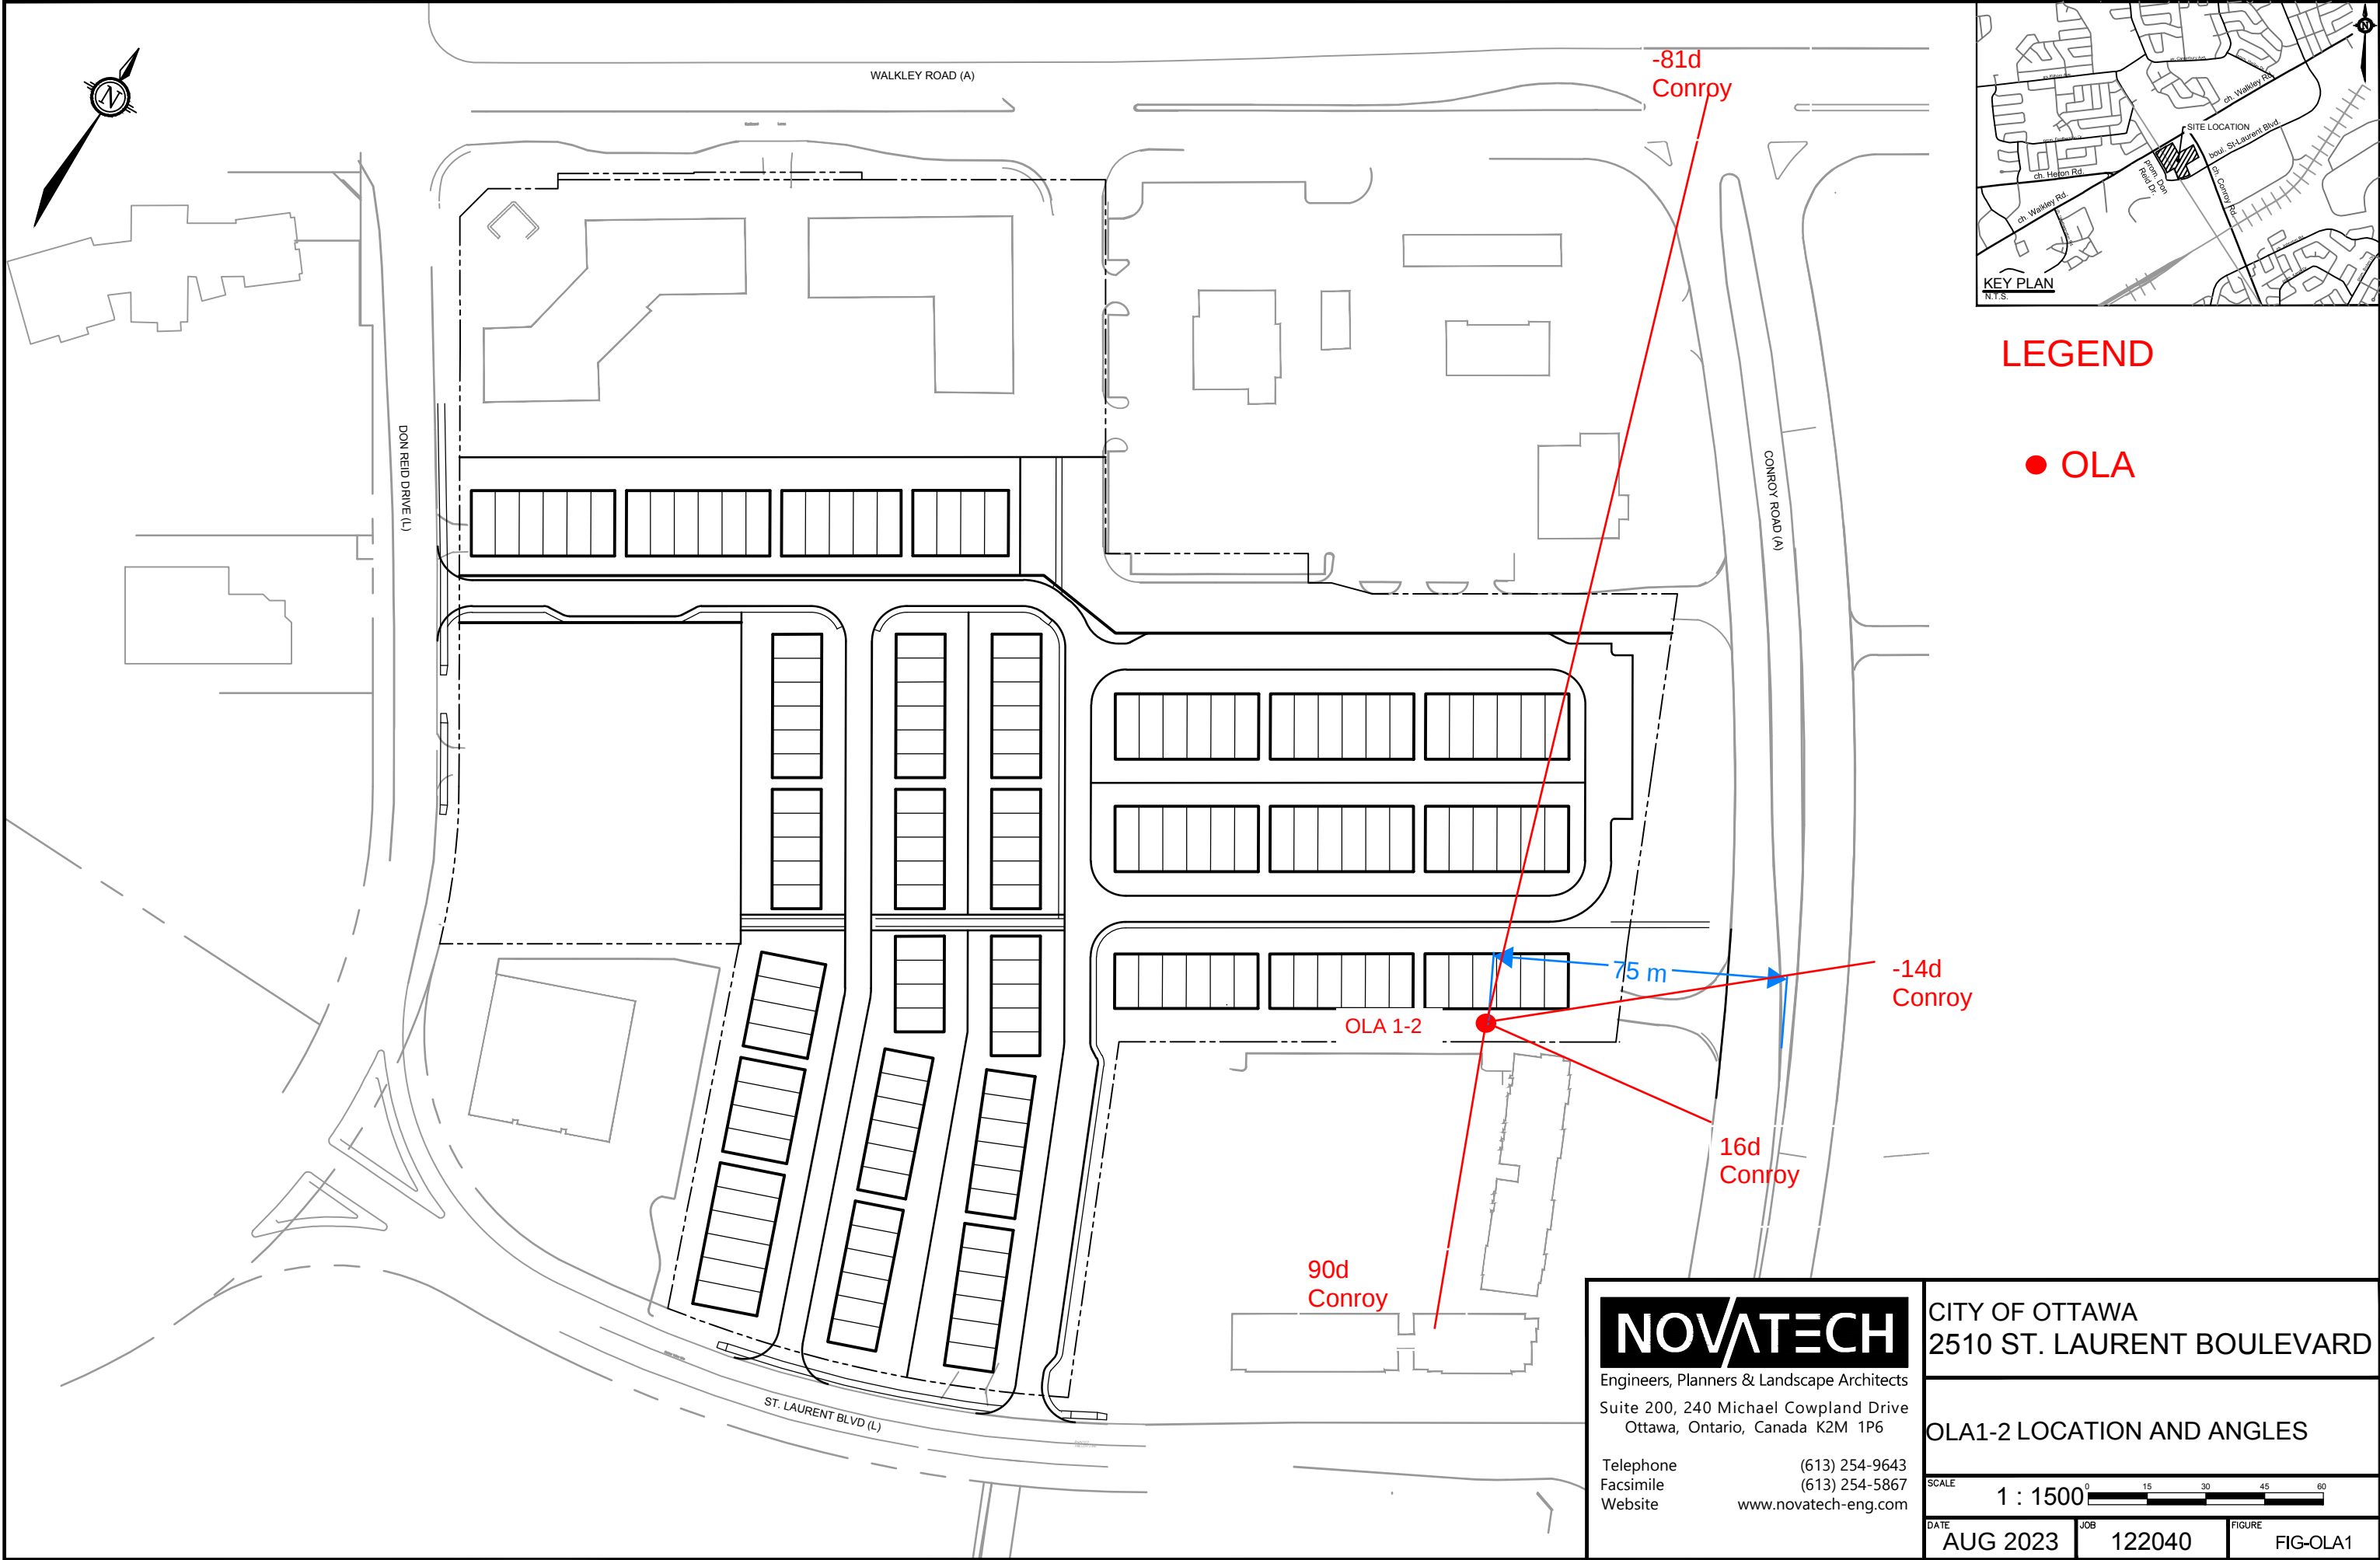


**NOVATECH**  
Engineers, Planners & Landscape Architects  
Suite 200, 240 Michael Cowpland Drive  
Ottawa, Ontario, Canada K2M 1P6  
Telephone (613) 254-9643  
Facsimile (613) 254-5867  
Website www.novatech-eng.com

|                                              |          |          |
|----------------------------------------------|----------|----------|
| CITY OF OTTAWA<br>2510 ST. LAURENT BOULEVARD |          |          |
| OLA1-2 LOCATION AND ANGLES                   |          |          |
| SCALE                                        | 1 : 1500 |          |
| DATE                                         | JOB      | FIGURE   |
| AUG 2023                                     | 122040   | FIG-OLA1 |


M:\2022\122040\CAD\Civil\Figures\Noise\122040-NC.dwg, Fig (W), Nov 29, 2024 - 8:47am, mfang

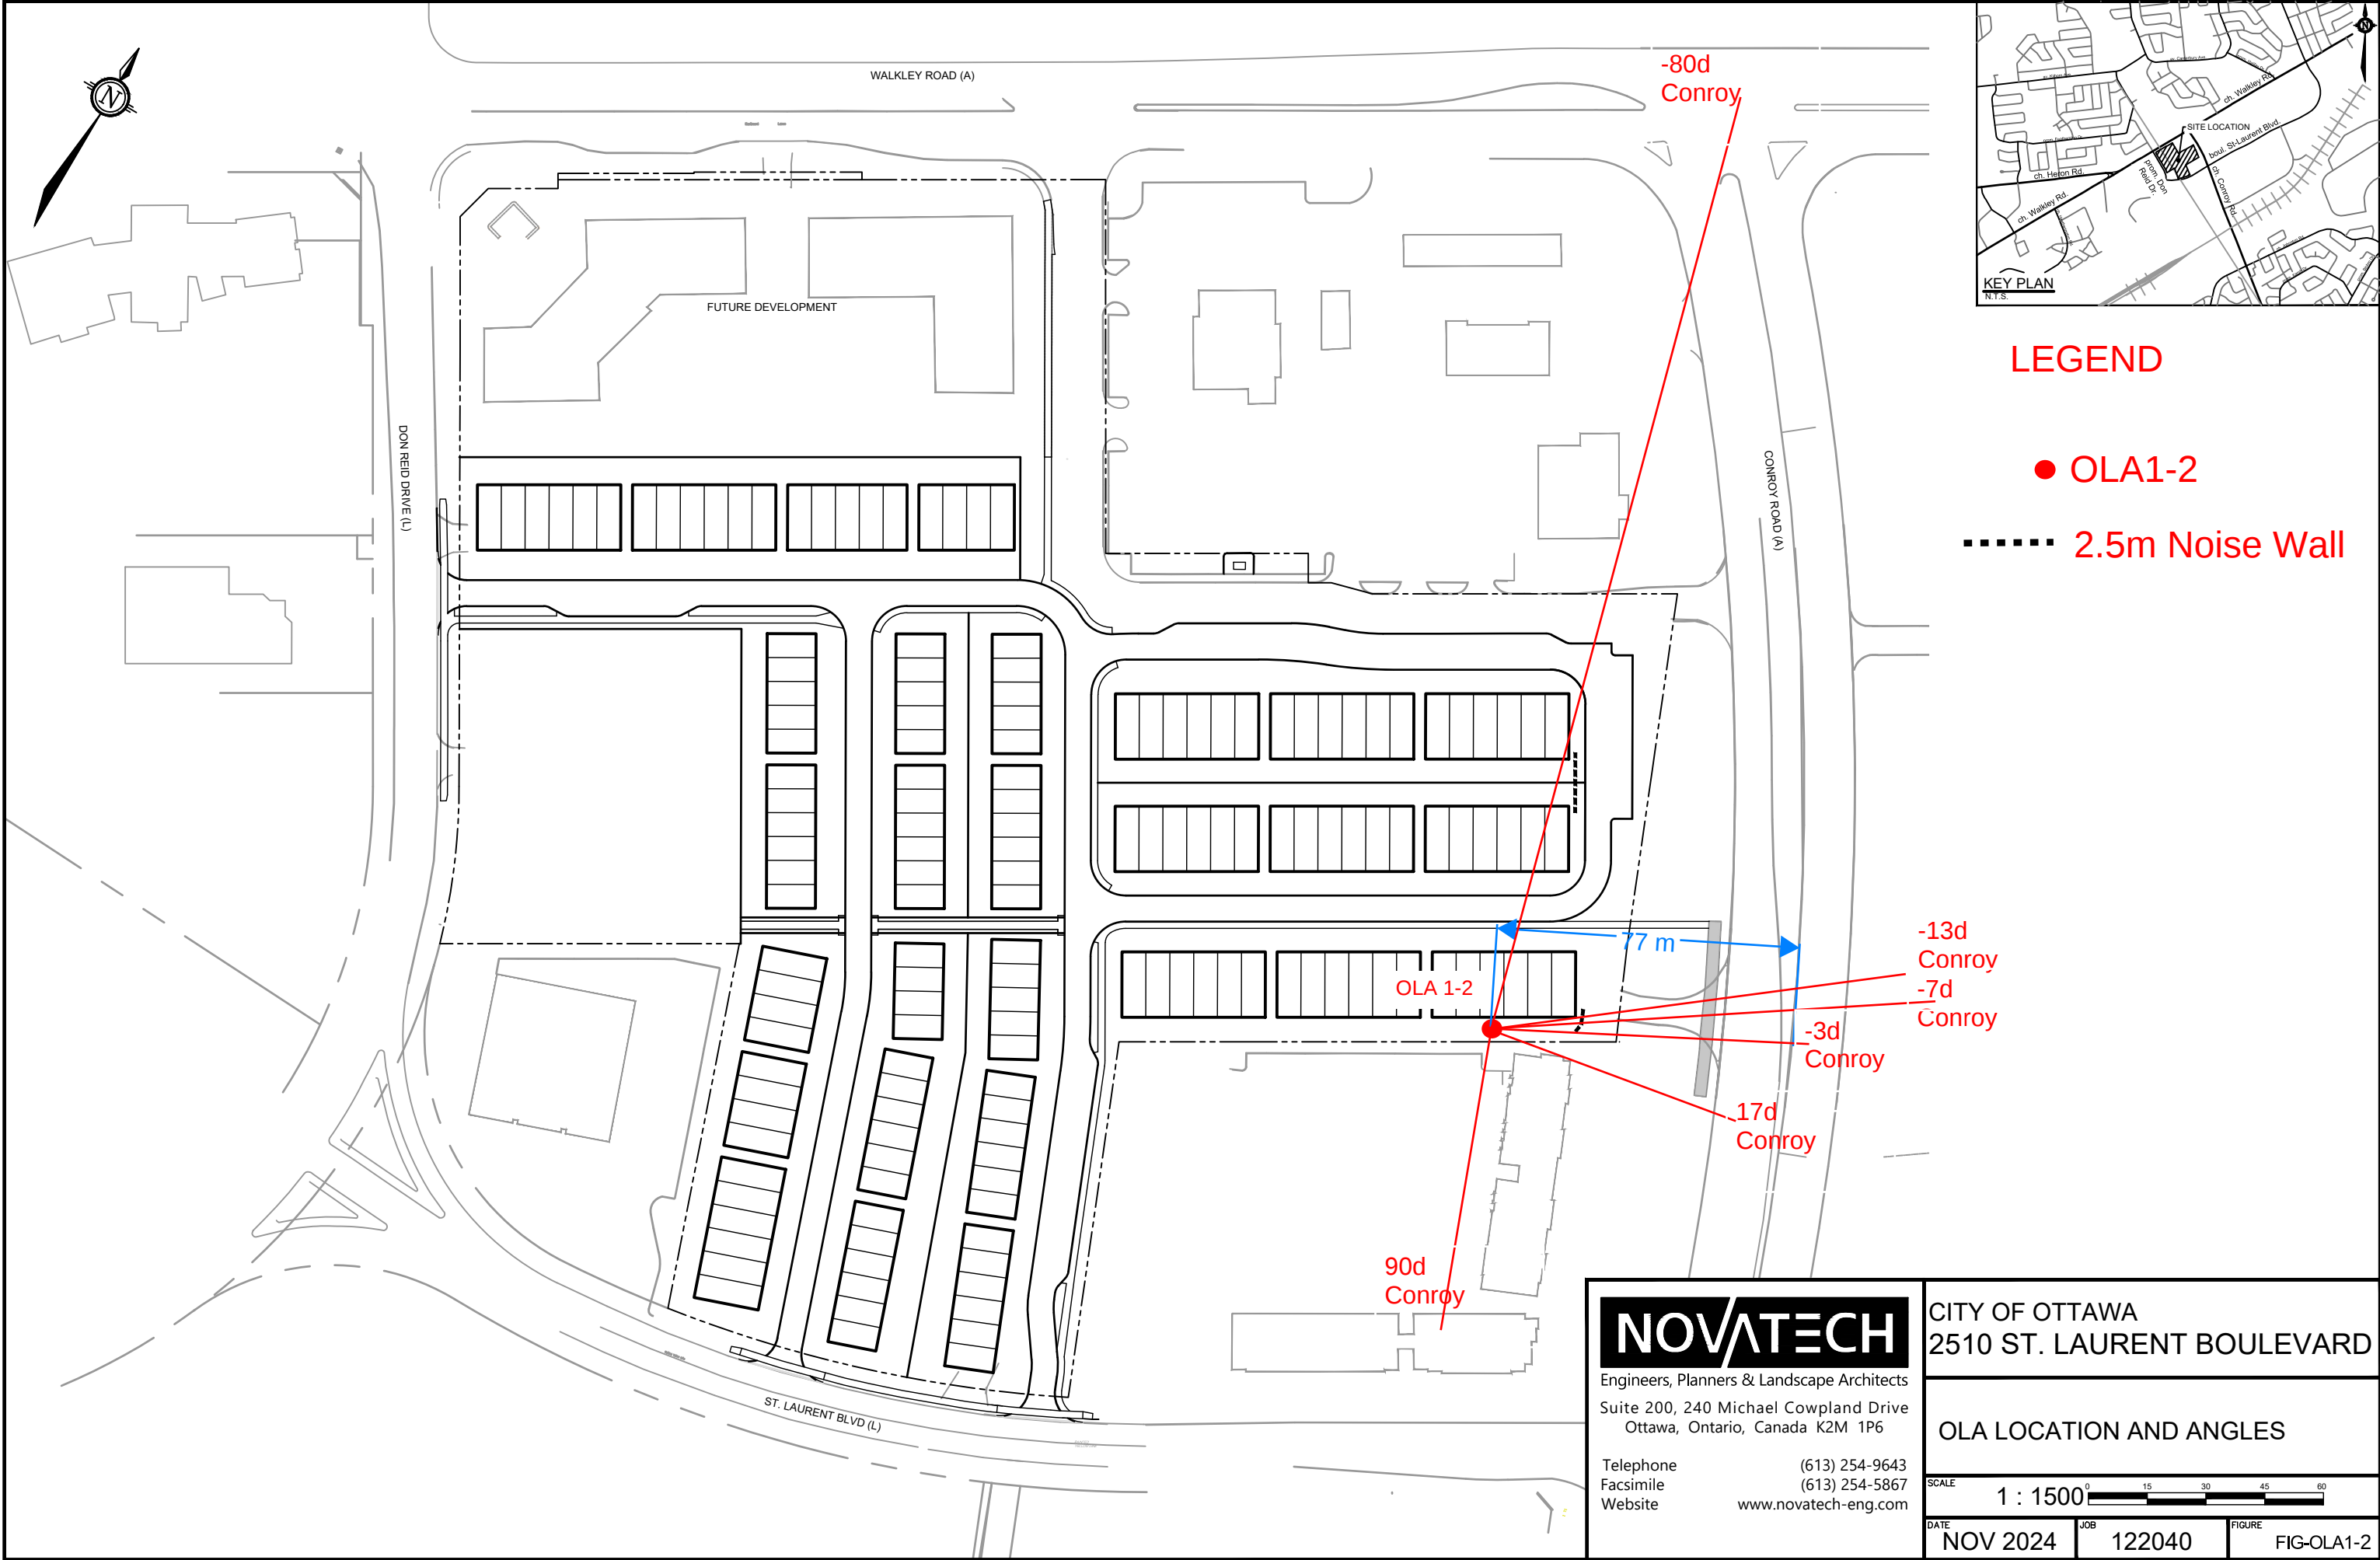

M:\2022\122040\CAD\Civil\Figures\Noise\122040-NC.dwg, Fig. Jul 17, 2023 - 11:42am, mfang


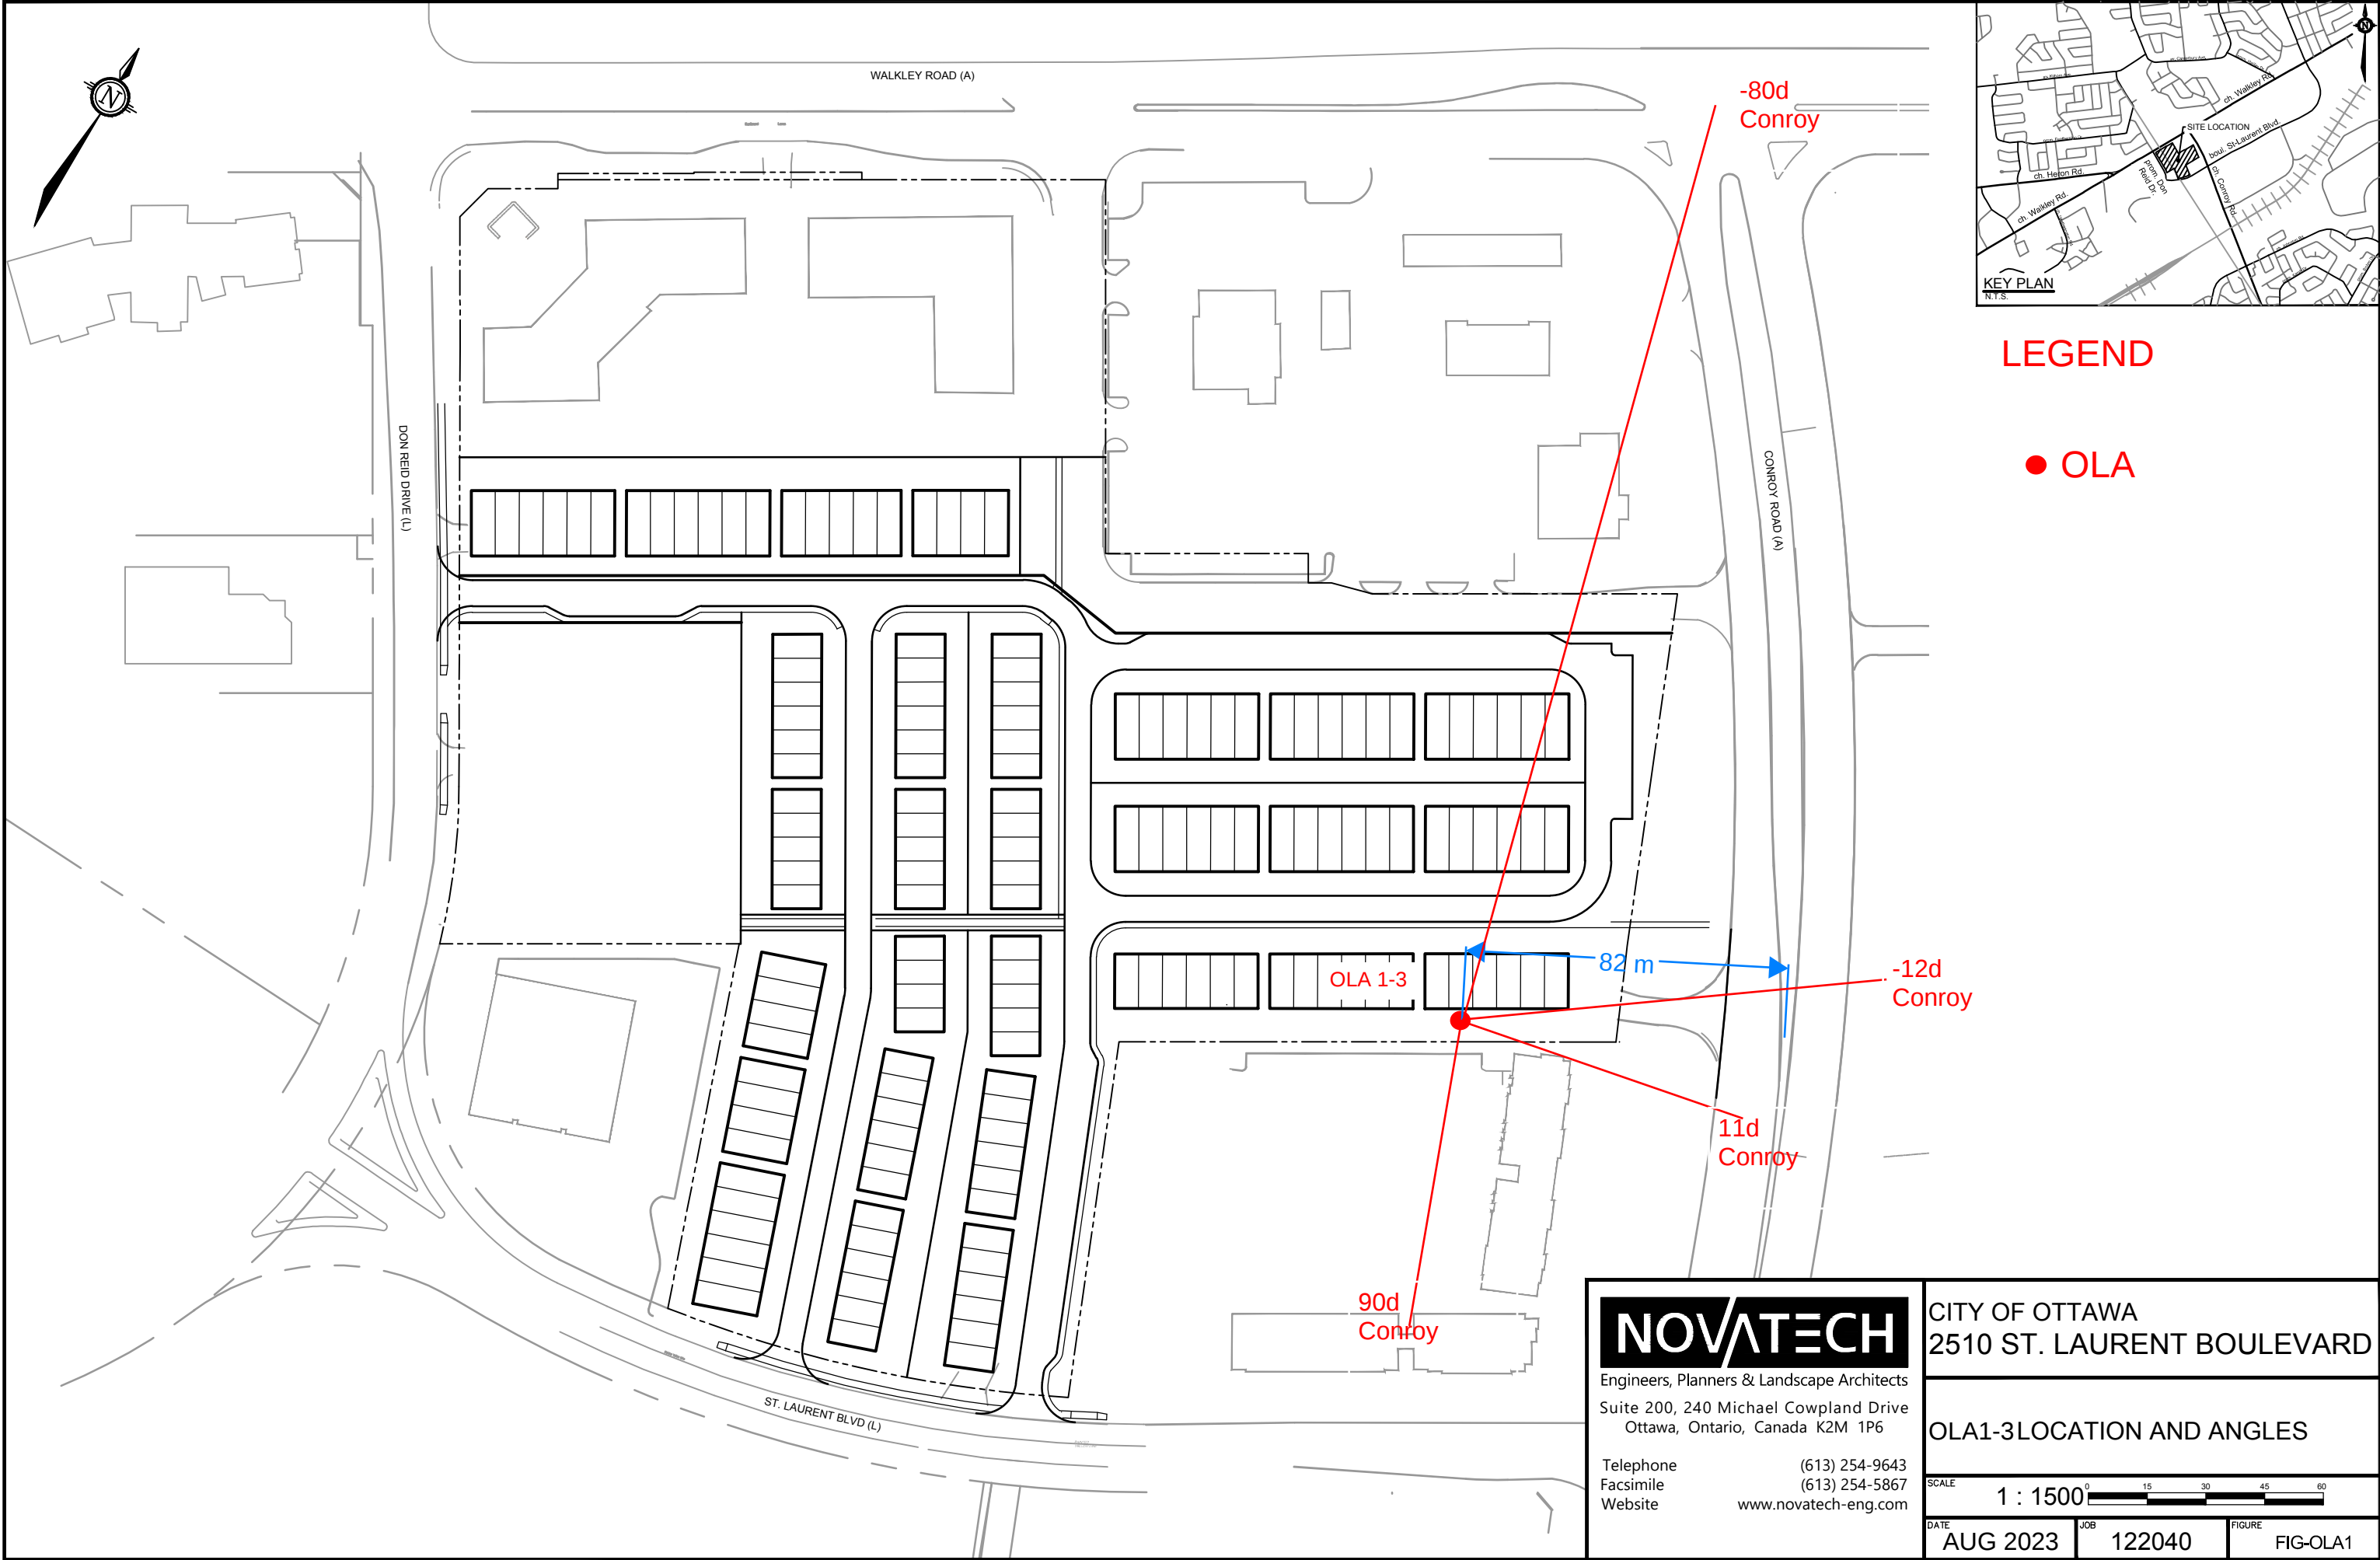


M:\2022\122040\CAD\Civil\Figures\Noise\122040-NC.dwg, Fig. Jul 17, 2023 - 11:42am, mfang

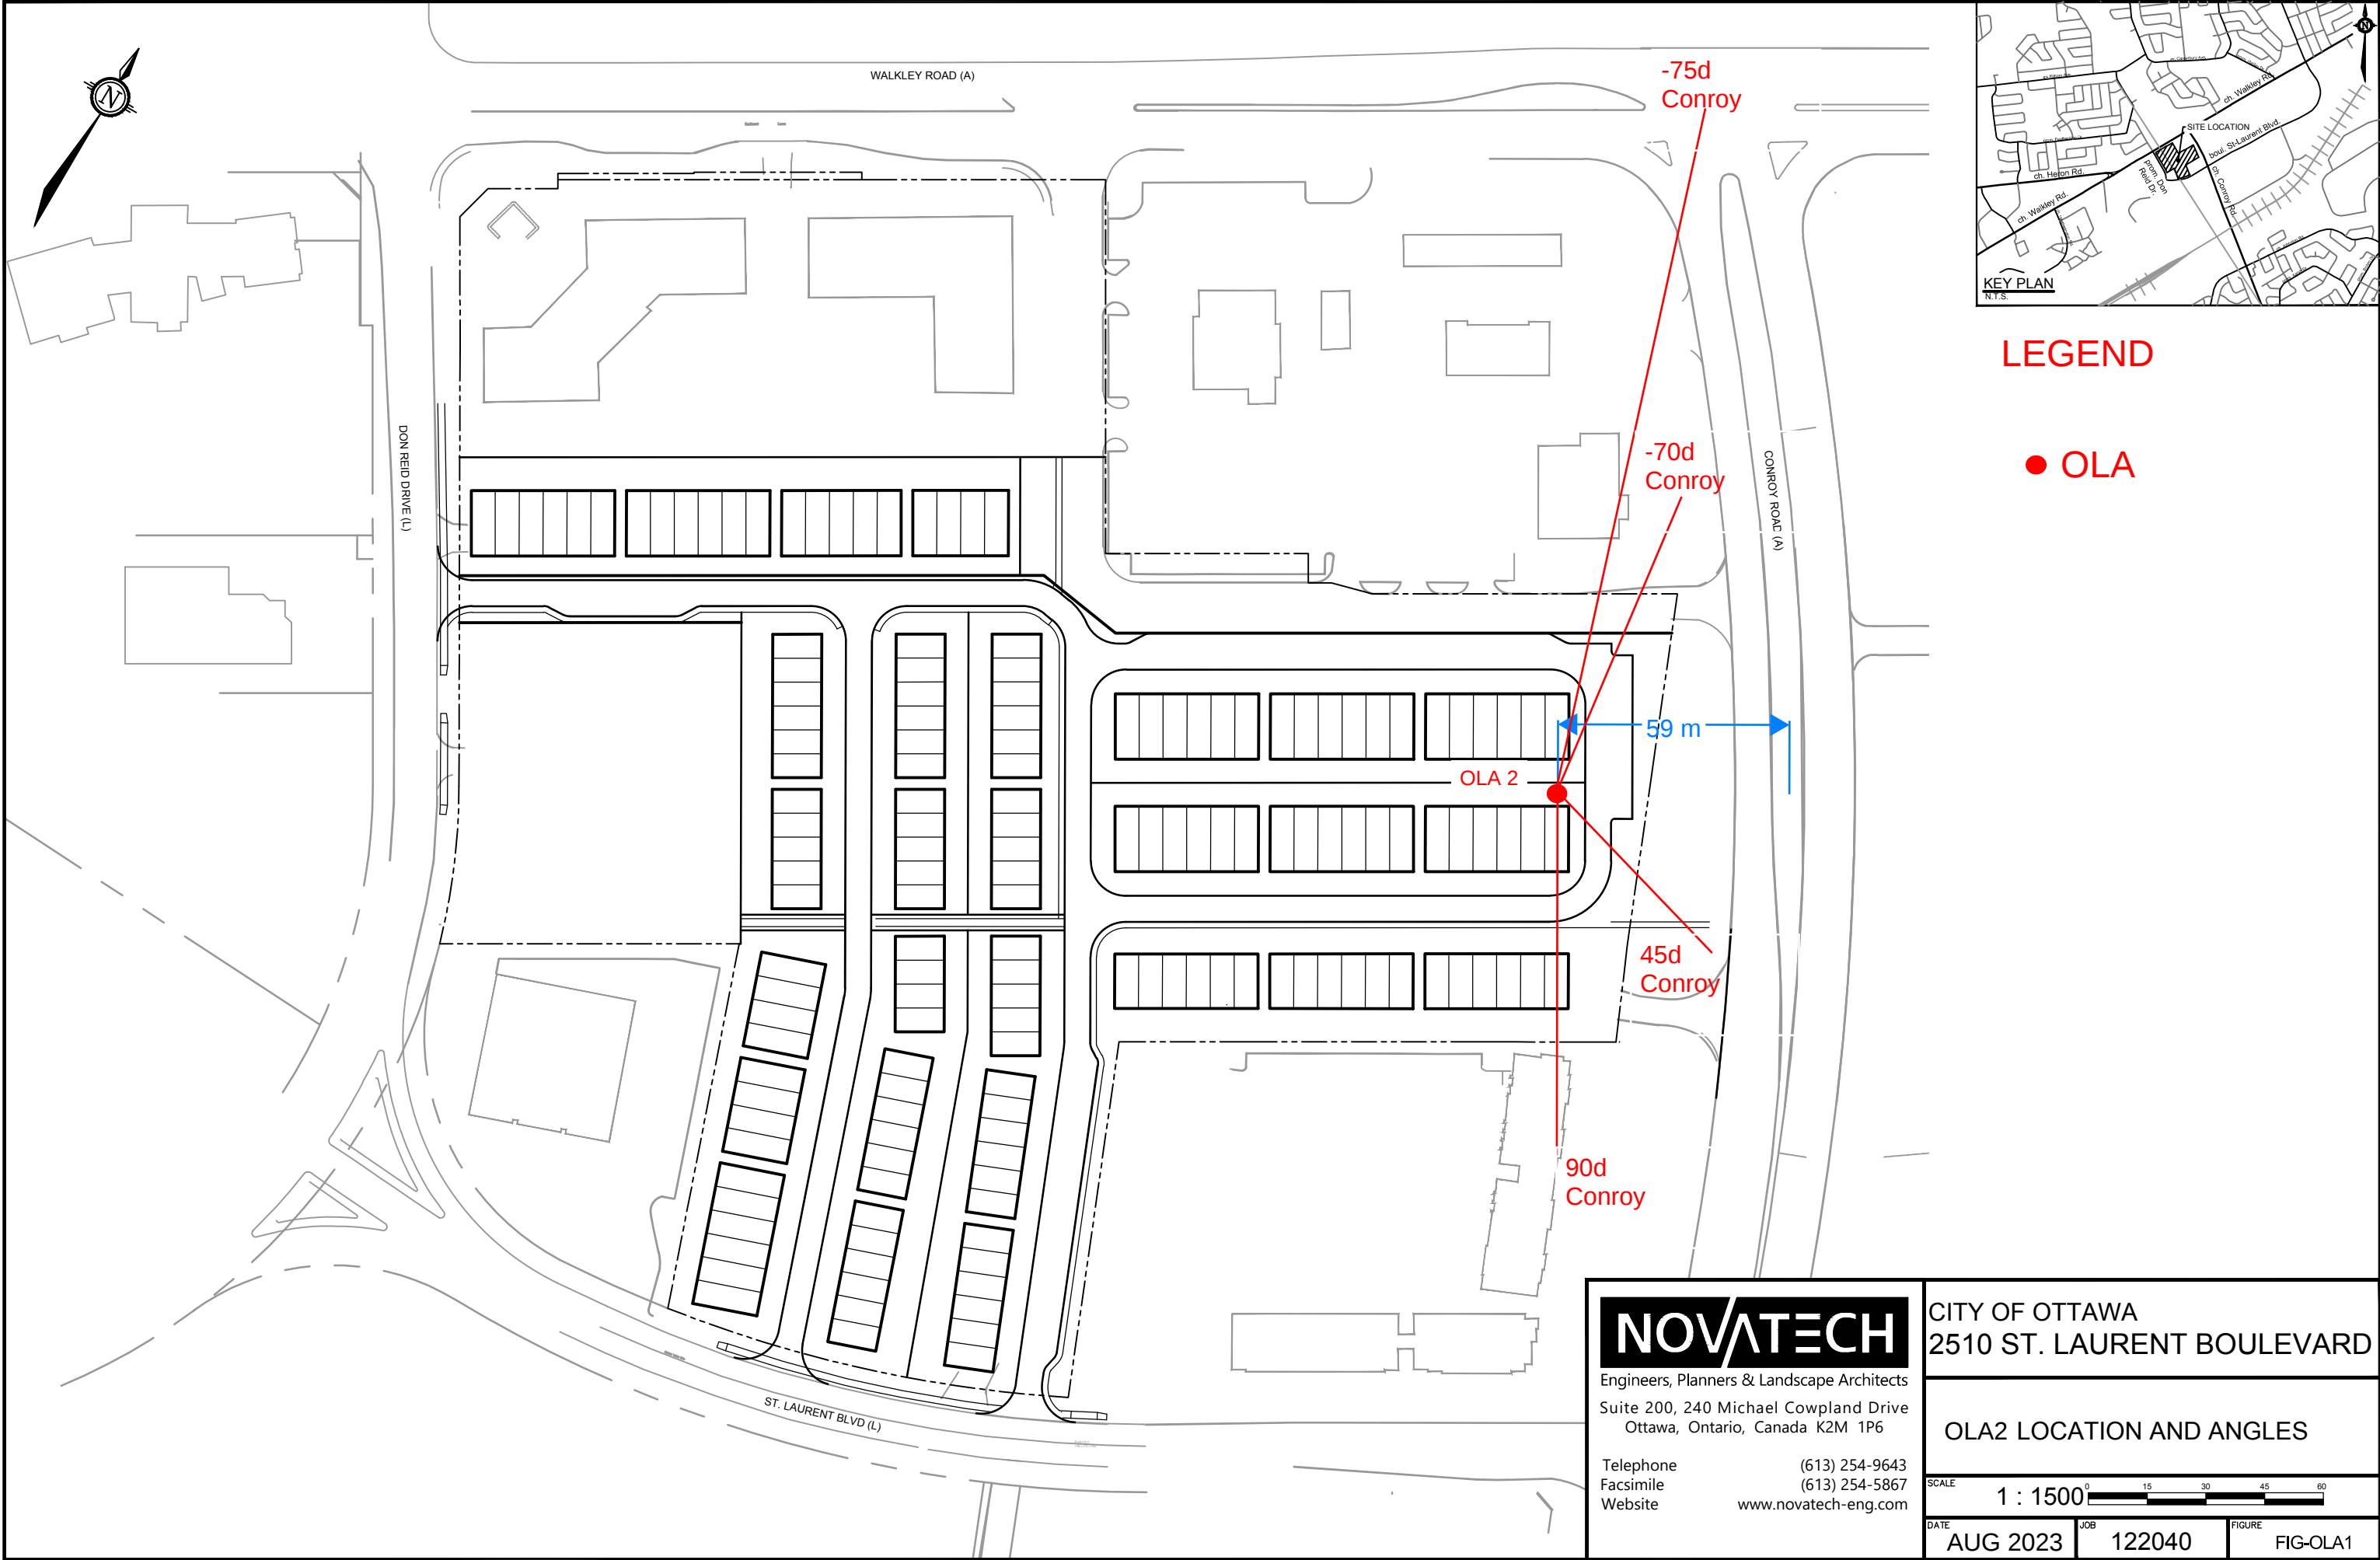

|                                                                                                                                                                                                                                                                                 |                                              |               |                    |
|---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|----------------------------------------------|---------------|--------------------|
| <b>NOVATECH</b><br>Engineers, Planners & Landscape Architects<br>Suite 200, 240 Michael Cowpland Drive<br>Ottawa, Ontario, Canada K2M 1P6<br><br>Telephone (613) 254-9643<br>Facsimile (613) 254-5867<br>Website <a href="http://www.novatech-eng.com">www.novatech-eng.com</a> | CITY OF OTTAWA<br>2510 ST. LAURENT BOULEVARD |               |                    |
|                                                                                                                                                                                                                                                                                 | OLA2 LOCATION AND ANGLES                     |               |                    |
|                                                                                                                                                                                                                                                                                 | SCALE<br>1 : 1500                            |               |                    |
|                                                                                                                                                                                                                                                                                 | DATE<br>AUG 2023                             | JOB<br>122040 | FIGURE<br>FIG-OLA1 |

M:\2022\122040\CAD\Civil\Figures\Noise\122040-NC.dwg, Fig (W), Nov 29, 2024 - 8:47am, mfang

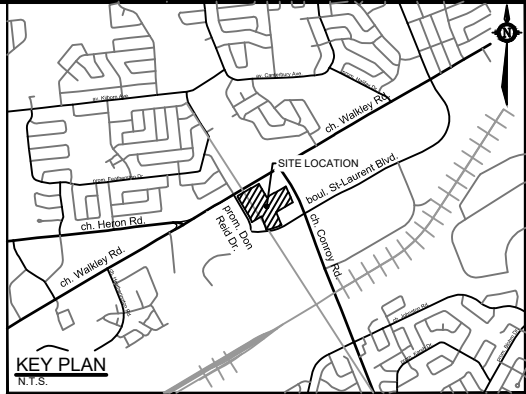
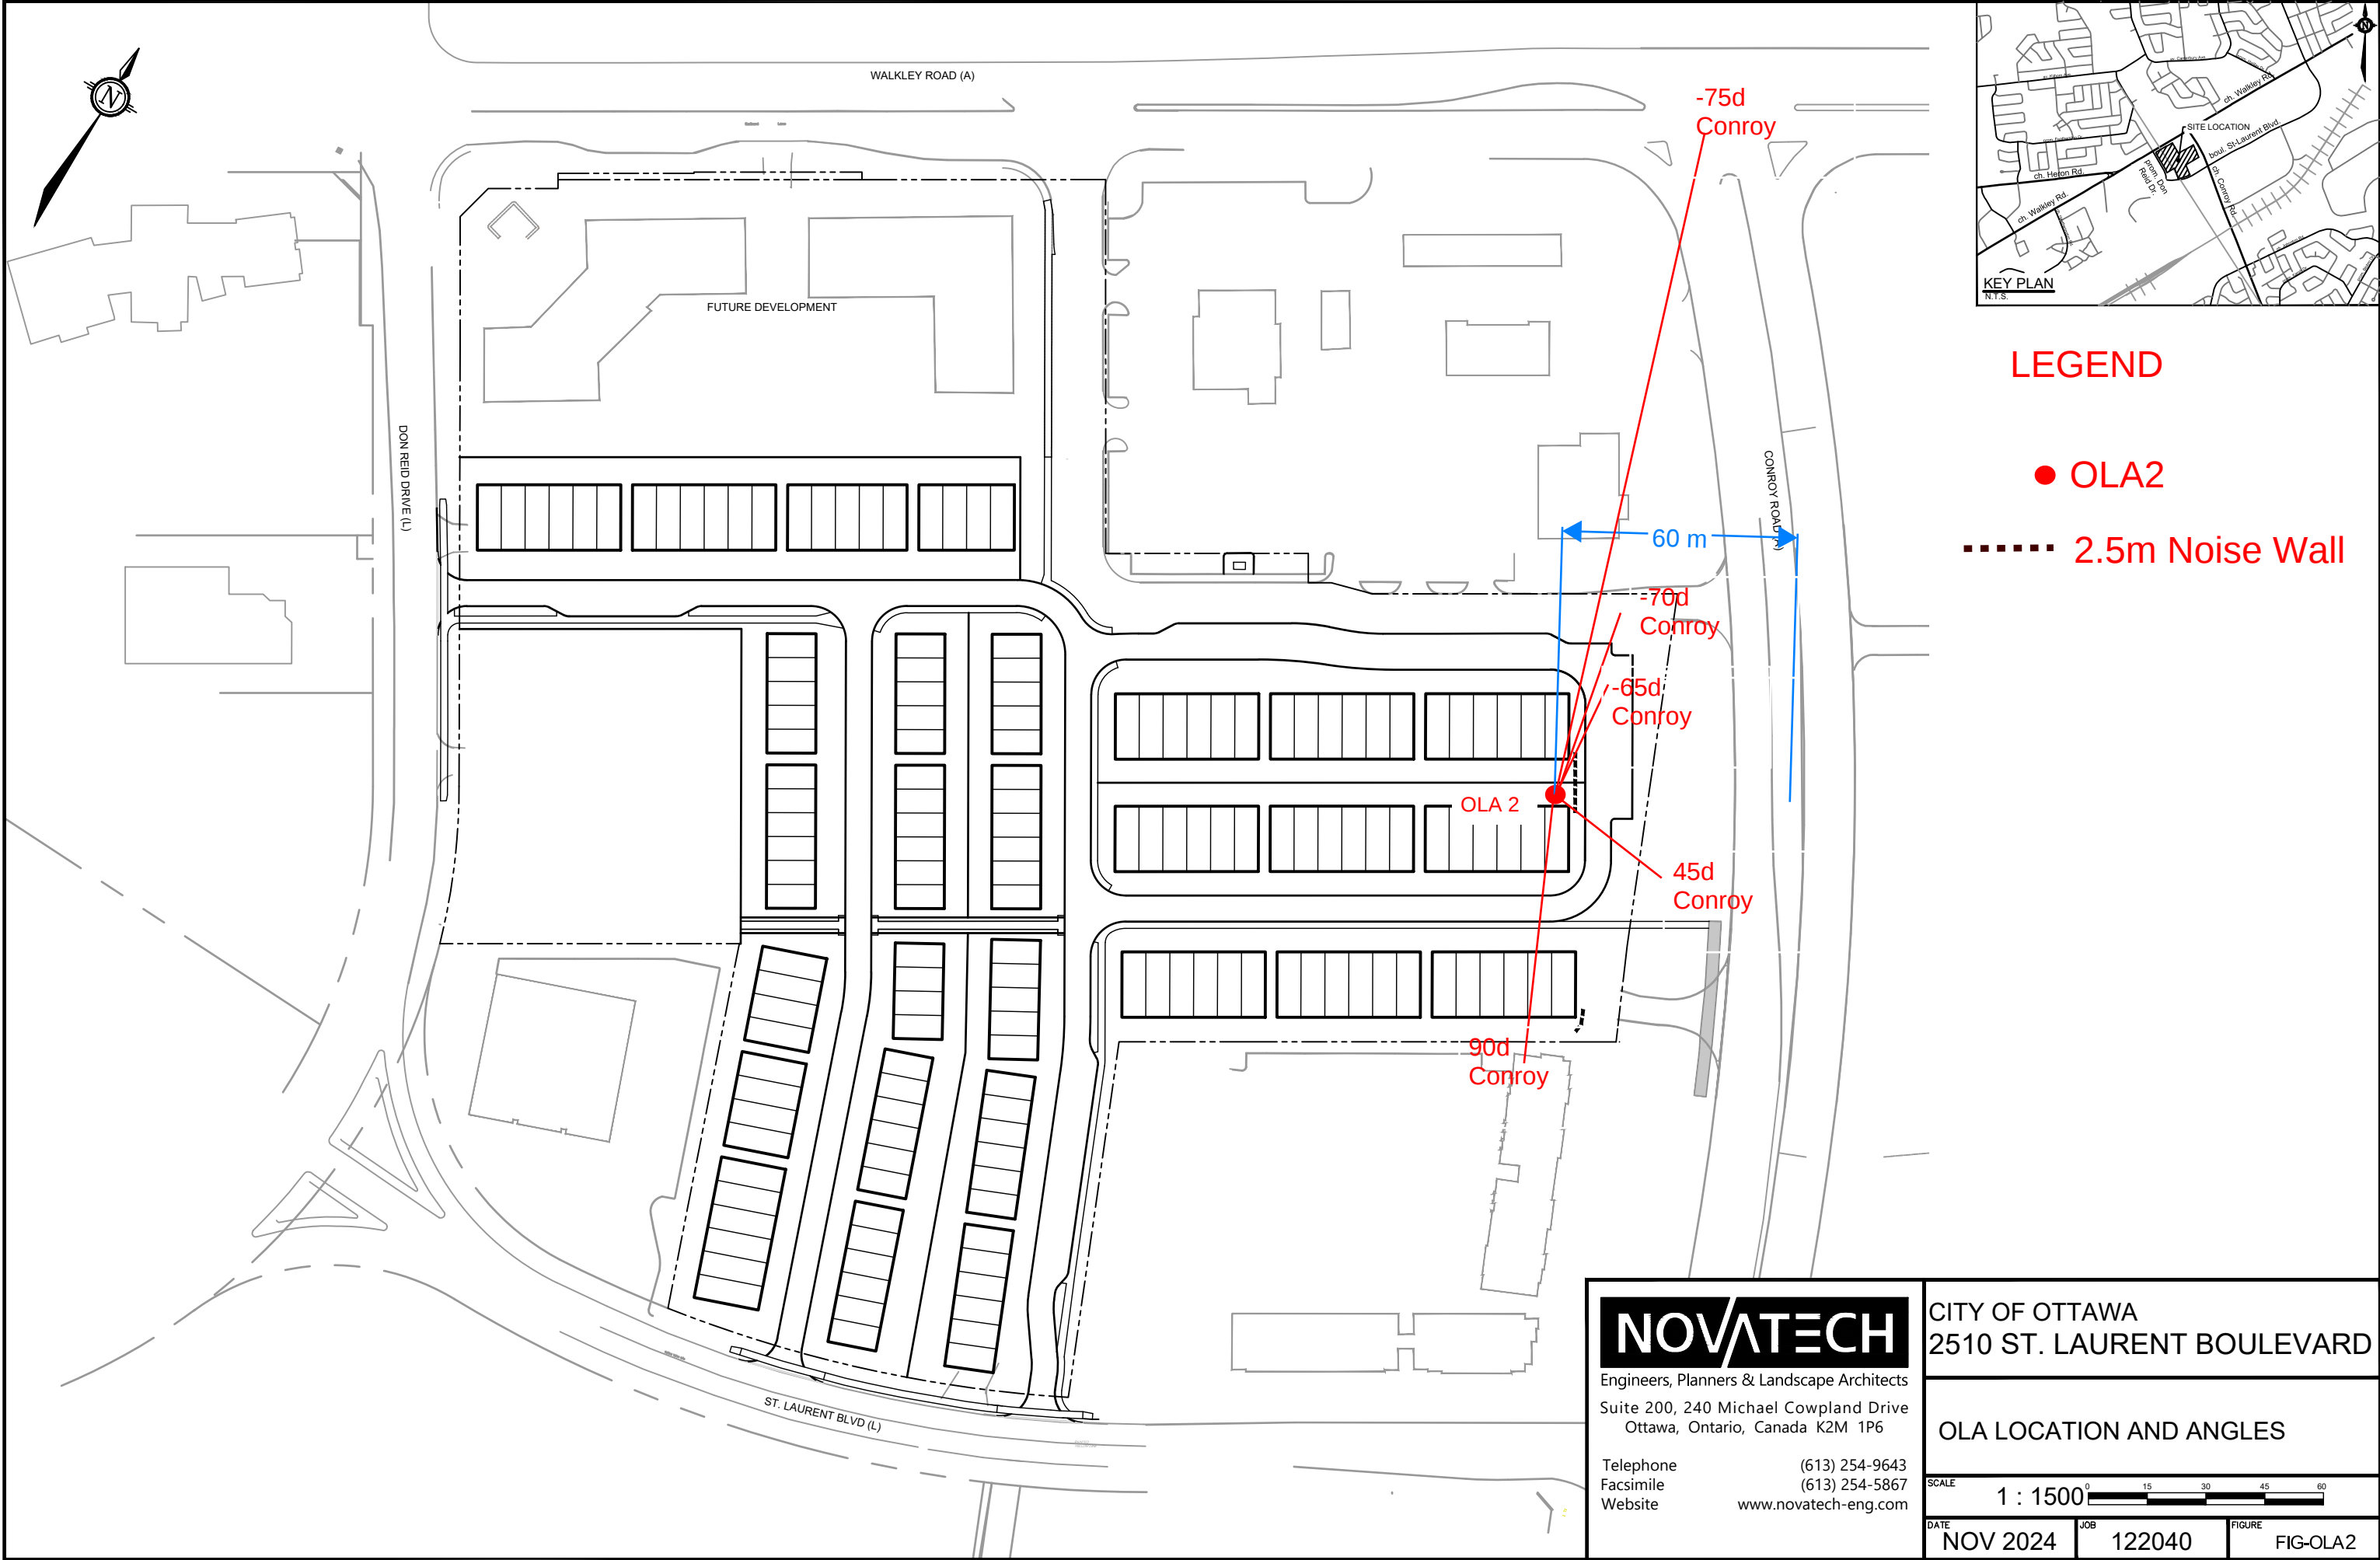


LEGEND

- OLA2
- ..... 2.5m Noise Wall

|                                                                                                                                                                                                                                       |                                              |               |                    |
|---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|----------------------------------------------|---------------|--------------------|
| <b>NOVATECH</b><br>Engineers, Planners & Landscape Architects<br>Suite 200, 240 Michael Cowpland Drive<br>Ottawa, Ontario, Canada K2M 1P6<br><br>Telephone (613) 254-9643<br>Facsimile (613) 254-5867<br>Website www.novatech-eng.com | CITY OF OTTAWA<br>2510 ST. LAURENT BOULEVARD |               |                    |
|                                                                                                                                                                                                                                       | OLA LOCATION AND ANGLES                      |               |                    |
|                                                                                                                                                                                                                                       | SCALE<br>1 : 1500                            |               |                    |
|                                                                                                                                                                                                                                       | DATE<br>NOV 2024                             | JOB<br>122040 | FIGURE<br>FIG-OLA2 |


M:\2022\122040\CAD\Civil\Figures\Noise\122040-NC.dwg, Fig (W), Nov 29, 2024 - 8:47am, mfang

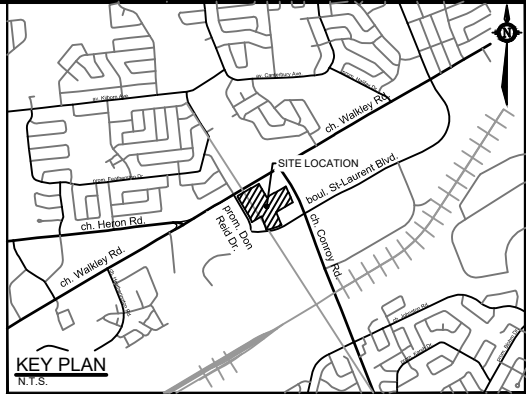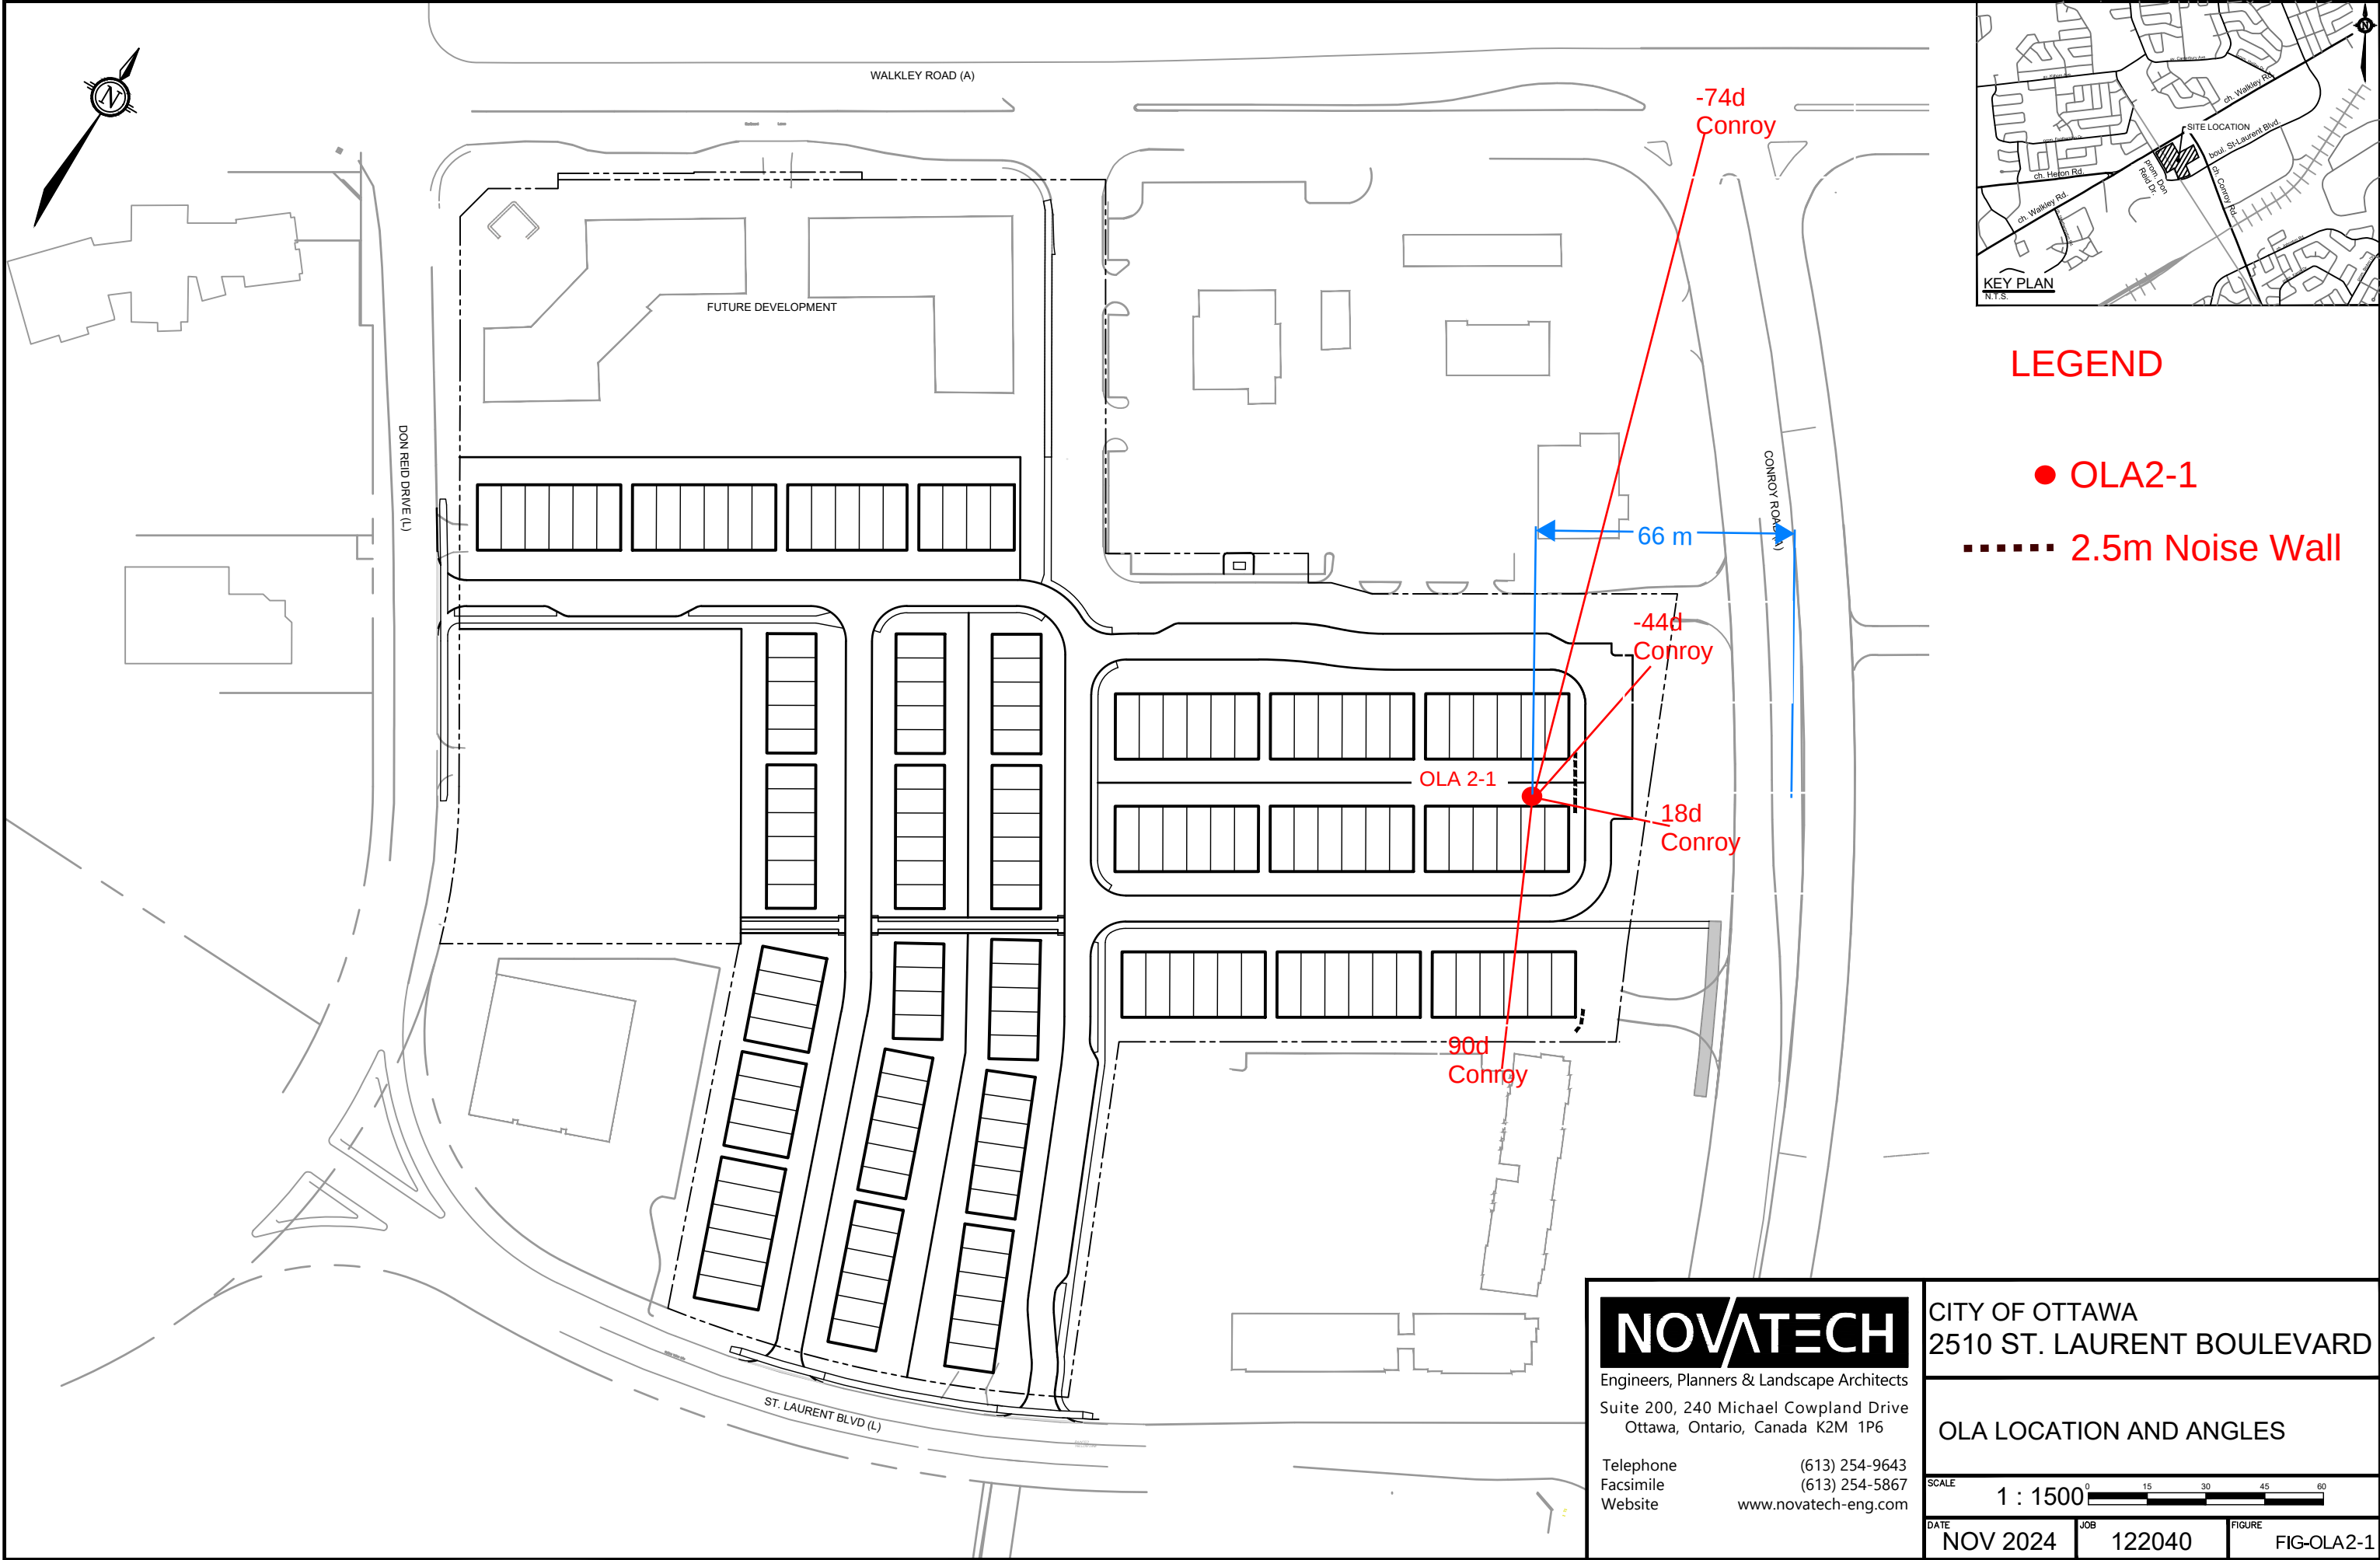

- LEGEND
- OLA2-1
  - ..... 2.5m Noise Wall

|                                                                                                                                                                                                                                       |                                              |               |                      |
|---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|----------------------------------------------|---------------|----------------------|
| <b>NOVATECH</b><br>Engineers, Planners & Landscape Architects<br>Suite 200, 240 Michael Cowpland Drive<br>Ottawa, Ontario, Canada K2M 1P6<br><br>Telephone (613) 254-9643<br>Facsimile (613) 254-5867<br>Website www.novatech-eng.com | CITY OF OTTAWA<br>2510 ST. LAURENT BOULEVARD |               |                      |
|                                                                                                                                                                                                                                       | OLA LOCATION AND ANGLES                      |               |                      |
|                                                                                                                                                                                                                                       | SCALE<br>1 : 1500                            |               |                      |
|                                                                                                                                                                                                                                       | DATE<br>NOV 2024                             | JOB<br>122040 | FIGURE<br>FIG-OLA2-1 |

M:\2022\122040\CAD\Civil\Figures\Noise\122040-NC.dwg, Fig. Jul 17, 2023 - 11:42am, mfang

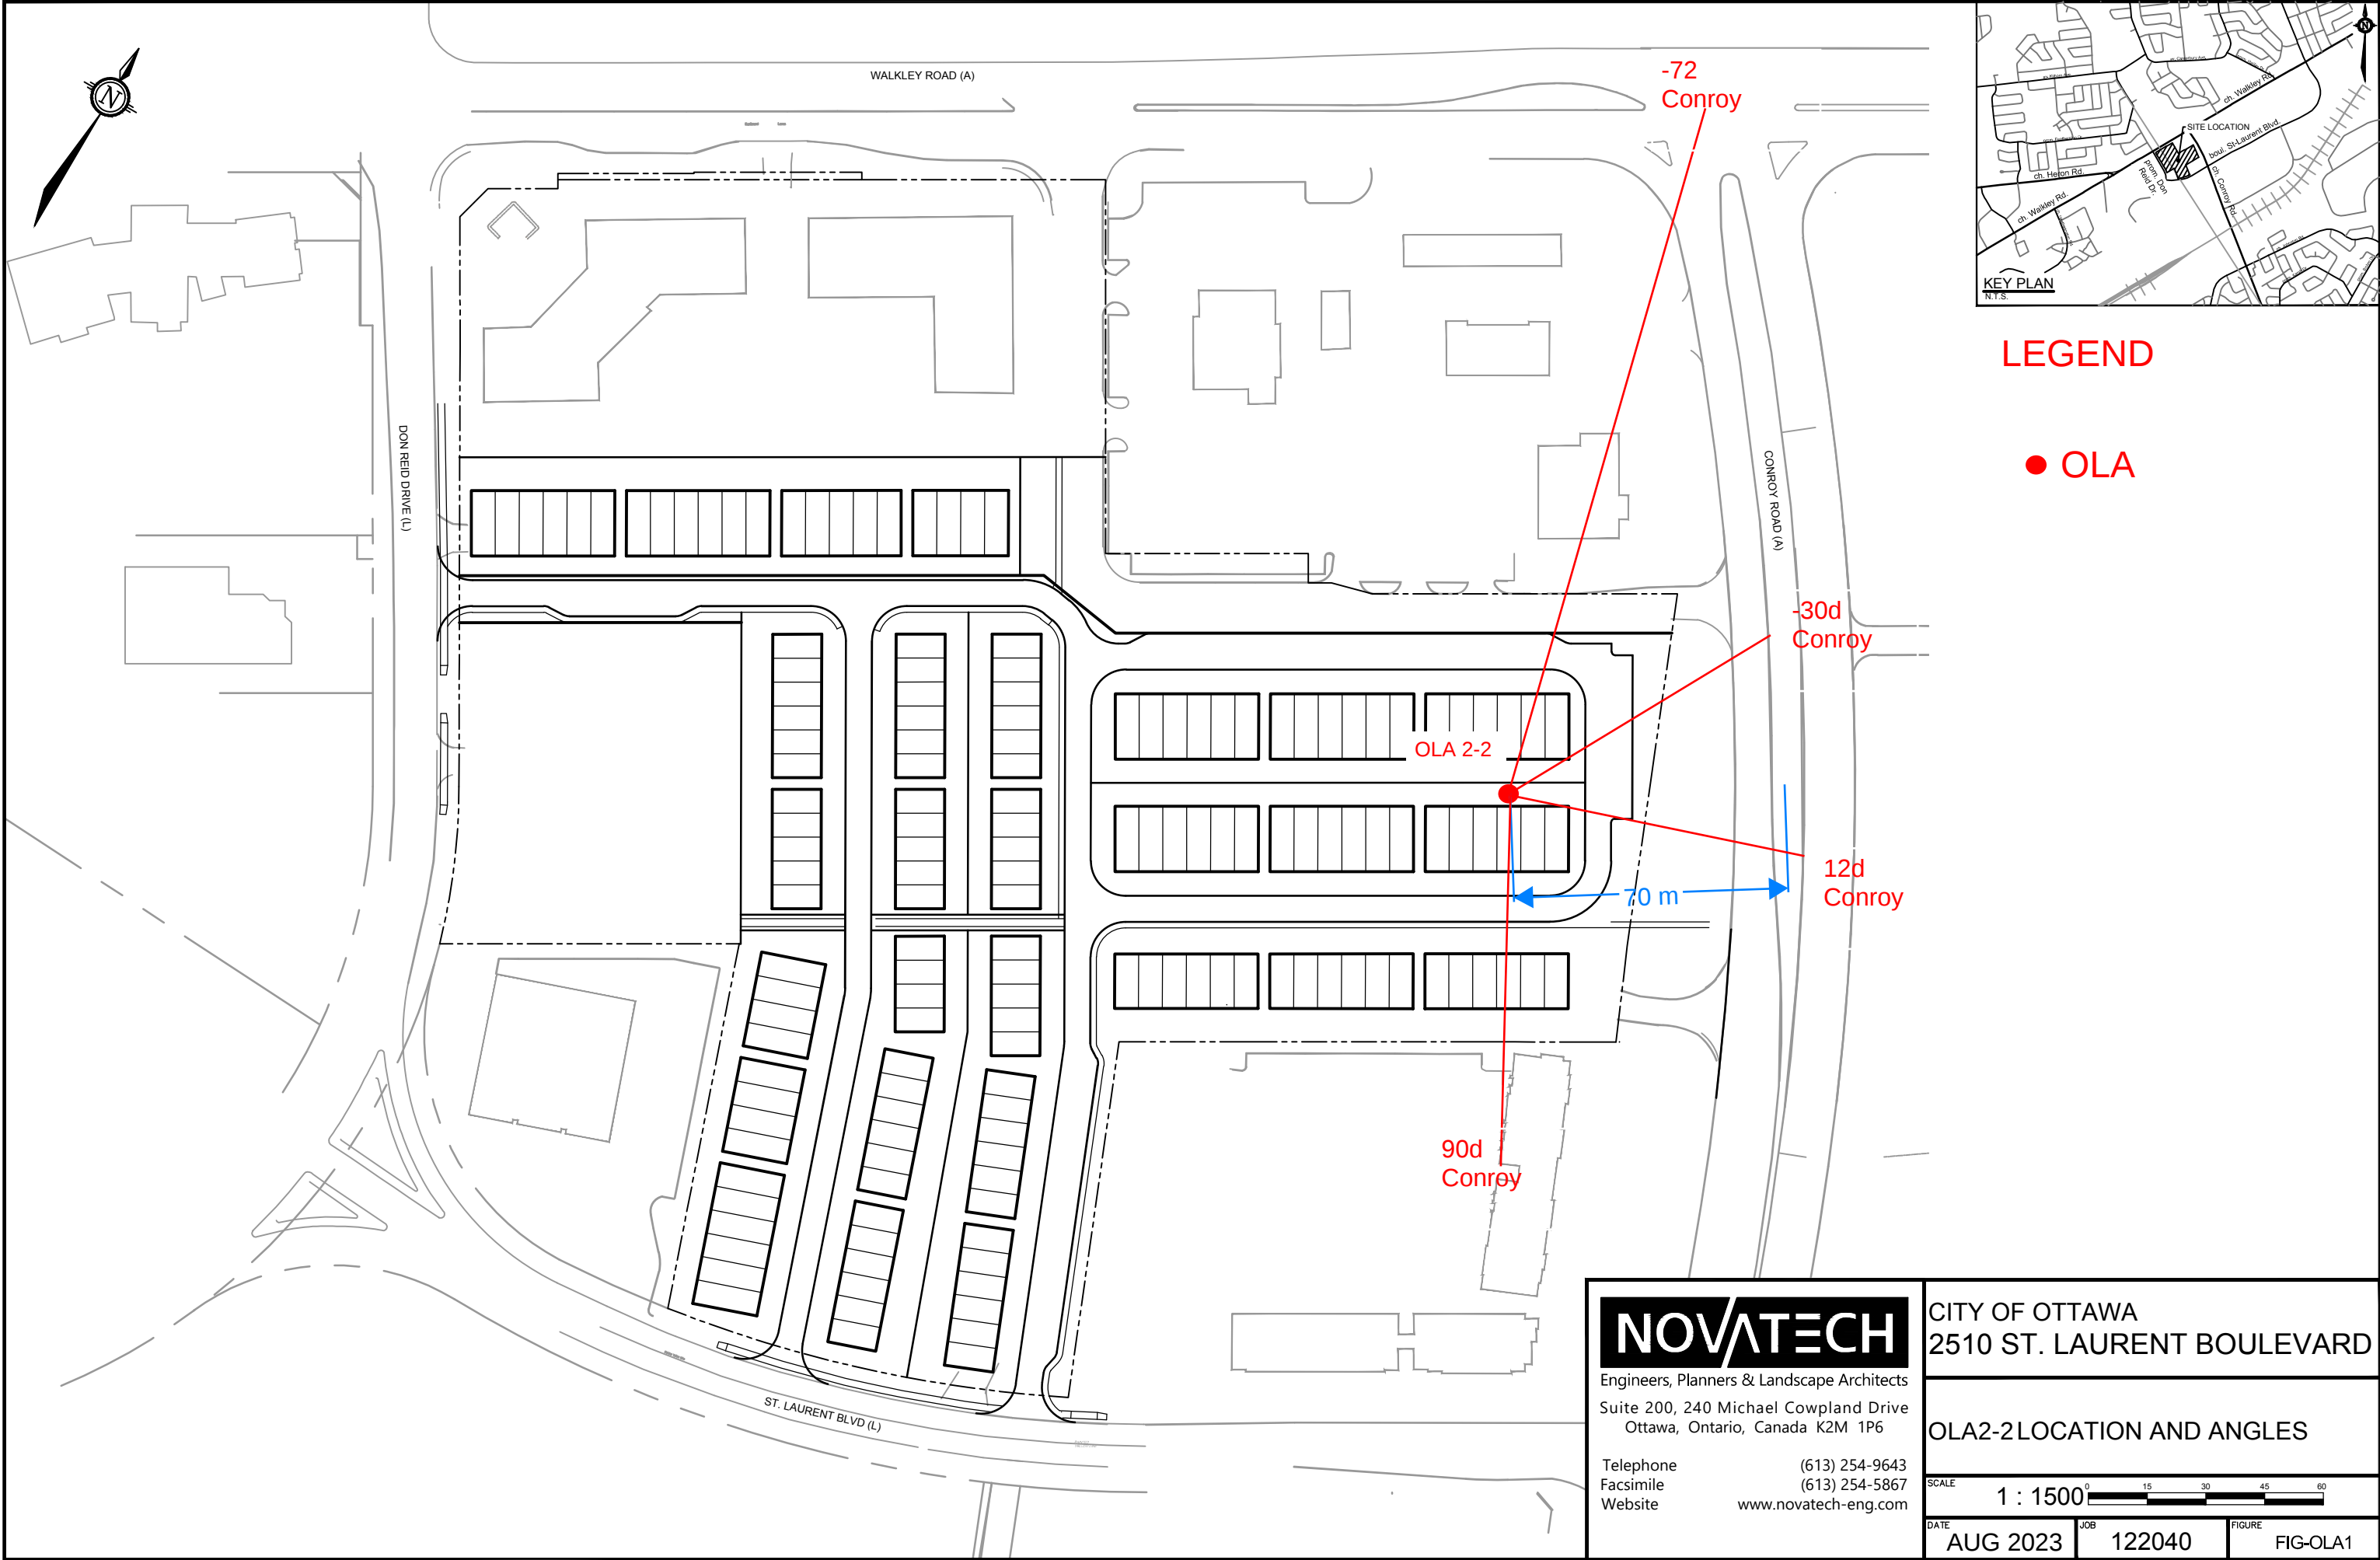

**NOVATECH**  
Engineers, Planners & Landscape Architects  
Suite 200, 240 Michael Cowpland Drive  
Ottawa, Ontario, Canada K2M 1P6  
Telephone (613) 254-9643  
Facsimile (613) 254-5867  
Website [www.novatech-eng.com](http://www.novatech-eng.com)

CITY OF OTTAWA  
2510 ST. LAURENT BOULEVARD

OLA2-2 LOCATION AND ANGLES



SCALE 1 : 1500

DATE AUG 2023

JOB 122040

FIGURE FIG-OLA1

M:\2022\122040\CAD\Civil\Figures\Noise\122040-NC.dwg, Fig (W), Nov 29, 2024 - 8:47am, mfang

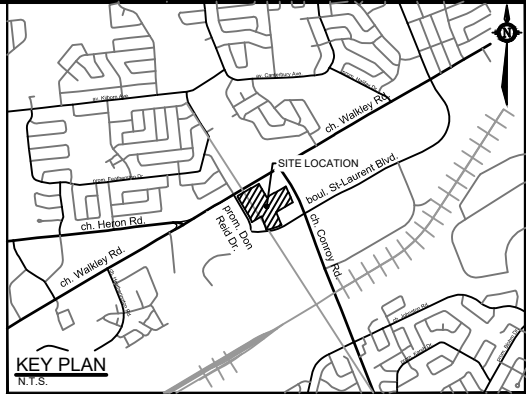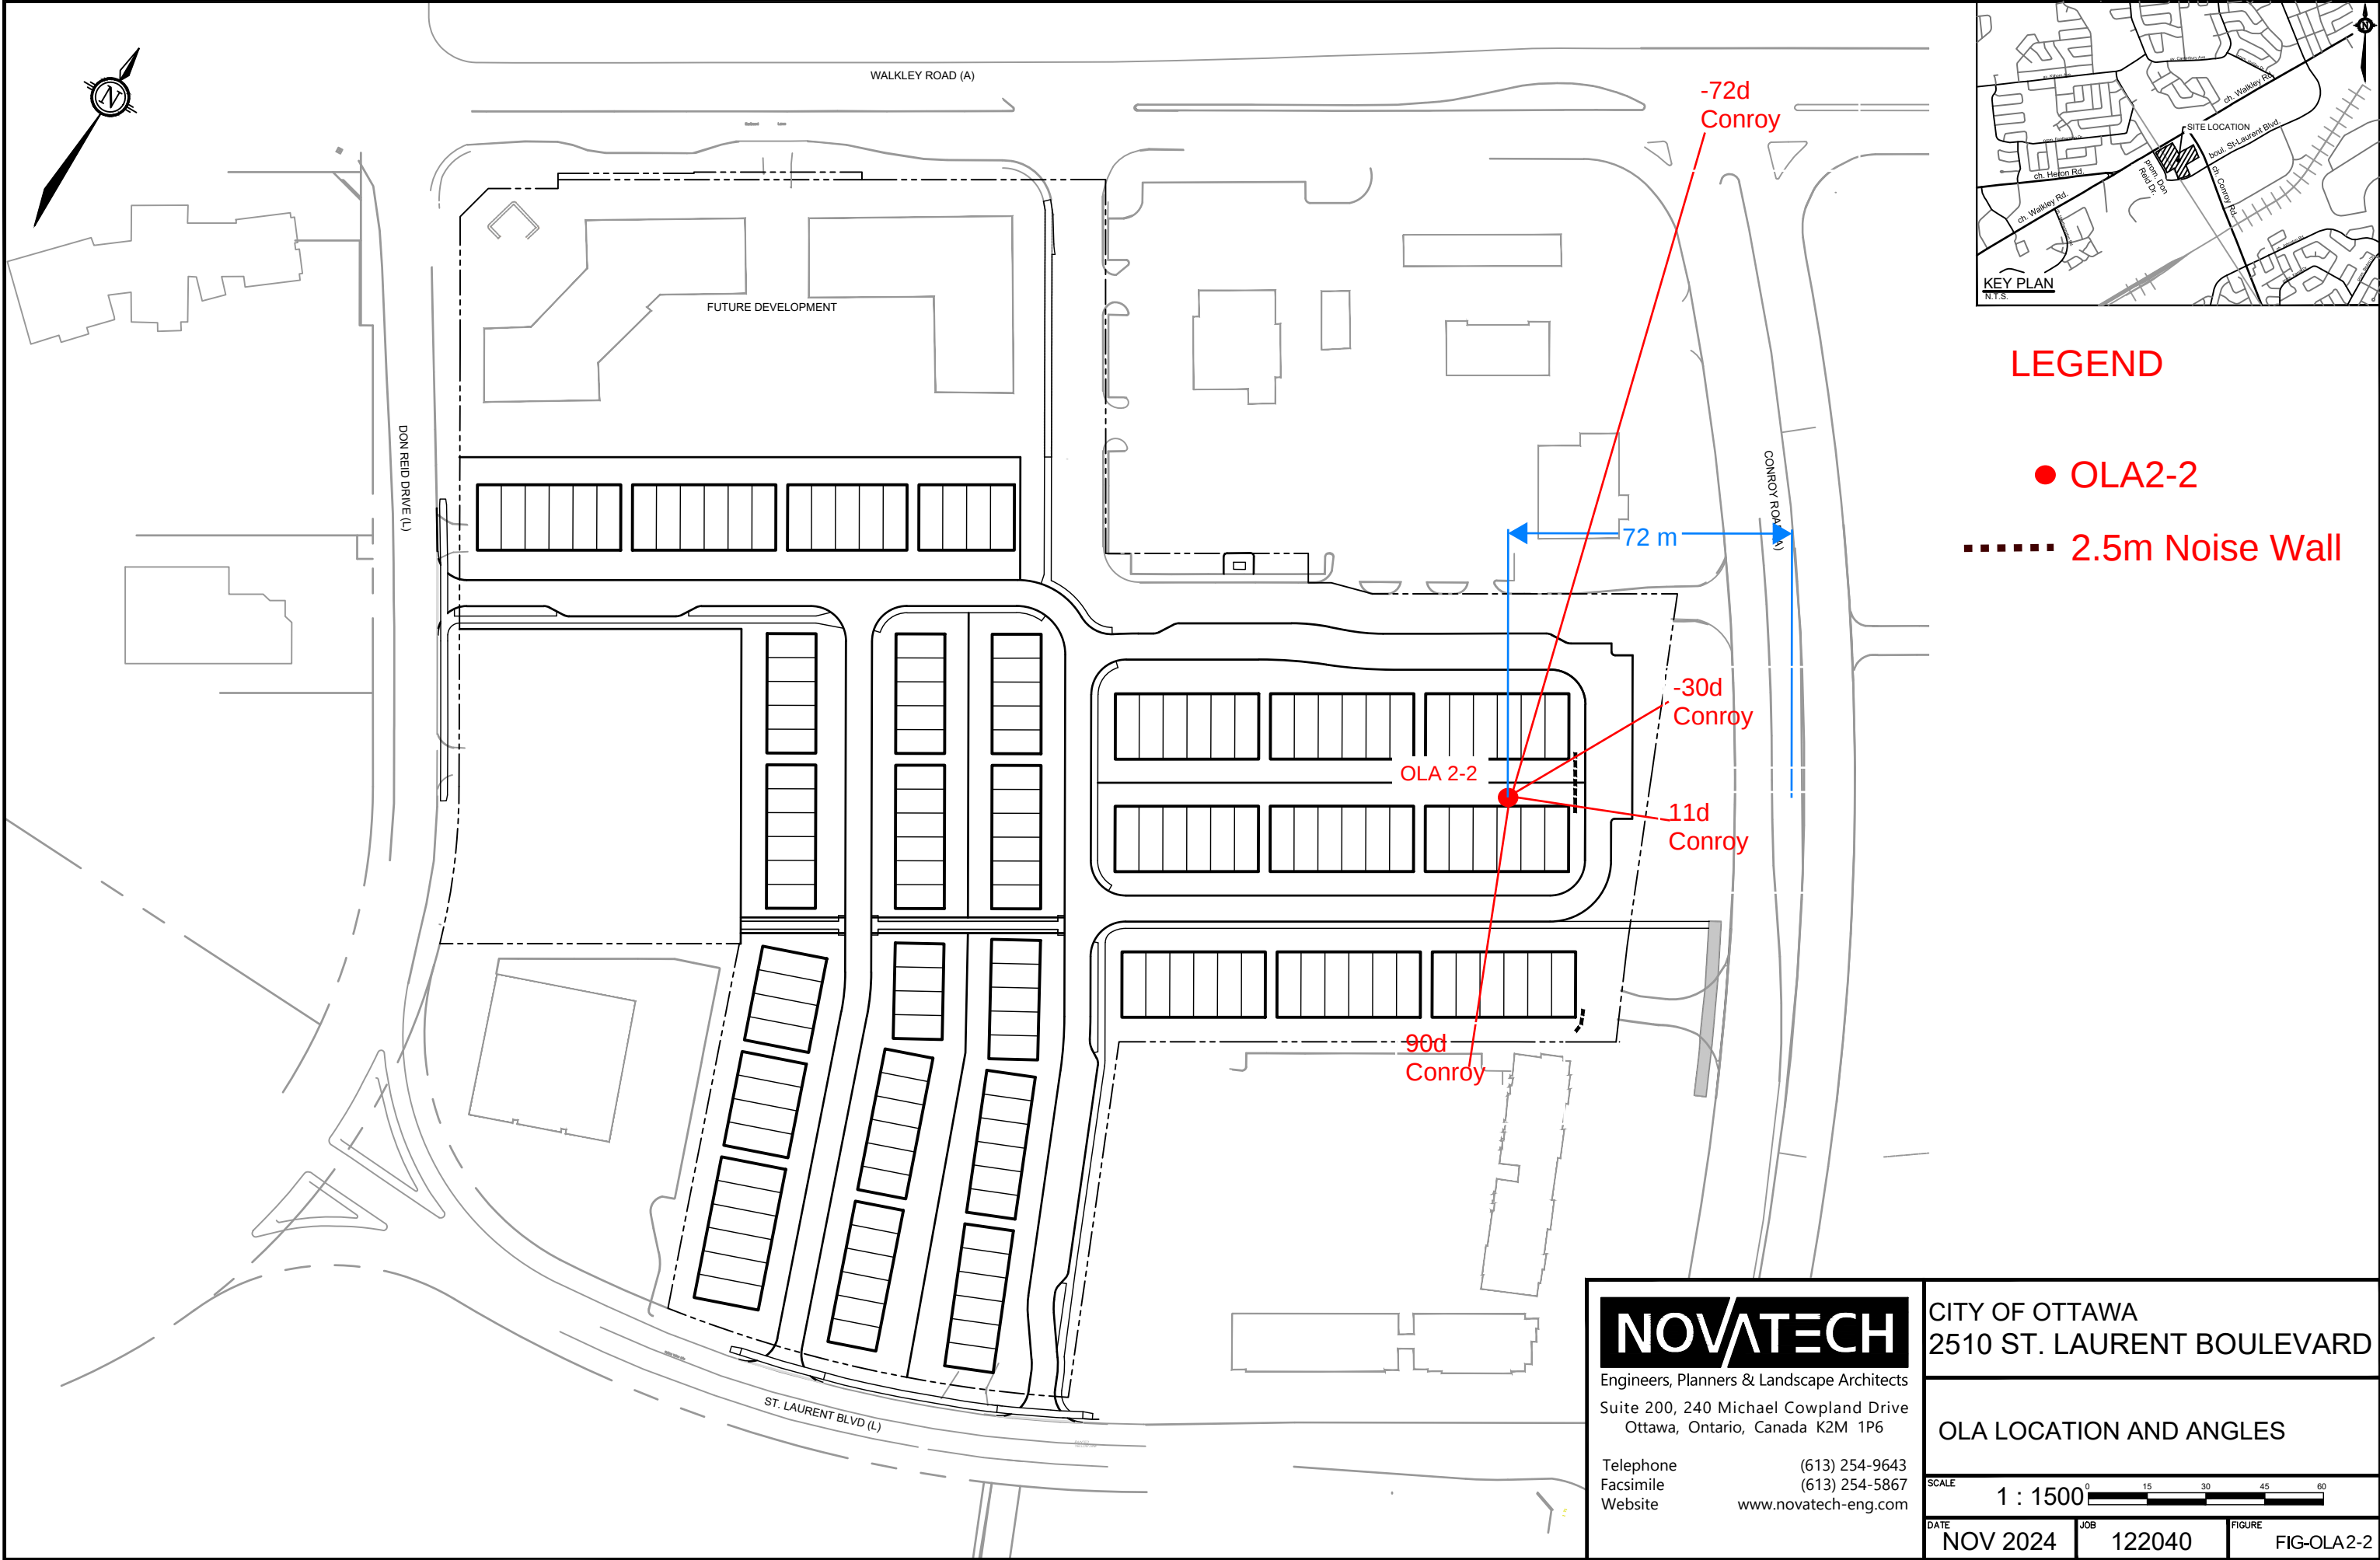


LEGEND

- OLA2-2
- ..... 2.5m Noise Wall

|                                                                                                                                                                                                                                       |                                              |               |                      |
|---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|----------------------------------------------|---------------|----------------------|
| <b>NOVATECH</b><br>Engineers, Planners & Landscape Architects<br>Suite 200, 240 Michael Cowpland Drive<br>Ottawa, Ontario, Canada K2M 1P6<br><br>Telephone (613) 254-9643<br>Facsimile (613) 254-5867<br>Website www.novatech-eng.com | CITY OF OTTAWA<br>2510 ST. LAURENT BOULEVARD |               |                      |
|                                                                                                                                                                                                                                       | OLA LOCATION AND ANGLES                      |               |                      |
|                                                                                                                                                                                                                                       | SCALE<br>1 : 1500                            |               |                      |
|                                                                                                                                                                                                                                       | DATE<br>NOV 2024                             | JOB<br>122040 | FIGURE<br>FIG-OLA2-2 |


M:\2022\122040\CAD\Civil\Figures\Noise\122040-NC.dwg, Fig. Jul 17, 2023 - 11:42am, mfang

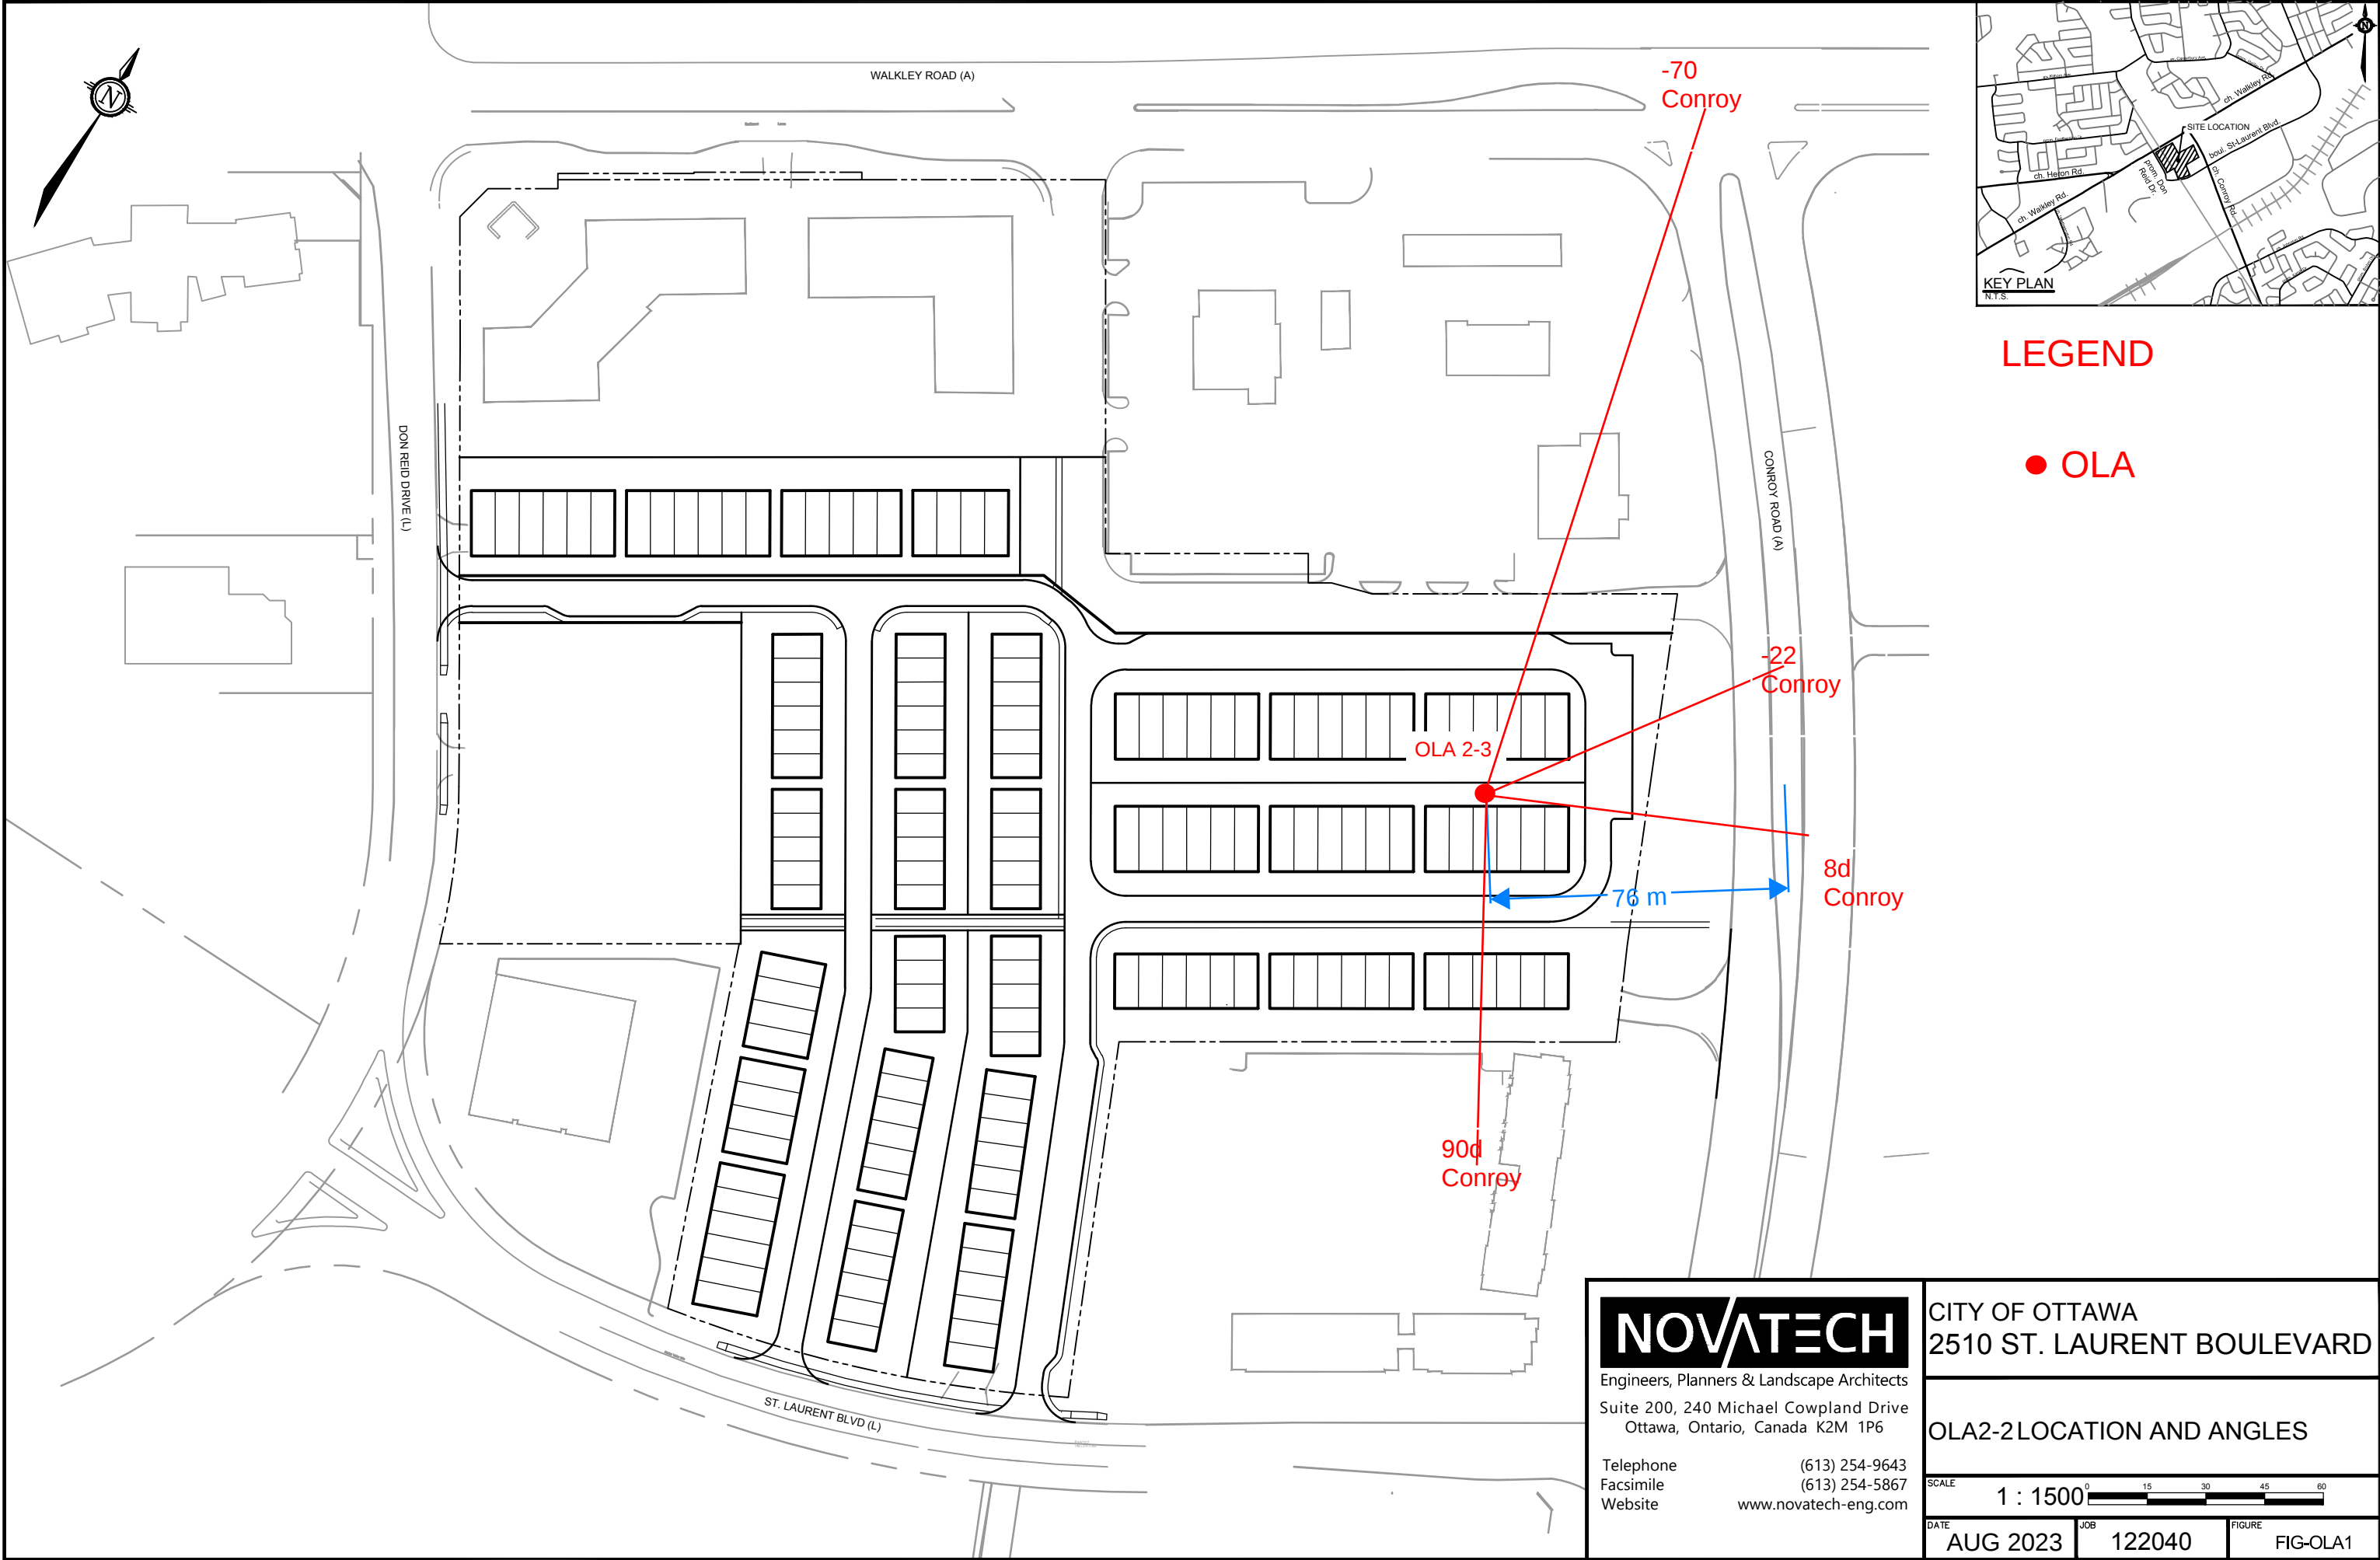



**NOVATECH**  
Engineers, Planners & Landscape Architects  
Suite 200, 240 Michael Cowpland Drive  
Ottawa, Ontario, Canada K2M 1P6  
Telephone (613) 254-9643  
Facsimile (613) 254-5867  
Website www.novatech-eng.com

CITY OF OTTAWA  
2510 ST. LAURENT BOULEVARD  
  
OLA2-2 LOCATION AND ANGLES  
  
SCALE 1 : 1500  
DATE AUG 2023 JOB 122040 FIGURE FIG-OLA1

M:\2022\122040\CAD\Civil\Figures\Noise\122040-NC.dwg, Fig. Jul 17, 2023 - 11:42am, mfang

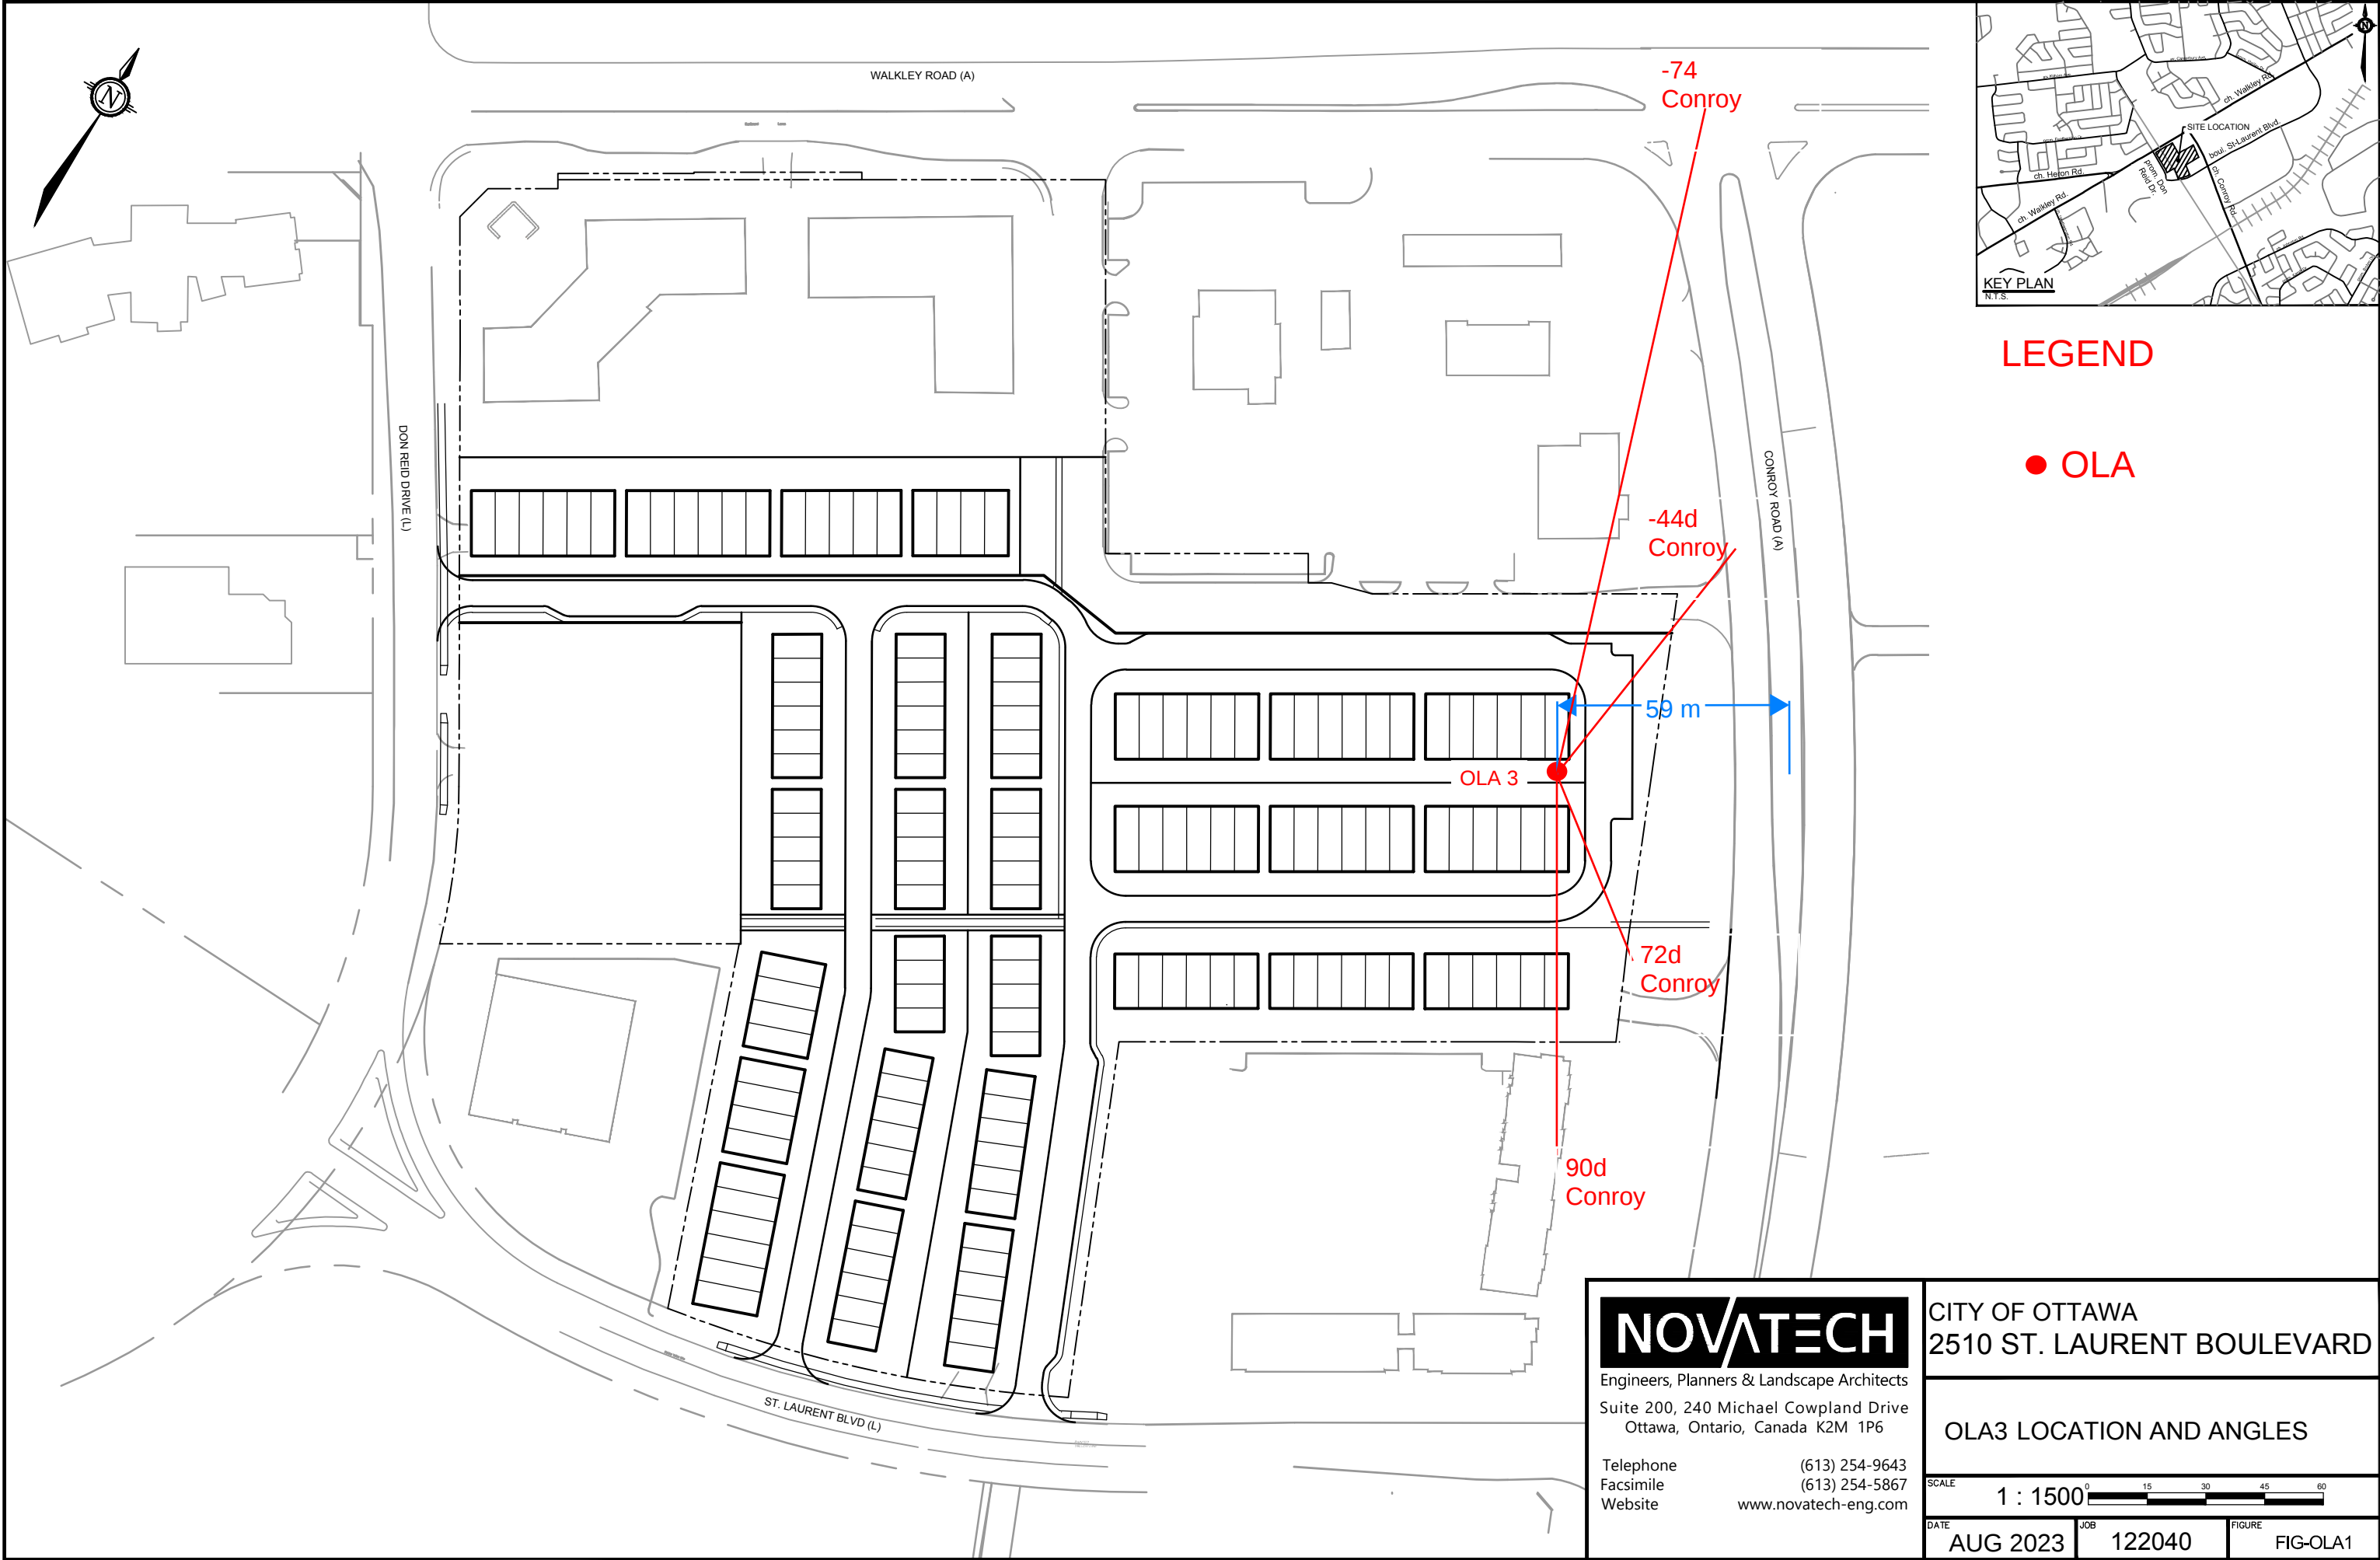

|                                                                                                                                                                                                                                       |                                              |               |                    |
|---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|----------------------------------------------|---------------|--------------------|
| <b>NOVATECH</b><br>Engineers, Planners & Landscape Architects<br>Suite 200, 240 Michael Cowpland Drive<br>Ottawa, Ontario, Canada K2M 1P6<br><br>Telephone (613) 254-9643<br>Facsimile (613) 254-5867<br>Website www.novatech-eng.com | CITY OF OTTAWA<br>2510 ST. LAURENT BOULEVARD |               |                    |
|                                                                                                                                                                                                                                       | OLA3 LOCATION AND ANGLES                     |               |                    |
|                                                                                                                                                                                                                                       | SCALE<br>1 : 1500                            |               |                    |
|                                                                                                                                                                                                                                       | DATE<br>AUG 2023                             | JOB<br>122040 | FIGURE<br>FIG-OLA1 |

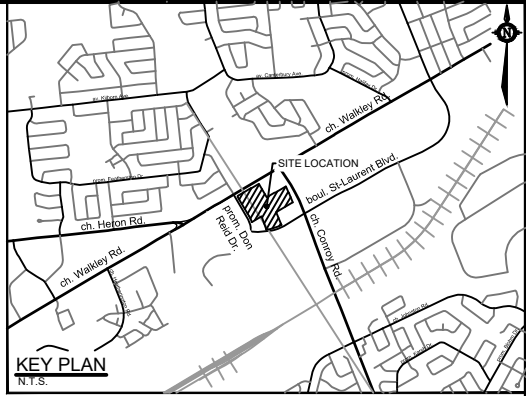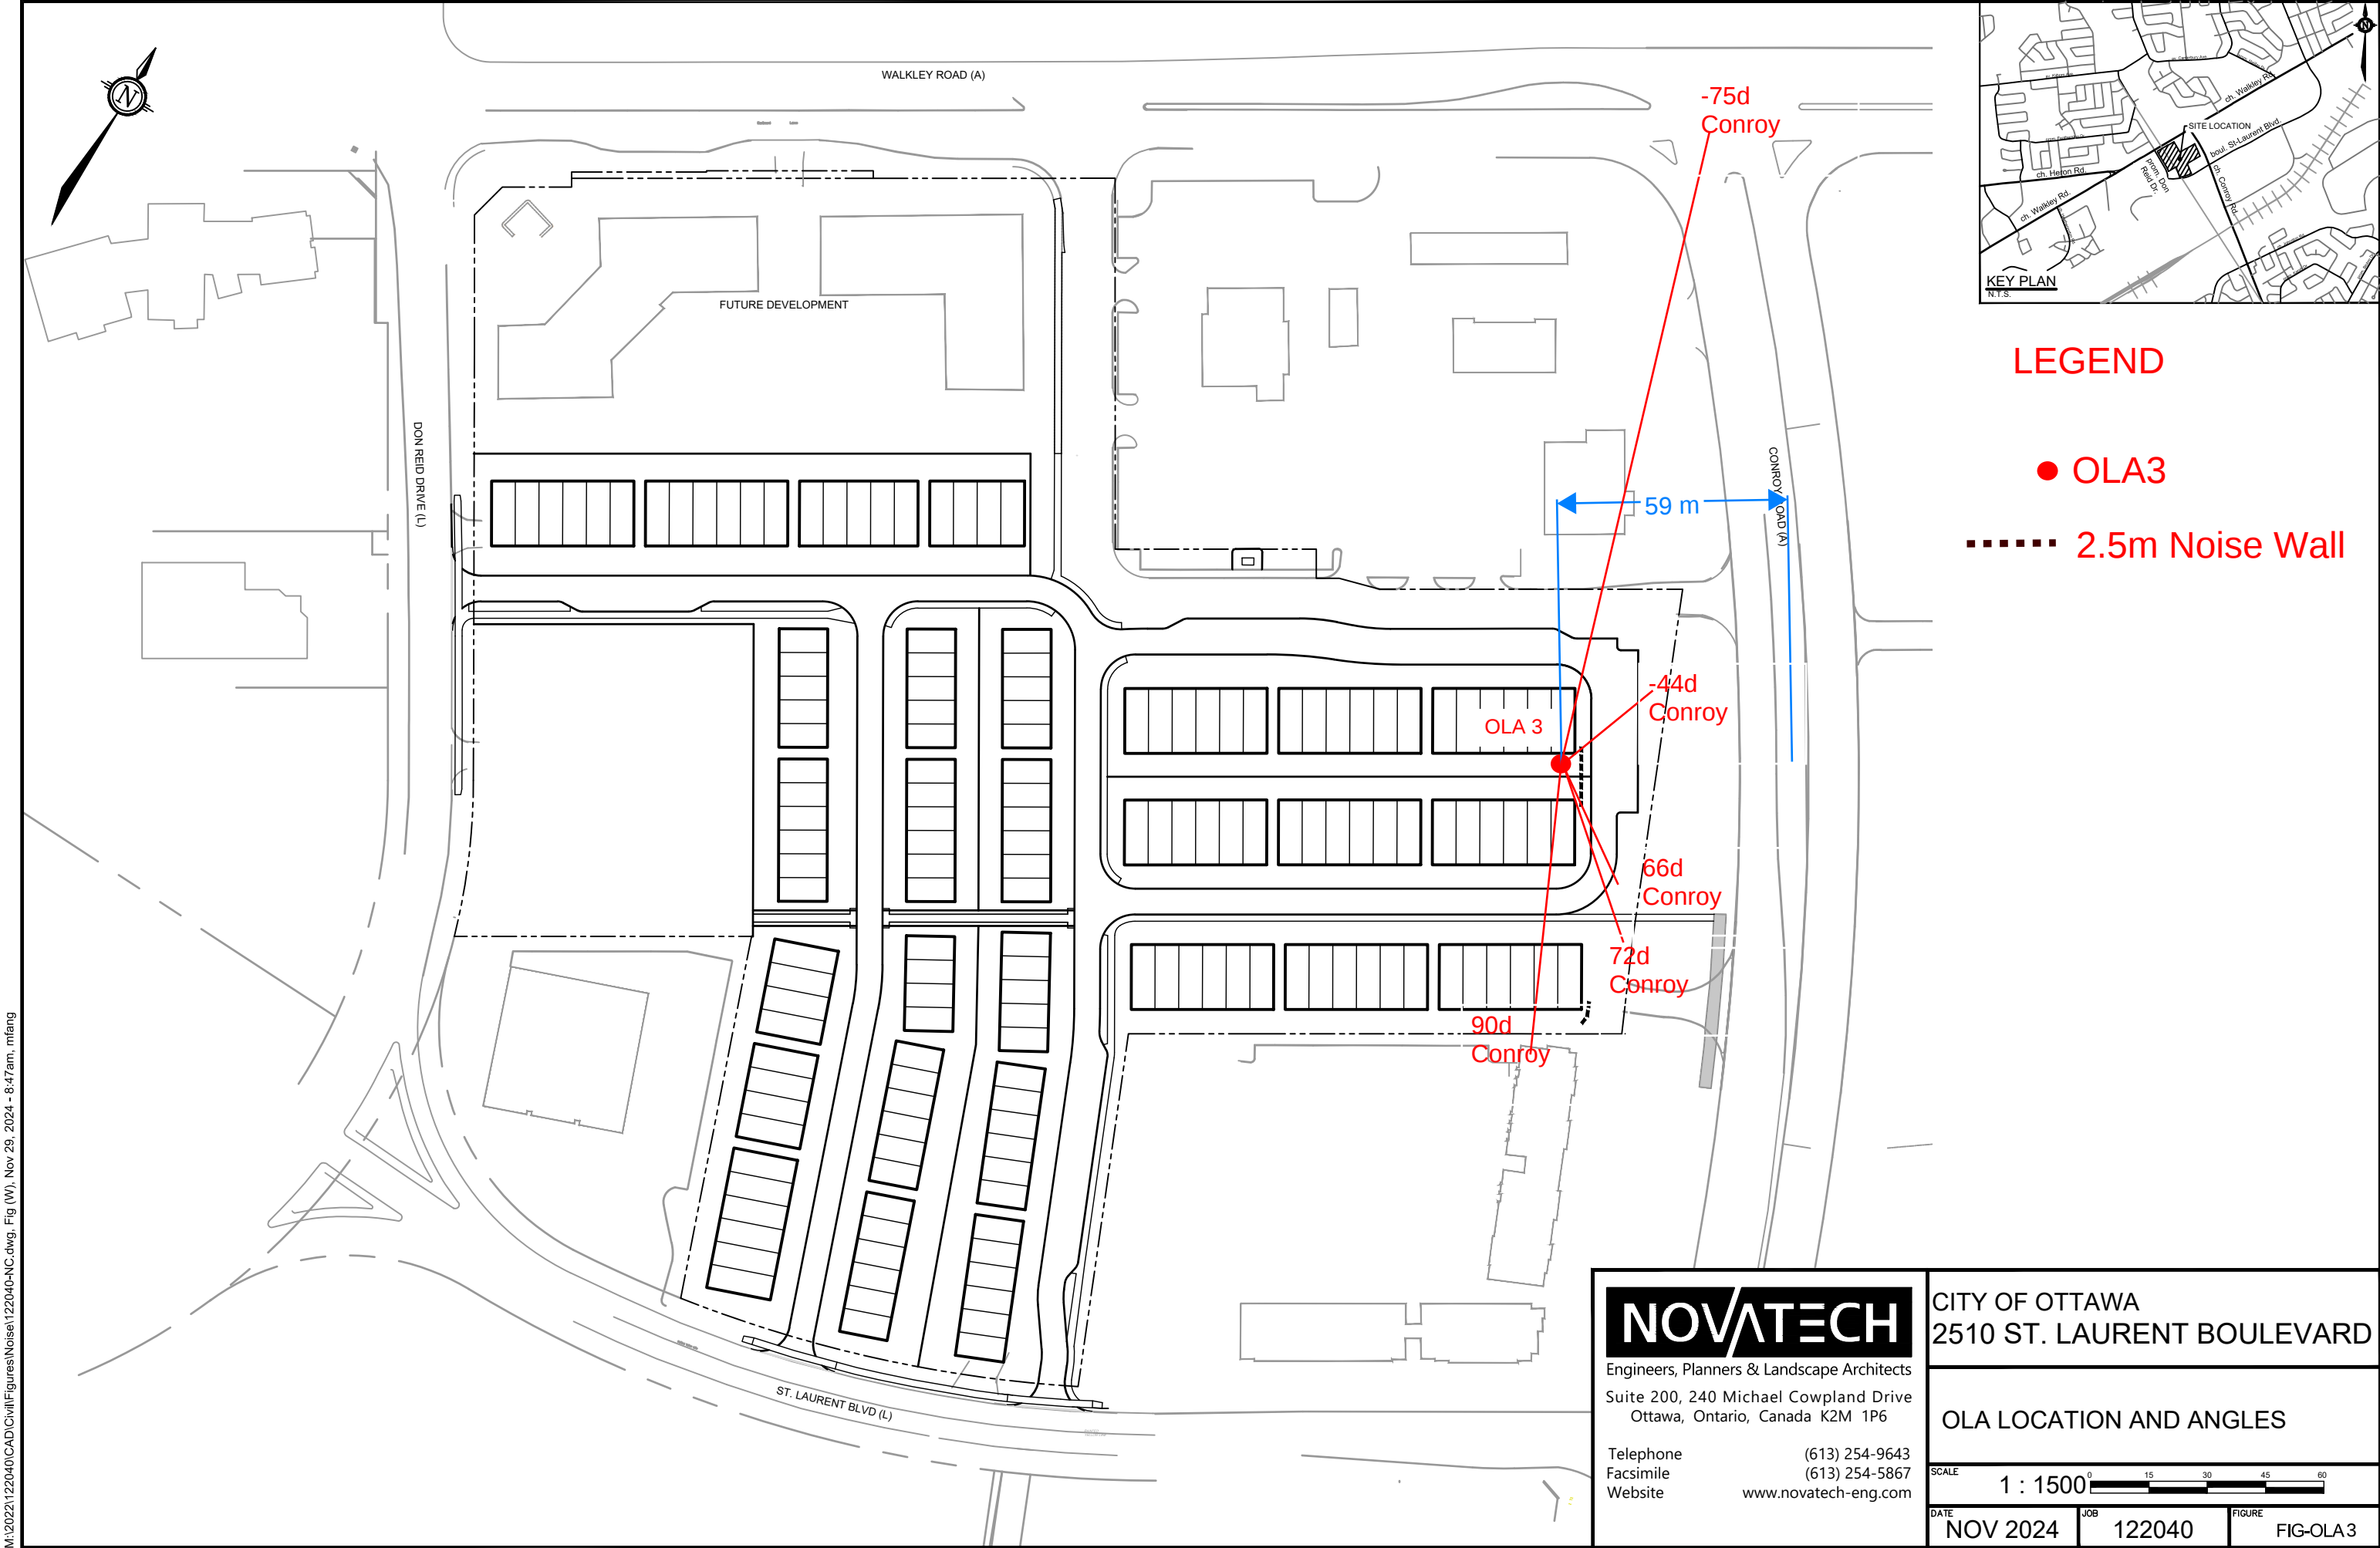

LEGEND

- OLA3
- ..... 2.5m Noise Wall

**NOVATECH**

Engineers, Planners & Landscape Architects  
Suite 200, 240 Michael Cowpland Drive  
Ottawa, Ontario, Canada K2M 1P6



Telephone (613) 254-9643  
Facsimile (613) 254-5867  
Website [www.novatech-eng.com](http://www.novatech-eng.com)

CITY OF OTTAWA  
2510 ST. LAURENT BOULEVARD

OLA LOCATION AND ANGLES

SCALE 1 : 1500 0 15 30 45 60

|      |          |     |        |        |           |
|------|----------|-----|--------|--------|-----------|
| DATE | NOV 2024 | JOB | 122040 | FIGURE | FIG-OLA 3 |
|------|----------|-----|--------|--------|-----------|

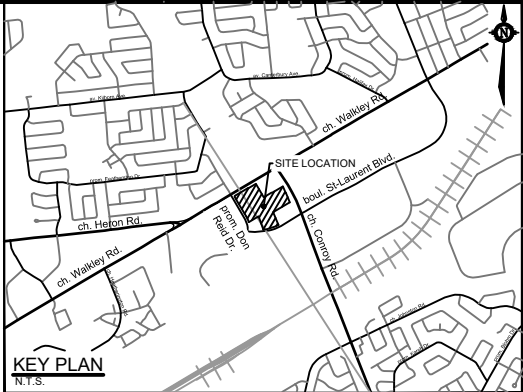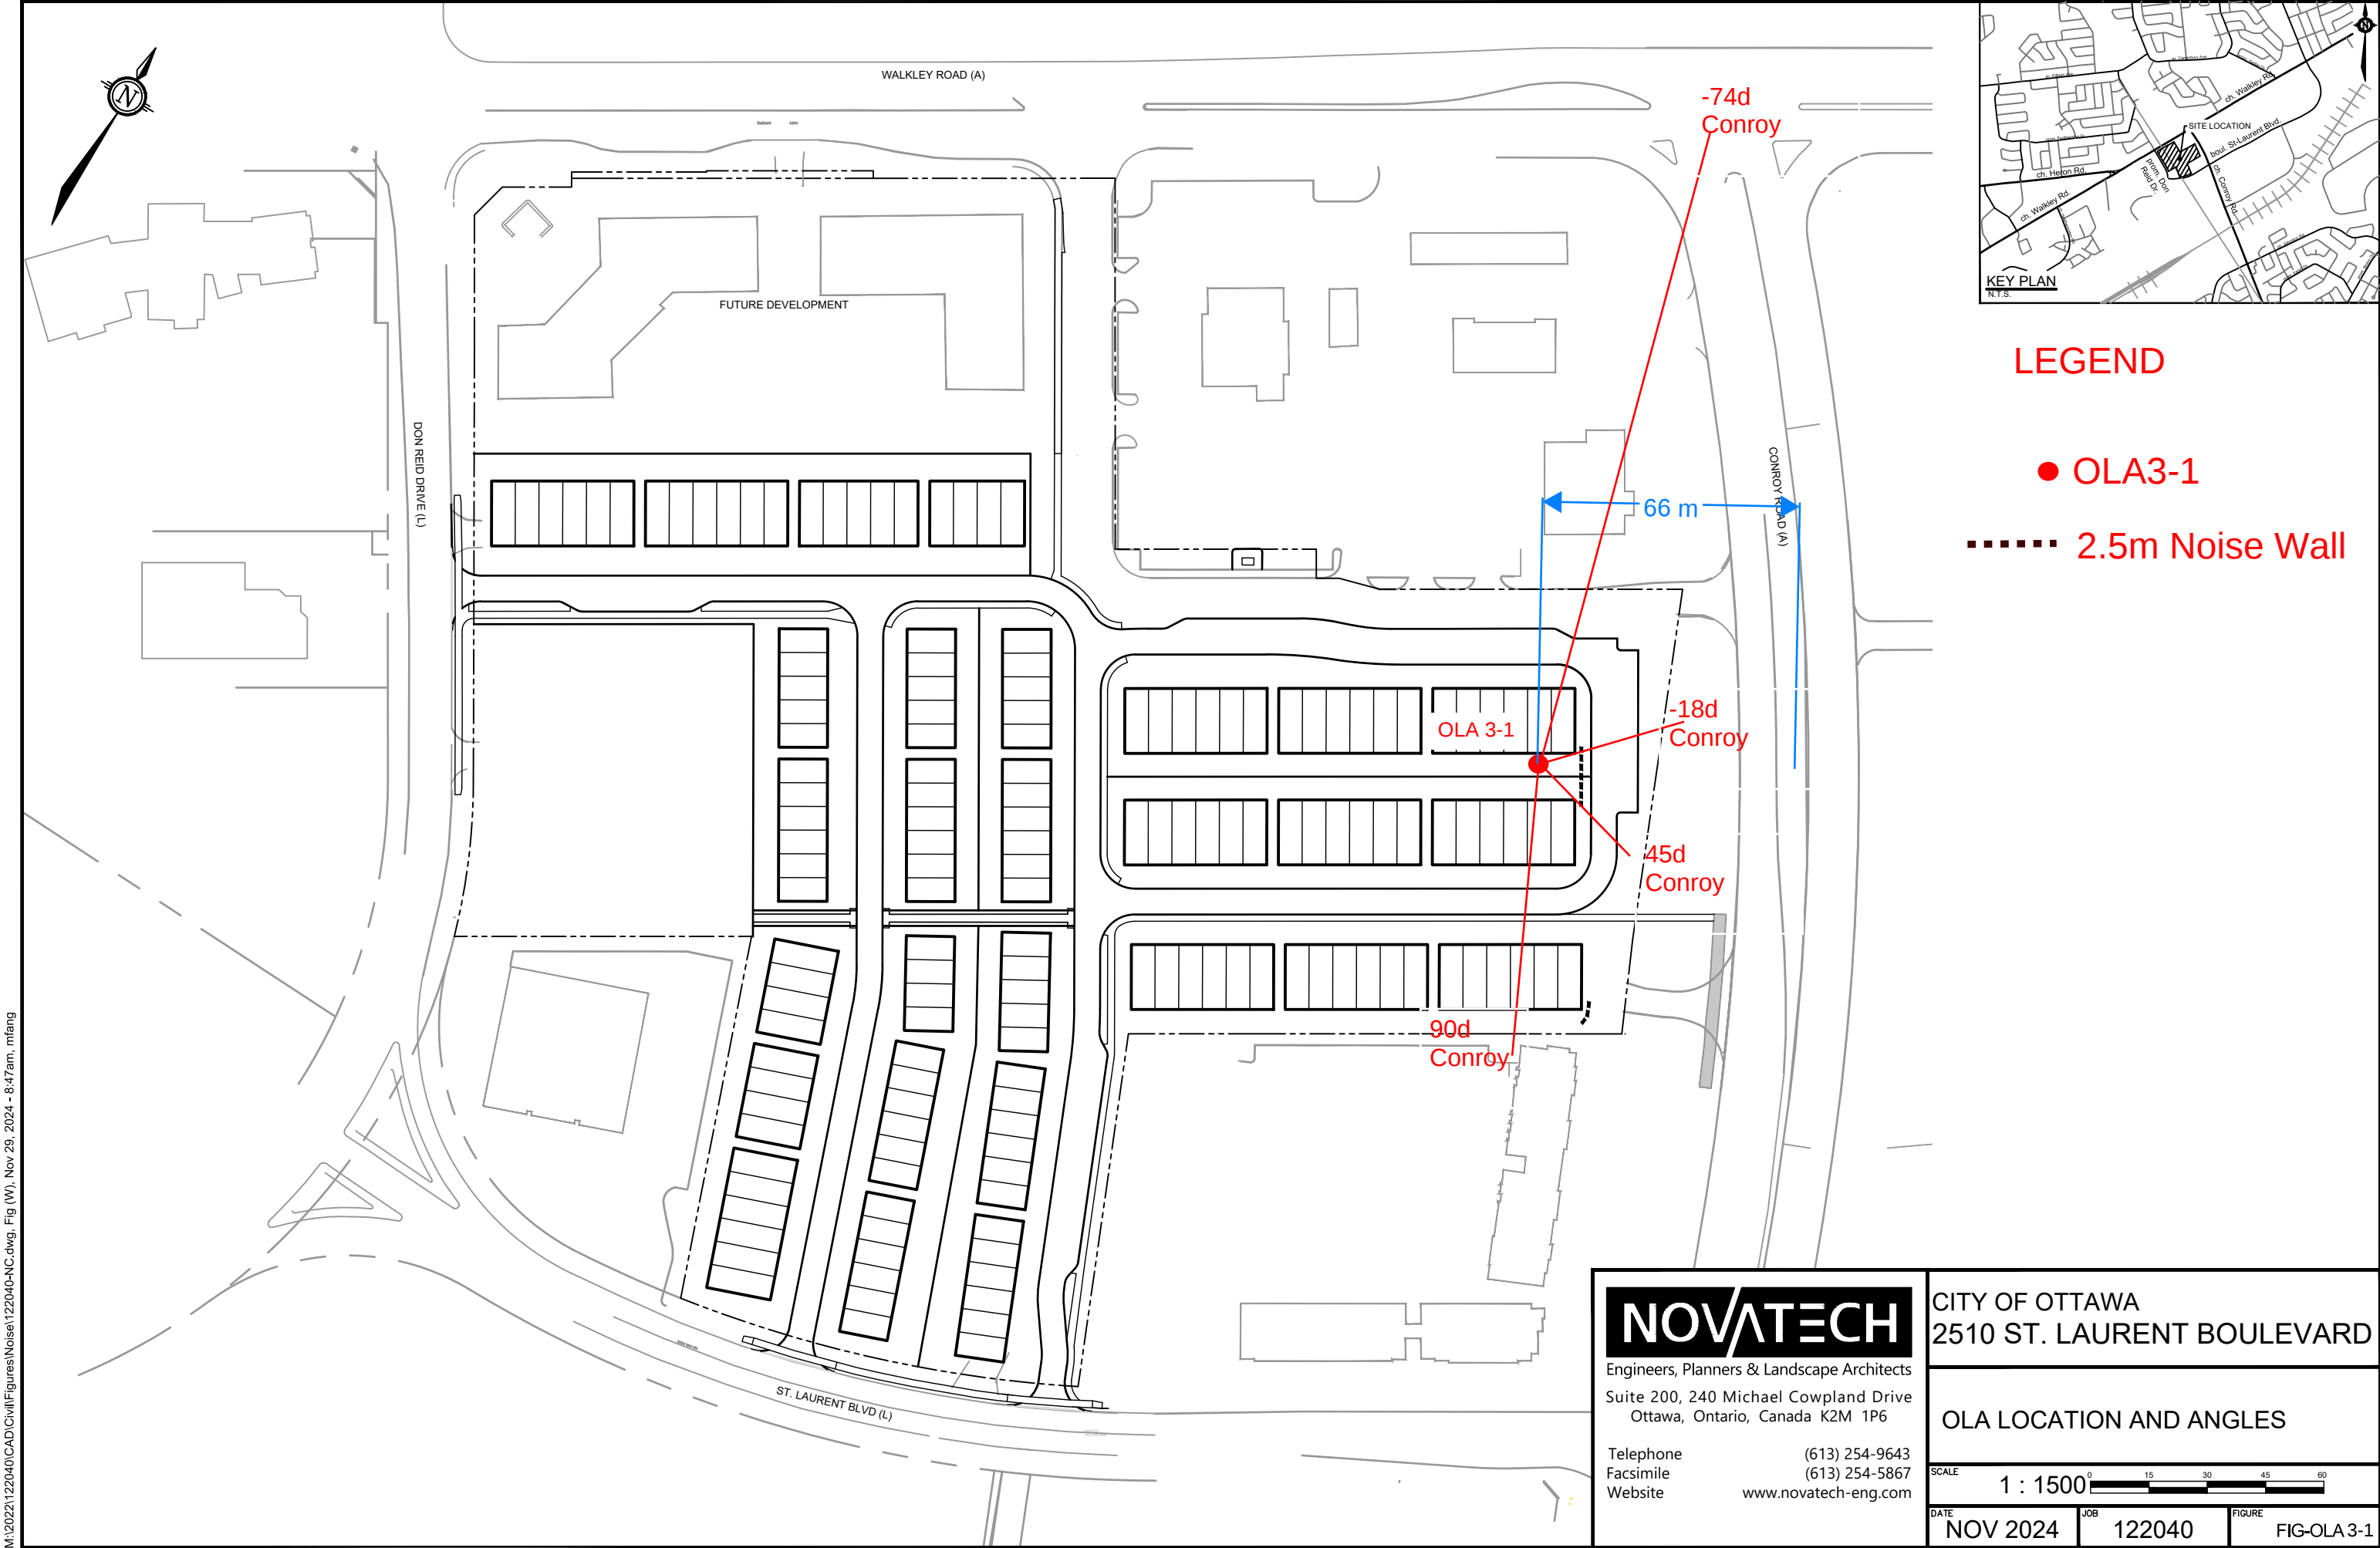

- LEGEND**
- OLA3-1
  - ..... 2.5m Noise Wall

**NOVATECH**  
Engineers, Planners & Landscape Architects  
Suite 200, 240 Michael Cowpland Drive  
Ottawa, Ontario, Canada K2M 1P6  
Telephone (613) 254-9643  
Facsimile (613) 254-5867  
Website [www.novatech-eng.com](http://www.novatech-eng.com)

CITY OF OTTAWA  
2510 ST. LAURENT BOULEVARD


**OLA LOCATION AND ANGLES**

SCALE 1 : 1500

DATE NOV 2024 JOB 122040 FIGURE FIG-OLA 3-1



M:\2022\122040\CAD\Civil\Figures\Noise\122040-NC.dwg, Fig (W), Nov 29, 2024 - 8:47am, mfang

M:\2022\122040\CAD\Civil\Figures\Noise\122040-NC.dwg, Fig. Jul 17, 2023 - 11:42am, mfang

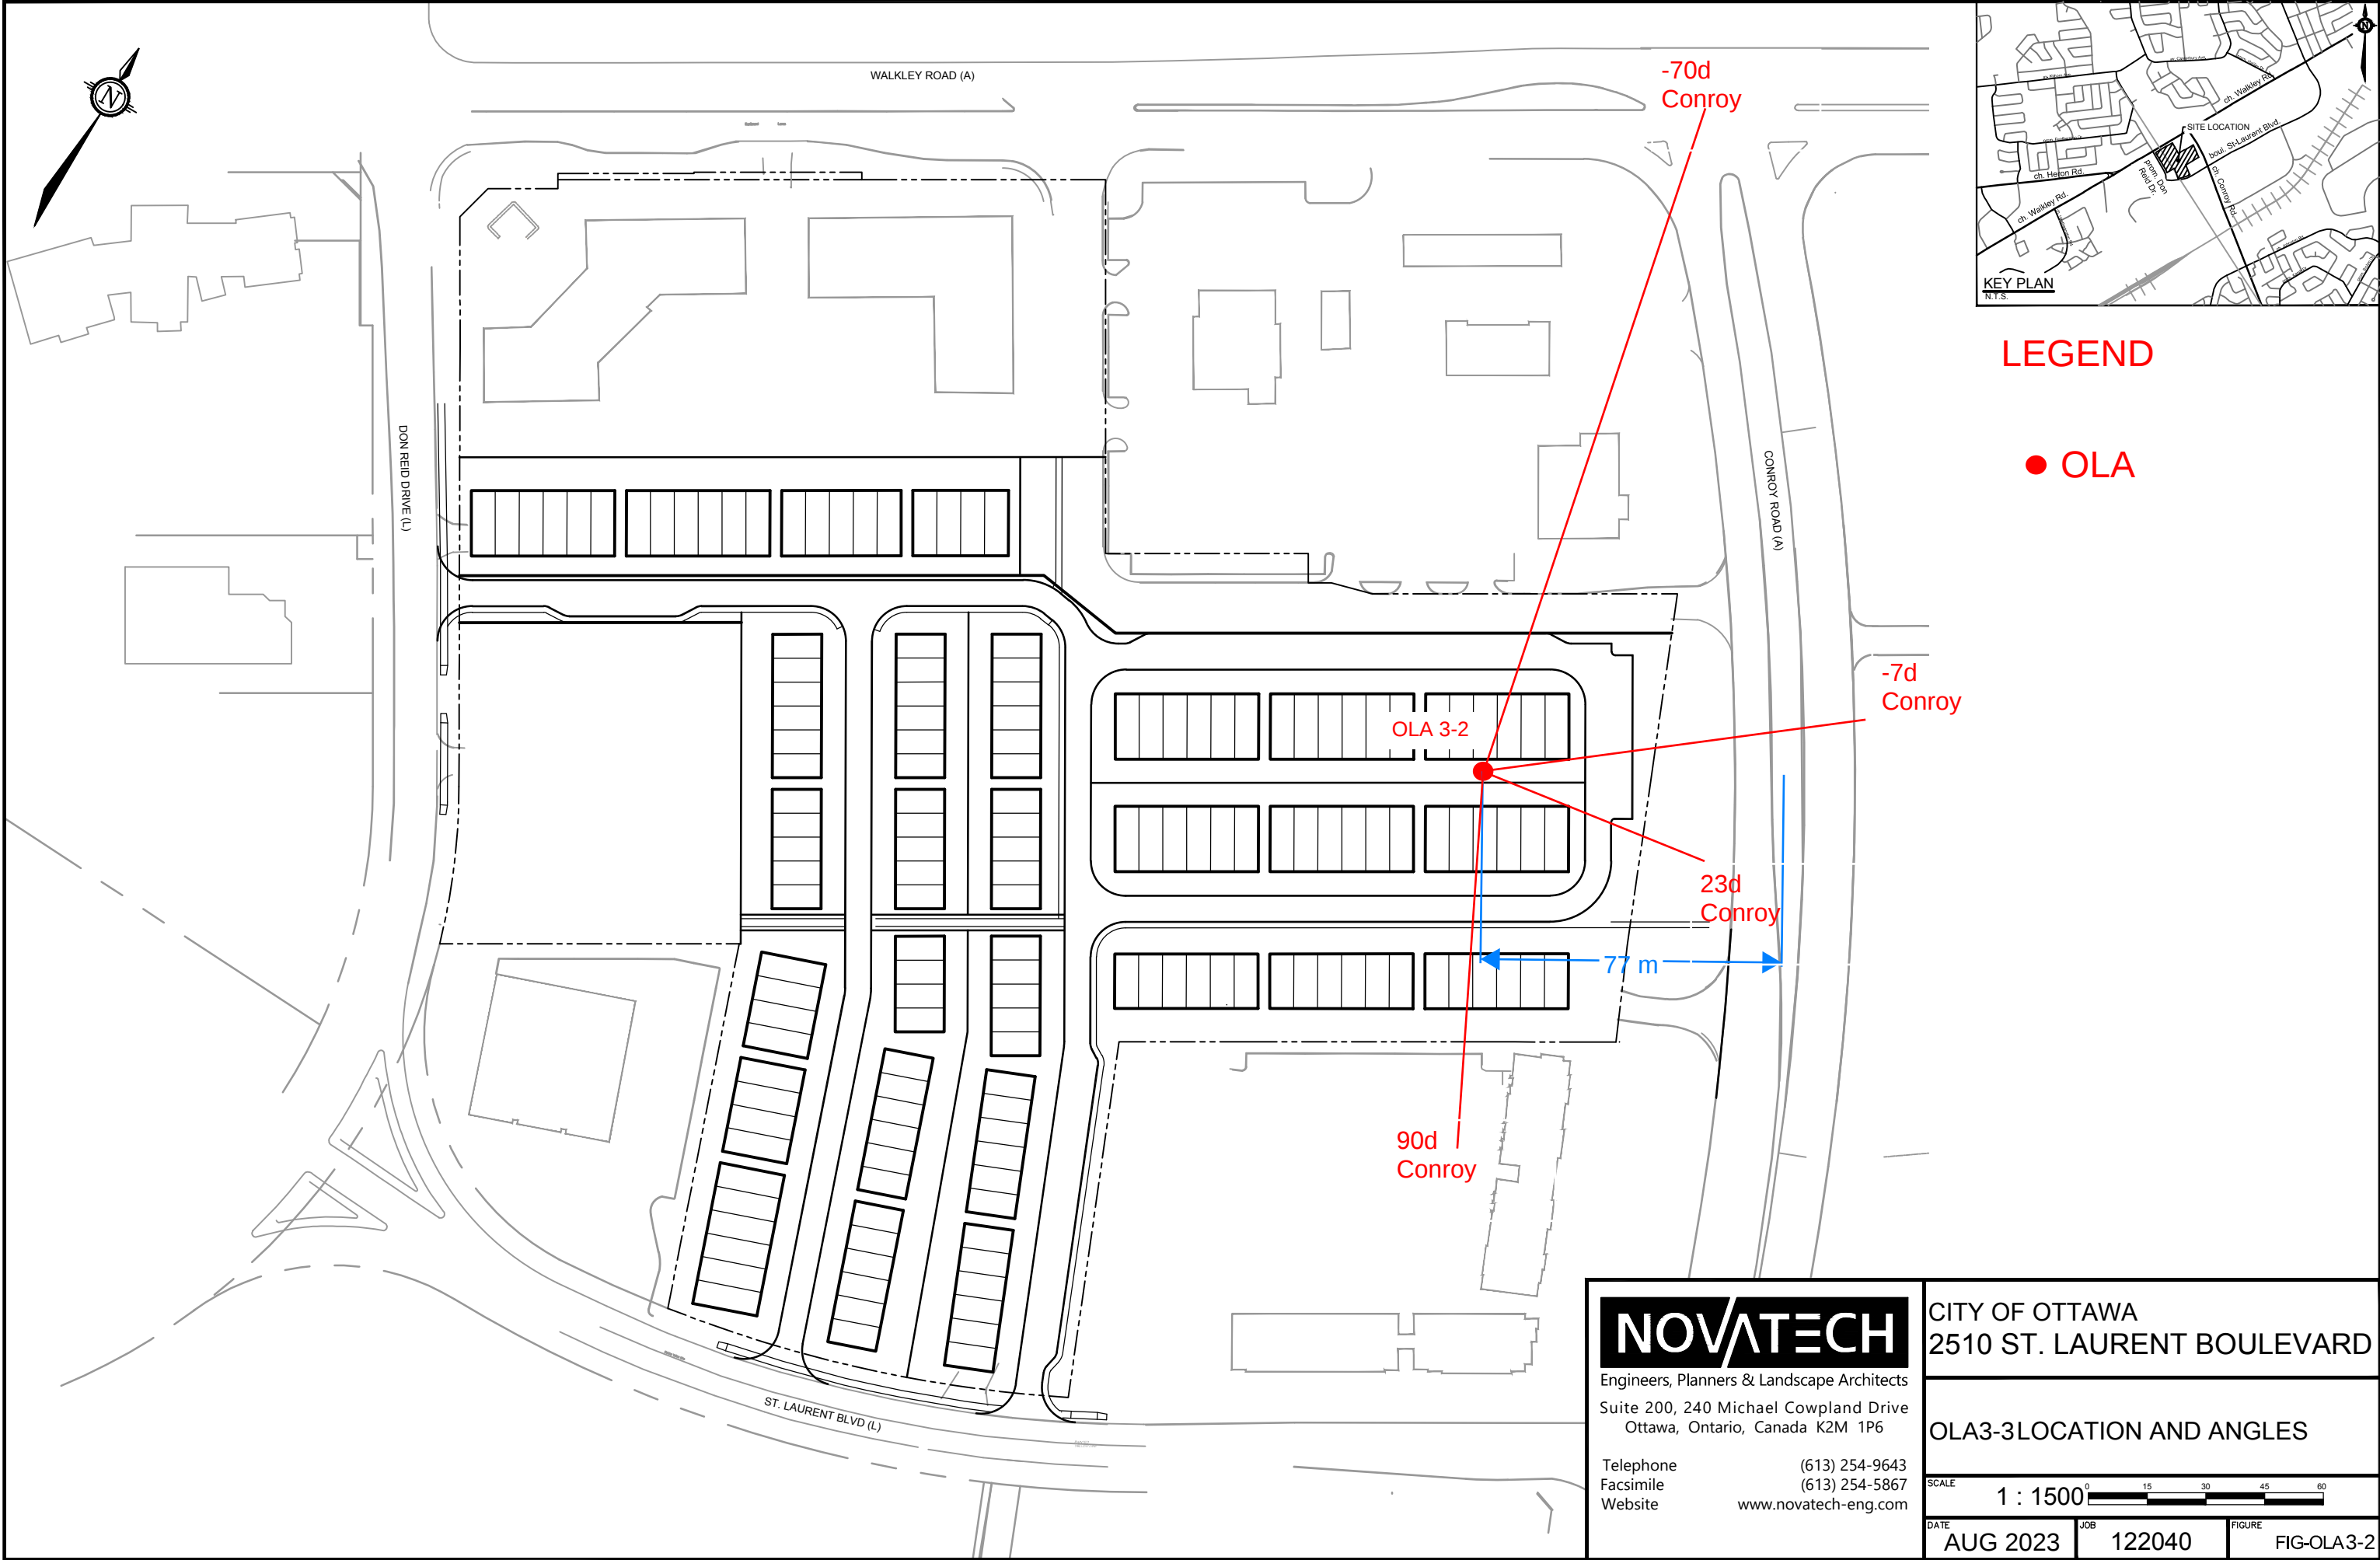

|                                                                                                                                                                                                                                       |                                              |               |                      |
|---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|----------------------------------------------|---------------|----------------------|
| <b>NOVATECH</b><br>Engineers, Planners & Landscape Architects<br>Suite 200, 240 Michael Cowpland Drive<br>Ottawa, Ontario, Canada K2M 1P6<br><br>Telephone (613) 254-9643<br>Facsimile (613) 254-5867<br>Website www.novatech-eng.com | CITY OF OTTAWA<br>2510 ST. LAURENT BOULEVARD |               |                      |
|                                                                                                                                                                                                                                       | OLA3-3LOCATION AND ANGLES                    |               |                      |
|                                                                                                                                                                                                                                       | SCALE<br>1 : 1500                            |               |                      |
|                                                                                                                                                                                                                                       | DATE<br>AUG 2023                             | JOB<br>122040 | FIGURE<br>FIG-OLA3-2 |


M:\2022\122040\CAD\Civil\Figures\Noise\122040-NC.dwg, Fig (W), Nov 29, 2024 - 8:47am, mfang

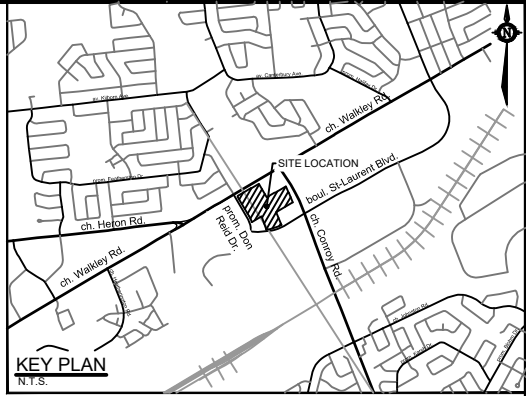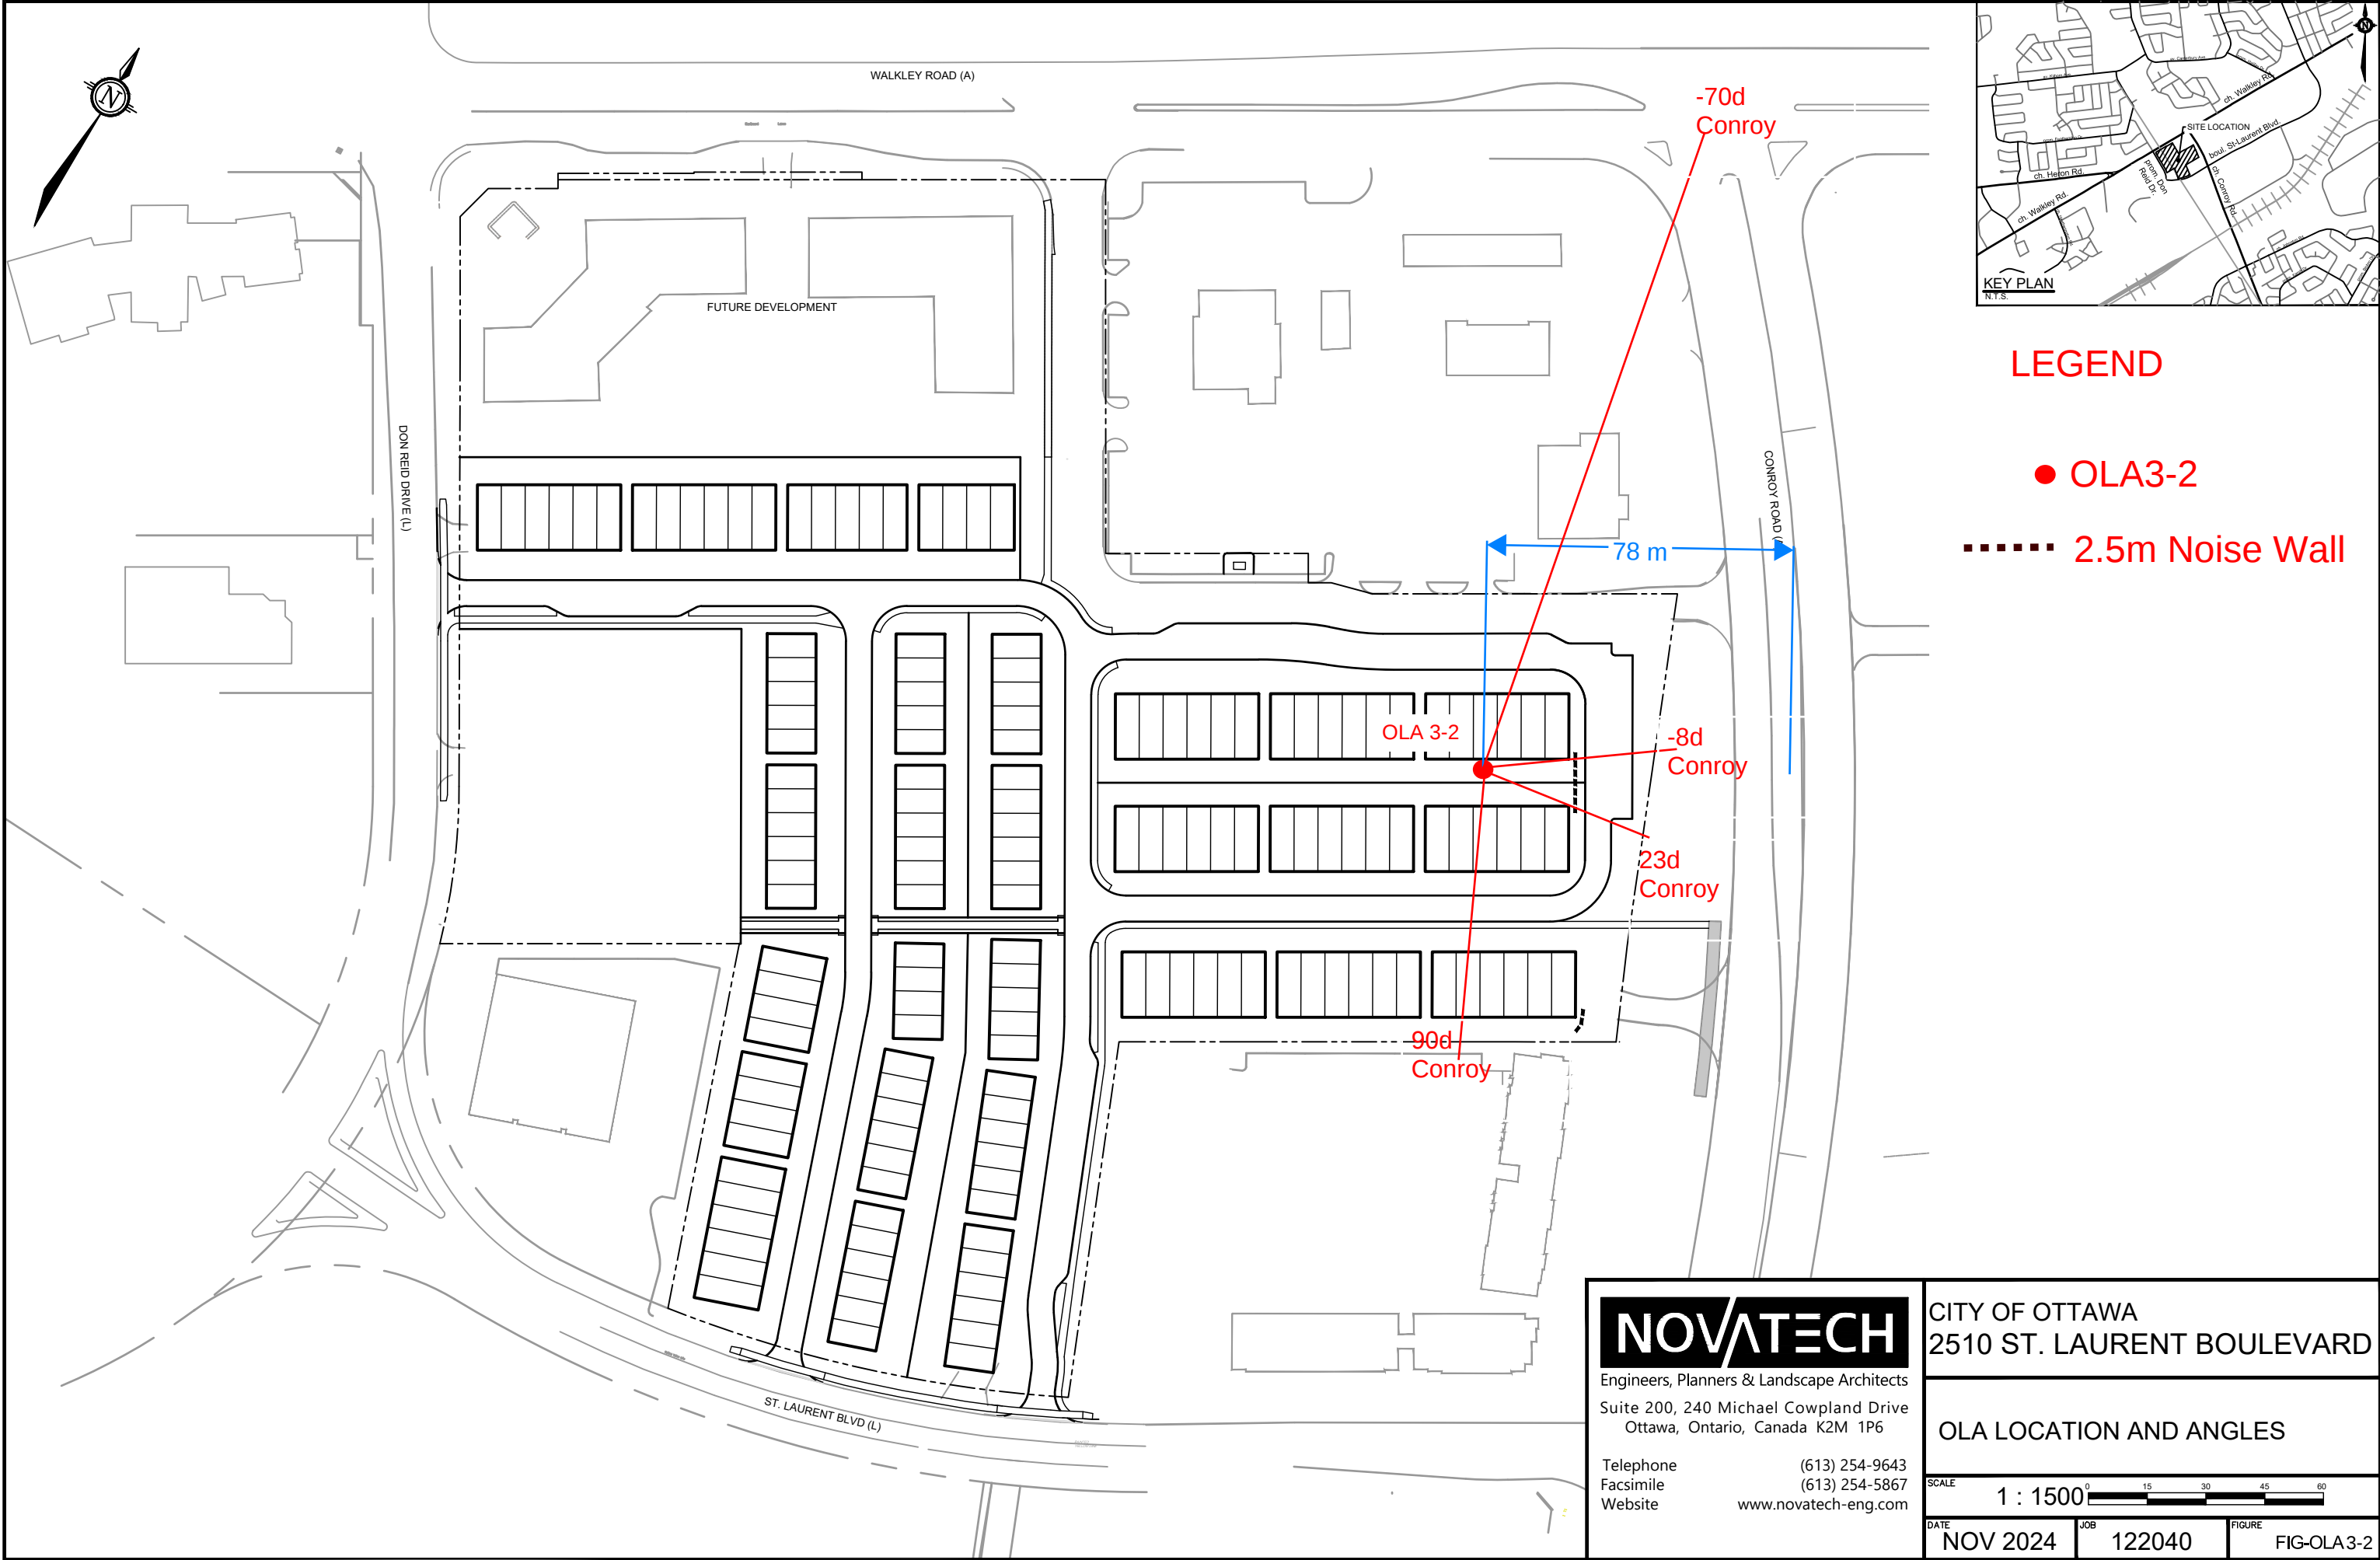

- LEGEND
- OLA3-2
  - ..... 2.5m Noise Wall

|                                                                                                                                                                                                                                       |                                              |               |                      |
|---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|----------------------------------------------|---------------|----------------------|
| <b>NOVATECH</b><br>Engineers, Planners & Landscape Architects<br>Suite 200, 240 Michael Cowpland Drive<br>Ottawa, Ontario, Canada K2M 1P6<br><br>Telephone (613) 254-9643<br>Facsimile (613) 254-5867<br>Website www.novatech-eng.com | CITY OF OTTAWA<br>2510 ST. LAURENT BOULEVARD |               |                      |
|                                                                                                                                                                                                                                       | OLA LOCATION AND ANGLES                      |               |                      |
|                                                                                                                                                                                                                                       | SCALE<br>1 : 1500                            |               |                      |
|                                                                                                                                                                                                                                       | DATE<br>NOV 2024                             | JOB<br>122040 | FIGURE<br>FIG-OLA3-2 |

M:\2022\122040\CAD\Civil\Figures\Noise\122040-NC.dwg, Fig. Jul 17, 2023 - 11:42am, mfang

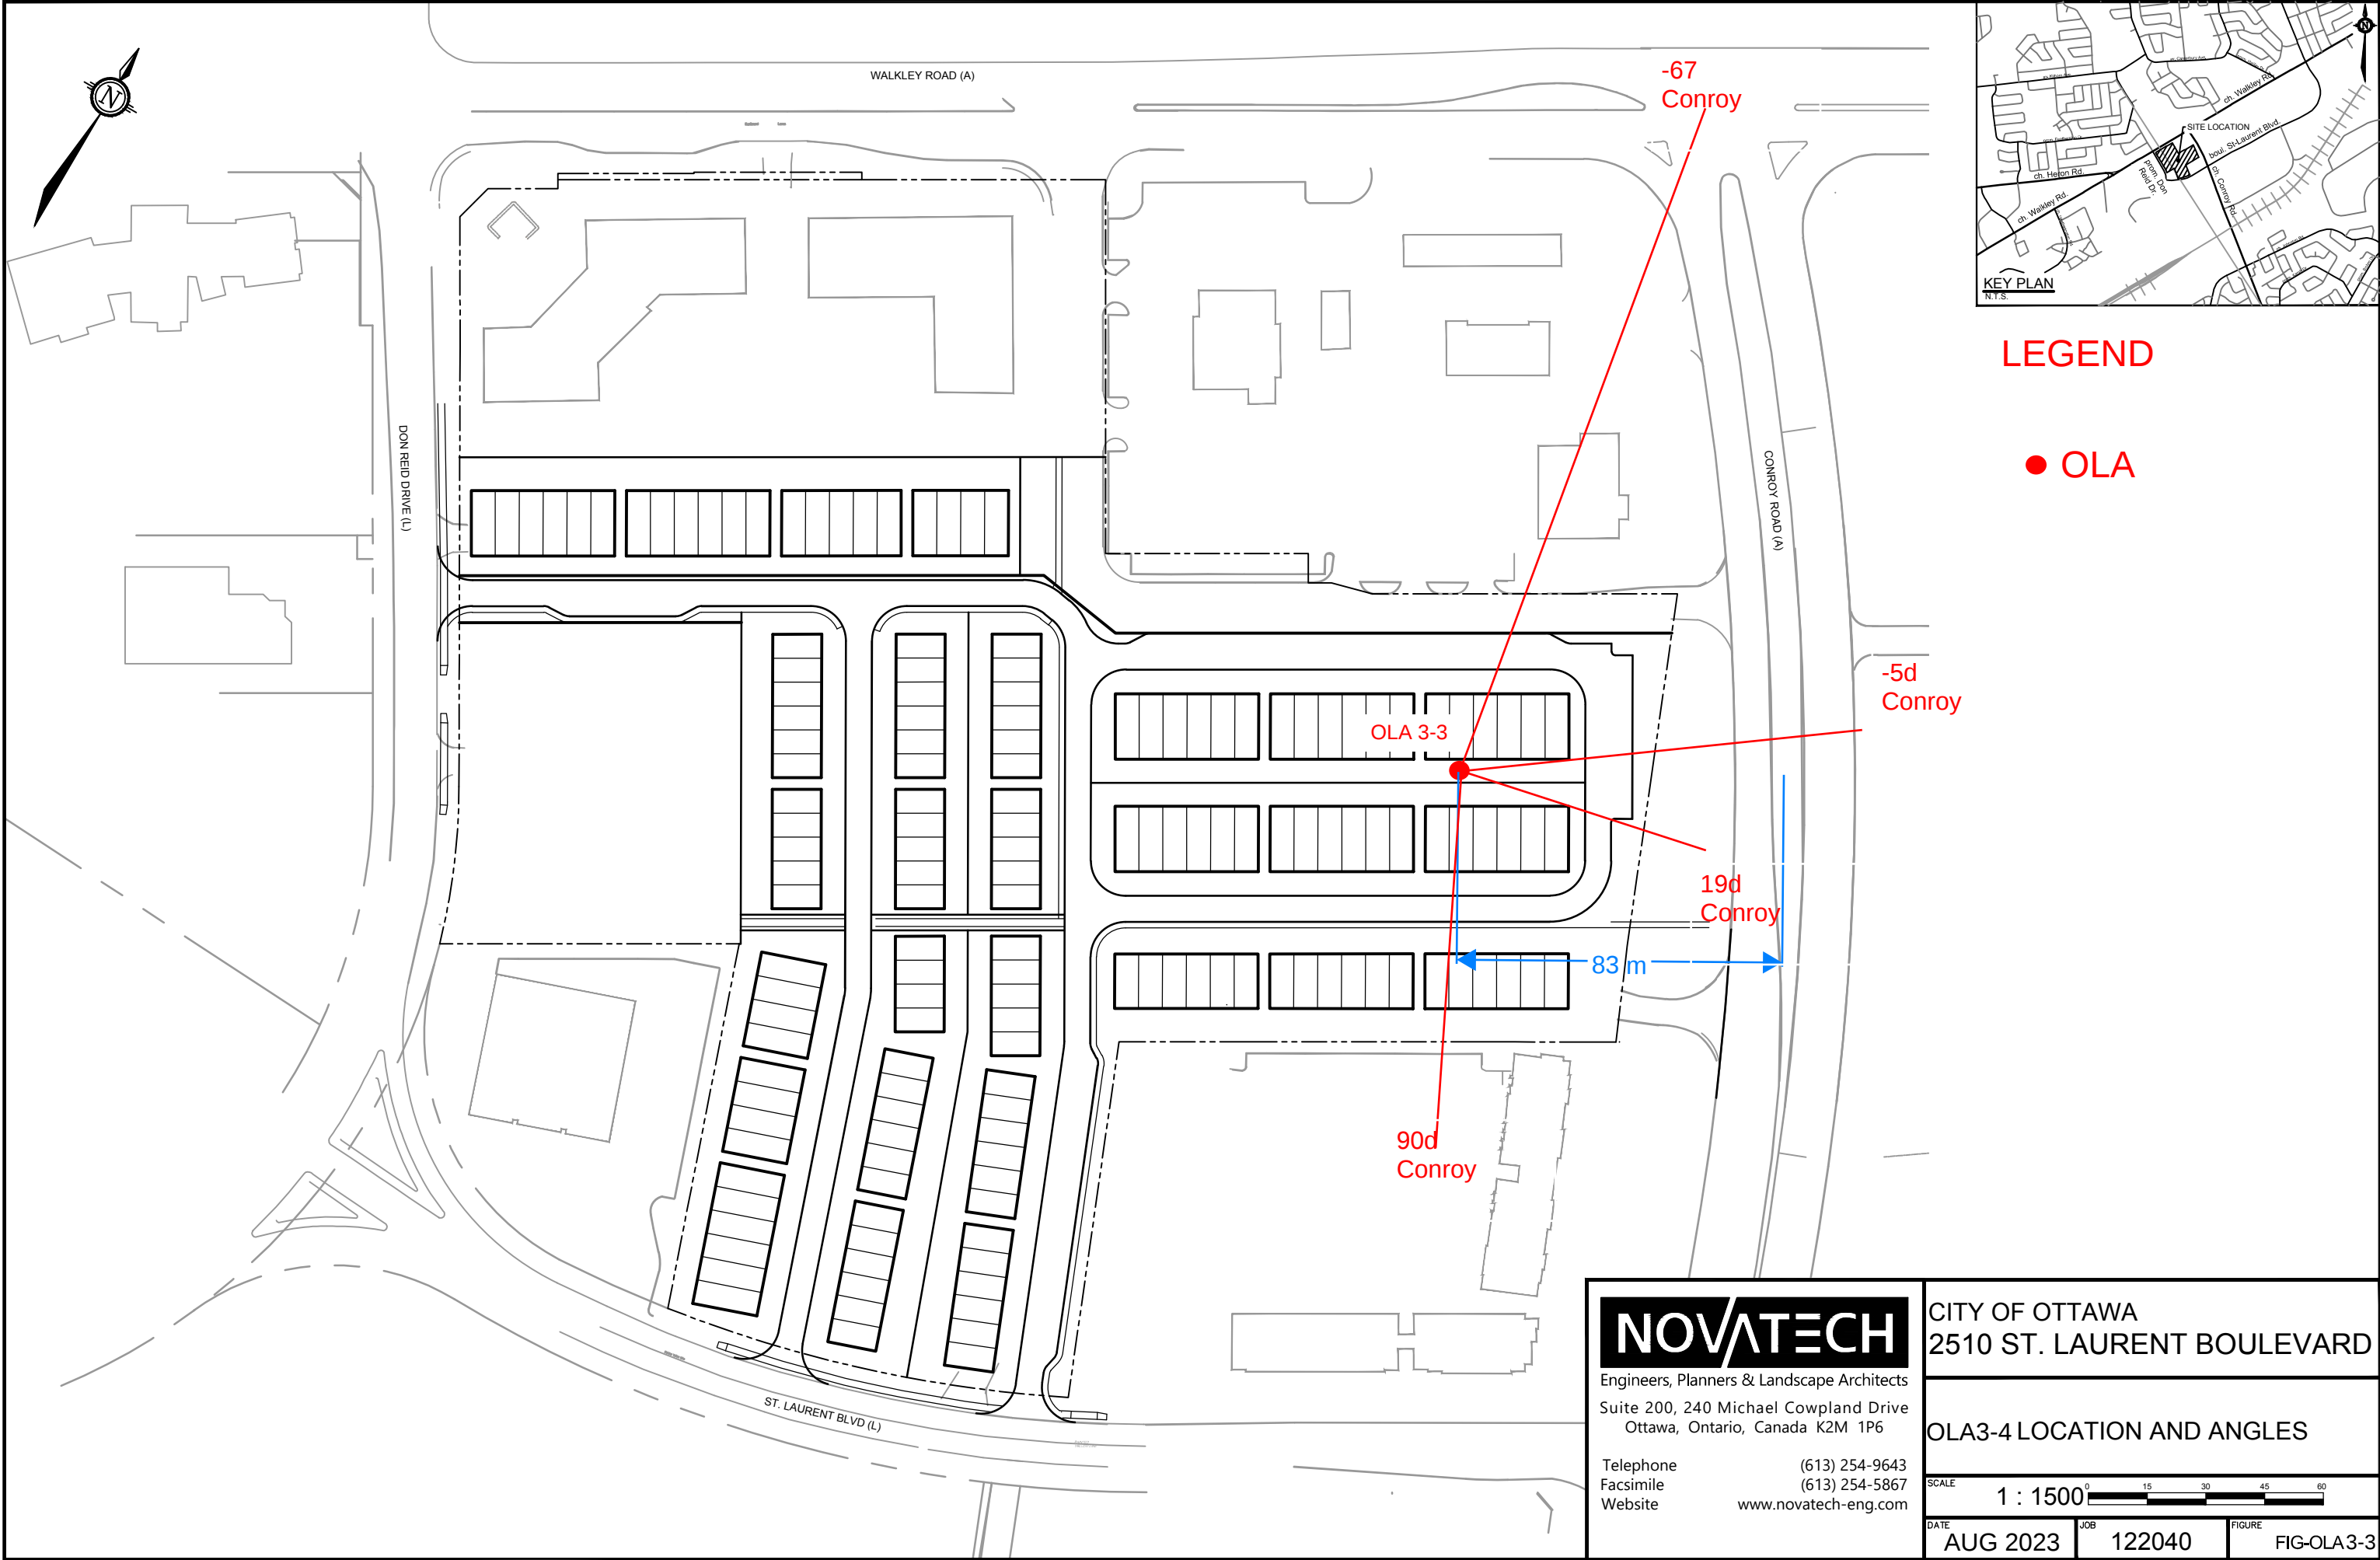

**NOVATECH**  
Engineers, Planners & Landscape Architects  
Suite 200, 240 Michael Cowpland Drive  
Ottawa, Ontario, Canada K2M 1P6  
Telephone (613) 254-9643  
Facsimile (613) 254-5867  
Website [www.novatech-eng.com](http://www.novatech-eng.com)

CITY OF OTTAWA  
2510 ST. LAURENT BOULEVARD

OLA3-4 LOCATION AND ANGLES


SCALE 1 : 1500

DATE AUG 2023

JOB 122040

FIGURE FIG-OLA3-3

M:\2022\122040\CAD\Civil\Figures\Noise\122040-NC.dwg, Fig. Jul 17, 2023 - 11:42am, mfang

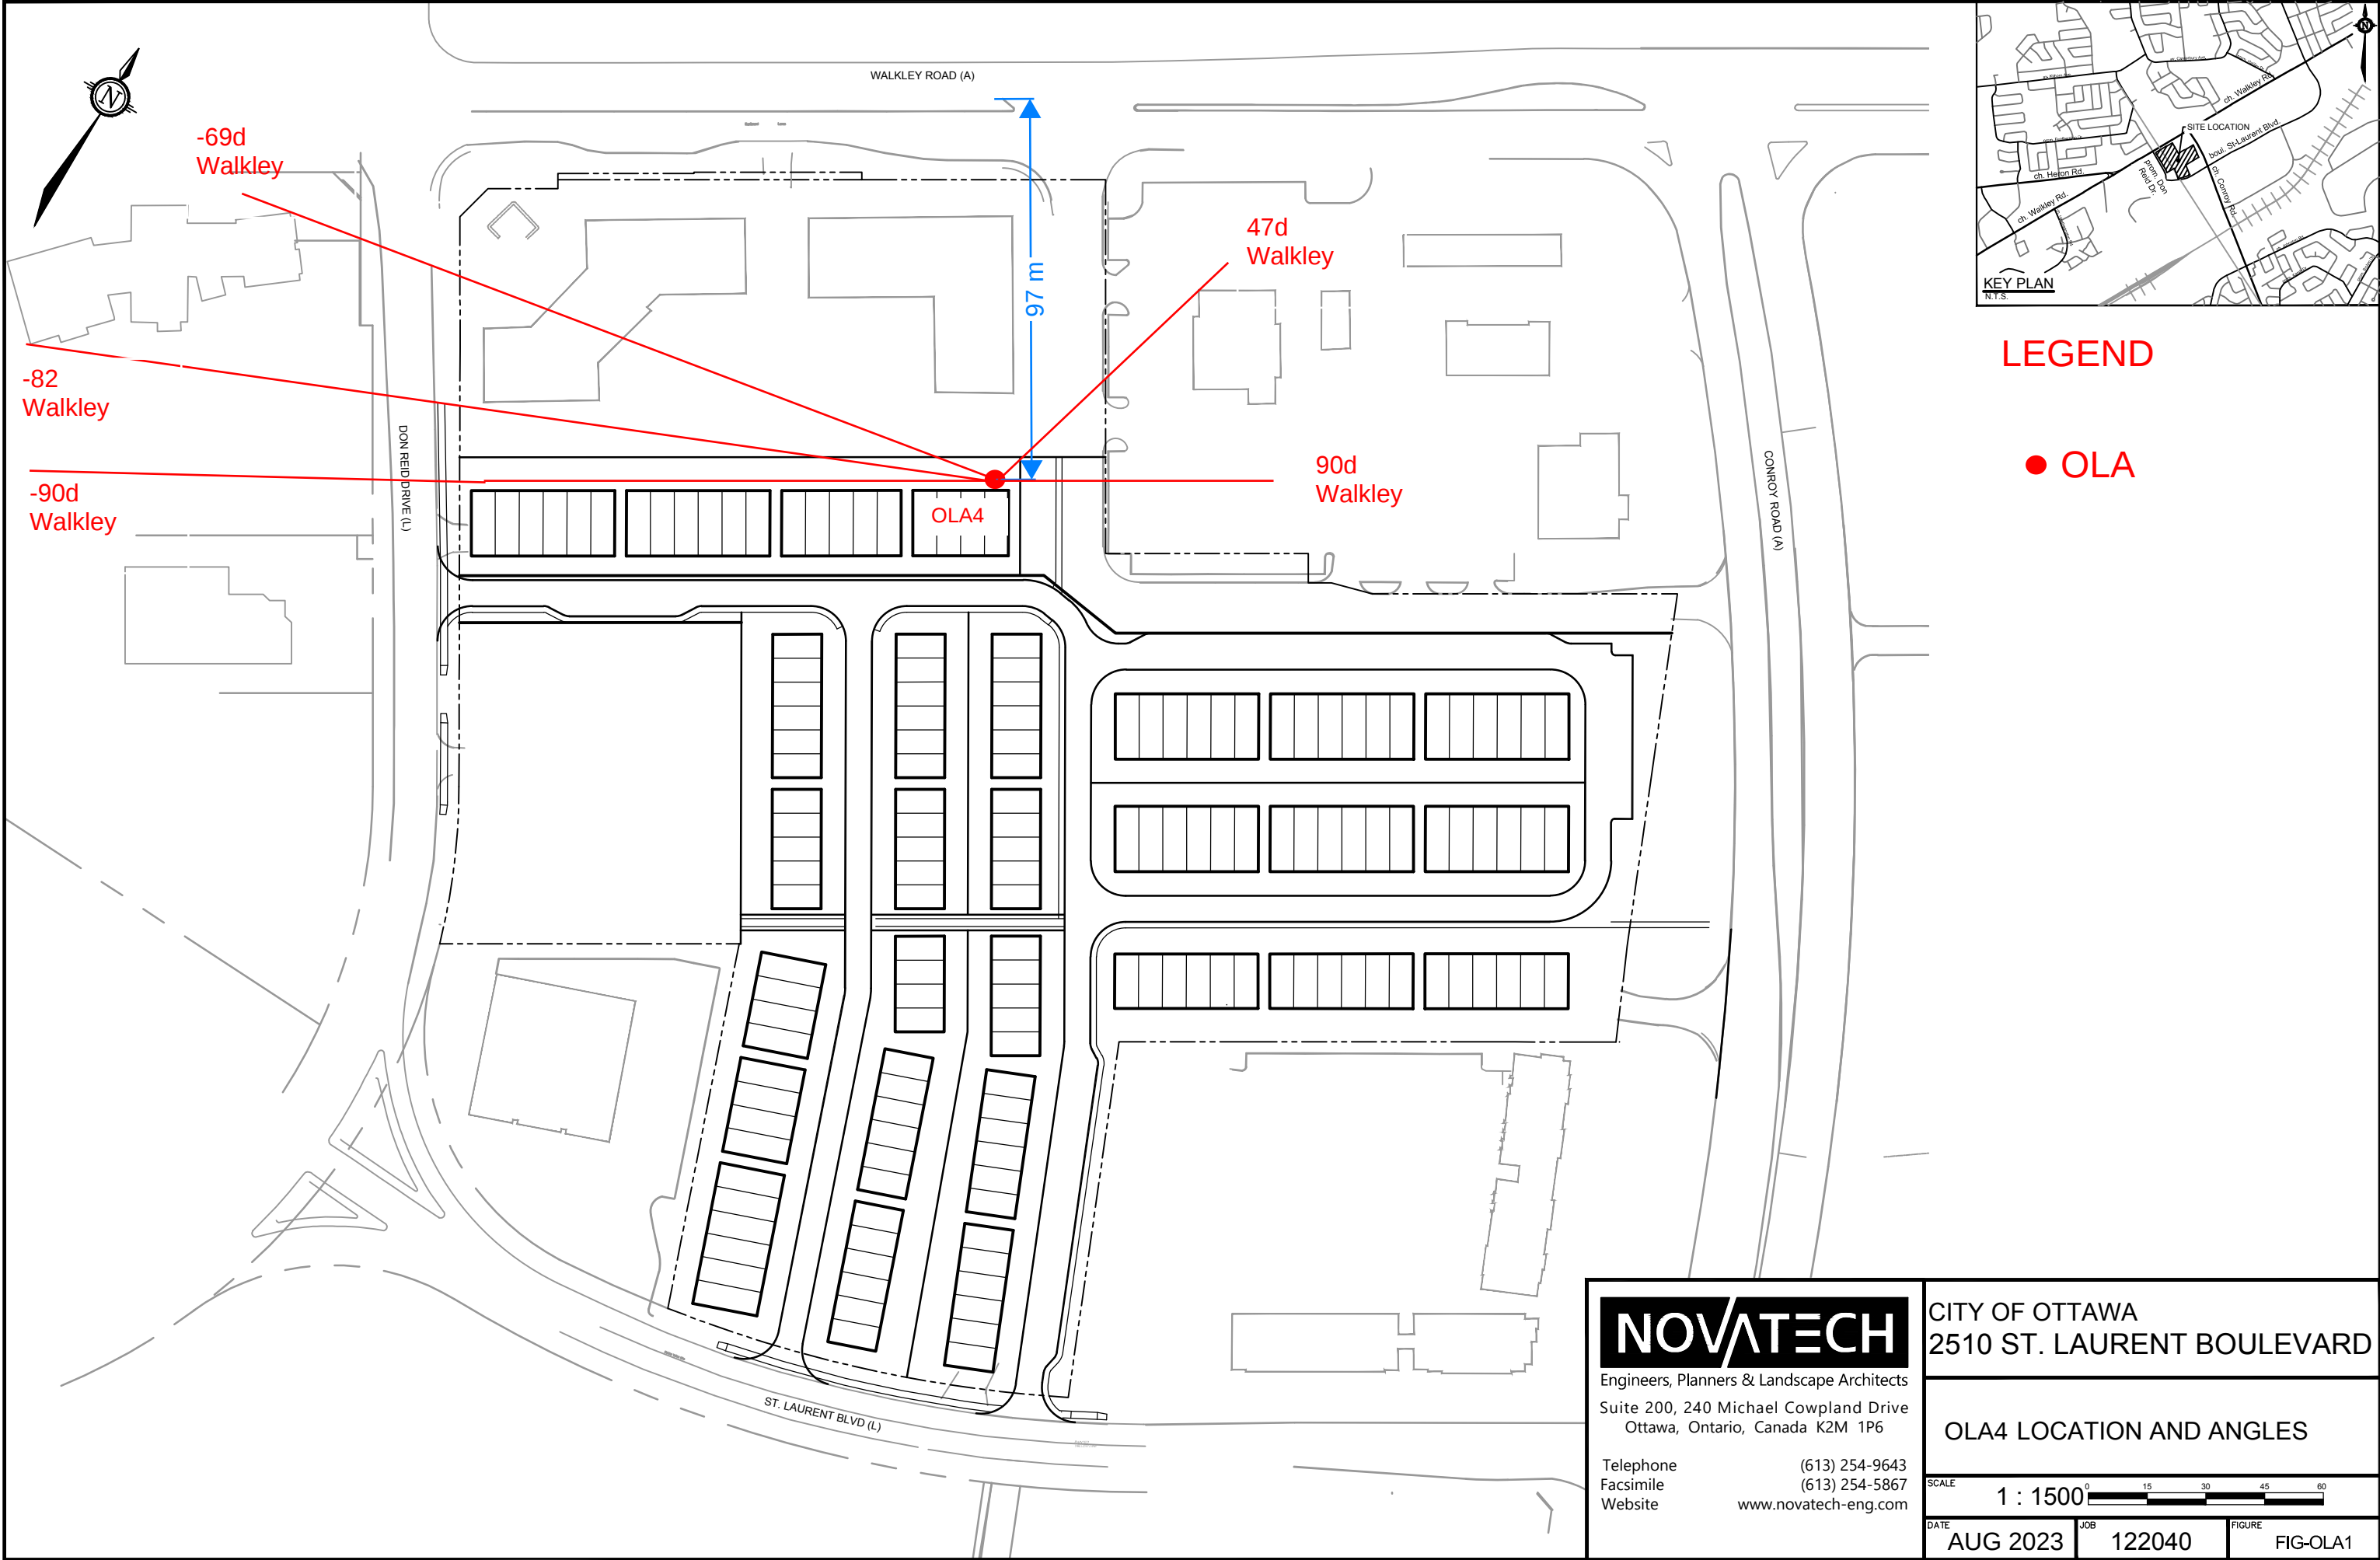

**NOVATECH**

Engineers, Planners & Landscape Architects  
Suite 200, 240 Michael Cowpland Drive  
Ottawa, Ontario, Canada K2M 1P6

Telephone (613) 254-9643  
Facsimile (613) 254-5867  
Website [www.novatech-eng.com](http://www.novatech-eng.com)

CITY OF OTTAWA  
2510 ST. LAURENT BOULEVARD



OLA4 LOCATION AND ANGLES

SCALE 1 : 1500

DATE AUG 2023 JOB 122040 FIGURE FIG-OLA1

SHT11X17.DWG - 279mmX432mm

M:\2022\122040\CAD\Civil\Figures\Noise\122040-NC.dwg, Fig. Jul 17, 2023 - 11:42am, mfang

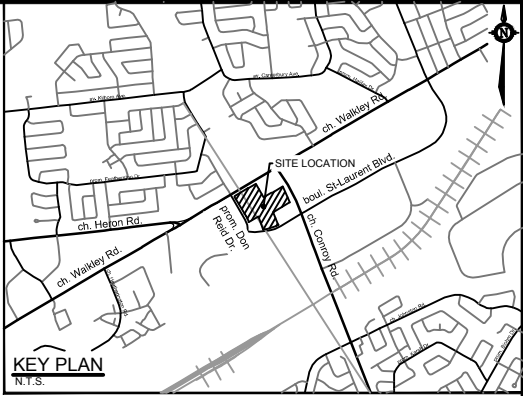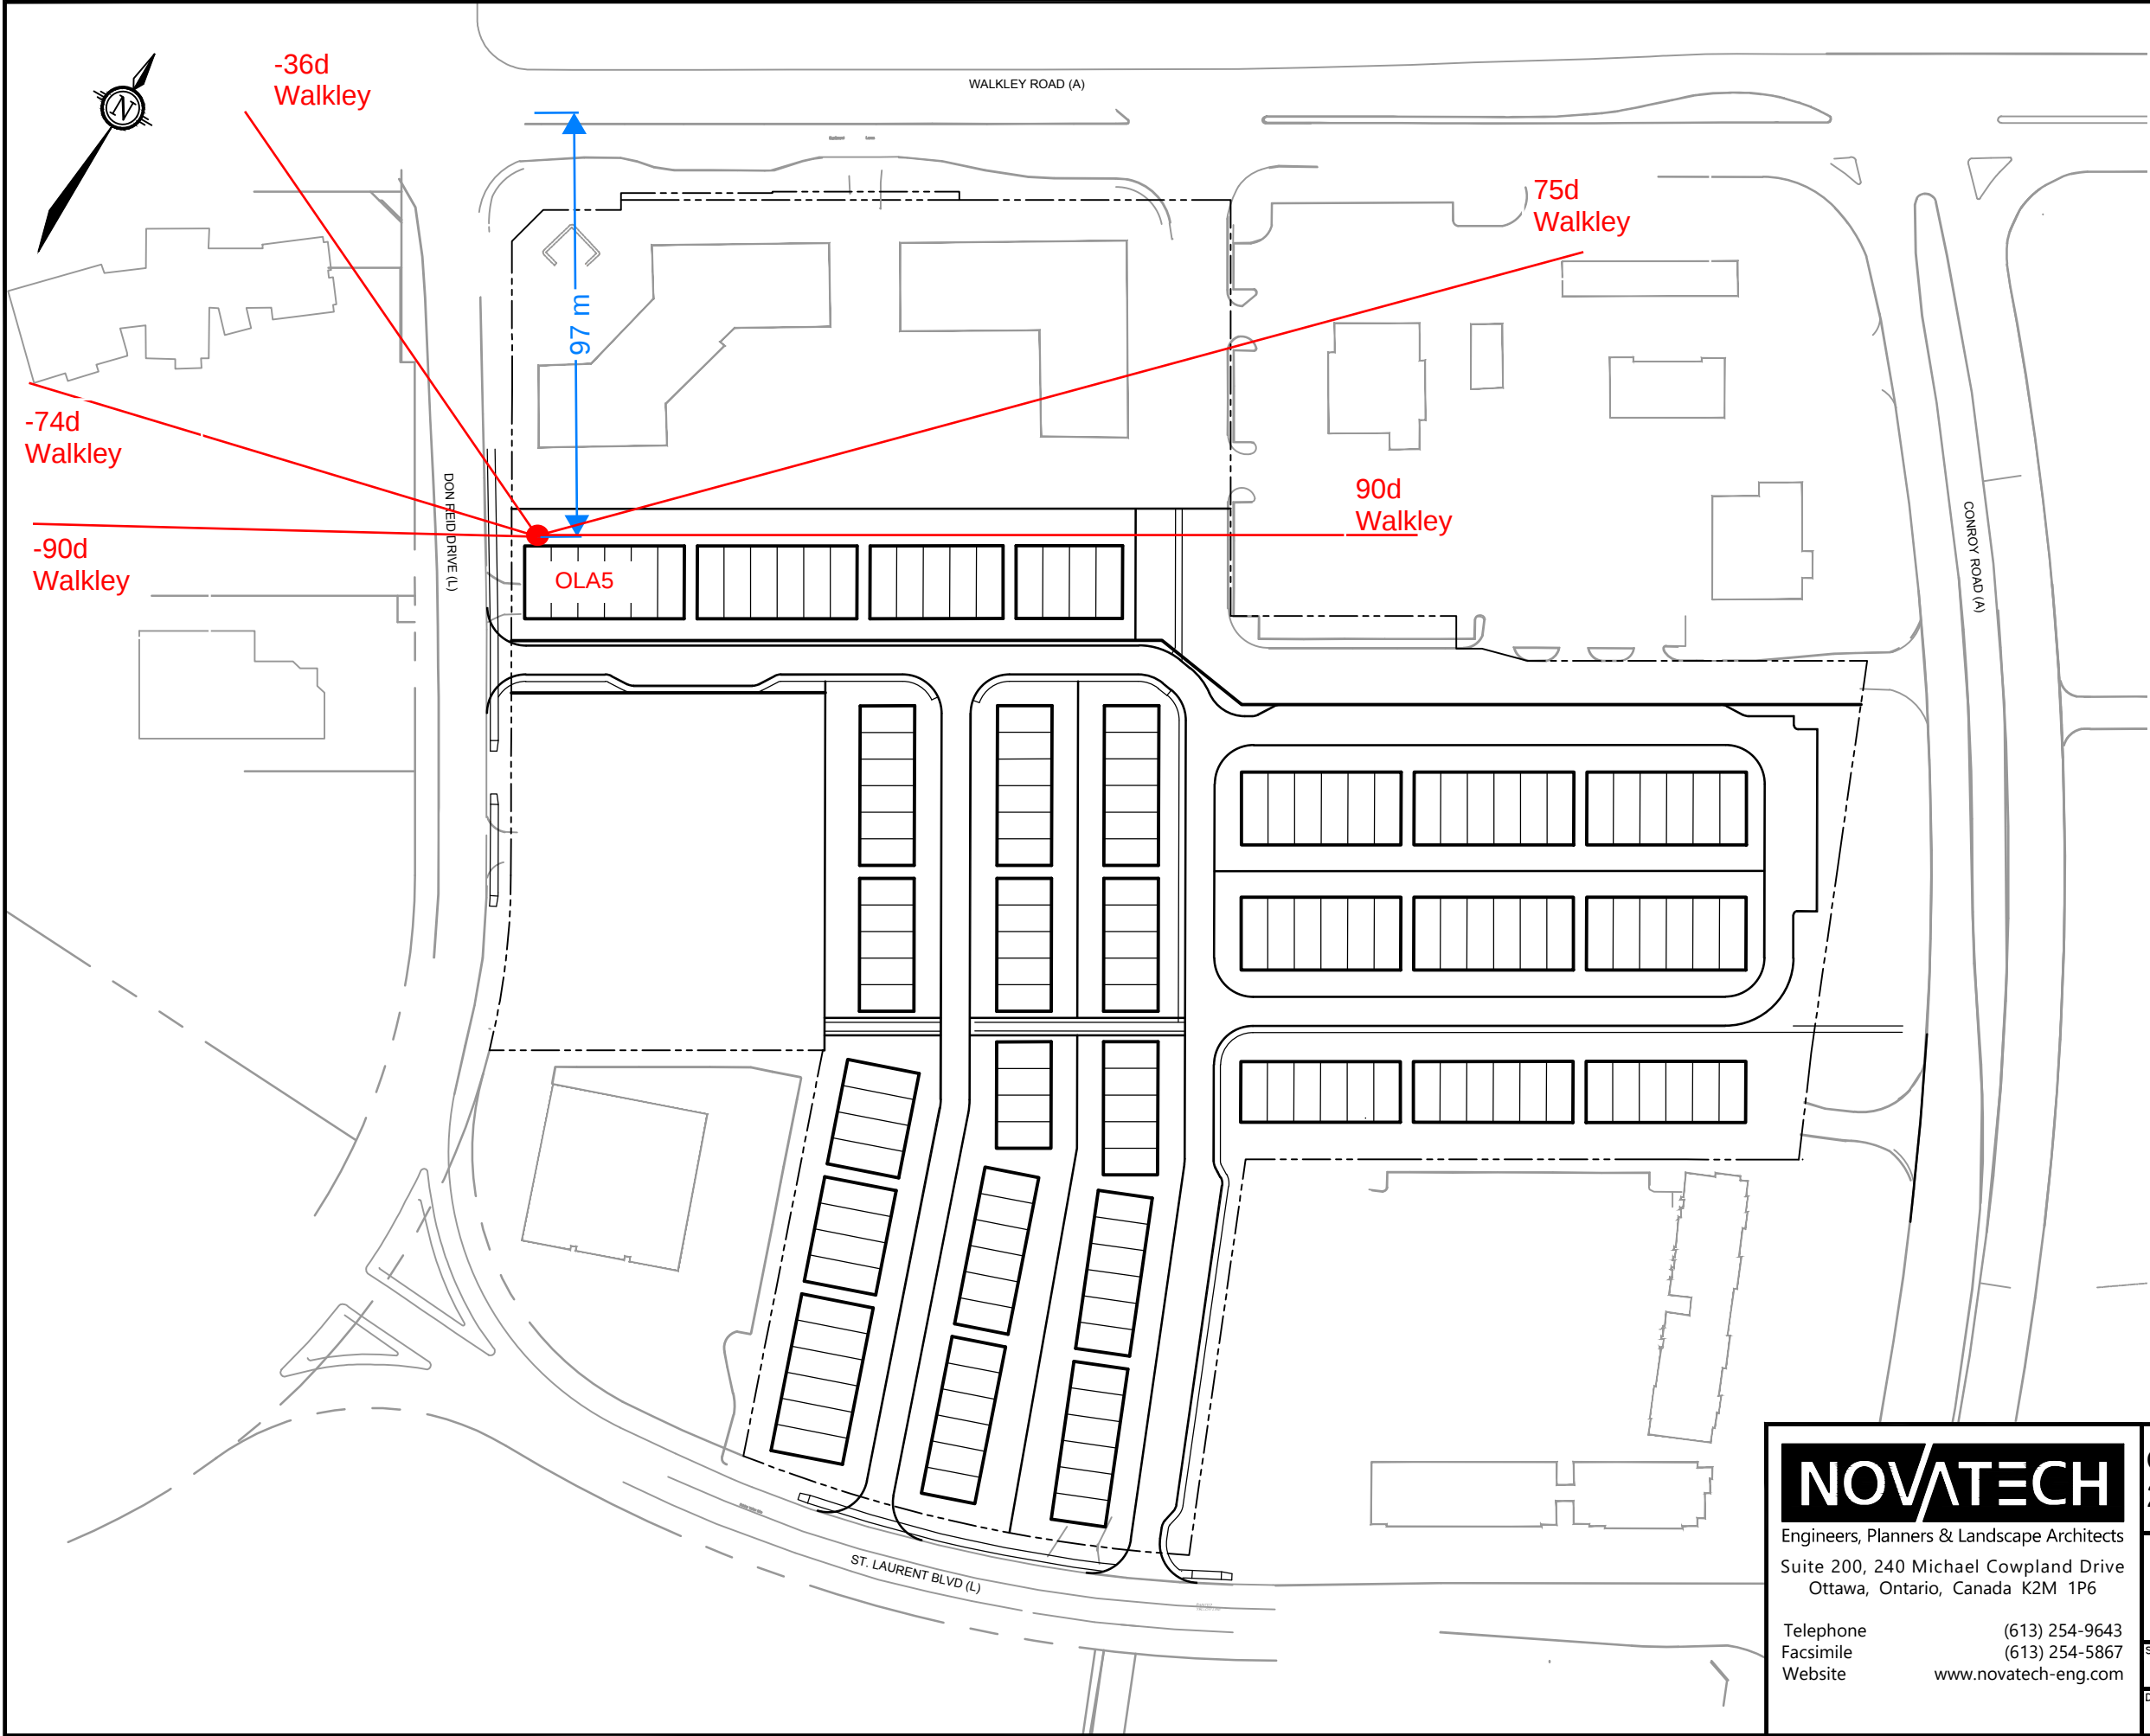

LEGEND

● OLA

**NOVATECH**

Engineers, Planners & Landscape Architects  
Suite 200, 240 Michael Cowpland Drive  
Ottawa, Ontario, Canada K2M 1P6

Telephone (613) 254-9643  
Facsimile (613) 254-5867  
Website [www.novatech-eng.com](http://www.novatech-eng.com)


CITY OF OTTAWA  
2510 ST. LAURENT BOULEVARD

OLA5 LOCATION AND ANGLES


SCALE 1 : 1500 0 15 30 45 60

|      |          |     |        |        |          |
|------|----------|-----|--------|--------|----------|
| DATE | AUG 2023 | JOB | 122040 | FIGURE | FIG-OLA1 |
|------|----------|-----|--------|--------|----------|

M:\2022\122040\CAD\Civil\Figures\Noise\122040-NC.dwg, Fig (W), Nov 29, 2024 - 8:47am, mfang

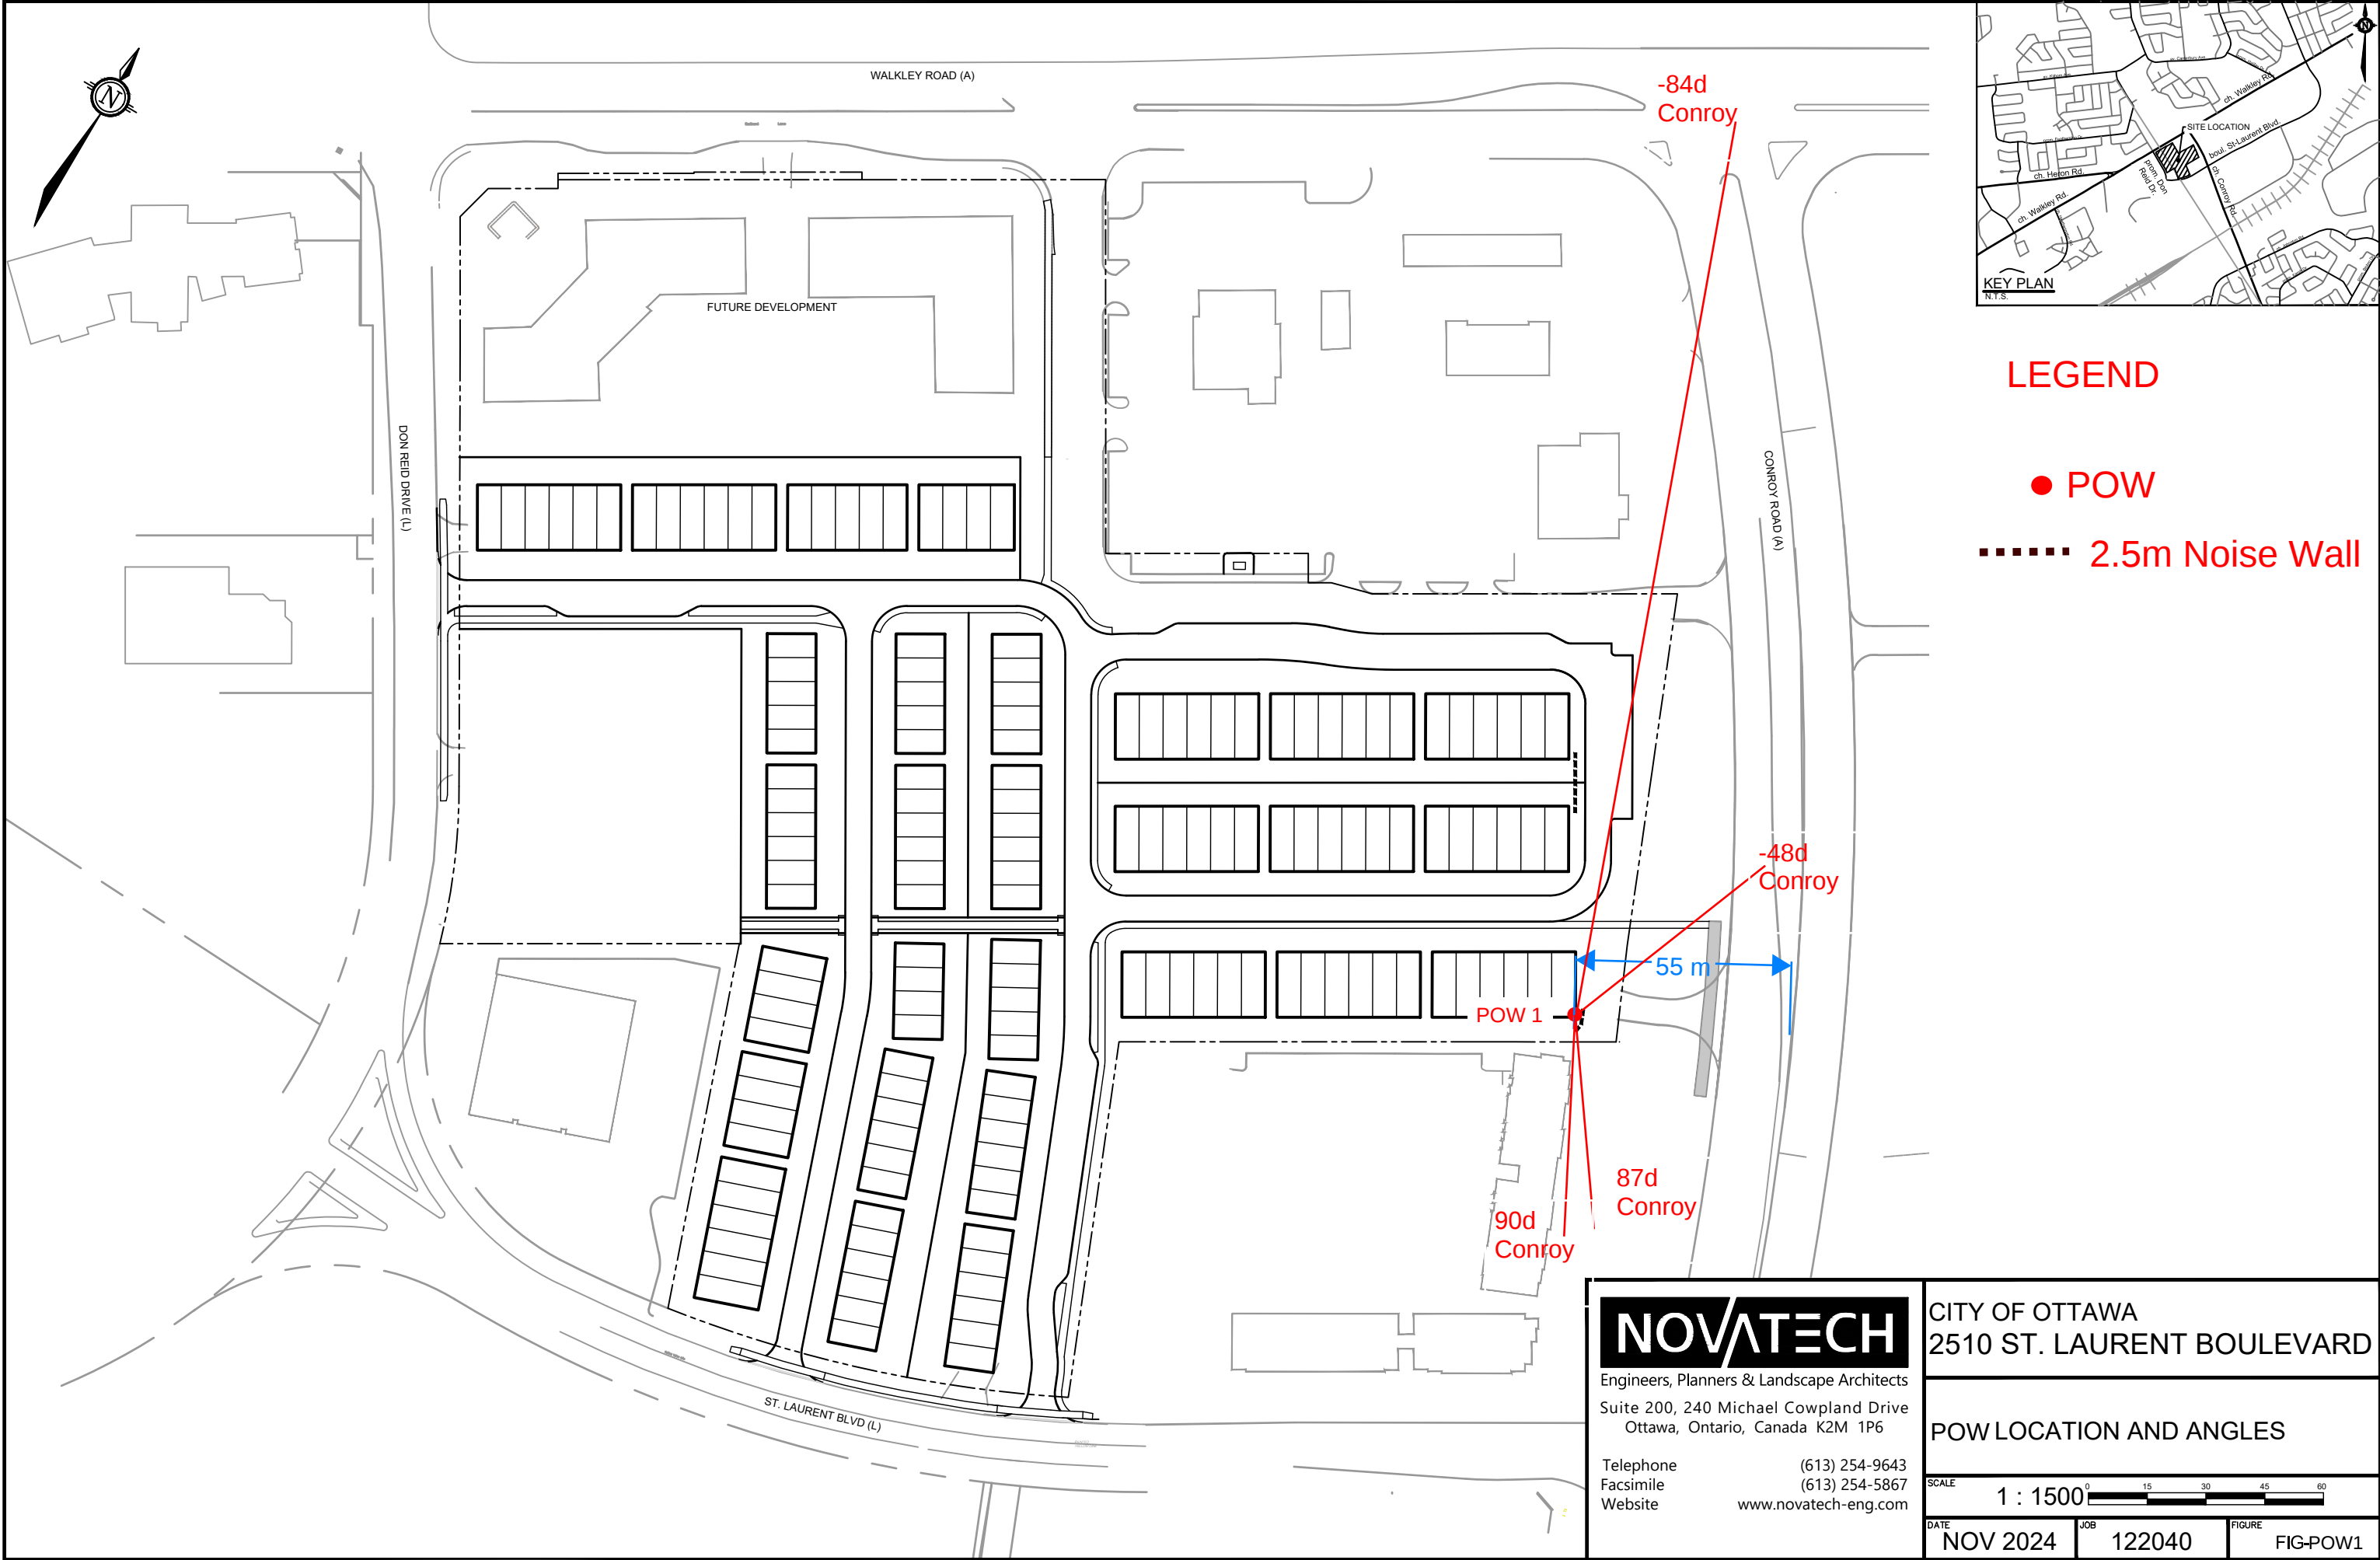


M:\2022\122040\CAD\Civil\Figures\Noise\122040-NC.dwg, Fig (W), Nov 29, 2024 - 8:47am, mfang

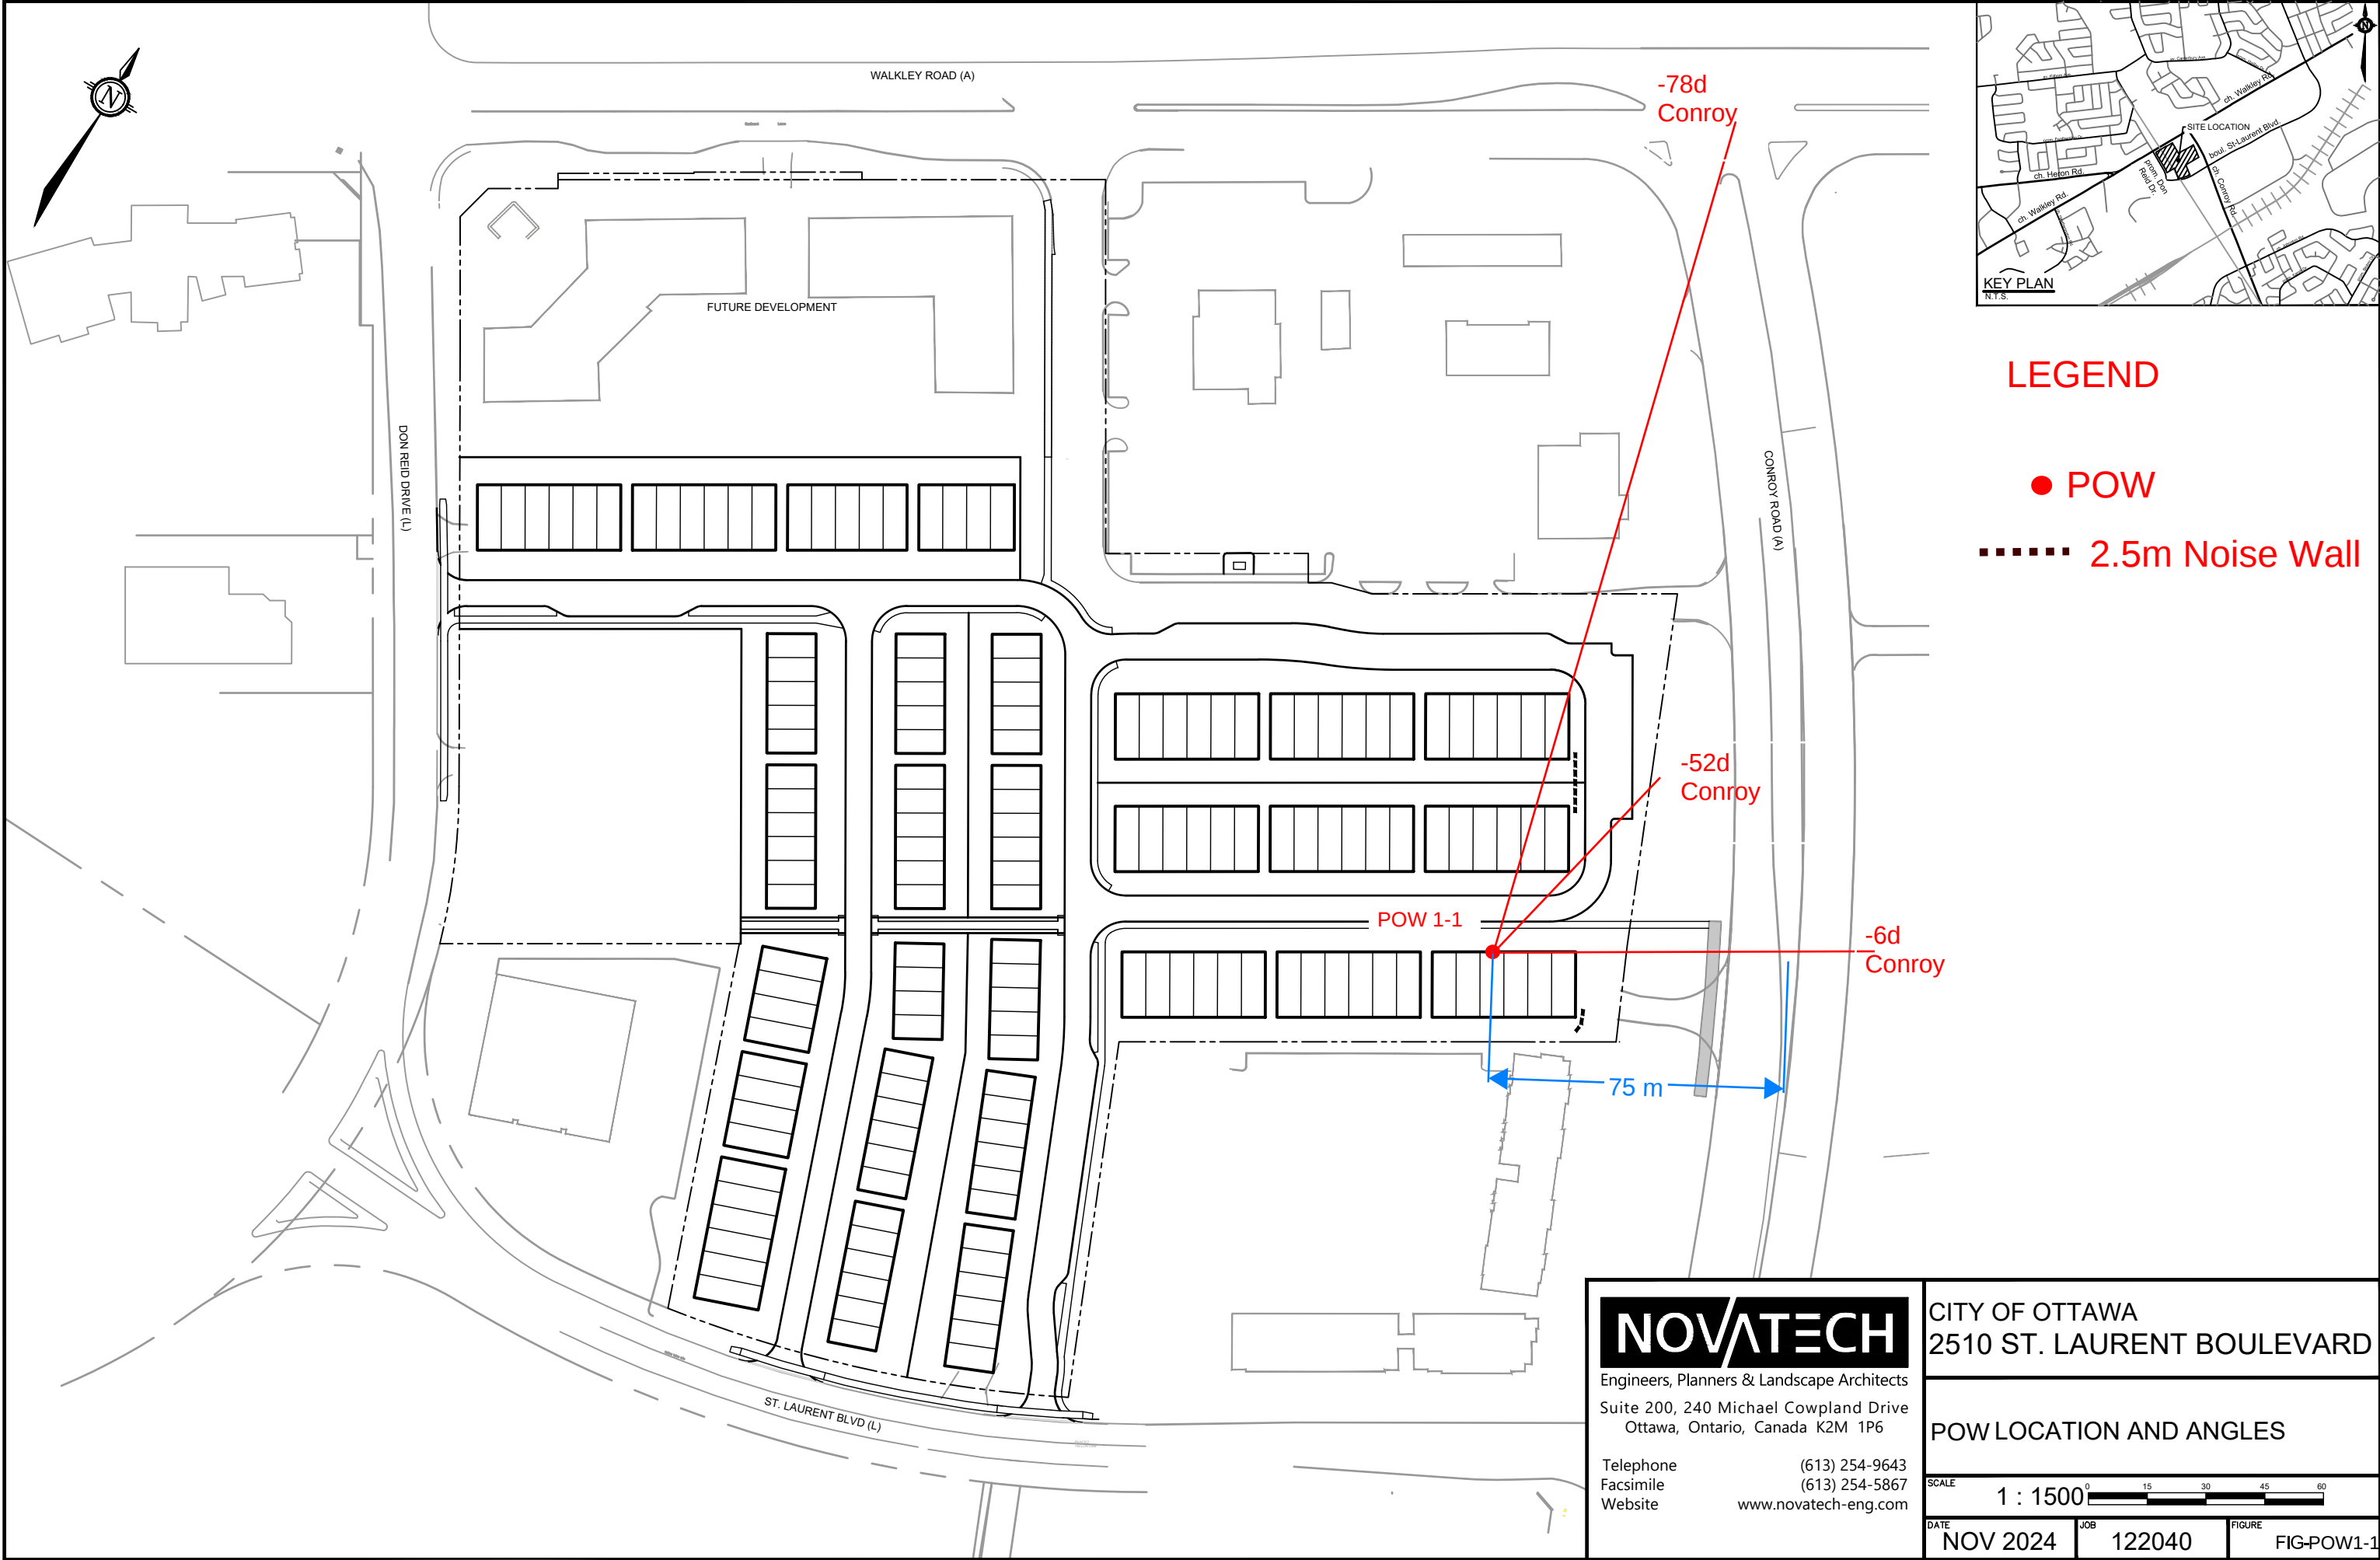



|                                                                                                                                                                                                                                       |                                              |               |                      |
|---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|----------------------------------------------|---------------|----------------------|
| <b>NOVATECH</b><br>Engineers, Planners & Landscape Architects<br>Suite 200, 240 Michael Cowpland Drive<br>Ottawa, Ontario, Canada K2M 1P6<br><br>Telephone (613) 254-9643<br>Facsimile (613) 254-5867<br>Website www.novatech-eng.com | CITY OF OTTAWA<br>2510 ST. LAURENT BOULEVARD |               |                      |
|                                                                                                                                                                                                                                       | POW LOCATION AND ANGLES                      |               |                      |
|                                                                                                                                                                                                                                       | SCALE<br>1 : 1500                            |               |                      |
|                                                                                                                                                                                                                                       | DATE<br>NOV 2024                             | JOB<br>122040 | FIGURE<br>FIG-POW1-1 |

M:\2022\122040\CAD\Civil\Figures\Noise\122040-NC.dwg, Fig (W), Nov 29, 2024 - 8:47am, mfang

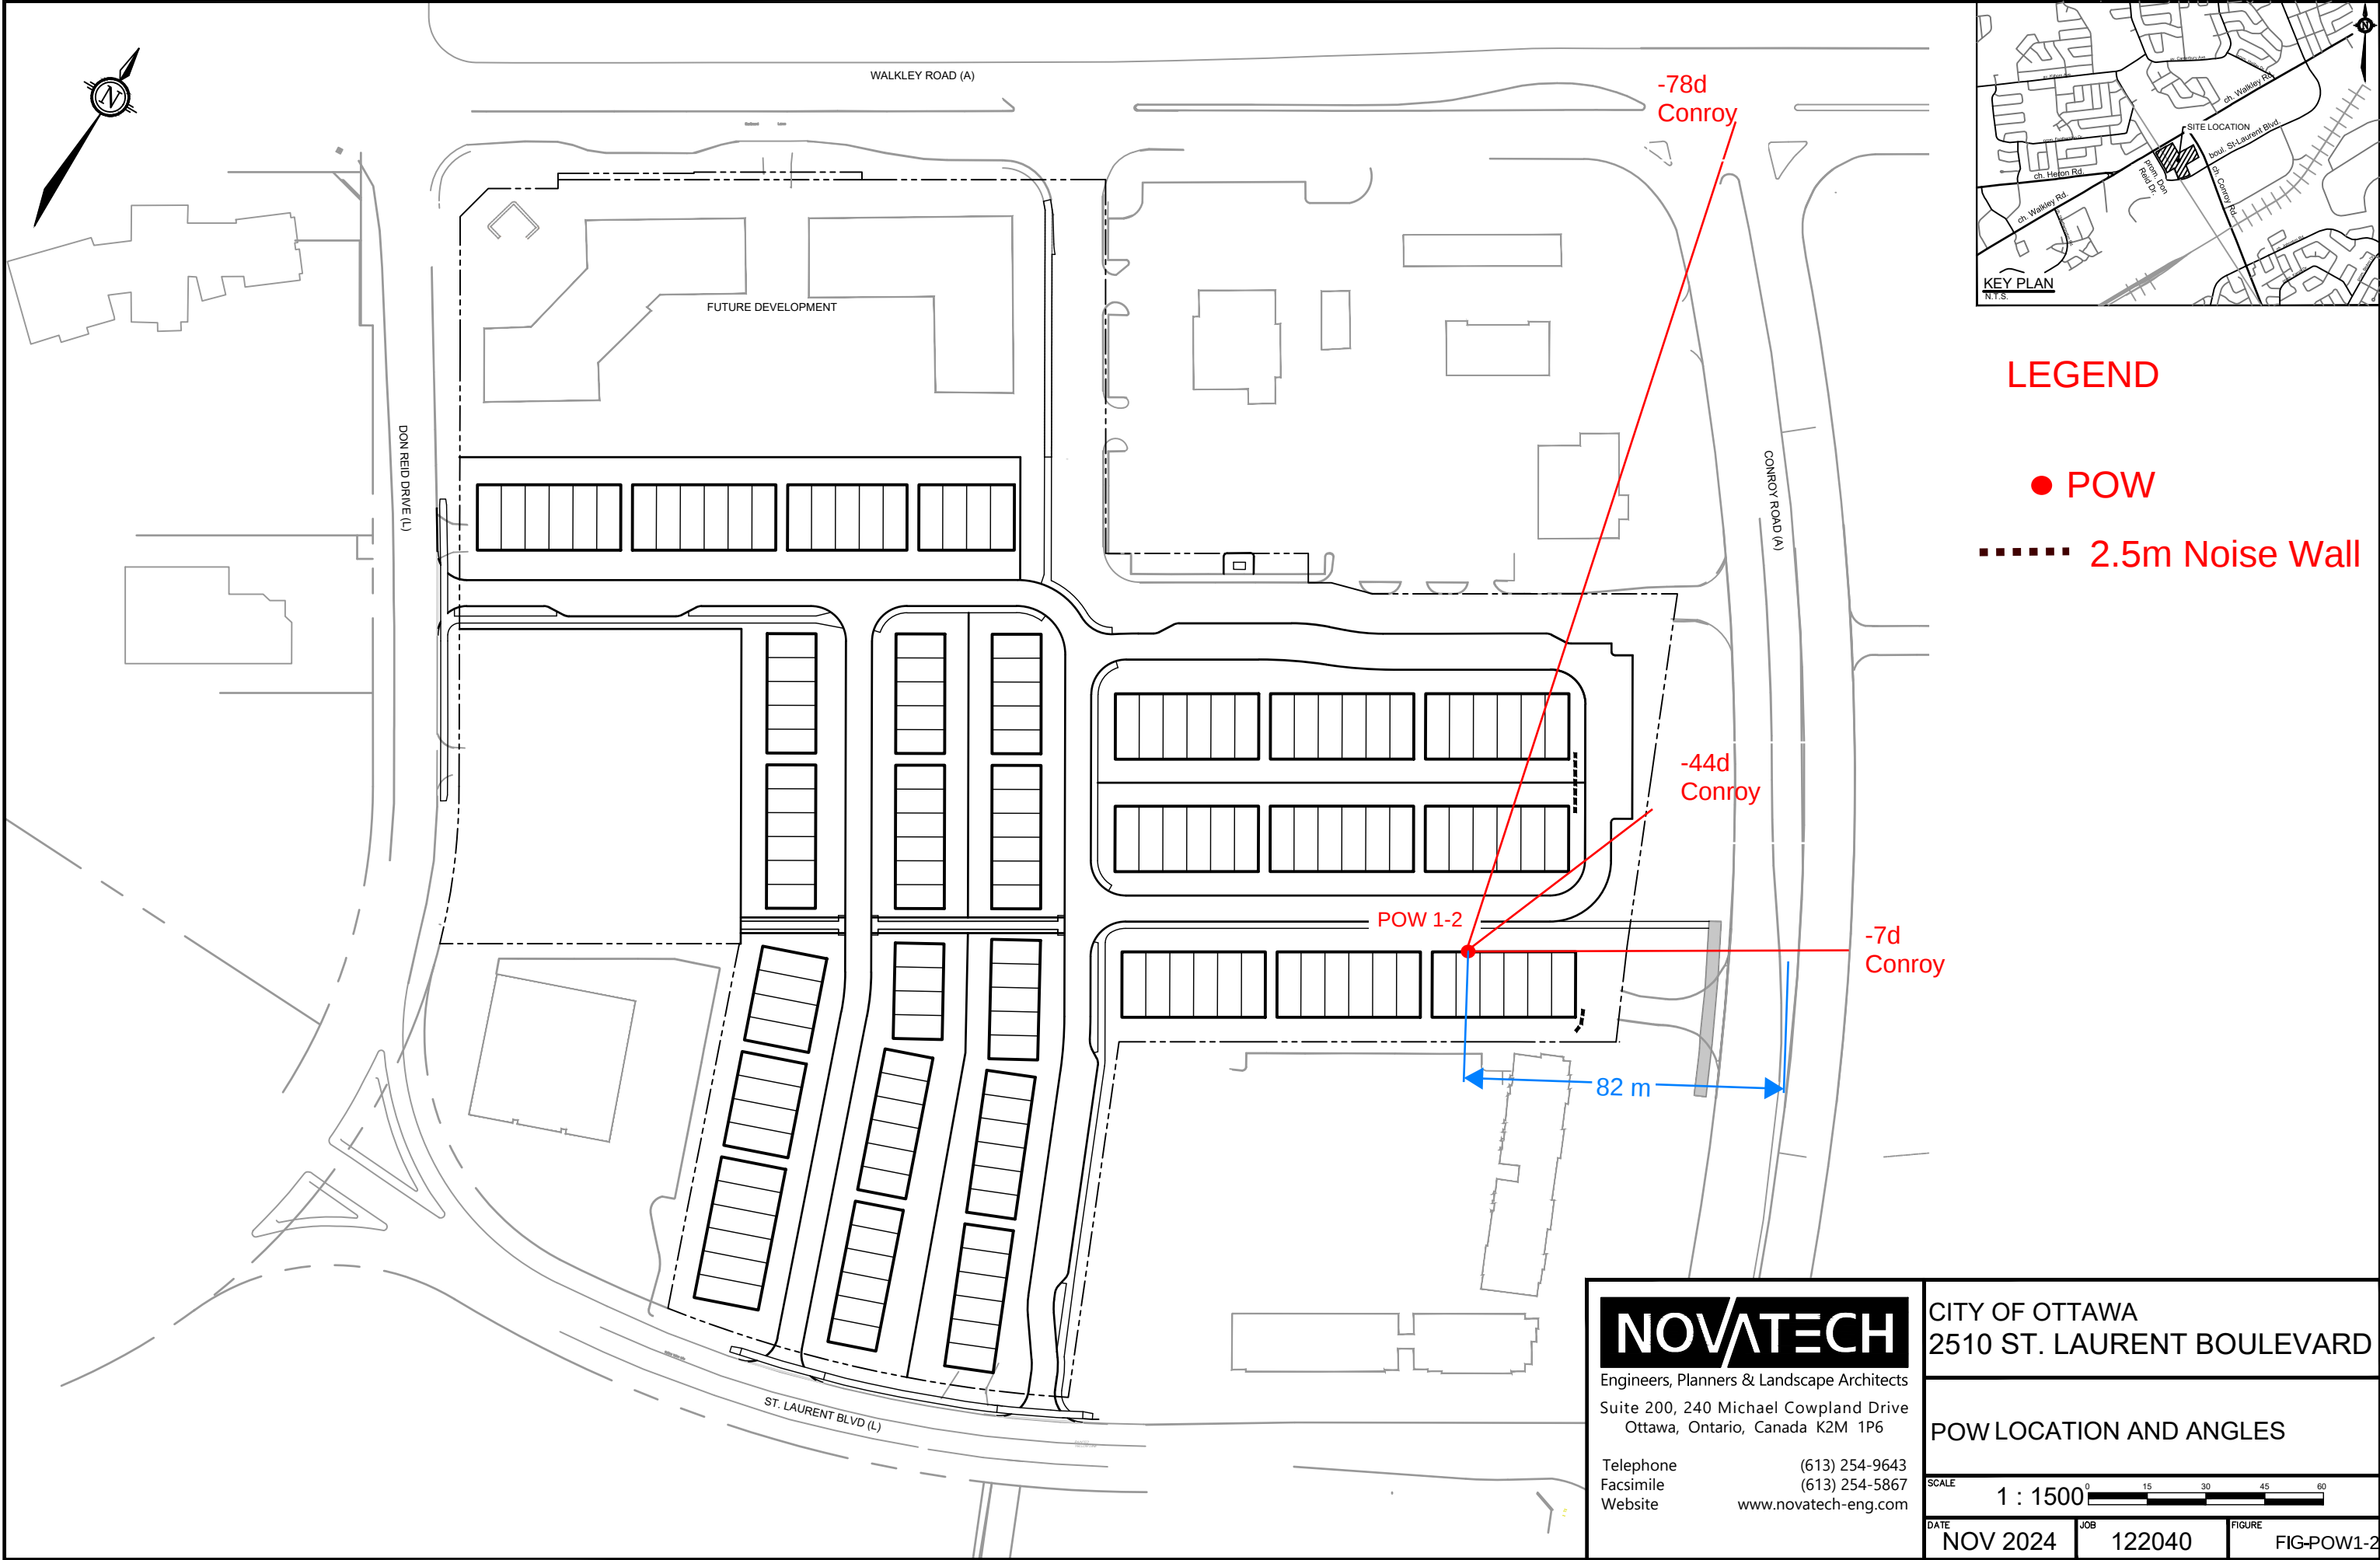



M:\2022\122040\CAD\Civil\Figures\Noise\122040-NC.dwg, Fig (W), Nov 29, 2024 - 8:47am, mfang

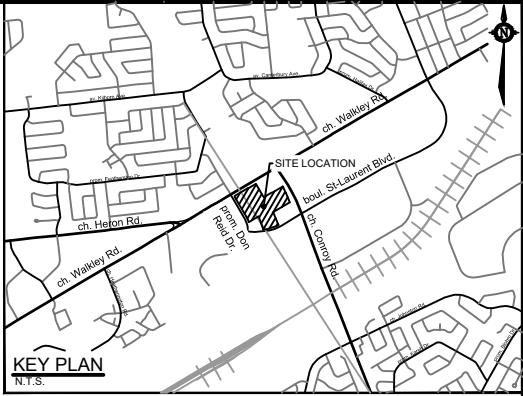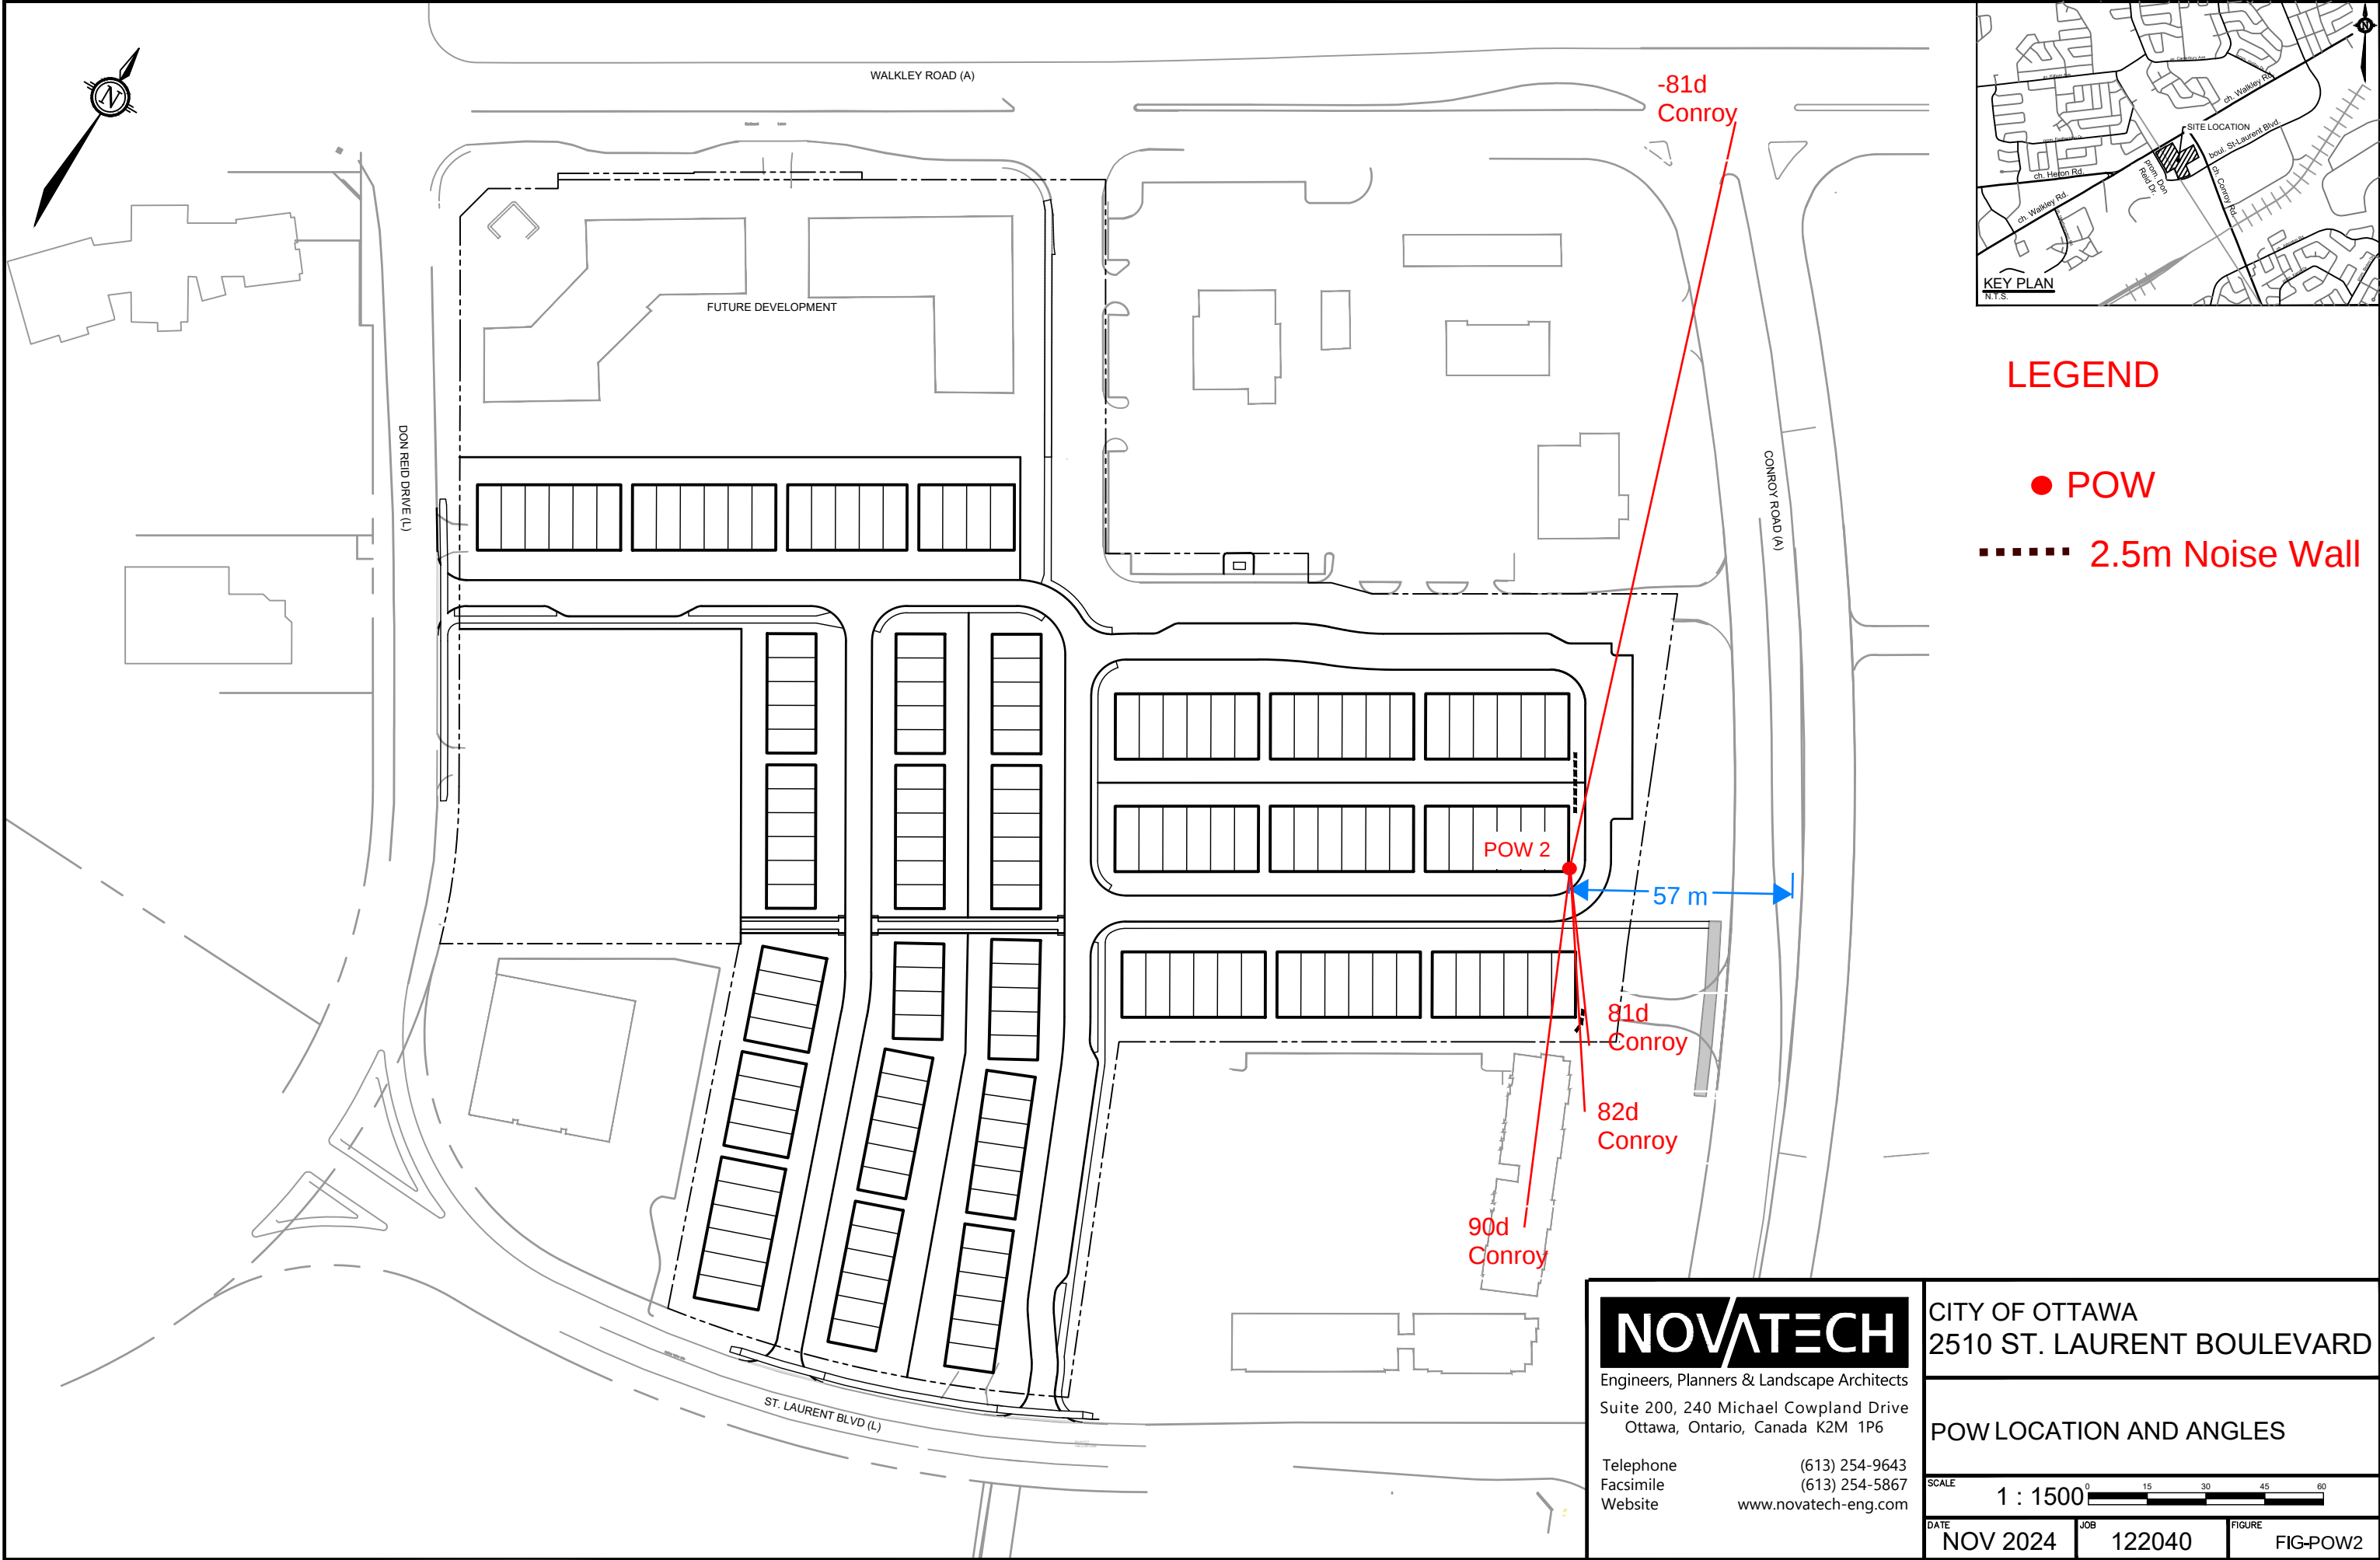

## LEGEND

- POW
- ..... 2.5m Noise Wall

**NOVATECH**

Engineers, Planners & Landscape Architects  
Suite 200, 240 Michael Cowpland Drive  
Ottawa, Ontario, Canada K2M 1P6



Telephone (613) 254-9643  
Facsimile (613) 254-5867  
Website [www.novatech-eng.com](http://www.novatech-eng.com)

CITY OF OTTAWA  
2510 ST. LAURENT BOULEVARD

## POW LOCATION AND ANGLES

SCALE 1 : 1500 0 15 30 45 60

DATE NOV 2024 JOB 122040 FIGURE FIG-POW2

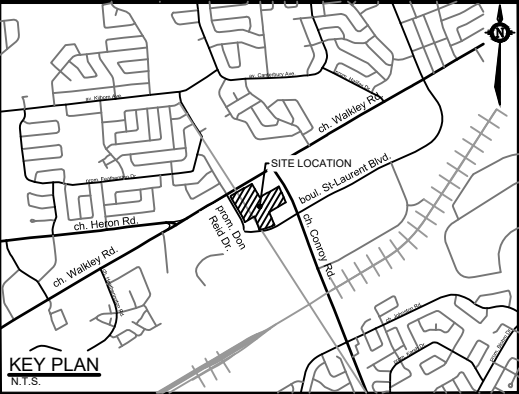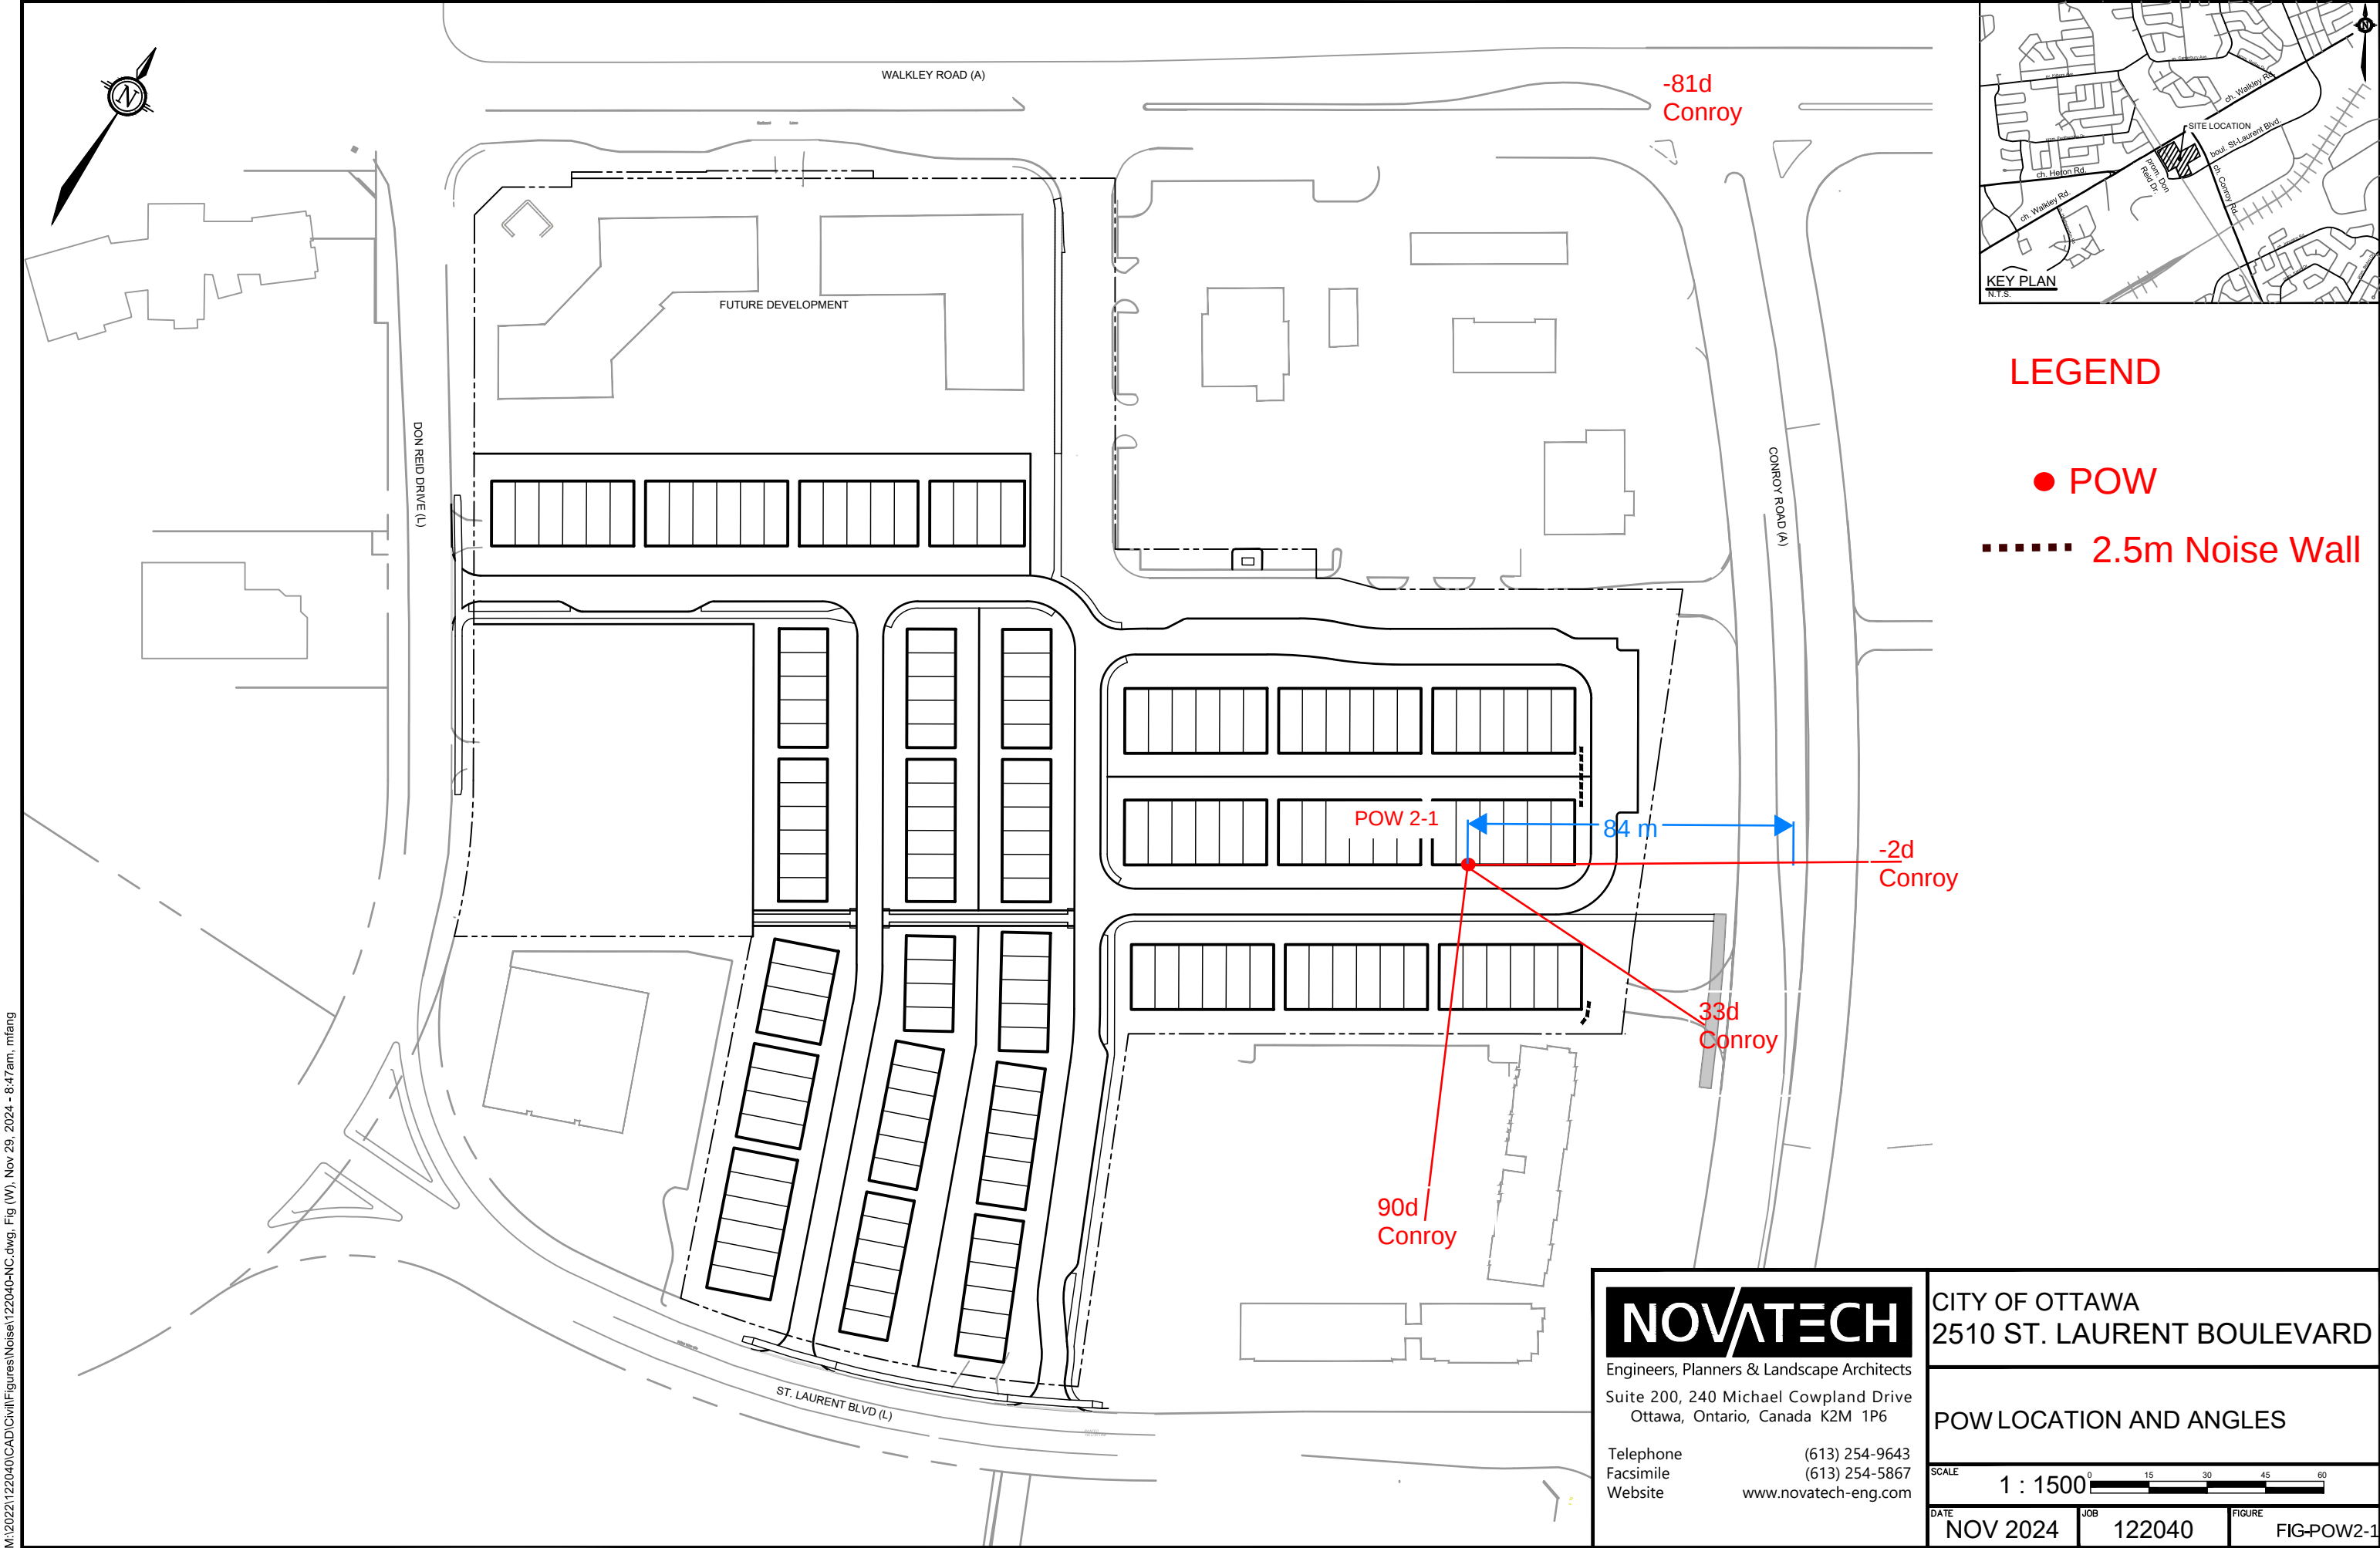

LEGEND

- POW
- ..... 2.5m Noise Wall

**NOVATECH**

Engineers, Planners & Landscape Architects  
Suite 200, 240 Michael Cowpland Drive  
Ottawa, Ontario, Canada K2M 1P6



Telephone (613) 254-9643  
Facsimile (613) 254-5867  
Website [www.novatech-eng.com](http://www.novatech-eng.com)

CITY OF OTTAWA  
2510 ST. LAURENT BOULEVARD

POW LOCATION AND ANGLES

SCALE 1 : 1500

|      |          |     |        |        |            |
|------|----------|-----|--------|--------|------------|
| DATE | NOV 2024 | JOB | 122040 | FIGURE | FIG-POW2-1 |
|------|----------|-----|--------|--------|------------|

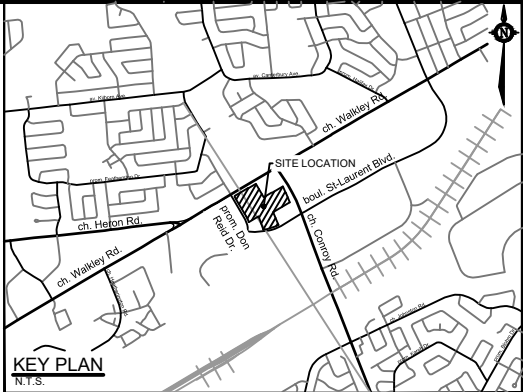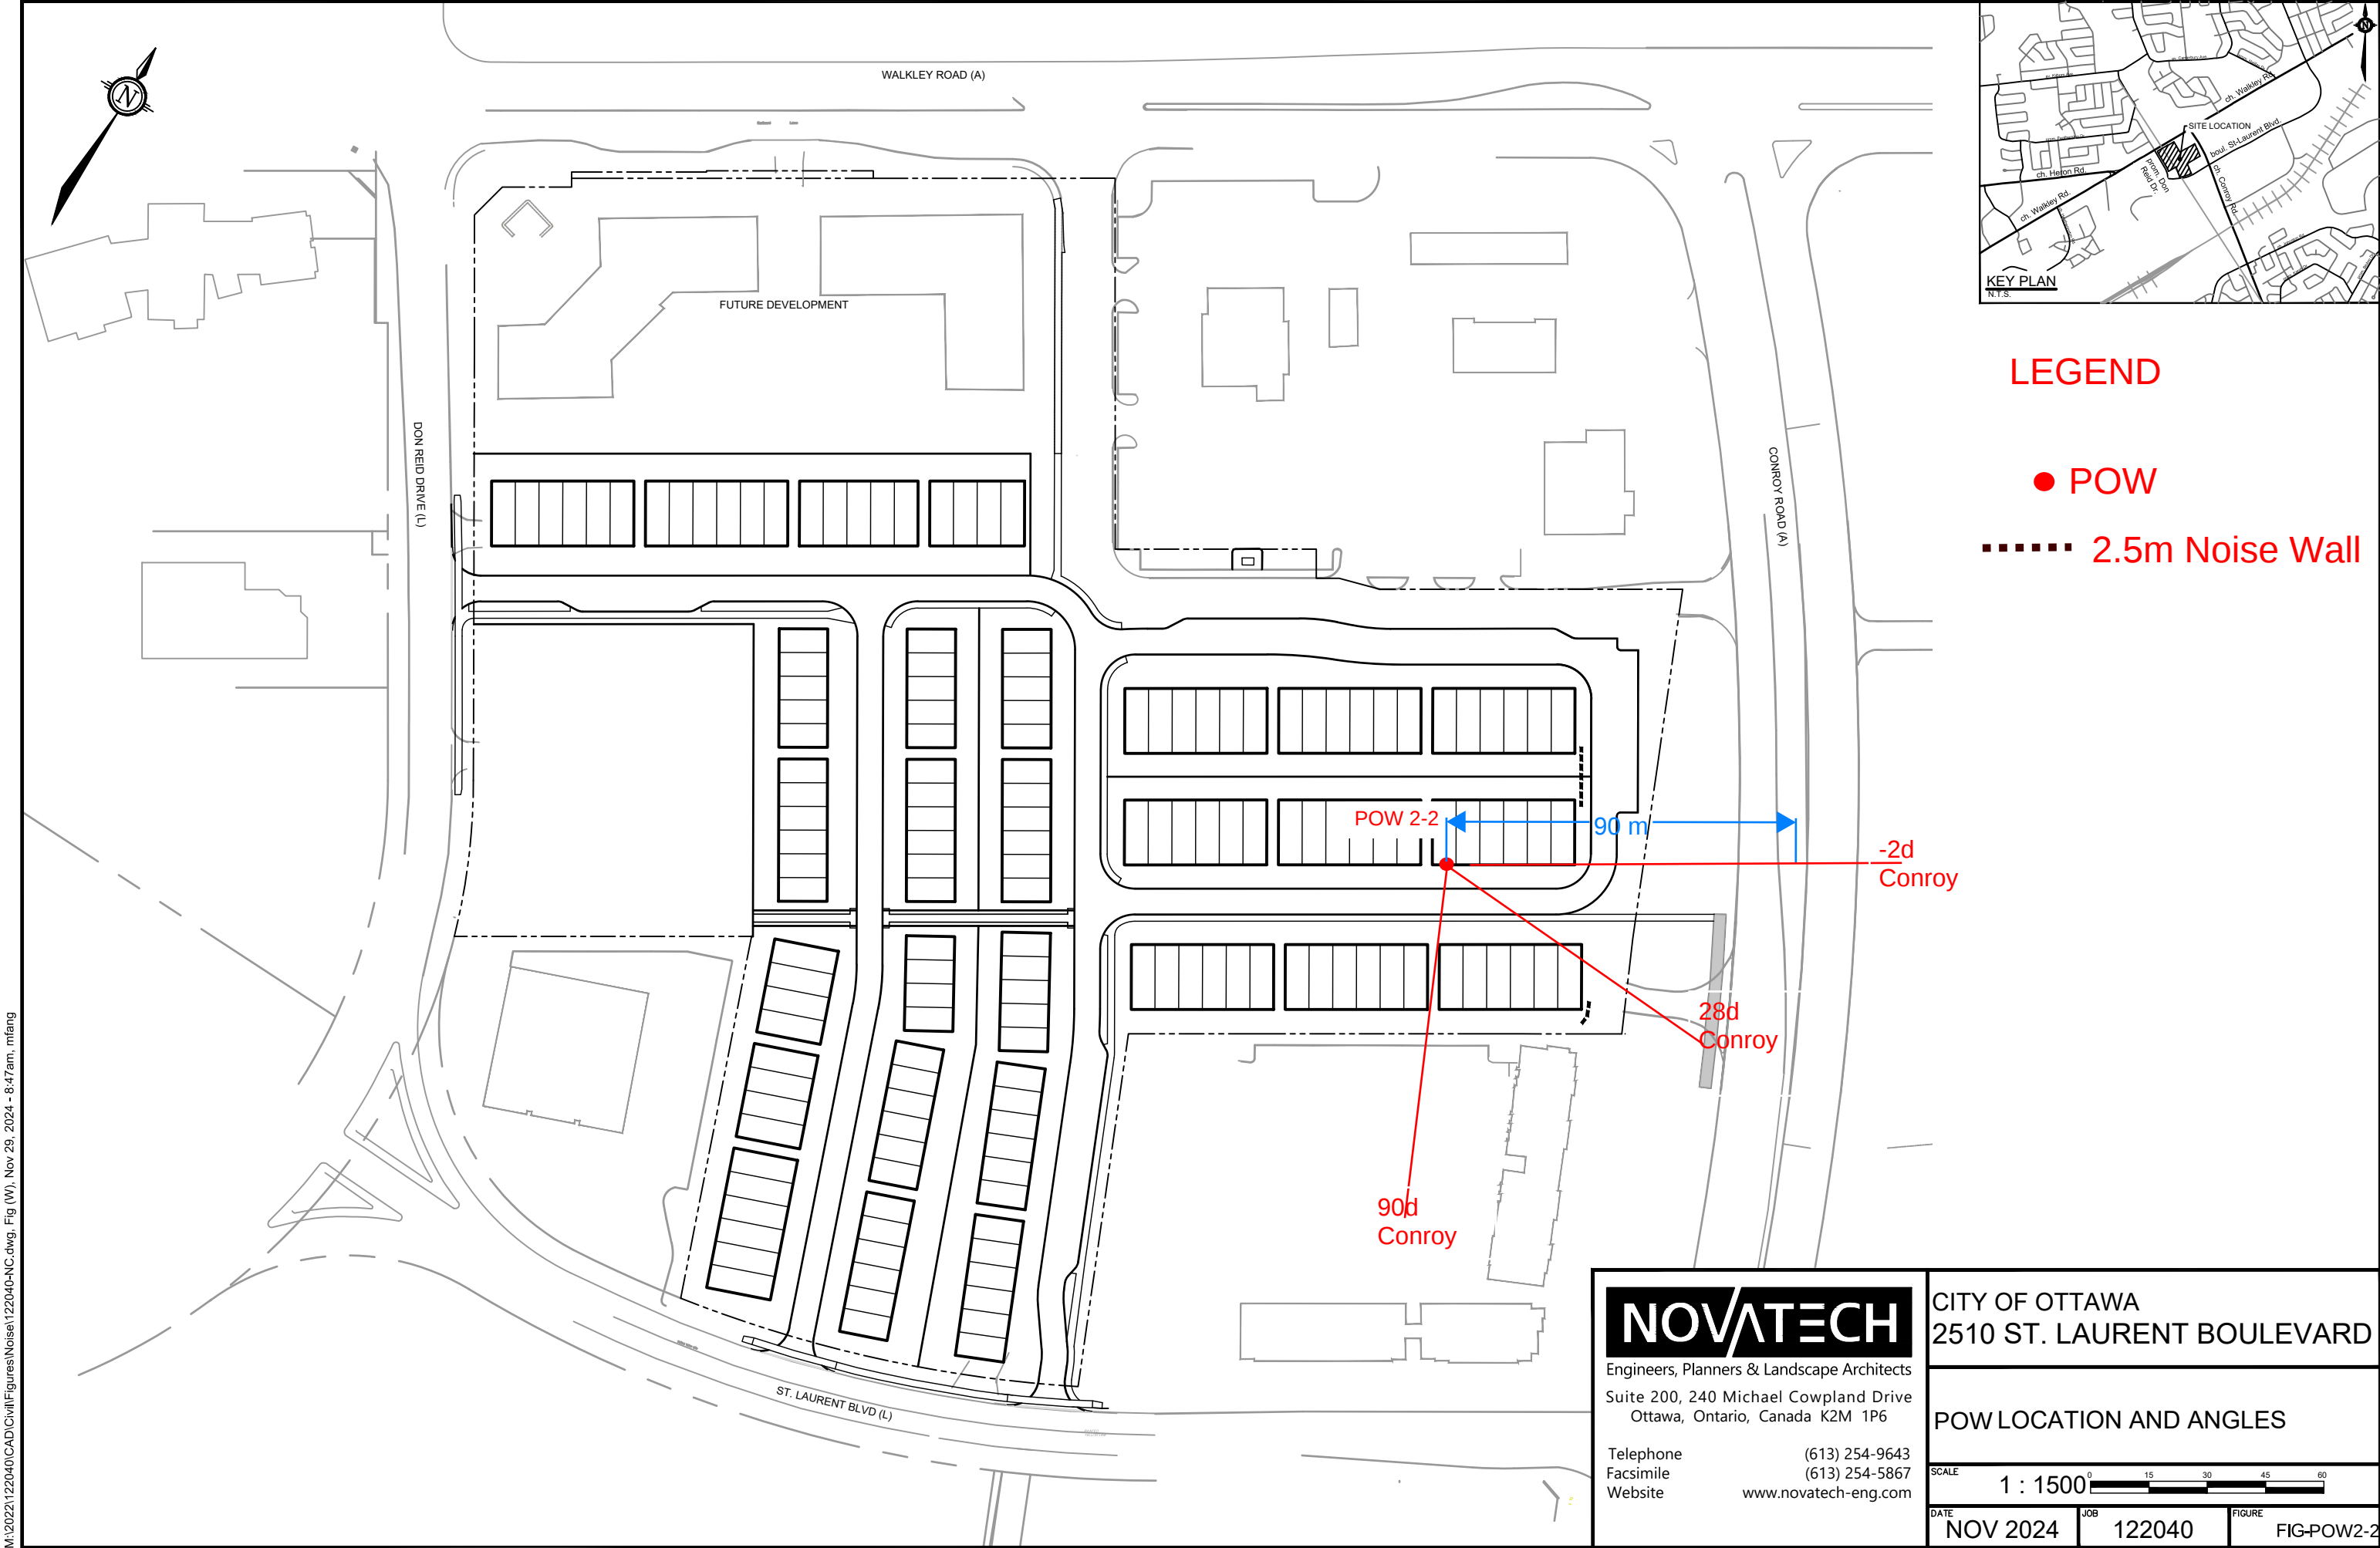


- LEGEND**
- POW
  - ..... 2.5m Noise Wall



|                                                                                                                                                                                                                                       |                                              |               |                      |
|---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|----------------------------------------------|---------------|----------------------|
| <b>NOVATECH</b><br>Engineers, Planners & Landscape Architects<br>Suite 200, 240 Michael Cowpland Drive<br>Ottawa, Ontario, Canada K2M 1P6<br><br>Telephone (613) 254-9643<br>Facsimile (613) 254-5867<br>Website www.novatech-eng.com | CITY OF OTTAWA<br>2510 ST. LAURENT BOULEVARD |               |                      |
|                                                                                                                                                                                                                                       | POW LOCATION AND ANGLES                      |               |                      |
|                                                                                                                                                                                                                                       | SCALE<br>1 : 1500                            |               |                      |
|                                                                                                                                                                                                                                       | DATE<br>NOV 2024                             | JOB<br>122040 | FIGURE<br>FIG-POW2-2 |

M:\2022\122040\CAD\Civil\Figures\Noise\122040-NC.dwg, Fig (W), Nov 29, 2024 - 8:47am, mfang

M:\2022\122040\CAD\Civil\Figures\Noise\122040-NC.dwg, Fig (W), Nov 29, 2024 - 8:47am, mfang

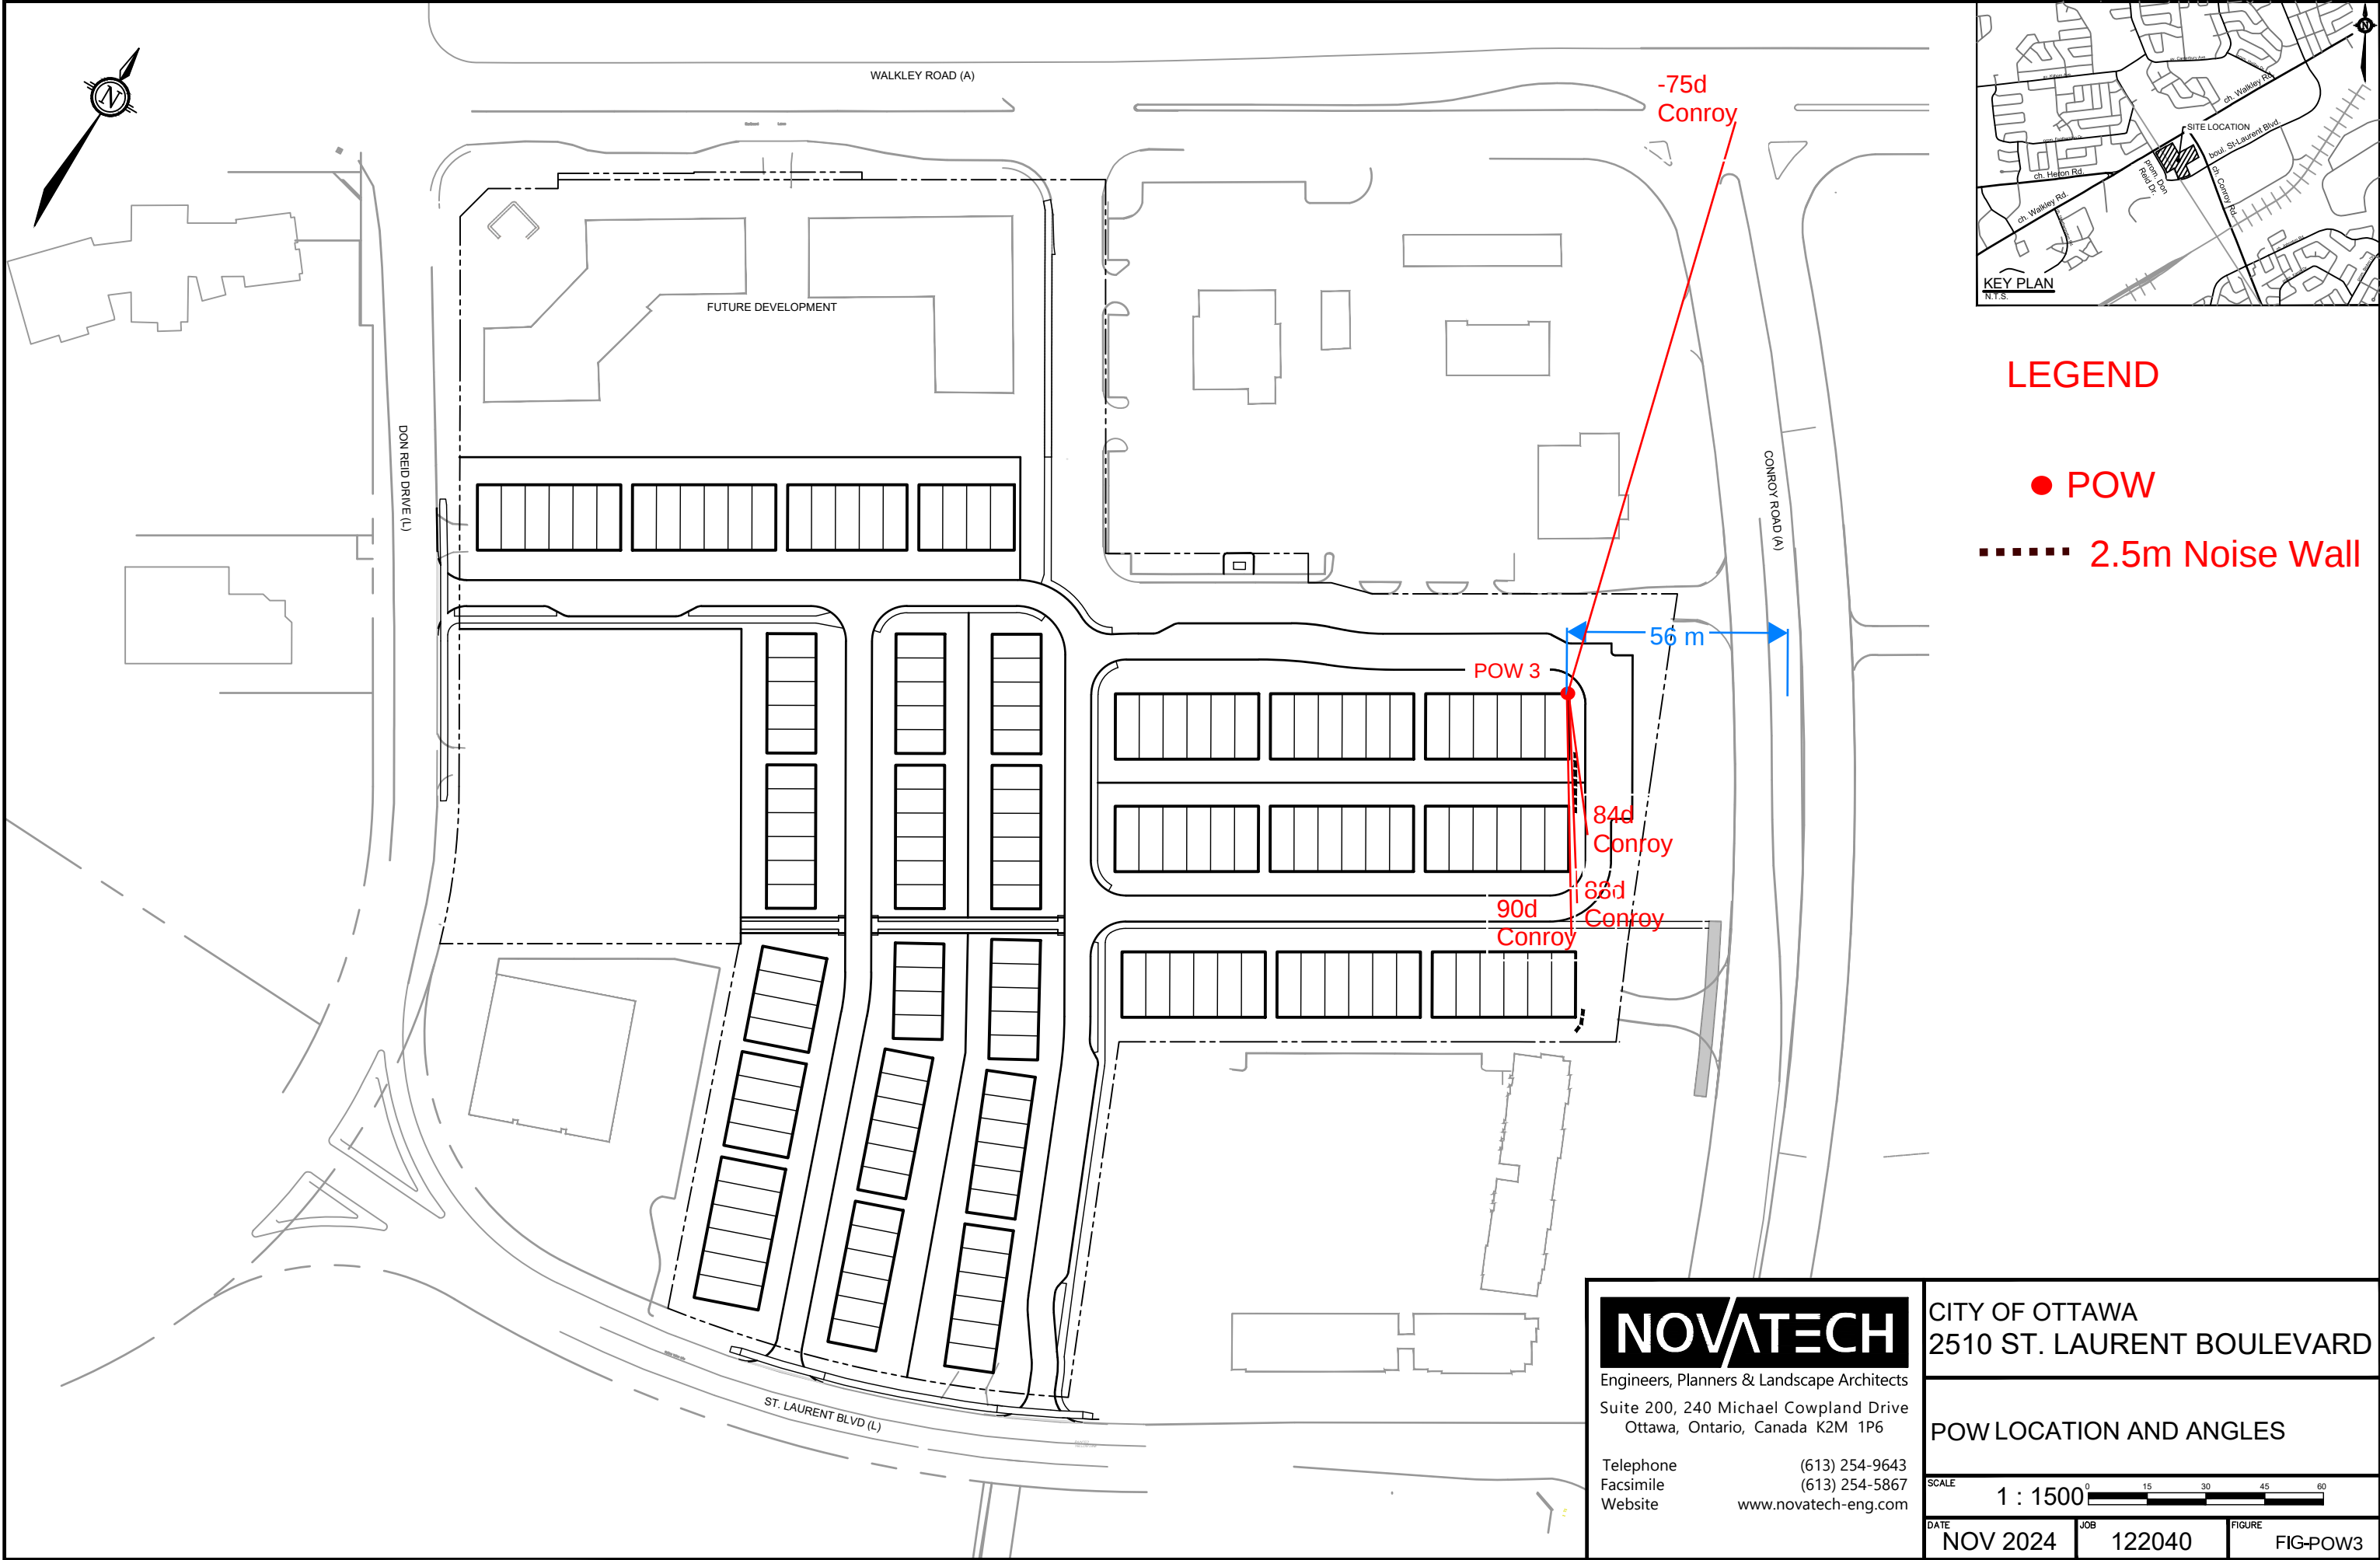

M:\2022\122040\CAD\Civil\Figures\Noise\122040-NC.dwg, Fig (W), Sep 05, 2024 - 3:35pm, mfang

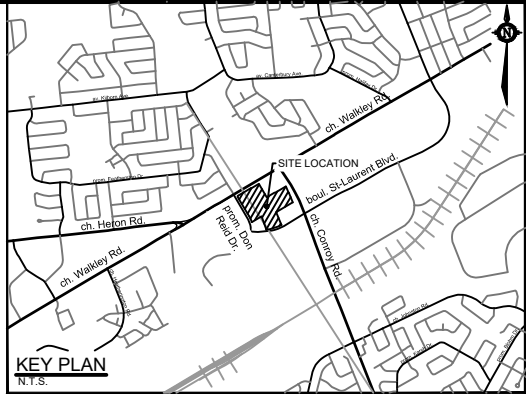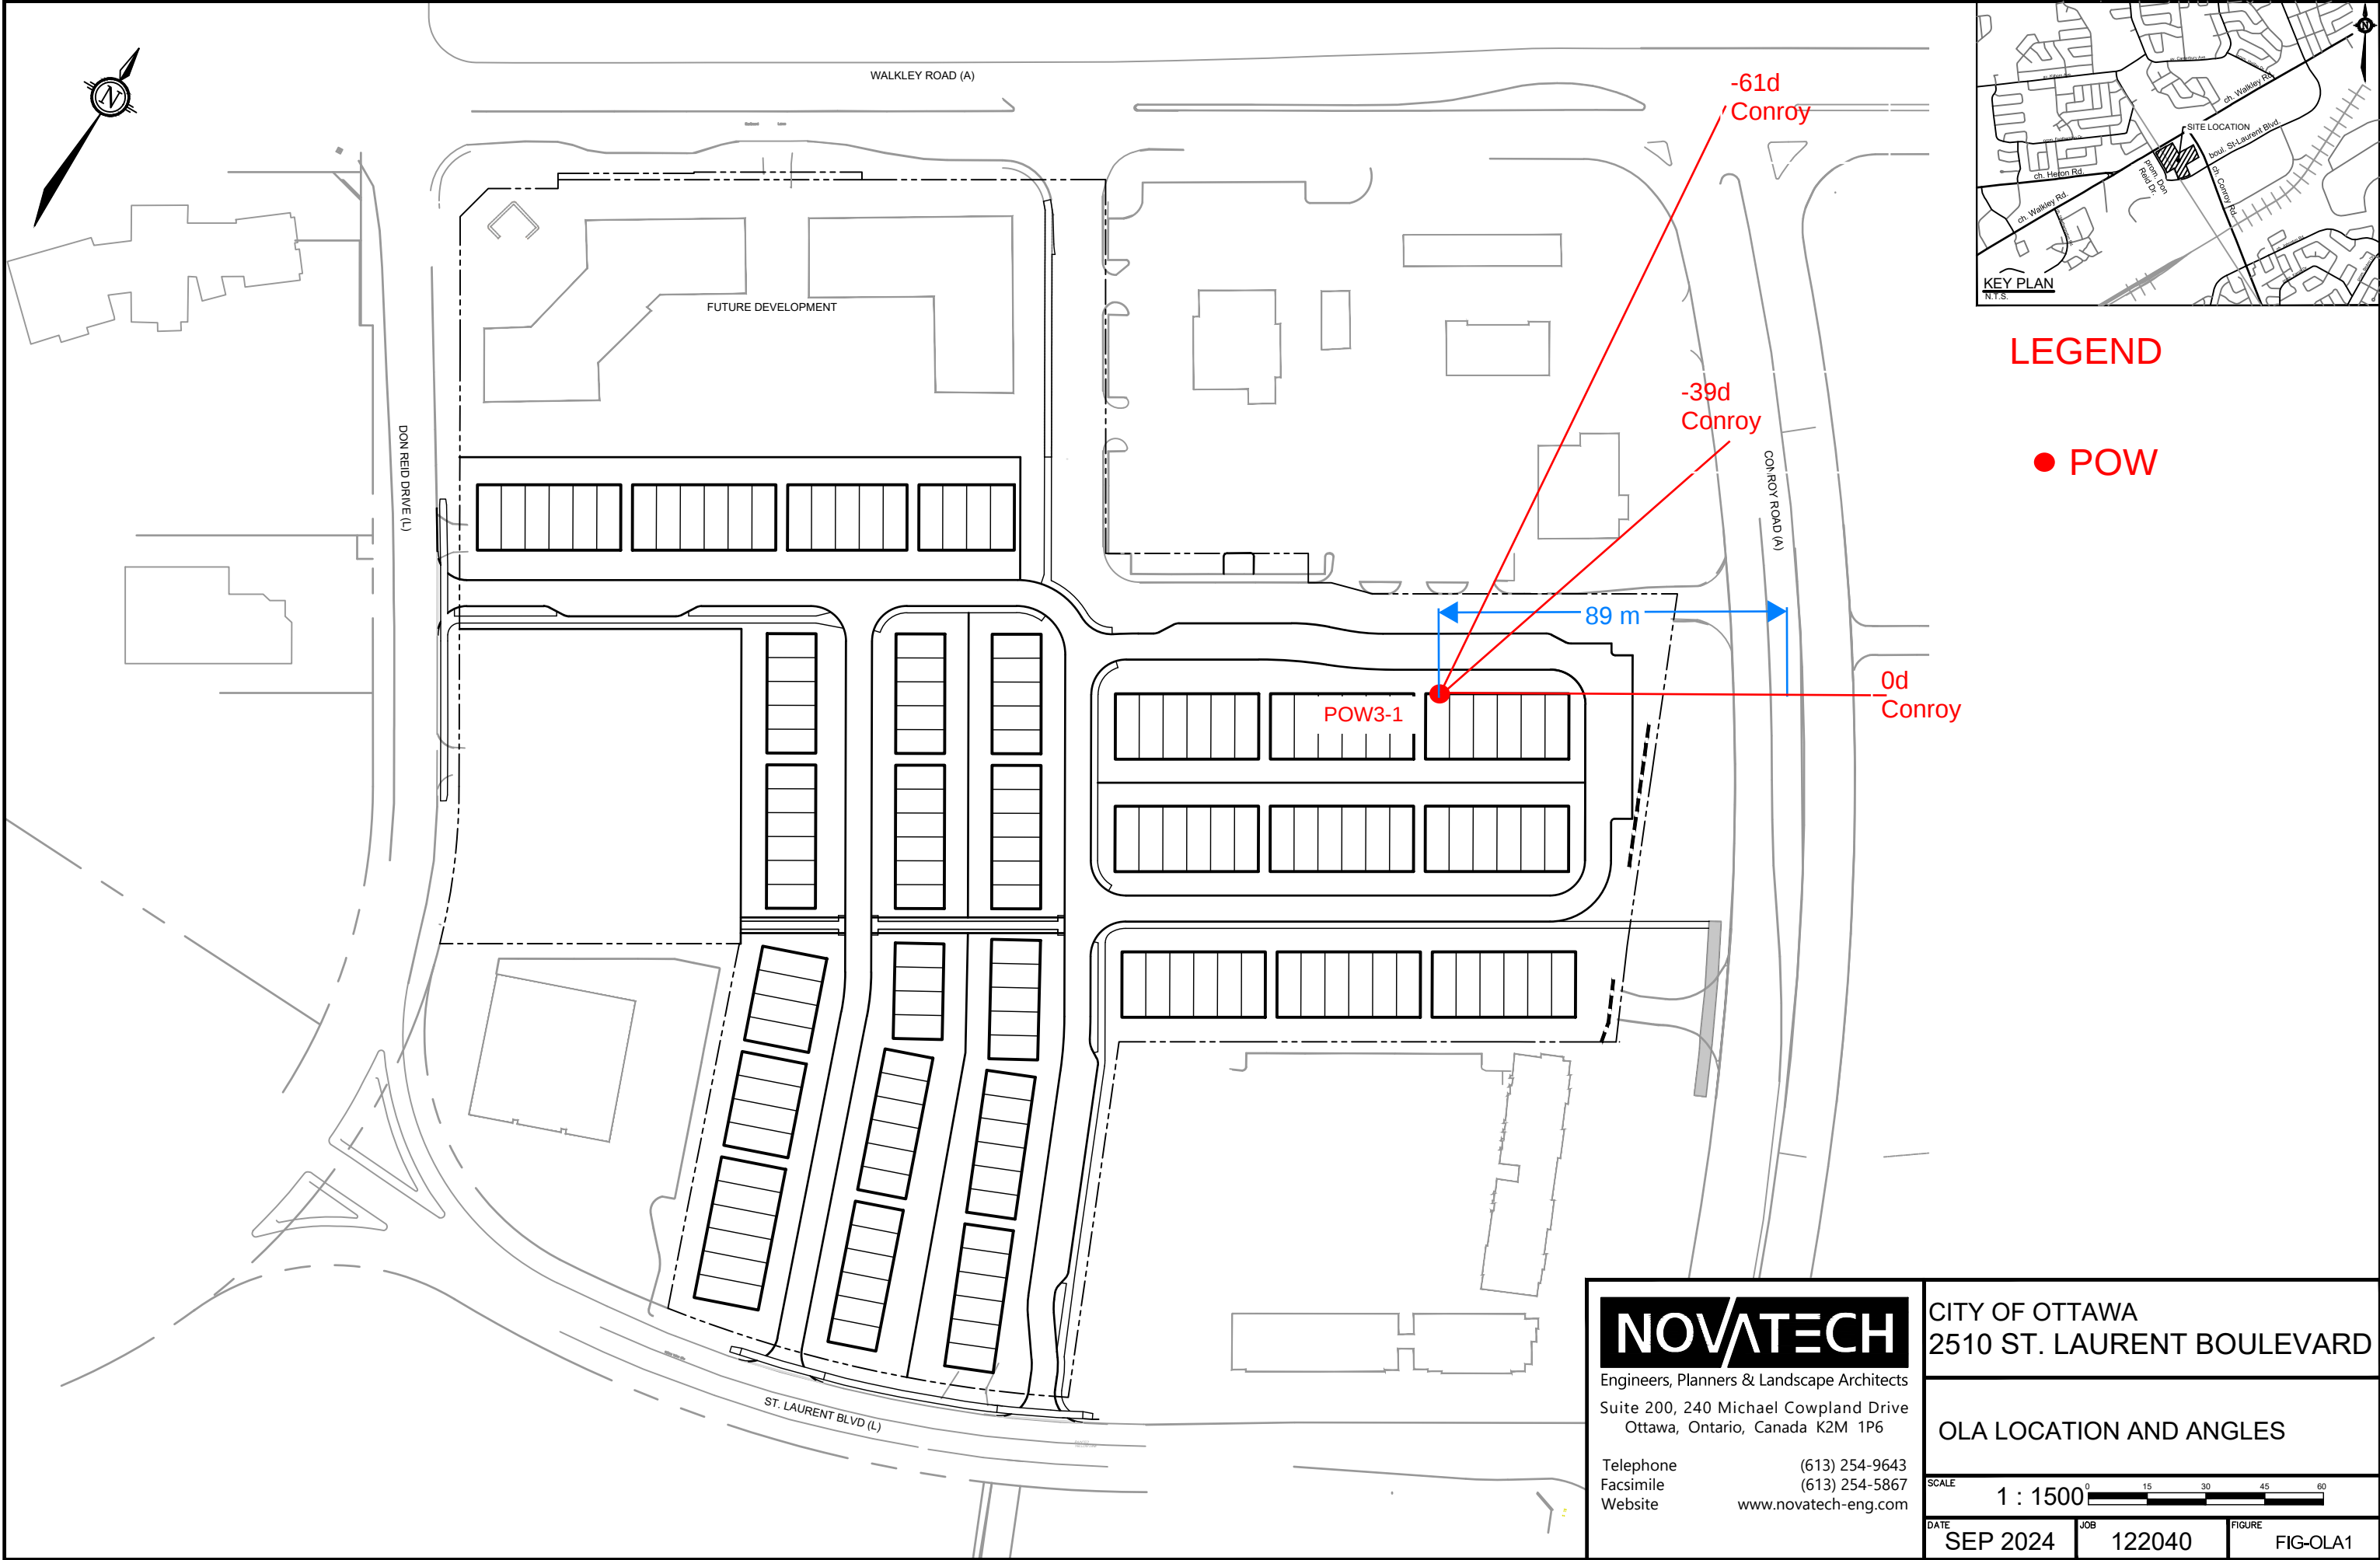


LEGEND

● POW


|                                                                                                                                                                                                                                       |                                              |               |                    |
|---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|----------------------------------------------|---------------|--------------------|
| <b>NOVATECH</b><br>Engineers, Planners & Landscape Architects<br>Suite 200, 240 Michael Cowpland Drive<br>Ottawa, Ontario, Canada K2M 1P6<br><br>Telephone (613) 254-9643<br>Facsimile (613) 254-5867<br>Website www.novatech-eng.com | CITY OF OTTAWA<br>2510 ST. LAURENT BOULEVARD |               |                    |
|                                                                                                                                                                                                                                       | OLA LOCATION AND ANGLES                      |               |                    |
|                                                                                                                                                                                                                                       | SCALE<br>1 : 1500                            |               |                    |
|                                                                                                                                                                                                                                       | DATE<br>SEP 2024                             | JOB<br>122040 | FIGURE<br>FIG-OLA1 |

M:\2022\122040\CAD\Civil\Figures\Noise\122040-NC.dwg, Fig. Jul 17, 2023 - 11:42am, mfang

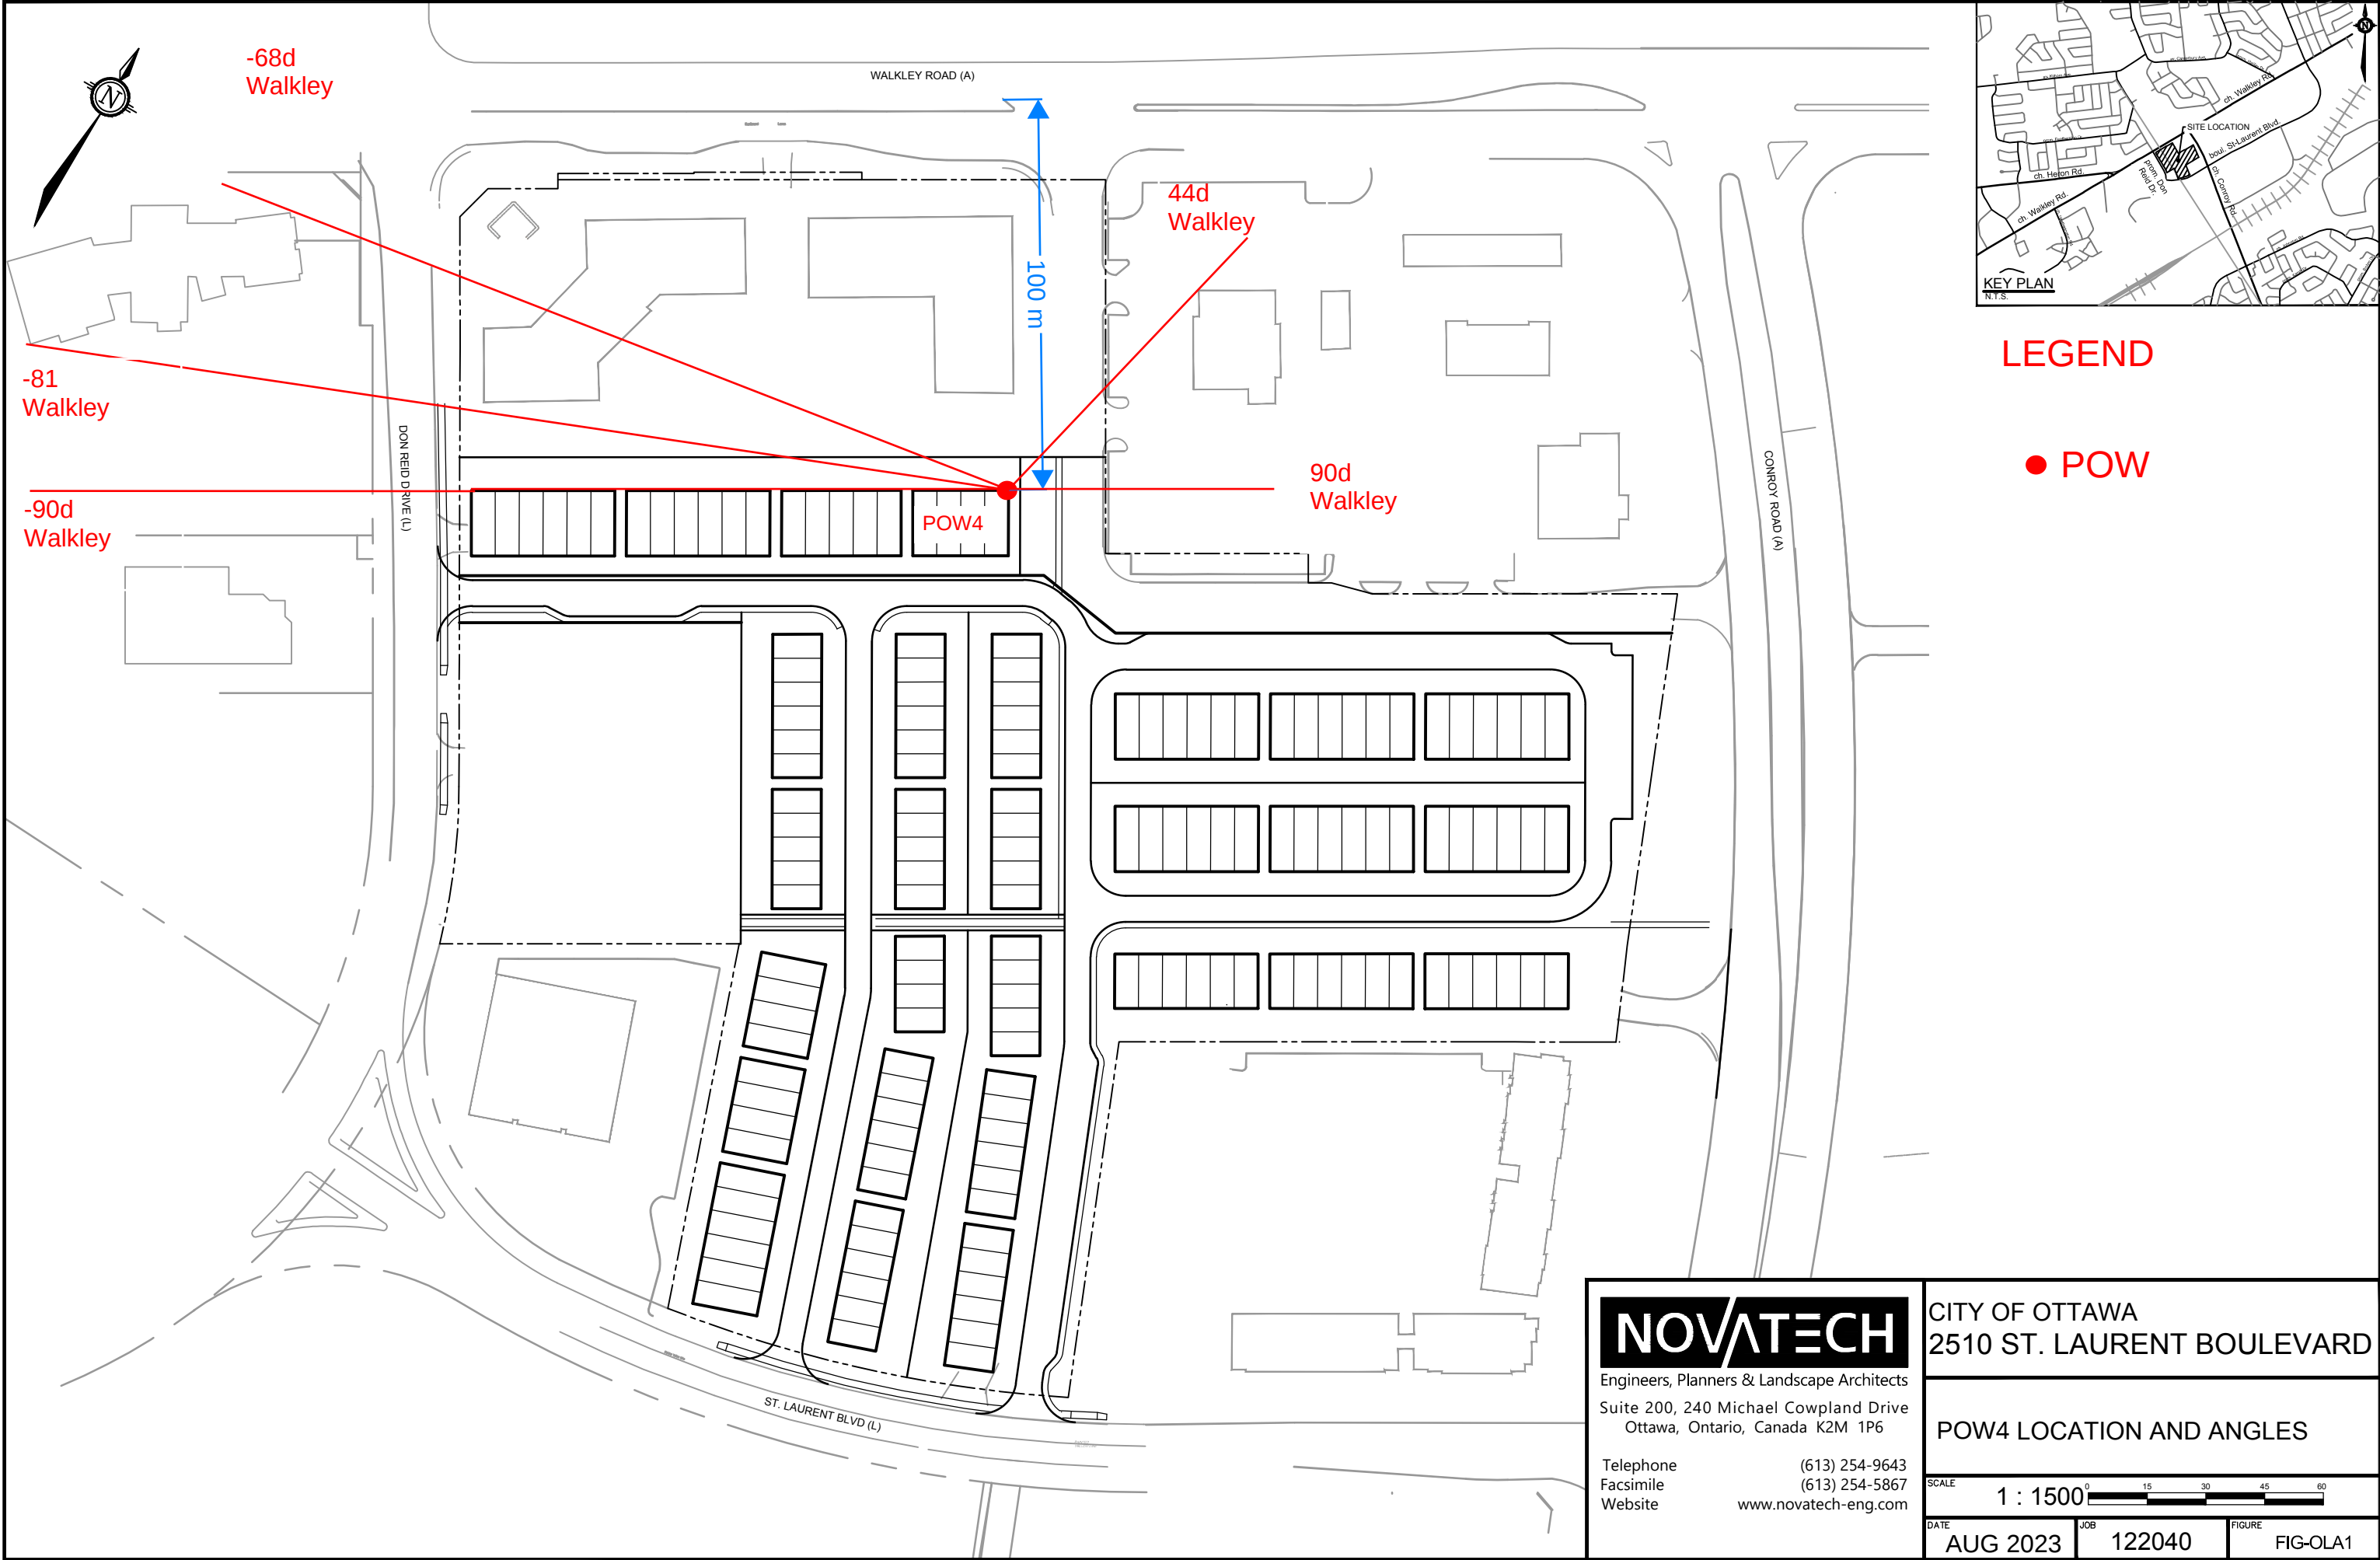

|                                                                                                                                                                                                                                   |                                              |               |                    |
|-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|----------------------------------------------|---------------|--------------------|
| <b>NOVATECH</b><br>Engineers, Planners & Landscape Architects<br>Suite 200, 240 Michael Cowpland Drive<br>Ottawa, Ontario, Canada K2M 1P6<br>Telephone (613) 254-9643<br>Facsimile (613) 254-5867<br>Website www.novatech-eng.com | CITY OF OTTAWA<br>2510 ST. LAURENT BOULEVARD |               |                    |
|                                                                                                                                                                                                                                   | POW4 LOCATION AND ANGLES                     |               |                    |
|                                                                                                                                                                                                                                   | SCALE 1 : 1500                               |               |                    |
|                                                                                                                                                                                                                                   | DATE<br>AUG 2023                             | JOB<br>122040 | FIGURE<br>FIG-OLA1 |

M:\2022\122040\CAD\Civil\Figures\Noise\122040-NC.dwg, Fig. Jul 17, 2023 - 11:42am, mfang

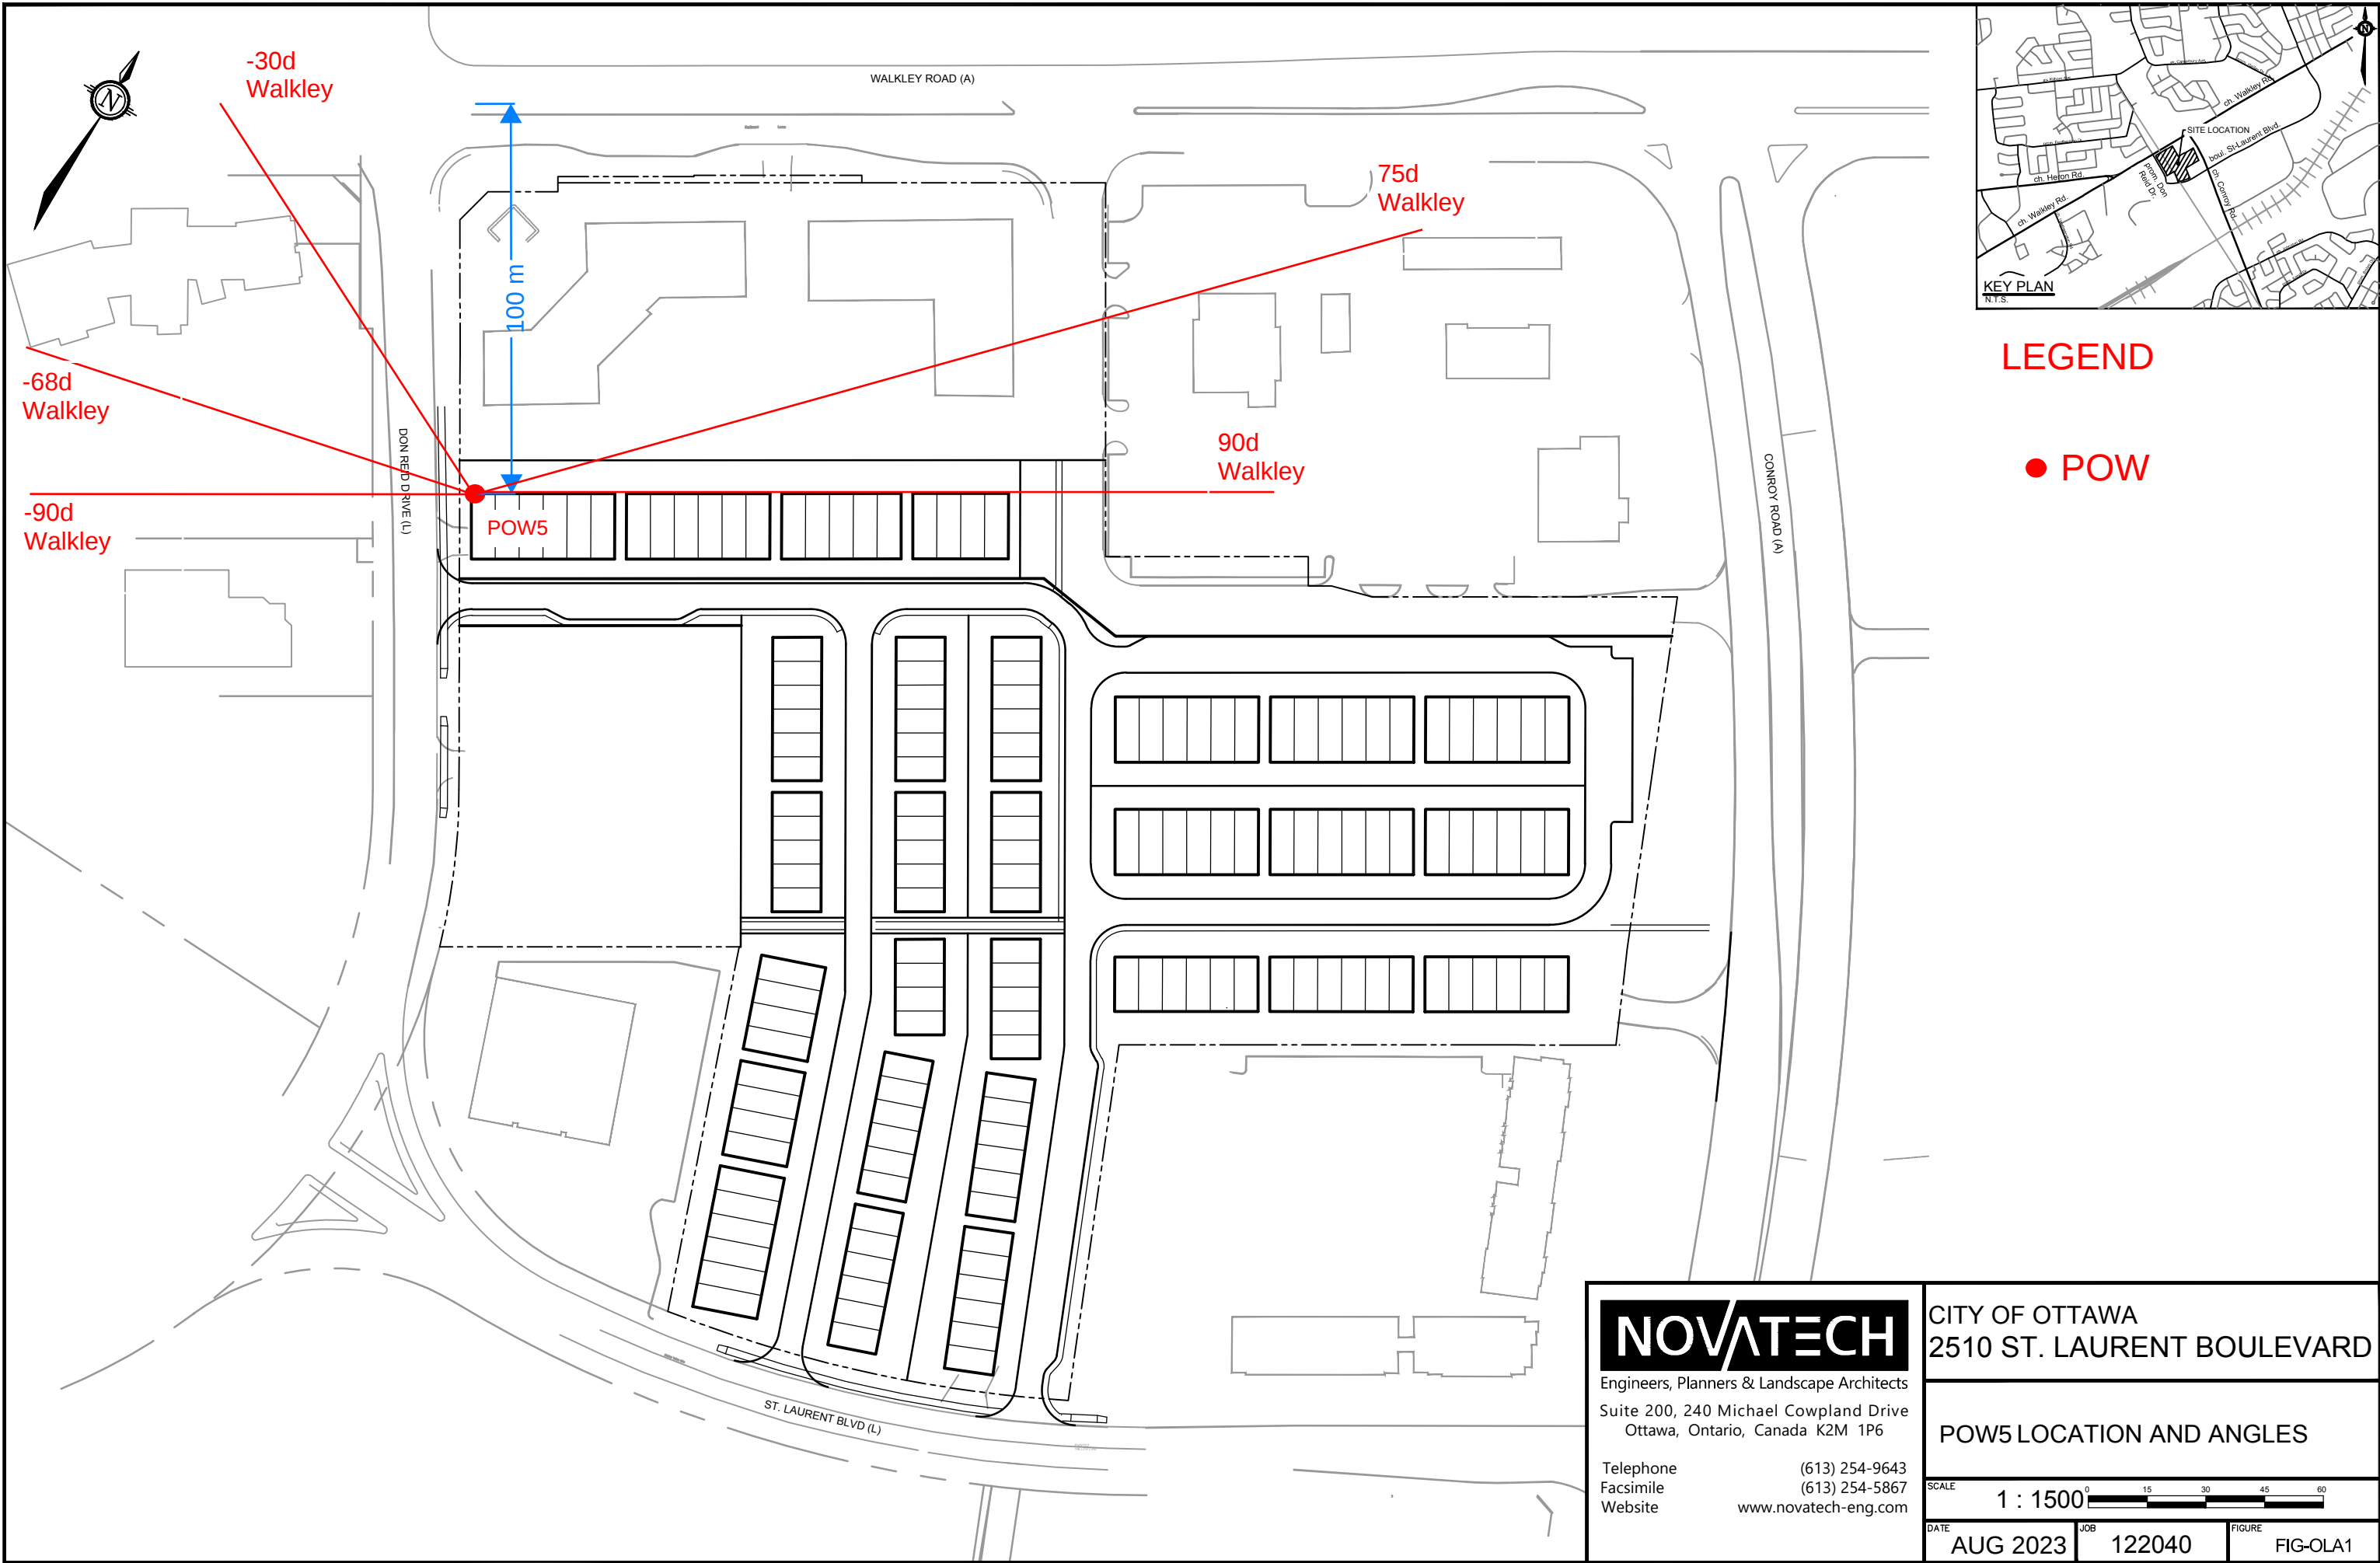

## LEGEND

● POW

**NOVATECH**

Engineers, Planners & Landscape Architects  
Suite 200, 240 Michael Cowpland Drive  
Ottawa, Ontario, Canada K2M 1P6

Telephone (613) 254-9643  
Facsimile (613) 254-5867  
Website [www.novatech-eng.com](http://www.novatech-eng.com)

CITY OF OTTAWA  
2510 ST. LAURENT BOULEVARD

### POW5 LOCATION AND ANGLES

SCALE 1 : 1500 0 15 30 45 60

DATE AUG 2023 JOB 122040 FIGURE FIG-OLA1