




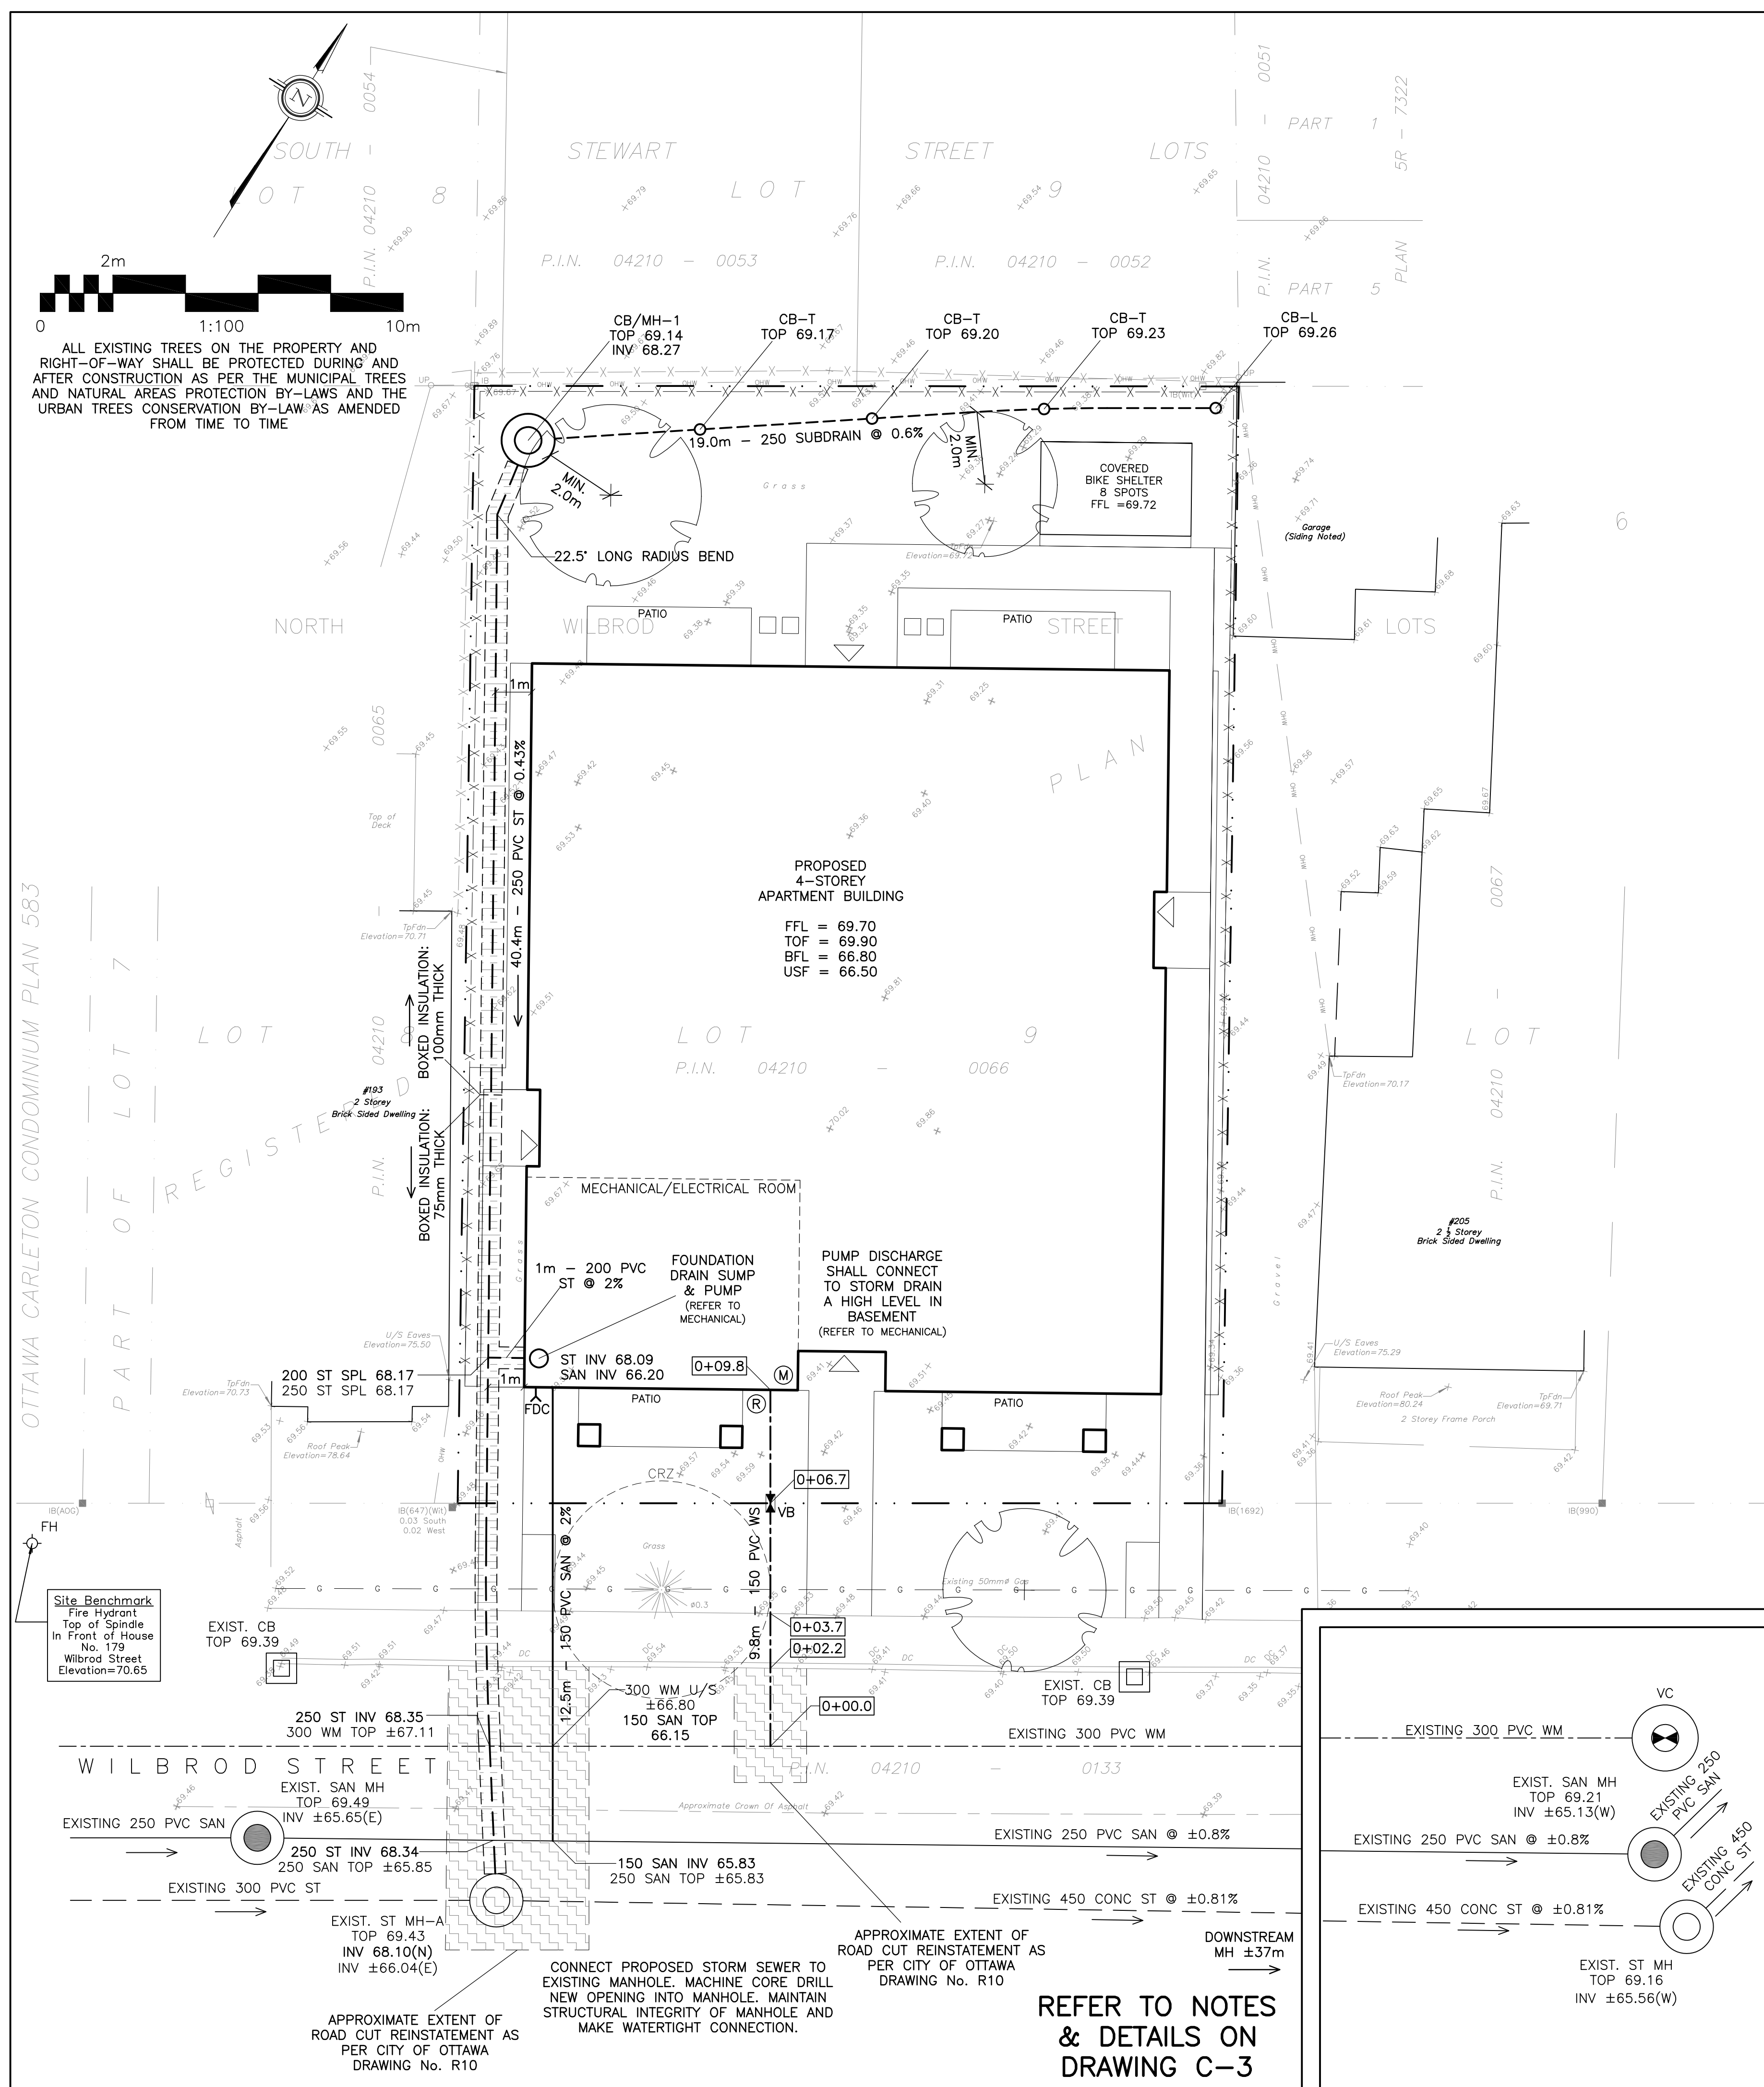


WATER SERVICE PROFILE TABLE					
MATERIAL: 150mm PVC PRESSURE CLASS 150 DR18					
STATION	DESCRIPTION	GRADE ELEVATION	TOP OF PIPE	DEPTH OF COVER	NOTES
0+00.0	300mm x 150mm TEE CONNECTION IN 300mm MUNICIPAL WATERMAIN TO CITY OF OTTAWA STANDARDS	±69.44	±67.04	±2.40	-
0+02.2	-	±69.44	67.04	±2.40	BOTTOM OF CURB
0+03.7	-	±69.55	67.04	±2.51	BACK OF SIDEWALK
0+06.7	150mm VALVE & VALVE BOX TO CITY OF OTTAWA STANDARDS	69.62	67.04	2.58	ON PROPERTY LINE
0+09.8	-	69.67	67.04	2.63	ENTRY INTO BUILDING

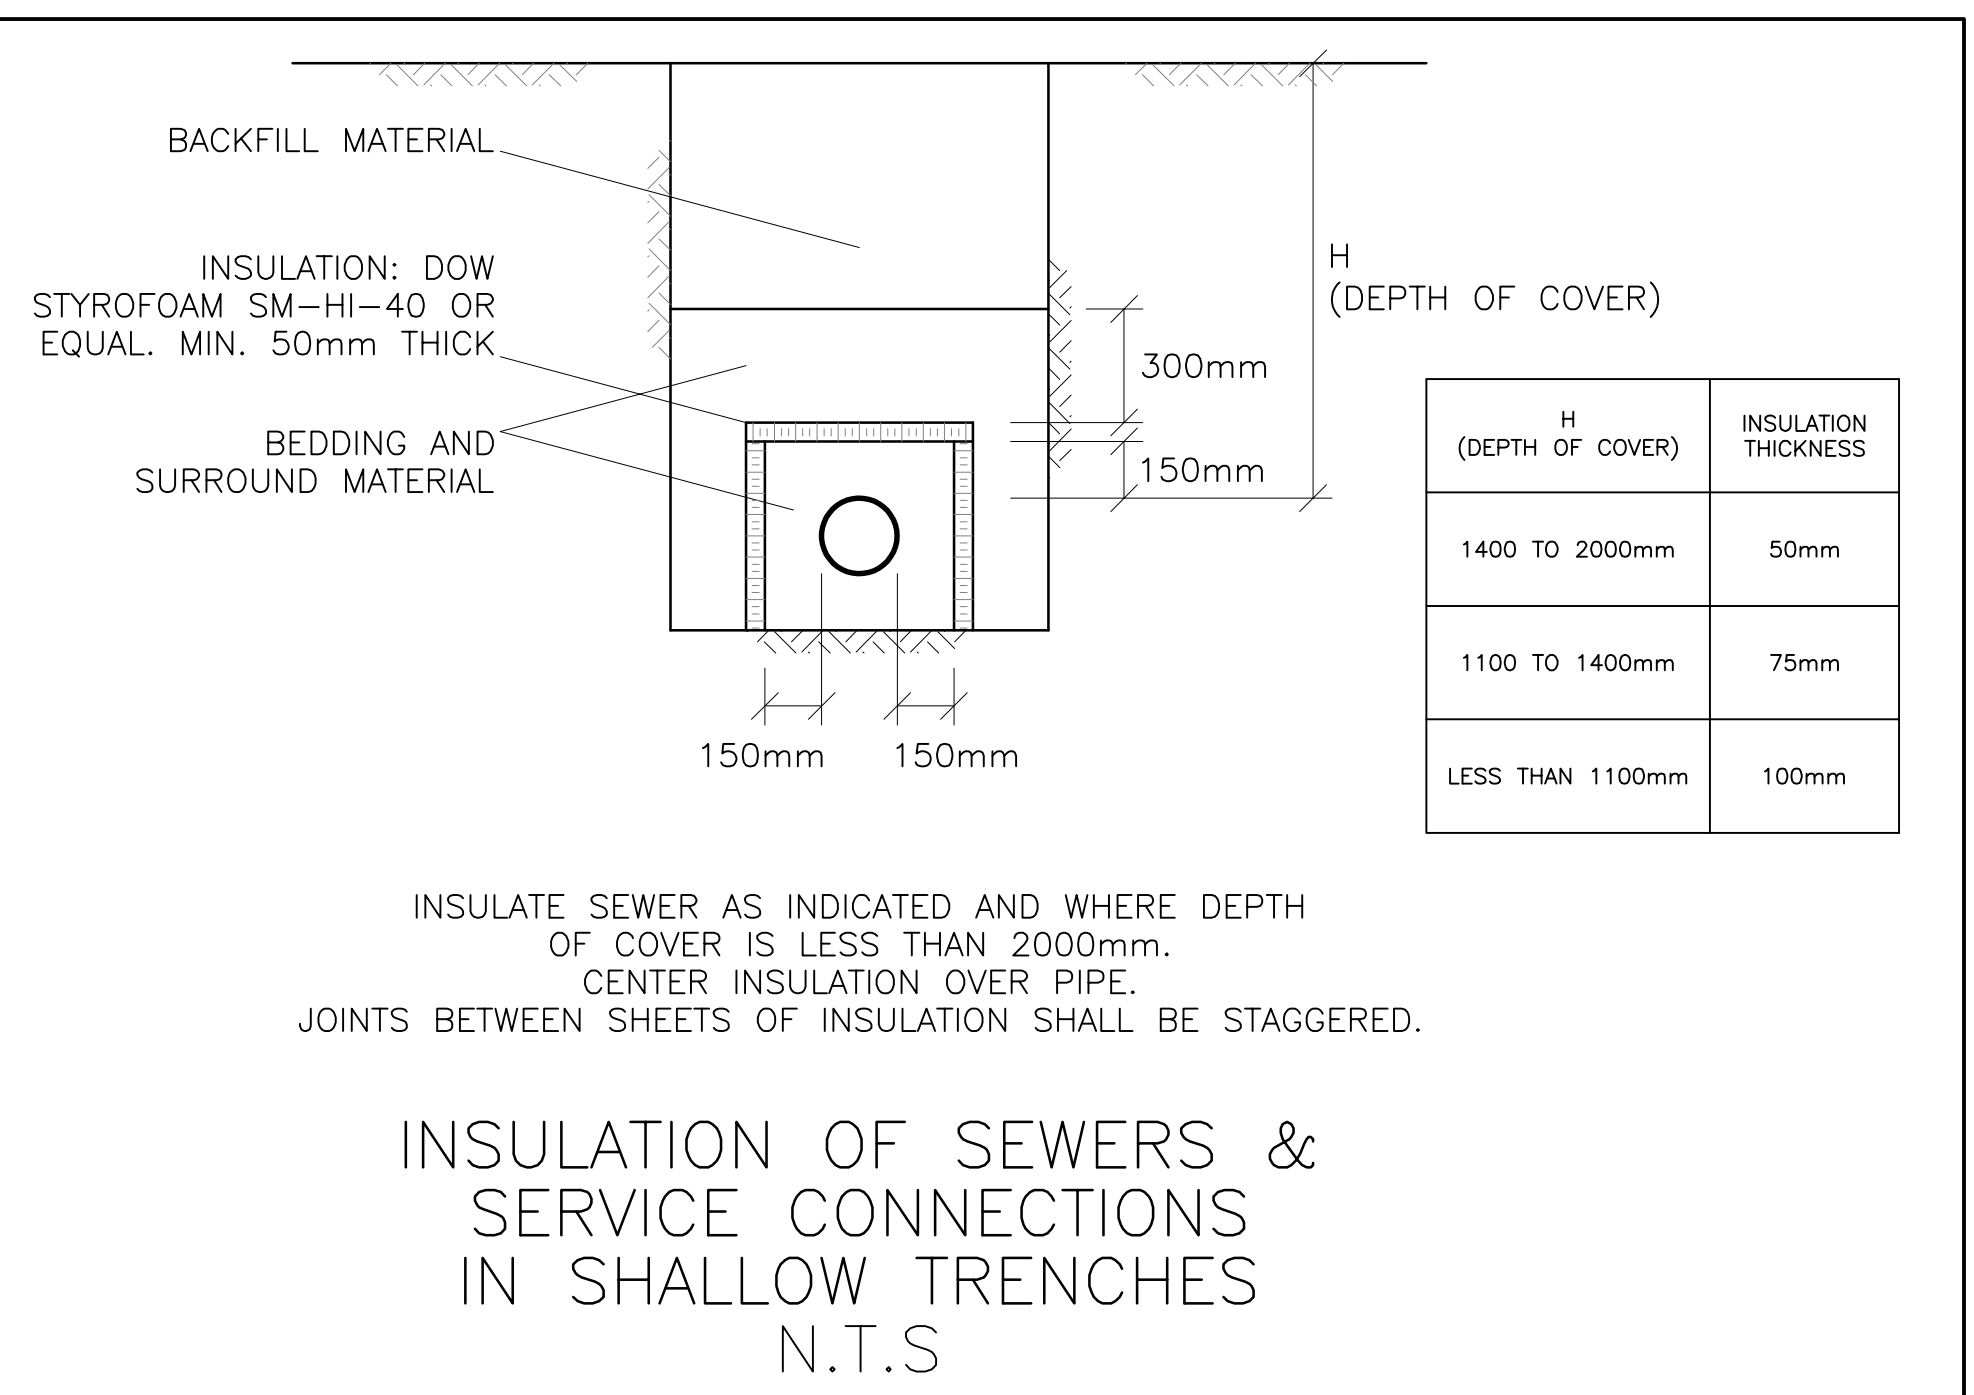

CATCH BASIN & MANHOLE SCHEDULE						
REF	TOP	SIZE	TYPE	INVERT AT INLET	INVERT AT OUTLET	NOTES
STORM SEWER						
CB/MH-1	69.20	1200mm	PRE-CAST CONCRETE CATCH BASIN / MANHOLE	-	68.27	TO OPSD 701.010 & CITY OF OTTAWA STANDARDS - FRAME & COVER TO CITY OF OTTAWA DRAWING No. S25 & S28.1 OR OPSD 401.010

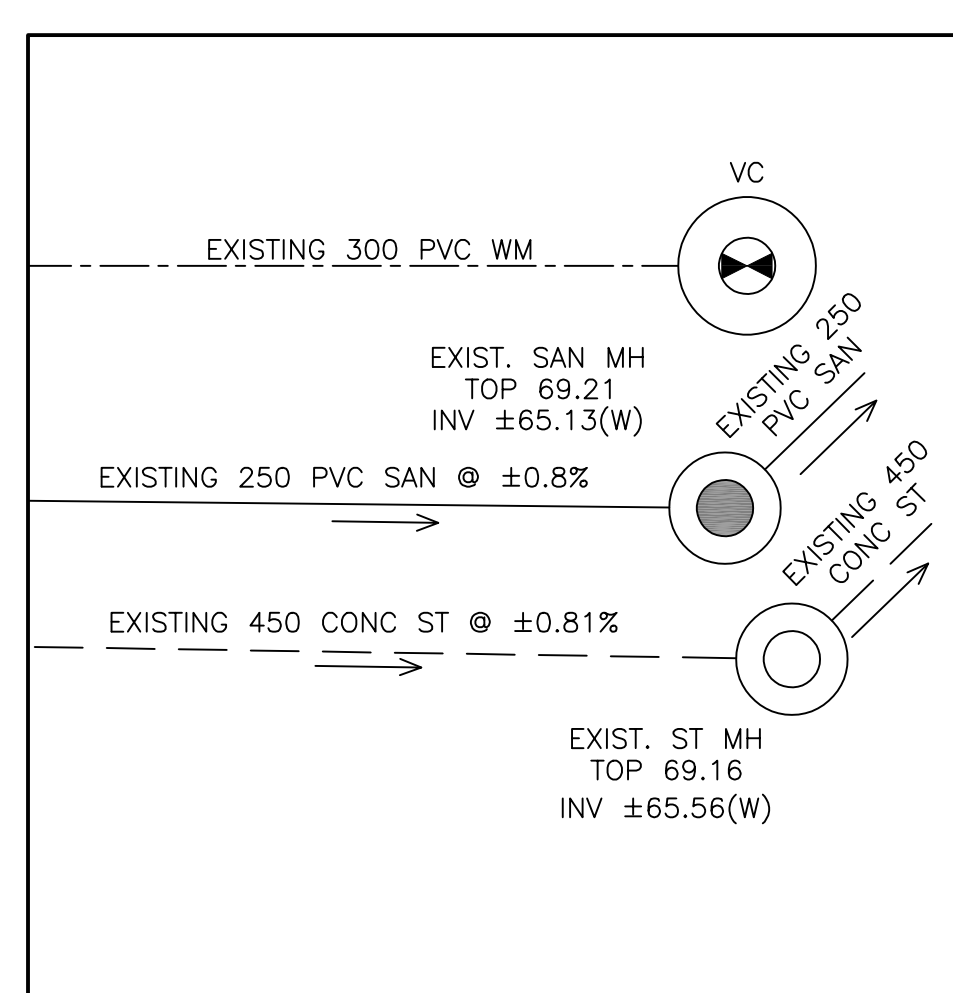

LEGEND	
CB	CATCH-BASIN
MH	STORM MANHOLE
CB/MH	CATCH-BASIN/MANHOLE
MH	SANITARY MANHOLE
VC	VALVE CHAMBER
VB	VALVE & VALVE BOX
FH	FIRE HYDRANT
FDC	FIRE DEPARTMENT CONNECTION
SAN	SANITARY SEWER
ST	STORM SEWER
WS/WM	WATER SERVICE/WATERMAIN
SPL	SPRINGLINE OF PIPE
INV	INVERT OF PIPE
M	WATER METER
R	REMOTE WATER METER
FFL	FINISHED FLOOR ELEVATION
TOF	TOP OF FOUNDATION
BFL	BASEMENT FLOOR ELEVATION
USF	UNDERSIDE OF FOOTING
- - - -	PROPERTY LINE
C.R.Z.	CRITICAL ROOT ZONE
	ROAD CUT REINSTATEMENT

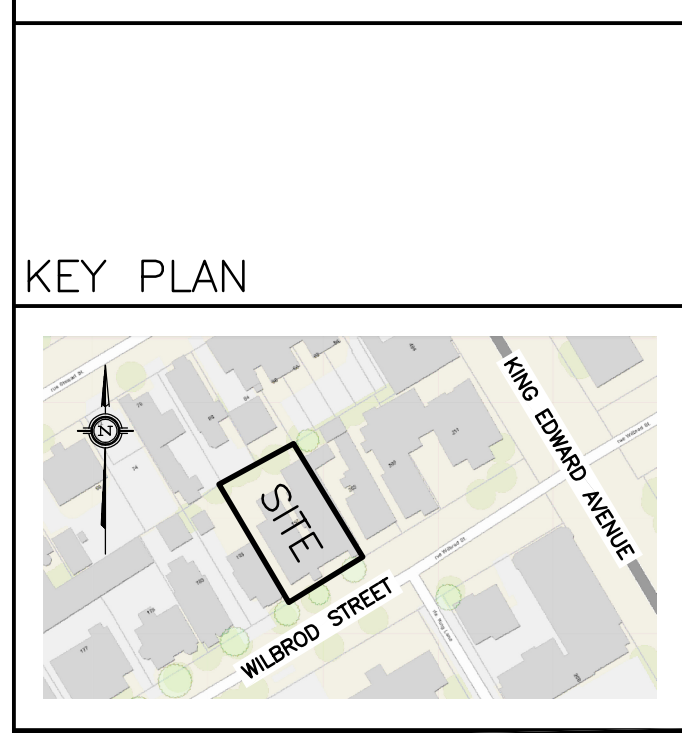

No.	DATE	REVISION
2	DEC 21-21	ISSUED FOR APPROVAL
1	DEC 17-21	ISSUED FOR COORDINATION

D. B. GRAY ENGINEERING INC.
Stormwater Management - Grading & Drainage - Storm & Sanitary Sewers - Watermain
700 Long Point Circle
Ottawa, Ontario
613-425-8044
d.gray@dbgrayengineering.com

Project
PROPOSED 4-STOREY APARTMENT BUILDING
197-201 WILBROD STREET
OTTAWA, ONTARIO

Drawing Title
SITE SERVICING PLAN

Engineer's Seal
REGISTERED PROFESSIONAL ENGINEER
D.B. GRAY
DEC 21-21
PROVINCE OF ONTARIO
NOT VALID UNLESS SIGNED & DATED

Drawn
H. Scale
V. Scale
Date
Job No.

D.B.G.
1:100
DEC 17-21
21057

Drawing No.
C-1
of 4