

Report
Project: 139185-6.04.03

1650 SHEA ROAD SERVICING BRIEF



Prepared for Davidson Co-Tenancy (Tartan Land Corporation)
by Arcadis Professional Services (Canada) Inc.

July 2025

Document Control Page

CLIENT:	Davidson Co-Tenancy
PROJECT NAME:	Project: 139185 - 6.04.03
REPORT TITLE:	1650 SHEA ROAD
IBI REFERENCE:	Project: 139185-6.04.03
VERSION:	
DIGITAL MASTER:	[File Location]
ORIGINATOR:	[Name]
REVIEWER:	[Name]
AUTHORIZATION:	[Name]
CIRCULATION LIST:	
HISTORY:	

Table of Contents

1	INTRODUCTION	1
1.1	Guidelines and Standards.....	1
1.2	Pre-Consultation Meeting	1
1.3	Environmental Issues.....	2
1.4	Geotechnical Concerns.....	2
1.5	Hydro One Networks Inc. Transmission Corridor	2
2	WATER DISTRIBUTION	3
2.1	Existing Conditions	3
2.2	Design Criteria	3
2.2.1	Water Demands	3
2.2.2	System Pressures	3
2.2.3	Fire Flow Rate.....	4
2.2.4	Boundary Conditions.....	4
2.2.5	Hydraulic Model	4
2.3	Proposed Water Plan.....	4
2.3.1	Hydraulic Analysis.....	4
2.3.2	Summary of Results.....	5
3	WASTEWATER.....	6
3.1	Existing Conditions	6
3.1.1	Verification of Existing Sanitary Sewer Capacity	6
3.2	Proposed Sewers.....	6
3.2.1	Design Flow:	6
3.2.2	Population Density:	6
4	MINOR STORM SEWERS	7
4.1	Existing Conditions	7
4.2	Serviceability Report	7
4.3	Design Criteria	7
4.4	Proposed Minor Storm Plan.....	8
4.5	Sewer Calculations	8
4.6	Hydro One Corridor Dry Pond	8
4.7	External Conveyance.....	8
4.7.1	Existing Drainage Feature.....	8

	4.7.2	Shea Road Roadside Ditch.....	8
5		STORMWATER MANAGEMENT	9
	5.1	Background.....	9
	5.2	Objective.....	9
	5.3	System Concept.....	10
		5.3.1 Scope	10
		5.3.2 Dual Drainage Design.....	10
	5.4	Stormwater Evaluation.....	10
		5.4.1 Hydrological Evaluation	10
		5.4.2 Results of the Hydrological Evaluation	14
		5.4.3 Hydraulic Evaluation.....	16
		5.4.4 Results of Hydraulic Evaluation	16
	5.5	Summary of Model Output Files	18
	5.6	MUSF and MGG	19
6		SOURCE CONTROLS	19
	6.1	General	19
	6.2	Lot Grading	19
	6.3	Roof Leaders	19
	6.4	Vegetation.....	19
7		CONVEYANCE CONTROLS	20
	7.1	General	20
	7.2	Catchbasins	20
8		SEDIMENT AND EROSION CONTROL PLAN	21
	8.1	General	21
	8.2	Trench Dewatering.....	21
	8.3	Bulkhead Barriers	21
	8.4	Seepage Barriers.....	21
	8.5	Surface Structure Filters	21
	8.6	Stockpile Management	22
9		ROADS AND NOISE ATTENUATION.....	23
	9.1	Aircraft Sound Levels.....	23
10		SOILS	24
11		RECOMMENDATIONS	25

List of Tables

Table 2.1: Summary of Boundary Conditions	4
Table 2.2: Results of Hydraulic Analysis	5
Table 5.1: Hydrological Parameters	13
Table 5.2: Allowable Peak Flows	14
Table 5.3: Summary of Cascading Flow during the 100 year 3 hour Chicago Storm	15
Table 5.4: Summary of Cascading Flow during the 100 year 3 hour Chicago Storm + 20%	15
Table 5.5: Storm HGL Elevations	16
Table 5.6: Functioning of the Dry Pond	18

List of Appendices

APPENDIX A

139185-001	City of Ottawa Pre-Consultation Meeting Notes STANTEC Plan of Subdivision for the Davidson Lands Phase 2 Site Plan for 1650 Shea Road 2024-03-26 Revised Block 10 Site Plan 2024-08-12 General Plan of Services
------------	---

APPENDIX B

	Ontario Building Code Calculations and Tables Boundary Conditions Water Demand Calculation Sheet Fire Flow Calculations Water Distribution Model
--	--

APPENDIX C

139185-400	Sanitary Sewer Design Sheet Sanitary Drainage Plan Davidson Lands Phase 2 Sanitary Design Sheet Davidson Lands Phase 2 Sanitary Drainage Area Plan
------------	---

APPENDIX D

139185-500	Storm Sewer Design Sheet
139185-600	Storm Drainage Plan Ponding Plan

139185-700	Davidson Lands Phase 2 Storm Design Sheet Davidson Lands Phase 2 Storm Drainage Area Plan Temporary Orifice Sizing Sample Runoff Coefficient Calculations Figure 4.1 Existing Minor Storm Plan – Design Brief Davidson Lands- OPA 76 Area 6a Phase 2 Figure 4.2 Proposed Minor Storm Plan – Design Brief Davidson Lands- OPA 76 Area 6a Phase 2 DDSWMM Drainage Area Plan Schematic 2025-03-19 Velocity x Depth Calculations Results of Hydraulic Grade Line Evaluation Davidson Lands Phase 1&2 Overall Storm Drainage Plan Davidson Lands Phase 1&2 Overall Ponding Plan Design Criteria for Future Development Areas - Design Brief Davidson Lands-OPA 76 Area 6a Phase 2 Summary Table for Storages – Flows to Cosanti at Outlet to Dry Pond Velocity x Depth Calculation – Davidson Lands Phase 2
------------	--

APPENDIX E


139185-900	Erosion and Sediment Control Plan
139185-200	Grading Plan

1 INTRODUCTION

1650 Shea Road is located in the north-eastern portion of the Davidson Lands Development Area (DLDA) and is a block within the Davidson Lands subdivision. Arcadis Professional Services (Canada) Inc. (formerly IBI Group) has been retained by Davidson Co-Tenancy to provide professional engineering services for 1650 Shea Road. The parcel area is 2.06Ha. The subject site is approximately 2.30 ha and consists of 118 townhouse units. The site area is inclusive of 0.24Ha of private road located within the HydroOne Networks Inc. (HONI) corridor.

The site consists of freehold frontage onto 8.5m and 6.0m wide private lanes. There will be a Common Elements Agreement in place for the shared elements of the site.

1650 Shea Road is bounded by Shea Road to the North-East, Cosanti Drive to the South-East, Dry pond to the South-West and agricultural to the North-West. Refer to key plan below for block location.

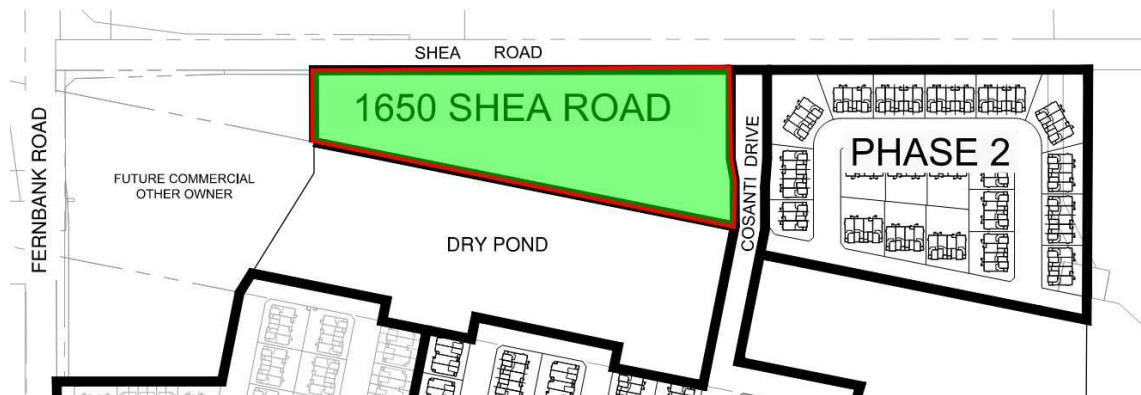

The proposed servicing design conforms to the current City of Ottawa and MECP design criteria, and no pre-consultation meetings were requested from the South Nation Conservation (SNC) or the Ontario Ministry of Environment, Conservation and Parks (MECP).

1.1 Guidelines and Standards

This evaluation takes into consideration the City of Ottawa Sewer Design Guidelines (OSDG) (October 2012), and the February 2014 Technical Bulletin ISDTB-2014-01, the September 2016 Technical Bulletin PIEDTB-2016-01, the June 2018 Technical Bulletin ISTB-2018-04, October 2019 Technical Bulletin 2019-01, and the July Technical Bulletin 2019-02.

It also considers the City of Ottawa Water Distribution Design Guidelines (OWDDG), and the 2010 Technical Bulletin 2010-02, the 2014 Technical Bulletin 2014-02, and the 2018 Technical Bulletin 2018-02.

All specifications are as per current City of Ottawa standards and specifications, and Province of Ontario (OPSS/D) standards, specifications and drawings.

1.2 Pre-Consultation Meeting

The City of Ottawa hosted a virtual pre-consultation meeting on February 18th, 2022. Notes of the meeting are provided in **Appendix A**. There was no major engineering concerns flagged in

this meeting. The City of Ottawa Servicing Study Checklist has also been included in **Appendix A**.

1.3 Environmental Issues

No environmental issues are related to this site, as all environmental concerns were dealt with as part of the applicant's subdivision approval.

An existing watercourse was noted on the City of Ottawa's Geomapping website. This water course has been diverted by others (Stantec design for the Fernbank Road pond outlet). The servicing infrastructure diversion, as designed by Stantec and constructed by others, has been shown on the servicing drawings as existing infrastructure.

1.4 Geotechnical Concerns

Gemtec was retained by Davidson Co-Tenancy to review the grading plan to ensure that the recommendations with its original report for the subject area. A detailed review will be provided prior to final Site Plan approval.

1.5 Hydro One Networks Inc. Transmission Corridor

A portion of the proposed site is located within the HydroOne Networks Inc. transmission corridor. Additionally, due to the private road located partially within the HONI corridor, a portion of the Davidson Lands stormwater management dry pond must be filled in. As a result, the dry pond configuration must also be reconfigured to provide an equal storage volume below the designated 100-year storage level. Additionally, due to the private road works, positive drainage to the ditch inlet CB can no longer be maintained. An extension of the CB lead and 3 new inlets are proposed to maintain adequate positive drainage within the dry pond and the HONI corridor.

2 WATER DISTRIBUTION

2.1 Existing Conditions

There is an existing 250mm watermain stub on the 1650 Shea Road property to the South-East of the site and an existing 200mm watermain stub immediately east of Jardiniere Street in Phase 1. The water model analysis for the Davidson Lands Phase 1 and Phase 2 development considered the proposed development.

2.2 Design Criteria

2.2.1 Water Demands

1650 Shea Road consists of 118 townhouse units. Per unit population density and consumption rates are taken from **Tables 4.1** and **4.2** of the Ottawa Design Guidelines – Water Distribution and are summarized as follows:

- Semi Detach/Townhouse 2.7 person per unit
- Average Day Demand 280 l/cap/day
- Peak Daily Demand 700 l/cap/day
- Peak Hour Demand 1,540 l/cap/day

A water demand calculation sheet is included in **Appendix B** and the total water demands are summarized as follows:

- Average Day 1.03 l/s
- Maximum Day 2.58 l/s
- Peak Hour 5.68 l/s

2.2.2 System Pressures

The 2010 City of Ottawa Water Distribution Guidelines states that the preferred practice for design of a new distribution system is to have normal operating pressures range between 345 kPa (50 psi) and 552 kPa (80 psi) under maximum daily flow conditions. Other pressure criteria identified in the guidelines are as follows:

- | | |
|------------------|--|
| Minimum Pressure | Minimum system pressure under peak hour demand conditions shall not be less than 276 kPa (40 psi). |
| Fire Flow | During the period of maximum day demand, the system pressure shall not be less than 140 kPa (20 psi) during a fire flow event. |
| Maximum Pressure | Maximum pressure at any point in the distribution system in unoccupied areas shall not exceed 689 kPa (100 psi). In accordance with the Ontario Building/Plumbing Code the maximum pressure should not exceed 552 kPa (80 psi) in occupied areas. Pressure reduction controls may be required for buildings where it is not possible/feasible to maintain the system pressure below 552 kPa. |

2.2.3 Fire Flow Rate

The site consists of 13 stacked townhouse blocks ranging from 4 unit to 12-unit blocks. All the blocks within the site are 3-storey back-to-back townhouse buildings. In accordance with Technical Bulletin IWSTB-2024-05 the Ottawa Design Guidelines – Water Distribution Section 4.2.11 has been amended so that the requirements for levels of fire protection on private property in urban areas are covered in Section A-3.2.5.7 of the Ontario Building Code for a fire flow less than 9,000 l/min. A calculation of Block 11 which represents the 10-unit blocks yields a fire flow of **6,300 l/min**, there is one 12-unit Block (Block 10) which has a firewall dividing the block into 8 and 4 unit compartments, a calculation has been done for the 8 unit side which results in a fire flow of **6,300 l/min**, a copy of the OBC calculations are included in **Appendix B**. For the purpose of this evaluation, a more conservative 9,000 l/min fire flow has been carried in the hydraulic analysis.

2.2.4 Boundary Conditions

The City of Ottawa has provided the hydraulic boundary conditions at two locations for 1650 Shea Road Development, including Connection 1 at Jardiniere Street and Connection 2 at Cosanti Drive. A copy of the Boundary Condition is included in **Appendix B** and summarized as follows:

Table 2.1 Summary of Boundary Conditions

CRITERIA	HYDRAULIC HEAD	
	CONNECTION 1 @ Cosanti Drive	CONNECTION 2 @ Jardiniere Street
Max HGL (Basic Day)	160.7 m	160.7 m
Peak Hour	154.9 m	154.9 m
Max Day + Fire (11,000 l/m)	128.3 m	129.8 m

2.2.5 Hydraulic Model

A computer model for the 1650 Shea Road water distribution system has been developed using the InfoWater program by Innovyze. The model includes the boundary conditions at Jardiniere Street and Cosanti Drive.

2.3 Proposed Water Plan

2.3.1 Hydraulic Analysis

A 250 mm watermain is proposed with the first connection to the existing 250mm watermain stub at Cosanti Drive and extends through the site with a second connection to the existing 200mm watermain at Jardiniere Street to provide a looped watermain to service the site. The rest of the watermains will be 200mm. Refer to the general plan of services **Drawing C-001** for detailed watermain layout for the subject site. The watermain connecting through the HONI corridor to the west, to existing Davidson Lands Phase 2, to Jardiniere Street, has been reviewed by the pipe manufacturer, who has confirmed that the pipe can withstand the truck loading of CL-625 (CAN/CSA-S6) and point loads from mobile cranes of 267kN. Correspondence from IpeX has been provided in **Appendix B**.

The hydraulic model was run under basic day conditions under the existing boundary condition to determine the maximum pressure for the site. The minimum pressure for the site is determined in the peak hour condition. There are 11 fire hydrants in the site; the model was run under the max day plus fire flow condition to determine the design fire flow at the hydrant locations. The fire flow

analysis was conducted with a fire demand of 9,000 l/min (150 l/s) with the 11,000 l/min (183.3 l/s) boundary condition. Results of the analysis for the 1650 Shea Road site are summarized in Section 2.3.2 and the water model schematic and model results are included in **Appendix B**.

2.3.2 Summary of Results

Results of the hydraulic analysis for 1650 Shea Road are summarized as follows:

Table 2.2 Results of Hydraulic Analysis

SCENARIO	EXISTING
Basic Day Pressure (kPa)	524.16 – 528.18
Peak Hour Pressure (kPa)	467.30 – 471.32
Minimum Residual Pressure (kPa)	149.7

A comparison of the results and design criteria is summarized as follows:

Maximum Pressure	All nodes have basic day pressure below 552 kPa for existing conditions; therefore, pressure reducing control is not required for this site.
Minimum Pressure	All nodes exceed the minimum requirement of 276 kPa during peak hour conditions under the existing boundary conditions.
Fire Flow	The model was run with a fire flow of 9,000 l/min under the 11,000 l/min boundary conditions. All nodes met the required fire flow with the residual pressures above 140 kPa.

3 WASTEWATER

3.1 Existing Conditions

A pump station was constructed south of Aridus Crescent adjacent to the stormwater management facility which serves as the sanitary outlet for this project. As part of the pump station construction, a dual forcemain was constructed in Phase 1 and Phase 2 lands. The forcemains are located in the boulevards of the streets. Drawing 501A shows the location of existing sanitary sewers placed as part of the Phase 2 works. The Davidson Lands Phase 2 report prepared by IBI Group dated July 2020 confirmed that the existing sewer systems have sufficient capacity for the 1650 Shea Road development.

3.1.1 Verification of Existing Sanitary Sewer Capacity

There is an existing 200mm sanitary sewer in Cosanti Drive, which connects to the 300 mm diameter sewer in Edenwylde Drive. In the previous Davidson Lands Phase 2 report, the design for 1650 Shea Road was assumed a density of 66 people per hectare, with an allocated population of 137.3 people, a site area of 2.08 and a total flow of 2.81 L/s, see **Appendix C** for excerpts from the Phase 2 report.

For the subject development, it is proposed to build a total of 116 back-to-back townhouse units, comprising of 2 bedrooms each. The City of Ottawa Sewer Design Guideline population density of 2.1 people per unit for 2-bedroom apartments was used for this site. The new total proposed population is 254.4 people, an area of 2.33 Ha and a total peak flow of 3.64L/s. This represents a total peaking flow increase of **0.83L/s** when compared to the Phase 2 allocation. The sanitary sewers downstream of the subject site has sufficient residual flow capacities. Therefore, the increase in flow on the existing system from the subject development is considered negligible and will have no negative impacts on downstream infrastructure.

3.2 Proposed Sewers

The proposed sanitary sewer system is shown on **Figure 4.2**. A sanitary sewer stub was extended from MH186A at Cosanti Drive to service the future residential block. Due to the configuration of the new proposed site plan the existing sewer stub cannot be utilized, and its to be capped at the property line and abandoned. A new location to service the future residential block at MH12A is proposed NW of existing MH187A at Cosanti Drive.

All on-site sewers have been designed to City of Ottawa and MOE design criteria which include but are not limited to the below listed criteria. A copy of the detailed sanitary tributary area plan 400 and the sanitary sewer design sheets are included in **Appendix C** illustrate the population densities and sewers which provide the necessary outlets.

3.2.1 Design Flow:

Average Residential Flow	-	280 l/cap/day
Peak Residential Factor	-	Harmon Formula
Infiltration Allowance	-	0.33 l/sec/Ha
Minimum Pipe Size	-	200mm diameter

3.2.2 Population Density:

Back-to-back Townhouse (2Bed)	-	2.1 person/unit
-------------------------------	---	-----------------

4 MINOR STORM SEWERS

4.1 Existing Conditions

Prior to the construction of Phase 1 and Phase 2, the majority of the site was cultivated farmland that drains southeast towards the Faulkner Drain through a series of farm ditches. The phase 2 pre-development drainage patterns are shown on **Figure 4.1** in **Appendix D**. This figure is an excerpt from the Davidson Lands – OPA 76 Area 6a Phase 2 Design Brief, July 2020. A stormwater management facility was constructed south of Aridus Crescent as part of Phase 1; this facility is the storm sewer outlet for Phase 2 and 1650 Shea Road.

4.2 Serviceability Report

The 2014 Design Brief by Novatech Engineering recommended that the Davidson Lands be serviced by local sewers to discharge to a separate off-line Stormwater Management Facility. The 2016 Conceptual Site Servicing Study for the Davidson Lands provided some preliminary details of that facility, which is proposed to be located south of the site and extend into the Hydro One corridor. The minor storm servicing scheme for the Davidson Lands will follow the recommendations of the 2016 preliminary report. Details of the proposed Davidson Lands stormwater management facility will be the subject of a separate design report by others.

4.3 Design Criteria

In accordance with the City of Ottawa Sewer Design Guidelines, the following design criteria was used to size storm sewers using the rational method:

- Design return period: 1:2 year (subdivision)
1:5 year (subdivision)
1:10 year (arterial road)
- Time of Concentration: 10 minutes
- Minimum velocity: 0.8 m/s
- Maximum velocity: 3.0 m/s
- Mannings roughness coefficient: 0.013
- Minimum allowable slopes listed below:

DIAMETER (MM)	SLOPE (%)
250	0.432
300	0.340
375	0.250
450	0.195
525	0.160
600	0.132
675	0.113
750 and larger	0.100

4.4 Proposed Minor Storm Plan

The Phase 2 proposed minor storm sewer system is shown on **Figure 4.2** in **Appendix D**. This figure is an excerpt from the Davidson Lands – OPA 76 Area 6a Phase 2 Design Brief, July 2020. A storm sewer stub was extended from MH186 at Cosanti Drive to service the future residential block. Due to the configuration of the proposed site plan, a new service location is proposed NW of existing MH187 at Cosanti Drive. The existing storm sewer stub will be decommissioned.

4.5 Sewer Calculations

The Storm Drainage Area Plans (Drawings 139185-500) and the detailed storm sewer design sheets, using City of Ottawa and Ministry of the Environment criteria, are provided in **Appendix D**. Detailed calculations for determining the various runoff coefficients are also included in **Appendix D**.

4.6 Hydro One Corridor Dry Pond

As discussed in section 1.5 of this report, the existing dry pond constructed as part of the Davidson Lands development will require modification to maintain its level of service. The configuration of the site plan block requires grading works within the dry pond limits, resulting in 1036.71m³ of lost storage below the 100year elevation of 104.71. To maintain the level of service, additional depth in the dry ponds is required to compensate for the loss of storage. By lowering the dry ponds, 1636.57m³ of additional ponding capacity has been provided, for a net gain in ponding volume of **599.86m³**. Additionally, the infilled areas will prevent positive drainage of the 3 dry pond cells, therefore, a piped extension of the existing CB has been provided, inclusive of 3 new inlets. Details of the hydraulic function of the dry pond are provided in Section 5.4.4.1.

4.7 External Conveyance

4.7.1 Existing Drainage Feature

The existing swale that runs between Fernbank Rd. and Shea Road is currently conveyed by the Shea Road westside ditch. This drainage system is proposed to be altered by adjacent development. Stantec was commissioned by the adjacent landowners to design an entombment system for its stormwater management facility, inclusive of Fernbank Rd, undeveloped lands, and Shea Rd local drainage.

4.7.2 Shea Road Roadside Ditch

The existing west side Shea Road roadside ditch drains from north to south along the subject lands frontage. The Stantec entombment works discussed in the preceding section provide inlets for roadside drainage at the north-east corner of the subject development site, as well as at the south-east corner of the subject development site.

The roadside ditch along the Shea Road frontage is to be maintained, however as a result of the inlets provided in the Stantec design, there are no upstream flows to be considered in this ditch. The 2 site entrances are provided with 500mm diameter culverts, which is the minimum size as recommended in the OSDG.

5 STORMWATER MANAGEMENT

5.1 Background

The subject site is tributary to the Faulkner Drain. Under existing conditions, the West Wind in-line stormwater management facility located south of the subject site routes flows to the Faulkner Drain from several locations including the West Wind Farm residential development, other existing residential properties, farm fields, and rural estate lots.

The overall stormwater management strategy for Davidson Lands was initially outlined in the “Stittsville South – Area 6 Master Servicing Report & Stormwater Management Design Plan” (Novatech/DSEL, December 2013). The stormwater management strategy was further updated in the “Stittsville South Subdivision, City of Ottawa Servicing and Stormwater Management Report” (Cavanagh and Regional, October 2014, Novatech). As noted in **Section 1.2**, areas 6b and 6c, which are located to the west of the subject site, will be serviced by a separate off-line stormwater management facility. As per the recommendations of the above noted October 2014 report, the subject site will also be serviced by a separate off-line SWM facility. The new facility will outlet to the West Wind ditch facility at the upper limit of the Faulkner Drain. The existing West Wind in-line stormwater management facility will continue to remain in service.

The stormwater management strategy for Davidson Lands was outlined in greater detail in the “Conceptual Site Servicing Study, Davidson Lands - OPA 76 Area 6a, Stittsville South,” prepared by IBI Group, 2016.

In November of 2017, DSEL/JFSA finalized the report “Design Brief for the Stormwater Management Pond for the Davidson Lands.” That report outlined the detailed design of the SWM facility.

The detailed design of the Phase 1 development was outlined within the report “Davidson Lands – OPA 76 Area 6a, Phase 1,” prepared by IBI Group, 2018. In July of 2020, the detailed design of Phase 2 was outlined within the report “Davidson Lands – OPA 76 Area 6a, Phase 2,” also prepared by IBI Group, referred to in this report as the Phase 2 Design Brief. Those studies identified the minor and major system flows for the subject site (identified as FP320). The flows for the site are **395 l/s** for the minor system and **344 l/s** for the major system. This flow allocation has been used to confirm the detailed design of the subject development.

The existing site topography and drainage patterns are shown on **Figure 4.1**. There are two distinct sub-drainage areas on the Davidson Lands. Most of the site drains from the northwest to the east and eventually outlets to the west side ditch along Shea Road. The southwest portion of the site drains southeast towards the hydro easement and eventually drains to the north side road ditch along Flewellyn Road.

5.2 Objective

The purpose of this evaluation is to prepare the dual drainage design, including the minor and major system, of the proposed development. The design includes the sizing of inlet control devices, maximum depth and velocity of flow on the surface and hydraulic grade line analysis. The stormwater system concept is discussed in subsequent sections and has been developed based on the October 2012 City of Ottawa Sewer Design Guidelines, February 2014 City of Ottawa Technical Bulletin ISDTB-2014-01, and the September 2016 City of Ottawa Technical Bulletin PIEDTB-2016-01.

Subsequent guidelines have been published to the aforementioned. The newest guidelines include the following changes: minor system design using capture rate of 2 years for local streets (previously 5 years), an increase in ponding depth to 0.35 m on streets (previously 0.30 m), flow parameters which use lower per capita flow rates for HGL.

5.3 System Concept

The stormwater management system for the site incorporates standard urban drainage design and stormwater management features that can be summarized as follows:

- a dual drainage concept;
- routing of surface runoff; and,
- an end-of-pipe SWM facility (designed by others).

The stormwater management system has been developed based on the MOE *Stormwater Management Planning and Design Manual* (March 2003) and the *City of Ottawa Sewer Design Guidelines* (October 2012), as well as subsequent City of Ottawa Technical Bulletins.

5.3.1 Scope

The evaluation has been completed to support the detailed design of the dual drainage for the site. The drainage area considered in the evaluation is presented on **Drawings 139185-700**.

5.3.2 Dual Drainage Design

The site was designed with dual drainage features, accommodating minor and major system flow. During frequent storm events, the effective runoff of a catchment area is directly released via catchbasin inlets to the network of storm sewers, called the minor system. During less frequent storm events, the balance of the flow (in excess of the minor flow) is accommodated by a system of rear yard swales and street segments, called the major system.

The streets within site feature a mix of sawtooth and continuous grade profiles. The sawtooth profile facilitates surface storage on subdivision streets. Inlet control devices (ICDs) are proposed across the site to maximize the use of available on-site storage and control surcharge of the minor system during infrequent storm events. The dual drainage system has been evaluated using the DDSWMM hydrological model, while the minor system hydraulic grade line analysis has been evaluated using the XPSWMM dynamic model.

The DDSWMM model technique offers single storm event flow generation and routing. ICDs were initially sized based on the 2 year 3 hour Chicago design storm event. In some instances, the proposed ICD release rates and minor system sewer sizing were optimized to protect lots from surface flooding. This was accomplished by increasing ICD release rates above the 2 year storm event.

The major system flow pattern outlets primarily to the Hydro One corridor north of Cosanti Drive, which is provided with a dry pond. The dry pond collects and temporarily stores surface runoff north of Cosanti Drive. The captured runoff in the dry pond is released to the storm sewer on Cosanti Drive. Further information regarding the detail design of the dry pond is provided in Section 5.4.4.1. Major flow from development immediately adjacent to Shea Road cascades to the Shea Road ditch. The drainage area plan is presented on **Drawings 37533-700**. Model files are enclosed with the report in **Appendix D**.

5.4 Stormwater Evaluation

5.4.1 Hydrological Evaluation

Land use, selected modeling routines, and input parameters for the model of the site are discussed in the following sections.

Land Use

The site will be developed with back to back townhouses.

Storms and Drainage Area Parameters

The main hydrology parameters are summarized below and in Table 5.1

- **Design storms:** The site was evaluated using the following storms:
 - 2 year 3 hour Chicago storm event with a 10 minute time step, applied for the dual drainage evaluation, specifically the minor system;
 - 100 year 3 hour Chicago storm event with a 10 minute time step applied for the dual drainage evaluation;
 - 100 year 3 hour Chicago storm event with a 10 minute time step plus 20% increase in intensity, applied as a stress test;
- **Infiltration:** The selected infiltration losses are consistent with the City of Ottawa Sewer Design Guidelines. The Horton values are as follows: $f_0 = 76.2$ mm/h, $f_c = 13.2$ mm/h, $k = 0.00115$ s⁻¹.
- **Area:** The approximate 2.30 ha drainage area was divided into sub-drainage areas based on the proposed minor system network of storm sewers. Respecting the existing site topography, major system surface flows from the majority of the site are proposed to be directed toward the hydro corridor.
- **Imperviousness:** The imperviousness values are based on the runoff coefficients, which were determined by obtaining the footprint of the model units intended for the site and placing the applying a typical footprint to the lots.
- **Width:** The catchment width was based on the conveyance route length of the drainage area and multiplied by two. The multiplier of two was only used if the drainage area had runoff contribution from both sides of the drainage area.
- **Slope:** The ground slope was based upon the average slope for both impervious and pervious area. Generally, the slope is approximately 2% (0.02 m/m). This assumes a slope of approximately 1% for impervious or road surfaces and 3% for pervious surfaces (lot grading).
- **Detention storage depth:** Detention storage depths of 1.57 mm and 4.67 mm were used for impervious and pervious areas, respectively.
- **Manning's roughness:** Manning's roughness coefficients of 0.013 and 0.25 were used for impervious and pervious areas, respectively.
- **Baseflow:** No baseflow components were assumed for any of the areas contributing runoff to the minor system.
- **Major system storage and routing:** The subject site is comprised of both continuous grade and sawtooth road profiles. For drainage areas with sawtoothing, available surface storage has been calculated based on the grading plan. Flow is attenuated within low points with potential overflow cascading to the next segment downstream. The total volume at each low point, up to the overflow depth, is the maximum static storage. Rear yard segments have a sawtooth pattern with some storage available, but the storage is not accounted for as part of the analysis.

For street segments with ponding, minor system capture is set to fully utilize storage during the 100 year design storm, while minimizing ponding during the 2 year event. Cascading

overflow from a low point to a downstream segment utilizes the static storage available plus an additional amount of storage equivalent to the depth required for the flow to cascade over the downstream high point. The attenuation in street sags was evaluated to account for static storage and, if overflow occurs, dynamic storage. Within this report it is referred to as double routing.

DDSWMM does not have a direct way of coding double routing since it does not allow the user to code dynamic storage over the high point. For this analysis, the method employed is that recommended in the February 2014 City of Ottawa Technical Bulletin ISDTB-2014-01. It accounts for overflow from a street segment (regular static storage at a sag) being conveyed to a downstream dummy segment. In other words, a regular low point segment is provided with a downstream dummy segment for further flow attenuation to account for the dynamic ponding during overflow.

There are no drainage area attributes associated with the dummy segment since it is a segment solely for routing. In addition, there is no inflow to the minor system from these dummy segments. The overflow hydrograph from the upstream catchment is routed in the dummy segment to the next "real" downstream segment. The dummy segments have the following specific characteristics:

- Segment Length: Equivalent to the length of the maximum static storage from the street segment contributing to it.
- Road Type: Equivalent to the right-of-way characteristics from the segment contributing to it, but with a longitudinal slope of 0.01% (0.0001 m/m).

The dummy segments for major system routing have been applied to the analysis of the subject site. The segments are referenced as D1, D2, D3, etc. within the DDSWMM modelling file. The drainage area plan presented on **Drawings 37533-700** does not show the dummy segments, but the DDSWMM output file shows the dummy segments immediately following the corresponding major segment which cascades into that dummy segment.

For street segments with continuous grade, simulations were based on the approach-capture characteristics of the catchbasin with the constraint that during the 100 year design storm the maximum cascading flow does not exceed 0.35 m.

For street segments with sawtoothing, simulations were based on the constraint that during the 100 year design storm the maximum depth of ponding (including cascading flow where applicable) does not exceed 0.35 m. Where surface storage is available, the storage-outflow characteristics for each low point were taken into consideration. The evaluation was undertaken assuming static conditions. The ponding plan for the subject site is presented on **Drawing 139185-600**.

- **Minor system capture:** The minor system capture is based on the 2 year 3 hour Chicago storm event for maximum ponding conditions. ICDs are incorporated into the design to protect the minor system from surcharge during infrequent storm events and to utilize the available on-site storage.

Standard ICD sizes and four custom sizes are proposed for the site to control the surcharge in the minor system during infrequent storm events. The minimum minor system capture of ICDs is based on DDSWMM generated flows for individual areas for the 2 year storm event. The size of the inlet control devices (ICDs) was optimized using DDSWMM. The custom sizes

are all vortex 8 l/s, 9 l/s, 10 l/s, 11 l/s, 17 l/s and 19 l/s (larger head). Further information on the ICDs can be found in the catchbasin table on **Drawing 139185-010**.

The minor system inflow rate was optimized to account for continuous grade. Specifically, the model incorporates the actual flow entering the minor system on continuous grade based on approach-capture curves derived from the 1984 MTO Drainage Manual (specifically, Charts E4-7D and Chart E4-7H). Based on the approach-capture curve, the actual capture during the 2 year event may be less than the 2 year simulated flow, resulting in cascading flow. In such cases, ICDs are sized to fully capture the cascading flow at the next downstream sag. A summary is available in the catchbasin table on **Drawing 139185-010**.

The main hydrological parameters used in the DDSWWM model are summarized in Table 5.1.

Table 5.1 Hydrological parameters

AREA ID	AREA (HA)	D/S SEGMENT	RE-CEIVING MH	IMP. (%)	LENGTH (M)	WIDTH (M)	AVAIL. PONDING (CU-M)	2 YEAR SIMULATED FLOW (L/S) 139185-3CH12.OUT	ICD RESTRICTION (L/S)	STORAGE USED DURING 2 YEAR EVENT (CU-M)
S1	0.07	S3	MH1	0.81	35	35	13.1	11	12	0.01
S3	0.05	S5	MH3	0.81	51	51	3.3	8	9	0.01
S22	0.05	S20	MH22	0.81	31	31	5.8	7	12	0.01
S20	0.16	S5	MH20	0.81	43	86	4.2	24	25	0.01
S21A	0.06	OSHEA	MH21	0.81	14	28	0.0	9	12	N/A
S21	0.16	S5	MH21	0.81	41	82	5.0	24	25	0.01
S5 ⁽¹⁾	0.10	S6	MH4	0.81	54	54	1.0	15	17	0.01
S30	0.21	S6	MH30	0.81	56	112	16.6	32	33	0.01
S6	0.03	S7	MH5	0.81	28	28	0.9	5	6	0.01
S32	0.05	S31	MH32	0.81	32	32	0.3	7	12	0.01
S31	0.22	S7	MH31	0.81	58	116	19.6	33	38	0.01
S8	0.03	OUTDP	MH8	0.81	20	20	0.9	5	6	0.01
S40A	0.10	OSHEA	MH40	0.81	20	40	0.0	15	15	N/A
S40B	0.21	S9	MH40	0.81	53	106	17.8	31	38	0.01
S7 ⁽²⁾	0.11	S8	MH6	0.81	54	54	0.9	17	19	0.01
S54	0.08	S9	MH54	0.81	33	33	0.2	11	12	0.01
S8A	0.04	S8	MH40	0.81	15	30	1.9	6	8	0.01
S10	0.17	S9	MH51	0.81	53	53	6.9	24	30	0.01
S9	0.05	S8	MH9	0.81	80	80	1.1	7	10	0.01
S52	0.15	S50	MH52	0.81	64	64	7.7	22	25	0.01
S50	0.18	S9	MH50	0.81	61	122	9.7	28	29	0.01
UNC1	0.02	OCD	PDUM	0.81	5	5	0.0	3	N/A	N/A

Notes: 1 - Area S5 includes subcatchments S4, S5 and S5A referenced on drawing 500 and is controlled at MH70
 2 - Area S7 includes subcatchments S6A, S7 and S7A referenced on drawing 500 and is controlled at MH80

There is no storage utilized during the 2 year event (design event). There are locations at which the model output indicates 0.01 cu-m utilized for a short duration of time (such as 10 minutes); however this is considered below the threshold of recognition.

5.4.2 Results of the Hydrological Evaluation

Minor system hydrographs generated by DDSWMM were exported to XPSWMM for the hydraulic grade line analysis (refer to **Section 5.4.3**). The results of the DDSWMM major system evaluation are summarized in the following sections.

5.4.2.1 Summary of allowable flows to receiving lands

As per the Phase 2 Design Brief, the allowable peak flows for the Shea Road site (previously FP320) are 395 l/s for the minor system and 344 l/s for the major system (see reference in Appendix D). The updated peak flows from this subdivision are 393 l/s for the minor system and 232 l/s for the major flow. These flows are less than the allowable peak flows and therefore will not constraint the system. The allowable peak flows are summarized in Table 5.2.

Table 5.2 Allowable peak flows

AREA ID	SITE PEAK FLOWS (L/S)	ALLOWABLE PEAK FLOWS (L/S)
Dry Pond Peak Flow to Minor System	469	492
Total Minor Peak Flow	393	395
Major Flows		
UNC1	8	N/A
S21A	18	N/A
S40A	29	N/A
S8	177	N/A
Total Major Peak Flow	232	344

5.4.2.2 Overland Flow on Street Segments

A summary of cascading overland flow on street segments is presented in **Table 5.3** for the 100 year 3 hour Chicago storm event and **Table 5.4** for the 100 year Chicago storm increased by 20%. The cascading overflow is the flow exiting a drainage area when maximum minor system inflow and maximum available ponding has been utilized. For the areas representing the future development, the major system should be re-confirmed at the detail design stage.

The cascading flow across the site was evaluated to confirm that depth and velocity are in accordance with City guidelines. To determine velocity of cascading overflow at critical locations, SWMHYMO was used. The applicable right-of-way (ROW) sections were entered into the model with the corresponding longitudinal slopes to obtain the maximum velocity of flow using the Route Channel routine. The resulting depths were also applied for street segments with continuous grade. To determine depth of the cascading overflow for street segments with ponding, the calculation sheet from the February 2014 City of Ottawa Technical Bulletin ISDTB-2014-01 was employed. The major system flow results are summarized in the tables below and presented in full in **Appendix D**, along with supporting model files.

Table 5.3 Summary of Cascading Flow during the 100 year 3 hour Chicago Storm

AREA ID (DUMMY SEGMENT IF APPLICABLE)	DUMMY SEGMENT ID	LONGITUDINAL SLOPE (%)	OVERFLOW (L/S)	VELOCITY (M/S)	MAX. STATIC PONDING DEPTH (WHERE APPLICABLE) (M)	DEPTH (DYNAMIC, WHERE APPLICABLE) (M)	MAX. DEPTH (STATIC + DYNAMIC, WHERE APPLICABLE) (M)	VXD (M ² /S)
S1	D1	0.71	0	0.000	0.18	0.00	0.18	0.000
S3	D2	0.77	7	0.283	0.11	0.02	0.13	0.006
S22	D3	0.64	0	0.000	0.15	0.00	0.15	0.000
S20	D4	1.98	29	0.707	0.10	0.06	0.16	0.039
S21A		3.00	18	0.731	0	0.03	0.03	0.019
S21	D5	1.72	28	0.664	0.10	0.05	0.15	0.036
S5	D6	0.59	74	0.571	0.07	0.06	0.22	0.035
S30	D7	1.49	13	0.520	0.15	0.04	0.19	0.021
S6	D8	0.82	81	0.657	0.07	0.06	0.13	0.039
S32	D9	0.64	5	0.252	0.05	0.02	0.07	0.004
S31	D10	1.23	13	0.482	0.15	0.04	0.19	0.020
S8	D11	2.00	177	0.784	0.07	0.04	0.11	0.030
S40A		3.00	29	0.817	0	0.03	0.03	0.026
S40B	D12	1.79	10	0.524	0.16	0.04	0.20	0.019
S7	D13	0.82	98	0.694	0.07	0.06	0.23	0.045
S54	D14	0.87	16	0.444	0.04	0.04	0.08	0.020
S8A	D15	0.61	7	0.319	0.12	0.03	0.15	0.011
S10	D16	0.65	28	0.463	0.16	0.06	0.22	0.026
S9	D17	0.61	80	0.589	0.07	0.06	0.13	0.037
S52	D18	0.57	17	0.389	0.11	0.05	0.16	0.018
S50	D19	0.87	37	0.554	0.12	0.06	0.18	0.034
UNC1		2.00	8	0.488	0	0.02	0.02	0.010

Table 5.4 Summary of Cascading Flow during the 100 year 3 hour Chicago Storm + 20%

AREA ID (DUMMY SEGMENT IF APPLICABLE)	DUMMY SEGMENT ID	LONGITUDINAL SLOPE (%)	OVERFLOW (L/S)	VELOCITY (M/S)	MAX. STATIC PONDING DEPTH (WHERE APPLICABLE) (M)	DEPTH (DYNAMIC, WHERE APPLICABLE) (M)	MAX. DEPTH (STATIC + DYNAMIC, WHERE APPLICABLE) (M)	VXD (M ² /S)
S1	D1	0.71	6	0.323	0.18	0.02	0.20	0.007
S3	D2	0.77	14	0.349	0.11	0.03	0.14	0.010
S22	D3	0.64	2	0.140	0.15	0.02	0.17	0.003
S20	D4	1.98	43	0.784	0.10	0.06	0.16	0.050
S21A		3.00	23	0.770	0.00	0.03	0.03	0.022
S21	D5	1.72	41	0.911	0.10	0.06	0.16	0.057
S5	D6	0.59	117	0.636	0.07	0.07	0.23	0.046
S30	D7	1.49	53	0.740	0.15	0.07	0.22	0.051
S6	D8	0.82	169	0.795	0.07	0.08	0.15	0.063
S32	D9	0.64	8	0.298	0.05	0.02	0.07	0.007
S31	D10	1.23	58	0.711	0.15	0.07	0.22	0.052
S8	D11	2.00	387	0.955	0.07	0.05	0.12	0.050

AREA ID (DUMMY SEGMENT IF APPLICABLE)	DUMMY SEGMENT ID	LONGITUDINAL SLOPE (%)	OVERFLOW (L/S)	VELOCITY (M/S)	MAX. STATIC PONDING DEPTH (WHERE APPLICABLE) (M)	DEPTH (DYNAMIC, WHERE APPLICABLE) (M)	MAX. DEPTH (STATIC + DYNAMIC, WHERE APPLICABLE) (M)	VXD (M ² /S)
S40A		3.00	36	0.872	0.00	0.03	0.03	0.030
S40B	D12	1.79	35	0.724	0.16	0.06	0.22	0.043
S7	D13	0.82	235	0.878	0.07	0.09	0.26	0.078
S54	D14	0.87	23	0.499	0.04	0.05	0.09	0.026
S8A	D15	0.61	11	0.349	0.12	0.04	0.16	0.014
S10	D16	0.65	42	0.519	0.16	0.07	0.23	0.034
S9	D17	0.61	149	0.691	0.07	0.08	0.15	0.055
S52	D18	0.57	34	0.462	0.11	0.06	0.17	0.028
S50	D19	0.87	65	0.640	0.12	0.08	0.20	0.048
UNC1		2.00	10	0.512	0.00	0.02	0.02	0.011

During the 100 year 3 hour Chicago design storm, the maximum depth of cascading flow on the street is less than the maximum allowable 350 mm, and the velocity by depth product is less than the allowable 0.6 m²/s. Also, during the 100 year Chicago design storm event increased by 20%, the maximum depth of cascading flow is less than 0.35 m across the site. It should be noted that UNC1 drains to existing Cosanti with negligible impacts to capture and surface ponding. The resulting summary of cascading flow on Cosanti has been added to Appendix D of this report for reference.

5.4.3 Hydraulic Evaluation

The approved XPSWMM hydraulic model from the Phase 2 Design Brief was updated to include the subject site. Minor system hydrographs generated from the DDSWMM model were exported to the XPSWMM model. Minor system losses were accounted for in accordance with Appendix 6-B of the City of Ottawa Sewer Design Guidelines (October 2012).

Simulations were performed for various storms to confirm the hydraulic grade line (HGL) through the Davidson Lands development.

5.4.4 Results of Hydraulic Evaluation

The hydraulic grade line (HGL) was analyzed using the XPSWMM dynamic model for the 100 year 3 hour Chicago storm. The corresponding stress test (100 year 3 hour Chicago storm + 20% increase in intensity) was also simulated.

The HGL elevations are presented in the following **Table 5.5**, along with a comparison of under-side of footing (USF) elevations. Results for all storm events as well as XPSWMM model output files are provided in **Appendix D**.

Table 5.5 Storm HGL Elevations

XPSWMM NODE	USF ELEV. (M)	STORM EVENTS							
		100 YEAR 3 HOUR CHICAGO ⁽¹⁾		100 YEAR 3 HOUR CHICAGO + 20% ⁽²⁾		100 YEAR 12 HOUR SCS TYPE II ⁽³⁾		100 YEAR 24 HOUR SCS TYPE II ⁽⁴⁾	
		HGL (M)	USF [OR PG] -HGL (M)	HGL (M)	USF [OR PG] -HGL (M)	HGL (M)	USF [OR PG] - HGL (M)	HGL (M)	USF [OR PG] - HGL (M)
MH1	105.02	104.40	0.62	104.44	0.58	104.40	0.62	104.40	0.62
MH2	N/A	104.25	N/A	104.42	N/A	104.24	N/A	104.33	N/A
MH3	N/A	104.25	N/A	104.42	N/A	104.24	N/A	104.33	N/A
MH22	N/A	104.43	N/A	104.46	N/A	104.43	N/A	104.43	N/A
MH20	104.84	104.32	0.52	104.44	0.40	104.32	0.52	104.35	0.49
MH4	N/A	104.24	N/A	104.41	N/A	104.23	N/A	104.32	N/A
MH21	104.84	104.26	0.58	104.40	0.44	104.26	0.58	104.32	0.52
MH5	N/A	104.21	N/A	104.39	N/A	104.20	N/A	104.30	N/A
MH30	104.88	104.24	0.64	104.39	0.49	104.23	0.65	104.31	0.57
MH6	N/A	104.19	N/A	104.36	N/A	104.18	N/A	104.28	N/A
MH32	N/A	104.28	N/A	104.40	N/A	104.28	N/A	104.32	N/A
MH31	104.88	104.24	0.64	104.40	0.48	104.24	0.64	104.32	0.56
MH7	N/A	104.17	N/A	104.33	N/A	104.16	N/A	104.26	N/A
MH8	N/A	104.15	N/A	104.32	N/A	104.14	N/A	104.25	N/A
MH40	104.72	104.20	0.52	104.37	0.35	104.20	0.52	104.29	0.43
MH9	N/A	104.13	N/A	104.29	N/A	104.12	N/A	104.23	N/A
MH52	104.82	104.26	0.56	104.42	0.40	104.25	0.57	104.35	0.47
MH53	N/A	104.23	N/A	104.41	N/A	104.23	N/A	104.34	N/A
MH54	104.92	104.23	0.69	104.41	0.51	104.22	0.70	104.34	0.58
MH50	104.72	104.23	0.49	104.41	0.31	104.22	0.50	104.34	0.38
MH51	104.67	104.22	0.45	104.39	0.28	104.21	0.46	104.32	0.35
MH10	104.92	104.10	0.82	104.26	0.66	104.08	0.84	104.20	0.72
MH11	104.92	104.08	0.84	104.23	0.69	104.06	0.86	104.18	0.74
MH12	N/A	104.05	N/A	104.21	N/A	104.03	N/A	104.15	N/A

(1) Model file: STM_0909-100CH_2025-07-25.OUT
 (2) Model file: STM_0909-120CH_2025-07-25.OUT
 (3) Model file: STM_0912-SC12100C_2025-07-25.OUT
 (4) Model file: STM_0909-SC24100X_2025-07-25.OUT

The above tables indicate that minimum 0.3 m clearance between the USF and HGL is maintained across the subject site during the 100 year 3 hour Chicago storm event, the 100 year SCS 12 hour event and the 100 year SCS 24 hour event. It should be noted that the above results also indicate that there would be no severe flooding to properties during the 100 year 3 hour Chicago storm with a 20% increase in intensity. The output files are presented in **Appendix D**.

5.4.4.1 Hydro Corridor Dry Pond

As outlined within the above Section 4.6, the existing dry pond constructed as part of the Davidson Lands development will require modification to maintain its level of service. The configuration of the site plan block requires grading works within the dry pond limits. The Hydro Corridor outlet receives major system flows from various portions of the Davidson Lands development. The dry pond will attenuate flows routed to the Hydro Corridor north of Cosanti drive. The hydraulic function of the dry pond has been confirmed in XPSWMM using the 100 year 3 hour Chicago storm as well as the stress test 100 year Chicago + 20% increase in intensity. The total available dry pond storage is approximately 2100 cu-m at ponding depth of 0.6 m (elevation of 104.75 m). The outflow

to the minor system is via a 450 mm diameter pipe to MH187 at the intersection of Cosanti Dr and Ocala St. The boundary conditions at the outlet of the dry pond are determined by a fully dynamic computer model (XPSWMM) which simulates the hydraulic grade line in the system including the receiving MH187. The pond plan view is provided on **Drawing 139185-751** and detail design is presented on **37533-HC**. The functioning of the dry pond during the design storms is presented in **Table 5.6**.

Table 5.6: Functioning of the Dry Pond

PARAMETER	100 YEAR CHICAGO		100 YEAR CHICAGO + 20%	
	PREVIOUSLY APPROVED*	CURRENT ANALYSIS	PREVIOUSLY APPROVED*	CURRENT ANALYSIS
Storage Utilised (cu. m)	576	479	1940	2008
Outflow (l/s)	492	469	545	546
Water Level (m)	104.55	104.46	104.73	104.74
Drawdown Time (hr)	<3	<3	<4	<3

*Previously approved as per the Phase 2 Design Brief

The above results indicate that the function of the SWM system and dry pond closely correspond with the previous analysis presented within the approved Design Brief.

5.5 Summary of Model Output Files

The following is a reference list of the model output files including file names and storm event evaluated. The files are included in **Appendix D**.

DDSWMM:

- 2 year 3 hour Chicago: 139185-3CHI2.OUT
- 5 year 3 hour Chicago: 139185-3CHI5.OUT
- 100 year 3 hour Chicago: 139185-3CHI100.OUT
- 100 year 3 hour Chicago + 20%: 139185-3CHI120.OUT
- 100 year 12 hour SCS Type II: 139185-12SCS100.OUT
- 100 year 24 hour SCS Type II: 139185-24SCS100Y10.OUT

SWMHYMO:

- 139185VXD.OUT

XPSWMM:

- 100 year 3 hour Chicago: STM_0909-100CH_2025-07-25.OUT
- 100 year 3 hour Chicago + 20%: STM_0909-120CH_2025-07-25.OUT
- 100 year 12 hour SCS Type II: STM_0912-SC12100C_2025-07-25.OUT
- 100 year 24 hour SCS Type II: STM_0909-SC24100X_2025-07-25.OUT

5.6 MUSF and MGG

The Minimum Underside of Footing (MUSF) was determined using the higher of the following:

- 100-year HGL + 0.3m
- Sanitary or Storm pipe obvert + 0.3m

The Minimum Garage Grade (MGG) was determined using the higher of the following:

- 100-year ponding elevation + 0.15 m
- 100 year + 20% ponding elevation + 0.10 m

The result is the most restrictive in setting the MUSF/ MGG elevations.

6 SOURCE CONTROLS

6.1 General

On site level or source control management of runoff will be provided to provide quality control for the subject lands. Such controls or mitigative measures are proposed for the development not only for final development but also during construction and build out. Some of these measures are:

- flat lot grading;
- split lot drainage;
- Roof-leaders to vegetated areas;
- vegetation planting.

6.2 Lot Grading

There is an elevation difference of approximately 0.8m from north to south in 1650 Shea Road. In accordance with local municipal standards, the private roads will be graded northeast between 0.5% and 5.0%. Most landscaped area drainage will be directed to the storm sewer system. Copies of the grading plans have been included in **Appendix E**.

Along the perimeter of the site, smooth grading transitions were not possible. A large retaining wall is required along Shea Road. 3:1 terracing is required along the northern and western property lines in order to transition down to existing grade.

6.3 Roof Leaders

This development will consist of back to back townhomes. It is proposed that roof leaders from these units be constructed such that runoff is directed to grass areas adjacent to the units. This will promote water quality treatment through settling, absorption, filtration and infiltration and a slow release rate to the conveyance network.

6.4 Vegetation

As with most subdivision agreements, the developer will be required to complete a vegetation and planting program. Vegetation throughout the development including planting along roadsides where possible.

7 CONVEYANCE CONTROLS

7.1 General

Besides source controls, the development also proposes to use several conveyance control measures to improve runoff quality. These will include:

- catchbasin and maintenance hole sumps; and

7.2 Catchbasins

All catchbasins within the development, either rear yard or street, will be constructed with minimum 600 mm deep sumps. These sumps trap pollutants, sand, grit and debris which can be mechanically removed prior to being flushed into the minor pipe system. Both rear yard and street catchbasins will be fabricated to OPSD 705.010 or 705.020. All storm sewer maintenance holes servicing local sewers less than 900 mm diameter shall be constructed with a 300 mm sump as per City standards.

8 SEDIMENT AND EROSION CONTROL PLAN

8.1 General

During construction, existing stream and conveyance systems can be exposed to significant sediment loadings. Although construction is only a temporary situation, it is proposed to introduce a number of mitigative construction techniques to reduce unnecessary construction sediment loadings. These will include:

- groundwater in trench will be pumped into a filter mechanism prior to release to the environment;
- bulkhead barriers will be installed at the nearest downstream manhole in each sewer which connects to an existing downstream sewer;
- seepage barriers will be constructed in any temporary drainage ditches; and
- silt sacks will remain on open surface structure such as manholes and catchbasins until these structures are commissioned and put into use.

8.2 Trench Dewatering

During construction of municipal services, any trench dewatering using pumps will be discharged into a filter trap made up of geotextile filters and straw bales similar in design to the OPSD 219.240 Dewatering Trap. These will be constructed in a bowl shape with the fabric forming the bottom and the straw bales forming the sides. Any pumped groundwater will be filtered prior to release to the existing surface runoff. The contractor will inspect and maintain the filters as needed including sediment removal and disposal and material replacement as needed.

8.3 Bulkhead Barriers

At the first manhole constructed immediately upstream of an existing sewer, a ½ diameter bulkhead will be constructed over the lower half of the out-letting sewer. This bulkhead will trap any sediment carrying flows, thus preventing any construction –related contamination of existing sewers. The bulkheads will be inspected and maintained including periodic sediment removal as needed.

8.4 Seepage Barriers

These barriers will consist of both the Light Duty Straw Bale Barrier as per OPSD 219.100 or the Light Duty Silt Fence Barrier as per OPSD 219.110 and will be installed in accordance with the sediment and erosion control drawing. The barriers are typically made of layers of straw bales or geotextile fabric staked in place. All seepage barriers will be inspected and maintained as needed.

8.5 Surface Structure Filters

All catchbasins, and to a lesser degree, manholes, convey surface water to sewers. However, until the surrounding surface has been completed these structures will be covered to prevent sediment from entering the minor storm sewer system. Until rear yards are sodded or until streets are asphalted and curbed, all catchbasins and manholes will be equipped with geotextile filter socks. These will stay in place and be maintained during construction and build until it is appropriate to remove them.

8.6 Stockpile Management

During construction of any development similar to that being proposed both imported and native soils are stockpiled. Mitigative measures and proper management to prevent these materials entering the sewer systems is needed.

During construction of the deeper municipal services, water, sewers and service connections, imported granular bedding materials are temporarily stockpiled on site. These materials are however quickly used up and generally before any catchbasins are installed. Street catchbasins are installed at the time of roadway construction and rear-yard catchbasins are usually installed after base course asphalt is placed.

Contamination of the environment as a result of stockpiling of imported construction materials is generally not a concern since these materials are quickly used and the mitigative measures stated previously, especially the use of filter fabric in catchbasins and manholes help to manage these concerns.

The roadway granular materials are not stockpiled on site. They are immediately placed in the roadway and have little opportunity of contamination. Lot grading sometimes generates stockpiles of native materials. However, this is only a temporary event since the materials are quickly moved off site.

The construction of this development will involve a substantial rock blasting, breaking and crushing operation. Given the existing topography, a substantial cut and fill operation is required in order to construct a development that meets City Standards. As part of this operation, materials will be manipulated onsite, and provided the sediment and erosion control measures are in place, are generally inconsequential to the surrounding environment.

9 ROADS AND NOISE ATTENUATION

Vehicular access to 1650 Shea Road is provided by three private entrances, two from Shea Road and one from Cosanti Drive.

There are no sidewalks or pathways proposed within the development. Pedestrian access to the site will be via the private roadway.

The site has been designed to provide curbside municipal waste disposal.

There are no bus routes proposed within 1650 Shea Road.

Environmental Noise measures and/or clauses will be required for the majority of units adjacent to Shea Road and Cosanti. There are no outdoor living areas, therefore no attenuation barriers will be required.

9.1 Aircraft Sound Levels

As stated in Section 2.1, the site is within the Airport Vicinity Development Zone (AVDZ), the limit of the AVCZ is shown on Figure 2. The site, however, is outside of the 25 NEF/NEP contour line, so the building components and ventilation requirements of Part 6 Prescribed Measures for Aircraft Noise of the Guidelines do not apply. A warning clause is required for the residential units inside the AVDZ.

Warning clause for aircraft noise is as follows:

“Purchasers/tenants are advised that due to the proximity of the airport, noise from the airport and individual aircraft may at times interfere with outdoor or indoor activities”.

10 SOILS

GEMTEC Consulting Ltd. was retained to prepare a geotechnical investigation for the proposed mixed use development for the 1650 Shea Road. The objectives of the investigation were to prepare a report to:

- Determine the subsoil and groundwater conditions at the site by means of test pits and boreholes and;
- To provide geotechnical recommendations pertaining to design of the proposed development including construction considerations.

The geotechnical report 63900.02-LET.01 was prepared by GEMTEC Consulting Ltd. in July 2020. The report contains recommendations which include but are not limited to the following:

- The maximum permissible grade raise is 3.5m
- In areas where finished grade exceeds grade raise limits, geotechnical reviews are required
- Fill placed below the foundations to meet OPSS Granular 'A' or Granular 'B' Type II placed in 300 mm lifts compacted to 98% SPMDD.
- Fill for roads to be suitable native material in 300mm lifts compared to 95% SPMDD

Pavement Structure:

LOCAL ROAD	THICKNESS
Asphaltic Concrete	90mm
OPSS Granular A Base	150mm
OPSS Granular B Type II Subbase	400mm

- Pipe bedding and cover; bedding to be minimum 150 mm OPSS Granular 'A' up to spring line of pipe. Cover to be 300 mm OPSS A (PUC and concrete pipes) or sand for concrete pipes. Both bedding and cover to be placed in maximum 225 mm lifts compacted to 95% SPMDD.

In general, the grading plan for 1650 Shea Road adheres to the grade raise constraints noted above. A copy of the grading plans is included in **Appendix E**. The site does not pose any significant grade raise; thus, a grading plan review letter is not required for this development.

11 RECOMMENDATIONS


Water, wastewater and stormwater systems required to develop 1650 Shea Road will be designed in accordance with MOE and City of Ottawa's current level of service requirements.

The use of lot level controls, conveyance controls and end of pipe controls outlined in the report will result in effective treatment of surface stormwater runoff from the site. Adherence to the proposed sediment and erosion control plan during construction will minimize harmful impacts on surface water.

Final detail design will be subject to governmental approval prior to construction, including but not limited to the following:

- 1650 Shea Road Commence Work Order: City of Ottawa
- ECA for Sewage Works: MOECP Transfer of Review by City of Ottawa
- 1650 Shea Road Watermain Approval: City of Ottawa

Report prepared by:



Demetrius Yannouloupoulos, P.Eng.
Director

A handwritten signature in blue ink, appearing to read "Ryan Magladry".

Ryan Magladry, C.E.T.
Project Manager

APPENDIX A

139185-001

City of Ottawa Pre-Consultation Meeting Notes
STANTEC Plan of Subdivision for the Davidson Lands Phase 2
Site Plan for 1650 Shea Road 2024-03-26
Revised Block 10 Site Plan 2024-08-12
General Plan of Services

Pre-Application Consultation Meeting Minutes

1650 Shea Road, Ottawa

1:00 PM to 2:00 PM, February 18, 2022

MS Teams

Attendees:

Molly Smith - Planner (File Lead), City of Ottawa
Eric Surprenant - Project Manager (Engineering), City of Ottawa
Adrian Van Wyk - Planner (Urban Design), City of Ottawa
Mike Giampa - Project Manager (Transportation), City of Ottawa
Matthew Hayley - Planner (Environmental Planning), City of Ottawa
Mark Richardson - Planning Forester (Forestry), City of Ottawa
Ashvinya Moorthy - Student Planner, City of Ottawa

Applicant Team:

Melissa Cote (Taggart)
Ryan Magladry (Engineer)
David Hook (Transportation Engineer)
Tyer Ferguson (Cardel Homes)
Peter Hume (Applicant)

Site-Wide Overview:

1. Pre-application consultation meeting for a Site Plan Control (Complex) and a Plan of Condo. The subject site size is 2.08 hectares and is registered as Block 175 on the phase 2 plan registration for the Edenwylde Subdivision. The site will provide back-to-back townhomes with 270 m frontage meters on Shea Road and 100 m frontage on Cosanti Drive and a hydro corridor to the west of the site. to the north of the site is a future commercial space.
2. 116 back-to-back townhouse units will be provided with two accesses to the site, one off Shea Road and the other off Cosanti Drive. Internal roads will be available throughout the site as private laneways that are either 6 metres or 8.5 metres in width, the 8.5 metre width is for on street parking. A turning radiuses of 20m with a minimum width of 12 m will allow fire services and garbage trucks around the site.
3. The lane along the west boundary of the site is along the Hydro 1 Corridor, connecting to Cosanti Drive.
4. The narrow block along Shea Road and Cosanti Drive is 3 m in width and it is there for a retaining wall.

Preliminary comments and questions

Parks

1. With the proposed development at 1650 Shea Road, the total density in the Edenwyld Subdivision area (e.g. D07-16-15-0008) is 784 units. As the subdivision approvals – including development at 1650 Shea Road – and parkland dedication was associated with 731 units, cash-in-lieu of parkland is owed for the increase in density of 53 units.
 - CIL requirement: 1 ha/500 units
 - 53 units = **1,060 sq.m.**

The cash-in-lieu of parkland dedication shall be directed 60% towards the Ward 21 cash-in-lieu of parkland reserve and 40% towards the City-wide cash-in-lieu of parkland reserve. The Owner further agrees to pay the cost of preparing a land valuation appraisal. The value of the land shall be determined as of the day before Site Plan approval.

2. There is no delegated authority for waiving the requirements of the Parkland Dedication By-law 2009-95, as amended. Only City Council has the authority to waive any requirements of the Parkland Dedication By-law.
3. Parks and Facilities Planning is currently undertaking a legislated review for the replacement of the Parkland Dedication By-law, with the new by-law to be considered by City Council in early July 2022. To ensure you are aware of parkland dedication requirements for your proposed development, we encourage you to familiarize yourself with the [existing Parkland Dedication By-law](#) and to sign up for project notifications on the [Engage Ottawa project page](#) or by emailing the project lead at Kersten.Nitsche@ottawa.ca

Please contact Kersten Nitsche, Parks Planner, at kersten.nitsche@ottawa.ca, if you have any questions or require additional information relating to the comments above.

Environmental Planning

1. The GeoOttawa mapping for this site shows a watercourse and an unevaluated wetland. These features should have been addressed in the subdivision however the EIS doesn't indicate they are present. Please confirm presence/absence of the mapped watercourse and confirm with the Conservation Authority. If the watercourse is indeed present, and its realignment wasn't addressed in the subdivision then the policies of the New OP Section 4.9.3 will apply.

Please contact Matthew Hayley, Environmental Planner, at Matthew.Hayley@ottawa.ca, if you have any questions or require additional information relating to the comments above.

Forestry

TCR requirements (if any trees identified):

1. A Tree Conservation Report (TCR) must be supplied for review along with the suite of other plans/reports required by the City
 - a. an approved TCR is a requirement of Site Plan approval.

- b. The TCR may be combined with the LP provided all information is supplied
2. Any removal of privately-owned trees 10cm or larger in diameter, or city-owned trees of any diameter requires a tree permit issued under the Tree Protection Bylaw (Bylaw 2020 – 340); the permit will be based on an approved TCR and made available at or near plan approval.
3. The Planning Forester from Planning and Growth Management as well as foresters from Forestry Services will review the submitted TCR
 - a. If tree removal is required, both municipal and privately-owned trees will be addressed in a single permit issued through the Planning Forester
 - b. Compensation may be required for city owned trees – if so, it will need to be paid prior to the release of the tree permit
4. the TCR must list all trees on site, as well as off-site trees if the CRZ extends into the developed area, by species, diameter and health condition
5. please identify trees by ownership – private onsite, private on adjoining site, city owned, co-owned (trees on a property line)
6. If trees are to be removed, the TCR must clearly show where they are, and document the reason they cannot be retained
7. All retained trees must be shown, and all retained trees within the area impacted by the development process must be protected as per City guidelines available at [Tree Protection Specification](#) or by searching Ottawa.ca
 - a. the location of tree protection fencing must be shown on the plan
 - b. show the critical root zone of the retained trees
 - c. if excavation will occur within the critical root zone, please show the limits of excavation
8. the City encourages the retention of healthy trees; if possible, please seek opportunities for retention of trees that will contribute to the design/function of the site.
9. For more information on the process or help with tree retention options, contact Mark Richardson mark.richardson@ottawa.ca or on [City of Ottawa](#)

LP tree planting requirements:

For additional information on the following please contact tracy.smith@Ottawa.ca

Minimum Setbacks

- Maintain 1.5m from sidewalk or MUP/cycle track.
- Maintain 2.5m from curb
- Coniferous species require a minimum 4.5m setback from curb, sidewalk or MUP/cycle track/pathway.
- Maintain 7.5m between large growing trees, and 4m between small growing trees. Park or open space planting should consider 10m spacing, except where otherwise approved in naturalization / afforestation areas. Adhere to Ottawa Hydro's planting guidelines (species and setbacks) when planting around overhead primary conductors.

Tree specifications

- Minimum stock size: 50mm tree caliper for deciduous, 200cm height for coniferous.
- Maximize the use of large deciduous species wherever possible to maximize future canopy coverage

- Tree planting on city property shall be in accordance with the City of Ottawa’s Tree Planting Specification; and include watering and warranty as described in the specification (can be provided by Forestry Services).
- Plant native trees whenever possible
- No root barriers, dead-man anchor systems, or planters are permitted.
- No tree stakes unless necessary (and only 1 on the prevailing winds side of the tree)

Hard surface planting

- Curb style planter is highly recommended
- No grates are to be used and if guards are required, City of Ottawa standard (which can be provided) shall be used.
- Trees are to be planted at grade

Soil Volume

- Please ensure adequate soil volumes are met:

Tree Type/Size	Single Tree Soil Volume (m3)	Multiple Tree Soil Volume (m3/tree)
Ornamental	15	9
Columnar	15	9
Small	20	12
Medium	25	15
Large	30	18
Conifer	25	15

Please note that these soil volumes are not applicable in cases with Sensitive Marine Clay.

Sensitive Marine Clay

- Please follow the City’s 2017 Tree Planting in Sensitive Marine Clay guidelines

Tree Canopy Cover

- The landscape plan shall show how the proposed tree planting will replace and increase canopy cover on the site over time, to support the City’s 40% urban forest canopy cover target.
- At a site level, efforts shall be made to provide as much canopy cover as possible, through tree planting and tree retention, with an aim of 40% canopy cover at 40 years, as appropriate.
- Indicate on the plan the projected future canopy cover at 40 years for the site.

Please contact Mark Richardson, Planning Forester, at Mark.Richardson@ottawa.ca, if you have any questions or require additional information relating to the comments above.

Infrastructure

1. Site Plan should not proceed until such time as there is an approved plan for the off-site stormwater management channel.
2. The roads should all be private (operations are not willing to take on maintenance of such streets due to very problematic maintenance).
3. The (public) road as shown on the concept plan is 1/2 private and 1/2 public where it intersects with Cossanti Dr. , which would be unacceptable.
4. Hydro sign off would be required with specific recognition of street located parallel to Hydro circuits and inside corridor.
5. Subdivision drawings and design still outstanding and implementation of street inside HONI corridor would need to be reflected on all subdivision drawings to assess impacts on (Stormwater Management, Grading, Dry Pond etc.. and would need to be recirculated to Stormwater Operations Group).
6. Major Flows would need to respect Subdivision design.
7. Boundary conditions to be requested.
8. FUS and Hydrant coverage calcs to reflect back to back units.
9. Shea Road widening to be provided and shown.
10. Retaining walls to be located onto private property.
11. Full geotechnical design to be provided.
12. Ditch cleaning along Shea Road to be completed.

Please contact Eric Surprenant, Infrastructure Project Manager, at eric.surprenant@ottawa.ca, if you have any questions or require additional information relating to the comments above.

Urban Design

1. An Urban Design Brief will be required. Please see the attached Terms of Reference.
2. The proposed street layout is circuitous. It is strongly recommended that the western side street be extended to Cosanti Drive and aligned with Ocala Street – please see attached illustrations.
3. The buildings located closest to Cosanti Drive should have frontage on that street – please see attached illustration.
4. Tree planting should be provided within the PUD and along Shea Road and Cosanti Drive, taking into account the requirements for marine clay soils.
5. Impervious asphalt should be kept to a minimum. The applicant should consider sustainable design measures such as permeable paving, bulb outs, bioswales and opportunities to introduce soft landscaping wherever possible.
6. Please consider pedestrian circulation throughout the site and provide some sidewalks in appropriate locations.

Transportation

1. Submit a screening form. If a TIA is warranted proceed to scoping.
2. The application will not be deemed complete until the submission of the draft step 2-4, including the functional draft RMA package (if applicable) and/or monitoring report (if applicable). Although a full review of the TIA Strategy report (Step 4) is not required prior to an application, it is strongly recommended.
3. Synchro files are required at Step 4.

4. As identified in the Fernbank Community Design Plan, Shea Road has a 26m ROW, please ensure the site plan accommodates.
5. Corner sight triangle: 5m x 5m.
6. A Road Noise Impact Study is required.
7. For the Shea Road access, ensure that the clear throat requirement is per TAC guidelines.

Please contact Mike Giampa, Project Manager (Transportation), at Mike.Giampa@ottawa.ca, if you have any questions or require additional information relating to the comments above.

Planning

1. In the period between Council approval of the New Official Plan and the Ministry's approval of the New Official Plan, City staff will apply whichever provision, as between the Current and New Official Plan, is more restrictive. However, both of the Official Plan documents must be reviewed in the planning rationale. It should be noted that the Current Official Plan designates the property under 'General Urban Area' and 'Developing Community (Expansion Area)'. The New Official Plan designates the property 'Suburban' under schedule B5 - Suburban (West) Transect.
2. The site is currently zoned R4Z[2415] (Residential Fourth Density Zone, Subzone Z, Exception 2415).
 - o Exception 2415 lists additional permitted and prohibited uses. Please refer to the exception [table](#) to examine the requirements further.
3. As per the Zoning-Bylaw, full analysis of the relevant sections will be required since this site would be considered a PUD. Please note the zoning requirements in Section 131 in terms of the building separation; in the case that the maximum height is being met, the building separation would be 1.3 m from each building.
4. Please provide architectural articulation on building facades abutting a street or walkway.
5. Opportunities for tree planting and landscaping throughout the site is strongly encouraged.
6. Provide a safe pedestrian/cycling connection to Cosanti Drive.
7. Please ensure that the proposed driveways meet the requirements of the minimum width that is permitted.
8. Shea Road has a ROW of 26m, please accommodate.
9. In the Planning Rationale, please explain how maintenance and operations works with the hydro easement and road maintenance.
10. Reaching out to ward councilor Scott Moffatt is encouraged.

Please contact Molly Smith, Planner, at molly.smith@ottawa.ca, if you have any questions or require additional information relating to the comments above.

Next Steps

Please refer to the links to [Guide to preparing studies and plans](#) and [fees](#) for further information. Additional information is available related to [building permits](#), [development charges](#), and the [Accessibility Design Standards](#). Be aware that other fees and permits may be required, outside of the development review process. You may obtain background drawings by contacting informationcentre@ottawa.ca.

These pre-consultation comments are valid for one year. If you submit a development application(s) after this time, you may be required to meet for another pre-consultation meeting and/or the submission requirements may change. You are as well encouraged to contact us for a follow-up meeting if the plan/concept will be further refined.

Please do not hesitate to contact Molly Smith, at molly.smith@ottawa.ca if you have any questions.

SITE PLAN OF

**BLOCK 175
AND PART OF BLOCK 176
REGISTERED PLAN 4M-1689
CITY OF OTTAWA**


PIN 04449-3211 (ALL OF BLOCK 175)
PIN 04449-3212 (PART OF BLOCK 176)



Bylaw Section	Zoning Mechanism	Zoning Standard	Provided	Compliant
R4Z	Minimum Front Yard	3m	4.37m	YES
	Minimum Corner Side Yard	3m	6.03m	YES
	Minimum Interior Yard	1.2m	16.25m	YES
	Minimum Rear Yard abutting GM Zone	0m	13.72	YES
	Minimum Width of Landscaped Area Abutting a Street	3m	3.2m	YES
Exemption 2415	Maximum Building Height	12m	12m	YES
	Lot Area	85 sq. m.	85 sq. m.	YES
PUD (S131)	Maximum Block Size	10	10	YES
	Maximum Units in a Row	5	5	YES
	Minimum Width of Private Way	6m	6m	YES
	Minimum Setback for any Wall of a Residential use Building to a Private	1.8m	5.2m	YES
	Minimum Setback for any Garage from a Private Way	5.2m	5.2m	YES
	Minimum Separation area between Buildings within a PUD	1.2m	4m	YES
S-101	Parking - 1 per dwelling Unit	116	116	YES
S-102	Visitor Parking - Not Required - Section 102 Subsection (4)	0	0	YES

BLOCK	NO. UNITS	LOT AREA (m ²)	BUILDING AREA(m ²)	LOT COVERAGE	ASPHALT (m ²)
1	10	1319.7	496.2	37.6%	209.6
2	6	867.4	379.0	43.7%	108.9
3	8	1043.0	486.4	46.6%	167.5
4	8	1037.7	399.1	38.4%	173.1
5	8	1013.6	428.61	42.2%	174.0
6	8	1069.4	399.1	37.3%	174.0
7	8	922.7	399.1	43.3%	174.0
8	10	1213.2	496.2	40.9%	213.0
9	10	1242.7	525.9	42.3%	213.0
10	10	1331.1	594.0	44.6%	201.2
11	10	1327.7	594.0	44.7%	201.2
12	10	1475.9	594.0	40.2%	298.4
13	10	1126.1	594.0	52.7%	201.6

TOTAL NO. UNITS= 116
SITE AREA= 2,3194 Ha
ASPHALT AREA= 2511.3 m²

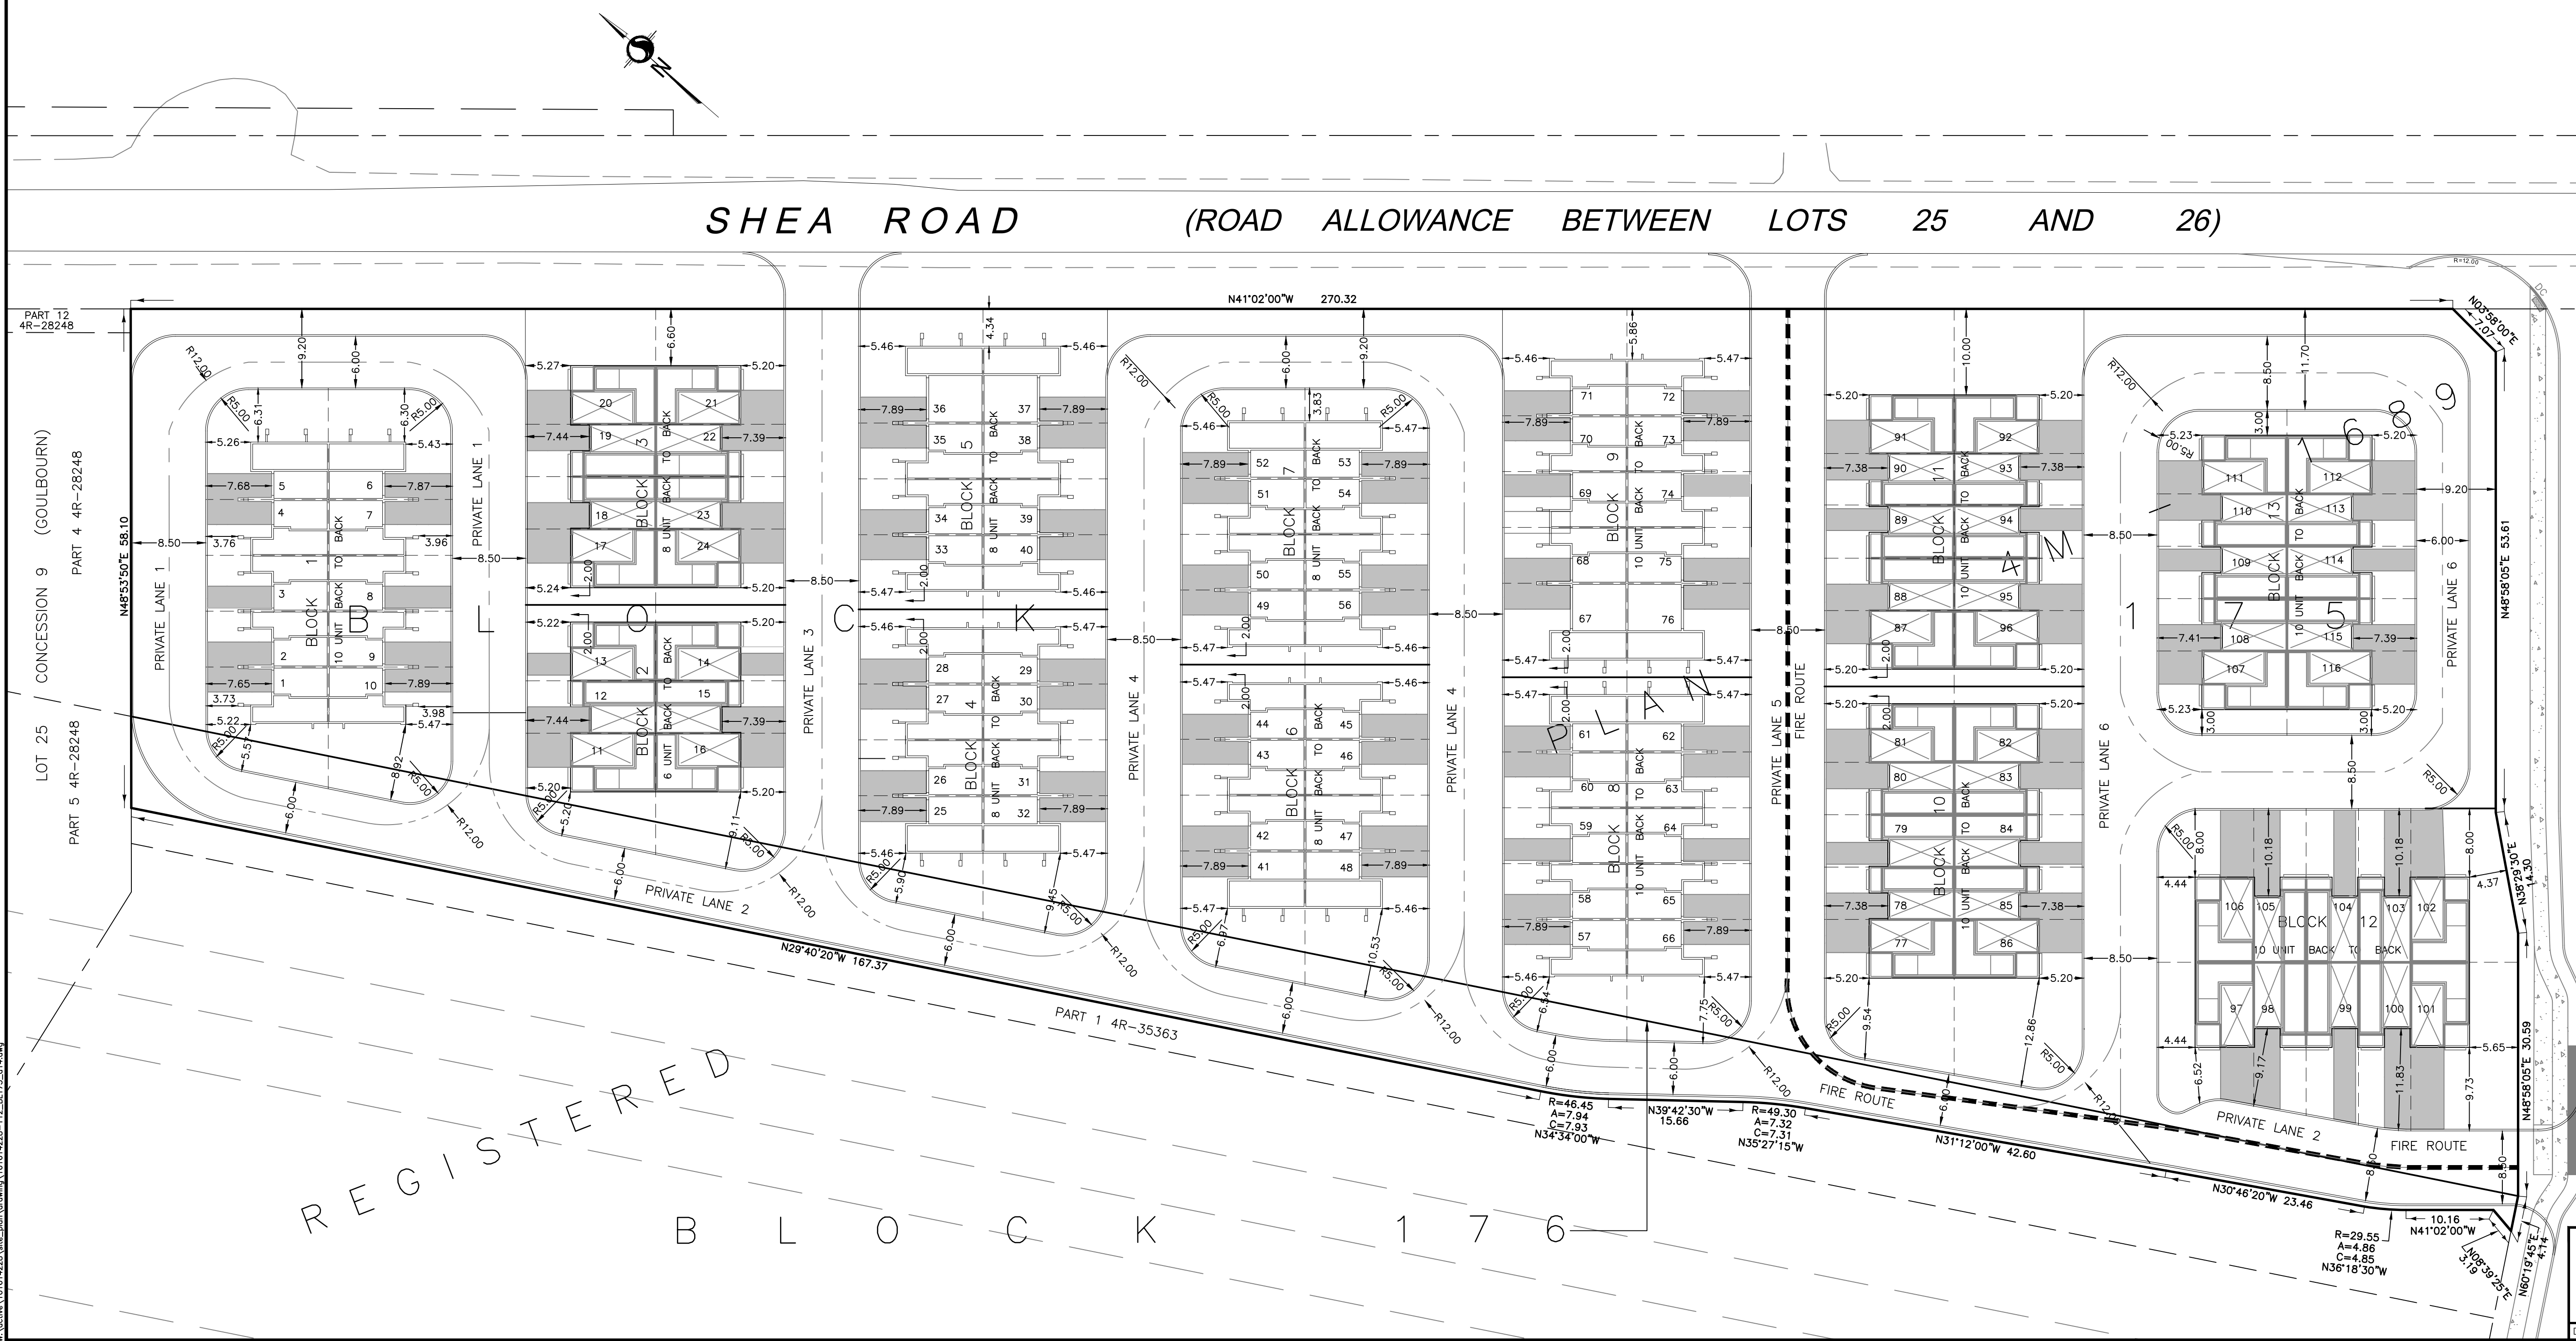

EDENWYLDE DEVELOPMENT

DESIGNER / OWNER:

DAVIDSON CO-TENANCY AND TAMARACK HOMES
3187 ALBION ROAD SOUTH,
OTTAWA, ONTARIO
K1V 8Y3

ENGINEER:

IBI GROUP
SUITE 500, 333 PRESTON STREET
OTTAWA, ONTARIO
K1S 5N4

TRANSPORTATION ENGINEER:

IBI GROUP
SUITE 500, 333 PRESTON STREET
OTTAWA, ONTARIO
K1S 5N4

LANDSCAPE ARCHITECT:


NAK DESIGN STRATEGIES
1285 WELLINGTON STREET WEST
OTTAWA, ONTARIO
K1Y 3A8

Revision

Date	Details	No.
3/16/2023	Revised Boundary	d8
12/6/2023	Revised Blocks 5, 9, 10 & 11	d9
12/12/2023	Revised Blocks 1 - 12	d10
12/12/2023	Revised West Site Boundary	d11
1/24/2024	Revised BLOCK 12	d12
2/07/2024	Revised from base plan	d13
3/26/2024	Revised BLOCKS 2, 8, 9 & 10	d14

Stantec
CANADA LAND SURVEYORS
ONTARIO LAND SURVEYORS
1331 CLYDE AVENUE, SUITE 300
OTTAWA, ONTARIO, K2C 3G4
TEL: 413-724-4400
stantec.com

DRAWN: ME CHECKED: PWC FL FIELD: PROJECT No.: 161614228-112



**M. David Blakely
Architect Inc.**

2200 Prince of Wales Dr. Suite 101 Nepean, Ontario
Phone (613) 226-8811 Fax (613) 226-7942

GENERAL NOTES:

- 1 - THE CONTRACTOR IS RESPONSIBLE FOR CHECKING AND VERIFYING ALL DIMENSIONS. ANY DISCREPANCY MUST BE REPORTED TO M. DAVID BLAKELY ARCH. INC.
- 2 - ALL WORK AND MATERIALS TO BE IN COMPLIANCE WITH ALL CODES, REGULATIONS, & BY-LAWS
- 3 - ADDITIONAL DRAWINGS MAY BE ISSUED FOR CLARIFICATION TO ASSIST THE PROPER EXECUTION OF WORK. SUCH DRAWINGS WILL HAVE THE SAME MEANING AND INTENT AS IF THEY WERE INCLUDED WITH THE PLANS IN CONTRACT DOCUMENTS
- 4 - DO NOT SCALE DRAWINGS.
- 5 - THIS DRAWING SHALL NOT BE USED OR COPIED WITHOUT THE AUTHORIZATION OF THE ARCHITECT
- 6 - THIS DRAWING SHALL NOT BE USED FOR PERMIT OR CONSTRUCTION UNLESS THE DRAWING BEARS THE ARCHITECT'S SEAL AND SIGNATURE
- 7 - THIS REPRODUCTION SHALL NOT BE ALTERED.

#	DATE:	DESCRIPTION	MB Int.
10.			
9.			
8.			
7.			
6.			
5.			
4.			
3.			
2.			
1.	12/08/24	FOR REVIEW	MB

REVISIONS

	A - DETAIL NUMBER
	B - SHEET NUMBER (DETAIL REQUIRED)
	C - SHEET NUMBER (DETAIL LOCATION)

SEAL:

PROJECT: EDENWYLDE
PLANNED UNIT DEVELOPMENT
OTTAWA, ONTARIO

CLIENT: CARDEL HOMES

DRAWING TITLE: PRELIMINARY SITE PLAN
BLOCK 10

DATE: AUG. 2024	SCALE: 1:400	SHEET #: SP1
DRAWN BY: mdb	CHECKED: MDB	



BASE PLAN DERIVED FROM SITE PLAN OF BLOCK 175 AND PART OF BLOCK 176 REGISTERED PLAN 4M-1689 CITY OF OTTAWA, PREPARED BY STANTEC GEOMATICS LTD., REV. d15, DATED 7/22/2024.

promenade Cosanti Drive



CLIENT
DAVIDSON SHEA
PROPERTY INC.

COPYRIGHT
This drawing has been prepared solely for the intended use. Any reproduction or distribution for any purpose other than authorized by IBI Group is forbidden. Written dimensions shall have precedence over scaled dimensions. Contractors shall verify and be responsible for all dimensions and conditions on the job, and IBI Group shall be relieved of any liabilities from the dimensions and conditions shown on the drawing. Shop drawings shall be submitted to IBI Group for general concurrence before proceeding with fabrication.

IBI Group Professional Services (Canada) Inc.
is a member of the IBI Group of companies.

ISSUES		
No.	DESCRIPTION	DATE
1	SUBMISSION NO 1 FOR CITY REVIEW	2022-09-15
2	SUBMISSION NO 2 FOR CITY REVIEW	2024-06-27
3	REVISED PER CITY COMMENTS	2025-03-21
4	REVISED PER NEW SITE PLAN	2025-05-12
5	SUBMISSION NO 4 FOR CITY REVIEW	2024-07-31
6		
7		
8		

SEE 010, 011 FOR NOTES, LEGEND, CB TABLE, STREET SECTIONS AND DETAILS

KEY PLAN
001

CONSULTANTS

SEAL

PROJECT
1650 SHEA ROAD
(OTTAWA, ON)

PROJECT NO:
139185

DRAWN BY:
M.M.

CHECKED BY:
R.M./D.Y.

PROJECT MGR:
R.M.

APPROVED BY:
R.M./D.Y.

SHEET TITLE
GENERAL PLAN

SHEET NUMBER
001

ISSUE
5

CITY PLAN No. 19029

CITY FILE No. D07-12-23-0032

Scale: 1:500

File Location: \\1139185_1650_Shea_Road\0_Production\02_Design\04_Civil\Shea\001-GENERAL PLAN.dwg
Last Saved: July 24, 2025, 4:32:35 PM by Mihai, Marian

APPENDIX B

Ontario Building Code Calculations and Tables
Boundary Conditions
Water Demand Calculation Sheet
Fire Flow Calculations
Water Distribution Model

Boundary Conditions 1650 Shea Road

Provided Information

Scenario	Demand	
	L/min	L/s
Average Daily Demand	62	1.03
Maximum Daily Demand	155	2.58
Peak Hour	341	5.68
Fire Flow Demand 1	11,000	183.33
Fire Flow Demand 2	12,000	200.00
Fire Flow Demand 3	13,000	216.67
Fire Flow Demand 4	14,000	233.33

Location



Results

Connection 1 – Jardinière Street

Demand Scenario	Head (m)	Pressure ¹ (psi)
Maximum HGL	160.7	79.1
Peak Hour	154.9	70.9
Max Day plus Fire Flow #1	128.3	33.0
Max Day plus Fire Flow #2	123.5	26.1
Max Day plus Fire Flow #3	118.4	18.9
Max Day plus Fire Flow #4	112.9	11.1

¹ Ground Elevation = 105.1 m

Connection 2 – Cosanti Drive

Demand Scenario	Head (m)	Pressure ¹ (psi)
Maximum HGL	160.7	79.3
Peak Hour	154.9	71.1
Max Day plus Fire Flow #1	129.8	35.4
Max Day plus Fire Flow #2	125.3	29.0
Max Day plus Fire Flow #3	120.5	22.1
Max Day plus Fire Flow #4	115.4	14.8

¹ Ground Elevation = 104.9 m

Notes

1. Demands for proposed Connection 2 at existing water main stub on Cosanti Drive were assigned to upstream junction at Cosanti Drive & Ocala Street off the public looped watermain. The engineer must calculate headloss off the proposed future watermain network.
2. Per the OWDG Section 4.2.2:
 - o During periods of maximum day and fire flow demand, the residual pressure at any point in the distribution system shall not be less than 20 psi.

Disclaimer

The boundary condition information is based on current operation of the city water distribution system. The computer model simulation is based on the best information available at the time. The operation of the water distribution system can change on a regular basis, resulting in a variation in boundary conditions. The physical properties of watermain deteriorate over time, as such must be assumed in the absence of actual field test data. The variation in physical watermain properties can therefore alter the results of the computer model simulation. Fire Flow analysis is a reflection of available flow in the watermain; there may be additional restrictions that occur between the watermain and the hydrant that the model cannot take into account.



IBI GROUP
333 PRESTON STREET
OTTAWA, ONTARIO
K1S 5N4

WATERMAIN DEMAND CALCULATION SHEET

PROJECT : 1650 Shea Road
LOCATION : City of Ottawa
CLIENT : Taggart

FILE: 139185-6.4.4
DATE PRINTED: 19-Mar-25
DESIGN: WZ
PAGE: 1 OF 1

NODE	RESIDENTIAL				NON-RESIDENTIAL (ICI)			AVERAGE DAILY DEMAND (l/s)			MAXIMUM DAILY DEMAND (l/s)			MAXIMUM HOURLY DEMAND (l/s)			FIRE DEMAND (l/min)
	SINGLE FAMILY UNITS	TOWNHOUSE / BACK TO BACK UNITS	MEDIUM DENSITY UNITS	POPULATION	INDUST. (ha)	COMM. (ha)	INSTIT. (ha)	RESIDENTIAL	ICI	TOTAL	RESIDENTIAL	ICI	TOTAL	RESIDENTIAL	ICI	TOTAL	
Node 1		3		8.1				0.03		0.03	0.07		0.07	0.14		0.14	9,000
Node 2		7		18.9				0.06		0.06	0.15		0.15	0.34		0.34	9,000
Node 3		7		18.9				0.06		0.06	0.15		0.15	0.34		0.34	9,000
Node 4		2		5.4				0.02		0.02	0.04		0.04	0.10		0.10	9,000
Node 5		5		13.5				0.04		0.04	0.11		0.11	0.24		0.24	9,000
Node 6		8		21.6				0.07		0.07	0.18		0.18	0.39		0.39	9,000
Node 7		8		21.6				0.07		0.07	0.18		0.18	0.39		0.39	9,000
Node 8		8		21.6				0.07		0.07	0.18		0.18	0.39		0.39	9,000
Node 9		9		24.3				0.08		0.08	0.20		0.20	0.43		0.43	9,000
Node 10		9		24.3				0.08		0.08	0.20		0.20	0.43		0.43	9,000
Node 11		8		21.6				0.07		0.07	0.18		0.18	0.39		0.39	9,000
Node 12		6		16.2				0.05		0.05	0.13		0.13	0.29		0.29	9,000
Node 13		4		10.8				0.04		0.04	0.09		0.09	0.19		0.19	9,000
Node 14		5		13.5				0.04		0.04	0.11		0.11	0.24		0.24	9,000
Node 15		12		32.4				0.11		0.11	0.26		0.26	0.58		0.58	9,000
Node 16		5		13.5				0.04		0.04	0.11		0.11	0.24		0.24	9,000
Node 17		5		13.5				0.04		0.04	0.11		0.11	0.24		0.24	9,000
Node 18		7		18.9				0.06		0.06	0.15		0.15	0.34		0.34	9,000
Total		118		318.6				1.03		1.03	2.58		2.58	5.68		5.68	

POPULATION DENSITY		WATER DEMAND RATES		PEAKING FACTORS		FIRE DEMANDS		ICI Areas	
Single Family	3.4 persons/unit	Residential	280 l/cap/day	Maximum Daily		Single Family	10,000 l/min (166.7 l/s)	INST	28,000 L/Ha/day
Semi Detached & Townhouse	2.7 persons/unit			Residential	2.5 x avg. day			COM	28,000 L/Ha/day
2 Bedroom Unit	2.1 persons/unit			Maximum Hourly		Semi Detached & Townhouse	10,000 l/min (166.7 l/s)	IND	35,000 L/Ha/day
Medium Density	1.8 persons/unit			Residential	2.2 x max. day				17,000 L/Ha/day
						Medium Density	15,000 l/min (250 l/s)		

Block 11

Required Fire Water Supply (Q) per OBC:	
$Q = K V S_{tot}$	Q = Minimum Supply of water in litres K = Water Supply Coefficient from Table 1 V = Total Building Volume in Cubic Meters S_{tot} = Total of Spaital coefficient values from property line exposures on all sides $S_{tot} = 1.0 + [S_{side\ 1} + S_{side\ 2} + \dots]$

Water Supply Coefficient (K)	
Building Group Classification:	C - Residential Occupancies
From Table 1, K =	23

Building Volume (V)	
Block 11 (10 Units)	
length =	35
width =	18
height =	12 (10.2 m from basement slab to upper level ceiling + 1.8 m to roof midpoint)
Building Volume (V):	7560 m ³

Spatial Coefficient (S):		
Side	Dist	S _{coeff}
Front	18.6	0
Back	19.4	0
Left	n/a	0
Right	4	0.5
Total		0.5

Therefore $S_{tot} = 1.5$

Required Fire Water Supply (Q) per OBC:	
$Q = K V S_{tot}$	
$Q = (23) (7680) (1.5)$	
Q =	260820
From Table 2: Q > 190000 L and < 270000 L	
Therefore Target Flow = 6300 l/min	



Block 10

Required Fire Water Supply (Q) per OBC:	
$Q = K V S_{tot}$	<p>Q = Minimum Supply of water in litres K = Water Supply Coefficient from Table 1 V = Total Building Volume in Cubic Meters S_{tot} = Total of Spaital coefficient values from property line exposures on all sides $S_{tot} = 1.0 + [S_{side\ 1} + S_{side\ 2} + \dots]$</p>

Water Supply Coefficient (K)	
Building Group Classification:	C - Residential Occupancies
From Table 1, K =	23

Building Volume (V)	
Block 10 (8 Units)	
length =	25
width =	20
height =	12 (10.2 m from basement slab to upper level ceiling + 1.8 m to roof midpoint)
Building Volume (V):	6000 m ³

Spatial Coefficient (S):		
Side	Dist	S _{coeff}
Front	18.25	0
Back	19	0
Left	firewall	0.5
Right	n/a	0
Total		0.5


Therefore S_{tot} = 1.5


Required Fire Water Supply (Q) per OBC:	
$Q = K V S_{tot}$	
$Q = (23) (6000) (1.5)$	
Q =	207000
From Table 2: Q > 190000 L and < 270000 L	
Therefore Target Flow = 6300 l/min	

OBC Tables and Figures

Table 1					
Water Supply Coefficient - K					
Type of Construction	Classification by Group or Division in Accordance with Table 3.1.2.1. of the Building Code				
	A-2 B-1 B-2 B-3 C D	A-4 F-3	A-1 A-3	E F-2	F-1
Building is of noncombustible construction with fire separations and fire-resistance ratings provided in accordance with Subsection 3.2.2., including loadbearing walls, columns and arches.	10	12	14	17	23
Building is of noncombustible construction or of heavy timber construction conforming to Article 3.1.4.6. Floor assemblies are fire separations but with no fire-resistance rating. Roof assemblies, mezzanines, loadbearing walls, columns and arches do not have a fire-resistance rating.	16	19	22	27	37
Building is of combustibile construction with fire separations and fire-resistance ratings provided in accordance with Subsection 3.2.2., including loadbearing walls, columns and arches. Noncombustible construction may be used in lieu of fire-resistance rating where permitted in Subsection 3.2.2.	18	22	25	31	41
Building is of combustibile construction. Floor assemblies are fire separations but with no fire-resistance rating. Roof assemblies, mezzanines, loadbearing walls, columns and arches do not have a fire-resistance rating.	23	28	32	39	53
Column 1	2	3	4	5	6

Table 2	
Part 3 Buildings under the Building Code	Required Minimum Water Supply Flow Rate, L/min
One-storey building with building area not exceeding 600 m ²	1 800
All other buildings	2 700 (if Q ≤ 108 000 L) ⁽¹⁾ 3 600 (if Q > 108 000 L and ≤ 135 000 L) ⁽¹⁾ 4 500 (if Q > 135 000 L and ≤ 162 000 L) ⁽¹⁾ 5 400 (if Q > 162 000 L and ≤ 190 000 L) ⁽¹⁾ 6 300 (if Q > 190 000 L and ≤ 270 000 L) ⁽¹⁾

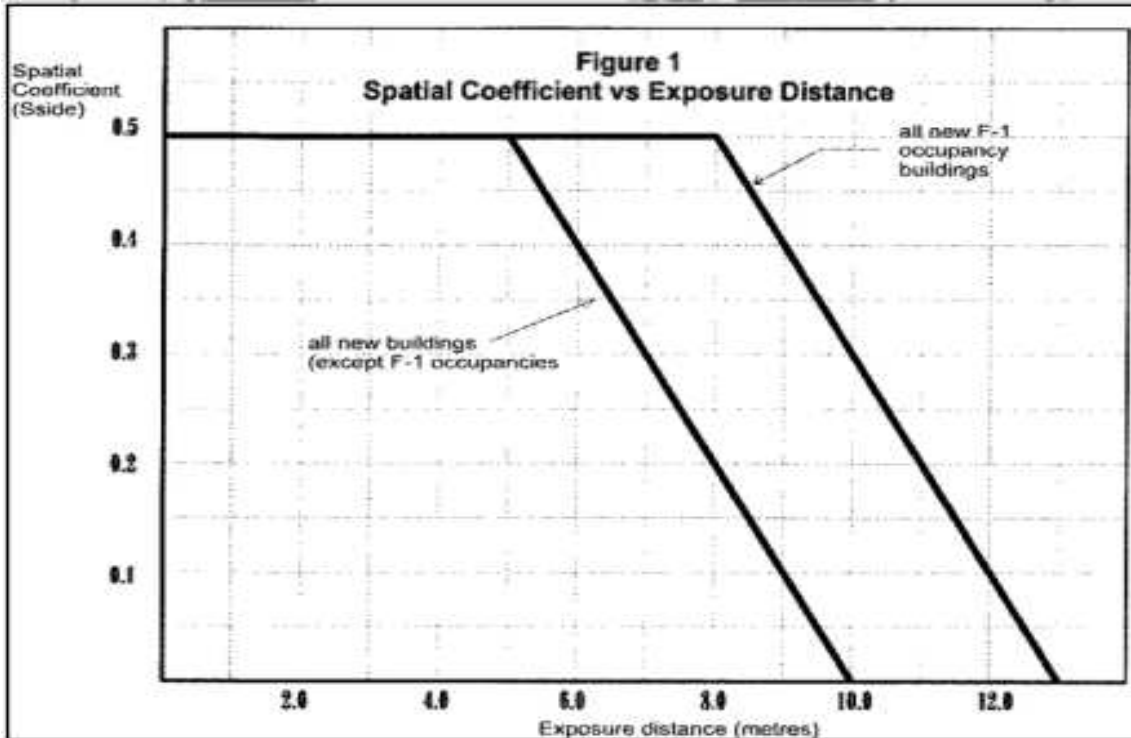

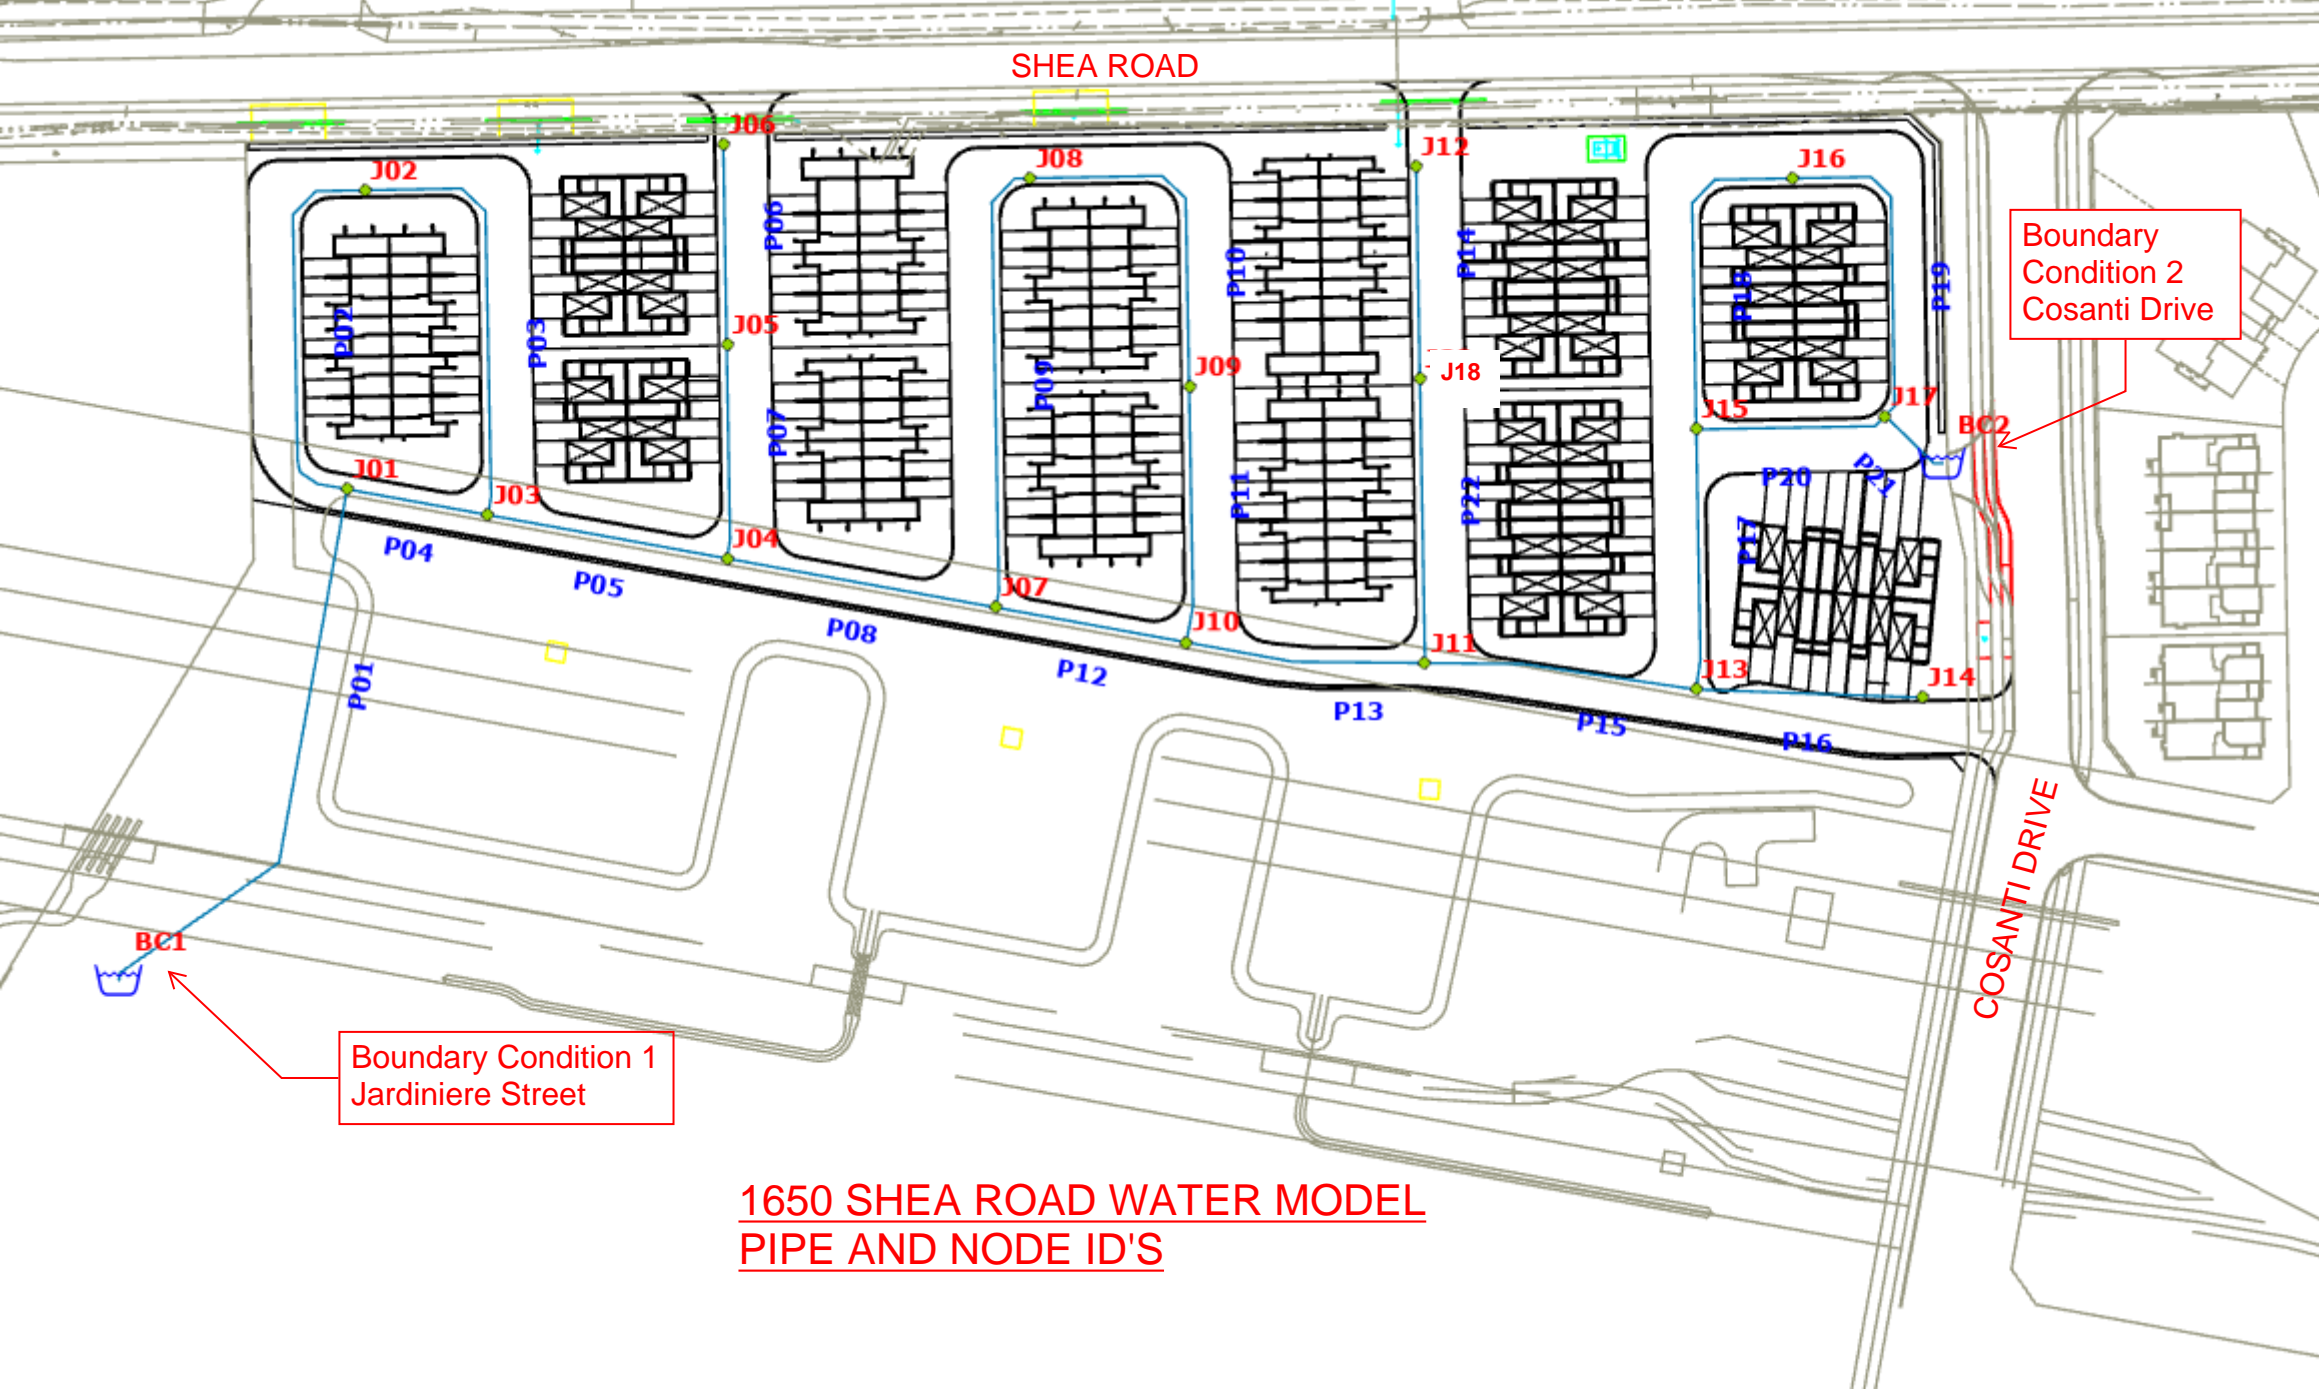

SHEA ROAD

Boundary Condition 2
Cosanti Drive

Boundary Condition 1
Jardiniere Street

1650 SHEA ROAD WATER MODEL
PIPE AND NODE ID'S

COSANTI DRIVE

Bacis Day - Junction Report

		ID	Demand (L/s)	Elevation (m)	Head (m)	Pressure (kPa)
1	<input type="checkbox"/>	J01	0.03	107.12	160.70	525.04
2	<input type="checkbox"/>	J02	0.06	107.21	160.70	524.16
3	<input type="checkbox"/>	J03	0.06	107.10	160.70	525.24
4	<input type="checkbox"/>	J04	0.02	107.05	160.70	525.73
5	<input type="checkbox"/>	J05	0.04	107.11	160.70	525.14
6	<input type="checkbox"/>	J06	0.07	106.80	160.70	528.18
7	<input type="checkbox"/>	J07	0.07	107.05	160.70	525.73
8	<input type="checkbox"/>	J08	0.07	107.15	160.70	524.75
9	<input type="checkbox"/>	J09	0.08	107.01	160.70	526.12
10	<input type="checkbox"/>	J10	0.08	106.95	160.70	526.71
11	<input type="checkbox"/>	J11	0.07	106.98	160.70	526.41
12	<input type="checkbox"/>	J12	0.05	107.01	160.70	526.12
13	<input type="checkbox"/>	J13	0.04	107.08	160.70	525.43
14	<input type="checkbox"/>	J14	0.04	106.86	160.70	527.59
15	<input type="checkbox"/>	J15	0.11	107.10	160.70	525.24
16	<input type="checkbox"/>	J16	0.04	107.02	160.70	526.02
17	<input type="checkbox"/>	J17	0.04	106.97	160.70	526.51
18	<input type="checkbox"/>	J18	0.06	106.80	160.70	528.18

Peak Hour - Junction Report

		ID	Demand (L/s)	Elevation (m)	Head (m)	Pressure (kPa)
1	<input type="checkbox"/>	J01	0.14	107.12	154.90	468.19
2	<input type="checkbox"/>	J02	0.34	107.21	154.90	467.30
3	<input type="checkbox"/>	J03	0.34	107.10	154.90	468.38
4	<input type="checkbox"/>	J04	0.10	107.05	154.90	468.87
5	<input type="checkbox"/>	J05	0.24	107.11	154.90	468.28
6	<input type="checkbox"/>	J06	0.39	106.80	154.90	471.32
7	<input type="checkbox"/>	J07	0.39	107.05	154.90	468.87
8	<input type="checkbox"/>	J08	0.39	107.15	154.90	467.89
9	<input type="checkbox"/>	J09	0.43	107.01	154.90	469.26
10	<input type="checkbox"/>	J10	0.43	106.95	154.90	469.85
11	<input type="checkbox"/>	J11	0.39	106.98	154.90	469.55
12	<input type="checkbox"/>	J12	0.29	107.01	154.90	469.26
13	<input type="checkbox"/>	J13	0.19	107.08	154.90	468.58
14	<input type="checkbox"/>	J14	0.24	106.86	154.90	470.73
15	<input type="checkbox"/>	J15	0.58	107.10	154.90	468.39
16	<input type="checkbox"/>	J16	0.24	107.02	154.90	469.18
17	<input type="checkbox"/>	J17	0.24	106.97	154.90	469.67
18	<input type="checkbox"/>	J18	0.34	106.80	154.90	471.32

Peak Hour - Pipe Report

		ID	From Node	To Node	Length (m)	Diameter (mm)	Roughness	Flow (L/s)	Velocity (m/s)	Headloss (m)	HL/1000 (m/k-m)	Status	Flow Reversal Count
1	<input type="checkbox"/>	P01	BC1	J01	94.16	250.00	110.00	2.34	0.05	0.00	0.02	Open	0
2	<input type="checkbox"/>	P02	J01	J02	63.44	204.00	110.00	0.53	0.02	0.00	0.00	Open	0
3	<input type="checkbox"/>	P03	J02	J03	70.37	204.00	110.00	0.19	0.01	0.00	0.00	Open	0
4	<input type="checkbox"/>	P04	J01	J03	23.23	250.00	110.00	1.68	0.03	0.00	0.01	Open	0
5	<input type="checkbox"/>	P05	J03	J04	39.44	250.00	110.00	1.52	0.03	0.00	0.01	Open	0
6	<input type="checkbox"/>	P06	J06	J05	32.51	204.00	110.00	-0.39	0.01	0.00	0.00	Open	0
7	<input type="checkbox"/>	P07	J05	J04	34.68	204.00	110.00	-0.63	0.02	0.00	0.00	Open	0
8	<input type="checkbox"/>	P08	J04	J07	44.38	250.00	110.00	0.79	0.02	0.00	0.00	Open	0
9	<input type="checkbox"/>	P09	J07	J08	73.68	204.00	110.00	0.35	0.01	0.00	0.00	Open	0
10	<input type="checkbox"/>	P10	J08	J09	57.19	204.00	110.00	-0.04	0.00	0.00	0.00	Open	0
11	<input type="checkbox"/>	P11	J09	J10	41.67	204.00	110.00	-0.47	0.01	0.00	0.00	Open	0
12	<input type="checkbox"/>	P12	J07	J10	31.46	250.00	110.00	0.05	0.00	0.00	0.00	Open	0
13	<input type="checkbox"/>	P13	J10	J11	39.02	250.00	110.00	-0.85	0.02	0.00	0.00	Open	0
14	<input type="checkbox"/>	P14	J12	J18	34.36	204.00	110.00	-0.29	0.01	0.00	0.00	Open	0
15	<input type="checkbox"/>	P15	J11	J13	44.30	250.00	110.00	-1.87	0.04	0.00	0.01	Open	0
16	<input type="checkbox"/>	P16	J13	J14	36.81	204.00	110.00	0.24	0.01	0.00	0.00	Open	0
17	<input type="checkbox"/>	P17	J13	J15	42.26	250.00	110.00	-2.30	0.05	0.00	0.02	Open	0
18	<input type="checkbox"/>	P18	J15	J16	54.62	204.00	110.00	-0.57	0.02	0.00	0.00	Open	0
19	<input type="checkbox"/>	P19	J16	J17	53.52	204.00	110.00	-0.81	0.02	0.00	0.01	Open	0
20	<input type="checkbox"/>	P20	J15	J17	31.35	250.00	110.00	-2.31	0.05	0.00	0.02	Open	0
21	<input type="checkbox"/>	P21	J17	BC2	12.34	250.00	110.00	-3.36	0.07	0.00	0.04	Open	0
22	<input type="checkbox"/>	P22	J18	J11	46.18	204.00	110.00	-0.63	0.02	0.00	0.00	Open	0

		ID	Capacity Assessment	Total Demand (L/s)	Hydrant Available Flow (L/s)	Critical Node ID for Design Run	Critical Node Pressure at Available Flow (kPa)	Critical Node Pressure at Fire Demand (kPa)	Critical Pressure for Design Run (kPa)	Hydrant Design Flow (L/s)	Hydrant Pressure at Design Flow (kPa)
1	<input type="checkbox"/>	J02	PASS	150.15	205.15	J02	139.96	171.15	139.96	205.15	139.96
2	<input type="checkbox"/>	J03	PASS	150.15	302.99	J03	139.96	192.73	139.96	303.00	139.97
3	<input type="checkbox"/>	J05	PASS	150.11	162.23	J05	139.96	149.74	139.96	162.23	140.01
4	<input type="checkbox"/>	J07	PASS	150.18	285.40	J07	139.96	191.99	139.96	285.40	139.96
5	<input type="checkbox"/>	J08	PASS	150.18	187.03	J08	139.96	164.62	139.96	187.03	139.96
6	<input type="checkbox"/>	J09	PASS	150.20	201.74	J09	139.96	171.65	139.96	201.74	139.96
7	<input type="checkbox"/>	J11	PASS	150.18	307.25	J11	139.96	196.33	139.96	307.25	139.96
8	<input type="checkbox"/>	J13	PASS	150.09	351.12	J13	139.96	200.84	139.96	351.12	139.96
9	<input type="checkbox"/>	J15	PASS	150.26	487.38	J15	139.96	207.81	139.96	487.39	139.96
10	<input type="checkbox"/>	J16	PASS	150.11	297.74	J16	139.96	195.95	139.96	297.74	139.96
11	<input type="checkbox"/>	J18	PASS	150.15	153.36	J18	139.96	142.96	139.96	153.36	140.06



June 27, 2024

Ryan Magladry

Arcadis
333 Preston Street, Suite 500
Ottawa, ON, K1S 5N4

Re: Live Load Resistance for IPEX Blue Brute Pipe

Dear Mr. Magladry;

This letter shall serve as confirmation that IPEX Blue Brute PVC watermain, when buried with 2.4 metres of cover, is able to withstand

- a) the transportation of heavy loads outlined by CL-625 truck loading according to the latest version of CAN/CSA-S6, and
- b) mobile cranes set up for work with counterweights in place (i.e. 267 kN per tandem axle, dual wheel, 1.53m axle spacing, 360mm tires)

If you have any questions, please do not hesitate to contact the undersigned.

Sincerely,

A handwritten signature in blue ink, appearing to read "Alex Sandovski". The signature is fluid and cursive, with a clear first and last name.

Alex Sandovski, P.Eng., MBA

Municipal Sales Engineer
IPEX Inc.


IPEX Inc.

6810 Invader Crescent, Mississauga, Ontario, Canada L5T 2B6 Tel (905) 670-7676 Fax (905) 670-5295

APPENDIX C

139185-400

Sanitary Sewer Design Sheet
Sanitary Drainage Plan
Davidson Lands Phase 2 Sanitary Design Sheet
Davidson Lands Phase 2 Sanitary Drainage Area Plan

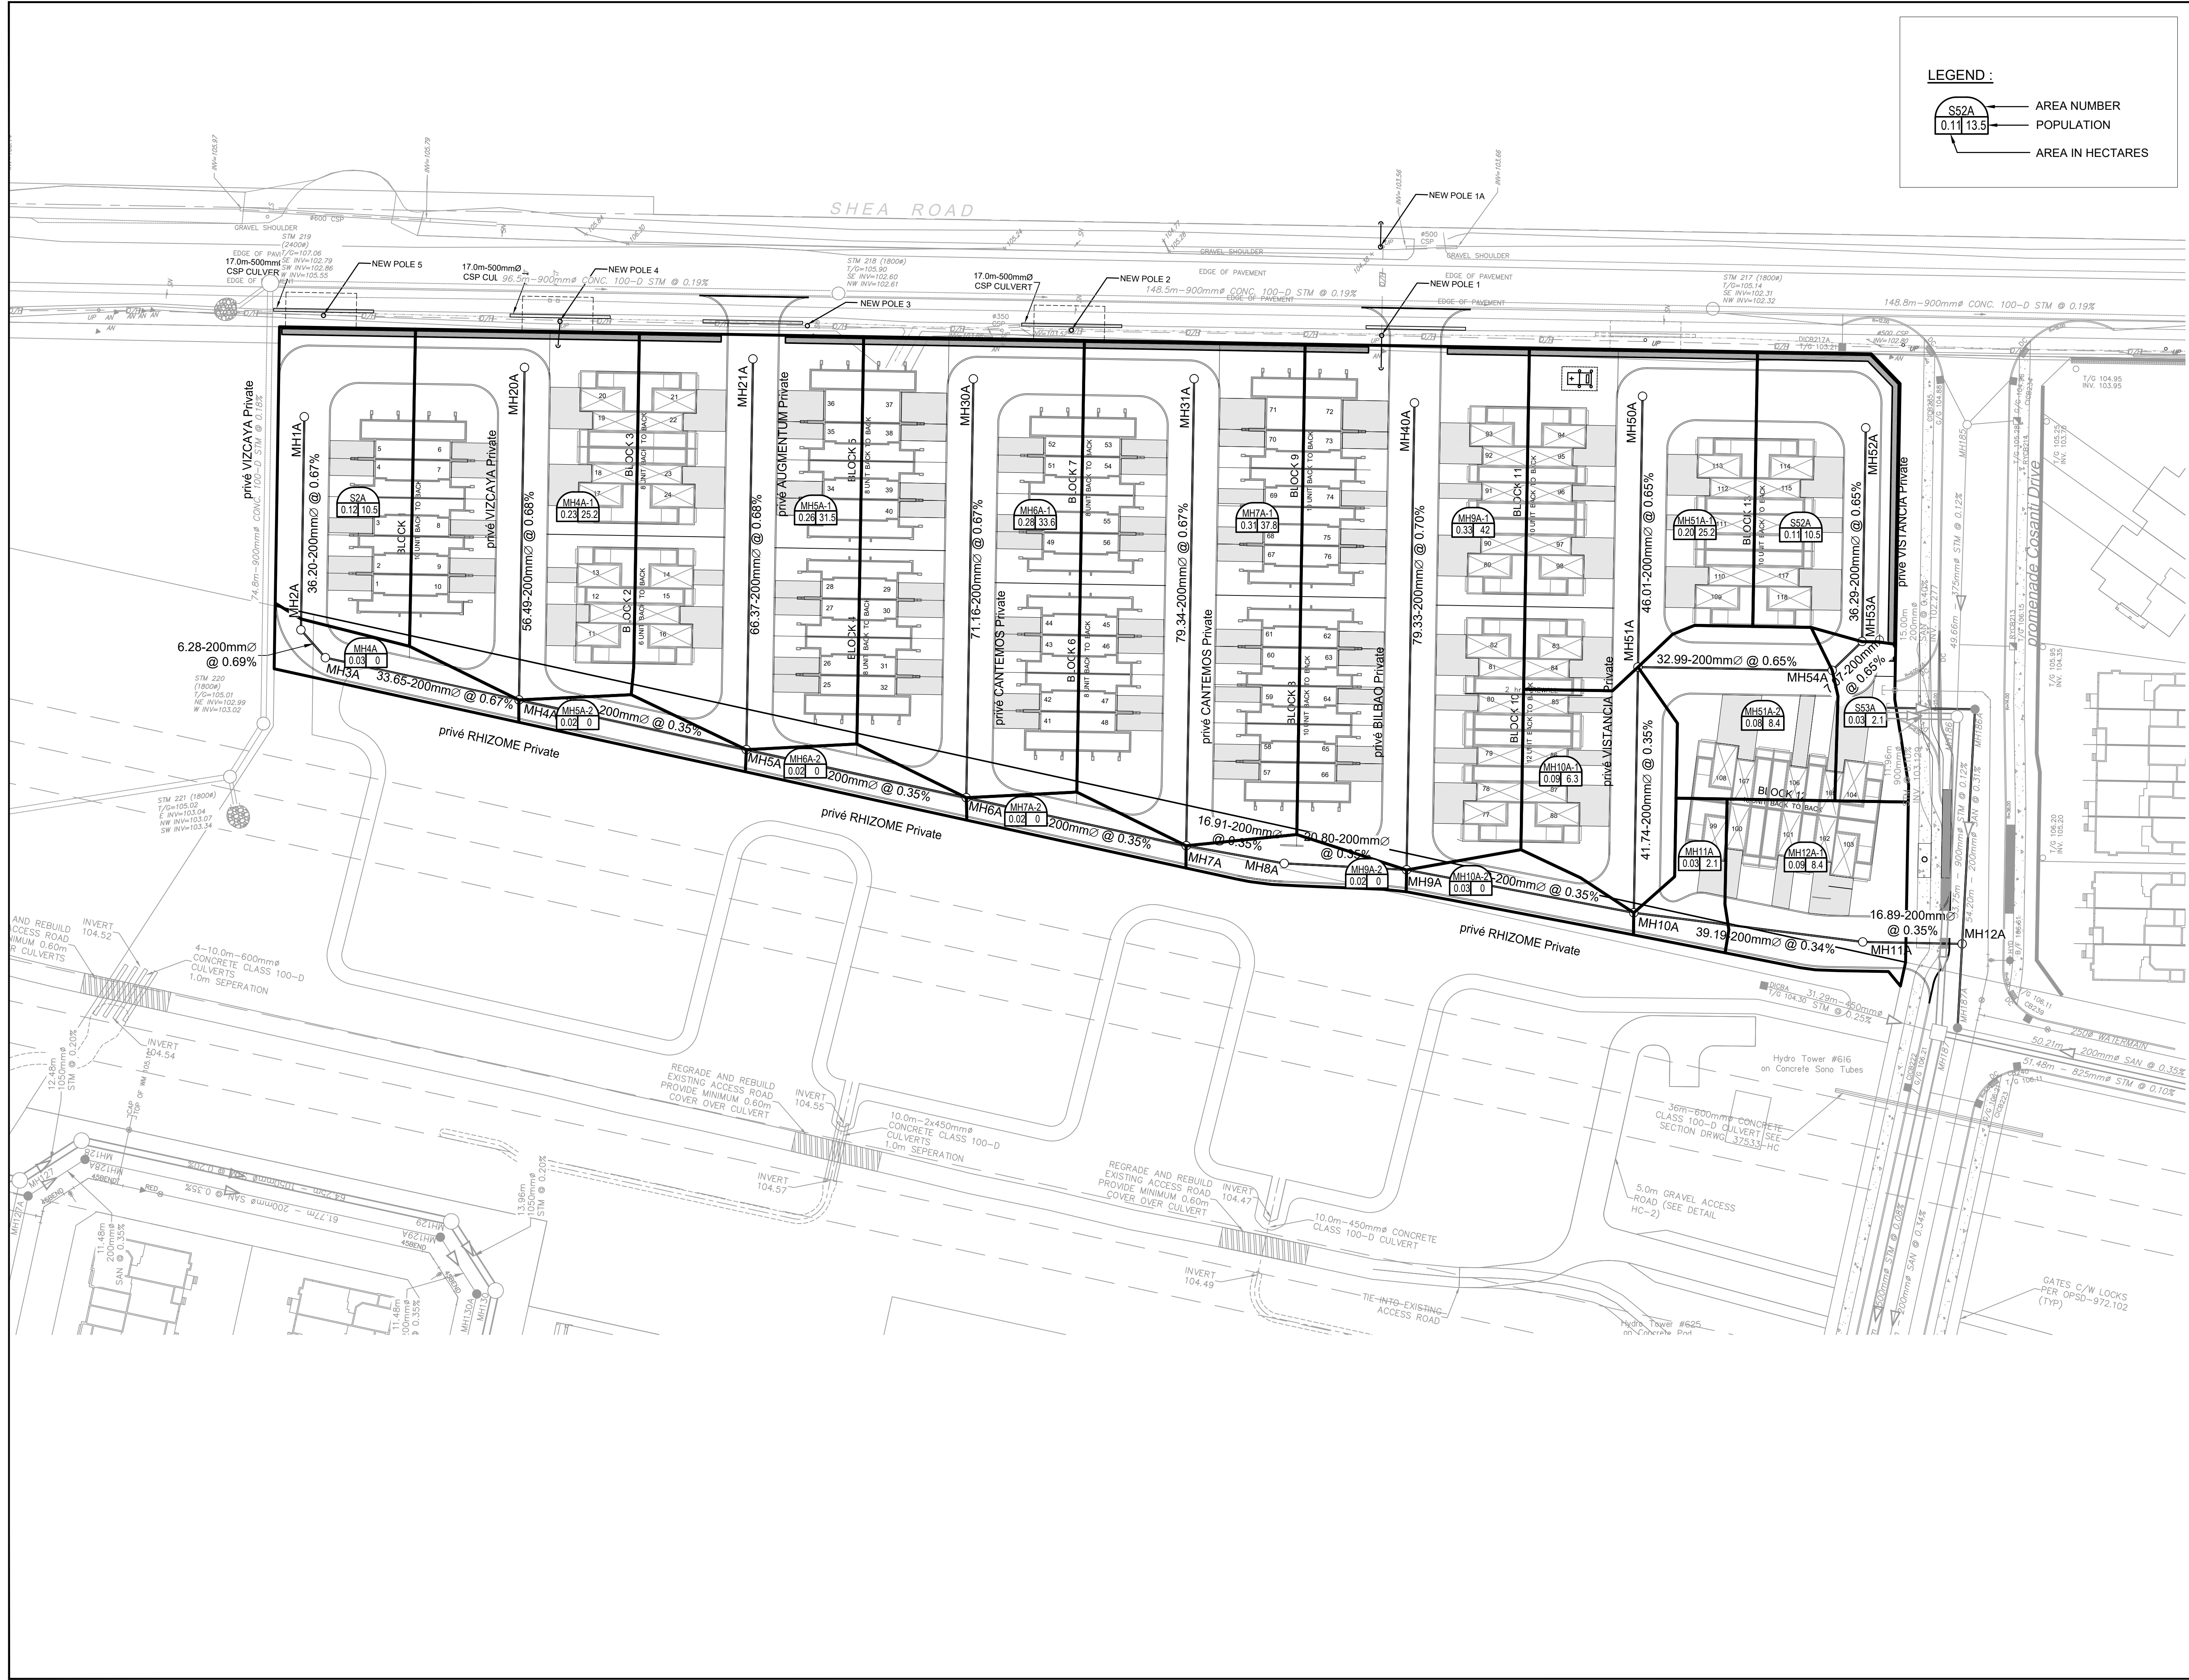

CLIENT
**DAVIDSON SHEA
 PROPERTY INC.**


COPYRIGHT
 This drawing has been prepared solely for the intended use. Any reproduction or distribution for any purpose other than that authorized by IBI Group is forbidden. Written dimensions shall have precedence over scaled dimensions. Contractors shall verify and be responsible for all dimensions and conditions on the job, and IBI Group shall be informed of any variations from the dimensions and conditions shown on the drawing. Shop drawings shall be submitted to IBI Group for general conformance before proceeding with fabrication.

IBI Group Professional Services (Canada) Inc.
 is a member of the IBI Group of companies



ISSUES

No.	DESCRIPTION	DATE
1	SUBMISSION NO. 1 FOR CITY REVIEW	2022-09-15
2	SUBMISSION NO. 2 FOR CITY REVIEW	2024-06-27
3	REVISED PER CITY COMMENTS	2025-03-21
4	REVISED PER NEW SITE PLAN	2025-05-12
5	SUBMISSION NO. 4 FOR CITY REVIEW	2024-07-31
6		
7		
8		

SEE 010, 011 FOR NOTES, LEGEND, CB TABLE, STREET SECTIONS AND DETAILS

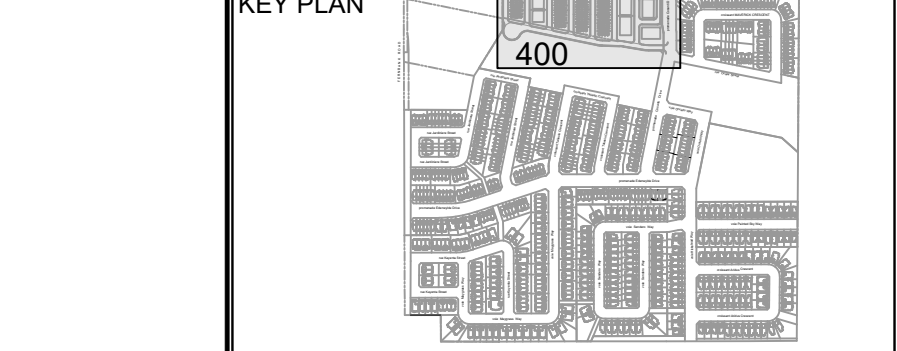

CONSULTANTS

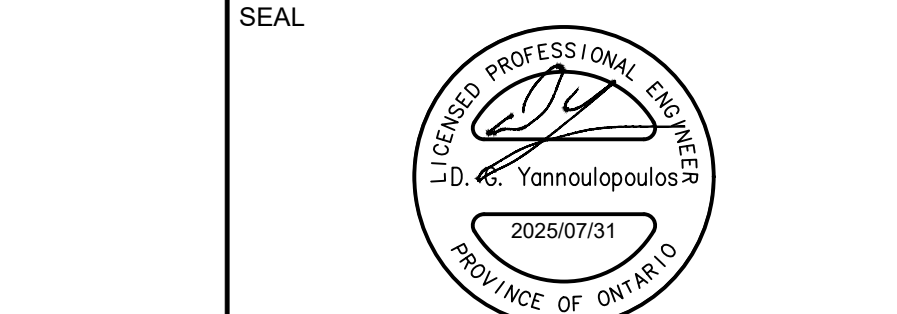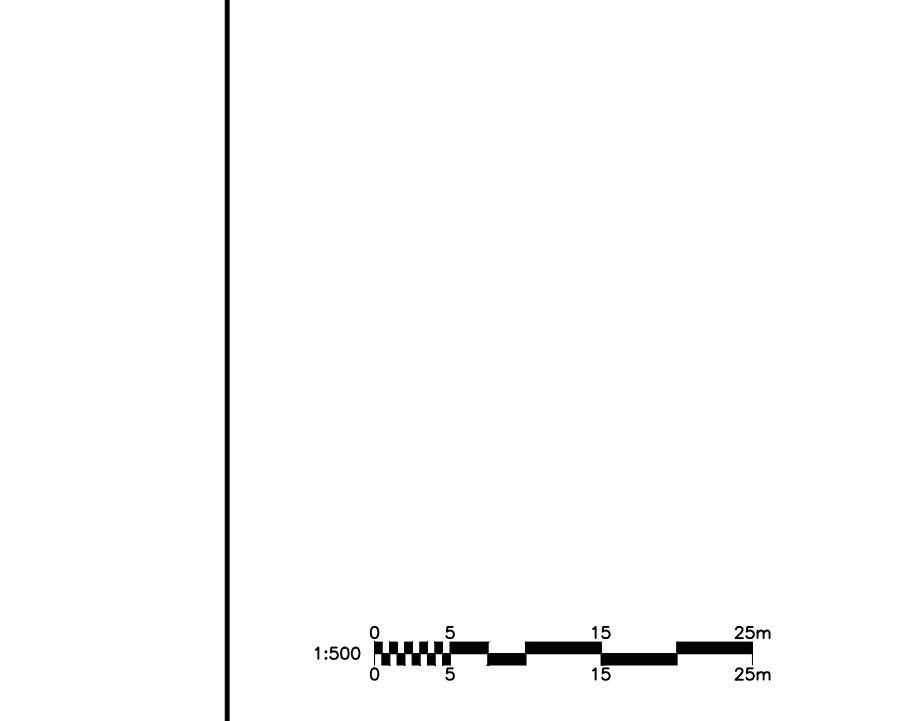

PROJECT
1650 SHEA ROAD
 (OTTAWA, ON)

PROJECT NO:
139185

DRAWN BY:
M.M.

PROJECT MGR:
R.M.

CHECKED BY:
R.M./D.Y.

APPROVED BY:
R.M./D.Y.

SHEET TITLE
**SANITARY DRAINAGE AREA
 PLAN**

SHEET NUMBER
400

ISSUE
5

CITY FILE No. D07-12-23-0032
 SCALE CHECK
 File Location: \\139185_1650_Shea_Road\0_Production\07_03_Design\04_Civil\Shea400-SANITARY DRAINAGE AREA PLAN.dwg Last Saved: July 25, 2025, 7:42:26 PM by Milna, Milna



IBI GROUP
 400-333 Preston Street
 Ottawa, Ontario K1S 5N4 Canada
 tel 613 225 1311 fax 613 225 9868
 ibigroup.com

SANITARY SEWER DESIGN SHEET

Davidson Lands
 City of Ottawa
 Name of Client/Developer

LOCATION				AREA w/ Units (Ha)	RESIDENTIAL				AREA w/o Units (Ha)	POPULATION				PEAK FACTOR	PEAK FLOW (L/s)	ICI AREAS						INFILTRATION ALLOWANCE			FIXED FLOW (L/s)	TOTAL FLOW (L/s)	PROPOSED SEWER DESIGN							
STREET	AREA ID	FROM MH	TO MH		UNIT TYPES					IND	CUM	IND	CUM			AREA (Ha)		IND	CUM	IND	CUM	PEAK FLOW (L/s)	AREA (Ha)				FLOW (L/s)	CAPACITY (L/s)	LENGTH (m)	DIA (mm)	SLOPE (%)	VELOCITY (full) (m/s)	AVAILABLE CAPACITY	
					SF	SD	TH	APT								IND	COMMERCIAL						INDUSTRIAL	IND									CUM	IND
PHASE 2																																		
Kayenta Street	142A	MH142A	MH143A	0.40	4	4				24.4	24.4	4.00	0.40							0.4	0.40	0.11		0.51	48.39	83.80	200	2.00	1.492	47.88	98.95%			
Maygrass Way	146A	MH146A	MH143A	0.29	1	4				14.2	14.2	4.00	0.23							0.29	0.29	0.08		0.31	64.01	39.65	200	3.50	1.974	63.70	99.51%			
Maygrass Way	143A	MH143A	MH144A	0.41		6	4			27.0	65.6	4.00	1.06							0.41	1.10	0.31		1.37	60.24	60.76	200	3.10	1.858	58.87	97.72%			
Kayenta Street	139A	MH139A	MH140A	0.20		4				10.8	10.8	4.00	0.18							0.2	0.20	0.06		0.23	59.26	40.89	200	3.00	1.827	59.03	99.61%			
	140A	MH140A	MH141A	0.07	1					3.4	14.2	4.00	0.23							0.07	0.27	0.08		0.31	51.89	9.57	200	2.30	1.600	51.59	99.41%			
	141A	MH141A	MH144A	0.38		6	3			24.3	38.5	4.00	0.62							0.38	0.65	0.18		0.81	51.89	78.46	200	2.30	1.600	51.09	98.45%			
Kayenta Street	144A	MH144A	MH145A	0.05			1			2.7	106.8	4.00	1.73							0.05	1.80	0.50		2.23	47.16	13.99	200	1.90	1.454	44.93	95.26%			
PHASE 1																																		
Kayenta Street	145A	MH145A	MH155A	0.24	1		4			14.2	121.0	4.00	1.96							0.24	2.04	0.57		2.53	47.16	54.00	200	1.90	1.454	44.63	94.63%			
Kayenta Street	159A	MH159A	MH153A	0.35	1	2	5			22.3	22.3	4.00	0.36							0.35	0.35	0.10		0.46	51.89	35.93	200	2.30	1.600	51.43	99.11%			
	153A	MH153A	MH154A	0.52	2	8	3			36.5	58.8	4.00	0.95							0.52	0.87	0.24		1.20	51.89	69.86	200	2.30	1.600	50.70	97.69%			
	154A	MH154A	MH155A	0.25	2					6.8	65.6	4.00	1.06							0.25	1.12	0.31		1.38	54.10	13.93	200	2.50	1.668	52.72	97.46%			
Block 159	155A	MH155A	MH156A	0.03						0.0	186.6	4.00	3.02							0.03	3.19	0.89		3.92	45.26	40.50	200	1.75	1.396	41.35	91.35%			
	156A	MH156A	MH103A	0.03						0.0	186.6	4.00	3.02							0.03	3.22	0.90		3.93	45.26	41.32	200	1.75	1.396	41.34	91.33%			
Edenwyde Drive	100A	MH100A	MH101A	0.63	3		16			53.4	53.4	4.00	0.87							0.63	0.63	0.18		1.04	43.28	68.32	200	1.60	1.335	42.24	97.59%			
	101A	MH101A	MH102A	0.23	1		3			11.5	64.9	4.00	1.05							0.23	0.86	0.24		1.29	28.63	29.78	200	0.70	0.883	27.34	95.49%			
	102A	MH102A	MH103A	0.34	2		8			28.4	93.3	4.00	1.51							0.34	1.20	0.34		1.85	48.39	43.19	200	2.00	1.492	46.54	96.18%			
Edenwyde Drive	103A	MH103A	MH104A	0.23			7			18.9	298.8	4.00	4.84							0.23	4.65	1.30		6.14	45.26	30.98	200	1.75	1.396	39.12	86.43%			
Jardinere Street	122A	MH122A	MH120A	0.21			5			13.5	13.5	4.00	0.22							0.21	0.21	0.06		0.28	28.63	40.37	200	0.70	0.883	28.35	99.03%			
	120A	MH120A	MH121A	0.05			1			2.7	16.2	4.00	0.26							0.05	0.26	0.07		0.34	28.63	9.56	200	0.70	0.883	28.29	98.83%			
	121A	MH121A	MH126A	0.41			12			32.4	48.6	4.00	0.79							0.41	0.67	0.19		0.98	35.89	86.22	200	1.10	1.107	34.91	97.28%			
Jardinere Street	123A	MH123A	MH124A	0.36			11			29.7	29.7	4.00	0.48							0.36	0.36	0.10		0.58	32.46	67.99	200	0.90	1.001	31.88	98.21%			
	124A	MH124A	MH125A	0.17			3			8.1	37.8	4.00	0.61							0.17	0.53	0.15		0.76	21.64	12.58	200	0.40	0.667	20.88	96.48%			
	125A	MH125A	MH126A	0.31			10			27.0	64.8	4.00	1.05							0.31	0.84	0.24		1.29	21.64	43.85	200	0.40	0.667	20.36	94.06%			
Jardinere Street	126A	MH126A	MH127A	0.47			14			37.8	151.2	4.00	2.45							0.47	1.98	0.55		3.00	26.50	97.91	200	0.60	0.817	23.50	88.66%			
External Commercial	135A	MH135A	MH127A							0.0	0.0	4.00	0.00			2.73	2.73			2.37	2.73	2.73	0.76		3.13	26.50	12.08	200	0.60	0.817	23.37	88.17%		
Jardinere Street	127A	MH127A	MH128A	0.02						0.0	151.2	4.00	2.45			2.73				2.37	0.02	4.73	1.32		6.14	20.24	11.48	200	0.35	0.624	14.10	69.65%		
	128A	MH128A	MH129A	0.09						0.0	151.2	4.00	2.45			2.73				2.37	0.09	4.82	1.35		6.17	20.24	61.77	200	0.35	0.624	14.07	69.52%		
	129A	MH129A	MH130A	0.03						0.0	151.2	4.00	2.45			2.73				2.37	0.03	4.85	1.36		6.18	20.24	11.48	200	0.35	0.624	14.07	69.48%		
	130A	MH130A	MH131A	0.70			26			70.2	221.4	4.00	3.59			2.73				2.37	0.7	5.55	1.55		7.51	20.24	91.95	200	0.35	0.624	12.73	62.89%		
	131A	MH131A	MH132A	0.48			15			40.5	261.9	4.00	4.24			2.73				2.37	0.48	6.03	1.69		8.30	20.24	71.17	200	0.35	0.624	11.94	58.99%		
	132A	MH132A	MH104A	0.04						0.0	261.9	4.00	4.24			2.73				2.37	0.04	6.07	1.70		8.31	20.24	28.10	200	0.35	0.624	11.93	58.93%		
Edenwyde Drive	104A	MH104A	MH105A	0.44			11			29.7	590.4	3.94	9.41			2.73				2.37	0.44	11.16	3.12		14.91	55.26	67.20	300	0.30	0.757	40.35	73.02%		
	105A	MH105A	MH106A							0.0	590.4	3.94	9.41			2.73				2.37	0	11.16	3.12		14.91	55.26	11.41	300	0.30	0.757	40.35	73.02%		
PHASE 2																																		
Maygrass Way	147A	MH147A	CAP	0.43	7					23.8	23.8	4.00	0.39							0.43	0.43	0.12		0.51	56.95	60.75	200	2.77	1.756	56.45	99.11%			
PHASE 1																																		
Maygrass Way		CAP	MH148A							0.0	23.8	4.00	0.39							0	0.43	0.12		0.51	56.95	12.00	200	2.77	1.756	56.44	99.11%			
	148B	MH148A	MH149A	0.40	6					20.4	44.2	4.00	0.72							0.4	0.83	0.23		0.95	50.75	69.93	200	2.20	1.565	49.80	98.13%			
	149A	MH149A	MH150A	0.18	2					6.8	51.0	4.00	0.83							0.18	1.01	0.28		1.11	50.75	11.43	200	2.20	1.565	49.64	97.81%			
	150A	MH150A	MH151A	0.51	1	1	12			38.5	89.5	4.00	1.45							0.51	1.52	0.43		1.88	41.91	68.53	200	1.50	1.292	40.03	95.52%			
	151A	MH151A	MH152A	0.55			7			43.2	132.7	4.00	2.15							0.55	2.07	0.58		2.73	41.91	65.09	200	1.50	1.292	39.18	93.49%			
	152A	MH152A	MH157A	0.63	1	10	5			43.9	176.6	4.00	2.86							0.63	2.70	0.76		3.62	37.48	87.29	200	1.20	1.156	33.86	90.35%			
	---	MH157A	MH106A							0.0	176.6	4.00	2.86							0	2.70	0.76		3.62	100.85	8.35	300	1.00	1.382	97.24	96.41%			
PHASE 2																																		
Taliesin Crescent	200A	MH200A	MH201A	0.56			18																											



IBI GROUP
 400-333 Preston Street
 Ottawa, Ontario K1S 5N4 Canada
 tel 613 225 1311 fax 613 225 9868
 ibigroup.com


SANITARY SEWER DESIGN SHEET

Davidson Lands
 City of Ottawa
 Name of Client/Developer

LOCATION				AREA w/ Units (Ha)	RESIDENTIAL				AREA w/o Units (Ha)	POPULATION		PEAK FACTOR	PEAK FLOW (L/s)	ICI AREAS						INFILTRATION ALLOWANCE			FIXED FLOW (L/s)	TOTAL FLOW (L/s)	PROPOSED SEWER DESIGN								
STREET	AREA ID	FROM MH	TO MH		UNIT TYPES					IND	CUM			AREA (Ha)		IND	CUM	IND	CUM	AREA (Ha)		FLOW (L/s)			CAPACITY (L/s)	LENGTH (m)	DIA (mm)	SLOPE (%)	VELOCITY (full) (m/s)	AVAILABLE CAPACITY			
					SF	SD	TH	APT						IND	CUM					IND	CUM									IND	CUM	IND	CUM
PHASE 2																																	
Block 170 Crosanti Drive	320A 186A	MH320A MH186A	MH186A MH187A	0.10					2.08	137.3 0.0	137.3 137.3	4.00 4.00	2.22 2.22							2.08 0.1	2.08 2.18	0.58 0.61				2.81 2.83	21.64 20.24	12.44 45.53	200 200	0.40 0.35	0.667 0.624	18.83 17.41	87.03% 86.00%
Maverick Crescent	300A	MH300A	MH301A	0.20					10.8	10.8	10.8	4.00	0.18							0.2	0.20	0.06				0.23	27.56	11.47	200	0.65	0.850	27.33	99.16%
	301A	MH301A	MH302A	1.01					83.7	94.5	94.5	4.00	1.53							1.01	1.21	0.34				1.87	20.24	116.48	200	0.35	0.624	18.37	90.76%
	302A	MH302A	MH303A	0.07					5.4	99.9	105.3	4.00	1.62							0.07	1.28	0.36				1.98	20.24	11.48	200	0.35	0.624	18.27	90.23%
	303A	MH303A	MH304A	0.35					24.3	124.2	148.5	4.00	2.01							0.35	1.63	0.46				2.47	20.24	61.29	200	0.35	0.624	17.77	87.80%
	304A	MH304A	MH305A	0.01					0.0	124.2	124.2	4.00	2.01							0.01	1.64	0.46				2.47	20.24	14.00	200	0.35	0.624	17.77	87.79%
Maverick Crescent	300A1	MH300A	MH306A	0.75					70.2	70.2	70.2	4.00	1.14							0.75	0.75	0.21				1.35	27.59	92.03	200	0.65	0.851	26.24	95.12%
	306A	MH306A	MH307A	0.08					0.0	70.2	70.2	4.00	1.14							0.08	0.83	0.23				1.37	20.24	12.96	200	0.35	0.624	18.87	93.23%
Ocala Street	307A	MH307A	MH308A	0.24					13.5	83.7	97.2	4.00	1.36							0.24	1.07	0.30				1.66	20.24	68.00	200	0.35	0.624	18.59	91.82%
	308A	MH308A	MH305A	0.26					18.9	102.6	121.5	4.00	1.66							0.26	1.33	0.37				2.03	20.24	59.95	200	0.35	0.624	18.21	89.95%
Ocala Street	305A	MH305A	MH187A	0.06					0.0	226.8	226.8	4.00	3.68							0.06	3.03	0.85				4.52	20.24	50.21	200	0.35	0.624	15.72	77.65%
Crosanti Drive	187A	MH187A	MH188A	0.19					0.0	364.1	364.1	4.00	5.90							0.19	5.40	1.51				7.41	20.24	89.74	200	0.35	0.624	12.83	63.39%
	188A	MH188A	MH189A	0.80					72.9	437.0	509.9	4.00	7.08							0.8	6.20	1.74				8.82	20.24	103.64	200	0.35	0.624	11.43	56.45%
	189A	MH189A	CAP	0.12					5.4	442.4	447.8	4.00	7.17							0.12	6.32	1.77				8.94	21.64	7.33	200	0.40	0.667	12.70	58.70%
	189A	CAP	MH108A						0.0	442.4	442.4	4.00	7.17							0	6.32	1.77				8.94	21.64	16.00	200	0.40	0.667	12.70	58.70%
PHASE 1																																	
Edenwyde Drive	108A	MH108A	MH109A	0.26					13.5	1455.1	1468.6	3.69	21.74				2.73			0.26	23.26	6.51				30.63	50.44	75.91	300	0.25	0.691	19.81	39.28%
PHASE 2																																	
Orviato Way	211A	MH211A	CAP210AE	0.65					35.1	35.1	35.1	4.00	0.57							0.65	0.65	0.18				0.75	27.59	86.14	200	0.65	0.851	26.84	97.28%
		CAP210AE	MH210A						0.0	35.1	35.1	4.00	0.57							0	0.65	0.18				0.75	27.59	4.00	200	0.65	0.851	26.84	97.28%
		MH210A	MH109A						0.0	35.1	35.1	4.00	0.57							0	0.65	0.18				0.75	27.59	11.31	200	0.65	0.851	26.84	97.28%
PHASE 1																																	
Hickstead Way	109A	MH109A	MH110A	0.32					17.0	1507.2	1524.2	3.68	22.46				2.73		0.32	24.23	6.78				31.61	50.44	76.01	300	0.25	0.691	18.83	37.33%	
PHASE 2																																	
FRIENDLY CRESCENT Block 169	EXTERNAL	EXMH181	MH230A	4.66	70				238.0	238.0	238.0	4.00	3.86							4.66	4.66	1.30				5.16	49.58	10.88	200	2.10	1.529	44.42	89.59%
		MH230A	MH231A						0.0	238.0	238.0	4.00	3.86							0	4.66	1.30				5.16	49.58	45.03	200	2.10	1.529	44.42	89.59%
Sendero Way	231A	MH231A	MH221A	0.59	10				34.0	272.0	306.0	4.00	4.41							0.59	5.25	1.47				6.88	34.22	67.09	200	1.00	1.055	28.34	82.82%
	221A	MH221A	MH222A	0.64	15				51.0	323.0	374.0	4.00	5.23							0.64	5.89	1.65				6.58	26.50	80.39	200	0.60	0.817	19.62	74.03%
	222A	MH222A	MH223A	0.17	2				6.8	329.8	336.6	4.00	5.34							0.17	6.06	1.70				7.04	34.22	11.46	200	1.00	1.055	27.18	79.42%
	223A	MH223A	MH224A	0.40	8				27.2	357.0	384.2	4.00	5.78							0.4	6.46	1.81				7.59	21.64	69.88	200	0.40	0.667	14.05	64.91%
Sendero Way	235A	MH235A	MH232A	0.56	8				27.2	27.2	27.2	4.00	0.44							0.56	0.56	0.16				0.60	34.22	61.94	200	1.00	1.055	33.62	98.25%
	232A	MH232A	MH233A	0.13	1				3.4	30.6	34.0	4.00	0.50							0.13	0.69	0.19				0.69	48.39	11.34	200	2.00	1.492	47.70	98.58%
	233A	MH233A	MH234A	0.45	10				34.0	64.6	98.6	4.00	1.05							0.45	1.14	0.32				1.37	21.64	57.60	200	0.40	0.667	20.27	93.69%
	234A	MH234A	MH224A	0.59	13				44.2	108.8	153.0	4.00	1.76							0.59	1.73	0.48				2.25	21.64	83.39	200	0.40	0.667	19.39	89.61%
Sendero Way	224A	MH224A	CAP 225AN	0.17	3				10.2	476.0	486.2	3.99	7.68							0.17	8.36	2.34				10.03	26.50	37.03	200	0.60	0.817	16.48	62.18%
		CAP 225AN	MH225A						0.0	476.0	476.0	3.99	7.68							0	8.36	2.34				10.03	26.50	6.50	200	0.60	0.817	16.48	62.18%
	225A	MH225A	MH226A	0.03					0.0	476.0	476.0	3.99	7.68							0.03	8.39	2.35				10.03	26.50	15.56	200	0.60	0.817	16.47	62.14%
	226A	MH226A	MH110A	0.02					0.0	476.0	476.0	3.99	7.68							0.02	8.41	2.35				10.04	26.50	21.49	200	0.60	0.817	16.46	62.12%
Painted Sky Way	215A	MH215A	MH216A	0.62	14				47.6	47.6	47.6	4.00	0.77							0.62	0.62	0.17				0.94	24.19	83.61	200	0.50	0.746	23.25	96.09%
	216A	MH216A	CAP 110AE	0.75	18				61.2	108.8	170.0	4.00	1.76							0.75	1.37	0.38				2.15	49.58	84.93	200	2.10	1.529	47.44	95.67%
		CAP 110AE	MH110A						0.0	108.8	108.8	4.00	1.76							0	1.37	0.38				2.15	49.58	15.00	200	2.10	1.529	47.44	95.67%
Hickstead Way	110A	MH110A	MH111A	0.36	6				20.4	2112.4	2132.8	3.57	30.52				2.73		0.36	34.37	9.62				42.52	50.44	78.00	300	0.25	0.691	7.92	15.71%	
Hickstead Way	176A	MH176A	MH111A	0.36	6				20.4	20.4	20.4	4.00	0.33							0.36	0.36	0.10				0.43	34.22	64.00	200	1.00	1.055	33.79	98.74%
Aridus Crescent	111A	MH111A	MH112A	0.47	10				34.0	2166.8	2200.8	3.56	31.23				2.73		0.47	35.20	9.86				43.46	91.46	68.97	375	0.25	0.802	48.00	52.48%	
	112A	MH112A	MH113A	0.51	10				34.0	2200.8	2234.8	3.55	31.68				2.73		0.51	35.71	10.00				44.05								

LEGEND :

126A — AREA NUMBER
0.47 | 37.8 — POPULATION
 — AREA IN HECTARES

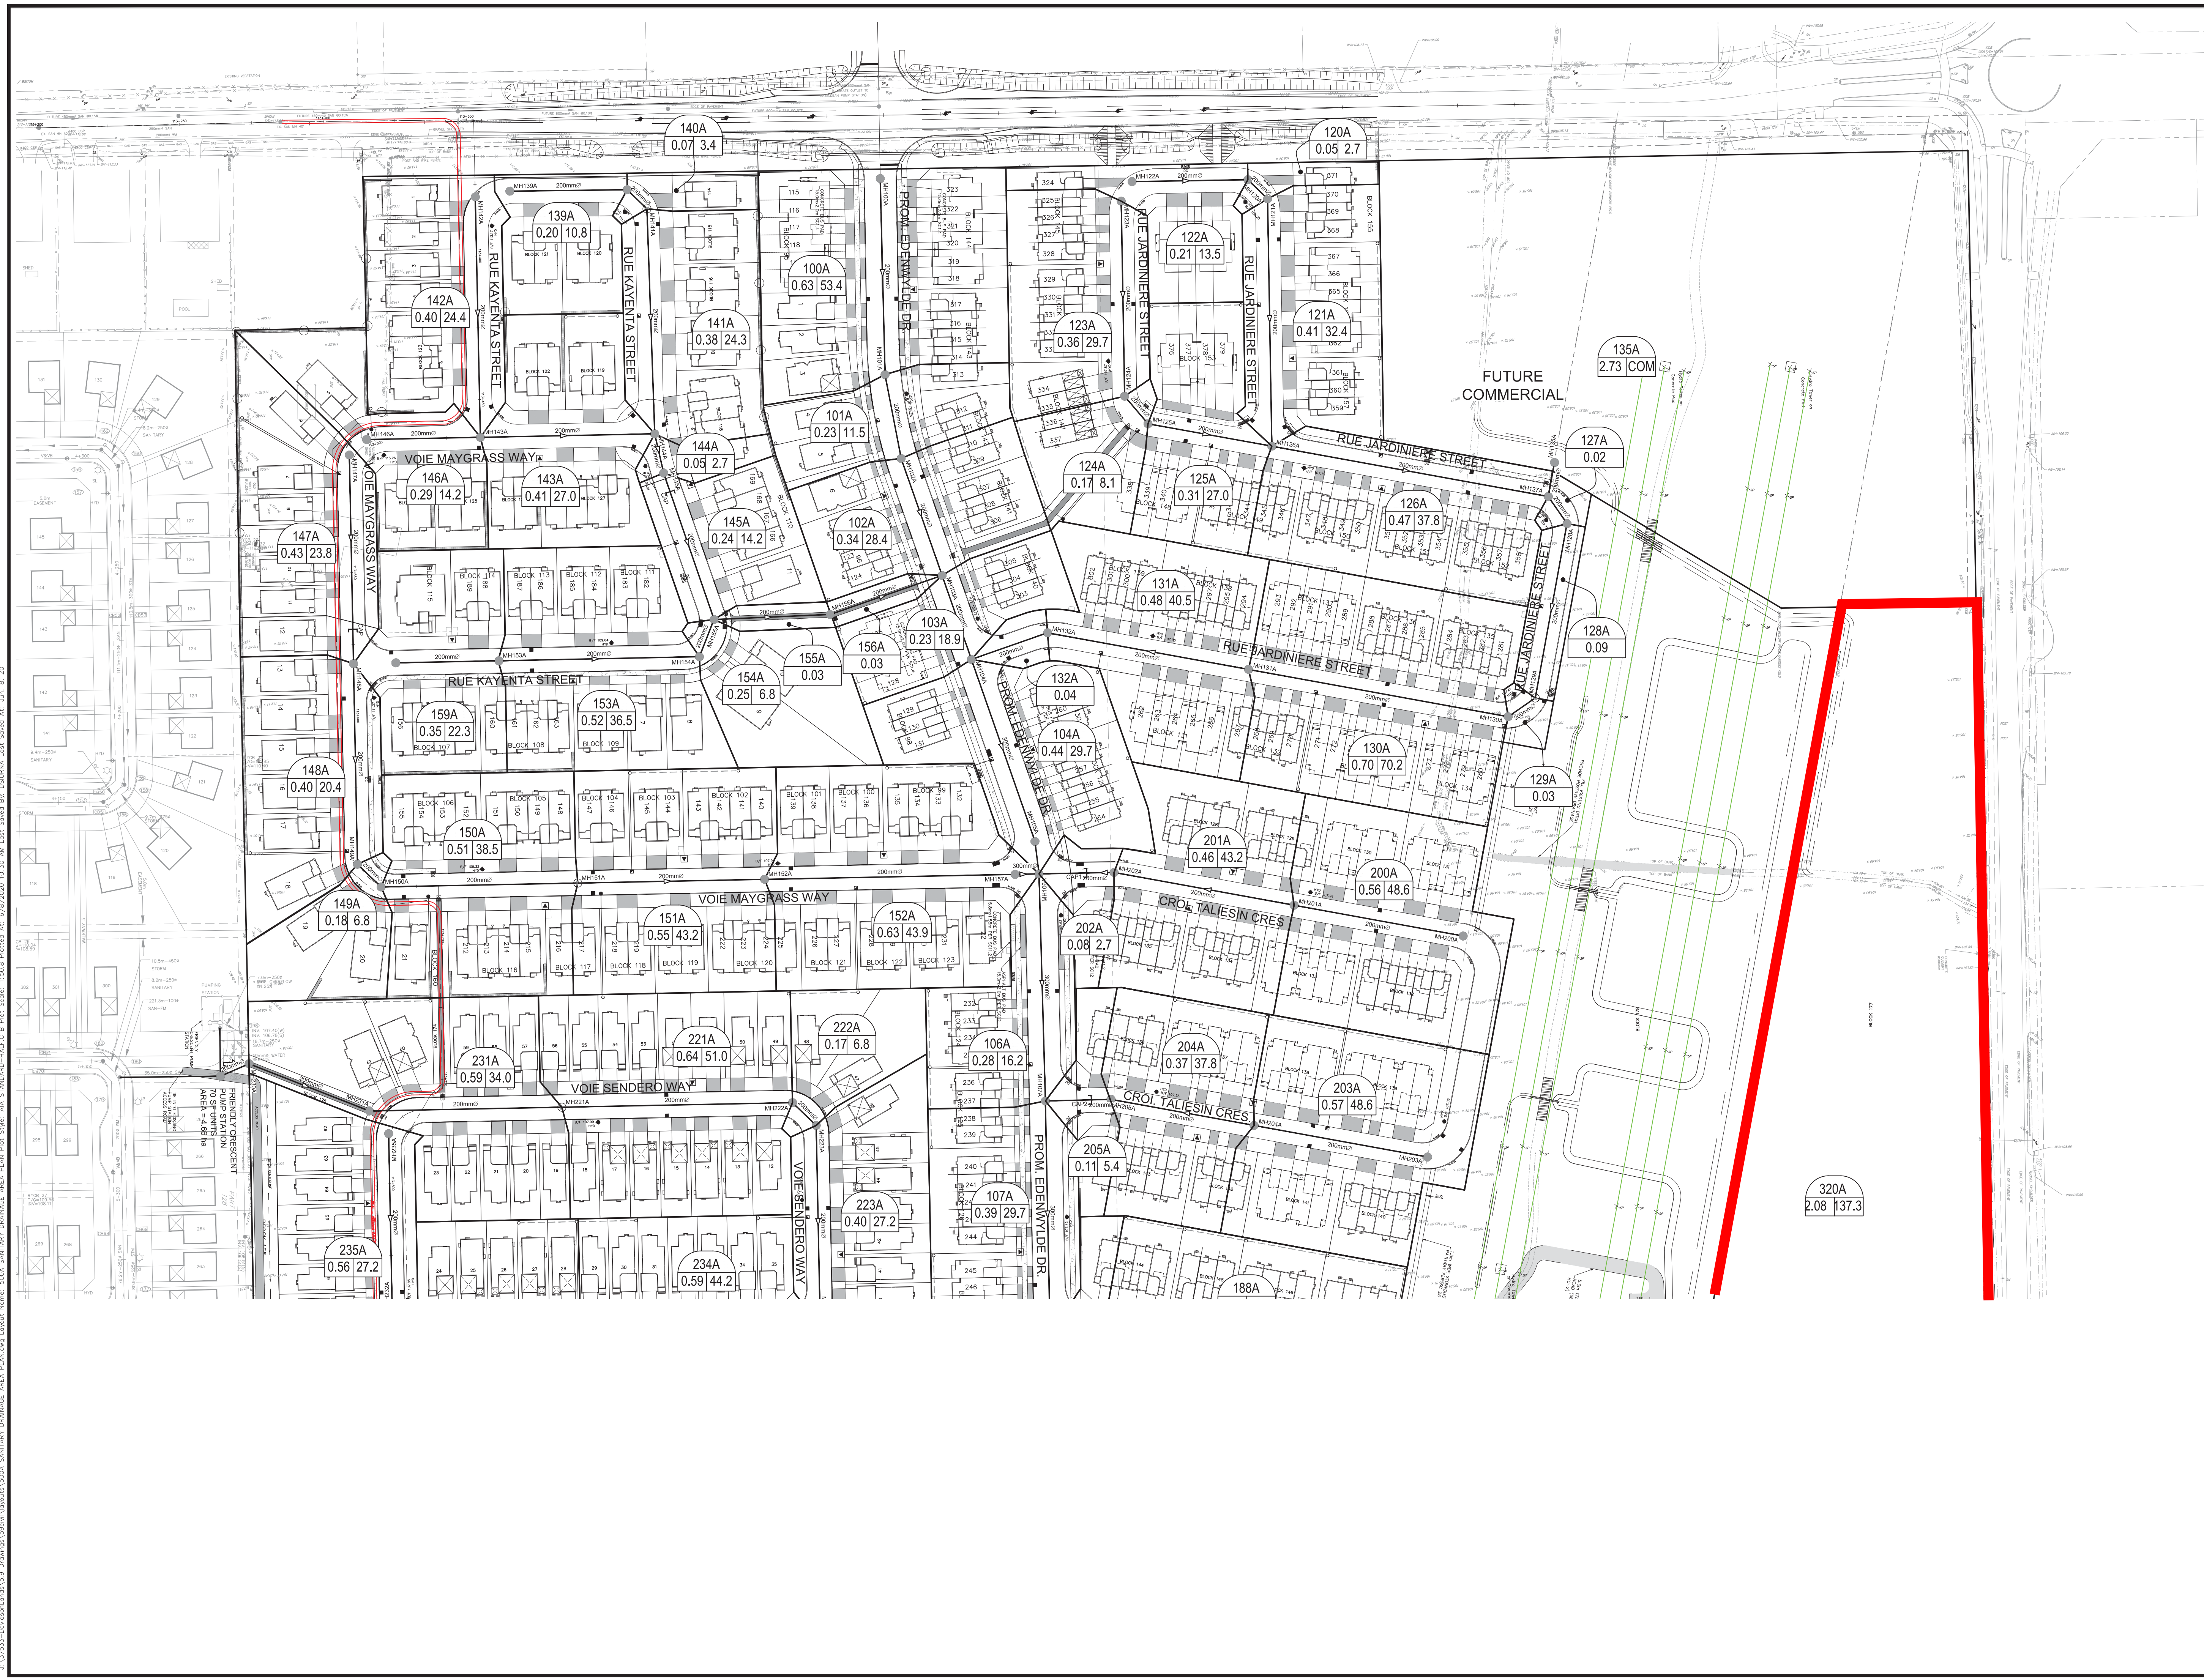

14			
13			
12	REVISED PHASE 2 PER CITY COMMENTS	L.M.E.	2020-06-05
11	REVISED PHASE 2 PER CITY COMMENTS	L.M.E.	2020-04-09
10	REVISED PHASE 2 AS PER CITY COMMENTS AND NEW LEGAL	L.M.E.	2020-02-07
9	PHASE 2 SUBMISSION 1 FOR CITY REVIEW	L.M.E.	2019-10-30
8	REVISED BLOCK 147	L.M.E.	2018-10-05
7	REVISED PER CITY COMMENTS	L.M.E.	2018-06-04
6	ISSUED FOR TENDER	L.M.E.	2018-05-30
5	REVISED PER NEW LEGAL	L.M.E.	2018-04-06
4	REVISED PER CITY COMMENTS	L.M.E.	2018-02-09
3	REVISED PER CITY COMMENTS	L.M.E.	2017-10-25
2	ISSUED FOR MOE APPROVAL (BY OTHERS)	L.M.E.	2017-03-10
1	SUBMISSION 1 FOR CITY REVIEW	L.M.E.	2017-02-27
No.	REVISIONS	By	Date

IBI GROUP
400 - 353 Preston Street
Ottawa ON K1S 5N4 Canada
tel 613 225 1311 fax 613 225 9868
ibigroup.com

Project Title
DAVIDSON LANDS
PHASE 1 & 2

Professional Engineer
L.M. ERNOLD
13379508
2020/06/05
PROVINCE OF ONTARIO


Drawing Title
SANITARY DRAINAGE AREA PLAN

Scale
1:1000


Design	L.E.	Date	DEC 2016
Drawn	D.D. / C.C.	Checked	J.I.M.
Project No.	37533	Drawing No.	500A

J:\37533-DavidsonLands\5.9 Drawings\5.9 Sanitary Drainage Area Plan\500A Sanitary Drainage Area Plan.dwg Layout Home: 500A Sanitary Drainage Area Plan Plot Size: A4 STANDARD-HALF CTB Plot Scale: 1:500.8 Printed At: 6/8/2020 10:30 AM User: Soud By: CSDURNA Last Saved At: Jun. 8, 2020

J:\37533-DavidsonLands\5.9 Drawings\38civil\Layout Name: 201A SANITARY DRAINAGE AREA PLAN.dwg Layout Name: 201A SANITARY DRAINAGE AREA PLAN Plot Style: AIA STANDARD-HALF CTB Plot Scale: 1:50.8 Plotted At: 6/9/2020 10:40 AM Last Saved By: DSURNA Last Saved At: Jun. 8, 20

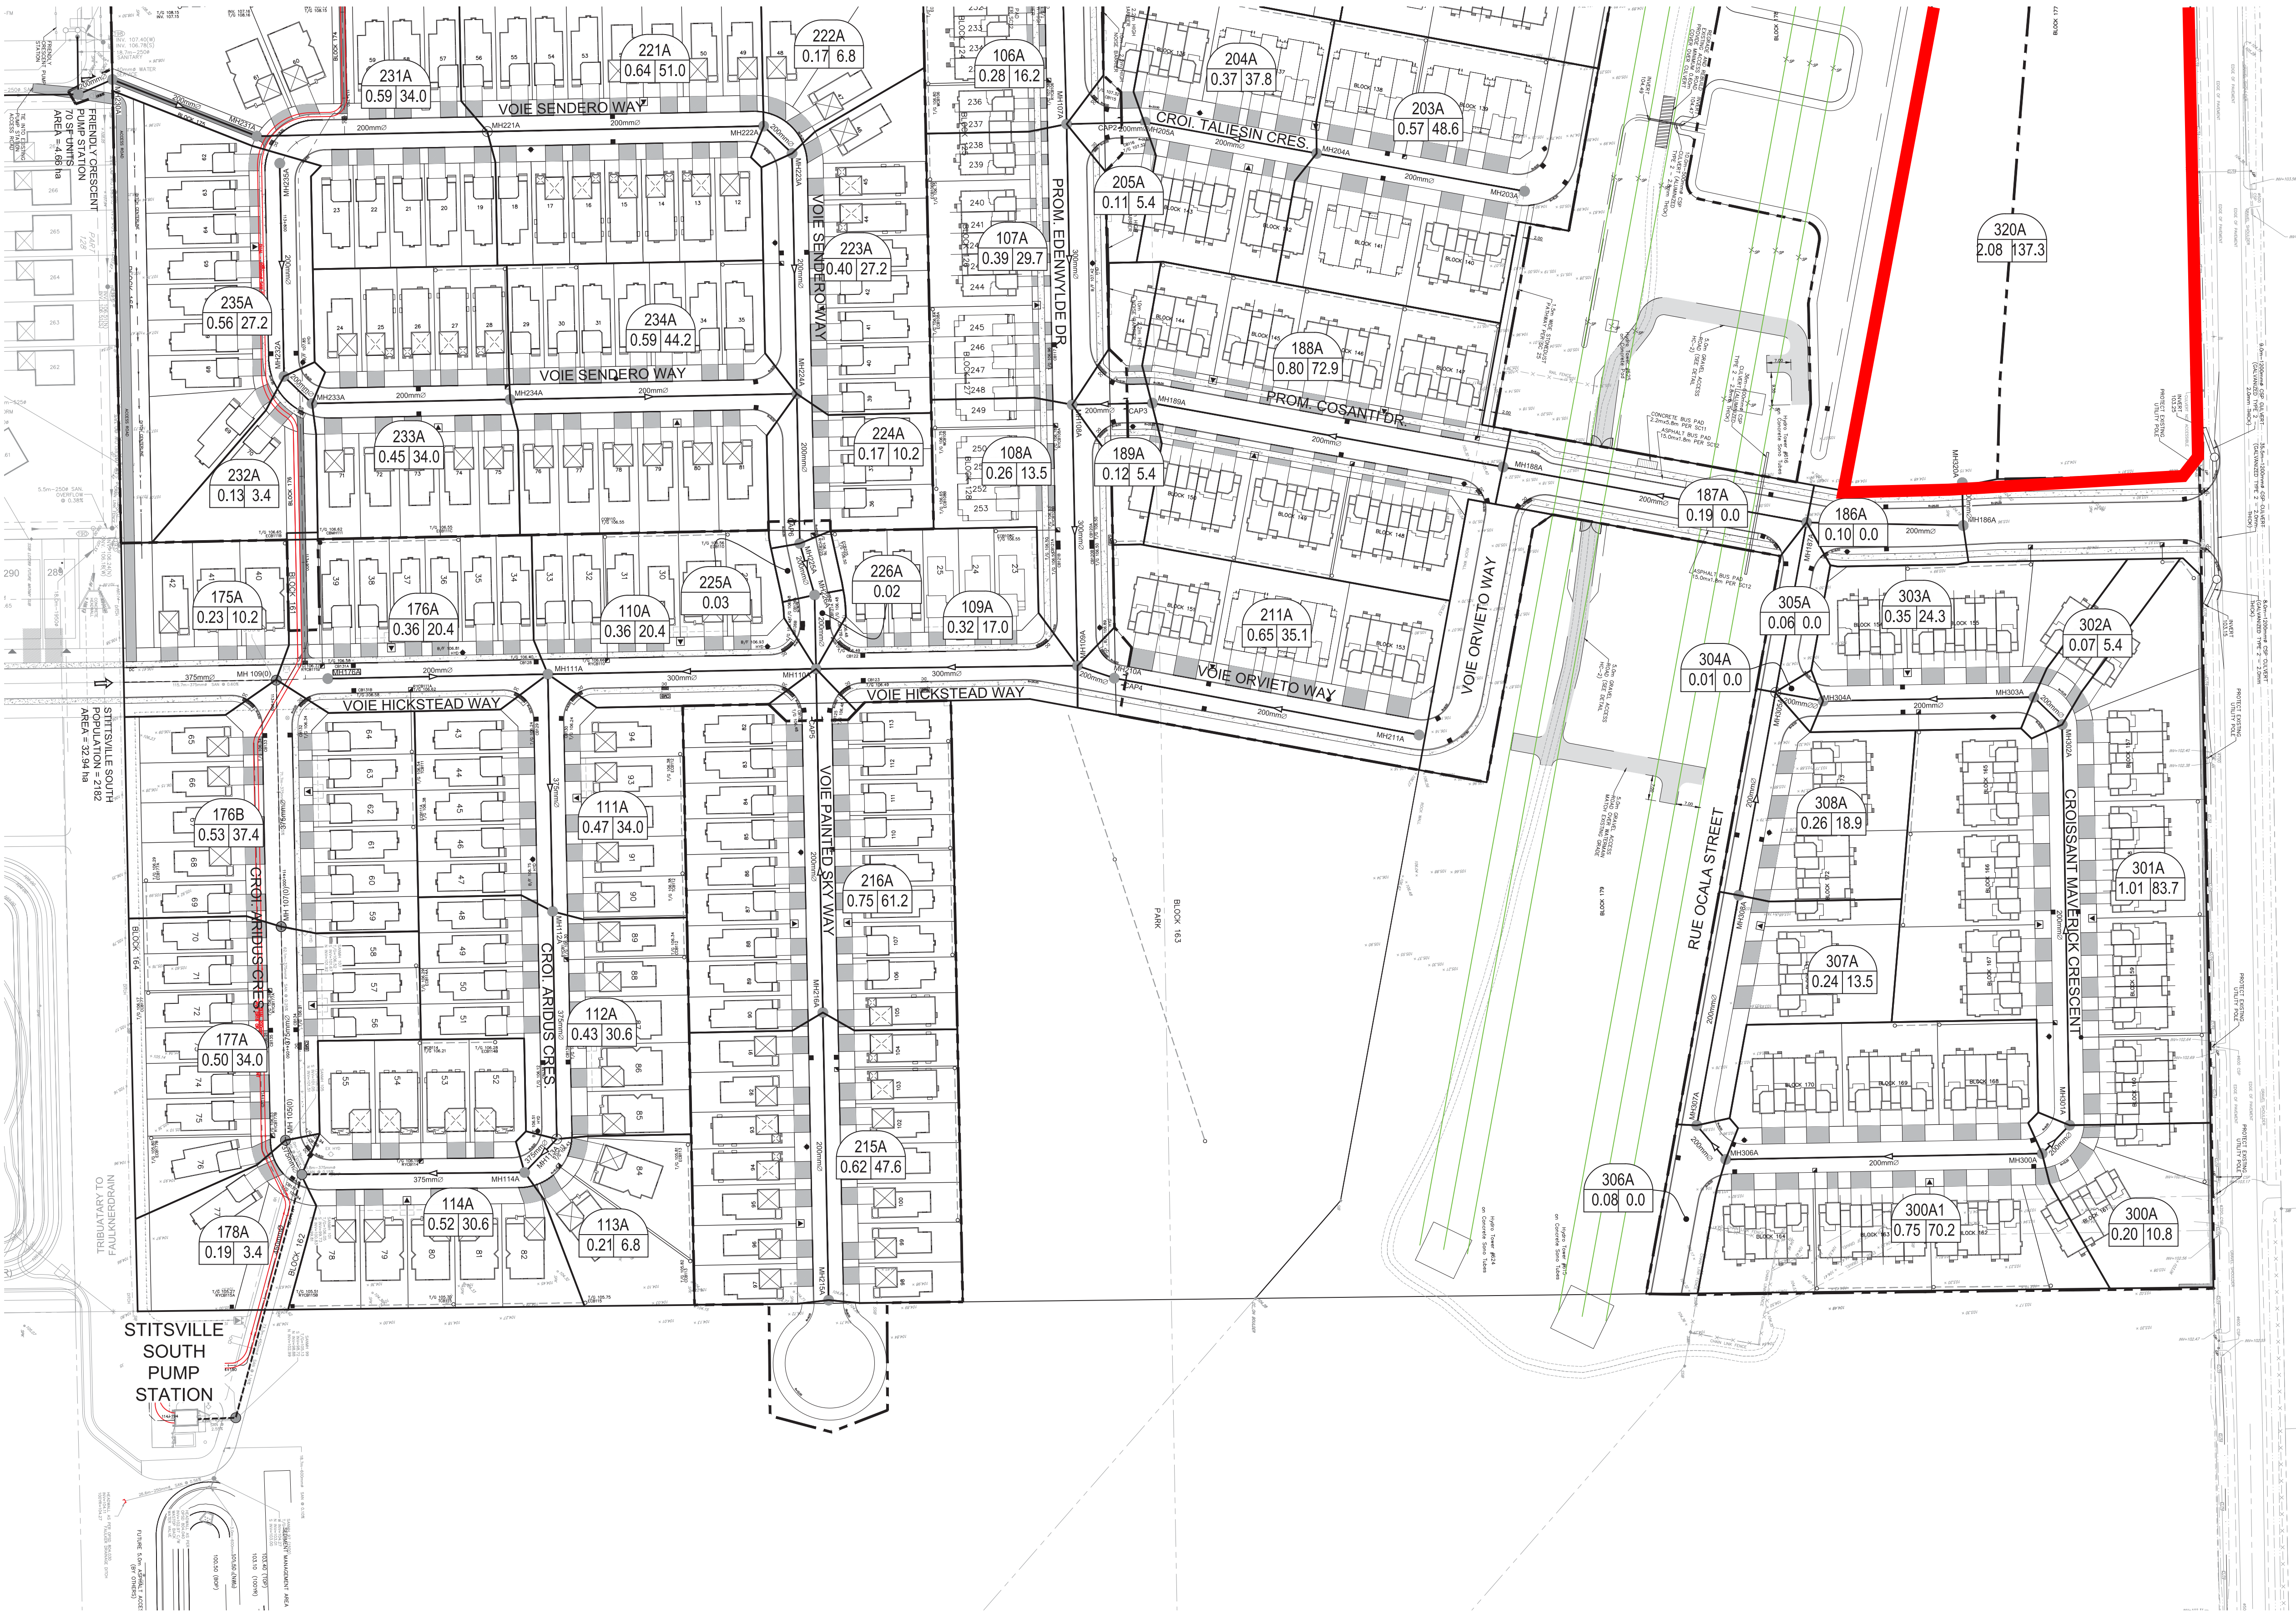


REVIEWED BY
 DEVELOPMENT REVIEW SERVICES BRANCH
 Signed _____
 Date _____ 2018
 Plan Number _____

LEGEND:

 107A — AREA NUMBER
 0.41 | 32.4 — POPULATION
 — AREA IN HECTARES


No.	REVISIONS	By	Date
14			
13			
12	REVISED PHASE 2 PER CITY COMMENTS	L.M.E.	2020-06-05
11	REVISED PHASE 2 PER CITY COMMENTS	L.M.E.	2020-04-09
10	REVISED PHASE 2 AS PER CITY COMMENTS AND NEW LEGAL PLAN	L.M.E.	2020-02-07
9	PHASE 2 SUBMISSION 1 FOR CITY REVIEW	L.M.E.	2019-10-30
8	REVISED LOT NUMBERS	L.M.E.	2018-09-11
7	REVISED PER CITY COMMENTS	L.M.E.	2018-06-04
6	ISSUED FOR TENDER	L.M.E.	2018-05-30
5	REVISED PER NEW LEGAL	L.M.E.	2018-04-06
4	REVISED PER CITY COMMENTS	L.M.E.	2018-02-09
3	REVISED PER CITY COMMENTS	L.M.E.	2017-10-25
2	ISSUED FOR MOE APPROVAL (BY OTHERS)	L.M.E.	2017-03-10
1	SUBMISSION 1 FOR CITY REVIEW	L.M.E.	2017-02-27

IBI IBI GROUP
 400 - 353 Preston Street
 Ottawa ON K1S 5N4 Canada
 tel 613 225 1311 fax 613 225 9868
 ibigroup.com

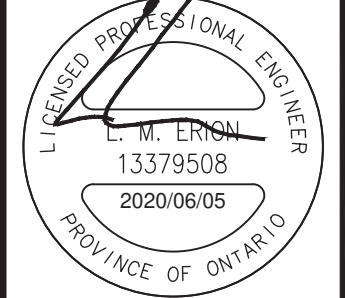Project Title
DAVIDSON LANDS
 PHASE 1 & 2



LI. 13379
 M. ERON
 13379508
 2020/06/05
 PROVINCE OF ONTARIO



Drawing Title
SANITARY DRAINAGE AREA PLAN

Scale 1 : 500

Design	L.E.	Date	DEC 2016
Drawn	D.D. / C.C.	Checked	J.I.M.
Project No.	37533	Drawing No.	501A

D07-16-15-0008

APPENDIX D

139185-500	Storm Sewer Design Sheet
139185-600	Storm Drainage Plan
	Ponding Plan
	Davidson Lands Phase 2 Storm Design Sheet
	Davidson Lands Phase 2 Storm Drainage Area Plan
	Temporary Orifice Sizing
	Sample Runoff Coefficient Calculations
	Figure 4.1 Existing Minor Storm Plan – Design Brief Davidson Lands-OPA 76 Area 6a Phase 2
	Figure 4.2 Proposed Minor Storm Plan – Design Brief Davidson Lands-OPA 76 Area 6a Phase 2
139185-700	DDSWMM Drainage Area Plan Schematic 2025-03-19
	Velocity x Depth Calculations
	Results of Hydraulic Grade Line Evaluation
	Davidson Lands Phase 1&2 Overall Storm Drainage Plan
	Davidson Lands Phase 1&2 Overall Ponding Plan
	Design Criteria for Future Development Areas - Design Brief Davidson Lands-OPA 76 Area 6a Phase 2
	Summary Table for Storages – Flows to Cosanti at Outlet to Dry Pond
	Velocity x Depth Calculation – Davidson Lands Phase 2

LEGEND :


- DRAINAGE BOUNDARY
- R126 AREA ID
- 0.14 RUNOFF COEFFICIENT
- AREA IN HECTARES
- ➔ MAJOR FLOW

No.	REVISIONS	By	Date
14	REVISED PHASE 2 PER REMOVAL OF BLK 178 AND REVISED PROFILES	J.M.E	2021-06-03
13	REVISED PHASE 2 PER CITY COMMENTS	J.M.E	2020-07-29
12	REVISED PHASE 2 PER CITY COMMENTS	J.M.E	2020-06-03
11	REVISED PHASE 2 PER CITY COMMENTS	J.M.E	2020-04-09
10	REVISED PHASE 2 AS PER CITY COMMENTS AND NEW LEGAL PLAN	J.M.E	2020-02-07
9	ISSUED FOR PHASE 2 REVIEW	J.M.E	2019-10-30
8	REVISED LOT NUMBERS	J.M.E	2018-09-11
7	REVISED PER CITY COMMENTS	J.M.E	2018-06-04
6	ISSUED FOR TENDER	J.M.E	2018-05-30
5	REVISED FOR NEW LEGAL	J.M.E	2018-04-06
4	REVISED PER CITY COMMENTS	J.M.E	2018-02-09
3	REVISED PER CITY COMMENTS	J.M.E	2017-10-25
2	ISSUED FOR MOE APPROVAL (BY OTHERS)	J.M.E	2017-03-10
1	SUBMISSION 1 FOR CITY REVIEW	J.M.E	2017-02-27

IBI GROUP
400 - 333 Preston Street
Ottawa ON K1S 5N4 Canada
tel 613 225 1311 fax 613 225 9868
ibigroup.com

Project Title
DAVIDSON LANDS
PHASE 1 & 2


Professional Engineer
L. M. T. ENCAL
13379508
2021/06/03
PROVINCE OF ONTARIO



Drawing Title
OVERALL STORM DRAINAGE PLAN


Scale
1 : 500

Design L.E.	Date DEC 2016
Drawn D.D. / C.C.	Checked J.I.M.
Project No. 37533	Drawing No. 750B

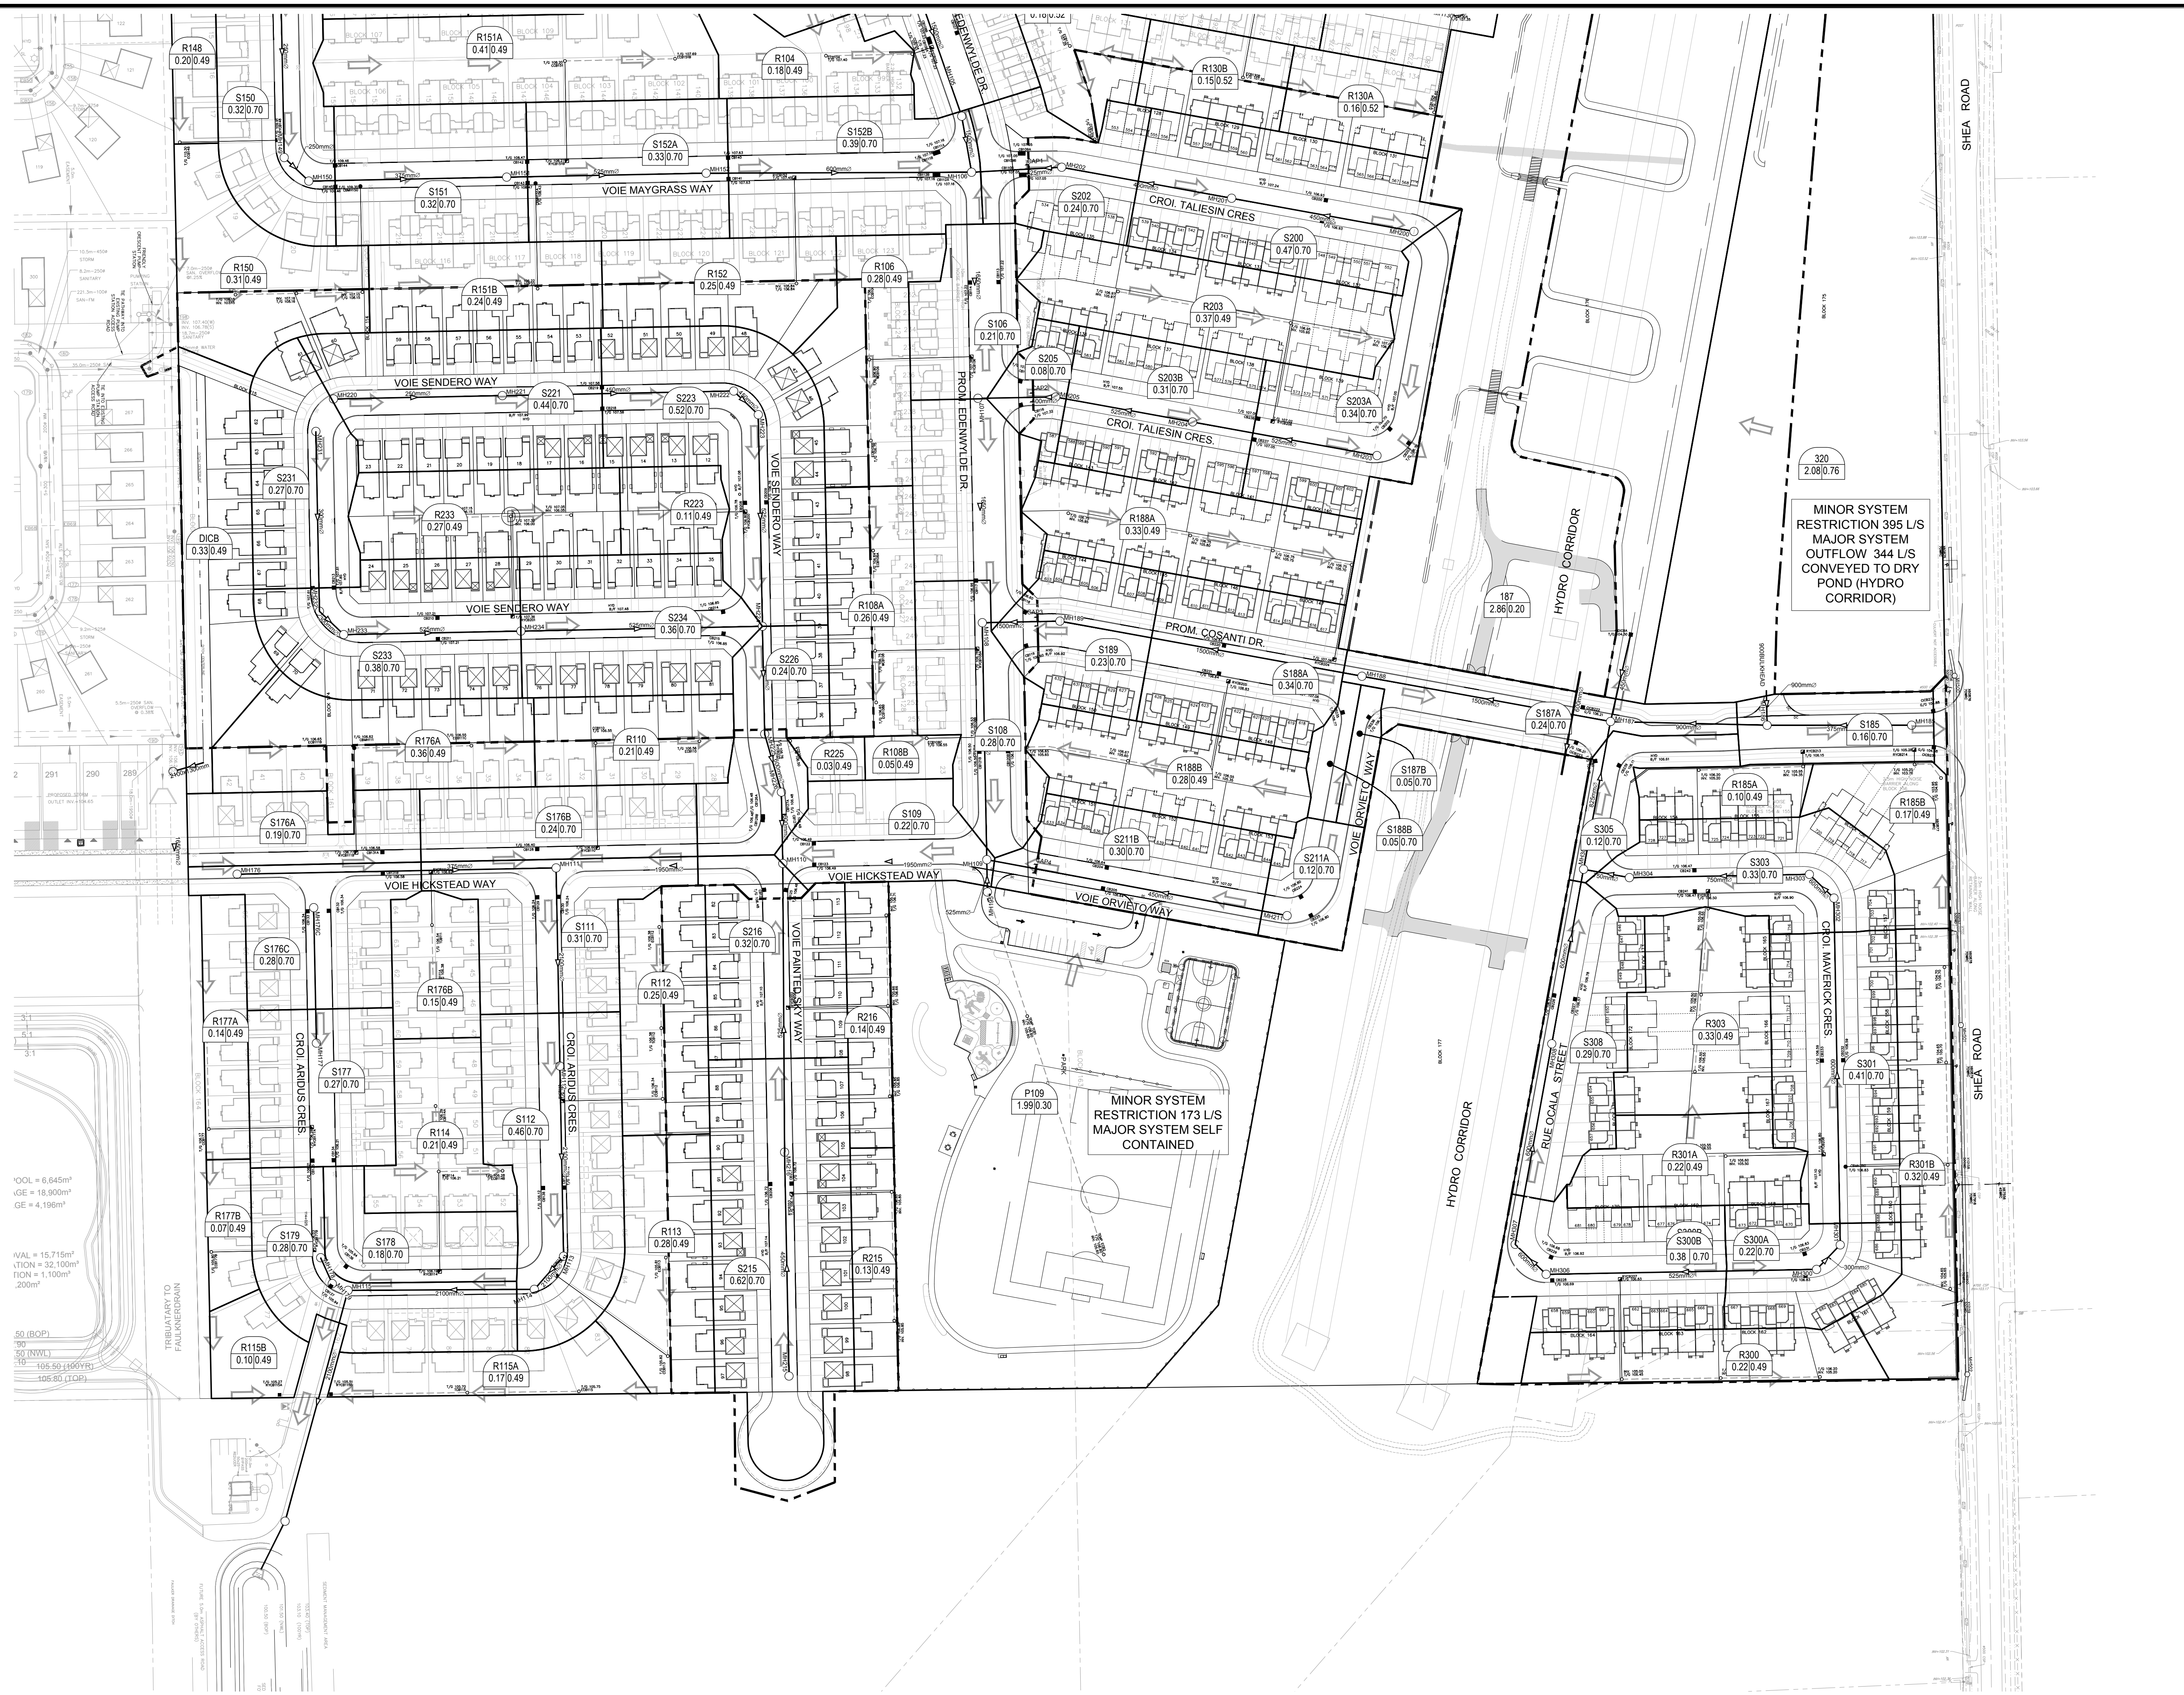

J:\37533-DavidsonLands\3.0 Drawings\3.0 Storm Drainage Plans\3.0 Storm Drainage Plan\3.0 Storm Drainage Plan.dwg
 Name: 750B OVERALL STORM DRAINAGE PLAN Plot Size: A4 STANDARD-HALF-CRIB Plot Scale: 1:50.0 Printed At: 7/9/2021 3:08 PM User: JESSE-SEBASTIEN.FORG
 Plot Scale: 1:50.0
 50 (BOP)
 50 (NWCL)
 105.50 (SOP) (H)
 105.80 (TOP)

'OOL = 6,645m²
 GE = 18,900m²
 GE = 4,196m²
 IVAL = 15,715m²
 VION = 32,100m²
 PION = 1,100m²
 200m²

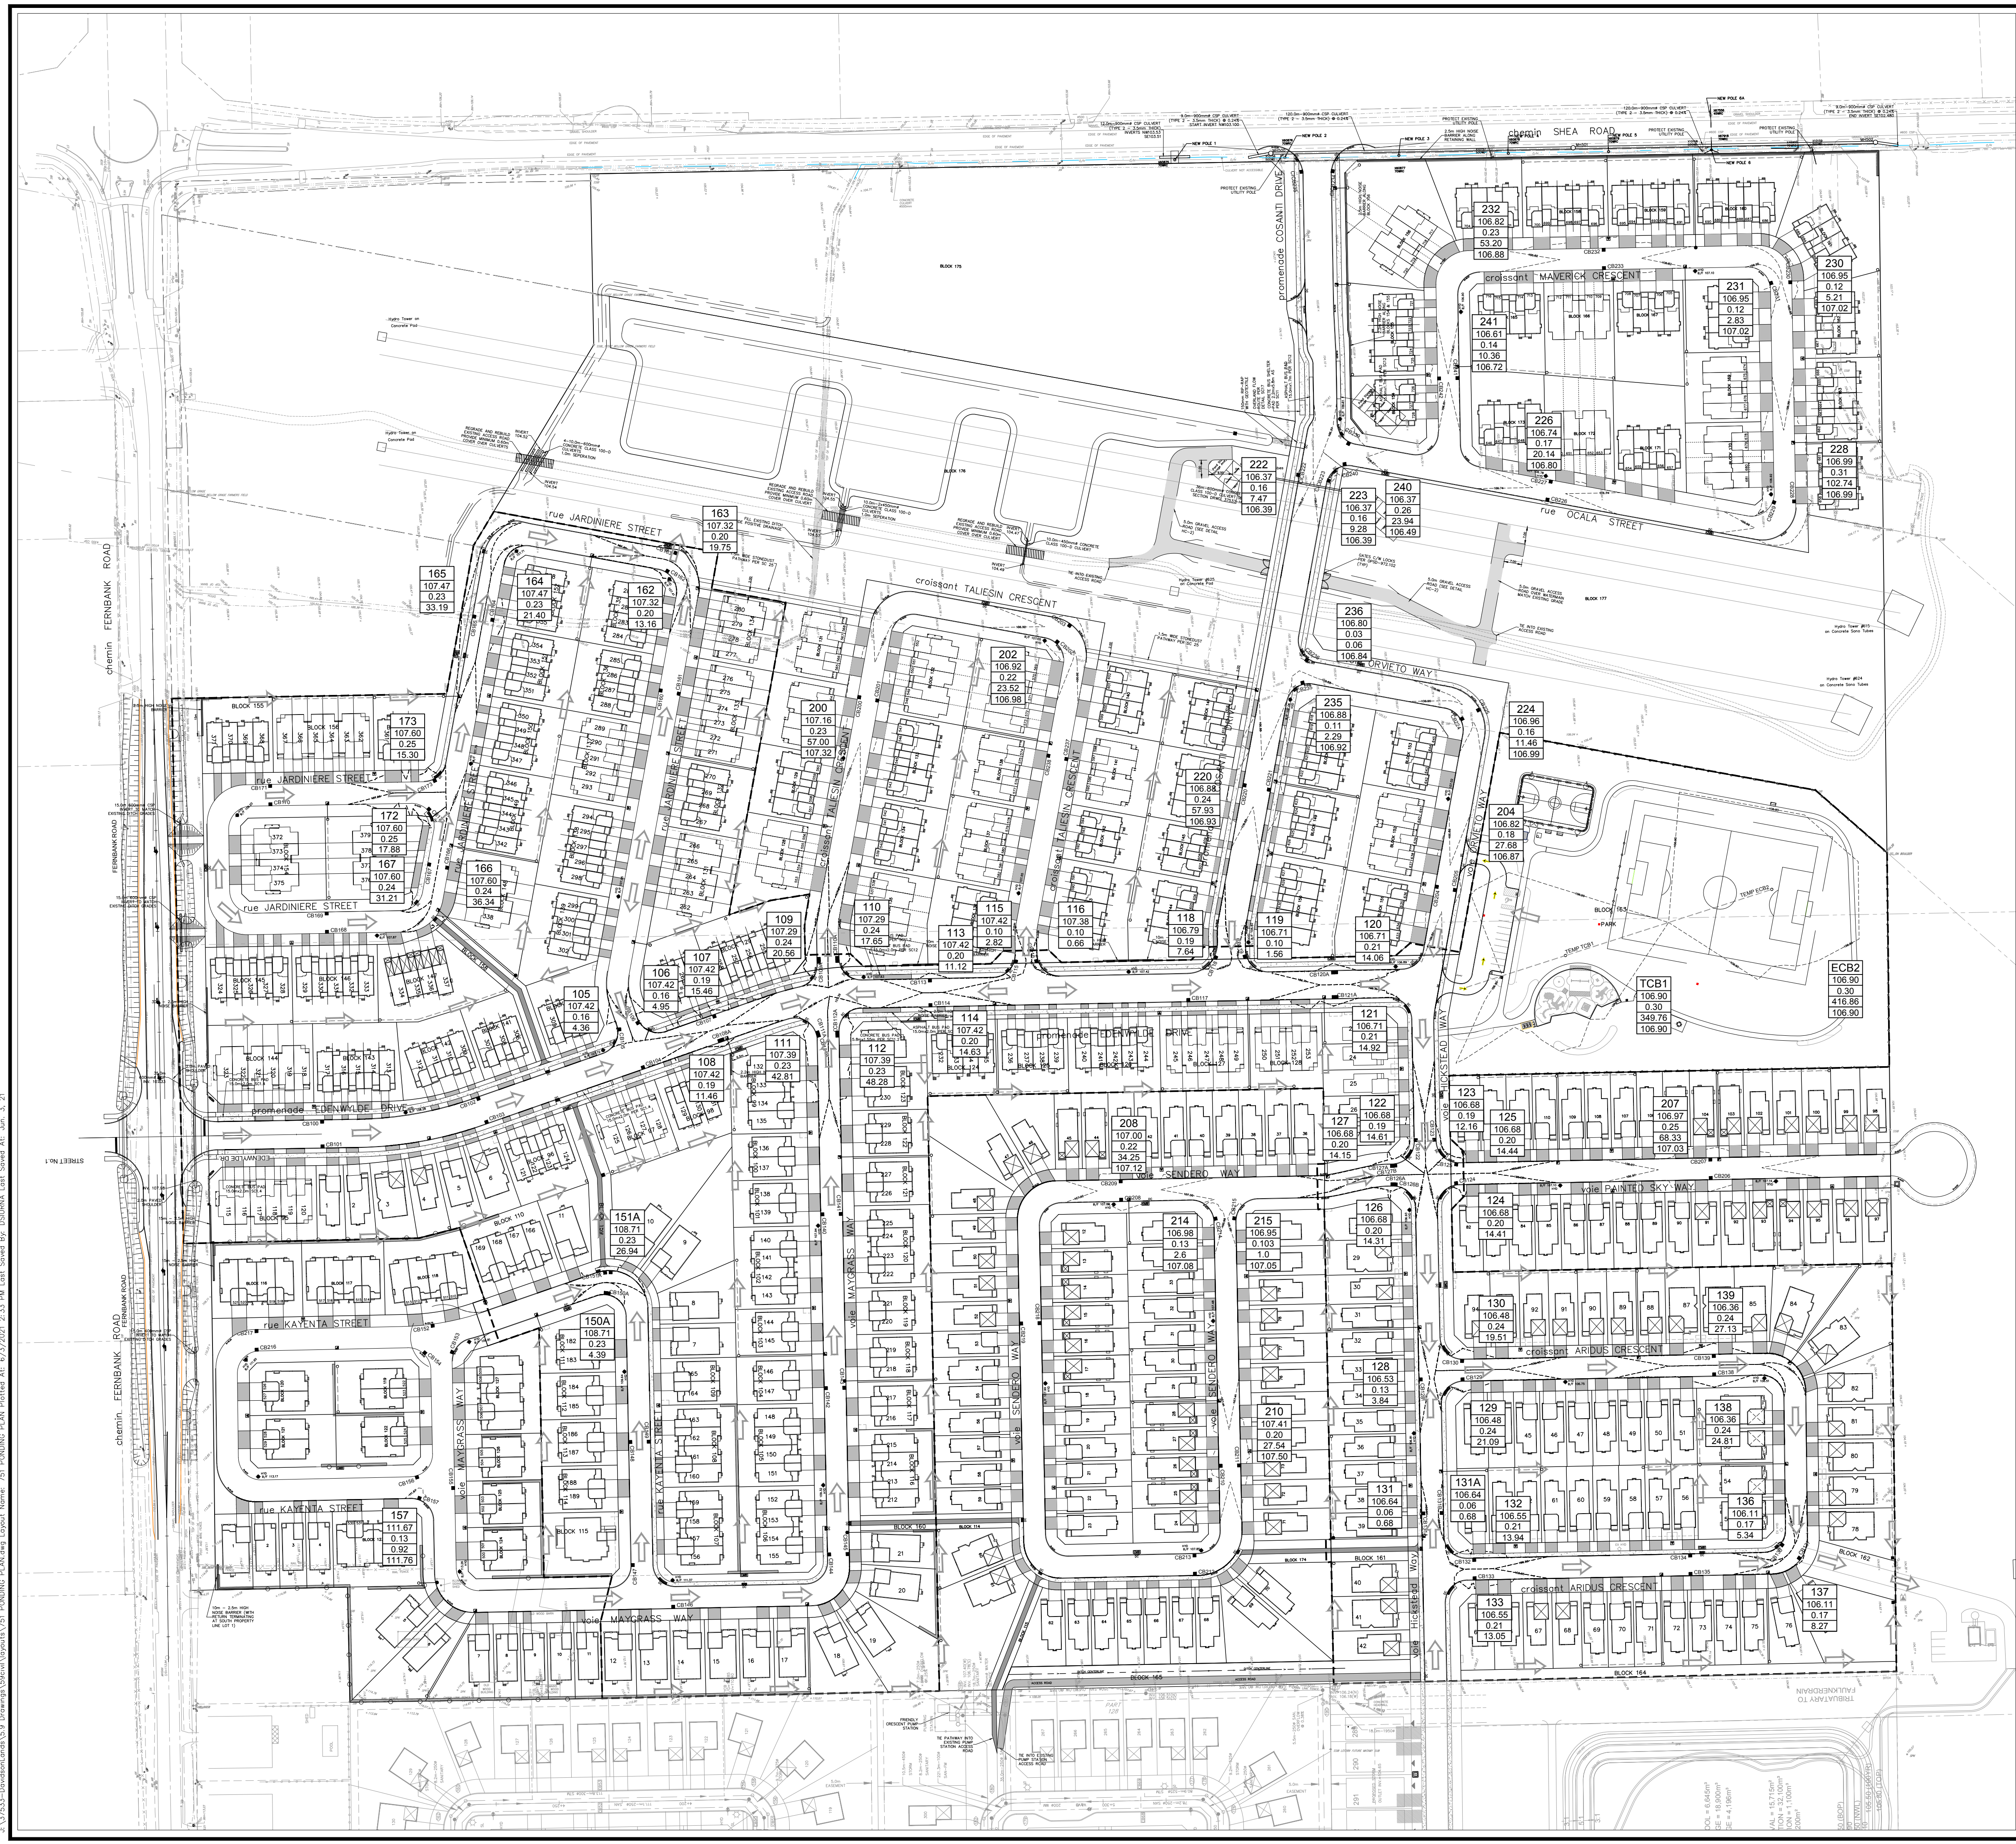

REVIEWED BY
 DEVELOPMENT REVIEW SERVICES BRANCH
 Signed _____
 Date _____ 2018
 Plan Number _____


LEGEND :

110	POND AREA #
107.29	STATIC POND ELEVATION (m)
0.24	STATIC POND DEPTH (m)
17.65	STATIC POND VOLUME (m ³)
107.35	CLIMATE CHANGE ELEVATION (m)

17			
16			
15	REVISED PHASE 2 PER REMOVAL OF BLK 178 AND REVISED PROFILES	L.M.E	2021-06-02
14	REVISED PHASE 2 PER CITY COMMENTS	L.M.E	2020-07-29
13	REVISED PHASE 2 PER CITY COMMENTS	L.M.E	2020-06-05
12	REVISED PHASE 2 AS PER CITY COMMENTS	L.M.E	2020-04-09
11	REVISED PHASE 2 AS PER CITY COMMENTS AND NEW LEGAL PLAN	L.M.E	2020-02-07
10	PHASE 2 SUBMISSION 1 FOR CITY REVIEW	L.M.E	2019-10-30
9	REVISED BLOCK 147	L.M.E	2019-10-05
8	REVISED LOT NUMBERS	L.M.E	2019-09-11
7	REVISED PER CITY COMMENTS	L.M.E	2019-08-04
6	ISSUED FOR TENDER	L.M.E	2019-06-30
5	REVISED PER NEW LEGAL	L.M.E	2019-04-06
4	REVISED PER CITY COMMENTS	L.M.E	2019-02-09
3	REVISED PER CITY COMMENTS	L.M.E	2017-10-25
2	ISSUED FOR MOE APPROVAL (BY OTHERS)	L.M.E	2017-03-10
1	SUBMISSION 1 FOR CITY REVIEW	L.M.E	2017-02-27
No.	REVISIONS	By	Date

IBI GROUP
 400 - 333 Preston Street
 Ottawa ON K1S 5N4 Canada
 tel 613 225 1311 fax 613 225 9868
 ibigroup.com

Project Title
DAVIDSON LANDS
 PHASE 1 & 2

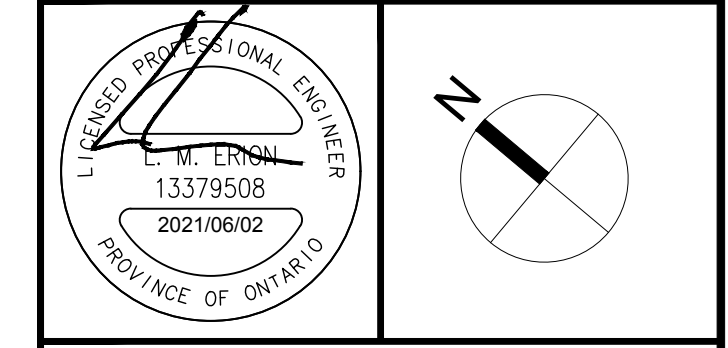

Drawing Title
PONDING PLAN

1:1250

Design	L.E.	Scale	DEC 2016
Drawn	J.F.	Checked	R.B.
Project No.	37533	Drawing No.	751

J:\37533-DavidsonLands\3.0 Drawings\37533\37533-1751-PONDING PLAN.dwg Layout Name: 751 PONDING PLAN Printed At: 6/2/2021 2:13 PM Last Saved By: EDIEMMA Last Saved At: Jun 3, 21

D07-16-15-0008

An evaluation of the hydraulic grade line in Phase 2 was undertaken assuming that those storm sewer pipes that are partially permanently submerged have 25% accumulation of sediment. The results of the hydraulic evaluation are presented in **Appendix D**.

5.4.5 Design Criteria for Future Development Areas

The design criteria for future development areas FP135, FP320 and P109 was determined and evaluated with the 3 hour, 100 year Chicago design storm. The major flow for FP135 is contained onsite up to the 100 year Chicago, 327cu.m. of on site storage is estimated but will be confirmed at the detailed design stage. The maximum allowable minor system flow is set to the 5 year Chicago Storm and corresponds to 622 l/s. The storm HGL within the receiving MH135 during the 100 year Chicago event would be 104.95 m. The major flow for FP320 includes 10.4 cu.m. of onsite storage and outflows 344 l/s of major flow during the 100 year Chicago design storm event. The maximum allowable minor system flow is set to the 5 year Chicago Storm and corresponds to 395 l/s. The storm HGL within the receiving MH 320 during the 100 year Chicago event would be 104.20 m. The major flow for P109 is contained onsite up to the 100 year Chicago using 130 cu.m. of on site storage. The maximum allowable minor system flow is set to the 5 year Rational Method flow with an inlet time of 10 minutes as per request by the City of Ottawa and corresponds to 173 l/s. The storm HGL within the receiving MH195 would be 103.89m.

5.5 Summary of Model Output Files

The following is a reference list of the model output files including file names and storm event evaluated. The files are included on the CD enclosed in **Appendix D**.

DDSWMM:

- 5 year 3 hour Chicago: 37533-5CH.OUT, EXT37533-5CH.OUT
- 100 year 3 hour Chicago: 37533-100CH.OUT, EXT37533-100CH.OUT
- 100 year 3 hour Chicago + 20%: 37533-120CH.OUT, EXT37533-120CH.OUT
- 100 year 12 hour SCS Type II: 37533-SC12100c.OUT, EXT37533-SC12100c.OUT
- 100 year 24 hour SCS Type II: 37533-SC24100X.OUT, EXT37533-SC24100x.OUT
- 100 year 24 hour SCS Type II + 20%: 37533-SC24120x.OUT, EXT37533-SC24120x.OUT
- July 1979: 37533-19790701.OUT, EXT37533-19790701.OUT
- August 1988: 37533-19880804.OUT, EXT37533-19880804.OUT
- August 1996: 37533-19960808.OUT, EXT37533-19960808.OUT

SWMHYMO:

- 37533VXD.OUT

XPSWMM:

- 2 year 3 hour Chicago: STM_0909-2CH_2020-06-04.out
- 5 year 3 hour Chicago: STM_0909-5CH_2020-06-04.out
- 100 year 3 hour Chicago: STM_0909-100CH_2020-06-04.OUT
- 100 year 3 hour Chicago + 20%: STM_0909-120CH_2020-06-04.OUT
- 100 year 12 hour SCS Type II: STM_0912-SC12100C_2020-06-04. OUT

Summary Table for Storages

5 Year Chicago Storm Event

Area ID	Max Inflow (l/s)	Capture Flow to MH	Static Depth	Dynamic Depth	Storage Used	Storage Available	Spill flow
S187A	51	50	0.16	0.00	0.02	16.75	0
S305	22	22	0.26	0.00	0.01	23.94	0

100 Year Chicago Storm Event

Area ID	Max Inflow (l/s)	Capture Flow to MH	Static Depth	Dynamic Depth	Storage Used	Storage Available	Spill flow
S187A	133	50	0.16	0.02	16.75	16.75	83
S305	127	43	0.26	0.12	23.94	23.94	84

Velocity x Depth Calculation - Davidson Lands - Phase 2

Iteration equation:

Velocity:

$$V_x = V_{min} + \frac{Q_x - Q_{min}}{Q_{max} - Q_{min}} (V_{max} - V_{min})$$

Depth:

$$d_x = d_{min} + \frac{Q_x - Q_{min}}{Q_{max} - Q_{min}} (d_{max} - d_{min})$$

100 Year 3 Hour Chicago Storm

Area ID (Dummy Segment, if applicable)	Road ROW Section	Longitudinal Slope (%)	Overflow Flowrate		SWMHYMO (37533vd.out)					Calculation Sheet: Overflow for Typical Road Ponding Area					SWMHYMO (37533vd.out)			Velocity x Depth (m ² /s)	Maximum Static Ponding Depth (m)	Total Depth (Static + Dynamic) (m)
			Qx (l/s)	Qx (cms)	Flowrate (cms)		Velocity (m/s)			Flowrate (cms)		Depth (m)			Depth (m)					
					Qmin	Qmax	vmin	vmax	vx	Qmin	Qmax	dmin	dmax	dx	dmin	dmax	dx			
S106	22	1.00	0	0.000	0.000	0.002	0.000	0.271	0.000	0.000	0.001	0.000	0.001	0.000	N/A	N/A	0.000	0.000	0.19	0.19
S202	18	0.60	0	0.000	0.000	0.001	0.000	0.199	0.000	0.000	0.001	0.000	0.001	0.000	N/A	N/A	N/A	0.000	0.24	0.24
S200	18	0.60	0	0.000	0.000	0.001	0.000	0.199	0.000	0.000	0.001	0.000	0.001	0.000	N/A	N/A	N/A	0.000	0.23	0.23
S205	18	0.60	0	0.000	0.000	0.001	0.000	0.199	0.000	0.000	0.001	0.000	0.001	0.000	N/A	N/A	N/A	0.000	0.10	0.10
S203B	18	0.60	83	0.083	0.076	0.123	0.583	0.658	0.594	N/A	N/A	N/A	N/A	N/A	0.063	0.075	0.065	0.038	0.00	0.06
S203A	18	2.00	88	0.088	0.081	0.116	0.594	0.649	0.605	0.078	0.091	0.080	0.085	N/A	0.033	0.038	0.034	0.021	0.22	0.25
S300A	18	0.60	26	0.026	0.019	0.042	0.414	0.502	0.441	0.021	0.027	0.050	0.055	0.054	N/A	N/A	N/A	0.024	0.12	0.17
S308	14.75	1.60	8	0.008	0.006	0.017	0.445	0.583	0.470	0.006	0.009	0.030	0.035	0.034	N/A	N/A	N/A	0.016	0.17	0.20
S301	18	0.60	0	0.000	0.000	0.001	0.000	0.199	0.000	0.000	0.001	0.000	0.001	0.000	N/A	N/A	N/A	0.000	0.23	0.23
S300B	18	0.60	0	0.000	0.000	0.001	0	0.199	0.000	0.000	0.001	0.000	0.001	0.000	N/A	N/A	N/A	0.000	0.30	0.30
S303	18	1.60	90	0.090	0.068	0.124	0.82	0.951	0.871	0.078	0.091	0.080	0.085	0.085	N/A	N/A	N/A	0.074	0.14	0.22
R300	3.6	1.50	27	0.027	0.017	0.036	0.619	0.75	0.688	N/A	N/A	N/A	N/A	N/A	0.095	0.126	0.111	0.077	0.00	0.11
R303	3.6	1.50	60	0.060	0.036	0.065	0.75	0.87	0.849	N/A	N/A	N/A	N/A	N/A	0.126	0.158	0.152	0.130	0.00	0.15
R301A	3.6	1.50	23	0.023	0.017	0.036	0.619	0.75	0.660	N/A	N/A	N/A	N/A	N/A	0.095	0.126	0.105	0.069	0.00	0.10
S187A	22	2.00	88	0.088	0.040	0.117	0.352	0.462	0.421	N/A	N/A	N/A	N/A	N/A	0.013	0.019	0.017	0.007	0.16	0.18
S187B S188B	20	0.80	11	0.011	0.005	0.014	0.387	0.507	0.467	0.008	0.012	0.035	0.040	0.039	0.027	0.041	N/A	0.018	0.03	0.07
S185	24	2.00	111	0.111	0.097	0.177	0.977	1.134	1.004	N/A	N/A	N/A	N/A	N/A	0.055	0.068	0.057	0.058	0.00	0.06
S107	22	0.80	70	0.070	0.061	0.11	0.612	0.71	0.630	N/A	N/A	N/A	N/A	N/A	0.055	0.068	0.057	0.036	0.00	0.06
S188B S187B	20	0.60	11	0.011	0.004	0.012	0.335	0.439	0.426	0.008	0.011	0.035	0.040	0.039	N/A	N/A	N/A	0.017	0.11	0.15
S188A	22	0.60	0	0.000	0.000	0.001	0	0.21	0.000	0.000	0.001	0.000	0.001	0.000	N/A	N/A	N/A	0.000	0.24	0.24
S189	22	0.80	0	0.000	0.000	0.002	0	0.243	0.000	0.001	0.000	0.001	0.000	N/A	N/A	N/A	0.000	0.19	0.19	
S108	22	0.60	0	0.000	0	0.001	0	0.21	0.000	0.000	0.001	0.000	0.001	0.000	N/A	N/A	N/A	0.000	0.21	0.21
S211A	20	0.60	0	0.000	0	0.001	0	0.211	0.000	0.000	0.001	0.000	0.001	0.000	N/A	N/A	N/A	0.000	0.16	0.16
S211B	20	0.60	10	0.010	0.008	0.024	0.335	0.439	0.348	0.008	0.011	0.035	0.040	0.038	N/A	N/A	N/A	0.013	0.18	0.22
S109	20	0.50	33	0.033	0.022	0.048	0.401	0.486	0.437	0.027	0.034	0.055	0.060	0.059	N/A	N/A	N/A	0.026	0.19	0.25
S221	18	1.00	115	0.115	0.098	0.159	0.752	0.849	0.779	N/A	N/A	N/A	N/A	N/A	0.063	0.075	0.066	0.052	0.00	0.07
S223	18	1.00	132	0.132	0.098	0.159	0.752	0.849	0.806	0.119	0.136	0.095	0.100	0.099	N/A	N/A	N/A	0.080	0.22	0.32
S231	18	0.82	63	0.063	0.049	0.089	0.587	0.681	0.620	N/A	N/A	N/A	N/A	N/A	0.05	0.063	0.055	0.034	0.00	0.05
S233	18	0.90	8	0.008	0.008	0.024	0.387	0.508	0.387	0.006	0.008	0.030	0.035	0.034	N/A	N/A	N/A	0.013	0.20	0.23
S234	18	1.00	43	0.043	0.025	0.054	0.535	0.648	0.605	0.035	0.043	0.060	0.065	0.065	N/A	N/A	N/A	0.039	0.12	0.18
S226 S216	18	0.50	229	0.229	0.17	0.242	0.666	0.728	0.717	0.215	0.240	0.120	0.125	0.123	N/A	N/A	N/A	0.088	0.20	0.32
S176B	20	0.70	202	0.202	0.181	0.247	0.912	0.987	0.936	0.192	0.215	0.115	0.120	0.117	N/A	N/A	N/A	0.110	0.13	0.25
S215	18	0.80	0	0.000	0	0.001	0	0.23	0.000	0.000	0.001	0.000	0.001	0.000	N/A	N/A	N/A	0.000	0.25	0.25
S216 S226	18	0.50	229	0.229	0.17	0.242	0.666	0.728	0.717	0.215	0.240	0.120	0.125	0.123	N/A	N/A	N/A	0.088	0.20	0.32
S111	18	0.60	106	0.106	0.076	0.123	0.583	0.658	0.631	0.100	0.115	0.090	0.095	0.092	N/A	N/A	N/A	0.058	0.24	0.33
S112	18	0.65	61	0.061	0.043	0.079	0.523	0.606	0.565	0.051	0.061	0.070	0.075	0.075	N/A	N/A	N/A	0.042	0.24	0.31
S176A	20	2.00	7	0.007	0.002	0.015	0.386	0.612	0.473	0.006	0.009	0.030	0.035	0.032	N/A	N/A	N/A	0.015	0.06	0.09
S176C	20	0.60	11	0.011	0.008	0.024	0.335	0.439	0.355	0.008	0.011	0.035	0.040	0.039	N/A	N/A	N/A	0.014	0.21	0.25
S177	20	0.60	69	0.069	0.053	0.096	0.532	0.617	0.564	N/A	N/A	N/A	N/A	N/A	0.055	0.068	0.060	0.034	0.00	0.06
S178	18	1.50	83	0.083	0.06	0.097	0.921	1.04	0.995	0.078	0.091	0.080	0.085	0.082	0.063	0.075	N/A	0.082	0.17	0.25
S179	18	1.50	83	0.083	0.051	0.109	0.735	0.89	0.821	N/A	N/A	N/A	N/A	N/A	0.036	0.048	0.043	0.035	0.17	0.21
R203	3.6	1.50	54	0.054	0.036	0.065	0.75	0.87	0.824	N/A	N/A	N/A	N/A	N/A	0.126	0.158	0.146	0.120	0.00	0.15
R188A	3.6	1.50	42	0.042	0.036	0.065	0.75	0.87	0.775	N/A	N/A	N/A	N/A	N/A	0.126	0.158	0.133	0.103	0.00	0.13
R188B	3.6	1.50	29	0.029	0.017	0.036	0.619	0.75	0.702	N/A	N/A	N/A	N/A	N/A	0.095	0.126	0.115	0.080	0.00	0.11
R215	3.6	1.50	15	0.015	0.006	0.017	0.473	0.619	0.592	N/A	N/A	N/A	N/A	N/A	0.063	0.095	0.089	0.053	0.00	0.09
R216	3.6	1.50	32	0.032	0.017	0.036	0.619	0.75	0.722	N/A	N/A	N/A	N/A	N/A	0.095	0.126	0.119	0.086	0.00	0.12
R233	3.6	1.50	27	0.027	0.017	0.036	0.619	0.75	0.688	N/A	N/A	N/A	N/A	N/A	0.095	0.126	0.111	0.077	0.00	0.11
R223	3.6	1.50	37	0.037	0.036	0.065	0.75	0.87	0.754	N/A	N/A	N/A	N/A	N/A	0.126	0.158	0.127	0.096	0.00	0.13
S142	18	4.00	75	0.075	0.05	0.108	1.07	1.296	1.167	0.067	0.080	0.075	0.080	0.078	N/A	N/A	N/A	0.091	0.13	0.21
S146	18	4.00	17	0.017	0.017	0.050	0.817	1.070	0.817	N/A	N/A	N/A	N/A	N/A	0.025	0.038	0.025	0.020	0.00	0.03
S141A	14.75	2.30	38	0.038	0.021	0.044	0.699	0.847	0.808	N/A	N/A	N/A	N/A	N/A	0.030	0.040	0.037	0.030	0.00	0.04
S141B	18	2.00	72	0.072	0.069	0.112	1.064	1.201	1.074	N/A	N/A	N/A	N/A	N/A	0.063	0.075	0.064	0.069	0.00	0.06
S143	18	2.00	176	0.176	0.170	0.242	1.331	1.455	1.341	N/A	N/A	N/A	N/A	N/A	0.088	0.100	0.089	0.119	0.00	0.09
R147	3.6	1.50	0	0.000	0.000	0.001	0.000	0.298	0.000	N/A	N/A	N/A	N/A	N/A	0.000	0.032	0.000	0.000	0.00	0.00
R146	3.6	1.50	22	0.022	0.017	0.036	0.619	0.750	0.653	N/A	N/A	N/A	N/A	N/A	0.095	0.126	0.103	0.067	0.00	0.10
R141	3.6	1.50	13	0.013	0.006	0.017	0.473	0.619	0.566	N/A	N/A	N/A	N/A	N/A	0.063	0.095	0.083	0.047	0.00	0.08
S305	14.75	0.60	90	0.090	0.070	0.100	0.567	0.628	0.629	0.086	0.100	0.085	0.090	0.086	0.070	0.080	0.080	0.050	0.26	0.35
R301B	3.6	1.50	63	0.063	0.036	0.065	0.750	0.870	0.862	N/A	N/A	N/A	N/A	N/A	0.126	0.158	0.156	0.134	0.00	0.16

Velocity x Depth Calculation - Davidson Lands - Phase 2

Iteration equation:

Velocity:

$$v_x = v_{min} + \frac{Q_x - Q_{min}}{Q_{max} - Q_{min}} (v_{max} - v_{min})$$

Depth:

$$d_x = d_{min} + \frac{Q_x - Q_{min}}{Q_{max} - Q_{min}} (d_{max} - d_{min})$$

100 Year 3 Hour Chicago Storm + 20%

Area ID (Dummy Segment, if applicable)	Road ROW Section	Longitudinal Slope (%)	SWMHYMO (37533vd.out)								Calculation Sheet: Overflow for Typical Road Ponding Area						Velocity x Depth (m ² /s)	Maximum Static Ponding Depth (m)	Total Depth (Static + Dynamic) (m)	
			Overflow Flowrate		Flowrate (cms)		Velocity (m/s)				Flowrate (cms)		Depth (m)							
			Qx (l/s)	Qx (cms)	Qmin	Qmax	vmin	vmax	vx	Qmin	Qmax	dmin	dmax	dx	dmin	dmax				dx
S106	22	1.00	0	0.000	0.000	0.002	0.000	0.271	0.000	0.000	0.001	0.000	0.001	0.000	N/A	N/A	0.000	0.000	0.19	0.19
S202	18	0.60	537	0.537	0.481	0.645	0.925	1.031	0.961	0.500	0.544	0.160	0.165	0.164	N/A	N/A	N/A	0.158	0.24	0.40
S200	18	0.60	468	0.468	0.363	0.481	0.862	0.925	0.918	0.458	0.500	0.155	0.160	0.156	N/A	N/A	N/A	0.143	0.23	0.39
S205	18	0.60	0	0.000	0.000	0.001	0.000	0.199	0.000	0.000	0.001	0.000	0.001	0.000	N/A	N/A	N/A	0.000	0.10	0.10
S203B	18	0.60	111	0.111	0.076	0.123	0.583	0.658	0.639	N/A	N/A	N/A	N/A	N/A	0.063	0.075	0.072	0.046	0.00	0.07
S203A	18	2.00	440	0.440	0.424	0.517	0.897	0.943	0.905	0.402	0.443	0.145	0.150	N/A	0.062	0.066	0.063	0.057	0.22	0.28
S300A	18	0.60	43	0.043	0.042	0.076	0.502	0.583	0.504	0.042	0.051	0.065	0.070	0.066	N/A	N/A	N/A	0.033	0.12	0.19
S308	14.75	1.60	38	0.038	0.037	0.067	0.706	0.820	0.710	0.036	0.045	0.060	0.065	0.061	N/A	N/A	N/A	0.043	0.17	0.23
S301	18	0.60	35	0.035	0.019	0.042	0.414	0.502	0.475	0.034	0.042	0.060	0.065	0.061	N/A	N/A	N/A	0.029	0.23	0.29
S300B	18	0.60	0	0.000	0.000	0.001	0	0.199	0.000	0.000	0.001	0.000	0.001	0.000	N/A	N/A	N/A	0.000	0.30	0.30
S303	18	1.60	164	0.164	0.124	0.201	0.951	1.074	1.015	0.160	0.181	0.105	0.110	0.106	N/A	N/A	N/A	0.107	0.14	0.25
R300	3.6	1.50	45	0.045	0.036	0.065	0.75	0.87	0.787	N/A	N/A	N/A	N/A	N/A	0.126	0.158	0.136	0.107	0.00	0.14
R303	3.6	1.50	101	0.101	0.065	0.106	0.87	0.983	0.969	N/A	N/A	N/A	N/A	N/A	0.158	0.189	0.185	0.180	0.00	0.19
R301A	3.6	1.50	40	0.040	0.036	0.065	0.75	0.87	0.767	N/A	N/A	N/A	N/A	N/A	0.126	0.158	0.130	0.100	0.00	0.13
S187A	22	2.00	202	0.202	0.117	0.254	0.462	0.563	0.525	N/A	N/A	N/A	N/A	N/A	0.019	0.025	0.023	0.012	0.16	0.18
S187B S188B	20	0.80	14	0.014	0.014	0.03	0.507	0.614	0.507	0.012	0.016	0.040	0.045	0.043	0.041	0.055	N/A	0.022	0.03	0.07
S185	24	2.00	179	0.179	0.177	0.287	1.134	1.28	1.137	N/A	N/A	N/A	N/A	N/A	0.068	0.082	0.068	0.078	0.00	0.07
S107	22	0.80	93	0.093	0.061	0.11	0.612	0.71	0.676	N/A	N/A	N/A	N/A	N/A	0.055	0.068	0.063	0.043	0.00	0.06
S188B S187B	20	0.60	14	0.014	0.012	0.026	0.439	0.532	0.452	0.011	0.016	0.040	0.045	0.043	N/A	N/A	N/A	0.019	0.11	0.15
S188A	22	0.60	22	0.022	0.008	0.024	0.334	0.437	0.424	0.021	0.027	0.050	0.055	0.051	N/A	N/A	N/A	0.022	0.24	0.29
S189	22	0.80	0	0.000	0.000	0.002	0	0.243	0.000	0.000	0.001	0.000	0.001	0.000	N/A	N/A	0.000	0.000	0.19	0.19
S108	22	0.60	0	0.000	0	0.001	0	0.21	0.000	0.000	0.001	0.000	0.001	N/A	N/A	N/A	0.000	0.000	0.21	0.21
S211A	20	0.60	7	0.007	0.001	0.008	0.211	0.335	0.317	0.005	0.008	0.030	0.035	0.033	N/A	N/A	N/A	0.010	0.16	0.19
S211B	20	0.60	24	0.024	0.024	0.053	0.439	0.532	0.439	0.021	0.027	0.050	0.055	0.053	N/A	N/A	N/A	0.023	0.18	0.23
S109	20	0.50	179	0.179	0.142	0.214	0.636	0.705	0.671	0.170	0.192	0.110	0.115	0.112	N/A	N/A	N/A	0.075	0.19	0.30
S221	18	1.00	155	0.155	0.098	0.159	0.752	0.849	0.843	N/A	N/A	N/A	N/A	N/A	0.063	0.075	0.074	0.063	0.00	0.07
S223	18	1.00	231	0.231	0.159	0.24	0.849	0.941	0.931	0.222	0.247	0.120	0.125	0.122	N/A	N/A	N/A	0.113	0.22	0.34
S231	18	0.82	86	0.086	0.049	0.089	0.587	0.681	0.674	N/A	N/A	N/A	N/A	N/A	0.05	0.063	0.062	0.042	0.00	0.06
S233	18	0.90	89	0.089	0.051	0.093	0.615	0.714	0.705	0.088	0.103	0.085	0.090	0.085	N/A	N/A	N/A	0.060	0.20	0.29
S234	18	1.00	138	0.138	0.098	0.159	0.752	0.849	0.816	0.136	0.155	0.100	0.105	0.100	N/A	N/A	N/A	0.082	0.12	0.22
S226 S216	18	0.50	677	0.677	0.589	0.763	0.941	1.043	0.993	0.638	0.687	0.175	0.180	0.179	N/A	N/A	N/A	0.178	0.20	0.38
S176B	20	0.70	613	0.613	0.582	0.729	1.345	1.432	1.363	0.590	0.638	0.170	0.175	0.172	N/A	N/A	N/A	0.235	0.13	0.30
S215	18	0.80	29	0.029	0.022	0.048	0.479	0.58	0.506	0.028	0.035	0.055	0.060	0.056	N/A	N/A	N/A	0.028	0.25	0.31
S216 S226	18	0.50	677	0.677	0.589	0.763	0.941	1.043	0.993	0.638	0.687	0.175	0.180	0.179	N/A	N/A	N/A	0.178	0.20	0.38
S111	18	0.60	527	0.527	0.481	0.645	0.925	1.031	0.955	0.500	0.544	0.160	0.165	0.163	N/A	N/A	N/A	0.156	0.24	0.40
S112	18	0.65	452	0.452	0.378	0.5	0.897	0.963	0.937	0.417	0.458	0.150	0.155	0.154	N/A	N/A	N/A	0.145	0.24	0.39
S176A	20	2.00	22	0.022	0.015	0.045	0.612	0.802	0.656	0.017	0.022	0.045	0.050	0.050	N/A	N/A	N/A	0.033	0.06	0.11
S176C	20	0.60	68	0.068	0.053	0.096	0.532	0.617	0.562	0.061	0.073	0.075	0.080	0.078	N/A	N/A	N/A	0.044	0.21	0.29
S177	20	0.60	144	0.144	0.096	0.155	0.617	0.697	0.682	N/A	N/A	N/A	N/A	N/A	0.068	0.082	0.079	0.054	0.00	0.08
S178	18	1.50	397	0.427	0.38	0.509	1.462	1.628	1.522	0.402	0.443	0.145	0.150	0.148	0.125	0.138	N/A	0.225	0.17	0.32
S179	18	1.50	427	0.427	0.321	0.484	1.166	1.293	1.249	N/A	N/A	N/A	N/A	N/A	0.073	0.085	0.081	0.101	0.17	0.25
R203	3.6	1.50	90	0.090	0.065	0.106	0.87	0.983	0.939	N/A	N/A	N/A	N/A	N/A	0.158	0.189	0.177	0.166	0.00	0.18
R188A	3.6	1.50	70	0.070	0.065	0.106	0.87	0.983	0.884	N/A	N/A	N/A	N/A	N/A	0.158	0.189	0.162	0.143	0.00	0.16
R188B	3.6	1.50	54	0.054	0.036	0.065	0.75	0.87	0.824	N/A	N/A	N/A	N/A	N/A	0.126	0.158	0.146	0.120	0.00	0.15
R215	3.6	1.50	26	0.026	0.017	0.036	0.619	0.75	0.681	N/A	N/A	N/A	N/A	N/A	0.095	0.126	0.110	0.075	0.00	0.11
R216	3.6	1.50	55	0.055	0.036	0.065	0.75	0.87	0.829	N/A	N/A	N/A	N/A	N/A	0.126	0.158	0.147	0.122	0.00	0.15
R233	3.6	1.50	50	0.050	0.036	0.065	0.75	0.87	0.808	N/A	N/A	N/A	N/A	N/A	0.126	0.158	0.141	0.114	0.00	0.14
R223	3.6	1.50	69	0.069	0.065	0.106	0.87	0.983	0.881	N/A	N/A	N/A	N/A	N/A	0.158	0.189	0.161	0.142	0.00	0.16
S142	18	4.00	125	0.125	0.108	0.196	1.296	1.504	1.336	0.109	0.126	0.090	0.095	0.095	N/A	N/A	N/A	0.126	0.13	0.22
S146	18	4.00	23	0.023	0.017	0.05	0.817	1.07	0.863	N/A	N/A	N/A	N/A	N/A	0.025	0.038	0.027	0.024	0.00	0.03
S141A	14.75	2.30	55	0.055	0.044	0.08	0.847	0.983	0.889	N/A	N/A	N/A	N/A	N/A	0.04	0.05	0.043	0.038	0.00	0.04
S141B	18	2.00	104	0.104	0.069	0.112	1.064	1.201	1.176	N/A	N/A	N/A	N/A	N/A	0.063	0.075	0.073	0.086	0.00	0.07
S143	18	2.00	267	0.267	0.242	0.331	1.455	1.574	1.488	N/A	N/A	N/A	N/A	N/A	0.1	0.113	0.104	0.154	0.00	0.10
R147	3.6	1.50	3	0.003	0.001	0.006	0.298	0.473	0.368	N/A	N/A	N/A	N/A	N/A	0.032	0.063	0.044	0.016	0.00	0.04
R146	3.6	1.50	39	0.039	0.036	0.065	0.75	0.87	0.762	N/A	N/A	N/A	N/A	N/A	0.126	0.158	0.129	0.099	0.00	0.13
R141	3.6	1.50	24	0.024	0.017	0.036	0.619	0.75	0.667	N/A	N/A	N/A	N/A	N/A	0.095	0.126	0.106	0.071	0.00	0.11
S305	14.75	0.60	199	0.199	0.196	0.26	0.743	0.797	0.746	0.192	0.215	0.115	0.120	0.117	0.100	0.11	0.100	0.075	0.26	0.38
R301B	3.6	1.50	107	0.107	0.106	0.16	0.983	1.089	0.985	N/A	N/A	N/A	N/A	N/A	0.189	0.221	0.190	0.187	0.00	0.19
R185A	3.6	1.50	16	0.016	0.006	0.017	0.473	0.619	0.606	N/A	N/A	N/A	N/A	N/A	0.063	0.095	0.092	0.056	0.00	0.09

Table 5-9: Functioning of the Dry Pond

PARAMETER	2 YEAR CHICAGO	5 YEAR CHICAGO	100 YEAR CHICAGO	100 YEAR CHICAGO + 20%	100 YEAR 12 HOUR SCS TYPE II	100 YEAR 24 HOUR SCS TYPE II	100 YEAR 24 HOUR SCS TYPE II + 20%
Storage Utilised (cu. m)	0	0	576	1940	425	456	1138
Outflow (l/s)	58	100	492	545	484	487	515
Water Level (m)	103.46	103.54	104.55	104.73	104.52	104.52	104.63
Drawdown Time (hr)	n/a	n/a	<3	<4	<4	<4	<5

The dry pond has a freeboard of 0.45 m during the 100 year Chicago design storm and 0.27m during the stress test.

The cumulative downstream major flow hydrograph to the SWM facility was provided to the SWM facility design engineer to incorporate into the facility’s design.

5.4.3 Hydraulic Evaluation

An XPSWMM hydraulic model was created for the subject site. Minor system hydrographs generated from the DDSWMM model were exported to the XPSWMM model. Minor system losses were accounted for in accordance with Appendix 6-B of the City of Ottawa Sewer Design Guidelines (October 2012).


Simulations were performed for various storms to confirm the performance of the proposed SWM facility and the hydraulic grade line (HGL) through the Davidson Lands development.

IBI Group provided SWM facility design engineer the cumulative downstream minor system hydrograph to include in the pond design. The boundary condition at the downstream MH of the Davidson Lands development (XPSWMM MH900) is a tailwater developed based on maximum water elevations for various storm events provided by SWM facility design engineer. For reference, the maximum water levels in the pond are summarized within Table 3B of the Design Brief for the Stormwater Management Pond, a copy is provided within Appendix D of this report. The below table provides summary of the tailwater elevation used for the respective design storms.

Table 5-10 Summary of Tailwater elevation at SWM facility (based on restrictive downstream conditions at pond Outlet)


DESIGN STORM	TAILWATER SURFACE ELEVATION(M)
100 year, 3 hour Chicago	103.00
100 year, 3 hour Chicago +20%	103.
100 year, 12 hour SCS	103.17
100 year, 24 hour SCS	103.12
100 year, 24 hour SCS +20%	103.24
July 1 st , 1979 (Historical)	103.25
August 4 th , 1988 (Historical)	103.08
August 8 th , 1996 (Historical)	102.76

Note: All WSEL as per DSEL Design Brief for the Stormwater Management Pond for the Davidson Lands, November 2017. See reference provided within Appendix D of this report

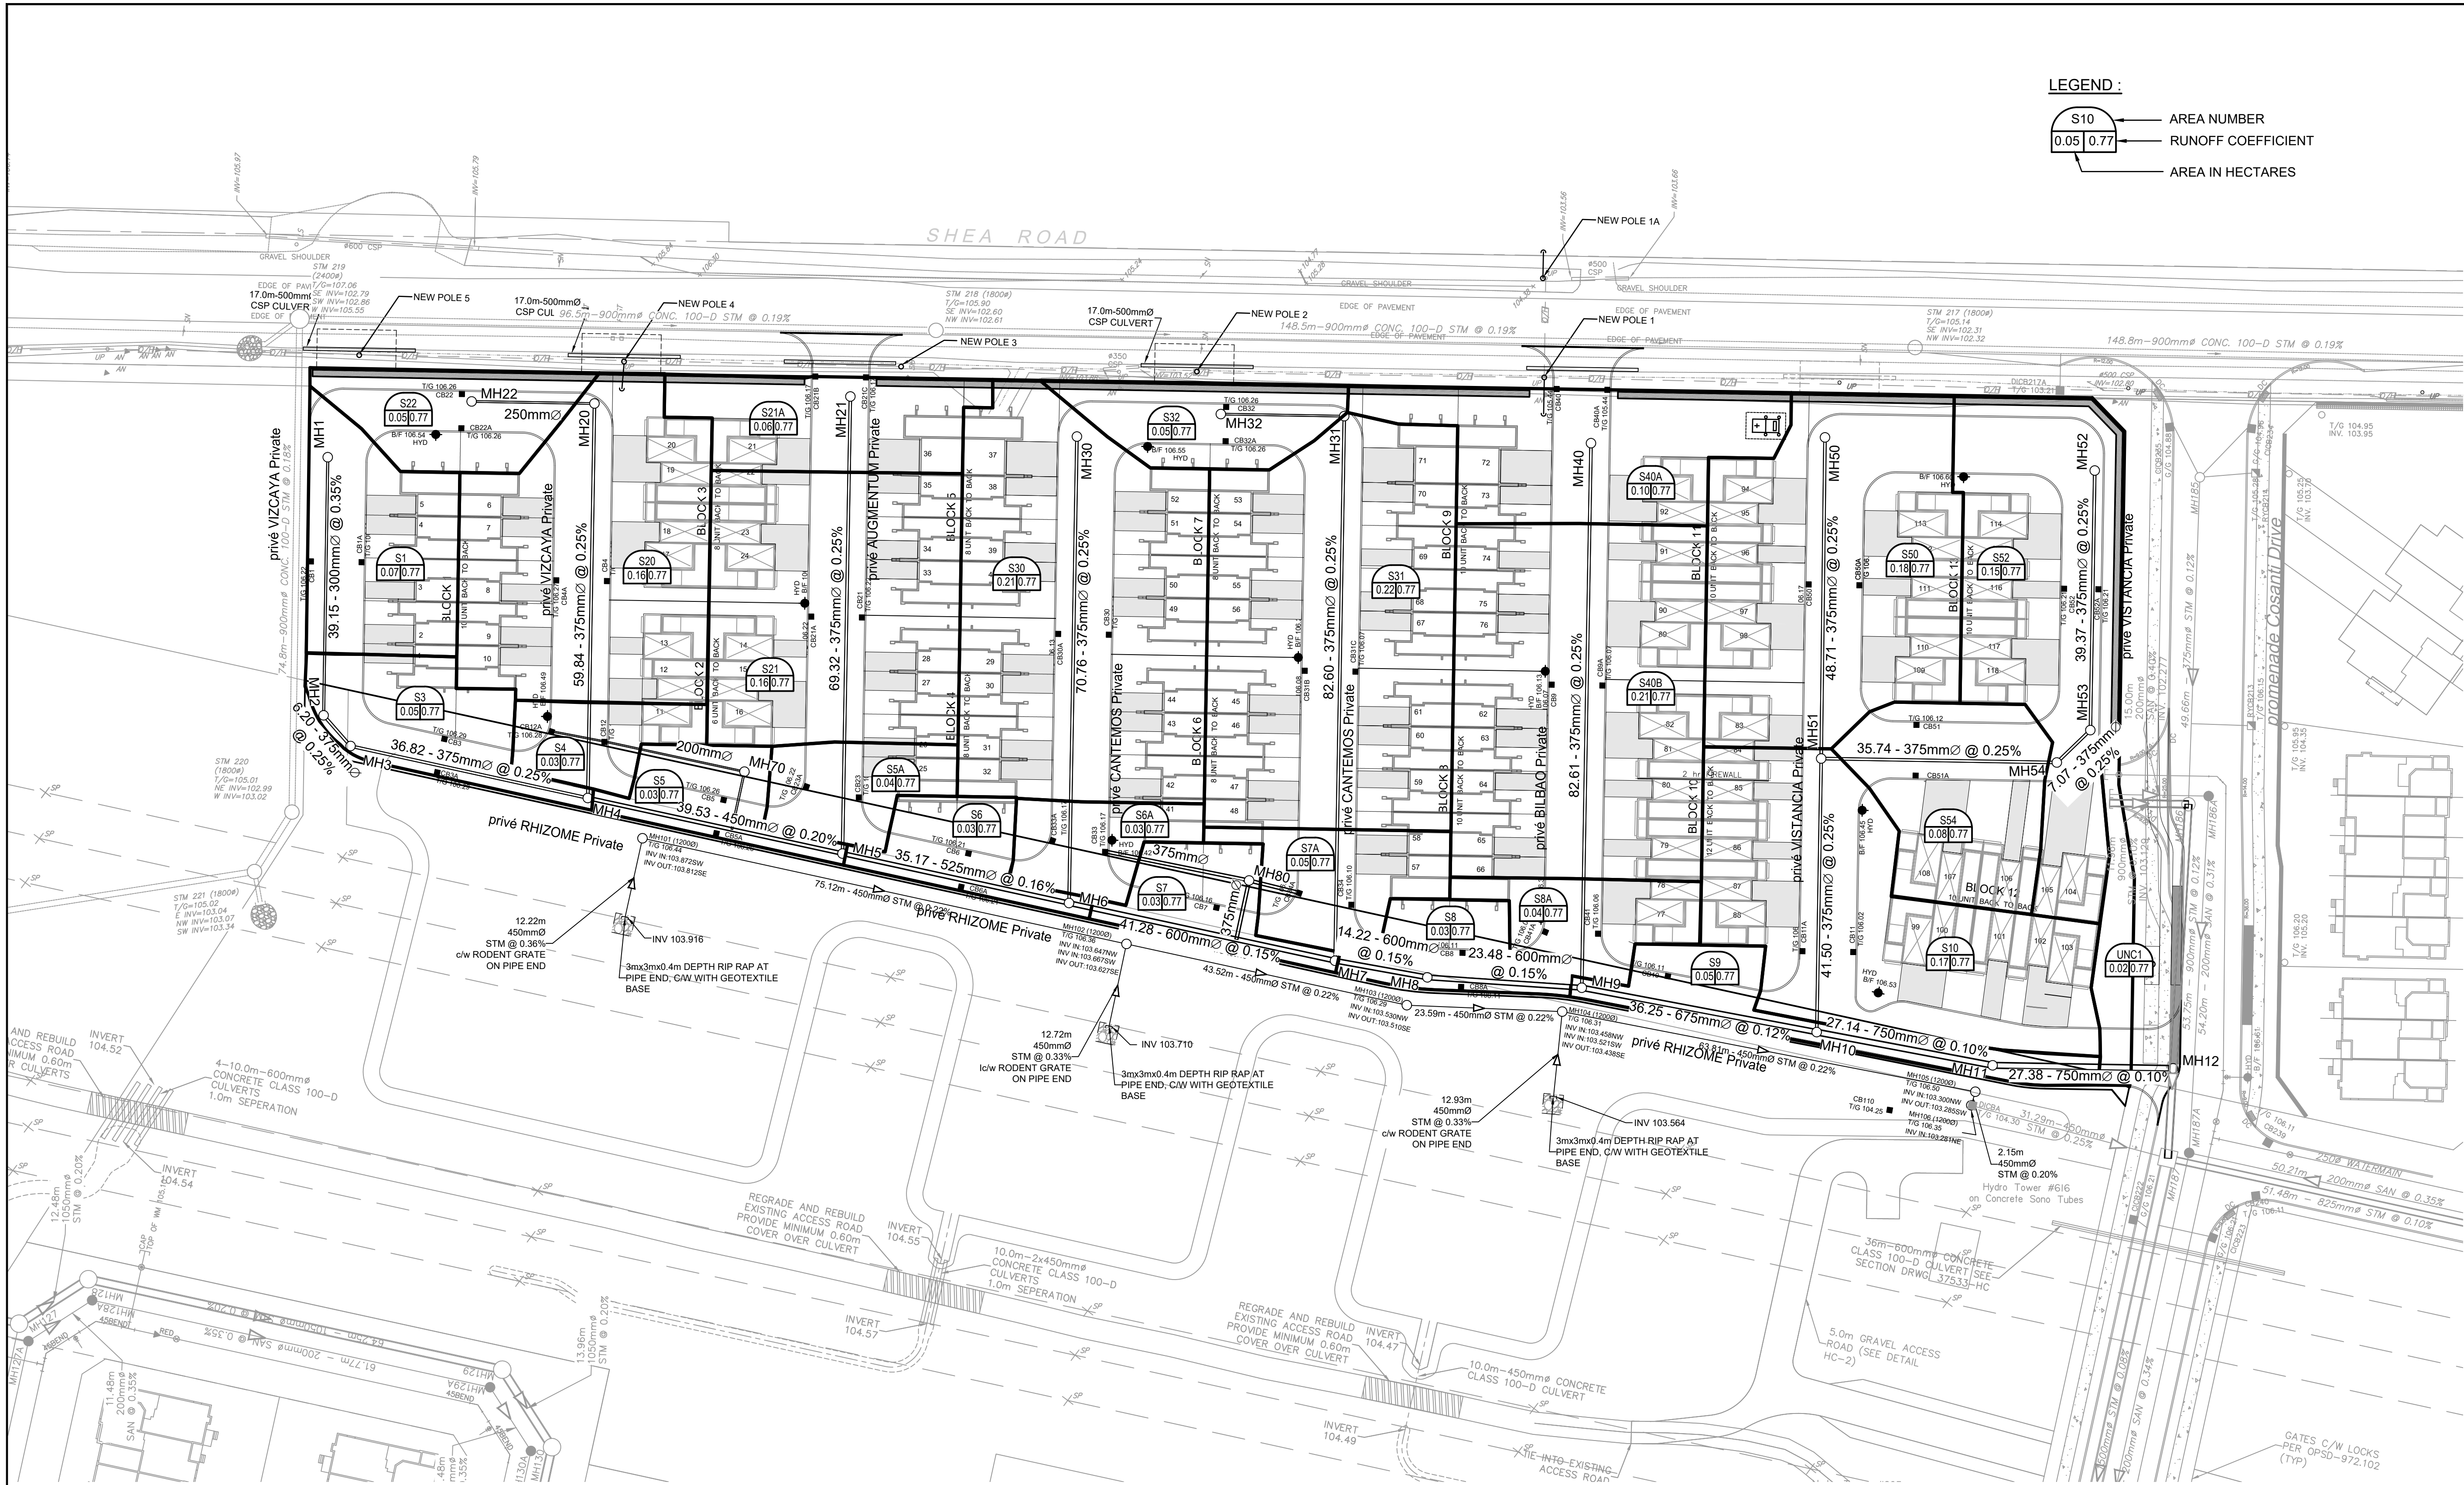

LEGEND:

- S10 → AREA NUMBER
- 0.05 0.77 → RUNOFF COEFFICIENT
- AREA IN HECTARES



CLIENT
DAVIDSON SHEA PROPERTY INC.


COPYRIGHT
This drawing has been prepared solely for the intended use. Any reproduction or distribution for any purpose other than authorized by IBI Group is forbidden. Written dimensions shall have precedence over scaled dimensions. Contractors shall verify and be responsible for all dimensions and conditions on the job, and IBI Group shall be informed of any variations from the dimensions and conditions shown on the drawing. Shop drawings shall be submitted to IBI Group for general conformance before proceeding with fabrication.

IBI Group Professional Services (Canada) Inc.
is a member of the IBI Group of companies

ISSUES

No.	DESCRIPTION	DATE
1	SUBMISSION NO. 1 FOR CITY REVIEW	2022-09-15
2	SUBMISSION NO. 2 FOR CITY REVIEW	2024-06-27
3	REVISED PER CITY COMMENTS	2025-03-21
4	REVISED PER NEW SITE PLAN	2025-05-12
5	SUBMISSION NO. 4 FOR CITY REVIEW	2024-07-31
6		
7		
8		

SEE 010, 011 FOR NOTES, LEGEND, CB TABLE, STREET SECTIONS AND DETAILS

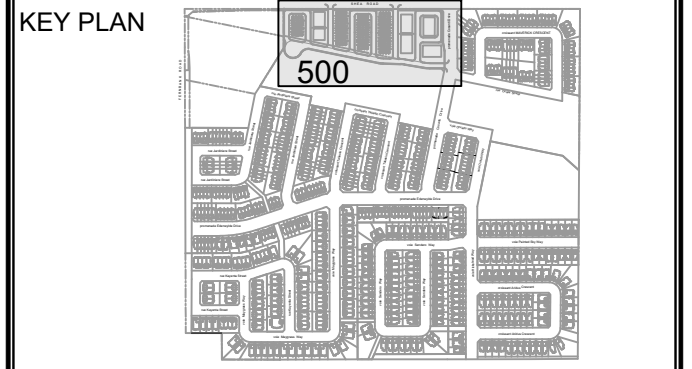

CONSULTANTS

SEAL

1:500 0 5 10 15 20 25m

IBI GROUP
400 - 333 Preston Street
Ottawa ON K1S 5M4 Canada
tel 613 225 1311 fax 613 225 5868
ibigroup.com

PROJECT
1650 SHEA ROAD
(OTTAWA, ON)

PROJECT NO:
139185



DRAWN BY: M.M. **CHECKED BY:** R.M./D.Y.

PROJECT MGR: R.M. **APPROVED BY:** R.M./D.Y.

SHEET TITLE
STORM DRAINAGE AREA PLAN

SHEET NUMBER 500 **ISSUE** 5

CITY FILE No. D07-12-23-0032
File Location: \\1139185_1650_Shea_Road\0_Production\07_03_Design\04_Civil\Shea\500-STORM DRAINAGE AREA PLAN.dwg Last Saved: July 25, 2025, 7:47:06 PM by Milne, Marlene
SCALE CHECK

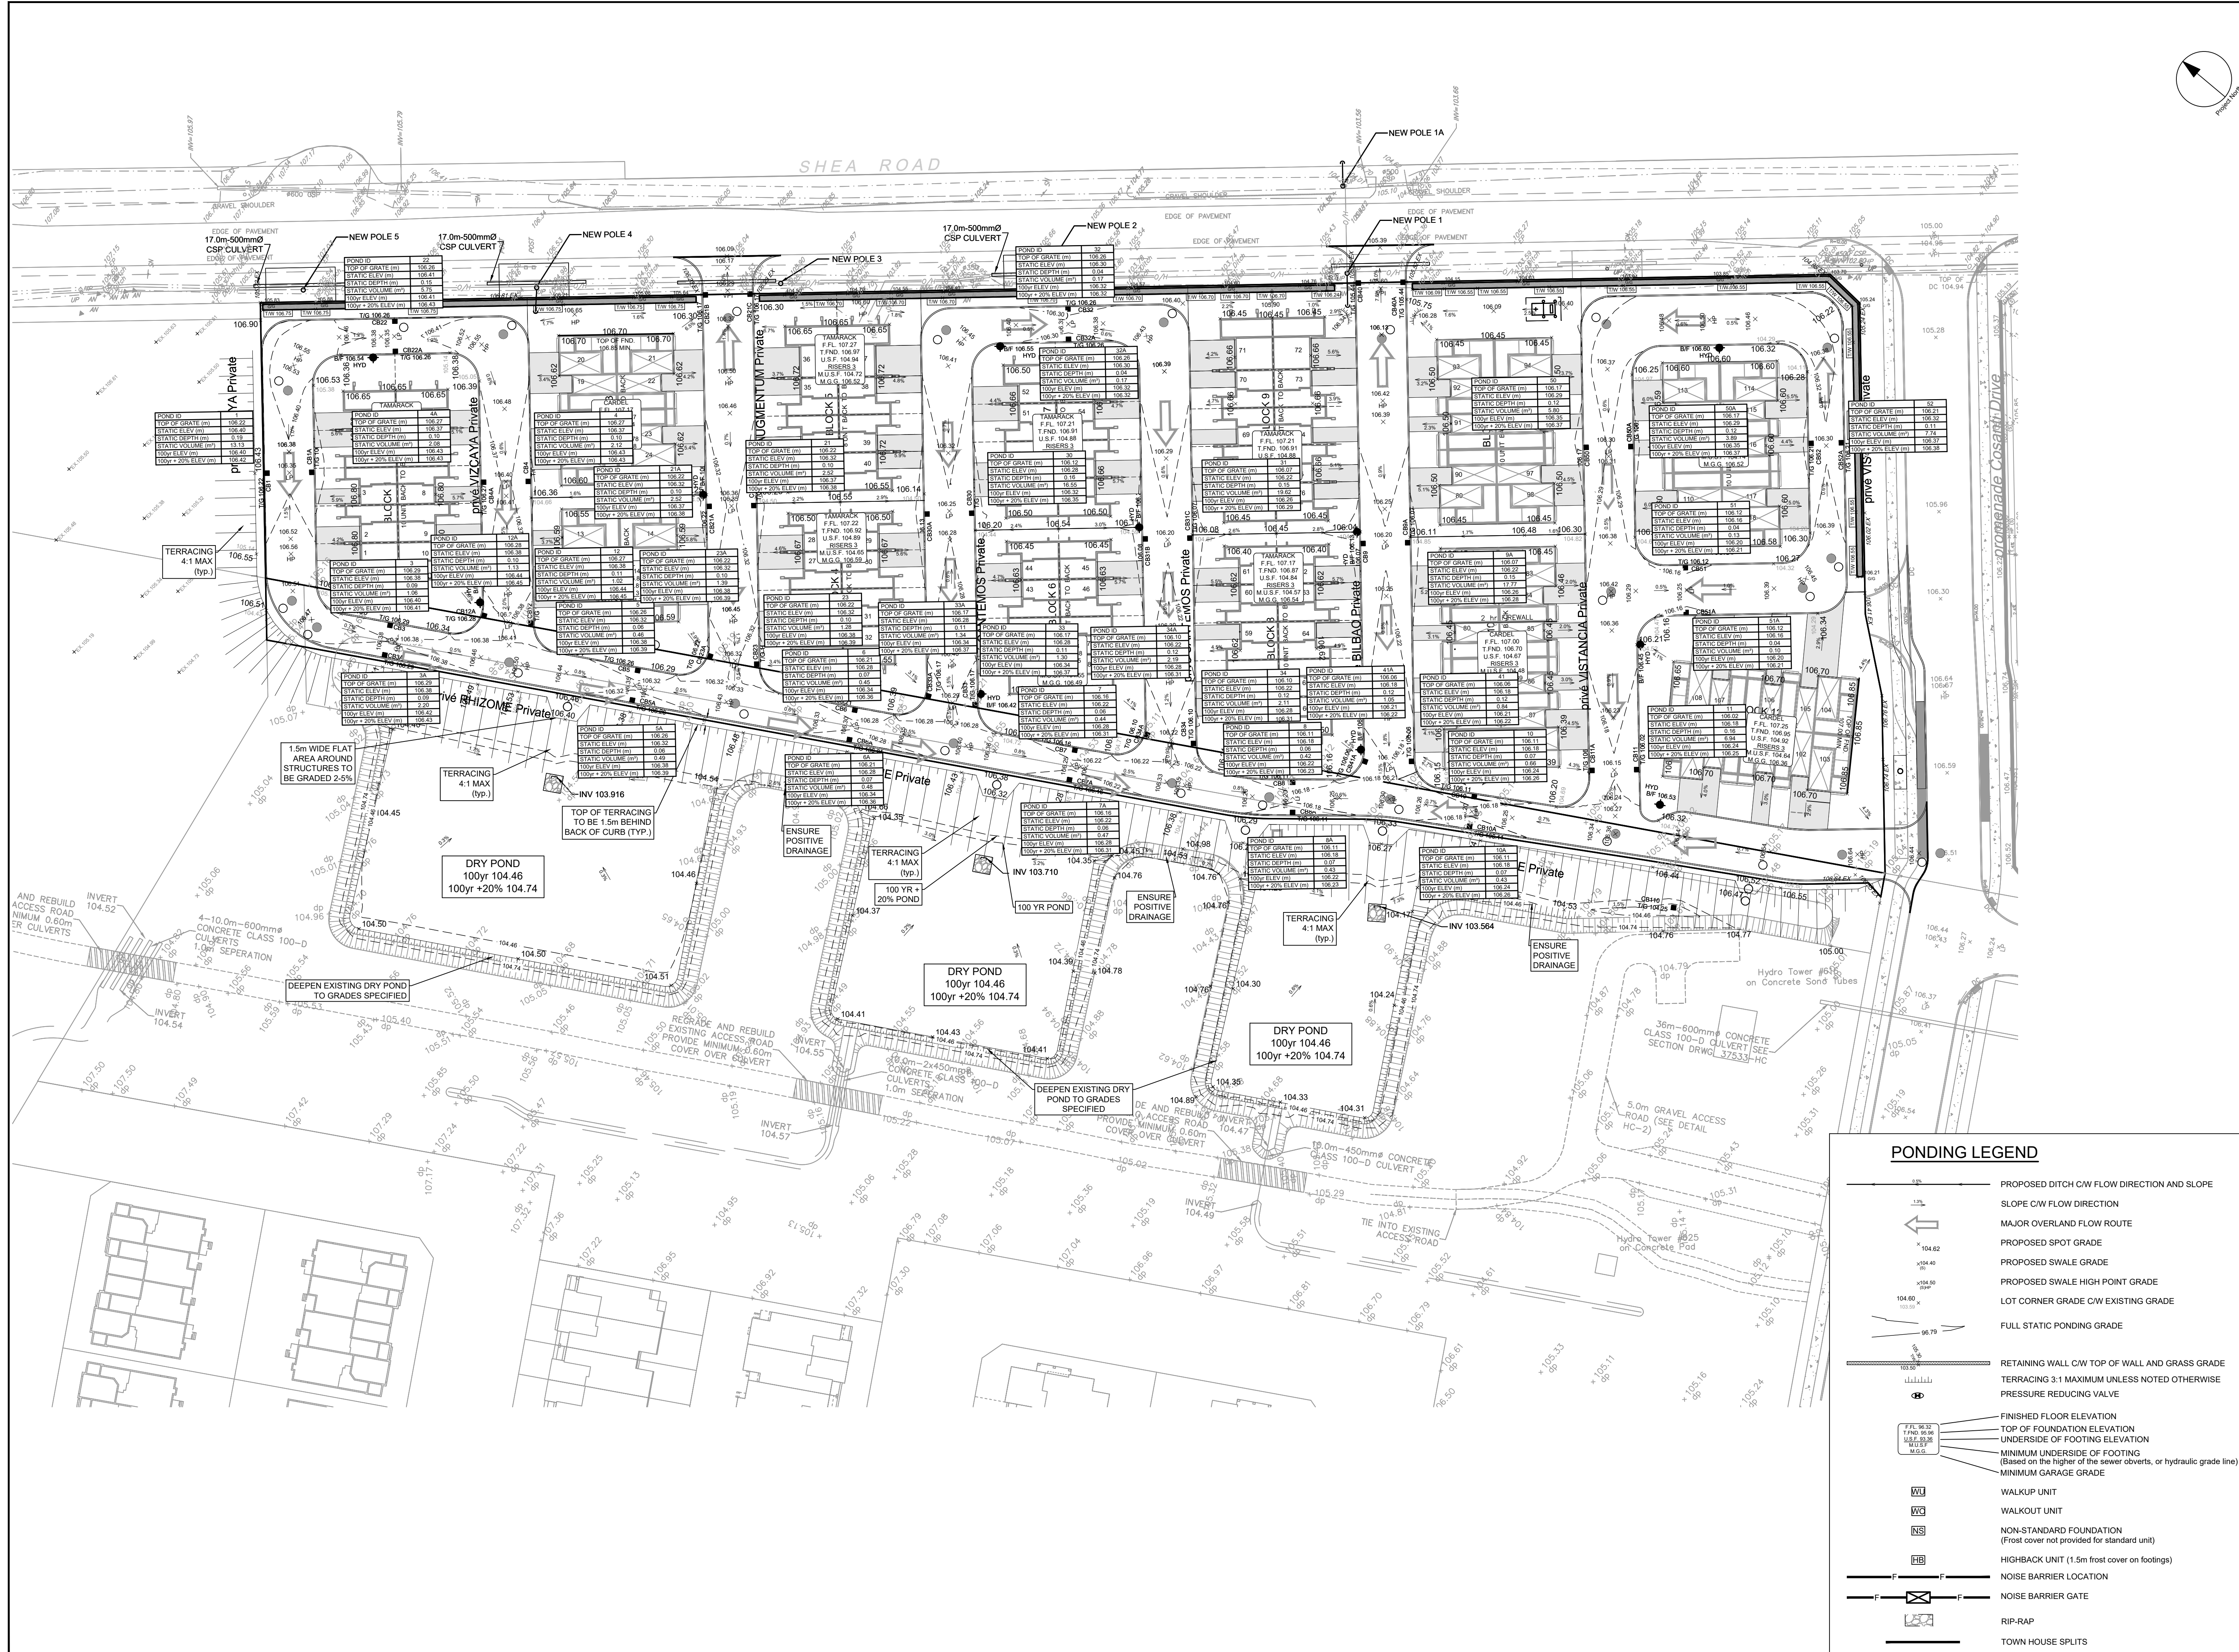


CLIENT
**DAVIDSON SHEA
 PROPERTY INC.**

COPYRIGHT
 This drawing has been prepared solely for the intended use, any reproduction or distribution for any purpose other than authorized by IBI Group is forbidden. Written dimensions shall have precedence over scaled dimensions. Contractors shall verify and be responsible for all dimensions and conditions on the job, and IBI Group shall be informed of any variations from the dimensions and conditions shown on the drawing. Shop drawings shall be submitted to IBI Group for general concurrence before proceeding with fabrication.


IBI Group Professional Services (Canada) Inc.
 a member of the IBI Group of companies

ISSUES	No.	DESCRIPTION	DATE
	1	SUBMISSION NO. 1 FOR CITY REVIEW	2022-09-15
	2	SUBMISSION NO. 2 FOR CITY REVIEW	2024-06-27
	3	REVISED PER CITY COMMENTS	2025-03-21
	4	REVISED PER NEW SITE PLAN	2025-05-12
	5	SUBMISSION NO. 4 FOR CITY REVIEW	2024-07-31
	6		
	7		
	8		

SEE 010, 011 FOR NOTES, LEGEND, CB TABLE, STREET SECTIONS AND DETAILS

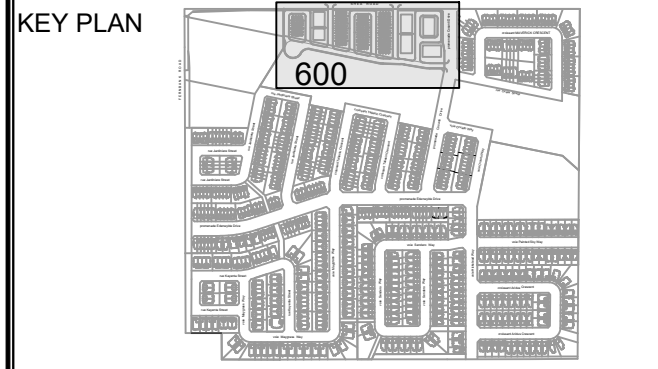

CONSULTANTS

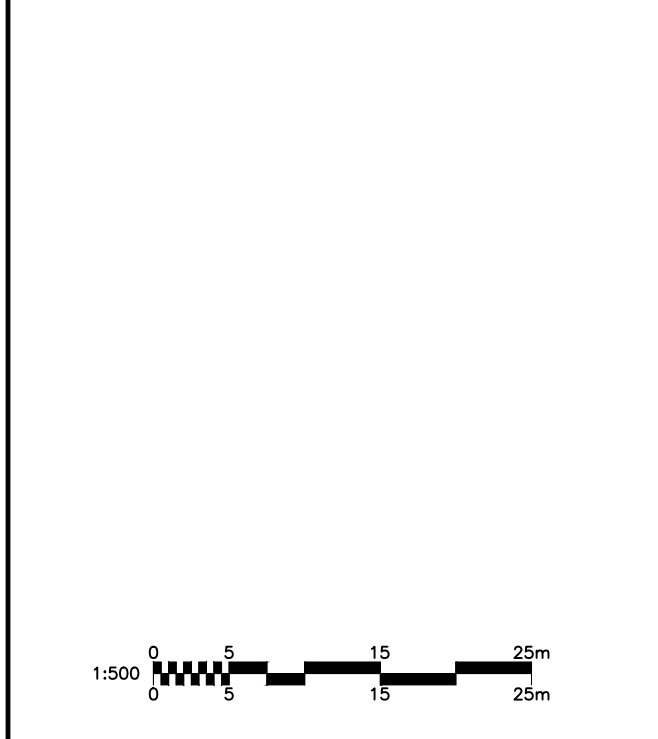

SEAL

PONDING LEGEND	
	PROPOSED DITCH C/W FLOW DIRECTION AND SLOPE
	SLOPE C/W FLOW DIRECTION
	MAJOR OVERLAND FLOW ROUTE
	PROPOSED SPOT GRADE
	PROPOSED SWALE HIGH POINT GRADE
	LOT CORNER GRADE C/W EXISTING GRADE
	FULL STATIC PONDING GRADE
	RETAINING WALL C/W TOP OF WALL AND GRASS GRADE
	TERRACING 3:1 MAXIMUM UNLESS NOTED OTHERWISE
	PRESSURE REDUCING VALVE
	FINISHED FLOOR ELEVATION
	TOP OF FOUNDATION ELEVATION
	UNDERSIDE OF FOOTING ELEVATION
	MINIMUM UNDERSIDE OF FOOTINGS (Based on the higher of the sewer obverts, or hydraulic grade line)
	MINIMUM GARAGE GRADE
	WALKUP UNIT
	WALKOUT UNIT
	NON-STANDARD FOUNDATION (Frost cover not provided for standard unit)
	HIGHBACK UNIT (1.5m frost cover on footings)
	NOISE BARRIER LOCATION
	NOISE BARRIER GATE
	RIP-RAP
	TOWN HOUSE SPLITS

IBI GROUP
 400 - 333 Preston Street
 Ottawa ON K1S 5M4 Canada
 tel 613 225 1311 fax 613 225 9868
 ibigroup.com

PROJECT
1650 SHEA ROAD
 (OTTAWA, ON)

PROJECT NO:
139185

DRAWN BY:
M.M.

PROJECT MGR:
R.M.

CHECKED BY:
R.M./D.Y.

APPROVED BY:
R.M./D.Y.

SHEET TITLE
PONDING PLAN

SHEET NUMBER
600

ISSUE
5

File Location: \\1139185_1650_Shea_Road\0_Production\0_Design\04_Civil\Shea600-PONDING PLAN.dwg
 Last Saved: July 31, 2025, by: mihandeb
 Printed: August 5, 2025 9:40:07 AM by: Mihne, Marjan
 SCALE CHECK

CITY FILE No. D07-12-23-0032
 CITY PLAN No. 19029



IBI GROUP
 400-333 Preston Street
 Ottawa, Ontario K1S 5N4 Canada
 tel 613 225 1311 fax 613 225 9868
 ibigroup.com

STORM SEWER DESIGN SHEET

Davidson Lands
 City of Ottawa
 Name of Client/Developer

STREET	LOCATION		SINGLE FAM								TOWN/SEMI								RATIONAL DESIGN FLOW										SEWER DATA					
	AREA ID	FROM	TO	C=0.20	C=0.30	C=0.49	C=0.70	C=0.52	C=0.68	C=0.76	C=0.90	IND 2.78AC	CUM 2.78AC	INLET (min)	TIME IN PIPE	TOTAL (min)	i (5) (mm/hr)	i (10) (mm/hr)	i (100) (mm/hr)	5yr PEAK FLOW (L/s)	10yr PEAK FLOW (L/s)	100yr PEAK FLOW (L/s)	FIXED FLOW (L/s)	DESIGN FLOW (L/s)	CAPACITY (L/s)	LENGTH (m)	PIPE SIZE (mm)			SLOPE (%)	VELOCITY (m/s)	AVAIL CAP (5yr) (L/s) (%)		
PHASE 2																																		
Kayenta Street	S142	MH142	MH143				0.39					0.76	0.76	10.00	0.68	10.68	104.19	122.14	178.56	79.08					79.08	142.67	80.20	300			2.00	1.955	63.59	44.57%
Maygrass Way	R146, S146	MH146	MH143			0.19		0.09				0.43	0.43	10.00	0.29	10.29	104.19	122.14	178.56	44.69					44.69	116.06	39.45	250			3.50	2.291	71.37	61.49%
Maygrass Way	S143	MH143	MH144					0.30				0.57	1.76	10.68	0.38	11.06	100.72	118.05	172.54	176.76					176.76	322.05	63.95	375			3.10	2.825	145.29	45.11%
Kayenta Street		MH139	MH140									0.00	0.00	10.00	0.32	10.32	104.19	122.14	178.56	0.00					0.00	107.45	40.72	250			3.00	2.121	107.45	100.00%
		MH140	MH141									0.00	0.00	10.32	0.09	10.41	102.53	120.19	175.69	0.00					0.00	94.09	9.77	250			2.30	1.857	94.09	100.00%
	R141, S141A&B	MH141	MH144					0.15	0.36			0.90	0.90	10.41	0.62	11.03	102.09	119.66	174.92	91.61					91.61	152.99	78.31	300			2.30	2.097	61.38	40.12%
Kayenta Street		MH144	MH145									0.00	2.65	11.06	0.13	11.19	98.90	115.91	169.41	262.33					262.33	409.98	19.87	450			1.90	2.497	147.65	36.01%
PHASE 1																																		
Kayenta Street	R145	MH145	MH155					0.27				0.39	3.04	11.19	0.34	11.54	98.28	115.18	168.34	299.05					299.05	409.98	51.61	450			1.90	2.497	110.93	27.06%
Kayenta Street	S148B	MH159	MH153			0.08						0.16	0.16	10.00	0.36	10.36	104.19	122.14	178.56	16.22					16.22	94.09	40.00	250			2.30	1.857	77.87	82.76%
	S153	MH153	MH154					0.25				0.47	0.63	10.36	0.62	10.98	102.33	119.95	175.34	64.29					64.29	94.09	69.45	250			2.30	1.857	29.79	31.66%
	S154	MH154	MH155					0.22				0.42	1.04	10.98	0.09	11.07	99.28	116.35	170.05	103.66					103.66	289.21	13.93	375			2.50	2.537	185.55	64.16%
Block 159	S155	MH155	MH156			0.38						0.74	4.83	11.54	0.22	11.76	96.72	113.34	165.62	466.78					466.78	847.38	38.64	600			1.75	2.903	380.60	44.91%
	R156A&B	MH156	MH103			0.12		0.21				0.47	5.29	11.76	0.23	11.99	95.73	112.18	163.93	506.76					506.76	847.38	39.60	600			1.75	2.903	340.62	40.20%
Edenwyde Drive	S100	MH100	MH101							0.24		0.45	0.45	10.00	0.75	10.75	104.19	122.14	178.56	47.27					47.27	78.47	69.61	250			1.60	1.549	31.20	39.78%
	R101	MH101	MH102					0.34				0.49	0.95	10.75	0.37	11.12	100.40	117.67	171.99	94.89					94.89	153.03	30.09	375			0.70	1.342	58.14	37.99%
	S102	MH102	MH103					0.37				0.70	1.64	11.12	0.33	11.46	98.61	115.57	168.91	162.19					162.19	258.68	45.33	375			2.00	2.269	96.49	37.30%
Edenwyde Drive	S103	MH103	MH104					0.15				0.28	7.22	11.99	0.27	12.26	94.75	111.02	162.23	684.25					684.25	899.63	32.00	750			0.60	1.973	215.37	23.94%
Jardinere Street		MH122	MH120									0.00	0.00	10.00	0.65	10.65	104.19	122.14	178.56	0.00					0.00	51.91	40.20	250			0.70	1.024	51.91	100.00%
		MH120	MH121									0.00	0.00	10.65	0.16	10.81	100.86	118.22	172.79	0.00					0.00	51.91	9.80	250			0.70	1.024	51.91	100.00%
	R121, S121A&B	MH121	MH126					0.10	0.42			0.94	0.94	10.81	1.07	11.89	100.08	117.30	171.45	93.93					93.93	153.03	86.32	375			0.70	1.342	59.10	38.62%
Jardinere Street	S123	MH123	MH124					0.17				0.32	0.32	10.00	0.94	10.94	104.19	122.14	178.56	33.48					33.48	58.86	65.17	250			0.90	1.162	25.37	43.11%
	R124	MH124	MH125					0.51				0.74	1.06	10.94	0.18	11.12	99.50	116.61	170.44	105.33					105.33	188.11	12.67	450			0.40	1.146	82.78	44.01%
	R125, S125	MH125	MH126					0.29	0.40			1.18	2.23	11.12	0.74	11.86	98.63	115.59	168.94	220.34					220.34	286.47	43.82	600			0.20	0.982	66.13	23.08%
Jardinere Street	R126, S126	MH126	MH127					0.14	0.32			0.81	3.98	11.89	1.45	13.34	95.19	111.54	162.98	378.83					378.83	517.55	98.97	750			0.20	1.135	138.71	26.80%
External Commercial	135	MH135	MH127							2.73		6.83	6.83	10.00	0.09	10.09	104.19	122.14	178.56	711.69					711.69	944.10	8.00	900			0.25	1.438	232.42	24.62%
Jardinere Street	R128, S128	MH127	MH128									0.00	10.81	13.34	0.15	13.48	89.34	104.65	152.88	965.78					965.78	1,273.98	12.48	1050			0.20	1.425	308.20	24.19%
		MH128	MH129					0.14	0.34			0.85	11.66	13.48	0.75	14.24	88.80	104.01	151.94	1,034.95					1,034.95	1,273.97	64.25	1050			0.20	1.425	239.02	18.76%
		MH129	MH130									0.00	11.66	14.24	0.16	14.40	86.11	100.85	147.30	1,003.64					1,003.64	1,273.93	13.96	1050			0.20	1.425	270.29	21.22%
	R130A&B, S130	MH130	MH131					0.31	0.35			1.11	12.77	14.40	1.07	15.47	85.55	100.20	146.33	1,092.05					1,092.05	1,274.01	91.57	1050			0.20	1.425	181.95	14.28%
	R131	MH131	MH132					0.18				0.26	13.03	15.47	1.09	16.56	82.07	96.10	140.33	1,068.98					1,068.98	1,286.16	72.00	1200			0.10	1.102	217.18	16.89%
	S132	MH132	MH104					0.37				0.70	13.72	16.56	0.46	17.02	78.84	92.30	134.75	1,082.01					1,082.01	1,286.26	30.31	1200			0.10	1.102	204.25	15.88%
Edenwyde Drive	R104, S104	MH104	MH105			0.18		0.25				0.72	21.66	17.02	0.76	17.77	77.56	90.80	132.54	1,680.24					1,680.24	2,332.02	57.99	1500			0.10	1.278	651.78	27.95%
		MH105	MH106									0.00	21.66	17.77	0.25	18.03	75.55	88.44	129.08	1,636.71					1,636.71	2,332.02	19.55	1500			0.10	1.278	695.31	29.82%
PHASE 2																																		
Maygrass Way	R147	MH147	CAP			0.07						0.10	0.10	10.00	0.52	10.52	104.19	122.14	178.56	9.94					9.94	103.80	63.75	250			2.80	2.049	93.87	90.43%
PHASE 1																																		
Maygrass Way		CAP	MH148									0.00	0.10	10.52	0.10	10.62	101.53	119.01	173.95	9.68					9.68	103.80	12.00	250			2.80	2.049	94.12	90.67%
	R148, S148A	MH148	MH149			0.20	0.18					0.62	0.72	10.62	0.64	11.26	101.05	118.44	173.11	72.56					72.56	92.02	69.76	250			2.20	1.816	19.46	21.15%
		MH149	MH150									0.00	0.72	11.26	0.11	11.36	97.99	114.84	167.83	70.37					70.37	92.02	11.69	250			2.20	1.816	21.65	23.53%
	R150, S150	MH150	MH151				0.31	0.32				1.05	1.76	11.36	0.58	11.94	97.50	114.26	166.98	171.90					171.90	224.02	67.97	375			1.50	1.965	52.12	23.26%
	R151A&B, S151	MH151	MH152				0.65	0.32				1.51	3.27	11.94	0.46	12.40	94.95	111.26	162.58	310.61					310.61	549.49	68.52	525			1.50	2.459	238.88	43.47%
	R152, S152A&B	MH152	MH106				0.25	0.72				1.74	5.01	12.40	0.63	13.04	93.00	108.96	159.21	466.21					466.21	701.70	91.12	600			1.20	2.404	235.49	33.56%
PHASE 2																																		
Taliesin Crescent	S200	MH200	MH201			0.47						0.91	0.91	10.00	1.07	11.07	104.19	122.14	178.56	95.30					95.30	162.91	63.65	450			0.30	0.992	67.61	41.50%
		MH201	MH202									0.00	0.91	11.07	1.00	12.07	98.87	115.87	169.34	90.42					90.42	162.91	59.							




IBI GROUP
 400-333 Preston Street
 Ottawa, Ontario K1S 5N4 Canada
 tel 613 225 1311 fax 613 225 9868
 ibigroup.com

STORM SEWER DESIGN SHEET

Davidson Lands
 City of Ottawa
 Name of Client/Developer

STREET	LOCATION		SINGLE FAM								TOWN/SEMI								RATIONAL DESIGN FLOW										SEWER DATA							
	AREA ID	FROM	TO	C=0.20	C=0.30	C=0.49	C=0.70	C=0.52	C=0.68	C=0.76	C=0.90	IND 2.78AC	CUM 2.78AC	INLET (min)	TIME IN PIPE	TOTAL (min)	i (5) (mm/hr)	i (10) (mm/hr)	i (100) (mm/hr)	5yr PEAK FLOW (L/s)	10yr PEAK FLOW (L/s)	100yr PEAK FLOW (L/s)	FIXED FLOW (L/s)	DESIGN FLOW (L/s)	CAPACITY (L/s)	LENGTH (m)	PIPE SIZE (mm)			SLOPE (%)	VELOCITY (m/s)	AVAIL CAP (5yr)				
																											DIA	W	H			(L/s)	(%)			
PHASE 2																																				
Crosanti Drive	S185, R185A&B	MH185	MH186			0.27	0.16					0.68	0.68	10.00	1.25	11.25	104.19	122.14	178.56	70.76				70.76	91.46	60.00	375				0.25	0.802	20.69	22.63%		
Block 170	320	MH320	MH186							2.08		4.39	4.39	12.00	0.17	12.17	94.70	110.96	162.13	416.15				416.15	597.22	9.02	900				0.10	0.909	181.07	30.32%		
Crosanti Drive	S186	MH186	MH187			0.09						0.18	5.25	12.17	0.81	12.97	94.00	110.13	160.92	493.38				493.38	586.99	43.41	900				0.10	0.894	93.61	15.95%		
Maverick Crescent	S301, R301A&B	MH300	MH301			0.54	0.41					0.00	0.00	10.00	0.24	10.24	104.19	122.14	178.56	0.00			0.00	59.68	11.71	300				0.35	0.818	59.68	100.00%			
	S303, R303	MH302	MH303									1.53	1.53	10.24	2.34	12.57	102.95	120.68	176.41	157.87			157.87	248.09	119.14	600				0.15	0.850	90.22	36.37%			
		MH303	MH304			0.33	0.33					0.00	1.53	12.57	0.23	12.80	92.31	108.15	158.01	141.55			141.55	248.09	11.72	600				0.15	0.850	106.53	42.94%			
		MH304	MH305									1.09	2.63	12.80	1.28	14.08	91.39	107.07	156.43	239.92			239.92	367.27	61.81	750				0.10	0.805	127.35	34.67%			
												0.00	2.63	14.08	0.33	14.41	86.64	101.48	148.22	227.44			227.44	367.27	16.00	750				0.10	0.805	139.83	38.07%			
Maverick Crescent	R300, S300 A&B	MH300	MH306			0.22	0.55					1.37	1.37	10.00	1.97	11.97	104.19	122.14	178.56	142.74			142.74	179.46	94.71	525				0.16	0.803	36.72	20.46%			
	S306	MH306	MH307				0.04					0.08	1.45	11.97	0.28	12.24	94.84	111.13	162.39	137.32			137.32	239.68	13.56	600				0.14	0.821	102.36	42.71%			
Ocala Street	S308	MH307	MH308									0.00	1.45	12.24	1.42	13.66	93.68	109.76	160.38	135.63			135.63	239.68	70.00	600				0.14	0.821	104.04	43.41%			
		MH308	MH305			0.29						0.56	2.01	13.66	1.24	14.90	88.15	103.25	150.82	177.37			177.37	239.68	60.94	600				0.14	0.821	62.31	26.00%			
Ocala Street	S305	MH305	MH187			0.08						0.16	4.79	14.41	1.00	15.42	85.50	100.13	146.24	409.79			409.79	473.55	51.58	825				0.10	0.858	63.76	13.46%			
Dry pond	187	DICB A	MH187			2.86						1.59	1.59	25.00	0.33	25.33	60.90	71.22	103.85	96.83			96.83	148.72	18.06	450				0.25	0.906	51.88	34.89%			
Crosanti Drive	S187A&B	MH187	MH188			0.24						0.47	12.10	15.42	1.12	16.54	82.24	96.30	140.61	994.98			994.98	2,352.00	86.75	1500				0.10	1.289	1357.02	57.70%			
	R188A&B, S188A&B	MH188	MH189			0.61	0.39					1.59	13.69	16.54	1.37	17.91	78.90	92.37	134.85	1,080.03			1,080.03	2,332.02	105.44	1500				0.10	1.278	1252.00	53.69%			
		MH189	CAP									0.00	13.69	17.91	0.10	18.01	75.19	88.02	128.47	1,029.32			1,029.32	2,332.02	7.64	1500				0.10	1.278	1302.70	55.86%			
	S189	CAP	MH108			0.23						0.45	14.14	17.91	0.25	18.16	75.19	88.02	128.47	1,062.98			1,062.98	2,332.02	19.00	1500				0.10	1.278	1269.05	54.42%			
PHASE 1																																				
Edenwyde Drive	R108A&B, S108	MH108	MH109			0.31	0.28					0.97	46.40	19.92	0.94	20.86	70.42	82.41	120.25	3,267.80			3,267.80	3,792.06	81.41	1800				0.10	1.444	524.26	13.83%			
Park Block 163	P109	MH195	MH109			1.99						1.66	1.66	10.00	0.15	10.15	104.19	122.14	178.56	172.93			172.93	283.76	11.11	525				0.40	1.270	110.83	39.06%			
PHASE 2																																				
Orvieto Way	S211A&B	MH211	CAP 109E			0.42						0.82	0.82	10.00	1.04	11.04	104.19	122.14	178.56	85.16			85.16	230.39	87.90	450				0.60	1.403	145.23	63.04%			
		CAP 109E	MH109									0.00	0.82	11.04	0.20	11.25	98.98	116.01	169.55	80.90			80.90	230.39	17.00	450				0.60	1.403	149.49	64.89%			
PHASE 1																																				
Hickstead Way	S109	MH109	MH110			0.22						0.43	49.31	20.86	0.77	21.63	68.41	80.05	116.79	3,373.35			3,373.35	4,694.35	70.05	1950				0.10	1.523	1321.00	28.14%			
PHASE 2																																				
Sendero Way	S221	MH220	MH221			0.44						0.00	0.00	10.00	0.88	10.88	104.19	122.14	178.56	0.00			0.00	55.49	58.00	250				0.80	1.095	55.49	100.00%			
		MH221	MH222									0.86	0.86	10.88	0.94	11.83	99.75	116.91	170.87	85.41			85.41	230.39	79.46	450				0.60	1.403	144.98	62.93%			
		MH222	MH223									0.00	0.86	11.83	0.17	12.00	95.44	111.84	163.43	81.72			81.72	188.11	11.70	450				0.40	1.146	108.39	56.56%			
	R223, S223	MH223	MH224			0.11	0.52					1.16	2.02	12.00	0.90	12.90	94.71	110.97	162.16	191.13			191.13	300.97	72.71	525				0.45	1.347	109.84	36.50%			
Sendero Way	S231	MH231	MH232			0.27						0.53	0.53	10.00	0.74	10.74	104.19	122.14	178.56	54.75			54.75	100.88	61.77	300				1.00	1.383	46.14	45.73%			
		MH232	MH233									0.00	0.53	10.74	0.14	10.88	100.42	117.69	172.03	52.76			52.76	100.88	11.58	300				1.00	1.383	48.12	47.70%			
	R233, S233	MH233	MH234			0.27	0.38					1.11	1.63	10.88	0.92	11.81	99.74	116.90	170.86	162.85			162.85	245.74	60.84	525				0.30	1.100	82.89	33.73%			
	S234	MH234	MH224			0.36						0.70	2.33	11.81	1.16	12.97	95.53	111.94	163.58	222.90			222.90	265.43	82.96	525				0.35	1.188	42.53	16.02%			
Sendero Way	R225	MH224	CAP 225N									0.00	4.35	12.97	0.35	13.32	90.74	106.31	155.31	394.85			394.85	496.18	35.50	600				0.60	1.700	101.32	20.42%			
	S226	CAP 225N	MH225			0.03						0.04	4.39	13.32	0.01	13.33	89.42	104.74	153.01	392.72			392.72	496.18	1.50	600				0.60	1.700	103.45	20.85%			
		MH225	MH226			0.24						0.47	4.86	13.33	0.20	13.54	89.36	104.68	152.91	434.22			434.22	496.18	20.78	600				0.60	1.700	61.96	12.49%			
		MH226	MH110									0.00	4.86	13.54	0.24	13.78	88.60	103.79	151.61	430.54			430.54	496.18	24.50	600				0.60	1.700	65.64	13.23%			
Painted Sky Way	R215, S215	MH215	MH216			0.13	0.62					1.38	1.38	10.00	1.05	11.05	104.19	122.14	178.56	144.16			144.16	210.32	80.40	450				0.50	1.281	66.16	31.45%			
	R216, S216	MH216	CAP 110E			0.14	0.32					0.81	2.20	11.05	1.14	12.19	98.97	116.00	169.53	217.45			217.45	283.76	87.18	525				0.40	1.270	66.30	23.37%			
		CAP 110E	MH110									0.00	2.20	12.19	0.16	12.35	93.89	110.01	160.74	206.28			206.28													

J:\37533-DavidsonLands\3.9 Drawings\59616\Layouts\501 STORM DRAINAGE PLAN.dwg Layout Name: 501 STORM DRAINAGE PLAN Plot Size: AIA STANDARD-HALF CTB Plot Scale: 1:50.8 Plotted At: 6/9/2020 10:37 AM Last Saved By: DSURNA Last Saved At: Jun. 8, 20

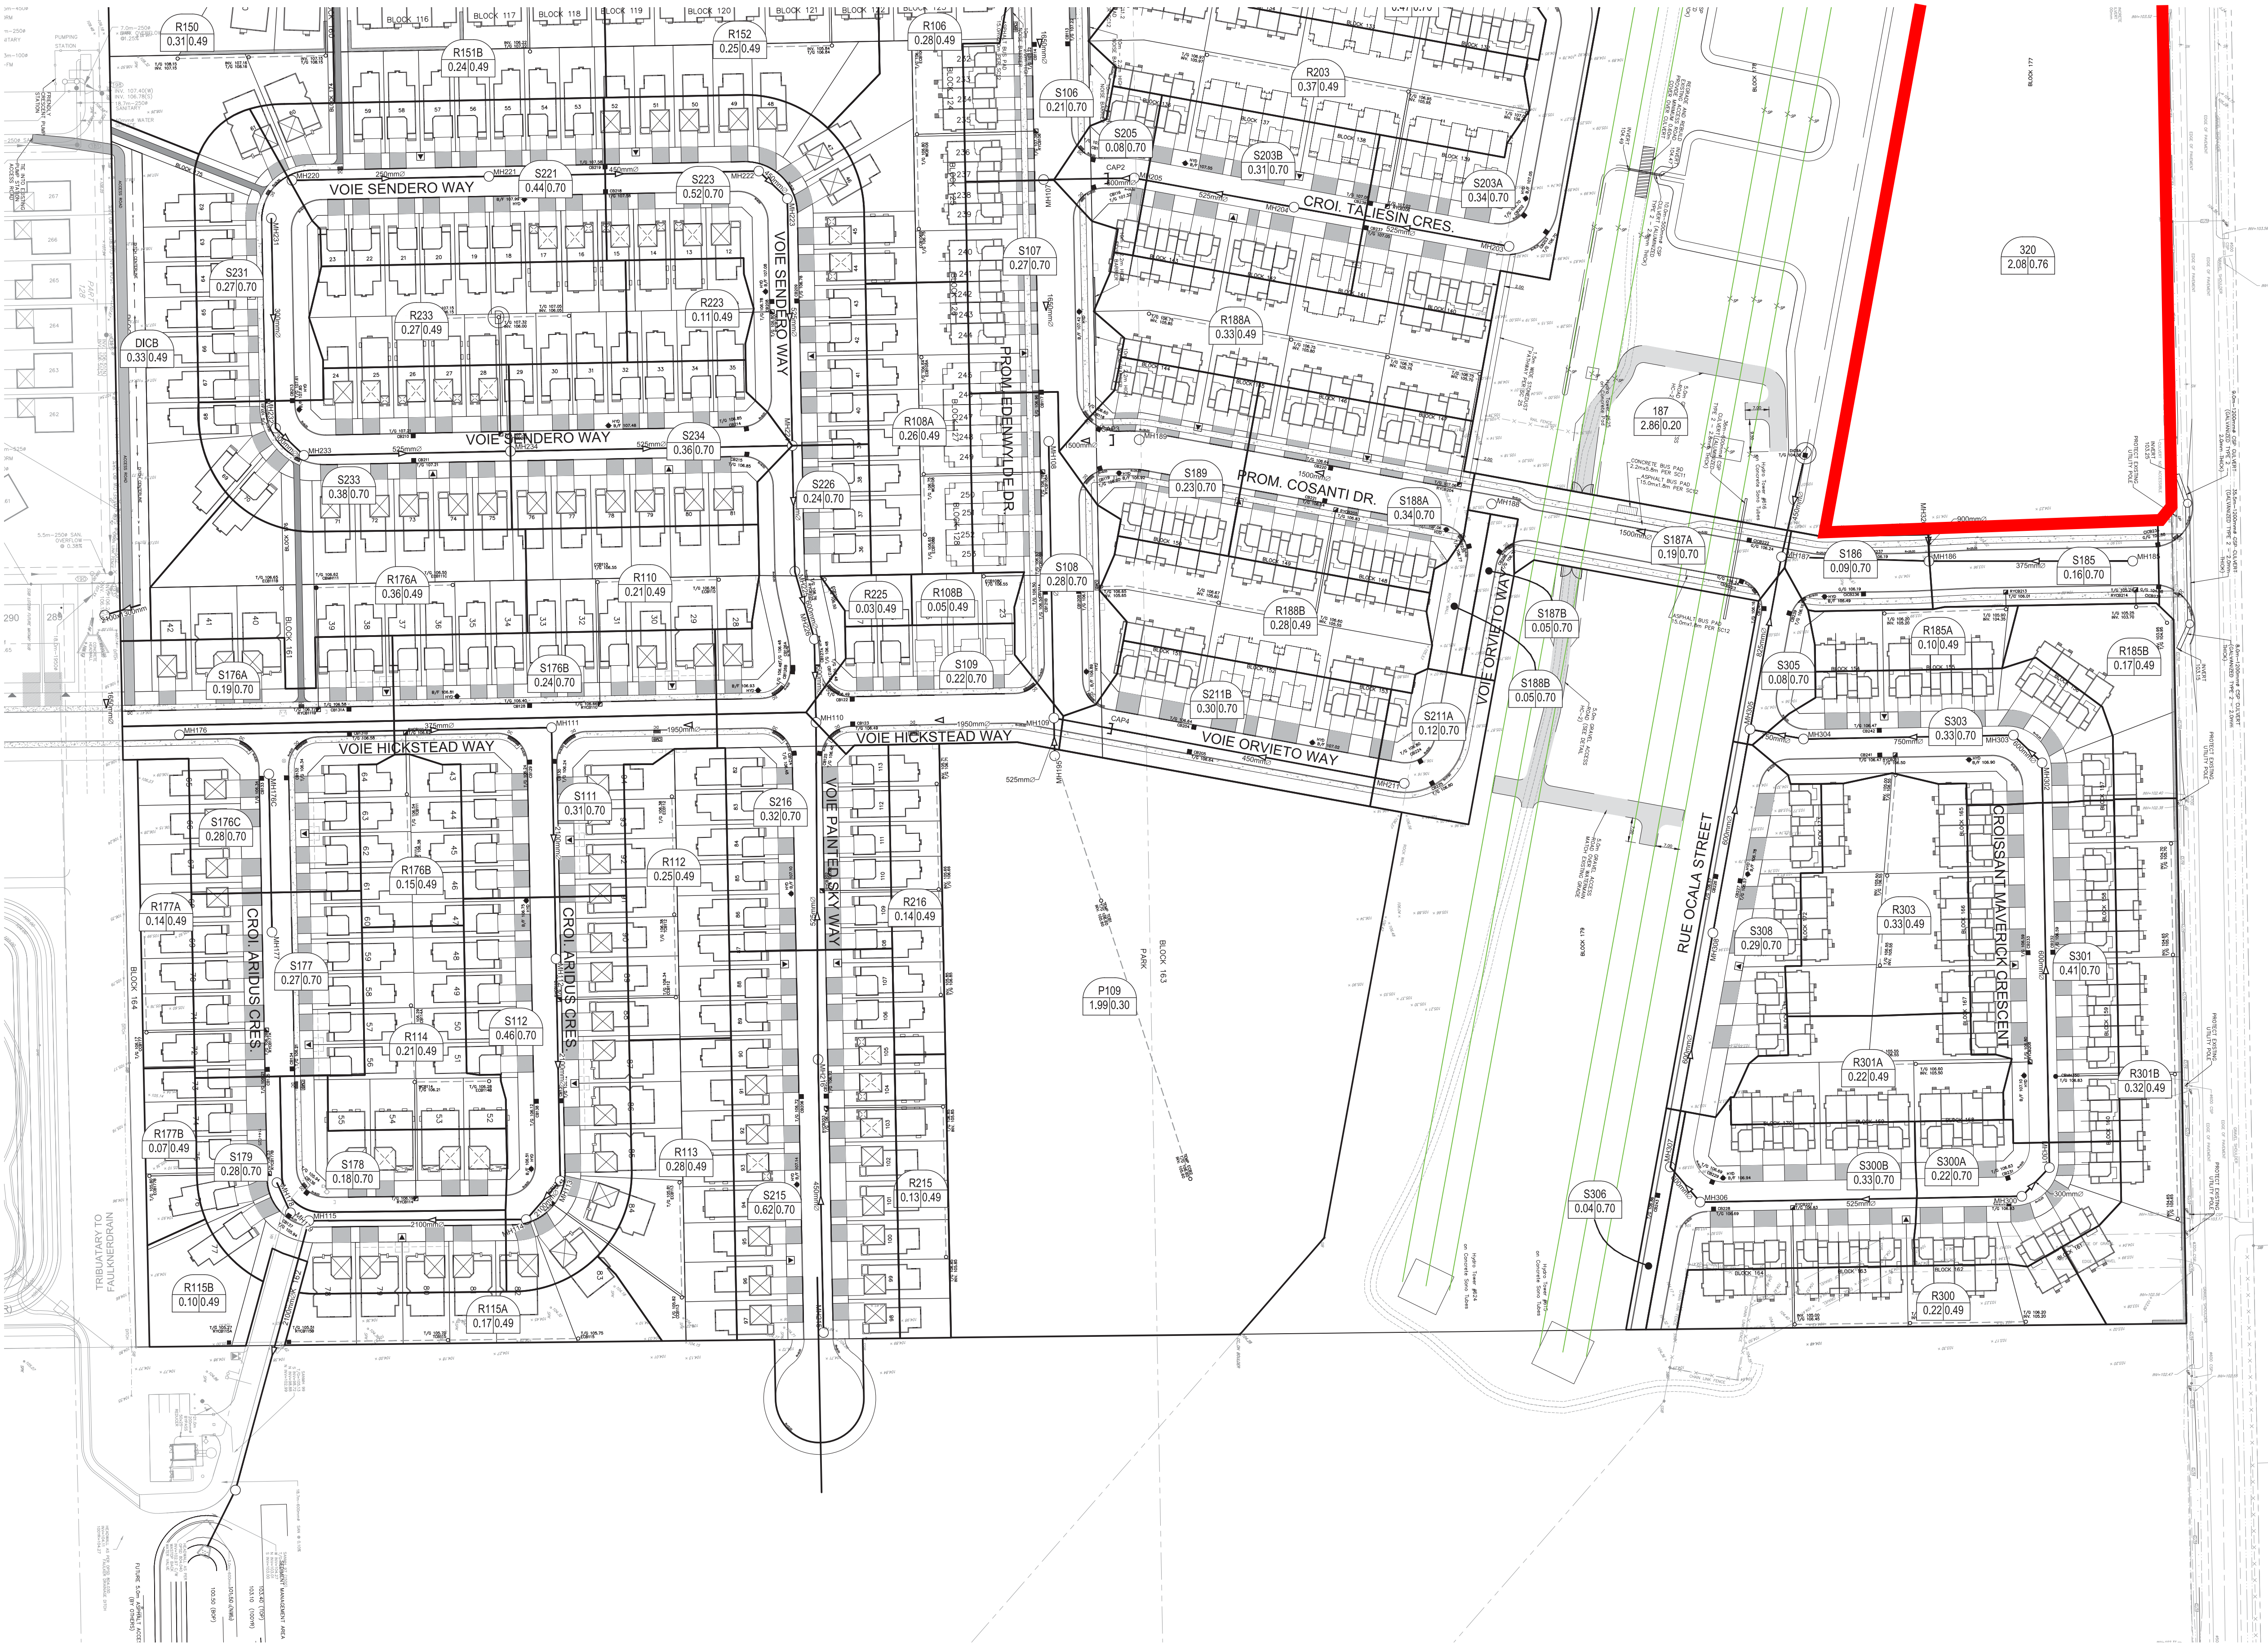

REVIEWED BY
DEVELOPMENT REVIEW SERVICES BRANCH
Signed _____
Date _____ 2018
Plan Number _____

LEGEND:

 AREA NUMBER
 RUNOFF COEFFICIENT
 AREA IN HECTARES

No.	REVISIONS	By	Date
14			
13			
12	REVISED PHASE 2 PER CITY COMMENTS	L.M.E	2020-06-05
11	REVISED PHASE 2 PER CITY COMMENTS	L.M.E	2020-04-09
10	REVISED PHASE 2 AS PER CITY COMMENTS AND NEW LEGAL PLAN	L.M.E	2020-02-07
9	PHASE 2 SUBMISSION 1 FOR CITY REVIEW	L.M.E	2019-10-30
8	REVISED LOT NUMBERS	L.M.E	2018-09-11
7	REVISED PER CITY COMMENTS	L.M.E	2018-06-04
6	ISSUED FOR TENDER	L.M.E	2018-05-30
5	REVISED PER NEW LEGAL	L.M.E	2018-04-06
4	REVISED PER CITY COMMENTS	L.M.E	2018-02-09
3	REVISED PER CITY COMMENTS	L.M.E	2017-10-25
2	ISSUED FOR MOE APPROVAL (BY OTHERS)	L.M.E	2017-03-10
1	SUBMISSION 1 FOR CITY REVIEW	L.M.E	2017-02-27

IBI IBI GROUP
400 - 333 Preston Street
Ottawa ON K1S 5N4 Canada
tel 613 225 1311 fax 613 225 9868
ibigroup.com

Project Title
DAVIDSON LANDS
PHASE 1 & 2

Professional Engineer

Drawing Title
STORM DRAINAGE AREA PLAN

Scale 1:1000

Design	L.E.	Date	DEC 2016
Drawn	D.D. / C.C.	Checked	J.I.M.
Project No.	37533	Drawing No.	501

D07-16-15-0008
#17769



IBI GROUP
 400-333 Preston Street
 Ottawa, Ontario K1S 5N4 Canada
 tel 613 225 1311 fax 613 225 9868
 ibigroup.com


PROJECT: 1650 Shea Road
DATE: 2022-08-31
FILE: 139185.6.04
REV #: 1
DESIGNED BY: Anton Chettrar
CHECKED BY: Ryan Magladry

TEMPORARY ICD ORIFICE SIZING

Orifice coefficients	
Cv =	0.60
Cv =	0.65

	Invert (m)	Diameter (mm)	Centre ICD (m)	Max. Pond Elevation (m)	Hydraulic Slope (m)	Target Flow (l/s)	Theoretical		Recommended	
							Orifice (m)	Actual Flow (l/s)	Orifice (m)	Actual Flow (l/s)
SANITARY MH	102.123	200	102.223	106.50	2.000	4.39	0.0342	4.39	0.075	21.14
STORM MH	103.191	750	103.566	106.50	2.000	367.27	0.3127	367.51	0.310	361.19

* minimum orifice size to be 0.075m

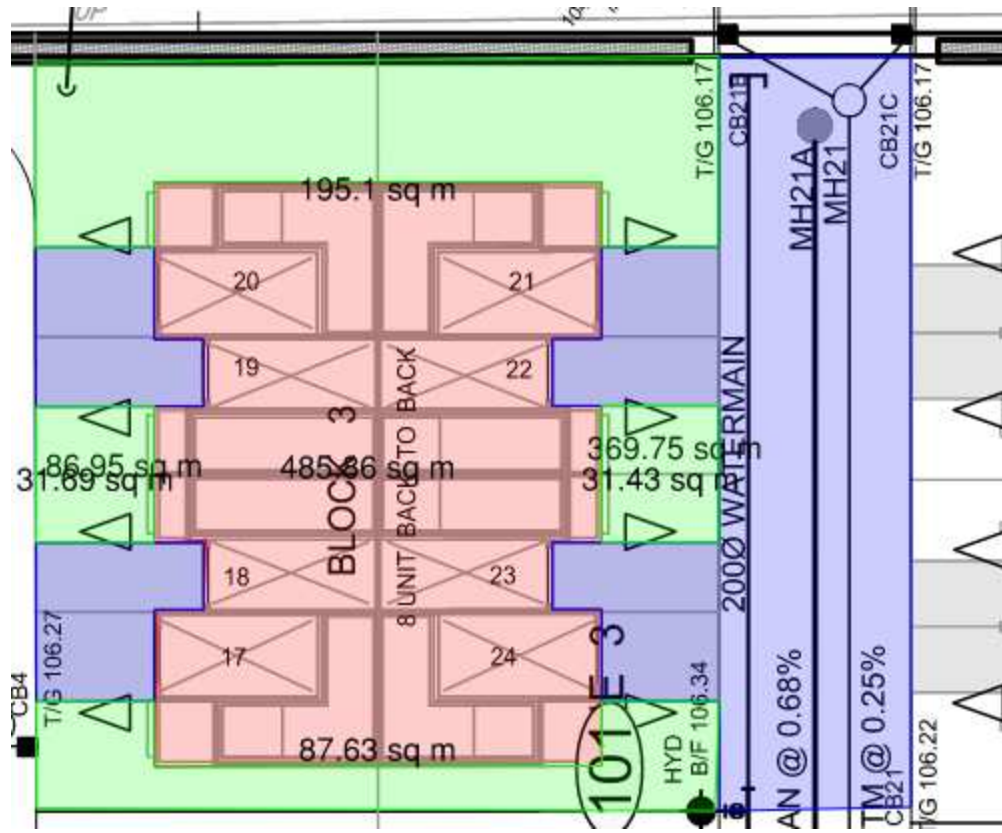



Arcadis
 400-333 Preston Street
 Ottawa, Ontario
 K1S 5N4

Run-off Coefficients

PROJECT: 1650 Shea Road
 DATE: 2025-03-13
 CLIENT: Davidson Co-Tennancy
 FILE: 139185.6.4

									BACK TO BACK - General Front Yard incl road		
									Landscape	Roof	Asphalt
									346.00	486.00	457.00
TOTAL (m ²)									346.00	486.00	457.00
									1289.00		

Runoff Coefficient (C) :									0.2	0.9	0.9
Ave. Runoff Coefficient (C):										0.71	


Runoff Coefficient Used(C):										0.77	
-----------------------------	--	--	--	--	--	--	--	--	--	------	--

FERNBANK ROAD




SHEA ROAD


EXISTING WEST WIND
RESIDENTIAL DEVELOPMENT

PROPOSED RATHWELL LANDING
RESIDENTIAL DEVELOPMENT

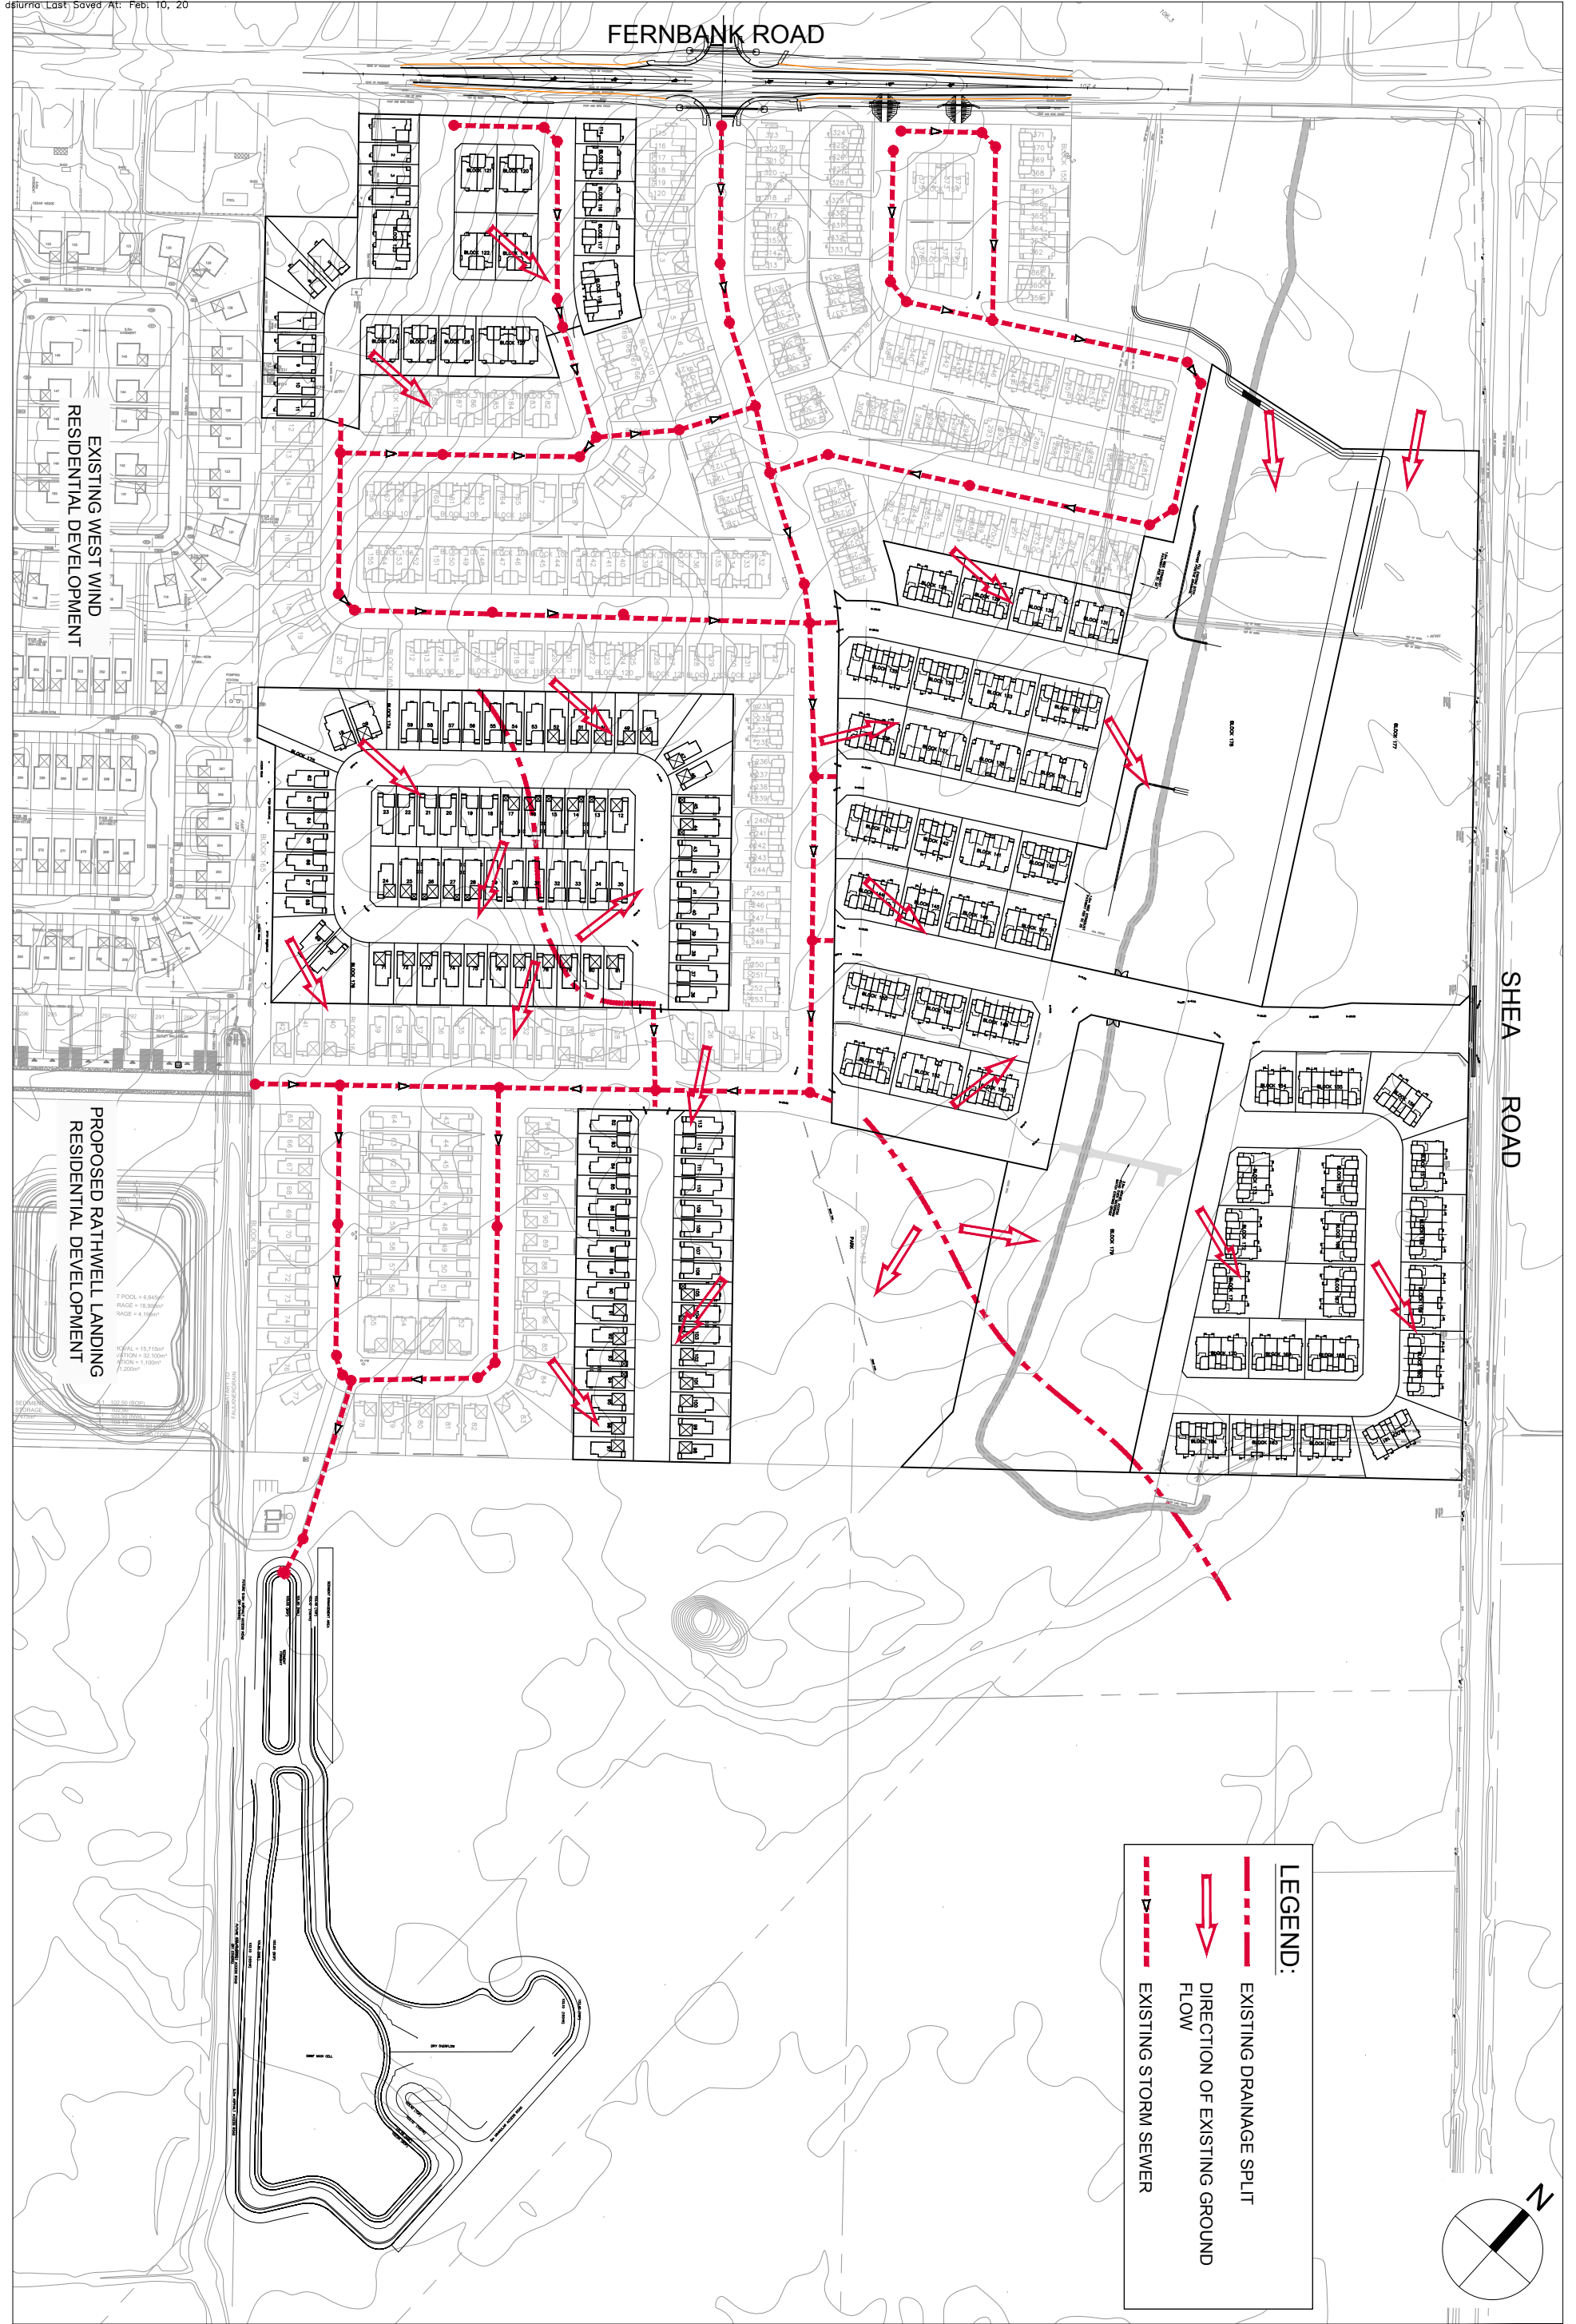

LEGEND:

-  EXISTING DRAINAGE SPLIT
-  DIRECTION OF EXISTING GROUND FLOW
-  EXISTING STORM SEWER



Sheet No.

Drawing Title

Project Title


Scale


FIGURE 4.1


EXISTING MINOR
STORM PLAN

DESIGN BRIEF
DAVIDSON LANDS-OPA 76 AREA 6a
PHASE 2
STITTVILLE SOUTH

N.T.S.



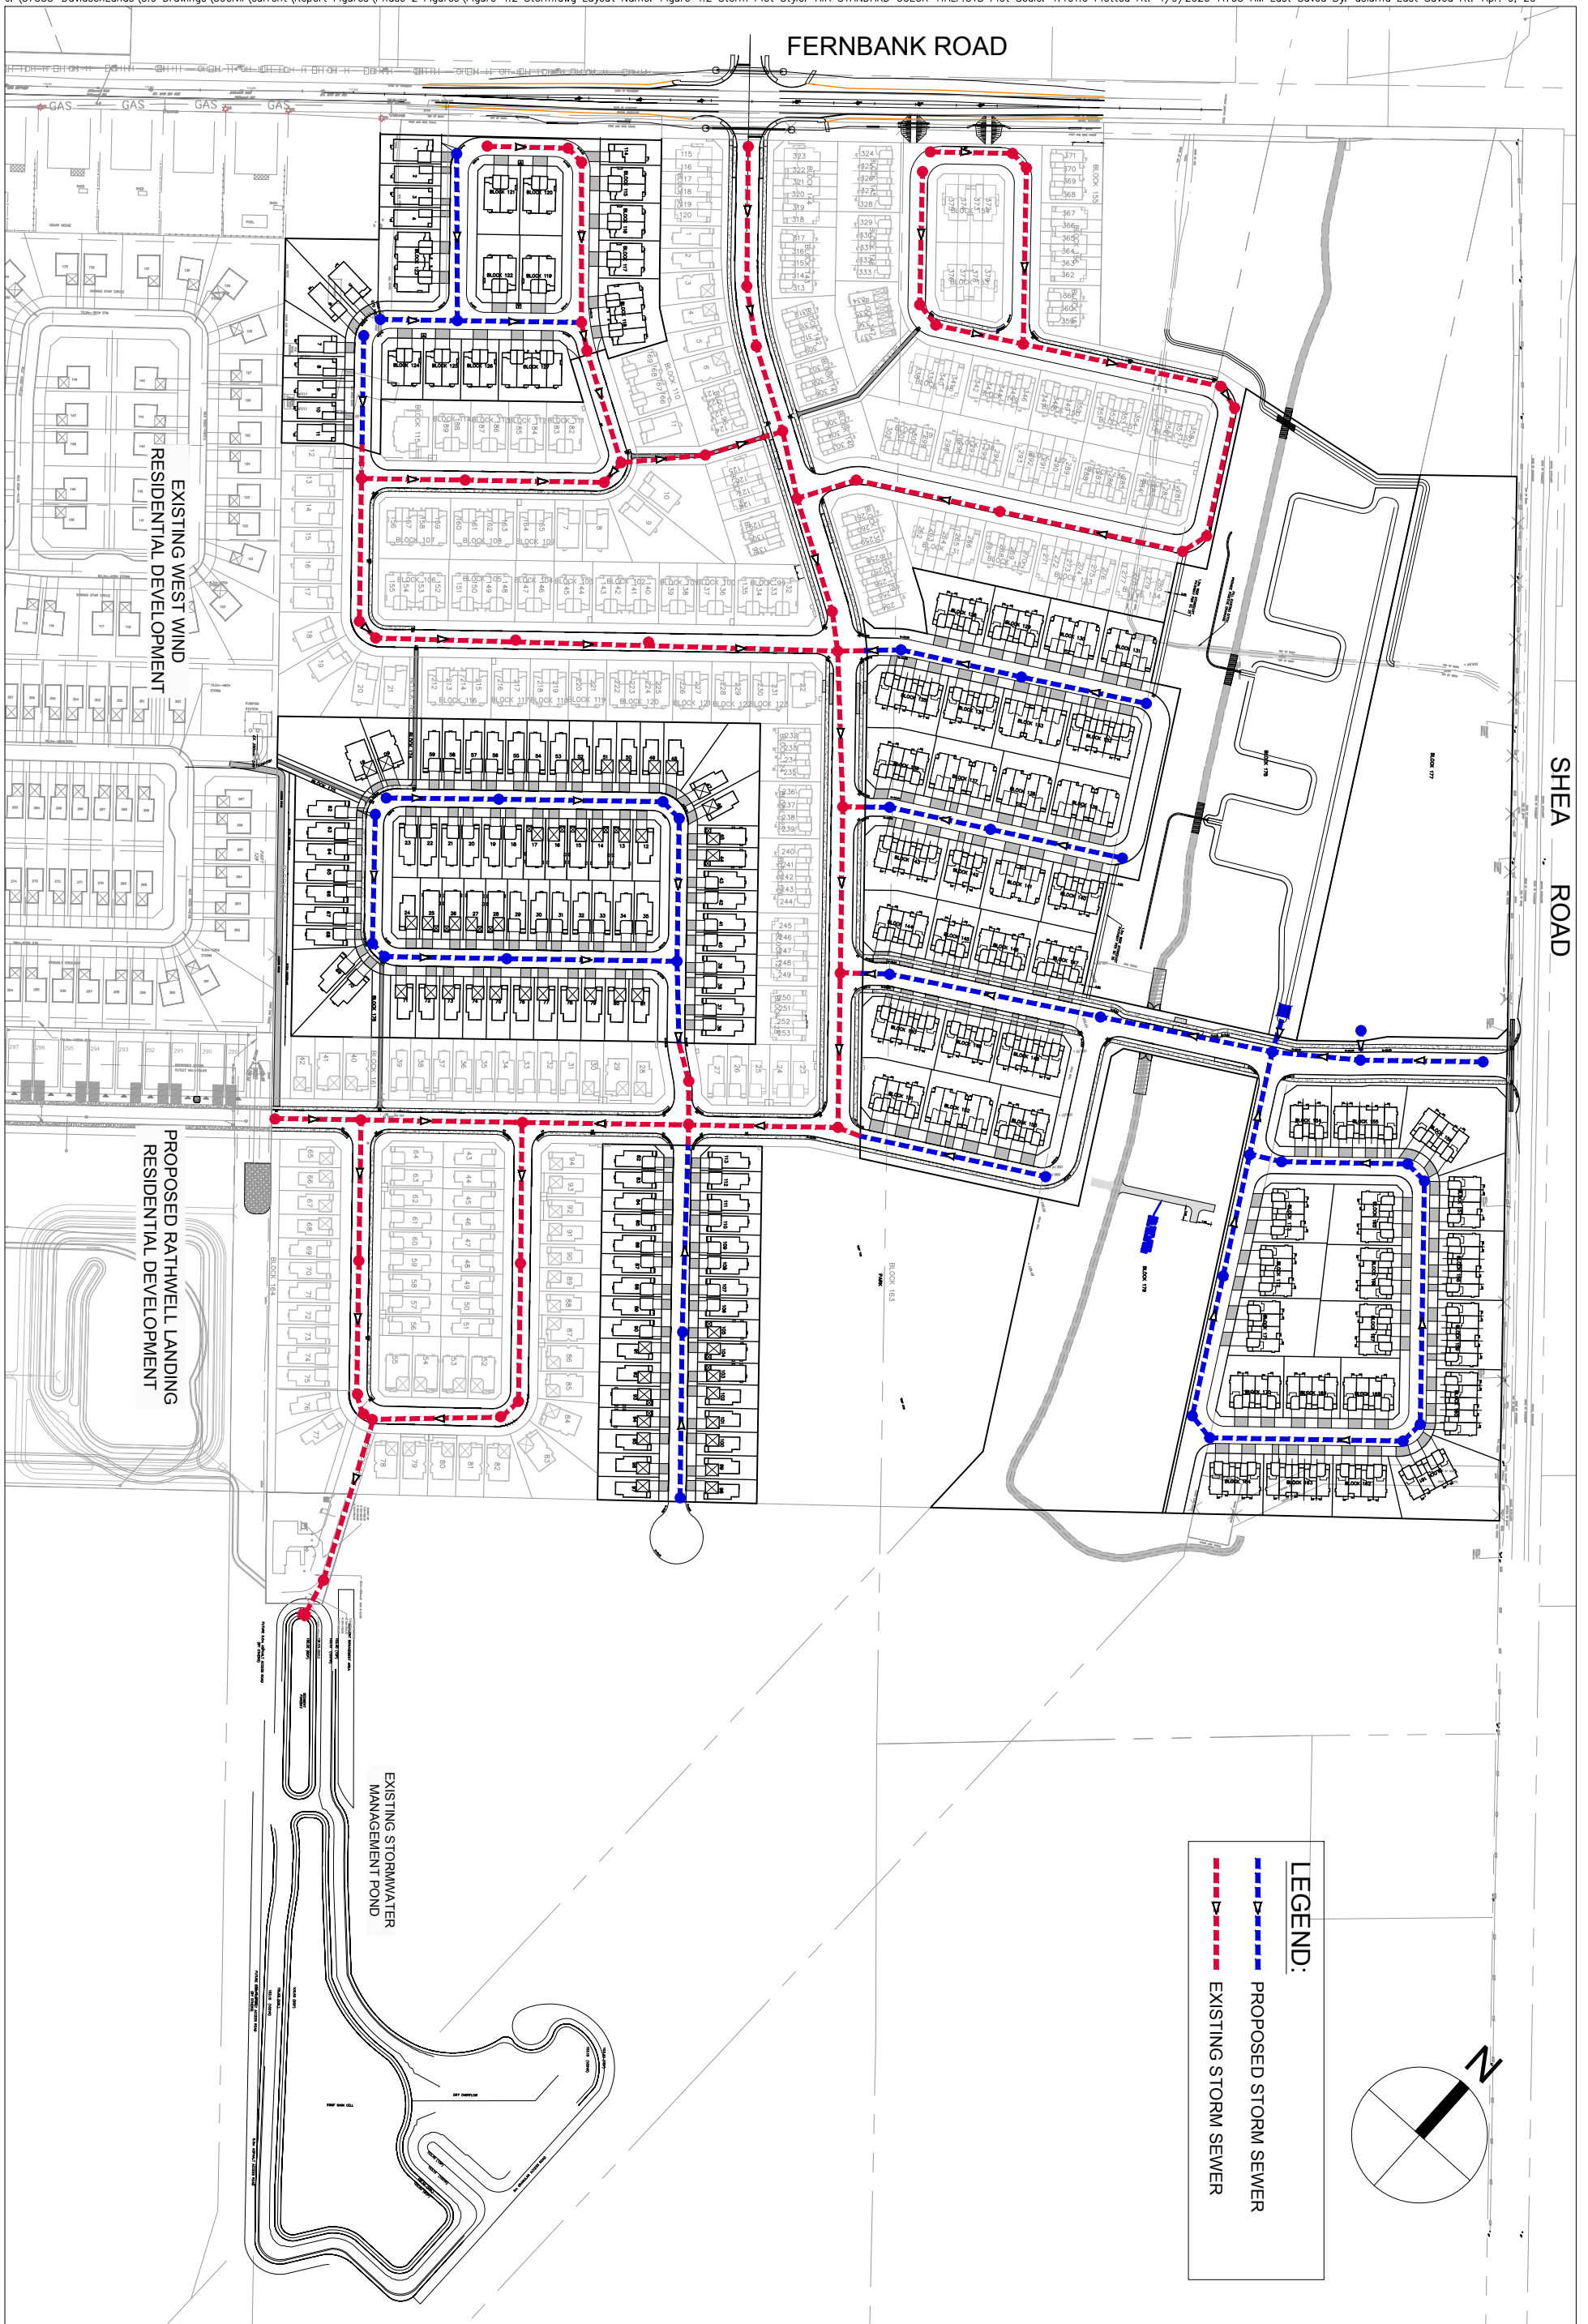

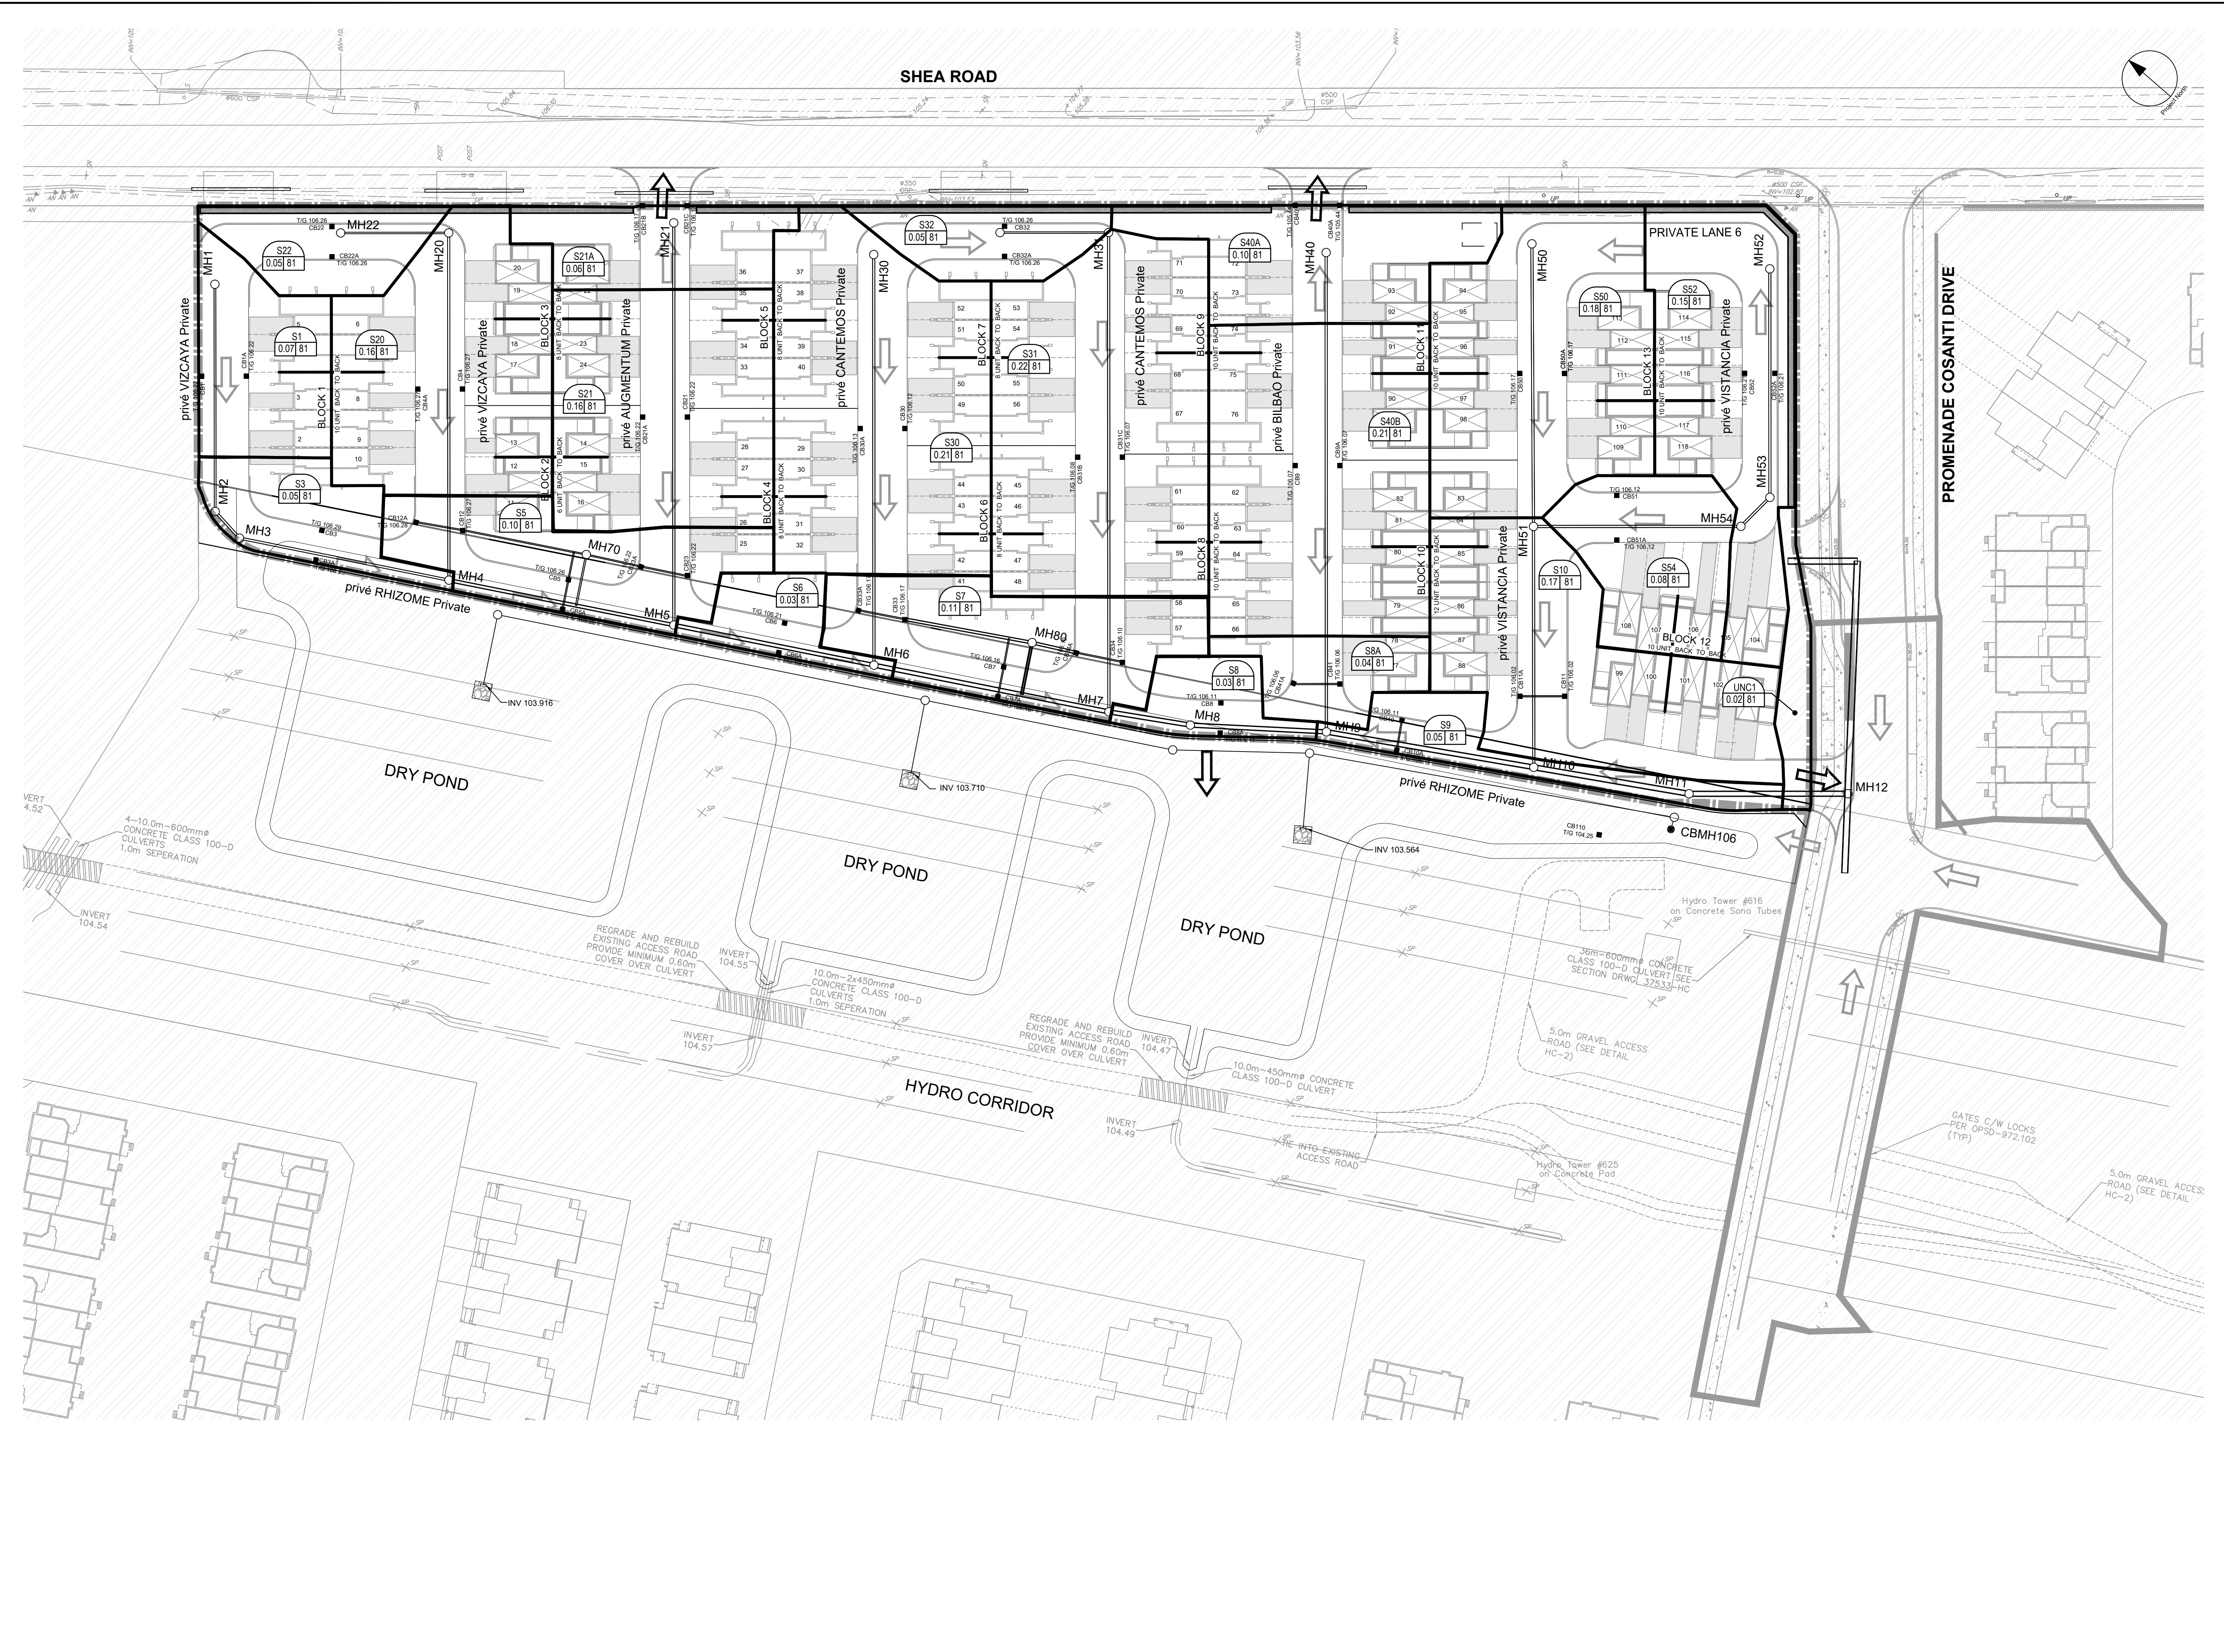

CLIENT
DAVIDSON SHEA
PROPERTY INC.

COPYRIGHT
This drawing has been prepared solely for the intended use. This any reproduction or distribution for any purpose other than authorized by IBI Group is prohibited. While dimensions shall have precedence over scaled dimensions, the user shall be responsible for verifying the dimensions and conditions shown on the drawing. Shop drawings shall be submitted to IBI Group for general conformance before proceeding with fabrication.

IBI Group Professional Services (Canada) Inc.
is a member of the IBI Group of companies.

ISSUES

No.	DESCRIPTION	DATE
01	SUBMISSION NO.1 FOR CITY REVIEW	2022-09-08
02	SUBMISSION NO.2 FOR CITY REVIEW	2024-01-19
03	SUBMISSION NO.3 FOR CITY REVIEW	2024-01-19

NOT FOR CONSTRUCTION

01, 011, 012 FOR NOTES, LEGEND, CB TABLE, STREET SECTIONS AND DETAILS.

KEY PLAN

CONSULTANTS

LEGEND

- VISTA STAGE 2 BOUNDARY
- DRAINAGE AREAS
- EXTERNAL AREA
- AREA ID
- IMPERVIOUS VALUE
- AREA (ha)
- MAJOR FLOW
- EXTERNAL MAJOR FLOW

1:500

SEAL

IBI GROUP
Suite 400 - 333 Preston Street
Ottawa ON, K1S 5N4, Canada
Tel: 613.225.1311 | 613.241.3300 fax: 613.225.9868
ibigroup.com

PROJECT
1650 SHEA ROAD
(OTTAWA, ON)

PROJECT NO:
139185

DRAWN BY: J.F.
CHECKED BY: P.D.

PROJECT MGR: P.D.
APPROVED BY: P.S.

SHEET TITLE
DSSWMM SCHEMATIC

SHEET NUMBER 700 **ISSUE** 3

CITY PLAN No. 19029

CITY FILE No. D07-12-23-0032

Velocity x Depth Calculation - 1650 Shea Rd

Iteration equation:

Velocity:

$$V_x = V_{min} + \frac{Q_x - Q_{min}}{Q_{max} - Q_{min}} (V_{max} - V_{min})$$

Depth:

$$d_x = d_{min} + \frac{Q_x - Q_{min}}{Q_{max} - Q_{min}} (d_{max} - d_{min})$$

100 Year 3 Hour Chicago Storm

Area ID (Dummy Segment, if applicable)	Road ROW Section	Longitudinal Slope (%)	Overflow Flowrate		SWMHYMO (139185vd.out)					Calculation Sheet: Overflow for Typical Road Ponding Area					SWMHYMO (139185vd.out)			Velocity x Depth (m ² /s)	Maximum Static Ponding Depth (m)	Total Depth (Static + Dynamic) (m)	
			Qx (l/s)	Qx (cms)	Flowrate (cms)		Velocity (m/s)			Flowrate (cms)		Depth (m)			Depth (m)						
					Qmin	Qmax	vmin	vmax	vx	Qmin	Qmax	dmin	dmax	dx	dmin	dmax	dx				
S1	14	0.71	0	0.000	0.000	0.001	0.000	0.217	0.000	0.000	0.001	0.000	0.001	N/A	0.000	0.013	0.025	0.000	0.000	0.18	0.18
S3	11.75	0.77	7	0.007	0.002	0.010	0.207	0.328	0.283	0.006	0.008	0.030	0.035	N/A	0.013	0.025	0.021	0.006	0.006	0.11	0.13
S22	11.75	0.64	0	0.000	0.000	0.002	0.000	0.140	0.000	0.000	0.001	0.000	0.001	N/A	0.000	0.018	0.000	0.000	0.000	0.15	0.15
S20	18	1.98	29	0.029	0.012	0.035	0.575	0.753	0.707	0.029	0.036	0.055	0.060	0.055	0.025	0.038	N/A	0.039	0.039	0.10	0.16
S21A	18	3.00	18	0.018	0.015	0.043	0.707	0.927	0.731	N/A	N/A	N/A	N/A	N/A	0.025	0.038	0.026	0.019	0.019	0.00	0.03
S21	18	1.72	28	0.028	0.011	0.033	0.536	0.702	0.664	0.022	0.029	0.050	0.055	0.055	0.025	0.038	N/A	0.036	0.036	0.10	0.15
S5	12.5	0.59	74	0.074	0.028	0.081	0.449	0.589	0.571	0.073	0.087	0.080	0.085	N/A	0.043	0.064	0.061	0.035	0.035	0.16	0.22
S30	18	1.49	13	0.013	0.010	0.031	0.498	0.653	0.520	0.012	0.017	0.040	0.045	0.041	0.025	0.038	N/A	0.021	0.021	0.15	0.19
S6	12.5	0.82	81	0.081	0.049	0.106	0.587	0.711	0.657	0.075	0.090	0.080	0.085	N/A	0.050	0.067	0.060	0.039	0.039	0.07	0.13
S32	11.75	0.64	5	0.005	0.002	0.010	0.207	0.328	0.252	0.003	0.005	0.025	0.030	N/A	0.013	0.025	0.018	0.004	0.004	0.05	0.07
S31	18	1.23	13	0.013	0.009	0.028	0.453	0.593	0.482	0.012	0.016	0.040	0.045	0.041	0.025	0.038	N/A	0.020	0.020	0.15	0.19
S8	12.5	2.00	177	0.177	0.154	0.219	0.759	0.829	0.784	0.173	0.196	0.105	0.110	N/A	0.037	0.042	0.039	0.030	0.030	0.07	0.11
S40A	18	3.00	29	0.029	0.015	0.043	0.707	0.927	0.817	N/A	N/A	N/A	N/A	N/A	0.025	0.038	0.032	0.026	0.026	0.00	0.03
S40B	18	1.79	10	0.010	0.002	0.011	0.344	0.546	0.524	0.009	0.012	0.035	0.040	0.037	0.013	0.025	N/A	0.019	0.019	0.16	0.20
S7	12.5	0.82	98	0.098	0.049	0.106	0.587	0.711	0.694	0.090	0.108	0.085	0.090	N/A	0.050	0.067	0.065	0.045	0.045	0.17	0.23
S54	18	0.87	16	0.016	0.008	0.023	0.381	0.499	0.444	0.012	0.016	0.040	0.045	0.045	0.025	0.038	N/A	0.020	0.020	0.04	0.08
S8A	18	0.61	7	0.007	0.007	0.020	0.319	0.418	0.319	0.005	0.008	0.030	0.035	0.033	0.025	0.038	N/A	0.011	0.011	0.12	0.15
S10	14	0.65	28	0.028	0.020	0.043	0.431	0.523	0.463	0.027	0.034	0.055	0.060	0.056	0.038	0.050	N/A	0.026	0.026	0.16	0.22
S9	12.5	0.61	80	0.080	0.042	0.091	0.506	0.613	0.589	0.073	0.087	0.080	0.085	N/A	0.050	0.067	0.063	0.037	0.037	0.07	0.13
S52	11.75	0.57	17	0.017	0.006	0.019	0.308	0.404	0.389	0.016	0.021	0.045	0.050	0.046	0.025	0.038	N/A	0.018	0.018	0.11	0.16
S50	18	0.87	37	0.037	0.023	0.050	0.499	0.605	0.554	0.035	0.043	0.060	0.065	0.061	0.038	0.050	N/A	0.034	0.034	0.12	0.18
UNC1	16.5	2.00	8	0.008	0.004	0.026	0.441	0.7	0.488	N/A	N/A	N/A	N/A	N/A	0.017	0.033	0.020	0.010	0.010	0.00	0.02

Velocity x Depth Calculation - 1650 Shea Rd

Iteration equation:

$$V_x = V_{min} + \frac{Q_x - Q_{min}}{Q_{max} - Q_{min}} (V_{max} - V_{min})$$

$$d_x = d_{min} + \frac{Q_x - Q_{min}}{Q_{max} - Q_{min}} (d_{max} - d_{min})$$

100 Year 3 Hour Chicago Storm + 20%																					
Area ID (Dummy Segment, if applicable)	Road ROW Section	Longitudinal Slope (%)	Overflow Flowrate		SWMHYMO (139185vd.out)					Calculation Sheet: Overflow for Typical Road Ponding Area					SWMHYMO (139185vd.out)			Velocity x Depth (m ² /s)	Maximum Static Ponding Depth (m)	Total Depth (Static + Dynamic) (m)	
			Qx (l/s)	Qx (cms)	Flowrate (cms)		Velocity (m/s)			Flowrate (cms)		Depth (m)			Depth (m)						
					Qmin	Qmax	vmin	vmax	vx	Qmin	Qmax	dmin	dmax	dx	dmin	dmax	dx				
S1	14	0.71	6	0.006	0.001	0.007	0.217	0.344	0.323	0.005	0.008	0.030	0.035	N/A	0.013	0.025	0.023	0.007	0.18	0.20	
S3	11.75	0.77	14	0.014	0.010	0.029	0.328	0.430	0.349	0.012	0.016	0.040	0.045	N/A	0.025	0.038	0.028	0.010	0.11	0.14	
S22	11.75	0.64	2	0.002	0.002	0.010	0.140	0.221	0.140	0.002	0.003	0.020	0.025	N/A	0.018	0.037	0.018	0.003	0.15	0.17	
S20	18	1.98	43	0.043	0.035	0.076	0.753	0.912	0.784	0.036	0.045	0.060	0.065	0.064	0.038	0.050	N/A	0.050	0.10	0.16	
S21A	18	3.00	23	0.023	0.015	0.043	0.707	0.927	0.770	N/A	N/A	N/A	N/A	N/A	0.025	0.038	0.029	0.022	0.00	0.03	
S21	18	1.72	41	0.041	0.015	0.043	0.707	0.927	0.911	0.036	0.045	0.060	0.065	0.063	0.025	0.038	N/A	0.057	0.10	0.16	
S5	12.5	0.59	117	0.117	0.081	0.175	0.589	0.713	0.636	0.104	0.123	0.090	0.095	N/A	0.064	0.086	0.072	0.046	0.16	0.23	
S30	18	1.49	53	0.053	0.031	0.066	0.653	0.791	0.740	0.045	0.054	0.065	0.070	0.069	0.038	0.050	N/A	0.051	0.15	0.22	
S6	12.5	0.82	169	0.169	0.106	0.191	0.711	0.825	0.795	0.168	0.190	0.105	0.110	N/A	0.067	0.083	0.079	0.063	0.07	0.15	
S32	11.75	0.64	8	0.008	0.002	0.010	0.207	0.328	0.298	0.005	0.008	0.030	0.035	N/A	0.013	0.025	0.022	0.007	0.05	0.07	
S31	18	1.23	58	0.058	0.028	0.060	0.593	0.719	0.711	0.053	0.063	0.070	0.075	0.072	0.038	0.05	N/A	0.052	0.15	0.22	
S8	12.5	2.00	387	0.387	0.300	0.398	0.897	0.962	0.955	0.386	0.417	0.145	0.150	N/A	0.047	0.053	0.052	0.050	0.07	0.12	
S40A	18	3.00	36	0.036	0.015	0.043	0.707	0.927	0.872	N/A	N/A	N/A	N/A	N/A	0.025	0.038	0.035	0.030	0.00	0.03	
S40B	18	1.79	35	0.035	0.033	0.072	0.716	0.867	0.724	0.029	0.036	0.055	0.060	0.059	0.038	0.050	N/A	0.043	0.16	0.22	
S7	12.5	0.82	235	0.235	0.191	0.328	0.825	0.991	0.878	0.214	0.238	0.115	0.120	N/A	0.083	0.100	0.088	0.078	0.17	0.26	
S54	18	0.87	23	0.023	0.023	0.050	0.499	0.605	0.499	0.021	0.028	0.050	0.055	0.051	0.038	0.050	N/A	0.026	0.04	0.09	
S8A	18	0.61	11	0.011	0.007	0.020	0.319	0.418	0.349	0.008	0.011	0.035	0.040	0.039	0.025	0.038	N/A	0.014	0.12	0.16	
S10	14	0.65	42	0.042	0.020	0.043	0.431	0.523	0.519	0.042	0.051	0.065	0.070	0.065	0.038	0.050	N/A	0.034	0.16	0.23	
S9	12.5	0.61	149	0.149	0.091	0.165	0.613	0.712	0.691	0.142	0.163	0.100	0.105	N/A	0.067	0.083	0.080	0.055	0.07	0.15	
S52	11.75	0.57	34	0.034	0.019	0.041	0.404	0.489	0.462	0.034	0.042	0.060	0.065	0.060	0.038	0.050	N/A	0.028	0.11	0.17	
S50	18	0.87	65	0.065	0.050	0.091	0.605	0.702	0.640	0.063	0.075	0.075	0.080	0.076	0.050	0.063	N/A	0.048	0.12	0.20	
UNC1	16.5	2.00	10	0.010	0.004	0.026	0.441	0.700	0.512	N/A	N/A	N/A	N/A	N/A	0.017	0.033	0.021	0.011	0.00	0.02	


Results of Hydraulic Grade Line Evaluation

XPSWMM Node	USF or Proposed Ground Elevation (m)	Need 0.3 m and 2.2 m min 100 year 3 hour Chicago		Need 0 m and 1.9 m min 100 year 3 hour Chicago + 20%		Need 0.3 m and 2.2 m min 100 year 12 hour SCS		Need 0.3 m and 2.2 m min 100 year 24 hour SCS	
		HGL (m)	USF or Proposed Ground - HGL (m)	HGL (m)	USF or Proposed Ground - HGL (m)	HGL (m)	USF or Proposed Ground - HGL (m)	HGL (m)	USF or Proposed Ground - HGL (m)
DAVIDSON LANDS									
MH900	N/A	103.00	N/A	103.24	N/A	103.17	N/A	103.12	N/A
MH115	104.30	103.00	1.30	103.24	1.06	103.18	1.12	103.12	1.18
MH179	104.20	103.16	1.04	103.24	0.96	103.18	1.02	103.15	1.05
MH178	104.25	103.19	1.06	103.24	1.01	103.18	1.07	103.18	1.07
MH177	104.70	103.43	1.27	103.43	1.27	103.42	1.28	103.43	1.27
MH176C	104.60	103.72	0.88	103.72	0.88	103.72	0.88	103.72	0.88
MH114	104.45	103.00	1.45	103.24	1.21	103.18	1.27	103.18	1.27
MH113	104.40	103.05	1.35	103.25	1.15	103.22	1.18	103.25	1.15
MH112	104.40	103.16	1.24	103.29	1.11	103.30	1.10	103.35	1.05
MH111	104.55	103.35	1.20	103.46	1.09	103.45	1.10	103.53	1.02
MH176	105.40	104.55	0.85	104.56	0.84	104.55	0.85	104.55	0.85
MH110	104.70	103.63	1.07	103.75	0.95	103.67	1.03	103.77	0.93
MH216	104.90	103.87	1.03	103.99	0.91	103.90	1.00	104.01	0.89
MH215	105.10	104.21	0.89	104.23	0.87	104.21	0.89	104.24	0.86
MH226	104.90	104.11	0.79	104.24	0.66	104.05	0.85	104.21	0.69
MH225	104.90	104.23	0.67	104.36	0.54	104.16	0.74	104.31	0.59
MH224	105.10	104.44	0.66	104.56	0.54	104.34	0.76	104.49	0.61
MH234	105.36	104.79	0.57	104.90	0.46	104.65	0.71	104.77	0.59
MH233	105.50	105.07	0.43	105.17	0.33	104.93	0.57	105.03	0.47
MH232	105.70	105.08	0.62	105.18	0.52	104.93	0.77	105.03	0.67
MH231	106.10	105.14	0.96	105.21	0.89	105.10	1.00	105.11	0.99
MH223	105.20	104.60	0.60	104.72	0.48	104.49	0.71	104.63	0.57
MH222	105.30	104.60	0.70	104.72	0.58	104.49	0.81	104.63	0.67
MH221	105.79	104.66	1.13	104.73	1.06	104.64	1.15	104.64	1.15
MH220	106.10	104.84	1.26	104.84	1.26	104.84	1.26	104.84	1.26
MH109	104.95	103.80	1.15	103.93	1.02	103.81	1.14	103.92	1.03
MH195	N/A	103.84	N/A	103.97	N/A	103.85	N/A	103.96	N/A
MH211	105.10	104.04	1.06	104.08	1.02	104.04	1.06	104.07	1.03
MH108	104.83	103.96	0.87	104.11	0.72	103.95	0.88	104.07	0.76
MH189	104.85	103.98	0.87	104.12	0.73	103.96	0.89	104.08	0.77
MH188	104.85	104.01	0.84	104.17	0.68	104.00	0.85	104.12	0.73
MH187	N/A	104.04	N/A	104.20	N/A	104.03	N/A	104.15	N/A
MH186	N/A	104.05	N/A	104.21	N/A	104.03	N/A	104.15	N/A
MH320	N/A	#N/A	N/A	#N/A	N/A	#N/A	N/A	#N/A	N/A
MH185	N/A	104.09	N/A	104.25	N/A	104.06	N/A	104.19	N/A
MH305	N/A	104.14	N/A	104.32	N/A	104.13	N/A	104.26	N/A
MH308	104.92	104.18	0.74	104.39	0.53	104.18	0.74	104.32	0.60
MH307	105.07	104.21	0.86	104.43	0.64	104.21	0.86	104.35	0.72
MH306	104.97	104.22	0.75	104.44	0.53	104.21	0.76	104.36	0.61
MH300	105.07	104.30	0.77	104.55	0.52	104.29	0.78	104.45	0.62
MH304	104.82	104.15	0.67	104.35	0.47	104.15	0.67	104.28	0.54
MH303	104.82	104.19	0.63	104.39	0.43	104.18	0.64	104.32	0.50
MH302	104.87	104.20	0.67	104.41	0.46	104.20	0.67	104.34	0.53
MH301	105.02	104.29	0.73	104.55	0.47	104.29	0.73	104.44	0.58
MH107	105.53	104.07	1.46	104.22	1.31	104.02	1.51	104.17	1.36
MH205	105.50	104.12	1.38	104.28	1.22	104.06	1.44	104.21	1.29
MH204	105.30	104.25	1.05	104.40	0.90	104.14	1.16	104.30	1.00
MH203	105.00	104.43	0.57	104.59	0.41	104.25	0.75	104.43	0.57
MH106	105.35	104.16	1.19	104.33	1.02	104.09	1.26	104.26	1.09
MH202	105.35	104.36	0.99	104.69	0.66	104.25	1.10	104.61	0.74
MH201	105.25	104.36	0.89	104.74	0.51	104.30	0.95	104.67	0.58
MH200	105.20	#N/A	#N/A	104.80	0.40	104.36	0.84	104.73	0.47
MH152	105.70	105.06	0.64	105.29	0.41	104.90	0.80	105.04	0.66
MH151	106.35	105.77	0.58	105.81	0.54	105.76	0.59	105.76	0.59
MH150	107.50	106.91	0.59	106.91	0.59	106.90	0.60	106.90	0.60
MH149	107.70	107.24	0.46	107.26	0.44	107.24	0.46	107.24	0.46
MH148	109.25	108.79	0.46	108.80	0.45	108.79	0.46	108.79	0.46
MH147	111.40	110.80	0.60	110.81	0.59	110.80	0.60	110.80	0.60
MH105	105.49	104.18	1.31	104.35	1.14	104.11	1.38	104.28	1.21
MH104	105.48	104.23	1.25	104.41	1.07	104.16	1.32	104.33	1.15
MH132	105.78	104.30	1.48	104.49	1.29	104.22	1.56	104.40	1.38
MH131	105.83	104.37	1.46	104.57	1.26	104.29	1.54	104.47	1.36
MH130	105.43	104.55	0.88	104.75	0.68	104.45	0.98	104.66	0.77
MH129	105.48	104.59	0.89	104.80	0.68	104.50	0.98	104.71	0.77
MH128	105.48	104.72	0.76	104.94	0.54	104.62	0.86	104.84	0.64
MH127	105.48	104.75	0.73	104.98	0.50	104.65	0.83	104.88	0.60
MH135	N/A	104.77	N/A	104.99	N/A	104.67	N/A	104.90	N/A
MH126	105.68	104.86	0.82	105.11	0.57	104.75	0.93	104.99	0.69
MH125	105.68	104.90	0.78	105.17	0.51	104.79	0.89	105.07	0.61
MH124	105.83	104.91	0.92	105.20	0.63	104.80	1.03	105.08	0.75
MH123	106.23	105.35	0.88	105.37	0.86	105.35	0.88	105.35	0.88
MH121	106.03	105.25	0.78	105.39	0.64	105.25	0.78	105.27	0.76
MH120	106.03	105.26	0.77	105.39	0.64	105.26	0.78	105.27	0.76
MH122	106.28	105.41	0.87	105.41	0.87	105.41	0.87	105.41	0.87
MH103	105.68	104.47	1.21	104.66	1.02	104.31	1.37	104.51	1.17
MH156	107.63	105.03	2.60	105.24	2.39	104.77	2.86	104.94	2.69
MH155	106.75	105.48	1.27	105.67	1.08	105.40	1.35	105.43	1.32
MH154	106.85	105.66	1.19	105.68	1.17	105.65	1.20	105.66	1.19
MH153	108.01	107.40	0.61	107.40	0.61	107.39	0.62	107.40	0.61
MH159	109.03	108.11	0.92	108.11	0.92	108.11	0.92	108.11	0.92
MH145	107.28	106.39	0.89	106.40	0.88	106.39	0.89	106.39	0.89
MH144	107.83	106.75	1.08	106.75	1.08	106.75	1.08	106.75	1.08
MH141	109.52	108.61	0.91	108.62	0.90	108.61	0.91	108.61	0.91
MH140	109.72	108.64	1.08	108.64	1.08	108.64	1.08	108.64	1.08
MH139	110.75	109.88	0.87	109.88	0.87	109.88	0.87	109.88	0.87
MH143	109.15	108.77	0.38	108.77	0.38	108.77	0.38	108.77	0.38
MH142	111.10	110.42	0.68	110.42	0.68	110.42	0.68	110.42	0.68
MH146	110.75	110.18	0.57	110.18	0.57	110.18	0.57	110.18	0.57
MH102	105.87	104.94	0.93	104.97	0.90	104.90	0.97	104.92	0.95
MH101	106.20	105.16	1.04	105.16	1.04	105.16	1.04	105.16	1.04
1650 SHEA ROAD									
MH1	105.02	104.40	0.62	104.44	0.58	104.40	0.62	104.40	0.62
MH2	N/A	104.25	N/A	104.42	N/A	104.24	N/A	104.33	N/A
MH3	N/A	104.25	N/A	104.42	N/A	104.24	N/A	104.33	N/A
MH22	N/A	104.43	N/A	104.46	N/A	104.43	N/A	104.43	N/A
MH20	104.84	104.32	0.52	104.44	0.40	104.32	0.52	104.35	0.49
MH4	N/A	104.24	N/A	104.41	N/A	104.23	N/A	104.32	N/A
MH21	104.84	104.26	0.58	104.40	0.44	104.26	0.58	104.32	0.52
MH5	N/A	104.21	N/A	104.39	N/A	104.20	N/A	104.30	N/A
MH30	104.88	104.24	0.64	104.39	0.49	104.23	0.65	104.31	0.57
MH6	N/A	104.19	N/A	104.36	N/A	104.18	N/A	104.28	N/A
MH32	N/A	104.28	N/A	104.40	N/A	104.28	N/A	104.32	N/A
MH31	104.88	104.24	0.64	104.40	0.48	104.24	0.64	104.32	0.56
MH7	N/A	104.17	N/A	104.33	N/A	104.16	N/A	104.26	N/A
MH8	N/A	104.15	N/A	104.32	N/A	104.14	N/A	104.25	N/A
MH40	104.72	104.20	0.52	104.37	0.35	104.20	0.52	104.29	0.43
MH9	N/A	104.13	N/A	104.29	N/A	104.12	N/A	104.23	N/A
MH52	104.82	104.26	0.56	104.42	0.40	104.25	0.57	104.35	0.47
MH53	N/A	104.23	N/A	104.41	N/A	104.23	N/A	104.34	N/A
MH54	104.92	104.23	0.69	104.41	0.51	104.22	0.70	104.34	0.58
MH50	104.72	104.23	0.49	104.41	0.31	104.22	0.50	104.34	0.38
MH51	104.67	104.22	0.45	104.39	0.28	104.21	0.46	104.32	0.35
MH10	104.92	104.10	0.82	104.26	0.66	104.08	0.84	104.20	0.72
MH11	104.92	104.08	0.84	104.23	0.69	104.06	0.86	104.18	0.74
MH12	N/A	104.05	N/A	104.21	N/A	104.03	N/A	104.15	N/A

APPENDIX E

139185-900
139185-200

Erosion and Sediment Control Plan
Grading Plan

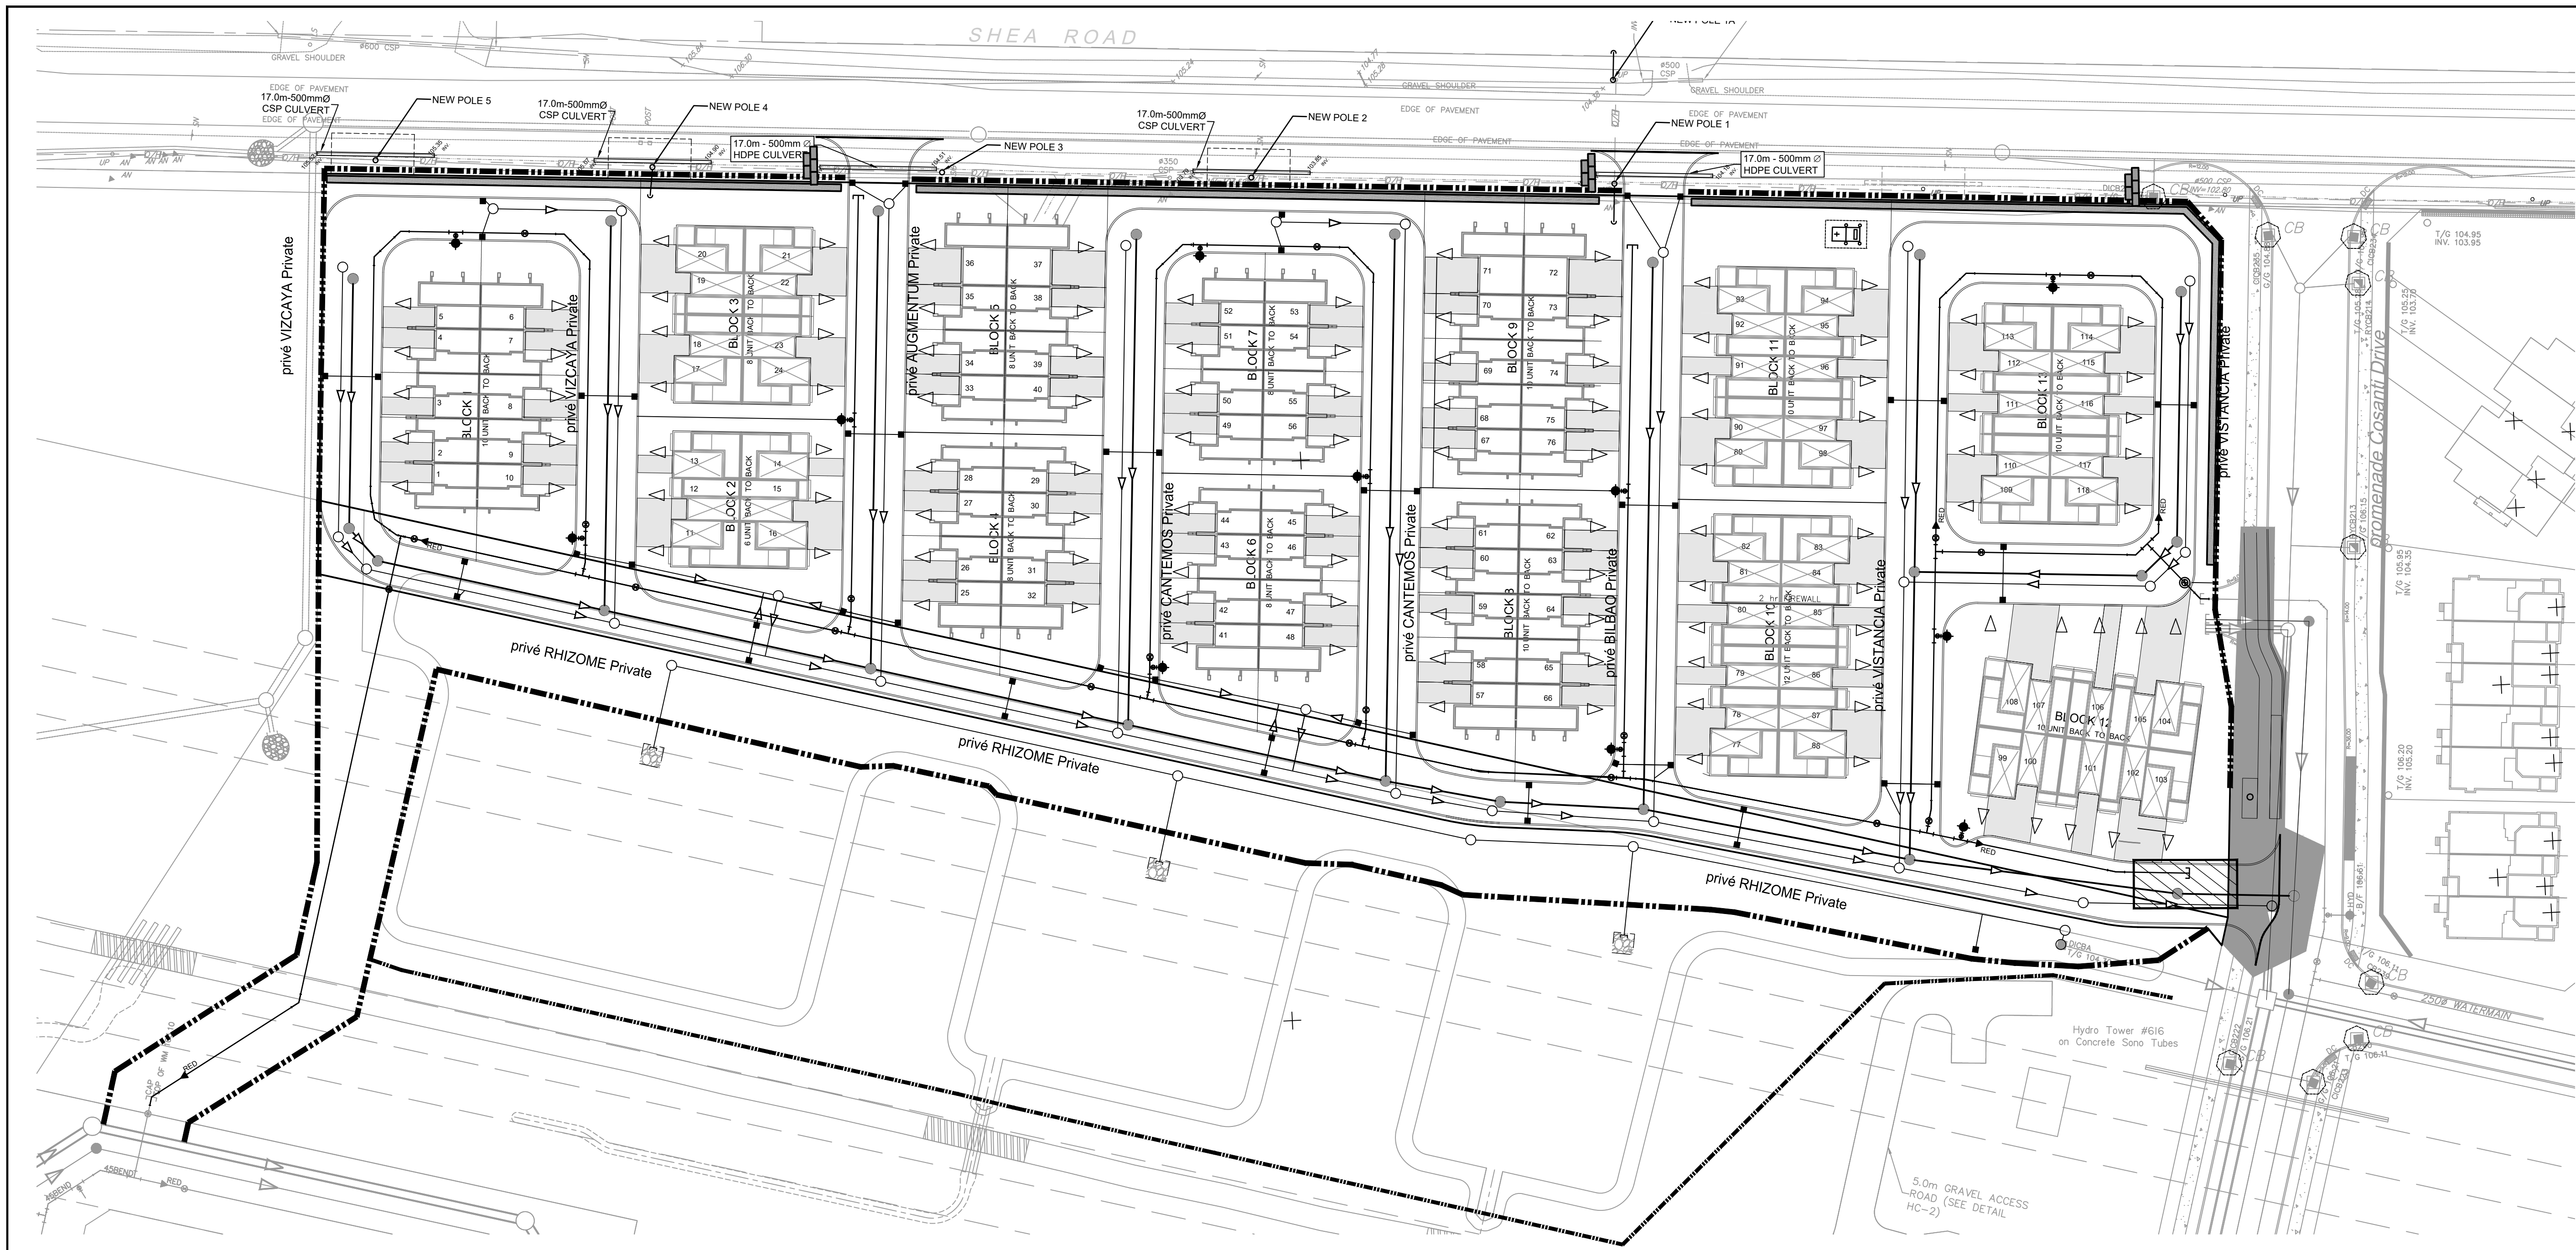

CLIENT
**DAVIDSON SHEA
PROPERTY INC.**


COPYRIGHT
This drawing has been prepared solely for the intended use. Any reproduction or distribution for any purpose other than authorized by IBI Group is forbidden. Written dimensions shall have precedence over scaled dimensions. Contractors shall verify and be responsible for all dimensions and conditions on the job, and IBI Group shall be informed of any variations from the dimensions and conditions shown on the drawing. Shop drawings shall be submitted to IBI Group for general conformance before proceeding with fabrication.

IBI Group Professional Services (Canada) Inc.
is a member of the IBI Group of companies.




ISSUES

No.	DESCRIPTION	DATE
1	SUBMISSION NO. 1 FOR CITY REVIEW	2022-09-15
2	SUBMISSION NO. 2 FOR CITY REVIEW	2024-06-27
3	REVISED PER CITY COMMENTS	2025-03-21
4	REVISED PER NEW SITE PLAN	2025-05-12
5	SUBMISSION NO. 4 FOR CITY REVIEW	2024-07-31
6		
7		
8		

SEE 010, 011 FOR NOTES, LEGEND, CB TABLE, STREET SECTIONS AND DETAILS

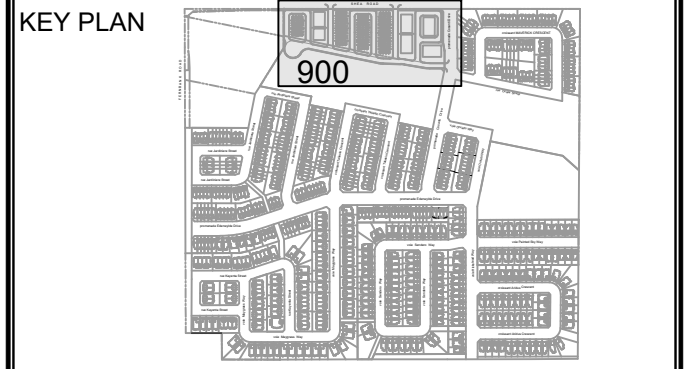


CONSULTANTS

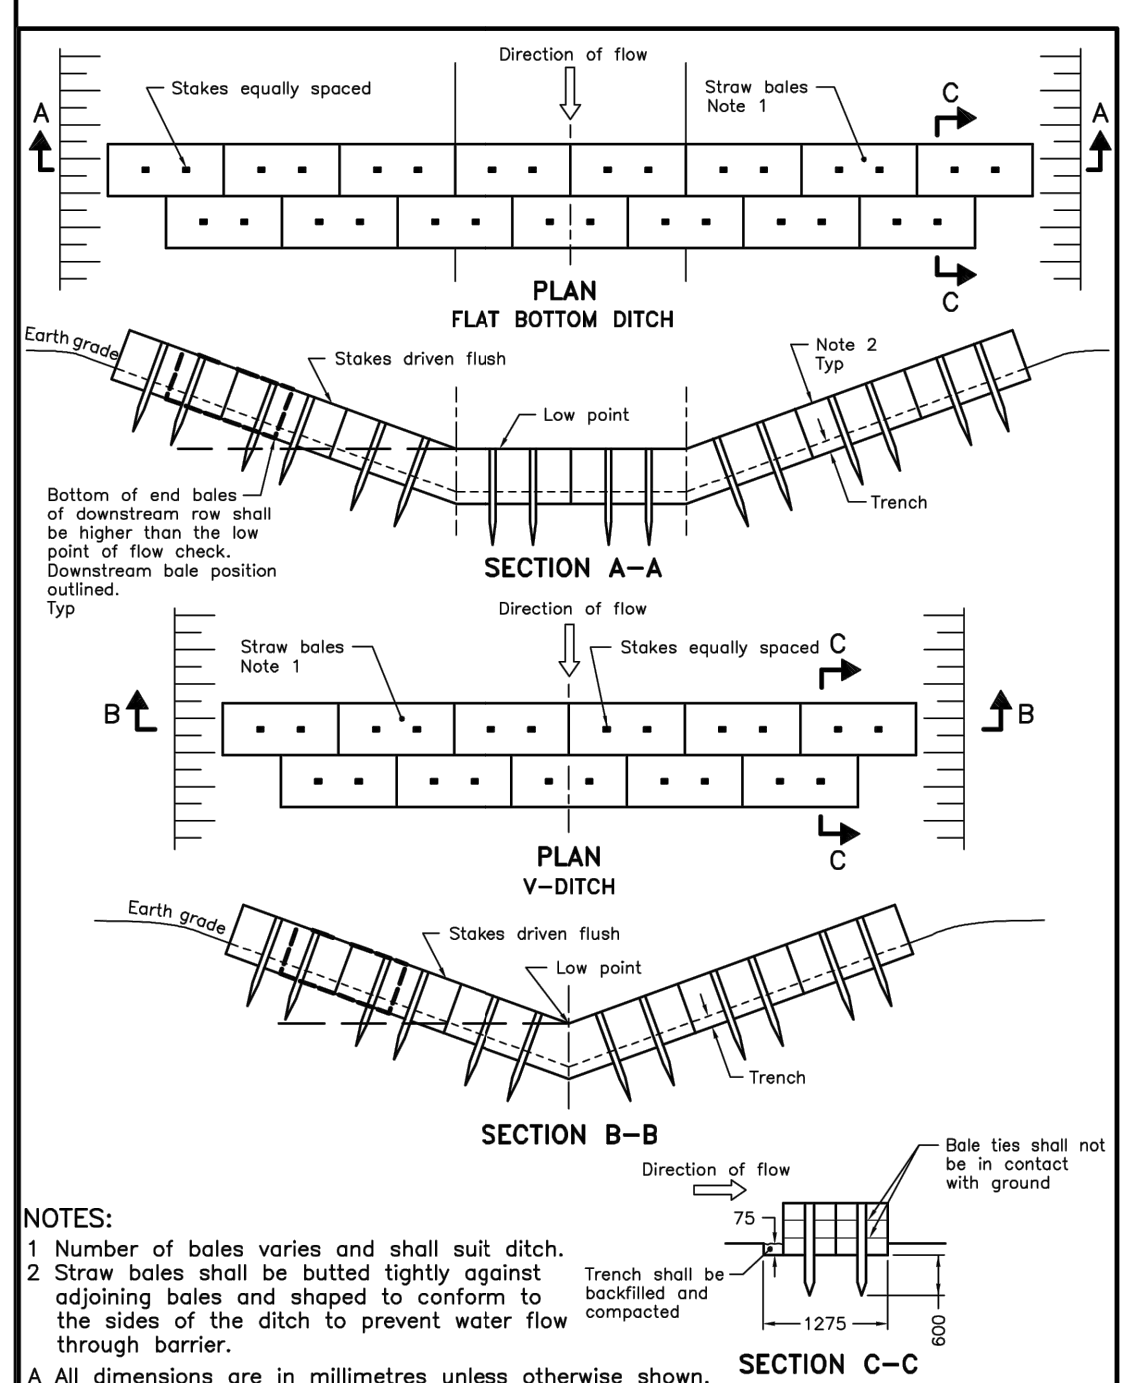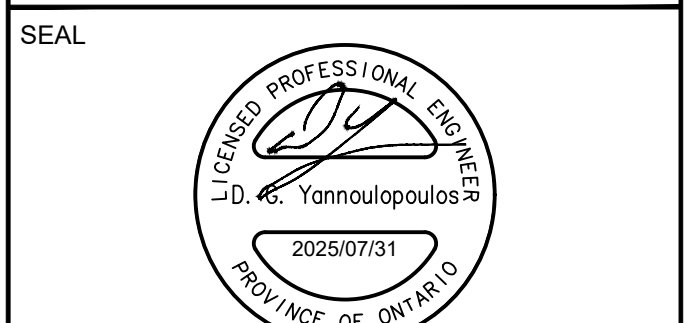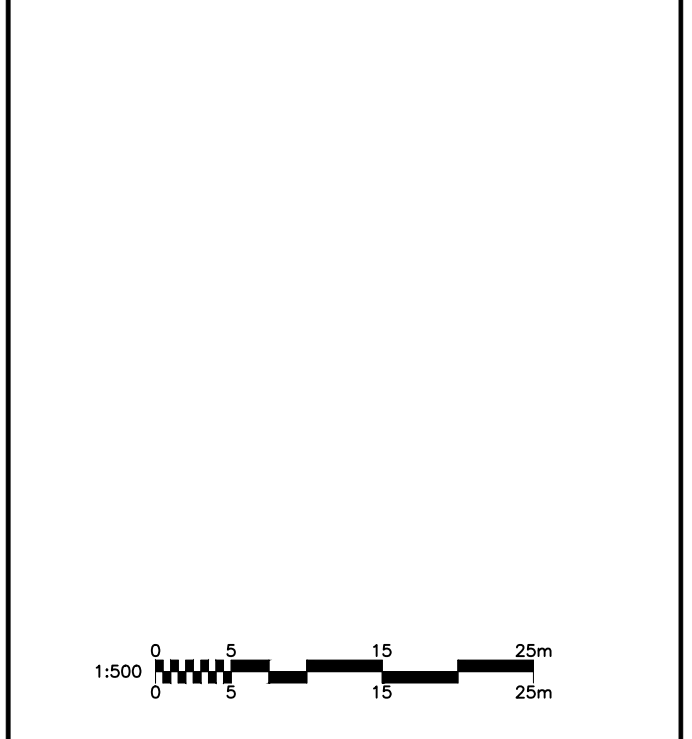

NOTES:
1. Number of bales varies and shall suit ditch.
2. Straw bales shall be butted tightly against adjoining bales and shaped to conform to the sides of the ditch to prevent water flow through barrier.


A All dimensions are in millimetres unless otherwise shown.

ONTARIO PROVINCIAL STANDARD DRAWING Nov 2015 Rev 2
STRAW BALE FLOW CHECK DAM
OPSD 219.180

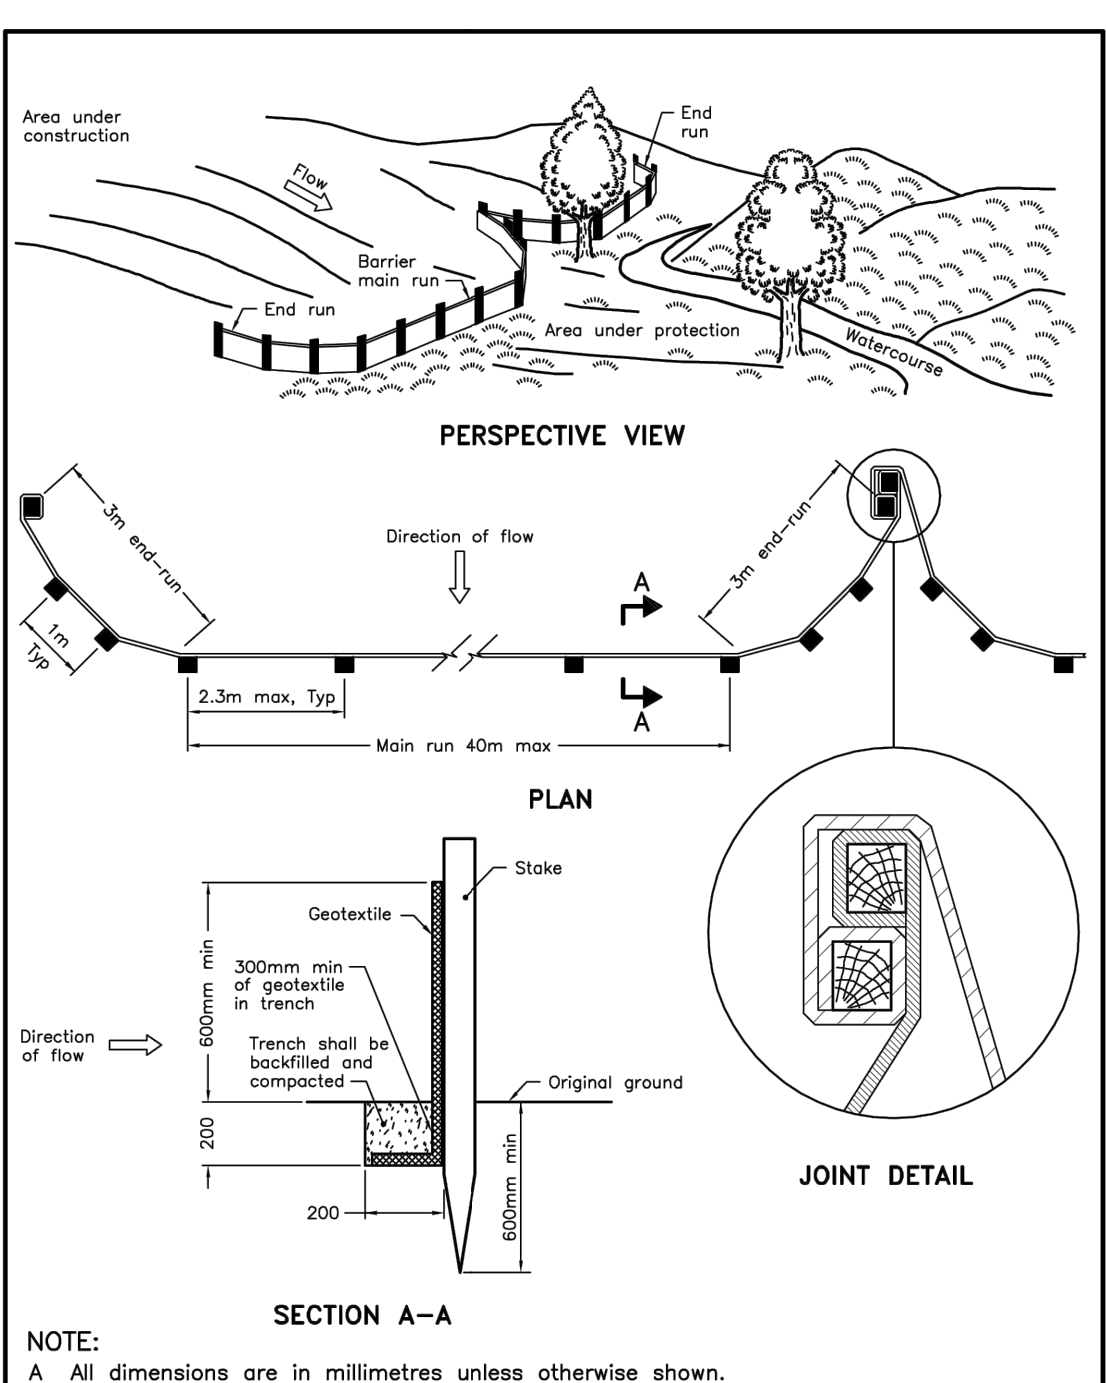

NOTE:
A All dimensions are in millimetres unless otherwise shown.

ONTARIO PROVINCIAL STANDARD DRAWING Nov 2015 Rev 2
**LIGHT-DUTY
SILT FENCE BARRIER**
OPSD 219.110

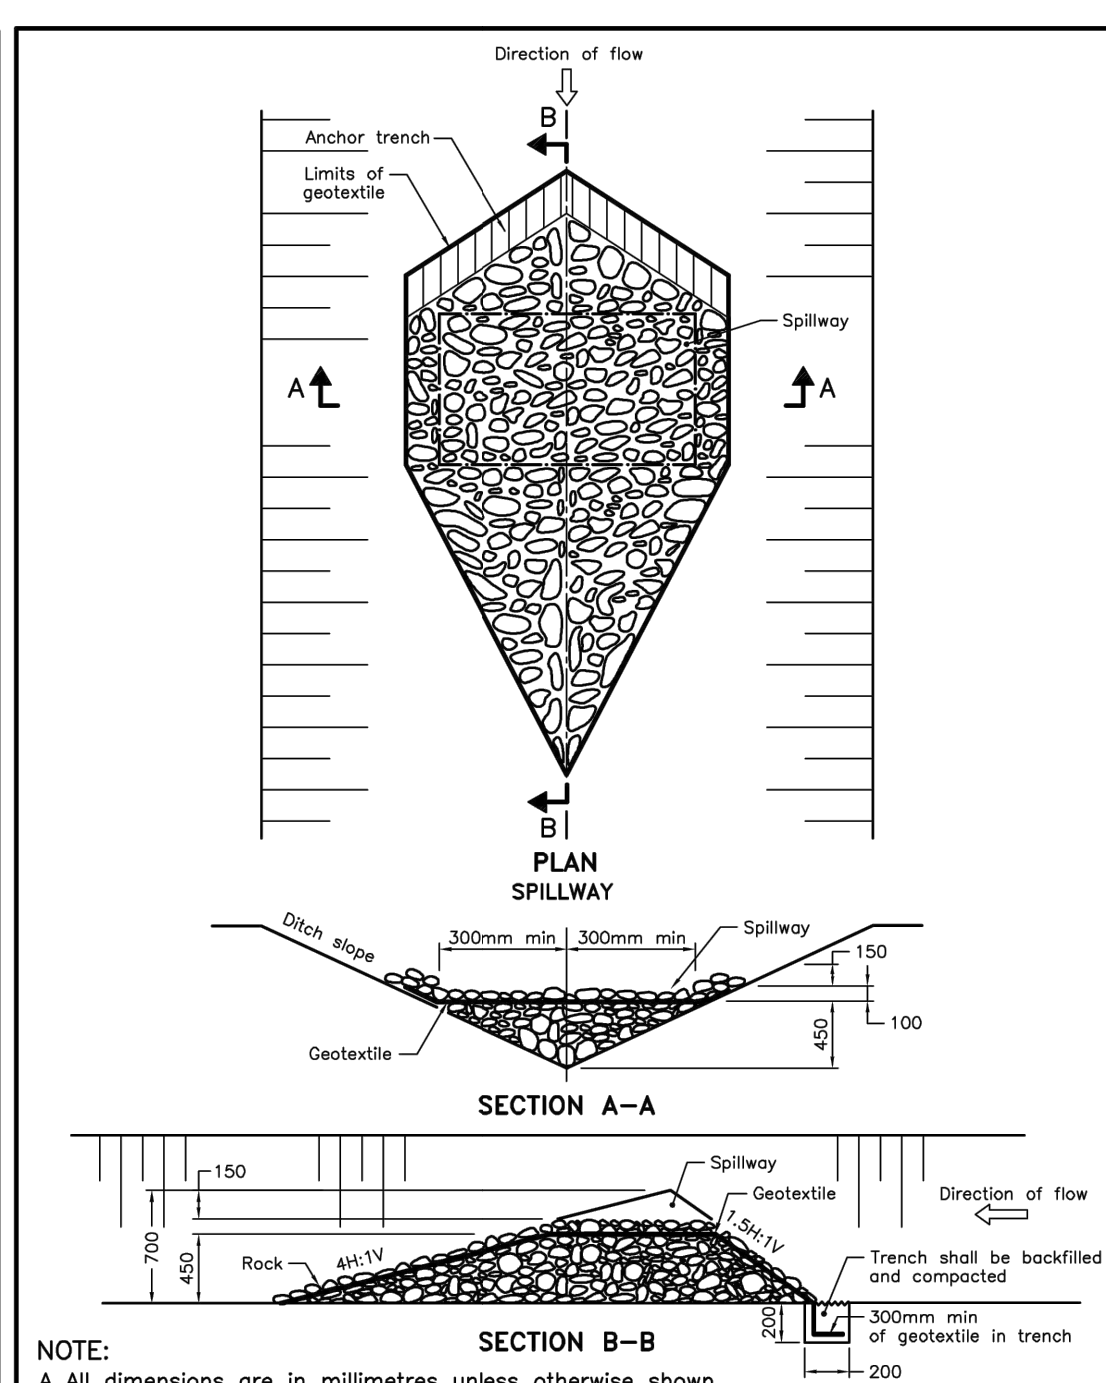

NOTE:
A All dimensions are in millimetres unless otherwise shown.

ONTARIO PROVINCIAL STANDARD DRAWING Nov 2015 Rev 2
**TEMPORARY
ROCK FLOW CHECK DAM
V-DITCH**
OPSD 219.210

NOTES:

1. THE CONTRACTOR SHALL IMPLEMENT BEST MANAGEMENT PRACTICES, TO PROVIDE FOR PROTECTION OF THE AREA DRAINAGE SYSTEM AND THE RECEIVING WATERCOURSE, DURING CONSTRUCTION ACTIVITIES. THE CONTRACTOR ACKNOWLEDGES THAT FAILURE TO IMPLEMENT APPROPRIATE EROSION AND SEDIMENT CONTROL MEASURES MAY BE SUBJECT TO PENALTIES IMPOSED BY ANY APPLICABLE REGULATORY AGENCY.
2. SILT FENCE TO BE ERECTED PRIOR TO EARTH WORKS BEING COMMENCED. SILT FENCE TO BE MAINTAINED UNTIL VEGETATION IS ESTABLISHED OR UNTIL START OF SUBSEQUENT PHASE.
3. STRAW BALE SEDIMENT TRAPS TO BE CONSTRUCTED IN EXISTING ROAD SIDE DITCHES. TRAPS TO REMAIN AND BE MAINTAINED UNTIL VEGETATION IS ESTABLISHED.
4. SILT SACK TO BE PLACED AND MAINTAINED UNDER COVER OF ALL CATCHBASINS. GEOTEXTILE SILT SACK IN STREET CBS TO REMAIN UNTIL ALL CURBS ARE CONSTRUCTED. GEOTEXTILE FABRIC IN RYCBs TO REMAIN UNTIL VEGETATION IS ESTABLISHED. ALL CATCHBASINS TO BE REGULARLY INSPECTED AND CLEANED, AS NECESSARY, UNTIL SOD AND CURBS ARE CONSTRUCTED.
5. CONTRACTOR TO PROVIDE DETAILS ON LOCATION(S) AND DESIGN OF DEWATERING TRAP(S) PRIOR TO COMMENCING WORK. CONTRACTOR ALSO RESPONSIBLE FOR MAINTAINING TRAP(S) AND ADJUSTING SIZE(S) IF DEEMED REQUIRED BY THE ENGINEER DURING CONSTRUCTION.
6. CONTRACTOR TO PROTECT EXISTING CATCHBASINS WITH FILTER CLOTH UNDER THE COVERS TO TRAP SEDIMENTATION. REFER TO IDENTIFIED STRUCTURES.
7. WORKS NOTED ABOVE ARE TO BE INSTALLED, INSPECTED, MAINTAINED AND ULTIMATELY REMOVED BY SERVICING CONTRACTOR.
8. THIS IS A "LIVING DOCUMENT" AND MAY BE MODIFIED IN THE EVENT THE PROPOSED CONTROL MEASURES ARE INSUFFICIENT
9. THE CONTRACTOR SHALL INSPECT THE EROSION AND SEDIMENT CONTROL MEASURES ON A MONTHLY BASIS DURING DRY WEATHER CONDITIONS, AFTER SIGNIFICANT STORM EVENTS (25 mm WITHIN A 24-HOUR PERIOD), AFTER SIGNIFICANT SNOW MELT EVENTS AND AFTER SIGNIFICANT WEATHER EVENTS THAT MAY AFFECT THE PERFORMANCE AND FUNCTION OF THE SYSTEMS.
10. THE CONTRACTOR SHALL IDENTIFY AND RECTIFY ANY DEFICIENCIES OR DAMAGE AND UNDERTAKE NECESSARY MAINTENANCE MEASURES AS SOON AS POSSIBLE
11. THE CONTRACTOR SHALL ENSURE THAT RECORDS OF INSPECTION ARE KEPT ONSITE, INCLUDING AT A MINIMUM, THE INSPECTOR'S NAME, DATE OF INSPECTION, VISUAL OBSERVATIONS, AND ANY NECESSARY REMEDIAL MEASURES TO MAINTAIN THE INTERIM EROSION AND SEDIMENT CONTROL MEASURES.

LEGEND:

- LIGHT DUTY SILT FENCE AS PER OPSD-219.110
- SNOW FENCE
- STRAW BALE CHECK DAM AS PER OPSD-219.180
- ROCK CHECK DAM AS PER OPSD-219.210
- SILT SACK PLACED UNDER EXISTING CB COVER
- TEMPORARY MUD MAT 0.15m THICK 50mm CLEAR STONE ON NON WOVEN FILTER CLOTH



PROJECT
1650 SHEA ROAD
(OTTAWA, ON)

PROJECT NO:
139185

DRAWN BY: M.M. CHECKED BY: R.M./D.Y.



PROJECT MGR: R.M. APPROVED BY: R.M./D.Y.

SHEET TITLE
**SEDIMENT AND EROSION
CONTROL PLAN**

SHEET NUMBER
900

ISSUE
5

CITY FILE No. D07-12-23-0032
Scale Check
File Location: \\1139185_1650_Shea_Road\0_Production\04_Civil\Shea\900-SEDIMENT AND EROSION CONTROL PLAN.dwg Last Saved: March 21, 2025, by: commec3392 Plotted: July 30, 2025, 7:55:14 PM by: Meline, Marian

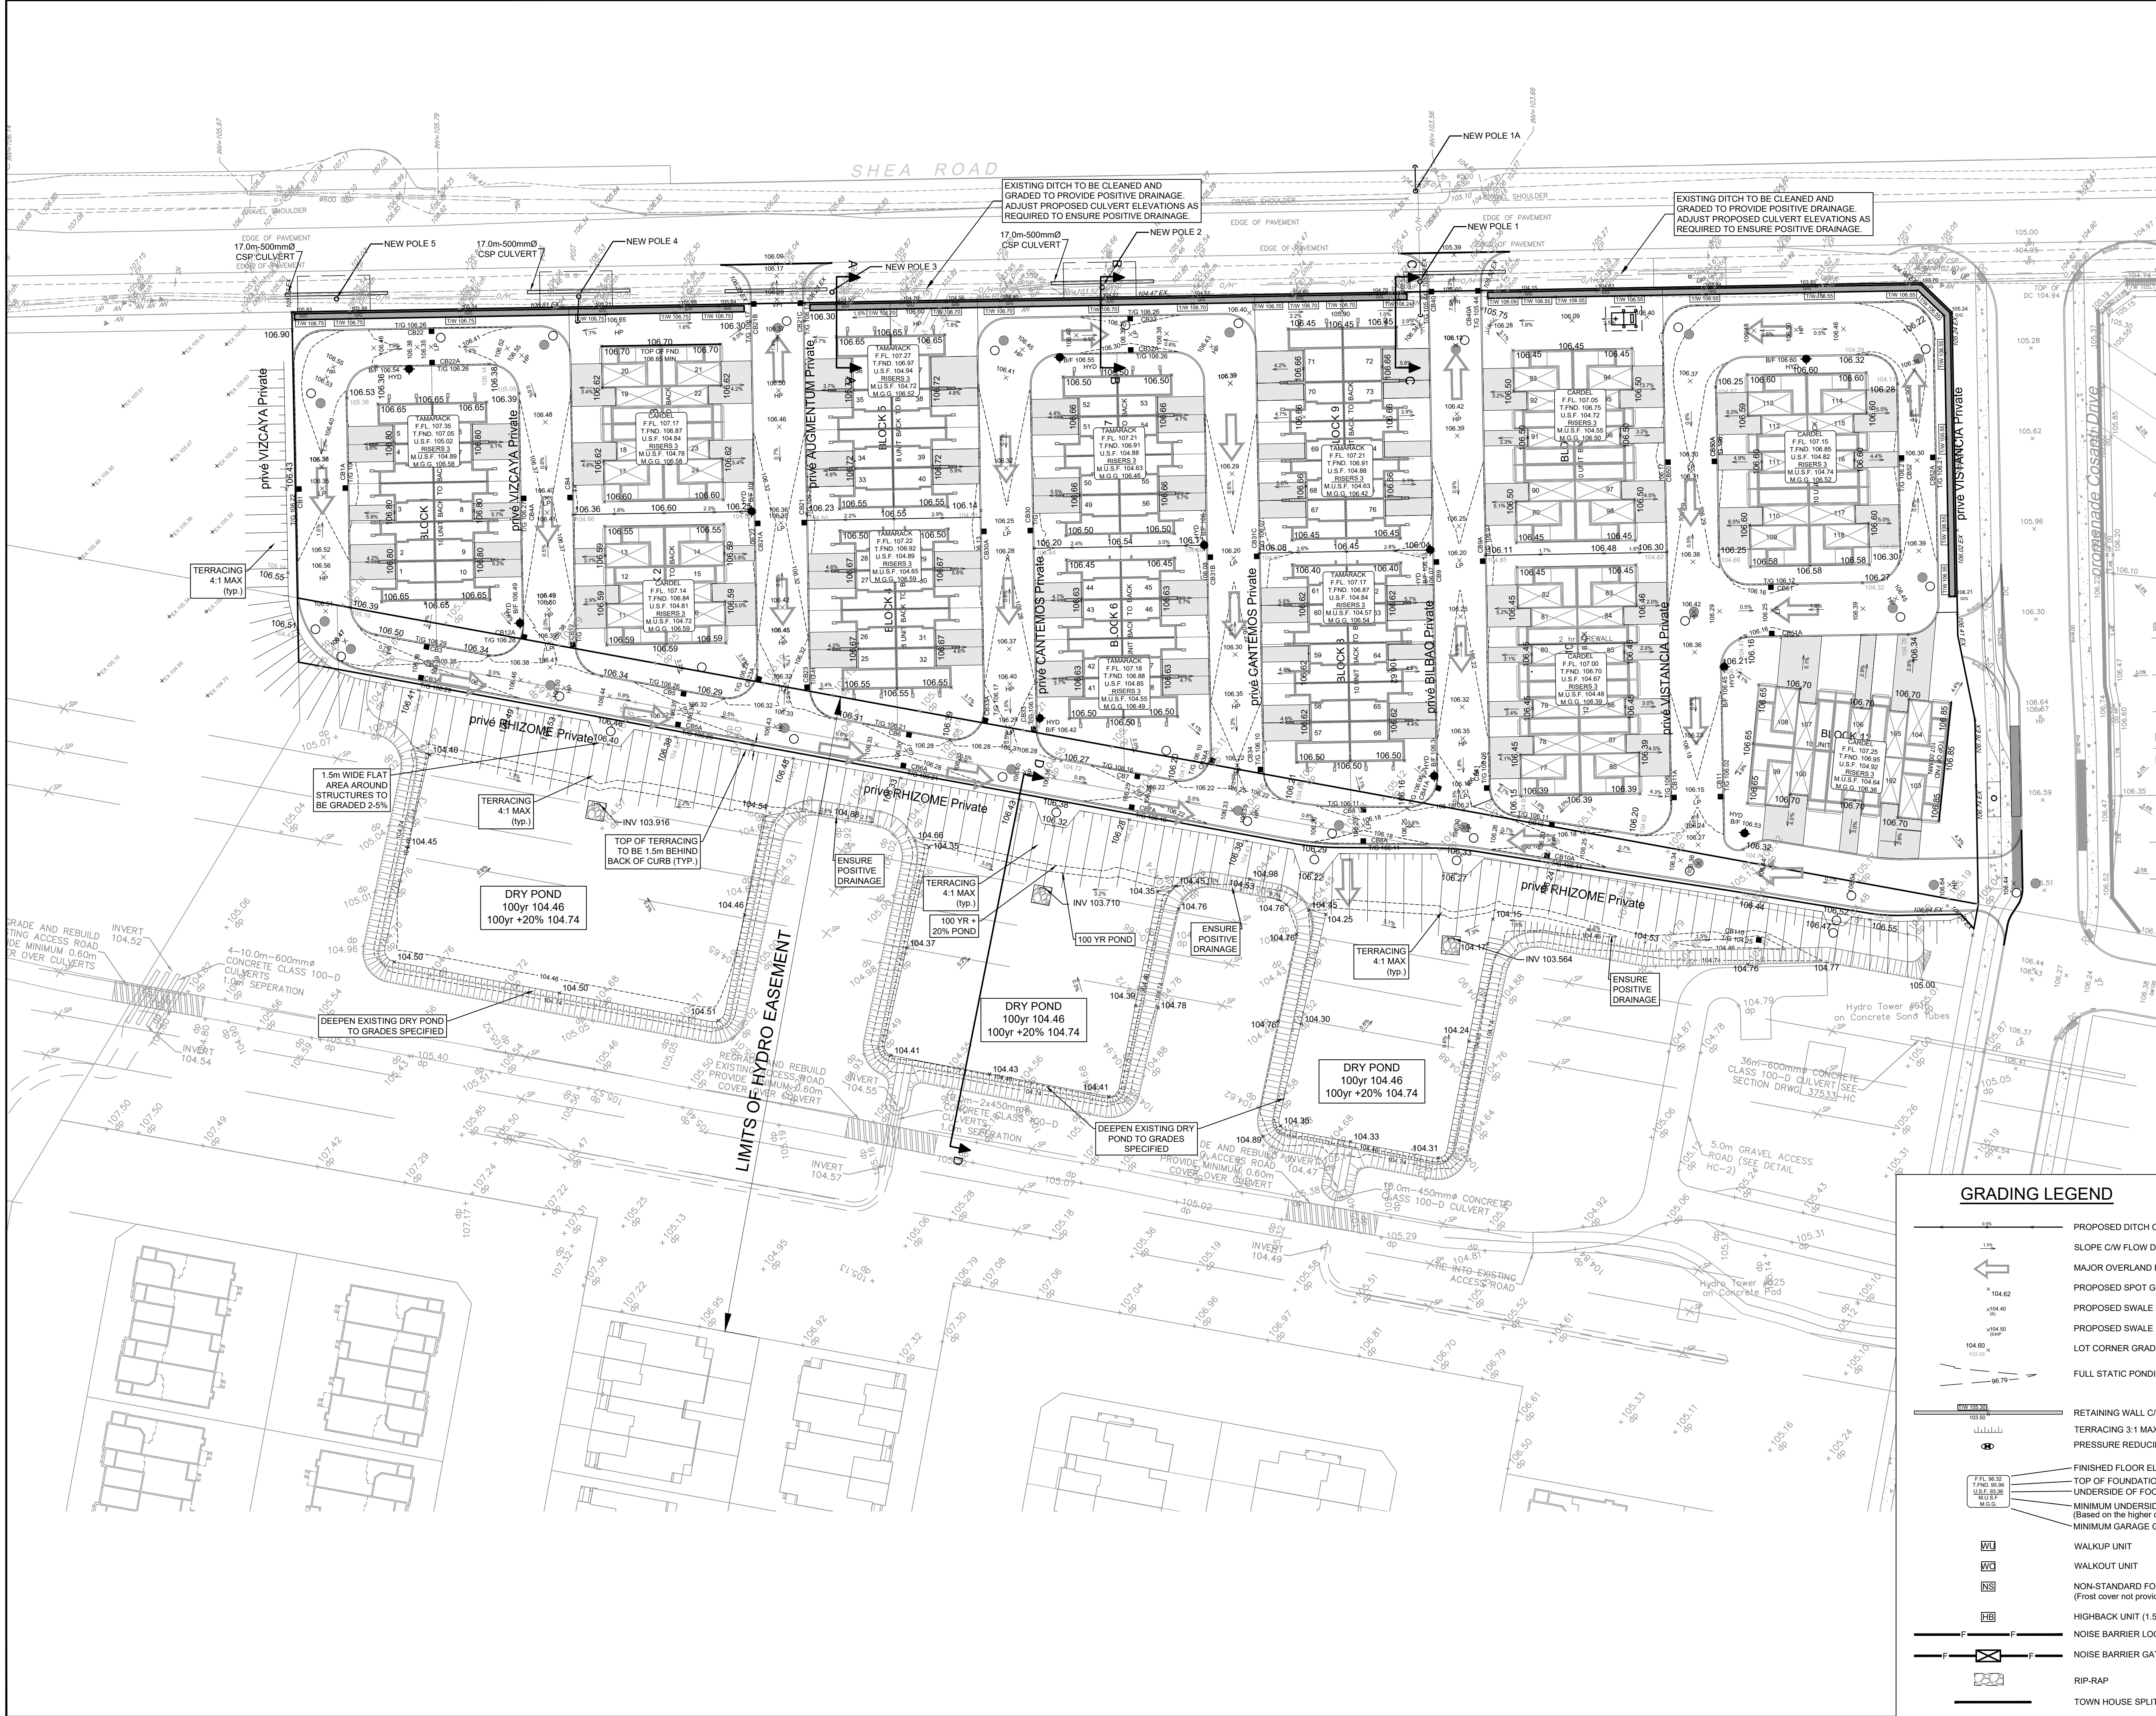


CLIENT
**DAVIDSON SHEA
 PROPERTY INC.**

COPYRIGHT
 This drawing has been prepared solely for the intended use. Any reproduction or distribution for any purpose other than authorized by IBI Group is forbidden. Written dimensions shall have precedence over scaled dimensions. Contractors shall verify and be responsible for all dimensions and conditions on the job, and IBI Group shall be informed of any variations from the dimensions and conditions shown on the drawing. Shop drawings shall be submitted to IBI Group for general concurrence before proceeding with fabrication.


IBI Group Professional Services (Canada) Inc.
 is a member of the IBI Group of companies.

ISSUES	No.	DESCRIPTION	DATE
	1	SUBMISSION NO. 1 FOR CITY REVIEW	2022-09-15
	2	SUBMISSION NO. 2 FOR CITY REVIEW	2024-06-27
	3	REVISION PER CITY COMMENTS	2025-03-21
	4	REVISED CADD GRADING RELATIONSHIPS	2025-06-18
	5	SUBMISSION NO. 4 FOR CITY REVIEW	2025-07-31
	6		
	7		
	8		

SEE 010, 011 FOR NOTES, LEGEND, CB TABLE, STREET SECTIONS AND DETAILS

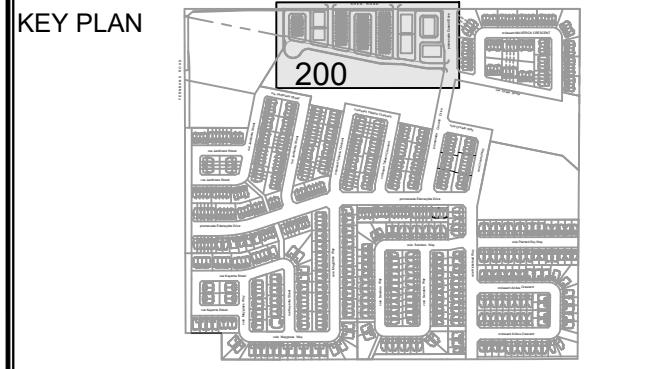

CONSULTANTS

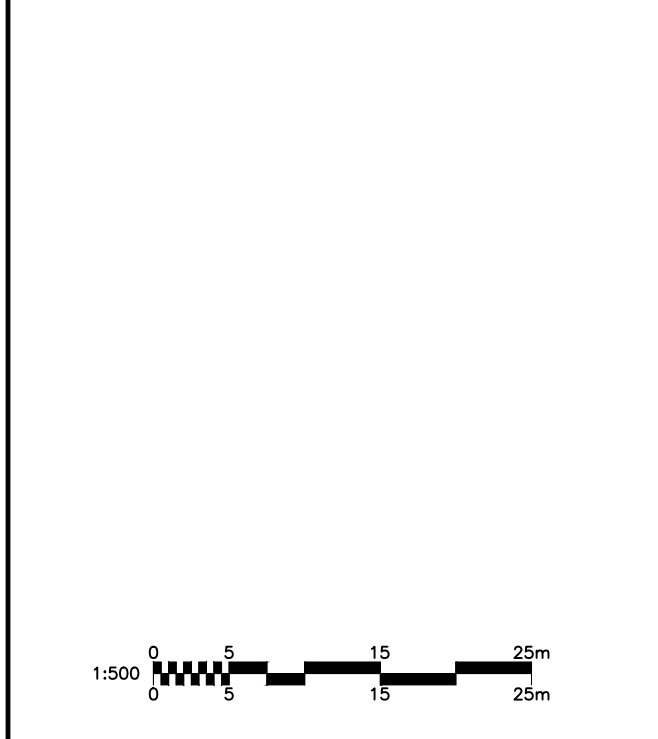

SEAL

GRADING LEGEND	
	PROPOSED DITCH C/W FLOW DIRECTION AND SLOPE
	SLOPE C/W FLOW DIRECTION
	MAJOR OVERLAND FLOW ROUTE
	PROPOSED SPOT GRADE
	PROPOSED SWALE GRADE
	PROPOSED SWALE HIGH POINT GRADE
	LOT CORNER GRADE C/W EXISTING GRADE
	FULL STATIC PONDING GRADE
	RETAINING WALL C/W TOP OF WALL AND GRASS GRADE
	TERRACING 3:1 MAXIMUM UNLESS NOTED OTHERWISE
	PRESSURE REDUCING VALVE
	FINISHED FLOOR ELEVATION
	TOP OF FOUNDATION ELEVATION
	UNDERSIDE OF FOOTING ELEVATION
	MINIMUM UNDERSIDE OF FOOTINGS
	MINIMUM GARAGE GRADE
	WALKUP UNIT
	WALKOUT UNIT
	NON-STANDARD FOUNDATION (Frost cover not provided for standard unit)
	HIGHBACK UNIT (1.5m frost cover on footings)
	NOISE BARRIER LOCATION
	NOISE BARRIER GATE
	RIP-RAP
	TOWN HOUSE SPLITS

IBI GROUP
 400 - 333 Preston Street
 Ottawa ON K1S 5M4 Canada
 tel 613 225 1311 fax 613 225 9868
 ibigroup.com

PROJECT
1650 SHEA ROAD
 (OTTAWA, ON)

PROJECT NO:
139185

DRAWN BY:
M.M.

PROJECT MGR:
R.M.

CHECKED BY:
R.M./D.Y.

APPROVED BY:
R.M./D.Y.

SHEET TITLE
GRADING PLAN

SHEET NUMBER
200

ISSUE
5

File Location: \\1139185_1650_Shea_Road\0_Production\02_Design\04_Civil\Shea\00-GRADING PLAN.dwg
 Last Saved: July 31, 2025, by: mihandeb
 Printed: August 5, 2025 9:42:34 AM by: Mirek, Marjan
 SCALE CHECK:

CITY FILE No. D07-12-23-0032
 CITY PLAN No. 19029