

Copyright Reserved

The Contractor shall verify and be responsible for all dimensions. DO NOT scale the drawing - any errors or omissions shall be reported to Stantec without delay.
The Copyrights to all designs and drawings are the property of Stantec. Reproduction or use for any purpose other than that authorized by Stantec is forbidden.

Legend

- PROPOSED WATERMAIN
- PROPOSED VALVE AND VALVE BOX
- PROPOSED VALVE CHAMBER
- PROPOSED W3 CHAMBER
- PROPOSED REDUCER
- PROPOSED FIRE HYDRANT
- PROPOSED SANITARY SEWER
- PROPOSED STORM SEWER
- PROPOSED CATCHBASIN MANHOLE
- PROPOSED CATCHBASIN
- EXISTING WATERMAIN
- EXISTING VALVE AND VALVE BOX
- EXISTING REDUCER
- EXISTING FIRE HYDRANT
- EXISTING COMBINED SEWER
- EXISTING STORM SEWER
- EXISTING CATCHBASIN MANHOLE
- EXISTING CATCHBASIN
- PROPOSED DEPRESSED CURB LOCATIONS
- PROPOSED BARRIER CURB
- THERMAL INSULATION ON STORM SEWERS WITH LESS THAN 2.0m COVER AND SANITARY SEWERS WITH LESS THAN 2.5m COVER TO BE INSULATED IN ACCORDANCE WITH CITY STANDARD S35. THERMAL INSULATION ON WATERMAIN WHERE COVER IS LESS THAN 2.4m AS PER W22.
- PROPOSED CLAY SEAL AS PER GEOTECH RECOMMENDATIONS

Notes

Revision	By	Appd.	YY.MM.DD	
3	REVISD PARK GRADING UPDATES	MJS	DT	26.05.15
2	30% ISSUED FOR COORDINATION	MJS	DT	25.09.19
1	REVISD AS PER CITY COMMENTS	MJS	DT	25.05.14
0	REVISD AS PER CITY COMMENTS	MJS	DT	24.09.16

File Name:	MJS	DT	MJS	24.09.12
160401663 PP KENT STREET	Dwn.	Chkd.	Dgn.	YY.MM.DD

Permit-Seal

Client/Project

BRIGIL


265 CATHERINE STREET

OTTAWA, ON

Title

PLAN AND PROFILE
KENT STREET
STN: 0+000 TO 0+120

Project No.	Scale	0 2.5 7.5 12.5m
160401663	1:250H 1:100V	
Drawing No.	Sheet	Revision
PP-1		

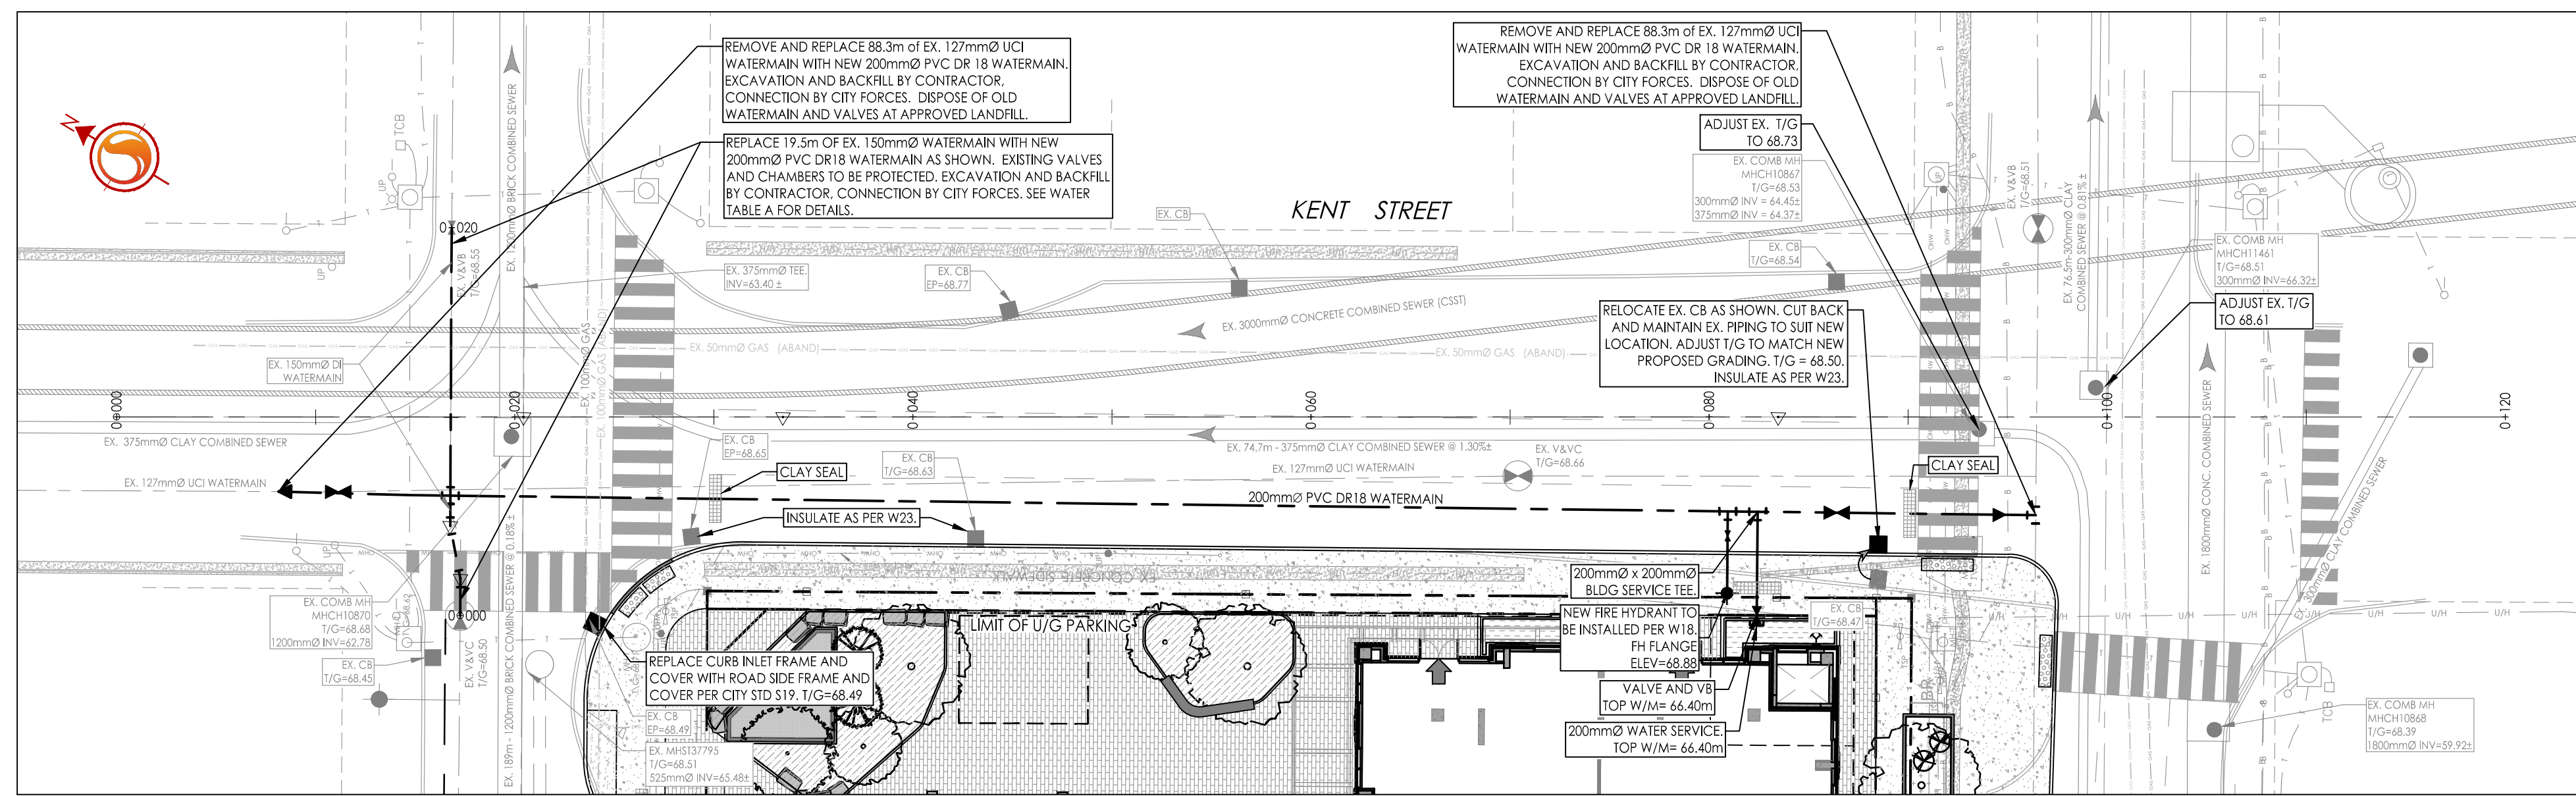

STATION	FINISHED GRADE	TOP W/M	ITEM
0+000	68.54	66.40±	EXISTING 200mmØ VALVE AND VALVE CHAMBER
0+001.9	68.55	66.150	200mmØ x 127mmØ REDUCER
0+004.6	68.67	66.270	200mmØ x 200mmØ CROSS
0+006.1	68.63	66.230	11 ±° HORIZONTAL BEND
0+010	68.65	66.250	11 ±° HORIZONTAL BEND
0+019.5	68.55	66.45±	EXISTING 200mmØ VALVE AND VALVE BOX

