CITY OF OTTAWA

LANSDOWNE PARK EVENT CENTRE
OTTAWA, ON
SERVICING REPORT

MARCH 07, 2025
REVISION 3

LANSDOWNE PARK EVENT CENTRE
OTTAWA, ON

SERVICING STUDY

CITY OF OTTAWA

PROJECT NO.: CA0033920.1056
DATE: MARCH 07, 2025

WSP
SUITE 300
2611 QUEENSVIEW DRIVE
OTTAWA, ON, CANADA, K2B 8K2

T: +1 613 829-2800
F: +1 613 829-8299
WSP.COM

March 07, 2025

City of Ottawa

Attention: Sean Moore

Dear Sir:

Subject: Lansdowne 2.0 Event Centre Development for Site Plan Control Application

We are pleased to deliver this enclosed servicing report in support of the application for Site Plan Control for the subject Lansdowne 2.0 Phase 1 – New Event Centre. This report details the water and sanitary demands for the proposed development in coordination with the existing site and future phased works.

Should there be any questions or comments regarding this report, please do not hesitate to contact the undersigned.

Yours sincerely,



Winston Yang, P.Eng.
Lead Engineer – Technical Lead
Land Development & Municipal
Engineering, Ontario

WSP ref.: CA0033920.1056

SIGNATURES

PREPARED BY




Zarak Ali, EIT
Civil Designer

March 07th, 2025
Date

APPROVED BY



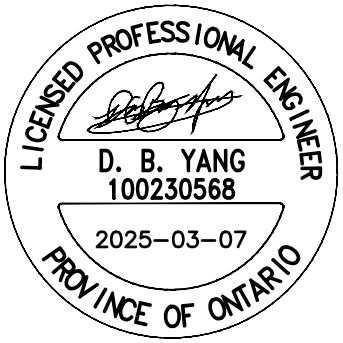

Winston Yang, P.Eng., PMP
Lead Engineer – Technical Lead

March 07th, 2025
Date

WSP Canada Inc. prepared this report solely for the use of the intended recipient, City of Ottawa, in accordance with the professional services agreement. The intended recipient is solely responsible for the disclosure of any information contained in this report. The content and opinions contained in the present report are based on the observations and/or information available to WSP Canada Inc. at the time of preparation. If a third party makes use of, relies on, or makes decisions in accordance with this report, said third party is solely responsible for such use, reliance or decisions. WSP Canada Inc. does not accept responsibility for damages, if any, suffered by any third party as a result of decisions made or actions taken by said third party based on this report. This limitations statement is considered an integral part of this report.

The original of this digital file will be conserved by WSP Canada Inc. for a period of not less than 10 years. As the digital file transmitted to the intended recipient is no longer under the control of WSP Canada Inc., its integrity cannot be assured. As such, WSP Canada Inc. does not guarantee any modifications made to this digital file subsequent to its transmission to the intended recipient.

TABLE OF CONTENTS

1 GENERAL 1

1.1 EXECUTIVE SUMMARY 1

1.2 DATE AND REVISION NUMBER 1

1.3 LOCATION MAP AND PLAN 2

1.4 Adherence to zoning and related requirements 2

1.5 Pre-Consultation meetings 2

1.6 Higher level studies 2

1.7 Statement of objectives and servicing criteria 3

1.8 Available existing and proposed infrastructure 3

1.9 Environmentally significant areas, watercourses and municIpal drains 3

1.10 Concept level master grading plan 4

1.11 Impacts on private services 4

1.12 Development phasing 4

1.13 Geotechnical study 4

1.14 Drawing requirement 4

2 WATER DISTRIBUTION 5

2.1 Consistency with ZBLA Functional Servicing and Stormwater Management study 5

2.2 System constraints and boundary conditions 6

2.3 Confirmation of adequate domestic supply and pressure 8

2.4 CONFIRMATION OF ADEQUATE Fire Flow Protection 10

2.5 Check of High Pressure 11

2.6 Phasing constraints 11

2.7 Reliability requirements 11

2.8 Need for pressure zone boundary modification 11

2.9 Capability of major infrastructure to supply sufficient water 12
2.10 Description of proposed water distribution network 12
2.11 Off-site requirements 12
2.12 Calculation of water demands 12
2.13 Model Schematic 12
3 WASTEWATER DISPOSAL 13
3.1 Design Criteria 13
3.2 Consistency with ZBLA Functional Servicing and Stormwater Management study 13
3.3 Review of Soil conditions 13
3.4 Description of existing sanitary sewer 14
3.5 Verification of available capacity in downstream sewer 14
3.6 Calculations for New sanitary sewEr 14
3.7 Description of proposed sewer network 14
3.8 Environmental constraints 14
3.9 Pumping requirements 14
3.10 Forcemains 14
3.11 Emergency overflows from sanitary pumping stations 14
3.12 Special considerations 15
4 SITE STORM SERVICING 16
4.1 Existing Condition 16
4.2 Analysis of availabLe capacity in public infrastructure 16
4.3 Drainage drawing 16
4.4 Water quantity control objective 16

4.5 Water quality control objective 16
4.6 Design criteria 16
4.7 Proposed minor system 17
4.8 Stormwater management 17
4.9 Inlet Controls 17
4.10 On-site detention 17
4.11 Watercourses 17
4.12 Pre and Post development peak flow rates 18
4.13 Diversion of drainage catchment areas 18
4.14 Downstream capacity where quanTity control is not proposed 18
4.15 Impacts to receiving watercourses 18
4.16 Municipal drains and related approvals 18
4.17 Means of conveyance and storage capacity 18
4.18 Hydraulic analysis 18
4.19 Identification of floodplains 18
4.20 Fill constraints 18

5 SEDIMENT AND EROSION CONTROL 19
5.1 General 19

6 APPROVAL AND PERMIT REQUIREMENTS 20
6.1 General 20

7 CONCLUSION CHECKLIST 21
7.1 Conclusions and recommendations 21
7.2 Comments received from review agencies 21

TABLES

TABLE 2-1: FIRE HYDRANT TESTING RESULTS.....5
TABLE 2-2: WATER DEMAND AND BOUNDARY CONDITIONS EXISTING CONDITIONS FROM DSEL'S ANALYSIS 6
TABLE 2-3: WATER DEMAND AND BOUNDARY CONDITIONS PROPOSED CONDITIONS 6
TABLE 2-4: LANSDOWNE SITE WATER DEMANDS BREAKDOWN PER BUILDING.....7
TABLE 2-5: EXISTING AND PROPOSED WATER DEMANDS AND FUS FOR PHASE 1 AND PHASE 2. 8
TABLE 2-6: FIRE SERVICE PIPE SIZING AND PRESSURE CHECK FOR EVENT CENTRE AND NORTH SIDE STAND 10
TABLE 2-7: DOMESTIC SERVICE PIPE SIZING AND PRESSURE CHECK FOR EVENT CENTRE AND NORTH SIDE STAND 10

FIGURES

FIGURE 1-1 LANSDOWNE SITE LOCATION.....2

APPENDICES

A

- CITY AND NCC COMMENTS
- LANSDOWNE CIVIL DRAWINGS - STANTEC
- CONCEPTUAL ARCHITECTUAL PLAN
- AS-BUILT DRAWINGS
- TOPOGRAPHICAL SURVEY PLAN

B

- BOUNDARY CONDITIONS
- CORRESPONDENCE

- FIRE FLOW CALCULATION FOR BUILDINGS
- EXISTING WATER DEMAND CALCULATION
- HYDRAULIC ANALYSIS
- FIRE HYDRANT TEST RESULTS
- HYDRANT COVERAGE FIGURE

C

- STORM SEWER DESIGN SHEET
- DWG C08 – STORM DRAINAGE AREA PLAN
- EXISTING STORM SEWER DESIGN SHEET AND DRAINAGE AREA PLAN BY STANTEC
- SANITARY SEWER DESIGN SHEET
- EXISTING SANITARY DESIGN SHEET BY DSEL
- CORRESPONDANCE
- DWG C04 – GRADING PLANS
- DWG C05A/C05B – SERVICING PLANS

D

- DWG C06 – EROSION AND SEDIMENTATION CONTROL PLAN

1 GENERAL

1.1 EXECUTIVE SUMMARY

Following the Zoning By-Law Amendment submission in September 2023, the Lansdowne Park redevelopment project (Lansdowne 2.0) entered the Site Plan Control Application stage. WSP was again retained by the City of Ottawa to provide servicing, grading and stormwater management design services for the phase 1 (Event Centre) development of the project for Site Plan Control Application.

The Lansdowne site is home to many commercial, residential, and leisure facilities. This includes TD place Stadium, Aberdeen Pavilion, Horticultural Building, mixed-use retail/office/residential, and a subsurface parking lot. The overall site is approximately 15.4 ha, and borders Bank Street to the west, Holmwood Ave to the north, and Queen Elizabeth Drive to the south and east.

The overall proposed redevelopment of Lansdowne Park is divided into 3 phases: Phase 1 includes a new event centre and landscaping/south stands modifications, Phase 2 involves the reconstruction of the north stands and Grand Stairs, and Phase 3 is for a future commercial/residential block containing probably two residential towers and retail space. This report pertains to the overall infrastructure upgrades except watermain due to Lansdowne 2.0 redevelopment and specifically to Phase 1, the design of the Event Centre, Great Lawn, and other landscaping modifications. See Appendix A for the architectural design upon which this report is based.

The site is located in the City of Ottawa per the Topographic Sketch of Lansdowne Park dated June 2024 and completed by Stantec Geomatics Ltd. Based on the topographic survey, the site slopes from the existing berm to the great lawn and the swale on the south side of the site. The existing Lansdowne site has been previously developed to convey flow to various underground tanks and the existing Great Lawn for detention. The private storm network eventually discharges to a 1050mm storm sewer on O'Connor Street. And runoff will drain overland to the Queen Elizabeth Drive exceeding 100 year event.

Design of a drainage and stormwater management system in this development must be prepared in accordance with the following documents:

- Sewer Design Guidelines, City of Ottawa, October 2012;
- Stormwater Management Planning and Design Manual, Ministry of the Environment, March 2003; and
- Stormwater Management Facility Design Guidelines, City of Ottawa, April 2012

This report was prepared utilizing servicing design criteria obtained from the City of Ottawa and outlines the design for water, sanitary wastewater, and stormwater facilities, including stormwater management.

The format of this report matches that of the servicing study checklist found in Section 4 of the City of Ottawa's Servicing Study Guidelines for Development Applications, November 2009.

It is proposed that:

- On-site stormwater management systems, employing underground storage will be provided to attenuate flow rates leaving the site area to be redeveloped. Existing drainage patterns, previously established controlled flow rates and storm sewers will be maintained.
- The on-site storm and sanitary pipes will be re-routed around the proposed Event Centre and previously established conveyance patterns will be maintained.

1.2 DATE AND REVISION NUMBER

This version of the report is the fourth issue (3rd revision), dated March 07th, 2025.

1.3 LOCATION MAP AND PLAN

The proposed development is located at 1015 Bank Street, Ottawa, Ontario at the location shown in Figure 1-1 below.



Figure 1-1 Lansdowne Site Location

1.4 ADHERENCE TO ZONING AND RELATED REQUIREMENTS

The proposed property use will be in conformance with zoning and related requirements prior to approval and construction and is understood to be in conformance with current zoning.

1.5 PRE-CONSULTATION MEETINGS

Outstanding comments from the ZBLA stage and updated engineering comments were provided July 26, 2024. These comments are provided in Appendix A for reference.

1.6 HIGHER LEVEL STUDIES

The review for servicing has been undertaken in conformance with, and utilizing information from, the following documents:

- Ottawa Sewer Design Guidelines, Second Edition, Document SDG002, October 2012, City of Ottawa including:
    - Technical Bulletin ISDTB-2012-4 (20 June 2012)
    - Technical Bulletin ISDTB-2014-01 (05 February 2014)
    - Technical Bulletin PIEDTB-2016-01 (September 6, 2018)
    - Technical Bulletin ISDTB-2018-01 (21 March 2018)

- Technical Bulletin ISDTB-2018-04 (27 June 2018)

- Ottawa Design Guidelines – Water Distribution, July 2010 (WDG001), including:

  - Technical Bulletin ISDTB-2014-02 (May 27, 2014)
  - Technical Bulletin ISTB-2018-02 (21 March 2018)

- Stormwater Management Planning and Design Manual, Ontario Ministry of the Environment and Climate Change, March 2003 (SMPDM).

- Functional Servicing and Stormwater Management Report for Lansdowne Live Ottawa Sports and Entertainment Group, Project No. 09-378, January 2012, by DSEL.

- Stormwater Management Design Report for Lansdowne Urban Park, February 2012, by Stantec Consulting Ltd.

- Functional Servicing and Stormwater Management Study for Lansdowne Park Redevelopment 2.0, Project No. CA0000286.1662, September 2023, by WSP.

- Stormwater Management Design Report for Lansdowne Park Event Centre, Report No.CA0033920.1056, January 2025, by WSP.

- Geotechnical Investigation – Proposed Event Centre Lansdowne Park Redevelopment, Report No. PG6655-1, May 2024, by Patterson Group.

- Fire Underwriters Survey, Water Supply for Public Fire Protection (FUS), 2020.

1.7 STATEMENT OF OBJECTIVES AND SERVICING CRITERIA

The objective of the site servicing is to meet the requirements for the proposed modification of the site while adhering to the stipulations of the applicable higher-level studies and City of Ottawa servicing design guidelines. The current phase of the site plan includes a new Event Centre building, a modified Great Lawn and south stands and other landscape features.

1.8 AVAILABLE EXISTING AND PROPOSED INFRASTRUCTURE

The site is currently serviced by a network of watermain, storm, and sanitary sewers constructed during the Lansdowne 1.0 redevelopment project completed between 2012 and 2015. The Sport and Entertainment Group provided an as-built services and grading plan after its completion, contained in Appendix A.

Based on the previous design information by DSEL and Stantec, portable water supply is available within the site, and there should be adequacy fire protection supply. The existing Lansdowne Park has a peak dry weather flow of 42.1 L/s and wet weather flow of 45.3 L/s. The existing minor storm system has been designed to convey all storms up to and including a 5-year storm event and detention up to and including a 100-year storm event has also been designed and provided on site with the use of existing subsurface tank and surface ponding within the existing Great Lawn.

Due to the placement of the Event Centre building and the modification to the Great Lawn area, it is proposed to internally reroute the on-site storm, sanitary and watermain infrastructure around the Event Centre footprint to service the redevelopment. In addition, it is proposed to flatten the Great Lawn in Lansdowne 2.0 and introduced a large new underground chamber that will be interconnected to the existing underground chamber to provide additional stormwater storage in place of the Great Lawn to accommodate the increased of imperviousness due to Lansdowne 2.0 redevelopment.

1.9 ENVIRONMENTALLY SIGNIFICANT AREAS, WATERCOURSES AND MUNICIPAL DRAINS

Rideau Canal is south to the Lansdowne site. From the previous design or the existing condition before Lansdowne 1.0 development, an outlet to the Rideau Canal exist. But the outlet to the Canal is no longer in used as per the current finding. And this outlet will be completely abandoned and removed to accommodate the changes for the proposed Lansdowne 2.0 redevelopment. Thus, the proposed changes to the site will not require any additional approvals or amendments to approvals pertaining to environmentally significant areas, watercourses or municipal drains.

1.10 CONCEPT LEVEL MASTER GRADING PLAN

As the design is being submitted for site plan approval, the grading plan has been developed for the Phase 1 modifications. The existing and proposed grading are shown on drawing C04 (Grading Plan). Existing grading information is based on the topographic survey of the site completed in June 2024. No changes in grading are proposed beyond the redevelopment area boundaries. The proposed grading plan confirms the feasibility of the proposed stormwater management system, drainage, soil removal and fills. The geotechnical investigation was completed in 2024 by Patterson Group. The grading along the redevelopment extents is proposed to meet the existing grade.

1.11 IMPACTS ON PRIVATE SERVICES

There are no existing domestic private services (septic system and well) located on the site. There are no neighbouring properties using private services.

The existing on-site storm, sanitary and watermain services will be re-routed around the Event Centre and connect back into the existing on-site systems just south of the Aberdeen Pavilion. The overall site drainage system will remain unaffected. The drainage areas around the modified Great Lawn will be modified based on the proposed grading and addition of a new underground storage chamber. Ultimately, all of the flows will still be conveyed through the same downstream on-site storm sewer system.

1.12 DEVELOPMENT PHASING

As previously mentioned, the redevelopment of Lansdowne 2.0 will be completed in 3 phases. This report focuses on phase 1 (New Event Centre, modified Great Lawn and surrounding landscaped areas). However, the civil design of storm conveyance, stormwater management and wastewater take into consideration the ultimate design/demands (i.e. all 3 phases are taking into account). Upgrading the existing watermain network for phase 1 and 2 is not anticipated since the domestic water demand for New Event Centre and New North Side Stands are assumed to be equal to or less than compared to existing condition, and the fire flow is less than existing. For phase 3, hydraulic analysis for the watermain network might be considered depending on the detail design of future residential and commercial development.

1.13 GEOTECHNICAL STUDY

A geotechnical investigation report was previously prepared by Patterson Group. on May 30, 2024. No additional geotechnical information was required for the design of the modified site services, including paving. This geotechnical report will be included with the contract documents to be issued for construction, and the recommendations of the reports will be referenced in the construction specifications. The geotechnical study specifies a design recommendation based on a maximum groundwater elevation of 60.78m.

1.14 DRAWING REQUIREMENT

The engineering plans submitted for site plan approval will be in compliance with City requirements.

2 WATER DISTRIBUTION

2.1 CONSISTENCY WITH ZBLA FUNCTIONAL SERVICING AND STORMWATER MANAGEMENT STUDY

Lansdowne Park resides within the City of Ottawa 1W Pressure Zone. Water supply is delivered to the subject property through existing 300mm on Bank Street, 400mm on Holmwood Ave and 200mm on Fifth Ave.

The existing on site 200mm watermain is proposed to be rerouted around and within the new addition (Event Centre) since it lays in the new addition's footprint. The Event Centre building's services (2 services will be required since the average day demands are greater than 50 m^3/day) are proposed to connect to the on-site 200mm watermain. The new Event Centre will be protected with a fully supervised and automatic fire protection system sprinkler system. The water service system includes a water flow and control valve alarm service. Refer to Appendix B for correspondence from the mechanical engineer. The fire department connection is located near the main entrance on the north side of the building.

No changes are required to the existing City water distribution system to allow servicing for this property.

The Ottawa Sports and Entertainment Group have completed fire hydrant testing on site in September 2022. Table 2-1 summarizes the results of the hydrant testing. The associated hydrant testing results are located Appendix B.

Table 2-1: Fire Hydrant Testing Results

Hydrant Location	Color Code	Static Pressure (psi)	Dynamic Pressure (psi)	Pitot Pressure (psi)	Measured Flow (Gallons/min L/s)	Available Fire Flow at 20 psi (Gallons/min L/s)
Apartment Facing Field	Blue	68	62	39	875/55.0	2689/169.7
Back Entrance	Blue	70	62	44	929/58.6	2499/157.7
Behind Apartment (Bank St)	Blue	70	61	41	897/56.6	2264/142.8
Behind Apartment (Parkway)	Blue	70	62	38	863/54.5	2323/146.6
Box Office	Blue	68	62	42	908/57.3	2790/176.0
Cattle Castle	Blue	70	62	38	863/54.5	2323/146.6
Cineplex	Blue	66	61	38	863/54.5	2739/172.8
Filed Entrance*	Blue	70	60	39	875/55.2	2086/131.6
On Field*	Blue	70	62	43	918/57.9	2471/155.9
Goodlife*	Blue	67	60	37	852/53.8	2382/150.3

Milestones*	Blue	67	62	34	817/51.5	2739/172.8
Sporting Life	Blue	65	58	41	897/56.6	2450/154.6

*Fire hydrants proposed to meet the fire flow demands of the Event Centre and North Side Stands.

2.2 SYSTEM CONSTRAINTS AND BOUNDARY CONDITIONS

The existing water supply network is shown on As-Built Site Servicing Plan C01003 by DSEL. Boundary condition from the Lansdowne 1.0 post development is summarized below. A conservative estimate for the required fire supply of 9,000 L/min (150 L/s) was used for the analysis. Table 2-2 summarizes the DSEL anticipated water demands and boundary conditions under existing conditions.

Table 2-2: Water Demand and Boundary Conditions Existing Conditions from DSEL's analysis

Design Parameter	Existing Demand (L/s)	Boundary Condition (Hydraulic m/kPa)
Average Daily Demand	11.8	115.6/481.7
Max Day + Fire Flow	19.9+150=169.9	106.4/391.4
Peak Hour	38.0	103.1/359.0

*Boundary conditions supplied by the City of Ottawa during Lansdowne 1.0. Assumed ground elevation 65.50m.

This report will focus on the existing total site and future total site water demands. Due to the lack of information for Phase 3, a hydraulic check should be conducted at the beginning of Phase 3 design to determine if modification to the existing watermain network is required.

A boundary request for the proposed Lansdowne 2.0 development for the entire site has been submitted to the City on December 11, 2024, based on the recent fire flows and domestic demands for the total site. It is assumed that the future demand from the Lansdowne 2.0 development (phase 1 and 2 only) will be equal to or less than the demand of the existing system. The existing system's real-world demands were determined from the provided actual metering data as described below. The purpose of this exercise is to ensure the pre and post water pressure are consistent from the existing water network. The new Event Centre and North Side Stands have fire flow demands of 5000 L/min (83 L/s) and 6000 L/min (100 L/s), respectively. Refer to Appendix B for the fire flow calculations. Note that the fire flow of 150 L/s (as per existing conditions) was used to analyze the Lansdowne 2.0 development as this is more conservative, and thus, is why it was provided for boundary conditions.

Table 2-3 summarizes the anticipated Water Demands (per metering data) and Boundary Conditions under proposed conditions.

Table 2-3: Water Demand and Boundary Conditions Proposed Conditions

Design Parameter	Proposed Demand (L/s)	Boundary Condition 1 (Hydraulic m/kPa)	Boundary Condition 2 (Hydraulic m/kPa)
Average Daily Demand	5.41	114.6/481.4	114.6/465.7
Max Day + Fire Flow	13.52+150=163.52	107.8/414.7	106.5/386.3
Peak Hour	29.73	105.7/394.1	105.6/377.5

*Boundary conditions supplied by the City of Ottawa. Assumed ground elevation 65.50m at Connection 1 and 67.10m at Connection 2. See Appendix B for detail boundary condition.

As demonstrated in Table 2-2 and 2-3, the pressure range is similar during Maximum Day plus Fire Flow as well as Peak Hour demands. Therefore, the existing water supply is available per the design requirement and conforms to all relevant City Guidelines and Policies.

For the purposes of determining accurate water demands for the ultimate condition, it has been assumed that the existing average day demands derived from the OSEG CARMA metering data for 2023 and 2024 will be equivalent, or greater than, the ultimate condition demands (see Appendix B for correspondence with the City of Ottawa regarding the use of metering data to determine the total site water demands and the OSEG CARMA metering data spreadsheet).

Based on the 12-month average of the November to December 2023 Metered Total readings in the OSEG CARMA Metering data and the January to October 2024 Metered Total readings, an average water consumption of 14,012,838 L/month was calculated. This is equivalent to 5.41 L/s. As per the City correspondence, 5.41 L/s and residential peaking factors is acceptable as the average day demand for the total site. The water demands for the entire site are as follows:

Average Day Demand = 5.41 L/s
Max. Day Demand = Average Day Demand x 2.5 (Residential Peaking Factor)
= 5.41 L/s x 2.5
= 13.52 L/s
Peak Hour Demand = Max. Day Demand x 2.2 (Residential Peaking Factor)
= 13.53 L/s x 2.2
= 29.73 L/s

As previously stated, the fire flow of 150 L/s was used in the boundary condition request for the entire site to determine the adequacy of the watermain network.

The water demands of the individual buildings as per the CARMA metering report is as follows:

Table 2-4: Lansdowne Site Water Demands Breakdown per Building

Building	Avg. Day (L/mo)	Avg. Day (L/s)	Max. Day (L/s)	Peak Hour (L/s)
Abeerdeen	133,208	0.05	0.13	0.28
Horticulture	96,600	0.04	0.09	0.20
Plaza	5,975	0.00	0.01	0.01
Ice Rink	1,572,614	0.61	1.52	3.34
Bldg I	627,112	0.24	0.60	1.33
Bldg A - Condo	396,692	0.15	0.38	0.84
Bldg K	946,138	0.37	0.91	2.01
NTH Condo	376,627	0.15	0.36	0.80
Bldg A - Retail	34,866	0.01	0.03	0.07
Bldg B - Retail	785,189	0.30	0.76	1.67
Bldg C - Retail	765,755	0.30	0.74	1.62
Bldg D - Retail	477,617	0.18	0.46	1.01
Bldg G - Retail	1,240,308	0.48	1.20	2.63

Bldg H - Retail	992,625	0.38	0.96	2.11
Bldg J - Civil Centre	659,273	0.25	0.64	1.40
North Stands	3,780,750	1.46	3.65	8.02
South Stands	987,500	0.38	0.95	2.10
Stadium Public Realm	133,990	0.05	0.13	0.28
Total	**14,012,838**	**5.41**	**13.52**	**29.73**

2.3 CONFIRMATION OF ADEQUATE DOMESTIC SUPPLY AND PRESSURE

Existing water demands are based on existing information that was used in Lansdowne 1.0. The existing (Lansdowne 1.0) and proposed (Lansdowne 2.0) condition total site demands are listed in Table 2-5. As shown in the table, the Lansdowne 2.0 demands, as determined from the CARMA metering report, are lower than the DSEL approved demands. Since it is assumed that the ultimate demands will be less than or equal to the existing (CARMA metering) demands, therefore, the existing watermain network should be adequate to support the proposed developments. Refer to Appendix B for detail existing demands (as used in Lansdowne 1.0) calculation provided by DSEL.

Table 2-5: Existing and Proposed Water Demands and FUS for Phase 1 and Phase 2.

	Avg Day (L/s)	**Max Day (L/s)**	**Peak HR (L/s)**	**FUS (L/s)**
Lansdowne 1.0 Demands (as per DSEL calculations)	11.8	19.9	38.0	150
Lansdowne 2.0 Demands (as per OSEG CARMA Metering Data)	5.41	13.52	29.73	150*

*FUS as per existing Lansdowne Park Building Service Summary by DSEL (Appendix B) to be conservative.

The 2010 City of Ottawa Water Distribution Guidelines stated that the preferred practice for design of a new distribution system is to have normal operating pressures range between 345 kPa (50 psi) and 552 kPa (80 psi) under maximum daily flow conditions. Other pressure criteria identified in the guidelines are as follows:

Minimum Pressure	Minimum system pressure under peak hour demand conditions shall not be less than 276 kPa (40 psi)
Fire Flow	During the period of maximum day demand, the system pressure shall not be less than 140 kPa (20 psi) during a fire flow event.
Maximum Pressure	Maximum pressure at any point the distribution system shall not exceed 689 kPa (100 psi). In accordance with the Ontario Building/Plumbing Code, the maximum pressure should not exceed 552 kPa (80 psi). Pressure reduction controls may be required for buildings where it is not possible/feasible to maintain the system pressure below 552 kPa.

To demonstrate the proposed service connections are able to provide the required building fire sprinkler and peak hour demand, conservative approach has been taken into account that the watermain analysis would not be looped or interconnected. The residual pressure for the proposed building is calculated by subtracting the total headloss from the residual pressure measured on the two connections on Holmwood Ave and Bank Street from City Boundary Condition.

The flow capacity of a water pipe is commonly modelled by the Hazen-Williams equation to confirm the physical properties of the pipe and the pressure drop caused by friction:

$$H_L = \frac{10.67 * L * Q^{1.852}}{C^{1.852} * D^{4.87}}$$

Where: Q is volumetric flow rate
C is the Hazen-Williams friction coefficient
L is the pipe length
D is the pipe diameter
H_L is the friction head loss

Sample calculation for residual pressure at Event Centre using Connection 1 and the Max. Day plus Fire Flow condition:

C = 110 (204mm diameter PVC pipe)
D = 0.205 m
Pipe Length = 395 m
Flow = 83 L/s + 13.52 L/s (use total site flow to be conservative)
= 97 L/s
= 0.097 m^3/s

Friction Head Loss is determined as follows:

$$H_L = \frac{10.67 * L * Q^{1.852}}{C^{1.852} * D^{4.87}}$$

$$H_L = \frac{10.67 * 395\ \text{m} * \left(\frac{0.097\ m^3}{s}\right)^{1.852}}{(110)^{1.852} * (0.204\ m)^{4.87}}$$

$$H_L = 21.17\ \text{m}$$

Total Head Loss = Friction Head Loss + Static Head (elevation different between boundary condition and building)
= 21.17 m + 1.80 m
= 22.97 m

Residual Pressure = Ex. Residual Pressure – Total Head Loss
= 415 kPa – (22.97 m * 9.81)
= 190 kPa > 140 kPa

Residual pressure and pipe sizing check are summarized as shown in Table 2-6 and Table 2-7 in respect to the provided boundary condition. Refer to Appendix B for detail water services sizing and pressure analysis.

Table 2-6: Fire Service Pipe Sizing and Pressure Check for Event Centre and North Side Stand

	Event Centre		North Side Stand	
Boundary Condition	Connection 1	Connection 2	Connection 1	Connection 2
Max Day + Fire Flow (l/s)	83.6	83.6	103.7	103.7
Existing Residual Pressure (kPa)	415	386	415	386
Length (m)	395	415	360	125
Total Headloss (kPa)	225	220	261	94
Residual Pressure for Site (kPa)	190	166	154	292

Table 2-7: Domestic Service Pipe Sizing and Pressure Check for Event Centre and North Side Stand

	Event Centre		North Side Stand	
Boundary Condition	Connection 1	Connection 2	Connection 1	Connection 2
Peak Hour (l/s)	1.40	1.40	8.02	8.02
Existing Residual Pressure (kPa)	394	378	394	378
Length (m)	395	415	360	125
Total Headloss (kPa)	41	27	26	12
Residual Pressure for Site (kPa)	353	351	368	365

The minimum water pressure inside the building at the connection is determined with the minimum HGL condition, resulting in a pressure of 351 kPa for Event Centre and 365 kPa for North Side Stand which exceed the minimum requirement of 276 kPa per the guidelines.

Fire flow pressure at building connection is determined with the max day + fire HGL condition resulting in a pressure of 166 kPa for Event Centre and 154 kPa for North Side Stand which exceed the minimum requirement of 140 kPa during a fire flow event.

And based on the on-site hydrant flow test, the residual pressures of both hydrants that will be used to service the Event Centre (Field Entrance and On Field) are 414 kPa and 427 kPa, respectively. Thus, the hydrants meet the requirements for minimum system pressure. The measured hydrant flow at 20 psi were 2086 gpm (131.6 l/s) and 2471 gpm (155.9 l/s), respectively, which is greater than the existing hydrant maximum rating of 95 L/s.

2.4 CONFIRMATION OF ADEQUATE FIRE FLOW PROTECTION

The fire flow rate has been calculated using the Fire Underwriters Survey (FUS) method. The method takes into account the type of building construction, the building occupancy, the use of sprinklers and the exposures to adjacent structures.

Assuming fire resistive construction for North Side Stands and Event Centre and a fully supervised sprinkler system, the following have been determined: Fire flow demand of 6,000 l/min (100 l/s) for the North Side Stands and fire flow demand of 5,000 l/min (83 l/s) for the Event Centre. Copies of the FUS calculation sheets are included in Appendix B.

The existing available fire flow for the nearby private hydrants at 140 kPa range from 131.6 l/s to 176.0 l/s. Each proposed building can be serviced by two or more existing fire hydrants. The combined available fire flow exceeds the required fire flow by FUS for each proposed building.

And the boundary condition for Maximum Day and Fire Flow results from Table 2-5 in a pressure of 166 kPa at the ground floor level for Event Centre and 154 kPa for North Side Stand. In the guidelines, a minimum residual pressure of 140 kPa must be maintained in the distribution system for a fire flow and maximum day event. As a pressure of 166 kPa and 154 kPa is achieved, the fire flow requirement is exceeded.

The existing fire hydrants that will be used to meet the required Event Centre's fire flow demand of 5,000 l/min (83 l/s) are located at the Field Entrance and On Field as listed on Table 2-1. These two hydrants are proposed to be slightly shifted to accommodate the new Event Centre footprint and the proposed rerouted servicing. These 2 hydrants can provide up to 95 l/s with a combined total of 190 l/s which is greater than the FUS demand for the Event Centre. The existing hydrants that will be used to meet the required North Side Stand's fire flow demand of 6,000 l/min (100 l/s) are located at the Field Entrance, On Field, Goodlife and Milestones as listed on Table 2-1. These hydrants can provide a total flow greater than the FUS demand for the North Side Stands, Therefore, the watermain system will have adequate capacity to service the Phase 1 and Phase 2 Lansdowne 2.0 development for new Event Centre and North Side Stands.

2.5 CHECK OF HIGH PRESSURE

High pressure is not a concern.

Water pressure at building connection (at average day) check:

Max. HGL – Finished floor elevation = 114.6m – 67.3m = 47.3m = 463.7 kPa

The maximum water pressure inside the Event Centre at the connection is determined with the maximum HGL condition, resulting in a pressure of 463.7 kPa which is less than the 552 kPa threshold in the guideline in which pressure control is required. Based on this result, pressure control is not required for the building.

2.6 PHASING CONSTRAINTS

There will be three different phases for the Lansdowne 2.0 redevelopment. Phase 1 and 2 will be the new Event Centre and North Side Stand. Phase 3 will be the Air Rights residential tower and commercial podium. The ultimate design condition, which assumes the ultimate condition is to be equal to or less than the existing conditions, is used for design consideration of this report. No on site and off-site upgrades are anticipated during the Phase 1 and 2 developments.

2.7 RELIABILITY REQUIREMENTS

Existing shut off valves will remain as per existing conditions. Additional shut off valves have been provided on the domestic services connecting to the Event Centre and North Side Stand.

2.8 NEED FOR PRESSURE ZONE BOUNDARY MODIFICATION

There is no need for a pressure zone boundary modification.

2.9 CAPABILITY OF MAJOR INFRASTRUCTURE TO SUPPLY SUFFICIENT WATER

The capability of the major infrastructure to supply sufficient water is confirmed.

2.10 DESCRIPTION OF PROPOSED WATER DISTRIBUTION NETWORK

The existing on-site network is proposed to be rerouted around the Event Centre and will be connected back onto the existing on-site watermain. New domestic services connecting to the on-site watermain is proposed to connect to the new Event Centre and North Side Stand. Two private hydrants will be slightly shifted to accommodate the Event Centre footprint and watermain rerouting. The overall site will continue to be serviced through existing 400mm and 200mm diameter watermains on Holmwood Avenue and Bank Street.

2.11 OFF-SITE REQUIREMENTS

No off-site improvements to watermains, feedermains, pumping stations, or other water infrastructure are required to maintain existing conditions and service the adjacent developments.

2.12 CALCULATION OF WATER DEMANDS

Water demands were calculated as described in Sections 2.3 and 2.4 above.

2.13 MODEL SCHEMATIC

The water works for phases 1 and 2 consist only a dual building services, the proposed condition are exactly the same as existing, a model schematic is not required for this development.

3 WASTEWATER DISPOSAL

3.1 DESIGN CRITERIA

In accordance with the City of Ottawa's Sewer Design Guidelines, the following design criteria have been utilized in order to predict wastewater flows generated by the subject site and complete the sewer design.

- Minimum Velocity 0.6 m/s
- Maximum Velocity 3.0 m/s
- Manning Roughness Coefficient 0.013
- Total est. hectares commercial and residential use 15.4
- Average residential daily flow 280 L/cap/day
- Average sanitary flow for institutional use 28,000 L/Ha/day
- Commercial/Institutional Peaking Factor 1.5
- Infiltration Allowance (Total) 0.33 L/Ha/s
- Minimum Sewer Slopes – 200 mm diameter 0.32%

The area of 15.4 ha represents the lot area of the Lansdowne Park. This is the sanitary collection area that is being considered to contribute to the existing 600mm trunk sanitary sewer along Holmwood Ave.

3.2 CONSISTENCY WITH ZBLA FUNCTIONAL SERVICING AND STORMWATER MANAGEMENT STUDY

The outlet for the sanitary service from the proposed buildings is the 375 mm diameter private sewer. The Ottawa Sewer Design Guidelines provide estimates of sewage flows based on residential development.

The criteria to determine anticipated actual peak flow based on site used as described in Ottawa Sewer Design Guidelines Appendix 4-A are described in the sanitary sewer design sheet in Appendix C.

The contributing flows for the north stands, south stands and the Event Centre are based on the DSEL sanitary design sheet and Building Service Summary for Lansdowne Park (also found in Appendix C). The new Event Centre is assumed to provide 5.2 l/s of sanitary flow.

The proposed Lansdowne 2.0 increases the peak dry weather flow from 42.1 l/s to 48.92 l/s. Under wet weather flow condition, the peak discharge is also increased from 45.3 l/s to 53.54 l/s. The release rate of 53.54 l/s is the approved ultimate release rate as per the zoning approval.

Based on the correspondence with the City, the capacity of the downstream sewer is 77.07 l/s which is greater than the peak wet weather discharge of 53.54 l/s. Refer to Appendix C for correspondence.

3.3 REVIEW OF SOIL CONDITIONS

There are no specific local subsurface conditions that suggest the need for a higher extraneous flow allowance. Soil conditions have been reviewed by Patterson Group. Bedding and backfill will be provided as recommended, conventional sewer materials will be utilized, and dewatering will be undertaken as necessary in accordance with the geotechnical recommendations and conditions encountered. The geotechnical study specifies a design recommendation based on a maximum groundwater elevation of 60.78m. Therefore, groundwater should not be an issue for the sanitary network.

3.4 DESCRIPTION OF EXISTING SANITARY SEWER

The subject site lies within the Rideau River Interceptor catchment. The existing development is serviced by a 600mm diameter sanitary trunk sewer on Holmwood Street. The existing peak wastewater flow rates have been determined employing City guidelines based on building type and usage. The anticipated dry weather peak wastewater discharge from the site is 42.1 l/s while the wet weather peak is 45.3 l/s. The peak discharge from the development assumes that both the retail and stadium will be operating at maximum capacity. The existing sanitary design sheet is found in Appendix C.

3.5 VERIFICATION OF AVAILABLE CAPACITY IN DOWNSTREAM SEWER

The capacity of the downstream 375 mm diameter private sewer from existing sanitary manhole 7 to existing sanitary manhole 6 has 67.91 l/s capacity with slope at 0.15%, which is adequate for the flow assumptions from the proposed addition as noted above. The servicing pipe capacity is capable to handle the estimated peak sanitary flow rate of 53.54 l/s for the site include both existing and proposed. Please refer to sanitary sewer design sheet in Appendix C.

3.6 CALCULATIONS FOR NEW SANITARY SEWER

The new sanitary network consists of varying pipe sizes and slopes. The downstream pipe size that conveys all the combined wastewater flows from the site is a 375 mm diameter sewer at a minimum slope of 0.15%. This size and slope of sewer provides a capacity of 67.91 l/s.

For the subject area, the post-development sanitary peak flow is calculated at a total flow of 53.54 l/s. Both the proposed and existing sanitary sewers will have adequate capacity to convey this flow. Refer to Appendix C for the sanitary design sheet for details.

3.7 DESCRIPTION OF PROPOSED SEWER NETWORK

The proposed sanitary sewer network on site will consist of a sanitary network of varying sized pipes ranging from 250mm to 375mm and ten 1200mm maintenance holes. The proposed sanitary network function to reroute the existing sanitary network around the Event Centre footprint and eventually connect back into the existing network.

3.8 ENVIRONMENTAL CONSTRAINTS

There are no previously identified environmental constraints that impact the sanitary servicing design in order to preserve the physical condition of watercourses, vegetation, or soil cover, or to manage water quantity or quality.

3.9 PUMPING REQUIREMENTS

The proposed development will have no impact on existing pumping stations and will not require new pumping facilities.

3.10 FORCEMAINS

There are no sanitary forcemains proposed on this site.

3.11 EMERGENCY OVERFLOWS FROM SANITARY PUMPING STATIONS

No sanitary pumping stations are proposed on this site.

3.12 SPECIAL CONSIDERATIONS

There is no known need for special considerations for sanitary sewer design related to existing site conditions.

4 SITE STORM SERVICING

4.1 EXISTING CONDITION

The existing conditions on the Lansdowne site are as designed in the Stantec Stormwater Management Design Report – Lansdowne Urban Park (2012). The primary site stormwater outlet is to the storm sewer on O'Connor Street, which discharges to a combined sewer at the intersection with Fifth Street. During large storm events (i.e. exceeding 100-year return period) runoff is directed to the Rideau Canal through overland flow.

The existing stormwater management system consists of two subsurface storage tanks, surface storage on the Great Lawn, outlet controls, and quality control structures. The two underground storage tanks provide 600 m^3 in Basin 1 and 2200 m^3 in Basin 2, with 700 m^3 provided in pipe storage (total of 3500 m^3 subsurface storage). A minimum storage volume of 3000 m^3 is also provided on the surface of the Great Lawn.

Based on the design criteria identified in the Stantec 2012 report (as per the OSDG 8.3.7.2 design criteria), the allowable release rate has been set to 616 l/s to O'Connor Street for all events from the 2-year to the 100-year return period.

4.2 ANALYSIS OF AVAILABLE CAPACITY IN PUBLIC INFRASTRUCTURE

As the allowable release rate from the site will be unchanged and was determined in conjunction with the design of the public infrastructure, there are no concerns related to the adequacy and available capacity of the downstream network. Capacity in the minor system is not a concern.

4.3 DRAINAGE DRAWING

Drawing C105A/C105B shows the detailed site sewer network. Drawings C104 provides proposed grading and drainage and includes existing grading information. Drawing C08 provides post-development drainage areas. Site sub-area information is also provided on the storm sewer design sheet attached in Appendix C. Drainage patterns and storm sewers outside of the study limits are to remain per the existing condition.

4.4 WATER QUANTITY CONTROL OBJECTIVE

Refer to the Stormwater Management Report for the water quantity objective for the site.

4.5 WATER QUALITY CONTROL OBJECTIVE

On-site quality control measures are expected for the proposed development per the previous studies. Stormwater shall be treated to MOE enhanced protection (80% TSS removal of suspended solids). The 80% TSS removal will be provided from the Stormtech chamber via an OGS unit at STMH201. Most of the runoff from the redeveloped area going to the chambers comes from grassed areas, Event Centre roof, and other pedestrian/landscaped areas and thus the runoff is considered clean.

4.6 DESIGN CRITERIA

The stormwater system was designed following the principles of dual drainage, making accommodation for both major and minor flow.

Some of the key criteria include the following:

- Design Storm (minor system) — 1:5-year return (Ottawa)
- Rational Method Sewer Sizing
- Initial Time of Concentration — 10 minutes
- Runoff Coefficients
  - Landscaped Areas — C = 0.20
  - Asphalt/Concrete — C = 0.90
  - Traditional Roof — C = 0.90
- Pipe Velocities — 0.80 m/s to 6.0 m/s
- Minimum Pipe Size — 250 mm diameter (200 mm CB Leads and service pipes)

4.7 PROPOSED MINOR SYSTEM

Under proposed conditions the majority of the site land use remains as it is under existing conditions, except for the new Event Centre with a traditional roof. The new event centre requires some rerouting of storm sewers and encroaches on the surface storage previously provided in the Great Lawn. The proposed design involves routing storm sewers south of the new Event Centre and installing subsurface storage beneath the Great Lawn to account for the additional storage required from the change in land use and elimination of storage available on the surface.

The subject site will be serviced by a storm sewer system designed in accordance with the amendment to the storm sewer and stormwater management elements of the Ottawa Design Guidelines. The minor system has been designed to convey the 5-year storm without ponding on the surface. Storm sewer design sheets are included in Appendix C.

The site outlets remain the same as they are in existing conditions. The primary outlet is to O'Connor Street to the north. During large storm events exceeding 100-year, runoff is directed to the Rideau Canal overland.

The major system will remain similar to how it is in existing conditions. The site is graded toward the Great Lawn where catch basins and trench drain around the perimeter will intercept overland runoff and direct it to the proposed underground storm chamber under the Great Lawn. Runoff within the Great Lawn will also be first intercepted by the subdrain along the perimeter, excess runoff that absorbed by the grass medium will also be intercepted by the weeper of the underground chamber down at the bottom, and ultimately directed to the piping system. Emergency overland flow is directed toward the Rideau Canal during extreme events exceeding the 100-year design storm.

4.8 STORMWATER MANAGEMENT

Refer to the Stormwater Management Report.

4.9 INLET CONTROLS

Refer to the Stormwater Management report.

4.10 ON-SITE DETENTION

Refer to the Stormwater Management report.

4.11 WATERCOURSES

There will be no modification to watercourses as a result of this proposed site plan.

4.12 PRE AND POST DEVELOPMENT PEAK FLOW RATES

Pre and post development peak flow rates have been noted in the Stormwater Management Report.

4.13 DIVERSION OF DRAINAGE CATCHMENT AREAS

There will be no diversion of existing drainage catchment areas arising from the proposed work described in this report.

4.14 DOWNSTREAM CAPACITY WHERE QUANTITY CONTROL IS NOT PROPOSED

This checklist item is not applicable to this development as quantity control is provided.

4.15 IMPACTS TO RECEIVING WATERCOURSES

No significant negative impact is anticipated to downstream receiving watercourses due to proposed quantity and quality control measures.

4.16 MUNICIPAL DRAINS AND RELATED APPROVALS

There are no municipal drains on the site or associated with the drainage from the site.

4.17 MEANS OF CONVEYANCE AND STORAGE CAPACITY

The means of flow conveyance and storage capacity are described in Sections 4.7, 4.8, 4.9 and 4.10 above.

4.18 HYDRAULIC ANALYSIS

Hydraulic calculations for the site storm sewers are provided in the storm sewer design sheet.

4.19 IDENTIFICATION OF FLOODPLAINS

There are no designated floodplains on the site of this development.

4.20 FILL CONSTRAINTS

There are no known fill constraints applicable to this site related to any floodplain. The site is generally being raised higher relative to existing conditions.

5 SEDIMENT AND EROSION CONTROL

5.1 GENERAL

During construction, existing storm sewer system can be exposed to sediment loadings. A number of construction techniques designed to reduce unnecessary construction sediment loadings will be used including:

- Silt sacks will remain on open surface structures such as manholes and catchbasins until these structures are commissioned and put into use.
- Installation of silt fence, where applicable, around the perimeter of the proposed work area.
- The installation of straw bales within existing drainage features surround the site.
- Bulkhead barriers will be installed in the outlet pipes.

During construction of the services, any trench dewatering using pumps will be fitted with a “filter sock.” Thus, any pumped groundwater will be filtered prior to release to the existing surface runoff. The contractor will inspect and maintain the filter sock as needed including sediment removal and disposal.

All catchbasins, and to a lesser degree, manholes, convey surface water to sewers. Consequently, until the surrounding surface has been completed, these structures will be covered to prevent sediment from entering the minor storm sewer system. These measures will stay in place and be maintained during construction and build-out until it is appropriate to remove them.

During construction of any development both imported and native soils are placed in stockpiles. Mitigative measures and proper management to prevent these materials entering the sewer system are needed.

During construction of the deeper watermains and sewers, imported granular bedding materials are temporarily stockpiled on site. These materials are however quickly used up and generally placed before any catchbasins are installed.

Refer to the Erosion and Sedimentation Control Plan (drawing C06) provided in Appendix D.

6 APPROVAL AND PERMIT REQUIREMENTS

6.1 GENERAL

The proposed development is subject to site plan approval.

No approvals related to municipal drains are required.

An ECA amendment through the Transfer of Review process is anticipated for the new stormwater management facility. No other permits or approvals are anticipated to be required from the Ontario Ministry of Transportation, National Capital Commission, Parks Canada, Public Works and Government Services Canada, or any other provincial or federal regulatory agency.

7 CONCLUSION CHECKLIST

7.1 CONCLUSIONS AND RECOMMENDATIONS

It is concluded that the proposed development can meet all provided servicing constraints and associated requirements. It is recommended that this report be submitted to the City of Ottawa in support of the application for site plan approval.

7.2 COMMENTS RECEIVED FROM REVIEW AGENCIES

The outstanding comments from the ZBLA stage and preliminary review have been addressed. Further comments will be provided after the complete review. This is the revision 2 of the report.

APPENDIX

A

- CITY AND NCC COMMENTS
- LANSDOWNE CIVIL DRAWINGS - STANTEC
- CONCEPTUAL ARCHITECTUAL PLAN
- AS-BUILT DRAWINGS
- TOPOGRAPHICAL SURVEY PLAN

ZBLA/OPA Comments to be Addressed During Site Plan Control Application

1. In addition to the above comment please see the previous comment from the ZBLA/OPA review regarding the underground storm water storage facility.

   Geotechnical comments Section 5.8 states the following "It is understood that an underground stormwater infiltration tank system will be included as part of the proposed development. The tank is expected to be founded on a combination of in-situ, undisturbed silty sand/sandy silt and sandy fill. Based on the above, a bearing resistance value for the proposed structure may be considered to be 120 kPa (SLS) and a factored bearing resistance value at ULS of 180 kPa may be considered for the system and associated infrastructure/structures."

   Please provide rational to how the subsurface soil data was determined. Based on the City guidelines we believe that an additional borehole be performed to determine the bearing capacity for the proposed storage tank.

   The above comment remains outstanding, please revise the report to include information addressing the foundation design of the under-ground storm storage cistern. The geotechnical design should include discussion regarding the elevation of ground water table in relation to the underside of footing of the storage facility and how this may affect the design.

   It is understood that the Great Lawn subsurface profile includes contaminated soil, the geotechnical report should speak to the contamination and any potential mitigation measures that may be required to ensure that migration of the contamination does not enter the underground storage facility.

2. Outstanding comments from ZBLA/OPA

   a. Storm Water Management Modeling:

      Please see comments from City of Ottawa Asset Management Branch regarding the storm water management model reviewed during the ZBLA and OPA. Comments were not addressed at the ZBLA and OPA, it is assumed that comments would be addressed during SPC.

      In summary, the modeling approach appears overly generalized as it lacks detailed consideration of the primary system. Assumptions are made regarding the flow being directed solely into the minor storage system, without sufficient clarity on the management of overland drainage. Potential issues arising from overland drainage remain unaddressed. While the approach is

conservative regarding the minor system's storage and release rates, certain key factors are overlooked.

Of note, external areas draining onto the site, as evidenced by the GIS Stream Builder snapshot provided, are not accounted for. Additionally, the current design indicates flow into the canal during a 5-year storm event, contrary to the presented model. It's worth noting that our authorization allows for controlled releases into the canal up to a specified rate, as outlined in the previous report. Leveraging this authorization could be beneficial.

Further detailed comments are available below. It may be prudent to arrange a meeting with the consultant to articulate these concerns effectively.



Existing model

a) There are IDs for the storm network based on city sources. Please use appropriate storm IDs and info to reflect the existing system. This will give us ease to review model files and documents.

b) Storage node at Great lawn can be defined by a storage curve as opposed to a constant value of 8150. Not sure where does it come from?

c) CB contributions in many areas are missing. Please consider CB captures where appropriate. For example, A3 subcatchment at TD place stadium– there are CBs within it, require assigning all CB captures to the minor system, and then excess runoff will travel to further downstream, similarly for A2, A4 etc.

d) All underground storage areas need to be clearly shown on a map/drawing or in the model. At basin2 node for underground storage, DICB needs to be included. Also confirm the existence of 450 mm dia backflow preventor. I don't see any orifice control at that location as per drawing. Also, not sure how DICB, orifice and underground reservoir are connected to what?

e) Area or catchbasin capture should be assigned at the beginning of the node, otherwise the system will lose its actual contributions, for example OPGG and Great lawn area/TD place stadium areas etc.

f) At J19 node, this is used as a ponding location but no area is being assigned to that.

g) Excess flow to Rideau Canal operating level at El 64.1 during a 5 year is 480 l/s (DSEL) after surcharging on-site, but WSP shows a 0.0 l/s during a 5 year (WSP). Appears to be quite different than previous findings. Please explain.

h) Some external area (from the area in between of Clarey and Holmwood) for overland flow contribution may require including in the model and eventually drains to the Great lawn area as per city streambuilder.

i) Please show the extent of ponding in the Great Lawn area.

j) Major system modelling is kind of unclear. The major systems were modelled by weir, looks like everything is drained to the minor system first before overflowing to the next segment. Should be other way around, yes/no?

k) As per Stantec schematic, 2x900 mm overflow from Basin 2 is connected to Great lawn area. This is not reflected in the existing model.

<u>Proposed New Arena</u>

l) The proposed system for the new arena was not properly modelled as per functional drawing. Also, the drawing info in the Great Lawn area is not clear or labelled to follow the model files.

m) The proposed pipe segment that connects to the existing outlet pipe to Rideau Canal should be included in the model.

n) Basin 1 connecting to J32 was modelled a bit differently though the pre and post remains the same. What's the reason behind it where water comes in and out of Basin1 node in the proposed condition?

o) The existing system (C8, C9, C11, C12) model should be in the proposed model as pipe storage as well unless these are proposed to be retired as per functional drawing. Please confirm

p) Flow releasing to Rideau Canal was controlled by a orifice plate. This is not found in the existing model or in the drawing. Please confirm or show on a drawing for consistency.

q) What size of underground storage facility is required instead of surface storage at Great lawn (basin3 node) if it is for recreational use? Modeling this storage node should be consistent with other underground storage curves. How many CBs are required to immediate capture flows to the proposed underground system to avoid ponding ? Require to include in the model as well.

Additional modeling comments post meeting on Monday 22nd 2024

3. WSP to confirm in the body of the servicing report that external flow from neighboring properties will not spill onto the Lansdowne property during the 100year event and below.
4. The major system needs to be included in the model to confirm flooding on the street.
5. Please provide pipe loss coefficients to the model.
6. My idea is that the **Rideau canal outlet** functions as an emergency flow. If the proposed great lawn storage is popped up by chance for the 100 year storm and above, then you may need an emergency exit. Please confirm the feasibility of decommissioning the Rideau Canal outfall. Note that this has been there for many years.
7. At node 40 linked to Basin2, please check the flow continuity at these locations.
8. Assuming the existing perforated system will be replaced by Great Lawn storage tank, still you may need some catch basins to capture local flows to the tank.

Comments:

9. Stormwater Management Quantity and Quality Criteria

   It is assumed that the stormwater management criteria for the subject site, is to follow the recommendations of the Functional Servicing and Stormwater

Management Study prepared by WSP May 25, 2023, which was based on the design criteria as identified in the Stantec Stormwater Management Design Report – Lansdowne Urban Park (2012) as per OSDG 8.3.7.2. Design criteria are as follows:

a. Peak flow rate of 616 L/s to O'Connor Street sewer for all events from the 2-year to the 100-year return period

b. Stormwater shall be treated to MOE "enhanced" standard (80% TSS removal)

c. The "first flush" (i.e. 10mm event) shall be directed to the O'Connor Street sewer for the entire site drainage area.

d. The 600mm pipe to the Rideau Canal may be used as an overflow, with a peak flow of 480 L/s once the water level is above the operating level of the canal (64.08 m).

e. Outflow to O'Connor Street Sewer will be restricted if the downstream system surcharges and will be cut off when the receiving sewer HGL is higher than the onsite HGL.

f. Minor system shall be design for a 5-year level of service with minimal surface ponding.

g. Major system shall provide a 100-year level of service while minimizing outflow to the canal.

h. The 5-yr storm event using the IDF information derived from the Meteorological Services of Canada rainfall data, taken from the MacDonald Cartier Airport, collected 1966 to 1997.

i. For separated sewer system built pre-1970 the design of the storm sewers are based on a 2 year storm.

j. The pre-development runoff coefficient or a maximum equivalent 'C' of 0.5, whichever is less (§ 8.3.7.3).

k. A calculated time of concentration (Cannot be less than 10 minutes).

l. Flows to the storm sewer in excess of the 5-year storm release rate, up to and including the 100-year storm event, must be detained on site.

10. Deep Services (Storm, Sanitary & Water Supply)

a. Provide existing servicing information and the recommended location for the proposed connections. Services should ideally be grouped in a common trench to minimize the number of road cuts.

b. Connections to trunk sewers and easement sewers are typically not permitted.

c. Provide information on the monitoring manhole requirements – should be located in an accessible location on private property near the property line (ie. Not in a parking area).

d. Review provision of a high-level sewer.

e. Sewer connections to be made above the springline of the sewermain as per:

    i. Std Dwg S11.1 for flexible main sewers – connections made using approved tee or wye fittings.

    ii. Std Dwg S11 (For rigid main sewers) – lateral must be less that 50% the diameter of the sewermain,

    iii. Std Dwg S11.2 (for rigid main sewers using bell end insert method) – for larger diameter laterals where manufactured inserts are not available; lateral must be less that 50% the diameter of the sewermain,

    iv. When the connection is to rigid main sewers where the lateral exceeds 50% the diameter of the sewermain connection via Maintenance hole is required. – Connect obvert to obvert with the outlet pipe.

    v. No submerged outlet connections.

11. Water Boundary condition requests must include the location of the service (map or plan with connection location(s) indicated) and the expected loads required by the proposed development, including calculations. Please provide the following information:

    Location of service

    Type of development and the amount of fire flow required (as per FUS).

    Average daily demand: ___ l/s.

    Maximum daily demand: ___l/s.

    Maximum hourly daily demand: ___ l/s.

    Please **review Technical Bulletin ISTB-2018-02**, maximum fire flow hydrant capacity is provided in Section 3 Table 1 of Appendix I. A **hydrant coverage**

figure shall be provided and **demonstrate there is adequate fire protection for the proposal**.

[*Fire flow demand requirements shall be based on **ISTB-2021-03***]
Exposure separation distances shall be defined on a figure to support the FUS calculation and required fore flow (RFF).

Hydrant capacity shall be assessed to demonstrate the RFF can be achieved. Please identify which hydrants are being considered to meet the RFF on a fire hydrant coverage plan as part of the boundary conditions request.

12. An MECP Environmental Compliance Approval **[Industrial Sewage Works or Municipal/Private Sewage Works]** will be required for the proposed development. Please contact the Ministry of the Environment, Conservation and Parks, Ottawa District Office to arrange a pre-submission consultation:

    a. Charlie Primeau at (613) 521-3450, ext. 251 or Charlie.Primeau@ontario.ca

    b. Emily Diamond at (613) 521-3450, ext. 238 or Emily.Diamond@ontario.ca

13. Water

    As per ISTB-2021-03, Industrial, commercial, institutional service areas with a basic day demand greater than 50 m^3/day and residential areas serving 50 or more dwellings shall be connected with a minimum of two watermains, separated by an isolation valve, to avoid the creation of a vulnerable service area. Individual residential facilities with a basic day demand greater than 50 m3/day shall be connected with a minimum of two water services, separated by an isolation valve, to avoid the creation of a vulnerable service area.

14. Sewer (sanitary and storm)

    a. Sanitary sewer capacity, Please provide the new Sanitary sewer discharge and we confirm if sanitary sewer main has the capacity.

    b. Sanitary sewer monitoring maintenance hole is required to be installed at the property line (on the private side of the property) as per City of Ottawa Sewer-Use By-Law 2003-514 (14) *Monitoring Devices*.

    c. A storm sewer monitoring maintenance hole is required to be installed at the property line (on the private side of the property) as per City of Ottawa Sewer-Use By-Law 2003-514 (14) *Monitoring Devices*.

15. Stormwater

a. Underground Storage: Please note that the Modified Rational Method for storage computation in the Sewer Design Guidelines was originally intended to be used for above ground storage (i.e. parking lot) where the change in head over the orifice varied from 1.5 m to 1.2 m (assuming a 1.2 m deep CB and a max ponding depth of 0.3 m). This change in head was small and hence the release rate fluctuated little, therefore there was no need to use an average release rate.

   When underground storage is used, the release rate fluctuates from a maximum peak flow based on maximum head down to a release rate of zero. This difference is large and has a significant impact on storage requirements. **We therefore require that an average release rate equal to 50% of the peak allowable rate shall be applied to estimate the required volume. Alternatively, the consultant may choose to use a submersible pump in the design to ensure a constant release rate.**

   In the event that there is a disagreement from the designer regarding the required storage, The City will require that the designer demonstrate their rationale utilizing dynamic modelling, that will then be reviewed by City modellers in the Water Resources Group.

   Provide information on type of underground storage system including product name and model, number of chambers, chamber configuration, confirm invert of chamber system, top of chamber system, required cover over system and details, interior bottom slope (for self-cleansing), chart of storage values, length, width and height, capacity, entry ports (maintenance) etc. UG storage to provide actual 2- and 100-year event storage requirements.

   In regard to all proposed UG storage, ground water levels (and in particular HGW levels) will need to be reviewed to ensure that the proposed system does not become surcharged and thereby ineffective.

   Modeling can be provided to ensure capacity for both storm and sanitary sewers for the proposed development by City's Water Distribution Dept. – Modeling Group, through PM and upon request.

b. **If rooftop control** and storage is proposed as part of the SWM solutions sufficient details (Cl. 8.3.8.4) shall be discussed and document in the report and on the plans. Roof drains are to be connected downstream of any incorporated ICDs within the SWM system and not to the foundation drain system. Provide a **Roof Drain Plan** as part of the submission.
c. Please note that the minimum orifice dia. for a plug style **ICD is 83mm and the minimum flow rate from a vortex ICD is 6 L/s** in order to reduce the likelihood of plugging.
d. Quality Control Stormwater shall be treated to MOE "enhanced" standard (80% TSS removal)

e. The “first flush” (i.e. 10mm event) shall be directed to the O’Connor Street sewer for the entire site drainage area.

f. Document how any foundation drainage system will be integrated into the servicing design and show the positive outlet on the plan. Foundation drainage is to be independently connected to sewer main unless being pumped with appropriate back up power, sufficient sized pump and back flow prevention. **It is recommended that the foundation drainage system be drained by a sump pump connection to the storm sewer to minimize risk of basement flooding as it will provide the best protection from the uncontrolled sewer system compared to relying on the backwater valve.**

16. Grading

Post-development site grading shall match existing property line grades to minimize disruption to the adjacent residential properties. A **topographical plan of survey** shall be provided as part of the submission and a note provided on the plans.

r) Are these extracted values from the model shown in Table 4-3? Please explain. Also, for comparison available storage can be added in the table.


s) Detailed info in the model should be laid on a drawing to follow, for example J30, J31 and so on. Also, show a separate drawing sheet for post development condition only for clarity.


LANSDOWNE PARK
RIDEAU RIVER
QUEEN ELIZABETH DRIVE
BRONSON AVENUE
BANK STREET
CLEGG
BOWALK
BELL
BRIGHTON
BELMONT
BELMONT
SOUTHERN
AVENUE
GLEBE
ROSEMOUNT
MELROSE
MELVILLE
MERRIVALE
MERIVALE
MELBOURNE



LEGEND

- PROPOSED STORM SEWER AND MAINTENANCE HOLE
- PROPOSED SANITARY SEWER AND MAINTENANCE HOLE
- PROPOSED CATCH BASIN
- PROPOSED WATERMAIN
- PROPOSED FIRE HYDRANT
- D= PROPOSED DRINKING FOUNTAIN
- W= PROPOSED WATER CONNECTION
- +DR PROPOSED SANITARY DRAIN FOR DRINKING FOUNTAIN
- 65.00 PROPOSED SURFACE SWALE AND DIRECTION OF FLOW
- + 65.81 PROPOSED GRADE
- EXISTING GRADE
- EXISTING TREES

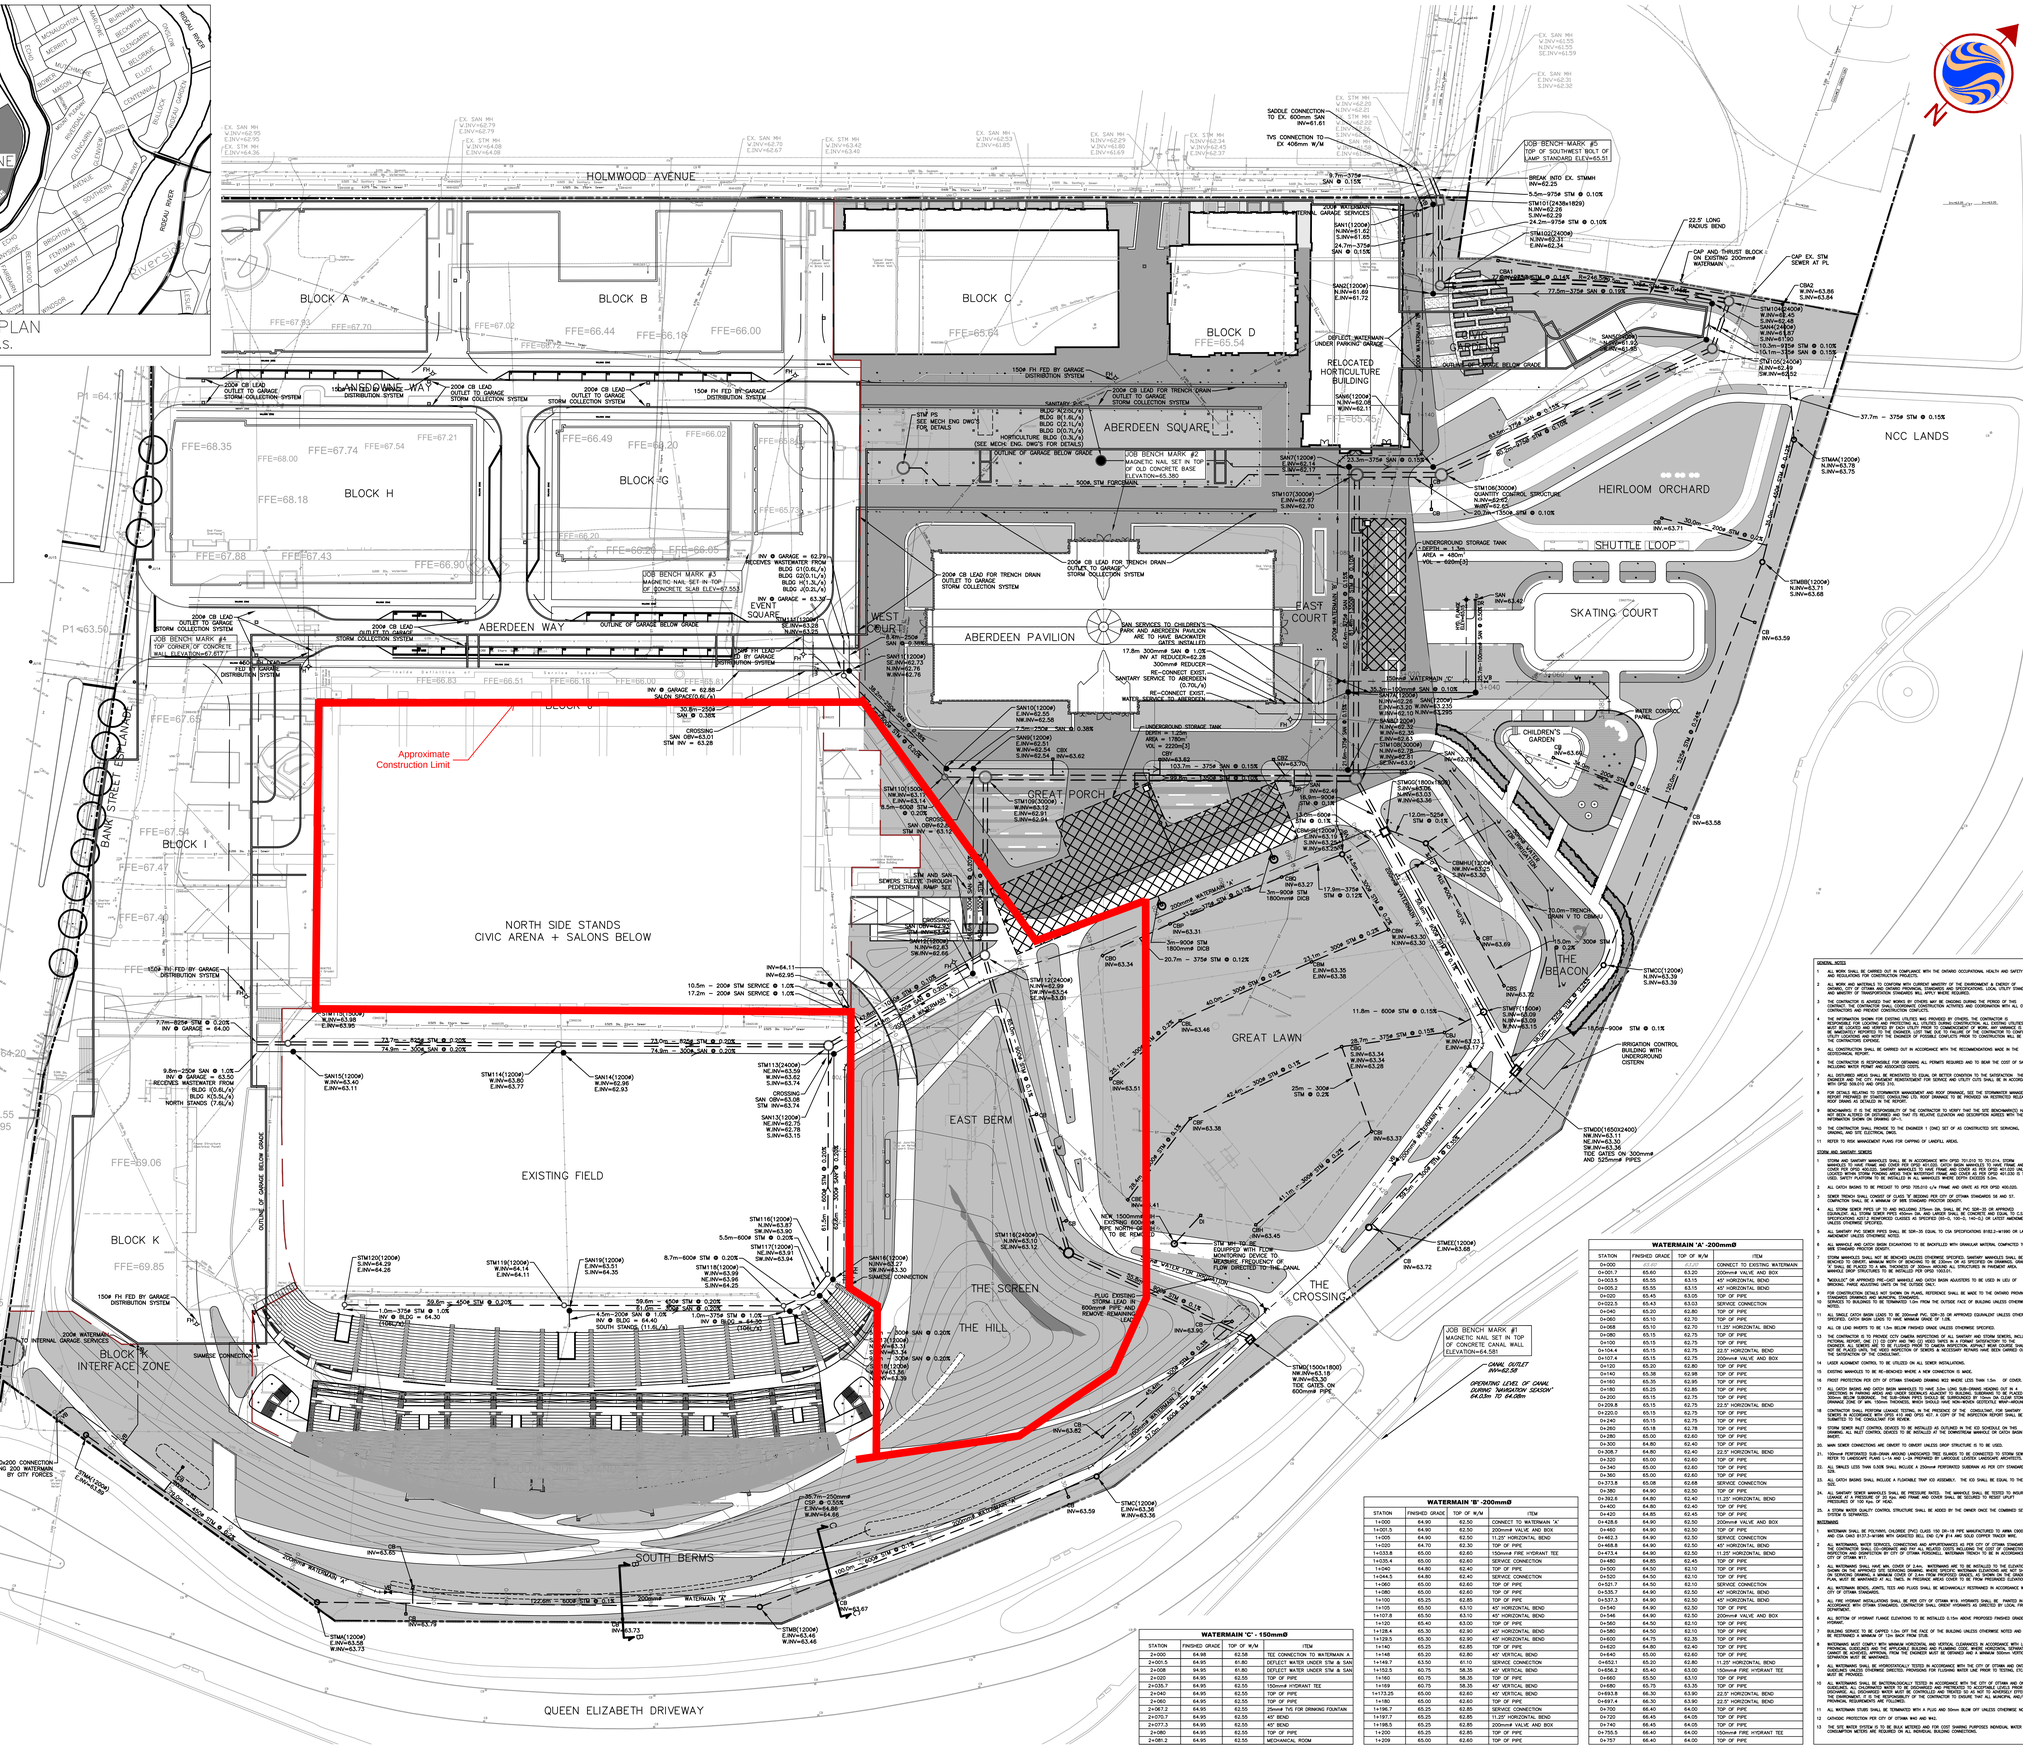

HOLMWOOD AVENUE
BLOCK A
BLOCK B
BLOCK C
BLOCK D
BLOCK H
BLOCK G
BLOCK I
BLOCK K
ABERDEEN SQUARE
ABERDEEN WAY
ABERDEEN PAVILION
WEST COURT
EAST COURT
EVENT SQUARE
RELOCATED HORTICULTURE BUILDING
HEIRLOOM ORCHARD
SHUTTLE LOOP
SKATING COURT
NCC LANDS
CHILDREN'S GARDEN
THE BEACON
GREAT PORCH
GREAT LAWN
EAST BERM
THE SCREEN
THE HILL
THE CROSSING
SOUTH BERMS
EXISTING FIELD
NORTH SIDE STANDS
CIVIC ARENA + SALONS BELOW
BANK STREET EXPLANADE
BANK STREET
QUEEN ELIZABETH DRIVE
Approximate Construction Limit
OUTLINE OF GARAGE BELOW GRADE
200m WATERMAIN 'A'
250m WATERMAIN 'B'
300m WATERMAIN 'C'
IRRIGATION CONTROL BUILDING WITH UNDERGROUND CISTERN
JOB BENCH MARK #5 TOP OF SOUTHWEST BOLT OF LAMP STANDARD ELEV=65.51
JOB BENCH MARK #2 MAGNETIC NAIL SET IN TOP OF OLD CONCRETE BASE ELEVATION=63.380
JOB BENCH MARK #3 MAGNETIC NAIL SET IN -TOP- OF CONCRETE SLAB ELEV=67.553
JOB BENCH MARK #4 TOP CORNER OF CONCRETE WALL ELEVATION=67.617
JOB BENCH MARK #1 MAGNETIC NAIL SET IN TOP OF CONCRETE CANAL WALL ELEVATION=64.581
CANAL OUTLET INV=62.58
OPERATING LEVEL OF CANAL DURING 'SHAKESPEARIAN SUMMER' 64.03m TO 64.08m
UNDERGROUND STORAGE TANK AREA = 480m² VOL = 600m³(±5)
UNDERGROUND STORAGE TANK DEPTH = 1.20m AREA = 1780m² VOL = 2220m³(±5)
UNDERGROUND STORAGE TANK AREA = 1780m² VOL = 2220m³(±5)
STM QUALITY CONTROL STRUCTURE
SAN SERVICES TO 'CHILDREN'S PARK' AND 'ABERDEEN PAVILION' ARE TO HAVE BACKWATER GATES INSTALLED.
RE-CONNECT EXIST. SANITARY SERVICE TO ABERDEEN (0.70L/s)
RE-CONNECT EXIST. WATER SERVICE TO ABERDEEN
PLUG EXISTING STORM LEAD IN 900mm# PIPE AND REMOVE-REMAINING LEAD
NEW 1500mm# EXISTING 900mm# PIPE TO BE REMOVED
STM 'BM-TOL' EQUIPPED WITH FLOW MONITORING DEVICE TO MEASURE FLOWS TO CANAL
SAMCC(1200#) N.INV=63.39 S.INV=63.39
SAMCC(1800x1800) N.INV=63.09 S.INV=63.15
STMCC(1200#) N.INV=63.39 S.INV=63.39
STM(1500x1800) NW.INV=63.18 W.INV=63.30 TIDE GATES ON 800mm# PIPE
STM(1650X2400) NW.INV=63.11 NE.INV=63.30 SW.INV=63.36 TIDE GATES ON 300mm# AND 525mm# PIPES
STM106(2400#) N.INV=62.89 SW.INV=62.02
STM104(2400#) W.INV=62.45 S.INV=62.34
SAM42(1800#) W.INV=61.87 S.INV=61.50
STM105(2400#) N.INV=62.89 SW.INV=62.02
STMA(1200#) N.INV=63.78 S.INV=63.75
STMB(1200#) N.INV=63.71 S.INV=63.68
STMC(1200#) E.INV=63.36 W.INV=63.36
STMB(1200#) E.INV=63.46 W.INV=63.46
STMA(1200#) E.INV=63.56 W.INV=63.73
STM(1500x1800) NW.INV=63.18 W.INV=63.30 TIDE GATES ON 800mm# PIPE
STM(1650X2400) NW.INV=63.11 NE.INV=63.30 SW.INV=63.36 TIDE GATES ON 300mm# AND 525mm# PIPES
STM(1800x1800) S.INV=62.08 N.INV=63.03 W.INV=63.36
STM(1200#) W.INV=63.09 S.INV=63.15
SAM(1200#) W.INV=63.35 E.INV=62.63 S.INV=62.53
SAM10(1200#) W.INV=63.35 E.INV=62.63 S.INV=62.53
STM108(3000#) N.INV=62.78 W.INV=62.51 SE.INV=63.01
SAM(1200#) N.INV=62.28 E.INV=63.30 W.INV=62.10
SAM(1200#) N.INV=62.28 E.INV=63.235 W.INV=62.05
SAM9(1200#) E.INV=62.73 N.INV=62.76 W.INV=62.76
SAM10(1200#) E.INV=62.52 N.INV=62.56
SAM11(1200#) E.INV=62.51 W.INV=62.54 S.INV=62.54
SAM12(2400#) N.INV=62.89 SW.INV=63.04 SE.INV=63.01
SAM13(1200#) NE.INV=62.75 W.INV=62.78 S.INV=63.15
SAM14(1200#) W.INV=62.86 E.INV=62.93
SAM15(1200#) W.INV=63.40 E.INV=63.11
SAM16(1200#) N.INV=63.27 SW.INV=63.30 SE.INV=63.30
SAM17(1200#) NE.INV=63.91 SW.INV=63.94
SAM18(1200#) W.INV=63.99 NE.INV=63.96 S.INV=64.25
SAM19(1200#) E.INV=64.14 S.INV=64.35
SAM20(1200#) E.INV=64.26
SAM21(1200#) E.INV=64.39
SAM22(1200#) E.INV=64.39
SAM23(1200#) E.INV=64.39
SAM24(1200#) E.INV=64.39
SAM25(1200#) E.INV=64.39
SAM26(1200#) E.INV=64.39
SAM27(1200#) E.INV=64.39
SAM28(1200#) E.INV=64.39
SAM29(1200#) E.INV=64.39
SAM30(1200#) E.INV=64.39
SAM31(1200#) E.INV=64.39
SAM32(1200#) E.INV=64.39
SAM33(1200#) E.INV=64.39
SAM34(1200#) E.INV=64.39
SAM35(1200#) E.INV=64.39
SAM36(1200#) E.INV=64.39
SAM37(1200#) E.INV=64.39
SAM38(1200#) E.INV=64.39
SAM39(1200#) E.INV=64.39
SAM40(1200#) E.INV=64.39




LEGEND

- PROPOSED STORM MAINTENANCE HOLE
- PROPOSED SANITARY MAINTENANCE HOLE
- PROPOSED CATCH BASIN
- 0.5% 65.00 PROPOSED SURFACE SWALE AND DIRECTION OF FLOW
- + 65.81 PROPOSED GRADE
- + 65.81 EX PROPOSED GRADE = EXISTING GRADE
- 65.70 EXISTING GRADE
- EXTENT OF PAH IMPACTED SOIL

HOLMWOOD AVENUE
LANSDOWNE WAY
ABERDEEN AVENUE
BANK STREET
QUEEN ELIZABETH DRIVEWAY
BLOCK A
BLOCK B
BLOCK C
BLOCK D
BLOCK G
BLOCK H
BLOCK J
BLOCK K
BLOCK K INTERFACE ZONE
RELOCATED HORTICULTURE BUILDING
ABERDEEN SQUARE
ABERDEEN PAVILION
WEST COURT
EAST COURT
EVENT SQUARE
HEIRLOOM ORCHARD
SHUTTLE LOOP
SKATING COURT
CHILDREN'S GARDEN
NCC LANDS
GREAT PORCH
GREAT LAWN
THE BEACON
THE CROSSING
EAST BERM
THE SCREEN
THE HILL
EXISTING FIELD
SOUTH BERMS
NORTH SIDE STANDS
CIVIC ARENA + SALONS BELOW
JOB BENCH MARK #1 MAGNETIC NAIL SET IN TOP OF CONCRETE CANAL WALL ELEVATION=64.581
JOB BENCH MARK #2 MAGNETIC NAIL SET IN TOP OF OLD CONCRETE BASE ELEVATION=65.380
JOB BENCH MARK #3 MAGNETIC NAIL SET IN TOP OF CONCRETE SLAB ELEV=67.193
JOB BENCH MARK #4 TOP CORNER OF CONCRETE ELEVATION=67.337
JOB BENCH MARK #5 TOP OF SOUTHWEST BOLT OF LAMP STANDARD ELEV=65.51
CANAL OUTLET INV=62.58
OPERATING LEVEL OF CANAL DURING "NAVIGATION SEASON" 64.03m TO 64.08m
100 YEAR FLOOD ELEVATION = 64.90m
100 YEAR FLOOD ELEVATION = 64.70m

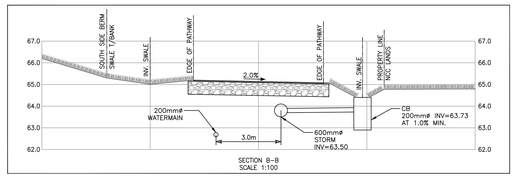

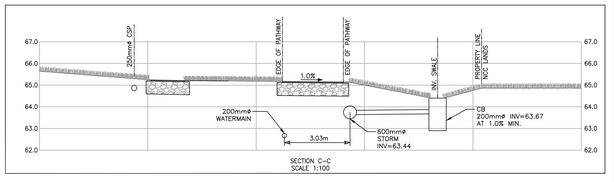

SITE GRADING

1. ALL GRANULAR BASE & SUB BASE COURSE MATERIALS SHALL BE COMPACTED TO 100% STANDARD PROCTOR MAX. DRY DENSITY.
2. ALL DISTURBED GRASSED AREAS SHALL BE RESTORED TO ORIGINAL CONDITION OR BETTER, WITH 300 ON MIN. 100mm TOPSOIL. THE RELOCATION OF TREES AND SHRUBS SHALL BE SUBJECT TO APPROVAL BY THE PROJECT LANDSCAPE ARCHITECT OR ENGINEER.
3. PAVEMENT CONSTRUCTION AS PER DETAILS ON DRAWING No. C07
4. ALL BARRIER CURBS AND SIDEWALKS TO BE CONSTRUCTED PER CITY OF OTTAWA STANDARD DRAWING SC1 AND SC8 UNLESS OTHERWISE NOTED OR DETAIL PROVIDED.
5. INSPECTIONS: ALL WORK ON THE MUNICIPAL RIGHT OF WAY AND EASEMENTS TO BE INSPECTED BY THE MUNICIPALITY PRIOR TO BACKFILLING. ALL WORK RELATING TO WATERMAINS AND SEWERS TO BE INSPECTED BY THE MUNICIPALITY WHEN REQUIRED.
6. REFER TO ARCHITECTURAL SITE PLAN FOR DIMENSIONS AND SITE DETAILS.
7. CONTRACTOR TO OBTAIN A ROAD OCCUPANCY PERMIT 48 HOURS PRIOR TO COMMENCING ANY WORK WITHIN THE MUNICIPAL ROAD ALLOWANCE IF REQUIRED BY THE MUNICIPALITY.
8. PARKING AREA PONDING DEPTH TO BE 0.30m (MAXIMUM).
9. EMBANKMENTS TO BE SLOPED AT MIN. 3:1, UNLESS OTHERWISE SPECIFIED.
10. ALL PAVEMENT MARKING, LINE PAINTING, DIRECTIONAL LINES/ARROWS ETC. SHALL BE PLACED IN ACCORDANCE WITH THE ARCHITECTURAL SITE PLAN OR THE OWNER'S TRAFFIC ENGINEERING CONSULTANT'S DRAWINGS. LINE PAINTING AND DIRECTIONAL SYMBOLS SHALL BE APPLIED WITH A MINIMUM OF TWO COATS OF ORGANIC SOLVENT BASED PAINT.
11. THE CONTRACTOR SHALL PROVIDE TO THE ENGINEER 1 (ONE) SET OF AS CONSTRUCTED SITE SERVICING, GRADING, AND SITE ELECTRICAL DWGS.
12. SITE SIGNAGE TO BE INSTALLED AS PER ARCHITECTURAL SITE PLAN.
13. ALL NECESSARY CLEARING AND GRUBBING SHALL BE COMPLETED BY THE CONTRACTOR. REVIEW WITH ARCHITECT AND THE CITY OF OTTAWA PRIOR TO TREE CUTTING.
14. SUB-EXCAVATE SOFT AREAS & FILL WITH GRANULAR 'B' COMPACTED IN 0.15m LAYERS.
15. FOR ALL LANDSCAPING FEATURES (ie. TREES, WALKWAYS, PARK DETAILS, NOISE BARRIERS, FENCES etc.) REFER TO LANDSCAPE ARCHITECT PLAN.
16. ROUGH GRADING FOR LANDSCAPED ISLANDS TO BE LEFT 150mm BELOW CURB AND COMPACTED TO 95%.
17. WHERE APPLICABLE THE CONTRACTOR IS TO SUBMIT SHOP DRAWINGS FOR RETAINING WALLS (INCLUDE RAILINGS IF APPLICABLE) TO THE ENGINEER FOR APPROVAL PRIOR TO CONSTRUCTION. SHOP DRAWINGS MUST BE SITE SPECIFIC, SIGNED AND SEALED BY A LICENCED STRUCTURAL ENGINEER. THE CONTRACTOR WILL ALSO BE REQUIRED TO SUPPLY STRUCTURAL AND GEOTECHNICAL CERTIFICATION OF THE AS-CONSTRUCTED RETAINING WALL TO THE ENGINEER PRIOR TO FINAL ACCEPTANCE.
18. ALL SWALES LESS THAN 0.50% SHALL INCLUDE A 250mmø PERFORATED SUBDRAIN AS PER CITY STANDARD S29.

0 6 18 30m
1:600

V:\01-634\active\1604_00832_Lansdowne Park Competition\design\drawing\160400832 Civil Stantec.dwg Feb06 ,2012 - 3:15pm

CLIENT PARTNERSHIP

Ottawa
OSEG
Ottawa Sports and Entertainment Group

CONSULTANT TEAM

CANNONDESIGN
AN IDEAS BASED PRACTICE

CORUSH SUNDERLAND WRIGHT

DSEL
david schaeffer engineering ltd
SMART SUBDIVISIONS™

GreenbergFarrow

Stantec

PHILLIPS FAREVAAG SMALLENBERG
PLANNING • URBAN DESIGN
LANDSCAPE ARCHITECTURE

COPYRIGHT RESERVED

This plan and design are, and at all times remain the exclusive property of the client and consultant team and cannot be used or reproduced without written consent.

Do not scale drawings. This drawing shall not be used for construction.

REVISIONS

No.	Date	Details	By
1	2011-11-21	ISSUED TO CITY FOR REVIEW	JVG
2	2011-12-12	REVISED AS PER CITY COMMENTS	JVG
3	2012-01-11	REVISED AS PER COORDINATION WITH DSEL	JVG
4	2012-01-26	REVISED AS PER CITY COMMENTS	JVG

PROJECT

Lansdowne
THE TRANSFORMATION OF LANSDOWNE PARK
LA TRANSFORMATION DU PARC LANSDOWNE

DRAWING TITLE

GRADING PLAN

DATE	DRAWING No.
Oct. 13, 2011	C02
SCALE 1:600	
REVISION # 4	



LEGEND

- PROPOSED STORM SEWER AND MAINTENANCE HOLE
- PROPOSED CATCH BASIN
- 65.00 PROPOSED SURFACE SWALE AND DIRECTION OF FLOW
- + 65.81 PROPOSED GRADE
- EXISTING GRADE
- STORM CATCHMENT BOUNDARY AREA
- B / 0.82 STORM CATCHMENT AREA ID / AREA (ha)

CLIENT PARTNERSHIP

Ottawa

OSEG
Ottawa Sports and Entertainment Group

CONSULTANT TEAM

CANNONDESIGN
AN IDEAS BASED PRACTICE

CORUSH SUNDERLAND WRIGHT

DSEL
david schaeffer engineering ltd
SMART SUBDIVISIONS

GreenbergFarrow

Stantec

PHILLIPS FAREVAAG SMALLENBERG
PLANNING • URBAN DESIGN
LANDSCAPE ARCHITECTURE

COPYRIGHT RESERVED
This plan and design are, and at all times remain the exclusive property of the client and consultant team and cannot be used or reproduced without written consent.
Do not scale drawings. This drawing shall not be used for construction.

REVISIONS

No.	Date	Details	By
1	2011-11-21	ISSUED TO CITY FOR REVIEW	JVG
2	2011-12-12	REVISED AS PER CITY COMMENTS	JVG
3	2012-01-11	REVISED AS PER COORDINATION WITH DSEL	JVG
4	2012-01-26	REVISED AS PER CITY COMMENTS	JVG

1:600 0 6 18 30m

PROJECT

Lansdowne
THE TRANSFORMATION OF LANSDOWNE PARK
LA TRANSFORMATION DU PARC LANSDOWNE

DRAWING TITLE
CATCHMENT AREA PLAN

DATE

SCALE 1:600

REVISION # 4

DRAWING No. C03

V:\01-634\active\1604_00832_Lansdowne Park Competition\design\drawing\160400832 Civil Stantec.dwg Feb06 ,2012 - 3:16pm



LEGEND

PROPOSED STORM SEWER AND MAINTENANCE HOLE

PROPOSED CATCH BASIN

HOLMWOOD AVENUE

LANSDOWNE WAY

ABERDEEN WAY

ABERDEEN SQUARE

BLOCK A

BLOCK B

BLOCK C

BLOCK D

BLOCK G

BLOCK H

BLOCK I

BLOCK J

BLOCK K

BLOCK L

RELOCATED HORTICULTURE BUILDING

CIVIC GARDEN

HEIRLOOM ORCHARD

NCC LANDS

SHUTTLE LOOP

SKATING COURT

CHILDREN'S GARDEN

ABERDEEN PAVILION

WEST COURT

EAST COURT

GREAT PORCH

GREAT LAWN

THE BEACON

THE CROSSING

THE SCREEN

THE HILL

EAST BERM

EXISTING FIELD

SOUTH BERMS

NORTH SIDE STANDS
CIVIC ARENA + SALONS BELOW

BLOCK K
INTERFACE ZONE

BANK STREET

QUEEN ELIZABETH DRIVEWAY

RIDEAU RIVER

JOB BENCH MARK #1
MAGNETIC NAIL SET IN TOP OF CONCRETE CANAL WALL
ELEVATION=64.581

JOB BENCH MARK #2
MAGNETIC NAIL SET IN TOP OF OLD CONCRETE BASE
ELEVATION=65.350

JOB BENCH MARK #3
MAGNETIC NAIL SET IN TOP OF CONCRETE SLAB
ELEV=67.553

JOB BENCH MARK #4
TOP CORNER OF CONCRETE WALL
ELEVATION=67.617

JOB BENCH MARK #5
TOP OF SOUTHWEST BOLT OF LAMP STANDARD
ELEV=65.51

CANAL OUTLET
INV=62.50

OPERATING LEVEL OF CANAL DURING NAVIGATION SEASON
64.03m TO 64.08m

GENERAL NOTES

1. ALL WORK SHALL BE CARRIED OUT IN CONFORMITY WITH THE ONTARIO OCCUPATIONAL HEALTH AND SAFETY ACT AND REGULATIONS FOR CONSTRUCTION PROJECTS.
2. ALL WORK AND MATERIALS TO CONFORM WITH CURRENT SPECIFICATIONS OF THE CORPORATION & DISTRICT OF ONTARIO, CITY OF OTTAWA AND ONTARIO PROVINCIAL STANDARDS AND SPECIFICATIONS, LOCAL UTILITY STANDARDS AND AMENDTS OF TRANSPORTATION STANDARDS ALL APPLY WHERE REQUIRED.
3. THE CONTRACTOR IS ADVISED THAT WORKS BY OTHERS MAY BE ONGOING DURING THE PERIOD OF THIS CONTRACT. THE CONTRACTOR SHALL COORDINATE HIS CONSTRUCTION ACTIVITIES AND COOPERATION WITH ALL OTHER CONTRACTORS AND PREVENT CONSTRUCTION CONFLICTS.
4. THE INFORMATION SHOWN FOR EXISTING UTILITIES WAS PROVIDED BY OTHERS. THE CONTRACTOR IS RESPONSIBLE FOR LOCATING AND PROTECTING ALL UTILITIES DURING CONSTRUCTION. ALL EXISTING UTILITIES MUST BE LOCATED AND VERIFIED BY EACH UTILITY PRIOR TO COMMENCEMENT OF WORK. ANY VARIANCE TO THE LOCATIONS SHOWN ON THE DRAWINGS MUST BE REPORTED TO THE ENGINEER. IT IS THE RESPONSIBILITY OF THE UTILITY LOCATORS AND NOTIFY THE ENGINEER OF POSSIBLE CONFLICTS PRIOR TO EXCAVATION. ALL TIE OF UTILITY LOCATIONS SHALL BE SHOWN.
5. ALL CONSTRUCTION SHALL BE CARRIED OUT IN ACCORDANCE WITH THE RECOMMENDATIONS MADE IN THE GEOTECHNICAL REPORT.
6. THE CONTRACTOR IS RESPONSIBLE FOR OBTAINING ALL PERMITS REQUIRED AND TO BEAR THE COST OF SAME, INCLUDING WATER PERMIT AND ASSOCIATED COSTS.
7. ALL DISTURBED AREAS SHALL BE REINSTATED TO EQUAL OR BETTER CONDITION TO THE SATISFACTION - THE ENGINEER AND THE CITY. PAVEMENT REINSTATEMENT AND UTILITY CUTS SHALL BE IN ACCORDANCE WITH OPSD 500.010 AND OPSD 310.010.
8. FOR DETAILS RELATING TO STORMWATER MANAGEMENT AND ROOF DRAINAGE, SEE THE STORMWATER MANAGEMENT REPORT PREPARED BY GREENBERG FARROW LTD. ROOF DRAINAGE TO BE PROVIDED VIA RESTRICTED RELEASE ROOF DRAINS AS DETAILED IN THE REPORT.
9. BENCHMARKS IS IT THE RESPONSIBILITY OF THE CONTRACTOR TO VERIFY THAT THE SITE BENCHMARKS HAS NOT BEEN ALTERED OR DISTURBED AND THAT ITS RELATIVE ELEVATION AND DESCRIPTION AGREES WITH THE INFORMATION SHOWN ON DRAWING GP-1.
10. THE CONTRACTOR SHALL PROVIDE TO THE ENGINEER 1 (ONE) SET OF AS CONSTRUCTED SITE SERVICING, GRADING AND SITE ELECTRICAL DWGS.
11. REFER TO RISK MANAGEMENT PLANS FOR CAPPING OF LANDFILL AREAS.

STORM AND SANITARY SEWERS

1. STORM AND SANITARY MANHOLES SHALL BE IN ACCORDANCE WITH OPSD 701.010 TO 701.014. STORM MANHOLES TO HAVE FRAME AND COVER FOR OPSD 401.030, CATCH BASIN MANHOLES TO HAVE FRAME AND COVER FOR OPSD 400.020, SANITARY MANHOLES TO HAVE FRAME AND COVER AS PER OPSD 401.030 UNLESS OTHERWISE NOTED. ALL MANHOLES TO BE BENCHED AS PER OPSD 701.021 AND OPSD 701.030 TO 701.031 TO BE USED. SAFETY PLATFORM TO BE INSTALLED IN ALL MANHOLES WHERE DEPTH EXCEEDS 7.0m.
2. ALL CATCH BASINS TO BE PRECAST TO OPSD 705.010 c/w FRAME AND GRATE AS PER OPSD 400.020.
3. SEWER TRENCH SHALL CONSIST OF CLASS 'B' BEDDING PER CITY OF OTTAWA STANDARDS SB AND ST. DEPARTMENT SHALL BE IN APPLY AND OTHER STANDARD PRACTICE DRAWINGS.
4. ALL STORM SEWER PIPES UP TO AND INCLUDING 675mm DIA. SHALL BE PVC DR35 OR APPROVED EQUIVALENT UNLESS OTHERWISE NOTED. ALL SANITARY SEWER PIPES SHALL BE SDR-35 CONFORMING TO CSA SPECIFICATIONS B182.2-M1995 OR LATEST AMENDMENT UNLESS OTHERWISE NOTED. ALL STORM SEWER PIPES 750mm DIA. AND LARGER SHALL BE CONCRETE PIPE TO CSA SPECIFICATIONS A257.2-M1992 OR LATEST AMENDMENT UNLESS OTHERWISE NOTED.
5. ALL SEWER PIPE SPIGOT ENDS SHALL BE SDR-35 EQUAL TO CSA SPECIFICATIONS B182.2-M1995 OR LATEST AMENDMENT UNLESS OTHERWISE NOTED.
6. ALL MANHOLES AND CATCH BASIN EXCAVATIONS TO BE BACKFILLED WITH GRANULAR MATERIAL COMPACTED TO 98% STANDARD PROCTOR DENSITY.
7. STORM MANHOLES SHALL NOT BE BENCHED UNLESS OTHERWISE SPECIFIED. SANITARY MANHOLES SHALL BE BENCHED TO SPRINGLINE WITHIN NOTCH OF BENCHING TO BE 25mm OR AS SPECIFIED ON DRAWINGS. GRANULAR 'A' SHALL BE PLACED TO A MIN. THICKNESS OF 300mm AROUND ALL STRUCTURES IN PAVEMENT AREA. MANHOLE DROP STRUCTURES TO BE INSTALLED PER OPSD 1050.01.
8. "MODIFIED" OR APPROVED PRE-CAST MANHOLE AND CATCH BASIN ADJUSTERS TO BE USED IN LIEU OF BRICK AND MORTAR ADJUSTING UNIT ON THIS PROJECT.
9. FOR CONSTRUCTION DETAILS NOT SHOWN ON PLANS, REFERENCE SHALL BE MADE TO THE ONTARIO PROVINCIAL STANDARD SPECIFICATIONS AND DRAWINGS (OPSS AND OPSD).
10. CURBLETS TO BUILDING TO BE TERMINATED 1.0m FROM THE OUTSIDE FACE OF BUILDING UNLESS OTHERWISE SPECIFIED.
11. ALL SINGLE CATCH BASIN LEADS TO BE 200mmØ PVC, SDR-35 OR APPROVED EQUIVALENT UNLESS OTHERWISE SPECIFIED. CATCH BASIN LEADS TO HAVE MINIMUM GRADE OF 1.0%.
12. ALL CB LEAD INVERTS TO BE 1.5m BELOW FINISHED GRADE UNLESS OTHERWISE SPECIFIED.
13. THE CONTRACTOR IS TO PROVIDE CITY CAMERA INSPECTIONS OF ALL SANITARY AND STORM SEWERS, INCLUDING LEADS, AS REQUIRED BY THE CITY OF OTTAWA. ALL SEWERS SHALL BE CLEANED AND FLUSHED TO THE SATISFACTION OF THE ENGINEER PRIOR TO CAMERA INSPECTION. ASPHALT BASE COURSE SHALL NOT BE PLACED UNTIL THE VIDEO INSPECTION OF SEWERS IS NECESSARY REPAIRS HAVE BEEN CARRIED OUT TO THE SATISFACTION OF THE CONSULTANT.
14. LASER ALIGNMENT CONTROL TO BE UTILIZED ON ALL SEWER INSTALLATIONS.
15. EXISTING MANHOLES TO BE RE-BENCHED WHERE A NEW CONNECTION IS MADE.
16. FROST PROTECTION PER CITY OF OTTAWA STANDARD DRAWING R22 WHERE LESS THAN 1.5m OF COVER.
17. ALL CATCH BASINS AND CATCH BASIN MANHOLES TO HAVE 3.0m LONG SUB-DRAINS RESTING ON IT IN DIRECTIONS IN PARKING AREAS AND UNDER SIDEWALK ADJACENT TO BUILDING. SUBDRAINS TO BE PLACED IN TRENCH WITH 19mm CLEAR STONE BEDDING AND COVER. SUBDRAINS TO BE WRAPPED IN FILTER CLOTH. DRAINAGE STONE OF MIN. 150mm THICKNESS. SINGLE SHIELD HDPE NON-WOVEN GEOTEXTILE MEMP-4WSSNL.
18. CONTRACTOR SHALL PERFORM LEAKAGE TESTING IN THE PRESENCE OF THE CONSULTANT, FOR SANITARY SEWERS IN ACCORDANCE WITH OPSS 410 AND OPSS 407. AS PART OF THE INSPECTION REPORT SHALL BE SUBMITTED TO THE CONSULTANT.
19. STORM SEWER INLET CONTROL DEVICES TO BE INSTALLED AS OUTLINED IN THE ICD SCHEDULE ON THIS DRAWING. INLET CONTROL DEVICES TO BE INSTALLED AT THE DOWNSTREAM MANHOLE OF EACH GRATE INLET.
20. MAIN SEWER CONNECTIONS ARE CONCRETE TO CONCRETE UNLESS STRUCTURE IS TO BE USED.
21. 100mmØ PERFORATED SUB-DRAIN AROUND LANDSCAPED TREE ISLANDS TO BE CONNECTED TO STORM SEWER. REFER TO LANDSCAPE PLANS L1-14 AND L1-26 PREPARED BY LANDSCAPE ARCHITECTS.
22. ALL SEWERS LESS THAN 0.60% SHALL INCLUDE A 250mmØ PERFORATED SUBDRAIN AS PER CITY STANDARD S28.
23. ALL CATCH BASINS SHALL INCLUDE A FLEXIBLE TRAP ICD ASSEMBLY. THE ICD SHALL BE EQUAL TO THE PIPE SIZE.
24. ALL SANITARY SEWER MANHOLES SHALL BE PRESSURE RATED. THE MANHOLE SHALL BE TESTED TO ENSURE NO LEAKAGE AT A TEST PRESSURE OF 35kpa. MAX FRAME AND COVER SHALL BE SECURED TO RESIST UPLIFT PRESSURES OF 700 kpa. OF 35KPA.
25. A STORM WATER QUALITY CONTROL STRUCTURE SHALL BE ADDED BY THE OWNER ONCE THE COMBINED SEWER SYSTEM IS SEPARATED.

WATERMAIN

1. WATERMAIN SHALL BE POLYVINYL CHLORIDE (PVC) CLASS 150 DR-18 PIPE MANUFACTURED TO AWWA C900-89 AND CSA CAN3 B137.3-M1989 WITH GASKETED BELL END C/W #14 AWG SOLID COPPER TRACER WIRE.
2. ALL WATERMAINS, WATER SERVICES, CONNECTIONS AND APPURTENANCES AS PER CITY OF OTTAWA STANDARDS. THE CONTRACTOR SHALL CO-ORDINATE AND PAY ALL RELATED COSTS INCLUDING THE COST OF CONNECTION, DISINFECTION AND INSPECTION BY CITY OF OTTAWA PERSONNEL. WATERMAIN TESTING TO BE IN ACCORDANCE WITH CITY OF OTTAWA SPECS.
3. ALL WATERMAINS SHALL HAVE MIN. COVER OF 2.4m. WATERMAINS ARE TO BE INSTALLED TO THE ELEVATIONS SHOWN ON THE APPROVED SITE SERVICING DRAWING. WHERE SPECIFIED WATERMAIN ELEVATIONS ARE NOT SHOWN ON SERVICING DRAWING, A MINIMUM COVER OF 2.4m FROM PROPOSED GRADES, AS SHOWN ON THE GRADING PLAN, MUST BE MAINTAINED AT ALL TIMES. IN PREVIOUS AREAS COVER TO BE FROM PREVIOUS ELEVATIONS.
4. ALL WATERMAIN BENDS, JOINTS, TEES AND PLUGS SHALL BE MECHANICALLY RESTRAINED IN ACCORDANCE WITH CITY OF OTTAWA STANDARDS.
5. ALL FIRE HYDRANT INSTALLATIONS SHALL BE PER CITY OF OTTAWA W10. HYDRANTS SHALL BE PAINTED IN ACCORDANCE WITH OTTAWA STANDARDS. CONTRACTOR SHALL ORDER HYDRANTS AS DIRECTED BY LOCAL FIRE DEPARTMENT.
6. ALL BOTTOM OF HYDRANT FLANGE ELEVATIONS TO BE INSTALLED 0.15m ABOVE PROPOSED FINISHED GRADE AT HYDRANT.
7. BUILDING SERVICE TO BE CAPPED 1.0m OFF THE FACE OF THE BUILDING UNLESS OTHERWISE NOTED AND MUST BE RESTRAINED A MINIMUM OF 10m BACK FROM STUB.
8. WATERMAINS MUST COMPLY WITH MINIMUM HORIZONTAL AND VERTICAL CLEARANCES IN ACCORDANCE WITH LOCAL UTILITY REQUIREMENTS AND MOE GUIDELINES. WATERMAIN CROSSING SEWERS SHALL BE LAID SUCH THAT THE WATERMAIN CANNOT BE ACCIDENTALLY APPROVED FROM THE STANDARD MUST BE DEFLECTED AND A MINIMUM 500mm VERTICAL SEPARATION MUST BE MAINTAINED.
9. ALL WATERMAINS TO BE DISINFECTED INDIVIDUALLY TESTED IN ACCORDANCE WITH THE CITY OF OTTAWA AND ONTARIO GUIDELINES. ALL DISINFECTING WORK TO BE UNDERTAKEN AND SUPERVISED BY A CERTIFIED OPERATOR. PROVISIONS FOR FLUSHING WATER LINE PRIOR TO TESTING, ETC. MUST BE PROVIDED.
10. ALL WATERMAINS SHALL BE BACTERIOLOGICALLY TESTED IN ACCORDANCE WITH THE CITY OF OTTAWA AND ONTARIO GUIDELINES. ALL CHLORINATED WATER TO BE DECHLORIZED AND PRETREATED TO ACCEPTABLE LEVELS PRIOR TO DISCHARGE TO THE ENVIRONMENT. ALL TESTING TO BE CARRIED OUT IN THE PRESENCE OF THE CONSULTANT AND THE ENVIRONMENT. IT IS THE RESPONSIBILITY OF THE CONTRACTOR TO ENSURE THAT ALL MUNICIPAL AND/OR PROVINCIAL REQUIREMENTS ARE FOLLOWED.
11. ALL WATERMAIN STUBS SHALL BE TERMINATED WITH A PLUG AND 50mm BLOW OFF UNLESS OTHERWISE NOTED.
12. CATHODIC PROTECTION PER CITY OF OTTAWA W40 AND W42.
13. THE SITE WATER FIXTURE IS TO BE BULK METERED AND FOR COST SHARING PURPOSES INDIVIDUAL WATER CONSUMPTION METERS ARE REQUIRED ON ALL INDIVIDUAL BUILDING CONNECTIONS.

0 6 18 30m
1:600

CLIENT PARTNERSHIP

Ottawa

OSEG
Ottawa Sports and Entertainment Group

CONSULTANT TEAM

CANNONDESIGN
AN IDEAS BASED PRACTICE

CORUSH SUNDERLAND WRIGHT

DSEL
david schaeffer engineering ltd
SMART SUBDIVISIONS

GreenbergFarrow

Stantec

PHILLIPS FAREVAAG SMALLENBERG
PLANNING • URBAN DESIGN
LANDSCAPE ARCHITECTURE

COPYRIGHT RESERVED

This plan and design are, and at all times remain the exclusive property of the client and consultant team and cannot be used or reproduced without written consent.

Do not scale drawings. This drawing shall not be used for construction.

REVISIONS

No.	Date	Details	By
1	2011-11-21	ISSUED TO CITY FOR REVIEW	JVG
2	2011-12-12	REVISED AS PER CITY COMMENTS	JVG
3	2012-01-11	REVISED AS PER COORDINATION WITH DSEL	JVG
4	2012-01-26	REVISED AS PER CITY COMMENTS	JVG

PROJECT

Lansdowne
THE TRANSFORMATION OF LANSDOWNE PARK
LA TRANSFORMATION DU PARC LANSDOWNE

DRAWING TITLE


INTERIM STORM SEWER CONNECTION PLAN

DATE Oct. 13, 2011


SCALE 1:600

REVISION # 4


DRAWING No. C04

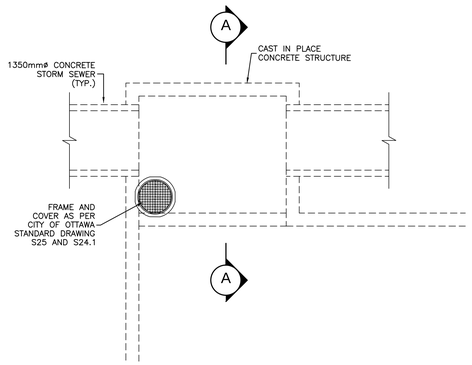


PLAN VIEW - AT GRADE

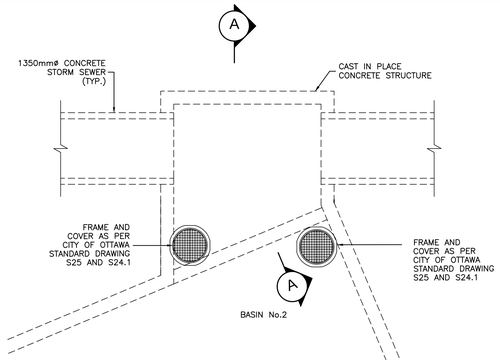


PLAN VIEW - AT GRADE

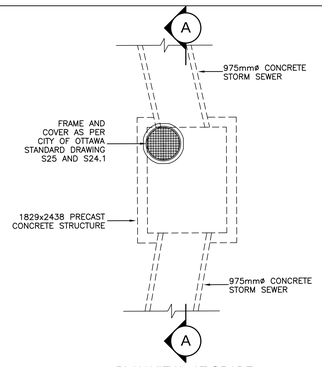


PLAN VIEW - AT GRADE

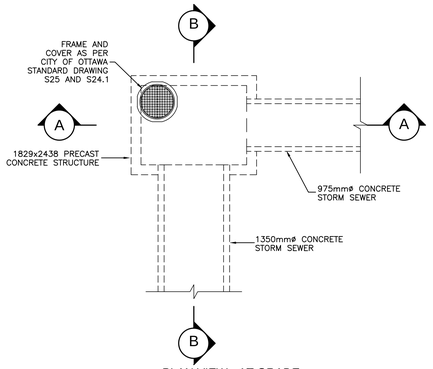


PLAN VIEW - AT GRADE

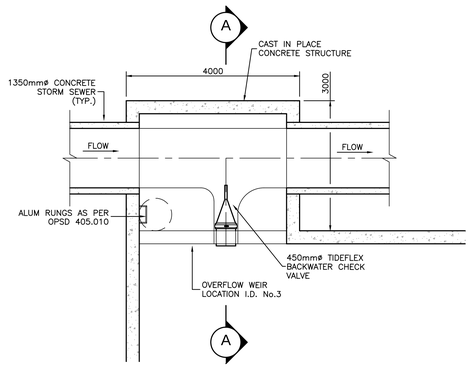


PLAN VIEW - SECTION

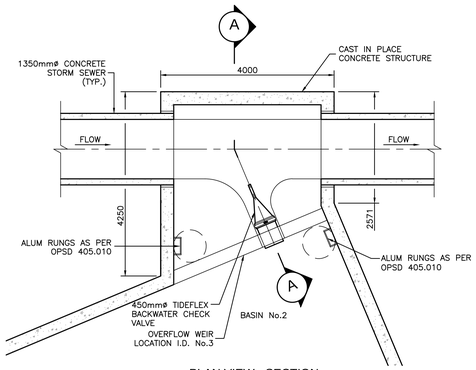


PLAN VIEW - SECTION

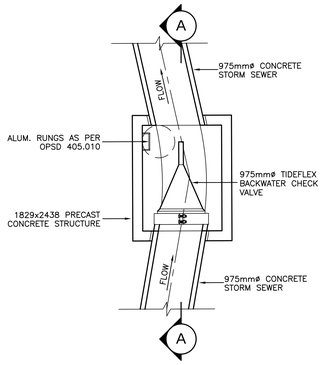


PLAN VIEW - SECTION

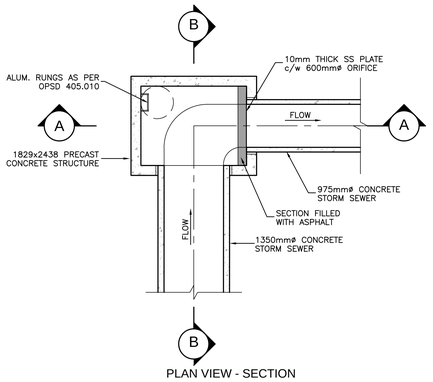


PLAN VIEW - SECTION

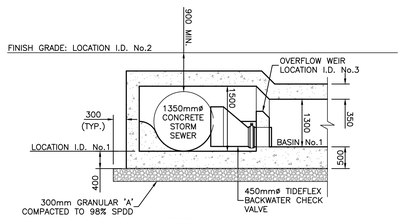

SECTION A-A

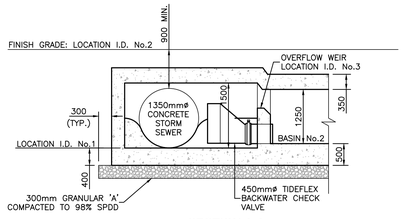


SECTION A-A

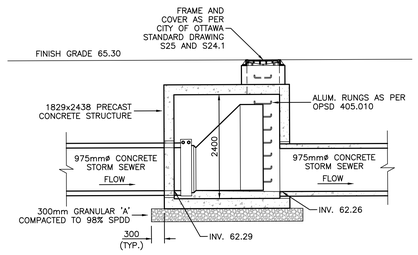


SECTION A-A

FLOW CONTROL MANHOLE No.101
DETAIL

0 500 1500 2500mm

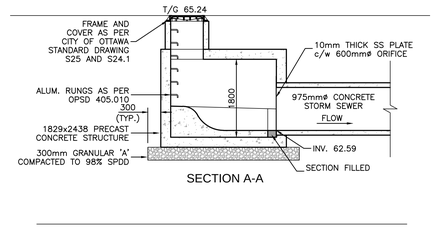

SECTION A-A

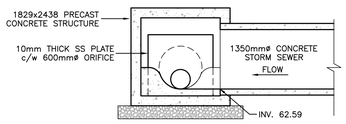

SECTION B-B

FLOW CONTROL MANHOLE No.105
DETAIL


0 500 1500 2500mm

ELEVATION TABLE–BASIN No.1	
LOCATION I.D. No.	NORTH MANHOLE 1
1	62.71
2	65.04
3	63.65

FLOW CONTROL MANHOLE TO SWM
BASIN No.1 DETAIL
N.T.S.

ELEVATION TABLE–BASIN No.2	
LOCATION I.D. No.	WEST MANHOLE 1
1	62.85
2	65.14
3	63.75

FLOW CONTROL MANHOLE TO SWM
BASIN No.2 DETAIL
N.T.S.

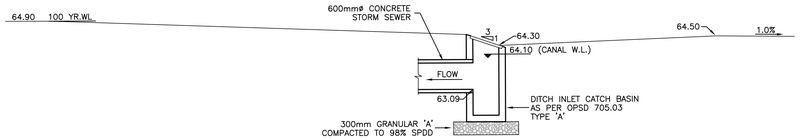

CANAL FLOW CONTROL MANHOLE

0 500 1500 2500mm

CLIENT PARTNERSHIP

CONSULTANT TEAM

CANNONDESIGN
AN IDEAS BASED PRACTICE

CORUSH SUNDERLAND WRIGHT

DSEL
david schaeffer engineering ltd
SMART SUBDIVISIONS™

GreenbergFarrow

Stantec

PHILLIPS FAREVAAG SMALLENBERG
PLANNING • URBAN DESIGN
LANDSCAPE ARCHITECTURE

COPYRIGHT RESERVED

This plan and design are, and at all times remain the exclusive property of the client and consultant team and cannot be used or reproduced without written consent.

Do not scale drawings. This drawing shall not be used for construction.

REVISIONS

No.	Date	Details	By
1	2011-11-21	ISSUED TO CITY FOR REVIEW	JVG
2	2011-12-12	REVISED AS PER CITY COMMENTS	JVG
3	2012-01-26	REVISED AS PER CITY COMMENTS	JVG

PROJECT

Lansdowne
THE TRANSFORMATION OF LANSDOWNE PARK
LA TRANSFORMATION DU PARC LANSDOWNE


DRAWING TITLE
DETAILS

DATE


SCALE
AS SHOWN

REVISION #
3


DRAWING No.
C05

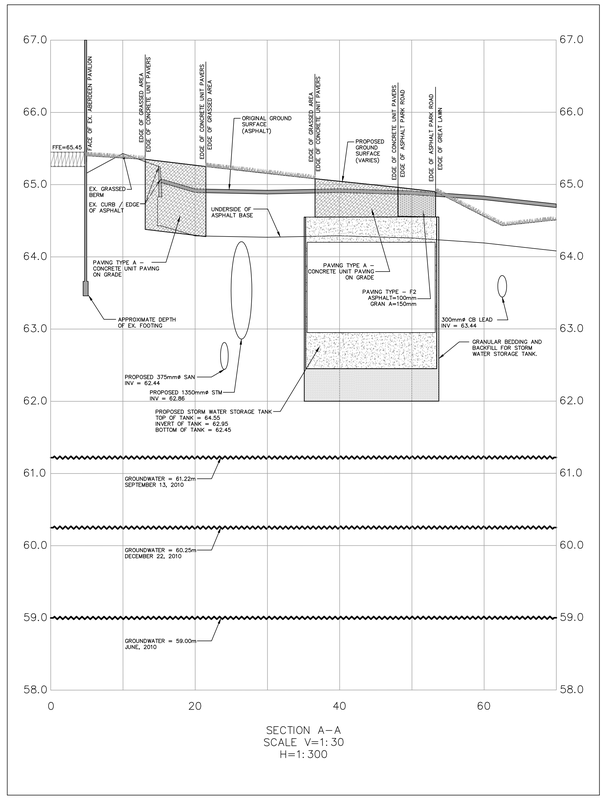


SECTION A–A
SCALE V=1:30
H=1:300

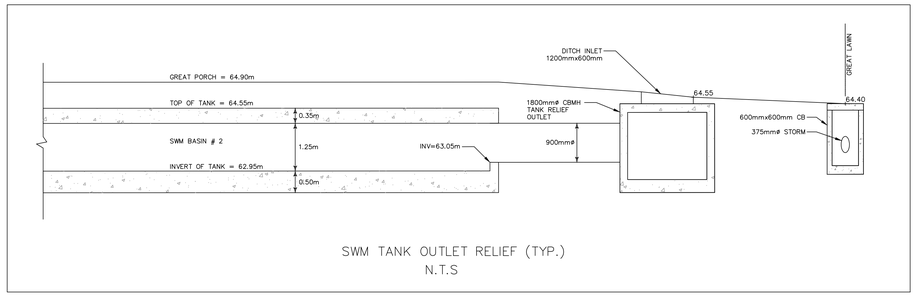


SWM TANK OUTLET RELIEF (TYP.)
N.T.S

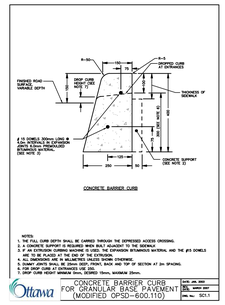


CONCRETE BARRIER CURB FOR GRANULAR BASE PAVEMENT (MODIFIED OPSD-600.110)

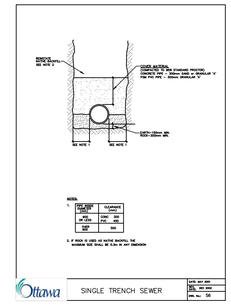


SINGLE TRENCH SEWER

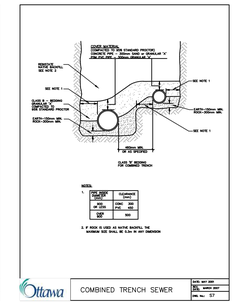


COMBINED TRENCH SEWER

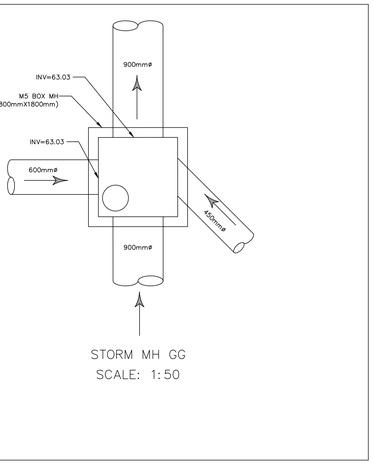


STORM MH GG
SCALE: 1:50

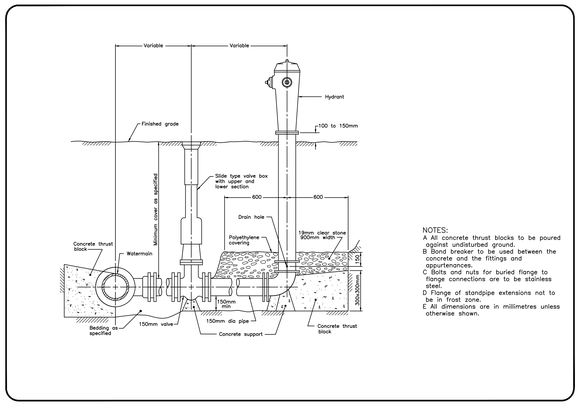

NOTES:
A All concrete thrust blocks to be poured against undisturbed ground.
B Bond breaker to be used between the concrete and the fittings and appurtenances.
C Bolts and nuts for buried flange to flange connections are to be stainless steel.
D Flange of standpipe extensions not to be in frost zone.
E All dimensions are in millimetres unless otherwise shown.

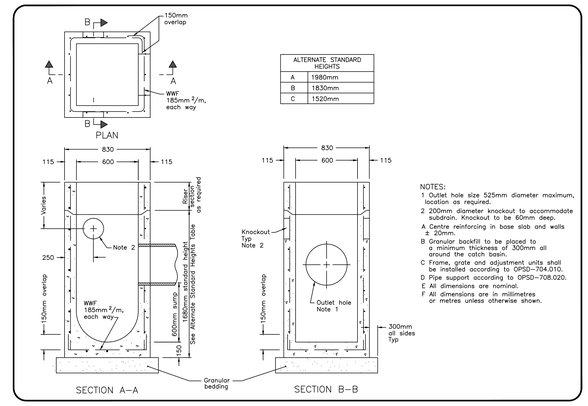

NOTES:
1 Outlet hole size 525mm diameter maximum, location as required.
2 200mm diameter knockout to accommodate subdrain. Knockout to be 60mm deep.
A Centre reinforcing in base slab and walls ± 20mm.
B Granular backfill to be placed to a minimum thickness of 300mm all around the catch basin.
C Frame, grate and adjustment units shall be installed according to OPSD-704.010.
D Pipe support according to OPSD-708.020.
E All dimensions are nominal.
F All dimensions are in millimetres or metres unless otherwise shown.

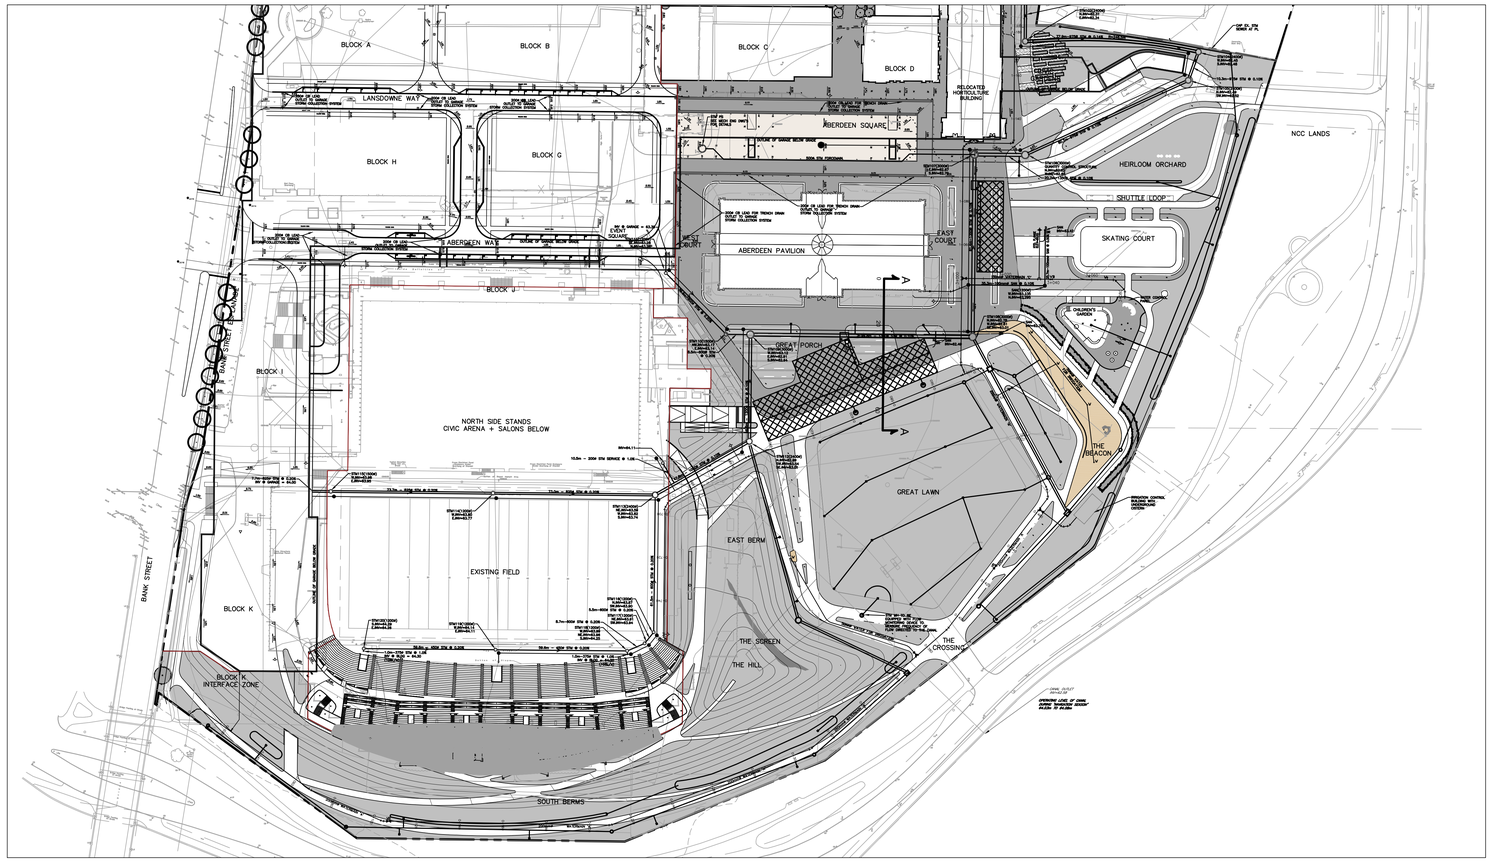

CLIENT PARTNERSHIP

Ottawa

OSEG
Ottawa Sports and Entertainment Group

CONSULTANT TEAM

CANNONDESIGN
AN IDEAS BASED PRACTICE

CORUSH SUNDERLAND WRIGHT

DSEL
david schaeffer engineering ltd
SMART SUBDIVISION

GreenbergFarrow

Stantec

PHILLIPS FAREVAAG SMALLENBERG
PLANNING • URBAN DESIGN
LANDSCAPE ARCHITECTURE

COPYRIGHT RESERVED

This plan and design are, and at all times remain the exclusive property of the client and consultant team and cannot be used or reproduced without written consent.

Do not scale drawings. This drawing shall not be used for construction.

REVISIONS

No.	Date	Details	By
1	2011-11-21	ISSUED TO CITY FOR REVIEW	JVG
2	2011-12-12	REVISED AS PER CITY COMMENTS	JVG
3	2012-01-26	REVISED AS PER CITY COMMENTS	JVG

PROJECT

Lansdowne
THE TRANSFORMATION OF LANSDOWNE PARK
LA TRANSFORMATION DU PARC LANSDOWNE

DRAWING TITLE


DETAILS

DATE

SCALE
AS SHOWN

REVISION #
3

DRAWING No.
C06

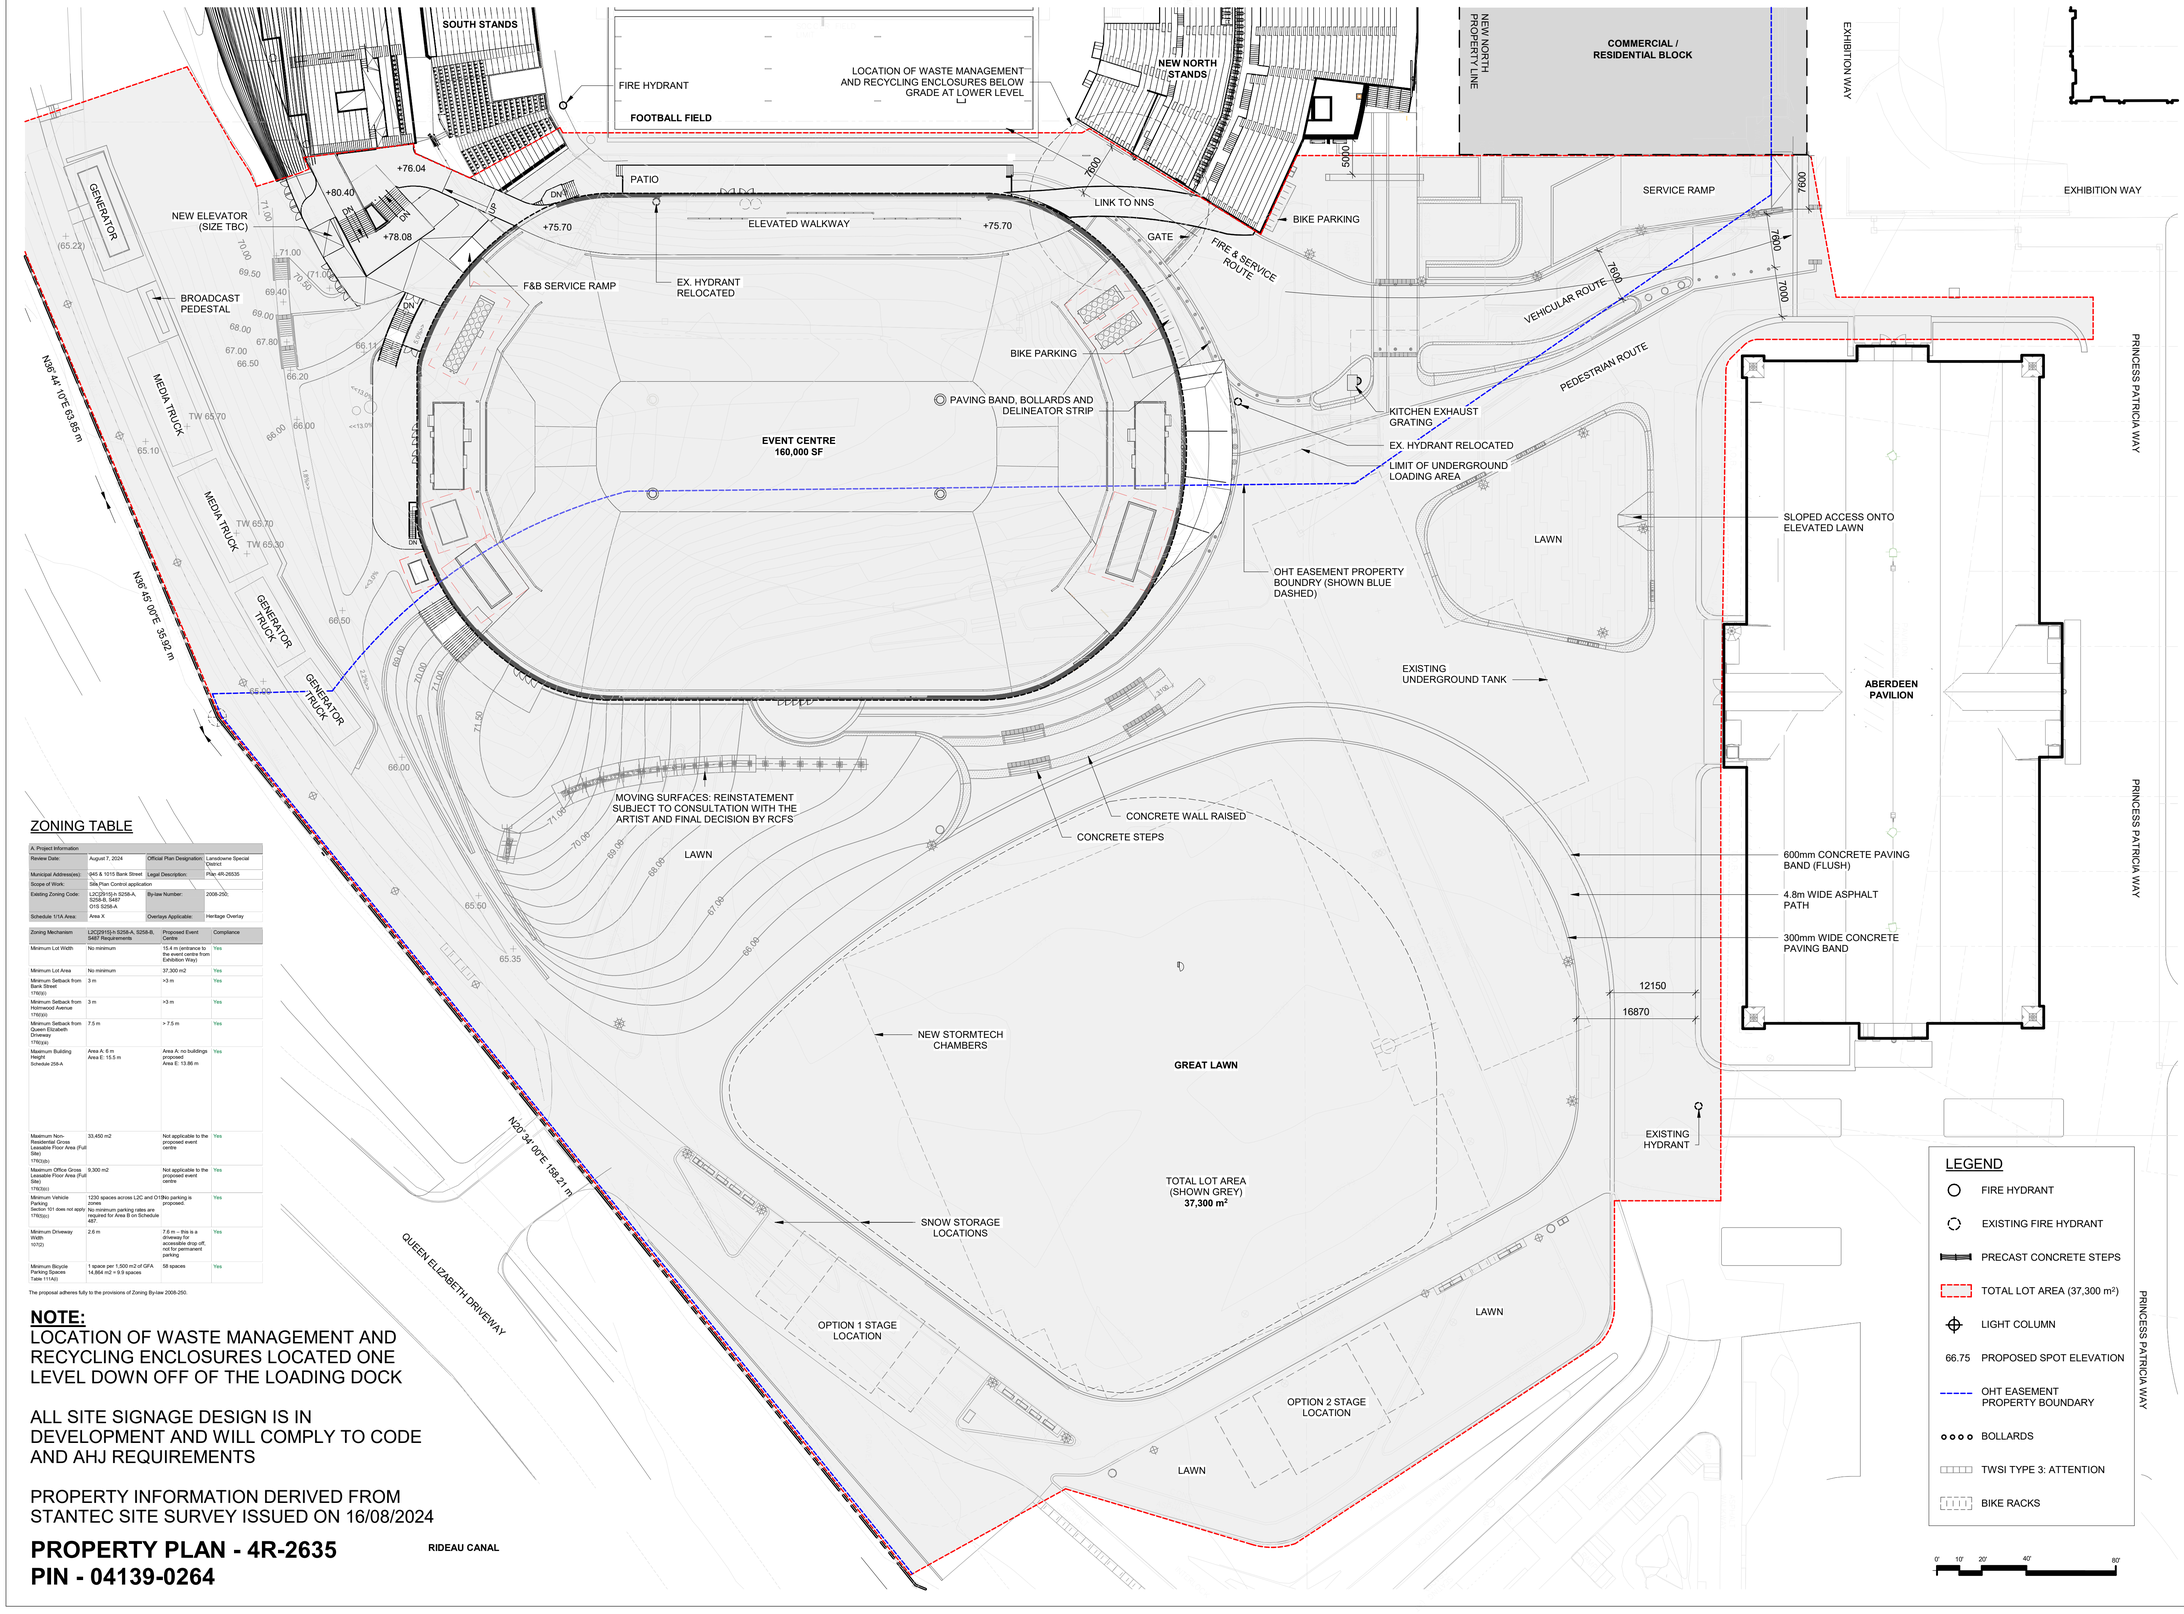

ZONING TABLE

A. Project Information			
Review Date:	August 7, 2024	Official Plan Designation:	Lansdowne Special Qwlnd
Municipal Address(es):	945 & 1015 Bank Street	Legal Description:	Plan 4R-26535
Scope of Work:	Site Plan Control application		
Existing Zoning Code:	L2C[2915]-h 9258-A, 9258-B, S487 - 019, 9258-A	By-law Number:	2008-250;
Schedule: I/1A Area:	Area X	Overlays Applicable:	Heritage Overlay

Zoning Mechanism	L2C[2915]-h 9258-A, 9258-B, S487 Requirements	Proposed Event Centre	Compliance
Minimum Lot Width	No minimum	15.4 m (entrance to the event centre from Exhibition Way)	Yes
Minimum Lot Area	No minimum	37,300 m2	Yes
Minimum Setback from Bank Street 176(9)(i)	3 m	>3 m	Yes
Minimum Setback from Holmwood Avenue 176(9)(i)	3 m	>3 m	Yes
Minimum Setback from Queen Elizabeth Driveway 176(9)(a)	7.5 m	> 7.5 m	Yes
Maximum Building Height Schedule 258-A	Area A: 6 m Area E: 15.5 m	Area A: no buildings proposed Area E: 13.86 m	Yes
Maximum Non-Residential Gross Leasable Floor Area (Full Site) 176(3)(b)	33,450 m2	Not applicable to the proposed event centre	Yes
Maximum Office Gross Leasable Floor Area (Full Site) 176(3)(c)	9,300 m2	Not applicable to the proposed event centre	Yes
Minimum Vehicle Parking Section 101 does not apply 176(5)(c)	1230 spaces across L2C and O1 No minimum parking rates are required for Area B on Schedule 442	No parking is proposed.	Yes
Minimum Driveway Width 107(2)	2.6 m	7.6 m – this is a driveway for accessible drop off, not for permanent parking	Yes
Minimum Bicycle Parking Spaces Table 111A(i)	1 space per 1,500 m2 of GFA 14,864 m2 = 9.9 spaces	58 spaces	Yes

The proposal adheres fully to the provisions of Zoning By-law 2008-250.

NOTE:
LOCATION OF WASTE MANAGEMENT AND RECYCLING ENCLOSURES LOCATED ONE LEVEL DOWN OFF OF THE LOADING DOCK

ALL SITE SIGNAGE DESIGN IS IN DEVELOPMENT AND WILL COMPLY TO CODE AND AHJ REQUIREMENTS

PROPERTY INFORMATION DERIVED FROM STANTEC SITE SURVEY ISSUED ON 16/08/2024

PROPERTY PLAN - 4R-2635
PIN - 04139-0264

© Copyright of BBB Architects Toronto Inc. 2024.
Not to be reproduced or distributed without written authorization of the copyright owner.

DATE PLOTTED: 2025-01-13 1:53:16 PM

Ottawa
OSEG Ottawa Sports and Entertainment Group
BRISBIN BROOK BEYNON ARCHITECTS
14 DUNCAN ST 4TH FLOOR
TORONTO, ON M5H 3G8
(416) 591-8999
ENTUITIVE
135 LAURIER AVE WEST, SUITE 413
OTTAWA, ON K1P 5J2
(343) 308-9274
STRUCTURAL
TMP
200 KING. ST. WEST, SUITE 310
TORONTO, ON M5H 3T4
(416) 499-8000
MECH, PLUMB, FIRE PROTECTION
MULVEY & BANANI
90 SHEPPARD AVE EAST, SUITE 500
TORONTO, ON M2N 3A
(416) 751-2520
ELECTRICAL
CSW
319 MCRAE AVENUE, SUITE 502
OTTAWA, ONTARIO K1Z 0B9
(613) 729-4536
LANDSCAPE

NO.	DESCRIPTION	DATE
4	ISSUED FOR 50% DD	2024-10-18
3	ISSUED FOR 35% DD	2024-10-04
2	ISSUED FOR CITY SPA COMMENTS	2024-09-05
1	ISSUED FOR SITE PLAN APPROVAL	2024-08-07

REVISIONS/ ISSUES

CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ANY OMISSIONS OR DISCREPANCIES TO THE ARCHITECT BEFORE PROCEEDING WITH THE WORK.
DO NOT SCALE THE DRAWINGS

A B C D

SEAL

THIS DOCUMENT IS RELEASED FOR THE PURPOSE OF PRELIMINARY SUBMITTAL

IT IS NOT TO BE USED FOR CONSTRUCTION PURPOSES

DRAWN JI
DATE 2024-10-04
CHECKED SJ

LANSDOWNE 2.0
EVENT CENTRE, NORTH SIDE STANDS AND PUBLIC REALM ENHANCEMENTS
945 & 1015 BANK STREET

DWG. TITLE
SITE PLAN - UPON COMPLETION OF EVENT CENTRE & NEW NORTH STANDS

SCALE 1 : 400
PROJ. NO. 2418
DWG. NO. EC-A1-004


IN PROGRESS

LEGEND


1. VERTICAL METAL PLANK SIDING
2. ALUMINUM FRAME CURTAIN WALL GLAZING W/ BIRD-SAFE GLAZING, REF TO SPECIFICATIONS
3. SPLIT FACE MASONRY BLOCK
4. MECHANICAL SCREENS
5. METAL FLASHING

NOTES:

1. ALL SIGNAGE TO COMPLY WITH THE LANSDOWNE SIGNAGE AND WAYFINDING PLAN

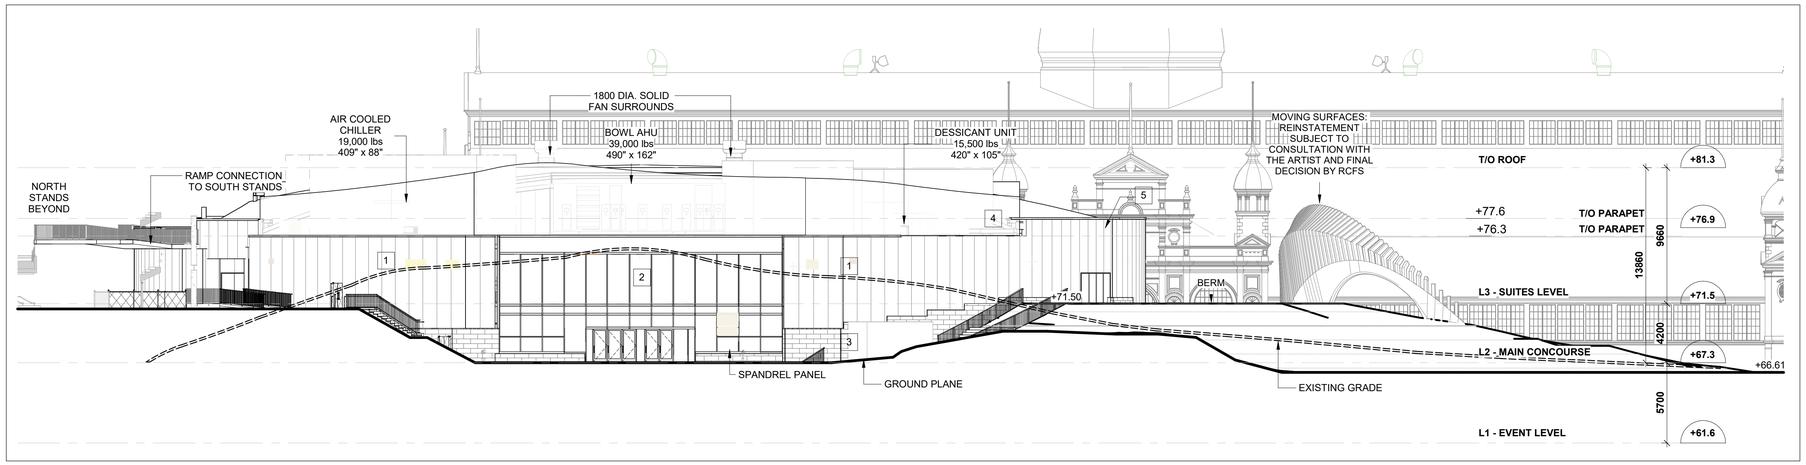

2 SOUTH ELEVATION - ARENA
1 : 200

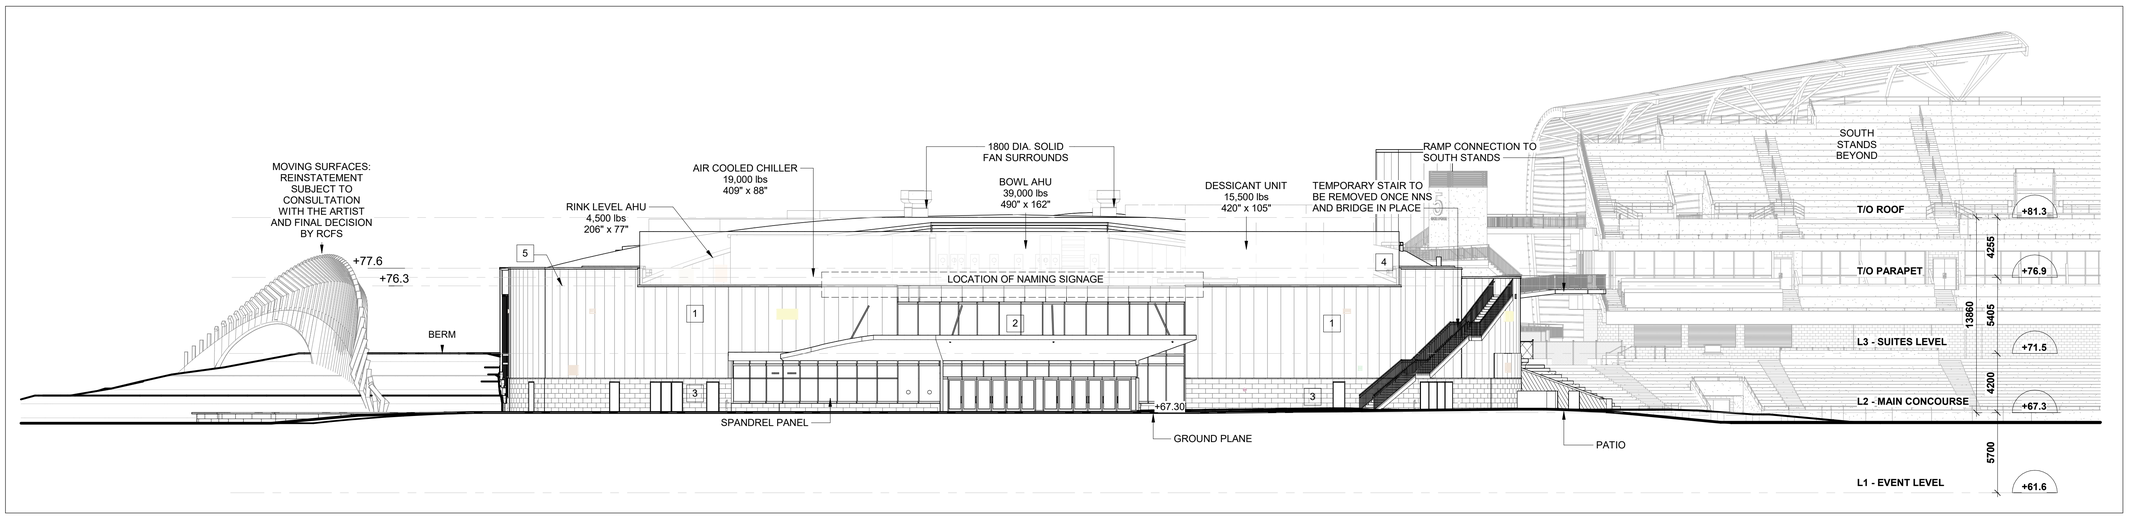

1 NORTH ELEVATION - ARENA
1 : 200

© Copyright of BBB Architects Toronto Inc. 2024.
Not to be reproduced or distributed without written authorization of the copyright owner.

DATE PLOTTED: 2025-01-13 1:53:43 PM

BRISBIN BROOK BEYNON ARCHITECTS
14 DUNCAN ST 4TH FLOOR
TORONTO, ON M5H 3G8
(416) 591-8999

ENTUITIVE
135 LAURIER AVE WEST, SUITE 413
OTTAWA, ON K1P 5J2
(343) 308-9274
STRUCTURAL

TMP
200 KING. ST. WEST, SUITE 310
TORONTO, ON M5H 3T4
(416) 499-8000
MECH, PLUMB, FIRE PROTECTION

MULVEY & BANANI
90 SHEPPARD AVE EAST, SUITE 500
TORONTO, ON M2N 3A
(416) 751-2520
ELECTRICAL

CSW
319 MCRAE AVENUE, SUITE 502
OTTAWA, ONTARIO K1Z 0B9
(613) 729-4536
LANDSCAPE

NO.	DESCRIPTION	DATE
6	CD RELEASE	2024-12-20
5	ISSUED FOR 90% DD- CLASS B ESTIMATE	2024-11-15
4	ISSUED FOR 50% DD	2024-10-18
3	ISSUED FOR 35% DD	2024-10-04
2	ISSUED FOR CITY SPA COMMENTS	2024-09-05
1	ISSUED FOR SITE PLAN APPROVAL	2024-08-07

REVISIONS/ ISSUES

CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ANY OMISSIONS OR DISCREPANCIES TO THE ARCHITECT BEFORE PROCEEDING WITH THE WORK.
DO NOT SCALE THE DRAWINGS

A B C D

SEAL

THIS DOCUMENT IS RELEASED FOR THE PURPOSE OF PRELIMINARY SUBMITTAL

IT IS NOT TO BE USED FOR CONSTRUCTION PURPOSES

DRAWN: JD
DATE: 2024-10-04
CHECKED: SJ

LANSDOWNE 2.0
EVENT CENTRE, NORTH SIDE STANDS AND PUBLIC REALM ENHANCEMENTS
945 & 1015 BANK STREET

DWG. TITLE
NORTH & SOUTH ELEVATIONS

SCALE: 1 : 200
PROJ. NO.: 2418
DWG. NO.: EC-A3-001


IN PROGRESS

LEGEND


1. VERTICAL METAL PLANK SIDING
2. ALUMINUM FRAME CURTAIN WALL GLAZING W/ BIRD-SAFE GLAZING, REF TO SPECIFICATIONS
3. SPLIT FACE MASONRY BLOCK
4. MECHANICAL SCREENS
5. METAL FLASHING

NOTES:


1. ALL SIGNAGE TO COMPLY WITH THE LANSDOWNE SIGNAGE AND WAYFINDING PLAN

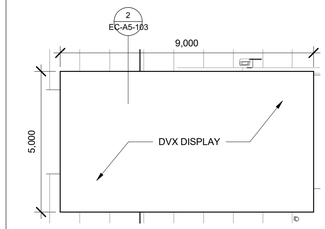

3 ELEVATION - VIDEO BOARD ADVERTISING
1 : 100

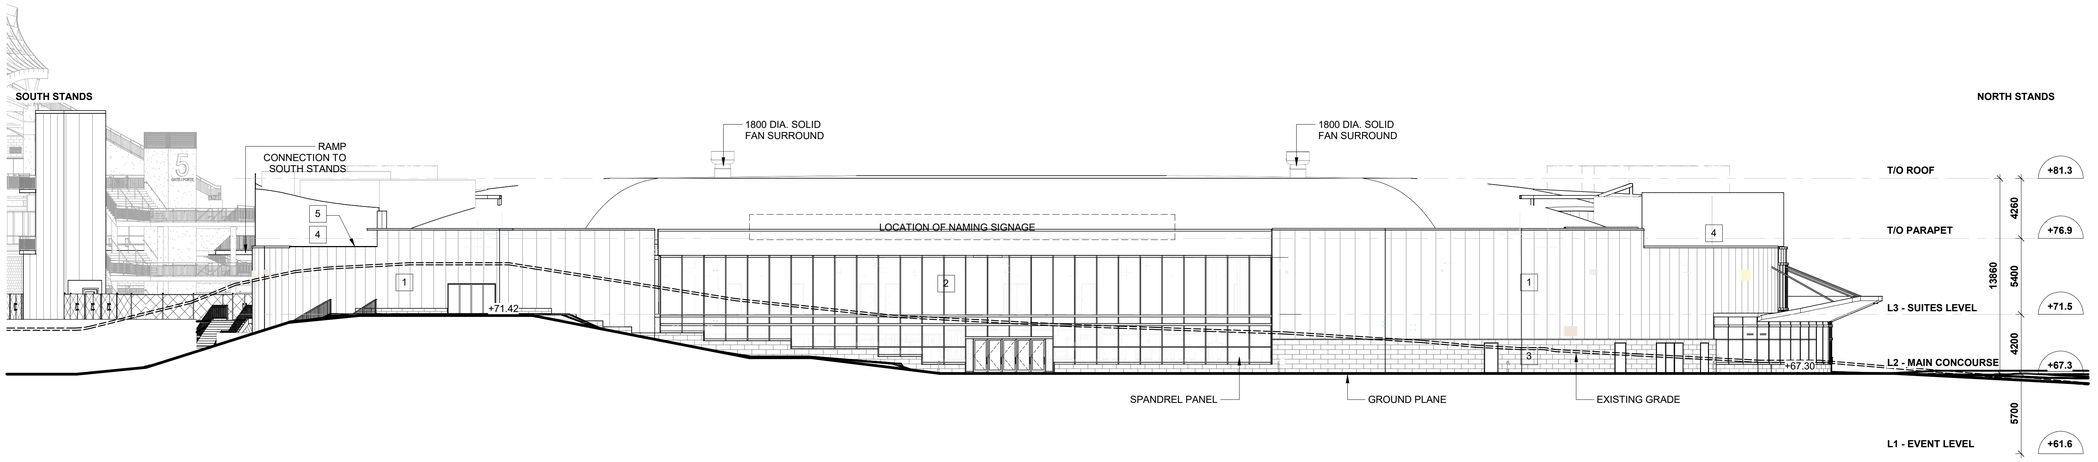

2 EAST ELEVATION - ARENA
1 : 200

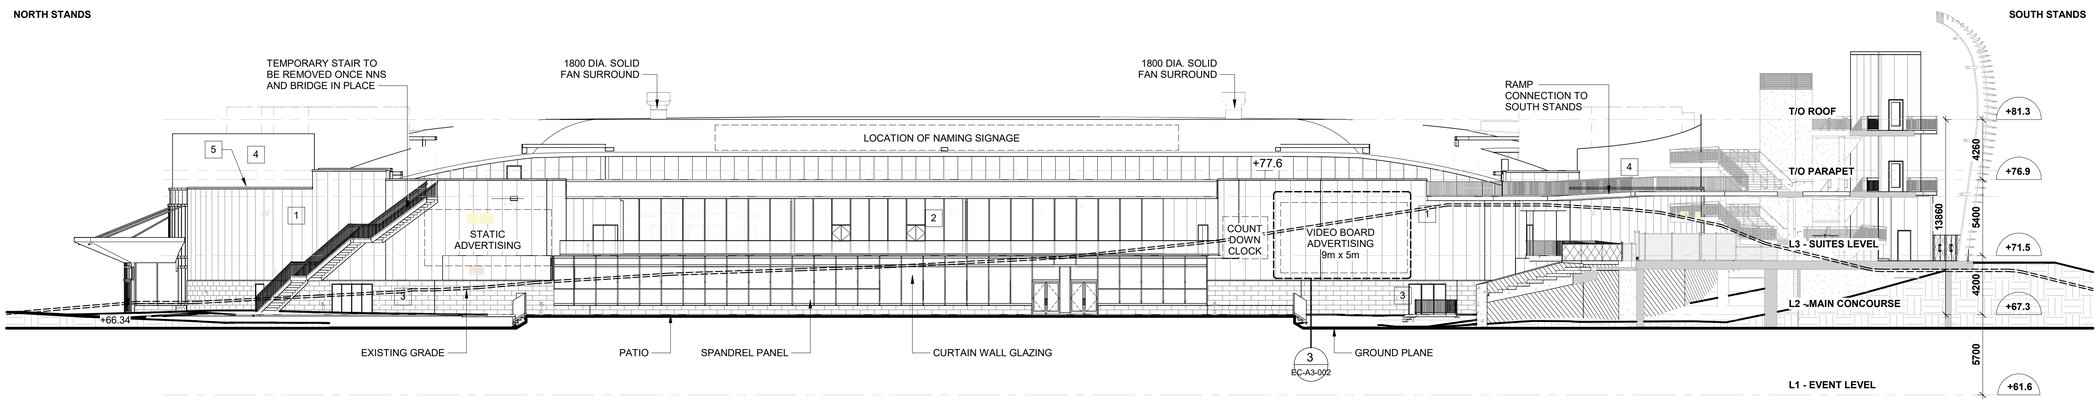

1 WEST ELEVATION - ARENA
1 : 200

© Copyright of BBB Architects Toronto Inc. 2024.
Not to be reproduced or distributed without written authorization of the copyright owner.

DATE PLOTTED: 2025-01-13 7:54:23 PM

Ottawa
OSEG
Ottawa Sports and Entertainment Group
BRISBIN BROOK BEYNON ARCHITECTS
14 DUNCAN ST 4TH FLOOR
TORONTO, ON M5H 3G8
(416) 591-8999
ENTUITIVE
135 LAURIER AVE WEST, SUITE 413
OTTAWA, ON K1P 5J2
(343) 308-9274
STRUCTURAL
TMP
200 KING. ST. WEST, SUITE 310
TORONTO, ON M5H 3T4
(416) 499-8000
MECH, PLUMB, FIRE PROTECTION
MULVEY & BANANI
90 SHEPPARD AVE EAST, SUITE 500
TORONTO, ON M2N 3A
(416) 751-2520
ELECTRICAL
CSW
319 MCRAE AVENUE, SUITE 502
OTTAWA, ONTARIO K1Z 0B9
(613) 729-4536
LANDSCAPE

NO.	DESCRIPTION	DATE
6	CD RELEASE	2024-12-20
5	ISSUED FOR 90% DD- CLASS B ESTIMATE	2024-11-15
4	ISSUED FOR 50% DD	2024-10-18
3	ISSUED FOR 35% DD	2024-10-04
2	ISSUED FOR CITY SPA COMMENTS	2024-09-05
1	ISSUED FOR SITE PLAN APPROVAL	2024-08-07

REVISIONS/ ISSUES

CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ANY OMISSIONS OR DISCREPANCIES TO THE ARCHITECT BEFORE PROCEEDING WITH THE WORK.
DO NOT SCALE THE DRAWINGS

A B D C

SEAL

THIS DOCUMENT IS RELEASED FOR THE PURPOSE OF PRELIMINARY SUBMITTAL

IT IS NOT TO BE USED FOR CONSTRUCTION PURPOSES

DRAWN: JI
DATE: 2024-10-04
CHECKED: SJ

LANSDOWNE 2.0
EVENT CENTRE, NORTH SIDE STANDS AND PUBLIC REALM ENHANCEMENTS
945 & 1015 BANK STREET

DWG. TITLE
EAST & WEST ELEVATIONS

SCALE: As indicated
PROJ. NO.: 2418
DWG. NO.: EC-A3-002

REDEVELOPMENT OF LANSDOWNE PARK

Lansdowne
THE TRANSFORMATION OF LANSDOWNE PARK | LA TRANSFORMATION DU PARC LANSDOWNE

Ottawa

OSEG
Ottawa Sports and Entertainment Group

1015 Bank Street
Ottawa, Ontario
K1S 3W7

DSEL david schaeffer engineering ltd
DAVID SCHAEFFER ENGINEERING LTD. SMART SOLUTIONS
120 Iber Road Unit 203
Stittsville, Ontario, K2S 1E9
Tel. (613) 836-0856
Fax. (613) 836-7183
www.DSEL.ca

Stantec
1505 Laperriere Avenue
Ottawa, Ontario, K1Z 7T1
Tel. (613) 722-4420
Fax. (613) 722-2799
www.stantec.com

Drawings are not to be scaled.

Contractors must verify all dimensions on the job and report any discrepancy to architects before proceeding with the work.

All drawings and specifications are the property of the architect and must be returned at the completion of the work.

This drawing is not to be used for construction until countersigned.

Signature: Date:

Seals:

PROFESSIONAL ENGINEERS ONTARIO — A.D. ROBERT — 100090626 — PROVINCE OF ONTARIO

PROFESSIONAL ENGINEERS ONTARIO — W. THYLAND — 100128853 — PROVINCE OF ONTARIO

GENERAL NOTES

1. ALL MATERIALS AND MATERIALS SHALL CONFORM TO THE LATEST REVISION OF THE STANDARDS AND SPECIFICATIONS FOR THE CITY OF OTTAWA, ONTARIO PROVINCIAL STANDARDS (OPSD) AND ONTARIO PROVINCIAL STANDARD SPECIFICATIONS (OPSS) AND MINISTRY OF TRANSPORTATION STANDARDS WILL APPLY WHERE REQUIRED.
2. THE CONTRACTOR SHALL CONFIRM THE LOCATION OF ALL EXISTING UTILITIES PRIOR TO THE START OF CONSTRUCTION. ANY DAMAGE DURING CONSTRUCTION TO BE REPAIRED/REPLACED TO EXISTING UTILITIES TO THE SATISFACTION OF THE AUTHORITY HAVING JURISDICTION. THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE REPAIR OR REPLACEMENT OF ANY SERVICES OR UTILITIES DISTURBED DURING CONSTRUCTION, TO THE SATISFACTION OF THE AUTHORITY HAVING JURISDICTION.
3. ALL DIMENSIONS SHALL BE CHECKED AND VERIFIED IN THE FIELD BY THE CONTRACTOR PRIOR TO THE START OF CONSTRUCTION. ANY DISCREPANCIES SHALL BE REPORTED IMMEDIATELY TO THE ENGINEER. THE CONTRACTOR SHALL NOT SCALE DRAWINGS. ALL DIMENSIONS AND LOCATIONS ARE NOTIFY EXISTENCE OF POSSIBLE CONFLICTS PRIOR TO CONSTRUCTION WILL BE AT THE CONTRACTORS EXPENSE.
4. ANY AREAS BEYOND THE LIMIT OF THE SITE DISTURBED DURING CONSTRUCTION SHALL BE RESTORED TO ORIGINAL CONDITION OR BETTER, AT THE CONTRACTORS EXPENSE, TO THE SATISFACTION OF THE AUTHORITY HAVING JURISDICTION AT THE CONTRACTOR'S EXPENSE.
5. RELOCATION OF EXISTING SERVICES AND/OR UTILITIES SHALL BE AS SHOWN ON THE DRAWINGS OR DIRECTED BY THE ENGINEER AT THE EXPENSE OF THE DEVELOPER.
6. ALL WORK SHALL BE COMPLETED IN ACCORDANCE WITH THE "OCCUPATIONAL HEALTH AND SAFETY ACT AND REGULATIONS FOR CONSTRUCTION PROJECTS" AND "THE INDUSTRIAL ESTABLISHMENTS ACT".
7. ALL CONSTRUCTION SIGNAGE MUST CONFORM TO THE MINISTRY OF TRANSPORTATION OF ONTARIO MANUAL OF UNIFORM TRAFFIC CONTROL DEVICES PER LATEST AMENDMENT.
8. THE CONTRACTOR IS ADVISED THAT WORKS BY OTHERS MAY BE ONGOING DURING THE CONSTRUCTION PERIOD. IT IS THE CONTRACTOR'S RESPONSIBILITY TO COORDINATE CONSTRUCTION ACTIVITIES TO PREVENT CONFLICTS.
9. ALL DIMENSIONS ARE IN METRES UNLESS SPECIFIED OTHERWISE.
10. THERE WILL BE NO SUBSTITUTION OF MATERIALS UNLESS PRIOR WRITTEN APPROVAL IS RECEIVED FROM THE ENGINEER.
11. ALL CONSTRUCTION SHALL BE CARRIED OUT IN ACCORDANCE WITH THE RECOMMENDATIONS MADE IN THE GEOTECHNICAL REPORT.
12. FOR DETAILS RELATING TO STORMWATER MANAGEMENT AND ROOF DRAINAGE, REFER TO THE SITE SERVICING AND STORMWATER MANAGEMENT REPORT.
13. ALL SEWERS CONSTRUCTED WITH GRADES LESS THAN 1.0% SHALL BE INSTALLED USING LASER ALIGNMENT AND CHECKED WITH LEVEL INSTRUMENT PRIOR TO BACKFILLING.
14. THE CONTRACTOR IS RESPONSIBLE FOR OBTAINING ALL PERMITS REQUIRED AND TO BEAR THE COST OF THE SAME.
15. THE CONTRACTOR WILL BE RESPONSIBLE FOR ADDITIONAL BEDDING OR ADDITIONAL STRENGTH PIPE IF THE MAXIMUM TRENCH WIDTH AS SPECIFIED BY OPSD IS EXCEEDED.
16. ALL PIPE / CULVERT SECTION SIZES REFER TO INSIDE DIMENSIONS.
17. SHOULD DEEPLY BURIED ARCHAEOLOGICAL REMAINS BE FOUND ON THE PROPERTY DURING CONSTRUCTION ACTIVITIES, THE HERITAGE OPERATIONS UNIT OF THE ONTARIO MINISTRY OF CULTURE MUST BE NOTIFIED IMMEDIATELY.
18. ALL NECESSARY CLEARING AND GRUBBING SHALL BE COMPLETED BY THE CONTRACTOR. REVIEW WITH CONTRACT ADMINISTRATOR AND THE CITY OF OTTAWA PRIOR TO ANY TREE CUTTING / REMOVAL.
19. DRAWINGS SHALL BE READ IN CONJUNCTION WITH THE ARCHITECTURAL PLANS.
20. THE CONTRACTOR SHALL PROVIDE THE PROJECT ENGINEER ONE SET OF AS CONSTRUCTED SITE SERVICING AND GRADING DRAWINGS.
21. BENCHMARKS / IT IS THE RESPONSIBILITY OF THE CONTRACTOR TO VERIFY THAT THE SITE BENCHMARK(S) HAS NOT BEEN ALTERED OR DISTURBED AND THAT ITS RELATIVE ELEVATION AND DESCRIPTION AGREES WITH THE INFORMATION DEPICTED ON THIS PLAN.

TOPOGRAPHIC INFORMATION

TOPOGRAPHIC INFORMATION PROVIDED BY FAIRHALL, MOFFATT & WOODLAND LTD.
PROJ. NO. P1950
DATED 2011-09-27

SITE PLAN INFORMATION


TOPOGRAPHIC INFORMATION PROVIDED BY CROUSH, SUNDERLAND AND WRIGHT
PROJ. NO. 1766
DATED 2013-06-14

BENCH MARK

MAGNETIC NAIL SET IN TOP OF CONCRETE WALL OF CANAL LOCATED AT SOUTH EAST SITE ACCESS
ELEV=64.581

No.	Description	Date
21	Issued to City	Jan 27/15
20	Issued to City	Sept 04/14
19	Revised Bldg G1 Siamese connection	June 17/14
18	Revised Siamese connections	May 8/14
17	Revised FH Bank Street	Feb 2/14
16	Revised per municipal comments	Dec 10/13
15	Added Meter and Remote Meter locations	Dec 4/13
14	Revised water meter at Bank street, updated per CCN-SS-9/3, CCN-SS-10, CD-SS-3, CD-SS-4	Nov 26/13

SUBJECT PROPERTY



KEY PLAN

Drawing Title:

LANSDOWNE PARK

SITE SERVICING PLAN

Scale.: 1:500 Date Created: MM/DD/YR

Project No.: 09-378 Checked by: CHK

SS 01003

© DSEL
All rights reserved. No part of this document may be modified or reproduced except with the prior written authorization by David Schaeffer Engineering Ltd.

01 January, 2012

z:\projects\09-378 lansdowne park\design\c detailed design\c.2 drawings\c.2.1 cod drawings\spa_base\spa_378-2015-01-27_odf.dwg

CONTRACTOR TO COMPLETE ALL WORKS WITHOUT ENCROACHMENT NEIGHBORING PROPERTIES

REFER TO SITE SERVICING NOTES ON DRAWING SS 01008

FIRE HYDRANT ABOVE PARKING GARAGE

REDEVELOPMENT OF LANSDOWNE PARK

1015 Bank Street
Ottawa, Ontario
K1S 3W7

120 Iber Road Unit 203
Stittsville, Ontario, K2S 1E9
Tel. (613) 836-0856
Fax. (613) 836-7183
www.DSEL.ca

1505 Laperriere Avenue
Ottawa, Ontario, K1Z 7T1
Tel. (613) 722-4420
Fax. (613) 722-2799
www.stantec.com

Drawings are not to be scaled.

Contractor must verify all dimensions on the job and report any discrepancy to architects before proceeding with the work.

All drawings and specifications are the property of the architect and must be returned at the completion of the work.

This drawing is not to be used for construction until countersigned.

Signature: Date:

Seals:

GENERAL NOTES

1. ALL WORKS AND MATERIALS SHALL CONFORM TO THE LATEST REVISION OF THE STANDARDS AND SPECIFICATIONS FOR THE CITY OF OTTAWA, OPSS, OPSD AND OTHER APPLICABLE MUNICIPAL STANDARDS. ANY SPECIFICATIONS, TYPICAL DRAWINGS APPLICABLE LOCAL MUNICIPAL STANDARDS AND MINISTRY OF TRANSPORTATION STANDARDS WILL APPLY WHERE REQUIRED.
2. THE CONTRACTOR SHALL CONFIRM THE LOCATION OF ALL EXISTING UTILITIES PRIOR TO THE START OF CONSTRUCTION. THE GENERAL CONTRACTOR SHALL BE RESPONSIBLE FOR PROTECTING ALL EXISTING UTILITIES TO THE SATISFACTION OF THE AUTHORITY HAVING JURISDICTION. THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE REPAIR OR REPLACEMENT OF ANY SERVICES OR UTILITIES DISTURBED DURING CONSTRUCTION TO THE SATISFACTION OF THE AUTHORITY HAVING JURISDICTION.
3. ALL DIMENSIONS SHALL BE CHECKED AND VERIFIED IN THE FIELD BY THE CONTRACTOR PRIOR TO THE START OF CONSTRUCTION. ANY DISCREPANCIES SHALL BE REPORTED IMMEDIATELY TO THE ENGINEER. THE LOCATIONS OF ALL EXISTING SERVICES SHALL BE VERIFIED FOR LOCATIONS AND NOTIFY ENGINEER OF POSSIBLE CONFLICTS PRIOR TO CONSTRUCTION WILL BE AT THE CONTRACTORS EXPENSE.
4. ANY AREAS BEYOND THE LIMIT OF THE SITE DISTURBED DURING CONSTRUCTION SHALL BE RESTORED TO ORIGINAL CONDITION OR BETTER TO THE SATISFACTION OF THE AUTHORITY HAVING JURISDICTION AT THE CONTRACTOR'S EXPENSE.
5. RELOCATION OF EXISTING SERVICES AND/OR UTILITIES SHALL BE AS SHOWN ON THE DRAWINGS OR DIRECTED BY THE ENGINEER AT THE EXPENSE OF THE DEVELOPER.
6. ALL WORK SHALL BE COMPLETED IN ACCORDANCE WITH THE "OCCUPATIONAL HEALTH AND SAFETY ACT AND REGULATIONS FOR CONSTRUCTION PROJECTS." THE GENERAL CONTRACTOR SHALL BE DEEMED TO BE THE "CONSTRUCTOR" AS DEFINED IN THE ACT.
7. ALL CONSTRUCTION SIGNAGE MUST CONFORM TO THE MINISTRY OF TRANSPORTATION ONTARIO MANUAL OF UNIFORM TRAFFIC CONTROL DEVICES PER LATEST AMENDMENT.
8. THE CONTRACTOR IS ADVISED THAT WORKS BY OTHERS MAY BE ONGOING DURING THE PERIOD OF THIS CONTRACT. THE CONTRACTOR SHALL COORDINATE CONSTRUCTION ACTIVITIES TO PREVENT CONFLICTS.
9. ALL DIMENSIONS ARE IN METRES UNLESS SPECIFIED OTHERWISE.
10. THERE WILL BE NO SUBSTITUTION OF MATERIALS UNLESS PRIOR WRITTEN APPROVAL IS GIVEN BY THE CONSULTANT.
11. ALL CONSTRUCTION SHALL BE CARRIED OUT IN ACCORDANCE WITH THE RECOMMENDATIONS MADE IN THE GEOTECHNICAL REPORT.
12. FOR DETAILS RELATING TO STORMWATER MANAGEMENT AND ROOF DRAINAGE REFER TO THE SITE SERVICING AND STORMWATER MANAGEMENT REPORT.
13. ALL SEWERS CONSTRUCTED WITH GRADES LESS THAN 1.0% SHALL BE MANDREL TESTED AND VIDEO RECORDED AND CHECKED WITH LEVEL INSTRUMENT PRIOR TO BACKFILLING.
14. THE CONTRACTOR IS RESPONSIBLE FOR OBTAINING ALL PERMITS REQUIRED AND TO BEAR THE COST OF THE SAME.
15. THE CONTRACTOR WILL BE RESPONSIBLE FOR ADDITIONAL BEDDING, OR GRANULAR "A" BACKFILL, IF THE MAXIMUM TRENCH WIDTH AS SPECIFIED BY OPSD IS EXCEEDED.
16. ALL PIPE / CULVERT SECTION SIZES REFER TO INSIDE DIMENSIONS.
17. SHOULD DEEPLY BURIED ARCHAEOLOGICAL REMAINS BE FOUND ON THE PROPERTY DURING CONSTRUCTION ACTIVITIES, THE HERITAGE OPERATIONS UNIT OF THE ONTARIO MINISTRY OF CULTURE MUST BE NOTIFIED IMMEDIATELY.
18. TREE REMOVAL, CLEARING AND GRUBBING SHALL BE COMPLETED BY THE CONTRACTOR. REVIEW WITH CONTRACT ADMINISTRATOR AND THE CITY OF OTTAWA PRIOR TO ANY TREE CUTTING / REMOVAL.
19. DRAWINGS SHALL BE READ IN CONJUNCTION WITH THE ARCHITECTURAL SITE PLAN.
20. THE CONTRACTOR SHALL PROVIDE THE PROJECT ENGINEER ONE SET OF AS CONSTRUCTED SITE SERVICING AND GRADING DRAWINGS.
21. PRIOR TO THE START OF CONSTRUCTION IT IS THE CONTRACTOR TO VERIFY THAT THE SITE BENCHMARK(S) HAS NOT BEEN DISTURBED OR DISTURBED AND THAT ITS RELATIVE ELEVATION AND DESCRIPTION AGREES WITH THE INFORMATION DEPICTED ON THIS PLAN.

TOPOGRAPHIC INFORMATION

TOPOGRAPHIC INFORMATION PROVIDED BY FAIRHALL, MOFFATT & WOODLAND LTD.
PROJ. NO. 11P5D0
DATED 2011-09-27

SITE PLAN INFORMATION

TOPOGRAPHIC INFORMATION PROVIDED BY COPLISH, SUNDERLAND AND WRIGHT
PROJ. NO. 1766
DATED 2013-06-14

BENCH MARK

MAGNETIC NAIL SET IN TOP OF CONCRETE WALL OF CANAL LOCATED AT SOUTH EAST SITE ACCESS
ELEV=64.581

GEOTECHNICAL REPORT

PREPARED BY PATERSON GROUP
GEOTECHNICAL INVESTIGATION – PROPOSED LANSDOWNE PARK REDEVELOPMENT BANK STREET AT HOLMWOOD AVENUE, OTTAWA, ONTARIO DATED MARCH 17, 2010
PROJ. NO.: PG1744-1

No.	Description	Date
17	Revised grading at BLDG A per Trinity request	Mar 14/14
16	Added area drain detail	Dec 10/13
15	Add area drains at Building K	Nov 22/13
14	Revised GP per IBI request	Jul 10/13
13	SI-SS-1R2: Modification to Building Locations on Plan	Mar 13/13

SUBJECT PROPERTY

KEY PLAN

Drawing Title:

LANSDOWNE PARK

SITE GRADING PLAN

Scale.: 1:500 Date Created: MM/DD/YR

Project No.: 09-378 Checked by: CHK

SS 01002

© DSEL


LEGEND

x00.00	PROPOSED SPOT ELEVATION		LIMITS OF CONTRACT
x00.00T/C	PROPOSED TOP OF CURB ELEVATION	P1 =64.10	APPROX. GARAGE FLOOR ELEVATION
x00.00B/W	PROPOSED BOTTOM OF WALL ELEVATION		PROPOSED TRENCH DRAIN "ACO DRAIN KI100S/KS100S" (REFER TO MECHANICAL AND LANDSCAPE DRAWINGS)
x00.00T/W	PROPOSED TOP OF WALL ELEVATION		PROPOSED DRAIN LOCATION "MATTS DRAINAGE FD-4-30" (REFER TO MECHANICAL AND LANDSCAPE DRAWINGS)
x00.00T/L	PROPOSED TOP OF LID ELEVATION		PROPOSED CATCH BASIN (OPSD 705.010)
1.0%	PROPOSED GRADE AND DIRECTION		PROPOSED STORM MAINTENANCE HOLE
			PROPOSED SANITARY MAINTENANCE HOLE
100.00 / 456.00	PROPOSED/EXISTING SPOT ELEVATION		

SITE GRADING NOTES


1. PRIOR TO THE COMMENCEMENT OF THE SITE GRADING WORKS, ALL SILTATION CONTROL DEVICES SHALL BE INSTALLED AND OPERATIONAL PER EROSION CONTROL PLAN.
2. ALL GRANULAR AND PAVEMENT FOR ROADS/PARKING AREAS SHALL BE CONSTRUCTED IN ACCORDANCE WITH GEOTECHNICAL ENGINEER'S RECOMMENDATIONS.
3. ALL TOPSOIL AND ORGANIC MATERIAL SHALL BE STRIPPED WITHIN THE ROAD AND PARKING AREAS ALLOWANCE PRIOR TO THE COMMENCEMENT OF CONSTRUCTION.
4. CONCRETE CURB SHALL BE IN ACCORDANCE WITH CITY OF OTTAWA STD. SC1.1. PROVISION SHALL BE MADE FOR CURB DEPRESSIONS AS INDICATED ON ARCHITECTURAL SITE PLAN. CONCRETE SIDEWALK SHALL BE IN ACCORDANCE WITH CITY OF OTTAWA STD SC1.4. ALL CURBS, CONCRETE ISLANDS, AND SIDEWALKS SHOWN ON THIS DRAWING ARE TO BE PRICED IN THE SITEWORKS PORTION OF THE CONTRACT.
5. PAVEMENT REINSTATEMENT FOR SERVICE AND UTILITY CUTS SHALL BE IN ACCORDANCE WITH THE CITY OF OTTAWA STD. R10 AND OPSD 509.010, AND OPSS 310.
6. GRANULAR "A" SHALL BE PLACED TO A MINIMUM THICKNESS OF 300mm AROUND ALL STRUCTURES WITHIN THE PAVEMENT AREA.
7. SUB-EXCAVATE SOFT AREAS AND FILL WITH GRANULAR 'B' COMPACTED IN MAXIMUM 300mm LIFTS.
8. ALL WORK ON THE MUNICIPAL RIGHT OF WAY AND EASEMENTS TO BE INSPECTED BY THE MUNICIPALITY PRIOR TO BACKFILLING.
9. CONTRACTOR TO OBTAIN A ROAD OCCUPANCY PERMIT 48 HOURS PRIOR TO COMMENCING ANY WORK WITHIN THE MUNICIPAL ROAD ALLOWANCE, IF REQUIRED BY THE MUNICIPALITY.
10. ALL PAVEMENT MARKING FEATURES AND SIGNAGE SHALL BE PLACED PER ARCHITECTURAL SITE PLAN. LINE PAINTING AND DIRECTIONAL SYMBOLS SHALL BE APPLIED IN TWO COATS, A MINIMUM OF 0.4mm WET FILM THICKNESS.
11. REFER TO ARCHITECTURAL SITE PLAN FOR DIMENSIONS AND SITE DETAILS.
12. STEP JOINTS ARE TO BE USED WHERE PROPOSED ASPHALT MEETS EXISTING ASPHALT. ALL JOINTS MUST BE SEALED.
13. SIDEWALKS TO BE 20mm BELOW THE FINISHED FLOOR SLAB AT ENTRANCES UNLESS OTHERWISE NOTED.
14. WHERE APPLICABLE THE CONTRACTOR IS TO SUBMIT SHOP DRAWS FOR RETAINING WALL (INCLUDE RAILINGS IF APPLICABLE) TO THE ENGINEER FOR APPROVAL PRIOR TO CONSTRUCTION. SHOP DRAWINGS MUST BE SITE SPECIFIC SIGNED AND SEALED BY A LICENSED STRUCTURAL ENGINEER. THE CONTRACTOR WILL ALSO BE REQUIRED TO SUPPLY STRUCTURAL AND GEOTECHNICAL CERTIFICATION OF THE AS-CONSTRUCTED RETAINING WALL TO THE ENGINEER PRIOR TO FINAL ACCEPTANCE.

AREA DRAIN DETAIL



E. DSEL
All rights reserved. Copyright of this document may be registered or otherwise protected. This document may not be reproduced or utilized in any form or manner without written authorization by David Schaeffer Engineering Ltd.
01 January, 2012


z:\projects\09-378 lansdowne park\design\c detailed design\c.2 drawings\c.2.1 cad drawings\spa_base\spa_378-2014-03-14_adf.dwg

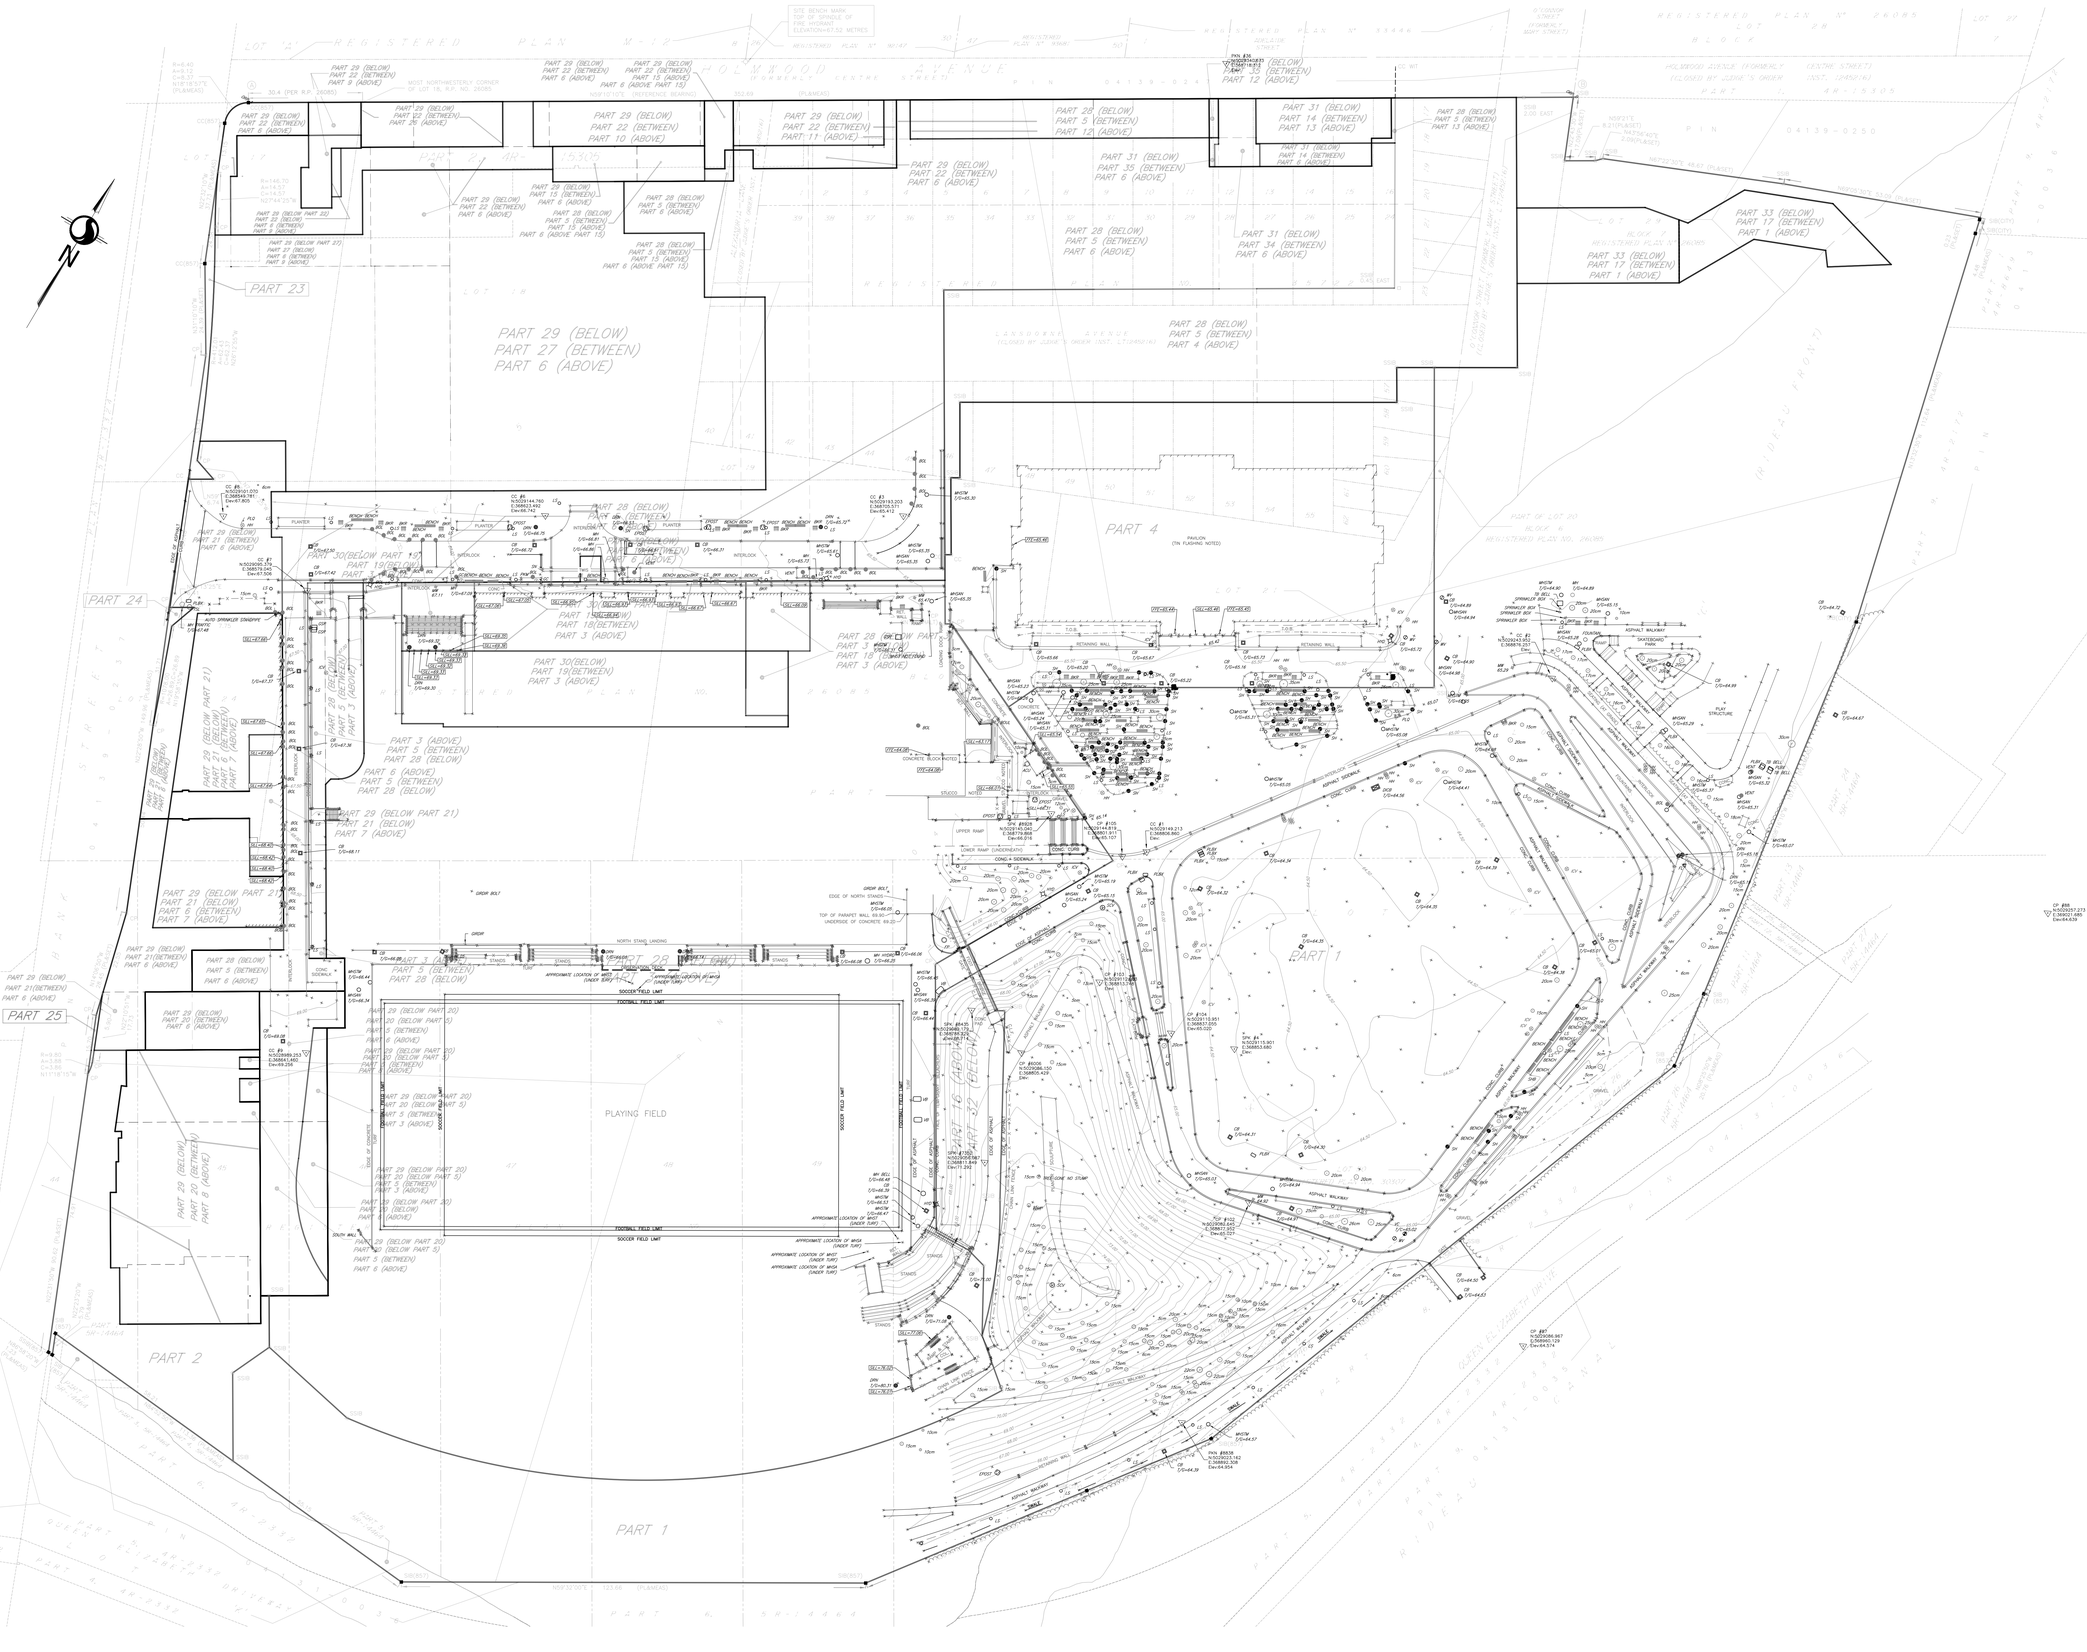
PART 23
PART 24
PART 25
PART 2
PART 1
PART 4
PLAYING FIELD
PAVILION (TIN FLASHING NOTED)
PART 29 (BELOW) PART 27 (BETWEEN) PART 6 (ABOVE)
PART 28 (BELOW) PART 5 (BETWEEN) PART 4 (ABOVE)
PART 31 (BELOW) PART 34 (BETWEEN) PART 6 (ABOVE)
PART 33 (BELOW) PART 17 (BETWEEN) PART 1 (ABOVE)
PART 30(BELOW) PART 19(BETWEEN) PART 3 (ABOVE)
PART 29 (BELOW PART 21) PART 21 (BELOW) PART 7 (ABOVE)
PART 29 (BELOW) PART 21(BETWEEN) PART 6 (ABOVE)
PART 29 (BELOW) PART 20 (BETWEEN) PART 8 (ABOVE)
PART 29 (BELOW PART 20) PART 20 (BELOW PART 5) PART 5 (BETWEEN) PART 3 (ABOVE)
PART 29 (BELOW PART 20) PART 20 (BELOW PART 5) PART 5 (BETWEEN) PART 6 (ABOVE)
PART 28 (BELOW) PART 5 (BETWEEN) PART 6 (ABOVE)
PART 3 (ABOVE) PART 5 (BETWEEN) PART 28 (BELOW)
PART 6 (ABOVE) PART 5 (BETWEEN) PART 28 (BELOW)
PART 29 (BELOW PART 21) PART 21 (BELOW) PART 7 (ABOVE)
PART 29 (BELOW PART 21) PART 21 (BELOW) PART 6 (BETWEEN) PART 7 (ABOVE)
PART 18(BETWEEN) PART 3 (ABOVE)
PART 28 (BELOW) PART 18 (BETWEEN) PART 3 (ABOVE)
PART 28 (BELOW) PART 3 (ABOVE)
PART 29 (BELOW) PART 22 (BETWEEN) PART 6 (ABOVE)
PART 29 (BELOW) PART 22 (BETWEEN) PART 10 (ABOVE)
PART 29 (BELOW) PART 22 (BETWEEN) PART 11 (ABOVE)
PART 29 (BELOW) PART 22 (BETWEEN) PART 12 (ABOVE)
PART 28 (BELOW) PART 5 (BETWEEN) PART 12 (ABOVE)
PART 31 (BELOW) PART 14 (BETWEEN) PART 13 (ABOVE)
PART 31 (BELOW) PART 35 (BETWEEN) PART 6 (ABOVE)
PART 31 (BELOW) PART 14 (BETWEEN) PART 6 (ABOVE)
PART 28 (BELOW) PART 5 (BETWEEN) PART 13 (ABOVE)
PART 28 (BELOW) PART 5 (BETWEEN) PART 6 (ABOVE)
PART 28 (BELOW) PART 5 (BETWEEN) PART 15 (ABOVE) PART 6 (ABOVE PART 15)
PART 29 (BELOW) PART 22 (BETWEEN) PART 6 (ABOVE)
PART 29 (BELOW) PART 22 (BETWEEN) PART 15 (ABOVE) PART 6 (ABOVE PART 15)
PART 29 (BELOW) PART 22 (BETWEEN) PART 6 (ABOVE)
PART 29 (BELOW PART 22) PART 27 (BELOW) PART 6 (BETWEEN) PART 9 (ABOVE)
PART 29 (BELOW) PART 22 (BETWEEN) PART 26 (ABOVE)
PART 29 (BELOW) PART 22 (BETWEEN) PART 9 (ABOVE)
PART 30(BELOW PART 19) PART 19 (BELOW) PART 3 (ABOVE)
PART 29 (BELOW) PART 21 (BETWEEN) PART 6 (ABOVE)
PART 29 (BELOW) PART 20 (BETWEEN) PART 6 (ABOVE)
PART 29 (BELOW) PART 21 (BELOW) PART 6 (BETWEEN) PART 8 (ABOVE)
PART 29 (BELOW) PART 21(BETWEEN) PART 6 (ABOVE)
PART 29 (BELOW) PART 21 (BELOW) PART 6 (BETWEEN) PART 7 (ABOVE)
PART 29 (BELOW PART 21) PART 21 (BELOW) PART 7 (ABOVE)
PART 29 (BELOW PART 20) PART 20 (BELOW PART 5) PART 5 (BETWEEN) PART 6 (ABOVE)
PART 29 (BELOW PART 20) PART 20 (BELOW PART 5) PART 5 (BETWEEN) PART 3 (ABOVE)
PART 29 (BELOW PART 20) PART 20 (BELOW PART 5) PART 3 (ABOVE)
PART 29 (BELOW PART 20) PART 20 (BELOW PART 5) PART 5 (BETWEEN) PART 6 (ABOVE)
PART 29 (BELOW PART 20) PART 20 (BELOW PART 5) PART 5 (BETWEEN) PART 3 (ABOVE)
PART 30 (BELOW PART 20) PART 20 (BELOW) PART 5 (ABOVE)
PART 29 (BELOW PART 20) PART 20 (BELOW PART 5) PART 5 (BETWEEN) PART 6 (ABOVE)
PART 30(BELOW PART 19) PART 19 (BETWEEN) PART 3 (ABOVE)
PART 30(BELOW PART 19) PART 19 (BETWEEN) PART 3 (ABOVE)
PART 29 (BELOW) PART 20 (BETWEEN) PART 8 (ABOVE)
PART 29 (BELOW) PART 21(BETWEEN) PART 6 (ABOVE)
PART 29 (BELOW) PART 21 (BELOW) PART 6 (BETWEEN) PART 7

APPENDIX

B

- BOUNDARY CONDITIONS
- CORRESPONDENCE
- FIRE FLOW CALCULATION FOR BUILDINGS
- EXISTING WATER DEMAND CALCULATION
- HYDRAULIC ANALYSIS
- FIRE HYDRANT TEST RESULTS
- HYDRANT COVERAGE FIGURE

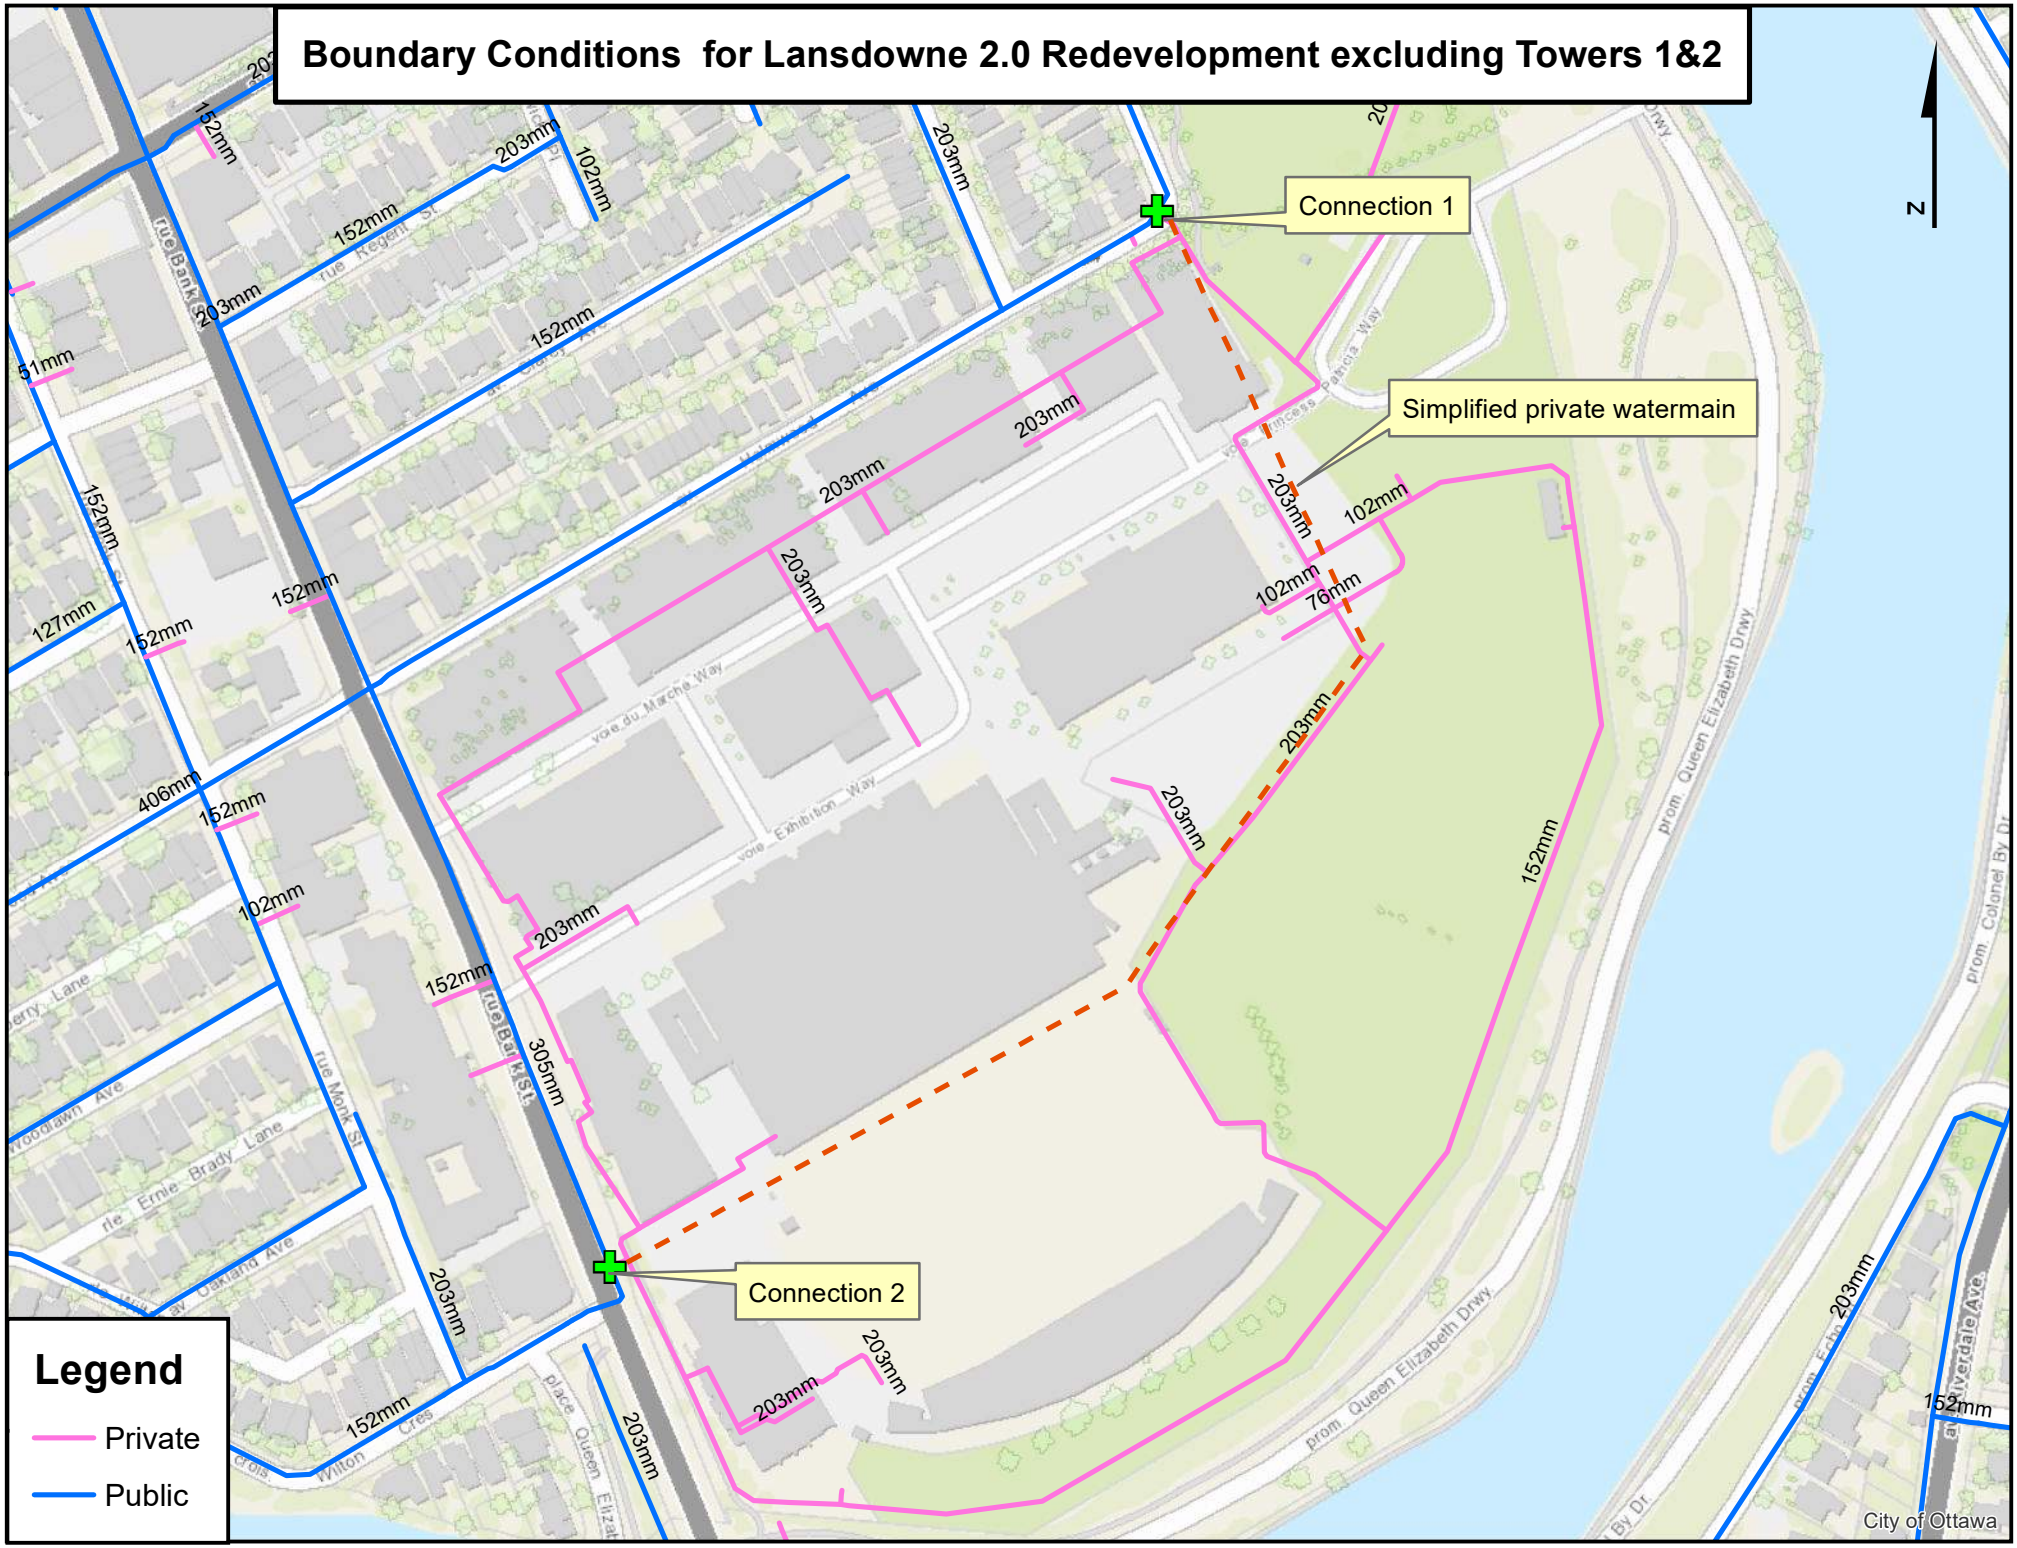
Boundary Conditions for Lansdowne 2.0 Redevelopment excluding Towers 1&2
Connection 1
Simplified private watermain
Connection 2
N
Legend
Private
Public
City of Ottawa
152mm
203mm
102mm
51mm
127mm
406mm
305mm
76mm
rue Bank St
rue Metcalfe St
rue Regent St
rue Monk St
prom Queen Elizabeth Drwy
prom Colonel By Dr
voie du Marché Way
voie Exhibition Way
voie Princess Patricia Way
place Queen Elizabeth
Woodlawn Ave
Oakland Ave
Riverdale Ave
Ernie Brady Lane
Wilton Cres

From: Whelan, Amy <amy.whelan@ottawa.ca>
Sent: December 19, 2024 8:43 AM
To: Ali, Zarak
Cc: Moore, Sean; Yang, Winston; Mottalib, Abdul
Subject: RE: Lansdowne Park - Existing Building Water Demands
Attachments: Lansdowne 2.0 Redevelopment REVISED December 2024.pdf

Good morning Ali,

Please find the results of the boundary condition request below:

Not much change in results from last BC that was provided. Fire flow governs. Since FF was the same there's no significant change in the BC.

Information Provided: (Water demands with New Additions)
Average Day= 5.2 L/s
Max Day= 13.0 L/s
Peak Hour= 28.6 L/s
Fire flow (RFF)= 150 L/s
Development type: Commercial - New North Stands and New Event Center (Lansdowne 2.0 Redevelopment excluding Towers 1&2)

The following are boundary conditions, HGL, for hydraulic analysis at 1015 Bank Street, Lansdowne 2.0 Redevelopment (excluding Towers 1 &2), (zone 1W) assumed to be privately connected to the 305 mm watermain on Bank Street, AND the 406 mm watermain on Holmwood Avenue (see attached PDF for location).

Both Connections:
Min HGL: 105.7 m
Max HGL: 114.6 m
Max Day + FF (150L/s): 107.8 m (Connection 1-Holmwood Avenue), 106.5 m (Connection 2-Bank Street)

These are for current conditions and are based on computer model simulation.
Disclaimer: The boundary condition information is based on current operation of the city water distribution system. The computer model simulation is based on the best information available at the time. The operation of the water distribution system can change on a regular basis, resulting in a variation in boundary conditions. The physical properties of watermains deteriorate over time, as such must be assumed in the absence of actual field test data. The variation in physical watermain properties can therefore alter the results of the computer model simulation.

Classified as City of Ottawa - Internal / Ville d'Ottawa - classé interne

From: Whelan, Amy
Sent: December 17, 2024 9:18 AM
To: Ali, Zarak <Zarak.Ali@wsp.com>
Cc: Moore, Sean <Sean.Moore@ottawa.ca>; Yang, Winston <winston.yang@wsp.com>; Mottalib, Abdul <Abdul.Mottalib@ottawa.ca>
Subject: RE: Lansdowne Park - Existing Building Water Demands

Hi Ali,

Thank you for your email. We have sent the request to our water resources group as an urgent request last week. We have not received a response, however we will follow up with the status.
I will let you know as soon as possible.

Kind regards,

Amy Whelan, E.I.T
Project Manager, Infrastructure Approvals
Development Review, Central | Examen des projets d'aménagement, Central
Planning, Development and Building Services Department (PDBS) | Direction générale des services de la planification, de l'aménagement et du bâtiment (DGSPAB)
City of Ottawa | Ville d'Ottawa
110 Laurier Avenue West Ottawa, ON | 110, avenue. Laurier Ouest. Ottawa (Ontario) K1P 1J1
613.580.2424 ext./poste 26642, amy.whelan@ottawa.ca

From: Ali, Zarak <Zarak.Ali@wsp.com>
Sent: December 16, 2024 3:54 PM
To: Whelan, Amy <amy.whelan@ottawa.ca>
Cc: Moore, Sean <Sean.Moore@ottawa.ca>; Yang, Winston <winston.yang@wsp.com>; Mottalib, Abdul <Abdul.Mottalib@ottawa.ca>
Subject: RE: Lansdowne Park - Existing Building Water Demands

CAUTION: This email originated from an External Sender. Please do not click links or open attachments unless you recognize the source.

ATTENTION : Ce courriel provient d'un expéditeur externe. Ne cliquez sur aucun lien et n'ouvrez pas de pièce jointe, excepté si vous connaissez l'expéditeur.

Hi Amy,

I am following up on my request below.

Please note that we will be using the Metered Totals readings from the CARMA Metering report spreadsheet instead of the City Main Totals readings. This is because the Metered Totals reading will allow us to determine the individual demands of each of the buildings. This slightly changes the overall water demands of the site to the following:

NEW: Water Demands (using residential peaking factors and OSEG CARMA Metering Data):
Avg Day Demand = 5.41 L/s
Max Day + Fire Flow Demand = 13.53 + 150 = 163.53 L/s
Peak Hour Demand = 29.77 L/s

Let me know if you have any questions.

Regards,

Zarak Ali
Designer E.I.T
Land Development & Municipal Engineering - Ontario

T+ 1 343-227-9179
Zarak.ali@wsp.com

WSP Canada Inc.
2611 Queensview Drive, Suite 300
Ottawa, Ontario
K2B 8K2 Canada

wsp.com

Classified as City of Ottawa - Internal / Ville d'Ottawa - classé interne

From: Ali, Zarak
Sent: December 11, 2024 12:02 PM
To: Whelan, Amy <amy.whelan@ottawa.ca>
Cc: Moore, Sean <Sean.Moore@ottawa.ca>; Yang, Winston <Winston.Yang@wsp.com>; Mottalib, Abdul <Abdul.Mottalib@ottawa.ca>
Subject: RE: Lansdowne Park - Existing Building Water Demands

Hi Amy,

Thank you for the confirmation below. We will include the spreadsheet in the appendix and include discussion and assumptions in the body regarding the approach. We will also use the residential peaking factors to be conservative.

We will need to request new boundary conditions as now the water demands are different from boundary request submitted in September 2024. Can you please take of this as soon as possible?

OLD: Sept 5, 2024 Boundary Condition Request:
Avg Day Demand = 12.3 L/s
Max Day + Fire Flow Demand = 20.8 + 150 = 170.8 L/s
Peak Hour Demand = 39.3 L/s

NEW: Water Demands (using residential peaking factors and OSEG CARMA Metering Data):
Avg Day Demand = 5.2 L/s
Max Day + Fire Flow Demand = 13 + 150 = 163 L/s
Peak Hour Demand = 28.6 L/s

Regards,

Zarak Ali
Designer E.I.T
Land Development & Municipal Engineering - Ontario

T+ 1 343-227-9179
Zarak.ali@wsp.com

WSP Canada Inc.
2611 Queensview Drive, Suite 300
Ottawa, Ontario
K2B 8K2 Canada

wsp.com

From: Whelan, Amy <amy.whelan@ottawa.ca>
Sent: December 10, 2024 1:29 PM
To: Ali, Zarak <Zarak.Ali@wsp.com>; Mottalib, Abdul <Abdul.Mottalib@ottawa.ca>
Cc: Moore, Sean <Sean.Moore@ottawa.ca>; Yang, Winston <Winston.Yang@wsp.com>
Subject: RE: Lansdowne Park - Existing Building Water Demands

Hi Winston and Zarak,

The average daily demand of 5.2L/s from the metering data is acceptable, please be sure to include the spread sheet information in the appendix of the report and include a discussion of the approach in the body of the report.

Additionally, we are okay with the assumptions detailed in Winston's email, again please be sure to include discussion of all assumptions in the body of the report.

What peaking factor are you proposing to use for the calculation will the average daily demands from the entire site be multiplied by one peaking factor or will the demands be segregated by each type of use? For simplicity and to remain conservative we would accept that the total site max day demand is calculated with the residential peaking factor. unless it is calculated individually for each use type.

Kind regards,

Amy Whelan, E.I.T
Project Manager, Infrastructure Approvals
Development Review, Central | Examen des projets d'aménagement, Central
Planning, Development and Building Services Department (PDBS) | Direction générale des services de la planification, de l'aménagement et du bâtiment (DGSPAB)
City of Ottawa | Ville d'Ottawa
110 Laurier Avenue West Ottawa, ON | 110, avenue. Laurier Ouest. Ottawa (Ontario) K1P 1J1
613.580.2424 ext./poste 26642, amy.whelan@ottawa.ca

Classified as City of Ottawa - Internal / Ville d'Ottawa - classé interne

---

From: Ali, Zarak <Zarak.Ali@wsp.com>
Sent: December 10, 2024 9:16 AM
To: Whelan, Amy <amy.whelan@ottawa.ca>; Mottalib, Abdul <Abdul.Mottalib@ottawa.ca>
Cc: Moore, Sean <Sean.Moore@ottawa.ca>; Yang, Winston <winston.yang@wsp.com>
Subject: RE: Lansdowne Park - Existing Building Water Demands

CAUTION: This email originated from an External Sender. Please do not click links or open attachments unless you recognize the source.

ATTENTION : Ce courriel provient d'un expéditeur externe. Ne cliquez sur aucun lien et n'ouvrez pas de pièce jointe, excepté si vous connaissez l'expéditeur.

Hi Amy/Abdul,

Based on the OSEG CARMA Metering City Main Total readings (see attached spreadsheet), I have calculated an average day demand of **5.2 L/s** over a 12 month span of data for the entire site.

I took the City Main Totals readings from January to October from 2024 data and November/December City Main Totals readings from 2023 data to determine an average 12-month consumption of 13,443,083 L/month or about 5.2 L/s.

Please let us know your thoughts.

Regards,

Zarak Ali
Designer E.I.T
Land Development & Municipal Engineering - Ontario

T+ 1 343-227-9179
Zarak.ali@wsp.com

WSP Canada Inc.
2611 Queensview Drive, Suite 300
Ottawa, Ontario
K2B 8K2 Canada

wsp.com

Classified as City of Ottawa - Internal / Ville d'Ottawa - classé interne

From: Yang, Winston <Winston.Yang@wsp.com>
Sent: December 9, 2024 1:33 PM
To: Whelan, Amy <amy.whelan@ottawa.ca>; Mottalib, Abdul <Abdul.Mottalib@ottawa.ca>
Cc: Moore, Sean <Sean.Moore@ottawa.ca>; Ali, Zarak <Zarak.Ali@wsp.com>
Subject: RE: Lansdowne Park - Existing Building Water Demands

Hi Amy,

We can update the calculation with the provided overall water meter data without knowing the consumption from each building as long as you are satisfied with the assumption we are going to make. We will assume that the future water demand will be equivalent in value to the existing demand or less.

Then we will just need to plug the number in to the current calculation. If the result shows minimum pressure is achieved, then further computer modeling includes the looping is not required for Phase 1 and 2.

Kindly let me know what's your thought.

Yours truly,

Winston Yang
Lead Engineer – Technical Lead
Land Development & Municipal Engineering, Ontario
P.Eng., PMP.

T+ 1 613-829-2800
T+ 1 613-690-0538 (Direct)
M+ 1 647-628-8108

WSP Canada Inc.
2611 Queensview Drive, Suite 300
Ottawa, Ontario,
K2B 8K2 Canada

wsp.com

From: Whelan, Amy <amy.whelan@ottawa.ca>
Sent: December 9, 2024 12:56 PM
To: Yang, Winston <Winston.Yang@wsp.com>; Mottalib, Abdul <Abdul.Mottalib@ottawa.ca>
Cc: Moore, Sean <Sean.Moore@ottawa.ca>; Ali, Zarak <Zarak.Ali@wsp.com>
Subject: RE: Lansdowne Park - Existing Building Water Demands

Hi Winston,

Thank you for your email, have you received more information about the meter account locations? Sean informed me that two chamber meters relating to four account numbers were identified. Please let me know if you would like me to reach out to Rick Nelson from facilities.

Unfortunately, although we understand that the approach is conservative we cannot accept fire flow calculations that do not meet the minimum pressure requirements under max day + fire flow. Since, the analysis does not meet the minimum pressure requirements with out analyzing the looping we suggest that you wait for the metering data or provide a computer model that includes the looping.

Understanding, that we are operating under tight timelines we could consider that the servicing report will be required to be updated as a condition of approval prior to building permit. The condition would require that you update the calculations with the metering data, if the minimum pressure under max day + fire flow is still not achieved then a hydraulic watermain analysis of the entire site would be required, finally if the hydraulic watermain analysis shows that minimum pressure still can not be achieved then the private infrastructure would need to be upsized accordingly. We would have to work on the exact wording with our legal team.

Kind regards,

Amy Whelan, E.I.T
Project Manager, Infrastructure Approvals
Development Review, Central | Examen des projets d'aménagement, Central
Planning, Development and Building Services Department (PDBS) | Direction générale des services de la planification, de l'aménagement et du bâtiment (DGSPAB)
City of Ottawa | Ville d'Ottawa
110 Laurier Avenue West Ottawa, ON | 110, avenue. Laurier Ouest. Ottawa (Ontario) K1P 1J1
613.580.2424 ext./poste 26642, amy.whelan@ottawa.ca

Classified as City of Ottawa - Internal / Ville d'Ottawa - classé interne

From: Yang, Winston <Winston.Yang@wsp.com>
Sent: December 06, 2024 4:58 PM
To: Whelan, Amy <amy.whelan@ottawa.ca>; Mottalib, Abdul <Abdul.Mottalib@ottawa.ca>
Cc: Moore, Sean <Sean.Moore@ottawa.ca>; Ali, Zarak <Zarak.Ali@wsp.com>
Subject: RE: Lansdowne Park - Existing Building Water Demands

CAUTION: This email originated from an External Sender. Please do not click links or open attachments unless you recognize the source.

ATTENTION : Ce courriel provient d'un expéditeur externe. Ne cliquez sur aucun lien et n'ouvrez pas de pièce jointe, excepté si vous connaissez l'expéditeur.

Hi Amy and Abdul,

If it takes time to sort out the water meter data and to identify the usage from different buildings, I would suggest to proceed with the below approach.

I have updated the calculation to include the overall demand for the entire Lansdowne site for both fire flow and minimum pressure check. Please see the below results for the updated residual pressure for each scenario.

	EC		NNS	
	Max Day+Fire Flow	Peak Hour	Max Day+Fire Flow	Peak Hour
BC from Bank	131 kPa < 140 kPa	334 kPa > 276 kPa	299 kPa > 140 kPa	363 kPa > 276 kPa
BC from Holmwood Ave	158 kPa > 140 kPa	337 kPa > 276 kPa	122 kPa < 140 kPa	353 kPa > 276 kPa

There are two feeds from City main to the Lansdowne Site. One at Bank Street near scoreboard and the other at the NE corner of Horticulture at Holmwood Ave. And there is an internal watermain looping system at Lansdowne.
As you can tell from the above results, most of the design pressures exceeds the minimum requirement except the boundary condition from Bank St to EC and boundary condition from Holmwood Ave to NNS. These two scenarios show the resulting pressures drop slightly below the

minimum requirement. But keep it in mind that this is a conservative scenario, the above calculations assume that the watermain would not be looped or interconnected, and the water service connection is assumed to connect to the building directly from the city main.

Base on the assumption without updating the demand from the city water meter data, we can conclude that the existing private watermain network at Lansdowne has sufficient pressure to provide adequate fire flow protection and secure minimum pressure during Peak Hour use.

Are you satisfied with the above approach?

Yours truly,

Winston Yang
Lead Engineer – Technical Lead
Land Development & Municipal Engineering, Ontario
P.Eng., PMP.

T+ 1 613-829-2800
T+ 1 613-690-0538 (Direct)
M+ 1 647-628-8108

WSP Canada Inc.
2611 Queensview Drive, Suite 300
Ottawa, Ontario,
K2B 8K2 Canada
wsp.com

Classified as City of Ottawa - Internal / Ville d'Ottawa - classé interne

From: Whelan, Amy <amy.whelan@ottawa.ca>
Sent: December 6, 2024 2:04 PM
To: Mottalib, Abdul <Abdul.Mottalib@ottawa.ca>; Moore, Sean <Sean.Moore@ottawa.ca>
Cc: Yang, Winston <Winston.Yang@wsp.com>
Subject: RE: Lansdowne Park - Existing Building Water Demands

Hello all,

I just had a quick phone call with Winston to discuss the metering data and he informed me that a request has ben made to OSEG and they confirmed that they could get the information that WSP requires. If for some reason we can not get that information from OSEG then we can ask Rick Nelson to see if he has the account information.

Kind regards,

Amy Whelan, E.I.T
Project Manager, Infrastructure Approvals
Development Review, Central | Examen des projets d'aménagement, Central

Planning, Development and Building Services Department (PDBS) | Direction générale des services de la planification, de l'aménagement et du bâtiment (DGSPAB)
City of Ottawa | Ville d'Ottawa
110 Laurier Avenue West Ottawa, ON | 110, avenue. Laurier Ouest. Ottawa (Ontario) K1P 1J1
613.580.2424 ext./poste 26642, amy.whelan@ottawa.ca

Classified as City of Ottawa - Internal / Ville d'Ottawa - classé interne

From: Mottalib, Abdul <Abdul.Mottalib@ottawa.ca>
Sent: December 05, 2024 6:11 PM
To: Moore, Sean <Sean.Moore@ottawa.ca>
Cc: Whelan, Amy <amy.whelan@ottawa.ca>; Yang, Winston <winston.yang@wsp.com>; Mottalib, Abdul <Abdul.Mottalib@ottawa.ca>
Subject: RE: Lansdowne Park - Existing Building Water Demands

Hi Sean,

Probably Nelson, Richard <Richard.Nelson@ottawa.ca can help us. Amy and I will talk about it tomorrow morning.

--

Thanks,

Abdul
Mohammad Abdul Mottalib, P. Eng.
Extension: 27798

Classified as City of Ottawa - Internal / Ville d'Ottawa - classé interne

From: Yang, Winston <Winston.Yang@wsp.com>
Sent: December 05, 2024 4:21 PM
To: Moore, Sean <Sean.Moore@ottawa.ca>
Cc: Whelan, Amy <amy.whelan@ottawa.ca>; Mottalib, Abdul <Abdul.Mottalib@ottawa.ca>
Subject: RE: Lansdowne Park - Existing Building Water Demands

CAUTION: This email originated from an External Sender. Please do not click links or open attachments unless you recognize the source.

ATTENTION : Ce courriel provient d'un expéditeur externe. Ne cliquez sur aucun lien et n'ouvrez pas de pièce jointe, excepté si vous connaissez l'expéditeur.

Hi Sean,

Will OSEG/TD Garden be able to verify the account number?

Yours truly,

Winston Yang
Lead Engineer – Technical Lead
Land Development & Municipal Engineering, Ontario
P.Eng., PMP.

T+ 1 613-829-2800
T+ 1 613-690-0538 (Direct)
M+ 1 647-628-8108

WSP Canada Inc.
2611 Queensview Drive, Suite 300
Ottawa, Ontario,
K2B 8K2 Canada
wsp.com

Classified as City of Ottawa - Internal / Ville d'Ottawa - classé interne

From: Moore, Sean <Sean.Moore@ottawa.ca>
Sent: December 5, 2024 4:18 PM
To: Yang, Winston <Winston.Yang@wsp.com>
Cc: Whelan, Amy <amy.whelan@ottawa.ca>; Mottalib, Abdul <Abdul.Mottalib@ottawa.ca>
Subject: FW: Lansdowne Park - Existing Building Water Demands

Winston,

I'm having trouble identifying the exact building for those water meters – Amy /Abdul do you have any suggestions on what we can do here?

sean

Classified as City of Ottawa - Internal / Ville d'Ottawa - classé interne

From: Khawam, Walid <Walid.Khawam@ottawa.ca>
Sent: December 05, 2024 4:10 PM
To: Johns, Susan <Susan.Johns@ottawa.ca>
Cc: Feilders, Andrea <Andrea.feilders@ottawa.ca>; Moore, Sean <Sean.Moore@ottawa.ca>
Subject: RE: Lansdowne Park - Existing Building Water Demands

Hi Sue,

There is currently no GIS layer showing exact locations of water meters. There is a water service location layer that shows those WSL#s in the table below. However, that layer puts a point in the middle of a parcel, which means it could be anywhere on the property, not necessarily where the meter is located. The address and detailed description of meter location is probably the best info to use.

Hope this helps,

Please let me know if you have any questions,

Thank you

Walid Khawam, P.Eng.
Infrastructure Assessment Engineer - Watermains
Linear Asset Management Branch
Infrastructure and Water Services / *Services d'infrastructure et d'eau*
City of Ottawa
Cell:613-263-5851

Classified as City of Ottawa - Internal / Ville d'Ottawa - classé interne

---

From: Johns, Susan <Susan.Johns@ottawa.ca>
Sent: December 03, 2024 10:51 AM
To: Khawam, Walid <Walid.Khawam@ottawa.ca>
Cc: Feilders, Andrea <Andrea.feilders@ottawa.ca>; Johns, Susan <Susan.Johns@ottawa.ca>
Subject: FW: Lansdowne Park - Existing Building Water Demands

Good morning,
I see some info on GeoOttawa with details of watermain structure numbers, and I cannot match the chart below to any ID numbers on GeoOttawa, although the address dsecriptions make sense.

Do we have a map that would include the info in the chart below so the designer for the Lansdowne project can proceed?
Thanks
Sue

Classified as City of Ottawa - Internal / Ville d'Ottawa - classé interne

---

From: Moore, Sean <Sean.Moore@ottawa.ca>
Sent: December 03, 2024 10:26 AM
To: Johns, Susan <Susan.Johns@ottawa.ca>
Subject: Fw: Lansdowne Park - Existing Building Water Demands

Hi Sue,

Can you look at the email below (see the Table) and let me know if there is some way we can use the structure ID and location number to on point exactly where the water meter is at Lansdowne Park -does staff have a map?

Our consulting engineer needs the location to finish their water design.

Thx

Sean

Get Outlook for iOS

Classified as City of Ottawa - Internal / Ville d'Ottawa - classé interne

---

From: Yang, Winston <Winston.Yang@wsp.com>
Sent: Tuesday, December 3, 2024 9:23 AM
To: Moore, Sean <Sean.Moore@ottawa.ca>
Cc: Ali, Zarak <Zarak.Ali@wsp.com>
Subject: RE: Lansdowne Park - Existing Building Water Demands

CAUTION: This email originated from an External Sender. Please do not click links or open attachments unless you recognize the source.

ATTENTION : Ce courriel provient d'un expéditeur externe. Ne cliquez sur aucun lien et n'ouvrez pas de pièce jointe, excepté si vous connaissez l'expéditeur.

Hi Sean,

Can we have OSEG/TD Garden to confirm which is which?

Yours truly,

Winston Yang
Lead Engineer – Technical Lead
Land Development & Municipal Engineering, Ontario
P.Eng., PMP.

T+ 1 613-829-2800
T+ 1 613-690-0538 (Direct)
M+ 1 647-628-8108

WSP Canada Inc.
2611 Queensview Drive, Suite 300
Ottawa, Ontario,
K2B 8K2 Canada
wsp.com

Classified as City of Ottawa - Internal / Ville d'Ottawa - classé interne

From: Moore, Sean <Sean.Moore@ottawa.ca>
Sent: December 2, 2024 4:35 PM
To: Yang, Winston <Winston.Yang@wsp.com>
Subject: Fw: Lansdowne Park - Existing Building Water Demands

Is this what you needed?

Get Outlook for iOS

Classified as City of Ottawa - Internal / Ville d'Ottawa - classé interne

---

From: Kuhn, Jonathan <Jonathan.Kuhn@ottawa.ca>
Sent: Monday, December 2, 2024 3:47 PM
To: Yang, Winston <winston.yang@wsp.com>; Moore, Sean <Sean.Moore@ottawa.ca>
Cc: Jafferjee, Ishaque <Ishaque.Jafferjee@wsp.com>; Whelan, Amy <amy.whelan@ottawa.ca>; Mottalib, Abdul <Abdul.Mottalib@ottawa.ca>; Ali, Zarak <Zarak.Ali@wsp.com>
Subject: RE: Lansdowne Park - Existing Building Water Demands

Hi So Sorry for the delay, See answers below,

1. Unit of measure is cubic meters
2. Here is some info I pulled from our Asset Management system. The identifier I previously gave you is the "ACCT" number. I hope between the address and the description you can identify where these meters are.

Structure ID	Location	Description
WSL00540604	588275	Water Service Location, WSL00540604, ACCT# 00540604, CHAMBER OPP #1 5TH AVE PKG L
WSL00530738	391449	Water Service Location, WSL00530738, ACCT#00530738, R F W, LS, N, B, 150, 1.0, OC, F, CU
WSL30059411	705517	Water Service Location, WSL30059411, ACCT#10069217, F.W, R.F, F, B, 020, 1.0, OC, CUST T
WSL00530736	377334	Water Service Location, WSL00530736, ACCT# 00530736, LSCW IN BOILER ROOM, LSCW LT
WSL60010180	739433	Water Service Location, WSL60010180, ACCT# 10081618, IN CHAMBER - 200 YARDS FROM C
WSL60005535	722563	Water Service Location, WSL60005535, ACCT# 10077975, OPP 1018 BANK IN LANDSDOWN
WSL60005532	722565	Water Service Location, WSL60005532, ACCT# 10077977, OPP 1018 BANK IN LANDSDOWN
WSL60005533	722564	Water Service Location, WSL60005533, ACCT# 10077978, EAST CORNER OF LANDSDOWN O
WSL30059412	705595	Water Service Location, WSL30059412, ACCT#10069216, FURNACE RM, R.F, F, B, 020, 1.0, C
WSL60005534	722566	Water Service Location, WSL60005534, ACCT# 10077976, EAST CORNER OF LANDSDOWN O

3. The calculated consumption column is just a simple delta of the meter read column and not something derived from the meter reading system so it can be ignored and you can calculate your own deltas with error correction from the "meter read column"

Jonathan Kuhn
AMI Network Administrator
City of Ottawa
Finance and Corporate Services
Tel: 613-580-2424, ext. 24067

951 Clyde Avenue
Ottawa ON, K2C 3R8
Ottawa.ca | My ServiceOttawa

Classified as City of Ottawa - Internal / Ville d'Ottawa - classé interne

From: Yang, Winston <Winston.Yang@wsp.com>
Sent: November 28, 2024 12:46 PM
To: Moore, Sean <Sean.Moore@ottawa.ca>; Kuhn, Jonathan <Jonathan.Kuhn@ottawa.ca>
Cc: Jafferjee, Ishaque <Ishaque.Jafferjee@wsp.com>; Whelan, Amy <amy.whelan@ottawa.ca>; Mottalib, Abdul <Abdul.Mottalib@ottawa.ca>; Ali, Zarak <Zarak.Ali@wsp.com>
Subject: RE: Lansdowne Park - Existing Building Water Demands

CAUTION: This email originated from an External Sender. Please do not click links or open attachments unless you recognize the source.

ATTENTION : Ce courriel provient d'un expéditeur externe. Ne cliquez sur aucun lien et n'ouvrez pas de pièce jointe, excepté si vous connaissez l'expéditeur.

Hi Sean and Kuhn,

I would like to follow up the below request.

Can we get the clarification ASAP? ‘

Yours truly,

Winston Yang
Lead Engineer – Technical Lead
Land Development & Municipal Engineering, Ontario
P.Eng., PMP.

T+ 1 613-829-2800
T+ 1 613-690-0538 (Direct)
M+ 1 647-628-8108

WSP Canada Inc.
2611 Queensview Drive, Suite 300
Ottawa, Ontario,
K2B 8K2 Canada
wsp.com

Classified as City of Ottawa - Internal / Ville d'Ottawa - classé interne

From: Ali, Zarak <Zarak.Ali@wsp.com>
Sent: November 20, 2024 12:22 PM
To: Moore, Sean <Sean.Moore@ottawa.ca>; Jonathan.Kuhn@ottawa.ca
Cc: Jafferjee, Ishaque <Ishaque.Jafferjee@wsp.com>; Yang, Winston <Winston.Yang@wsp.com>
Subject: RE: Lansdowne Park - Existing Building Water Demands

Hi Sean/Jonathan,

Thank you for the water consumption data. We had a few questions we were hoping you could help us with.

1. Can you provide us the units of measurement for the “Calculater Consumption” column and the “MeterRead” column?

2. There seem to be 9 different account numbers/meters (see image below). Are you able to provide information

   on which building on the Lansdowne campus corresponds to each meter?

Unique acc numbers
530736
530738
540604
10069216
10077975
10077976
10077977
10077978
10081618

3. Can you verify that the 0 value data points (calculated consumption column) are correct data points and that the negative/large positive numbers (also calculated consumption column) are readings which can be ignored for purposes of determining average daily consumptions?

Regards,

Zarak Ali
Designer E.I.T
Land Development & Municipal Engineering - Ontario

T+ 1 343-227-9179
Zarak.ali@wsp.com

WSP Canada Inc.
2611 Queensview Drive, Suite 300
Ottawa, Ontario

K2B 8K2 Canada
wsp.com

From: Yang, Winston <Winston.Yang@wsp.com>
Sent: November 20, 2024 9:55 AM
To: Ali, Zarak <Zarak.Ali@wsp.com>
Cc: Jafferjee, Ishaque <Ishaque.Jafferjee@wsp.com>
Subject: FW: Lansdowne Park - Existing Building Water Demands

Hi Zarak,

Can you look at the attached water consumption data for Lansdowne?
The attached data contains all the meter consumption for the entire Lansdown site. City would like us to use the actual demand instead of the assumption we have made on the report.

Let me know if you have any questions.

Yours truly,

Winston Yang
Lead Engineer – Technical Lead
Land Development & Municipal Engineering, Ontario
P.Eng., PMP.

T+ 1 613-829-2800
T+ 1 613-690-0538 (Direct)
M+ 1 647-628-8108

WSP Canada Inc.
2611 Queensview Drive, Suite 300
Ottawa, Ontario,
K2B 8K2 Canada
wsp.com

From: Moore, Sean <Sean.Moore@ottawa.ca>
Sent: November 14, 2024 7:53 PM
To: Yang, Winston <Winston.Yang@wsp.com>; Jafferjee, Ishaque <Ishaque.Jafferjee@wsp.com>
Subject: Fw: Lansdowne Park - Existing Building Water Demands

Winston please find the water consumption data as requested:

Sean

Get Outlook for iOS

Classified as City of Ottawa - Internal / Ville d'Ottawa - classé interne

---

From: Kuhn, Jonathan <Jonathan.Kuhn@ottawa.ca>
Sent: Thursday, November 14, 2024 4:43 PM
To: Moore, Sean <Sean.Moore@ottawa.ca>
Subject: FW: Lansdowne Park - Existing Building Water Demands

Hi Sean,

I have some water consumption data as requested by WSP.

I do not have a working relationship with WSP so I do not know what level of data we can share with them. I have included account numbers and water consumption for the Lansdown meters.

If you see no issue with sharing this data with the consultant you may fwd it along.

Jonathan Kuhn
AMI Network Administrator
City of Ottawa
Finance and Corporate Services
Tel: 613-580-2424, ext. 24067
951 Clyde Avenue
Ottawa ON, K2C 3R8
Ottawa.ca | My ServiceOttawa

Classified as City of Ottawa - Internal / Ville d'Ottawa - classé interne

---

From: Yang, Winston <Winston.Yang@wsp.com>
Sent: November 11, 2024 4:51 PM
To: Kuhn, Jonathan <Jonathan.Kuhn@ottawa.ca>
Cc: Levesque, Joshua <Joshua.Levesque@ottawa.ca>; Whelan, Amy <amy.whelan@ottawa.ca>; Mottalib, Abdul <Abdul.Mottalib@ottawa.ca>; Zhang, Alice <alice.zhang@ottawa.ca>
Subject: FW: Lansdowne Park - Existing Building Water Demands
Importance: High

CAUTION: This email originated from an External Sender. Please do not click links or open attachments unless you recognize the source.

ATTENTION : Ce courriel provient d'un expéditeur externe. Ne cliquez sur aucun lien et n'ouvrez pas de pièce jointe, excepté si vous connaissez l'expéditeur.

Hi Jonathan,

In Alice's away, can you look into the below request?

Yours truly,

Winston Yang
Lead Engineer – Technical Lead
Land Development & Municipal Engineering, Ontario
P.Eng., PMP.

T+ 1 613-829-2800
T+ 1 613-690-0538 (Direct)
M+ 1 647-628-8108

WSP Canada Inc.
2611 Queensview Drive, Suite 300
Ottawa, Ontario,
K2B 8K2 Canada
wsp.com

From: Yang, Winston
Sent: November 11, 2024 4:43 PM
To: alice.zhang@ottawa.ca
Cc: Whelan, Amy <amy.whelan@ottawa.ca>; Mottalib, Abdul <Abdul.Mottalib@ottawa.ca>
Subject: RE: Lansdowne Park - Existing Building Water Demands
Importance: High

Hi Alice,

We are working for the Lansdowne 2.0 project. City would like us to obtain the existing water demands from the existing buildings on site.

Can I have the existing domestic water demand data from the entire Lansdowne site?

Feel free to reach out if you need more info.

Yours truly,

Winston Yang
Lead Engineer – Technical Lead
Land Development & Municipal Engineering, Ontario
P.Eng., PMP.

T+ 1 613-829-2800
T+ 1 613-690-0538 (Direct)
M+ 1 647-628-8108

WSP Canada Inc.
2611 Queensview Drive, Suite 300
Ottawa, Ontario,
K2B 8K2 Canada

wsp.com

From: Whelan, Amy <amy.whelan@ottawa.ca>
Sent: September 11, 2024 3:31 PM
To: Moore, Sean <Sean.Moore@ottawa.ca>
Cc: Mottalib, Abdul <Abdul.Mottalib@ottawa.ca>; Hughes, Brett <brett.hughes@ottawa.ca>; Renaud, Jean-Charles <jean-charles.renaud@ottawa.ca>; van Wyk, Adrian <adrian.vanwyk@ottawa.ca>; Smith, Jack <jack.smith@ottawa.ca>; McCreight, Andrew <Andrew.McCreight@ottawa.ca>; Ahmad, Shohan <Shohan.Ahmad@ottawa.ca>
Subject: RE: Lansdowne Park - CODE REPORT to interconnection

Good afternoon Sean,

Please find the updated boundary conditions enclosed in this email. Upon further internal discussion it was determined that due to the rationale that WSP consulting had indicated in the meeting held September 5th 2024 from 11:00am-12:00pm the City is willing to accept a spreadsheet type hydraulic watermain analysis. Please note that the requirement to model the entire private network has been lifted on an exceptional basis, for this specific application, and does not set precedent for future applications.

The applicant is required to demonstrate how the internal private network can support the proposed development i.e. the future event centre through the above mentioned hydraulic watermain analysis and include the results in their servicing report. The City does not accept hydrant pressure testing in place of a hydraulic watermain analysis.

The following details/changes are required for approval:
-Submit an updated boundary condition request to the City of Ottawa for the proposed event center only. (Completed)
-Include the boundary condition request correspondence email in the appendix of the servicing report.
-Remove all language in the site servicing report that states that the design is considering all three phases of the proposed Lansdowne design as it pertains to drinking water servicing.
-Provide the domestic demand calculations of the existing event center and provide the domestic demand calculations of proposed the event center.
-Provide the required fire flow calculations of the existing event center and the required fire flow calculations of the proposed event center.
-Provide discussion in the site servicing report explaining the rational discussed in the meeting detailing how the demands of the proposed event center can be met with the existing watermain network. In addition the report should justify that the proposed development will not negatively impact the existing hydraulic condition. This rational is required as a basis for the City to make an exception for this site to accept a hydraulic analysis using the spreadsheet approach.
-Provide a hydraulic watermain analysis that incorporates the hydraulic losses in the system from the boundary condition connection locations to the proposed event center. The hydraulic watermain analysis is required to include the existing demands from the existing buildings, please

contact water metering division to obtain the existing domestic water demand data (alice.zhang@ottawa.ca).
-Provide results of the spread sheet analysis demonstrating that the private system meets the criteria of section 4.2.2 of the Ottawa Design Guidelines – Water Distribution for the proposed event centers demands. This includes data that shows that the expected demands under average day, peak hour and fire flow conditions provide water within the required pressure ranges.

Requirements for future phases:
-All subsequent phases will require updated boundary conditions, and an updated hydraulic watermain analysis.
-Phase 3 Lansdowne project (towers and podium) will be required to demonstrate, via a hydraulic watermain analysis that the private system meets the criteria of section 4.2.2 of the Ottawa Design Guidelines – Water Distribution. The hydraulic watermain analysis will be required to analyze the entire private system and include the existing site demands and the proposed demands for the project.

If you have any questions or wish to arrange a meeting to discuss further, please let us know.

Kind regards,

Amy Whelan, E.I.T
Project Manager, Infrastructure Approvals
Development Review, Central | Examen des projets d'aménagement, Central
Planning, Development and Building Services Department (PDBS) | Direction générale des services de la planification, de l'aménagement et du bâtiment (DGSPAB)
City of Ottawa | Ville d'Ottawa
110 Laurier Avenue West Ottawa, ON | 110, avenue. Laurier Ouest. Ottawa (Ontario) K1P 1J1
613.580.2424 ext./poste 26642, amy.whelan@ottawa.ca

From: Moore, Sean <Sean.Moore@ottawa.ca>
Sent: September 06, 2024 11:59 AM
To: Whelan, Amy <amy.whelan@ottawa.ca>
Cc: Mottalib, Abdul <Abdul.Mottalib@ottawa.ca>
Subject: RE: Lansdowne Park - CODE REPORT to interconnection

Thank you for the update Amy.

Sean.

From: Whelan, Amy <amy.whelan@ottawa.ca>
Sent: September 06, 2024 11:27 AM
To: Moore, Sean <Sean.Moore@ottawa.ca>
Cc: Mottalib, Abdul <Abdul.Mottalib@ottawa.ca>
Subject: RE: Lansdowne Park - CODE REPORT to interconnection

Good morning Sean,

I am just following up to inform you that we are currently awaiting the boundary condition results from the updated request that Winston had sent yesterday. We would like to review the results of the boundary conditions internally and get back to you regarding the hydraulic watermain analysis requirement. As per the meeting we believe that we should be receiving the boundary condition results by Monday or Tuesday next week.

Kind regards,

Amy Whelan, E.I.T
Project Manager, Infrastructure Approvals
Development Review, Central | Examen des projets d'aménagement, Central
Planning, Development and Building Services Department (PDBS) | Direction générale des services de la planification, de l'aménagement et du bâtiment (DGSPAB)
City of Ottawa | Ville d'Ottawa
110 Laurier Avenue West Ottawa, ON | 110, avenue. Laurier Ouest. Ottawa (Ontario) K1P 1J1
613.580.2424 ext./poste 26642, amy.whelan@ottawa.ca

From: Yang, Winston <Winston.Yang@wsp.com>
Sent: September 05, 2024 5:41 PM
To: Moore, Sean <Sean.Moore@ottawa.ca>; Mottalib, Abdul <Abdul.Mottalib@ottawa.ca>
Cc: Whelan, Amy <amy.whelan@ottawa.ca>
Subject: Re: Lansdowne Park - CODE REPORT to interconnection
Importance: High

CAUTION: This email originated from an External Sender. Please do not click links or open attachments unless you recognize the source.

ATTENTION : Ce courriel provient d'un expéditeur externe. Ne cliquez sur aucun lien et n'ouvrez pas de pièce jointe, excepté si vous connaissez l'expéditeur.

Hi Sean and Abdul,

Attached is the code report prepared specifically for OSEG by Morrison Hershfield dated May 17, 2012 for the Lansdowne site and this information should be used on future developments on site.
.
The approach used at Lansdowne is unique and took some detailed conversations with the Authority having jurisdiction to come to an agreeable arrangement.

As you are aware that most of the existing watermain network is within the building garage, they are part of the building mechanical system, all these network are also inter-connected within the building plumping system and designed using the O.B.C requirement.
The typical hydraulic water model that City uses to work on is not applicable for this site.

The existing water network was designed and completed by few different consultants, Civil and Building Mechanical, etc., we are not able to put up a unique model that it's suitable for this site.

And as I have mentioned during the meeting, the worse case scenario is the max daily demand + fire flow within the development site shall be governed.
This is typical for all subdivision or site plan developments that we have to make sure there will be adequate demand available from each junction through the hydraulic analysis to meet the targeting max daily and fire.
As per previous approved design, fire flow of 150 l/s has been used for all the buildings within Lansdowne site.
For the current redevelopment phase 1 EC and phase 2 NNS, the max daily demand are almost the same, the fire flow is way less than 150 L/s. This is better off from the existing condition.
If the existing network is working, issues for phase 1 and 2 should not be anticipated.

For future residential development (the two towers), hydraulic analysis is also not required because tower 1 and 2 will be part of the existing building, it should be treated as a single building as per the attached Code report since the underground parking is attached.
The two towers will be serviced internally from the existing garage system.

Further analysis should be provided by the Architect and Mechanical consultant to verify the pressure for daily demand and fire protection during the design of the residential towers.

I am agree that we can obtain an updated boundary condition for city's record, but hydraulic analysis for the entire Lansdowne site is not necessary.
Simple hydraulic check on water pressure using the new boundary condition should be enough to verify the maximum and minimum pressures for phase 1 and 2.
And the hydrant flow test result can be used to confirm the adequate flow within the system down to 140 Kpa (20 psi) to meet the targeting the max daily + fire flow.

Feel free to reach out if you would like to discuss.

Yours truly,

Winston Yang
Lead Engineer – Technical Lead
Land Development & Municipal Engineering, Ontario
P.Eng., PMP.

T+ 1 613-829-2800
T+ 1 613-690-0538 (Direct)
M+ 1 647-628-8108

WSP Canada Inc.
2611 Queensview Drive, Suite 300
Ottawa, Ontario,
K2B 8K2 Canada
wsp.com

NOTICE: This communication and any attachments ("this message") may contain information which is privileged, confidential, proprietary or otherwise subject to restricted disclosure under applicable law. This message is for the sole use of the intended recipient(s). Any unauthorized use, disclosure, viewing, copying, alteration, dissemination or distribution of, or reliance on, this message is strictly prohibited. If you have received this message in error, or you are not an authorized or intended recipient, please notify the sender immediately by replying to this message, delete this message and all copies from your e-mail system and destroy any printed copies. You are receiving this communication because you are listed as a current WSP contact. Should you have any questions regarding WSP's electronic communications policy, please consult our Anti-Spam Commitment at www.wsp.com/casl. For any concern or if you believe you should not be receiving this message, please forward this message to caslcompliance@wsp.com so that we can promptly address your request. Note that not all messages sent by WSP qualify as commercial electronic messages.

AVIS : Ce message, incluant tout fichier l'accompagnant (« le message »), peut contenir des renseignements ou de l'information privilégiés, confidentiels, propriétaires ou à divulgation restreinte en vertu de la loi. Ce message est destiné à l'usage exclusif du/des destinataire(s) voulu(s). Toute utilisation non permise, divulgation, lecture, reproduction, modification, diffusion ou distribution est interdite. Si vous avez reçu ce message par erreur, ou que vous n'êtes pas un destinataire autorisé ou voulu, veuillez en aviser l'expéditeur immédiatement et détruire le message et toute copie électronique ou imprimée. Vous recevez cette communication car vous faites partie des contacts de WSP. Si vous avez des questions concernant la politique de communications électroniques de WSP, veuillez consulter notre Engagement anti-pourriel au www.wsp.com/lcap. Pour toute question ou si vous croyez que vous ne devriez pas recevoir ce message, prière de le transférer au conformitelcap@wsp.com afin que nous puissions rapidement traiter votre demande. Notez que ce ne sont pas tous les messages transmis par WSP qui constituent des messages electroniques commerciaux.

-LAEmHhHzdJzBlTWfa4Hgs7pbKI

'

This e-mail originates from the City of Ottawa e-mail system. Any distribution, use or copying of this e-mail or the information it contains by other than the intended recipient(s) is unauthorized. Thank you.

Le présent courriel a été expédié par le système de courriels de la Ville d'Ottawa. Toute distribution, utilisation ou reproduction du courriel ou des renseignements qui s'y trouvent par une personne autre que son destinataire prévu est interdite. Je vous remercie de votre collaboration.

'

'

This e-mail originates from the City of Ottawa e-mail system. Any distribution, use or copying of this e-mail or the information it contains by other than the intended recipient(s) is unauthorized. Thank you.

Le présent courriel a été expédié par le système de courriels de la Ville d'Ottawa. Toute distribution, utilisation ou reproduction du courriel ou des renseignements qui s'y trouvent par une personne autre que son destinataire prévu est interdite. Je vous remercie de votre collaboration.

'

'

This e-mail originates from the City of Ottawa e-mail system. Any distribution, use or copying of this e-mail or the information it contains by other than the intended recipient(s) is unauthorized. Thank you.

Le présent courriel a été expédié par le système de courriels de la Ville d'Ottawa. Toute distribution, utilisation ou reproduction du courriel ou des renseignements qui s'y trouvent par une personne autre que son destinataire prévu est interdite. Je vous remercie de votre collaboration.

'
'

This e-mail originates from the City of Ottawa e-mail system. Any distribution, use or copying of this e-mail or the information it contains by other than the intended recipient(s) is unauthorized. Thank you.

Le présent courriel a été expédié par le système de courriels de la Ville d'Ottawa. Toute distribution, utilisation ou reproduction du courriel ou des renseignements qui s'y trouvent par une personne autre que son destinataire prévu est interdite. Je vous remercie de votre collaboration.

'
'

This e-mail originates from the City of Ottawa e-mail system. Any distribution, use or copying of this e-mail or the information it contains by other than the intended recipient(s) is unauthorized. Thank you.

Le présent courriel a été expédié par le système de courriels de la Ville d'Ottawa. Toute distribution, utilisation ou reproduction du courriel ou des renseignements qui s'y trouvent par une personne autre que son destinataire prévu est interdite. Je vous remercie de votre collaboration.

'
'

This e-mail originates from the City of Ottawa e-mail system. Any distribution, use or copying of this e-mail or the information it contains by other than the intended recipient(s) is unauthorized. Thank you.

Le présent courriel a été expédié par le système de courriels de la Ville d'Ottawa. Toute distribution, utilisation ou reproduction du courriel ou des renseignements qui s'y trouvent par une personne autre que son destinataire prévu est interdite. Je vous remercie de votre collaboration.

'
'

This e-mail originates from the City of Ottawa e-mail system. Any distribution, use or copying of this e-mail or the information it contains by other than the intended recipient(s) is unauthorized. Thank you.

Le présent courriel a été expédié par le système de courriels de la Ville d'Ottawa. Toute distribution, utilisation ou reproduction du courriel ou des renseignements qui s'y trouvent par une personne autre que son destinataire prévu est interdite. Je vous remercie de votre collaboration.

Yang, Winston

From: Moore, Sean <Sean.Moore@ottawa.ca>
Sent: September 12, 2024 6:55 PM
To: Yang, Winston
Subject: Fw: Lansdowne Park - CODE REPORT to interconnection
Attachments: FW: Lansdowne 2.0 - Revised Boundary Conditions Request (Excluding Future Residential Tower 1 and 2)

Winston please let me know your teams ETA on the necessary updates based on the boundary conditions provided and Amy's deficiencies identified.

Thx

Sean

Get Outlook for iOS

From: Moore, Sean <Sean.Moore@ottawa.ca>
Sent: Wednesday, September 11, 2024 3:45 PM
To: Yang, Winston <winston.yang@wsp.com>
Cc: Patricia Warren <warren@fotenn.com>
Subject: Fw: Lansdowne Park - CODE REPORT to interconnection

Winston please see email below from the City and action.

Thank you
Sean

Get Outlook for iOS

From: Whelan, Amy <amy.whelan@ottawa.ca>
Sent: Wednesday, September 11, 2024 3:31 PM
To: Moore, Sean <Sean.Moore@ottawa.ca>
Cc: Mottalib, Abdul <Abdul.Mottalib@ottawa.ca>; Hughes, Brett <brett.hughes@ottawa.ca>; Renaud, Jean-Charles <Jean-Charles.Renaud@ottawa.ca>; van Wyk, Adrian <adrian.vanwyk@ottawa.ca>; Smith, Jack <jack.smith@ottawa.ca>; McCreight, Andrew <Andrew.McCreight@ottawa.ca>; Ahmad, Shohan <Shohan.Ahmad@ottawa.ca>
Subject: RE: Lansdowne Park - CODE REPORT to interconnection

Good afternoon Sean,

Please find the updated boundary conditions enclosed in this email. Upon further internal discussion it was determined that due to the rationale that WSP consulting had indicated in the meeting held September 5th 2024 from 11:00am-12:00pm the City is willing to accept a spreadsheet type hydraulic watermain analysis. Please note that the requirement to model the entire private network has been lifted on an exceptional basis, for this specific application, and does not set precedent for future applications.

The applicant is required to demonstrate how the internal private network can support the proposed development i.e. the future event centre through the above mentioned hydraulic watermain analysis and include the results in their servicing report. The City does not accept hydrant pressure testing in place of a hydraulic watermain analysis.

The following details/changes are required for approval:
-Submit an updated boundary condition request to the City of Ottawa for the proposed event center only. (Completed)
-Include the boundary condition request correspondence email in the appendix of the servicing report.
-Remove all language in the site servicing report that states that the design is considering all three phases of the proposed Lansdowne design as it pertains to drinking water servicing.
-Provide the domestic demand calculations of the existing event center and provide the domestic demand calculations of proposed the event center.
-Provide the required fire flow calculations of the existing event center and the required fire flow calculations of the proposed event center.
-Provide discussion in the site servicing report explaining the rational discussed in the meeting detailing how the demands of the proposed event center can be met with the existing watermain network. In addition the report should justify that the proposed development will not negatively impact the existing hydraulic condition. This rational is required as a basis for the City to make an exception for this site to accept a hydraulic analysis using the spreadsheet approach.
-Provide a hydraulic watermain analysis that incorporates the hydraulic losses in the system from the boundary condition connection locations to the proposed event center. The hydraulic watermain analysis is required to include the existing demands from the existing buildings, please contact water metering division to obtain the existing domestic water demand data (alice.zhang@ottawa.ca).
-Provide results of the spread sheet analysis demonstrating that the private system meets the criteria of section 4.2.2 of the Ottawa Design Guidelines – Water Distribution for the proposed event centers demands. This includes data that shows that the expected demands under average day, peak hour and fire flow conditions provide water within the required pressure ranges.

Requirements for future phases:
-All subsequent phases will require updated boundary conditions, and an updated hydraulic watermain analysis.
-Phase 3 Lansdowne project (towers and podium) will be required to demonstrate, via a hydraulic watermain analysis that the private system meets the criteria of section 4.2.2 of the Ottawa Design Guidelines – Water Distribution. The hydraulic watermain analysis will be required to analyze the entire private system and include the existing site demands and the proposed demands for the project.

If you have any questions or wish to arrange a meeting to discuss further, please let us know.

Kind regards,

Amy Whelan, E.I.T
Project Manager, Infrastructure Approvals
Development Review, Central | Examen des projets d'aménagement, Central
Planning, Development and Building Services Department (PDBS) | Direction générale des services de la planification, de l'aménagement et du bâtiment (DGSPAB)
City of Ottawa | Ville d'Ottawa
110 Laurier Avenue West Ottawa, ON | 110, avenue. Laurier Ouest. Ottawa (Ontario) K1P 1J1
613.580.2424 ext./poste 26642, amy.whelan@ottawa.ca

From: Moore, Sean <Sean.Moore@ottawa.ca>
Sent: September 06, 2024 11:59 AM
To: Whelan, Amy <amy.whelan@ottawa.ca>
Cc: Mottalib, Abdul <Abdul.Mottalib@ottawa.ca>
Subject: RE: Lansdowne Park - CODE REPORT to interconnection

Thank you for the update Amy.

Sean.

From: Whelan, Amy <amy.whelan@ottawa.ca>
Sent: September 06, 2024 11:27 AM
To: Moore, Sean <Sean.Moore@ottawa.ca>
Cc: Mottalib, Abdul <Abdul.Mottalib@ottawa.ca>
Subject: RE: Lansdowne Park - CODE REPORT to interconnection

Good morning Sean,

I am just following up to inform you that we are currently awaiting the boundary condition results from the updated request that Winston had sent yesterday. We would like to review the results of the boundary conditions internally and get back to you regarding the hydraulic watermain analysis requirement. As per the meeting we believe that we should be receiving the boundary condition results by Monday or Tuesday next week.

Kind regards,

Amy Whelan, E.I.T
Project Manager, Infrastructure Approvals
Development Review, Central | Examen des projets d'aménagement, Central
Planning, Development and Building Services Department (PDBS) | Direction générale des services de la planification, de l'aménagement et du bâtiment (DGSPAB)
City of Ottawa | Ville d'Ottawa
110 Laurier Avenue West Ottawa, ON | 110, avenue. Laurier Ouest. Ottawa (Ontario) K1P 1J1
613.580.2424 ext./poste 26642, amy.whelan@ottawa.ca

From: Yang, Winston <Winston.Yang@wsp.com>
Sent: September 05, 2024 5:41 PM
To: Moore, Sean <Sean.Moore@ottawa.ca>; Mottalib, Abdul <Abdul.Mottalib@ottawa.ca>
Cc: Whelan, Amy <amy.whelan@ottawa.ca>
Subject: Re: Lansdowne Park - CODE REPORT to interconnection
Importance: High

CAUTION: This email originated from an External Sender. Please do not click links or open attachments unless you recognize the source.

ATTENTION : Ce courriel provient d'un expéditeur externe. Ne cliquez sur aucun lien et n'ouvrez pas de pièce jointe, excepté si vous connaissez l'expéditeur.

Hi Sean and Abdul,

Attached is the code report prepared specifically for OSEG by Morrison Hershfield dated May 17, 2012 for the Lansdowne site and this information should be used on future developments on site.
.
The approach used at Lansdowne is unique and took some detailed conversations with the Authority having jurisdiction to come to an agreeable arrangement.

As you are aware that most of the existing watermain network is within the building garage, they are part of the building mechanical system, all these network are also inter-connected within the building plumping system and designed using the O.B.C requirement.
The typical hydraulic water model that City uses to work on is not applicable for this site.

The existing water network was designed and completed by few different consultants, Civil and Building Mechanical, etc., we are not able to put up a unique model that it's suitable for this site.

And as I have mentioned during the meeting, the worse case scenario is the max daily demand + fire flow within the development site shall be governed.
This is typical for all subdivision or site plan developments that we have to make sure there will be adequate demand available from each junction through the hydraulic analysis to meet the targeting max daily and fire.
As per previous approved design, fire flow of 150 l/s has been used for all the buildings within Lansdowne site.
For the current redevelopment phase 1 EC and phase 2 NNS, the max daily demand are almost the same, the fire flow is way less than 150 L/s. This is better off from the existing condition.
If the existing network is working, issues for phase 1 and 2 should not be anticipated.

For future residential development (the two towers), hydraulic analysis is also not required because tower 1 and 2 will be part of the existing building, it should be treated as a single building as per the attached Code report since the underground parking is attached.
The two towers will be serviced internally from the existing garage system.

Further analysis should be provided by the Architect and Mechanical consultant to verify the pressure for daily demand and fire protection during the design of the residential towers.

I am agree that we can obtain an updated boundary condition for city's record, but hydraulic analysis for the entire Lansdowne site is not necessary.
Simple hydraulic check on water pressure using the new boundary condition should be enough to verify the maximum and minimum pressures for phase 1 and 2.
And the hydrant flow test result can be used to confirm the adequate flow within the system down to 140 Kpa (20 psi) to meet the targeting the max daily + fire flow.

Feel free to reach out if you would like to discuss.

Yours truly,

Winston Yang
Lead Engineer – Technical Lead
Land Development & Municipal Engineering, Ontario
P.Eng., PMP.

T+ 1 613-829-2800
T+ 1 613-690-0538 (Direct)
M+ 1 647-628-8108

WSP Canada Inc.
2611 Queensview Drive, Suite 300

Ottawa, Ontario,
K2B 8K2 Canada

wsp.com

NOTICE: This communication and any attachments ("this message") may contain information which is privileged, confidential, proprietary or otherwise subject to restricted disclosure under applicable law. This message is for the sole use of the intended recipient(s). Any unauthorized use, disclosure, viewing, copying, alteration, dissemination or distribution of, or reliance on, this message is strictly prohibited. If you have received this message in error, or you are not an authorized or intended recipient, please notify the sender immediately by replying to this message, delete this message and all copies from your e-mail system and destroy any printed copies. You are receiving this communication because you are listed as a current WSP contact. Should you have any questions regarding WSP's electronic communications policy, please consult our Anti-Spam Commitment at www.wsp.com/casl. For any concern or if you believe you should not be receiving this message, please forward this message to caslcompliance@wsp.com so that we can promptly address your request. Note that not all messages sent by WSP qualify as commercial electronic messages.

AVIS : Ce message, incluant tout fichier l'accompagnant (« le message »), peut contenir des renseignements ou de l'information privilégiés, confidentiels, propriétaires ou à divulgation restreinte en vertu de la loi. Ce message est destiné à l'usage exclusif du/des destinataire(s) voulu(s). Toute utilisation non permise, divulgation, lecture, reproduction, modification, diffusion ou distribution est interdite. Si vous avez reçu ce message par erreur, ou que vous n'êtes pas un destinataire autorisé ou voulu, veuillez en aviser l'expéditeur immédiatement et détruire le message et toute copie électronique ou imprimée. Vous recevez cette communication car vous faites partie des contacts de WSP. Si vous avez des questions concernant la politique de communications électroniques de WSP, veuillez consulter notre Engagement anti-pourriel au www.wsp.com/lcap. Pour toute question ou si vous croyez que vous ne devriez pas recevoir ce message, prière de le transférer au conformitelcap@wsp.com afin que nous puissions rapidement traiter votre demande. Notez que ce ne sont pas tous les messages transmis par WSP qui constituent des messages électroniques commerciaux.

-LAEmHhHzdJzBlTWfa4Hgs7pbKl

'

This e-mail originates from the City of Ottawa e-mail system. Any distribution, use or copying of this e-mail or the information it contains by other than the intended recipient(s) is unauthorized. Thank you.

Le présent courriel a été expédié par le système de courriels de la Ville d'Ottawa. Toute distribution, utilisation ou reproduction du courriel ou des renseignements qui s'y trouvent par une personne autre que son destinataire prévu est interdite. Je vous remercie de votre collaboration.

'

From: McKinnon, John <jmckinnon@tmptoronto.com>
Sent: December 17, 2024 9:50 AM
To: Ali, Zarak
Cc: Talundzic, Tarik; Yang, Winston
Subject: RE: Lansdowne Civil - coordination mtg

Hi Ali,

Apologies for the delay.
The fire protection system will be a fully supervised system.

Regards,

John McKinnon B.Eng.
Mechanical Designer
C: 647-454-1806
tmptoronto.com

From: Ali, Zarak <Zarak.Ali@wsp.com>
Sent: Tuesday, December 17, 2024 9:46 AM
To: McKinnon, John <jmckinnon@tmptoronto.com>
Cc: Talundzic, Tarik <ttalundzic@tmptoronto.com>; Yang, Winston <Winston.Yang@wsp.com>
Subject: RE: Lansdowne Civil - coordination mtg

Hi John,

I am following up on my inquiry below.

Regards,

Zarak Ali
Designer E.I.T
Land Development & Municipal Engineering - Ontario

T+ 1 343-227-9179
Zarak.ali@wsp.com

WSP Canada Inc.
2611 Queensview Drive, Suite 300
Ottawa, Ontario
K2B 8K2 Canada

wsp.com

From: Ali, Zarak
Sent: December 11, 2024 1:31 PM
To: McKinnon, John <jmckinnon@tmptoronto.com>
Cc: Talundzic, Tarik <ttalundzic@tmptoronto.com>; Yang, Winston <Winston.Yang@wsp.com>
Subject: RE: Lansdowne Civil - coordination mtg

Hi John/Tarik,

Can you provide confirmation that the new Event Centre will be a Fully Supervised System as per the 2020 Fire Underwriter's Survey. A fully supervised system requires a proper supervision system including water flow and control valve alarm service. The City would like us to provide confirmation from mechanical consultant that the water service system for this building will have this arrangement.

Regards,

Zarak Ali
Designer E.I.T
Land Development & Municipal Engineering - Ontario

T+ 1 343-227-9179
Zarak.ali@wsp.com

WSP Canada Inc.
2611 Queensview Drive, Suite 300
Ottawa, Ontario
K2B 8K2 Canada

wsp.com

From: McKinnon, John <jmckinnon@tmptoronto.com>
Sent: December 10, 2024 5:13 PM
To: Yang, Winston <Winston.Yang@wsp.com>
Cc: Talundzic, Tarik <ttalundzic@tmptoronto.com>; Ali, Zarak <Zarak.Ali@wsp.com>
Subject: RE: Lansdowne Civil - coordination mtg

Hi Winston,

EC Domestic water demand: 480 GPM
NNS Domestic water demand: 210 gpm

As we work through finalizing our connections for the EC, I am hoping to have an updated coordination pdf to you later this week.

Regards,

John McKinnon B.Eng.
Mechanical Designer
C: 647-454-1806
tmptoronto.com

From: Yang, Winston <Winston.Yang@wsp.com>
Sent: Thursday, November 28, 2024 3:36 PM
To: McKinnon, John <jmckinnon@tmptoronto.com>
Cc: Talundzic, Tarik <ttalundzic@tmptoronto.com>; Ali, Zarak <Zarak.Ali@wsp.com>
Subject: RE: Lansdowne Civil - coordination mtg

Hi John,

Please see attached CAD file for the 90% DD package and the pdf we have discussed on Tuesday.

By the way, we are looking for the domestic water demand for the New Event Centre and North Side Stand.
Do you have these finalized?

Yours truly,

Winston Yang
Lead Engineer – Technical Lead
Land Development & Municipal Engineering, Ontario
P.Eng., PMP.

T+ 1 613-829-2800
T+ 1 613-690-0538 (Direct)
M+ 1 647-628-8108

WSP Canada Inc.
2611 Queensview Drive, Suite 300
Ottawa, Ontario,
K2B 8K2 Canada

wsp.com

From: McKinnon, John <jmckinnon@tmptoronto.com>
Sent: November 27, 2024 5:35 PM

To: Yang, Winston <Winston.Yang@wsp.com>
Cc: Talundzic, Tarik <ttalundzic@tmptoronto.com>
Subject: RE: Lansdowne Civil - coordination mtg

Evening Winston,

I am hoping you can share your 90% DD package as we do not seem to have this on file.

Further to our discussion, please see attached plan for our EC storm, sanitary, and DCW connections.
For the fire protection line, we are currently determining whether we are feeding both EC & NNS from one fire service, or if we will provide a dedicated FSP line to NNS.

We are also working through the foundation drainage and hope to have the connection and detailed info to you by end of week, if not first thing next week.

Regards,

John McKinnon B.Eng.
Mechanical Designer
C: 647-454-1806
tmptoronto.com

My moustache is in need of your support! Please donate to my #Movember efforts and help me change the face of men's health.
Click the link here to donate!

From: Yang, Winston <Winston.Yang@wsp.com>
Sent: Friday, November 22, 2024 10:47 AM
To: Sylvia Jacobs <sjacobs@bbb.ca>; Sheri Edwards <edwards@csw.ca>; Jerrold Corush <corush@csw.ca>; Nick Manesis <nmanesis@mbii.com>; Liam Green <lgreen@mbii.com>; Talundzic, Tarik <ttalundzic@tmptoronto.com>; Barry Charnish <barry.charnish@entuitive.com>; David Stevenson <david.stevenson@entuitive.com>; Jason Dello <jdello@bbb.ca>; Valeriia Vapelnyk <vvapelnyk@bbb.ca>; El-Haddad, Haitham <haitham.el-haddad@ottawa.ca>
Cc: Christian Matteau <Matteau@csw.ca>; Orchard, Steve <sorchard@tmptoronto.com>; McKinnon, John <jmckinnon@tmptoronto.com>; Murray Beynon <murray@bbb.ca>; Scott, Ryan (ISD) <Ryan.Scott2@ottawa.ca>; Kurosky, Justin <justin.kurosky@ottawa.ca>
Subject: RE: Lansdowne Civil - coordination mtg

Hi Sylvia,

I am available Monday 1-4pm and Tuesday 1-2pm.

Yours truly,

Winston Yang
Lead Engineer – Technical Lead

Land Development & Municipal Engineering, Ontario
P.Eng., PMP.

T+ 1 613-829-2800
T+ 1 613-690-0538 (Direct)
M+ 1 647-628-8108

WSP Canada Inc.
2611 Queensview Drive, Suite 300
Ottawa, Ontario,
K2B 8K2 Canada

wsp.com

From: Sylvia Jacobs <sjacobs@bbb.ca>
Sent: November 22, 2024 10:45 AM
To: Yang, Winston <Winston.Yang@wsp.com>; Sheri Edwards <edwards@csw.ca>; Jerrold Corush <corush@csw.ca>; Nick Manesis <nmanesis@mbii.com>; Liam Green <lgreen@mbii.com>; Talundzic, Tarik <ttalundzic@tmptoronto.com>; Barry Charnish <barry.charnish@entuitive.com>; David Stevenson <david.stevenson@entuitive.com>; Jason Dello <jdello@bbb.ca>; Valeriia Vapelnyk <vvapelnyk@bbb.ca>; El-Haddad, Haitham <haitham.el-haddad@ottawa.ca>
Cc: Christian Matteau <Matteau@csw.ca>; Steve Orchard <sorchard@tmptoronto.com>; McKinnon, John <jmckinnon@tmptoronto.com>; Murray Beynon <murray@bbb.ca>; Scott, Ryan (ISD) <Ryan.Scott2@ottawa.ca>; Kurosky, Justin <justin.kurosky@ottawa.ca>
Subject: Lansdowne Civil - coordination mtg

Hi Winston,

Now that you have been retained by the City for new duct bank scope we would like to set up a coordination mtg for this and few other civil items to be captured in the civil package.

Can everyone pls confirm their availability for a mtg next:
Monday Nov 25 between 1-4
Tuesday Nov 26 between 1-4

Regards,
Sylvia

NOTICE: This communication and any attachments ("this message") may contain information which is privileged, confidential, proprietary or otherwise subject to restricted disclosure under applicable law. This message is for the sole use of the intended recipient(s). Any unauthorized use, disclosure, viewing, copying, alteration, dissemination or distribution of, or reliance on, this message is strictly prohibited. If you have received this message in error, or you are not an authorized or intended recipient, please notify the sender immediately by replying to this message, delete this message and all copies from your e-mail system and destroy any printed copies. You are receiving this communication because you are listed as a current WSP contact. Should you have any questions regarding WSP's electronic communications policy, please consult our Anti-Spam Commitment at www.wsp.com/casl. For any concern or if you believe you should not be receiving this message, please forward this message to caslcompliance@wsp.com so that we can promptly address your request. Note

that not all messages sent by WSP qualify as commercial electronic messages.

AVIS : Ce message, incluant tout fichier l'accompagnant (« le message »), peut contenir des renseignements ou de l'information privilégiés, confidentiels, propriétaires ou à divulgation restreinte en vertu de la loi. Ce message est destiné à l'usage exclusif du/des destinataire(s) voulu(s). Toute utilisation non permise, divulgation, lecture, reproduction, modification, diffusion ou distribution est interdite. Si vous avez reçu ce message par erreur, ou que vous n'êtes pas un destinataire autorisé ou voulu, veuillez en aviser l'expéditeur immédiatement et détruire le message et toute copie électronique ou imprimée. Vous recevez cette communication car vous faites partie des contacts de WSP. Si vous avez des questions concernant la politique de communications électroniques de WSP, veuillez consulter notre Engagement anti-pourriel au www.wsp.com/lcap. Pour toute question ou si vous croyez que vous ne devriez pas recevoir ce message, prière de le transférer au conformitelcap@wsp.com afin que nous puissions rapidement traiter votre demande. Notez que ce ne sont pas tous les messages transmis par WSP qui constituent des messages electroniques commerciaux.

-LAEmHhHzdJzBlTWfa4Hgs7pbKI

Carma Metering Report - MM0781 - Lansdowne Stadium - Water - 2023

Less than 20% of previous month | **More than 20% of previous month**

<-- 1st to 1st (Jun.14 city bill) | (Jun.14 city bill) 9th to 9th-->

Tenant Name	Tenant Number	CARMA Plus Meter Number	Service Description [Real Meter]	Percentage (%)	January			February			March			April			May			June			July			August	
					End Read Date: Feb.1		Rate $/unit	End Read Date: Mar.1		Rate $/unit	End Read Date: Apr.1		Rate $/unit	End Read Date: May.1		Rate $/unit	End Read Date: May.9		Rate $/unit	End Read Date: Jun.9		Rate $/unit	End Read Date: Jul.9		Rate $/unit	End Read Date: Aug.8		Rate $/unit	End Read Date: Sep.7	
					Units = Litres		$0.0040	Units = Litres		$0.0040	Units = Litres		$0.0059	Units = Litres		$0.0059	Units = Litres		$0.0059	Units = Litres		$0.0059	Units = Litres		$0.0056	Units = Litres		$0.0055	Units = Litres	
					Reading	Consumption	Cost	Reading	Consumption	Cost	Reading	Consumption	Cost	Reading	Consumption	Cost	Reading	Consumption	Cost	Reading	Consumption	Cost	Reading	Consumption	Cost	Reading	Consumption	Cost	Reading	Consumption
City-Ottawa-Aberdeen	City-Aber	No Reader	[No Meter] 1" Mdl-70-Badger in Aberdeen SE Fire R	100			$0.00			$0.00	33,835,600		$0.00	33,946,800	111,200	$660.92	34,005,400	58,600	$348.29	34,120,700	115,300	$675.68	34,340,000	219,300	$1,238.27	34,423,400	83,400	$460.72	34,549,500	126,100
		Total			0	0	$0.00	0	0	$0.00	33,835,600	0	$0.00	33,946,800	111,200	$660.92	34,005,400	58,600	$348.29	34,120,700	115,300	$675.68	34,340,000	219,300	$1,238.27	34,423,400	83,400	$460.72	34,549,500	126,100
City-Ottawa-Horticulture	City-Hort	E249M01	[E249M01] 1.5in T-10 (2.5in pipe) in Horticulture 1	100	10,659,900	66,900	$267.60	10,742,100	82,200	$328.80	10,824,000	81,900	$483.21	10,981,500	157,500	$936.10	11,021,000	156,100	$927.78	11,175,200	154,200	$903.65	11,325,900	150,700	$850.92	11,455,500	129,600	$715.94	11,583,100	129,300
		Total			10,659,900	66,900	$267.60	10,742,100	82,200	$328.80	10,824,000	81,900	$483.21	10,981,500	157,500	$936.10	11,021,000	156,100	$927.78	11,175,200	154,200	$903.65	11,325,900	150,700	$850.92	11,455,500	129,600	$715.94	11,583,100	129,300
City-Ottawa-Plaza	City-Plaza	E249M02	[E249M02] 3in HPT (3in pipe) in Garage Room P161	100	2,262,300	0	$0.00	2,262,300	0	$0.00	2,262,300	0	$0.00	2,262,300	0	$0.00	2,265,900	3,600	$21.40	2,289,900	24,000	$140.65	2,312,200	22,300	$125.92	2,329,200	17,000	$93.91	2,343,100	14,000
		Total			2,262,300	0	$0.00	2,262,300	0	$0.00	2,262,300	0	$0.00	2,262,300	0	$0.00	2,265,900	3,600	$21.40	2,289,900	24,000	$140.65	2,312,200	22,300	$125.92	2,329,200	17,000	$93.91	2,343,100	14,000
City-Ottawa-Serv-Bunk-Ice-Rink	City-Serv-Bunk	No Reader	[No Meter] 2in T-10 (4in pipe) in Urban Park East C	100			$0.00			$0.00			$0.00	75,853,408		$0.00	77,173,615	1,320,207	$7,846.68	79,047,974	1,874,359	$10,984.18	80,958,065	1,910,091	$10,785.26	83,962,772	3,004,707	$16,598.78	87,270,548	3,307,776
		Total			0	0	$0.00	0	0	$0.00	0	0	$0.00	75,853,408	0	$0.00	77,173,615	1,320,207	$7,846.68	79,047,974	1,874,359	$10,984.18	80,958,065	1,910,091	$10,785.26	83,962,772	3,004,707	$16,598.78	87,270,548	3,307,776
I-Office BTB_REIT	Office-I	E921M00	[E252M02] 2in T-10 (4in pipe) in Garage Bldg I Fire	100	51,341,910	461,480	$1,845.92	51,787,900	445,990	$1,783.96	53,956,930	2,169,030	$12,797.28	55,381,630	1,424,700	$8,467.74	55,960,640	1,260,820	$7,493.71	58,202,170	2,241,530	$13,135.89	59,076,210	874,040	$4,935.23	59,905,600	829,390	$4,581.76	60,579,730	696,170
		Total			51,341,910	461,480	$1,845.92	51,787,900	445,990	$1,783.96	53,956,930	2,169,030	$12,797.28	55,381,630	1,424,700	$8,467.74	55,960,640	1,260,820	$7,493.71	58,202,170	2,241,530	$13,135.89	59,076,210	874,040	$4,935.23	59,905,600	829,390	$4,581.76	60,579,730	696,170
A-Condo Vibe OCSCC 967	Res-A-Condo	E910M00	[E218M08] 2in T-10 (4in pipe) in Garage Bldg A Fire	100	36,090,100	376,800	$1,507.20	36,416,700	326,600	$1,306.40	36,771,500	354,800	$2,093.32	37,087,100	315,600	$1,875.78	37,190,800	319,700	$1,900.14	37,650,600	459,800	$2,694.53	38,103,600	453,000	$2,557.85	38,560,800	457,200	$2,525.69	39,018,500	470,900
		Total			36,090,100	376,800	$1,507.20	36,416,700	326,600	$1,306.40	36,771,500	354,800	$2,093.32	37,087,100	315,600	$1,875.78	37,190,800	319,700	$1,900.14	37,650,600	459,800	$2,694.53	38,103,600	453,000	$2,557.85	38,560,800	457,200	$2,525.69	39,018,500	470,900
K-Condo Rideau OCSCC 1003	Res-K-Condo (needs replacement)	E919M00	[E213M06] Hi-Flo and [E213M07] Low-Flo 3in Nep	100	57,869,960	90,085	$360.34	57,943,660	73,700	$294.80	58,032,960	89,300	$526.87	58,133,160	100,200	$595.54	58,163,460	103,500	$615.15	Roll-up submete	929,927	$5,449.59	Roll-up submete	849,910	$4,798.98	Roll-up submete	890,594	$4,919.87	Roll-up submete	931,432
		Total			57,869,960	90,085	$360.34	57,943,660	73,700	$294.80	58,032,960	89,300	$526.87	58,133,160	100,200	$595.54	58,163,460	103,500	$615.15	Roll-up submete	929,927	$5,449.59	Roll-up submete	849,910	$4,798.98	Roll-up submete	890,594	$4,919.87	Roll-up submete	931,432
NorthTH-Condo OCSCC 1010	Res-NTH-Condo	E909M00	[TH-Total] Virtual Meter Total of Townhomes	100	24,998,220	359,130	$1,436.52	25,335,900	337,680	$1,350.72	25,704,300	368,400	$2,173.56	26,091,430	387,130	$2,300.92	26,203,510	381,140	$2,265.31	26,589,300	385,790	$2,260.82	26,954,210	364,910	$2,060.45	27,294,510	340,300	$1,879.90	27,625,950	342,860
		Total			24,998,220	359,130	$1,436.52	25,335,900	337,680	$1,350.72	25,704,300	368,400	$2,173.56	26,091,430	387,130	$2,300.92	26,203,510	381,140	$2,265.31	26,589,300	385,790	$2,260.82	26,954,210	364,910	$2,060.45	27,294,510	340,300	$1,879.90	27,625,950	342,860
A-Retail Trinity	Ret-A-Retail (needs electrician)	E911M00	[E160M05] 1.5in T-10 (4in pipe) in 1st Fl Fire Room	100	4,782,424	60,430	$241.72	4,837,006	54,582	$218.33	4,897,436	60,430	$356.53	4,955,916	58,480	$347.58	4,973,460	58,480	$347.58	5,023,529	50,069	$293.42	5,062,584	39,055	$220.52	Estimate	50,069	$276.60	5,117,062	25,154
		Total			4,782,424	60,430	$241.72	4,837,006	54,582	$218.33	4,897,436	60,430	$356.53	4,955,916	58,480	$347.58	4,973,460	58,480	$347.58	5,023,529	50,069	$293.42	5,062,584	39,055	$220.52	Estimate	50,069	$276.60	5,117,062	25,154
B-Retail Trinity	Ret-B-Retail	E912M00	[E162M05] 1.5in T-10 (4in pipe) in 1st Fl Fire Room	100	60,659,200	53,700	$214.80	60,721,400	62,200	$248.80	60,775,200	53,800	$317.42	61,063,100	287,900	$1,711.14	61,172,000	374,400	$2,225.25	62,010,500	838,500	$4,913.80	63,302,300	1,291,800	$7,294.10	64,639,300	1,337,000	$7,385.93	65,852,300	1,213,000
		Total			60,659,200	53,700	$214.80	60,721,400	62,200	$248.80	60,775,200	53,800	$317.42	61,063,100	287,900	$1,711.14	61,172,000	374,400	$2,225.25	62,010,500	838,500	$4,913.80	63,302,300	1,291,800	$7,294.10	64,639,300	1,337,000	$7,385.93	65,852,300	1,213,000
C-Retail Trinity	Ret-C-Retail	E913M00	[E137M04] 2in T-10 (4in pipe) in 1st Fl Fire Room	100	67,706,100	764,300	$3,057.20	68,366,200	660,100	$2,640.40	69,061,200	695,000	$4,100.50	70,062,800	1,001,600	$5,953.03	70,326,700	978,300	$5,814.55	71,206,200	879,500	$5,154.07	72,012,300	806,100	$4,551.61	72,942,700	930,400	$5,139.77	73,804,400	861,700
		Total			67,706,100	764,300	$3,057.20	68,366,200	660,100	$2,640.40	69,061,200	695,000	$4,100.50	70,062,800	1,001,600	$5,953.03	70,326,700	978,300	$5,814.55	71,206,200	879,500	$5,154.07	72,012,300	806,100	$4,551.61	72,942,700	930,400	$5,139.77	73,804,400	861,700
D-Retail Trinity	Ret-D-Retail	E914M00	[E156M05] 1.5in T-10 (4in pipe) in 1st Fl Fire Room	100	30,698,800	493,100	$1,972.40	31,152,100	453,300	$1,813.20	31,653,900	501,800	$2,960.62	32,216,500	562,600	$3,343.83	32,366,400	536,900	$3,191.08	32,893,800	527,400	$3,090.69	33,436,400	542,600	$3,063.77	33,918,200	481,800	$2,661.59	34,388,300	470,100
		Total			30,698,800	493,100	$1,972.40	31,152,100	453,300	$1,813.20	31,653,900	501,800	$2,960.62	32,216,500	562,600	$3,343.83	32,366,400	536,900	$3,191.08	32,893,800	527,400	$3,090.69	33,436,400	542,600	$3,063.77	33,918,200	481,800	$2,661.59	34,388,300	470,100
G-Retail Trinity	Ret-G-Retail	E915M00	[E139M08] 2in T-10 (4in pipe) in 1st Fl Fire Room	100	108,047,900	1,134,000	$4,536.00	109,111,300	1,063,400	$4,253.60	110,316,900	1,205,600	$7,113.04	111,731,700	1,414,800	$8,408.90	112,149,500	1,414,300	$8,405.92	113,564,100	1,414,600	$8,289.88	114,306,166	742,066	$4,190.05	115,632,200	1,202,356	$6,642.12	116,969,600	1,337,400
		E915M01	[E144M02] 1in Mdl-70-Badger (2in pipe) in Bldg G	-100	13,066,590	0	$0.00	13,066,590	0	$0.00	13,066,590	0	$0.00	13,089,650	-23,060	-$137.06	13,110,930	-44,340	-$263.54	13,280,590	-169,660	-$994.25	13,441,040	-160,450	-$905.97	13,589,350	-148,310	-$819.30	13,736,410	-147,060
		Total			121,114,490	1,134,000	$4,536.00	122,177,890	1,063,400	$4,253.60	123,383,490	1,205,600	$7,113.04	124,821,350	1,391,740	$8,271.84	125,260,430	1,369,960	$8,142.39	126,844,690	1,244,940	$7,295.64	127,747,206	581,616	$3,284.07	102,042,850	1,054,046	$6,148.80	1,190,340	
H-Retail Trinity	Ret-H-Retail	E916M00	[E155M02] 1st-Flr_Tenants 1.5in T-10 and [E154M0	100	88,316,100	1,270,300	$5,081.20	89,426,200	1,110,100	$4,440.40	90,682,800	1,256,600	$7,413.94	91,862,000	1,179,200	$7,008.60	92,218,400	1,162,100	$6,906.97	93,726,900	1,508,500	$8,840.16	95,768,300	2,041,400	$11,526.69	97,749,200	1,980,900	$10,943.00	98,995,400	1,246,200
		Total			88,316,100	1,270,300	$5,081.20	89,426,200	1,110,100	$4,440.40	90,682,800	1,256,600	$7,413.94	91,862,000	1,179,200	$7,008.60	92,218,400	1,162,100	$6,906.97	93,726,900	1,508,500	$8,840.16	95,768,300	2,041,400	$11,526.69	97,749,200	1,980,900	$10,943.00	98,995,400	1,246,200
J-Retail Trinity	Ret-J-Retail	E917M00	[E133M05] 2in GWF (2in pipe) in Arena Service Lev	100	62,435,770	724,930	$2,899.72	63,003,860	568,090	$2,272.36	63,647,950	644,090	$3,800.13	64,258,810	610,860	$3,630.66	64,448,130	613,850	$3,648.43	65,119,700	671,570	$3,935.56	65,775,610	655,910	$3,703.57	66,239,990	464,380	$2,565.35	66,805,040	565,050
		Total			62,435,770	724,930	$2,899.72	63,003,860	568,090	$2,272.36	63,647,950	644,090	$3,800.13	64,258,810	610,860	$3,630.66	64,448,130	613,850	$3,648.43	65,119,700	671,570	$3,935.56	65,775,610	655,910	$3,703.57	66,239,990	464,380	$2,565.35	66,805,040	565,050
Stadium OSEG Stadium	Stad-OSEG	No Reader	[No Meter] North Stad 4in HPT (4in pipe) in North	100	1,116,161,000		$0.00	1,118,931,000	2,770,000	$11,080.00	1,125,337,000	6,406,000	$37,795.40	1,129,092,000	3,755,000	$22,317.93	1,131,432,000	2,340,000	$13,907.84	1,134,320,000	2,888,000	$16,924.35	1,138,119,000	3,799,000	$21,450.91	1,141,057,000	2,938,000	$16,230.27	1,146,263,000	5,206,000
		No Reader	[No Meter] South Stad 2in T-10 (4in pipe) in Urban	100	68,059,000		$0.00	68,096,000	37,000	$148.00	68,209,000	113,000	$666.70	68,436,000	227,000	$1,349.18	68,924,000	488,000	$2,900.44	69,778,000	854,000	$5,004.64	71,113,000	1,335,000	$7,538.03	72,439,000	1,326,000	$7,325.17	73,729,000	1,290,000
		E917M00	[E133M05] 2in GWF (2in pipe) in Arena Service Lev	-100			$0.00	63,003,860	-568,090	-$2,272.36	63,647,950	-644,090	-$3,800.13	64,258,810	-610,860	-$3,630.66	64,448,130	-613,850	-$3,648.43	65,119,700	-671,570	-$3,935.56	65,775,610	-655,910	-$3,703.57	66,239,990	-464,380	-$2,565.35	66,805,040	-565,050
		Total			1,184,220,000	0	$0.00	.	2,238,910	$8,955.64	.	5,874,910	$34,661.97	.	3,371,140	$20,036.45	.	2,214,150	$13,159.85	.	3,070,430	$17,993.43	.	4,478,090	$25,285.36	.	3,799,620	$20,990.08	.	5,930,950	
Stadium Public Realm	Stad-PubRealm	E915M01	[E144M02] 1in Mdl-70-Badger (2in pipe) in Bldg G	100	13,066,590	0	$0.00	13,066,590	0	$0.00	13,066,590	0	$0.00	13,089,650	23,060	$137.06	13,110,930	44,340	$263.54	13,280,590	169,660	$994.25	13,441,040	160,450	$905.97	13,589,350	148,310	$819.30	13,736,410	147,060
		E922M00	[E252M06] 1in Dwyer (1.5in pipe) in Garage Bldg I	100	7,846,007	0	$0.00	7,846,007	0	$0.00	7,846,007	0	$0.00	7,855,028	9,022	$53.62	7,870,822	24,815	$147.49	7,927,056	56,235	$329.55	7,983,307	56,251	$317.62	8,041,859	58,552	$323.46	8,098,836	58,919
		E923M00	[E213M05] 0.75" Dwyer WMT2-A-C-03 in Garage N	100	1,786,880	0	$0.00	1,786,880	0	$0.00	1,786,880	0	$0.00	1,793,219	6,339	$37.68	1,807,938	21,058	$125.16	1,860,305	52,367	$306.88	1,910,093	49,788	$281.12	1,962,510	52,417	$289.57	2,011,183	50,353
		Total			22,699,476	0	$0.00	22,699,476	0	$0.00	22,699,476	0	$0.00	22,737,897	38,421	$228.36	22,789,689	90,213	$536.18	23,067,951	278,262	$1,630.68	23,334,439	266,488	$1,504.72	23,593,719	259,280	$1,432.33	.	256,332	
City Total			**City Total**			**66,900**	$267.60		**82,200**	$328.80		**81,900**	$483.21		**268,700**	$1,597.02		**1,538,507**	$9,144.15		**2,167,859**	$12,704.16		**2,302,391**	$13,000.36		**3,234,707**	$17,869.35		**3,577,176**	
Office Total			**Office Total**			**461,480**	$1,845.92		**445,990**	$1,783.96		**2,169,030**	$12,797.28		**1,424,700**	$8,467.74		**1,260,820**	$7,493.71		**2,241,530**	$13,135.89		**874,040**	$4,935.23		**829,390**	$4,581.76		**696,170**	
Residential Total			**Residential Total**			**826,015**	$3,304.06		**737,980**	$2,951.92		**812,500**	$4,793.75		**802,930**	$4,772.23		**804,340**	$4,780.61		**1,775,517**	$10,404.94		**1,667,820**	$9,417.28		**1,688,094**	$9,325.47		**1,745,192**	
Retail Total			**Retail Total**			**4,500,760**	$18,003.04		**3,971,772**	$15,887.09		**4,417,320**	$26,062.19		**5,092,380**	$30,266.68		**5,093,990**	$30,276.25		**5,720,479**	$33,523.34		**5,958,481**	$33,644.33		**6,298,595**	$34,795.06		**5,571,544**	
Stadium / OSEG Total			**Stadium / OSEG Total**			**0**	$0.00		**2,238,910**	$8,955.64		**5,874,910**	$34,661.97		**3,409,561**	$20,264.80		**2,304,363**	$13,696.03		**3,348,692**	$19,624.11		**4,744,578**	$26,790.08		**4,058,900**	$22,422.41		**6,187,282**	
Metered Total					5,855,154	$23,420.62		7,476,852	$29,907.41		13,355,660	$78,788.39		10,998,271	$65,368.47		11,002,020	$55,350.76		15,254,077	$89,392.44		15,547,310	$87,707.29		16,100,585	$89,320.03		17,777,264	
City Main Utility Meter1			**City Account 1of4 (0270300 - 10077975)**			**536,809,000**			**528,249.56**		**550,235,000**	**6,755,000**		**550,235,000**	**6,671,000**	**$28,414.09**	**550,235,000**	**6,671,000**	**$28,414.09**	**557,764,000**	**7,529,000**	**$32,069.17**	**565,059,000**	**7,295,000**	**$31,072.33**	**572,554,000**	**7,495,000**	**$31,924.33**	**580,154,000**	**7,600,000**
City Main Utility Meter2			**City Account 2of4 (0270300 - 10077976)**			**121,996,000**					**124,112,000**	**2,116,000**	**$8,847.67**	**126,394,000**	**2,282,000**	**$9,716.95**	**126,394,000**	**2,282,000**	**$9,716.95**	**128,587,000**	**2,193,000**	**$9,337.81**	**130,766,000**	**2,179,000**	**$9,278.17**	**132,934,000**	**2,168,000**	**$9,231.31**	**135,098,000**	**2,164,000**
City Main Utility Meter3			**City Account 3of4 (0270300 - 10077977)**			**92,829,000**					**93,425,000**	**596,000**	**$19,693.78**	**94,117,000**	**692,000**	**$21,390.57**	**94,117,000**	**692,000**	**$21,390.57**	**95,866,000**	**1,749,000**	**$32,069.17**	**97,338,000**	**1,472,000**	**$24,713.37**	**98,925,000**	**1,587,000**	**$25,203.27**	**100,474,000**	**1,549,000**
City Main Utility Meter4			**City Account 4of4 (0270300 - 10077978)**			**missing bill**					**286,175,000**	**missing bill**	**missing bill**	**290,772,000**	**4,597,000**	**$25,126.04**	**290,772,000**	**4,597,000**	**$25,126.04**	**296,471,000**	**5,699,000**	**$27,144.04**	**300,888,000**	**4,417,000**	**$21,682.72**	**306,486,000**	**5,598,000**	**$26,713.78**	**312,434,000**	**5,948,000**
City Mains Total						0	$0.00		0	$0.00		9,467,000	$56,791.01		14,242,000	$84,647.65		14,242,000	$84,647.65		17,170,000	$100,620.19		15,363,000	$86,746.59		16,848,000	$93,072.69		17,261,000	
% Difference Submeter to Mains						**100.0%**			**100.0%**			**29.1%**			**-29.5%**			**-29.4%**			**-12.6%**			**1.2%**			**-4.6%**			**2.9%**	

Carma Metering Report - MM0781 - Lansdowne Stadium - Water - 2023

Less than 20% of previous month | **More than 20% of previous month**

Tenant Name	Tenant Number	CARMA Plus Meter Number	Service Description [Real Meter]	Percentage (%)	Rate $/unit	September		Rate $/unit	October		Rate $/unit	November		Rate $/unit	December		Rate $/unit	Total YTD	Total YTD
					$0.0055	End Read Date: Oct.7		$0.0057	End Read Date: Nov.6		$0.0063	End Read Date: Dec.6		$0.0066	End Read Date: Jan.5		$0.0065	Litres	$
					Cost	Reading	Consumption	Cost	Reading	Consumption	Cost	Reading	Consumption	Cost	Reading	Consumption	Cost	Consumption	Cost
City-Ottawa-Aberdeen	City-Aber	No Reader	[No Meter] 1" Mdl-70-Badger in Aberdeen SE Fire H	100	$692.79	34,663,900	114,400	$649.65	34,799,500	135,600	$852.84	35,003,500	**204,000**	$1,343.41	35,158,000	**154,500**	$1,010.74	1,322,400	$7,933.32
		Total			$692.79	34,663,900	114,400	$649.65	34,799,500	135,600	$852.84	35,003,500	204,000	$1,343.41	.	154,500	$1,010.74	1,322,400	$7,933.32
City-Ottawa-Horticulture	City-Hort	E249M01	[E249M01] 1.5in T-10 (2.5in pipe) in Horticulture 1	100	$710.38	11,700,200	117,100	$664.99	11,803,600	103,400	$650.32	11,889,300	85,700	$564.36	12,012,600	**123,300**	$806.63	1,537,900	$8,810.69
		Total			$710.38	.	117,100	$664.99		103,400	$650.32	.	85,700	$564.36	.	**123,300**	$806.63	1,537,900	$8,810.69
City-Ottawa-Plaza	City-Plaza	E249M02	[E249M02] 3in HPT (3in pipe) in Garage Room P16	100	$76.92	2,355,200	12,100	$68.71	2,362,700	**7,500**	$47.17	2,362,700	**0**	$0.00	2,362,700	0	$0.00	100,500	$574.67
		Total			$76.92		12,100	$68.71		**7,500**	$47.17		**0**	$0.00		0	$0.00	100,500	$574.67
City-Ottawa-Serv-Bunk-Ice-Rink	City-Serv-Bunk	No Reader	[No Meter] 2in T-10 (4in pipe) in Urban Park East C	100	$18,172.95	89,437,035	**2,166,487**	$12,303.01	90,114,773	**677,738**	$4,262.54	90,135,137	**20,364**	$134.10	90,135,137	**0**	$0.00	14,281,729	$81,087.50
		Total			$18,172.95	89,437,035	2,166,487	$12,303.01	90,114,773	677,738	$4,262.54	90,135,137	20,364	$134.10	.	0	$0.00	14,281,729	$81,087.50
I-Office BTB_REIT	Office-I	E921M00	[E252M02] 2in T-10 (4in pipe) in Garage Bldg I Fire	100	$3,824.76	61,326,900	747,170	$4,243.02	61,876,840	**549,940**	$3,458.77	62,389,060	512,220	$3,373.15	63,045,940	**656,880**	$4,297.31	12,869,360	$74,238.50
		Total			$3,824.76	.	747,170	$4,243.02	.	**549,940**	$3,458.77	.	512,220	$3,373.15	.	**656,880**	$4,297.31	12,869,360	$74,238.50
A-Condo Vibe OCSCC 967	Res-A-Condo	E910M00	[E218M08] 2in T-10 (4in pipe) in Garage Bldg A Fire	100	$2,587.13	39,414,400	395,900	$2,248.23	39,744,400	330,000	$2,075.49	40,083,300	338,900	$2,231.78	40,407,200	323,900	$2,118.95	4,923,100	$27,722.49
		Total			$2,587.13	.	395,900	$2,248.23	.	330,000	$2,075.49	.	338,900	$2,231.78	.	323,900	$2,118.95	4,923,100	$27,722.49
K-Condo Rideau OCSCC 1003	Res-K-Condo (needs replacement)	E919M00	[E213M06] Hi-Flo and [E213M07] Low-Flo 3in Nep	100	$5,117.29	Roll-up submete	887,086	$5,037.57	Roll-up submete	870,583	$5,475.41	Roll-up submete	803,710	$5,292.71	Roll-up submete	840,330	$5,497.44	7,460,357	$43,981.58
		Total			$5,117.29	Roll-up submete	887,086	$5,037.57	Roll-up submete	870,583	$5,475.41	Roll-up submete	803,710	$5,292.71	Roll-up submete	840,330	$5,497.44	7,460,357	$43,981.58
NorthTH-Condo OCSCC 1010	Res-NTH-Condo	E909M00	[TH-Total] Virtual Meter Total of Townhomes	100	$1,883.68	27,995,380	369,430	$2,097.91	28,353,920	358,540	$2,254.99	28,716,020	362,100	$2,384.56	29,090,990	374,970	$2,453.05	4,732,380	$26,802.39
		Total			$1,883.68	.	369,430	$2,097.91	.	358,540	$2,254.99	.	362,100	$2,384.56	.	374,970	$2,453.05	4,732,380	$26,802.39
A-Retail Trinity	Ret-A-Retail (needs electrician)	E911M00	[E160M05] 1.5in T-10 (4in pipe) in 1st Fl Fire Room	100	$138.20	5,149,300	**32,238**	$183.08	5,186,402	37,102	$233.35	5,220,800	34,398	$226.52	5,261,700	40,900	$267.57	601,387	$3,350.98
		Total			$138.20	.	**32,238**	$183.08	.	37,102	$233.35	.	34,398	$226.52	.	40,900	$267.57	601,387	$3,350.98
B-Retail Trinity	Ret-B-Retail	E912M00	[E162M05] 1.5in T-10 (4in pipe) in 1st Fl Fire Room	100	$6,664.23	66,796,200	**943,900**	$5,360.20	67,075,231	**279,031**	$1,754.93	67,353,700	278,469	$1,833.82	67,727,900	**374,200**	$2,448.02	7,387,900	$42,372.45
		Total			$6,664.23	.	**943,900**	$5,360.20	.	**279,031**	$1,754.93	.	278,469	$1,833.82	.	**374,200**	$2,448.02	7,387,900	$42,372.45
C-Retail Trinity	Ret-C-Retail	E913M00	[E137M04] 2in T-10 (4in pipe) in 1st Fl Fire Room	100	$4,734.19	74,534,600	730,200	$4,146.65	75,228,940	694,340	$4,366.96	75,975,700	746,760	$4,917.68	76,743,900	768,200	$5,025.57	10,516,500	$59,602.17
		Total			$4,734.19	.	730,200	$4,146.65	.	694,340	$4,366.96	.	746,760	$4,917.68	.	768,200	$5,025.57	10,516,500	$59,602.17
D-Retail Trinity	Ret-D-Retail	E914M00	[E156M05] 1.5in T-10 (4in pipe) in 1st Fl Fire Room	100	$2,582.73	34,860,900	472,600	$2,683.79	35,332,900	472,000	$2,968.58	35,831,000	498,100	$3,280.16	36,353,400	522,400	$3,417.54	6,534,700	$37,029.98
		Total			$2,582.73	.	472,600	$2,683.79	.	472,000	$2,968.58	.	498,100	$3,280.16	.	522,400	$3,417.54	6,534,700	$37,029.98
G-Retail Trinity	Ret-G-Retail	E915M00	[E139M08] 2in T-10 (4in pipe) in 1st Fl Fire Room	100	$7,347.69	118,405,300	1,435,700	$8,153.03	119,670,300	1,265,000	$7,956.05	120,799,000	1,128,700	$7,432.89	122,073,100	1,274,100	$8,335.17	16,032,022	$91,064.33
		E915M01	[E144M02] 1in Mdl-70-Badger (2in pipe) in Bldg G	-100	-$807.95	13,921,030	**-184,620**	-$1,048.42	13,982,850	**-61,820**	-$388.81	13,982,850	**0**	$0.00	13,982,850	0	$0.00	-939,320	-$5,365.29
		Total			$6,539.74	.	1,251,080	$7,104.61	.	1,203,180	$7,567.24	.	1,128,700	$7,432.89	.	1,274,100	$8,335.17	15,092,702	$86,025.02
H-Retail Trinity	Ret-H-Retail	E916M00	[E155M02] 1st-Flr_Tenants 1.5in T-10 and [E154M0	100	$6,846.63	99,992,100	**996,700**	$5,660.04	101,073,300	1,081,200	$6,800.06	102,043,300	970,000	$6,387.79	103,077,400	1,034,100	$6,765.08	16,837,300	$94,620.57
		Total			$6,846.63	.	**996,700**	$5,660.04	.	1,081,200	$6,800.06	.	970,000	$6,387.79	.	1,034,100	$6,765.08	16,837,300	$94,620.57
J-Retail Trinity	Ret-J-Retail	E917M00	[E133M05] 2in GWF (2in pipe) in Arena Service Lev	100	$3,104.39	67,414,600	609,560	$3,461.56	67,989,980	575,380	$3,618.77	68,618,230	628,250	$4,137.25	69,201,250	583,020	$3,814.12	7,914,940	$44,591.87
		Total			$3,104.39	.	609,560	$3,461.56	.	575,380	$3,618.77	.	628,250	$4,137.25	.	583,020	$3,814.12	7,914,940	$44,591.87
Stadium OSEG Stadium	Stad-OSEG	No Reader	[No Meter] North Stad 4in HPT (4in pipe) in North	100	$28,601.81	1,150,723,000	4,460,000	$25,327.38	1,154,021,000	**3,298,000**	$20,742.32	1,158,023,000	**4,002,000**	$26,354.57	1,161,290,000	3,267,000	$21,372.72	45,129,000	$262,105.50
		No Reader	[No Meter] South Stad 2in T-10 (4in pipe) in Urban	100	$7,087.27	75,353,000	**1,624,000**	$9,222.35	75,828,000	**475,000**	$2,987.45	75,990,000	**162,000**	$1,066.83	76,080,000	**90,000**	$588.78	8,021,000	$45,884.82
		E917M00	[E133M05] 2in GWF (2in pipe) in Arena Service Lev	-100	-$3,104.39	67,414,600	-609,560	-$3,461.56	67,989,980	-575,380	-$3,618.77	68,618,230	0	$0.00	69,201,250	0	$0.00	-5,978,740	-$33,740.79
		Total			$32,584.69	.	5,474,440	$31,088.16	.	3,197,620	$20,111.00	.	4,164,000	$27,421.40	.	3,357,000	$21,961.50	47,171,260	$274,249.53
Stadium Public Realm	Stad-PubRealm	E915M01	[E144M02] 1in Mdl-70-Badger (2in pipe) in Bldg G	100	$807.95	13,921,030	**184,620**	$1,048.42	13,982,850	**61,820**	$388.81	13,982,850	**0**	$0.00	13,982,850	0	$0.00	939,320	$5,365.29
		E922M00	[E252M06] 1in Dwyer (1.5in pipe) in Garage Bldg I	100	$323.70	8,156,710	57,874	$328.65	8,181,175	**24,465**	$153.87	8,181,176	**2**	$0.01	8,181,176	**0**	$0.00	346,134	$1,977.97
		E923M00	[E213M05] 0.75" Dwyer WMT2-A-C-03 in Garage N	100	$276.64	2,037,986	**26,803**	$152.21	2,058,121	**20,135**	$126.64	2,058,121	**0**	$0.00	2,058,121	0	$0.00	279,261	$1,595.90
		Total			$1,408.29	.	269,297	$1,529.28	.	**106,420**	$669.32	.	**2**	$0.01	.	**0**	$0.00	1,564,715	$8,939.16
City Total			**City Total**		$19,653.03		**2,410,087**	$13,686.36		**924,238**	$5,812.87		**310,064**	$2,041.88		**277,800**	$1,817.37	**17,242,529**	$98,406.18
Office Total			**Office Total**		$3,824.76		**747,170**	$4,243.02		**549,940**	$3,458.77		**512,220**	$3,373.15		**656,880**	$4,297.31	**12,869,360**	$74,238.50
Residential Total			**Residential Total**		$9,588.10		**1,652,416**	$9,383.71		**1,559,123**	$9,805.89		**1,504,710**	$9,909.04		**1,539,200**	$10,069.45	**17,115,837**	$98,506.46
Retail Total			**Retail Total**		$30,610.11		**5,036,278**	$28,599.94		**4,342,233**	$27,309.89		**4,284,677**	$28,216.10		**4,596,920**	$30,073.06	**64,885,428**	$367,267.06
Stadium / OSEG Total			**Stadium / OSEG Total**		$33,992.98		**5,743,737**	$32,617.44		**3,304,040**	$20,780.31		**4,164,002**	$27,421.41		**3,357,000**	$21,961.50	**48,735,975**	$283,188.69
Metered Total					$97,668.93		15,589,688	$88,530.48		10,679,575	$67,157.74		10,775,672	$70,961.53		10,427,800	$68,218.69	160,849,329	$921,322.87
City Main Utility Meter1			**City Account 1of4 (0270300 - 10077975)**		**$32,371.63**	**587,548,000**	**7,394,000**	**$31,494.07**	**594,033,000**	**6,485,000**	**$27,621.73**	**599,997,000**	**5,964,000**	**$25,402.27**	**605,971,000**	**5,974,000**	**$25,444.87**	**75,833,000**	**$322,478.14**
City Main Utility Meter2			**City Account 2of4 (0270300 - 10077976)**		**$9,214.27**	**137,238,000**	**2,140,000**	**$9,112.03**	**139,362,000**	**2,124,000**	**$9,043.87**	**141,423,000**	**2,061,000**	**$8,775.49**	**143,460,000**	**2,037,000**	**$8,673.25**	**23,746,000**	**$100,947.77**
City Main Utility Meter3			**City Account 3of4 (0270300 - 10077977)**		**$25,041.39**	**101,642,000**	**1,168,000**	**$23,418.33**	**102,017,000**	**375,000**	**$20,040.15**	**102,235,000**	**218,000**	**$19,371.33**	**102,566,000**	**331,000**	**$19,852.71**	**10,429,000**	**$252,184.64**
City Main Utility Meter4			**City Account 4of4 (0270300 - 10077978)**		**$28,204.78**	**316,745,000**	**4,311,000**	**$21,231.16**	**318,257,000**	**1,512,000**	**$9,307.42**	**319,174,000**	**917,000**	**$6,772.72**	**320,166,000**	**992,000**	**$7,092.22**	**38,588,000**	**$198,400.92**
City Mains Total					$94,832.07		15,013,000	$85,255.59		10,496,000	$66,013.17		9,160,000	$60,321.81		9,334,000	$61,063.05	148,596,000	$874,011.47
% Difference Submeter to Mains							**3.7%**			**1.7%**			**15.0%**			**10.5%**		**14.8%**	

Carma Metering Report - MM0781 - Lansdowne Stadium - Water - 2024

Less than 20% of previous month | More than 20% of previous month

Tenant Name	Tenant Number	CARMA Plus Meter Number	Service Description [Real Meter]	Percentage (%)	January End Read Date: Feb.4 Units = Litres $0.0067			February End Read Date: Mar.5 Units = Litres $0.0064			March End Read Date:Apr.4 Units = Litres $0.0067			April End Read Date: May3 Units = Litres $0.0064			May End Read Date: Jun.2 Units = Litres $0.0058			June End Read Date: Jul.2 Units = Litres $0.0053			July End Read Date: Aug.1 Units = Litres $0.0055			August End Read Date: Aug.31 Units = Litres $0.0058			September End Read Date: Sep.30 Units = Litres $0.0060		
					Reading	Consumption	Cost	Reading	Consumption	Cost	Reading	Consumption	Cost	Reading	Consumption	Cost	Reading	Consumption	Cost	Reading	Consumption	Cost	Reading	Consumption	Cost	Reading	Consumption	Cost	Reading	Consumption	Cost
City-Ottawa-Aberdeen	City-Aber	No Reader	[No Meter] 1" Mdl-70-Badger in Aberdeen SE Fire Room	100	35,196,700	38,700	$258.09	35,328,400	131,700	$848.58	35,408,100	79,700	$531.56	35,492,000	83,900	$538.47	35,746,400	254,400	$1,480.11	35,920,900	174,500	$925.27	36,019,600	98,700	$543.06	36,121,000	101,400	$592.55	36,244,400	123,400	$735.37
			Total		.	38,700	$258.09	.	131,700	$848.58	.	79,700	$531.56	.	83,900	$538.47	.	254,400	$1,480.11	.	174,500	$925.27	.	98,700	$543.06	.	101,400	$592.55	.	123,400	$735.37
City-Ottawa-Horticulture	City-Hort	E249M01	[E249M01] 1.5in T-10 (2.5in pipe) in Horticulture 1st Fl Mechanical Room	100	12,076,400	63,800	$425.48	12,163,300	86,900	$559.92	12,234,800	71,500	$476.87	12,319,000	84,200	$540.40	12,445,800	126,800	$737.73	12,593,400	147,600	$782.64	12,694,200	100,800	$554.61	12,783,200	89,000	$520.09	12,886,800	103,600	$617.37
			Total		.	63,800	$425.48	.	86,900	$559.92	.	71,500	$476.87	.	84,200	$540.40	.	126,800	$737.73	.	147,600	$782.64	.	100,800	$554.61	.	89,000	$520.09	.	103,600	$617.37
City-Ottawa-Plaza	City-Plaza	E249M02	[E249M02] 3in HPT (3in pipe) in Garage Room P161	100	2,362,700	0	$0.00	2,362,700	0	$0.00	2,362,700	0	$0.00	2,364,000	1,300	$8.34	2,379,300	15,300	$89.02	2,393,500	14,200	$75.29	2,405,500	12,000	$66.03	2,414,400	8,900	$52.01	2,427,400	13,000	$77.47
			Total		.	0	$0.00	.	0	$0.00	.	0	$0.00	.	1,300	$8.34	.	15,300	$89.02	.	14,200	$75.29	.	12,000	$66.03	.	8,900	$52.01	.	13,000	$77.47
City-Ottawa-Serv-Bunk-Ice-Rink	City-Serv-Bunk	No Reader	[No Meter] 2in T-10 (4in pipe) in Urban Park East Court Manhole	100	90,135,137	0	$0.00	90,153,671	18,534	$119.42	90,153,702	31	$0.21	91,228,877	1,075,175	$6,900.47	95,280,237	4,051,360	$23,571.00	98,478,137	3,197,900	$16,956.62	104,001,615	5,523,478	$30,390.80	106,566,599	2,564,984	$14,989.05	108,027,897	1,461,298	$8,708.18
			Total		.	0	$0.00	.	18,534	$119.42	.	31	$0.21	.	1,075,175	$6,900.47	.	4,051,360	$23,571.00	.	3,197,900	$16,956.62	.	5,523,478	$30,390.80	.	2,564,984	$14,989.05	.	1,461,298	$8,708.18
I-Office BTB_REIT	Office-I	E921M00	[E252M02] 2in T-10 (4in pipe) in Garage Bldg I Fire Room P119	100	63,530,010	484,070	$3,228.25	64,041,010	511,000	$3,292.52	64,620,120	579,110	$3,862.36	65,293,274	673,154	$4,320.30	66,067,715	774,441	$4,505.74	66,867,910	800,195	$4,242.97	67,595,080	727,170	$4,000.97	68,240,480	645,400	$3,771.54	68,881,310	640,830	$3,818.84
			Total		.	484,070	$3,228.25	.	511,000	$3,292.52	.	579,110	$3,862.36	.	673,154	$4,320.30	.	774,441	$4,505.74	.	800,195	$4,242.97	.	727,170	$4,000.97	.	645,400	$3,771.54	.	640,830	$3,818.84
A-Condo Vibe OCSCC 967	Res-A-Condo	E910M00	[E218M08] 2in T-10 (4in pipe) in Garage Bldg A Fire Room P144B	100	40,746,400	339,200	$2,262.12	41,087,900	341,500	$2,200.38	41,422,700	334,800	$2,232.94	41,725,500	302,800	$1,943.37	42,181,100	455,600	$2,650.70	42,689,300	508,200	$2,694.69	43,228,300	539,000	$2,965.64	43,675,700	447,400	$2,614.48	44,128,200	452,500	$2,696.54
			Total		.	339,200	$2,262.12	.	341,500	$2,200.38	.	334,800	$2,232.94	.	302,800	$1,943.37	.	455,600	$2,650.70	.	508,200	$2,694.69	.	539,000	$2,965.64	.	447,400	$2,614.48	.	452,500	$2,696.54
K-Condo Rideau OCSCC 1003	Res-K-Condo	E919M00	[E213M07] 3in Nep (3in pipe) in Garage Bldg K Water Room P119	100	Roll-up submeter	885,620	$5,906.18	1,404,787,000	790,000	$5,090.20	3,405,591,000	804,000	$5,362.25	3,406,519,000	813,000	$5,217.83	3,407,523,000	1,004,000	$5,841.32	3,408,694,000	1,171,000	$6,209.14	3,409,867,000	1,173,000	$6,453.98	3,411,027,000	1,160,000	$6,778.72	3,412,125,000	1,098,000	$6,543.21
			Total		Roll-up submeter	885,620	$5,906.18	.	790,000	$5,090.20	.	804,000	$5,362.25	.	813,000	$5,217.83	.	1,004,000	$5,841.32	.	1,171,000	$6,209.14	.	1,173,000	$6,453.98	.	1,160,000	$6,778.72	.	1,098,000	$6,543.21
NorthTH-Condo OCSCC 1010	Res-NTH-Condo	E909M00	[TH-Total] Virtual Meter Total of Townhomes	100	29,459,430	368,440	$2,457.12	29,805,130	345,700	$2,227.45	30,181,810	376,680	$2,512.26	30,547,860	366,050	$2,349.31	30,926,520	378,660	$2,203.06	31,344,780	418,260	$2,217.79	31,729,210	384,430	$2,115.18	32,112,640	383,430	$2,240.66	32,489,690	377,050	$2,246.92
			Total		.	368,440	$2,457.12	.	345,700	$2,227.45	.	376,680	$2,512.26	.	366,050	$2,349.31	.	378,660	$2,203.06	.	418,260	$2,217.79	.	384,430	$2,115.18	.	383,430	$2,240.66	.	377,050	$2,246.92
A-Retail Trinity	Ret-A-Retail	E911M00	[E160M05] 1.5in T-10 (4in pipe) in 1st Fl Fire Room	100	5,296,700	35,000	$233.41	5,326,700	30,000	$193.30	5,350,100	23,400	$156.07	5,375,700	25,600	$164.30	5,418,100	42,400	$246.69	5,500,700	82,600	$437.98	5,526,700	26,000	$143.05	5,552,600	25,900	$151.35	5,579,400	26,800	$159.71
			Total		.	35,000	$233.41	.	30,000	$193.30	.	23,400	$156.07	.	25,600	$164.30	.	42,400	$246.69	.	82,600	$437.98	.	26,000	$143.05	.	25,900	$151.35	.	26,800	$159.71
B-Retail Trinity	Ret-B-Retail	E912M00	[E162M05] 1.5in T-10 (4in pipe) in 1st Fl Fire Room	100	68,022,400	294,500	$1,964.01	68,316,700	294,300	$1,896.26	68,593,900	277,200	$1,848.78	68,937,000	343,100	$2,202.01	69,918,800	981,800	$5,712.16	71,398,400	1,479,600	$7,845.47	73,126,900	1,728,500	$9,510.40	74,649,900	1,523,000	$8,899.99	75,859,400	1,209,500	$7,207.67
			Total		.	294,500	$1,964.01	.	294,300	$1,896.26	.	277,200	$1,848.78	.	343,100	$2,202.01	.	981,800	$5,712.16	.	1,479,600	$7,845.47	.	1,728,500	$9,510.40	.	1,523,000	$8,899.99	.	1,209,500	$7,207.67
C-Retail Trinity	Ret-C-Retail	E913M00	[E137M04] 2in T-10 (4in pipe) in 1st Fl Fire Room	100	77,351,300	607,400	$4,050.74	78,091,500	740,200	$4,769.33	78,774,500	683,000	$4,555.25	79,359,200	584,700	$3,752.60	80,059,000	699,800	$4,071.47	80,988,900	929,900	$4,930.72	82,018,200	1,029,300	$5,663.33	83,059,100	1,040,900	$6,082.73	83,785,500	726,400	$4,328.77
			Total		.	607,400	$4,050.74	.	740,200	$4,769.33	.	683,000	$4,555.25	.	584,700	$3,752.60	.	699,800	$4,071.47	.	929,900	$4,930.72	.	1,029,300	$5,663.33	.	1,040,900	$6,082.73	.	726,400	$4,328.77
D-Retail Trinity	Ret-D-Retail	E914M00	[E156M05] 1.5in T-10 (4in pipe) in 1st Fl Fire Room	100	36,833,000	479,600	$3,198.44	37,336,100	503,100	$3,241.62	37,785,600	449,500	$2,997.93	38,268,900	483,300	$3,101.82	38,797,100	528,200	$3,073.09	39,316,600	519,500	$2,754.61	39,765,100	448,500	$2,467.70	40,215,400	450,300	$2,631.43	40,658,400	443,000	$2,639.93
			Total		.	479,600	$3,198.44	.	503,100	$3,241.62	.	449,500	$2,997.93	.	483,300	$3,101.82	.	528,200	$3,073.09	.	519,500	$2,754.61	.	448,500	$2,467.70	.	450,300	$2,631.43	.	443,000	$2,639.93
G-Retail Trinity	Ret-G-Retail	E915M00	[E139M08] 2in T-10 (4in pipe) in 1st Fl Fire Room	100	123,106,400	1,033,300	$6,891.06	124,171,200	1,064,800	$6,860.82	125,256,000	1,084,800	$7,235.04	126,360,200	1,104,200	$7,086.75	127,702,200	1,342,000	$7,807.82	129,204,200	1,502,000	$7,964.24	130,582,100	1,377,900	$7,581.36	131,951,600	1,369,500	$8,002.98	133,307,400	1,355,800	$8,079.50
		E915M01	[E144M02] 1in Mdl-70-Badger (2in pipe) in Bldg G 1st Fl Fire Room f.f. E139M08	-100	13,982,850	0	$0.00	13,982,850	0	$0.00	13,982,850	0	$0.00	14,011,540	0	$0.00	14,106,800	0	$0.00	14,312,200	0	$0.00	14,492,460	0	$0.00	14,694,830	0	$0.00	14,900,720	0	$0.00
			Total		.	1,033,300	$6,891.06	.	1,064,800	$6,860.82	.	1,084,800	$7,235.04	.	1,104,200	$7,086.75	.	1,342,000	$7,807.82	.	1,502,000	$7,964.24	.	1,377,900	$7,581.36	.	1,369,500	$8,002.98	.	1,355,800	$8,079.50
H-Retail Trinity	Ret-H-Retail	E916M00	[E155M02] 1st-Flr_Tenants 1.5in T-10 and [E154M01] 2nd-Flr_WholeFoods (4in	100	104,173,200	1,095,800	$7,307.87	105,215,900	1,042,700	$6,718.42	106,172,300	956,400	$6,378.68	107,054,100	881,800	$5,659.39	108,028,700	974,600	$5,670.27	109,038,500	1,009,800	$5,354.39	110,052,800	1,014,300	$5,580.79	111,013,500	960,700	$5,614.06	111,967,100	953,600	$5,682.70
			Total		.	1,095,800	$7,307.87	.	1,042,700	$6,718.42	.	956,400	$6,378.68	.	881,800	$5,659.39	.	974,600	$5,670.27	.	1,009,800	$5,354.39	.	1,014,300	$5,580.79	.	960,700	$5,614.06	.	953,600	$5,682.70
J-Retail Trinity	Ret-J-Retail	E917M00	[E133M05] 2in GWF (2in pipe) in Arena Service Level Boiler Room	100	69,853,340	652,090	$4,348.78	70,504,520	651,180	$4,195.74	71,129,660	625,140	$4,169.35	71,755,560	625,900	$4,017.02	72,375,960	620,400	$3,609.52	72,967,730	591,770	$3,137.81	73,538,920	571,190	$3,142.75	74,119,040	580,120	$3,390.06	74,984,230	865,190	$5,155.85
			Total		.	652,090	$4,348.78	.	651,180	$4,195.74	.	625,140	$4,169.35	.	625,900	$4,017.02	.	620,400	$3,609.52	.	591,770	$3,137.81	.	571,190	$3,142.75	.	580,120	$3,390.06	.	865,190	$5,155.85
Stadium OSEG Stadium	Stad-OSEG	No Reader	[No Meter] North Stad 4in HPT (4in pipe) in North Side SE Room	100	1,165,096,000	3,806,000	$25,382.14	1,169,148,000	4,052,000	$26,108.22	1,173,250,000	4,102,000	$27,358.17	1,177,900,000	4,650,000	$29,843.68	1,181,723,000	3,823,000	$22,242.39	1,184,955,000	3,232,000	$17,137.43	1,187,932,000	2,977,000	$16,379.79	1,191,252,000	3,320,000	$19,401.16	1,195,268,000	4,016,000	$23,932.19
		No Reader	[No Meter] South Stad 2in T-10 (4in pipe) in Urban Park East Court Manhole	100	76,135,000	55,000	$366.79	76,213,000	78,000	$502.58	76,386,000	173,000	$1,153.82	77,194,000	808,000	$5,185.74	79,202,000	2,008,000	$11,682.64	81,279,000	2,077,000	$11,013.13	83,607,000	2,328,000	$12,808.92	85,141,000	1,534,000	$8,964.27	86,541,000	1,400,000	$8,342.89
		E917M00	[E133M05] 2in GWF (2in pipe) in Arena Service Level Boiler Room	-100	69,853,340	0	$0.00	70,504,520	0	$0.00	71,129,660	0	$0.00	71,755,560	0	$0.00	72,375,960	0	$0.00	72,967,730	0	$0.00	73,538,920	0	$0.00	74,119,040	0	$0.00	74,984,230	0	$0.00
			Total		.	3,861,000	$25,748.94	.	4,130,000	$26,610.80	.	4,275,000	$28,511.99	.	5,458,000	$35,029.42	.	5,831,000	$33,925.02	.	5,309,000	$28,150.56	.	5,305,000	$29,188.71	1,276,393,000	4,854,000	$28,365.43	1,281,809,000	5,416,000	$32,275.09
Stadium Public Realm	Stad-PubRealm	E915M01	[E144M02] 1in Mdl-70-Badger (2in pipe) in Bldg G 1st Fl Fire Room f.f. E139M08	100	13,982,850	0	$0.00	13,982,850	0	$0.00	13,982,850	0	$0.00	14,011,540	28,690	$184.13	14,106,800	95,260	$554.23	14,312,200	205,400	$1,089.12	14,492,460	180,260	$991.81	14,694,830	202,370	$1,182.59	14,900,720	205,890	$1,226.94
		E922M00	[E252M06] 1in Dwyer (1.5in pipe) in Garage Bldg I Fire Room P119	100	8,181,176	0	$0.00	8,181,176	0	$0.00	8,181,176	0	$0.00	8,210,489	29,313	$188.13	8,278,222	67,733	$394.07	8,312,690	34,468	$182.76	8,362,584	49,894	$274.52	8,428,863	66,279	$387.32	8,484,588	55,725	$332.07
		E923M00	[E213M05] 0.75" Dwyer WMT2-A-C-03 in Garage Near RB player entrance vent s	100	2,058,121	0	$0.00	2,058,121	0	$0.00	2,058,121	0	$0.00	2,074,981	16,860	$108.21	2,126,060	51,079	$297.18	2,177,589	51,529	$273.23	2,228,362	50,773	$279.36	2,277,866	49,504	$289.29	2,317,199	39,333	$234.39
			Total		.	0	$0.00	.	0	$0.00	.	0	$0.00	.	74,863	$480.47	.	214,071	$1,245.48	.	291,397	$1,545.11	.	280,927	$1,545.69	.	318,153	$1,859.20	.	300,947	$1,793.41
City Total			**City Total**			**102,500**	$683.57		**237,134**	$1,527.92		**151,231**	$1,008.63		**1,244,575**	$7,987.68		**4,447,860**	$25,877.85		**3,534,200**	$18,739.82		**5,734,978**	$31,554.50		**2,764,284**	$16,153.71		**1,701,298**	$10,138.39
Office Total			**Office Total**			**484,070**	$3,228.25		**511,000**	$3,292.52		**579,110**	$3,862.36		**673,154**	$4,320.30		**774,441**	$4,505.74		**800,195**	$4,242.97		**727,170**	$4,000.97		**645,400**	$3,771.54		**640,830**	$3,818.84
Residential Total			**Residential Total**			**1,593,260**	$10,625.42		**1,477,200**	$9,518.03		**1,515,480**	$10,107.45		**1,481,850**	$9,510.51		**1,838,260**	$10,695.08		**2,097,460**	$11,121.62		**2,096,430**	$11,534.80		**1,990,830**	$11,633.86		**1,927,550**	$11,486.68
Retail Total			**Retail Total**			**4,197,690**	$27,994.31		**4,326,280**	$27,875.49		**4,099,440**	$27,341.10		**4,048,600**	$25,983.89		**5,189,200**	$30,191.00		**6,115,170**	$32,425.22		**6,195,690**	$34,089.39		**5,950,420**	$34,772.60		**5,580,290**	$33,254.12
Stadium / OSEG Total			**Stadium / OSEG Total**			**3,861,000**	$25,748.94		**4,130,000**	$26,610.80		**4,275,000**	$28,511.99		**5,532,863**	$35,509.89		**6,045,071**	$35,170.50		**5,600,397**	$29,695.67		**5,585,927**	$30,734.41		**5,172,153**	$30,224.62		**5,716,947**	$34,068.49
Metered Total						10,238,520	$68,280.50		10,681,614	$68,824.77		10,620,261	$70,831.52		12,981,042	$83,312.26		18,294,833	$106,440.17		18,147,422	$96,225.31		20,340,195	$111,914.07		16,523,087	$96,556.33		15,566,915	$92,766.53
City Main Utility Meter1	**Bank - 50mm Low Flow**		**City Account 1of4 (0270300 - 10077975)**		**611,806,000**	**5,835,000**	**$24,852.73**	**617,838,000**	**6,032,000**	**$25,691.95**	**623,795,000**	**5,957,000**	**$25,428.99**	**630,370,000**	**6,576,000**	**$28,667.37**	**637,961,000**	**7,590,000**	**$33,088.41**	**646,265,000**	**8,304,000**	**$36,201.45**	**2,578,000**	**2,578,000**	**$11,297.05**	**5,189,000**	**2,611,000**	**$11,379.97**	**7,856,000**	**2,667,000**	**$11,624.13**
City Main Utility Meter2	**Holmwood - 50mm Low Flow**		**City Account 2of4 (0270300 - 10077976)**		**145,514,000**	**2,054,000**	**$8,745.67**	**147,567,000**	**2,053,000**	**$8,741.41**	**149,614,000**	**2,047,000**	**$8,735.39**	**151,719,000**	**2,105,000**	**$9,173.81**	**153,853,000**	**2,134,000**	**$9,300.25**	**155,981,000**	**2,128,000**	**$9,274.09**	**158,075,000**	**2,094,000**	**$9,125.85**	**160,156,000**	**2,081,000**	**$9,069.17**	**162,236,000**	**2,080,000**	**$9,064.81**
City Main Utility Meter3	**Bank - 200mm High Flow**		**City Account 3of4 (0270300 - 10077977)**		**102,809,000**	**243,000**	**$19,477.83**	**103,186,000**	**377,000**	**$20,048.67**	**103,429,000**	**243,000**	**$19,679.39**	**104,076,000**	**647,000**	**$23,259.06**	**105,335,000**	**1,259,000**	**$25,927.38**	**108,299,000**	**2,964,000**	**$33,361.18**	**111,605,000**	**3,306,000**	**$34,852.30**	**113,857,000**	**2,252,000**	**$30,256.86**	**115,735,000**	**1,878,000**	**$28,626.22**
City Main Utility Meter4	**Holmwood - 200mm High Flow**		**City Account 4of4 (0270300 - 10077978)**		**320,876,000**	**710,000**	**$5,890.90**	**322,170,000**	**1,294,000**	**$8,378.74**	**322,886,000**	**716,000**	**$5,934.70**	**324,939,000**	**2,053,000**	**$11,942.96**	**330,020,000**	**5,081,000**	**$25,145.04**	**341,477,000**	**11,457,000**	**$52,944.40**	**354,060,000**	**12,583,000**	**$57,853.76**	**362,902,000**	**8,842,000**	**$41,543.00**	**370,923,000**	**8,021,000**	**$37,963.44**
City Mains Total						8,842,000	$58,967.13		9,756,000	$62,860.77		8,963,000	$59,778.47		11,381,000	$73,043.20		16,064,000	$93,461.08		24,853,000	$131,781.12		20,561,000	$113,128.96		15,786,000	$92,249.00		14,646,000	$87,278.60
% Difference Submeter to Mains						**13.6%**			**8.7%**			**15.6%**			**12.3%**			**12.2%**			**-37.0%**			**-1.1%**			**4.5%**			**5.9%**	

Carma Metering Report - MM0781 - Lansdowne Stadium - Water - 2024

Less than 20% of previous month | **More than 20% of previous month**

Tenant Name	Tenant Number	CARMA Plus Meter Number	Service Description [Real Meter]	Percantage (%)	October			November			December			Total YTD
					End Read Date: Oct.30		Rate $/unit	End Read Date: CNov.1		Rate $/unit	End Read Date: Dec.1		Rate $/unit	
					Units = Litres		$0.0063	Units = Litres		#DIV/0!	Units = Litres		#DIV/0!	Litres
					Reading	Consumption	Cost	Reading	Consumption	Cost	Reading	Consumption	Cost	Consumption
City-Ottawa-Aberdeen	City-Aber	No Reader	[No Meter] 1" Mdl-70-Badger in Aberdeen SE Fire Room	100	36,398,000	153,600	$970.22		-36,398,000	#DIV/0!		0	#DIV/0!	-35,158,000
		Total			36,398,000	153,600	$970.22	0	-36,398,000	#DIV/0!	0	0	#DIV/0!	-35,158,000
City-Ottawa-Horticulture	City-Hort	E249M01	[E249M01] 1.5in T-10 (2.5in pipe) in Horticulture 1st Fl Mechanical Room	100	12,962,800	76,000	$480.06			#DIV/0!			#DIV/0!	950,200
		Total			.	76,000	$480.06			#DIV/0!			#DIV/0!	950,200
City-Ottawa-Plaza	City-Plaza	E249M02	[E249M02] 3in HPT (3in pipe) in Garage Room P161	100	2,434,400	7,000	$44.22			#DIV/0!			#DIV/0!	71,700
		Total			.	7,000	$44.22			#DIV/0!			#DIV/0!	71,700
City-Ottawa-Serv-Bunk-Ice-Rink	City-Serv-Bunk	No Reader	[No Meter] 2in T-10 (4in pipe) in Urban Park East Court Manhole	100	108,986,140	958,243	$6,052.80		-108,986,140	#DIV/0!		0	#DIV/0!	-90,135,137
		Total			108,986,140	958,243	$6,052.80	0	-108,986,140	#DIV/0!	0	0	#DIV/0!	-90,135,137
I-Office BTB_REIT	Office-I	E921M00	[E252M02] 2in T-10 (4in pipe) in Garage Bldg I Fire Room P119	100	69,402,180	520,870	$3,290.11			#DIV/0!			#DIV/0!	6,356,240
		Total			.	520,870	$3,290.11			#DIV/0!			#DIV/0!	6,356,240
A-Condo Vibe OCSCC 967	Res-A-Condo	E910M00	[E218M08] 2in T-10 (4in pipe) in Garage Bldg A Fire Room P144B	100	44,504,700	376,500	$2,378.19			#DIV/0!			#DIV/0!	4,097,500
		Total			.	376,500	$2,378.19			#DIV/0!			#DIV/0!	4,097,500
K-Condo Rideau OCSCC 1003	Res-K-Condo	E919M00	[E213M07] 3in Nep (3in pipe) in Garage Bldg K Water Room P119	100	3,412,936,000	811,000	$5,122.73			#DIV/0!			#DIV/0!	9,709,620
		Total			.	811,000	$5,122.73			#DIV/0!			#DIV/0!	9,709,620
NorthTH-Condo OCSCC 1010	Res-NTH-Condo	E909M00	[TH-Total] Virtual Meter Total of Townhomes	100	32,873,440	383,750	$2,423.98			#DIV/0!			#DIV/0!	3,782,450
		Total			.	383,750	$2,423.98			#DIV/0!			#DIV/0!	3,782,450
A-Retail Trinity	Ret-A-Retail	E911M00	[E160M05] 1.5in T-10 (4in pipe) in 1st Fl Fire Room	100	5,604,800	25,400	$160.44			#DIV/0!			#DIV/0!	343,100
		Total			.	25,400	$160.44			#DIV/0!			#DIV/0!	343,100
B-Retail Trinity	Ret-B-Retail	E912M00	[E162M05] 1.5in T-10 (4in pipe) in 1st Fl Fire Room	100	76,497,500	638,100	$4,030.60			#DIV/0!			#DIV/0!	8,769,600
		Total			.	638,100	$4,030.60			#DIV/0!			#DIV/0!	8,769,600
C-Retail Trinity	Ret-C-Retail	E913M00	[E137M04] 2in T-10 (4in pipe) in 1st Fl Fire Room	100	84,418,000	632,500	$3,995.23			#DIV/0!			#DIV/0!	7,674,100
		Total			.	632,500	$3,995.23			#DIV/0!			#DIV/0!	7,674,100
D-Retail Trinity	Ret-D-Retail	E914M00	[E156M05] 1.5in T-10 (4in pipe) in 1st Fl Fire Room	100	41,064,300	405,900	$2,563.89			#DIV/0!			#DIV/0!	4,710,900
		Total			.	405,900	$2,563.89			#DIV/0!			#DIV/0!	4,710,900
G-Retail Trinity	Ret-G-Retail	E915M00	[E139M08] 2in T-10 (4in pipe) in 1st Fl Fire Room	100	134,554,000	1,246,600	$7,874.23			#DIV/0!			#DIV/0!	12,480,900
		E915M01	[E144M02] 1in Mdl-70-Badger (2in pipe) in Bldg G 1st Fl Fire Room f.f. E139M08	-100	15,005,280	0	$0.00			#DIV/0!			#DIV/0!	0
		Total			.	1,246,600	$7,874.23			#DIV/0!			#DIV/0!	12,480,900
H-Retail Trinity	Ret-H-Retail	E916M00	[E155M02] 1st-Flr_Tenants 1.5in T-10 and [E154M01] 2nd-Flr_WholeFoods (4in	100	112,984,800	1,017,700	$6,428.37			#DIV/0!			#DIV/0!	9,907,400
		Total			.	1,017,700	$6,428.37			#DIV/0!			#DIV/0!	9,907,400
J-Retail Trinity	Ret-J-Retail	E917M00	[E133M05] 2in GWF (2in pipe) in Arena Service Level Boiler Room	100	75,901,250	917,020	$5,792.42			#DIV/0!			#DIV/0!	6,700,000
		Total			.	917,020	$5,792.42			#DIV/0!			#DIV/0!	6,700,000
Stadium OSEG Stadium	Stad-OSEG	No Reader	[No Meter] North Stad 4in HPT (4in pipe) in North Side SE Room	100	1,199,390,000	4,122,000	$26,036.88		-1,199,390,000	#DIV/0!		0	#DIV/0!	-1,161,290,000
		No Reader	[No Meter] South Stad 2in T-10 (4in pipe) in Urban Park East Court Manhole	100	87,678,000	1,137,000	$7,181.93		-87,678,000	#DIV/0!		0	#DIV/0!	-76,080,000
		E917M00	[E133M05] 2in GWF (2in pipe) in Arena Service Level Boiler Room	-100	75,901,250	0	$0.00	0	0	#DIV/0!	0	0	#DIV/0!	0
		Total			1,287,068,000	5,259,000	$33,218.82	0	-1,287,068,000	#DIV/0!	0	0	#DIV/0!	-1,237,370,000
Stadium Public Realm	Stad-PubRealm	E915M01	[E144M02] 1in Mdl-70-Badger (2in pipe) in Bldg G 1st Fl Fire Room f.f. E139M08	100	15,005,280	104,560	$660.46			#DIV/0!			#DIV/0!	1,022,430
		E922M00	[E252M06] 1in Dwyer (1.5in pipe) in Garage Bldg I Fire Room P119	100	8,507,538	22,950	$144.96			#DIV/0!			#DIV/0!	326,362
		E923M00	[E213M05] 0.75" Dwyer WMT2-A-C-03 in Garage Near RB player entrance vent s	100	2,317,202	4	$0.02			#DIV/0!			#DIV/0!	259,081
		Total			.	127,514	$805.45			#DIV/0!			#DIV/0!	1,607,873
City Total			**City Total**			**1,194,843**	$7,547.30		**-145,384,140**	#DIV/0!		**0**	#DIV/0!	**-124,271,237**
Office Total			**Office Total**			**520,870**	$3,290.11		**0**	#DIV/0!		**0**	#DIV/0!	**6,356,240**
Residential Total			**Residential Total**			**1,571,250**	$9,924.90		**0**	#DIV/0!		**0**	#DIV/0!	**17,589,570**
Retail Total			**Retail Total**			**4,883,220**	$30,845.18		**0**	#DIV/0!		**0**	#DIV/0!	**50,586,000**
Stadium / OSEG Total			**Stadium / OSEG Total**			**5,386,514**	$34,024.26		**-1,287,068,000**	#DIV/0!		**0**	#DIV/0!	**-1,235,762,127**
Metered Total						13,556,697	$85,631.76		-1,432,452,140	#VALUE!		0	#VALUE!	-1,285,501,554
City Main Utility Meter1	**Bank - 50mm Low Flow**		**City Account 1of4 (0270300 - 10077975)**		**10,510,000**	**2,654,000**	**$11,567.45**			**$0.00**				**50,804,000**
City Main Utility Meter2	**Holmwood - 50mm Low Flow**		**City Account 2of4 (0270300 - 10077976)**		**164,397,000**	**2,161,000**	**$9,417.97**			**$0.00**				**20,937,000**
City Main Utility Meter3	**Bank - 200mm High Flow**		**City Account 3of4 (0270300 - 10077977)**		**116,950,000**	**1,215,000**	**$25,735.54**			**$0.00**				**14,384,000**
City Main Utility Meter4	**Holmwood - 200mm High Flow**		**City Account 4of4 (0270300 - 10077978)**		**376,864,000**	**5,941,000**	**$28,894.64**			**$0.00**				**56,698,000**
City Mains Total						11,971,000	$75,615.60		1	$0.00		1	$0.00	142,823,000
% Difference Submeter to Mains						**11.7%**			**100.0%**					**13.3%**

Fire Flow Design Sheet (FUS)
Lansdwone Park Redevelopment
City of Ottawa
WSP Project No. CA000286.1662
Date: 22-Sep-23

Proposed North Stands
Fire Flow Requirements Based on Fire Underwriters Survey (FUS) 2020

1. An estimate of the Fire Flow required for a given fire area may be estimated by: $F = 220\ C\ \sqrt{A}$

F = required fire flow in litres per minute
C = coefficient related to the type of construction
- 1.5 for **Type V** Wood Frame Construction
- 0.8 for **Type IV-A** Mass Timber Construction
- 0.9 for **Type IV-B** Mass Timber Construction
- 1.0 for **Type IV-C** Mass Timber Construction
- 1.5 for **Type IV-D** Mass Timber Construction
- 1.0 for **Type III** Ordinary Construction
- 0.8 for **Type II** Noncombustible Construction
- 0.6 for **Type I** Fire resistive Construction

A =2-b) The single largest Floor Area plus 25% of each of the two immediately adjoining floors

A = 9318.1 m^2
C = 0.6
F = 12742.0 L/min

rounded off to 13,000 L/min (min value of 2000 L/min)

2. The value obtained in 1. may be reduced by as much as 25% for occupancies having a low contents fire hazard.

Non-combustible	-25%
Limited Combustible	-15%
Combustible	0%
Free Burning	15%
Rapid Burning	25%

Reduction due to low occupancy hazard -25% x 13,000 = 9,750 L/min

3. The value obtained in 2. may be reduced by as much as 50% for buildings equipped with automatic sprinkler protection.

Adequate Sprinkler confirms to NFPA13	-30%
Water supply common for sprinklers & fire hoses	-10%
Fully supervised system	-10%
No Automatic Sprinkler System	0%

Reduction due to Sprinkler System -50% x 9,750 = -4,875 L/min

4. The value obtained in 2. is increased for structures exposed within 45 metres by the fire area under consideration.

Separation	Charge
0 to 3 m	25%
3.1 to 10 m	20%
10.1 to 20 m	15%
20.1 to 30 m	10%
30.1 to 45 m	0%

Side 1	10	0%	north side	(fire resistive wall with residential towers)
Side 2	16	0%	east side	(fire resistive wall with Event Centre)
Side 3	85	0%	south side	
Side 4	13	15%	west side	
		15%		(Total shall not exceed 75%)

Increase due to separation 15% x 9,750 = 1,463 L/min

5. The flow requirement is the value obtained in 2., minus the reduction in 3., plus the addition in 4.

The fire flow requirement is 6,000 L/min (Rounded to nearest 1000 L/min)
or **100 L/sec**
or 1,585 gpm (us)
or 1,320 gpm (uk)

Based on method described in:
"Water Supply for Public Fire Protection - A Guide to Recommended Practice", 2020
by Fire Underwriters Survey

Fire Flow Design Sheet (FUS)
Lansdwone Park Redevelopment
City of Ottawa
WSP Project No. CA000286.1662
Date: 22-Sep-23

Proposed Event Centre
Fire Flow Requirements Based on Fire Underwriters Survey (FUS) 2020

1. An estimate of the Fire Flow required for a given fire area may be estimated by: $F = 220\ C\ \sqrt{A}$

F = required fire flow in litres per minute
C = coefficient related to the type of construction
- 1.5 for **Type V** Wood Frame Construction
- 0.8 for **Type IV-A** Mass Timber Construction
- 0.9 for **Type IV-B** Mass Timber Construction
- 1.0 for **Type IV-C** Mass Timber Construction
- 1.5 for **Type IV-D** Mass Timber Construction
- 1.0 for **Type III** Ordinary Construction
- 0.8 for **Type II** Noncombustible Construction
- 0.6 for **Type I** Fire resistive Construction

A =2-b) The single largest Floor Area plus 25% of each of the two immediately adjoining floors

A = 7926.3 m^2
C = 0.6
F = 11751.9 L/min

rounded off to 12,000 L/min (min value of 2000 L/min)

2. The value obtained in 1. may be reduced by as much as 25% for occupancies having a low contents fire hazard.

Non-combustible	-25%
Limited Combustible	-15%
Combustible	0%
Free Burning	15%
Rapid Burning	25%

Reduction due to low occupancy hazard -25% x 12,000 = 9,000 L/min

3. The value obtained in 2. may be reduced by as much as 50% for buildings equipped with automatic sprinkler protection.

Adequate Sprinkler confirms to NFPA13	-30%
Water supply common for sprinklers & fire hoses	-10%
Fully supervised system	-10%
No Automatic Sprinkler System	0%

Reduction due to Sprinkler System -50% x 9,000 = -4,500 L/min

4. The value obtained in 2. is increased for structures exposed within 45 metres by the fire area under consideration.

Separation	Charge
0 to 3 m	25%
3.1 to 10 m	20%
10.1 to 20 m	15%
20.1 to 30 m	10%
30.1 to 45 m	0%

Side 1	85	0%	north side	
Side 2	100	0%	east side	
Side 3	100	0%	south side	
Side 4	16	0%	west side	(fire resistive wall seperation with North Stands)
		0%		(Total shall not exceed 75%)

Increase due to separation 0% x 9,000 = 0 L/min

5. The flow requirement is the value obtained in 2., minus the reduction in 3., plus the addition in 4.

The fire flow requirement is 5,000 L/min (Rounded to nearest 1000 L/min)
or **83 L/sec**
or 1,321 gpm (us)
or 1,100 gpm (uk)

Based on method described in:
"Water Supply for Public Fire Protection - A Guide to Recommended Practice", 2020
by Fire Underwriters Survey

Building	Retail (m^2)	Residential # towns	Residential # apts	Office (m^2)	Estimated WTR / SAN / STM per Mechancal Eng. WTR (L/s)	FIRE (L/s)	SAN (L/s)	STM (L/s)	Estimated Per City of Ottawa Design Guidelines WTR AVG (L/s)	MAX. DAY (L/s)	PEAK HR (L/s)	FIRE (L/s)	SAN (L/s)	STM (L/s)	Notes
A	4,129	7	50		16.7		5.4	8.3	0.6	1.3	2.7	150	2.5	8.6	Mech Eng values provided by LKM 2011-11-29 (Includes retail and residential)
B	5,401	15			6.9		5.7	8.6	0.3	0.6	1.3	150	1.6	11.1	Mech Eng values provided by LKM 2011-11-29 (Includes retail and residential)
C	9,262	11			13.9		5.4	19.6	0.4	0.7	1.4	150	2.1	10.1	Mech Eng values provided by LKM 2011-11-29 (Includes retail and residential)
D	2,131	7			6.3		3.8	5.2	0.1	0.3	0.6	150	0.7	4.6	Mech Eng values provided by LKM 2011-11-29 (Includes retail and residential)
G1	3,507				6.3		5.4	5.5	0.1	0.2	0.3	150	0.6	5.8	Mech Eng values provided by LKM 2011-11-29 (Includes retail)
G2	399				5.0		2.6	2.4	0.0	0.0	0.0	150	0.1	1.3	Mech Eng values provided by LKM 2011-11-29 (Includes retail)
H	7,294				9.5		500FU	9.5	0.2	0.3	0.6	150	1.3	11.7	Mech Eng values provided by LKM 2011-11-29 (Includes retail)
I	2,505			8,361					0.9	1.3	2.3	150	1.6	8.1	
J	1,220								0.0	0.1	0.1	150	0.2	4.3	
J - Salon	3,425								0.1	0.1	0.3	150	0.6	N/A	Roof covered in North Stands flow.
K			190						1.4	3.5	7.6	150	5.5	5.3	
North Stands									2.8	4.2	7.6	150	7.6	219.2	No City standard for estimating flow from stadium / civic centre. Used monitored data
South Stands					25.2	31.5	11.6	211	2.8	4.2	7.5	150	11.6	212.0	No City standard for estimating flow from stadium / civic centre. Used monitored data
Civil Centre									1.9	2.9	5.2	150	5.2	N/A	No City standard for estimating flow from stadium / civic centre. Used monitored data
Aberdeen	4,098								0.1	0.2	0.3	150	0.7	N/A	Peaked Roof, storm runoff included in surface drainage.
Horticulture	1,591								0.0	0.1	0.1	150	0.3	N/A	Peaked Roof, storm runoff included in surface drainage.
Total	**44,962**	**40**	**240**	**8,361**	**89.9**	**31.5**	**39.8**	**270.1**	**11.8**	**19.9**	**38.0**		**42.1**	**502.2**	

Notes

1) Retail floor areas for buildings A, B, C, D, G1, G2, H, I, J, J - Salon provided by Perkins Eastman - Novemeber 18, 2011. Above table uses total GFA.

2) Residential for Buildings A, B, C, D, and K component extracted from RFO Addendum 3 - October 20, 2011 as follows:

Parcel A1 = Residential Tower above Bldg A. 240units (280units max less townhomes) proportionate between Bldg A and K. Therefore, 240units x 66,000/316,000 = 50units.

Parcel A2 = Townhomes abutting buildings A, B, C, D. Assuming 1,225sq.ft townhomes = 40units. Divided between buildings per ground floor area shown on Perkins Eastman November 19, 2011 merchandising plan.

Bldg A = 3,426/19,104 x 40 = 7 units

Bldg B = 7,188/19,104 = 15 units

Bldg C = 5,096/19,104 = 11 units

Bldg D = 3,394/19,104 = 7units

Parcel B = Office tower above Building I, 90,000sq.ft.

Parcel C = Building K 240units (280units max less townhomes) proportionate between Bldg A and K. Therefore, 240units x 250,000/316,000 = 190units.

3) Mech. Eng. Servcing for Bldgs A, B, C, D, G1, G2, H provided by LKM, dated July 19, 2011. Revised Storm and Sanitary flow per November 29, 2011 email.

4) City of Ottawa rates were estimated accordingly

Water Supply

Retail: Average Day 2.5L/m^2/d, Max Day = Avg Day x 1.5, Peak Hour = Avg Day x 2.7

Residential:

Townhouse Avg Day = 2.7p/unit x 350m^3/d, Max Day = Avg Day x 2.5, Peak Hour = Avg Day x 5.5

Apartement Avg Day = 1.8p/unit x 350m^3/d, Max Day = Avg Day x 2.5, Peak Hour = Avg Day x 5.5

Office: Average Day 75L/9.3m^2/d, Max Day = Avg Day x 1.5, Peak Hour = Avg Day x 2.7

North and South Stands: City of Ottawa completed Flow Monitoring in 2005. A peak dry weather flow for a capacity game was recorded to be 15.1L/s.

Report titled "Lansdowne Park - 2005, Combined Sewer Flow Monitoring Report," G.A. Clark & Associates Limited, Proj. No: 200524

Interpolated Average Day, Max Day and, Peak Hour accordingly: Peak Hour = 15.1L/s, Max Day = Peak Hour / 1.8, Average Day = Peak Hour / 2.7

North and South stands flow proportioned by number of seating: North Stands = 14,542 South Stands = 14,284, as decribed in Lansdowne Park information material.

Civil Centre: Flow monitoring completed in 2005 indicated a peak a 4L/s. However, this recorded flow did not account for wastewater directed to Holmwood.

Civil Centre Flow estimated based on Stadium monitored flow and seating: 9,836 / 28,826 x 15.1 = 5.2L/s

Interpolated Average Day, Max Day and, Peak Hour accordingly: Peak Hour = 5.2L/s, Max Day = Peak Hour / 1.8, Average Day = Peak Hour / 2.7

Wastewater

Retail: Average Day 5L/m^2/d x 24hour day / 12hour operation, Peak = Average Day x 1.5

Residential:

Townhouse Avg Day = 2.7p/unit x 350m^3/d, Peak = Avg Day x 3.95

Apartment Avg Day = 1.8p/unit x 350m^3/d, Peak = Avg Day x 3.95

Office: Average Day 75L/9.3m^2/d, Peak = Avg Day x 1.5

North and South Stands: City of Ottawa completed Flow Monitoring in 2005. A peak dry weather flow for a capacity game was recorded to be 15.1L/s.

Report titled "Lansdowne Park - 2005, Combined Sewer Flow Monitoring Report," G.A. Clark & Associates Limited, Proj. No: 200524

Peak flow interpreted as peak monitored flow (15.1L/s)

North stands flow proportioned by number of seating: North Stands = 14,542 South Stands = 14,284, as decribed in Lansdowne Park information material.

Civil Centre: Flow monitoring completed in 2005 indicated a peak a 4L/s. However, this recorded flow did not account for wastewater directed to Holmwood.

Civil Centre Flow estimated based on Stadium monitored flow and seating: 9,836 / 28,826 x 15.1 = 5.2L/s

South Stands - Mechanical Consultant provided estimated peak Wastewater Flow Rate (Smith and Anderson (2011-12-02) servicing sketch)

Storm

See Separate Analysis - Estimated per City of Ottawa IDF curves and Control Flow roof drains where appropriate

North and South Stands assumed to have roof drains sized to accommodate 5-year storm only. To be confirmed by DSEL through modeling.

The proposed water supply network is illustration on ***Drawing C01003*** and the associated hydraulic analysis is located ***Appendix B***. ***Table 3*** summarizes the anticipated Water Demand and Boundary Conditions under proposed conditions.

Table 4
Water Demand and Boundary Conditions
Proposed Conditions

Design Parameter	Anticipated Demand[1] (L/s)	Boundary Condition[2] (m H_2O / kPa)
Average Daily Demand	11.8	115.6 / 481.7
Max Day + Fire Flow	19.9 + 150 = 169.9	106.4 / 391.4
Peak Hour	38.0	103.1 / 359.0

1) Water demand calculation per Water Supply Guidelines. See ***Appendix B*** for detailed calculations.
2) Boundary conditions supplied by the City of Ottawa. Assumed ground elevation ***65.50m***. See ***Appendix B.***

3.3 Fire Flow Requirements

Section 4.2.11 of the City Design guidelines for water distribution provides guidance for determining the method for estimating Fire Demand. As indicated, the requirements for levels of fire protection on private property are covered in the Ontario Building code. Section 7.2.11 of the OBC addresses the installation of water service pipes and fire service mains. Part 3 of the OBC outlines the requirement for Fire Protection, Occupant Safety, and Accessibility; and sub-section A-3.2.5.7 provides the provisions for fire fighting. Based on trained personnel responding to the emergency, and water supply being delivered through a municipal system, the required minimum provision for water supply shall not be less than 2,700L/min or greater than 9000L/min (OBC Section A.3.2.5.7, Table 2). Therefore, a conservative estimate for the required fire supply is 9000L/min (150L/s). A certified fire protection system specialist shall be employed to design the building fire suppression system(s) and confirm the actual fire flow demand.

City of Ottawa completed fire hydrant testing in ***2007***. The testing indicated that water supply is available between ***8,610/min*** and ***11,610L/min*** at ***140kPa***.

3.4 Water Supply Conclusion

Anticipated water demand under proposed conditions were submitted to the City of Ottawa for establishing boundary conditions considering the existing and proposed zoning.

As demonstrated in ***Table 4***, the recommended pressure range is respected during Maximum Day plus Fire Flow as well as Peak Hour demands. A pressure check should be conducted at the completion of construction to determine if pressure control is required.

© DSEL


CONNECTION 1
~360m TO NORTH STANDS
~395m TO EVENT CENTRE
NEW NORTH SIDE STANDS (PHASE 2)
EVENT CENTRE (PHASE 1)
~125m
~415m
CONNECTION 2
voie du Marché Way
Princess Patricia Way
prom. Queen Elizabeth Drwy.
Canal Rideau Canal
Wilton Cres.
Clarey Ave.

Table A1 - 200mm Fire Service Pipe Sizing

WATERMAIN SIZING CALCULATIONS					COMMENTS
Average Day Flow:					
Project Area		Ha			
ADF_{BLDG} =	467,424	L/d	=	5.41 L/s	As per City of Ottawa Water Distribution Guidelines and Existing Consumption Data from Lansdowne 1.0
ADF_{TOTAL} =	467,424	L/d	=	5.41 L/s	Sum of ADF
Maximum Day Flow:					
Maximum Day Factor =	2.50				
MDF_{BLDG} =	1,168,128	L/d	=	13.52 L/s	As per City of Ottawa Water Distribution Guidelines and Existing Consumption Data from Lansdowne 1.0
MDF_{TOTAL} =	1,168,128	L/d	=	13.52 L/s	Sum of MDF
Peak Hour Flow:					
Peak Hour Factor =	2.20				
PHF_{BLDG} =	2,568,672	L/d	=	29.73 L/s	As per City of Ottawa Water Distribution Guidelines and Existing Consumption Data from Lansdowne 1.0
PHF_{TOTAL} =	2,568,672	L/d	=	29.73 L/s	Sum of PHF
Fire Flow =	83	L/s			The FUS (2020) calculated Fire Flow
Max Day + Fire Flow > Peak Hour Flow =	97	L/s	>	29.73 L/s	Max Day + Fire Flow for sizing calculations - Note: No upgrade to existing network Required
Maximum Pressure =	552	kPa			As per City of Ottawa Water Distribution Guidelines
Minimum Pressure =	276	kPa			As per City of Ottawa Water Distribution Guidelines
Minimum Pressure under Fire Flow =	140	kPa			As per City of Ottawa Water Distribution Guidelines
Existing Static Pressure =	481	kPa			Boundary Condition provided by City at Holmwood Ave
Existing Residual Pressure =	415	kPa			Boundary Condition provided by City at Holmwood Ave
Hazen-Williams Equation Parameters					
Design Flow =	97	L/s			MDF + Fire Flow from above
Length =	395	m			Measured (length from the Holmwood Watermain to Building Connection)
C =	110				As per City of Ottawa Water Distribution Guidelines
Inside Diameter of Watermain =	204	mm			Assuming a PVC DR18 Watermain is used.
Solve for Friction Headloss =	21.17	m			Calculated using Hazen Williams Equation
Static Head =	1.80	m			Estimated elevation difference (from boundary connection to building)
Total Headloss =	22.97	m	=	225 kPa	
Residual Pressure for Site =	190	kPa	>	140 kPa	Existing Residual pressure minus total headloss

The residual pressure for the proposed building is calculated by subtracting the total headloss from the residual pressure measured on the connection on Holmwood Ave from City Boundary Condition. The residual pressure for the site is above the minimum pressure for the given pipe size.

To present a conservative scenario, the above calculations assume that the service connection must supply 100% of the building fire sprinkler demand and that the watermain would not be looped or interconnected.

Designed By: Ding Bang Yang, P.Eng.	**Project:** **Lansdowne Park 2.0 Redevelopment - Event Centre**
Checked By: Ding Bang Yang, P.Eng.	**Location:** **1015 Bank Street** **Ottawa, ON**
Project Number: CA0033920.1056	**Dwg. Reference:**

Table A2 - 200mm Domestic Service Pipe Sizing

WATERMAIN SIZING CALCULATIONS						COMMENTS
Average Day Flow:						
Project Area		Ha				
ADF_{BLDG} =	467,424	L/d	=	5.41	L/s	As per City of Ottawa Water Distribution Guidelines and Existing Consumption Data from Lansdowne 1.0
ADF_{TOTAL} =	467,424	L/d	=	5.41	L/s	Sum of ADF
Maximum Day Flow:						
Maximum Day Factor =	2.50					
MDF_{BLDG} =	1,168,128	L/d	=	13.52	L/s	As per City of Ottawa Water Distribution Guidelines and Existing Consumption Data from Lansdowne 1.0
MDF_{TOTAL} =	1,168,128	L/d	=	13.52	L/s	Sum of MDF
Peak Hour Flow:						
Peak Hour Factor =	2.20					
PHF_{BLDG} =	2,568,672	L/d	=	29.73	L/s	As per City of Ottawa Water Distribution Guidelines and Existing Consumption Data from Lansdowne 1.0
PHF_{TOTAL} =	2,568,672	L/d	=	29.73	L/s	Sum of PHF
Maximum Pressure =	552	kPa				As per City of Ottawa Water Distribution Guidelines
Minimum Pressure =	276	kPa				As per City of Ottawa Water Distribution Guidelines
Minimum Pressure under Fire Flow =	140	kPa				As per City of Ottawa Water Distribution Guidelines
Existing Static Pressure =	481	kPa				Boundary Condition provided by City at Holmwood Ave
Existing Residual Pressure =	394	kPa				Boundary Condition provided by City at Holmwood Ave
Hazen-Williams Equation Parameters						
Design Flow =	29.73	L/s				From above - Peak Hour Flow
Length =	395	m				Measured (length from the Holmwood Watermain to Building Connection)
C =	110					As per City of Ottawa Water Distribution Guidelines
Inside Diameter of Watermain =	204	mm				Assuming a PVC DR18 Watermain is used.
Solve for Friction Headloss =	2.39	m				Calculated using Hazen Williams Equation
Static Head =	1.80	m				Estimated elevation difference (from boundary connection to building)
Total Headloss =	4.19	m	=	41	kPa	
Residual Pressure for Site =	353	kPa	>	276	kPa	Existing Residual pressure minus total headloss

The residual pressure for the proposed building is calculated by subtracting the total headloss from the residual pressure measured on the connection on Holmwood Ave from City Boundary Condition. The residual pressure for the site is above the minimum pressure for the given pipe size.

To present a conservative scenario, the above calculations assume that the service connection must supply 100% of the building Peak Hour Flow and that the watermain would not be looped or interconnected.

Designed By: Ding Bang Yang, P.Eng.	**Project:** **Lansdowne Park 2.0 Redevelopment - Event Centre**
Checked By: Ding Bang Yang, P.Eng.	**Location:** **1015 Bank Street** **Ottawa, ON**
Project Number: CA0033920.1056	**Dwg. Reference:**

Table A3 - 200mm Fire Service Pipe Sizing

WATERMAIN SIZING CALCULATIONS						COMMENTS
Average Day Flow:						
Project Area		Ha				
ADF_{BLDG} =	467,424	L/d	=	5.41	L/s	As per City of Ottawa Water Distribution Guidelines and Existing Consumption Data from Lansdowne 1.0
ADF_{TOTAL} =	467,424	L/d	=	5.41	L/s	Sum of ADF
Maximum Day Flow:						
Maximum Day Factor =	2.50					
MDF_{BLDG} =	1,168,128	L/d	=	13.52	L/s	As per City of Ottawa Water Distribution Guidelines and Existing Consumption Data from Lansdowne 1.0
MDF_{TOTAL} =	1,168,128	L/d	=	13.52	L/s	Sum of MDF
Peak Hour Flow:						
Peak Hour Factor =	2.20					
PHF_{BLDG} =	2,568,672	L/d	=	29.73	L/s	As per City of Ottawa Water Distribution Guidelines and Existing Consumption Data from Lansdowne 1.0
PHF_{TOTAL} =	2,568,672	L/d	=	29.7	L/s	Sum of PHF
Fire Flow =	83	L/s				The FUS (2020) calculated Fire Flow
Max Day + Fire Flow > Peak Hour Flow =	96.5	L/s	>	29.7	L/s	Max Day + Fire Flow for sizing calculations - Note: No upgrade to existing network Required
Maximum Pressure =	552	kPa				As per City of Ottawa Water Distribution Guidelines
Minimum Pressure =	276	kPa				As per City of Ottawa Water Distribution Guidelines
Minimum Pressure under Fire Flow =	140	kPa				As per City of Ottawa Water Distribution Guidelines
Existing Static Pressure =	466	kPa				Boundary Condition provided by City at Bank Street
Existing Residual Pressure =	386	kPa				Boundary Condition provided by City at Bank Street
Hazen-Williams Equation Parameters						
Design Flow =	96.5	L/s				MDF + Fire Flow from above
Length =	415	m				Measured (length from the Bank Watermain to Building Connection)
C =	110					As per City of Ottawa Water Distribution Guidelines
Inside Diameter of Watermain =	204	mm				Assuming a PVC DR18 Watermain is used.
Solve for Friction Headloss =	22.24	m				Calculated using Hazen Williams Equation
Static Head =	0.20	m				Estimated elevation difference (from boundary connection to building)
Total Headloss =	22.44	m	=	220	kPa	
Residual Pressure for Site =	166	kPa	>	140	kPa	Existing Residual pressure minus total headloss

The residual pressure for the proposed building is calculated by subtracting the total headloss from the residual pressure measured on the connection on Bank Street from City Boundary Condition. The residual pressure for the site is above the minimum pressure for the given pipe size.

To present a conservative scenario, the above calculations assume that the service connection must supply 100% of the building fire sprinkler demand and that the watermain would not be looped or interconnected.

Designed By: Ding Bang Yang, P.Eng.	**Project:** **Lansdowne Park 2.0 Redevelopment - Event Centre**
Checked By: Ding Bang Yang, P.Eng.	**Location:** **1015 Bank Street** **Ottawa, ON**
Project Number: CA0033920.1056	**Dwg. Reference:**

Table A4 - 200mm Domestic Service Pipe Sizing

WATERMAIN SIZING CALCULATIONS						COMMENTS
Average Day Flow:						
Project Area		Ha				
ADF_{BLDG} =	467,424	L/d	=	5.41	L/s	As per City of Ottawa Water Distribution Guidelines and Existing Consumption Data from Lansdowne 1.0
ADF_{TOTAL} =	467,424	L/d	=	5.41	L/s	Sum of ADF
Maximum Day Flow:						
Maximum Day Factor =	2.50					
MDF_{BLDG} =	1,168,128	L/d	=	13.52	L/s	As per City of Ottawa Water Distribution Guidelines and Existing Consumption Data from Lansdowne 1.0
MDF_{TOTAL} =	1,168,128	L/d	=	13.52	L/s	Sum of MDF
Peak Hour Flow:						
Peak Hour Factor =	2.20					
PHF_{BLDG} =	2,568,672	L/d	=	29.73	L/s	As per City of Ottawa Water Distribution Guidelines and Existing Consumption Data from Lansdowne 1.0
PHF_{TOTAL} =	2,568,672	L/d	=	29.73	L/s	Sum of PHF
Maximum Pressure =	552	kPa				As per City of Ottawa Water Distribution Guidelines
Minimum Pressure =	276	kPa				As per City of Ottawa Water Distribution Guidelines
Minimum Pressure under Fire Flow =	140	kPa				As per City of Ottawa Water Distribution Guidelines
Existing Static Pressure =	466	kPa				Boundary Condition provided by City at Bank Street
Existing Residual Pressure =	378	kPa				Boundary Condition provided by City at Bank Street
Hazen-Williams Equation Parameters						
Design Flow =	29.73	L/s				From above - Peak Hour Flow
Length =	415	m				Measured (length from the Bank Watermain to Building Connection)
C =	110					As per City of Ottawa Water Distribution Guidelines
Inside Diameter of Watermain =	204	mm				Assuming a PVC DR18 Watermain is used.
Solve for Friction Headloss =	2.51	m				Calculated using Hazen Williams Equation
Static Head =	0.20	m				Estimated elevation difference (from boundary connection to building)
Total Headloss =	2.71	m	=	27	kPa	
Residual Pressure for Site =	351	kPa	>	276	kPa	Existing Residual pressure minus total headloss

The residual pressure for the proposed building is calculated by subtracting the total headloss from the residual pressure measured on the connection on Bank Street from City Boundary Condition. The residual pressure for the site is above the minimum pressure for the given pipe size.

To present a conservative scenario, the above calculations assume that the service connection must supply 100% of the building Peak Hour Flow and that the watermain would not be looped or interconnected.

Designed By: Ding Bang Yang, P.Eng.	**Project:** **Lansdowne Park 2.0 Redevelopment - Event Centre**
Checked By: Ding Bang Yang, P.Eng.	**Location:** **1015 Bank Street** **Ottawa, ON**
Project Number: CA0033920.1056	**Dwg. Reference:**

Table B1 - 200mm Fire Service Pipe Sizing

WATERMAIN SIZING CALCULATIONS						COMMENTS
Average Day Flow:						
Project Area		Ha				
ADF_{BLDG} =	467,424	L/d	=	5.41	L/s	As per City of Ottawa Water Distribution Guidelines and Existing Consumption Data from Lansdowne 1.0
ADF_{TOTAL} =	467,424	L/d	=	5.41	L/s	Sum of ADF
Maximum Day Flow:						
Maximum Day Factor =	2.50					
MDF_{BLDG} =	1,168,128	L/d	=	13.52	L/s	As per City of Ottawa Water Distribution Guidelines and Existing Consumption Data from Lansdowne 1.0
MDF_{TOTAL} =	1,168,128	L/d	=	13.52	L/s	Sum of MDF
Peak Hour Flow:						
Peak Hour Factor =	2.20					
PHF_{BLDG} =	2,568,672	L/d	=	29.73	L/s	As per City of Ottawa Water Distribution Guidelines and Existing Consumption Data from Lansdowne 1.0
PHF_{TOTAL} =	2,568,672	L/d	=	29.7	L/s	Sum of PHF
Fire Flow =	100	L/s				The FUS (2020) calculated Fire Flow
Max Day + Fire Flow > Peak Hour Flow =	114	L/s	>	29.7	L/s	Max Day + Fire Flow for sizing calculations - Note: No upgrade to existing network Required
Maximum Pressure =	552	kPa				As per City of Ottawa Water Distribution Guidelines
Minimum Pressure =	276	kPa				As per City of Ottawa Water Distribution Guidelines
Minimum Pressure under Fire Flow =	140	kPa				As per City of Ottawa Water Distribution Guidelines
Existing Static Pressure =	481	kPa				Boundary Condition provided by City at Holmwood Ave
Existing Residual Pressure =	415	kPa				Boundary Condition provided by City at Holmwood Ave
Hazen-Williams Equation Parameters						
Design Flow =	114	L/s				MDF + Fire Flow from above
Length =	360	m				Measured (length from the Holmwood Watermain to Building Connection)
C =	110					As per City of Ottawa Water Distribution Guidelines
Inside Diameter of Watermain =	204	mm				Assuming a PVC DR18 Watermain is used.
Solve for Friction Headloss =	26.06	m				Calculated using Hazen Williams Equation
Static Head =	0.50	m				Estimated elevation difference (from boundary connection to building)
Total Headloss =	26.56	m	=	261	kPa	
Residual Pressure for Site =	154	kPa	>	140	kPa	Existing Residual pressure minus total headloss

The residual pressure for the proposed building is calculated by subtracting the total headloss from the residual pressure measured on the connection on Holmwood Ave from City Boundary Condition. The residual pressure for the site is above the minimum pressure for the given pipe size.

To present a conservative scenario, the above calculations assume that the service connection must supply 100% of the building fire sprinkler demand and that the watermain would not be looped or interconnected.

Designed By: Ding Bang Yang, P.Eng.	**Project:** **Lansdowne Park 2.0 Redevelopment - New North Stand**
Checked By: Ding Bang Yang, P.Eng.	**Location:** **1015 Bank Street** **Ottawa, ON**
Project Number: CA0033920.1056	**Dwg. Reference:**

Table B2 - 200mm Domestic Service Pipe Sizing

WATERMAIN SIZING CALCULATIONS						COMMENTS
Average Day Flow:						
Project Area		Ha				
ADF_{BLDG} =	467,424	L/d	=	5.41	L/s	As per City of Ottawa Water Distribution Guidelines and Existing Consumption Data from Lansdowne 1.0
ADF_{TOTAL} =	467,424	L/d	=	5.41	L/s	Sum of ADF
Maximum Day Flow:						
Maximum Day Factor =	2.50					
MDF_{BLDG} =	1,168,128	L/d	=	13.52	L/s	As per City of Ottawa Water Distribution Guidelines and Existing Consumption Data from Lansdowne 1.0
MDF_{TOTAL} =	1,168,128	L/d	=	13.52	L/s	Sum of MDF
Peak Hour Flow:						
Peak Hour Factor =	2.20					
PHF_{BLDG} =	2,568,672	L/d	=	29.73	L/s	As per City of Ottawa Water Distribution Guidelines and Existing Consumption Data from Lansdowne 1.0
PHF_{TOTAL} =	2,568,672	L/d	=	29.7	L/s	Sum of PHF
Maximum Pressure =	552	kPa				As per City of Ottawa Water Distribution Guidelines
Minimum Pressure =	276	kPa				As per City of Ottawa Water Distribution Guidelines
Minimum Pressure under Fire Flow =	140	kPa				As per City of Ottawa Water Distribution Guidelines
Existing Static Pressure =	481	kPa				Boundary Condition provided by City at Holmwood Ave
Existing Residual Pressure =	394	kPa				Boundary Condition provided by City at Holmwood Ave
Hazen-Williams Equation Parameters						
Design Flow =	29.7	L/s				From above - Peak Hour Flow
Length =	360	m				Measured (length from the Holmwood Watermain to Building Connection)
C =	110					As per City of Ottawa Water Distribution Guidelines
Inside Diameter of Watermain =	204	mm				Assuming a PVC DR18 Watermain is used.
Solve for Friction Headloss =	2.18	m				Calculated using Hazen Williams Equation
Static Head =	0.50	m				Estimated elevation difference (from boundary connection to building)
Total Headloss =	2.68	m	=	26	kPa	
Residual Pressure for Site =	368	kPa	>	276	kPa	Existing Residual pressure minus total headloss

The residual pressure for the proposed building is calculated by subtracting the total headloss from the residual pressure measured on the connection on Holmwood Ave from City Boundary Condition. The residual pressure for the site is above the minimum pressure for the given pipe size.

To present a conservative scenario, the above calculations assume that the service connection must supply 100% of the building Peak Hour Flow and that the watermain would not be looped or interconnected.

Designed By: Ding Bang Yang, P.Eng.	**Project:** **Lansdowne Park 2.0 Redevelopment - New North Stand**
Checked By: Ding Bang Yang, P.Eng.	**Location:** **1015 Bank Street** **Ottawa, ON**
Project Number: CA0033920.1056	**Dwg. Reference:**

Table A3 - 200mm Fire Service Pipe Sizing

WATERMAIN SIZING CALCULATIONS						COMMENTS
Average Day Flow:						
Project Area		Ha				
ADF_{BLDG} =	467,424	L/d	=	5.41	L/s	As per City of Ottawa Water Distribution Guidelines and Existing Consumption Data from Lansdowne 1.0
ADF_{TOTAL} =	467,424	L/d	=	5.41	L/s	Sum of ADF
Maximum Day Flow:						
Maximum Day Factor =	2.50					
MDF_{BLDG} =	1,168,128	L/d	=	13.52	L/s	As per City of Ottawa Water Distribution Guidelines and Existing Consumption Data from Lansdowne 1.0
MDF_{TOTAL} =	1,168,128	L/d	=	13.52	L/s	Sum of MDF
Peak Hour Flow:						
Peak Hour Factor =	2.20					
PHF_{BLDG} =	2,568,672	L/d	=	29.73	L/s	As per City of Ottawa Water Distribution Guidelines and Existing Consumption Data from Lansdowne 1.0
PHF_{TOTAL} =	2,568,672	L/d	=	29.7	L/s	Sum of PHF
Fire Flow =	100.0	L/s				The FUS (2020) calculated Fire Flow
Max Day + Fire Flow > Peak Hour Flow =	113.5	L/s	>	29.73	L/s	Max Day + Fire Flow for sizing calculations - Note: No upgrade to existing network Required
Maximum Pressure =	552	kPa				As per City of Ottawa Water Distribution Guidelines
Minimum Pressure =	276	kPa				As per City of Ottawa Water Distribution Guidelines
Minimum Pressure under Fire Flow =	140	kPa				As per City of Ottawa Water Distribution Guidelines
Existing Static Pressure =	466	kPa				Boundary Condition provided by City at Bank Street
Existing Residual Pressure =	386	kPa				Boundary Condition provided by City at Bank Street
Hazen-Williams Equation Parameters						
Design Flow =	113.5	L/s				MDF + Fire Flow from above
Length =	125	m				Measured (length from the Bank Watermain to Building Connection)
C =	110					As per City of Ottawa Water Distribution Guidelines
Inside Diameter of Watermain =	204	mm				Assuming a PVC DR18 Watermain is used.
Solve for Friction Headloss =	9.05	m				Calculated using Hazen Williams Equation
Static Head =	0.50	m				Estimated elevation difference (from boundary connection to building)
Total Headloss =	9.55	m	=	94	kPa	
Residual Pressure for Site =	292	kPa	>	140	kPa	Existing Residual pressure minus total headloss

The residual pressure for the proposed building is calculated by subtracting the total headloss from the residual pressure measured on the connection on Bank Street from City Boundary Condition. The residual pressure for the site is above the minimum pressure for the given pipe size.

To present a conservative scenario, the above calculations assume that the service connection must supply 100% of the building fire sprinkler demand and that the watermain would not be looped or interconnected.

Designed By: Ding Bang Yang, P.Eng.	**Project:** **Lansdowne Park 2.0 Redevelopment - New North Stand**
Checked By: Ding Bang Yang, P.Eng.	**Location:** **1015 Bank Street** **Ottawa, ON**
Project Number: CA0033920.1056	**Dwg. Reference:**


Table A4 - 200mm Domestic Service Pipe Sizing

WATERMAIN SIZING CALCULATIONS						COMMENTS
Average Day Flow:						
Project Area		Ha				
ADF_{BLDG} =	467,424	L/d	=	5.41	L/s	As per City of Ottawa Water Distribution Guidelines and Existing Consumption Data from Lansdowne 1.0
ADF_{TOTAL} =	467,424	L/d	=	5.41	L/s	Sum of ADF
Maximum Day Flow:						
Maximum Day Factor =	2.50					
MDF_{BLDG} =	1,168,128	L/d	=	13.52	L/s	As per City of Ottawa Water Distribution Guidelines and Existing Consumption Data from Lansdowne 1.0
MDF_{TOTAL} =	1,168,128	L/d	=	13.52	L/s	Sum of MDF
Peak Hour Flow:						
Peak Hour Factor =	2.20					
PHF_{BLDG} =	2,568,672	L/d	=	29.73	L/s	As per City of Ottawa Water Distribution Guidelines and Existing Consumption Data from Lansdowne 1.0
PHF_{TOTAL} =	2,568,672	L/d	=	29.7	L/s	Sum of PHF
Maximum Pressure =	552	kPa				As per City of Ottawa Water Distribution Guidelines
Minimum Pressure =	276	kPa				As per City of Ottawa Water Distribution Guidelines
Minimum Pressure under Fire Flow =	140	kPa				As per City of Ottawa Water Distribution Guidelines
Existing Static Pressure =	466	kPa				Boundary Condition provided by City at Bank Street
Existing Residual Pressure =	378	kPa				Boundary Condition provided by City at Bank Street
Hazen-Williams Equation Parameters						
Design Flow =	29.7	L/s				From above - Peak Hour Flow
Length =	100	m				Measured (length from the Bank Watermain to Building Connection)
C =	110					As per City of Ottawa Water Distribution Guidelines
Inside Diameter of Watermain =	204	mm				Assuming a PVC DR18 Watermain is used.
Solve for Friction Headloss =	0.76	m				Calculated using Hazen Williams Equation
Static Head =	0.50	m				Estimated elevation difference (from boundary connection to building)
Total Headloss =	1.26	m	=	12	kPa	
Residual Pressure for Site =	365	kPa	>	276	kPa	Existing Residual pressure minus total headloss

The residual pressure for the proposed building is calculated by subtracting the total headloss from the residual pressure measured on the connection on Bank Street from City Boundary Condition. The residual pressure for the site is above the minimum pressure for the given pipe size.

To present a conservative scenario, the above calculations assume that the service connection must supply 100% of the building Peak Hour Flow and that the watermain would not be looped or interconnected.

Designed By: Ding Bang Yang, P.Eng.	**Project:** **Lansdowne Park 2.0 Redevelopment - New North Stand**
Checked By: Ding Bang Yang, P.Eng.	**Location:** **1015 Bank Street** **Ottawa, ON**
Project Number: CA0033920.1056	**Dwg. Reference:**

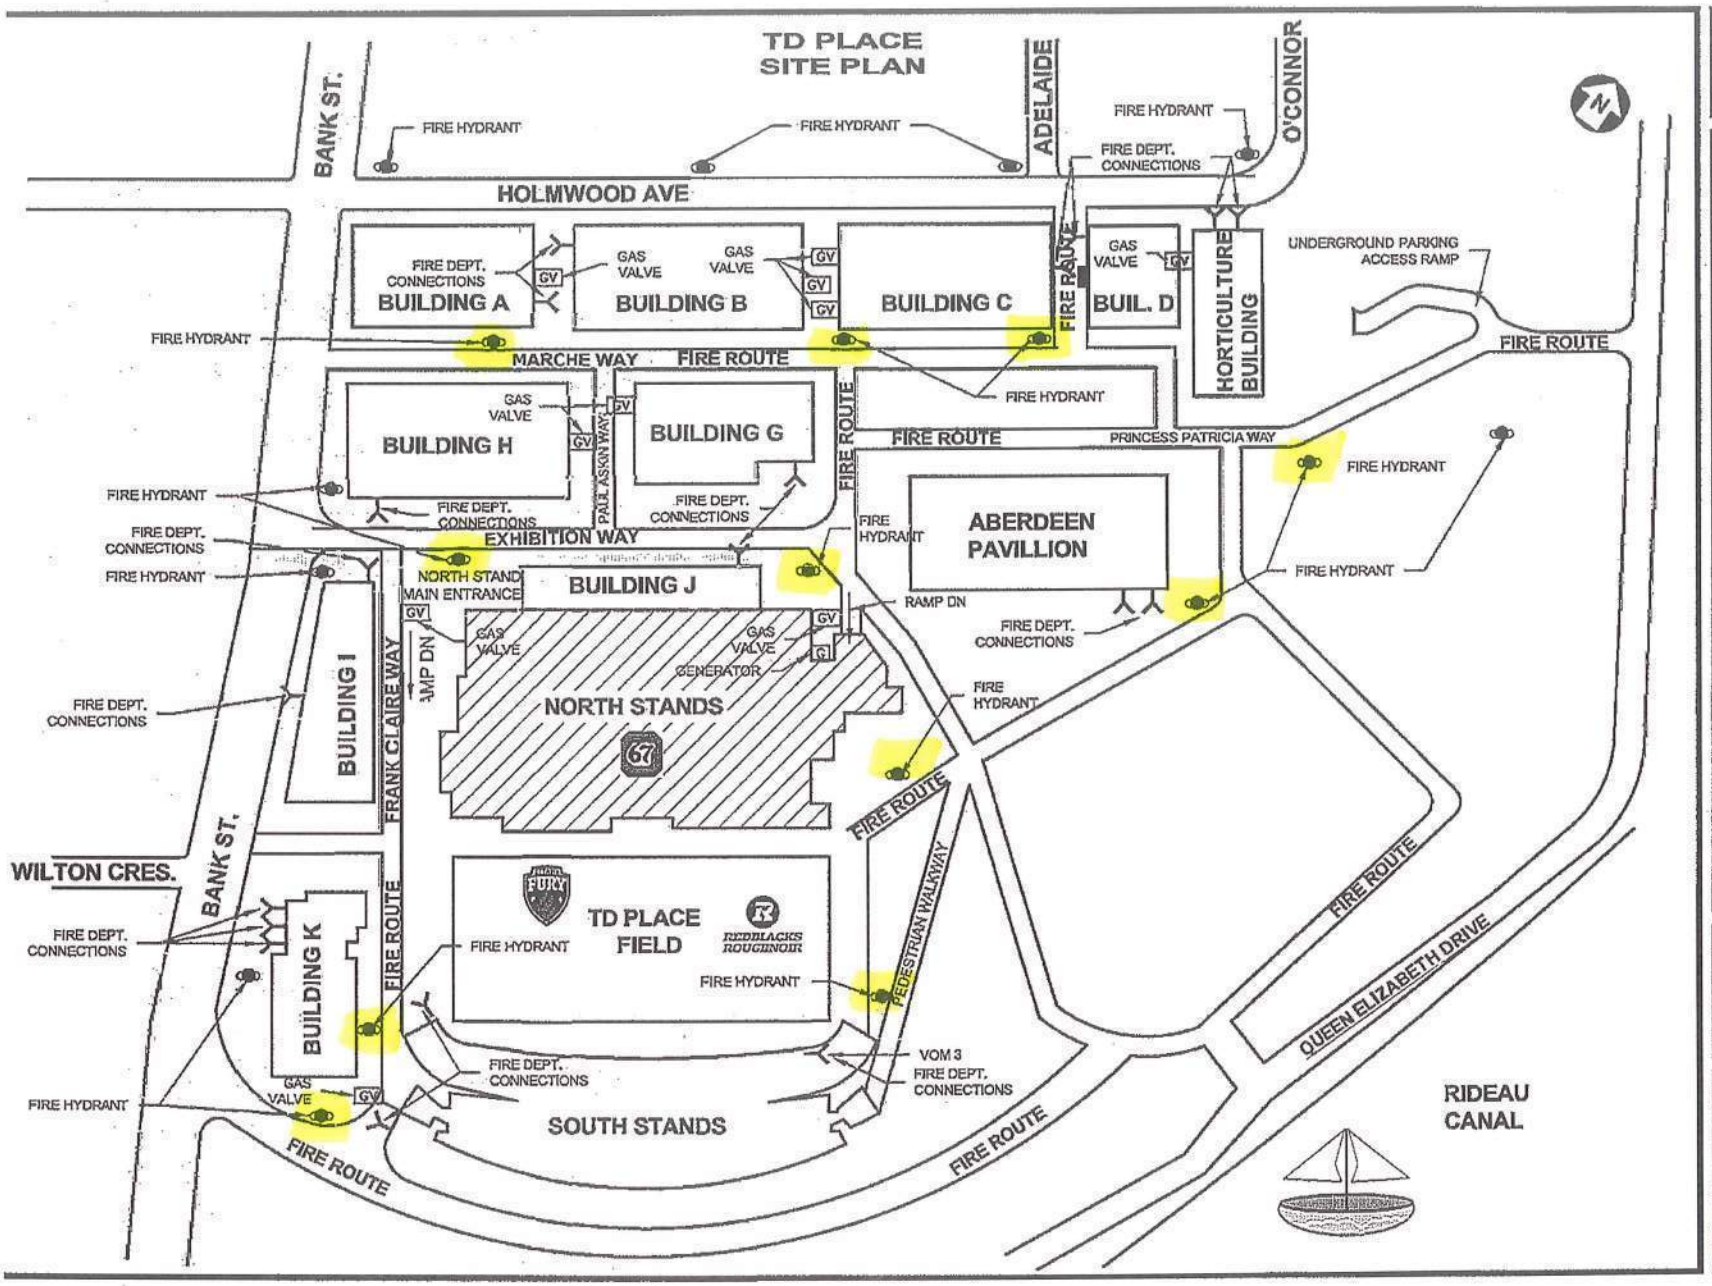

LEGEND.

- FIRE DEPT. CONNECTION
- FIRE HYDRANT
- GV GAS VALVE
- G GENERATOR

FIRE SAFETY PLAN

SITE PLAN

TD PLACE NORTH STANDS
OTTAWA,ONTARIO

NOT TO SCALE

MAY 2014

HYDRANTS-R-US Inc.

Hydrants-R-Us Inc.
53 Forest Creek Drive
K2S 1M1
613-804-0088
dalton@hydrantsrus.com

Sept 20th 2022

HYDRANT INSPECTION REPORT

Owner: **Ottawa Sports and Entertainment Group (TD PLACE)**

Hydrant Location: **Apartment Facing Field** **Hydrant Type: DARLING**

Paint: **Paint to code**
Stem: **OK**
O-Rings: **OK**
Top Nut: **OK**
Valve Seat: **OK**
Condition of Water: **Normal**
Isolation Valve: **OK**
Flow test: **Complete**
Caps:**OK**

Residual Hydrant Static Pressure: **68 PSI**
Residual Hydrant Flowing Pressure:**62 PSI**
Flowing Hydrant Pitot Pressure: **39 PSI**

Number of Ports Flowed: **1**
Nozzle Size: **2 ½ in.**

Gallons Per Minute**: 875**
Gallons Per Minute at 20 PSI: **2689**
Color Code: BLUE

Remarks: OK

HYDRANTS-R-US Inc.

Hydrants-R-Us Inc.
53 Forest Creek Drive
K2S 1M1
613-804-0088
dalton@hydrantsrus.com

Sept 20th 2022

HYDRANT INSPECTION REPORT

Owner: **Ottawa Sports and Entertainment Group (TD PLACE)**

Hydrant Location: **Back Entrance** **Hydrant Type: McAvity**

Paint: **Paint to code**
Stem: **OK**
O-Rings: **OK**
Top Nut: **OK**
Valve Seat: **OK**
Condition of Water: **Normal**
Isolation Valve: **OK**
Flow test: **Complete**
Caps:**OK**

Residual Hydrant Static Pressure: **70 PSI**
Residual Hydrant Flowing Pressure:**62 PSI**
Flowing Hydrant Pitot Pressure: **44 PSI**

Number of Ports Flowed: **1**
Nozzle Size: **2 ½ in.**

Gallons Per Minute**: 929**
Gallons Per Minute at 20 PSI: **2499**
Color Code: BLUE

Remarks: OK

HYDRANTS-R-US Inc.

Hydrants-R-Us Inc.
53 Forest Creek Drive
K2S 1M1
613-804-0088
dalton@hydrantsrus.com

Sept 20th 2022

HYDRANT INSPECTION REPORT

Owner: **Ottawa Sports and Entertainment Group (TD PLACE)**

Hydrant Location: **Behind Apartment (Bank St)** **Hydrant Type: DARLING**

Paint: **Paint to code**
Stem: **OK**
O-Rings: **OK**
Top Nut: **OK**
Valve Seat: **OK**
Condition of Water: **Normal**
Isolation Valve: **OK**
Flow test: **Complete**
Caps:**OK**

Residual Hydrant Static Pressure: **70 PSI**
Residual Hydrant Flowing Pressure:**61 PSI**
Flowing Hydrant Pitot Pressure: **41 PSI**

Number of Ports Flowed: **1**
Nozzle Size: **2 ½ in.**

Gallons Per Minute**: 897**
Gallons Per Minute at 20 PSI: **2264**
Color Code: BLUE

Remarks: OK

HYDRANTS-R-US Inc.

Hydrants-R-Us Inc.
53 Forest Creek Drive
K2S 1M1
613-804-0088
dalton@hydrantsrus.com

Sept 20th 2022

HYDRANT INSPECTION REPORT

Owner: **Ottawa Sports and Entertainment Group (TD PLACE)**

Hydrant Location: **Behind Apartment (Parkway)** **Hydrant Type: DARLING**

Paint: **Paint to code**
Stem: **OK**
O-Rings: **OK**
Top Nut: **OK**
Valve Seat: **OK**
Condition of Water: **Normal**
Isolation Valve: **OK**
Flow test: **Complete**
Caps:**OK**

Residual Hydrant Static Pressure: **70 PSI**
Residual Hydrant Flowing Pressure:**62 PSI**
Flowing Hydrant Pitot Pressure: **38 PSI**

Number of Ports Flowed: **1**
Nozzle Size: **2 ½ in.**

Gallons Per Minute**: 863**
Gallons Per Minute at 20 PSI: **2323**
Color Code: BLUE

Remarks: OK

HYDRANTS-R-US Inc.

Hydrants-R-Us Inc.
53 Forest Creek Drive
K2S 1M1
613-804-0088
dalton@hydrantsrus.com

Sept 20th 2022

HYDRANT INSPECTION REPORT

Owner: **Ottawa Sports and Entertainment Group (TD PLACE)**

Hydrant Location: **Box Office** **Hydrant Type: McAvity**

Paint: **OK**
Stem: **OK**
O-Rings: **OK**
Top Nut: **OK**
Valve Seat: **OK**
Condition of Water: **Normal**
Isolation Valve: **Buried**
Flow test: **Complete**
Caps:**OK**

Residual Hydrant Static Pressure: **68 PSI**
Residual Hydrant Flowing Pressure:**62 PSI**
Flowing Hydrant Pitot Pressure: **42 PSI**

Number of Ports Flowed: **1**
Nozzle Size: **2 ½ in.**

Gallons Per Minute**: 908**
Gallons Per Minute at 20 PSI: **2790**
Color Code: BLUE

Remarks: OK
Isolation valve-could not locate

HYDRANTS-R-US Inc.

Hydrants-R-Us Inc.
53 Forest Creek Drive
K2S 1M1
613-804-0088
dalton@hydrantsrus.com

Sept 20th 2022

HYDRANT INSPECTION REPORT

Owner: **Ottawa Sports and Entertainment Group (TD PLACE)**

Hydrant Location: **Cattle Castle** **Hydrant Type: McAvity**

Paint: **Paint to code**
Stem: **OK**
O-Rings: **OK**
Top Nut: **OK**
Valve Seat: **OK**
Condition of Water: **Normal**
Isolation Valve: **OK**
Flow test: **Complete**
Caps:**OK**

Residual Hydrant Static Pressure: **70 PSI**
Residual Hydrant Flowing Pressure:**62 PSI**
Flowing Hydrant Pitot Pressure: **38 PSI**

Number of Ports Flowed: **1**
Nozzle Size: **2 ½ in.**

Gallons Per Minute**: 863**
Gallons Per Minute at 20 PSI: **2323**
Color Code: BLUE

Remarks: OK

HYDRANTS-R-US Inc.

Hydrants-R-Us Inc.
53 Forest Creek Drive
K2S 1M1
613-804-0088
dalton@hydrantsrus.com

Sept 20th 2022

HYDRANT INSPECTION REPORT

Owner: **Ottawa Sports and Entertainment Group (TD PLACE)**

Hydrant Location: **Cineplex** **Hydrant Type: DARLING**

Paint: **OK**
Stem: **OK**
O-Rings: **OK**
Top Nut: **OK**
Valve Seat: **OK**
Condition of Water: **Normal**
Isolation Valve: **OK**
Flow test: **Complete**
Caps:**OK**

Residual Hydrant Static Pressure: **66 PSI**
Residual Hydrant Flowing Pressure:**61 PSI**
Flowing Hydrant Pitot Pressure: **38 PSI**

Number of Ports Flowed: **1**
Nozzle Size: **2 ½ in.**

Gallons Per Minute**: 86**
Gallons Per Minute at 20 PSI: **2739**
Color Code: BLUE

Remarks: OK

HYDRANTS-R-US Inc.

Hydrants-R-Us Inc.
53 Forest Creek Drive
K2S 1M1
613-804-0088
dalton@hydrantsrus.com

Sept 20th 2022

HYDRANT INSPECTION REPORT

Owner: **Ottawa Sports and Entertainment Group (TD PLACE)**

Hydrant Location: **Field Entrance** **Hydrant Type: McAvity**

Paint: **Paint to code**
Stem: **OK**
O-Rings: **OK**
Top Nut: **OK**
Valve Seat: **OK**
Condition of Water: **Normal**
Isolation Valve: **Partially Paved over**
Flow test: **Complete**
Caps:**OK**

Residual Hydrant Static Pressure: **70 PSI**
Residual Hydrant Flowing Pressure:**60 PSI**
Flowing Hydrant Pitot Pressure: **39 PSI**

Number of Ports Flowed: **1**
Nozzle Size: **2 ½ in.**

Gallons Per Minute**: 875**
Gallons Per Minute at 20 PSI: **2086**
Color Code: BLUE

Remarks: OK

HYDRANTS-R-US Inc.

Hydrants-R-Us Inc.
53 Forest Creek Drive
K2S 1M1
613-804-0088
dalton@hydrantsrus.com

Sept 20th 2022

HYDRANT INSPECTION REPORT

Owner: **Ottawa Sports and Entertainment Group (TD PLACE)**

Hydrant Location: **On Field** **Hydrant Type: McAvity**

Paint: **OK**
Stem: **OK**
O-Rings: **OK**
Top Nut: **OK**
Valve Seat: **OK**
Condition of Water: **Normal**
Isolation Valve: **OK**
Flow test: **Complete**
Caps:**OK**

Residual Hydrant Static Pressure: **70 PSI**
Residual Hydrant Flowing Pressure:**62 PSI**
Flowing Hydrant Pitot Pressure: **43 PSI**

Number of Ports Flowed: **1**
Nozzle Size: **2 ½ in.**

Gallons Per Minute**: 918**
Gallons Per Minute at 20 PSI: **2471**
Color Code: BLUE

Remarks: OK

HYDRANTS-R-US Inc.

Hydrants-R-Us Inc.
53 Forest Creek Drive
K2S 1M1
613-804-0088
dalton@hydrantsrus.com

Sept 20th 2022

HYDRANT INSPECTION REPORT

Owner: **Ottawa Sports and Entertainment Group (TD PLACE)**

Hydrant Location: **Goodlife** **Hydrant Type: Darling**

Paint: **OK**
Stem: **OK**
O-Rings: **OK**
Top Nut: **OK**
Valve Seat: **OK**
Condition of Water: **Normal**
Isolation Valve: **OK**
Flow test: **Complete**
Caps:**OK**

Residual Hydrant Static Pressure: **67 PSI**
Residual Hydrant Flowing Pressure:**60 PSI**
Flowing Hydrant Pitot Pressure: **37 PSI**

Number of Ports Flowed: **1**
Nozzle Size: **2 ½ in.**

Gallons Per Minute**: 852**
Gallons Per Minute at 20 PSI: **2382**
Color Code: BLUE

Remarks: OK

HYDRANTS-R-US Inc.

Hydrants-R-Us Inc.
53 Forest Creek Drive
K2S 1M1
613-804-0088
dalton@hydrantsrus.com

Sept 20th 2022

HYDRANT INSPECTION REPORT

Owner: **Ottawa Sports and Entertainment Group (TD PLACE)**

Hydrant Location: **Milestones** **Hydrant Type: DARLING**

Paint: **OK**
Stem: **OK**
O-Rings: **OK**
Top Nut: **OK**
Valve Seat: **OK**
Condition of Water: **Normal**
Isolation Valve: **OK**
Flow test: **Complete**
Caps:**OK**

Residual Hydrant Static Pressure: **67 PSI**
Residual Hydrant Flowing Pressure:**62 PSI**
Flowing Hydrant Pitot Pressure: **34 PSI**

Number of Ports Flowed: **1**
Nozzle Size: **2 ½ in.**

Gallons Per Minute**: 817**
Gallons Per Minute at 20 PSI: **2739**
Color Code: BLUE

Remarks: OK

HYDRANTS-R-US Inc.

Hydrants-R-Us Inc.
53 Forest Creek Drive
K2S 1M1
613-804-0088
dalton@hydrantsrus.com

Sept 20th 2022

HYDRANT INSPECTION REPORT

Owner: **Ottawa Sports and Entertainment Group (TD PLACE)**

Hydrant Location: **Sporting Life** **Hydrant Type: DARLING**

Paint: **OK**
Stem: **OK**
O-Rings: **OK**
Top Nut: **OK**
Valve Seat: **OK**
Condition of Water: **Normal**
Isolation Valve: **Partially Paved Over**
Flow test: **Complete**
Caps:**OK**

Residual Hydrant Static Pressure: **65 PSI**
Residual Hydrant Flowing Pressure:**58 PSI**
Flowing Hydrant Pitot Pressure: **41 PSI**

Number of Ports Flowed: **1**
Nozzle Size: **2 ½ in.**

Gallons Per Minute**: 897**
Gallons Per Minute at 20 PSI: **2450**
Color Code: BLUE

Remarks: OK



LEGEND

- FIRE HYDRANT
- HYDRANT COVERAGE (75m RADIUS)

Meters
22.5 0 22.5 45
1:750

DATE PLOTTED:

Ottawa

OSEG
Ottawa Sports and Entertainment Group

BRISBIN BROOK BEYNON ARCHITECTS
14 DUNCAN ST 4TH FLOOR
TORONTO, ON M5H 3G8
(416) 591-8999
ARCHITECT

ENTUITIVE
135 LAURIER AVE WEST, SUITE 413
OTTAWA, ON K1P 5J2
(343) 308-9274
STRUCTURAL ENGINEER

TMP
200 KING. ST. WEST, SUITE 310
TORONTO, ON M5H 3T4
(416) 499-8000
MECH, PLUMB, FIRE PROTECTION ENGINEER

MULVEY & BANANI
90 SHEPPARD AVE EAST, SUITE 500
TORONTO, ON M2N 3A
(416) 751-2520
ELEC, LIGHTING ENGINEER

S2O
530 N. WOOD STREET #C
CHICAGO, IL 60622
(224) 717-1999
FOOD AND BEVERAGE

CSW
319 MCRAE AVENUE, SUITE 502
OTTAWA, ONTARIO K1Z 0B9
(613) 729-4536
LANDSCAPE ARCHITECT

wsp
2011 QUEENSVIEW DR.
OTTAWA, ONTARIO K2B 8K2
(613) 829-2800
CIVIL ENGINEER

NO.	DESCRIPTION	DATE

REVISIONS/ ISSUES

CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ANY OMISSIONS OR DISCREPANCIES TO THE ARCHITECT BEFORE PROCEEDING WITH THE WORK.
DO NOT SCALE THE DRAWINGS



SEAL

DRAWN	J.T
DATE	2024/08/07
CHECKED	W.Y

LANSDOWNE EC

DWG. TITLE
HYDRANT COVERAGE SKETCH

SCALE	DWG. NO.
1:750	F01
PROJ. NO.	
CA0033920.1056	

APPENDIX

C

- STORM SEWER DESIGN SHEET
- DWG C08 – STORM DRAINAGE AREA PLAN
- EXISTING STORM SEWER DESIGN SHEET AND DRAINAGE AREA PLAN BY STANTEC
- SANITARY SEWER DESIGN SHEET
- EXISTING SANITARY DESIGN SHEET BY DSEL
- CORRESPONDANCE
- DWG C04 – GRADING PLANS
- DWG C05A/C05B – SERVICING PLANS

STORM SEWER DESIGN SHEET
LANSDOWNE 2.0
REDEVELOPMENT
CITY OF OTTAWA
Project: CA0033920.1056
Date: February 2025

LOCATION				AREA (Ha)						RATIONAL DESIGN FLOW												PROPSOED SEWER DATA								
BLDG FLOW	AREA ID	FROM	TO	C= 0.20	C= 0.35	C= 0.75	C= 0.80	C= 0.90	C= 1.00	IND 2.78AC	CUM 2.78 AC	INLET (min)	TOTAL (min)	i (2) (mm/hr)	i (5) (mm/hr)	i (100) (mm/hr)	BLDG FLOW (L/s)	2yr PEAK FLOW (L/s)	5yr PEAK FLOW (L/s)	100yr PEAK FLOW (L/s)	ICD FIXED FLOW (L/s)	DESIGN FLOW (L/s)	MODIFIED DESIGN FLOW (L/s)	MATERIAL PIPE	SIZE (mm)	SLOPE (%)	LENGTH (m)	CAPACITY (l/s)	VELOCITY (m/s)	TIME IN PIPE	AVAIL CAP (2yr) (L/s)	AVAIL CAP (2yr) (%)
Lansdowne 2.0																															
+106 l/s	*S. STANDS 1 & S. STANDS 2*	*Ex. STM 120*	*Ex. STM 119*							0.000	0.000	20.00	21.24	52.03	70.25	119.95			0.00			0.00	106.00	CONC	*450.0*	*0.20*	*59.60*	127.63	0.80	1.24	21.63	16.95%
		Ex. STM 119	*Ex. STM 118*							0.000	0.000	21.24	22.48	50.12	67.64	115.46			0.00			0.00	106.00	CONC	*450.0*	*0.20*	*59.60*	127.63	0.80	1.24	21.63	16.95%
+106 l/s		*Ex. STM 118*	*Ex. STM 117*							0.000	0.000	22.48	22.63	48.36	65.24	111.33			0.00			0.00	212.00	CONC	*600.0*	*0.20*	*8.70*	274.87	0.97	0.15	62.87	22.87%
		Ex. STM 117	STMH 208							0.000	0.000	22.63	22.67	48.16	64.97	110.85			0.00			0.00	212.00	CONC	600.0	0.33	3.00	353.08	1.25	0.04	141.08	39.96%
+232.6 l/s	A3-1 to A3-7, A4-1 to A4-7, A5, BLDG I, K, N. STANDS AREAS (NS R1, NS R2, NS 4-1 to NS 4-7)	*Ex. STM 115*	*Ex. STM 114*	1.135				0.367		1.549	1.549	20.00	21.02	52.03	70.25	119.95			108.84			108.84	341.44	CONC	*825.0*	*0.20*	*73.70*	642.59	1.20	1.02	301.15	46.87%
		Ex. STM 114	STMH 209							0.000	1.549	21.02	22.06	50.44	68.08	116.22			105.48			105.48	338.08	CONC	*825.0*	*0.20*	*74.50*	642.59	1.20	1.03	304.51	47.39%
	NEC 1, NEC 3, A3-8	STMH 209	STMH 208	0.000				0.466		1.166	2.715	22.06	23.27	48.94	66.04	112.69			179.31			179.31	411.91	CONC	900.0	0.10	65.64	573.05	0.90	1.22	161.14	28.12%
$Q_{bldg\ Tot}$ = 444.6 l/s		STMH 208	STMH 207							0.000	2.715	23.27	23.70	47.30	63.80	108.84			173.23			173.23	617.83	CONC	1050.0	0.10	25.70	864.40	1.00	0.43	246.57	28.52%
		STMH 207	STMH 206							0.000	2.715	23.70	24.13	46.75	63.05	107.55			171.19			171.19	615.79	CONC	1050.0	0.10	25.40	864.40	1.00	0.42	248.61	28.76%
		STMH 206	STMH 205							0.000	2.715	24.13	24.56	46.22	62.33	106.31			169.23			169.23	613.83	CONC	1050.0	0.10	25.80	864.40	1.00	0.43	250.57	28.99%
	NEC 2	STMH 205	STMH 204	0.000				0.353		0.883	3.598	24.56	25.05	45.69	61.61	105.08			221.70			221.70	666.30	CONC	1050.0	0.10	29.50	864.40	1.00	0.49	198.10	22.92%
		STMH 204	STMH 203							0.000	3.598	25.05	25.50	45.11	60.82	103.71			218.84			218.84	663.44	CONC	1050.0	0.10	27.10	864.40	1.00	0.45	200.96	23.25%
	Great Lawn 5a and 5b	STMH 203	STMH 202	0.090				0.024		0.110	3.709	25.50	26.16	44.58	60.10	102.48			222.90			222.90	667.50	CONC	1050.0	0.10	39.20	864.40	1.00	0.66	196.91	22.78%
	Great Lawn 6, A-1, A-2, D, D1-1, D1-2	*Ex. STMD*	CBMH 210	1.214				0.638		2.271	2.271	20.00	21.00	52.03	70.25	119.95			159.56			159.56		CONC	600.0	0.07	34.40	162.62	0.57	1.00	3.06	1.88%
	Great Lawn 4	CBMH 210	STMH 202	0.160				0.024		0.149	2.420	21.00	21.56	50.48	68.13	116.30			164.90			164.90		CONC	600.0	0.10	23.10	194.36	0.69	0.56	29.46	15.16%
$Q_{bldg\ Tot}$ = 444.6 l/s		CBMH 202	CHAMBER / *Ex. Chamber*							0.000	6.129	26.16	26.16	43.85	59.11	100.77			362.25			362.25	806.85	REFER TO STORMTECH DESIGN								
	OPGG5, Great Lawn 3	CHAMBER / *Ex. Chamber*	*Ex. 1350 PIPE*	0.219				0.120		0.422	6.551	26.16	26.16	43.85	59.11	100.77			387.20			387.20	831.80	REFER TO STORMTECH DESIGN								
+23.1 l/s	A1, BLDGS H, G, J, J1, J2	*Ex. STM-CCN1*	NEW STMH 212	0.015				0.901		2.263	2.263	20.00	20.20	52.03	70.25	119.95			158.95			158.95	182.05	CONC	600.0	0.21	12.00	281.66	1.00	0.20	99.61	35.36%
	N1	NEW STMH 212	NEW STMH 211	0.000				0.034		0.085	2.348	20.20	20.80	51.71	69.81	119.20			163.90			163.90	187.00	CONC	600.0	0.15	30.00	238.05	0.84	0.59	51.04	21.44%
		NEW STMH 211	*Ex. STM 110*							0.000	2.348	20.80	20.98	50.79	68.55	117.02			160.94			160.94	184.04	CONC	600.0	0.20	11.00	274.87	0.97	0.19	90.83	33.04%
	OPGG1, OPGG4	*Ex. STM 110*	*Ex. STM 109*	0.079				0.222		0.599	2.947	20.98	21.19	50.50	68.16	116.35			200.88			200.88	223.98	CONC	*600.0*	*0.20*	*11.70*	274.87	0.97	0.20	50.89	18.51%
$Q_{bldg\ Tot}$ = 467.7 l/s	OPGG2	*Ex. STM 109*	*Ex. STM 108*	0.065				0.224		0.597	10.094	26.16	27.44	43.85	59.11	100.77			596.65			596.65	1064.35	CONC	*1350.0*	*0.13*	*103.30*	1926.37	1.34	1.28	862.02	44.75%
	102, AA, BB, EE	*Ex. STMDD*	*Ex. STMFF*	1.226				0.778		2.628	2.628	21.70	22.27	49.45	66.73	113.88			175.37			175.37		CONC	*900.0*	*0.10*	*31.00*	573.05	0.90	0.57	397.67	69.40%
	Great Lawn 1 & 2, T1, T2, V1, V2	*Ex. STMFF*	*Ex. STMGG*	0.553				0.258		0.952	3.581	22.27	23.33	48.64	65.62	111.98			234.98			234.98		CONC	*900.0*	*0.10*	*57.00*	573.05	0.90	1.06	338.07	59.00%
		Ex. STMGG	*Ex. STM 108*							0.000	3.581	23.33	23.74	47.23	63.70	108.67			228.08			228.08		CONC	*900.0*	*0.10*	*22.00*	573.05	0.90	0.41	344.97	60.20%
$Q_{bldg\ Tot}$ = 467.7 l/s	OPGG3, 108	*Ex. STM 108*	*Ex. STM 107*	0.143				0.340		0.930	14.605	27.44	28.59	42.50	57.26	97.60			836.31			836.31	1304.01	CONC	*1350.0*	*0.10*	*81.40*	1689.54	1.18	1.15	385.53	22.82%
+34.4 l/s, Qbldg Tot = 502.1 l/s	A2, BLDGS A, B, C, D	*Ex. STM 107*	*Ex. STM 106*	0.049				1.508		3.800	18.406	28.59	28.88	41.35	55.71	94.93			1025.33			1025.33	1527.43	CONC	*1350.0*	*0.10*	*20.70*	1689.54	1.18	0.29	162.11	9.59%
Controlled Flow*		*Ex. STM 106*	*Ex. STM 105*																			298.00		CONC	*975.0*	*0.10*	*80.20*	709.40	0.95	1.41	411.40	57.99%
		Ex. STM 105	*Ex. STM 104*																			298.00		CONC	*975.0*	*0.10*	*12.10*	709.40	0.95	0.21	411.40	57.99%
		Ex. STM 104	*Ex. STM 103*																			298.00		CONC	*975.0*	*0.10*	*19.20*	709.40	0.95	0.34	411.40	57.99%
		Ex. STM 103	*Ex. STM 102*																			298.00		CONC	*975.0*	*0.10*	*54.20*	709.40	0.95	0.95	411.40	57.99%
		Ex. STM 102	*Ex. STM 101*																			298.00		CONC	*975.0*	*0.10*	*24.20*	709.40	0.95	0.42	411.40	57.99%
		Ex. STM 101	*Ex. STM MH (O'Connnor)*																			298.00		CONC	*975.0*	*0.10*	*5.80*	709.40	0.95	0.10	411.40	57.99%

Definition:
Q=2.78CiA, where:
Q = Peak Flow in Litres per Second (L/s)
A = Area in Hectares (Ha)
i = Rainfall Intensity in millimeters per hour (mm/hr)
i = 732.951/(TC+6.199)^0.810 — 2 Year
i = 1174.184/(TC+6.014)^0.816 — 5 Year
i = 1735.688/(TC+6.014)^0.820 — 100 Year

Notes:
1. Mannings coefficient (n) = 0.013

*5-Yr Flow controlled to 298 l/s (refer to SWM report for details)


Time-of-Concentration in the Swale
FAA Equation: t (min) = 3.258 [(1.1 - C) L^0.5 / S^.33]
Where: Longest Watercourse Length, L (m). S (%)
Runoff Coef.C = Impervious

No.	L (m)	S %	Tc (min)
			#DIV/0!

Designed: Z.A.
Checked: D.B.Y.
Dwg. Reference: C05A/C05B

No.	Revision	Date
1.	City Submission No. 1	2023-05-25
2.	City Submission No. 2	2023-09-22
3.	City Submission No. 3	2024-08-07
4.	City Submission No. 4	2025-01-14
5.	City Submission No. 5	2025-03-07

File Reference: CA0002045.0622
Date: 2025-02-28
Sheet No: 1 of 1

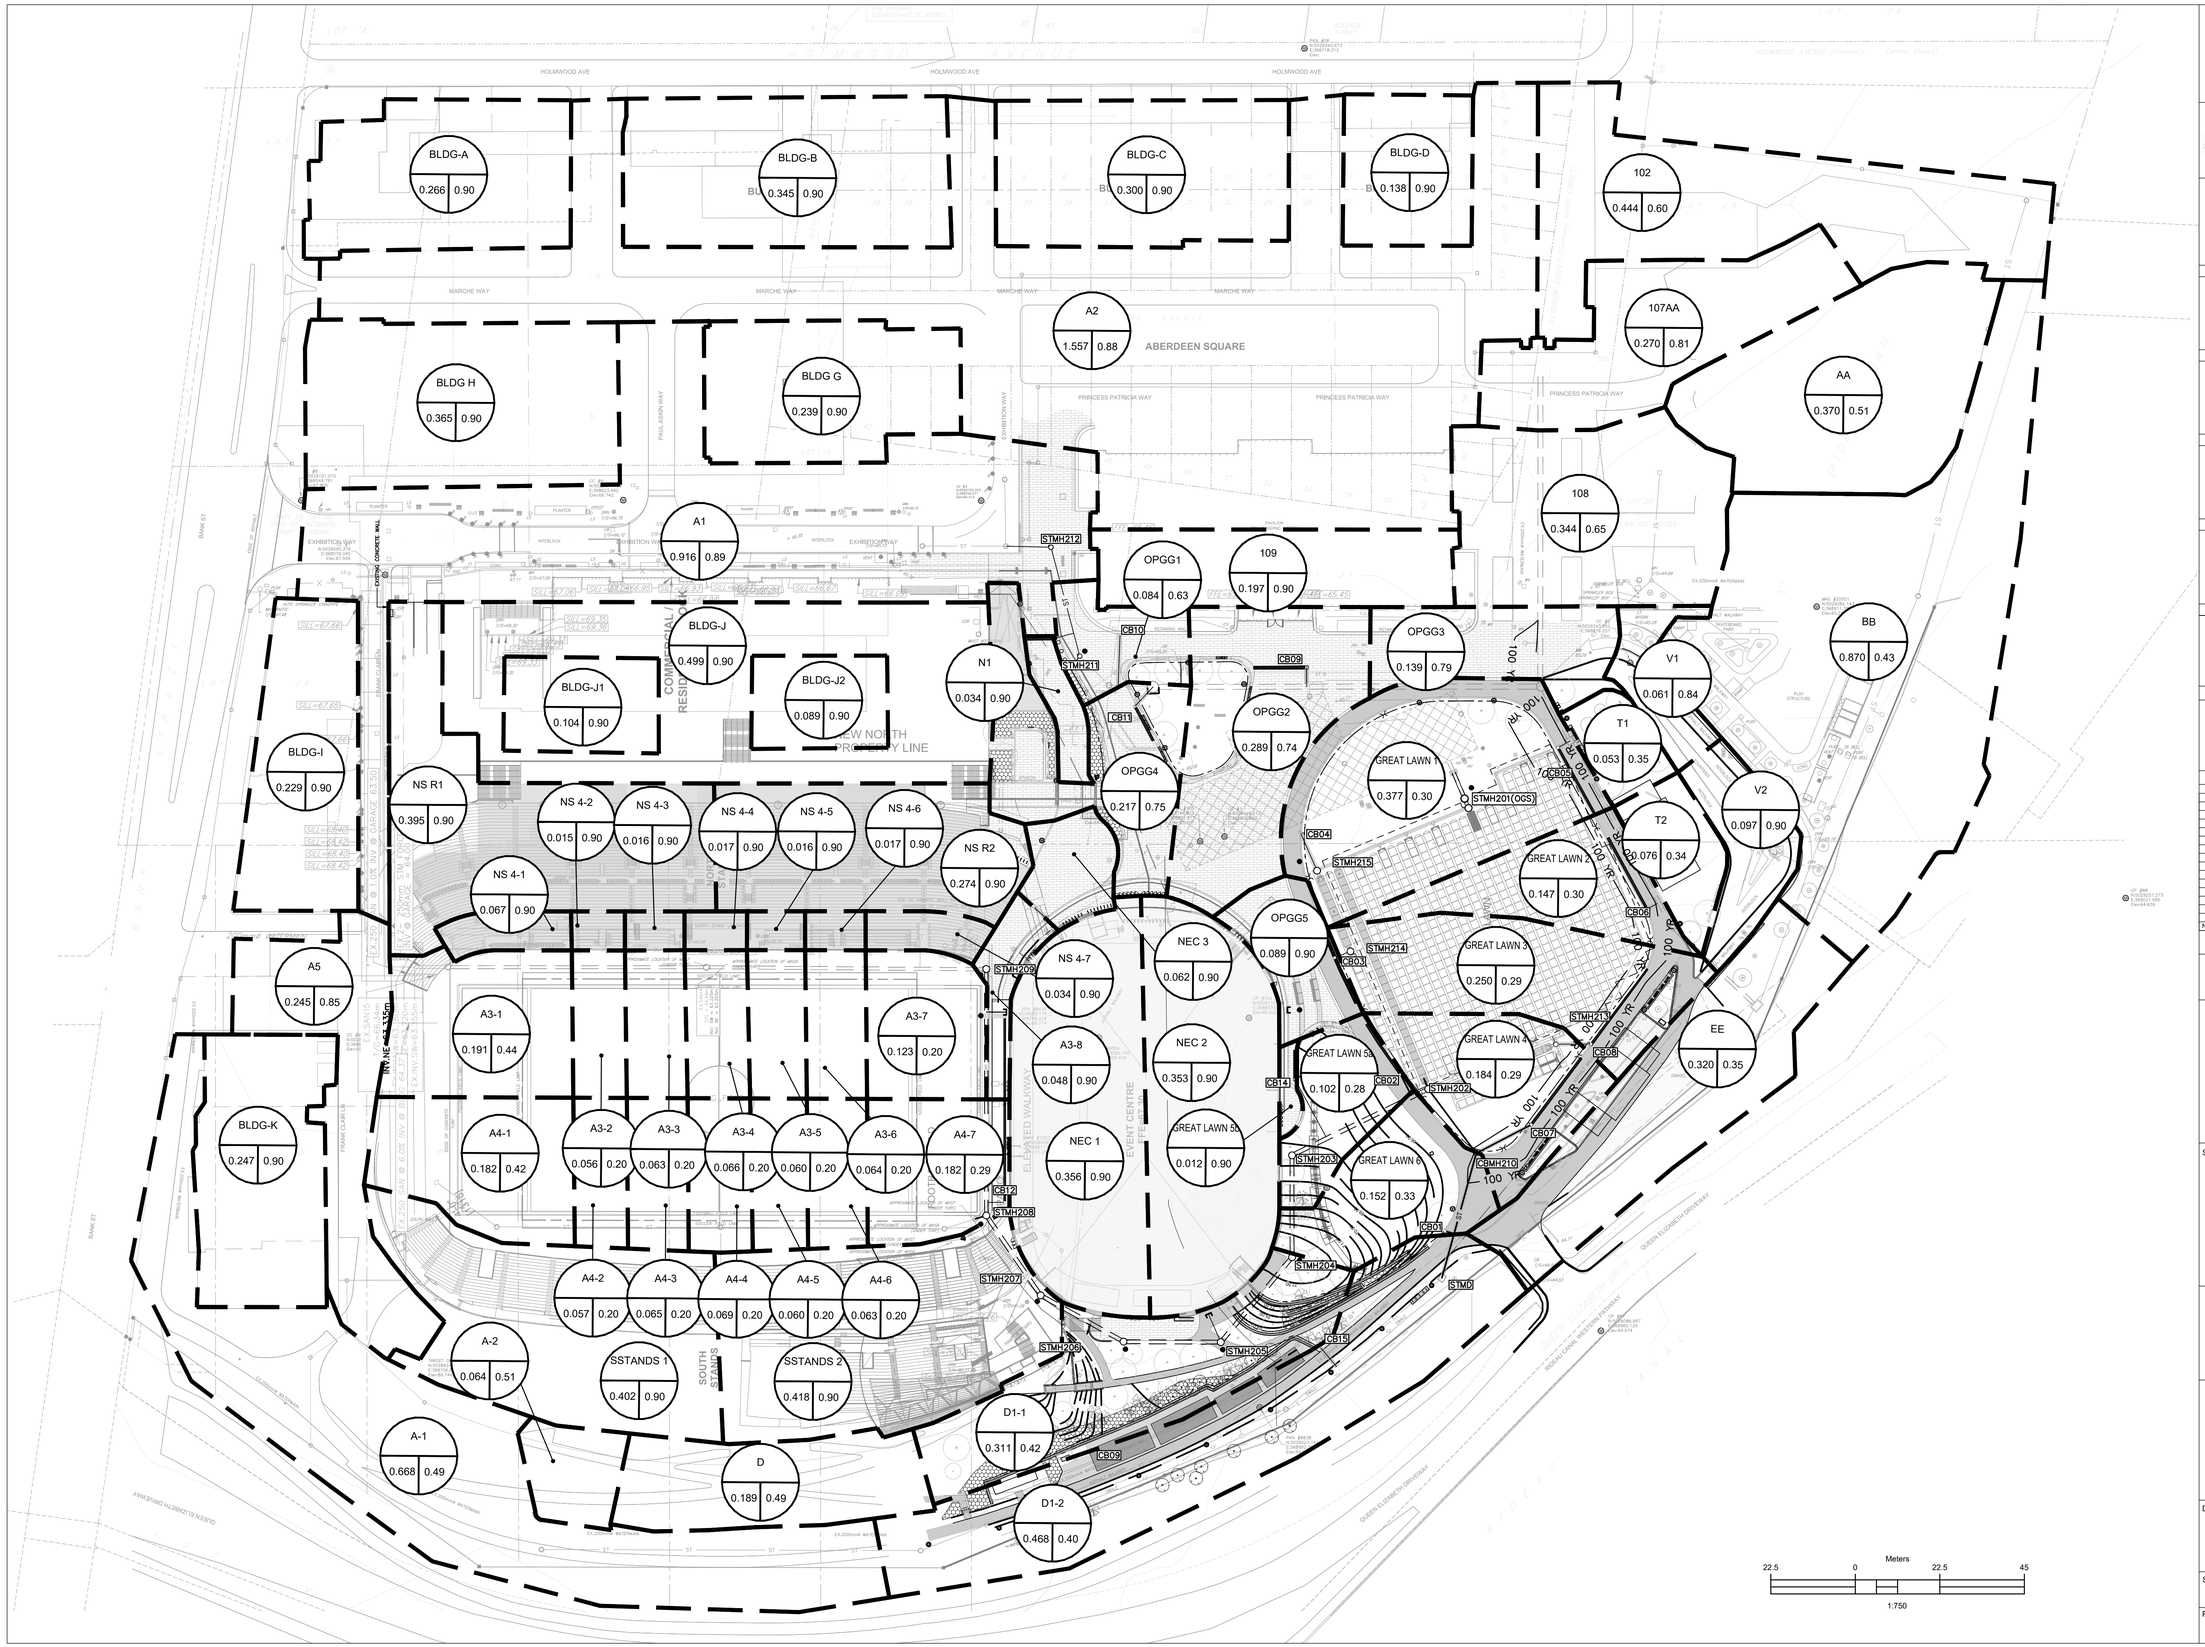

DATE PLOTTED:

Ottawa

OSEG
Ottawa Sports and Entertainment Group

BRISBIN BROOK BEYNON ARCHITECTS
14 DUNCAN ST 4TH FLOOR
TORONTO, ON M5H 3G8
(416) 591-8999
ARCHITECT

ENTUITIVE
135 LAURIER AVE WEST, SUITE 413
OTTAWA, ON K1P 5J2
(343) 308-9274
STRUCTURAL ENGINEER

TMP
200 KING. ST. WEST, SUITE 310
TORONTO, ON M5H 3T4
(416) 499-8000
MECH, PLUMB, FIRE PROTECTION ENGINEER

MULVEY & BANANI
90 SHEPPARD AVE EAST, SUITE 500
TORONTO, ON M2N 3A
(416) 751-2520
ELEC, LIGHTING ENGINEER

S2O
530 N. WOOD STREET #C
CHICAGO, IL 60622
(224) 717-1999
FOOD AND BEVERAGE

CSW
319 MCRAE AVENUE, SUITE 502
OTTAWA, ONTARIO K1Z 0B9
(613) 729-4536
LANDSCAPE ARCHITECT

wsp
2011 QUEENSVIEW DR.
OTTAWA, ONTARIO K2B 8K2
(613) 829-2800
CIVIL ENGINEER

NO	DESCRIPTION	DATE
7	REVISED AS PER CITY COMMENTS	2025-03-07
6	ISSUED FOR CD UPDATE	2025-02-28
5	ISSUED FOR CD UPDATE	2025-01-17
4	REVISED AS PER CITY COMMENTS	2025-01-15
3	ISSUED FOR 90% DD - CLASS B ESTIMATE	2024-11-15
2	REVISED AS PER CITY COMMENTS	2024-09-13
1	ISSUED FOR SPA	2024-08-07

REVISIONS/ ISSUES

CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ANY OMISSIONS OR DISCREPANCIES TO THE ARCHITECT BEFORE PROCEEDING WITH THE WORK.
DO NOT SCALE THE DRAWINGS



SEAL



NORTH

DRAWN	J.T
DATE	2025/03/07
CHECKED	W.Y

LANSDOWNE EVENT CENTRE

945 & 1015 BANK STREET

DWG. TITLE

POST-DRAINAGE AREA PLAN

SCALE	DWG. NO.
1:750	C08
PROJ. NO. CA0033920.1056	

#D07-12-24-0082

#19172

														Sewer Data								
Up	Down	BLDG ID	Q_{BLDG}	$Q_{BLDG\ TOT}$	AREA ID	Area	C	Indiv AxC	Acc AxC	T_C	I	Q	Q_{TOT}	DIA	Slope	Length	$A_{hydraulic}$	R	Velocity	Qcap	Time Flow	Q / Q full
			(L/s)	(L/s)		(ha)	(-)			(min)	(mm/hr)	(L/s)	(L/s)	(mm)	(%)	(m)	(m^2)	(m)	(m/s)	(L/s)	(min)	(-)
120	119	S. Stands	106.0	106.0				0.00	0.00	***20.0***	70.3	0.0	106.0	450	0.20	59.6	0.159	0.113	0.80	127.5	1.2	0.83
119	118			106.0				0.00	0.00	21.2	67.6	0.0	106.0	450	0.20	59.6	0.159	0.113	0.80	127.5	1.2	0.83
118	117	S. Stands	106.0	212.0				0.00	0.00	22.5	65.2	0.0	212.0	600	0.20	8.7	0.283	0.150	0.97	274.6	0.1	0.77
117	116			212.0				0.00	0.00	22.6	65.0	0.0	212.0	600	0.20	3.8	0.283	0.150	0.97	274.6	0.1	0.77
116	113			212.0				0.00	0.00	22.7	64.8	0.0	212.0	600	0.20	62.4	0.283	0.150	0.97	274.6	1.1	0.77
										23.8												
115	114	I, K, N.STANDS	232.6	232.6	A3, A4, A5	2.133	0.80	1.71	1.71	***20.0***	70.3	333.0	565.6	825	0.20	73.7	0.535	0.206	1.20	641.9	1.0	0.88
114	113			232.6				0.00	1.71	21.0	68.1	322.7	555.4	825	0.20	73.0	0.535	0.206	1.20	641.9	1.0	0.87
										22.0												
113	112			444.6				0.00	1.71	23.8	62.9	298.4	743.0	1050	0.10	47.8	0.866	0.263	1.00	863.5	0.8	0.86
										24.6												
A	B			0.0		0.870	0.35	0.30	0.30	***15.0***	83.6	70.7	70.7	600	0.10	100.0	0.283	0.150	0.69	194.2	2.4	0.36
B	C			0.0		0.430	0.35	0.15	0.46	17.4	76.5	96.6	96.6	600	0.10	100.0	0.283	0.150	0.69	194.2	2.4	0.50
C	D			0.0				0.00	0.46	19.9	70.6	89.2	89.2	600	0.10	57.0	0.283	0.150	0.69	194.2	1.4	0.46
D	D1			0.0		0.520	0.35	0.18	0.64	21.2	67.6	119.7	119.7	900	0.10	55.8	0.636	0.225	0.90	572.5	1.0	0.21
D1	112			0.0		0.340	0.35	0.12	0.76	22.3	65.6	137.8	137.8	900	0.10	85.0	0.636	0.225	0.90	572.5	1.6	0.24
										23.8												
112	109			444.6				0.00	2.46	24.6	61.6	421.4	866.0	1200	0.10	46.8	1.131	0.300	1.09	1232.9	0.7	0.70
										25.3												
111	110	H, G1, G2, J	23.1	23.1	A1	1.181	0.75	0.89	0.89	***20.0***	70.3	172.8	196.0	600	0.20	39.6	0.283	0.150	0.97	274.6	0.7	0.71
110	109			23.1				0.00	0.89	20.7	68.8	169.3	192.4	600	0.20	8.5	0.283	0.150	0.97	274.6	0.1	0.70
										20.8												
109	108			467.8				0.00	3.35	25.3	60.5	562.3	1030.0	1350	0.10	99.8	1.431	0.338	1.18	1687.8	1.4	0.61
										26.7												
CB1A	AA			0.0		0.430	0.60	0.26	0.26	***15.0***	83.6	59.9	59.9	375	0.15	114.0	0.110	0.094	0.61	67.9	3.1	0.88
AA	BB			0.0		0.360	0.35	0.13	0.38	18.1	74.7	79.7	79.7	450	0.12	35.0	0.159	0.113	0.62	98.8	0.9	0.81
BB	CC			0.0		0.870	0.35	0.30	0.69	19.0	72.5	138.6	138.6	525	0.24	120.0	0.216	0.131	0.97	210.7	2.1	0.66
CC	DD			0.0				0.00	0.69	21.1	68.0	130.0	130.0	525	0.24	38.0	0.216	0.131	0.97	210.7	0.7	0.62
										21.7												
EE	DD			0.0		0.320	0.35	0.11	0.11	***15.0***	83.6	26.0	26.0	300	0.40	59.0	0.071	0.075	0.87	61.2	1.1	0.43
										16.1												
DD	FF			0.0				0.00	0.80	***21.7***	66.7	148.2	148.2	900	0.10	31.0	0.636	0.225	0.90	572.5	0.6	0.26
										22.3												
H	G			0.0		0.270	0.35	0.09	0.09	***15.0***	83.6	21.9	21.9	300	0.20	66.0	0.071	0.075	0.61	43.2	1.8	0.51
G	J			0.0		0.310	0.35	0.11	0.20	16.8	78.2	44.1	44.1	375	0.15	30.0	0.110	0.094	0.61	67.9	0.8	0.65
J	FF			0.0		0.100	0.35	0.04	0.24	17.6	76.0	50.2	50.2	600	0.15	12.0	0.283	0.150	0.84	237.8	0.2	0.21
										17.8												
FF	GG			0.0				0.00	1.04	***22.3***	65.6	189.1	189.1	900	0.10	57.0	0.636	0.225	0.90	572.5	1.1	0.33
										23.4												
K	M			0.0		0.270	0.35	0.09	0.09	***15.0***	83.6	21.9	21.9	300	0.20	65.0	0.071	0.075	0.61	43.2	1.8	0.51
M	R			0.0		0.070	0.35	0.02	0.12	16.8	78.2	25.9	25.9	300	0.20	47.0	0.071	0.075	0.61	43.2	1.3	0.60
										18.1												

														Sewer Data								
Up	Down	BLDG ID	Q_{BLDG}	$Q_{BLDG\ TOT}$	AREA ID	Area	C	Indiv AxC	Acc AxC	T_C	I	Q	Q_{TOT}	DIA	Slope	Length	$A_{hydraulic}$	R	Velocity	Qcap	Time Flow	Q / Q full
			(L/s)	(L/s)		(ha)	(-)			(min)	(mm/hr)	(L/s)	(L/s)	(mm)	(%)	(m)	(m^2)	(m)	(m/s)	(L/s)	(min)	(-)
O	P			0.0		0.280	0.60	0.17	0.17	***15.0***	83.6	39.0	39.0	375	0.12	21.0	0.110	0.094	0.55	60.7	0.6	0.64
P	Q			0.0		0.180	0.60	0.11	0.28	15.6	81.6	62.5	62.5	375	0.10	34.0	0.110	0.094	0.50	55.4	1.1	1.13
Q	R			0.0		0.300	0.60	0.18	0.46	16.8	78.3	99.1	99.1	375	0.12	18.0	0.110	0.094	0.55	60.7	0.5	1.63
R	GG			0.0				0.00	0.58	17.3	76.8	122.6	122.6	600	0.10	13.0	0.283	0.150	0.69	194.2	0.3	0.63
										17.6												
S	U			0.0		0.130	0.60	0.08	0.08	***15.0***	83.6	18.1	18.1	450	0.20	30.0	0.159	0.113	0.80	127.5	0.6	0.14
U	GG			0.0		0.140	0.60	0.08	0.16	15.6	81.6	36.7	36.7	525	0.10	17.0	0.216	0.131	0.63	136.0	0.5	0.27
										16.1												
GG	108			0.0				0.00	1.78	***17.6***	75.9	374.5	374.5	900	0.10	22.0	0.636	0.225	0.90	572.5	0.4	0.65
										18.0												
108	107			0.0		0.340	0.60	0.20	5.33	***26.7***	58.3	863.2	863.2	1350	0.10	81.4	1.431	0.338	1.18	1687.8	1.2	0.51
107	106	A, B, C, D	34.4	502.2	A2	1.555	0.75	1.17	6.49	27.8	56.7	1023.0	1525.1	1350	0.10	20.7	1.431	0.338	1.18	1687.8	0.3	0.90
										28.1												
CONTROLLED FLOW																						
106	105		616.0	616.0				0.00	0.00	27.8	56.7	0.0	616.0	975	0.10	80.2	0.747	0.244	0.95	708.7	1.4	0.87
105	104			616.0				0.00	0.00	29.2	54.9	0.0	616.0	975	0.10	12.1	0.747	0.244	0.95	708.7	0.2	0.87
104	103			616.0				0.00	0.00	29.5	54.6	0.0	616.0	975	0.10	19.2	0.747	0.244	0.95	708.7	0.3	0.87
103	102			616.0				0.00	0.00	29.8	54.2	0.0	616.0	975	0.10	54.2	0.747	0.244	0.95	708.7	1.0	0.87
102	101			616.0				0.00	0.00	30.7	53.0	0.0	616.0	975	0.10	24.2	0.747	0.244	0.95	708.7	0.4	0.87
101	EX			616.0				0.00	0.00	31.2	52.5	0.0	616.0	975	0.10	5.8	0.747	0.244	0.95	708.7	0.1	0.87
										31.3												



LEGEND

- PROPOSED STORM SEWER AND MAINTENANCE HOLE
- PROPOSED CATCH BASIN
- 65.00 PROPOSED SURFACE SWALE AND DIRECTION OF FLOW
- + 65.81 PROPOSED GRADE
- EXISTING GRADE
- STORM CATCHMENT BOUNDARY AREA
- B / 0.82 STORM CATCHMENT AREA ID / AREA (ha)

CLIENT PARTNERSHIP

CONSULTANT TEAM

CANNONDESIGN
AN IDEAS BASED PRACTICE

CORUSH SUNDERLAND WRIGHT

DSEL
david schaeffer engineering ltd
SMART SUBDIVISIONS

GreenbergFarrow

Stantec

PHILLIPS FAREVAAG SMALLENBERG
PLANNING • URBAN DESIGN
LANDSCAPE ARCHITECTURE

COPYRIGHT RESERVED
This plan and design are, and at all times remain the exclusive property of the client and consultant team and cannot be used or reproduced without written consent.
Do not scale drawings. This drawing shall not be used for construction.

REVISIONS

No.	Date	Details	By
1	2011-11-21	ISSUED TO CITY FOR REVIEW	JVG
2	2011-12-12	REVISED AS PER CITY COMMENTS	JVG
3	2012-01-11	REVISED AS PER COORDINATION WITH DSEL	JVG
4	2012-01-26	REVISED AS PER CITY COMMENTS	JVG

1:600 0 6 18 30m

PROJECT

Lansdowne
THE TRANSFORMATION OF LANSDOWNE PARK
LA TRANSFORMATION DU PARC LANSDOWNE

DRAWING TITLE
CATCHMENT AREA PLAN

DATE

SCALE 1:600

REVISION # 4

DRAWING No. C03

V:\01-634\active\1604_00832_Lansdowne Park Competition\design\drawing\160400832 Civil Stantec.dwg Feb06 ,2012 - 3:16pm

SANITARY SEWER DESIGN SHEET
Lansdowne Redevelopment 2.0
Ottawa, ON
Project: CA0000286.1662
Date: January 2025

LOCATION				RESIDENTIAL AREA AND POPULATION											OTHER				RETAIL		OFFICE		I+C+I	INFILTRATION			TOTAL	PIPE					
LOCATION	FROM M.H.	TO M.H.	SANITARY DRAINAGE AREA ID	INDV AREA (ha)	ACCU AREA (ha)	NUMBER OF UNITS						POPULATION		PEAK FACT.	PEAK FLOW (l/s)	GROSS AREA (ha)	DEVEL. AREA (ha)	PEAK FLOW (l/s)	ACCU. PEAK FLOW (l/s)	INDIV AREA (ha)	ACCU. AREA (ha)	INDIV AREA (ha)	ACCU. AREA (ha)	PEAK FLOW (l/s)	INDIV AREA (ha)	ACCU. AREA (ha)	INFILT. FLOW (l/s)	**TOTAL FLOW (l/s)**	LENGTH (m)	DIA. (mm)	SLOPE (%)	CAP. (FULL) (l/s)	VEL. (FULL) (m/s)	AVAIL. CAP. (%)
						SINGLES	SEMIS	AVG TOWNS	AVG APT.	2-BED APT.	3-BED APT.	INDIV POP.	ACCU POP.																				
EXISTING DEVELOPMENT																																
South Stands		*Ex.19*										0	0	3.80	0.00			11.60	11.60					11.60	0.000	0.00	0.00	**11.60**	*4.50*	*200*	*1.00*	32.80	1.04	**64.63%**
	Ex.19	*Ex.18*										0	0	3.80	0.00				11.60					11.60	0.000	0.00	0.00	**11.60**	*9.30*	*300*	*0.20*	43.25	0.61	**73.18%**
	Ex.18	*Ex.17*										0	0	3.80	0.00				11.60					11.60	0.000	0.00	0.00	**11.60**	*9.30*	*300*	*0.20*	43.25	0.61	**73.18%**
	Ex.17	*Ex.16*										0	0	3.80	0.00				11.60					11.60	0.000	0.00	0.00	**11.60**	*5.80*	*300*	*0.20*	43.25	0.61	**73.18%**
	Ex.16	*Ex.13*										0	0	3.80	0.00				11.60					11.60	0.000	0.00	0.00	**11.60**	*62.60*	*300*	*0.20*	43.25	0.61	**73.18%**
Bldg K, I, N Stands		*Ex.15*							190			342	342	3.44	3.82			7.60	7.60	0.25	0.25	0.84	0.84	7.95	0.000	0.00	0.00	**11.77**	*9.80*	*250*	*1.00*	59.47	1.21	**80.21%**
	Ex.15	*Ex.14*										0	342	3.44	3.82				7.60		0.25		0.84	7.95	0.000	0.00	0.00	**11.77**	*74.90*	*300*	*0.20*	43.25	0.61	**72.79%**
	Ex.14	*Ex.13*										0	342	3.44	3.82				7.60		0.25		0.84	7.95	0.000	0.00	0.00	**11.77**	*74.90*	*300*	*0.20*	43.25	0.61	**72.79%**
	Ex.13	*Ex.12*										0	342	3.44	3.82				19.20		0.25		0.84	19.55	0.000	0.00	0.00	**23.37**	*44.40*	*300*	*0.20*	43.25	0.61	**45.96%**
	Ex.12	*Ex.9*										0	342	3.44	3.82				19.20		0.25		0.84	19.55	0.000	0.00	0.00	**23.37**	*56.60*	*300*	*0.20*	43.25	0.61	**45.96%**
Bldg G1, G2, H, J		*Ex.11*										0	0	3.80	0.00				0.00	1.59	1.59			0.51	0.000	0.00	0.00	**0.51**	*8.40*	*250*	*0.38*	36.66	0.75	**98.60%**
Salon, Civic Centre		*Ex.11*										0	0	3.80	0.00			5.20	5.20		0.00			5.20	0.000	0.00	0.00	**5.20**	*30.80*	*250*	*0.38*	36.66	0.75	**85.81%**
	Ex.11	*Ex.10*										0	0	3.80	0.00				5.20		1.59			5.71	0.000	0.00	0.00	**5.71**	*38.20*	*250*	*0.38*	36.66	0.75	**84.41%**
	Ex.10	*Ex.9*										0	0	3.80	0.00				5.20		1.59			5.71	0.000	0.00	0.00	**5.71**	*7.50*	*250*	*0.38*	36.66	0.75	**84.41%**
	Ex.9	*Ex.8*										0	342	3.44	3.82				24.40		1.84		0.84	25.27	0.000	0.00	0.00	**29.08**	*84.00*	*375*	*0.15*	67.91	0.61	**57.17%**
Aberdeen Pavilion	*Ex.8*	*Ex.7*										0	342	3.44	3.82				24.40	0.41	2.25		0.84	25.40	0.000	0.00	0.00	**29.21**	*23.30*	*375*	*0.15*	67.91	0.61	**56.98%**
Bldg A, B, C, D, Horticulture	*Ex.7*	*Ex.6*						40	50			198	540	3.37	5.89				24.40	2.25	4.50		0.84	26.13	0.000	0.00	0.00	**32.02**	*23.30*	*375*	*0.15*	67.91	0.61	**52.85%**
	Ex.6	*Ex.5*										0	540	3.37	5.89				24.40		4.50		0.84	26.13	0.000	0.00	0.00	**32.02**	*83.50*	*375*	*0.15*	67.91	0.61	**52.85%**
	Ex.5	*Ex.4*										0	540	3.37	5.89				24.40		4.50		0.84	26.13	0.000	0.00	0.00	**32.02**	*10.10*	*375*	*0.15*	67.91	0.61	**52.85%**
	Ex.4	*Ex.3*										0	540	3.37	5.89				24.40		4.50		0.84	26.13	0.000	0.00	0.00	**32.02**	*17.50*	*375*	*0.15*	67.91	0.61	**52.85%**
	Ex.3	*Ex.2*										0	540	3.37	5.89				24.40		4.50		0.84	26.13	0.000	0.00	0.00	**32.02**	*60.00*	*375*	*0.15*	67.91	0.61	**52.85%**
	Ex.2	*Ex.1*										0	540	3.37	5.89				24.40		4.50		0.84	26.13	0.000	0.00	0.00	**32.02**	*24.70*	*375*	*0.15*	67.91	0.61	**52.85%**
	Ex.1	*EX*										0	540	3.37	5.89				24.40		4.50		0.84	26.13	0.000	0.00	0.00	**32.02**	*9.70*	*375*	*0.15*	67.91	0.61	**52.85%**

DESIGN PARAMETERS

RESIDENTIAL AVG. DAILY FLOW =	280	l/cap/day	COMMERCIAL PEAK FACTOR =	1.5	(WHEN AREA > 20%)	PEAK POPULATION FLOW, (l/s) =	P*q*M/86400	UNIT TYPE	PERSONS/UNIT
COMMERCIAL AVG. DAILY FLOW =	28,000	l/ha/day		1.0	(WHEN AREA < 20%)	PEAK EXTRANEOUS FLOW, (l/s) =	I*Ac	SINGLES	3.4
	0.324	l/ha/s				RESIDENTIAL PEAKING FACTOR, M =	1+(14/(4+P^0.5))*K	SEMI-DETACHED	2.7
INSTITUTIONAL AVG. DAILY FLOW =	28,000	l/ha/day	INSTITUTIONAL PEAK FACTOR =	1.5	(WHEN AREA > 20%)	Ac = CUMULATIVE AREA (ha)		TOWNHOMES	2.7
	0.324	l/ha/s		1.0	(WHEN AREA < 20%)	P = POPULATION (THOUSANDS)		WALK UP TOWNS	1.8
LIGHT INDUSTRIAL FLOW =	35,000	l/ha/day						2-BED APT. UNIT	2.1
	0.405	l/ha/s	RESIDENTIAL CORRECTION FACTOR, K =	0.80		SEWER CAPACITY, Qcap (l/s) =	1/N S^(1/2) R^(2/3) Ac	3-BED APT. UNIT	3.1
HEAVY INDUSTRIAL FLOW =	55,000	l/ha/day	MANNING N =	0.013		(MANNING'S EQUATION)			
	0.637	l/ha/s	PEAK EXTRANEOUS FLOW, I (l/s/ha) =	0.33					

DESIGNED:	**NO.**	**REVISION**	**DATE**
D.B.Y	1.	City Submission No.1	2023-05-25
CHECKED:	2.	City Submission No.2	2023-09-22
D.B.Y	3.	City Submission No.3	2024-08-07
PROJECT:	4.	City Submission No.4	2025-01-15
Lansdowne Redevelopment 2.0			
LOCATION:			
Ottawa, Ontario			
PAGE NO:	**FILE & DWG. REFERENCE:**		
1 of 2			

SANITARY SEWER DESIGN SHEET
Lansdowne Redevelopment 2.0
Ottawa, ON
Project: CA0000286.1662
Date: January 2025

LOCATION				RESIDENTIAL AREA AND POPULATION												OTHER				RETAIL		OFFICE		I+C+I	INFILTRATION			TOTAL	PIPE					
LOCATION	FROM M.H.	TO M.H.	SANITARY DRAINAGE AREA ID	INDV AREA (ha)	ACCU AREA (ha)	NUMBER OF UNITS						POPULATION		PEAK FACT.	PEAK FLOW (l/s)	GROSS AREA (ha)	DEVEL. AREA (ha)	PEAK FLOW (l/s)	ACCU. PEAK FLOW (l/s)	INDIV AREA (ha)	ACCU. AREA (ha)	INDIV AREA (ha)	ACCU. AREA (ha)	PEAK FLOW (l/s)	INDIV AREA (ha)	ACCU. AREA (ha)	INFILT. FLOW (l/s)	**TOTAL FLOW (l/s)**	LENGTH (m)	DIA. (mm)	SLOPE (%)	CAP. (FULL) (l/s)	VEL. (FULL) (m/s)	AVAIL. CAP. (%)
						SINGLES	SEMIS	AVG TOWNS	AVG APT.	2-BED APT.	3-BED APT.	INDIV POP.	ACCU POP.																				
POST DEVELOPMENT																																
BLDG I, K, North Stands		*Ex.15*							190			342	342	3.44	3.82			7.60	7.60	0.25	0.25	0.84	0.84	7.95	0.000	0.00	0.00	**11.77**						
	Ex.15	*Ex.14*										0	342	3.44	3.82				7.60		0.25		0.84	7.95	0.000	0.00	0.00	**11.77**	73.58	375	0.15	67.91	0.61	**82.67%**
	Ex.14	SAMH 208										0	342	3.44	3.82				7.60		0.25		0.84	7.95	0.000	0.00	0.00	**11.77**	71.25	375	0.15	67.91	0.61	**82.67%**
	SAMH 208	SAMH 208A										0	342	3.44	3.82				7.60		0.25		0.84	7.95	0.000	0.00	0.00	**11.77**	10.88	375	0.15	67.91	0.61	**82.67%**
New Event Centre (half flow)	Bldg	SAMH208A										0	0	3.80	0.00			2.60	2.60		0.00		0.00	2.60	0.000	0.00	0.00	**2.60**	6.84	200	1.00	32.80	1.04	**92.07%**
	SAMH 208A	SAMH 207										0	342	3.44	3.82				10.20		0.25		0.84	10.55	0.000	0.00	0.00	**14.37**	55.51	375	0.15	67.91	0.61	**78.84%**
South Stands	*Ex.18*	SAMH 207										0	0	3.80	0.00			11.60	11.60		0.00		0.00	11.60	0.000	0.00	0.00	**11.60**	8.67	300	0.23	46.38	0.66	**74.99%**
	SAMH 207	SAMH 206										0	342	3.44	3.82				21.80		0.25		0.84	22.15	0.000	0.00	0.00	**25.97**	25.49	375	0.15	67.91	0.61	**61.76%**
	SAMH 206	SAMH 205										0	342	3.44	3.82				21.80		0.25		0.84	22.15	0.000	0.00	0.00	**25.97**	26.70	375	0.15	67.91	0.61	**61.76%**
	SAMH 205	SAMH 204										0	342	3.44	3.82				21.80		0.25		0.84	22.15	0.000	0.00	0.00	**25.97**	25.91	375	0.16	70.13	0.63	**62.97%**
	SAMH 204	SAMH 203										0	342	3.44	3.82				21.80		0.25		0.84	22.15	0.000	0.00	0.00	**25.97**	31.38	375	0.15	67.91	0.61	**61.76%**
	SAMH 203	SAMH 202A										0	342	3.44	3.82				21.80		0.25		0.84	22.15	0.000	0.00	0.00	**25.97**	66.65	375	0.15	67.91	0.61	**61.76%**
New Event Centre (half flow)	Bldg	SAMH 202A										0	0	3.80	0.00			2.60	2.60		0.00		0.00	2.60	0.000	0.00	0.00	**2.60**	3.27	200	1.00	32.80	1.04	**92.07%**
	SAMH 202A	SAMH 202										0	342	3.44	3.82				24.40		0.25		0.84	24.75	0.000	0.00	0.00	**28.57**	39.51	375	0.15	67.91	0.61	**57.93%**
	SAMH 202	SAMH 201										0	342	3.44	3.82				24.40		0.25		0.84	24.75	0.000	0.00	0.00	**28.57**	49.82	375	0.15	67.91	0.61	**57.93%**
	SAMH 201	*Ex.8*										0	342	3.44	3.82				24.40		0.25		0.84	24.75	0.000	0.00	0.00	**28.57**	33.19	375	0.15	67.91	0.61	**57.93%**
Tower 1 & 2, BLDG G1, G2, H, J	*Ex. SAN-CCN1*	SAMH 210							252	250	250	1754	1754	3.10	17.64				0.00	2.33	2.33	0.08	0.08	0.78	0.000	0.00	0.00	**18.42**	12.03	250	0.25	29.73	0.61	**38.07%**
	SAMH 210	SAMH 209										0	1754	3.10	17.64				0.00		2.33		0.08	0.78	0.000	0.00	0.00	**18.42**	30.43	250	0.25	29.73	0.61	**38.07%**
	SAMH 209	*Ex. 10*										0	1754	3.10	17.64				0.00		2.33		0.08	0.78	0.000	0.00	0.00	**18.42**	10.07	250	0.38	36.66	0.75	**49.76%**
	Ex. 10	*Ex.9*										0	1754	3.10	17.64				0.00		2.33		0.08	0.78	0.000	0.00	0.00	**18.42**	*8.00*	*250*	*0.35*	35.18	0.72	**47.66%**
	Ex. CAP	*Ex.9*										0	0	3.80	0.00				0.00		0.00		0.00	0.00	0.000	0.00	0.00	**0.00**	*20.20*	*375*	*0.14*	65.60	0.59	**100.00%**
	Ex.9	*Ex.8*										0	1754	3.10	17.64				0.00		2.33		0.08	0.78	0.000	0.00	0.00	**18.42**	*103.59*	*375*	*0.16*	70.13	0.63	**73.74%**
Aberdeen Pavilion	*Ex.8*	*Ex.7*										0	2096	3.06	20.75				24.40	0.41	2.99		0.92	25.66	0.000	0.00	0.00	**46.42**	*23.30*	*375*	*0.15*	67.91	0.61	**31.64%**
Bldg A, B, C, D, Horticulture	*Ex.7*	*Ex.6*						40	50			198	2294	3.03	22.53				24.40	2.25	5.24		0.92	26.39	14.000	14.00	4.62	**53.54**	*23.30*	*375*	*0.15*	67.91	0.61	**21.15%**

DESIGN PARAMETERS

RESIDENTIAL AVG. DAILY FLOW =	280	l/cap/day	COMMERCIAL PEAK FACTOR =	1.5	(WHEN AREA > 20%)	PEAK POPULATION FLOW, (l/s) =	P*q*M/86400	UNIT TYPE	PERSONS/UNIT	
COMMERCIAL AVG. DAILY FLOW =	28,000	l/ha/day		1.0	(WHEN AREA < 20%)	PEAK EXTRANEOUS FLOW, (l/s) =	I*Ac	SINGLES	3.4	
	0.324	l/ha/s				RESIDENTIAL PEAKING FACTOR, M =	1+(14/(4+P^0.5))*K	SEMI-DETACHED	2.7	
INSTITUTIONAL AVG. DAILY FLOW =	28,000	l/ha/day	INSTITUTIONAL PEAK FACTOR =	1.5	(WHEN AREA > 20%)	Ac = CUMULATIVE AREA (ha)		TOWNHOMES	2.7	
	0.324	l/ha/s		1.0	(WHEN AREA < 20%)	P = POPULATION (THOUSANDS)		WALK UP TOWNS	1.8	
LIGHT INDUSTRIAL FLOW =	35,000	l/ha/day						2-BED APT. UNIT	2.1	
	0.405	l/ha/s	RESIDENTIAL CORRECTION FACTOR, K =	0.80		SEWER CAPACITY, Qcap (l/s) =	1/N S^(1/2) R^(2/3) Ac	3-BED APT. UNIT	3.1	
HEAVY INDUSTRIAL FLOW =	55,000	l/ha/day	MANNING N =	0.013		(MANNING'S EQUATION)				
	0.637	l/ha/s	PEAK EXTRANEOUS FLOW, I (l/s/ha) =	0.33						

DESIGNED:	**NO.**	**REVISION**	**DATE**
D.B.Y	1.	City Submission No.1	2023-05-25
CHECKED:	2.	City Submission No.2	2023-09-22
D.B.Y	3.	City Submission No.3	2024-08-07
PROJECT:	4.	City Submission No.4	2025-01-15
Lansdowne Redevelopment 2.0			
LOCATION:			
Ottawa, Ontario			
PAGE NO:	**FILE & DWG. REFERENCE:**		
2 of 2			

From: Yang, Winston
Sent: January 13, 2025 10:15 AM
To: Ali, Zarak
Subject: FW: Sanitary sewer capacity confirmation for Lansdowne redevelopment

Hi Zarak,

See below email correspondence from Abdul Mottalib for the sanitary capacity confirmation during ZBLA. It should be good for **comment 3.41.**

Yours truly,

Winston Yang
Lead Engineer – Technical Lead
Land Development & Municipal Engineering, Ontario
P.Eng., PMP.

T+ 1 613-829-2800
T+ 1 613-690-0538 (Direct)
M+ 1 647-628-8108

WSP Canada Inc.
2611 Queensview Drive, Suite 300
Ottawa, Ontario,
K2B 8K2 Canada

wsp.com

From: Mottalib, Abdul <Abdul.Mottalib@ottawa.ca>
Sent: May 8, 2023 3:05 PM
To: Nwanise, Nwanise <Nwanise.Nwanise@wsp.com>
Cc: Moore, Sean <Sean.Moore@ottawa.ca>; Yang, Winston <Winston.Yang@wsp.com>; Jafferjee, Ishaque <Ishaque.Jafferjee@wsp.com>; Mottalib, Abdul <Abdul.Mottalib@ottawa.ca>
Subject: FW: Sanitary sewer capacity confirmation for Lansdowne redevelopment

Hi Nwanise,

Please see below email. In terms of capacity, 77.07l/s is exceeding the city sewer capacity limit a bit. However as per the latest revised calculation, the demand is 54.82l/s which is lower than 77.07l/s, so the proposed development is acceptable.

--

Thanks,

Abdul
Mohammad Abdul Mottalib, P. Eng.
Extension: 27798

Sent: May 08, 2023 11:53 AM
To: Mottalib, Abdul <Abdul.Mottalib@ottawa.ca>
Subject: RE: Sanitary sewer capacity confirmation for Lansdowne redevelopment

Hi Abdul

We ran the flow in the model and although there is a slight increase for all events, it is still withing acceptable levels.
Regards

From: Mottalib, Abdul <Abdul.Mottalib@ottawa.ca>
Sent: April 26, 2023, 5:32 PM
To:……..
Cc: Mottalib, Abdul <Abdul.Mottalib@ottawa.ca>
Subject: FW: Sanitary sewer capacity confirmation for Lansdowne redevelopment

Good afternoon ……,

Hope you are doing well. The below request is for sanitary capacity concern for Lansdown Project Phase 2.

Please take a look at it and let me know whether the city 600mm sanitary sewer on Holmwood Avenue has capacity to handle additional 27l/s flow from the proposed phase 2 development. With the additional flow, the total projected flow from the Lansdown Project will be 78l/s to the 600mm sanitary sewer on Holmwood Avenue.

It would be much appreciated if you could provide your response at your earliest possible time.

--

Thanks,

Abdul
Mohammad Abdul Mottalib, P. Eng.
Extension: 27798

From: Moore, Sean <Sean.Moore@ottawa.ca>
Sent: April 14, 2023 8:34 AM
To: Mottalib, Abdul <Abdul.Mottalib@ottawa.ca>
Subject: FW: Sanitary sewer capacity confirmation for Lansdowne redevelopment

Hi Abdul,

For my Lansdowne project can you action the below request about sanitary flows on Holmwood Ave

Thanks.

Sean.

Sean Moore, MCIP/RPP
Director, Lansdowne Park Redevelopment Project | Directeur, Projet de réaménagement du parc Lansdowne
Planning, Real Estate and Economic Development Department | Direction générale de la planification, des biens immobiliers et du développement économique
City of Ottawa | Ville d'Ottawa

Cell: 613-805-9804

Please note: The best way to reach me is either through email or my Cell #

From: Nwanise, Nwanise <Nwanise.Nwanise@wsp.com>
Sent: April 13, 2023 3:05 PM
To: Moore, Sean <Sean.Moore@ottawa.ca>
Cc: Yang, Winston <winston.yang@wsp.com>; Jafferjee, Ishaque <ishaque.jafferjee@wsp.com>
Subject: Sanitary sewer capacity confirmation for Lansdowne redevelopment

CAUTION: This email originated from an External Sender. Please do not click links or open attachments unless you recognize the source.

ATTENTION : Ce courriel provient d'un expéditeur externe. Ne cliquez sur aucun lien et n'ouvrez pas de pièce jointe, excepté si vous connaissez l'expéditeur.

Hi Sean,

We would like to confirm if there is adequate capacity in the 600mm dia sanitary sewer on Holmwood Ave. to accommodate the projected additional sanitary sewer flows from the proposed Lansdowne 2.0 Redevelopment at 1015 Bank Street, Ottawa, ON.

The additional sanitary flows contributed by the site is estimated as 26.67L/s. The projected sanitary flows from the entire site will now be 77.07L/s.

See projected sanitary flow calculation and draft sanitary servicing plan attached.

Please do not hesitate to contact me if you have any questions.

Thank you.

Regards,

Regards,

Nwanise Nwanise, P.Eng.
Project Engineer

Municipal Engineering - Ottawa

WSP Global Inc.
2611 Queensview Drive, Suite 300, Ottawa, ON
Ottawa, Ontario
K2B 6B7 Canada

wsp.com

NOTICE: This communication and any attachments ("this message") may contain information which is privileged, confidential, proprietary or otherwise subject to restricted disclosure under applicable law. This message is for the sole use of the intended recipient(s). Any unauthorized use, disclosure, viewing, copying, alteration, dissemination or distribution of, or reliance on, this message is strictly prohibited. If you have received this message in error, or you are not an authorized or intended recipient, please notify the sender immediately by replying to this message, delete this message and all copies from your e-mail system and destroy any printed copies. You are receiving this communication because you are listed as a current WSP contact. Should you have any questions regarding WSP's electronic communications policy, please consult our Anti-Spam Commitment at www.wsp.com/casl. For any concern or if you believe you should not be receiving this message, please forward this message to caslcompliance@wsp.com so that we can promptly address your request. Note that not all messages sent by WSP qualify as commercial electronic messages.

AVIS : Ce message, incluant tout fichier l'accompagnant (« le message »), peut contenir des renseignements ou de l'information privilégiés, confidentiels, propriétaires ou à divulgation restreinte en vertu de la loi. Ce message est destiné à l'usage exclusif du/des destinataire(s) voulu(s). Toute utilisation non permise, divulgation, lecture, reproduction, modification, diffusion ou distribution est interdite. Si vous avez reçu ce message par erreur, ou que vous n'êtes pas un destinataire autorisé ou voulu, veuillez en aviser l'expéditeur immédiatement et détruire le message et toute copie électronique ou imprimée. Vous recevez cette communication car vous faites partie des contacts de WSP. Si vous avez des questions concernant la politique de communications électroniques de WSP, veuillez consulter notre Engagement anti-pourriel au www.wsp.com/lcap. Pour toute question ou si vous croyez que vous ne devriez pas recevoir ce message, prière de le transférer au conformitelcap@wsp.com afin que nous puissions rapidement traiter votre demande. Notez que ce ne sont pas tous les messages transmis par WSP qui constituent des messages électroniques commerciaux.

-LAEmHhHzdJzBlTWfa4Hgs7pbKI

'

This e-mail originates from the City of Ottawa e-mail system. Any distribution, use or copying of this e-mail or the information it contains by other than the intended recipient(s) is unauthorized. Thank you.

Le présent courriel a été expédié par le système de courriels de la Ville d'Ottawa. Toute distribution, utilisation ou reproduction du courriel ou des renseignements qui s'y trouvent par une personne autre que son destinataire prévu est interdite. Je vous remercie de votre collaboration.

'

Lansdowne Park
Building Service Summary

Building	Retail (m^2)	Residential # towns	Residential # apts	Office (m^2)	Estimated WTR / SAN / STM per Mechancal Eng. WTR (L/s)	FIRE (L/s)	SAN (L/s)	STM (L/s)	Estimated Per City of Ottawa Design Guidelines WTR AVG (L/s)	MAX. DAY (L/s)	PEAK HR (L/s)	FIRE (L/s)	SAN (L/s)	STM (L/s)	Notes
A	4,129	7	50		16.7		5.4	8.3	0.6	1.3	2.7	150	2.5	8.6	Mech Eng values provided by LKM 2011-11-29 (Includes retail and residential)
B	5,401	15			6.9		5.7	8.6	0.3	0.6	1.3	150	1.6	11.1	Mech Eng values provided by LKM 2011-11-29 (Includes retail and residential)
C	9,262	11			13.9		5.4	19.6	0.4	0.7	1.4	150	2.1	10.1	Mech Eng values provided by LKM 2011-11-29 (Includes retail and residential)
D	2,131	7			6.3		3.8	5.2	0.1	0.3	0.6	150	0.7	4.6	Mech Eng values provided by LKM 2011-11-29 (Includes retail and residential)
G1	3,507				6.3		5.4	5.5	0.1	0.2	0.3	150	0.6	5.8	Mech Eng values provided by LKM 2011-11-29 (Includes retail)
G2	399				5.0		2.6	2.4	0.0	0.0	0.0	150	0.1	1.3	Mech Eng values provided by LKM 2011-11-29 (Includes retail)
H	7,294				9.5		500FU	9.5	0.2	0.3	0.6	150	1.3	11.7	Mech Eng values provided by LKM 2011-11-29 (Includes retail)
I	2,505			8,361					0.9	1.3	2.3	150	1.6	8.1	
~~J~~	1,220								0.0	0.1	0.1	150	0.2	4.3	
J - Salon	3,425								0.1	0.1	0.3	150	0.6	N/A	Roof covered in North Stands flow.
K			190						1.4	3.5	7.6	150	5.5	5.3	
~~North Stands~~									2.8	4.2	7.6	150	7.6	219.2	No City standard for estimating flow from stadium / civic centre. Used monitored data
South Stands					25.2	31.5	11.6	211	2.8	4.2	7.5	150	11.6	212.0	No City standard for estimating flow from stadium / civic centre. Used monitored data
~~Civil Centre~~									1.9	2.9	5.2	150	5.2	N/A	No City standard for estimating flow from stadium / civic centre. Used monitored data
Aberdeen	4,098								0.1	0.2	0.3	150	0.7	N/A	Peaked Roof, storm runoff included in surface drainage.
Horticulture	1,591								0.0	0.1	0.1	150	0.3	N/A	Peaked Roof, storm runoff included in surface drainage.
Total	**44,962**	**40**	**240**	**8,361**	**89.9**	**31.5**	**39.8**	**270.1**	**11.8**	**19.9**	**38.0**		**42.1**	**502.2**	

Notes

1) Retail floor areas for buildings A, B, C, D, G1, G2, H, I, J, J - Salon provided by Perkins Eastman - Novemeber 18, 2011. Above table uses total GFA.

2) Residential for Buildings A, B, C, D, and K component extracted from RFO Addendum 3 - October 20, 2011 as follows:

Parcel A1 = Residential Tower above Bldg A. 240units (280units max less townhomes) proportionate between Bldg A and K. Therefore, 240units x 66,000/316,000 = 50units.

Parcel A2 = Townhomes abutting buildings A, B, C, D. Assuming 1,225sq.ft townhomes = 40units. Divided between buildings per ground floor area shown on Perkins Eastman November 19, 2011 merchandising plan.

Bldg A = 3,426/19,104 x 40 = 7 units

Bldg B = 7,188/19,104 = 15 units

Bldg C = 5,096/19,104 = 11 units

Bldg D = 3,394/19,104 = 7units

Parcel B = Office tower above Building I, 90,000sq.ft.

Parcel C = Building K 240units (280units max less townhomes) proportionate between Bldg A and K. Therefore, 240units x 250,000/316,000 = 190units.

3) Mech. Eng. Servcing for Bldgs A, B, C, D, G1, G2, H provided by LKM, dated July 19, 2011. Revised Storm and Sanitary flow per November 29, 2011 email.

4) City of Ottawa rates were estimated accordingly

Water Supply

Retail: Average Day 2.5L/m^2/d, Max Day = Avg Day x 1.5, Peak Hour = Avg Day x 2.7

Residential:

Townhouse Avg Day = 2.7p/unit x 350m^3/d, Max Day = Avg Day x 2.5, Peak Hour = Avg Day x 5.5

Apartement Avg Day = 1.8p/unit x 350m^3/d, Max Day = Avg Day x 2.5, Peak Hour = Avg Day x 5.5

Office: Average Day 75L/9.3m^2/d, Max Day = Avg Day x 1.5, Peak Hour = Avg Day x 2.7

North and South Stands: City of Ottawa completed Flow Monitoring in 2005. A peak dry weather flow for a capacity game was recorded to be 15.1L/s.

Report titled "Lansdowne Park - 2005, Combined Sewer Flow Monitoring Report," G.A. Clark & Associates Limited, Proj. No: 200524

Interpolated Average Day, Max Day and, Peak Hour accordingly: Peak Hour = 15.1L/s, Max Day = Peak Hour / 1.8, Average Day = Peak Hour / 2.7

North and South stands flow proportioned by number of seating: North Stands = 14,542 South Stands = 14,284, as decribed in Lansdowne Park information material.

Civil Centre: Flow monitoring completed in 2005 indicated a peak a 4L/s. However, this recorded flow did not account for wastewater directed to Holmwood.

Civil Centre Flow estimated based on Stadium monitored flow and seating: 9,836 / 28,826 x 15.1 = 5.2L/s

Interpolated Average Day, Max Day and, Peak Hour accordingly: Peak Hour = 5.2L/s, Max Day = Peak Hour / 1.8, Average Day = Peak Hour / 2.7

Wastewater

Retail: Average Day 5L/m^2/d x 24hour day / 12hour operation, Peak = Average Day x 1.5

Residential:

Townhouse Avg Day = 2.7p/unit x 350m^3/d, Peak = Avg Day x 3.95

Apartment Avg Day = 1.8p/unit x 350m^3/d, Peak = Avg Day x 3.95

Office: Average Day 75L/9.3m^2/d, Peak = Avg Day x 1.5

North and South Stands: City of Ottawa completed Flow Monitoring in 2005. A peak dry weather flow for a capacity game was recorded to be 15.1L/s.

Report titled "Lansdowne Park - 2005, Combined Sewer Flow Monitoring Report," G.A. Clark & Associates Limited, Proj. No: 200524

Peak flow interpreted as peak monitored flow (15.1L/s)

North stands flow proportioned by number of seating: North Stands = 14,542 South Stands = 14,284, as decribed in Lansdowne Park information material.

Civil Centre: Flow monitoring completed in 2005 indicated a peak a 4L/s. However, this recorded flow did not account for wastewater directed to Holmwood.

Civil Centre Flow estimated based on Stadium monitored flow and seating: 9,836 / 28,826 x 15.1 = 5.2L/s

South Stands - Mechanical Consultant provided estimated peak Wastewater Flow Rate (Smith and Anderson (2011-12-02) servicing sketch)

Storm

See Separate Analysis - Estimated per City of Ottawa IDF curves and Control Flow roof drains where appropriate


North and South Stands assumed to have roof drains sized to accommodate 5-year storm only. To be confirmed by DSEL through modeling.

PROJECT: **Lansdowne Park Re-Development**
LOCATION: **City of Ottawa**
FILE REF: **10-378**
DATE: **19-Dec-11**

DESIGN PARAMETERS

Avg. Daily Flow Res.	350	L/p/d	Peak Fact Res. Per Harmons: Min = 2.0, Max =4.0		Infiltration / Inflow	0.28	L/s/ha
Avg. Daily Flow Retail	5	$L/m^2/d$	Peak Fact. Retail	1.5	Min. Pipe Velocity	0.60	m/s full flowing
Avg. Office Flow	75	$L/9.3m^2/d$	Peak Fact. Office	1.5	Max. Pipe Velocity	3.00	m/s full flowing
					Mannings N	0.013	

Location			Residential Area and Population								Retail		Office		Other			Infiltration				Pipe Data							
Area ID	Up	Down	Area			Pop.	Cumulative		Peak.	Q_{res}	Area	Accu.	Incr.	Accu.	Area	Accu.	Q_{C+I+I}	Total	Accu.	Infiltration	Total	DIA	Slope	Length	$A_{hydraulic}$	R	Velocity	Q_{cap}	Q / Q full
							Area	Pop.	Fact.			Area	Area	Area		Area		Area	Area	Flow	Flow								
			(ha)	Town's	Apt's		(ha)		(-)	(L/s)	(m^2)	(m^2)	(m^2)	(m^2)	(L/s)	(L/s)	(L/s)	(ha)	(ha)	(L/s)	(L/s)	(mm)	(%)	(m)	(m^2)	(m)	(m/s)	(L/s)	(-)
South Stands	19	18				0.0	0.000	0.0	4.00	0.0		-		-	11.6	11.6	11.6	0.000	0.000	0.000	11.6	300	0.20	61.0	0.071	0.075	0.61	43.2	0.27
	18	17				0.0	0.000	0.0	4.00	0.0		-		-		11.6	11.6	0.000	0.000	0.000	11.6	300	0.20	9.3	0.071	0.075	0.61	43.2	0.27
	17	16				0.0	0.000	0.0	4.00	0.0		-		-		11.6	11.6	0.000	0.000	0.000	11.6	300	0.20	5.8	0.071	0.075	0.61	43.2	0.27
	16	13				0.0	0.000	0.0	4.00	0.0		-		-		11.6	11.6	0.000	0.000	0.000	11.6	300	0.20	62.6	0.071	0.075	0.61	43.2	0.27
BLDG K, I, N.Stands	15	14			190	342.0	0.000	342.0	4.00	5.5	2,505	2,505	8,361	8,361	7.6	7.6	9.2	0.000	0.000	0.000	14.8	300	0.20	74.9	0.071	0.075	0.61	43.2	0.34
	14	13				0.0	0.000	342.0	4.00	5.5		2,505		8,361		7.6	9.2	0.000	0.000	0.000	14.8	300	0.20	74.9	0.071	0.075	0.61	43.2	0.34
	13	12				0.0	0.000	342.0	4.00	5.5		2,505		8,361		19.2	20.8	0.000	0.000	0.000	26.4	300	0.20	44.4	0.071	0.075	0.61	43.2	0.61
	12	9				0.0	0.000	342.0	4.00	5.5		2,505		8,361		19.2	20.8	0.000	0.000	0.000	26.4	300	0.20	56.6	0.071	0.075	0.61	43.2	0.61
BLDG G1, G2, H, J, Salon, Civic Cen	11	10				0.0	0.000	0.0	4.00	0.0	15,845	15,845		-	5.2	5.2	8.0	0.000	0.000	0.000	8.0	250	0.38	38.2	0.049	0.063	0.75	36.7	0.22
	10	9				0.0	0.000	0.0	4.00	0.0		15,845		-		5.2	8.0	0.000	0.000	0.000	8.0	250	0.38	7.5	0.049	0.063	0.75	36.7	0.22
	9	8				0.0	0.000	342.0	4.00	5.5		18,350		8,361		24.4	28.8	0.000	0.000	0.000	34.3	375	0.15	84.0	0.110	0.094	0.61	67.9	0.51
Aberdeen Pavilion	8	7				0.0	0.000	342.0	4.00	5.5	4,098	22,448		8,361		24.4	29.5	0.000	0.000	0.000	35.0	375	0.15	23.3	0.110	0.094	0.61	67.9	0.52
BLDG A, B, C, D, Horticulture	7	5		40	50	198.0	0.000	540.0	3.96	8.7	22,514	44,962		8,361		24.4	33.4	0.000	0.000	0.000	42.0	375	0.15	83.5	0.110	0.094	0.61	67.9	0.62
	5	4				0.0	0.000	540.0	3.96	8.7		44,962		8,361		24.4	33.4	0.000	0.000	0.000	42.0	375	0.15	10.1	0.110	0.094	0.61	67.9	0.62
	4	3				0.0	0.000	540.0	3.96	8.7		44,962		8,361		24.4	33.4	0.000	0.000	0.000	42.0	375	0.15	17.5	0.110	0.094	0.61	67.9	0.62
	3	2				0.0	0.000	540.0	3.96	8.7		44,962		8,361		24.4	33.4	0.000	0.000	0.000	42.0	375	0.15	60.0	0.110	0.094	0.61	67.9	0.62
	2	1				0.0	0.000	540.0	3.96	8.7		44,962		8,361		24.4	33.4	0.000	0.000	0.000	42.0	375	0.15	24.7	0.110	0.094	0.61	67.9	0.62
	1	EX				0.0	0.000	540.0	3.96	8.7		44,962		8,361		24.4	33.4	0.000	0.000	0.000	42.0	375	0.15	9.7	0.110	0.094	0.61	67.9	0.62

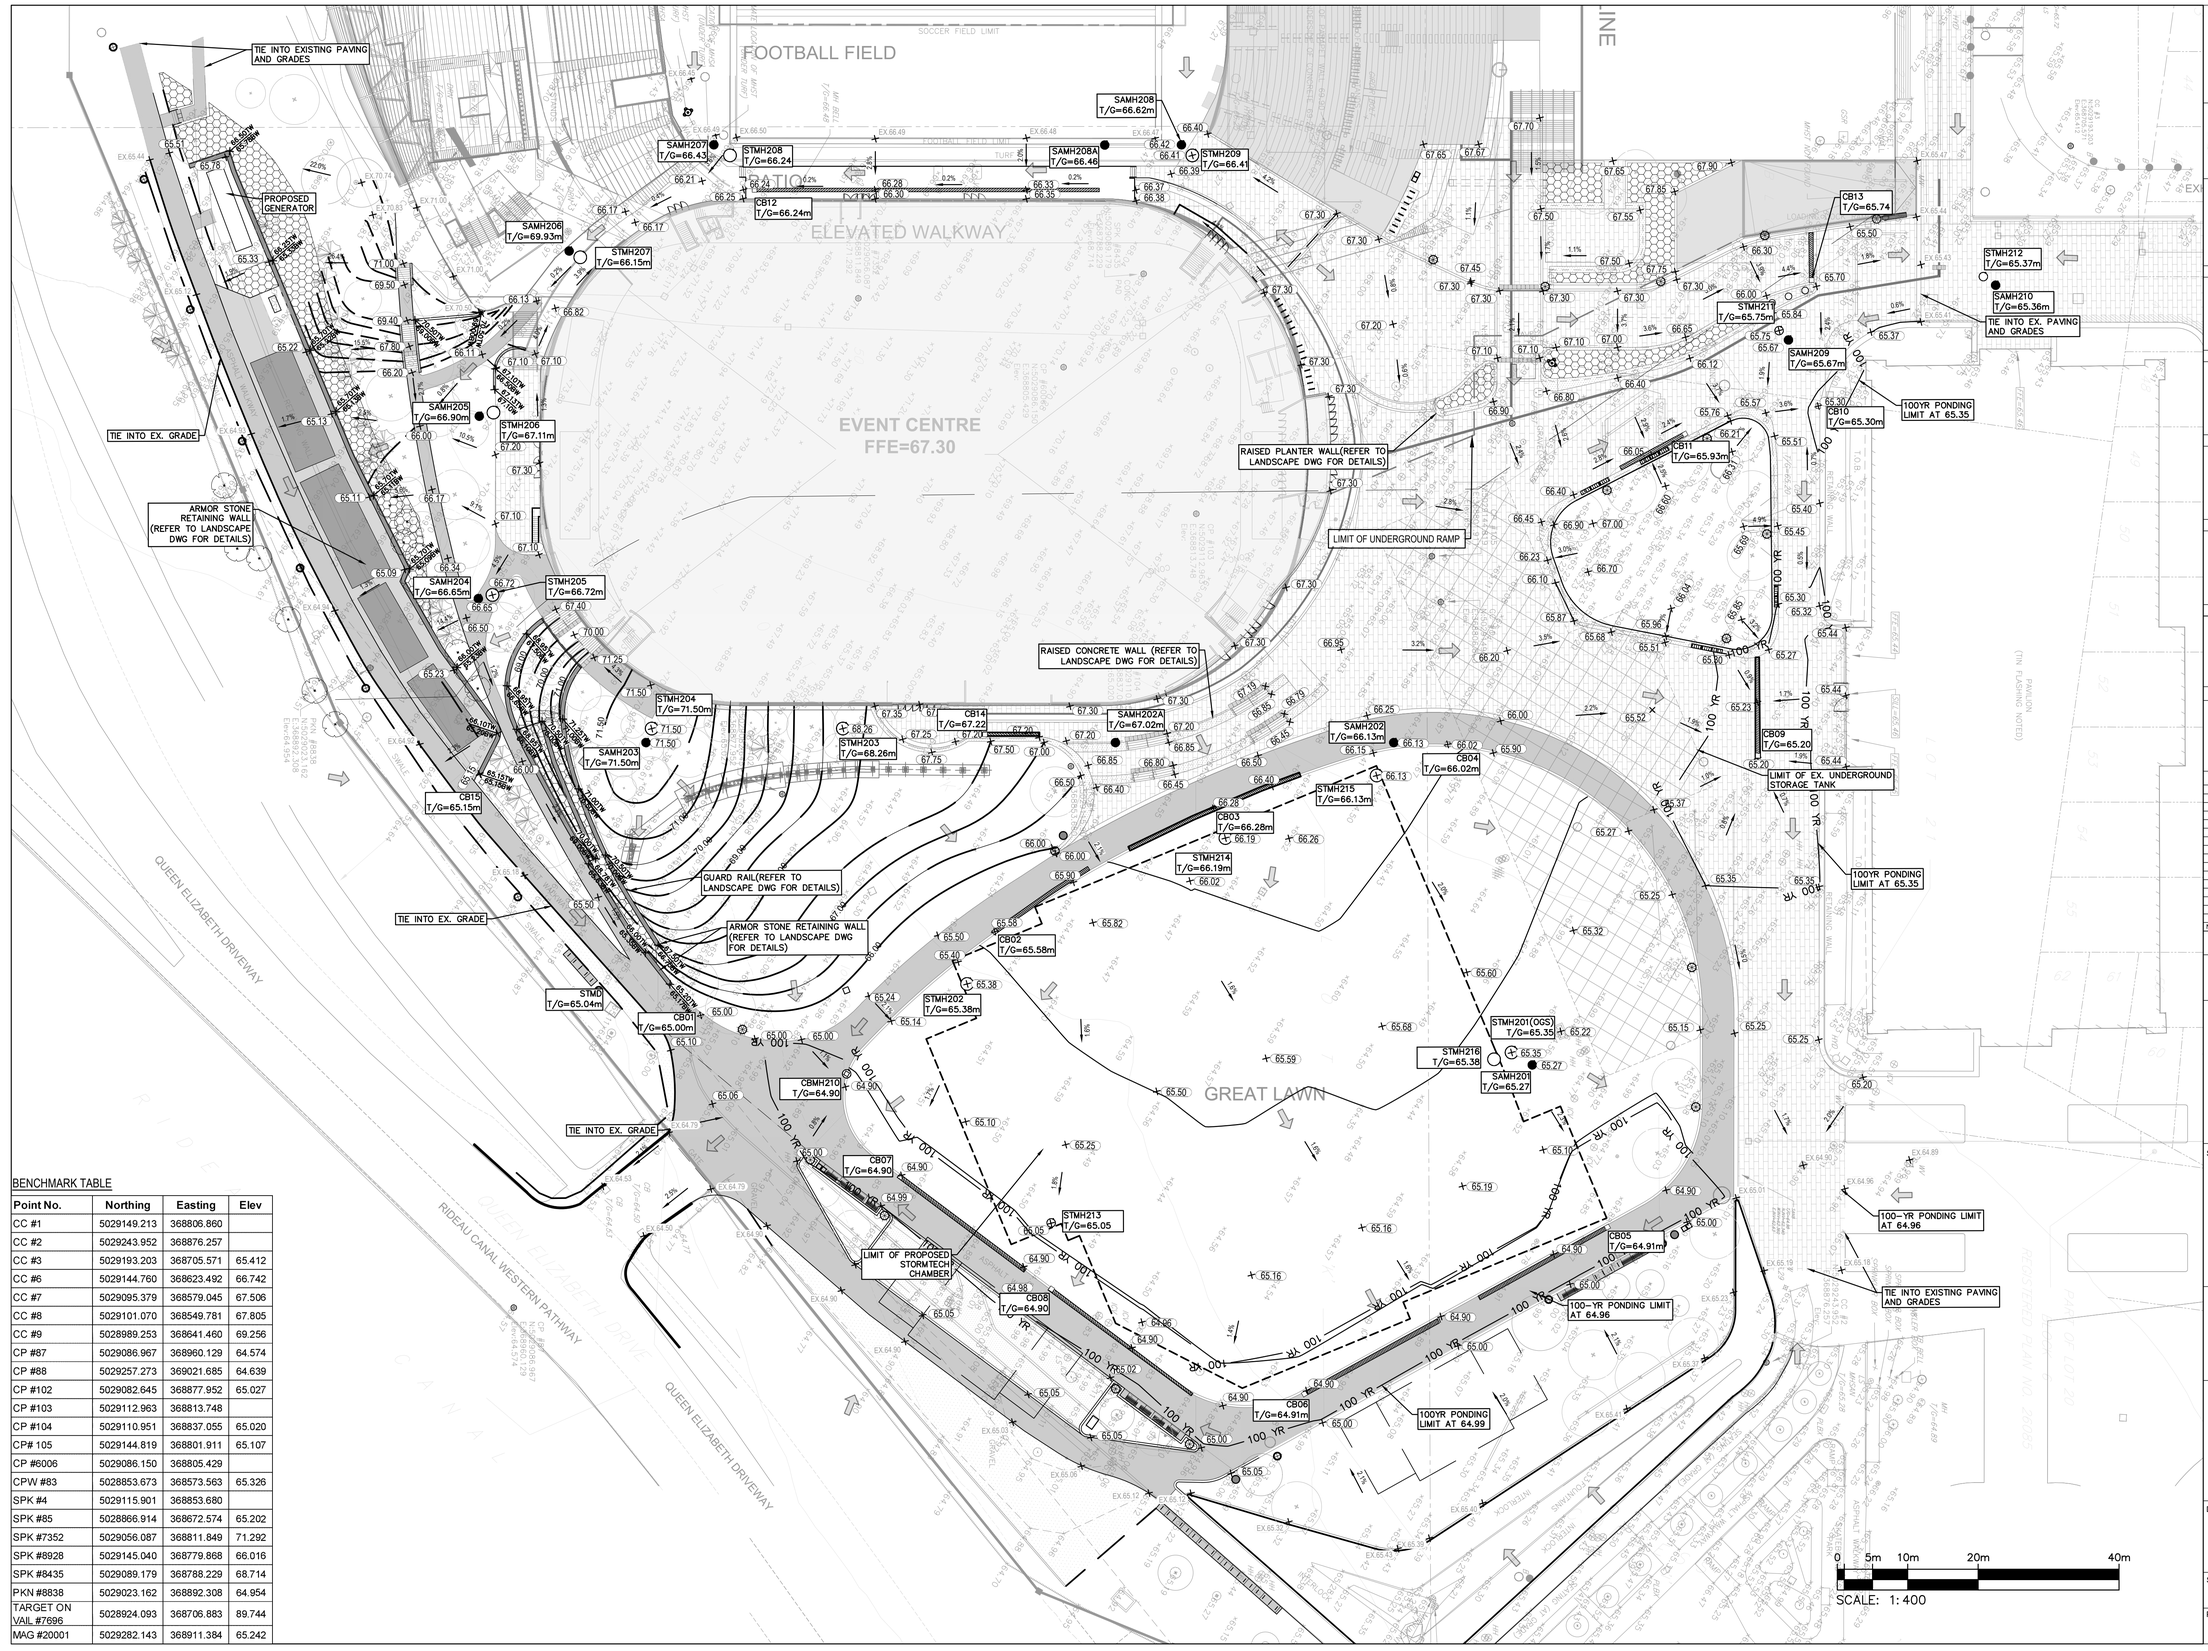

BENCHMARK TABLE

Point No.	Northing	Easting	Elev
CC #1	5029149.213	368806.860	
CC #2	5029243.952	368876.257	
CC #3	5029193.203	368705.571	65.412
CC #6	5029144.760	368623.492	66.742
CC #7	5029095.379	368579.045	67.506
CC #8	5029101.070	368549.781	67.805
CC #9	5028989.253	368641.460	69.256
CP #87	5029086.967	368960.129	64.574
CP #88	5029257.273	369021.685	64.639
CP #102	5029082.645	368877.952	65.027
CP #103	5029112.963	368813.748	
CP #104	5029110.951	368837.055	65.020
CP# 105	5029144.819	368801.911	65.107
CP #6006	5029086.150	368805.429	
CPW #83	5028853.673	368573.563	65.326
SPK #4	5029115.901	368853.680	
SPK #85	5028866.914	368672.574	65.202
SPK #7352	5029056.087	368811.849	71.292
SPK #8928	5029145.040	368779.868	66.016
SPK #8435	5029089.179	368788.229	68.714
PKN #8838	5029023.162	368892.308	64.954
TARGET ON VAIL #7696	5028924.093	368706.883	89.744
MAG #20001	5029282.143	368911.384	65.242

DATE PLOTTED:

Ottawa

OSEG
Ottawa Sports and Entertainment Group

BRISBIN BROOK BEYNON ARCHITECTS
14 DUNCAN ST 4TH FLOOR
TORONTO, ON M5H 3G8
(416) 591-8999
ARCHITECT

ENTUITIVE
135 LAURIER AVE WEST, SUITE 413
OTTAWA, ON K1P 5J2
(343) 308-8274
STRUCTURAL ENGINEER

TMP
200 KING. ST. WEST, SUITE 310
TORONTO, ON M5H 3T4
(416) 499-8000
MECH, PLUMB, FIRE PROTECTION ENGINEER

MULVEY & BANANI
90 SHEPPARD AVE EAST, SUITE 500
TORONTO, ON M2N 3A
(416) 751-2520
ELEC, LIGHTING ENGINEER

S2O
530 N. WOOD STREET #C
CHICAGO, IL 60622
(224) 717-1999
FOOD AND BEVERAGE

CSW
319 MCRAE AVENUE, SUITE 502
OTTAWA, ONTARIO K1Z 0B9
(613) 729-4536
LANDSCAPE ARCHITECT

wsp
2011 QUEENSVIEW DR.
OTTAWA, ONTARIO K2B 8K2
(613) 829-2800
CIVIL ENGINEER

NO.	DESCRIPTION	DATE
7	REVISED AS PER CITY COMMENTS	2025-03-07
6	ISSUED FOR CD UPDATE	2025-02-28
5	ISSUED FOR CD UPDATE	2025-01-17
4	REVISED AS PER CITY COMMENTS	2025-01-15
3	ISSUED FOR 90% DD - CLASS B ESTIMATE	2024-11-15
2	REVISED AS PER CITY COMMENTS	2024-09-13
1	ISSUED FOR SPA	2024-08-07

REVISIONS/ ISSUES

CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ANY OMISSIONS OR DISCREPANCIES TO THE ARCHITECT BEFORE PROCEEDING WITH THE WORK.
DO NOT SCALE THE DRAWINGS



SEAL

LICENSED PROFESSIONAL ENGINEER
D. B. YANG
100230568
2025-03-07
PROVINCE OF ONTARIO

HUNTER

DRAWN	J.T
DATE	2025/03/07
CHECKED	W.Y

LANSDOWNE EVENT CENTRE

945 & 1015 BANK STREET

DWG. TITLE

GRADING PLAN

SCALE	DWG. NO.
1:400	C04
PROJ. NO.	
CA0033920.1056	

#D07-12-24-0082

#19172

BENCHMARK TABLE

Point No.	Northing	Easting	Elev
CC #1	5029149.213	368806.860	
CC #2	5029243.952	368876.257	
CC #3	5029193.203	368705.571	65.412
CC #6	5029144.760	368623.492	66.742
CC #7	5029095.379	368579.045	67.506
CC #8	5029101.070	368549.781	67.805
CC #9	5028989.253	368641.460	69.256
CP #87	5029086.967	368960.129	64.574
CP #88	5029257.273	369021.685	64.639
CP #102	5029082.645	368877.952	65.027
CP #103	5029112.963	368813.748	
CP #104	5029110.951	368837.055	65.020
CP# 105	5029144.819	368801.911	65.107
CP #6006	5029086.150	368805.429	
CPW #83	5028853.673	368573.563	65.326
SPK #4	5029115.901	368853.680	
SPK #85	5028866.914	368672.574	65.202
SPK #7352	5029056.087	368811.849	71.292
SPK #8928	5029145.040	368779.868	66.016
SPK #8435	5029089.179	368788.229	68.714
PKN #8838	5029023.162	368892.308	64.954
TARGET ON VAIL #7696	5028924.093	368706.883	89.744
MAG #20001	5029282.143	368911.384	65.242

Ottawa

OSEG
Ottawa Sports and Entertainment Group

BRISBIN BROOK BEYNON ARCHITECTS
14 DUNCAN ST 4TH FLOOR
TORONTO, ON M5H 3G8
(416) 591-8999
ARCHITECT

ENTUITIVE
135 LAURIER AVE WEST, SUITE 413
OTTAWA, ON K1P 5J2
(343) 308-9274
STRUCTURAL ENGINEER

TMP
200 KING. ST. WEST, SUITE 310
TORONTO, ON M5H 3T4
(416) 499-8000
MECH, PLUMB, FIRE PROTECTION ENGINEER

MULVEY & BANANI
90 SHEPPARD AVE EAST, SUITE 500
TORONTO, ON M2N 3A
(416) 751-2520
ELEC, LIGHTING ENGINEER

S2O
530 N. WOOD STREET #C
CHICAGO, IL 60622
(224) 717-1999
FOOD AND BEVERAGE

CSW
319 MCRAE AVENUE, SUITE 502
OTTAWA, ONTARIO K1Z 0B9
(613) 729-4536
LANDSCAPE ARCHITECT

msp
2011 QUEENSVIEW DR.
OTTAWA, ONTARIO K2B 8K2
(613) 829-2800
CIVIL ENGINEER

NO.	DESCRIPTION	DATE
7	REVISED AS PER CITY COMMENTS	2025-03-07
6	ISSUED FOR CD UPDATE	2025-02-28
5	ISSUED FOR CD UPDATE	2025-01-17
4	REVISED AS PER CITY COMMENTS	2025-01-15
3	ISSUED FOR 90% DD - CLASS B ESTIMATE	2024-11-15
2	REVISED AS PER CITY COMMENTS	2024-09-13
1	ISSUED FOR SPA	2024-08-07

REVISIONS/ ISSUES

CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ANY OMISSIONS OR DISCREPANCIES TO THE ARCHITECT BEFORE PROCEEDING WITH THE WORK.
DO NOT SCALE THE DRAWINGS



SEAL

LICENSED PROFESSIONAL ENGINEER
D. B. YANG
100230568
2025-03-07
PROVINCE OF ONTARIO

DRAWN	J.T
DATE	2025/03/07
CHECKED	W.Y

LANSDOWNE EVENT CENTRE

945 & 1015 BANK STREET

DWG. TITLE

SERVICING PLAN

SCALE	DWG. NO.
1:400	C05A
PROJ. NO.	
CA0033920.1056	

SCALE: 1: 400

DATE PLOTTED:

#19172

#D07-12-24-0082

MATCH LINE
SEE DRAWING C05A

EVENT CENTRE
FFE=67.30

GREAT LAWN

FIELD

EXHIBITION WAY

PRINCESS PATRICIA WAY

QUEEN ELIZABETH DRIVEWAY

RIDEAU CANAL WESTERN PATHWAY

PROPERTY LINE

SOCCER FIELD LIMIT

TRENCH DRAIN AT THE BOTTOM OF THE RAMP AND LEAD OUTLET TO GARAGE STORM COLLECTION SYSTEM

CONNECT TO 900mm STM AT INV.=63.594

NEW 10.88m – 375mm⌀ PVC SAN @ 0.15%

NEW 65.64m – 900mm⌀ CONC STM @ 0.10%

NEW 55.51m – 375mm⌀ PVC SAN @ 0.15%

NEW 200mm⌀ PVC W/M

SAMH207
T/G =66.43m
INV. NW = 62.94m
INV. SE = 62.92m
INV. SW = 63.34m

SAMH208A
T/G =66.46m
INV. NW = 63.02m
INV. SE = 63.02m
INV. NE = 64.86m

SAMH208
T/G =66.42m
INV. SW = 63.10m
INV. SE = 63.04m

STMH209
T/G = 66.41m
INV. SE = 63.58m
INV. SW = 63.62m

FDC FOR SS

NEW 25.49m – 375mm⌀ PVC SAN @ 0.15%

NEW 2.92m – 250mm⌀ PVC STM @ 1.01%

NEW 5.36m – 300mm⌀ PVC STM @ 1.01%

NEW 6.84m – 200mm⌀ PVC SAN @ 1.04%

CB12
T/G = 66.24m
INV. SW = 63.66m

CONNECT TO BUILDING WATER SERVICE AT 63.80m (REFER TO MECH DWG FOR CONTINUATION)

CONNECT TO BUILDING SANITARY SERVICE AND BUILDING FOUNDATION DRAIN. SEE MECH. PLANS FOR CONTINUATION. INV.=64.93m

CONNECT TO BUILDING WATER SERVICE AT 64.10m (REFER TO MECH DWG FOR CONTINUATION)

CONNECT TO BUILDING ROOFDRAIN. SEE MECH. PLAN FOR CONTINUATION INV.=63.646m

SAMH206
T/G =66.93m
INV. NW = 62.88m
INV. E = 62.86m

STMH207
T/G = 66.15m
INV. NW = 63.42m
INV. E = 63.39m

STMH208
T/G = 66.39m
INV. NW = 63.52m
INV. SE = 63.44m
INV. SW = 63.90m

NEW 25.72m – 1050mm⌀ CONC STM @ 0.10%

NEW 26.70m – 375mm⌀ PVC SAN @ 0.15%

CONNECT TO EX.200mm W/M WITH 22.5° BEND TEE

NEW 25.35m – 1050mm⌀ CONC STM @ 0.10%

CONNECT TO BUILDING WATER SERVICE AT 64.50m (REFER TO MECH DWG FOR CONTINUATION)

NEW 200mm⌀ PVC W/M

SAMH205
T/G = 66.90m
INV. W = 62.82m
INV. NE = 62.80m

STMH206
T/G = 67.11m
INV. W = 63.37m
INV. NE = 63.35m

200mm HDPE PERFORATED RETAINING WALL SUBDRAIN

NEW 25.91m – 375mm⌀ PVC SAN @ 0.15%

NEW 25.80m – 1050mm⌀ CONC STM @ 0.10%

STMH205
T/G = 66.72m
INV. SW = 63.32m
INV. N = 63.29m
INV. NW = 64.07m

NEW 200mm⌀ PVC W/M

CONNECT TO BUILDING WATER SERVICE AT 64.50m (REFER TO MECH DWG FOR CONTINUATION)

CONNECT TO BUILDING ROOF DRAIN AT 64.15m (SEE MECH. PLAN FOR CONTINUATION).

NEW 8.22m – 300mm⌀ PVC STM @ 1.00%

CONNECT TO BUILDING WATER SERVICE AT 65.00m (REFER TO MECH DWG FOR CONTINUATION)

CONNECT TO EX.200mm W/M WITH 200X200 TEE

SAMH204
T/G =66.65m
INV. SW = 62.76m
INV. N = 62.74m

INSTALL 200mm VB ON EX.200mm W/M

NEW 29.52m – 1050mm⌀ CONC STM @ 0.10%

EX.STMC
T/G = 64.57m
INV. N = 63.350m
INV. SW = 63.360m

NEW 31.38m – 375mm⌀ PVC SAN @ 0.15%

CONNECT TO EX.200mm W/M WITH 200X200 TEE

NEW 200mm⌀ PVC W/M

SAMH203
T/G =71.50m
INV. S = 62.69m
INV. NW = 62.67m

CB15
T/G = 65.15m
INV. E = 63.83m

NEW 27.14m – 1050mm⌀ CONC STM @ 0.10%

NEW 6.59m – 250mm⌀ PVC STM @ 1.00%

NEW 66.65m – 375mm⌀ PVC SAN @ 0.15%

STMH204
T/G = 71.50m
INV. S = 63.26m
INV. NW = 63.24m

STMH203
T/G = 68.26m
INV. SE = 63.21m
INV. NE = 63.19m

ACO TRENCH DRAIN CB14
T/G = 67.22m
INV. SE = 64.29m

NEW 39.51m – 375mm⌀ PVC SAN @ 0.15%

NEW 3.27m – 200mm⌀ PVC SAN @ 1.00%

SAMH202A
T/G =67.02m
INV. SE = 62.57m
INV. NW = 62.57m
INV. SW = 64.91m

SAMH202
T/G =66.13m
INV. SE = 62.51m
INV. NE = 62.48m

NEW 5.16m – 250mm⌀ PVC STM @ 1.00%

CB04
T/G = 66.02m
INV. SE = 64.22m

NEW 11.00m – 250mm⌀ PVC STM @ 1.02%

STMH215
T/G = 66.13m
INV. NW = 64.11m
INV. NE = 63.38m
INV. SE = 63.06m

ACO TRENCH DRAIN CB03
T/G = 66.28m
INV. NE = 64.19m

NEW 4.53m – 250mm⌀ PVC STM @ 1.79%

STMH214
T/G = 66.19m
INV. SW = 64.11m
INV. NW = 63.60m
INV. SE = 63.06m

NEW 49.82m – 375mm⌀ PVC SAN @ 0.15%

37.16m – 250mm PERFORATED HDPE STM C/W FILTER SOCK

NEW 17.37m – 250mm⌀ PVC STM @ 1.00%

NEW 6.25m – 250mm⌀ CONC STM @ 0.93%

27.64m – 250mm PERFORATED HDPE STM C/W FILTER SOCK

ACO TRENCH DRAIN CB02
T/G = 65.58m
INV. SE = 64.01m

27.11m – 250mm PERFORATED HDPE STM C/W FILTER SOCK

200mm HDPE PERFORATED RETAINING WALL SUBDRAIN

CB01
T/G = 65.00m
INV. E = 63.60m

NEW 3.04m – 1050mm⌀ CONC STM @ 0.07%

NEW 2.67m – 250mm⌀ PVC STM @ 0.00%

CONNECT TO EX.DICB AT INV.63.05 REPLACE EX.DICB GRATE AND TOP SECTION WITH NEW STMH GRATE AND RISER TO MEET NEW GRADING

STMH202
T/G = 65.38m
INV. SW = 63.15m
INV. SE = 63.38m
INV. NW = 63.06m

STMH216
T/G = 65.38m
INV. NW = 63.08m
INV. SE = 63.08m

NEW 7.62m – 900mm⌀ CONC STM @ 0.10%

NEW 33.19m – 375mm⌀ PVC SAN @ 0.15%

STMH201(OGS)
T/G = 65.35m
INV. NW = 63.06m
INV. SE = 63.08m

74.50m – 250mm PERFORATED HDPE STM C/W FILTER SOCK

SAMH201
T/G =65.27m
INV. SW = 62.41m
INV. N = 62.38m

STMD(1500x1800)
T/G = 65.04m
INV. W = 63.200m
INV. S = 63.270m
INV. N = 63.240m

NEW 2.53m – 250mm⌀ PVC STM @ 0.99%

NEW 34.44m – 600mm⌀ CONC STM @ 0.07%

CBMH210
T/G = 64.90m
INV. NW = 63.18m
INV. S = 63.20m
INV. NE = 63.52m

PROVIDE INSULATION AS PER CITY STANDARD S35 (TYP.)

NEW 16.52m – 250mm⌀ PVC STM @ 1.00%

36.21m – 250mm PERFORATED HDPE STM C/W FILTER SOCK

NEW 21.34m – 600mm⌀ CONC STM @ -0.96%

STMH213
T/G = 65.05m
INV. NE = 63.11m
INV. NW = 63.06m
INV. SE = 63.38m
INV. SW = 63.38m

ACO TRENCH DRAIN CB07
T/G = 64.90m
INV. SW = 63.69m

NEW 2.29m – 250mm⌀ PVC STM @ 0.09%

ACO TRENCH DRAIN CB05
T/G = 64.91m
INV. NE = 63.74m

EX.1350mm⌀ CONC STORM SEWER

EX.STM108(1800x2400)
T/G = 65.05m
INV. SW = 62.830m
INV. NW = 62.800m
INV. SE = 62.000m
INV. N = 63.150m

EX.900mm⌀ CONC STORM SEWER

NEW 3.66m – 250mm⌀ PVC STM @ 1.00%

EX.STMGG(1800x1800)
T/G = 64.98m
INV. NW = 63.030m
INV. SE = 63.060m
INV. SW = 63.360m
INV. SW = 63.708m

PROPOSED STORMTECH CHAMBERS OR EQUIVALEN APPROVED BY ENGINEER
CHAMBERS AREA: 5013.5m²
CHAMBER DEPTH: 1.14m
BOTTOM OF CHAMBER: 63.03m
STORAGE REQUIRED: 3860m³
AVAILABLE STORAGE: 4302.5m³

NEW 9.40m – 250mm⌀ PVC STM @ 0.85%

ACO TRENCH DRAIN CB08
T/G = 64.90m
INV. SW = 63.19m

36.20m – 250mm PERFORATED HDPE STM C/W FILTER SOCK

33.05m – 250mm PERFORATED HDPE STM C/W FILTER SOCK

ACO TRENCH DRAIN CB06
T/G = 64.91m
INV. NE = 63.76m

NEW 3.66m – 250mm⌀ PVC STM @ 1.00%

PROVIDE INSULATION AS PER CITY STANDARD S35 (TYP.)

EX.STMFF(1500⌀)
T/G = 65.00m
INV. NW = 63.090m
INV. E = 63.090m
INV. SW = 63.150m

ACO TRENCH DRAIN CB13
T/G = 65.74m
INV. NE = 63.75m

NEW 5.75m – 250mm⌀ PVC STM @ 1.00%

STMH211
T/G = 65.75m
INV. W = 63.22m
INV. E = 63.22m
INV. NW = 63.24m

STMH212
T/G = 65.37m
INV. SE = 63.29m
INV. SW = 63.36m

NEW 12.03m – 600mm⌀ CONC STM @ 0.21%

EX.250mm⌀ CONC STORM SEWER

NEW 12.03m – 250mm⌀ PVC SAN @ 0.25%

EX.STM111A
T/G = 65.30m
INV. SE = 63.760m

EX.SAN-CCN1
T/G = 65.35m
INV. SW = 62.860m
INV. SE = 62.800m
INV. NE = 62.845m

SAMH210
T/G =65.36m
INV. SW = 62.82m
INV. SE = 62.76m

NEW 200mm⌀ PVC W/M

NEW 30.00m – 600mm⌀ CONC STM @ 0.15%

NEW 30.43m – 250mm⌀ PVC SAN @ 0.25%

EX.STM110
T/G = 64.01m
INV. W = 63.200m
INV. NE = 63.140m

SAMH209
T/G =65.67m
INV. NW = 62.68m
INV. E = 62.66m

EX.SAN10
T/G = 65.23m
INV. W = 62.634m
INV. NE = 62.598m

CB10
T/G = 65.30m
INV. SE = 63.62m

NEW 13.42m – 250mm⌀ PVC STM @ 1.00%

EX.SAN9
T/G = 65.24m
INV. SW = 62.570m
INV. NE = 62.530m
INV. SE = 62.560m

EX.STM109
T/G = 64.75m
INV. SW = 63.120m
INV. NE = 62.960m
INV. SE = 62.970m
INV. S = 63.399m

NEW 7.06m – 250mm⌀ PVC STM @ 1.00%

ACO TRENCH DRAIN CB11
T/G = 65.93m
INV. N = 63.47m

EX. 375mm⌀ PVC SAN SEWER

EX.1200mm⌀ CONC STORM SEWER

CONNECT TO EX. 200mm⌀ W/M WITH 200x200 TEE

LIMIT OF UNDERGROUND RAMP

EX.UNDERGROUND STORAGE TANK
DEPTH=1.25m
AREA=1780m²
VOLUME=2220m³

EX.1350mm⌀ CONC STORM SEWER

200mm HDPE PERFORATED SUBDRAIN

ACO TRENCH DRAIN CB09
T/G = 65.20m
INV. SE = 64.22m

200mm HDPE PERFORATED SUBDRAIN

150mm FH FED BY GARAGE DISTRIBUTION SYSTEM

200mm⌀ W/M AS PER THE BUILDING DISTRIBUTION SYSTEM DESIGN (REFER TO MECH DWG FOR DETAILS)

CONNECT TO BUILDING WATER SERVICE AT 62.90m (REFER TO MECH DWG FOR CONTINUATION).

CONNECT TO BUILDING SANITARY SERVICE AND BUILDING FOUNDATION DRAIN AT 64.94m (SEE MECH. PLANS FOR CONTINUATION).

FDC FOR EC

BENCHMARK TABLE

Point No.	Northing	Easting	Elev
CC #1	5029149.213	368806.860	
CC #2	5029243.952	368876.257	
CC #3	5029193.203	368705.571	65.412
CC #6	5029144.760	368623.492	66.742
CC #7	5029095.379	368579.045	67.506
CC #8	5029101.070	368549.781	67.805
CC #9	5028989.253	368641.460	69.256
CP #87	5029086.967	368960.129	64.574
CP #88	5029257.273	369021.685	64.639
CP #102	5029082.645	368877.952	65.027
CP #103	5029112.963	368813.748	
CP #104	5029110.951	368837.055	65.020
CP# 105	5029144.819	368801.911	65.107
CP #6006	5029086.150	368805.429	
CPW #83	5028853.673	368573.563	65.326
SPK #4	5029115.901	368853.680	
SPK #85	5028866.914	368672.574	65.202
SPK #7352	5029056.087	368811.849	71.292
SPK #8928	5029145.040	368779.868	66.016
SPK #8435	5029089.179	368788.229	68.714
PKN #8838	5029023.162	368892.308	64.954
TARGET ON VAIL #7696	5028924.093	368706.883	89.744
MAG #20001	5029282.143	368911.384	65.242

0 5m 10m 20m 40m
SCALE: 1:400

DATE PLOTTED:

Ottawa
OSEG
Ottawa Sports and Entertainment Group

BRISBIN BROOK BEYNON ARCHITECTS
14 DUNCAN ST 4TH FLOOR
TORONTO, ON M5H 3G8
(416) 591-8999
ARCHITECT

ENTUITIVE
135 LAURIER AVE WEST, SUITE 413
OTTAWA, ON K1P 5J2
(343) 308-9274
STRUCTURAL ENGINEER

TMP
200 KING. ST. WEST, SUITE 310
TORONTO, ON M5H 3T4
(416) 499-8000
MECH, PLUMB, FIRE PROTECTION ENGINEER

MULVEY & BANANI
90 SHEPPARD AVE EAST, SUITE 500
TORONTO, ON M2N 3A
(416) 751-2520
ELEC, LIGHTING ENGINEER

S2O
530 N. WOOD STREET #C
CHICAGO, IL 60622
(224) 717-1999
FOOD AND BEVERAGE

319 MCRAE AVENUE, SUITE 502
OTTAWA, ONTARIO K1Z 0B9
(613) 729-4536
LANDSCAPE ARCHITECT

wsp
2011 QUEENSVIEW DR.
OTTAWA, ONTARIO K2B 8K2
(613) 829-2800
CIVIL ENGINEER

NO.	DESCRIPTION	DATE
7	REVISED AS PER CITY COMMENTS	2025-03-07
6	ISSUED FOR CD UPDATE	2025-02-28
5	ISSUED FOR CD UPDATE	2025-01-17
4	REVISED AS PER CITY COMMENTS	2025-01-15
3	ISSUED FOR 90% DD - CLASS B ESTIMATE	2024-11-15
2	REVISED AS PER CITY COMMENTS	2024-09-13
1	ISSUED FOR SPA	2024-08-07

REVISIONS/ ISSUES

CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ANY OMISSIONS OR DISCREPANCIES TO THE ARCHITECT BEFORE PROCEEDING WITH THE WORK.
DO NOT SCALE THE DRAWINGS



SEAL

LICENSED PROFESSIONAL ENGINEER
D. B. YANG
100230568
2025-03-07
PROVINCE OF ONTARIO

DRAWN: J.T
DATE: 2025/03/07
CHECKED: W.Y

LANSDOWNE EVENT CENTRE

945 & 1015 BANK STREET

DWG. TITLE

SERVICING PLAN

SCALE: 1:400

DWG. NO.: C05B

PROJ. NO.: CA0033920.1056


#D07-12-24-0082

#19172

APPENDIX

D

- DWG C06 – EROSION AND SEDIMENTATION CONTROL PLAN

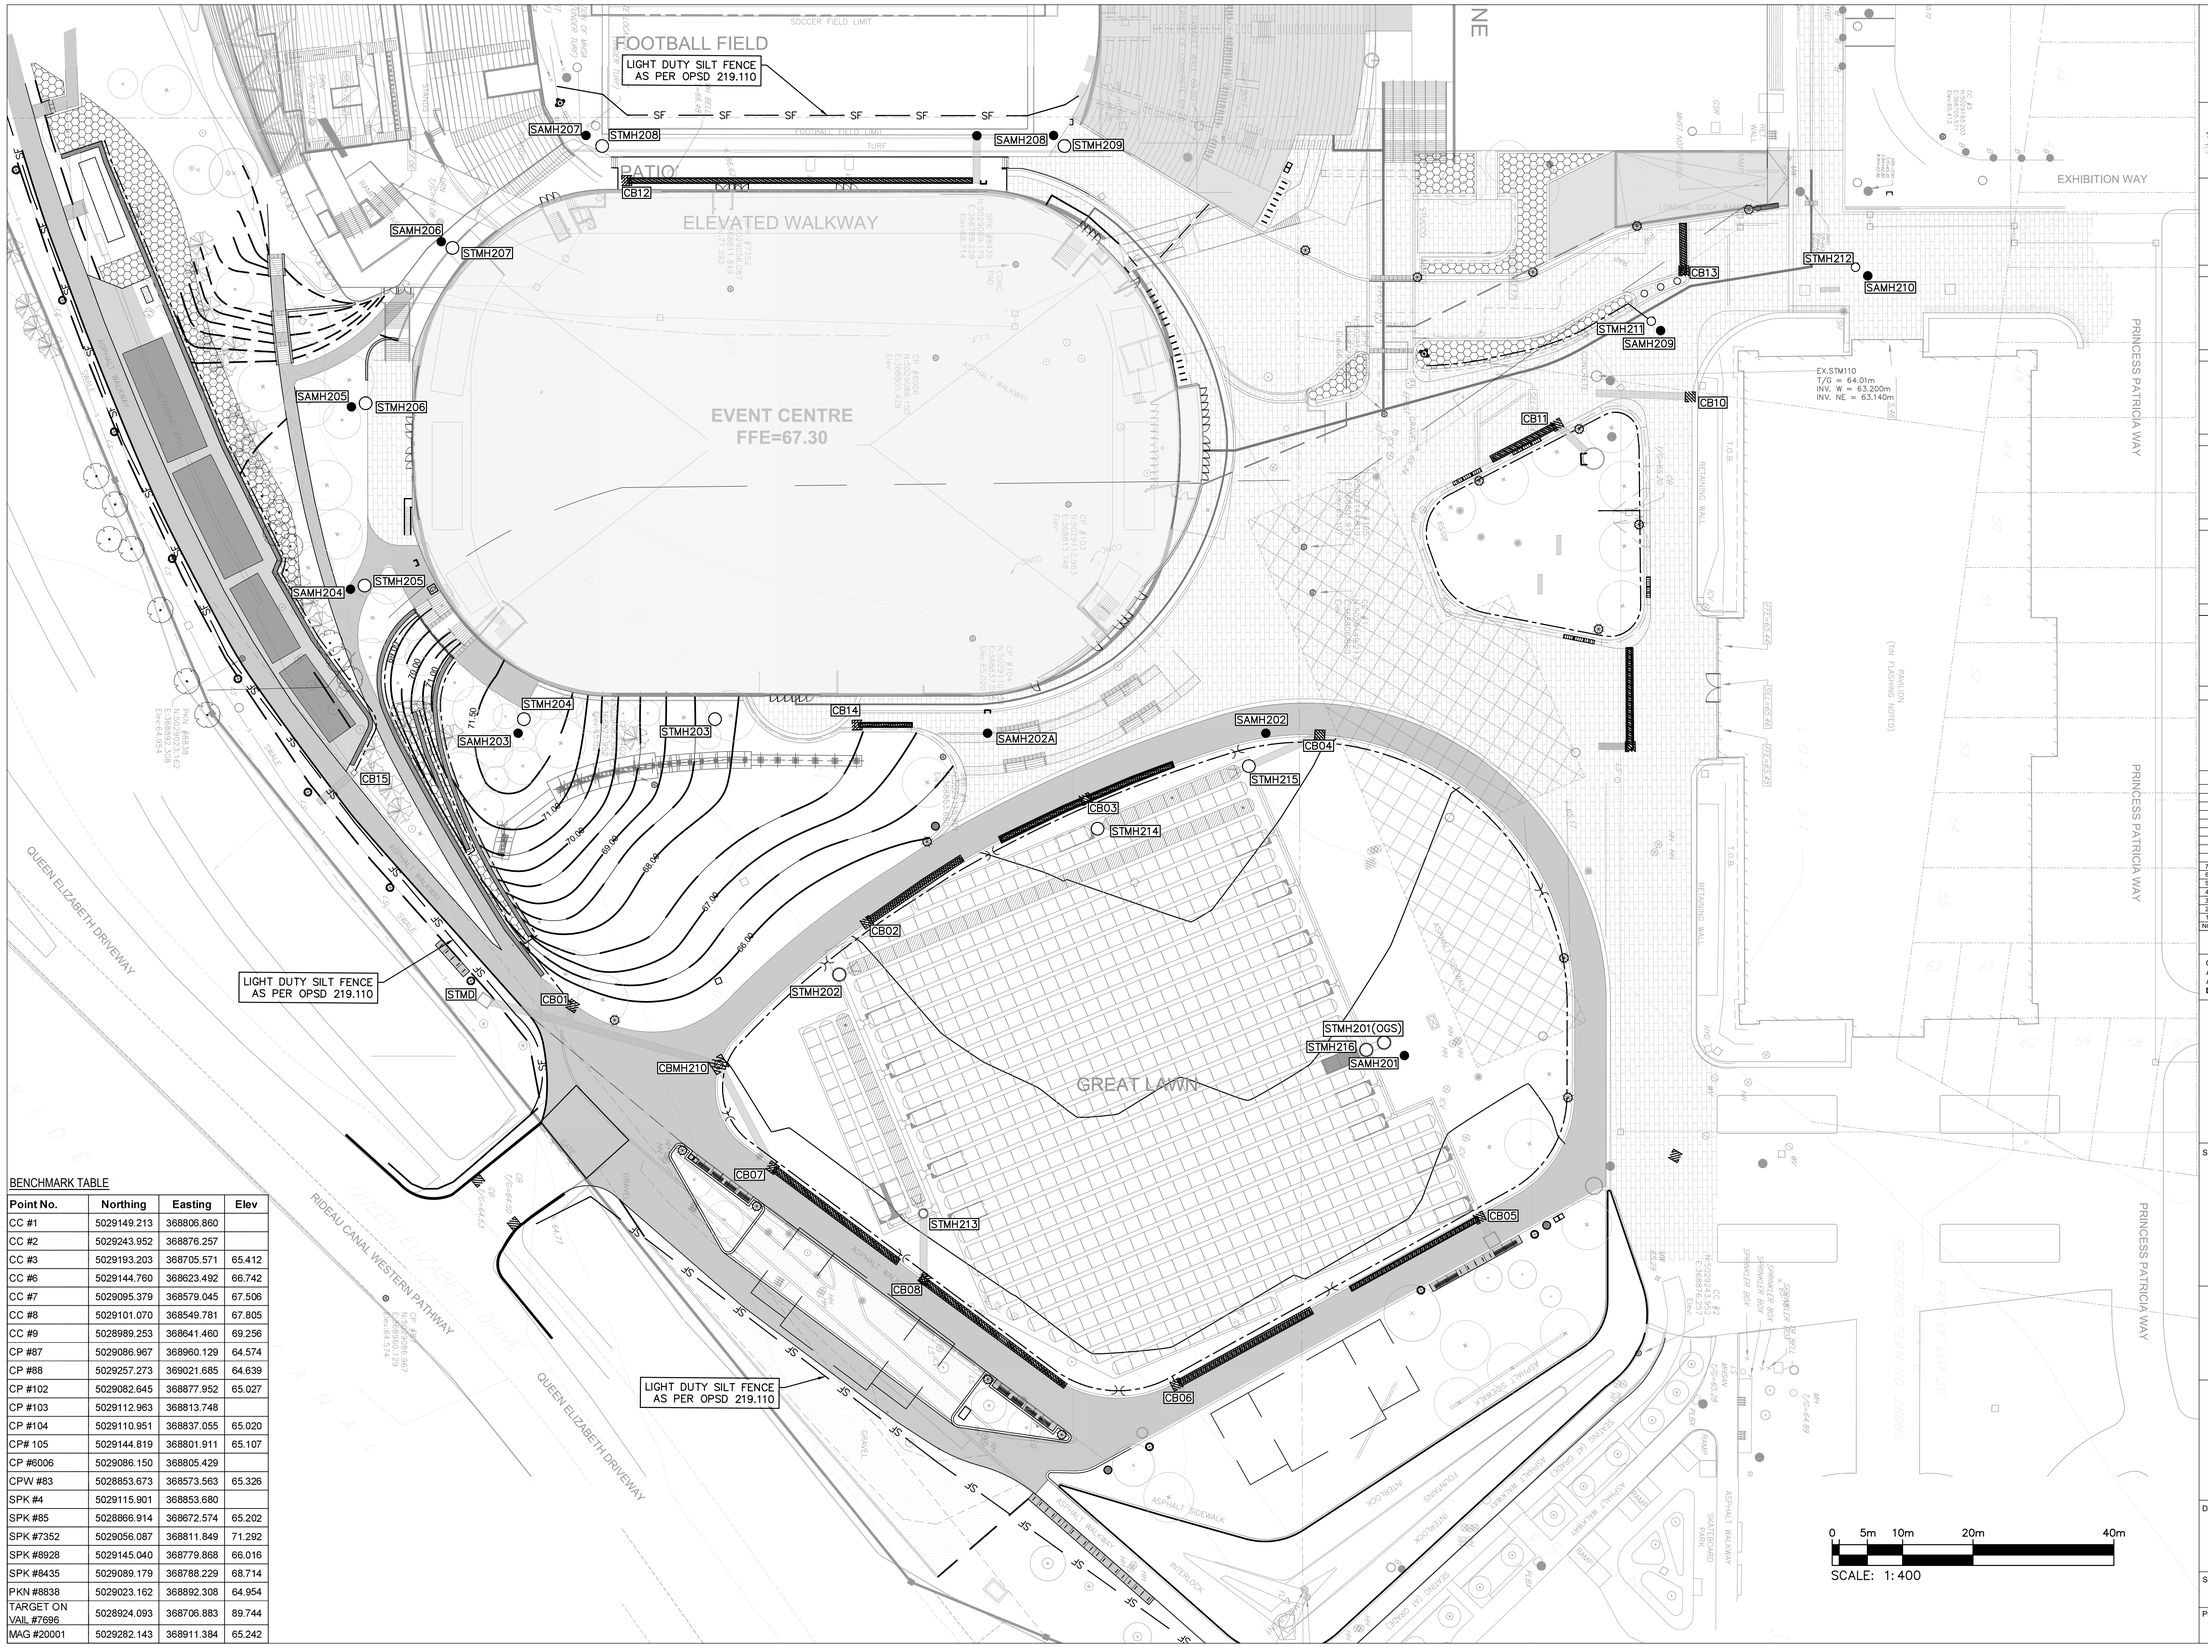

BENCHMARK TABLE

Point No.	Northing	Easting	Elev
CC #1	5029149.213	368806.860	
CC #2	5029243.952	368876.257	
CC #3	5029193.203	368705.571	65.412
CC #6	5029144.760	368623.492	66.742
CC #7	5029095.379	368579.045	67.506
CC #8	5029101.070	368549.781	67.805
CC #9	5028989.253	368641.460	69.256
CP #87	5029086.967	368960.129	64.574
CP #88	5029257.273	369021.685	64.639
CP #102	5029082.645	368877.952	65.027
CP #103	5029112.963	368813.748	
CP #104	5029110.951	368837.055	65.020
CP# 105	5029144.819	368801.911	65.107
CP #6006	5029086.150	368805.429	
CPW #83	5028853.673	368573.563	65.326
SPK #4	5029115.901	368853.680	
SPK #85	5028866.914	368672.574	65.202
SPK #7352	5029056.087	368811.849	71.292
SPK #8928	5029145.040	368779.868	66.016
SPK #8435	5029089.179	368788.229	68.714
PKN #8838	5029023.162	368892.308	64.954
TARGET ON VAIL #7696	5028924.093	368706.883	89.744
MAG #20001	5029282.143	368911.384	65.242

DATE PLOTTED:

Ottawa

OSEG
Ottawa Sports and Entertainment Group

BRISBIN BROOK BEYNON ARCHITECTS
14 DUNCAN ST 4TH FLOOR
TORONTO, ON M5H 3G8
(416) 591-8999
ARCHITECT

ENTUITIVE
135 LAURIER AVE WEST, SUITE 413
OTTAWA, ON K1P 5J2
(343) 308-9274
STRUCTURAL ENGINEER

TMP
200 KING. ST. WEST, SUITE 310
TORONTO, ON M5H 3T4
(416) 499-8000
MECH, PLUMB, FIRE PROTECTION ENGINEER

MULVEY & BANANI
90 SHEPPARD AVE EAST, SUITE 500
TORONTO, ON M2N 3A
(416) 751-2520
ELEC, LIGHTING ENGINEER

S2O
530 N. WOOD STREET #C
CHICAGO, IL 60622
(224) 717-1999
FOOD AND BEVERAGE

CSW
319 MCRAE AVENUE, SUITE 502
OTTAWA, ONTARIO K1Z 0B9
(613) 729-4536
LANDSCAPE ARCHITECT

wsp
2011 QUEENSVIEW DR.
OTTAWA, ONTARIO K2B 8K2
(613) 829-2800
CIVIL ENGINEER

NO.	DESCRIPTION	DATE
7	REVISED AS PER CITY COMMENTS	2025-03-07
6	ISSUED FOR CD UPDATE	2025-02-28
5	ISSUED FOR CD UPDATE	2025-01-17
4	REVISED AS PER CITY COMMENTS	2025-01-15
3	ISSUED FOR 90% DD - CLASS B ESTIMATE	2024-11-15
2	REVISED AS PER CITY COMMENTS	2024-09-13
1	ISSUED FOR SPA	2024-08-07

REVISIONS/ ISSUES

CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND REPORT ANY OMISSIONS OR DISCREPANCIES TO THE ARCHITECT BEFORE PROCEEDING WITH THE WORK.
DO NOT SCALE THE DRAWINGS



SEAL

LICENSED PROFESSIONAL ENGINEER
D. B. YANG
100230568
2025-03-07
PROVINCE OF ONTARIO

HUBON

DRAWN: J.T
DATE: 2025/03/07
CHECKED: W.Y

LANSDOWNE EVENT CENTRE

945 & 1015 BANK STREET

DWG. TITLE
EROSION AND SEDIMENT CONTROL PLAN

SCALE: 1:400
DWG. NO.: C06
PROJ. NO.: CA0033920.1056

#D07-12-24-0082
#19172

Servicing study guidelines for development applications

4. Development Servicing Study Checklist

The following section describes the checklist of the required content of servicing studies. It is expected that the proponent will address each one of the following items for the study to be deemed complete and ready for review by City of Ottawa Infrastructure Approvals staff.

The level of required detail in the Servicing Study will increase depending on the type of application. For example, for Official Plan amendments and re-zoning applications, the main issues will be to determine the capacity requirements for the proposed change in land use and confirm this against the existing capacity constraint, and to define the solutions, phasing of works and the financing of works to address the capacity constraint. For subdivisions and site plans, the above will be required with additional detailed information supporting the servicing within the development boundary.

4.1 General Content

- ☒ Executive Summary (for larger reports only).
- ☒ Date and revision number of the report.
- ☒ Location map and plan showing municipal address, boundary, and layout of proposed development.
- ☒ Plan showing the site and location of all existing services.
- ☒ Development statistics, land use, density, adherence to zoning and official plan, and reference to applicable subwatershed and watershed plans that provide context to which individual developments must adhere.
- ☒ Summary of Pre-consultation Meetings with City and other approval agencies.
- ☒ Reference and confirm conformance to higher level studies and reports (Master Servicing Studies, Environmental Assessments, Community Design Plans), or in the case where it is not in conformance, the proponent must provide justification and develop a defendable design criteria.
- ☒ Statement of objectives and servicing criteria.
- ☒ Identification of existing and proposed infrastructure available in the immediate area.
- ☒ Identification of Environmentally Significant Areas, watercourses and Municipal Drains potentially impacted by the proposed development (Reference can be made to the Natural Heritage Studies, if available).
- ☒ Concept level master grading plan to confirm existing and proposed grades in the development. This is required to confirm the feasibility of proposed stormwater management and drainage, soil removal and fill constraints, and potential impacts to neighbouring properties. This is also required to confirm that the proposed grading will not impede existing major system flow paths.
- ☐ Identification of potential impacts of proposed piped services on private services (such as wells and septic fields on adjacent lands) and mitigation required to address potential impacts.
- ☒ Proposed phasing of the development, if applicable.

☒ Reference to geotechnical studies and recommendations concerning servicing.

☒ All preliminary and formal site plan submissions should have the following information:
- Metric scale
- North arrow (including construction North)
- Key plan
- Name and contact information of applicant and property owner
- Property limits including bearings and dimensions
- Existing and proposed structures and parking areas
- Easements, road widening and rights-of-way
- Adjacent street names

4.2 Development Servicing Report: Water

☒ Confirm consistency with Master Servicing Study, if available
☒ Availability of public infrastructure to service proposed development
☒ Identification of system constraints
☒ Identify boundary conditions
☒ Confirmation of adequate domestic supply and pressure
☒ Confirmation of adequate fire flow protection and confirmation that fire flow is calculated as per the Fire Underwriter's Survey. Output should show available fire flow at locations throughout the development.
☒ Provide a check of high pressures. If pressure is found to be high, an assessment is required to confirm the application of pressure reducing valves.
☐ Definition of phasing constraints. Hydraulic modeling is required to confirm servicing for all defined phases of the project including the ultimate design
☒ Address reliability requirements such as appropriate location of shut-off valves
☒ Check on the necessity of a pressure zone boundary modification.
☒ Reference to water supply analysis to show that major infrastructure is capable of delivering sufficient water for the proposed land use. This includes data that shows that the expected demands under average day, peak hour and fire flow conditions provide water within the required pressure range

- ☒ Description of the proposed water distribution network, including locations of proposed connections to the existing system, provisions for necessary looping, and appurtenances (valves, pressure reducing valves, valve chambers, and fire hydrants) including special metering provisions.
- ☒ Description of off-site required feedermains, booster pumping stations, and other water infrastructure that will be ultimately required to service proposed development, including financing, interim facilities, and timing of implementation.
- ☒ Confirmation that water demands are calculated based on the City of Ottawa Design Guidelines.
- ☐ Provision of a model schematic showing the boundary conditions locations, streets, parcels, and building locations for reference.

4.3 Development Servicing Report: Wastewater

- ☒ Summary of proposed design criteria (Note: Wet-weather flow criteria should not deviate from the City of Ottawa Sewer Design Guidelines. Monitored flow data from relatively new infrastructure cannot be used to justify capacity requirements for proposed infrastructure).
- ☒ Confirm consistency with Master Servicing Study and/or justifications for deviations.
- ☒ Consideration of local conditions that may contribute to extraneous flows that are higher than the recommended flows in the guidelines. This includes groundwater and soil conditions, and age and condition of sewers.
- ☒ Description of existing sanitary sewer available for discharge of wastewater from proposed development.
- ☒ Verify available capacity in downstream sanitary sewer and/or identification of upgrades necessary to service the proposed development. (Reference can be made to previously completed Master Servicing Study if applicable)
- ☒ Calculations related to dry-weather and wet-weather flow rates from the development in standard MOE sanitary sewer design table (Appendix ‘C’) format.
- ☒ Description of proposed sewer network including sewers, pumping stations, and forcemains.
- ☒ Discussion of previously identified environmental constraints and impact on servicing (environmental constraints are related to limitations imposed on the development in order to preserve the physical condition of watercourses, vegetation, soil cover, as well as protecting against water quantity and quality).
- ☒ Pumping stations: impacts of proposed development on existing pumping stations or requirements for new pumping station to service development.
- ☒ Forcemain capacity in terms of operational redundancy, surge pressure and maximum flow velocity.
- ☒ Identification and implementation of the emergency overflow from sanitary pumping stations in relation to the hydraulic grade line to protect against basement flooding.
- ☒ Special considerations such as contamination, corrosive environment etc.

4.4 Development Servicing Report: Stormwater Checklist

- ☒ Description of drainage outlets and downstream constraints including legality of outlets (i.e. municipal drain, right-of-way, watercourse, or private property)
- ☒ Analysis of available capacity in existing public infrastructure.
- ☒ A drawing showing the subject lands, its surroundings, the receiving watercourse, existing drainage patterns, and proposed drainage pattern.
- ☒ Water quantity control objective (e.g. controlling post-development peak flows to pre-development level for storm events ranging from the 2 or 5 year event (dependent on the receiving sewer design) to 100 year return period); if other objectives are being applied, a rationale must be included with reference to hydrologic analyses of the potentially affected subwatersheds, taking into account long-term cumulative effects.
- ☒ Water Quality control objective (basic, normal or enhanced level of protection based on the sensitivities of the receiving watercourse) and storage requirements.
- ☒ Description of the stormwater management concept with facility locations and descriptions with references and supporting information.
- ☐ Set-back from private sewage disposal systems.
- ☐ Watercourse and hazard lands setbacks.
- ☐ Record of pre-consultation with the Ontario Ministry of Environment and the Conservation Authority that has jurisdiction on the affected watershed.
- ☐ Confirm consistency with sub-watershed and Master Servicing Study, if applicable study exists.
- ☒ Storage requirements (complete with calculations) and conveyance capacity for minor events (1:5 year return period) and major events (1:100 year return period).
- ☐ Identification of watercourses within the proposed development and how watercourses will be protected, or, if necessary, altered by the proposed development with applicable approvals.
- ☒ Calculate pre and post development peak flow rates including a description of existing site conditions and proposed impervious areas and drainage catchments in comparison to existing conditions.
- ☐ Any proposed diversion of drainage catchment areas from one outlet to another.
- ☒ Proposed minor and major systems including locations and sizes of stormwater trunk sewers, and stormwater management facilities.
- ☐ If quantity control is not proposed, demonstration that downstream system has adequate capacity for the post-development flows up to and including the 100 year return period storm event.
- ☐ Identification of potential impacts to receiving watercourses
- ☒ Identification of municipal drains and related approval requirements.
- ☒ Descriptions of how the conveyance and storage capacity will be achieved for the development.
- ☒ 100 year flood levels and major flow routing to protect proposed development from flooding for establishing minimum building elevations (MBE) and overall grading.

- ☒ Inclusion of hydraulic analysis including hydraulic grade line elevations.
- ☒ Description of approach to erosion and sediment control during construction for the protection of receiving watercourse or drainage corridors.
- ☐ Identification of floodplains – proponent to obtain relevant floodplain information from the appropriate Conservation Authority. The proponent may be required to delineate floodplain elevations to the satisfaction of the Conservation Authority if such information is not available or if information does not match current conditions.
- ☐ Identification of fill constraints related to floodplain and geotechnical investigation.

4.5 Approval and Permit Requirements: Checklist

The Servicing Study shall provide a list of applicable permits and regulatory approvals necessary for the proposed development as well as the relevant issues affecting each approval. The approval and permitting shall include but not be limited to the following:

- ☐ Conservation Authority as the designated approval agency for modification of floodplain, potential impact on fish habitat, proposed works in or adjacent to a watercourse, cut/fill permits and Approval under Lakes and Rivers Improvement Act. The Conservation Authority is not the approval authority for the Lakes and Rivers Improvement Act. Where there are Conservation Authority regulations in place, approval under the Lakes and Rivers Improvement Act is not required, except in cases of dams as defined in the Act.
- ☐ Application for Certificate of Approval (CofA) under the Ontario Water Resources Act.
- ☐ Changes to Municipal Drains.
- ☐ Other permits (National Capital Commission, Parks Canada, Public Works and Government Services Canada, Ministry of Transportation etc.)

4.6 Conclusion Checklist

- ☒ Clearly stated conclusions and recommendations
- ☒ Comments received from review agencies including the City of Ottawa and information on how the comments were addressed. Final sign-off from the responsible reviewing agency.
- ☒ All draft and final reports shall be signed and stamped by a professional Engineer registered in Ontario