

1. ALL MATERIALS AND CONSTRUCTION METHODS TO BE IN ACCORDANCE WITH OPS AND CITY OF OTTAWA STANDARD SPECIFICATIONS AND DRAWINGS AND OPS SUPPLEMENT. ONTARIO PROVINCIAL STANDARDS WILL APPLY WHERE NO CITY STANDARDS ARE AVAILABLE.
2. THE CONTRACTOR IS RESPONSIBLE FOR OBTAINING ALL PERMITS REQUIRED AND BEAR COST OF SAME INCLUDING WATER PERMIT AND ASSOCIATED COSTS.
3. LOCATION AND UTILITY LOCATIONS ARE APPROXIMATE, CONTRACTOR TO VERIFY LOCATION AND ELEVATION OF EXISTING SERVICES AND UTILITIES PRIOR TO CONSTRUCTION. CONTRACTOR SHALL BE RESPONSIBLE FOR OBTAINING LOCATIONS FROM ALL UTILITY COMPANIES TO LOCATE EXISTING UTILITIES PRIOR TO EXCAVATION. THE CONTRACTOR IS RESPONSIBLE FOR PROTECTION AND REINSTATEMENT.
4. ALL DISTURBED AREAS SHALL BE REINSTATED TO EQUAL OR BETTER CONDITION TO THE SATISFACTION OF THE ENGINEER & THE CITY. PAVEMENT REINSTATEMENT FOR SERVICE AND UTILITY CUTS SHALL BE IN ACCORDANCE WITH OPSD 508.010, OPSD 310, AND CITY OF OTTAWA R10.
5. ALL WORK SHALL BE COMPLETED IN ACCORDANCE WITH THE "OCCUPATIONAL HEALTH AND SAFETY ACT AND REGULATION FOR CONSTRUCTION PROJECTS". THE GENERAL CONTRACTOR SHALL BE DEEMED TO BE THE CONSTRUCTOR AS DEFINED IN THE ACT.

- WHERE EC PLANS ARE NOT FOLLOWED, OR ARE FOUND TO PROVIDE INSUFFICIENT PROTECTION, THE CONTRACTOR SHALL SUBMIT AN EROSION AND SEDIMENTATION CONTROL PLAN THAT WILL IMPLEMENT BEST MANAGEMENT PRACTICES TO PROVIDE PROTECTION FOR RECEIVING STORM SEWERS OR DRAINAGE DURING CONSTRUCTION ACTIVITIES. THIS PLAN SHALL INCLUDE BUT NOT BE LIMITED TO CATCH BASIN INSERTS, STRAW BALE CHECK DAMS AND SEDIMENT CONTROLS AROUND ALL DISTURBED AREAS. DEWATERING SHALL BE PUMPED INTO SEDIMENT TRAPS.
7. SITE PLAN, PREPARED BY: NEUF ARCHITECTS, DRAWING TITLED SITE PLAN, A101, DATED 2023-01-01 REV B DATED 2026.03.02, PROJECT NO. 13284.
8. TOPOGRAPHIC SURVEY SUPPLIED BY J.BARNES LIMITED, TOPOGRAPHIC DETAIL OF PART OF LOT 14, CONCESSION 3 (RIDEAU FRONT) CITY OF OTTAWA.
9. REFER TO LANDSCAPE ARCHITECTURE PLAN FOR ALL LANDSCAPING FEATURES (i.e. TREES, WALKWAYS, PARK DETAILS, NOISE BARRIERS, FENCES etc.)
10. GEOTECHNICAL INVESTIGATION PREPARED BY PATERSON GROUP, DATED DECEMBER 15, 2023, TITLED PROPOSED RESIDENTIAL DEVELOPMENT, 100 STEADICE DRIVE - OTTAWA, REPORT NO PGS788-1. GEOTECHNICAL INFORMATION PRESENTED ON THESE DRAWINGS MAY BE INTERPOLATED FROM THE ORIGINAL REPORT TO REFLECT AN ORIGINAL GEOTECHNICAL REPORT FOR ADDITIONAL DETAILS AND TO VERIFY ASSUMPTIONS MADE HEREIN.
11. GEOTECHNICAL MEMORANDUM PREPARED BY PATERSON GROUP TITLED EXCAVATION, GRADING AND DRAINAGE PLAN REVIEW, PROPOSED RESIDENTIAL DEVELOPMENT, 100 STEADICE DRIVE, OTTAWA, ON, DATED FEBRUARY 13, 2026, PGS788-MEMO.03 REVISION 1.
11. STREET LIGHTING TO CITY OF OTTAWA STANDARDS.
12. ALL DIMENSIONS ARE IN METRES UNLESS OTHERWISE STATED. DIMENSIONS SHALL BE CHECKED AND VERIFIED IN THE FIELD BY THE CONTRACTOR PRIOR TO THE START OF CONSTRUCTION. ANY DISCREPANCIES TO BE REPORTED IMMEDIATELY TO ENGINEER.
13. THERE WILL BE NO SUBSTITUTION OF MATERIALS UNLESS PRIOR WRITTEN APPROVAL BY THE CONTRACT ADMINISTRATOR AND PROJECT ENGINEER HAS BEEN OBTAINED.
14. HERITAGE OPERATIONS UNIT OF THE ONTARIO MINISTRY OF CULTURE TO BE NOTIFIED IF DEEPLY BURIED ARCHEOLOGICAL REMAINS ARE FOUND ON THE PROPERTY DURING CONSTRUCTION ACTIVITIES.

1. ALL TOPSOIL AND ORGANIC MATERIAL TO BE STRIPPED FROM WITHIN THE FULL RIGHT OF WAY PRIOR TO CONSTRUCTION.
2. SUB-EXCAVATE SOFT AREAS & FILL WITH GRANULAR 'B' COMPACTED IN 0.30m LAYERS.
3. ALL GRANULAR FOR ROADS SHALL BE COMPACTED TO A MINIMUM OF 96% STANDARD PROCTOR MAXIMUM DRY DENSITY (SPMDSD).
4. ROAD SUBDRAINS SHALL BE CONSTRUCTED AS PER CITY OF OTTAWA STANDARD R1.
5. ASPHALT WEAR COURSE SHALL NOT BE PLACED UNTIL THE VIDEO INSPECTION OF SEWERS & NECESSARY REPAIRS HAVE BEEN CARRIED OUT TO THE SATISFACTION OF THE CONSULTANT.
6. CONTRACTOR TO OBTAIN A ROAD OCCUPANCY PERMIT 48 HOURS PRIOR TO COMMENCING ANY WORK WITHIN THE MUNICIPAL ROAD ALLOWANCE IF REQUIRED BY THE MUNICIPALITY. ALL WORK ON THE MUNICIPAL RIGHT OF WAY AND EASEMENTS TO BE INSPECTED BY THE MUNICIPALITY PRIOR TO BACKFILLING.
7. PAVEMENT REINSTATEMENT FOR SERVICE AND UTILITY CUTS SHALL BE IN ACCORDANCE WITH CITY OF OTTAWA STANDARD R10, AND OPSD 509.010, AND OPSB 310.
8. CONCRETE CURBS SHALL BE CONSTRUCTED AS PER CITY STANDARD SC1.1 AND SC1.3 (BARRIER OR MOUNTABLE CURB AS SHOWN ON DRAWINGS).
9. CONCRETE SIDEWALKS SHALL BE CONSTRUCTED AS PER CITY STANDARDS SC3 AND SC1.4.

PAVEMENT CONSTRUCTION AS PER GEOTECHNICAL INVESTIGATION BY PATERSON GROUP, DATED DECEMBER 15, 2023. TITLED PROPOSED RESIDENTIAL DEVELOPMENT, 100 STEACIE DRIVE - OTTAWA. REPORT No PG5788-1.

DRIVEWAYS CAR ONLY PARKING AREAS
50mm WEAR COURSE- HL 3 OR SP 12.5 ASPHALTIC CONCRETE
150mm OPSS GRANULAR 'A' BASE
300mm OPSS GRANULAR 'B' TYPE II

ACCESS LANES - HEAVY DUTY
 40mm WEAR COURSE- HL 3 OR SP 12.5 ASPHALTIC CONCRETE
 50mm BINDER COURSE- HL 8 OR SP 19.0 ASPHALTIC CONCRETE
 150mm OPSS GRANULAR 'A' BASE
 400mm OPSS GRANULAR 'B' TYPE II

1. THE CONTRACTOR SHALL CONSTRUCT WATERMAIN, WATER SERVICES, CONNECTIONS & APPURTENANCES AS PER CITY OF OTTAWA SPECIFICATIONS & SHALL CO-ORDINATE AND PAY ALL RELATED COSTS INCLUDING THE COST OF CONNECTION, INSPECTION & DISINFECTION BY CITY PERSONNEL.
2. WATERMAIN PIPE MATERIAL SHALL BE P.V.C. CL150 DR18. DEFLECTION OF WATERMAIN PIPE IS NOT TO EXCEED 1/2" OF THAT SPECIFIED BY THE MANUFACTURER. P.V.C. WATERMAINS TO BE INSTALLED WITH TRACER WIRE IN ACCORDANCE WITH CITY OF OTTAWA STANDARD W36.
3. WATER SERVICES ARE TO BE PEX TUBING AS PER CITY OF OTTAWA STANDARD W26 (UNLESS OTHERWISE NOTED). WATER SERVICE TO EXTEND 2.0M BEYOND PROPERTY LINE. STAND POST TO BE INSTALLED AT PROPERTY LINE. ROLL OF PEX MIN 8M LONG TO BE LEFT. NOTE: 20mm INSIDE DIAMETER REQUIRED
4. FIRE HYDRANTS TO BE INSTALLED AS PER CITY OF OTTAWA STANDARDS W18 AND W19.
5. WATER VALVES TO BE INSTALLED AS PER CITY OF OTTAWA STANDARD W24.

6. WATERMAIN TRENCH AND BEDDING SHALL BE IN ACCORDANCE WITH CITY OF OTTAWA STD. W17 UNLESS OTHERWISE SPECIFIED. BEDDING AND COVER MATERIAL TO BE SPECIFIED BY PROJECT GEOTECHNICAL CONSULTANT.
7. SERVICE CONNECTIONS SHALL BE INSTALLED A MINIMUM OF 2400mm FROM ANY CATCHBASIN, MANHOLE OR OBJECT THAT MAY CONTRIBUTE TO FREEZING. THERMAL INSULATION SHALL BE INSTALLED ON ALL PROPOSED CB'S ON THE W/M STREET SIDE WHERE 2400mm SEPARATION CANNOT BE ACHIEVED,(AS PER CITY OF OTTAWA W22 & W23)
8. CATHODIC PROTECTION TO BE SUPPLIED ON METALLIC FITTINGS AS PER CITY OF OTTAWA W40 AND W42.
9. THRUST BLOCKS TO BE INSTALLED AS PER CITY OF OTTAWA STANDARDS W25.3 AND W25.4.
10. WATERMAIN TO HAVE MIN. 2.4m COVER. WHERE WATERMAIN COVER IS LESS THAN 2.4m, INSULATION TO BE SUPPLIED IN ACCORDANCE WITH CITY STANDARD W22.
11. WATERMAIN CROSSINGS ABOVE AND BELOW SEWERS TO BE INSTALLED AS PER CITY OF OTTAWA STANDARD W25 AND W25.2.
12. PRESSURE REDUCING VALVES (PRVs) ON ALL UNITS TO BE INSTALLED AS PER ONTARIO PLUMBING CODE.

1. STORM AND SANITARY SEWERS 375mm DIA. OR SMALLER SHALL BE PVC SD30S. SANITARY SEWERS LARGER THAN 375mm SHALL BE CONCRETE CSA A 257.2 CLASS 100D AS PER OPSD 807.010.
2. ALL STORM AND SANITARY SEWER BEDDING SHALL BE INSTALLED AS PER CITY OF OTTAWA STANDARDS S6 AND S7, CLASS "B" BEDDING, UNLESS OTHERWISE NOTED. SUITABLE BEDDING AND COVER MATERIALS TO BE SPECIFIED BY GEOTECHNICAL CONSULTANT.
3. STORM AND SANITARY MANHOLES SHALL BE 1200mm DIAMETER IN ACCORDANCE WITH OPSD-701.01 (UNLESS OTHERWISE NOTED) c/w FRAME AND COVER AS PER CITY OF OTTAWA S24, S24.1, AND S25 WHERE APPLICABLE, CATCH BASIN MANHOLE FRAME AND COVERS PER S19, S26, AND S30.1 WHERE APPLICABLE. STORM MANHOLES WITH SEWERS 900mm DIA SEWERS AND OVER IN SIZE SHALL BE BENCHED. ALL OTHER STORM MANHOLES SHALL BE COMPLETED WITH 300mm SUMPS AS PER CITY STANDARDS. SANITARY MANHOLES SHALL NOT HAVE SUMPS.
4. ALL SEWERS CONSTRUCTED WITH GRADES 5.0% OR LESS TO BE INSTALLED WITH LASER AND CHECKED WITH LEVEL INSTRUMENT PRIOR TO BACKFILLING.
5. FOR STORM SEWER INSTALLATION (EXCLUDING CB LEADS) THE MINIMUM DEPTH OF COVER OVER THE CROWN OF THE SEWER IS 2.0m. FOR SANITARY SEWERS THE MINIMUM DEPTH OF COVER IS 2.5m OVER PIPE COVER.
6. ALL STORM AND SANITARY SERVICES TO BE EQUIPPED WITH APPROVED BACKWATER VALVES AS PER CITY STANDARD (S14.514.1, AND S14.512).
7. STORM AND SANITARY SERVICE LATERALS TO BE SDR 28 INSTALLED AT MIN. 1.0% SLOPE. SINGLE STORM SERVICES TO BE 100mmID. SINGLE SANITARY SERVICES TO BE 135mmID. (SERVICES TO EXTEND 2.0m BEYOND PROPERTY LINE)
8. CATCH BASINS SHALL BE INSTALLED IN ACCORDANCE WITH CITY STANDARDS S1, S2, S3 c/w FRAME AND GRATE AS PER S19, CURB INLET FRAME AND GRATE PER S22 AND S23. PROVIDE 150mm AJUSTED SPACERS. ALL CATCH BASINS SHALL HAVE SUMPS (600mm DEEP), STREET CATCH BASIN LEADS SHALL BE 200mm DIA/MIN/IN PVC SD30R AS PER 1.0% GRADE WHEN NOT OTHERWISE SHOWN ON PLAN. CATCH BASIN LEADS SHALL BE INSTALLED WITH INLET CONTROL DEVICES (ICD) AS PER ICD SCHEDULE ON STANDARD DRAWING PLAN.
9. STREET CATCH BASINS TO BE INSTALLED c/w SUBDRAINS 3m LONG IN FOUR ORTHOGONAL DIRECTIONS LONGITUDINALLY WHEN PLACED ALONG A CURB, AND AT AN ELEVATION OF 300mm BELOW SUBGRADE LEVEL.
10. REAR LOT PERFORATED PIPE TO BE INSTALLED AS PER CITY OF OTTAWA STANDARDS S28. REAR LOT STRUCTURES TO BE INSTALLED AS PER CITY OF OTTAWA STANDARD W30 AND W31.
11. CLAY SEALS TO BE INSTALLED AS PER CITY STANDARD DRAWING S8. THE SEALS SHOULD BE AT LEAST 1.5m LONG (IN THE TRENCH DIRECTION) AND SHOULD EXTEND FROM TRENCH WALL TO TRENCH WALL. GENERALLY, THE SEALS SHOULD EXTEND FROM THE FRONT LINE AND FULLY PENETRATE THE BEDDING, SUBBEDDING AND COVER MATERIAL. THE BARRIERS SHOULD CONSIST OF RELATIVELY DRY AND COMPACTABLE BROWN SILTY CLAY PLACED IN MAXIMUM 225mm THICK LOOSE LAYERS COMPACTED TO A MINIMUM OF 95% OF THE NEBRASKA STANDARD. THE CLAY SEALS SHALL BE PLACED AT THE SITE BOUNDARIES AND AT STRATEGIC LOCATIONS AT NO MORE THAN 60m INTERVALS IN THE SERVICE TRENCHES. FOR DETAILS REFER TO GEOTECHNICAL INVESTIGATION.
12. GRANULAR "A" SHALL BE PLACED TO A MINIMUM THICKNESS OF 300 mm AROUND ALL STRUCTURES WITH PAVEMENT AREA AND COMPACTED TO A MINIMUM OF 98% STANDARD PROCTOR DENSITY.
13. CONTRACTOR SHALL PERFORM LEAKAGE TESTING, IN THE PRESENCE OF THE CONSULTANT, FOR SANITARY SEWERS IN ACCORDANCE WITH OPSD 410 AND OPSD 407. CONTRACTOR SHALL PERFORM VIDEO INSPECTION OF ALL STORM AND SANITARY SEWERS. A COPY OF THE VIDEO AND INSPECTION REPORT SHALL BE SUBMITTED TO THE CONSULTANT FOR REVIEW.
14. ANY SEWER ABANDONED TO BE CONDUCTED ACCORDING TO CITY OF OTTAWA STANDARD S11.4

1. ALL GRANULAR BASE & SUB BASE COURSE MATERIALS SHALL BE COMPACTED TO 98% STANDARD PROCTOR MAX. DRY DENSITY.
2. SUB-EXCAVATE SOFT AREAS & FILL WITH GRANULAR 'B' COMPACTED IN 0.30m LAYERS.
3. ALL DISTURBED GRASSED AREAS SHALL BE RESTORED TO ORIGINAL CONDITION OR BETTER, WITH SOO ON MIN. 100mm TOPSOIL. THE RELOCATION OF TREES AND SHRUBS SHALL BE SUBJECT TO APPROVAL BY THE PROJECT LANDSCAPE ARCHITECT OR ENGINEER.
4. 100 YEAR PONDING DEPTH TO BE 0.35m (MAXIMUM).
5. EMBANKMENTS TO BE SLOPED AT MIN. 3:1, UNLESS OTHERWISE SPECIFIED.
6. ALL SWALES TO BE CONSTRUCTED AS PER CITY STANDARD S29.
7. ALL ROOF DOWNSPOUTS TO DISCHARGE TO THE GROUND ONTO SPLASH PADS, AND SHALL NOT BE DIRECTED TO THE STORM SEWER, OR THE BUILDING FOUNDATION DRAIN.
8. TOP OF GRATE (T/G) ELEVATIONS FOR ALL STREET CATCHBASINS SHOWN ON PLANS, REFER TO THE ELEVATION AT EDGE OF PAVEMENT, OR GUTTERLINE WHERE APPLICABLE.
9. ALL RETAINING WALLS GREATER THAN 1.0m IN HEIGHT ARE TO BE DESIGNED, APPROVED, AND STAMPED BY STRUCTURAL ENGINEER.
10. FENCES OR RAILINGS ARE REQUIRED FOR RETAINING WALLS GREATER THAN 0.60m IN HEIGHT.
11. EXCESS EXCAVATED MATERIAL SHALL BE REMOVED FROM THE SITE.
12. ALL NECESSARY CLEARING AND GRUBBING SHALL BE COMPLETED BY THE CONTRACTOR. REVIEW WITH CONTRACT ADMINISTRATOR AND THE CITY OF OTTAWA PRIOR TO TREE CUTTING.
13. REFER TO DRAWING EC-1 FOR EROSION AND SEDIMENT CONTROL DETAILS.

CONTRACTOR TO PROVIDE EROSION AND SEDIMENT CONTROLS (BEST MANAGEMENT PRACTICES) DURING CONSTRUCTION OF THIS PROJECT. THE CONTRACTOR SHALL IMPLEMENT BEST MANAGEMENT PRACTICES, TO PROVIDE FOR PROTECTION OF THE AREA DRAINAGE SYSTEM AND THE RECEIVING WATERCOURSE, DURING CONSTRUCTION ACTIVITIES. THE CONTRACTOR ACKNOWLEDGES THAT FAILURE TO IMPLEMENT APPROPRIATE EROSION AND SEDIMENT CONTROL MEASURES MAY BE SUBJECT TO PENALTIES IMPOSED BY ANY APPLICABLE REGULATORY AGENCY.

EROSION MUST BE MINIMIZED AND SEDIMENTS MUST BE REMOVED FROM CONSTRUCTION SITE RUN-OFF IN ORDER TO PROTECT DOWNSTREAM AREAS. DURING ALL CONSTRUCTION, EROSION AND SEDIMENTATION SHOULD BE CONTROLLED BY THE FOLLOWING TECHNIQUES:

1. LIMIT THE EXTENT OF EXPOSED SOILS AT ANY GIVEN TIME.
2. REVEGETATE EXPOSED AREAS AND SLOPES AS SOON AS POSSIBLE.
3. MINIMIZE AREA TO BE CLEARED AND GRUBBED.
4. PROTECT EXPOSED SLOPES WITH PLASTIC OR SYNTHETIC MULCHES.
5. INSTALL CATCH BASIN INSERTS OR EQUIVALENT IN ALL PROPOSED CATCH BASINS AND CATCH BASIN MANHOLES AND IN ALL EXISTING CATCH BASINS THAT WILL RECEIVE RUN-OFF FROM THE SITE.
6. A SILT FENCE SHALL BE INSTALLED AROUND THE PERIMETER OF ALL AND ANY STOCKPILES OF MATERIAL TO BE USED OR REMOVED FROM SITE. (LOCATION TO BE DETERMINED)
7. A VISUAL INSPECTION SHALL BE DONE DAILY ON SEDIMENT CONTROL MEASURES AND CLEANED OF ANY ACCUMULATED SILT AS REQUIRED. THE DEPOSITS WILL BE DISPOSED OFF SITE AS PER THE REQUIREMENTS OF THE CONTRACT.
8. SEDIMENT CONTROL BARRIERS MAY ONLY BE REMOVED TEMPORARILY WITH APPROVAL OF CONTRACT ADMINISTRATOR TO ACCOMMODATE CONSTRUCTION OPERATIONS. ALL AFFECTED BARRIERS MUST BE REINSTATED AT NIGHT WHEN CONSTRUCTION IS COMPLETED. NO REMOVAL WILL OCCUR IF THERE IS A SIGNIFICANT RAINFALL EVENT EXISTING (>>10mm) UNLESS A NEW DEVICE HAS BEEN INSTALLED TO PROTECT ANTICIPATED STORM AND SANITARY SEWER SYSTEMS OR DOWNSTREAM WATERCOURSES.
9. NO REFUELING OR CLEANING OF EQUIPMENT IS PERMITTED NEAR ANY EXISTING WATERWAY.
10. CONTRACTOR SHALL REMOVE SEDIMENT CONTROL MEASURES WHEN, IN THE OPINION OF THE CONTRACT ADMINISTRATOR, THE MEASURE(S) IS (NO LONGER REQUIRED) FOR CONTROL. MATERIALS SHALL BE PERMANENTLY REMOVED WITHOUT PRIOR WRITTEN AUTHORIZATION FROM THE CONTRACT ADMINISTRATOR.
11. THE CONTRACTOR SHALL PERIODICALLY, OR WHEN REQUESTED BY THE CONTRACT ADMINISTRATOR, CLEAN OUT ACCUMULATED SEDIMENTS AS REQUIRED.
12. THE CONTRACTOR SHALL IMMEDIATELY REPORT TO THE ENGINEER ANY ACCIDENTAL DISCHARGES OF SEDIMENT MATERIAL INTO THE WATERCOURSE. APPROPRIATE RESPONSE MEASURES, INCLUDING ANY REPAIRS TO EXISTING CONTROL MEASURES OR THE IMPLEMENTATION OF ADDITIONAL CONTROL MEASURES, SHALL BE CARRIED OUT BY THE CONTRACTOR WITHOUT DELAY.
13. CONTRACTOR SHALL INSTALL MUD MATS AT ALL CONSTRUCTION ENTRANCES TO THE SITE.
14. STORMWATER SWALES TO BE COVERED WITH HYDRO-SEED AND MULCH.

EXISTING WATERMAIN

EXISTING VALVE AND VALVE BOX

EXISTING VALVE CHAMBER

EXISTING FIRE HYDRANT

EXISTING SANITARY SEWER

EXISTING OVERHEAD WIRES

EXISTING DITCH


EXISTING RAIL LINE

EXISTING CULVERT

EXISTING STONE RETAINING WALL

EXISTING FENCE LINE

EXISTING MAJOR FLOW DIRECTION

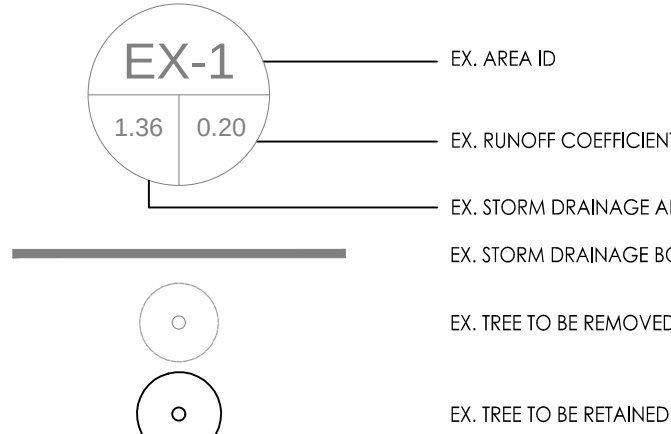

	PROPOSED WATERMAIN
	PROPOSED VALVE AND VALVE BOX
	PROPOSED VALVE CHAMBER
	PROPOSED REDUCER
	PROPOSED FIRE HYDRANT
	PROPOSED VALVE AND DMA CHAMBER A3 PER CITY STD W3
	WATER METER
	REMOTE WATER METER
	PROPOSED SANITARY SEWER
	PROPOSED STORM SEWER
	PROPOSED CATCH-BASIN
	EXISTING CULVERT
	EXISTING WATERMAIN
	EXISTING VALVE AND VALVE BOX
	EXISTING VALVE CHAMBER
	EXISTING FIRE HYDRANT
	EXISTING SANITARY SEWER
	PROPOSED DEPRESSED CURB LOCATIONS
	PROPOSED BARRIER CURB
	Thermal insulation on storm sewer where cover is less than 1.5m, thermal insulation on watermain where cover is less than 2.4m A3 per W22.
	EX. TREE TO BE REMOVED
	EX. TREE TO BE RETAINED
	ROAD CUT ASPHALT RE-INSTATEMENT PER CITY S
	GRAVEL RE-INSTATEMENT AREA
	LANDSCAPE RE-INSTATEMENT AREA, 150mm TOPSOIL AND SEED
	HEAVY DUTY ASPHALT
	ASPHALT ACCESS PER MODIFIED SC21.
	SEE DETAIL DWG E-002-1
	RETAINED TREE CRITICAL ROOT ZONES (REFER TO TCR FOR DETAILS)
	TREE PROTECTION FENCING PER CITY STD F7 (REFER TO TCR FOR DETAILS)

R1A

0.38 155

SANITARY DRAINAGE AREA ID

POPULATION

SANITARY DRAINAGE AREA ho

G1A

0.38 INF

SANITARY DRAINAGE AREA ID

INFILTRATION RATES

SANITARY DRAINAGE AREA ho

SANITARY DRAINAGE AREA

PROPOSED SANITARY SEWER

EXISTING SANITARY SEWER

ORIGINAL GROUND ELEVATION
 PROPOSED ELEVATION
 PROPOSED LOT CORNER ELEVATION
 EXISTING ELEVATION AT LOT CORNER
 FLOW DIRECTION AND GRADE
 FINISHED FIRST FLOOR ELEVATION
 UNDERGROUND PARKING SLAB
 TERRACING 3:1 SLOPE MAXIMUM
 (UNLESS OTHERWISE SHOWN)
 DIRECTION OF EMERGENCY OVERLAND FLOW
 PROPOSED VALVE BOX
 PROPOSED VALVE CHAMBER
 PROPOSED FIRE HYDRANT
 PROPOSED VALVE AND DMA CHAMBER AS PER CITY STD 13
 PROPOSED SANITARY SEWER MANHOLE
 PROPOSED STORM SEWER MANHOLE
 PROPOSED CATCHBASIN MANHOLE
 PROPOSED CATCHBASIN
 PROPOSED DEPRESSIONED CURB LOCATION
 PROPOSED BARRIER CURB
 OVERLAND SPILL / HIGH POINT LOCATION
 TWSI LOCATION AS PER CITY STD
 EX. TREE TO BE REMOVED
 EX. TREE TO BE RETAINED
 ROAD CUT ASPHALT RE-INSTATEMENT PER CITY STD R10
 GRAVEL RE-INSTATEMENT AREA
 LANDSCAPE RE-INSTATEMENT AREA, 150mm
 TOPSOIL AND SEED
 HEAVY DUTY ASPHALT
 ASPHALT ACCESS PER MODIFIED SC21.
 SEE DETAIL DWG SC21
 RETAINED TREE CRITICAL ROOT ZONES
 (REFER TO TCR FOR DETAILS)
 TREE PROTECTION FENCING PER CITY STD F7
 (REFER TO TCR FOR DETAILS)
 ROOF DRAIN LOCATION

The diagram illustrates the components of a stormwater catchbasin. It includes a top view of the catchbasin with labels for the area ID (L101A), runoff coefficient (1.00 and 0.85), storm drainage area (ha), storm drainage boundary, and off-site area ID (OFF-1). It also shows the off-site runoff coefficient (0.17 and 0.20), off-site storm drainage area (ha), and off-site storm drainage boundary. A side view shows the maximum static ponding limits, the direction of overland flow, the proposed storm sewer, proposed catchbasin manhole, proposed catchbasin, circular orifice (see ICD Table SD-1), existing storm sewer, and existing catchbasin. A note at the bottom states: 'THERMAL INSULATION ON STORM SEWER WHERE COVER IS LESS THAN 1.5m; THERMAL INSULATION ON WATERMAIN WHERE COVER IS LESS THAN 2.4m AS PER W22.'

Top View Labels:

- AREA ID
- RUNOFF COEFFICIENT
- STORM DRAINAGE AREA ha.
- STORM DRAINAGE BOUNDARY
- EX. OFFSITE AREA ID
- EX. OFFSITE RUNOFF COEFFICIENT
- EX. OFFSITE STORM DRAINAGE AREA ha.
- EX. OFFSITE STORM DRAINAGE BOUNDARY

Side View Labels:

- MAXIMUM STATIC PONDING LIMITS
- DIRECTION OF OVERLAND FLOW
- PROPOSED STORM SEWER
- PROPOSED CATCHBASIN MANHOLE
- PROPOSED CATCHBASIN
- CIRCULAR ORIFICE (SEE ICD TABLE SD-1)
- EXISTING STORM SEWER
- EXISTING CATCHBASIN

Note: THERMAL INSULATION ON STORM SEWER WHERE COVER IS LESS THAN 1.5m; THERMAL INSULATION ON WATERMAIN WHERE COVER IS LESS THAN 2.4m AS PER W22.

	PROPOSED SILT FENCE BOUNDARY AS PER OPSD 219.110
	PROPOSED STRAW BALE LOCATION AS PER OPSD 219.110
	PROPOSED CATCH BASIN PROTECTION AS PER DETAIL.
	PROPOSED MUD MAT LOCATION
	PROPOSED VALVE BOX
	PROPOSED VALVE CHAMBER
	PROPOSED FIRE HYDRANT
	PROPOSED VALVE AND DWA CHAMBER AS PER CITY STD W3
	PROPOSED SANITARY SEWER MANHOLE
	PROPOSED STORM SEWER MANHOLE
	PROPOSED CATCHBASIN

**SEAN MOORE MCIP, RPP
MANAGER, DEVELOPMENT REVIEW - WEST
PLANNING, INFRASTRUCTURE & ECONOMIC
DEVELOPMENT DEPARTMENT, CITY OF OTTAWA**

APPROVED
By Sean Moore at 9:15 pm, Aug 06, 2026

Copyright Reserved

The Contractor shall verify and be responsible for all dimensions. DO NOT scale the drawing - any errors or omissions shall be reported to Stantec without delay.

The Copyrights to all designs and drawings are the property of Stantec. Reproduction or use for any purpose other than that authorized by Stantec is forbidden.

9	REVISED PER CITY COMMENTS	MJS	DT	26.06.17
8	REVISED PER CITY COMMENTS	MJS	DT	26.03.24
7	REVISED PER CITY COMMENTS	MJS	DT	25.11.28
6	REVISED PER NEW SITE PLAN	MJS	DT	25.07.11
5	REVISED AS PER SITE PLAN AND CITY COMMENTS	MJS	DT	24.12.02
4	REVISED WATERMAIN SIZE	MJS	DT	24.04.08
3	REVISED WATERMAIN SIZE	MJS	DT	22.04.08
2	REVISED AS PER CITY COMMENTS	MJS	TR	21.05.07
1	ISSUED FOR REVIEW	MJS	TR	20.11.23
Revision	By	Appd.	YY.MM.DD	

BRIGIL
100 STEACIE DRIVE
OTTAWA, ON

Title
NOTES AND LEGEND PLAN

Project No.	Scale
160401570	0 5 15 25 1:500
Drawing No.	Sheet
	Revision

NL-1 1 of 12 9
PLAN# 18327