



**PATERSON  
GROUP**

January 8, 2026

**PH4991-LET.02.REV.02**

**Titan Environmental Management**  
777 Quest Boulevard  
Ile de Chenes, Manitoba  
R0A 0T1

Attention: Lucky Montierro

Subject: **Hydrogeological Assessment and  
Terrain Analysis**  
Proposed Commercial Development  
**541 Somme Street, Ottawa, Ontario**

**Consulting Engineers**

9 Auriga Drive  
Ottawa, Ontario  
K2E 7T9  
Tel: (613) 226-7381

Geotechnical Engineering  
Environmental Engineering  
Hydrogeology  
Materials Testing  
Building Science  
Rural Development Design  
Temporary Shoring Design  
Retaining Wall Design  
Noise and Vibration Studies  
Energy and Sustainability  
Temporary Shoring Design  
Pile Dynamic Analysis and Testing

[patersongroup.ca](http://patersongroup.ca)

## **INTRODUCTION**

Further to your request, Paterson has conducted a Hydrogeological Assessment and Terrain Analysis in support of a Site Plan Control Application (hereby referred to as a Site Plan application) for the proposed commercial development located at 541 Somme Street in Ottawa. Please refer to the Figure 1 - Key Plan attached for the approximate site location.

The purpose of this work has been to determine the suitability of the water supply aquifer underlying the site to support the Site Plan Application for a new commercial building.

The Subject Site consists of a 0.80 ha lot and which is mostly grass covered with a treed area on the far east portion of the site. The ground surface is generally flat with a downward slope towards the eastern end of the site.

The suitability of the aquifer to supply the subject site was assessed using the methodology provided in City of Ottawa Hydrogeological and Terrain Analysis Guidelines (HTAG).

The following Assessment is for a non-drinkable water supply source, due to the manganese concentration encountered in the test well which exceeded the federal Maximum Acceptable Concentration (MAC) and provincial Maximum Concentration Considered Reasonably Treatable (MCCRT).



## **HYDROGEOLOGICAL PRE-CONSULTATION**

A Hydrogeological pre-consultation was completed with a City of Ottawa Hydrogeologist on December 3, 2024. The City Hydrogeologist suggested that additional sampling be completed during the 8-hour pumping test for Polycyclic Aromatic Hydrocarbons (PAH's) in addition to the standard Subdivision Package suite of parameters, trace metals and Volatile Organic Compounds (VOCs) required by the City of Ottawa Hydrogeological and Terrain Analysis Guidelines (HTAG).

## **DESCRIPTION OF SUBJECT SITE**

The subject site is an approximately 0.80 ha lot, generally infilled with fill material. The Site Plan application is for a proposed commercial development. Please refer to Figure-1 Key Plan and Novatech Drawing No. 1241111-SP Site Plan dated February, 2025 attached for the proposed site location and site layout.

The subject site is currently vacant, and will be serviced by a private water supply and sewage system. A new drilled well was installed onsite, hereafter referred to as Test Well 1 (TW1), is the well which will service the new building.

The site is bordered by vacant land to the north and south, by agricultural lands to the east and by Somme Street to the west. The subject site itself and the surrounding commercial areas are zoned RH for Rural Heavy Industrial Zone (GeoOttawa). General groundwater flow direction in the area is anticipated to be towards the northeast to east direction, towards the Findlay Creek Municipal Drain.

## **POTENTIAL KARST**

Based on available Ontario Geological Survey (OGS) mapping (GRS005), the subject site is not within an area of known, potential or inferred karst.

## **RAISIN-SOUTH NATION SOURCE PROTECTION PLAN**

The Raisin-South Nation Source Protection Plan (RSNSPP) provides guidance as to which policies apply to a given property, municipality or specific activity and if there are specific designations that apply to the area. The subject site and surrounding areas have been designated as a Highly Vulnerable Aquifer (HVA within the RSNSPP) and is identified as one of four groundwater related vulnerable areas identified within the Clean Water Act (2006). The four vulnerable areas consist of Significant Groundwater Recharge Area (SGRA), HVA, Intake Protection Zone (IPZ), and wellhead protection area (WHPA).

Based upon the designation, the RSNSPP provides a list of activities that are prohibited, managed or encouraged to change/educate dependent upon the vulnerable area type. There is no restrictions of land uses on the subject site based upon its proposed usage.

Therefore, there are no related requirements for an HVA at this location.



## FIELDWORK PROGRAM

### Well Testing

As a means to demonstrate the adequacy of the aquifer underlying the subject lands with respect to water quality and quantity, TW1 was installed and submitted to a pumping test. TW1 has a Water Well Record (WWR) Well ID of A421912. TW1 has a 152.4 mm diameter steel casing that extends to 12.1 m below ground surface (bgs) with a 0.65 m stick up. The well itself extends to a depth of 42.67 m bgs. Based on available geological mapping, the drift thickness at TW1 varies from 0 to 1 m. Refer to Novatech Drawing 124111-SP Site Plan, dated February 2025, attached, for the approximate location of TW1.

As a means to evaluate the water supply aquifer intercepted by the well, the well was subjected to an 8-hour constant rate pumping test. The pumping test was conducted on March 4, 2025 under the full-time supervision of Paterson personnel. Prior to the pumping test the well was disinfected, and a data-logger was installed to monitor the background groundwater levels.

A submersible pump was installed by Air Rock Drilling Co Ltd and used for the 8-hour pumping test. The pumping test was carried out at a pumping rate of 57 L/min for a duration of 8 hours. The water was discharged at surface towards the northwest portion of the site. During the pumping test, the pumping rate was periodically measured using the timed volume correlation method. The pumping rate was maintained within 5% of the selected pumping rate. The static water level was recorded manually and an electric datalogger (VanEssen TD-Diver) was installed in the test well prior to the start of the pumping test.

The selected rate of 57 L/min provides approximately 27.2 times the maximum total daily design volume of 1,005 L/day for the septic system during the 8-hour pumping test. The total daily design sanitary sewage flows (TDDSSF) were calculated as per the Ontario Building Code Section 8.2.1.3. The TDDSSF calculation was performed by Novatech and the approved Ottawa Septic System Office (OSSO) Sewage System Installation Permit (SSIP) is available under separate cover. The rate was determined to be representative of a flow rate which would be in excess of what the development would require.

The data logger recorded water levels at 30 second intervals. In addition, manual water level readings were taken at periodic intervals during the test.

Recovery data was collected from the well following the completion of the pumping. The well was noted to have achieved 95% recovery approximately 15 minutes after the completion of pumping.

Groundwater samples were collected at 4 hours and 8 hours after the start of pumping. Prior to collection of the groundwater samples, the free chlorine residual was verified as



non-detectable. The water samples were submitted for comprehensive testing of bacteriological, chemical, and physical water quality parameters consistent with the standard “Subdivision Supply” suite of parameters plus trace metals, VOCs, and PAHs.

Due to elevated field parameters, after completing the 8-hour pumping test of 57 L/min, the flow rate was reduced to 24 L/min for an additional hour, where additional field sampling was performed and additional laboratory samples were obtained for colour and turbidity.

All samples were collected unfiltered and unchlorinated and were placed directly into clean bottles supplied by the analytical laboratory. Samples were placed immediately into a cooler with ice and were transported directly to Environmental Testing Canada Inc. (Eurofins) laboratory in Ottawa. All samples were received by the laboratory within 24 hours of collection.

A series of field tests of the pumped water were carried out at the well head during the 8-hour pumping test. The parameters tested at the well head included: pH, total dissolved solids, conductivity, turbidity, apparent colour, hydrogen sulfide, and temperature. Calibration / confirmation of calibration of all field-testing equipment was performed in Paterson’s laboratory the day prior to the pumping test. Values are then confirmed again onsite prior to the start of the pumping test.

## Aquifer Analysis

### Water Quantity

Pumping test data was analyzed using AQTESOLV Pro Version 4 aquifer analysis software package by HydroSOLVE Inc. Drawdown data was measured using an electronic water level tape and an electronic datalogger unit.

<b>AQUIFER PARAMETER</b>	<b>RESULT OF ANALYSIS</b>
Transmissivity (m <sup>2</sup> /day)	52
Storativity	3.44E-04
Pumping Rate (L/min)	57
Pre-test Static Water Level (m)	6.7
Post-test Static Water Level (m)	9.0
Available Drawdown (m)	36.0
% Drawdown During Pumping Test (%)	6
Specific Capacity (L/min/m drawdown)	24.9

The drawdown data was analyzed using the Theis and Cooper Jacob methods of analysis. Aquifer transmissivity is estimated to be 52 m<sup>2</sup>/day. The aquifer storativity is



estimated to be 3.44E-04. Refer to the Theis and Cooper Jacob methods of analysis data sheets attached to this report.

The water level varied over the constant-rate pumping test, with a trend of decreasing with time. The variance in drawdown can be attributed to the development of the well during the pumping test.

The pumping test results show that TW1 has a high yield to support the water demands that may be required. Overall maximum drawdown at a constant pumping rate for a period of 8 hours was approximately 2.3 m (6% of the available drawdown). Full Recovery was attained within 15 hours after pumping ceased.

The total volume of water pumped during the 8-hour pumping event was approximately 27,360 L. This is approximately 27.2 times the maximum total daily design volume of water (1,005 L/d) required to support the Site Plan Control Application.

The suitability of the aquifer to supply the proposed Site Plan Application for the proposed commercial modification was assessed using the methodology provided in the City of Ottawa Hydrogeological and Terrain Analysis Guidelines (HTAG).

Based on the information summarized in Table 1, it is readily apparent that the water supply well has intercepted an adequately strong water supply aquifer which has sufficient quantity to service the proposed Site Plan Control Application.

Given the analyses presented and summarized above, it is our opinion that there is an adequate supply of water to support the proposed Site Plan Control Application. Available water well records (WWR) of the neighboring properties on the MECP Well Record mapping website indicated that the wells were screened in limestone. Surrounding WWRs are attached to this report.

## **Water Quality**

### ***Field Data***

Turbidity, electrical conductivity, total dissolved solids (TDS), pH, apparent color and temperature were measured at the wellhead during the pumping test. The measurements and time intervals for each of these parameters are summarized on the graphical representation (Figure 1) below. In addition, a HACH Pocket Colorimeter II chlorine reader was used to measure the free chlorine residual level. No chlorine residual was detected in the discharge water prior to the collection of the water samples.

Hydrogen sulfide was detected olfactorily during the pumping test. Hydrogen sulfide was measured using the HACH Hydrogen Sulfide Test Kit, Model HS-C, (# 2537800) when it was detected. Hydrogen sulfide was measured in the range of 0-0.1 mg/L at each point.

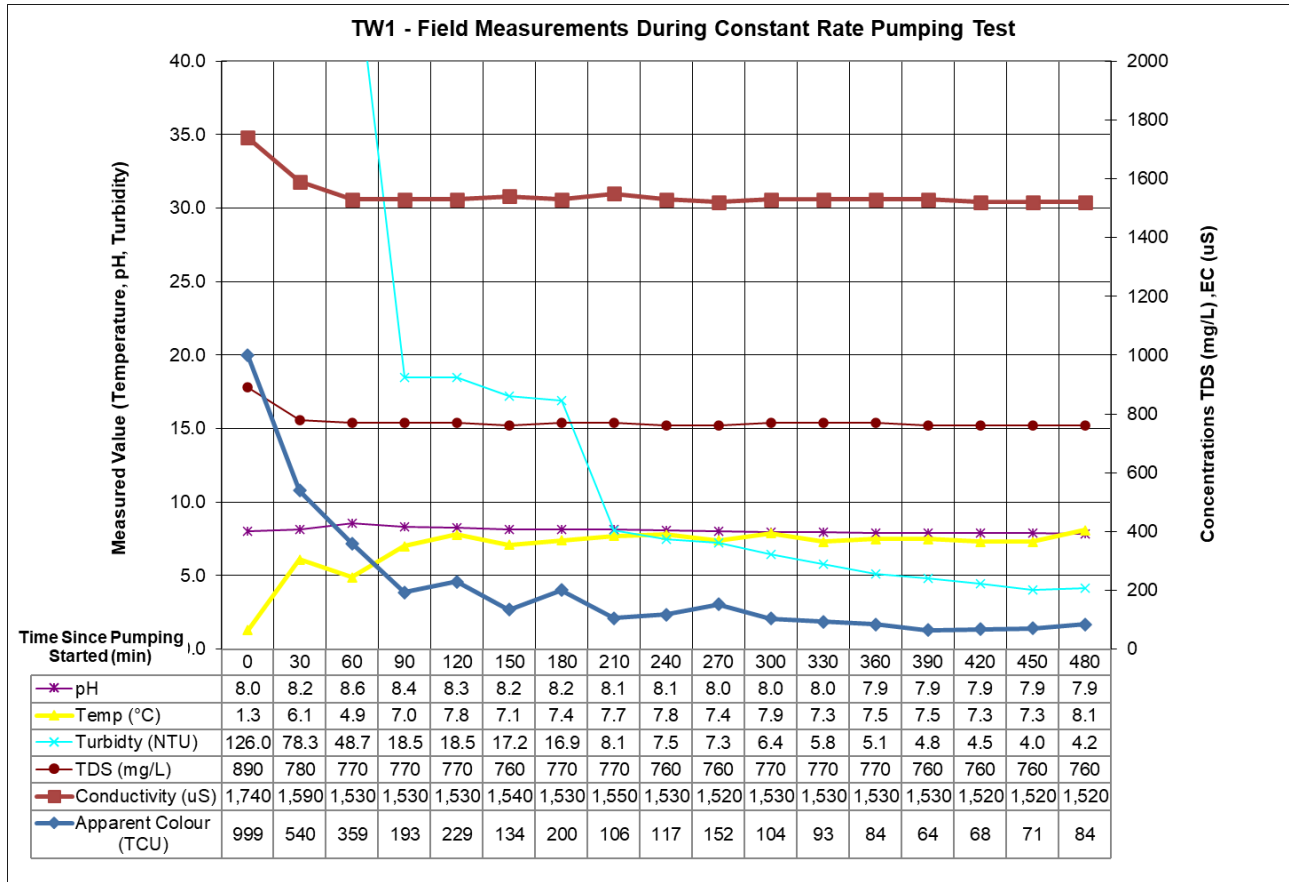


Figure 1: Field Measurements

**Laboratory Data**

The Subdivision Package suite of parameters and trace metals laboratory water quality obtained from the pumping test of TW1 is provided in Table 2a and 2b below, and the laboratory analyses reports can be found attached. VOC and PAH laboratory analytical testing were completed and measured to be non-detect in the sample results. All laboratory test results can be found attached to this report.



**TABLE 2a: GROUNDWATER MICROBIOLOGY & GENERAL GEOCHEMISTRY**

PARAMETER	UNITS	ODWS		TW1		
		LIMIT	TYPE	GW1 (4 hr)	GW2 (8 hr)	GW3 (9 hr)
				3/4/2025	3/4/2025	3/4/2025
<b>MICROBIOLOGICAL</b>						
Escherichia Coli (E.Coli)	ct/100mL	0	MAC	0	0	-
Total Coliforms	ct/100mL	0	MAC	4	3	-
<b>GENERAL CHEMICAL - HEALTH RELATED</b>						
Fluoride (F)	mg/L	1.5	MAC	0.16	0.18	-
Ammonia (N-NH <sub>3</sub> )	mg/L	-	-	0.80	0.83	-
Nitrite (N-NO <sub>2</sub> )	mg/L	1	MAC	<0.5	<0.5	-
Nitrate (N-NO <sub>3</sub> )	mg/L	10	MAC	<0.5	<0.5	-
Total Kjeldahl Nitrogen	mg/L	-	-	1.24	1.10	-
Turbidity (Field)	NTU	1.0 (5.0)	MAC/AO	7.5	4.20	2.38
Turbidity (Laboratory)	NTU	1.0 (5.0)	MAC/AO	16.4	17.0	18.3
<b>GENERAL CHEMICAL - AESTHETIC RELATED</b>						
Alkalinity (as CaCO <sub>3</sub> )	mg/L	30-500	OG	578	570	-
Chloride (Cl)	mg/L	250	AO	116	115	-
Colour (Apparent - Lab)	TCU	5	AO	97	86	116
Colour (Apparent - Field)	TCU	5	AO	117	84	76
Conductivity	uS/cm	-	-	1,530	1,530	-
Dissolved Organic Carbon	mg/L	5	AO	7.70	7.20	-
Hardness (as CaCO <sub>3</sub> )	mg/L	100	OG	708	704	-
Ion Balance	unitless	-	-	1.01	1.02	-
pH	unitless	6.5-8.5	AO	7.91	7.72	-
Phenols	mg/L	-	-	<0.001	<0.001	-
Sulphate (SO <sub>4</sub> )	mg/L	500	AO	185	185	-
Sulphide (S <sub>2</sub> <sup>-</sup> )	mg/L	0.05	AO	<0.01	<0.01	-
Tannin & Lignin	mg/L	-	-	0.70	0.70	-
Total Dissolved Solids	mg/L	500	AO	995	993	-

1. ODWS identifies the following types of parameters:

MAC = Maximum Allowable Concentration

AO = Aesthetic Objective

OG = Operational Guideline

2. Shaded Concentration Indicates an Exceedance of the ODWS Objective

**TABLE 2b: GROUNDWATER GEOCHEMISTRY - METALS**

PARAMETER	UNITS	ODWS		TW1		
		LIMIT	TYPE	GW1 (4 hr) 3/4/2025	GW2 (8 hr) 3/4/2025	GW3 (9 hr) 3/4/2025
<b>Volatiles</b>						
Aluminum (Al)	mg/L	0.1	OG	0.07	0.03	0.03
Antimony (Sb)	mg/L	0.006	IMAC	<0.0005	<0.0005	<0.0005
Arsenic (As)	mg/L	0.01	IMAC	<0.001	<0.001	<0.001
Barium (Ba)	mg/L	1.0	MAC	0.22	0.21	0.214
Beryllium (Be)	mg/L	-	-	<0.0005	<0.0005	<0.0005
Boron (B)	mg/L	5.0	IMAC	0.10	0.11	0.11
Cadmium (Cd)	mg/L	0.005	MAC	<0.0001	<0.0001	<0.0001
Calcium (Ca)	mg/L	-	-	190	188	188
Chromium (Cr)	mg/L	0.05	MAC	<0.001	<0.001	<0.001
Cobalt (Co)	mg/L	-	-	0.0002	0.0002	0.0002
Copper (Cu)	mg/L	1.0	AO	<0.001	<0.001	<0.001
Iron (Fe)	mg/L	0.3	AO	2.22	2.19	2.29
Lead (Pb)	mg/L	0.01	MAC	<0.001	<0.001	<0.001
Magnesium (Mg)	mg/L	-	-	57	57	57
Manganese (Mn)	mg/L	0.05	AO	2.89	2.87	2.89
Mercury (Hg)	mg/L	0.001	MAC	<0.0001	<0.0001	<0.0001
Molybdenum (Mo)	mg/L	-	-	0.001	0.01	0.009
Nickle (Ni)	mg/L	-	-	<0.005	<0.005	<0.005
Potassium (K)	mg/L	-	-	11	11	11
Selenium (Se)	mg/L	0.05	MAC	<0.001	<0.001	<0.001
Silver (Ag)	mg/L	-	-	<0.0001	<0.0001	<0.0001
Sodium (Na)	mg/L	200	AO	100	101	101
Strontium (Sr)	mg/L	-	-	4.5	4.56	4.62
Thallium (Tl)	mg/L	-	-	<0.0001	<0.0001	<0.0001
Uranium (U)	mg/L	0.02	MAC	0.001	0.001	0.001
Vanadium (V)	mg/L	-	-	<0.001	<0.001	<0.001
Zinc (Zn)	mg/L	5.0	AO	<0.01	<0.01	<0.01

1. ODWS identifies the following types of parameters:

MAC = Maximum Acceptable Concentration

IMAC = Interim Maximum Acceptable Concentration

AO = Aesthetic Objective

OG = Operational Guideline

2. Shaded Concentration Indicates an Exceedance of the ODWS Objective

The bacteriological test results (Certificate of Analysis – Report No. 4259100) indicated that the test samples at the 4- and 8-hour interval were non-detect (0 ct/100 mL) for E.Coli. Total coliforms were detected in concentrations of 4 and 3 ct/100 mL at the 4-hour and 8-hour marks, respectively. According to the City of Ottawa HTAG, a total coliform concentration of less than 6 ct/100 mL is deemed acceptable.

The water quality of the subject water supply well meets all the Ontario Drinking Water Standards maximum acceptable concentrations (MAC) with the exception of Manganese. As there is an exceedance of a health-related parameter and the exceedance is above the Maximum Concentration Considered Reasonably Treatable (MCCRT), the water source can only be used as a non-drinking water source. The water meets all of the



Aesthetic Objectives (AO) and Operational Guidelines (OG) with the exception of the following:

- Hardness (as CaCO<sub>3</sub>)
- Alkalinity (as CaCO<sub>3</sub>)
- Dissolved Organic Carbon (DOC)
- Colour
- Turbidity
- Total Dissolved Solids (TDS)
- Iron (Fe)

Each of these groundwater parameters are discussed in detail below.

Should any water treatment be desired by the owner, it is recommended that a water treatment specialist be retained to ensure that water treatment occurs in a safe manner.

As the water is considered to be a non-drinking water source, there will be **no consumption** of the non-drinking water supply, and signs will be posted to indicate that there should be no consumption from the available faucets. The public will not have access to the proposed bathroom facilities. Drinking water will need to be brought in from external sources such as water coolers.

### **Hardness as CaCO<sub>3</sub>**

Hardness, expressed as calcium carbonate, is an operational guideline and does not appear in the ODWS. Rather, it appears in the Technical Support Documents for Ontario Drinking Water Standards, Objectives and Guidelines as a parameter with an operational guideline at 100 mg/L. At the measured concentrations of 708 and 704 mg/L, the water is considered to be extremely hard, and it is above the reasonably treatable limit of 500 mg/L specified in Table 3 of the MOECC guidance document Procedure D-5-5 (1996).

The Technical Support Document for Ontario Drinking Water Standards, Objectives, and Guidelines sets the MCCRT of hardness at 500 mg/L as, at concentrations removed above this limit, the salt exchange would make the water unpalatable and unsuitable for domestic use (i.e. consumption). As the water well is being used as a non-drinking water source (i.e. not used for consumption), the MCCRT does not apply in this case.

The Langelier Saturation Index (LSI) calculation provided an LSI of 0.6. Based on the evaluation of the result, the water is super saturated and tends to precipitate a scale layer of calcium carbonate (scale forming but non-corrosive). Based on the range of stability in the positive direction, there are no mitigative measures needed to prevent corrosion, however, hardness reduction technologies can be implemented to prevent scaling which may inhibit boilers and cause staining. See Langelier Saturation Index Calculation attached for calculation details.



It is recommended that water hardness be treated using conventional technologies such as water softening or reverse osmosis, if desired by the owner. Without treating hardness, scaling can occur which can result in discolouration and residue buildup on water fixtures, or reduction in boiler efficiency due to scale build-up. According to Health Canada's *Guidelines for Canadian Drinking Water Quality - Summary Tables*, "Although hardness may have significant aesthetic effects, a guideline has not been established because public acceptance of hardness may vary considerably according to the local conditions; major contributors to hardness (calcium and magnesium) are not of direct public health concern".

### **Alkalinity**

Alkalinity, expressed as calcium carbonate, is a measure of the resistance of the water to the effects of acids added to water. Alkalinity is an operation guideline and does not appear in the ODWS. Rather, it appears in the Technical Support Documents for Ontario Drinking Water Standards, Objectives and Guidelines as a parameter with an operational guideline at 500 mg/L. At concentrations above the operational guideline, scaling may form on service pipes and water heaters. The alkalinity concentration in the groundwater was 578 and 570 mg CaCO<sub>3</sub>/L at 4 and 8 hours, respectively. As there is no MCCRT or health related effects related to alkalinity, no treatment is required. It is anticipated that the treatment of hardness would reduce alkalinity to within acceptable limits.

The Langelier calculation provided an LSI of 0.6. Based on the evaluation of the result, the water is super saturated and tends to precipitate a scale layer of calcium carbonate (scale forming but non-corrosive). Based on the range of stability in the positive direction, there are no mitigative measures needed to prevent corrosion, however, hardness reduction technologies can be implemented to prevent scaling which may inhibit boilers and cause staining. See Langelier Saturation Index Calculation attached for calculation details.

### **Dissolved Organic Carbon**

Dissolved Organic Carbon (DOC) is a key indicator of potential water quality deterioration, as it can serve as a nutrient source that promotes bacterial growth. Furthermore, DOC can react with chlorine to create disinfection by-products which may be harmful. DOC was found in the groundwater at concentrations of 7.7 and 7.2 mg/L at the 4- and 8-hour marks, respectively. The DOC concentrations found in the groundwater exceed the aesthetic objective of 5 mg/L, however, the DOC concentrations are below the MECP Procedure D-5-5 MCCRT of 10 mg/L. As the water is to be used as a non-drinking water source, there will be no consumption of the water and, therefore, the aesthetic objective exceedance is not anticipated to be an issue.

### **Total Dissolved Solids (TDS)**

Total Dissolved Solids (TDS) refers to the concentration of inorganic substances dissolved in water. The main constituents are typically chloride, sulphates, calcium,



magnesium, and bicarbonates. The TDS concentration of 993 mg/L exceeds the Aesthetic Objective of 500 mg/L. At concentrations above 500 mg/L, some consumers may find the taste objectionable, however, as the objective is an aesthetic objective and the water will be used for non-drinking water sources, no treatment is required.

The Langelier calculation provided an LSI of 0.6. Based on the evaluation of the result, the water is super saturated and tends to precipitate a scale layer of calcium carbonate (scale forming but non-corrosive). Based on the range of stability in the positive direction, there are no mitigative measures needed for TDS specifically. See Langelier Saturation Index Calculation attached for calculation details.

### **Iron**

Concentrations of iron above 0.3 mg/L can contribute to staining of fixtures and a metallic taste at higher concentrations. Precipitation of iron can promote the growth of iron bacteria in pipes. The concentration of iron in the groundwater in TW1 was measured to be 2.19 to 2.29 mg/L. The concentration of iron in the groundwater is considered to be reasonably treatable in accordance with Procedure D-5-5. It is recommended that a water softener or manganese greensand filter be used to reduce the levels of iron and reduce the potential for excessive precipitate occurring in the water supply system, if desired by the property owner. If treatment is not used, negative impacts such as discolouration of water fixtures, precipitation of iron and staining may occur.

### **Manganese**

The manganese concentration results from the laboratory test samples yielded a value of 2.89 mg/L in the onsite well, which is above the aesthetic objective in the ODWSOG of 0.05 mg/L and the health related MAC of 0.12 mg/L. As the manganese concentration is well above the MAC of 0.12 mg/L and the MCCRT of 1 mg/L, the water is considered not safe to consume. Therefore, the water source will be considered only as a non-drinking water source.

Manganese, like iron, can stain fixtures at concentrations above 0.05 mg/L. Procedure D-5-5 gives a maximum concentration considered reasonably treatable for manganese as 1.0 mg/L. It is recommended that a reverse osmosis system, ion exchange / water softeners and / or an oxidizing filter be used to reduce the manganese concentration, if desired by the owner.

As the concentration of manganese is elevated above the Health Canada Federal Drinking Water Guidelines, a notice regarding the elevated levels of manganese in the aquifer accessed by TW1 is recommended to be registered on title so that future owners are made aware.

The City of Ottawa (Ottawa Public Health) has prepared a Manganese in drinking Water Factsheet, which can be found attached to this report.



## Colour

Colour may occur in drinking water for several reasons. It may be due to organic substances from the decay of vegetation, or the presence of metals such as iron, manganese, and copper, which are abundant in nature. The provincial aesthetic objective for colour in drinking water is 5 True Colour Units (TCU). The federal (Health Canada) guideline aesthetic objective limit for colour is 15 TCU (Guidelines for Canadian Drinking Water Quality, Health Canada June 2019). Procedure D-5-5 gives a maximum concentration considered reasonably treatable for colour as 7 TCU.

During the field pumping test, a DR900 colorimeter was used to measure apparent colour in the groundwater at regular intervals. Apparent colour in the groundwater was measured as 86 TCU at the end of the 8 hour pumping test which is above the aesthetic guidelines of 5 TCU and above the MCCRT of 7 TCU. The elevated apparent colour levels detected in the lab samples and field samples is attributed to the precipitation of iron and manganese out of the groundwater. Due to the elevated concentrations of iron and manganese in the groundwater, rapid discoloration can occur when exposed to oxygen. It is anticipated that the colour concentration will decrease with the treatment of other parameters such as iron and manganese.

## Turbidity

Turbidity, which is generally an aesthetic parameter, was detected in the laboratory test samples at values of 16.4 to 18.3 NTU in pumping test. Field testing detected the samples at values of 7.48, 4.15 and 2.38 NTU in the 4, 8, and 9-hour field tests, respectively. Continued pumping showed a decrease towards the end of the test. It is expected that continued use of the well would further reduce turbidity values. The elevated turbidity in the laboratory analyzed samples is attributed to the precipitation of iron and manganese. Therefore, it is anticipated that turbidity levels will also decrease due to treatment of other constituents, if treatment is desired by the owner.

During the pumping test, a Hanna Instruments HI98703 Fast Tracker Turbidity Meter was used to measure the turbidity in the groundwater at regular intervals. The ODWS maximum acceptable concentration for turbidity in drinking water entering the distribution system is 1 NTU. The Aesthetic Objective for turbidity in drinking water reaching the consumer is 5 NTU. The MECP Procedure D-5-5 MCCRT for turbidity is 5 NTU. The field test parameters are below the 5 NTU objective and MCCRT. As turbidity was detected above 1 NTU, particular care must be taken during testing to ensure that the bacteria requirements of Table 1 are met. The bacteriological test results indicated that the test samples at the 4 and 8 hour interval were non-detect (0 ct/100 mL) for E.Coli, and Total Coliforms was below 6 ct/100 mL which is considered acceptable.



## **Terrain Analysis**

### **Surficial Geology**

A series of boreholes were put down on the subject parcel to delineate the subsurface soil conditions as part of the Geotechnical Investigation (Paterson Report PG7327-1 dated November 25, 2024). On November 11, 2024 three (3) boreholes were excavated on the property for the design of the proposed building and its associated infrastructure. The boreholes were advanced to a maximum depth of 1.3 m below ground surface (bgs). Additionally, one borehole (Paterson Report PE4828-1R, 2019) and one test pit (Paterson Report PG6452-1, 2022) were excavated at the site during previous investigations. The boreholes were distributed in a manner to provide general coverage of the subject site, taking into consideration underground services and available site access. The locations of the test pits on the property are delineated on the Test Hole Location Plan, drawing PG7327-1, attached.

The borehole locations were recorded and the subsurface conditions, including the soil morphology and depth to the groundwater table (if encountered), were carefully observed and recorded. The soils encountered were classified texturally in the field and later reviewed in the laboratory.

Generally, the subsurface profile at the borehole locations were observed to consist of imported fill material to a depth of 0.6 to 1.3 m. The fill material was generally observed to consist of loose to compact, grey to brown silty sand to sandy silt with traces of topsoil and gravel. Practical refusal to augering was encountered on inferred bedrock at depths ranging from 0.6 to 1.3 m bgs. No groundwater was observed within the boreholes.

It should be noted that groundwater levels can fluctuate both seasonally and in conjunction with precipitation events. Therefore, the groundwater levels could vary at the time of construction.

Reference should be made to the test pit logs appended to this report for the details of the soil profiles encountered at each test hole location. The client should be aware that any information pertaining to soils are furnished as a matter of general information only and borehole descriptions are not to be interpreted as descriptive of conditions at locations other than those described by the boreholes themselves.

### **Hydrogeological Sensitivity of the Site**

The subject site is currently vacant and undeveloped. The subject site is to be serviced by a private well and septic system. The site is bordered by vacant land to the north and south, by agricultural lands to the east and by Somme Street to the west. All surrounding properties are on private services.



The overburden at the test hole locations generally consists of a fill overlying bedrock. Refusal was encountered between 0.6 to 1.3 m bgs. According to available geological mapping, the drift thickness within the site varies from 0 to 1 m bgs.

According to the geotechnical field investigation, the overburden thickness was observed to be less than 2 m. Due to the shallow nature of the inferred bedrock, the site is considered to be hydrogeologically sensitive and, therefore, mitigating measures are recommended. It is recommended that any sewage system be located a minimum of 30 m from the water supply well, and that the sewage system is lined with a **100 mm** clay seal.

The water supply well has been installed with 12.1 m of casing, which is twice the O.Reg 903 required amount of casing, and is located more than 60 m away from the leaching bed, which is more than twice the Ontario Building Code (OBC) required separation distance. Furthermore, available surface water mapping indicates that the general groundwater flow direction is in the northeast to east direction towards the Findlay Creek Municipal Drain. Therefore the proposed sewage system is downgradient of TW1. Due to the increased separation distance, increased well casing, the 100 mm clay seal underlying the sewage system and general groundwater flow direction, septic impacts are not anticipated in the onsite drinking well.

### **Conceptual Lot Development Plan**

A one-storey warehouse with a mezzanine and an office along with associated parking and infrastructure is proposed to be constructed onsite. The location of the proposed structure can be found on the attached Novatech Drawing 124111-SP, Site Plan dated February, 2025. The proposed private sewage servicing and site grading design is provided by Novatech.

### **Proposed Sewage System**

A sewage system design was completed by Novatech. Novatech provided a total daily design sewage flow (TDDSF) of 1,005 L/day and a sewage system capacity of 1,100 L/day.

### **Predictive Nitrate Impact Assessment**

Nitrate is considered to be a critical parameter of concern when assessing impacts to groundwater quality downgradient of an onsite sewage system. The City's HTAG, including the annotated MECP Procedure D-5-4 applies for the proposed development. For the purpose of this guideline, the Ontario Drinking Water Objective of 10 mg/L of nitrate is used as an indicator of groundwater impact potential.

Under this guideline, where the average lot size is one hectare or larger and the minimum lot size is 0.8 ha or greater, a detailed impact assessment may not be required. It has been the City of Ottawa's policy that where the lot size of 0.8 ha or larger, a detailed assessment is typically not required since it is considered to be a low-risk development.



The subject site is located within the Hawthorne Industrial Park industrial subdivision (Golder Associates 08-1122-0215-3, September 2011). The subject site is 0.8 ha in size, while the industrial subdivision has an average lot size of 3.15 ha, with lot sizes ranging from 0.8 – 11.04 ha. As such, a detailed nitrate impact assessment (NIA) would not typically be necessary. An NIA was completed below to corroborate our opinion that the property can adequately support the proposed development without having adverse impacts on the underlying bedrock aquifer should the minimum separation distances, well construction, and septic system be completed as per the recommendations of this report and the OBC. The values shown in the Predictive Nitrate Impact Assessment attached to this report are summarized below. To be conservative, the maximum sewage system capacity of 1,100 L/day was used for the assessment.

<input type="checkbox"/> Site area	0.8 ha
<input type="checkbox"/> Impervious area (%)	56 %
<input type="checkbox"/> Daily sewage flow	1.1 m <sup>3</sup> /d
<input type="checkbox"/> Concentration of nitrate in effluent (Value based on typical effluent concentration)	40 mg/L
<input type="checkbox"/> Concentration of nitrate in effluent with treatment (Value based on nitrate reduction system (Ecoflo ECDn Series) with 50 % nitrate reduction)	20 mg/L
<input type="checkbox"/> Surplus Water (The surplus water value was estimated based on Environment Canada Climate Office values with a soil type comprised of fine sandy loam (Urban Lawns) and anthropogenic sources.)	379 mm/yr
<input type="checkbox"/> Combined infiltration factor based on:	0.70
• Topography infiltration factor	0.30
• Soil texture infiltration factor	0.30
• Cover infiltration factor	0.10

The topography infiltration factor of 0.30 is based upon a flat land with an average slope of 0.6 m/km. The soil texture infiltration factor was based upon a silty sand-based fill which is approximated to be between “open sandy loam” and “medium combinations of loam and clay” with a value of 0.3. This is a reasonable generalization of the overburden. The “cover infiltration factor” was calculated at 0.10 based upon a conservative cultivated land type cover.

There are numerous tertiary treatment technologies that are NSF/ANSI 245 and/or BNQ certified for 50% nitrate reduction, resulting in an effluent nitrate concentration of 20 mg/L. When using an effluent nitrate concentration of 20 mg/L, the predicted nitrate concentration at the property boundary is **5.97 mg/L**. This is below the limit of 10 mg/L of nitrate at the property boundary.



Based on the results of the predicted nitrate impact assessment, it is our opinion that the property can adequately support the proposed building addition without having an adverse impact on the underlying bedrock aquifer, provided that a NSF/ANSI 245 and/or BNQ certified 50% nitrate reduction technology is used in the septic system.





## CONCLUSIONS

Based on the information contained within the body of this report the following conclusions can be drawn:

1. The water supply aquifer intercepted by the existing well is considered to be adequate to support the water quantity demands for the proposed commercial development.
2. The property owner will need to ensure that protective measures are taken to protect the wellhead, such as the use of a barrier, when constructing the proposed commercial development.
3. The groundwater contains elevated concentrations of hardness, alkalinity, DOC, TDS, colour, turbidity, iron, and manganese. The noted parameters can be treated to functional concentrations with current readily available water conditioning equipment.
4. Elevated concentrations of manganese were encountered in the water supply intercepted by TW1. The manganese concentration was recorded to be 2.29 mg/L in the groundwater, which exceeded the MAC of 0.12 mg/L and the MCCRT of 1.0 mg/L. Therefore, as there is a health-related risk, the water is considered not suitable to consume and can only be used for non-drinking water sources such as toilet flushing. As the manganese exceedance is health related, a notice regarding the elevated levels of manganese in the aquifer accessed by TW1 is recommended to be registered on title so that future owners are made aware. Manganese treatment is recommended to reduce staining.
5. If desired by the property owner, a residential grade water softener can be used to facilitate the reduction of the hardness concentration and reduce scaling. If a water softener is used for the proposed development, the owner should be made aware that additional sodium will be added to the water to reduce hardness. Note that elevated hardness is above the MCCRT, however, the MCCRT for hardness is related to aesthetic reasons, therefore, as the water is for non-drinking water purposes, the hardness can be treated. It is anticipated that alkalinity will be reduced as hardness is reduced.
6. If desired by the property owner, iron and manganese can be reduced using greensand filters to reduce staining. It is not anticipated that the manganese can be reduced to a concentration that would allow the water to be drinkable.
7. As the well water is to be used for non-drinking water purposes, DOC, TDS, colour, and turbidity do not need to be treated.



8. The predicted nitrate concentrations at the property boundary is calculated to be below the required 10 mg/L threshold when an NSF/ANSI 245 and/or certified BNQ system with a minimum of 50 % nitrate reduction tertiary treatment system is used.
9. Due to the hydrogeological sensitivity of the site, a 30 m setback between the drinking water well and sewage system is recommended. It is recommended that a 100 mm clay seal be used at the base of the sewage system.
10. Well water can only be used for non-drinking water purposes such as toilet flushing and/or hand washing, and drinking water will have to be obtained from offsite sources such as water coolers.
11. A Sewage System Permit and Building Permit need to be issued prior to the commencement of construction on the proposed commercial building or the proposed septic system.
12. The results of the Hydrogeological Assessment and Terrain Analysis have provided satisfactory evidence that the subject site can support the proposed building addition with respect to water quantity and sewage system placement.

We trust that the current submission satisfies your immediate requirements.

Best Regards,

**Paterson Group Inc.**

Alexander Schopf, PhD, EIT



Erik Ardley, P. Geo

**Attachments:**

- Key Plan
- Novatech 124111-SP Site Plan dated February , 2025
- MECP Water Well Records
- Eurofins Certificate of Analysis
- Paterson Borehole Logs
- AQTESOLV - Pumping Test Analysis Reports
- Nitrate Impact Assessment Calculations
- Langelier Saturation Index (LSI) Calculation
- Paterson Drawing PG7327-1 - Test Hole Location Plan
















# FIGURE 1

## KEY PLAN



**LEGEND**

-  Property Line
-  Zoning Setback Line
-  Fire Route
-  Proposed Barrier Curb
-  Proposed Swale
-  Proposed Bollard
-  Proposed Building Entrance
-  Proposed Well
-  Proposed Gravel Area

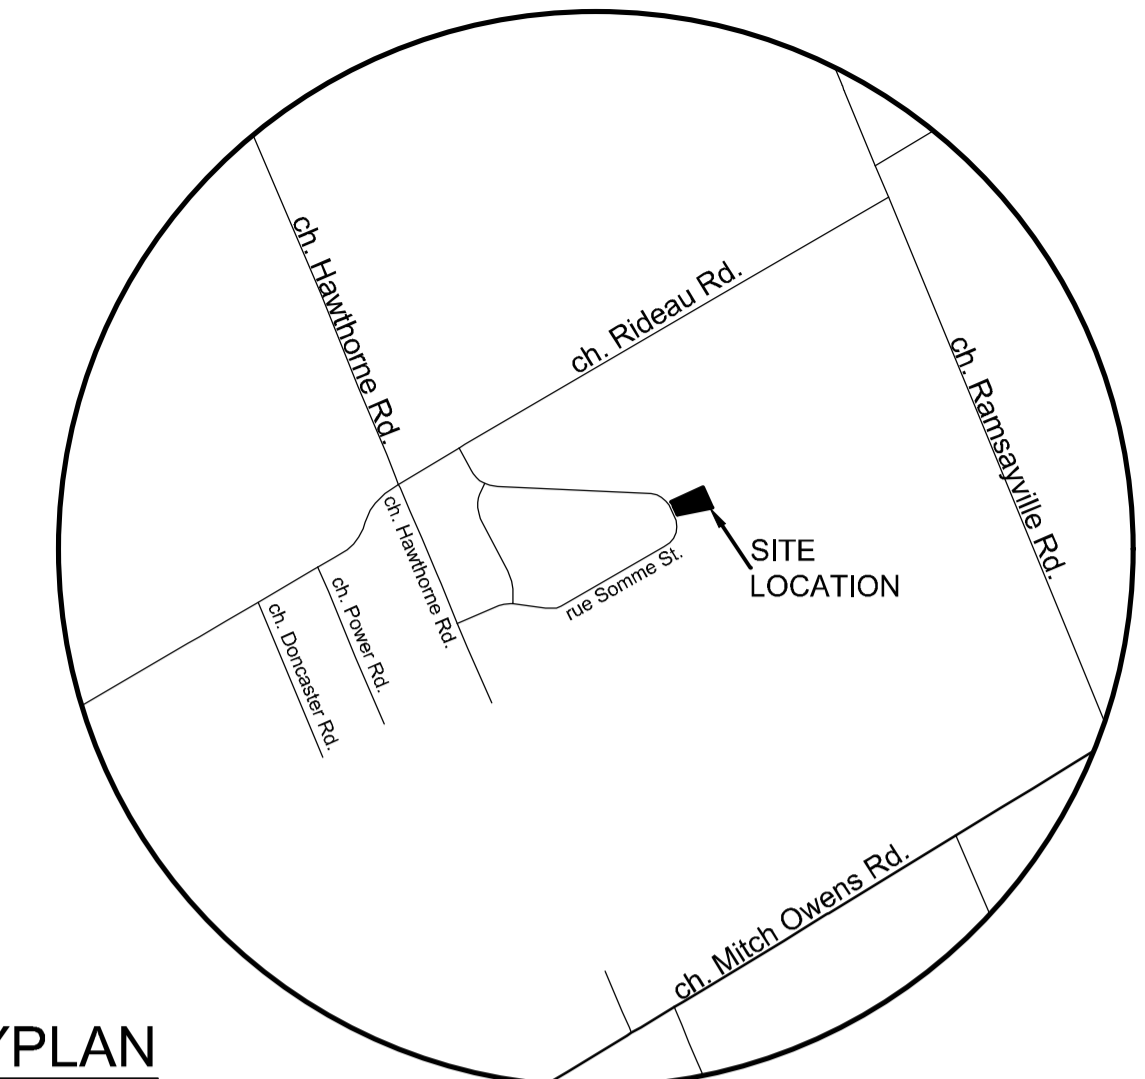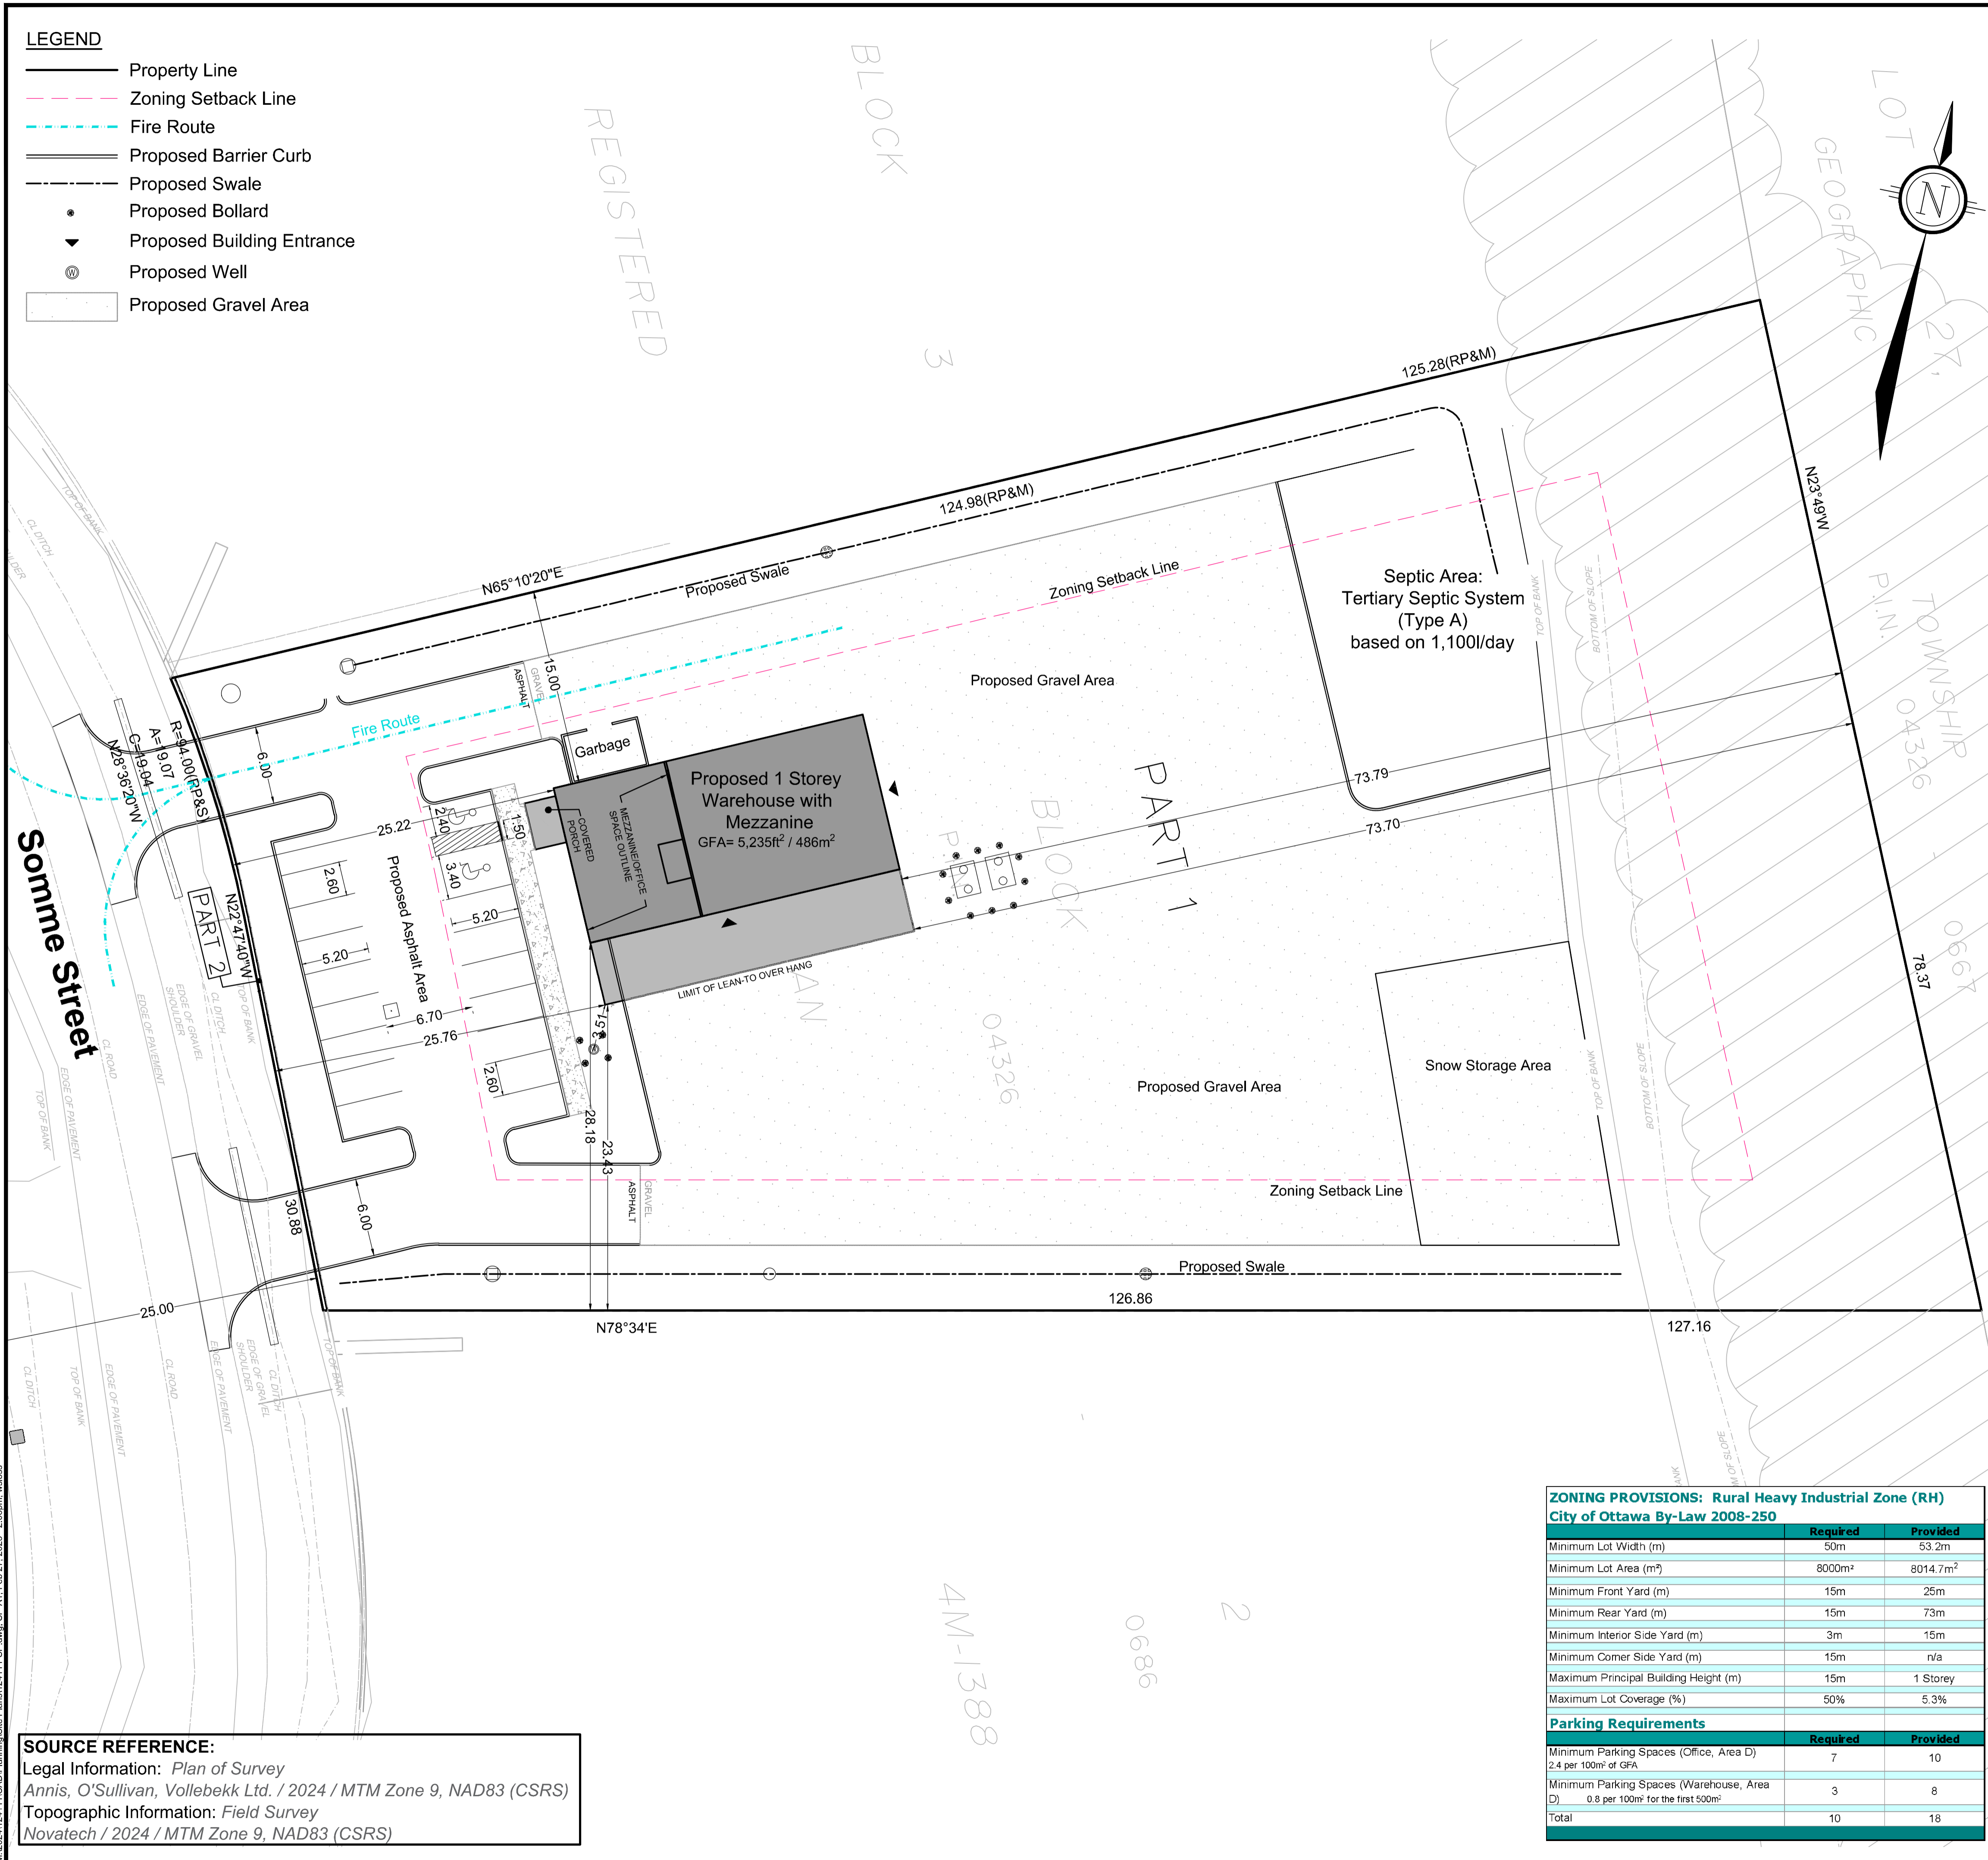


# SITE PLAN

## HAWTHORNE LOT 541

PART OF BLOCKS 2 AND  
RESERVE BLOCK 17  
REGISTERED PLAN 4M-1388  
CITY OF OTTAWA


Titan Environmental Containment  
Unit #7 - 812 Burton Road  
Vars, Ontario



**ZONING PROVISIONS: Rural Heavy Industrial Zone (RH)**  
**City of Ottawa By-Law 2008-250**

	Required	Provided
Minimum Lot Width (m)	50m	53.2m
Minimum Lot Area (m <sup>2</sup> )	8000m <sup>2</sup>	8014.7m <sup>2</sup>
Minimum Front Yard (m)	15m	25m
Minimum Rear Yard (m)	15m	73m
Minimum Interior Side Yard (m)	3m	15m
Minimum Corner Side Yard (m)	15m	n/a
Maximum Principal Building Height (m)	15m	1 Storey
Maximum Lot Coverage (%)	50%	5.3%
<b>Parking Requirements</b>		
Minimum Parking Spaces (Office, Area D) 2.4 per 100m <sup>2</sup> of GFA	7	10
Minimum Parking Spaces (Warehouse, Area D) 0.8 per 100m <sup>2</sup> for the first 500m <sup>2</sup>	3	8
<b>Total</b>	<b>10</b>	<b>18</b>

**SOURCE REFERENCE:**  
Legal Information: Plan of Survey  
Annis, O'Sullivan, Vollebakk Ltd. / 2024 / MTM Zone 9, NAD83 (CSRS)  
Topographic Information: Field Survey  
Novatech / 2024 / MTM Zone 9, NAD83 (CSRS)

No.	ISSUED FOR SITE PLAN APPROVAL	DATE	BY
	REVISION		
 Engineers, Planners & Landscape Architects Suite 200, 240 Michael Cowpland Drive Ottawa, Ontario, Canada K2M 1P6 Telephone: (613) 254-9643 Facsimile: (613) 254-5867 Website: www.novatech-eng.com		ISSUED <b>FEBRUARY, 2025</b> PROJECT No. <b>124111</b> DRAWING No. <b>124111-SP</b>	

M:\2024\124111\CADD\Planning\Site Plans\124111-SP.dwg, SP-A1, Feb 27, 2025 - 2:05pm, webster

DXX-XX-XX-XXXX

#XXXXX

Measurements recorded in:  Metric  Imperial

A421912

Page \_\_\_ of \_\_\_

Well Owner's information

First Name, Last Name/Organization, E-mail Address, Mailing Address, Municipality, Province, Postal Code, Telephone No.

Well Location

Address of Well Location, Township, Lot, Concession, County/District/Municipality, City/Town/Village, Province, Postal Code, UTM Coordinates, Municipal Plan and Sublot Number

Overburden and Bedrock Materials/Abandonment Sealing Record

Table with columns: General Colour, Most Common Material, Other Materials, General Description, Depth (m/ft) From. Includes entries for Sandy Clay and Gray Sandstone.

Annular Space table with columns: Depth Set at (m/ft) From To, Type of Sealant Used, Volume Placed (m³/lb).

Method of Construction and Well Use checkboxes including Cable Tool, Rotary, Boring, Air percussion, etc.


Construction Record - Casing table with columns: Inside Diameter, Open Hole OR Material, Wall Thickness, Depth (m/ft) From To, Status of Well.

Construction Record - Screen table with columns: Outside Diameter, Material, Slot No., Depth (m/ft) From To.

Water Details and Hole Diameter tables with columns for depth, kind of water, and diameter.

Well Contractor and Well Technician Information section including Business Name, Address, and Licences.

Results of Well Yield Testing table with columns for Draw Down (Time, Water Level) and Recovery (Time, Water Level).

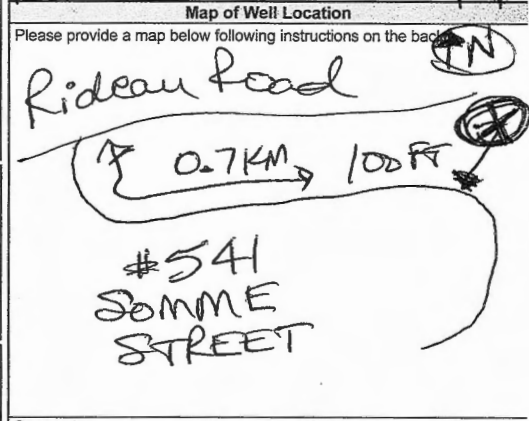

Comments: 1HP-20GPM Sat @ 100 FT

Well owner's information package delivery and Ministry Use Only section including Date Package Delivered, Date Work Completed, and Audit No.

1527048

MUNICIPALITY: 15002 CON. NO.: 06

1. PRINT ONLY IN SPACES PROVIDED  
2. CHECK  CORRECT BOX WHERE APPLICABLE

COUNTY OR DISTRICT: Ottawa Carleton TOWNSHIP, BOROUGH CITY, TOWN, VILLAGE: Gloucester CON. BLOCK, TRACT, SURVEY ETC: 6 LOT: 26  
OWNER (SURNAME FIRST): Beaver Road Builders Ltd. ADDRESS: P.O. Box 4208 st. "E" Ottawa, Ontario K1S 5B2 DATE COMPLETED: DAY 19 MO 4 YR 93

21 ZONE EASTING NORTHING RC ELEVATION RC BASIN CODE II III IV

**LOG OF OVERBURDEN AND BEDROCK MATERIALS (SEE INSTRUCTIONS)**

GENERAL COLOUR	MOST COMMON MATERIAL	OTHER MATERIALS	GENERAL DESCRIPTION	DEPTH - FEET	
				FROM	TO
Brown	Sandy Clay	Broken Rock	Fill	0	9
Gray	Hardpan	Boulders		9	15
Gray	Limestone		Soft	15	33
White & Gray	Sandstone		Hard	33	135

31 32

**41 WATER RECORD**

WATER FOUND AT - FEET	KIND OF WATER
56	1 <input type="checkbox"/> FRESH 3 <input type="checkbox"/> SULPHUR 2 <input type="checkbox"/> SALTY 4 <input type="checkbox"/> MINERALS 6 <input type="checkbox"/> GAS
120	1 <input type="checkbox"/> FRESH 3 <input type="checkbox"/> SULPHUR 2 <input type="checkbox"/> SALTY 4 <input type="checkbox"/> MINERALS 6 <input type="checkbox"/> GAS
	NOT TESTED
	1 <input type="checkbox"/> FRESH 3 <input type="checkbox"/> SULPHUR 2 <input type="checkbox"/> SALTY 4 <input type="checkbox"/> MINERALS 6 <input type="checkbox"/> GAS
	1 <input type="checkbox"/> FRESH 3 <input type="checkbox"/> SULPHUR 2 <input type="checkbox"/> SALTY 4 <input type="checkbox"/> MINERALS 6 <input type="checkbox"/> GAS

**51 CASING & OPEN HOLE RECORD**

INSIDE DIAM INCHES	MATERIAL	WALL THICKNESS INCHES	DEPTH - FEET	
			FROM	TO
6 1/4	1 <input checked="" type="checkbox"/> STEEL 2 <input checked="" type="checkbox"/> GALVANIZED 3 <input type="checkbox"/> CONCRETE 4 <input type="checkbox"/> OPEN HOLE 5 <input type="checkbox"/> PLASTIC	.188	0	31
6 1/8	1 <input type="checkbox"/> STEEL 2 <input type="checkbox"/> GALVANIZED 3 <input type="checkbox"/> CONCRETE 4 <input type="checkbox"/> OPEN HOLE 5 <input type="checkbox"/> PLASTIC		31	75
6	1 <input type="checkbox"/> STEEL 2 <input type="checkbox"/> GALVANIZED 3 <input type="checkbox"/> CONCRETE 4 <input type="checkbox"/> OPEN HOLE 5 <input type="checkbox"/> PLASTIC		75	135

**SCREEN**

SIZE OF OPENING (SLOT NO.): 31-33 DIAMETER: 34-38 LENGTH: 39-40  
MATERIAL AND TYPE: DEPTH TO TOP OF SCREEN: 41-44 10 FEET

**61 PLUGGING & SEALING RECORD**


DEPTH SET AT - FEET	MATERIAL AND TYPE (CEMENT GROUT LEAD PACKER, ETC.)
31	Grouted - Cement (18)

**71 PUMPING TEST**

PUMPING TEST METHOD: 1  PUMP 2  BAILER PUMPING RATE: 15-20 GPM DURATION OF PUMPING: 1 HOURS

STATIC LEVEL	WATER LEVEL END OF PUMPING	WATER LEVELS DURING			
31 FEET	130 FEET	15 MINUTES: 40 FEET	30 MINUTES: 32 FEET	45 MINUTES: 31 FEET	60 MINUTES: 31 FEET

RECOMMENDED PUMP TYPE:  SHALLOW  DEEP RECOMMENDED PUMP SETTING: 125 FEET RECOMMENDED PUMPING RATE: 5 GPM

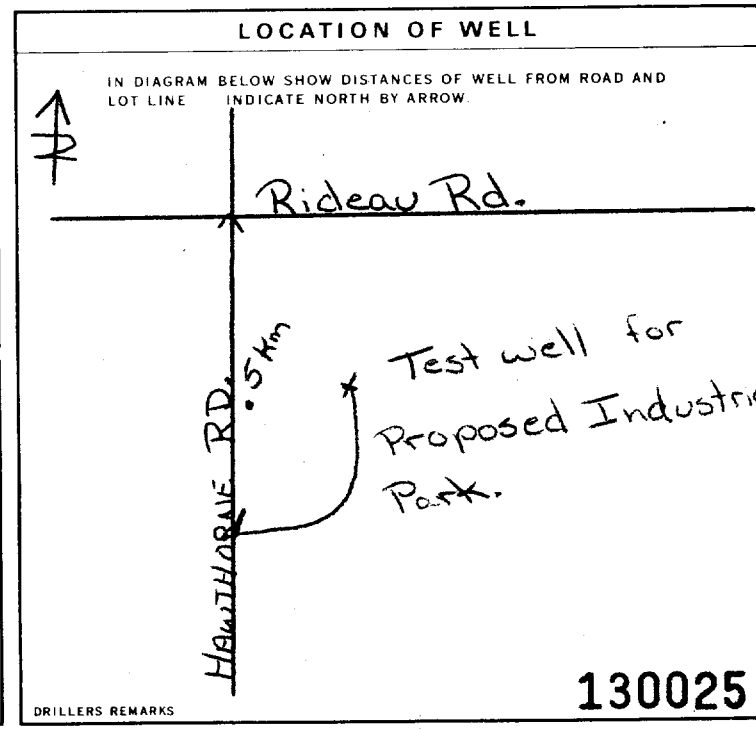

**FINAL STATUS OF WELL**

1  WATER SUPPLY 5  ABANDONED, INSUFFICIENT SUPPLY  
2  OBSERVATION WELL 6  ABANDONED POOR QUALITY  
3  TEST HOLE 7  UNFINISHED  
4  RECHARGE WELL  DEWATERING

**WATER USE**

1  DOMESTIC 5  COMMERCIAL  
2  STOCK 6  MUNICIPAL  
3  IRRIGATION 7  PUBLIC SUPPLY  
4  INDUSTRIAL 8  COOLING OR AIR CONDITIONING  
 OTHER 9  NOT USED

**METHOD OF CONSTRUCTION**

1  CABLE TOOL 6  BORING  
2  ROTARY (CONVENTIONAL) 7  DIAMOND  
3  ROTARY (REVERSE) 8  JETTING  
4  ROTARY (AIR) 9  DRIVING  
5  AIR PERCUSSION  DIGGING  OTHER

**CONTRACTOR**

NAME OF WELL CONTRACTOR: Capital Water Supply Ltd. WELL CONTRACTOR'S LICENCE NUMBER: 1558  
ADDRESS: P.O. Box 490 Stittsville, Ontario K2S 1A6  
NAME OF WELL TECHNICIAN: S. Miller WELL TECHNICIAN'S LICENCE NUMBER: T0097  
SIGNATURE OF TECHNICIAN/CONTRACTOR: [Signature] SUBMISSION DATE: DAY 20 NO. 4 YR 93

**OFFICE USE ONLY**

DATA SOURCE: 1558 CONTRACTOR: 1558 DATE RECEIVED: MAY 06 1993  
DATE OF INSPECTION: INSPECTOR:  
REMARKS:

1. PRINT ONLY IN SPACES PROVIDED

2. CHECK  CORRECT BOX WHERE APPLICABLE

11

1527383

MUNICIPALITY 15002

CON. CON.

106

COUNTY OR DISTRICT: **Westchester** TOWNSHIP, BOROUGH, CITY, TOWN, VILLAGE: **Box 4208 stn. "E" Ottawa, Ontario K1S 5B2** CON. BLOCK, TRACT, SURVEY ETC: **6** LOT: **26**

DATE COMPLETED: DAY **16** MO **8** YR **93**

**LOG OF OVERBURDEN AND BEDROCK MATERIALS (SEE INSTRUCTIONS)**

GENERAL COLOUR	MOST COMMON MATERIAL	OTHER MATERIALS	GENERAL DESCRIPTION	DEPTH - FEET	
				FROM	TO
Brown	Sand	Stone		0	5
Gray	Hardpan	Boulders		5	28
Gray	Sandstone		Hard	28	100

31

32

**41 WATER RECORD**

WATER FOUND AT - FEET	KIND OF WATER
58	1 <input type="checkbox"/> FRESH 3 <input type="checkbox"/> SULPHUR 2 <input type="checkbox"/> SALTY 4 <input type="checkbox"/> MINERALS 6 <input type="checkbox"/> GAS
88	1 <input type="checkbox"/> FRESH 3 <input type="checkbox"/> SULPHUR 2 <input type="checkbox"/> SALTY 4 <input type="checkbox"/> MINERALS 6 <input type="checkbox"/> GAS
20-23	<b>NOT TESTED</b>
25-28	1 <input type="checkbox"/> FRESH 3 <input type="checkbox"/> SULPHUR 2 <input type="checkbox"/> SALTY 4 <input type="checkbox"/> MINERALS 6 <input type="checkbox"/> GAS
30-33	1 <input type="checkbox"/> FRESH 3 <input type="checkbox"/> SULPHUR 2 <input type="checkbox"/> SALTY 4 <input type="checkbox"/> MINERALS 6 <input type="checkbox"/> GAS

**51 CASING & OPEN HOLE RECORD**

INSIDE DIAM. INCHES	MATERIAL	WALL THICKNESS INCHES	DEPTH - FEET	
			FROM	TO
6 1/4	1 <input checked="" type="checkbox"/> STEEL 2 <input checked="" type="checkbox"/> GALVANIZED 3 <input type="checkbox"/> CONCRETE 4 <input type="checkbox"/> OPEN HOLE 5 <input type="checkbox"/> PLASTIC	.188	0	39
5 15/16	1 <input type="checkbox"/> STEEL 2 <input type="checkbox"/> GALVANIZED 3 <input type="checkbox"/> CONCRETE 4 <input checked="" type="checkbox"/> OPEN HOLE 5 <input type="checkbox"/> PLASTIC		39	100

**SCREEN**


SIZE(S) OF OPENING (SLOT NO.)	DIAMETER INCHES	LENGTH FEET

**61 PLUGGING & SEALING RECORD**

DEPTH SET AT - FEET	MATERIAL AND TYPE (CEMENT GROUT LEAD PACKER ETC.)
37.5	Cement - Grouted

**71 PUMPING TEST**

PUMPING TEST METHOD	PUMPING RATE	DURATION OF PUMPING
1 <input checked="" type="checkbox"/> PUMP 2 <input type="checkbox"/> BAILER	20 GPM	1 15-16 HOURS 17-18 MINS
STATIC LEVEL	WATER LEVEL END OF PUMPING	WATER LEVELS DURING
7'6" FEET	14'6" FEET	15 MINUTES: 13'11" FEET 30 MINUTES: 14 FEET 45 MINUTES: 14'4" FEET 60 MINUTES: 14'6" FEET
IF FLOWING GIVE RATE	PUMP INTAKE SET AT	WATER AT END OF TEST
	50 GPM	1 <input type="checkbox"/> CLEAR 2 <input checked="" type="checkbox"/> CLOUDY
RECOMMENDED PUMP TYPE	RECOMMENDED PUMP SETTING	RECOMMENDED PUMPING RATE
<input type="checkbox"/> SHALLOW <input checked="" type="checkbox"/> DEEP	50 FEET	5 GPM

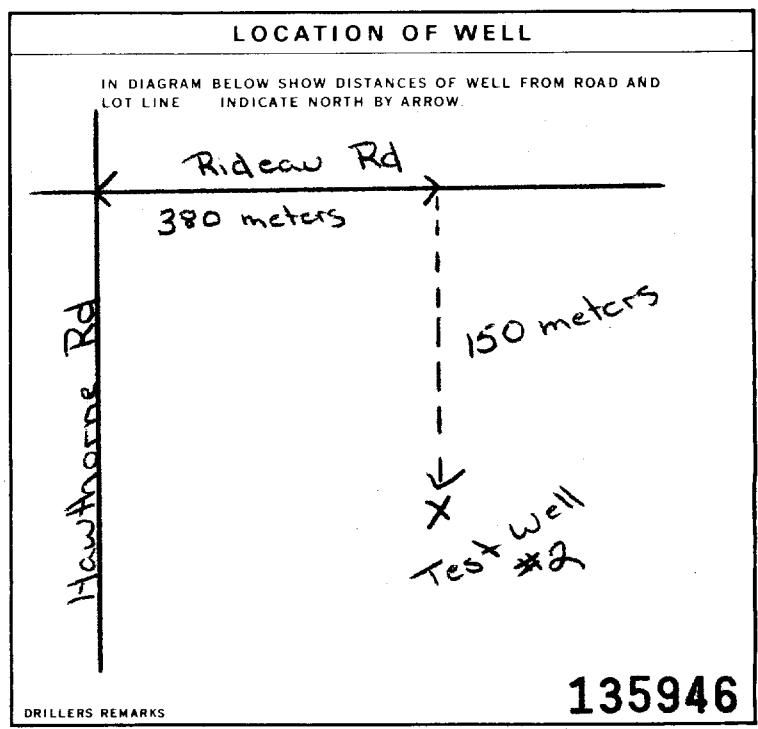

**FINAL STATUS OF WELL**

1 <input checked="" type="checkbox"/> WATER SUPPLY	5 <input type="checkbox"/> ABANDONED, INSUFFICIENT SUPPLY
2 <input type="checkbox"/> OBSERVATION WELL	6 <input type="checkbox"/> ABANDONED POOR QUALITY
3 <input type="checkbox"/> TEST HOLE	7 <input type="checkbox"/> UNFINISHED
4 <input type="checkbox"/> RECHARGE WELL	<input type="checkbox"/> DEWATERING

**WATER USE**

1 <input checked="" type="checkbox"/> DOMESTIC	5 <input type="checkbox"/> COMMERCIAL
2 <input type="checkbox"/> STOCK	6 <input type="checkbox"/> MUNICIPAL
3 <input type="checkbox"/> IRRIGATION	7 <input type="checkbox"/> PUBLIC SUPPLY
4 <input type="checkbox"/> INDUSTRIAL	8 <input type="checkbox"/> COOLING OR AIR CONDITIONING
<input type="checkbox"/> OTHER	9 <input type="checkbox"/> NOT USED

**METHOD OF CONSTRUCTION**

1 <input type="checkbox"/> CABLE TOOL	6 <input type="checkbox"/> BORING
2 <input type="checkbox"/> ROTARY (CONVENTIONAL)	7 <input type="checkbox"/> DIAMOND
3 <input type="checkbox"/> ROTARY (REVERSE)	8 <input type="checkbox"/> JETTING
4 <input type="checkbox"/> ROTARY (AIR)	9 <input type="checkbox"/> DRIVING
5 <input checked="" type="checkbox"/> AIR PERCUSSION	<input type="checkbox"/> DIGGING <input type="checkbox"/> OTHER

**CONTRACTOR**

NAME OF WELL CONTRACTOR: **Capital Water Supply Ltd.** WELL CONTRACTOR'S LICENCE NUMBER: **1558**

ADDRESS: **Box 490 Stittsville, Ontario K2S 1A6**

NAME OF WELL TECHNICIAN: **S. Miller/T. Harrison** WELL TECHNICIAN'S LICENCE NUMBER: **T0097/T2251**

SIGNATURE OF TECHNICIAN/CONTRACTOR: *[Signature]* SUBMISSION DATE: DAY **18** MO **8** YR **93**

**OFFICE USE ONLY**

DATA SOURCE: **1558** CONTRACTOR: **1558** DATE RECEIVED: **SEP 21 1993**

DATE OF INSPECTION: \_\_\_\_\_ INSPECTOR: \_\_\_\_\_

REMARKS: \_\_\_\_\_



Address of Well Location (Street Number/Name) **TW #5 - Rideau** Township **Gloucester** 26 Province **6** Postal Code \_\_\_\_\_  
 County/District/Municipality **Ottawa Carleton** City/Town/Village **Gloucester** Ontario  
 UTM Coordinates Zone Easting Northing Municipal Plan and Sublot Number Other  
 NAD **83184570435016848**

**Overburden and Bedrock Materials/Abandonment Sealing Record** (see instructions on the back of this form)

General Colour	Most Common Material	Other Materials	General Description	Depth (m/ft)	
				From	To
Brown	Soil	Stones	Fill	0	1.21
Gray	Sandy Soil	Stones	Wet	1.21	3.96
Gray	Sandstone		Very Hard	3.96	29.86

**Annular Space**

Depth Set at (m/ft)	Type of Sealant Used (Material and Type)	Volume Placed (m <sup>3</sup> /ft <sup>3</sup> )
From: 12.80 To: 0	Grouted Cement	.525m <sup>3</sup>

**Results of Well Yield Testing**

After test of well yield, water was:	Draw Down		Recovery	
	Time (min)	Water Level (m/ft)	Time (min)	Water Level (m/ft)
<input checked="" type="checkbox"/> Clear and sand free <input type="checkbox"/> Other, specify _____				
If pumping discontinued, give reason:	Static Level	6.85		
	1	8.03	1	8.97
	Pump intake set at (m/ft)			
	22.85		2	8.69
	Pumping rate (l/min / GPM)			
	54.6		3	8.55
Duration of pumping				
6 hrs + _____ min		4	8.46	
Final water level end of pumping (m/ft)				
9.99		5	8.40	
If flowing give rate (l/min / GPM)				
		10	8.23	
		15		
		20	8.04	
Recommended pump depth (m/ft)				
22.85		25	7.99	
Recommended pump rate (l/min / GPM)				
45.5		30	7.93	
Well production (l/min / GPM)				
		40	7.84	
Disinfected?				
<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No		50	7.77	
		60	7.69	

**Method of Construction**

Cable Tool  Diamond  Public  Commercial  Not used  
 Rotary (Conventional)  Jetting  Domestic  Municipal  Dewatering  
 Rotary (Reverse) Air  Driving  Livestock  Test Hole  Monitoring  
 Boring  Digging  Irrigation  Cooling & Air Conditioning  
 Air percussion  Industrial  
 Other, specify \_\_\_\_\_  Other, specify **Test Well**

**Construction Record - Casing**

Inside Diameter (cm/in)	Open Hole OR Material (Galvanized, Fibreglass, Concrete, Plastic, Steel)	Wall Thickness (cm/in)	Depth (m/ft)		Status of Well
			From	To	
15.86	Steel	.48	+ .45	12.80	<input checked="" type="checkbox"/> Water Supply <input type="checkbox"/> Replacement Well <input type="checkbox"/> Test Hole <input type="checkbox"/> Recharge Well <input type="checkbox"/> Dewatering Well <input type="checkbox"/> Observation and/or Monitoring Hole <input type="checkbox"/> Alteration (Construction) <input type="checkbox"/> Abandoned, Insufficient Supply <input type="checkbox"/> Abandoned, Poor Water Quality <input type="checkbox"/> Abandoned, other, specify _____ <input type="checkbox"/> Other, specify _____

**Construction Record - Screen**

Outside Diameter (cm/in)	Material (Plastic, Galvanized, Steel)	Slot No.	Depth (m/ft)	
			From	To

**Water Details**

Water found at Depth (m/ft)	Kind of Water: <input type="checkbox"/> Fresh <input checked="" type="checkbox"/> Untested	Depth (m/ft)	Diameter (cm/in)
27.12	<input type="checkbox"/> Gas <input type="checkbox"/> Other, specify _____	0	15.86
		12.80	29.86

**Well Contractor and Well Technician Information**

Business Name of Well Contractor: **Capital Water Supply Ltd.** Well Contractor's Licence No.: **1 5 5 8**  
 Business Address (Street Number/Name): **Box 490** Municipality: **Stittsville**  
 Province: **Ontario** Postal Code: **K2S1A6** Business E-mail Address: **office@capitalwater.ca**  
 Bu.s. Telephone No. (inc. area code): **6138361766** Name of Well Technician (Last Name, First Name): **Miller, Stephen**  
 Well Technician's Licence No.: **0097** Signature of Technician and/or Contractor: \_\_\_\_\_ Date Submitted: **20081010**

**Map of Well Location**

Please provide a map below following instructions on the back.

**Ministry Use Only**

Audit No. **Z 84410**  
 Received **DEC 02 2008**

Well owner's information package delivered:  Yes  No  
 Date Package Delivered: **20081007**  
 Date Work Completed: **20080926**

**Master Well Owner's and Land Owner's Information**

First Name: [Redacted] Last Name: Tomlinson  
 Mailing Address (Street Number/Name, RR): 5597 Power Road  
 Municipality: Ottawa Province: ON Postal Code: K1G3N4 Telephone No. (inc. area code): 613 822 1067

**Location and Construction of the Master Well in the Cluster**

Address of Well Location (Street Number/Name, RR): Hawthorne Road at Rideau Road  
 Township: [Redacted] Lot: 26:27 Concession: 6  
 County/District/Municipality: [Redacted] City/Town/Village: Ottawa Province: Ontario Postal Code: [Redacted]

UTM Coordinates: NAD 83 Zone Easting Northing: 18 45640050 16859  
 GPS Unit Make Model: Garmin Etrex  
 Mode of Operation:  Undifferentiated  Averaged  
 Differentiated, specify

**Overburden and Bedrock Materials (see instructions on the back of this form)**

General Colour	Most Common Material	Other Materials	General Description	Depth (Metres)	
				From	To
Gray/Brown	Very fine sand + silt		dense, moist	0	0.8
Brown	Fill - sand/silt/clay/gravels			0.8	4.7
Gray/Brown	Sand with silt		compact oxidized	4.7	6.0
Brown	Till - silty sand, gravel			6.0	7.6

**Hole Details**

Depth (Metres)	Diameter (Centimetres)	
	From	To
0	7.6	20

**Water Use**

Public  Industrial  Not used  Other, specify  
 Domestic  Commercial  Dewatering  
 Livestock  Municipal  Monitoring  
 Irrigation  Test Hole  Cooling & Air Conditioning

**Method of Construction**

Cable Tool  Air Percussion  Digging  
 Rotary (Conventional)  Diamond  Boring  
 Rotary (Reverse)  Jetting  Other, specify  
 Rotary (Air)  Driving HSA

**Status of Well**

Test Hole  Abandoned, Insufficient Supply  
 Replacement Well  Abandoned, Poor Water Quality  
 Dewatering Well  Other, specify  
 Alteration (Construction)  Abandoned, other, specify

**No Casing and Screen Used**  Yes  No

**Static Water Level Test**  
 Open Hole: 1.7 Metres

**Screen**

Galvanized  Steel  Fibreglass  Concrete  Plastic

Outside Diameter (Centimetres): 5.8 Slot No.: 10

**Water Details**

Water found at Depth: [Redacted] Metres  Gas  Fresh  Salty  Sulphur  Minerals

Water found at Depth: [Redacted] Metres  Gas  Fresh  Salty  Sulphur  Minerals

Water found at Depth: [Redacted] Metres  Gas  Fresh  Salty  Sulphur  Minerals

Disinfected  Yes  No If no, provide reason: Monitoring well Date Master Well Completed (yyyy/mm/dd): 2008/07/14

**Cluster Information (Please also fill out the additional Cluster Well Information for Well Construction for each parcel of land and cluster.)**

Total Wells in Cluster: 10 Please indicate Number of Cluster Well Information Log Sheets Submitted: 1

Total Wells on this Property: unknown

**Location of Well Cluster**

Detailed Map must be provided as an attachment no larger than legal size (8.5" x 14"). Sketches are not allowed.  
 Check box to confirm detailed map is provided as per Section 11.1 (3)

**Consent to release additional information concerning the cluster to the Director upon request**

Signature of Technician/Contractor: Bruce Downing Date (yyyy/mm/dd): 2008/10/20  
 Master Well Owner's/Land Owner's consent to use Cluster Form: [Redacted]

**Construction Details**

Inside Diameter (Centimetres)	Material (steel, plastic, fibreglass, concrete, galvanized)	Wall Thickness	Depth (Metres)	
			From	To
5.1	PVC	Sched 40	0	3.0

**Annular Space/Abandonment Sealing Record**

Depth Set at (Metres) From	To	Type of Sealant Used (Material and Type)	Volume Used (Cubic Metres)
0.6	2.4	Bentonite	606 Kgs

**Well Contractor and Well Technician Information**

Business Name of Well Contractor: George Downing Estate Drilling Well Contractor's Licence No.: 1844  
 Business Address (Street No./Name, number, RR): 410 Rue Principale Grenville-sur-la-Rouge Municipality: [Redacted]  
 Province: QC Postal Code: J0V1B0 Business E-mail Address: downing@xplornet.com  
 Name of Well Technician (Last Name, First Name): Downing, Bruce  
 Signature of Technician: Bruce Downing Date Submitted (yyyy/mm/dd): 2008/10/20

**Ministry Use Only**

Audit No.: M 02897 Well Contractor No.: [Redacted]  
 Date Received (yyyy/mm/dd): NOV 26 2008 Date of Inspection (yyyy/mm/dd):  
 Remarks:

**Property Owner's Information**

First Name: Orgaworld Canada Real Estate Last Name: Tomlinson Mailing Address (Street No./Name, RR): 5597 Power Road Municipality: Ottawa  
 Province: Ontario Postal Code: K1G3N4 E-mail Address: rtomlinson@tomlinsongroup.com Telephone No. (inc. area code): 6138221867

**Cluster Well Information**

Address of Well Location (Street Number/Name, RR): Hawthorne Road at Rideau Road Lot: 26127 Concession: 6 Township: \_\_\_\_\_ County/District/Municipality: \_\_\_\_\_  
 City/Town/Village: Ottawa Province: Ontario Postal Code: K1G3N4 GPS Unit Make: \_\_\_\_\_ Model: \_\_\_\_\_ Unit Mode of Operation:  Undifferentiated  Averaged  Differentiated, specify: \_\_\_\_\_

Signature of Technician/Contractor: Bruce Downing Date (yyyy/mm/dd): 2008/10/20

Well # on Sketch	UTM Coordinates		Full Depth of Hole (metres)	Hole Diameter (cm)	Method of Construction	Casing Material	Casing Length (metres)	Screen Interval (metres)		Annular Space Sealant Used	Static Water Level (metres)	Abandonment Sealant Used	Comments	Date of Completion (yyyy/mm/dd)
	Zone	Easting						Northing	From					
MW 1-08	18	45683150	16712	2.97	20	HSA	PVC	1.5	1.5	2.97	Bentonite	1.3		2008/07/07
MW 2-08	18	45679950	16553	2.77	10	DIA		0.6	0.6	2.77			Overburden from 0 to 0.18	2008/07/08
MW 3-08	18	45653350	16411	17.37	10	DIA		2.13	2.13	17.37			" " 0 to 0.30	2008/07/09
MW 4-08	18	45647450	16604	2.84	10/20	HSA/DIA		1.22	1.22	2.8				2008/07/08
MW 5-08	18	45659850	16675	2.77	20	HSA		1.5	1.5	2.77				2008/07/07
MW 7-08	18	45662250	17219	6.98	20	HSA		3.0	3.0	6.10				2008/07/14
MW 8-08	18	45668750	17036	4.72	20	HSA		3.0	3.0	4.2				2008/07/15
MW 9-08	18	45708650	17625	3.66	20	HSA		1.5	1.5	3.0				2008/07/15
MW 10-08	18	45720650	17303	2.90	20	HSA		1.37	1.37	2.90				2008/07/15


**Well Contractor and Well Technician Information**

Business Name of Well Contractor: George Downing Estate Drilling Ltd. Business Address (Street Number/Name, RR): 410 Rue Principale Municipality: Grenville-sur-la-Rouge Province: QC  
 Postal Code: J0V1B0 Business Telephone No. (inc. area code): 8192426469 Well Contractor's Licence No.: 1844 Business E-mail Address: downing@xplornet.com  
 Name of Well Technician (First Name, Last Name): Bruce Downing Well Technician's Licence No.: 2173 Date Submitted (yyyy/mm/dd): 2008/10/20 Signature of Technician: Bruce Downing

Date 1st Well in Cluster Constructed (yyyy/mm/dd): 2008/07/07 Date Last Well in Cluster Constructed (yyyy/mm/dd): 2008/07/15

**Ministry Use Only**

Date Received (yyyy/mm/dd): NOV 26 2008 Date Inspected (yyyy/mm/dd): \_\_\_\_\_  
 Audit No.: C 01984 Remarks: m02897

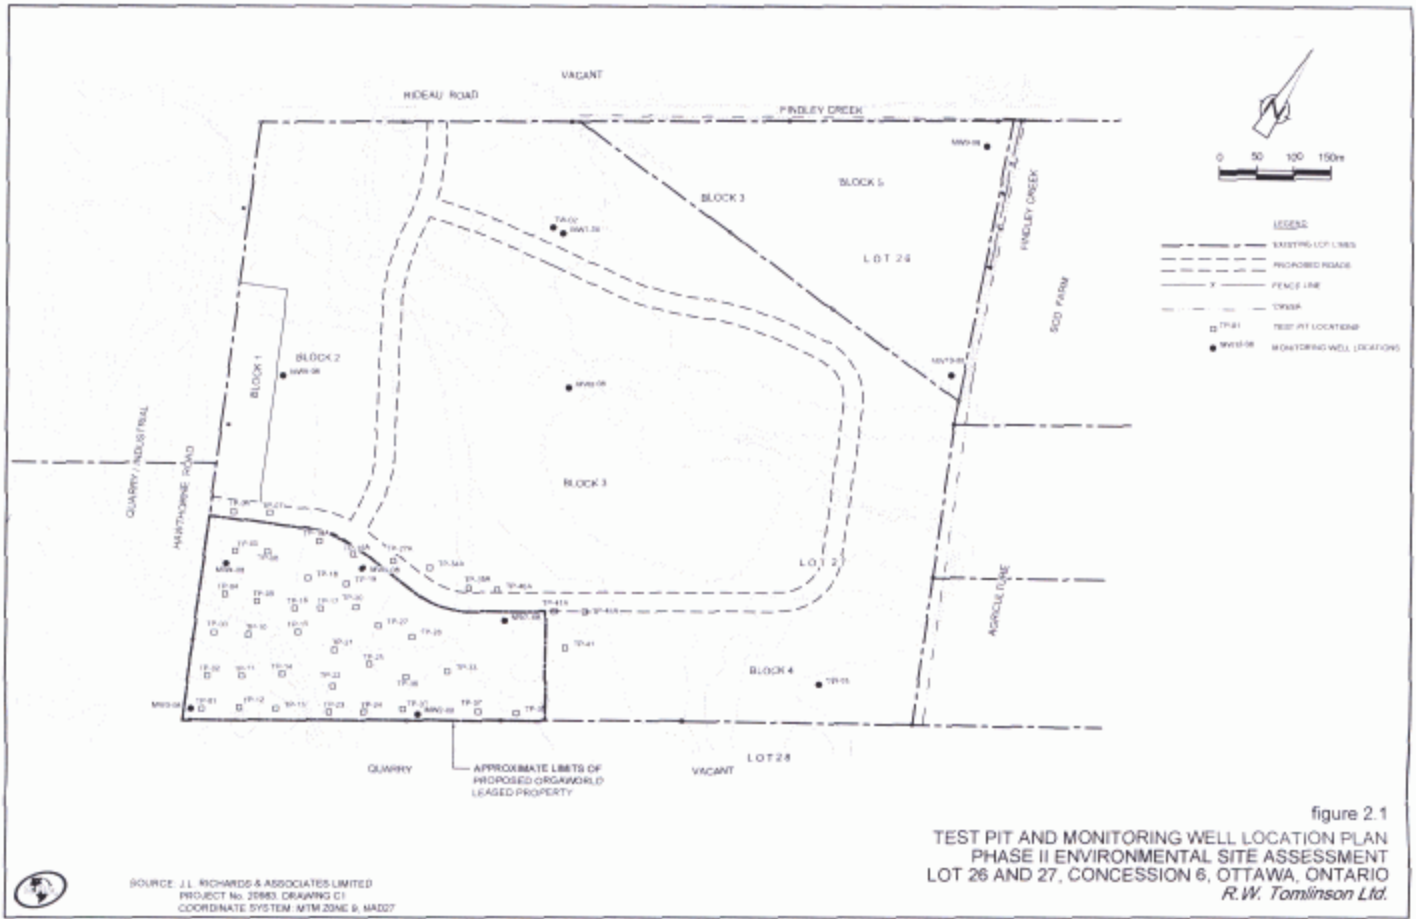

C-1844 m02897 c01984

NOV 26 2008

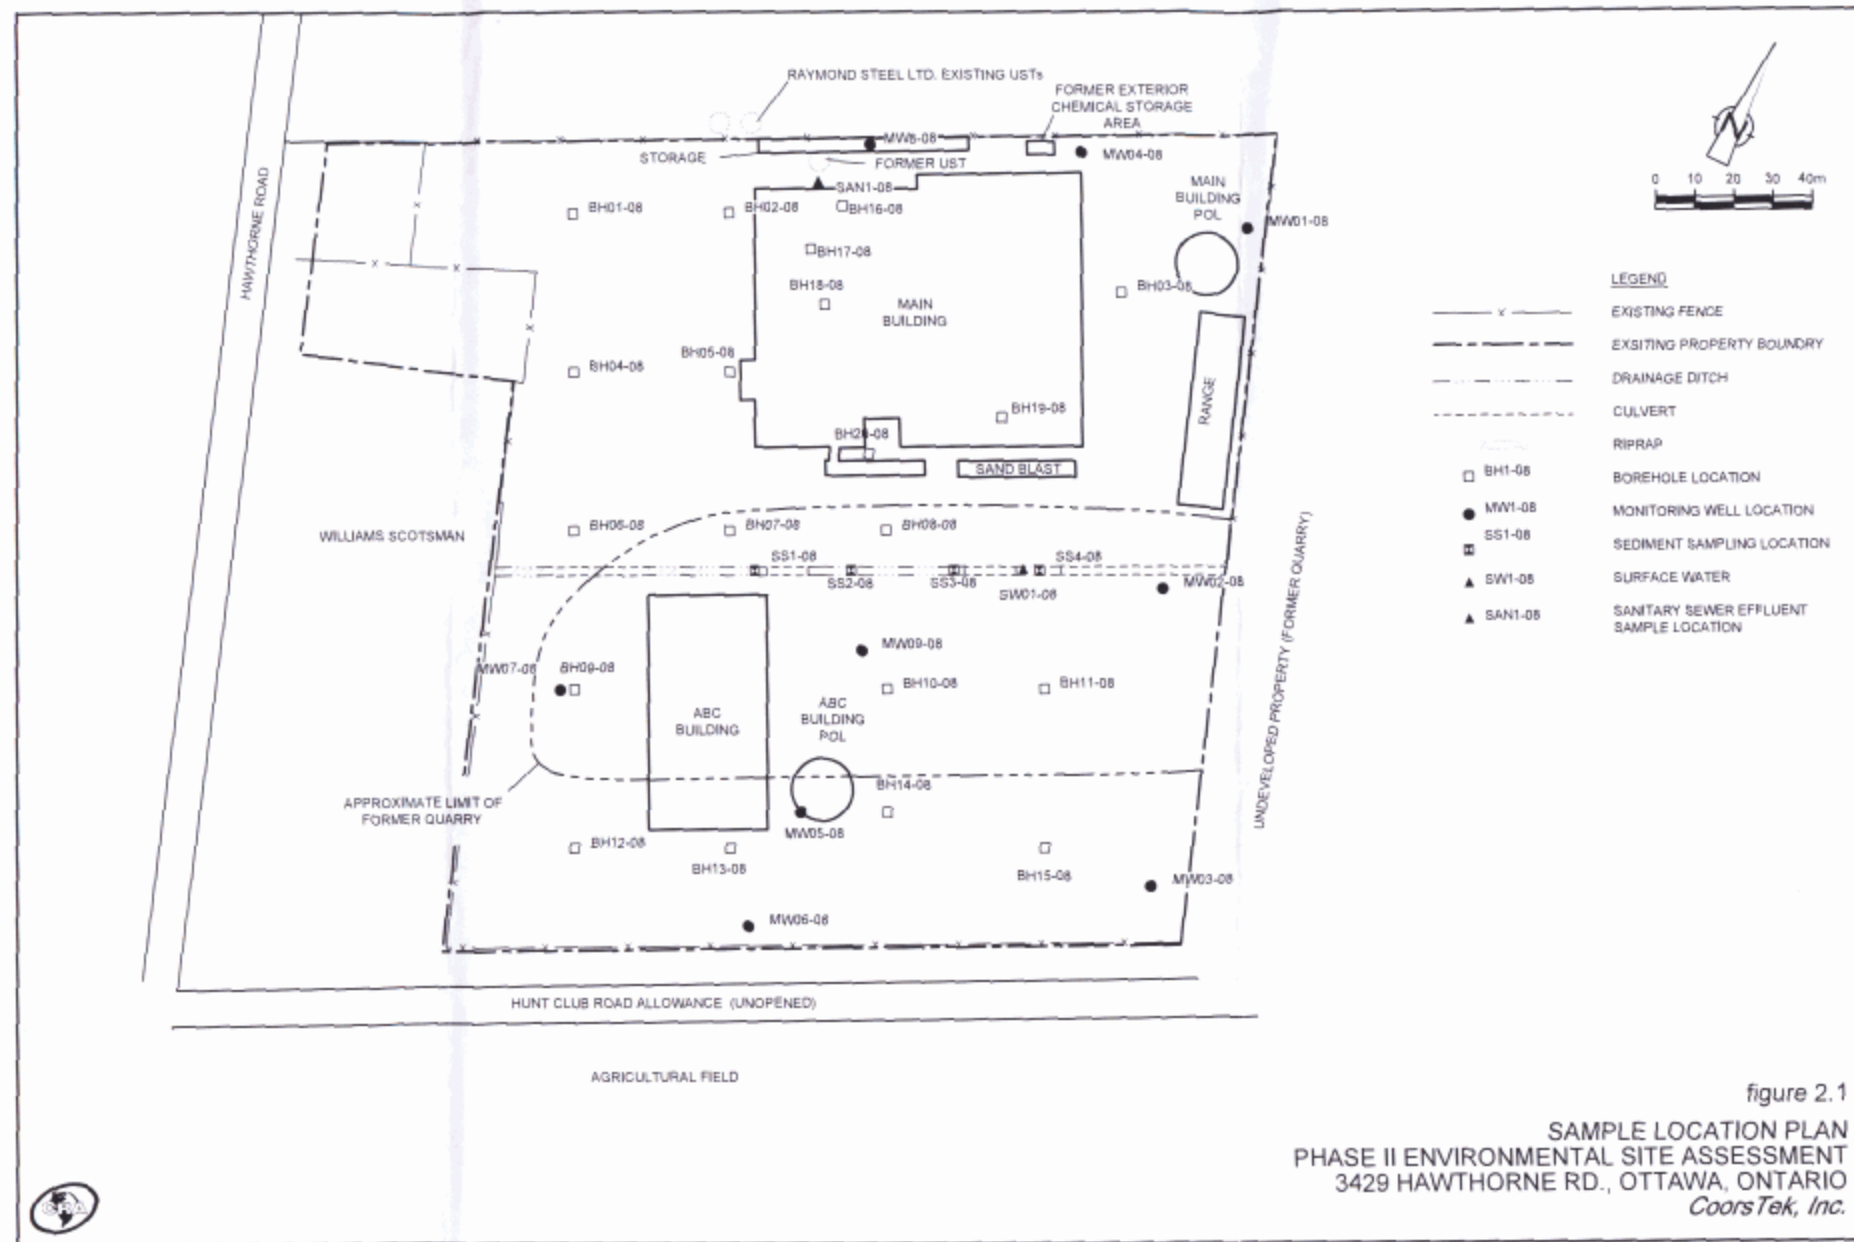


figure 2.1  
 SAMPLE LOCATION PLAN  
 PHASE II ENVIRONMENTAL SITE ASSESSMENT  
 3429 HAWTHORNE RD., OTTAWA, ONTARIO  
 CoorsTek, Inc.



053403-04(007)GN-OT001 AUG 20/2008

NOV 26 2008

C-1844 m02888 c03068

Measurements recorded in:  Metric  Imperial

A082844

**A 082844**

ion 903 Ontario Water Resources Act

Page \_\_\_\_\_ of \_\_\_\_\_

**Well Owner's Information**

First Name	Last Name / Organization <b>Orgaworld</b>	E-mail Address	<input type="checkbox"/> Well Constructed by Well Owner
Mailing Address (Street Number/Name) <b>c/o 400-179 Colonnade Road</b>		Municipality <b>Ottawa</b>	Province <b>Ontario</b>
		Postal Code <b>K2E 7J4</b>	Telephone No. (inc. area code) <b>613 727 0510</b>

**Well Location**

Address of Well Location (Street Number/Name) <b>TW #7 Hawthorne Road</b>		Township <b>Gloucester</b>	Lot <b>27</b>	Concession <b>6</b>
County/District/Municipality <b>Ottawa Carleton</b>		City/Town/Village <b>Gloucester</b>	Province <b>Ontario</b>	Postal Code
UTM Coordinates	Zone <b>18</b>	Easting <b>456879</b>	Northing <b>5016752</b>	Municipal Plan and Sublot Number
				Other

**Overburden and Bedrock Materials/Abandonment Sealing Record (see instructions on the back of this form)**

General Colour	Most Common Material	Other Materials	General Description	Depth (m/ft)	
				From	To
Brown	Soil Stones		Packed	0	4.26
Grey & White	Sandstone		Very Hard	4.26	29.86

Annular Space		
Depth Set at (m/ft)	Type of Sealant Used (Material and Type)	Volume Placed (m³/ft³)
From: 6.40 To: 0	Grouted Cement	.21m³

Method of Construction	Well Use
<input type="checkbox"/> Cable Tool <input type="checkbox"/> Rotary (Conventional) <input checked="" type="checkbox"/> Rotary (Reverse) <input type="checkbox"/> Boring <input checked="" type="checkbox"/> Air percussion <input type="checkbox"/> Other, specify _____	<input type="checkbox"/> Public <input type="checkbox"/> Commercial <input type="checkbox"/> Not used <input type="checkbox"/> Domestic <input type="checkbox"/> Municipal <input type="checkbox"/> Dewatering <input type="checkbox"/> Livestock <input type="checkbox"/> Test Hole <input checked="" type="checkbox"/> Monitoring <input type="checkbox"/> Irrigation <input type="checkbox"/> Cooling & Air Conditioning <input type="checkbox"/> Industrial <input type="checkbox"/> Other, specify _____

Construction Record - Casing				Status of Well	
Inside Diameter (cm/in)	Open Hole OR Material (Galvanized, Fibreglass, Concrete, Plastic, Steel)	Wall Thickness (cm/in)	Depth (m/ft)		<input checked="" type="checkbox"/> Water Supply <input type="checkbox"/> Replacement Well <input type="checkbox"/> Test Hole <input type="checkbox"/> Recharge Well <input type="checkbox"/> Dewatering Well <input checked="" type="checkbox"/> Observation and/or Monitoring Hole <input type="checkbox"/> Alteration (Construction) <input type="checkbox"/> Abandoned, Insufficient Supply <input type="checkbox"/> Abandoned, Poor Water Quality <input type="checkbox"/> Abandoned, other, specify _____ <input type="checkbox"/> Other, specify _____
			From	To	
15.86	Steel	.48	+4.5	6.40	


Construction Record - Screen				Status of Well	
Outside Diameter (cm/in)	Material (Plastic, Galvanized, Steel)	Slot No.	Depth (m/ft)		
			From	To	

Water Details		Hole Diameter	
Water found at Depth <b>9.14-12.19</b>	Kind of Water: <input type="checkbox"/> Fresh <input checked="" type="checkbox"/> Untested	Depth (m/ft)	Diameter (cm/in)
<b>18.28-21.33</b>	Kind of Water: <input type="checkbox"/> Fresh <input checked="" type="checkbox"/> Untested	From: 0 To: 6.40	15.86
<b>6.40</b>	Kind of Water: <input type="checkbox"/> Fresh <input type="checkbox"/> Untested	From: 6.40 To: 29.86	15.23

Well Contractor and Well Technician Information			
Business Name of Well Contractor <b>Capital Water Supply Ltd.</b>		Well Contractor's Licence No. <b>1 5 5 8</b>	
Business Address (Street Number/Name) <b>Box 490</b>		Municipality <b>Stittsville</b>	
Province <b>Ontario</b>	Postal Code <b>K2S 1A6</b>	Business E-mail Address <b>office@capitalwater.ca</b>	

Well Technician Information			
Bus. Telephone No. (inc. area code) <b>613 836 1766</b>		Name of Well Technician (Last Name, First Name) <b>Miller, Stephen</b>	
Well Technician's Licence No. <b>0 0 9 7</b>	Signature of Technician and/or Contractor 	Date Submitted <b>2 0 1 0 0 5 2 8</b>	

Results of Well Yield Testing				
After test of well yield, water was: <input checked="" type="checkbox"/> Clear and sand free <input type="checkbox"/> Other, specify _____	Draw Down		Recovery	
	Time (min)	Water Level (m/ft)	Time (min)	Water Level (m/ft)
If pumping discontinued, give reason:  Pump intake set at (m/ft) <b>24.38</b> Pumping rate (l/min / GPM) <b>27.3</b> Duration of pumping <b>6</b> hrs + _____ min Final water level end of pumping (m/ft) <b>7.01</b> If flowing give rate (l/min / GPM)	Static Level	<b>4.41</b>		
	1	5.20	1	6.07
	2	5.57	2	5.68
	3	5.78	3	5.46
	4	5.94	4	5.33
	5	6.05	5	5.25
Recommended pump depth (m/ft) <b>24.38</b>	10	6.37	10	5.01
Recommended pump rate (l/min / GPM) <b>27.3</b>	15	6.52	15	4.89
Well production (l/min / GPM)	20	6.60	20	4.81
Disinfected? <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	25	6.68	25	4.76
	30	6.72	30	4.72
	40	6.81	40	4.65
	50	6.86	50	4.61
	60	6.89	60	4.58

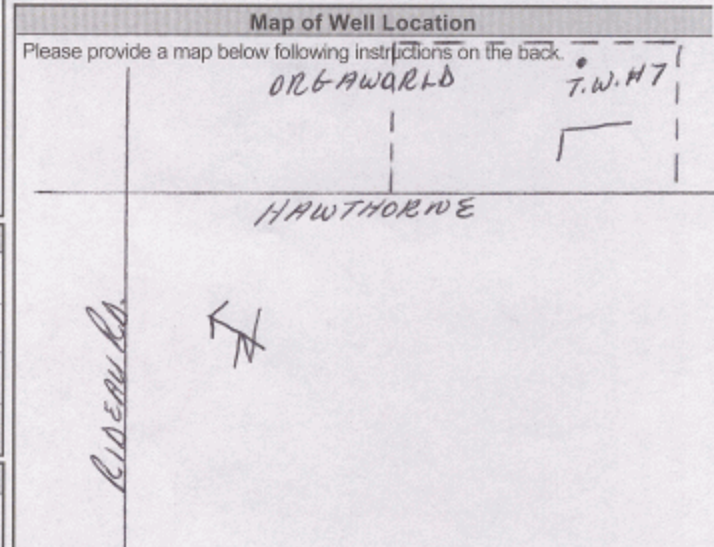

Ministry Use Only	
Audit No. <b>Z 101832</b>	Received <b>AUG 04 2010</b>
Well owner's information package delivered <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No	Date Package Delivered <b>2 0 1 0 0 5 2 7</b> Date Work Completed <b>2 0 1 0 0 5 2 5</b>

Measurements recorded in:  Metric  Imperial

Page \_\_\_\_\_ of \_\_\_\_\_

**Well Owner's Information**

First Name: \_\_\_\_\_ Last Name/Organization: **TECHO-BLOC INC.** E-mail Address: \_\_\_\_\_  Well Constructed by Well Owner

Mailing Address (Street Number/Name): **#5255 Albert Millichamp** Municipality: **Saint-Hubert** Province: **Quebec** Postal Code: **J3H 8Z8** Telephone No. (inc. area code): \_\_\_\_\_

**Well Location**

Address of Well Location (Street Number/Name): **5123 Hawthorne Road** Township: **Gloucester** Lot: **27** Concession: **6**

County/District/Municipality: **Ottawa Carleton** City/Town/Village: **Ottawa** Province: **Ontario** Postal Code: \_\_\_\_\_

UTM Coordinates Zone: **18** Easting: **457054** Northing: **5016813** Municipal Plan and Sublot Number: **4m-1388 Part 23-4/48-32280 Block 2**

**Overburden and Bedrock Materials/Abandonment Sealing Record** (see instructions on the back of this form)

General Colour	Most Common Material	Other Materials	General Description	Depth (m(ft)) From	To
	Sandy Clay & Gravel			0'	15'
Grey	Limestone			15'	80'
Grey & White	Sandstone			80'	83'
Grey & White	Sandstone			83'	116'
Grey & White	Sandstone			116'	122'

**Annular Space**

Depth Set at (m(ft)) From	To	Type of Sealant Used (Material and Type)	Volume Placed (m <sup>3</sup> (ft <sup>3</sup> ))
41'	31'	Neat cement	18.7
31'	0'	Bentonite slurry	10.8

**Method of Construction**

Cable Tool  Diamond  Public  Commercial  Not used  
 Rotary (Conventional)  Jetting  Domestic  Municipal  Dewatering  
 Rotary (Reverse)  Driving  Livestock  Test Hole  Monitoring  
 Boring  Digging  Irrigation  Cooling & Air Conditioning  
 Air percussion  Industrial  Other, specify \_\_\_\_\_  
 Other, specify \_\_\_\_\_

**Construction Record - Casing**

Inside Diameter (cm(in))	Open Hole OR Material (Galvanized, Fibreglass, Concrete, Plastic, Steel)	Wall Thickness (cm(in))	Depth (m(ft))		Status of Well
			From	To	
6 1/4"	Steel	.188"	+2'	41'	<input checked="" type="checkbox"/> Water Supply <input type="checkbox"/> Replacement Well <input type="checkbox"/> Test Hole <input type="checkbox"/> Recharge Well <input type="checkbox"/> Dewatering Well <input type="checkbox"/> Observation and/or Monitoring Hole <input type="checkbox"/> Alteration (Construction) <input type="checkbox"/> Abandoned, Insufficient Supply <input type="checkbox"/> Abandoned, Poor Water Quality <input type="checkbox"/> Abandoned, other, specify _____ <input type="checkbox"/> Other, specify _____
6"	Open Hole		41'	122'	

**Construction Record - Screen**

Outside Diameter (cm/in)	Material (Plastic, Galvanized, Steel)	Slot No.	Depth (m(ft))	
			From	To

**Water Details**

Water found at Depth (m(ft))	Kind of Water: <input type="checkbox"/> Fresh <input checked="" type="checkbox"/> Untested	Depth (m(ft)) From	To	Diameter (cm(in))
83 (m(ft)) <input type="checkbox"/> Gas <input checked="" type="checkbox"/> Other, specify _____				
116 (m(ft)) <input type="checkbox"/> Gas <input checked="" type="checkbox"/> Other, specify _____		0'	41'	1 3/4"
		41'	122'	6"

**Well Contractor and Well Technician Information**

Business Name of Well Contractor: **Air Rock Drilling Co. Ltd.** Well Contractor's Licence No.: **7881**

Business Address (Street Number/Name): **6659 Franktown Road** Municipality: **Richmond**

Province: **ON** Postal Code: **K0A 2Z0** Business E-mail Address: **air-rock@sympatico.ca**

Bus. Telephone No. (inc. area code): **6138382170** Name of Well Technician (Last Name, First Name): **Hogan, Dan**

Well Technician's Licence No.: **T3058** Signature of Technician and/or Contractor: \_\_\_\_\_ Date Submitted: **2020 08 31**

**Results of Well Yield Testing**

After test of well yield, water was:  
 Clear and sand free  
 Other, specify **Not tested**

If pumping discontinued, give reason: \_\_\_\_\_

Pump intake set at (m(ft)) **100**

Pumping rate (l/min (GPM)) **20**

Duration of pumping: \_\_\_\_\_ hrs + \_\_\_\_\_ min

Final water level end of pumping (m(ft)) **33.5**

If flowing give rate (l/min/GPM) \_\_\_\_\_


Recommended pump depth (m(ft)) **100'**

Recommended pump rate (l/min/GPM) **20**

Well production (l/min/GPM) **20**

Disinfected?  Yes  No

Time (min)	Draw Down		Recovery	
	Water Level (m(ft))	Time (min)	Water Level (m(ft))	Time (min)
1	26.5	1	26.5	
2	29.8	2	26.5	
3	30.5	3	26.5	
4	30.8	4	26.5	
5	31.1	5	26.5	
10	31.3	10	26.5	
15	31.9	15	26.5	
20	32.3	20	26.5	
25	32.6	25	26.5	
30	32.8	30	26.5	
40	33.1	40	26.5	
50	33.3	50	26.5	
60	33.5	60	26.5	

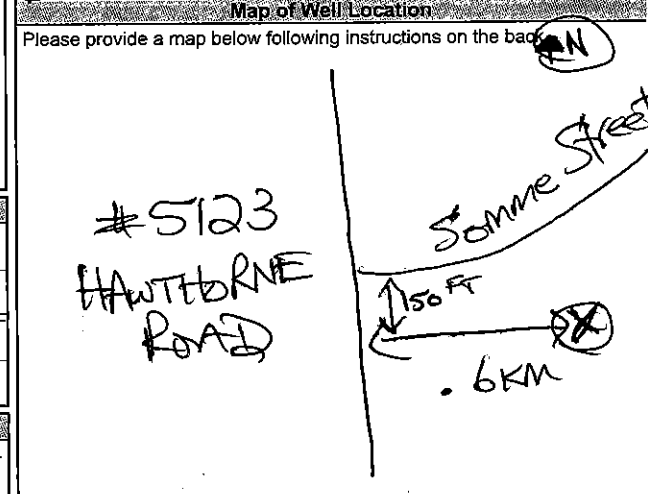

Comments: **3/4 HP - 15 GPM Set @ 100 FT**

Well owner's information package delivered	Date Package Delivered	Ministry Use Only
<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	2020 08 20	Audit No. <b>2344019</b>
	Date Work Completed	<b>OCT 30 2020</b>
		Received

Measurements recorded in:  Metric  Imperial

A295342

Page \_\_\_ of \_\_\_

Well Owner's Information

First Name, Last Name/Organization (Paul Lalonde Holdings Inc), E-mail Address, Mailing Address (5146 Bank Street), Municipality (Ottawa), Province (ON), Postal Code (K1X 1G8), Telephone No.

Well Location

Address of Well Location (5123 Hawthorne Road), Township (Gloucester), Lot (27), Concession (6), County/District/Municipality (Ottawa Carleton), City/Town/Village (Ottawa), Province (Ontario), UTM Coordinates, Municipal Plan and Sublot Number (4M-1388), Other (Parts 2,3,4)

Overburden and Bedrock Materials/Abandonment Sealing Record

Table with columns: General Colour, Most Common Material, Other Materials, General Description, Depth From, Depth To. Includes entries for Sandy Till & Boulders, Limestone, Sandstone.

Annular Space table with columns: Depth Set at (From/To), Type of Sealant Used, Volume Placed. Includes entries for Neat cement and Bentonite slurry.

Method of Construction and Well Use section with checkboxes for Cable Tool, Rotary, Boring, Air percussion, Diamond, Jetting, Driving, Digging, Public, Commercial, Domestic, Municipal, Test Hole, Livestock, Irrigation, Industrial, Cooling & Air Conditioning, Not used, Dewatering, Monitoring, Other.


Construction Record - Casing table with columns: Inside Diameter, Open Hole OR Material, Wall Thickness, Depth (From/To), Status of Well. Includes entries for Steel and Open Hole casings.

Construction Record - Screen table with columns: Outside Diameter, Material, Slot No., Depth (From/To). Includes handwritten annotations.

Water Details and Hole Diameter section with tables for water found at depth and hole diameter measurements.

Well Contractor and Well Technician Information section including Business Name (Air Rock Drilling Co. Ltd.), Licence No. (7881), Business Address (6659 Franktown Road), Province (ON), Postal Code (K0A 2Z0), Business E-mail Address (air-rock@sympatico.ca), Bus. Telephone No. (613-838-2170), Name of Well Technician (Hogan, Dan), Well Technician's Licence No. (T3058), Date Submitted (2020 08 31).

Results of Well Yield Testing table with columns: Time (min), Water Level (m/ft), Recovery Time (min), Water Level (m/ft). Includes pumping rate (20 GPM), static level (27'5"), and recommended pump depth (100').

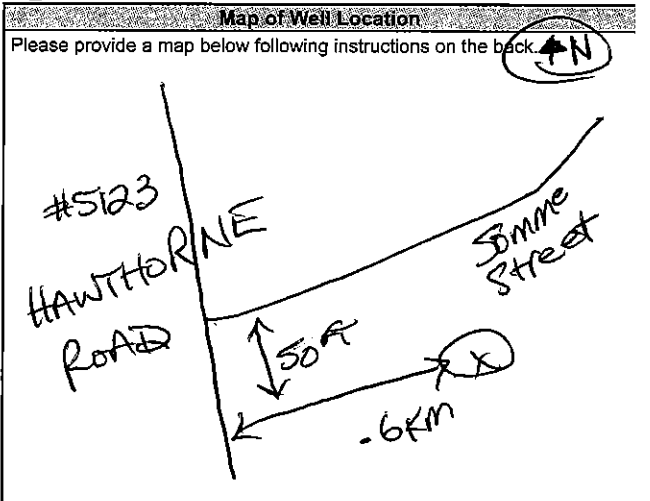

Comments (1 HP - 20 GPM SET @ 100 FT), Well owner's information package delivered (Yes), Date Package Delivered (2020 08 28), Date Work Completed (2020 08 26), Ministry Use Only (Audit No. 2344069, Received OCT 30 2020).



All measurements recorded in:  Metric  Imperial

Follow instructions on the front and back of this form. Print or Type

Well Tag No. of Deepest Well: (Print Well Tag No.)

A 290 221

Well No. on Drawing of Deepest Well: 109-21

Dewatering wells

Test holes

No. of wells reported 3

Page 1 of 1

Well Cluster Location Information						Mandatory Attachments/Additional Information	
Address of Well Location (Street Number(s)/Name(s), RR, if available)		Lot(s)	Concession(s)	Geographic Township	County/District/Upper Tier Municipality		<input checked="" type="checkbox"/> Land Owner Consent Form must be attached. <input checked="" type="checkbox"/> Detailed Drawing of All Well Locations must be attached. I, the person constructing the well, will promptly submit to the Director, on request, any additional information in my custody or control related to any well in the well cluster that I have constructed.
300 SOMME STREET, BESIDE 5123 HAWTHORNE ROAD							
City, Town, Village or Hamlet		Province	GPS Unit Make	Model	Unit Mode of Operation <input type="checkbox"/> Undifferentiated <input checked="" type="checkbox"/> Averaged		Signature of Technician/Contractor <u>[Signature]</u> Date (yyyy/mm/dd) 2021/10/22
OTTAWA		Ontario	GARMIN	ETREX	<input type="checkbox"/> Differentiated, specify: _____		

Well # on Drawing	UTM Coordinates		Hole Depth (m/ft)	Hole Diameter (cm/in)	Method of Construction	Casing Material; Diameter (cm/in)	Casing (m/ft)		Screen Interval (m/ft)		Annular Space Material (m/ft)			Overburden/Bedrock or Abandonment Filing Material Intervals (m/ft)	Static Water Level (m/ft)	Date of Completion (yyyy/mm/dd)	
	Zone	Easting					Northing	From	To	From	To	From	To				Material:
109	18	456697	50117052	6.1	20.3	HSA	5.08	0.1	3.05	3.05	6.1	0.25	2.44	BENTONITE	0-4.57 Silt Fill w. Sand/Clay/Gravel/Debris, Till	1.465	2021/10/05
110	18	456775	50117046	4.42	20.3	HSA	5.08	0.1	2.9	2.9	4.42	0.25	2.6	BENTONITE	" " " "	1.681	2021/10/05
111	18	456825	50117039	3.66	20.3	HSA	5.08	0.1	2.13	2.13	3.66	0.25	1.83	BENTONITE	" " " "	1.041	2021/10/05

Well Contractor and Well Technician Information				Date First Well in Cluster Constructed or Abandoned (yyyy/mm/dd)		Date Last Well in Cluster Completed (yyyy/mm/dd)		Ministry Use Only			
Business Name of Well Contractor		Business Address (Street Number/Name, RR)		Municipality		Province		Date Received (yyyy/mm/dd)		Audit No.	
GEORGE DOWNING ESTATE DRILLING LTD		410 AVE PRINCIPALE		GREAVILLE-SUR-LA-ROUGE		QC		2021/10/05		2021/10/05	
Postal Code		Bus. Telephone No.		Well Contractor's Licence No.		Business E-mail Address		Well Abandonment		Comments:	
J1W1V11B1Q		(819) 242-6469		1844		info@georgedowningdrilling.com		Person Abandoning the Wells:			
Name of Well Technician (First Name, Last Name)		Well Technician's Licence No.		Signature of Well Technician		Date Submitted (yyyy/mm/dd)		Name			
STEPHEN DOWNING		3326		[Signature]		2021/10/22		N/A			
(Print or Type) - See instruction 11 on the back of this form											



**OFFICIAL CERTIFICATE OF ANALYSIS : 4259100**

**WORK REQUEST : 100341628**

**Report Date : 2025-03-11**

**Paterson Group**

9 Auriga Dr  
Nepean, Ontario  
K2E 7T9  
Attention : Alex Schopf

Reception Date : 2025-03-05

Project : PH4991

Sampler : NA

PO Number : 62526

Temperature : 9 °C

Analysis	Quantity	External Method
Alkalinity (Water, Automated)	2	Modified from SM 2320 B
Ammonia, Total (Water, Colorimetry)	2	Modified from EPA 350.1
Base Neutrals (Water, GC/MS)	1	Modified from EPA 8270
Chloride (Water, IC)	2	Modified from SM 4110 B and C
Colour, Apparent (Water, Spectrophotometry)	3	Modified from SM 2120 C
Conductivity (Water, Automated)	2	Modified from SM 2510 B
DOC (Water, IR)	2	Modified from SM 5310 B
Escherichia coli (DC Plate)	2	Modified from MECP E3407
Fluoride (Water, Auto/ISE)	2	Modified from SM 4500-F A and 4500-F C
Hardness (Water, Calculation Only)	2	SM 2340 B
Ion Balance (Water, Calculation)	2	Modified from SM1030 E
Metals Scan (Water, ICP/MS)	3	Modified from EPA 200.8
Metals Scan (Water, ICP/OES)	3	Modified from SM 3120 B
Nitrate (Water, IC)	2	Modified from SM 4110 B and C
Nitrite (Water, IC)	2	Modified from SM 4110 B and C
PAH (Water, GC/MS)	1	Modified from EPA 8270
pH (25°C) (Water, Automated)	2	Modified from SM 4500-H+ B
Phenolics (Water, GC/MS)	1	Modified from EPA 8270
Phenols (Water, Colorimetry)	2	Modified from EPA 420.2
Sulphate (Water, IC)	2	Modified from SM 4110 B and C
Sulphide (Water, Colorimetry)	2	Modified from SM 4500-S2 D
Tannin and Lignin (Water, Spec)	2	Modified from SM 5550 B
TDS (Estimated)	2	Modified from SM 2510 A
Total Coliforms (DC Plate)	2	Modified from MECP E3407
Total Kjeldahl Nitrogen (Water, Colorimetry)	2	Modified from EPA 351.2
Turbidity (Water, Turbidimeter)	3	Modified from SM 2130 B
VOCs (Water, GC/MS)	1	Modified from EPA 8260

**Criteria :**

**A :** Ontario Regulation 169/03 (Non-Regulated Drinking Water)

**Sample status upon receipt :**

8408304 8408306 8408308

**Compliant**

**Certificate Comments :**

8408304 8408306

**N-NO2 and N-NO3 MRL increased due to matrix interference.**

**Notes :**

- All analysis is completed at Eurofins Environment Testing Canada Inc. (Ottawa, Ontario) unless otherwise stated.
- Eurofins Environment Testing Canada Inc. is accredited by CALA, Canadian Association for Laboratory Accreditation to ISO/IEC 17025 for tests which appear on the scope of accreditation. The scope is available at <https://directory.cala.ca/>
- Please note: Field data, where presented on the report, has been provided by the client and is presented for informational purposes only. Guideline or regulatory limits listed on this report are provided for ease of use (informational purposes) only. Eurofins recommends consulting the official guideline or regulation as required. Unless otherwise stated, measurement uncertainty is not taken into account when determining guideline or regulatory exceedances.

**Legend :**

RL : Reporting limit

N/A : Not applicable

\* : Analysis conducted by external subcontracting

QC : Reference material (QC)

1 : Results in annex

^ : Analysis not accredited

## OFFICIAL CERTIFICATE OF ANALYSIS - EXCEEDENCE SUMMARY

Client : Paterson Group

Project : PH4991

Reception Date : 2025-03-05

Eurofins Sample No	Client Sample Identification	Analyte	Result	Units	Exceeded Criteria		
					A	B	C
<b>Alkalinity (Water, Automated)</b>							
8408304	TW1 - GW1	Alkalinity (as CaCO <sub>3</sub> )	578	mg/L	500		
8408306	TW1 - GW2	Alkalinity (as CaCO <sub>3</sub> )	570	mg/L	500		
<b>Colour, Apparent (Water, Spectrophotometry)</b>							
8408304	TW1 - GW1	Colour (Apparent)	97	TCU	5		
8408306	TW1 - GW2	Colour (Apparent)	86	TCU	5		
8408308	TW1 - GW3	Colour (Apparent)	116	TCU	5		
<b>DOC (Water, IR)</b>							
8408304	TW1 - GW1	Dissolved Organic Carbon	7.7	mg/L	5		
8408306	TW1 - GW2	Dissolved Organic Carbon	7.2	mg/L	5		
<b>Hardness (Water, Calculation Only)</b>							
8408304	TW1 - GW1	Hardness as CaCO <sub>3</sub> (Calculation)	708	mg/L	80-100		
8408306	TW1 - GW2	Hardness as CaCO <sub>3</sub> (Calculation)	704	mg/L	80-100		
<b>Metals Scan (Water, ICP/MS)</b>							
8408304	TW1 - GW1	Iron	2.22	mg/L	0.3		
8408306	TW1 - GW2	Iron	2.19	mg/L	0.3		
8408308	TW1 - GW3	Iron	2.29	mg/L	0.3		
8408304	TW1 - GW1	Manganese	2.89	mg/L	0.05		
8408306	TW1 - GW2	Manganese	2.87	mg/L	0.05		
8408308	TW1 - GW3	Manganese	2.89	mg/L	0.05		
<b>TDS (Estimated)</b>							
8408304	TW1 - GW1	TDS (Estimated)^	995	mg/L	500		
8408306	TW1 - GW2	TDS (Estimated)^	993	mg/L	500		
<b>Total Coliforms (DC Plate)</b>							
8408304	TW1 - GW1	Total Coliforms (DC)	4	CFU/100mL	0		
8408306	TW1 - GW2	Total Coliforms (DC)	3	CFU/100mL	0		
<b>Turbidity (Water, Turbidimeter)</b>							
8408304	TW1 - GW1	Turbidity	16.4	NTU	5		
8408306	TW1 - GW2	Turbidity	17.0	NTU	5		
8408308	TW1 - GW3	Turbidity	18.3	NTU	5		

## OFFICIAL CERTIFICATE OF ANALYSIS - RESULTS

Client : Paterson Group  
Project : PH4991

Reception Date: 2025-03-05

						Eurofins Sample No :		8408304	8408306			
						Matrix :		Groundwater	Groundwater			
Anions						Sampling Date :		2025-03-04	2025-03-04			
						Client Sample Identification :		TW1 - GW1	TW1 - GW2			
		RL	Unit	Criteria								
				A	B	C						
Chloride	0.5	mg/L	250				116	115				
Nitrate (as Nitrogen)	0.1	mg/L	10.0				<0.5	<0.5				
Nitrite (as Nitrogen)	0.1	mg/L	1.0				<0.5	<0.5				
Sulphate	1	mg/L	500				185	186				

						Eurofins Sample No :		8408304	8408306			
						Matrix :		Groundwater	Groundwater			
Calculations						Sampling Date :		2025-03-04	2025-03-04			
						Client Sample Identification :		TW1 - GW1	TW1 - GW2			
		RL	Unit									
Ion Balance (Calculation)^	0.1		1.01	1.02								

						Eurofins Sample No :			8408304	8408306	8408308		
						Matrix :			Groundwater	Groundwater	Groundwater		
General Chemistry						Sampling Date :			2025-03-04	2025-03-04	2025-03-04		
						Client Sample Identification :			TW1 - GW1	TW1 - GW2	TW1 - GW3		
		RL	Unit	Criteria									
				A	B	C							
Alkalinity (as CaCO3)	5	mg/L	500				578	570					
Colour (Apparent)	2	TCU	5				97	86	116				
Conductivity @ 25°C	5	µS/cm					1530	1530					
Dissolved Organic Carbon	0.5	mg/L	5				7.7	7.2					
Fluoride	0.1	mg/L	1.5				0.16	0.18					
Hardness as CaCO3 (Calculation)	1	mg/L	80-100				708	704					
pH @ 25°C	1		6.5-8.5				7.91	7.72					
Phenols-4AAP	0.001	mg/L					<0.001	<0.001					
Sulphide (S2-)	0.01	mg/L	0.05				<0.01	<0.01					
Tannin and Lignin	0.1	mg/L					0.7	0.7					
TDS (Estimated)^	5	mg/L	500				995	993					
Turbidity	0.1	NTU	5				16.4	17.0	18.3				

## OFFICIAL CERTIFICATE OF ANALYSIS - RESULTS

Client : Paterson Group  
Project : PH4991

Reception Date: 2025-03-05

Metals						Eurofins Sample No :		
						8408304	8408306	8408308
RL						Matrix :		
						Groundwater	Groundwater	Groundwater
Unit						Sampling Date :		
						2025-03-04	2025-03-04	2025-03-04
Criteria						Client Sample Identification :		
						TW1 - GW1	TW1 - GW2	TW1 - GW3
						A	B	C
<b>Metals Scan (Water, ICP/MS)</b>								
Aluminum	0.01	mg/L	0.1			0.07	0.03	0.03
Antimony	0.0005	mg/L	0.006			<0.0005	<0.0005	<0.0005
Arsenic	0.001	mg/L	0.01			<0.001	<0.001	<0.001
Barium	0.001	mg/L	1			0.219	0.212	0.214
Beryllium	0.0005	mg/L				<0.0005	<0.0005	<0.0005
Boron	0.01	mg/L	5			0.10	0.11	0.11
Cadmium	0.0001	mg/L	0.005			<0.0001	<0.0001	<0.0001
Chromium	0.001	mg/L	0.05			<0.001	<0.001	<0.001
Cobalt	0.0002	mg/L				0.0002	0.0002	<0.0002
Copper	0.001	mg/L	1			<0.001	<0.001	<0.001
Iron	0.03	mg/L	0.3			2.22	2.19	2.29
Lead	0.001	mg/L	0.01			<0.001	<0.001	<0.001
Manganese	0.01	mg/L	0.05			2.89	2.87	2.89
Mercury	0.0001	mg/L	0.001			<0.0001	<0.0001	<0.0001
Molybdenum	0.005	mg/L				0.010	0.010	0.009
Nickel	0.005	mg/L				<0.005	<0.005	<0.005
Selenium	0.001	mg/L	0.05			<0.001	<0.001	<0.001
Silicon	0.1	mg/L						6.5
Silver	0.0001	mg/L				<0.0001	<0.0001	<0.0001
Strontium	0.001	mg/L				4.50	4.56	4.62
Thallium	0.0001	mg/L				<0.0001	<0.0001	<0.0001
Titanium	0.01	mg/L						<0.01
Uranium	0.001	mg/L	0.02			0.001	0.001	
Vanadium	0.001	mg/L				<0.001	<0.001	<0.001
Zinc	0.01	mg/L	5			<0.01	<0.01	<0.01
<b>Metals Scan (Water, ICP/OES)</b>								
Calcium	1	mg/L				190	188	188
Magnesium	1	mg/L				57	57	57
Potassium	1	mg/L				11	11	11
Sodium	1	mg/L	200			100	101	101

Microbiology						Eurofins Sample No :		
						8408304	8408306	
RL						Matrix :		
						Groundwater	Groundwater	
Unit						Sampling Date :		
						2025-03-04	2025-03-04	
Criteria						Client Sample Identification :		
						TW1 - GW1	TW1 - GW2	
						A	B	C
Escherichia coli (DC)	0	CFU/100mL	0			0	0	
Total Coliforms (DC)	0	CFU/100mL	0			4	3	

## OFFICIAL CERTIFICATE OF ANALYSIS - RESULTS

Client : Paterson Group  
 Project : PH4991

Reception Date: 2025-03-05

Eurofins Sample No :		<b>8408304</b>	<b>8408306</b>					
Matrix :		Groundwater	Groundwater					
Sampling Date :		2025-03-04	2025-03-04					
Client Sample Identification :		TW1 - GW1	TW1 - GW2					
<b>Nutrients</b>	<b>RL</b>	<b>Unit</b>						
Ammonia (Total, as Nitrogen)	0.02	mg/L	0.795	0.825				
Total Kjeldahl Nitrogen	0.1	mg/L	1.24	1.10				

## OFFICIAL CERTIFICATE OF ANALYSIS - RESULTS

Client : Paterson Group  
Project : PH4991

Reception Date: 2025-03-05

		Eurofins Sample No :		8408306					
		Matrix :		Groundwater					
		Sampling Date :		2025-03-04					
		Client Sample Identification :		TW1 - GW2					
Semivolatile Organic Compounds	RL	Unit	Criteria						
			A	B	C				
<b>Base Neutrals (Water, GC/MS)</b>									
1,2,4-Trichlorobenzene	0.5	ug/L				<0.5			
1,2-Dichlorobenzene <sup>^</sup>	0.4	ug/L				<0.4			
1,3-Dichlorobenzene <sup>^</sup>	0.4	ug/L				<0.4			
1,4-Dichlorobenzene <sup>^</sup>	0.4	ug/L				<0.4			
2,4 + 2,6-Dinitrotoluene	0.5	ug/L				<0.5			
2,4-Dinitrotoluene	0.3	ug/L				<0.3			
2,6-Dinitrotoluene	0.3	ug/L				<0.3			
2-Chloronaphthalene	0.2	ug/L				<0.2			
3,3'-Dichlorobenzidine	0.5	ug/L				<0.5			
4-Bromophenyl phenyl ether	0.3	ug/L				<0.3			
4-Chloroaniline	0.2	ug/L				<0.2			
4-Chlorophenyl phenyl ether	0.3	ug/L				<0.3			
Azobenzene	0.3	ug/L				<0.3			
Biphenyl	0.6	ug/L				<0.6			
bis(2-chloro-1-methylethyl)ether	0.5	ug/L				<0.5			
Bis(2-chloroethoxy)methane	0.6	ug/L				<0.6			
Bis(2-chloroethyl)ether	0.8	ug/L				<0.8			
Bis(2-ethylhexyl)phthalate	0.4	ug/L				<0.4			
Butyl benzyl phthalate	0.3	ug/L				<0.3			
Camphene <sup>^</sup>	3.5	ug/L				<3.5			
Diethyl phthalate	0.2	ug/L				<0.2			
Dimethyl phthalate	0.2	ug/L				<0.2			
Di-n-butyl phthalate	1.3	ug/L				<0.3			
Di-n-octyl phthalate	0.9	ug/L				<0.9			
Diphenylamine <sup>^</sup>	5	ug/L				<1			
Hexachlorobenzene	0.01	ug/L				<0.01			
Hexachlorobutadiene	0.01	ug/L				<0.01			
Hexachlorocyclopentadiene <sup>^</sup>	0.5	ug/L				<0.5			
Hexachloroethane	0.01	ug/L				<0.01			
Indole <sup>^</sup>	1.9	ug/L				<1.9			
Isophorone	0.2	ug/L				<0.2			
Nitrobenzene	0.2	ug/L				<0.2			
N-Nitroso-di-n-propylamine	0.3	ug/L				<1.0			
N-Nitrosodiphenylamine & Diphenylamine <sup>^</sup>	1	ug/L				<1			
Phenyl ether <sup>^</sup>	0.4	ug/L				<0.4			
Quinoline <sup>^</sup>	2	ug/L				<2			
5-Nitroacenaphthene <sup>^</sup>	0.3	ug/L				<0.3			
1-Chloronaphthalene <sup>^</sup>	4.3	ug/L				<4.3			
p-Terphenyl-d14 (surrogate)	0	%				70			
<b>PAH (Water, GC/MS)</b>									
1-Methylnaphthalene	0.1	ug/L				<0.1			
2-Methylnaphthalene	0.1	ug/L				<0.1			
Acenaphthene	0.1	ug/L				<0.1			
Acenaphthylene	0.1	ug/L				<0.1			

## OFFICIAL CERTIFICATE OF ANALYSIS - RESULTS

Client : Paterson Group  
Project : PH4991

Reception Date: 2025-03-05

			Eurofins Sample No : <b>8408306</b>						
			Matrix : Groundwater						
			Sampling Date : 2025-03-04						
			Client Sample Identification : TW1 - GW2						
Semivolatile Organic Compounds	RL	Unit	Criteria						
			A	B	C				
Anthracene	0.1	ug/L				<0.1			
Benzo(a)anthracene	0.1	ug/L				<0.1			
Benzo(a)pyrene	0.01	ug/L	0.01			<0.01			
Benzo(b)fluoranthene	0.05	ug/L				<0.05			
Benzo(g,h,i)perylene	0.1	ug/L				<0.1			
Benzo(k)fluoranthene	0.05	ug/L				<0.05			
Chrysene	0.05	ug/L				<0.05			
Dibenzo(a,h)anthracene	0.1	ug/L				<0.1			
Fluoranthene	0.1	ug/L				<0.1			
Fluorene	0.1	ug/L				<0.1			
Indeno(1,2,3-c,d)pyrene	0.1	ug/L				<0.1			
Naphthalene	0.1	ug/L				<0.1			
Phenanthrene	0.1	ug/L				<0.1			
Pyrene	0.1	ug/L				<0.1			
p-Terphenyl-d14 (surrogate)	0	%				99			
<b>Phenolics (Water, GC/MS)</b>									
2,3,4,6-Tetrachlorophenol	1	ug/L	100			<1.0			
2,3,4-Trichlorophenol	1	ug/L				<1.0			
2,3,4,5 & 2,3,4,6-Tetrachlorophenol^	1	ug/L				<1.0			
2,3,4,5-Tetrachlorophenol^	1	ug/L				<1.0			
2,3,5,6-Tetrachlorophenol^	1	ug/L				<1.0			
2,3,5-Trichlorophenol	1	ug/L				<1.0			
2,4,5-Trichlorophenol	0.2	ug/L				<0.2			
2,4,6-Trichlorophenol	0.2	ug/L	5			<0.2			
2,4-Dichlorophenol	0.2	ug/L	900			<0.2			
2,4-Dimethylphenol	1	ug/L				<1.0			
2,4-Dinitrophenol	2.5	ug/L				<2.5			
2,6-Dichlorophenol	2	ug/L				<2.0			
2-Chlorophenol	1	ug/L				<1.0			
2-Methyl-4,6-dinitrophenol	2.2	ug/L				<2.2			
2-Methylphenol	1	ug/L				<1.0			
2-Nitrophenol	2	ug/L				<2.0			
3 & 4-Methylphenol	1	ug/L				<1.0			
4-Chloro-3-Methylphenol	1	ug/L				<1.0			
4-Nitrophenol	2.5	ug/L				<2.5			
Methylphenols (Total Cresols)	2	ug/L				<2.0			
Pentachlorophenol	1	ug/L	60			<1.0			
Phenol	1	ug/L				<1.0			
Tribromophenol (surrogate)	0	%				93			

## OFFICIAL CERTIFICATE OF ANALYSIS - RESULTS

Client : Paterson Group  
Project : PH4991

Reception Date: 2025-03-05

			Eurofins Sample No : <b>8408306</b>						
			Matrix : Groundwater						
			Sampling Date : 2025-03-04						
			Client Sample Identification : TW1 - GW2						
Volatile Organic Compounds	RL	Unit	Criteria						
			A	B	C				
<b>VOCs (Water, GC/MS)</b>									
1,1,1,2-Tetrachloroethane	0.5	ug/L				<0.5			
1,1,1-Trichloroethane	0.4	ug/L				<0.4			
1,1,2,2-Tetrachloroethane	0.5	ug/L				<0.5			
1,1,2-Trichloroethane	0.4	ug/L				<0.4			
1,1-Dichloroethane	0.4	ug/L				<0.4			
1,1-Dichloroethene	0.5	ug/L	14			<0.5			
1,2-Dibromoethane	0.2	ug/L				<0.2			
1,2-Dichlorobenzene	0.4	ug/L	200			<0.4			
1,2-Dichloroethane	0.2	ug/L	5			<0.2			
1,2-Dichloropropane	0.5	ug/L				<0.5			
1,3,5-Trimethylbenzene	0.3	ug/L				<0.3			
1,3-Dichlorobenzene	0.4	ug/L				<0.4			
1,4-Dichlorobenzene	0.4	ug/L	5			<0.4			
Acetone	5	ug/L				<5.0			
Benzene	0.5	ug/L	1			<0.5			
Bromodichloromethane	0.3	ug/L				<0.3			
Bromoform	0.4	ug/L				<0.4			
Bromomethane	0.5	ug/L				<0.5			
Carbon tetrachloride	0.2	ug/L	2			<0.2			
Chloroethane	0.5	ug/L				<0.5			
Chloroform	0.5	ug/L				<0.5			
Chloromethane	0.2	ug/L				<0.2			
cis-1,2-Dichloroethene	0.4	ug/L				<0.4			
cis-1,3-Dichloropropene	0.5	ug/L				<0.5			
Dibromochloromethane	0.3	ug/L				<0.3			
Dichloromethane	4	ug/L	50			<4.0			
Diethyl ether	5	ug/L				<5.0			
Ethylbenzene	0.5	ug/L	140			<0.5			
m/p-Xylene	0.4	ug/L				<0.4			
Methyl ethyl ketone (MEK)	2	ug/L				<2.0			
Methyl isobutyl ketone (MIBK)	5	ug/L				<5.0			
Methyl tert-butyl ether (MTBE)	2	ug/L				<2.0			
Monochlorobenzene	0.5	ug/L	80			<0.5			
o-Xylene	0.4	ug/L				<0.4			
Styrene	0.5	ug/L				<0.5			
Tetrachloroethylene (PCE)	0.3	ug/L	10			<0.3			
Toluene	0.4	ug/L	60			<0.4			
trans-1,2-dichloroethene	0.4	ug/L				<0.4			
trans-1,3-dichloropropene	0.5	ug/L				<0.5			
Trichloroethylene (TCE)	0.3	ug/L	5			<0.3			
Trichlorofluoromethane	0.5	ug/L				<0.5			
Vinyl chloride	0.2	ug/L	1			<0.2			
Xylene (Total)	0.5	ug/L	90			<0.5			
1,2-dichloroethane-d4 (surrogate)	0	%				102			
4-bromofluorobenzene (surrogate)	0	%				64			


## OFFICIAL CERTIFICATE OF ANALYSIS - RESULTS

Client : Paterson Group  
Project : PH4991


Reception Date: 2025-03-05

			Eurofins Sample No :			8408306						
			Matrix :			Groundwater						
			Sampling Date :			2025-03-04						
			Client Sample Identification :			TW1 - GW2						
<b>Volatile Organic Compounds</b>						<b>Criteria</b>						
	<b>RL</b>	<b>Unit</b>	<b>A</b>	<b>B</b>	<b>C</b>							
Toluene-d8 (surrogate)	0	%						86				

Approved by :

  
Adrine Thomas,  
Inorganic supervisor, Ottawa

Approved by :

  
Patrick Jacques,  
Ottawa, Environmental Chemist,

## OFFICIAL CERTIFICATE OF ANALYSIS - QUALITY CONTROL

Client : Paterson Group  
Project : PH4991

Reception Date: 2025-03-05

Parameter	Unit	RL	Blank	QC		Matrix Spike		Duplicate	
				Recovery %	Range %	Recovery %	Range %	RPD %	Range %
<b>Alkalinity (Water, Automated)</b>									
<i>Method : Alkalinity (water, titration to pH 4.5, automated). Internal method: OTT-I-AT-WI45398.</i>									
Alkalinity (as CaCO3)	mg/L	5	<5	97	95-105			1	0-20
Associated Samples : 8408304, 8408306								Prep Date: 2025-03-06 Analysis Date: 2025-03-07	
<b>Ammonia, Total (Water, Colorimetry)</b>									
<i>Method : Ammonia (Water, Colorimetry). Internal method: OTT-I-NUT-WI46201.</i>									
Ammonia (Total, as Nitrogen)	mg/L	0.02	<0.020	95	80-120	99	80-120	6	0-20
Associated Samples : 8408304, 8408306								Prep Date: 2025-03-06 Analysis Date: 2025-03-06	
<b>Base Neutrals (Water, GC/MS)</b>									
<i>Method : Semi-volatile organic compounds (Water, GC/MS). Internal method: OTT-O-SEMI-WI45239.</i>									
1,2,4-Trichlorobenzene	ug/L	0.5	<0.5	60	50-140				
1,2-Dichlorobenzene^	ug/L	0.4	<0.4		50-140				
1,3-Dichlorobenzene^	ug/L	0.4	<0.4		50-140				
1,4-Dichlorobenzene^	ug/L	0.4	<0.4		50-140				
2,4 + 2,6-Dinitrotoluene	ug/L	0.5	<0.5	87	50-140				
2,4-Dinitrotoluene	ug/L	0.3	<0.3	52	50-140				
2,6-Dinitrotoluene	ug/L	0.3	<0.3	122	50-140				
2-Chloronaphthalene	ug/L	0.2	<0.2	64	50-140				
3,3'-Dichlorobenzidine	ug/L	0.5	<0.5	34	30-130				
4-Bromophenyl phenyl ether	ug/L	0.3	<0.3	58	50-140				
4-Chloroaniline	ug/L	0.2	<0.2	46	30-130				
4-Chlorophenyl phenyl ether	ug/L	0.3	<0.3	58	50-140				
Azobenzene	ug/L	0.3	<0.3	70	50-140				
Biphenyl	ug/L	0.6	<0.6	64	50-140				
bis(2-chloro-1-methylethyl)ether	ug/L	0.5	<0.5	60	50-140				
Bis(2-chloroethoxy)methane	ug/L	0.6	<0.6	62	50-140				
Bis(2-chloroethyl)ether	ug/L	0.8	<0.8	60	50-140				
Bis(2-ethylhexyl)phthalate	ug/L	0.4	<0.4	86	50-140				
Butyl benzyl phthalate	ug/L	0.3	<0.3	68	50-140				
Camphene^	ug/L	3.5	<3.5		50-140				
Diethyl phthalate	ug/L	0.2	<0.2	62	50-140				
Dimethyl phthalate	ug/L	0.2	<0.2	58	50-140				
Di-n-butyl phthalate	ug/L	1.3	<0.3	66	50-140				
Di-n-octyl phthalate	ug/L	0.9	<0.9	64	50-140				
Diphenylamine^	ug/L	5	<1		50-140				
Hexachlorobenzene	ug/L	0.01	<0.01	58	50-140				
Hexachlorobutadiene	ug/L	0.01	<0.01	56	50-140				
Hexachlorocyclopentadiene^	ug/L	0.5	<0.5	54	50-140				
Hexachloroethane	ug/L	0.01	<0.01	65	50-140				
Indole^	ug/L	1.9	<1.9	50	50-140				
Isophorone	ug/L	0.2	<0.2	64	50-140				
Nitrobenzene	ug/L	0.2	<0.2	68	50-140				
N-Nitroso-di-n-propylamine	ug/L	0.3	<1.0	60	50-140				
N-Nitrosodiphenylamine & Diphenylamine^	ug/L	1	<1	30	50-140				
Phenyl ether^	ug/L	0.4	<0.4	62	50-140				
Quinoline^	ug/L	2	<2						
5-Nitroacenaphthene^	ug/L	0.3	<0.3						

## OFFICIAL CERTIFICATE OF ANALYSIS - QUALITY CONTROL

Client : Paterson Group  
Project : PH4991

Reception Date: 2025-03-05

Parameter	Unit	RL	Blank	QC		Matrix Spike		Duplicate	
				Recovery %	Range %	Recovery %	Range %	RPD %	Range %
<b>Base Neutrals (Water, GC/MS)</b>									
<i>Method : Semi-volatile organic compounds (Water, GC/MS). Internal method: OTT-O-SEMI-WI45239.</i>									
1-Chloronaphthalene^	ug/L	4.3	<4.3						
Associated Samples : 8408306								Prep Date: 2025-03-07 Analysis Date: 2025-03-07	
<b>Chloride (Water, IC)</b>									
<i>Method : Anions (Water, Ion Chromatography). Internal method: OTT-I-IC-WI45985.</i>									
Chloride	mg/L	0.5	<0.5	99	80-120	107	80-120	-	0-20
Associated Samples : 8408304, 8408306								Prep Date: 2025-03-07 Analysis Date: 2025-03-10	
<b>Colour, Apparent (Water, Spectrophotometry)</b>									
<i>Method : Colour (Water, Spectrophotometric). Internal method: OTT-I-SPEC-WI45980.</i>									
Colour (Apparent)	TCU	2	<2	108	78-116			0	0-40
Associated Samples : 8408304, 8408306, 8408308								Prep Date: 2025-03-07 Analysis Date: 2025-03-10	
<b>Conductivity (Water, Automated)</b>									
<i>Method : Conductivity (Water, Autotitrator). Internal Method: OTT-I-AT-WI45398.</i>									
Conductivity @ 25°C	uS/cm	5	<5	99	98-102				
Associated Samples : 8408304, 8408306								Prep Date: 2025-03-06 Analysis Date: 2025-03-07	
<b>DOC (Water, IR)</b>									
<i>Method : Organic carbon (water, IR, combustion). Internal method: OTT-I-DEM-WI46148.</i>									
Dissolved Organic Carbon	mg/L	0.5	<0.5	97	84-116	111	80-120	8	0-15
Associated Samples : 8408304, 8408306								Prep Date: 2025-03-06 Analysis Date: 2025-03-07	
<b>Escherichia coli (DC Plate)</b>									
<i>Method : Total Coliforms and E.Coli by MF (Water, DC plate). Internal method: OTT-M-BAC-WI45296.</i>									
Escherichia coli (DC)	CFU/100mL	0	0					-	0-30
Associated Samples : 8408304, 8408306								Prep Date: 2025-03-05 Analysis Date: 2025-03-06	
<b>Fluoride (Water, Auto/ISE)</b>									
<i>Method : Fluoride by autotitrator, ion selective electrode. Internal method: OTT-I-AT-WI45398.</i>									
Fluoride	mg/L	0.1	<0.10	97	90-110				
Associated Samples : 8408304, 8408306								Prep Date: 2025-03-06 Analysis Date: 2025-03-07	

## OFFICIAL CERTIFICATE OF ANALYSIS - QUALITY CONTROL

Client : Paterson Group  
Project : PH4991

Reception Date: 2025-03-05

Parameter	Unit	RL	Blank	QC		Matrix Spike		Duplicate	
				Recovery %	Range %	Recovery %	Range %	RPD %	Range %
<b>Metals Scan (Water, ICP/MS)</b>									
<i>Method : Metals (Water, ICP/MS). Internal method: AMMTFQE1.</i>									
Aluminum	mg/L	0.01	<0.01	100	80-120	95	70-130	1	0-20
Antimony	mg/L	0.0005	<0.0005	82	80-120	84	70-130	-	0-20
Arsenic	mg/L	0.001	<0.001	99	80-120	98	70-130	-	0-20
Barium	mg/L	0.001	<0.001	100	80-120	94	70-130	1	0-20
Beryllium	mg/L	0.0005	<0.0005	106	80-120	108	70-130	-	0-20
Boron	mg/L	0.01	<0.01	100	80-120	104	70-130	-	0-20
Cadmium	mg/L	0.0001	<0.0001	101	80-120	99	70-130	-	0-20
Chromium	mg/L	0.001	<0.001	100	80-120	94	70-130	-	0-20
Cobalt	mg/L	0.0002	<0.0002	101	80-120	96	70-130	-	0-20
Copper	mg/L	0.001	<0.001	110	80-120	99	70-130	-	0-20
Iron	mg/L	0.03	<0.03	100	80-120	95	70-130	0	0-20
Lead	mg/L	0.001	<0.001	110	80-120	97	70-130	-	0-20
Manganese	mg/L	0.01	<0.01	100	80-120	96	70-130	-	0-20
Mercury	mg/L	0.0001	<0.0001	107	80-120	97	70-130	-	0-20
Molybdenum	mg/L	0.005	<0.005	90	80-120	91	70-130	-	0-20
Nickel	mg/L	0.005	<0.005	100	80-120	100	70-130	-	0-20
Selenium	mg/L	0.001	<0.001	97	80-120	97	70-130	-	0-20
Silicon	mg/L	0.1	<0.1	100	80-120			0	0-20
Silver	mg/L	0.0001	<0.0001	111	80-120	96	70-130	-	0-20
Strontium	mg/L	0.001	<0.001	100	80-120	90	70-130	1	0-20
Thallium	mg/L	0.0001	<0.0001	106	80-120	96	70-130	-	0-20
Titanium	mg/L	0.01	<0.01	102	80-120	97	70-130	-	0-20
Uranium	mg/L	0.001	<0.001	100	80-120	98	70-130	-	0-20
Vanadium	mg/L	0.001	<0.001	90	80-120	91	70-130	-	0-20
Zinc	mg/L	0.01	<0.01	110	80-120	102	70-130	-	0-20
Associated Samples : 8408304, 8408306, 8408308								Prep Date: 2025-03-06 Analysis Date: 2025-03-06	
<b>Metals Scan (Water, ICP/OES)</b>									
<i>Method : Metals (Water, ICP/OES). Internal method: OTT-I-MET-WI48491.</i>									
Calcium	mg/L	1	<1	101	86-115	98	70-130	0	0-20
Magnesium	mg/L	1	<1	98	91-109	98	70-130	0	0-20
Potassium	mg/L	1	<1	104	87-113	103	70-130	-	0-20
Sodium	mg/L	1	<1	103	85-115	103	70-130	0	0-20
Associated Samples : 8408304, 8408306, 8408308								Prep Date: 2025-03-06 Analysis Date: 2025-03-05	
<b>Nitrate (Water, IC)</b>									
<i>Method : Anions (Water, Ion Chromatography). Internal method: OTT-I-IC-WI45985.</i>									
Nitrate (as Nitrogen)	mg/L	0.1	<0.1	97	80-120	111	80-120	-	0-20
Associated Samples : 8408304, 8408306								Prep Date: 2025-03-07 Analysis Date: 2025-03-10	
<b>Nitrite (Water, IC)</b>									
<i>Method : Anions (Water, Ion Chromatography). Internal method: OTT-I-IC-WI45985.</i>									
Nitrite (as Nitrogen)	mg/L	0.1	<0.1	106	80-120				
Associated Samples : 8408304, 8408306								Prep Date: 2025-03-07 Analysis Date: 2025-03-10	

## OFFICIAL CERTIFICATE OF ANALYSIS - QUALITY CONTROL

Client : Paterson Group  
Project : PH4991

Reception Date: 2025-03-05

Parameter	Unit	RL	Blank	QC		Matrix Spike		Duplicate	
				Recovery %	Range %	Recovery %	Range %	RPD %	Range %
<b>PAH (Water, GC/MS)</b>									
<i>Method : Semi-volatile organic compounds (Water, GC/MS). Internal method: OTT-O-SEMI-WI45239.</i>									
1-Methylnaphthalene	ug/L	0.1	<0.1	72	50-140				
2-Methylnaphthalene	ug/L	0.1	<0.1	72	50-140				
Acenaphthene	ug/L	0.1	<0.1	72	50-140				
Acenaphthylene	ug/L	0.1	<0.1	72	50-140				
Anthracene	ug/L	0.1	<0.1	84	50-140				
Benzo(a)anthracene	ug/L	0.1	<0.1	78	50-140				
Benzo(a)pyrene	ug/L	0.01	<0.01	67	50-140				
Benzo(b)fluoranthene	ug/L	0.05	<0.05	59	50-140				
Benzo(g,h,i)perylene	ug/L	0.1	<0.1	76	50-140				
Benzo(k)fluoranthene	ug/L	0.05	<0.05	82	50-140				
Chrysene	ug/L	0.05	<0.05	81	50-140				
Dibenzo(a,h)anthracene	ug/L	0.1	<0.1	64	50-140				
Fluoranthene	ug/L	0.1	<0.1	72	50-140				
Fluorene	ug/L	0.1	<0.1	74	50-140				
Indeno(1,2,3-c,d)pyrene	ug/L	0.1	<0.1	62	50-140				
Naphthalene	ug/L	0.1	<0.1	70	50-140				
Phenanthrene	ug/L	0.1	<0.1	78	50-140				
Pyrene	ug/L	0.1	<0.1	74	50-140				

Associated Samples : 8408306

Prep Date: 2025-03-07  
Analysis Date: 2025-03-07

### pH (25°C) (Water, Automated)

*Method : pH (Water, Automated Meter). Internal method: OTT-I-AT-WI45398.*

pH @ 25°C		1	6.56	100	97-103			1	0-20
-----------	--	---	------	-----	--------	--	--	---	------

Associated Samples : 8408304, 8408306

Prep Date: 2025-03-06  
Analysis Date: 2025-03-07

## OFFICIAL CERTIFICATE OF ANALYSIS - QUALITY CONTROL

Client : Paterson Group  
Project : PH4991

Reception Date: 2025-03-05

Parameter	Unit	RL	Blank	QC		Matrix Spike		Duplicate	
				Recovery %	Range %	Recovery %	Range %	RPD %	Range %
<b>Phenolics (Water, GC/MS)</b>									
<i>Method : Semi-volatile organic compounds (Water, GC/MS). Internal method: OTT-O-SEMI-WI45239.</i>									
2,3,4,6-Tetrachlorophenol	ug/L	1	<1.0	73	50-140				
2,3,4-Trichlorophenol	ug/L	1	<1.0	108	50-140				
2,3,4,5 & 2,3,4,6-Tetrachlorophenol^	ug/L	1	<1.0		50-140				
2,3,4,5-Tetrachlorophenol^	ug/L	1	<1.0	79	50-140				
2,3,5,6-Tetrachlorophenol^	ug/L	1	<1.0	98	50-140				
2,3,5-Trichlorophenol	ug/L	1	<1.0	108	50-140				
2,4,5-Trichlorophenol	ug/L	0.2	<0.2	126	50-140				
2,4,6-Trichlorophenol	ug/L	0.2	<0.2	107	50-140				
2,4-Dichlorophenol	ug/L	0.2	<0.2	106	50-140				
2,4-Dimethylphenol	ug/L	1	<1.0	76	30-130				
2,4-Dinitrophenol	ug/L	2.5	<2.5	101	30-130				
2,6-Dichlorophenol	ug/L	2	<2.0	106	50-140				
2-Chlorophenol	ug/L	1	<1.0	82	50-140				
2-Methyl-4,6-dinitrophenol	ug/L	2.2	<2.2		50-140				
2-Methylphenol	ug/L	1	<1.0	56	50-140				
2-Nitrophenol	ug/L	2	<2.0	69	30-130				
3 & 4-Methylphenol	ug/L	1	<1.0	57	50-140				
4-Chloro-3-Methylphenol	ug/L	1	<1.0		50-140				
4-Nitrophenol	ug/L	2.5	<2.5	58	30-130				
Methylphenols (Total Cresols)	ug/L	2	<2.0	57	50-140				
Pentachlorophenol	ug/L	1	<1.0	121	50-140				
Phenol	ug/L	1	<1.0	67	30-130				
Associated Samples : 8408306								Prep Date: 2025-03-07 Analysis Date: 2025-03-07	
<b>Phenols (Water, Colorimetry)</b>									
<i>Method : Phenols (Water, Colorimetry). Internal method: OTT-I-4AAP-WI46150.</i>									
Phenols-4AAP	mg/L	0.001	<0.001	110	75-125	106	70-130	-	0-20
Associated Samples : 8408304, 8408306								Prep Date: 2025-03-07 Analysis Date: 2025-03-07	
<b>Sulphate (Water, IC)</b>									
<i>Method : Anions (Water, Ion Chromatography). Internal method: OTT-I-IC-WI45985.</i>									
Sulphate	mg/L	1	<1	95	90-110	108	80-120	0	0-20
Associated Samples : 8408304, 8408306								Prep Date: 2025-03-07 Analysis Date: 2025-03-10	
<b>Sulphide (Water, Colorimetry)</b>									
<i>Method : Sulphide, S2- (Water, Colorimetry). Internal method: OTT-I-SPEC-WI45931.</i>									
Sulphide (S2-)	mg/L	0.01	<0.01	87	80-120			-	0-20
Associated Samples : 8408304, 8408306								Prep Date: 2025-03-07 Analysis Date: 2025-03-10	
<b>Tannin and Lignin (Water, Spec)</b>									
<i>Method : Tannin and Lignin (Water, Spec), Internal method: OTT-I-SPEC-WI57693.</i>									
Tannin and Lignin	mg/L	0.1	<0.1	106	80-120			-	0-20
Associated Samples : 8408304, 8408306								Prep Date: 2025-03-06 Analysis Date: 2025-03-06	

## OFFICIAL CERTIFICATE OF ANALYSIS - QUALITY CONTROL

Client : Paterson Group  
 Project : PH4991

Reception Date: 2025-03-05

Parameter	Unit	RL	Blank	QC		Matrix Spike		Duplicate	
				Recovery %	Range %	Recovery %	Range %	RPD %	Range %
<b>Total Coliforms (DC Plate)</b>									
<i>Method : Total Coliforms and E.Coli by MF (Water, DC plate). Internal method: OTT-M-BAC-WI45296.</i>									
Total Coliforms (DC)	CFU/100mL	0	0					-	0-30
Associated Samples : 8408304, 8408306								Prep Date: 2025-03-05 Analysis Date: 2025-03-06	
<b>Total Kjeldahl Nitrogen (Water, Colorimetry)</b>									
<i>Method : TKN (Water, colorimetry). Internal method: OTT-I-NUT-WI46201.</i>									
Total Kjeldahl Nitrogen	mg/L	0.1	<0.100	90	70-130	112	70-130	2	0-20
Associated Samples : 8408304, 8408306								Prep Date: 2025-03-06 Analysis Date: 2025-03-06	
<b>Turbidity (Water, Turbidimeter)</b>									
<i>Method : Turbidity (Water, Turbidimeter). Internal method: OTT-I-TUR-WI46288.</i>									
Turbidity	NTU	0.1	<0.1	105	80-120			2	0-30
Associated Samples : 8408304, 8408306, 8408308								Prep Date: 2025-03-06 Analysis Date: 2025-03-06	

## OFFICIAL CERTIFICATE OF ANALYSIS - QUALITY CONTROL

Client : Paterson Group  
Project : PH4991

Reception Date: 2025-03-05

Parameter	Unit	RL	Blank	QC		Matrix Spike		Duplicate	
				Recovery %	Range %	Recovery %	Range %	RPD %	Range %
<b>VOCs (Water, GC/MS)</b>									
<i>Method : Volatile Organic Compounds (Water, GC/MS). Internal method: AMVOMSE8.</i>									
1,1,1,2-Tetrachloroethane	ug/L	0.5	<0.5	105	70-130	73	70-130	-	0-30
1,1,1-Trichloroethane	ug/L	0.4	<0.4	113	70-130	74	70-130	-	0-30
1,1,2,2-Tetrachloroethane	ug/L	0.5	<0.5	109	70-130	78	70-130	-	0-30
1,1,2-Trichloroethane	ug/L	0.4	<0.4	106	70-130	74	70-130	-	0-30
1,1-Dichloroethane	ug/L	0.4	<0.4	115	70-130	75	70-130	-	0-30
1,1-Dichloroethene	ug/L	0.5	<0.5	119	70-130	128	70-130	-	0-30
1,2-Dibromoethane	ug/L	0.2	<0.2	95	70-130	104	70-130	-	0-30
1,2-Dichlorobenzene	ug/L	0.4	<0.4	103	70-130	92	70-130	-	0-30
1,2-Dichloroethane	ug/L	0.2	<0.2	111	70-130	106	70-130	-	0-30
1,2-Dichloropropane	ug/L	0.5	<0.5	105	70-130	112	70-130	-	0-30
1,3,5-Trimethylbenzene	ug/L	0.3	<0.3	86	70-130	114	70-130	-	0-30
1,3-Dichlorobenzene	ug/L	0.4	<0.4	89	70-130	83	70-130	-	0-30
1,4-Dichlorobenzene	ug/L	0.4	<0.4	89	70-130	89	70-130	-	0-30
Acetone	ug/L	5	<5.0	107	70-130	78	70-130	-	0-30
Benzene	ug/L	0.5	<0.5	95	70-130	77	70-130	-	0-30
Bromodichloromethane	ug/L	0.3	<0.3	118	70-130	79	70-130	-	0-30
Bromoform	ug/L	0.4	<0.4	112	70-130	78	70-130	-	0-30
Bromomethane	ug/L	0.5	<0.5	126	70-130	117	70-130	-	0-30
Carbon tetrachloride	ug/L	0.2	<0.2	122	70-130	78	70-130	-	0-30
Chloroethane	ug/L	0.5	<0.5	116	70-130	116	70-130	-	0-30
Chloroform	ug/L	0.5	<0.5	123	70-130	81	70-130	-	0-30
Chloromethane	ug/L	0.2	<0.2	108	70-130	105	70-130	-	0-30
cis-1,2-Dichloroethene	ug/L	0.4	<0.4	118	70-130	78	70-130	-	0-30
cis-1,3-Dichloropropene	ug/L	0.5	<0.5	83	70-130	88	70-130	-	0-30
Dibromochloromethane	ug/L	0.3	<0.3	100	70-130	98	70-130	-	0-30
Dichloromethane	ug/L	4	<4.0	106	70-130	76	70-130	-	0-30
Diethyl ether	ug/L	5	<5.0	120	70-130	112	70-130	-	0-30
Ethylbenzene	ug/L	0.5	<0.5	96	70-130	78	70-130	-	0-30
m/p-Xylene	ug/L	0.4	<0.4	109	70-130	96	70-130	-	0-30
Methyl ethyl ketone (MEK)	ug/L	2	<2.0	94	70-130	76	70-130	-	0-30
Methyl isobutyl ketone (MIBK)	ug/L	5	<5.0	124	70-130	90	70-130	-	0-30
Methyl tert-butyl ether (MTBE)	ug/L	2	<2.0	140	70-130	82	70-130	-	0-30
Monochlorobenzene	ug/L	0.5	<0.5	89	70-130	108	70-130	-	0-30
o-Xylene	ug/L	0.4	<0.4	100	70-130	108	70-130	-	0-30
Styrene	ug/L	0.5	<0.5	99	70-130	124	70-130	-	0-30
Tetrachloroethylene (PCE)	ug/L	0.3	<0.3	92	70-130	82	70-130	-	0-30
Toluene	ug/L	0.4	<0.4	94	70-130	98	70-130	-	0-30
trans-1,2-dichloroethene	ug/L	0.4	<0.4	122	70-130	77	70-130	-	0-30
trans-1,3-dichloropropene	ug/L	0.5	<0.5	100	70-130	103	70-130	-	0-30
Trichloroethylene (TCE)	ug/L	0.3	<0.3	95	70-130	113	70-130	-	0-30
Trichlorofluoromethane	ug/L	0.5	<0.5	126	70-130	122	70-130	-	0-30
Vinyl chloride	ug/L	0.2	<0.2	128	70-130	94	70-130	-	0-30
Xylene (Total)	ug/L	0.5	<0.5					-	-

Associated Samples : 8408306

Prep Date: 2025-03-07  
Analysis Date: 2025-03-11

Where RPD % is reported as "-" the calculation is not available because one or both of the duplicates is within 5 times the RL.





# Manganese in Drinking Water Fact Sheet

## WHAT IS MANGANESE?

Manganese is a naturally occurring element that is an essential nutrient for humans and animals. It is found in many foods, as well as in air, water, soil, and rocks.<sup>1</sup> Manganese makes up 0.1% of the Earth's crust, and can be found as a component of other minerals like sulfides, oxides, carbonates, and silicates.<sup>2</sup> Manganese is used in the manufacture of various products including iron and steel alloys, batteries, glass, fireworks, fertilizers, cosmetics, paints, and cleaning and disinfection products.<sup>1,2</sup> Manganese can also be purchased as a nutritional supplement.<sup>2</sup>

## HOW DOES MANGANESE GET INTO DRINKING WATER?

Manganese is naturally occurring in many surface and ground waters. Manganese can also be dissolved from soils, sand and rocks to enter surface and ground waters.<sup>1</sup> Human activities like mining, industrial discharges, or landfills may also contribute to manganese in surface and ground waters.<sup>1,2</sup> In general, manganese can be found at higher concentrations in groundwater compared to surface water.<sup>2</sup> Some lakes and reservoirs can also have higher levels of manganese due to natural water chemistry.<sup>2</sup>

Permanganate, a compound that contains manganese, may also be added to water during the treatment of drinking water to remove other chemicals (e.g., for the removal of iron).<sup>2,3</sup>

## HOW DOES MANGANESE INTAKE AFFECT MY HEALTH?

Too much or too little manganese in your body can lead to health problems.

**Manganese deficiency:** Manganese deficiency is rare and symptoms are not well defined. Health effects observed in individuals with diets very low in manganese include skin rashes, slow nail growth, reduced bone density, loss of pigmentation in hair, and low cholesterol levels.<sup>2</sup>

**Manganese excess:** There are few reports of adverse health effects from people who ingest too much manganese from food and water.<sup>1</sup> Recent evidence reviewed by Health Canada indicates that high levels of manganese in drinking water may impact memory and learning, behaviour, and fine motor control in infants and young children.<sup>2,4</sup> Formula-fed infants may be more susceptible to health risks if water with high concentrations of manganese is used to prepare formula. This is because infant brains are rapidly developing, they drink more water in proportion to their body weight, and they absorb more manganese and are less able to remove

it from their bodies compared to other age groups.<sup>3</sup> For adults and older children, short term exposure to manganese in drinking water at levels slightly above the guideline is unlikely to cause negative health effects.<sup>3</sup>

Health Canada notes that exposure to manganese while showering (either through breathing in water vapour or absorption through skin) is likely to be negligible.<sup>2</sup>

## WHAT ARE THE LEVELS OF MANGANESE FOUND IN CANADIANS?

For most Canadians, diet is the main source of manganese. The Canadian Health Measures Survey (CHMS) is a national survey that collects information about the general health of Canadians and includes measurements of chemicals in blood and urine samples.<sup>5</sup> The objective of the chemical measurements in the CHMS survey is to establish baseline levels in the Canadian population. Given that manganese is an essential trace element, its presence in the blood and urine of Canadians is expected. Manganese in blood and urine can be interpreted as an indicator of exposure, but does not necessarily mean that health effects will occur.<sup>5</sup> Data collected from 2007 to 2011 for the CHMS found that the average levels of manganese measured in the blood of people in the Canadian population (aged 3 to 79) ranged from 8.8 – 11 µg/L.<sup>6</sup> More information on the CHMS and the levels of manganese in Canadians can be obtained by visiting the Canadian Biomonitoring Dashboard.<sup>6</sup>

## ARE THERE STANDARDS FOR MANGANESE IN DRINKING WATER?

The Ontario Drinking Water Standard (ODWS) published in 2006 sets an aesthetic objective for manganese in drinking water at 0.05 mg/L.<sup>7</sup> The aesthetic objective is not intended to prevent health effects (e.g., not a health-based standard), but instead is intended to prevent the discolouration and staining of fixtures, and the undesirable taste caused by higher levels of manganese in water.

The Canadian Drinking Water Guideline for manganese developed by Health Canada stipulates a maximum acceptable concentration (MAC) in drinking water of 0.12 mg/L and an aesthetic objective of 0.02 mg/L.<sup>2</sup> The MAC is a health-based value intended to be protective of neurological effects in infants, the most sensitive population, and therefore it is also protective for chronic exposure in children and adults.<sup>2</sup>

## ARE THERE OTHER STANDARDS OR GUIDELINE VALUES FOR MANGANESE?

The main source of exposure to manganese is via food, with grains, nuts and vegetables contributing the most to a person's daily intake of manganese. The average dietary intakes of manganese across all age groups according to the Canadian Total Diet Study (TDS) were estimated to range between 44.0 to 61.3 µg/kg of bodyweight per day (based on data gathered from different Canadian cities for the TDS).<sup>2</sup> Health Canada has also established Adequate Intake Levels for manganese ranging with age or lifestage from 0.003 to 2.6 mg/day and Tolerable Upper Intake Levels ranging from 2 to 11 mg/day.<sup>8</sup>

Infant formula sold in Canada is regulated to contain a minimum of 5 µg of manganese per 100 available kilocalories (equivalent to 3.33 µg per 100 mL of ready-to-feed formula); a maximum amount of manganese has not been set for infant formula.<sup>9</sup>

## HOW CAN I TELL IF MY DRINKING WATER HAS HIGH MANGANESE LEVELS?

Water testing is the only way to know if manganese is present. Although water with elevated levels of manganese may impart a bitter metallic taste, tint water purplish brown or black (water discolouration may occur at concentrations as low as 0.005 to 0.02 mg/L), and stain laundry and plumbing fixtures;<sup>2,10,11</sup> but these issues can also be caused by other chemicals.

## WHAT SHOULD I DO IF A HIGH LEVEL OF MANGANESE IS FOUND IN MY WELL WATER?

For households who do not obtain their drinking water from a municipal source, a residential drinking water treatment device may be an option to reduce manganese concentrations in drinking water. Options can be explored with professionals specialized in water treatment, but examples of treatment processes effective at removing manganese include reverse osmosis, ion exchange (including water softeners and other cation exchange systems) and oxidizing filters.<sup>2</sup> As with any water treatment system, it is important to follow the manufacturer's recommendations for operation and maintenance (e.g., replacement of filter media).

## REFERENCES

1. United States Environmental Protection Agency (US EPA). Drinking Water Health Advisory for Manganese [Internet]. 2004. Available from: [https://www.epa.gov/sites/default/files/2014-09/documents/support\\_cc1\\_magnese\\_dwreport\\_0.pdf](https://www.epa.gov/sites/default/files/2014-09/documents/support_cc1_magnese_dwreport_0.pdf)
2. Health Canada. Guidelines for Canadian Drinking Water Quality: Guideline Technical Document – Manganese [Internet]. 2019. Available from: <https://www.canada.ca/en/health-canada/services/publications/healthy-living/guidelines-canadian-drinking-water-quality-guideline-technical-document-manganese.html>
3. Health Canada. Water Talk - Manganese in drinking water [Internet]. 2023. Available from: <https://www.canada.ca/en/health-canada/services/environmental-workplace-health/reports-publications/water-quality/water-talk-manganese.html>
4. HealthLink British Columbia. Manganese in Drinking Water [Internet]. Available from: <https://www.healthlinkbc.ca/healthlinkbc-files/manganese-drinking-water>
5. Health Canada. Second Report on Human Biomonitoring of Environmental Chemicals in Canada: Manganese [Internet]. 2013. Available from: <https://www.canada.ca/en/health-canada/services/environmental-workplace-health/reports-publications/environmental->

COORD. SYS.: MTM ZONE 9      EASTING: 379616.40      NORTHING: 5018877.07      ELEVATION: 89.30

PROJECT: Proposed Commercial Development      FILE NO.: **PG7327**  
 BORINGS BY: CME-55 Low Clearance Drill  
 REMARKS:      DATE: November 11, 2024      HOLE NO.: **BH1-24**

SAMPLE DESCRIPTION	STRATA PLOT	DEPTH (m)	SAMPLE				PEN. RESIST. (BLOWS/0.3m) DCPT (50mm DIA. CONE)			PIEZOMETER CONSTRUCTION	ELEVATION (m)	
			TYPE AND NO.	RECOVERY (%)	N, Nc OR RQD	WATER CONTENT (%)	20	40	60			80
							△ REMOULDED SHEAR STRENGTH, $C_{ur}$ (kPa)	▲ PEAK SHEAR STRENGTH, $C_u$ (kPa)	PL (%)			WATER CONTENT (%)
							20	40	60			80
GROUND SURFACE		0										
<b>TOPSOIL</b> 0.10m [89.20m] FILL: Compact, grey silty fine sand to sandy silt, trace gravel		0	SS 1	62	3-8-7-7 15					89		
0.84m [88.46m] FILL: Compact, brown silty fine sand to sandy silt, topsoil, trace gravel		1	SS 2	60	6-50-/-/ 50/0.03					88		
1.12m [88.18m] End of Borehole  Practical refusal to augering at 1.12 m depth		1.12								88		
		2								87		
		3								86		
		4								85		
		5								84		
		6								84		

P:/AutoCAD Drawings/Test Hole Data Files/PG7327/data/sqlite 2024-11-14, 14:08 Paterson\_Template KS

COORD. SYS.: MTM ZONE 9      EASTING: 379637.62      NORTHING: 5018860.97      ELEVATION: 89.58

PROJECT: Proposed Commercial Development      FILE NO.: **PG7327**

BORINGS BY: CME-55 Low Clearance Drill

REMARKS:      DATE: November 11, 2024      HOLE NO.: **BH2-24**

SAMPLE DESCRIPTION	STRATA PLOT	DEPTH (m)	SAMPLE				PEN. RESIST. (BLOWS/0.3m) DCPT (50mm DIA. CONE)			MONITORING WELL CONSTRUCTION	ELEVATION (m)	
			TYPE AND NO.	RECOVERY (%)	N, Nc OR RQD	WATER CONTENT (%)	20	40	60			80
							▲ REMOULDED SHEAR STRENGTH, $C_{ur}$ (kPa) ▲ PEAK SHEAR STRENGTH, $C_u$ (kPa)					
			PL (%)		WATER CONTENT (%)		LL (%)					
GROUND SURFACE		0										
TOPSOIL and organics 0.10m [89.48m] FILL: Loose, grey silty fine sand to sandy silt		0 to 0.10	SS 1	50	2-3-3-4 6					89.48		
1.27m [88.31m] End of Borehole Practical refusal to augering at 1.27 m depth		0 to 1.27	SS 2	62	4-4-50-/ 54/0.1					88.31		

P:/AutoCAD Drawings/Test Hole Data Files/PG7327/data/sqlite 2024-11-14, 14:08 Paterson\_Template KS

COORD. SYS.: MTM ZONE 9      EASTING: 379649.37      NORTHING: 5018891.13      ELEVATION: 89.68

PROJECT: Proposed Commercial Development      FILE NO.: **PG7327**  
 BORINGS BY: CME-55 Low Clearance Drill  
 REMARKS:      DATE: November 11, 2024      HOLE NO.: **BH3-24**


SAMPLE DESCRIPTION	STRATA PLOT	DEPTH (m)	SAMPLE				PEN. RESIST. (BLOWS/0.3m) DCPT (50mm DIA. CONE)			PIEZOMETER CONSTRUCTION	ELEVATION (m)	
			TYPE AND NO.	RECOVERY (%)	N, Nc OR RQD	WATER CONTENT (%)	20	40	60			80
							△ REMOULDED SHEAR STRENGTH, $C_{ur}$ (kPa)	△ PEAK SHEAR STRENGTH, $C_u$ (kPa)	PL (%)			WATER CONTENT (%)
							20	40	60			80
GROUND SURFACE		0										
FILL: Compact, brown silty fine sand to sandy silt with gravel, trace topsoil and organics 0.30m [89.38m]		0	SS 1	71	3-7-7-6 14							
FILL: Compact, grey silty fine sand to sandy silt 0.86m [88.82m]		0.30	SS 2	51	50-/-/- 50/0.05					89		
End of Borehole		1										
Practical refusal to augering at 0.86 m depth		1										
		2										
		3										
		4										
		5										
		6										

DISCLAIMER: THE DATA PRESENTED IN THIS LOG IS THE PROPERTY OF PATERSON GROUP AND THE CLIENT FOR WHO IT WAS PRODUCED. THIS LOG SHOULD BE READ IN CONJUNCTION WITH ITS COORESPONDING REPORT. PATERSON GROUP IS NOT RESPONSIBLE FOR THE UNAUTHORIZED USE OF THIS DATA. PAGE: 1 / 1

P:/AutoCAD Drawings/Test Hole Data Files/PG7327/data/sqlite 2024-11-14, 14:08 Paterson\_Template KS


**Pumping Test Analysis Report**

File No.	PH4991	Well ID:	TW1
Date:	March 4, 2025	Solution Method:	<b>Theis</b>
Client:	Titan Environmental	Transmissivity (m <sup>2</sup> /day):	51
Site Address:	541 Somme Street	Storativity	0.0003793
Project:	Site Plan Control Application	Discharge Rate (L/min)	57
		Analysis performed by:	AS

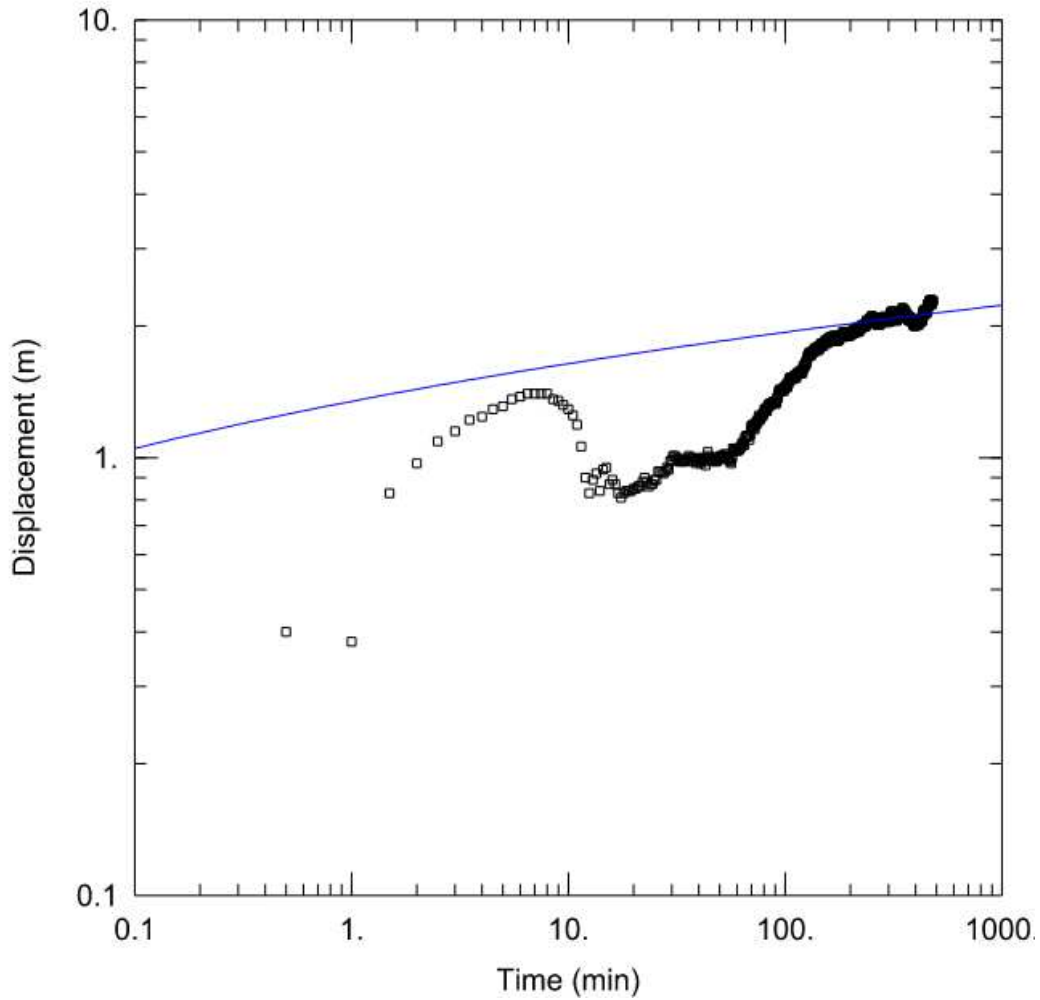

**Pumping Test Analysis Report**

File No.	PH4991	Well ID:	TW1
Date:	March 4, 2025	Solution Method:	<b>Cooper-Jacob</b>
Client:	Titan Environmental	Transmissivity (m <sup>2</sup> /day):	53
Site Address:	541 Somme Street	Storativity	0.0003083
Project:	Site Plan Control Application	Discharge Rate (L/min)	57
		Analysis performed by:	AS

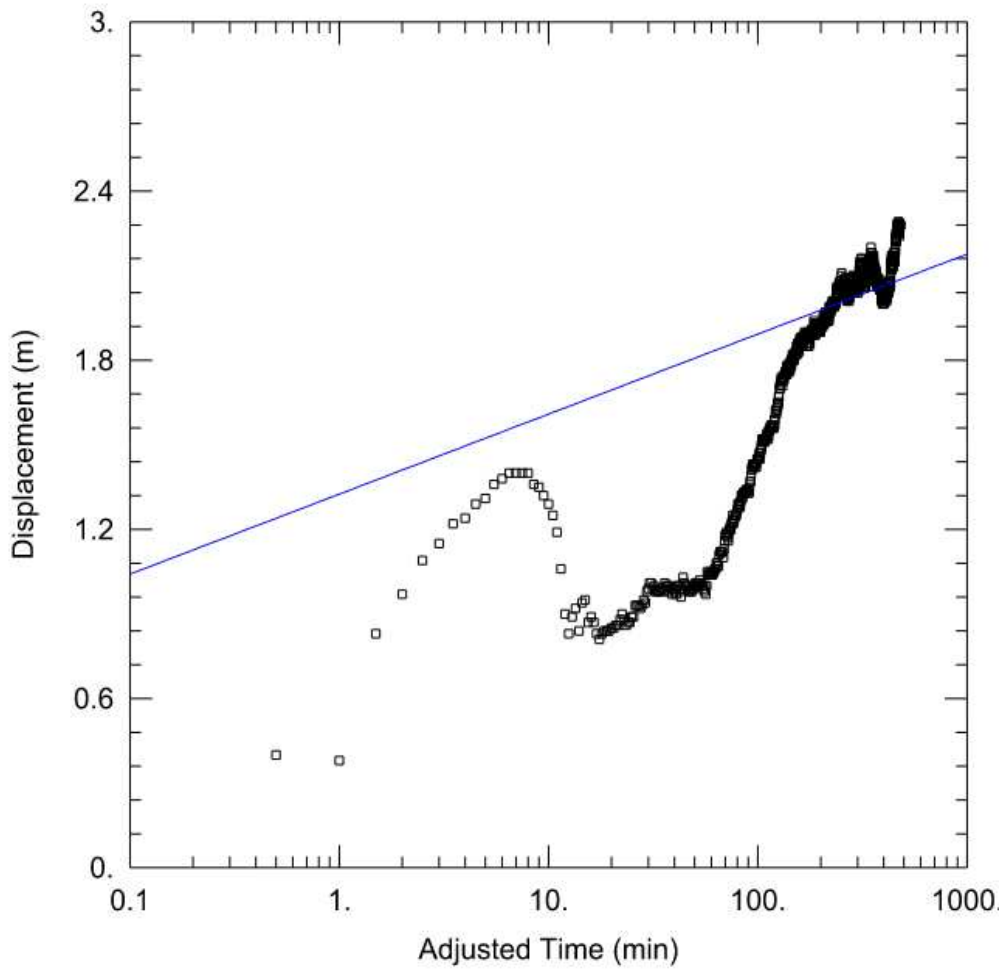

**Pumping Test Analysis Report**

File No. PH4991  
 Date: March 4, 2025  
 Client: Titan Environmental  
 Site Address: 541 Somme Street  
 Project: Site Plan Control Application


Summary Table:			
Solution Method:	Well ID:	Transmissivity (m <sup>2</sup> /day):	
Theis	TW1	51	
Cooper-Jacob	TW1	53	
Average:		<b>52.00</b>	

Summary Table:			
Solution Method:	Well ID:	Storativity	
Theis	TW1	3.79E-04	
Cooper-Jacob	TW1	3.08E-04	
Average:		<b>3.44E-04</b>	

<b>PREDICTIVE NITRATE IMPACT ASSESSEMENT</b>		
<b>Infiltration Factors</b>		
Topography	0.30	
Soil	0.30	
Cover	0.10	
<b>Total</b>	<b>0.70</b>	
<b>Site Characteristics</b>		
Area of Site :	8014	m <sup>2</sup>
Total of roof areas:	415	m <sup>2</sup>
Total area of paved driveway areas:	4034	m <sup>2</sup>
Roof + paved driveway areas	4449	m <sup>2</sup>
Impervious Area	4449	m <sup>2</sup>
Percent Impervious Area =	56	%
Infiltration Area =	3565	m <sup>2</sup>
<b>Septic Effluent</b>		
Concentration of Effluent (Cs) =	20	mg/L
<b>Infiltration Calculation</b>		
Nitrate concentration in precipitation (C <sub>i</sub> ) =	0	mg/L
Surplus Water (Environment Canada)	378	mm/yr
Factored Water Surplus =	265	mm/yr
Infiltration % due to stormwater management measures	-	%
Infiltration rate from stormwater management measures =	0	mm/yr
Infiltration Flow Entering the System (Q <sub>i</sub> ) =	3	m <sup>3</sup> /day
<b>Mass Balance Model (MOEE, 1995)</b>		
$C_T = (Q_b C_b + Q_e C_e + Q_i C_i) / (Q_b + Q_e + Q_i)$ = Cumulative Nitrate Concentration		
Q <sub>b</sub> = flow entering the system across the upgradient area	0	m <sup>3</sup> /day
C <sub>b</sub> = background nitrate concentration	0	mg/L
Q <sub>e</sub> = flow entering the system from the septic drainfield	1.1	m <sup>3</sup> /day
C <sub>e</sub> = concentration of nitrates in the septic effluent	20	mg/L
Q <sub>i</sub> = flow entering the system from infiltration	3	m <sup>3</sup> /day
C <sub>i</sub> = Concentration of nitrates in the infiltrate	0	mg/L
<b>C<sub>T</sub> =</b>	<b>5.97</b>	<b>mg/L</b>
<b>Maximum Allowable Sewage Flow Volume</b>		
Daily Sewage Flow (Q <sub>s</sub> )=	1.1	m <sup>3</sup>
<i>Notes: Site characteristic values were measured as approximate values from the available site plans and GeoOttawa.</i>		

MW1 inputs			
pH	7.85	A	0.20
TDS	995	B	2.42
Calcium	188	C	1.87
Alkalinity	570	D	2.76
Temp.	8.1		
		pHs =	7.290695309

Langelier Saturation Index (LSI) Calculation		(Langelier, 1936)
LSI = pH - pHs	A = (Log10 [TDS] - 1) / 10	
pHs = (9.3 + A + B) - (C + D)	B = -13.12 x Log10 (oC + 273) + 34.55	
Where:	C = Log10 [Ca <sup>2+</sup> as CaCO <sub>3</sub> ] - 0.4	
	D = Log10 [alkalinity as CaCO <sub>3</sub> ]	
		LSI = <b>0.6</b>
LSI	Effect	
0.5 to 2	Water is super saturated and tends to precipitate a scale layer of calcium carbonate (scale forming but non-corrosive)	
<b>0 to 0.5</b>	<b>Water is super saturated and tends to precipitate a scale layer of calcium carbonate (slightly scale forming and corrosive).</b>	
0	Water is saturated (in equilibrium) with calcium carbonate. A scale layer of calcium carbonate is neither precipitated nor dissolved.	
0 to -0.5	Water is under saturated and tends to dissolve solid calcium carbonate (slightly corrosivebut non-scale forming).	
-0.5 to -2	Water is under saturated and tends to dissolve solid calcium carbonate (seriously corrosive).	

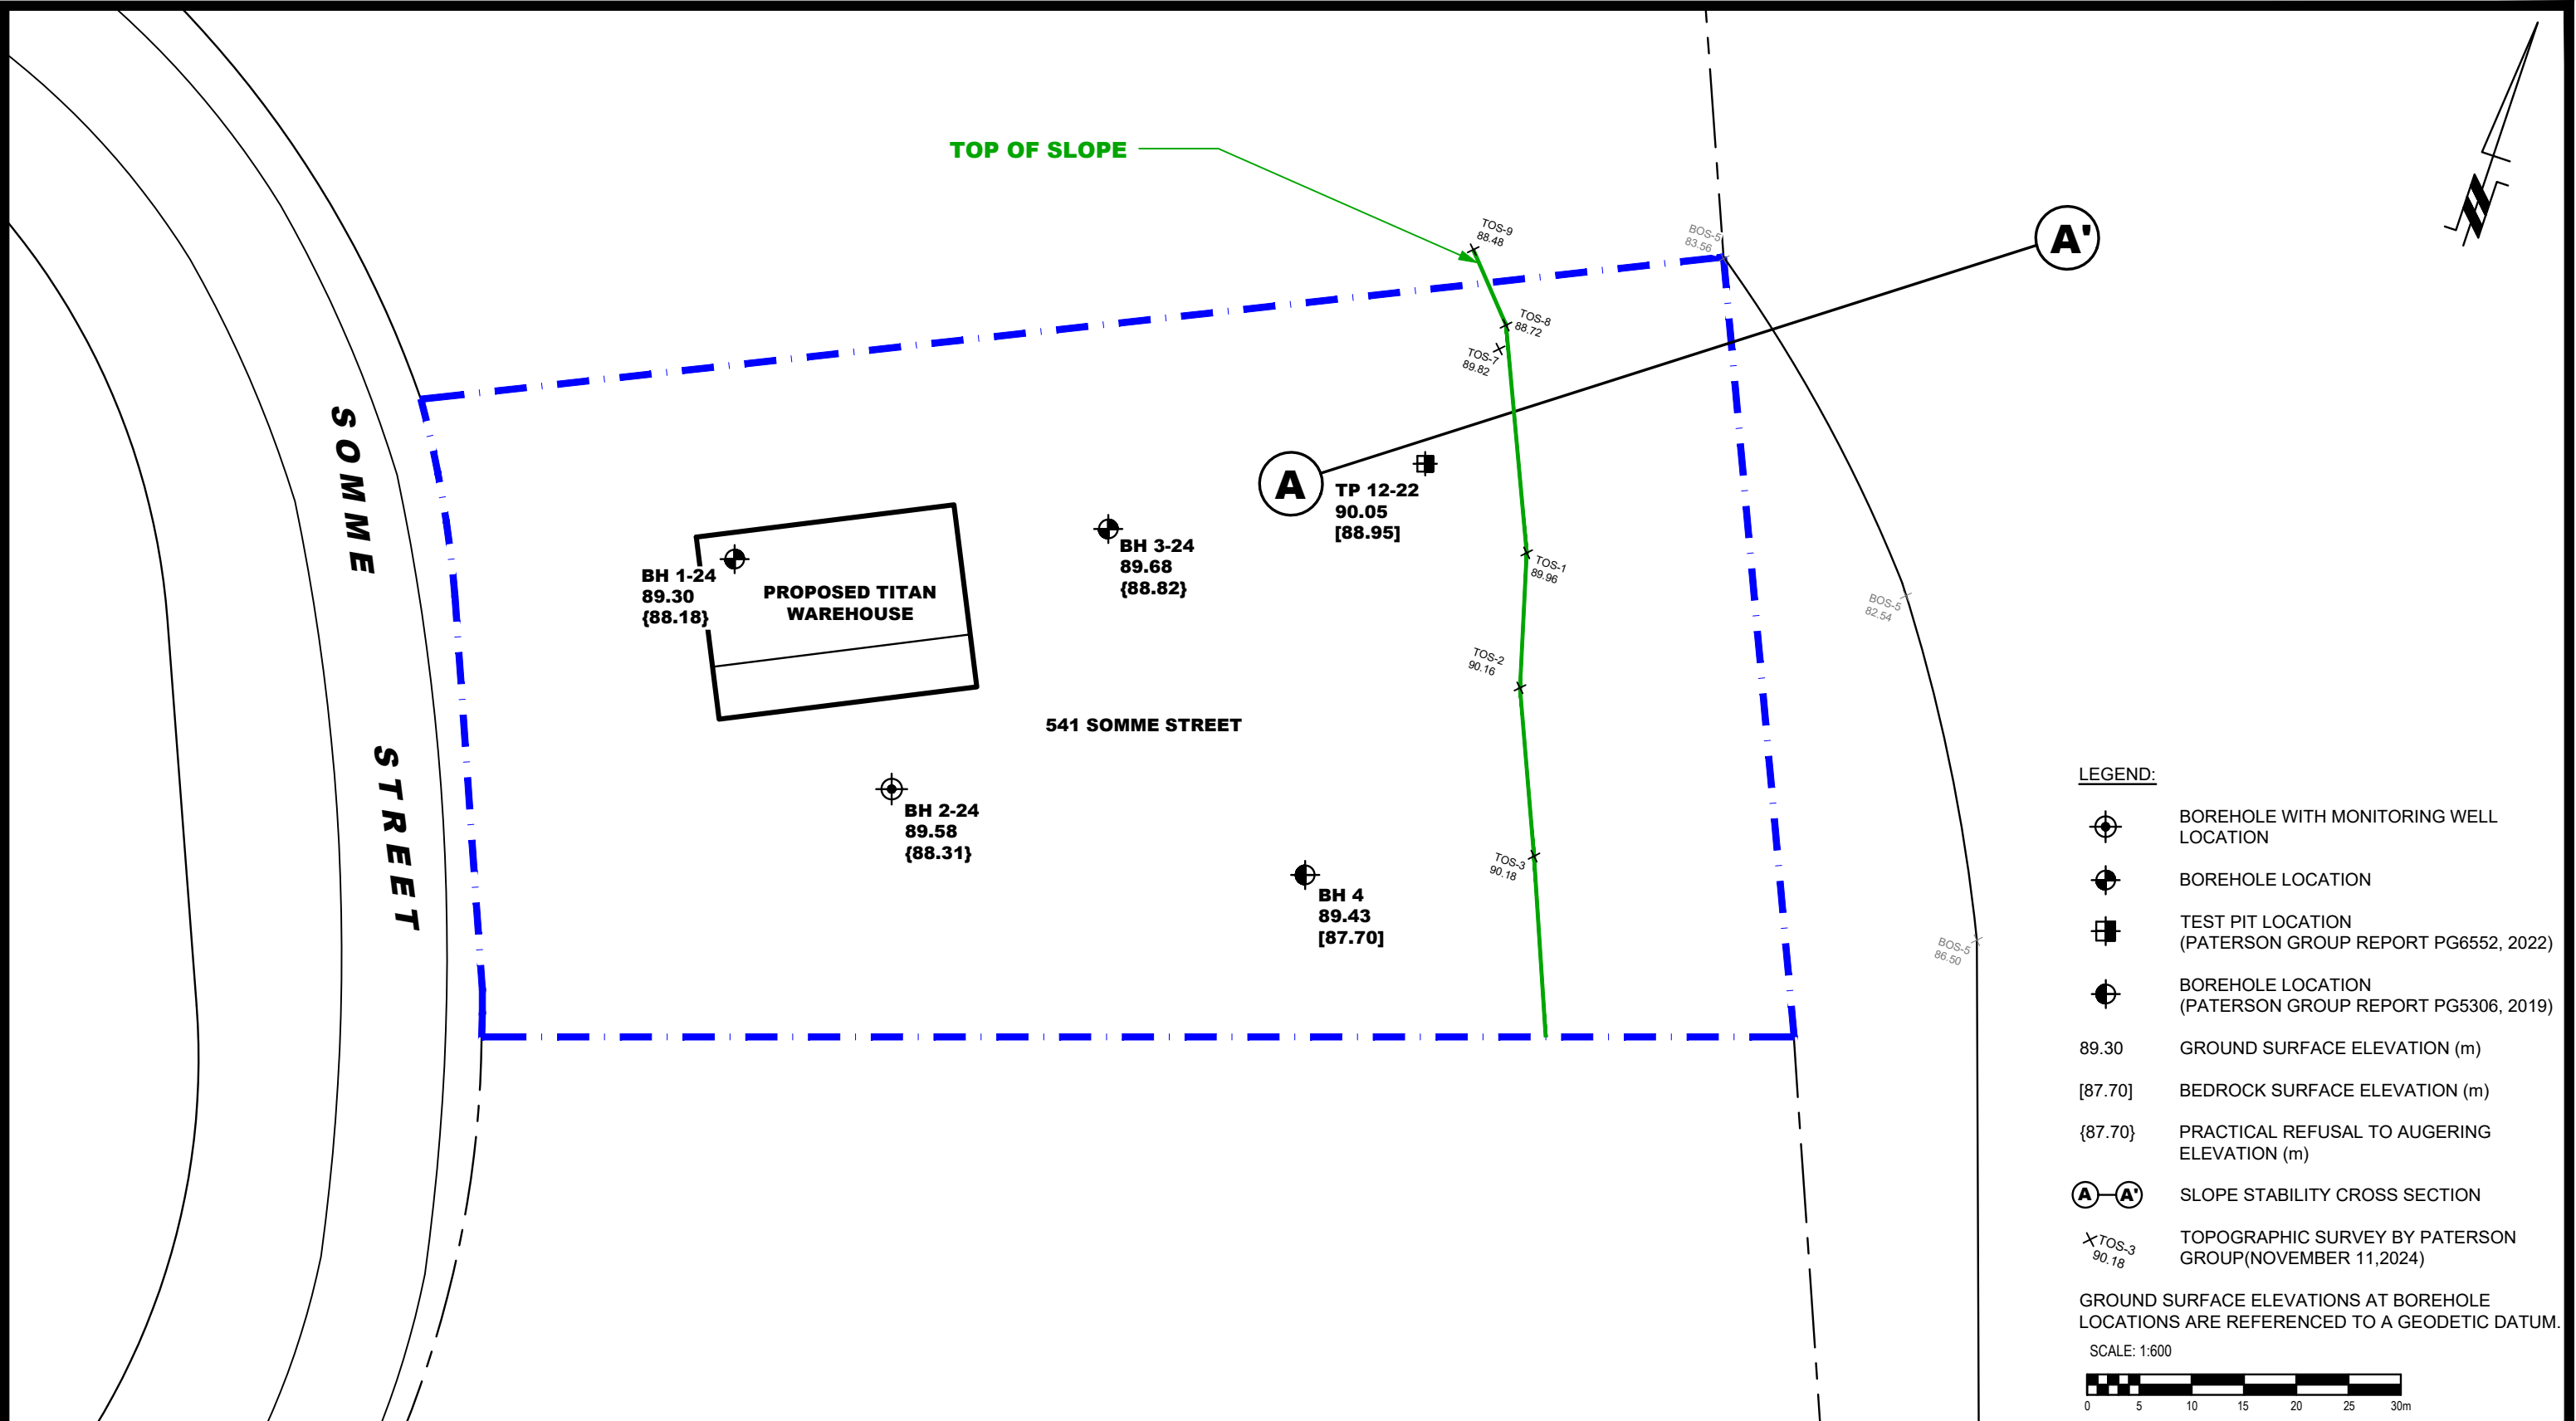

NO.	REVISIONS	DATE	INITIAL

OTTAWA,  
Title:

**TITAN ENVIRONMENTAL CONTAINMENT  
GEOTECHNICAL INVESTIGATION  
PROPOSED COMMERCIAL DEVELOPMENT  
541 SOMME STREET**

**TEST HOLE LOCATION PLAN**

ONTARIO

Scale:	1:600	Date:	11/2024
Drawn by:	GK	Report No.:	PG7327-1
Checked by:	PB	Dwg. No.:	<b>PG7327-1</b>
Approved by:	SD	Revision No.:	