

PROJECT INFORMATION table with columns for DRAWING NO., PROJECT NO., PRODUCT, MANAGER, ADS SALES REP, PROJECT NO., ONTARIO SITE COORDINATION.




OTC ZEB NEW GARAGE OTTAWA, ON.

MC-3500 STORMTECH CHAMBER SPECIFICATIONS



- 1. CHAMBER SHALL BE IDENTIFIED AS MC-3500.
2. CHAMBERS SHALL BE ARCH-BARRIED AND SHALL BE MANUFACTURED FROM VIRGIN, IMPACT-MODIFIED POLYPROPYLENE COPOLYMERS.
3. CHAMBERS SHALL BE CERTIFIED TO CSA B148, 'POLYMER SUBSURFACE STORMWATER MANAGEMENT STRUCTURES' AND MEET THE REQUIREMENTS OF ASTM F418, 'STANDARD SPECIFICATION FOR POLYPROPYLENE (PP) CORRUGATED WALL STORMWATER COLLECTION CHAMBERS' CHAMBER CLASSIFICATION AND DESIGNATIONS.
4. CHAMBERS SHALL PROVIDE CONTINUOUS UNOBSTRUCTED INTERNAL SPACE WITH NO INTERNAL SUPPORTS THAT WOULD IMPED FLOW OR LIMIT ACCESS FOR INSPECTION.
5. THE STRUCTURAL DESIGN OF THE CHAMBERS, THE STRUCTURAL BACKFILL AND THE INSTALLATION REQUIREMENTS SHALL ENSURE THAT THE LOAD FACTORS SPECIFIED IN THE ARCH DUBRO BRIDGE DESIGN SPECIFICATIONS, SECTION 12.12, ARE MET FOR: 1. LONG-DURATION (DL) LOADS AND 2. SHORT-DURATION (SD) LOADS BASED ON THE CSA B148 65 TRUCK AND THE ARCH DUBRO DESIGN TRUCK WITH CONSIDERATION FOR IMPACT AND MULTIPLE VEHICLE PRESENCES.
6. CHAMBERS SHALL BE DESIGNED, TESTED AND ALLOWABLE LOAD CAPACITIES DETERMINED IN ACCORDANCE WITH ASTM F229, 'STANDARD PRACTICE FOR STRUCTURAL DESIGN OF THERMOPLASTIC CORRUGATED WALL STORMWATER COLLECTION CHAMBERS'. LOAD CAPACITIES SHALL RELLECT THE TRAFFIC LOADS (1.8M AGHS) DESIGN TRUCK LOAD ON MINIMUM COVER OVER CHAMBER PERMANENT (75% R) COVER LOAD AND 5. ALLOWABLE COVER WITH PARKED (1-WEEK) ASHTRIO DESIGN TRUCK.
7. REQUIREMENTS FOR HANDLING AND INSTALLATION.
8. CHAMBERS AND END CAPS SHALL BE PRODUCED AT AN ISO 9001 CERTIFIED MANUFACTURING FACILITY.
9. MANUFACTURER SHALL BE RESPONSIBLE FOR OBTAINING PERMITS. SEE TECHNICAL NOTE 8.2 FOR MANHOLE BONDING SUBSTANCE. DUE TO THE ADAPTATION OF THIS CHAMBER SYSTEM TO SPECIFIC SITE AND DESIGN CONSTRAINTS, IT MAY BE NECESSARY TO CUT AND CORRECT ADDITIONAL ITEMS TO STANDARD MANHOLE COMPONENTS IN THE FIELD.
10. ADS DOES NOT DESIGN OR PROVIDE MEMBRANE LINER SYSTEMS. TO MINIMIZE THE LEAKAGE POTENTIAL OF LINER SYSTEMS, THE MEMBRANE LINER SHOULD BE DESIGNED BY A KNOWLEDGEABLE GEOTECHNICAL PROFESSIONAL AND INSTALLED BY A QUALIFIED CONTRACTOR.

PROPOSED LAYOUT and PROPOSED ELEVATIONS tables with columns for STATIONING, ELEVATION, and SYSTEM PARAMETERS.

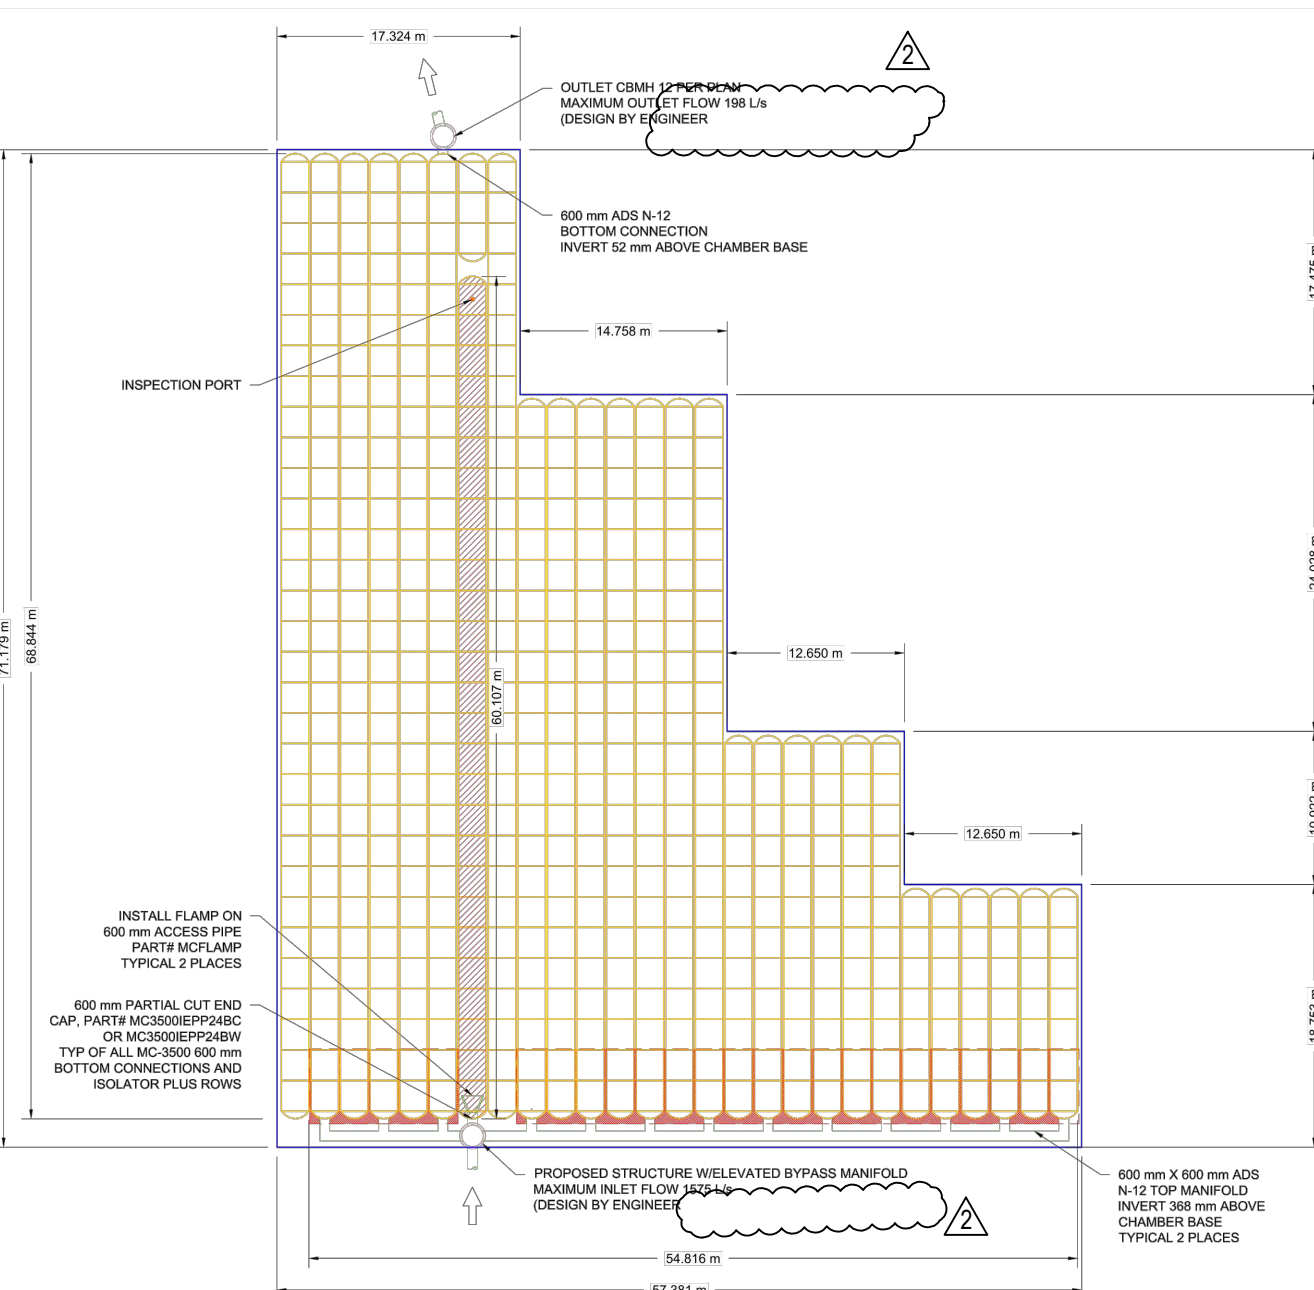

ACCEPTABLE FILL MATERIALS: STORMTECH MC-3500 CHAMBER SYSTEMS

Table with columns: MATERIAL LOCATION, DESCRIPTION, AASHTO MATERIAL CLASSIFICATIONS, COMPACTION / DENSITY REQUIREMENT.

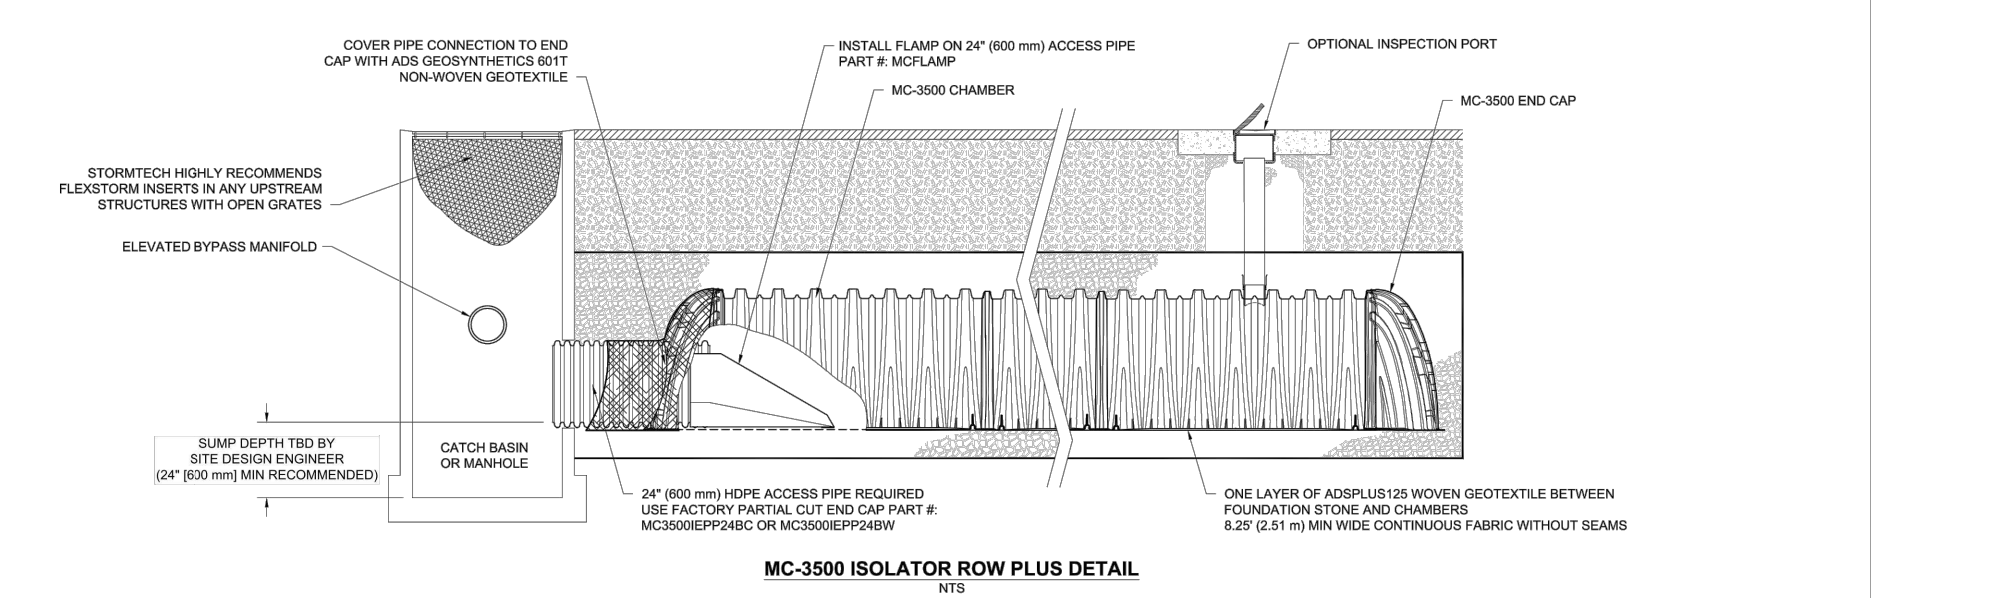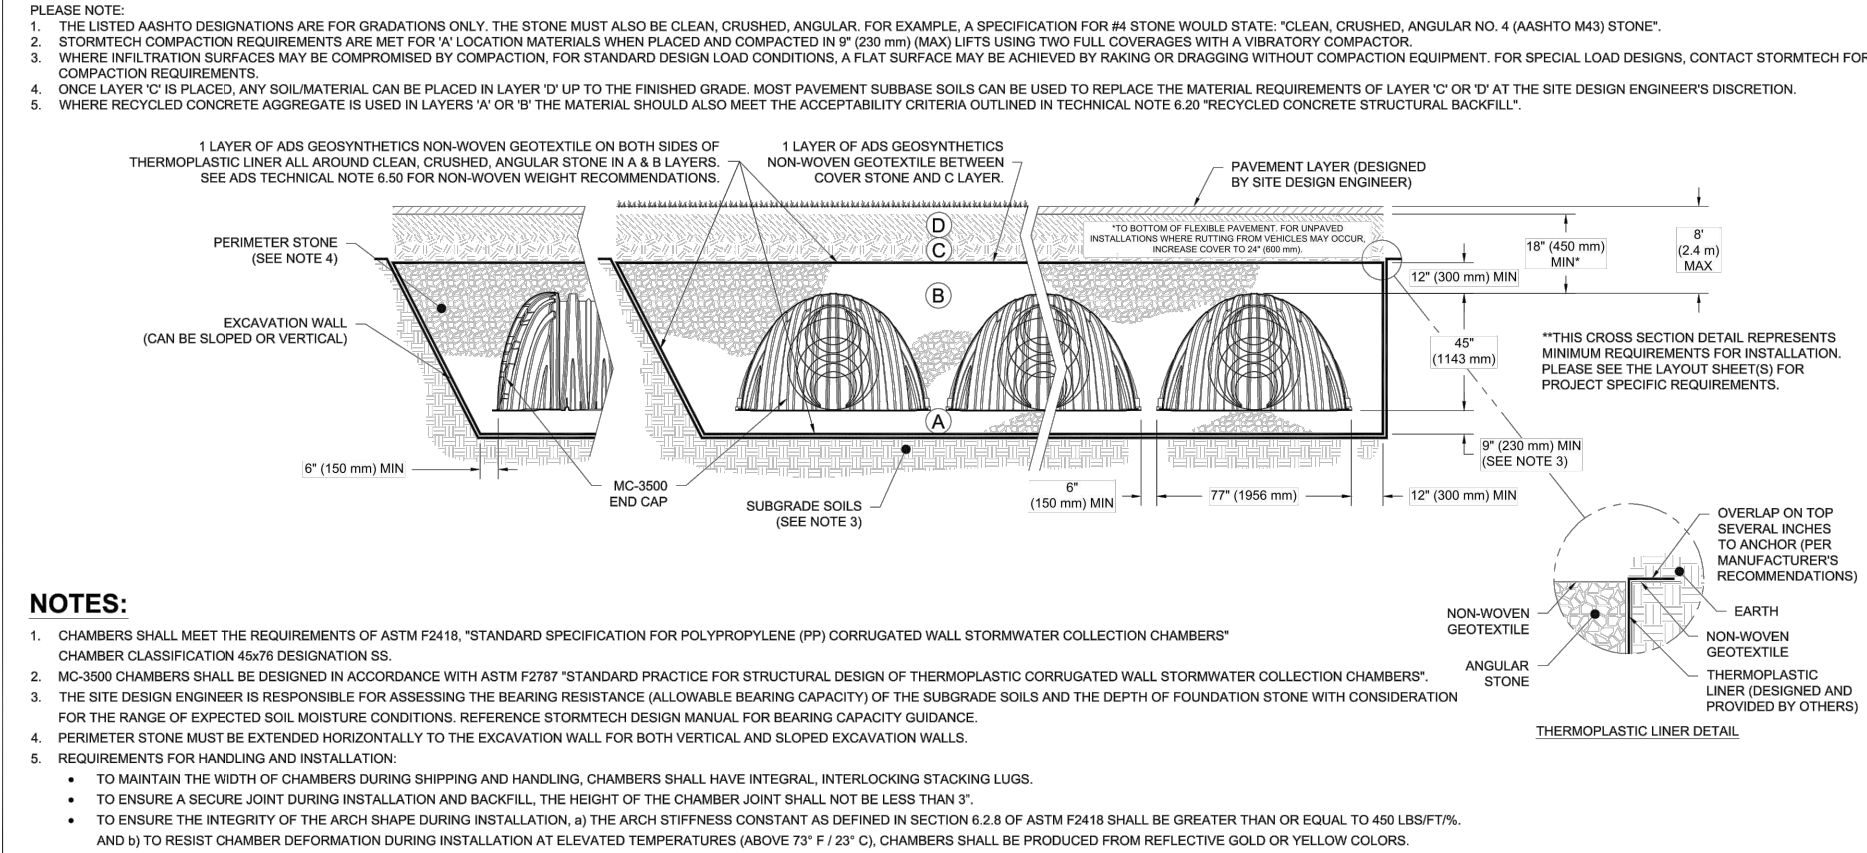


INSPECTION & MAINTENANCE

- STEP 1) INSPECT ISOLATOR ROW PLUS FOR SEDIMENT.
A.1. REMOVE COVER FROM ISOLATOR ROW PLUS.
A.2. REMOVE AND CLEAN FLEXTON FROM FILTER IF INSTALLED.
A.3. REMOVE SEDIMENT FROM ISOLATOR ROW PLUS.
A.4. LOWER CAMERA INTO ISOLATOR ROW PLUS FOR VISUAL INSPECTION OF SEDIMENT LEVELS (OPTIONAL).
A.5. REMOVE CAMERA FROM ISOLATOR ROW PLUS.
B.1. REMOVE COVER FROM STRUCTURE AT UPSTREAM END OF ISOLATOR ROW PLUS.
B.2. REMOVE COVER FROM STRUCTURE AT DOWNSTREAM END OF ISOLATOR ROW PLUS.
B.3. IF SEDIMENT IS AT OR ABOVE 3" (80 mm) PROCEED TO STEP 2. IF NOT, PROCEED TO STEP 3.
STEP 2) CLEAN ONLY ISOLATOR ROW PLUS WITH HIGH PRESSURE WATER.
A. A FROZEN CLEANING NOZZLE WITH REAR FACING SPREAD OF 45° (1.1 m) OR MORE IS PREFERRED.
A.1. WIPER MULTIPLE PASSES BY JETTING TO REMOVE ALL SEDIMENT.
A.2. WASH DOWN STRUCTURE WITH CLEAN WATER.
A.3. WASH DOWN STRUCTURE WITH CLEAN WATER.
STEP 3) REPLACE ALL COVERS, GRATES, FILTERS, AND END CAPS. RECORD OBSERVATIONS AND ACTIONS.


NOTES

- 1. INSPECT EVERY 6 MONTHS DURING THE FIRST YEAR OF OPERATION. ADJUST THE INSPECTION INTERVAL BASED ON PREVIOUS OBSERVATIONS OF SEDIMENT ACCUMULATION AND HIGH WATER LEVELS.
2. CONDUCT JETTING AND VACUUMING ANNUALLY OR WHEN INSPECTION SHOWS THAT MAINTENANCE IS NECESSARY.

MC-3500 TECHNICAL SPECIFICATION

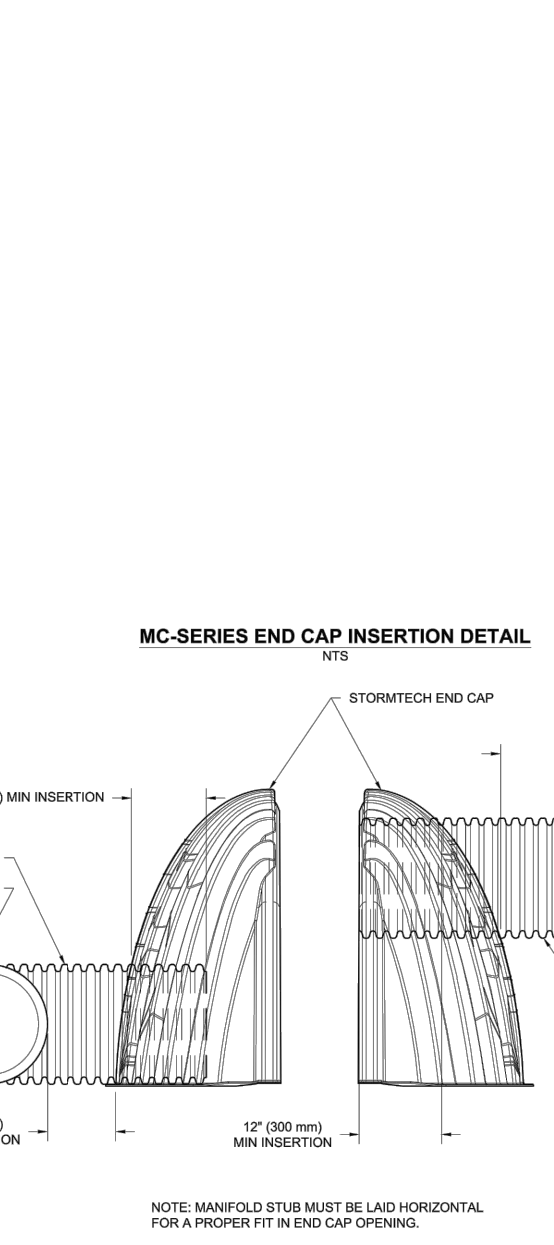


MC-SERIES END CAP INSERTION DETAIL

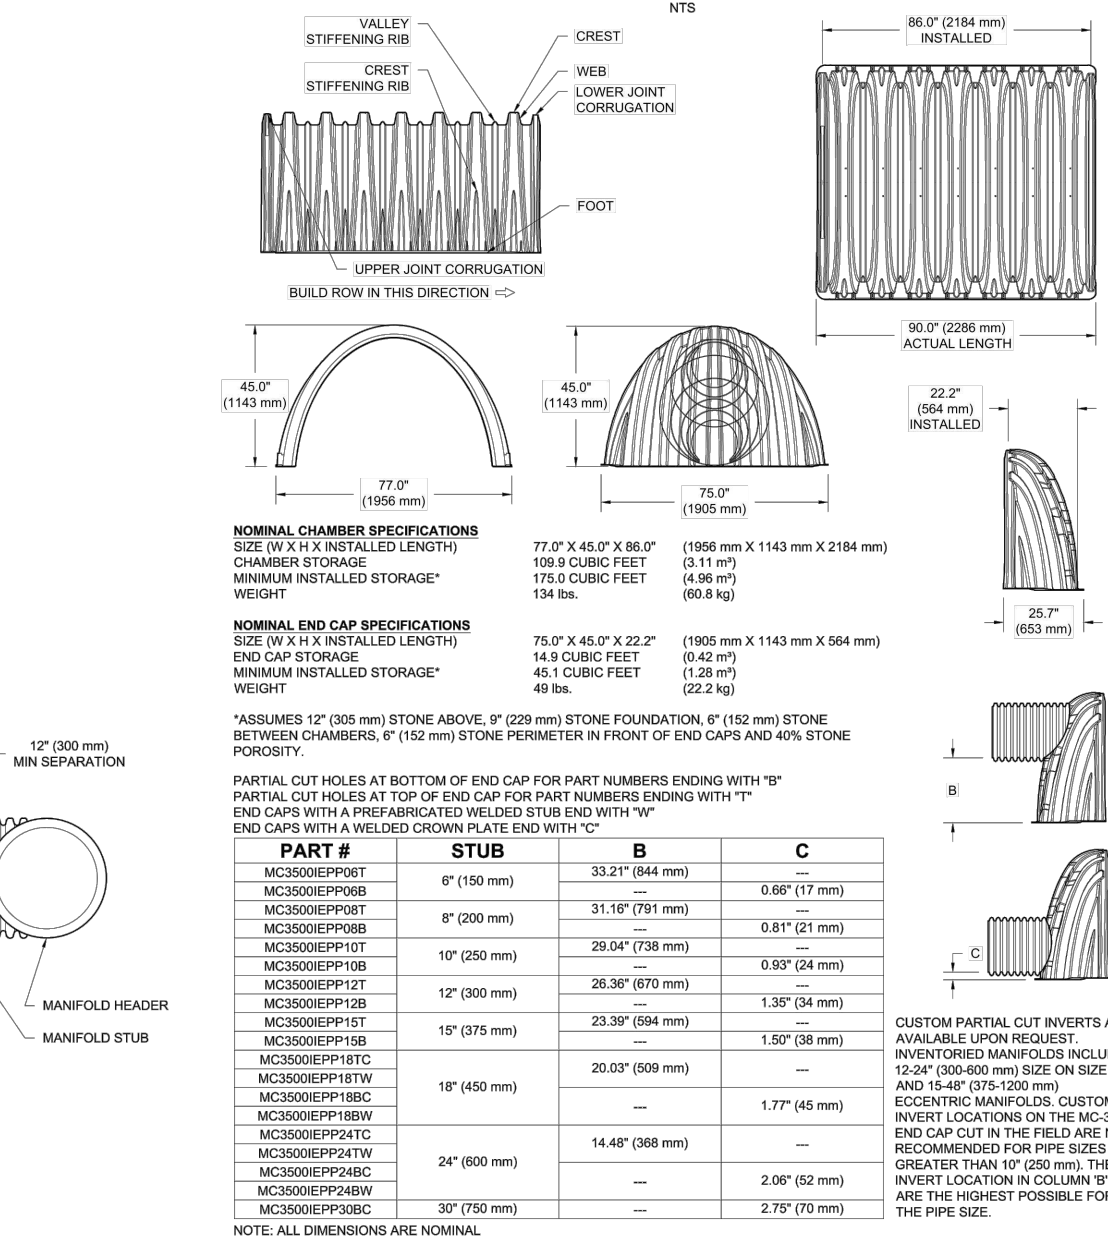

NOTES

- 1. CHAMBERS SHALL MEET THE REQUIREMENTS OF ASTM F418, 'STANDARD SPECIFICATION FOR POLYPROPYLENE (PP) CORRUGATED WALL STORMWATER COLLECTION CHAMBERS' CHAMBER CLASSIFICATION AND DESIGNATIONS.
2. MC-3500 CHAMBERS SHALL BE DESIGNED IN ACCORDANCE WITH ASTM F229, 'STANDARD PRACTICE FOR STRUCTURAL DESIGN OF THERMOPLASTIC CORRUGATED WALL STORMWATER COLLECTION CHAMBERS'.
3. THE SITE DESIGN ENGINEER IS RESPONSIBLE FOR ADDRESSING THE BEARING CAPACITY OF THE SUBGRADE SOIL AND THE DEPTH OF FOUNDATION STONE WITH CONSIDERATION FOR THE RANGES OF EXPECTED SOIL MOISTURE CONDITIONS. REFERENCE TO STANDARD DESIGN MANUAL FOR BEARING CAPACITY GUIDANCE.
4. PERIMETER STONE MUST BE INSTALLED HORIZONTAL TO THE EXCAVATION WALL FOR BOTH VERTICAL AND SLOPED EXCAVATION WALLS.
5. REQUIREMENTS FOR HANDLING AND INSTALLATION:
- TO MAINTAIN THE WIDTH OF CHAMBERS DURING SHIPPING AND HANDLING, CHAMBERS SHALL HAVE INTERNAL, INTERLOCKING STACKING LUGS.
- TO ENSURE A SECURE JOINT DURING INSTALLATION AND BACKFILL, THE HEIGHT OF THE CHAMBER JOINT SHALL NOT BE LESS THAN 1/2" (12.7 mm).
- TO ENSURE THE INTEGRITY OF THE ARCH SHAPE DURING INSTALLATION, THE ARCH STIFFNESS CONSTANT AS DEFINED IN SECTION 2.8.8 OF ASTM F418 SHALL BE GREATER THAN OR EQUAL TO 40-180 LB/FT-LIN.
- AND TO TEST CHAMBER STIFFNESS DURING INSTALLATION AT ELEVATED TEMPERATURES ABOVE 77 °F (25 °C), CHAMBERS SHALL BE PRODUCED FROM REFLECTIVE GOLD OR YELLOW COLORED.

INLET CONTROL DEVICE 1 ORIFICE PLATE DETAIL




INLET CONTROL DEVICE 2 ORIFICE PLATE DETAIL



INLET CONTROL DEVICE 3 ORIFICE PLATE DETAIL



MUD MAT DETAIL

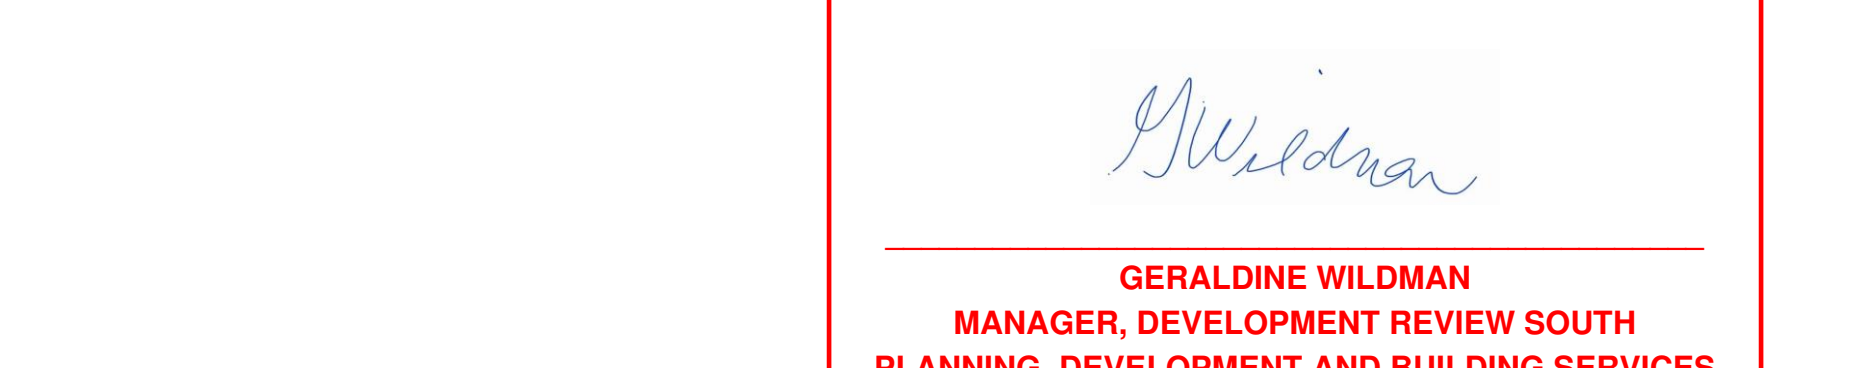

APPROVED By wildmange at 9:51 pm, Jun 04, 2026. GERALDINE WILDMAN, MANAGER, DEVELOPMENT REVIEW SOUTH PLANNING, DEVELOPMENT AND BUILDING SERVICES DEPARTMENT, CITY OF OTTAWA.



SERVICES D'INFRASTRUCTURE DIRECTION DE CONCEPTION ET DE CONSTRUCTION FOR / POUR Client - Department Infrastructure and Water Services Department Design & Construction




PRIME: AECOM Canada Architects Ltd. 50 Spadina Avenue, Suite 2900, Toronto, Ontario, M5P 2P4



NOTE: IT IS THE RESPONSIBILITY OF THE CONTRACTORS TO INFORM THEMSELVES OF THE EXACT LOCATION OF AND ASSUME ALL LIABILITY FOR DAMAGE TO ALL UTILITIES, SERVICES AND STRUCTURES WHETHER ABOVE GROUND OR BELOW GRADE BEFORE COMMENCING THE WORK. SUCH INFORMATION IS NOT ACCURATELY SHOWN ON THE DRAWING, AND WHERE SHOWN, THE ACCURACY CANNOT BE GUARANTEED. WITH THE SOLE EXCEPTION OF THE RECOMMENDED SPECIFICALLY DESCRIBED FOR THIS PROJECT, NO ELEVATION INDICATED OR ASSUMED HEREON IS TO BE USED AS A REFERENCE ELEVATION FOR ANY PURPOSE.

Revision table with columns: NO., REVISION, DATE, INITIALS.

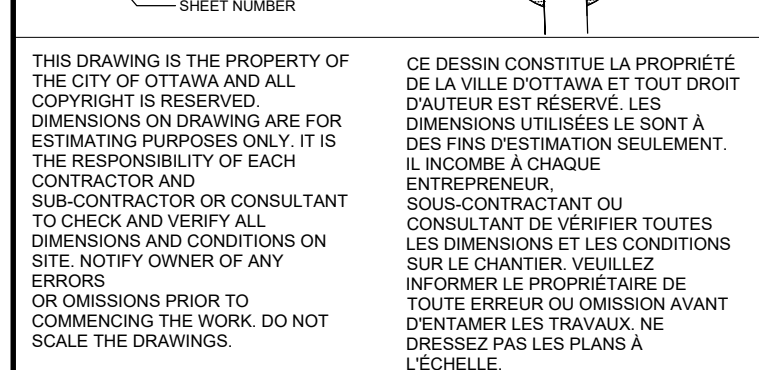

THIS DRAWING IS THE PROPERTY OF THE CITY OF OTTAWA AND ALL COPYRIGHT IS RESERVED. DIMENSIONS ON DRAWINGS ARE FOR ESTIMATING PURPOSES ONLY. IT IS THE RESPONSIBILITY OF EACH CONTRACTOR AND SUB-CONTRACTOR OR CONSULTANT TO CHECK AND VERIFY ALL DIMENSIONS AND CONDITIONS ON SITE. NOTIFY OWNER OF ANY ERRORS OR OMISSIONS PRIOR TO COMMENCING THE WORK. DO NOT SCALE THE DRAWINGS.

ARCHITECT / ARCHITECTE CONSULTANT / EXPERT-CONSEIL CONSULTANT / EXPERT-CONSEIL

PROJECT / LOCATION / PROJET / ENDROIT OTC ZEB-New Garage

Enter address here, OTTAWA, ONTARIO DRAWING / DESSIN STORMWATER STORAGE AND INLET CONTROL DETAILS

BUSINESS ENTITY / NUMÉRO DE L'ENTITÉ BUILDING NUMBER / NUMÉRO DU BATIMENT OMF1 CITY PROJECT NO. / NUMÉRO DE PROJET 60716350 CONS. PROJECT NO. / NUMÉRO DE PROJET SHEET NO. / FEUILLE NO. C012