

LEGEND

- SITE BOUNDARY
- PROPOSED STORM MANHOLE & SEWER
- PROPOSED SANITARY MANHOLE & SEWER
- PROPOSED WATERMAIN
- PROPOSED VALVE & VALVE BOX
- PROPOSED CURB STOP LOCATION
- PROPOSED DISTRICT METERING AREA (DMA) CHAMBER (AS PER CITY OF OTTAWA DETAIL W3.3)
- PROPOSED HYDRANT AND VALVE & VALVE BOX
- PROPOSED TWSI AS PER CITY OF OTTAWA DETAIL SC7.2
- PROPOSED TREES
- PROPOSED CURB INLET CATCHBASIN
- PROPOSED CATCHBASIN
- PROPOSED CATCHBASIN MANHOLE
- PROPOSED REAR YARD ELBOW
- PROPOSED REAR YARD TEE
- PROPOSED PRESSURE REDUCING VALVE
- EXISTING STORM MANHOLE AND SEWER
- EXISTING SANITARY MANHOLE AND SEWER
- EXISTING WATERMAIN
- EXISTING UNDERGROUND GAS
- EXISTING VALVE AND VALVE BOX
- EXISTING FIRE HYDRANT
- EXISTING CATCHBASIN
- EXISTING TOP OF GRATE
- EXISTING HYDRAULIC GRADE LINE
- EXISTING UTILITY POLE C/W/G WIRES
- EXISTING STREETLIGHT


NOTE: BUILDING SERVICES TO BE 150mmØ SANITARY, 150mmØ STORM AND 38mmØ WATERMAIN.

PROPOSED RETAINING WALL

NORTH

KEY PLAN

SITE BENCHMARK REFERENCED TO LOCAL GEODETIC DATUM
 N: 5015148.638
 E: 354367.4350
 ELEV: 98.10m

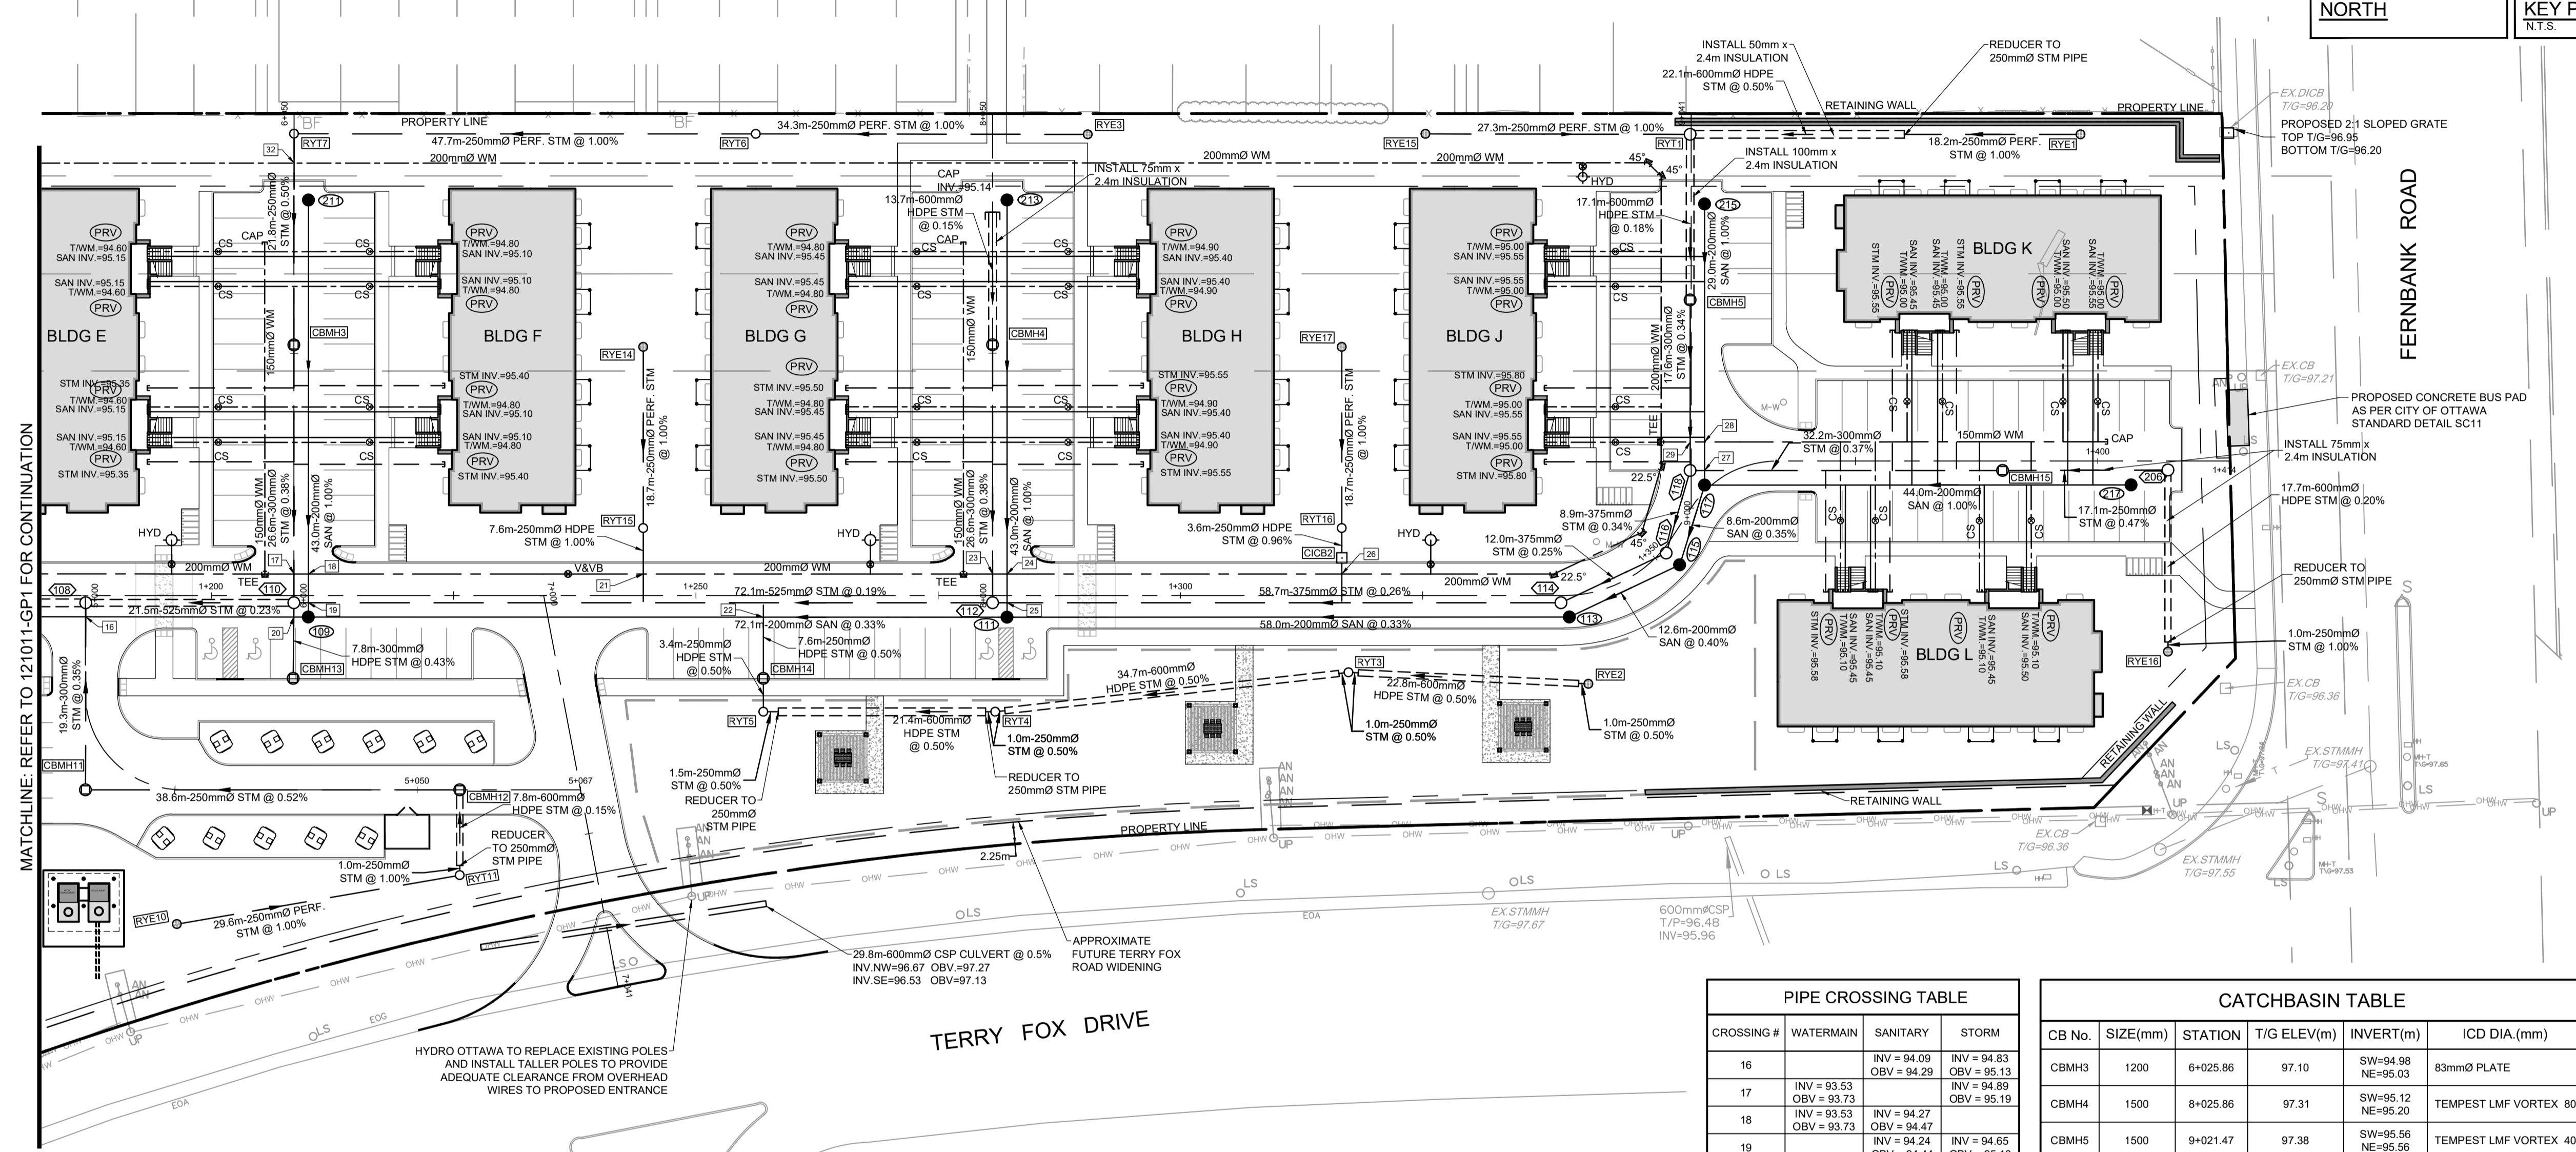

SAN MANHOLE TABLE				
MANHOLE ID	SIZE(mm)	STATION	T/G ELEV(m)	INVERT(m)
109	1200	1+210.01	97.35	SE=94.20 NW=94.17 NE=94.23
111	1200	1+282.11	97.43	SE=94.47 NW=94.44 NE=94.50
113	1200	1+340.05	97.54	NW=94.66 SE=94.69
115	1200	1+351.12	97.60	NE=94.77 NW=94.74
117	1200	1+359.04	97.67	SW=94.80 SE=94.86 NE=94.83
211	1200	6+040.80	97.33	SW=94.66
213	1200	8+040.80	97.50	SW=94.93
215	1200	9+031.37	97.51	SW=95.12
217	1200	1+403.45	97.70	NW=95.30

STM MANHOLE TABLE				
MANHOLE ID	SIZE(mm)	STATION	T/G ELEV(m)	INVERT(m)
108	1200	1+187.05	97.28	SE=94.60 SW=94.83 NW=94.53
110	1200	1+208.53	97.36	SE=94.65 NE=94.88 NW=94.68
112	1200	1+280.61	97.47	SE=94.94 NE=95.02 NW=94.79
114	1200	1+339.26	97.55	NW=95.09 SE=95.06
116	1200	1+351.13	97.61	NE=95.12 NW=95.12
118	1200	1+358.97	97.67	SE=95.23 NE=95.50 SW=95.15
206	1200	1+407.25	97.76	NW=95.48 SW=95.75

PIPE CROSSING TABLE			
CROSSING #	WATERMAIN	SANITARY	STORM
16		INV = 94.09 OBV = 94.29	INV = 94.83 OBV = 95.13
17	INV = 93.53 OBV = 93.73	INV = 94.27 OBV = 94.47	INV = 94.65 OBV = 95.15
18		INV = 94.17 OBV = 94.37	INV = 94.89 OBV = 95.19
21	INV = 94.78 OBV = 94.98	INV = 94.36 OBV = 94.56	INV = 95.87 OBV = 96.12
22	INV = 93.80 OBV = 94.00	INV = 94.54 OBV = 94.74	INV = 95.03 OBV = 95.33
24		INV = 94.51 OBV = 94.71	INV = 94.94 OBV = 95.32
26	INV = 94.87 OBV = 95.07	INV = 94.84 OBV = 95.04	INV = 96.03 OBV = 96.28
27		INV = 94.84 OBV = 95.04	INV = 95.16 OBV = 95.46
*28	INV = 94.25 OBV = 94.35	INV = 94.87 OBV = 95.07	INV = 95.51 OBV = 95.81
*29	INV = 94.25 OBV = 94.35		INV = 95.13 OBV = 95.38
32	INV = 94.40 OBV = 94.60		INV = 95.13 OBV = 95.38

CATCHBASIN TABLE					
CB No.	SIZE(mm)	STATION	T/G ELEV(m)	INVERT(m)	ICD DIA.(mm)
CBMH3	1200	6+025.86	97.10	SW=94.98 NE=95.03	83mmØ PLATE
CBMH4	1500	8+025.86	97.31	SW=95.12 NE=95.20	TEMPEST LMF VORTEX 80
CBMH5	1500	9+021.47	97.38	SW=95.56 NE=95.56	TEMPEST LMF VORTEX 40
CBMH11	1800	5+017.92	97.08	NE=94.90 SE=94.95	83mmØ PLATE
CBMH12	1200	5+054.40	97.55	NW=95.15 SW=95.15	
CBMH13	1200	1+208.45	97.23	NE=94.91	83mmØ PLATE
CBMH14	1200	1+256.96	97.23	NE=95.09 SW=95.09	TEMPEST LMF VORTEX 40
CBMH15	1200	1+390.18	97.50	SE=95.40 NW=95.35	TEMPEST LMF VORTEX 45
CICB2	600Øx600	1+316.65	97.44	NE=96.04 SW=96.04	83mmØ PLATE

REAR YARD CATCHBASIN TABLE					
CB No.	SIZE(mm)	T/G ELEV(m)	INVERT(m)	ICD SIZE (mm)	
RYE1	300	97.47	NW=95.88		
RYE2	300	97.50	NW=95.51		
RYE3	300	97.40	NW=95.96		
RYE10	300	97.37	SE=95.47		
RYE14	300	97.50	SW=96.10		
RYE15	300	97.38	SE=95.86		
RYE16	300	97.58	NE=95.79		
RYE17	300	97.66	SW=96.26		
RYT1	1200	97.35	SW=95.59 SE=95.59 NW=95.59		
RYT3	300	97.44	SE=96.39 NW=95.41		
RYT4	300	97.26	SE=95.23 NW=95.23		
RYT5	300	97.23	NE=95.11 SE=95.11		
RYT6	300	97.18	NW=95.62 SE=95.62		
RYT7	300	97.15	SW=95.14 SE=95.14		
RYT11	300	97.58	NW=95.17 NE=95.17		
RYT15	300	97.48	NE=95.91 SW=95.91	83mmØ PLATE	
RYT16	300	97.64	SW=96.07 NE=96.07		


SANITARY MANHOLES THAT REQUIRE WATERTIGHT LIDS AS PER CITY SPEC MS-22.15	
MH ID	
109	
113	
115	
213	
215	

STORM MANHOLES THAT REQUIRE WATERTIGHT LIDS AS PER CITY SPEC MS-22.15	
MH ID	
106	
204	

* WATERMAIN CROSSING AS PER W25 & W25.2 PROVIDE THERMAL INSULATION AS PER W22 WHERE THERE IS LESS THAN 2.4m COVER.

NOTE: THE POSITION OF ALL POLE LINES, CONDUITS, WATERMANS, SEWERS AND OTHER UNDERGROUND AND OVERGROUND UTILITIES AND STRUCTURES IS NOT NECESSARILY SHOWN ON THE CONTRACT DRAWINGS, AND WHERE SHOWN, THE ACCURACY OF THE POSITION OF SUCH UTILITIES AND STRUCTURES IS NOT GUARANTEED. BEFORE STARTING WORK, DETERMINE THE EXACT LOCATION OF ALL SUCH UTILITIES AND STRUCTURES AND ASSUME ALL LIABILITY FOR DAMAGE TO THEM.

No.	REVISION	DATE	BY
7.	REVISED PER CITY COMMENTS	MAR 18/26	DOB
6.	REVISED SITE PLAN SUBMISSION	NOV 14/25	DOB
5.	RE-ISSUED FOR TENDER	JAN 18/24	DOB
4.	ISSUED FOR TENDER	MAY 20/22	DOB
3.	REVISED PER CITY COMMENTS	FEB 17/22	DOB
2.	REVISED PER CITY COMMENTS	NOV 5/21	DOB
1.	ISSUED FOR CITY OF OTTAWA REVIEW	JUN 2/21	DOB

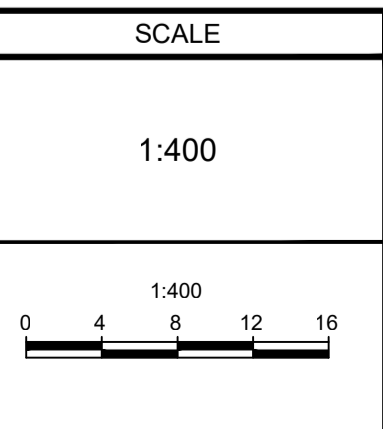

FOR REVIEW ONLY

DESIGN: BM

CHECKED: DDB

DRAWN: ATE

CHECKED: BM

APPROVED: DDB



N VATECH
 Engineers, Planners & Landscape Architects
 Suite 200, 240 Michael Cowpland Drive
 Ottawa, Ontario, Canada K2M 1P6
 Telephone: (613) 254-9643
 Facsimile: (613) 254-5867
 Website: www.novatech-eng.com

CITY OF OTTAWA
 5331 FERNBANK ROAD
 IRON VALLEY 2

DRAWING NAME: GENERAL PLAN OF SERVICES

PROJECT No.: 121011-00

REV #1

DRAWING No.: 121011-GP2

#18539

M:\2021\121011-GP2\Drawings\GP2_Mar_18_2026 - 5:11pm.dwg