

Proposed Site Plan  
391 Hilversum Lane  
Carp, ON  
Servicing & Stormwater  
Management Report

Prepared For:

Inverness Homes

Prepared By:

Robinson Land Development

Project No. 25094

Version 1.0

November 2025

**TABLE OF CONTENTS**

LEGAL NOTIFICATION..... I

1.0 INTRODUCTION..... 1

2.0 GUIDELINES, STUDIES AND REPORTS ..... 1

3.0 EXISTING CONDITIONS ..... 2

4.0 DEVELOPMENT PROPOSAL ..... 3

5.0 WATER SERVICING..... 3

    5.1 Existing System..... 3

    5.2 Proposed System..... 3

    5.3 Design Criteria ..... 4

    5.4 Water Demands ..... 4

    5.5 Fire Flow ..... 5

    5.6 Hydraulic Model ..... 6

    5.7 Hydraulic Model Outputs ..... 6

    5.8 Hydrant Coverage ..... 7

6.0 SANITARY SERVICING..... 7

    6.1 Existing System..... 7

    6.2 Existing System Allocation ..... 8

    6.3 Proposed System..... 8

    6.4 Design Criteria ..... 9

    6.5 Sanitary Design Flows..... 9

7.0 STORM SERVICING..... 10

    7.1 Existing System..... 10

    7.2 Existing System Allocation ..... 10

    7.3 Proposed System..... 10

    7.4 Design Criteria ..... 11

    7.5 Minor System Peak Design Flow ..... 11

8.0 STORMWATER MANAGEMENT ..... 12

    8.1 Design Criteria ..... 12

    8.2 Allowable Release Rates..... 12

    8.3 Quantity Control ..... 12

    8.4 Quantity Storage ..... 14

    8.5 Stress Test (100-YR + 20%) and Freeboard..... 15

    8.6 Major System ..... 15

    8.7 Quality Control ..... 15

    8.8 Low Impact Development (LID) ..... 16

9.0 UNDERGROUND PARKING GARAGE RAMP DESIGN ..... 17

10.0 EROSION AND SEDIMENT CONTROL ..... 17

11.0 CONCLUSIONS..... 18

**LIST OF FIGURES**

Figure 1.0 Key Plan..... Following Page 1

Figure 2.0 Existing Conditions..... Page 2

Figure 3.0 Hydraulic Water Model ..... Appendix C

Figure 4.0 Hydrant Coverage Plan ..... Appendix C

**LIST OF TABLES**

Table 5.1 Domestic Water Demands..... Page 4

Table 5.2 System Pressures at Building Junctions ..... Page 6

Table 5.3 Hydrant Coverage ..... Page 7

## TABLE OF CONTENTS CONTINUED

Table 6.1	Peak Sanitary Design Flows.....	Page 9
Table 7.1	2-Year Unrestricted Minor System Flow .....	Page 11
Table 8.1	Allowable Release Rates.....	Page 12
Table 8.2	Stormwater Peak Flows.....	Page 13
Table 8.3	100-Year Surface Storage Volumes & Ponding Depths .....	Page 14
Table 8.4	Freeboard .....	Page 15
Table 8.5	OGS Unit Sizing Parameters .....	Page 16

## LIST OF APPENDICES

Appendix A	Pre-Consultation Notes Superseded Plan of Subdivision (prepared by FMW) Plan of Subdivision (prepared by FMW) Huntley Hollow General Plan of Services (DWG. 19008-S2) Huntley Hollow Grading Plan (DWG. 19008-GR2) Carp Short Term Upgrades Presentation Correspondence with City
Appendix B	Site Plan (prepared by Peter Mansfield Architect) Servicing Plan (DWG. 25094-S1) Grading and Drainage Plan (DWG. 25094-GR1) Notes & Details (DWG. 25094-N1) Erosion and Sediment Control Plan (DWG. 25094-ESC1) Parking Garage Ramp Plan & Plan (DWG. 25094-P1)
Appendix C	Robinson Report Excerpts Water Demand Calculations Fire Flow Calculations (OBC) Fire Flow Calculations (FUS) Boundary Conditions Figure 3.0: Hydraulic Water Model Table C1: Peak Hour Model Outputs Table C2: Max. Day Model Outputs Table C3: Max. Day Plus Fire Flow Outputs Table C4: Pipe Report Figure 4.0: Hydrant Coverage Plan
Appendix D	Robinson Report Excerpts Huntley Hollow Sanitary Sewer Design Sheet Huntley Hollow Sanitary Drainage Area Plan (DWG. 19008-SAN1) Appendix 4-A Sanitary Sewer Design Sheet
Appendix E	Robinson Report Excerpts Huntley Hollow Storm Sewer Design Sheet Huntley Hollow Storm Drainage Area Plan (DWG. 19008-STM1) Runoff Coefficient Calculations Storm Sewer Design Sheet Storm Drainage Area Plan (DWG. 25094-STM1)

## TABLE OF CONTENTS CONTINUED

Appendix F	Robinson Report Excerpts
	LMF ICD Flow Curves
	Tempest ICD Technical Manual
	Table F1: Ponding and Orifice Calculations
	Free Flow Calculations
	Storage Volume Tables
	Figure 5: OGS Unit Drainage Area Plan
	Amended ECA
	Geotechnical Excerpts

## **LEGAL NOTIFICATION**

This report was prepared by Robinson Land Development for the account of **Inverness Homes**.

Any use which a third party makes of this report, or any reliance on or decisions to be made based on it, are the responsibility of such third parties. **Robinson Land Development** accepts no responsibility for damages, if any, suffered by any third party as a result of decisions made or actions based on this project

## 1.0 INTRODUCTION

Robinson Land Development have been retained by Inverness Homes to prepare detailed servicing and stormwater management designs in support of a proposed residential site plan development located at 391 Hilversum Lane in the Village of Carp (refer to **Figure 1.0 – Key Plan** following page 1).

This report will detail the proposed means of servicing the site and will provide details on how the stormwater management requirements will be achieved in accordance with overarching reports and current City of Ottawa guidelines.

## 2.0 GUIDELINES, STUDIES AND REPORTS

The servicing and stormwater management designs for the subject site have been prepared in keeping with the following documents:

- **Sewer Design Guidelines**, City of Ottawa, Second Edition, October 2012 (herein referred to as OSDG).
  - **Technical Bulletin ISD-2010-1**, City of Ottawa, September 28, 2010.
  - **Technical Bulletin ISD-2011-2**, City of Ottawa, October 6, 2011.
  - **Technical Bulletin ISD-2012-1**, City of Ottawa, January 31, 2012.
  - **Technical Bulletin ISD-2012-4**, City of Ottawa, June 20, 2012.
  - **Technical Bulletin ISD-2012-6**, City of Ottawa, October 31, 2012.
  - **Technical Bulletin ISDTB-2014-01**, City of Ottawa, February 5, 2014.
  - **Technical Bulletin PIEDTB-2016-01**, City of Ottawa, September 6, 2016.
  - **Technical Bulletin ISTB-2018-01**, City of Ottawa, March 21, 2018.
  - **Technical Bulletin ISTB-2018-03**, City of Ottawa, March 21, 2018.
  - **Technical Bulletin ISTB-2018-04**, City of Ottawa, June 27, 2018.
  - **Technical Bulletin ISTB-2019-02**, City of Ottawa, July 08, 2019.
  - **Technical Bulletin IWSTB-2024-04**, City of Ottawa, September 12, 2024.
- **Ottawa Design Guidelines, Water Distribution**, City of Ottawa, First Edition, July 2010 (herein referred to as OWDG).
  - **Technical Bulletin ISD-2010-2**, City of Ottawa, December 15, 2010.
  - **Technical Bulletin ISDTB-2014-02**, City of Ottawa, May 27, 2014.
  - **Technical Bulletin ISTB-2018-02**, City of Ottawa, March 21, 2018.
  - **Technical Bulletin ISTB-2021-03**, City of Ottawa, August 18, 2021.
  - **Technical Bulletin IWSTB-2024-05**, City of Ottawa, November 18, 2024.
- **Design Guidelines for Sewage Works**, Ministry of the Environment, 2008 (herein referred to as MECP Design Guidelines).
- **Design Guidelines for Drinking-Water Systems**, Ministry of the Environment, 2008 (herein referred to as MECP Water Design Guidelines).
- **Stormwater Planning and Design Manual**, Ministry of the Environment, March 2003 (herein referred to as MECP SWM Design Guidelines).
- **Water Supply for Public Fire Protection**, Fire Underwriters Survey, 2020 (herein referred to as FUS Guidelines).



# Robinson

## Land Development


scale	N.T.S.	391 HILVSERUM LANE, CARP	project no.	25094
date	13/11/25		KEY PLAN	FIG 1.0
drawn by	BLM			

- **Ontario Building Code Compendium**, Ministry of Municipal Affairs and Housing Building Development Branch, January 1, 2010 (herein referred to as OBC).
- **147 Langstaff Drive, Village of Carp, ON, Proposed Residential Development, Servicing and Stormwater Management Report**, Robinson Land Development, May 2024 (herein referred to as the Robinson Report).
- **Geotechnical Recommendations, Proposed Residential Development – Phase 1 Apartment Building (Block 27), 391 Hilversum Lane**, Paterson Group, November 5, 2025 (herein referred to as the Paterson Report)

A pre-consultation meeting was held with the City of Ottawa on April 30, 2025 to discuss requirements for the proposed development. Refer to pre-consultation notes provided under **Appendix A** for more details.

### 3.0 EXISTING CONDITIONS

The subject site is contained within a 0.31-hectare block which is zoned Village Residential Third Density Zone (V3I[932r]-h). The site is located within Phase 1 of the Huntley Hollow Subdivision, formerly known as 147 Langstaff Drive. The current Plan of Subdivision has identified the subject site as Block 12, however, the block was formerly known as Block 27 at time of the subdivision approval and is referenced as such in the overarching Robinson Report). The block is bound by Hilversum Lane to the west, a future park block to the north, and open space (i.e. ravine and watercourse) to the east. Refer to the superseded and current Plan of Subdivisions, prepared by Fairhall Moffatt & Woodland Limited, under **Appendix A** for more details. Phase 1 of the Huntley Hollow Subdivision is currently under construction. Municipal infrastructure has been installed within the Hilversum Lane right-of-way. Refer to **Figure 2.0** below for an aerial view of the site (defined by “red” boundary) under its pre-development state.

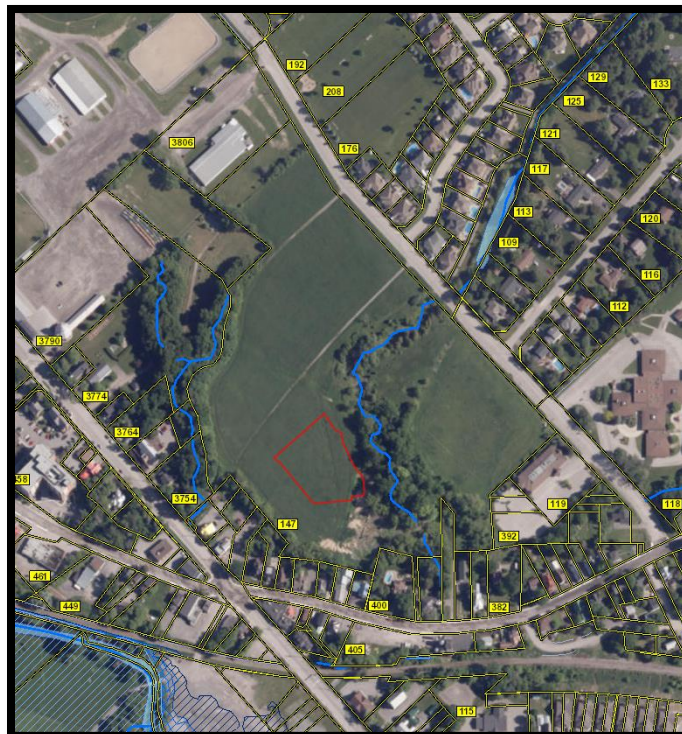

**Figure 2.0: Existing Conditions**

## 4.0 DEVELOPMENT PROPOSAL

The Owner is proposing to construct a 3-storey 39-unit residential apartment building with a footprint of approximately 1257 square metres. The site plan will also include an underground parking garage and a slab-on-grade club house building. Refer to the site plan, prepared by Peter Mansfield Architect, under **Appendix B** for more details.

The site is constrained by a limit of hazard lands and a 15.0m top of slope setback established through geotechnical investigations completed for the adjacent ravine and watercourse. The site is also constrained by a Blanding's turtle habitat setback established through on-site environmental investigations. The setbacks associated with the subject site are shown on the civil plans provided under **Appendix B**.

The subject site will be provided with new water, sanitary and storm infrastructure via connections to the existing municipal systems as detailed in the sections below.

## 5.0 WATER SERVICING

### 5.1 Existing System

Existing municipal watermains are available in proximity to the subject site as follows:

- A 203mm diameter PVC watermain within the Hilversum Lane right-of-way.

In addition, a 203mm diameter watermain stub was installed off the 203mm diameter municipal watermain to service the subject site as part of the construction works for Phase 1 of the Huntley Hollow Subdivision. The municipal watermain distribution system is looped between Langstaff Drive and Carp Road via Hilversum Lane, Block 14 (i.e. pathway block), and the unopened John Street road allowance. Refer to the General Plan of Services, prepared by Robinson Land Development for the Huntley Hollow Subdivision under **Appendix A**.

There are known capacity constraints with the Village water treatment and pumping station on Salisbury Street. There is a significant level of service (low pressure) risk in the existing system during Max. Day and Peak Hour demand scenarios. The station requires short-term upgrades to mitigate the known capacity constraints. The City has indicated that the detailed design for the short-term upgrades is anticipated to be completed in Q4 2026 with construction being completed in Q4 2028. Refer to the Carp Short Term Upgrades presentation prepared by the City's Water Resources Planning and Engineering Branch under **Appendix A** for more details.

Through recent communications with City staff, the Infrastructure and Planning group have advised that sufficient capacity is available for the subject site. Refer to correspondence with the City under **Appendix A**.

### 5.2 Proposed System

The proposed apartment building will be serviced for domestic water supply and fire protection via an extension of the 203mm diameter watermain stub. The proposed club house will be serviced for domestic water supply and fire protection via a 152mm diameter water service fed from the apartment building's mechanical room. The proposed watermain network is shown on the Servicing Plan (DWG. 25094-S1) provided under **Appendix B**.

### 5.3 Design Criteria

The design of the municipal watermain distribution system for the Huntley Hollow Subdivision is detailed in the overarching Robinson Report. In keeping with Robinson Report and current Ottawa Water Design Guidelines (OWDG), the following design criteria will be utilized for the design of the subject site (i.e. Block 12, formerly Block 27):

• Basic Day (BSDY) Demand	280 L/person/day	(OWDG; ISTB-2021-03)
• Maximum Day (MXDY) Demand	BSDY x 2.9	(MECP; Table 3-3)
• Peak Hour (PKHR) Demand	MXDY x 4.3	(MECP; Table 3-3)
• Apartment Population Densities		(OWDG; Table 4.1)
• Bachelor	1.4 persons/unit	
• 1-Bedroom	1.4 persons/unit	
• 2-Bedroom	2.1 persons/unit	
• Club House		
• Water Closet	150 L/fixture/hour of use	(Appendix 4-A)
• Wash Basin	375 L/fixture/day	(Appendix 4-A)
• Roughness Coefficient		(OWDG; Table 4.4)
• 150mm diameter pipe	100	
• 200mm diameter pipe	110	
• Minimum Pressure	40 psi	(OWDG; S4.2.2)
• Maximum Pressure	80 psi	(OWDG; S4.2.2)
• Available Fire Flow	6,750 L/min	

The City of Ottawa have indicated that the available fire flow in the municipal watermain distribution system is only 6,750 L/min (112.5 L/s) which corresponds to the capacity of a single high lift pump at the Carp Drinking Water Facility. Refer to excerpts from the Robinson Report under **Appendix C**.

### 5.4 Water Demands

Domestic water demands have been calculated for the subject site in accordance with the OWDG and in keeping with the overarching Robinson Report. Demands for the proposed club house have been calculated based on water use estimates for miscellaneous fixtures as per *Appendix 4-A* of the OSDG. Peaking factors for maximum day and peak hour demands are in keeping with the peaking factors established in the overarching Robinson Report (which accounted for the subject site). The calculated water demands have been summarized in the table below:

**Table 5.1: Domestic Water Demands**

Dwelling	Basic Day Demand (L/s)	Maximum Day Demand (L/s)	Peak Hour Demand (L/s)
Apartments	0.22	0.62	0.93
Club House	0.016	0.045	0.067
<b>Total</b>	<b>0.23</b>	<b>0.67</b>	<b>0.99</b>

Notes:

1. BSDY = 280 L/person/day
2. MXDY = BSDY x 2.9
3. PKHR = BSDY x 4.3

Refer to the water demand calculations provided under **Appendix C** for more details.

## 5.5 Fire Flow

The total required fire flow for the subject site has been calculated in accordance with City of Ottawa Technical Bulletin IWSTB-2024-05. Since the apartment building is significantly larger than the club house, the required fire flow for the apartment building will be greater and will govern for the site design. The required fire flow shall first be calculated based on OBC *Appendix A-3.2.5.7* as follows:

- Water Supply Coefficient (K) OBC Table 1
- Total Building Volume (V) A x H
- Total of Spatial Coefficient ( $S_{TOT}$ ) OBC Figure 1
- Minimum Supply of Water (Q)  $K \times V \times S_{TOT}$
- Type of Construction Combustible (with fire resistance ratings)
- Group Classification Group C
- Building Area (A) 1257 m<sup>2</sup>
- Building Height (H) 9.1 m

The water supply coefficient (K) is derived from OBC Table 1. Through correspondence with the Architect, it has been confirmed that the proposed building will be classified as Group C, combustible with fire resistance ratings, which returns a K value of 18.

The total building volume has been calculated to be 11,438.70 m<sup>3</sup> based on dimensions provided by the Architect.

The total of spatial coefficient ( $S_{TOT}$ ) is interpolated from OBC Figure 1 based on exposure distances measured from the proposed building. Where a building has exposures on more than one side, the percentage increase in the fire protection water supply should be totaled to reflect all exposure protection requirements. Note that the total of spatial coefficient need not exceed a value of 2.0. The spatial coefficients for each side of the building are summarized below:

$$\begin{aligned} S_{side\ 1} &= 0.50 \text{ (exposure distance of 4.5m measured to the north property line)} \\ S_{side\ 2} &= 0.00 \text{ (exposure distance of 15.1m measured to centreline of Hilversum Lane)} \\ S_{side\ 3} &= 0.40 \text{ (exposure distance of 6.1m measured to the east property line)} \\ S_{side\ 4} &= 0.50 \text{ (exposure distance of 4.25m measured to midpoint of club house)} \\ S_{TOT} &= 1.0 + (0.50 + 0.40 + 0.50) = 2.4 \end{aligned}$$

$$S_{TOT} = 2.0$$

$$\text{Minimum Supply of Water (Q)} = K \times V \times S_{TOT}$$

$$Q = (18) \times (11,438.70 \text{ m}^3) \times (2.0) = 411,793 \text{ L}$$

The required minimum water supply flow rate can be derived from OBC Table 2. For a minimum supply of water of 411,793 L, the required minimum water supply flow rate is 9,000 L/min.

In accordance with IWSTB-2024-05, since the site has a pressurized hydrant available and the required minimum water supply flow rate is 9,000 L/min (or greater), the required fire flow shall also be calculated using FUS guidelines. The total required fire flow has been calculated using the following parameters:

Apartment Building:

- Type of Construction Ordinary Construction (Type III)
- Effective Floor Area 1257 m<sup>2</sup> x 3 = 3771 m<sup>2</sup>
- Occupancy Class Limited Combustible
- Sprinkler Protection Automatic Sprinkler Protection  
Water Supply is Standard  
Full Supervision of Sprinkler System
- Exposure Distances Separations as per Site Plan

Club House:

- Type of Construction Wood Frame
- Sprinkler Protection Automatic Sprinkler Protection  
Water Supply is Standard  
Full Supervision of Sprinkler System

Using FUS guidelines, the total required fire flow has been calculated to be 6,000 L/min. Therefore, the developed hydraulic model for the site must demonstrate that the available fire flow from the distribution system exceeds 6,000 L/min (refer to **Section 5.7** for further discussion). Refer to the supporting fire flow calculations provided under **Appendix C**.

## 5.6 Hydraulic Model

A water distribution hydraulic model has been created for the subject site using EPANET2 software. The hydraulic model has incorporated the proposed watermain layout, proposed hydrant locations, boundary conditions (provided by the City of Ottawa), and appropriate roughness coefficients. To provide a cohesive model between the provided boundary condition on Hilversum Lane and the club house, a dummy watermain alignment has been assigned for the segment of the system located internal to the building. Refer to **Figure 3.0: Hydraulic Water Model** and the boundary conditions provided by the City under **Appendix C** for more details.

## 5.7 Hydraulic Model Outputs

The developed hydraulic model was used to assess the anticipated pressures within the proposed system under the peak hour and maximum day scenarios. The model outputs at the building junctions are summarized in the table below:

**Table 5.2: System Pressures at Building Junctions**

Building	Model Junction	Peak Hour (psi)	Max. Day (psi)
Apartment* <sup>2</sup>	J7	70.33	84.19
Club House* <sup>3</sup>	J11	72.49	86.34

Notes:

1. Outputs modelled using EPANET2 software.
2. Pressures have been assessed at model junction J7 which has an assigned elevation equal to the building ground floor elevation (105.17m).
3. Pressures have been assessed at model junction J11 which has an assigned elevation equal to the building ground floor elevation (103.66m).

As shown in the table above, the minimum pressures modelled (peak hour scenario) at the building junctions exceed the minimum operating pressure of 40 psi and therefore are in

accordance with the current OWDG. The maximum pressures modelled (max. day scenario) at the building junctions exceed the maximum pressure of 80 psi and therefore pressure reducing valves (PRVs) will be required. Refer to the complete hydraulic model outputs (**Table C1 & C2**) for the peak hour and maximum day scenarios under **Appendix C**.

A fire flow analysis has been completed using the developed hydraulic model for the subject site under the maximum day plus fire flow boundary condition. The analysis has determined that the available fire flow from the proposed on-site hydrant is over 24,000 L/min (at a reference pressure of 20 psi) which well exceeds the total required fire flow of 6,000 L/min (refer to **Section 5.5**). It should be noted that the available fire flow within the distribution system is greater than the capacity of the hydrant itself as discussed further under **Section 5.8** below. Refer to the max. day plus fire flow outputs (**Table C3**) and pipe report (**Table C4**) provided under **Appendix C**.

## 5.8 Hydrant Coverage

Pressure losses (due to friction) in firehoses are proportional to the firehose length. Therefore, the actual fire flow delivered by the nozzle at the end of a long firehose will be less compared to a shorter firehose connected to the same hydrant. In accordance with City of Ottawa Technical Bulletin ISTB-2018-02, the aggregate fire flow capacity of all contributing fire hydrants within 150 m of a building shall not be less than the required fire flow. In some instances, involving dead-end watermains, standard spacing requirements may not be sufficient to meet the required fire flow. The contribution to the required fire flow is dependent on the distance from the hydrant to building being considered. A flow of 5,700 L/min should be assigned to all hydrants with a distance of less than or equal to 75 m from the building being considered and 3,800 L/min to all hydrants with a distance between 75 m and 150 m from the building being considered (as per *Table 1* from ISTB-2018-02 for AA rated hydrants). Coverage for the apartment building and club house will be provided by the proposed private hydrant and by the existing hydrant on Hilversum Lane. Since the apartment building and club house will each be sprinklered, a hydrant must also be located within 45 m of the building's siamese connection in accordance with the OBC. The contributing fire flows have been summarized in the table below:

**Table 5.3: Hydrant Coverage**

Building	Distance Proposed Hydrant (m)	Hydrant Contrib. (L/min)	Distance Existing Hydrant (m)	Hydrant Contrib. (L/min)	Total Fire Flow Contrib. (L/min)
Apartment	19	5,700	54	5,700	11,400
Club House	39	5,700	46	5,700	11,400

As shown in the table above, the contributing fire flows from the proposed private hydrant in combination with the existing hydrant, exceeds the total required fire flows (refer to **Section 5.5**) and therefore adequate fire protection coverage has been demonstrated. Refer to **Figure 4.0: Hydrant Coverage Plan** provided under **Appendix C**.

## 6.0 SANITARY SERVICING

### 6.1 Existing System

Existing municipal sanitary sewers are available in proximity to the subject site as follows:

- A 200mm diameter PVC sanitary sewer within the Hilversum Lane right-of-way.

In addition, a 200mm diameter sanitary sewer stub was installed to the east of the existing sanitary maintenance hole (denoted as MH 110) to service the subject site. The existing municipal sanitary sewer system conveys wastewater in a southwest direction, through Block 14 (i.e. pathway block) and the unopened John Street road allowance before discharging to the existing system on Carp Road and ultimately to the wastewater pumping station on Salisbury Street. Refer to the General Plan of Services, prepared by Robinson Land Development for the Huntley Hollow Subdivision under **Appendix A**.

There are known capacity constraints with the Village wastewater pumping station (WWPS) on Salisbury Street. There is a significant flood risk at the station itself and for existing basements in the low-lying area of the Village. The WWPS requires short-term upgrades to increase the maximum flow rate to 75 L/s and the incorporation of a proper system overflow (i.e. to an adjacent storm sewer system) to mitigate the known capacity constraints. The City has indicated that the detailed design for the short-term upgrades is anticipated to be completed in Q4 2026 with construction being completed in Q4 2028. Refer to the Carp Short Term Upgrades presentation prepared by the City's Water Resources Planning and Engineering Branch under **Appendix A**.

## 6.2 Existing System Allocation

The design of the municipal sanitary sewer system for Phase 1 of the Huntley Hollow Subdivision is detailed in the overarching Robinson Report (refer to excerpts provided under **Appendix D**). The sanitary sewer system design allocated capacity for the subject site (i.e. Block 12, formerly Block 27) based on the following:

• Apartment Units	32
• Population	67.2 people (2.1 persons/unit)
• Site Area	0.30 ha
• Extraneous Flow	0.10 L/s
• Peak Design Flow	0.89 L/s

A peak sanitary design flow of 0.89 L/s was allocated for the subject site within the municipal sanitary sewer system on Hilversum Lane (downstream of MH 110). Refer to the *sanitary sewer design sheet* and *Sanitary Drainage Area Plan (DWG. 19008-SAN1)* prepared by Robinson Land Development for the Huntley Hollow Subdivision under **Appendix D** for more details.

Through recent communications with City staff, the Infrastructure and Planning group have advised that sufficient capacity is available for the subject site. Refer to correspondence with the City under **Appendix A**.

## 6.3 Proposed System

The proposed apartment building will be serviced via an extension of the 200mm diameter sanitary sewer stub installed as part of the Phase 1 construction for the Huntley Hollow Subdivision. The proposed club house will be serviced via a 135mm diameter sanitary service. The 135mm diameter club house service will be directed to the apartment building mechanical room and will ultimately be discharged via the 200mm diameter sanitary sewer outlet for the site. The proposed sanitary sewer/service have been designed with adequate capacity to convey the peak sanitary design flow and to meet the allowable full flow velocities for self-

cleansing in accordance with the current OSDG. The proposed sanitary sewer network is shown on the Servicing Plan (DWG. 25094-S1) provided under **Appendix B**.

#### 6.4 Design Criteria

The proposed sanitary sewer system for the subject site has been designed in accordance with the current OSDG and in keeping with the overarching Robinson Report using the following design criteria:

• Residential Flow	280 L/person/day	(ISTB-2018-01)
• Residential Peaking Factor	Harmon Formula	
• Harmon Correction Factor	0.80	(ISTB-2018-01)
• Extraneous Flow	0.33 L/s/ha	(ISTB-2018-01)
• Minimum Full Flow Velocity	0.60 m/s	(OSDG S6.1.2.2)
• Maximum Full Flow Velocity	3.0 m/s	(OSDG S6.1.2.2)
• Manning's 'n' Value	0.013	(OSDG S6.1.8.2)
• Apartment Population Densities		(OSDG; Table 4.1)
• Bachelor	1.4 persons/unit	
• 1-Bedroom	1.4 persons/unit	
• 2-Bedroom	2.1 persons/unit	
• Water Closets	550 L/fixture/day	(Appendix 4-A)
• Wash Basins	350 L/fixture/day	(Appendix 4-A)
• Club House Peaking Factor	3.68	

Peak sanitary design flows generated from the proposed club house have been estimated using fixture daily flow values from *Appendix 4-A* of the OSDG (provided under **Appendix D** for reference). The peaking factor for the club house has been interpolated using the Harmon Formula for an assumed population of 30 people.

#### 6.5 Sanitary Design Flows

Using the design criteria above, the peak sanitary design flow for the subject site has been calculated and summarized in the table below.

**Table 6.1: Peak Sanitary Design Flows**

Design	Pop.	Peak Residential Flow (L/s)	Peak Club House Flow (L/s)	Extraneous Flow (L/s)	Peak Design Flow (L/s)
Robinson Report* <sup>1</sup>	67.2	0.79	-	0.10	0.89
Current	66.5	0.78	0.08	0.10	0.96

Notes:

1. Approved Robinson Report (May 2024) for Huntley Hollow Subdivision.

As shown in the table above, the calculated population is marginally below the population value assumed in the Robinson Report. With the addition of the club house, the calculated peak design flow of 0.96 L/s is greater than the allocated value in the Robinson Report (7.9% increase). As demonstrated in the Huntley Hollow sanitary sewer design sheet, the sewers downstream of the site outlet have adequate capacity to accommodate a 0.07 L/s increase in peak flows. For reference, a flow rate of 0.07 L/s represents approximately 0.37% of the total pipe capacity of a 200mm diameter sewer installed at minimum slope (0.33%). Refer to the sanitary sewer design sheet provided under **Appendix D** for more details.

## 7.0 STORM SERVICING

### 7.1 Existing System

Existing municipal storm sewers are available in proximity to the subject site as follows:

- A 525mm-750mm diameter conc. storm sewers within the Hilversum Lane right-of-way.

In addition, a 375mm diameter storm sewer stub was installed to the east of the existing storm maintenance hole (denoted as MH 210) to service the subject site. The existing municipal storm sewer system conveys stormwater in an easterly direction before discharging to the existing ravine and watercourse bisecting the Huntley Hollow Subdivision. The ravine has existing inline control structures which provide stormwater detention for the Huntley Hollow Subdivision and upstream drainage areas as detailed in the overarching Robinson Report. Refer to the General Plan of Services, prepared by Robinson Land Development for the Huntley Hollow Subdivision under **Appendix A**.

### 7.2 Existing System Allocation

The design of the municipal storm sewer (minor) system for Phase 1 of the Huntley Hollow Subdivision is detailed in the overarching Robinson Report. The storm sewer system design allocated capacity for the subject site (i.e. Block 12, formerly Block 27) based on the following:

- Site Area 0.31 ha
- Weighted Runoff Coefficient 0.69
- Time of Concentration 10 minutes
- 2-Year Peak Design Flow 46.26 L/s

An unrestricted 2-year peak design flow of 46.26 L/s was allocated for the subject site within the municipal storm sewer (minor) system on Hilversum Lane (downstream of MH 210). Refer to the *storm sewer design sheet* and *Storm Drainage Area Plan (DWG. 19008-STM1)* prepared by Robinson Land Development for the Huntley Hollow Subdivision under **Appendix E** for more details.

### 7.3 Proposed System

The subject site will be serviced for stormwater via a connection to the 375mm diameter storm sewer stub installed as part of the Phase 1 construction for the Huntley Hollow Subdivision. The proposed 250mm diameter storm service to the apartment building will provide an outlet for the foundation drainage system and for the roof drainage system. The mechanical design will need to incorporate a backflow prevention device to protect the foundation drainage system against surcharging in the minor system. The roof system will need to outlet downstream of the backflow prevention device on the foundation drainage system.

Stormwater runoff from the underground parking garage ramp will be captured by a trench drain and/or internal floor drain system (to be designed by the Mechanical Consultant) and conveyed via the internal building plumbing to the building's storm service.

The proposed club house will be slab-on-grade construction with a pitched roof and will therefore not require a storm service.

Stormwater runoff from the majority of the site frontage will be captured by surface inlets and conveyed to the on-site minor system.

The proposed storm sewer network is shown on the Servicing Plan (DWG. 25094-S1) provided under **Appendix B**

#### 7.4 Design Criteria

The proposed storm sewer (minor) system for the subject site has been designed in accordance with the current OSDG and in keeping with the overarching Robinson Report using the following design criteria:

- Peak Flow (Q) 2.78CiA (Rational Method)
- Rainfall Intensity (i) City of Ottawa IDF Curve Equations
- Runoff Coefficient (C)
  - Pervious Areas 0.20
  - Impervious Areas 0.90
  - Gravel Areas 0.80
  - 100-Year C C + 25% (Max. 1.0)
- Inlet Time 10 minutes (OSDG S5.1.4)
- Minimum Full Flow Velocity 0.80 m/s (OSDG S6.1.2.1)
- Maximum Full Flow Velocity 3.0 m/s (OSDG S6.1.2.1)
- Minimum Sewer Diameter 250 mm (OSDG S6.1.1.2)
- Minimum Catch Basin Lead 200 mm (OSDG S5.6.7)
- Manning's 'n' Value 0.013 (OSDG S6.1.8.1)
- Design Level of Service 2-Year Event (PIEDTB-2016-01)

#### 7.5 Minor System Peak Design Flow

Using the design criteria above, the unrestricted 2-year peak design flow to the minor system has been calculated and summarized in the table below.

**Table 7.1: 2-Year Unrestricted Peak Minor System Flow**

Design	Area (ha)	Runoff Coeff.	2-Year Peak Minor System Flow (L/s)
Robinson Report* <sup>1</sup>	0.31	0.69	46.26
Current	0.16	0.74	24.75

Notes:

1. Approved Robinson Report (May 2024) for Huntley Hollow Subdivision.

As shown in the table above, the unrestricted 2-year peak flow to the on-site minor system has been reduced from the peak flow rate allocated for in the overarching Robinson Report. At the time of the subdivision design, the entire area of Block 27 was conservatively assumed to discharge to the minor storm sewer system via the provided storm sewer stub. Due to the topography of the property, a portions of the site will be uncontrolled, bypassing the on-site minor storm system. The reduced peak flow to the minor system can be attributed to the reduction in the tributary drainage area. Since the 2-year minor system flow has been reduced from the allocated rate, the existing storm sewers downstream of the site outlet will have adequate capacity to convey the peak flows from the subject site.

The proposed storm sewers have been designed with adequate capacity to convey the unrestricted 2-year peak design flow and to meet the allowable full flow velocities for self-cleansing in accordance with the current OSDG. The proposed storm sewers also have

adequate capacity to convey the restricted 100-year peak flow without surcharging of the system. Refer to the runoff coefficient calculations, storm sewer design sheet and Storm Drainage Area Plan (DWG. 25094-STM1) provided under **Appendix E** for more details.

## 8.0 STORMWATER MANAGEMENT

### 8.1 Design Criteria

In accordance with the overarching Robinson Report and pre-consultation with the City of Ottawa, the following stormwater management design criteria have been implemented into the on-site design:

- Control post-development peak flows to the allowable release rates established in the overarching Robinson Report.
- Provide on-site storage (in excess of the allowable release rates) for all storm events up to and including the 100-year event.
- No surface ponding during the 2-year design event.
- Maximum surface ponding depth of 350mm.
- Minimum 300mm of freeboard between 100-year spill elevation and any building openings.
- No spill from stress test (100-year + 20%) onto permanent structures.
- Minimum 150mm of freeboard between spill elevations and ground elevation at building envelope (in proximity to flow route or ponding area).
- Provide a major overland flow route to the adjacent municipal right-of-way.
- Provide enhanced level (80% TSS removal) quality control of stormwater runoff.
- Implement low impact development (LID) measures where feasible.

### 8.2 Allowable Release Rates

Post-development peak flows for the subject site will need to be controlled to the allowable release rates allocated in the overarching Robinson Report for Block 27. The allocated minor and major system flows have been summarized in the table below.

**Table 8.1: Allowable Release Rates**

Minor System Flow (L/s)	Major System Flows (L/s)		
	2-Year	5-Year	100-Year
47	0	22	87

Notes:

1. Flows as per *Table 8.11* from the approved Robinson Report (May 2024) prepared for the Huntley Hollow Subdivision.

Stormwater peak flows from the subject site must be controlled to the rates noted in the table above in accordance with the overarching Robinson Report.

### 8.3 Quantity Control

In order to restrict stormwater peak flows to the established allowable release rates, quantity controls will be required.

Drainage areas STM1 and STM2 comprise the majority of the site frontage along Hilversum Lane and consist of both impervious and pervious surface treatments. The drainage areas will each be restricted by an inlet control device (ICD) installed within the outlet pipe of the

proposed catch basin structure for each respective catchment. The ICDs are proposed to be Tempest LMF types since a standard circular orifice would be below the minimum orifice diameter of 83mm based on the assigned flow rate. Refer to the Tempest LMF flow curves and technical manual provided under **Appendix F** for more details.

Drainage area R1 is comprised of the flat portion of the apartment building roof and will be restricted by roof drain controls. A roof drain release rate of 40 L/s/ha has been assigned, which equates to a peak flow rate of 3.9 L/s over the total roof area. The total number of roof drains required will need to be confirmed by the Mechanical Consultant.

Drainage area FF1 is comprised of the underground parking garage ramp which will be captured by a trench drain (and/or internal building floor drains) and conveyed to the building plumbing system. For stormwater management purposes, area FF1 has been assumed to be uncontrolled and will ultimately discharge to the building storm service via the internal building plumbing system.

Drainage area FF2 is comprised of the remaining site frontage along Hilversum Lane and will be conveyed uncontrolled to the Hilversum Lane right-of-way where it will be captured by an existing surface inlet and conveyed to the municipal storm sewer system.

Drainage area FF3 is comprised of the remaining site area along the northern and eastern perimeters of the property which will be conveyed uncontrolled to the existing ravine.

Stormwater peak flows for the 2-year through 100-year design events have been summarized in the table below.

**Table 8.2: Stormwater Peak Flows**

<b>Drainage Area</b>	<b>2-Year Peak Flow (L/s)</b>	<b>5-Year Peak Flow (L/s)</b>	<b>100-Year Peak Flow (L/s)</b>	<b>Flow Control</b>
STM1* <sup>1</sup>	1.8	2.4	5.2	ICD
STM2* <sup>1</sup>	2.6	3.6	7.6	ICD
R1* <sup>2</sup>	3.9	3.9	3.9	Roof Drain
FF1* <sup>3</sup>	1.6	2.2	4.2	Uncontrolled
FF2* <sup>3</sup>	5.6	7.6	16.3	Uncontrolled
FF3* <sup>3</sup>	9.9	13.4	28.8	Uncontrolled
<b>Total</b>	<b>25.5</b>	<b>33.2</b>	<b>66.1</b>	
<b>Total (Minor Only)*<sup>4</sup></b>	<b>10.0</b>	<b>12.2</b>	<b>21.0</b>	
<b>Total (Major Only)*<sup>5</sup></b>	<b>15.5</b>	<b>21.0</b>	<b>45.1</b>	
<b>Allowable (Minor)*<sup>6</sup></b>	<b>47.0</b>	<b>47.0</b>	<b>47.0</b>	
<b>Allowable (Major)*<sup>6</sup></b>	<b>0.0</b>	<b>22.0</b>	<b>87.0</b>	

Notes:

1. Since the calculated peak flow at a time of concentration of 10 minutes is less than the assigned ICD release rate, the calculated peak flow rate has been used.
2. Peak flows for roof area (R1) are based on roof drain release rate of 40 L/s/ha.
3. Peak flows for free flow areas (FF1-FF3) are calculated using the Rational Method at a time of concentration of 10 minutes.
4. Excludes peak flow from free flow areas (FF 2 & FF3) which bypasses the on-site minor system.
5. Includes free flow area conveyed to Hilversum Lane right-of-way (FF2) and free flow area conveyed directly to the ravine (FF3).
6. Allowable release rates as per approved Robinson Report for Huntley Hollow Subdivision.

As shown in the table above, the total peak flows from the subject site tributary to the minor storm sewer system for the 2-year through 100-year design events, do not exceed the allowable release rates established in the overarching Robinson Report.

The Robinson Report assumed that during the 2-year design event, stormwater runoff from the subject site (i.e. Block 27) would be fully captured by the on-site minor system such that no major system flows would be conveyed to the Hilversum Lane right-of-way. However, based on grading constraints, some major system flow from the uncontrolled drainage area (i.e. FF2) will be conveyed to the Hilversum Lane right-of-way where it will be captured by an existing surface inlet and conveyed to the municipal minor storm sewer system (i.e. pipe run 211-OGS1). In review of the storm sewer design sheet prepared for the Huntley Hollow Subdivision, pipe run 211-OGS1 has a full flow capacity of 687.79 L/s and is only 49% full during the 2-year design event. The additional peak flow of 5.6 L/s generated from the subject site will only account for 0.81% of the total pipe capacity and therefore is considered a negligible increase.

Overall, the peak flows from the subject site during the 2-year through 100-year design events are less than the allowable release rates and therefore have been designed in keeping with the overarching Robinson Report. Refer to **Table F1: Ponding and Orifice Calculations** and supporting free flow calculations provided under **Appendix F** for more details.

## 8.4 Quantity Storage

In order to restrict stormwater peak flows to the rates provided in **Table 8.2**, on-site storage will be required. On-site storage (in excess of the allowable release rates) will be required for all storm events up to and including the 100-year event. In accordance with the current OSDG, there shall be no surface ponding during the 2-year design event and the maximum ponding depth shall not exceed 350mm. Required storage volumes have been calculated using the Modified Rational Method and the allowable release rates provided in **Table 8.2**. Storage volume and ponding depths for the on-site catchment areas during the 100-year design event have been summarized in the table below.

**Table 8.3: 100-Year Surface Storage Volumes & Ponding Depths**

Drainage Area	100-Year		
	Required Storage Volume (m <sup>3</sup> )	Available Storage Volume <sup>*1,2</sup> (m <sup>3</sup> )	Max. Static Ponding Depth <sup>*3,4</sup> (m)
STM1	0.0	2.8	0.30
STM2	0.0	2.1	0.30

Notes:

1. Available storage volumes are calculated using AutoCAD Civil3D by Autodesk.
2. Available storage volumes only account for surface storage.
3. Ponding depths are measured from the maximum static ponding elevation to the top of grate elevation.
4. Static ponding depth before overtopping occurs; there will be no surface ponding during the 100-year design event.

As shown in the table above, adequate on-site storage has been provided to detain the 100-year event to the allowable release rates established in the overarching Robinson Report. Since the capture rates of the ICDs exceed the peak flows from the tributary drainage areas, no surface ponding will occur for up to and including the 100-year design event. Refer to the storage volume tables provided under **Appendix F** for more details.

## 8.5 Stress Test (100-YR + 20%) and Freeboard

The stress test (100-year + 20%) event must be assessed to ensure that ponding limits do not encroach onto adjacent permanent structures. For drainage areas STM1 and STM2, no surface ponding will occur during the street test event. For building floodproofing, a minimum freeboard of 0.30m must also be provided between the maximum static ponding elevation and any building openings adjacent to the ponding area. The table below demonstrates the provided freeboard for the subject site:

**Table 8.4: Freeboard**

Drainage Area	Max. Static Ponding Elev.* <sup>1</sup> (m)	Building Opening Elevation (m)	Freeboard (m)	Stress Test Ponding Elev. (m)	Ground Surface Elev.* <sup>2</sup> (m)	Freeboard (m)
STM1	104.36	105.17	0.81	104.06* <sup>4</sup>	104.92	0.86
STM2	103.77	105.17	1.40	103.47* <sup>4</sup>	105.15	1.68
Cul-de-sac	103.36* <sup>3</sup>	103.66	0.30	103.42* <sup>3</sup>	103.51	0.09

Notes:

1. Maximum static ponding elevation before spilling occurs.
2. Ground surface elevation at perimeter of closest permanent structure adjacent to ponding area.
3. Ponding elevations as per approved Robinson Report for Huntley Hollow Subdivision.
4. Where no surface ponding is expected to occur, ponding elevations are set to the T/G elevation.

As demonstrated in the table above, adequate freeboard has been provided in accordance with the current OSDG. Static and stress test ponding elevations from the Robinson Report have been used to assess the freeboard for the club house which is adjacent to the ponding area for the Hilversum Lane cul-de-sac. Supporting flow and storage volume calculations for the stress test event are shown on the storage volume tables provided under **Appendix F**.

A freeboard of 0.30m has also been provided between the overtopping spill elevation for the Hilversum Lane cul-de-sac (103.36m) and the high point for the proposed parking garage ramp (103.66m).

## 8.6 Major System

Major system flows within the municipal right-of-way are conveyed via the dedicated overland flow block to the existing ravine. In the event that the minor system becomes blocked or over capacity, the major system for the subject site has been designed to cascade overland flow from the individual catchment areas to the adjacent Hilversum Lane right-of-way, except for free flow area (FF3) which is conveyed directly to the ravine. As demonstrated under **Section 8.5**, adequate freeboard has been provided between the major system spill elevations and any adjacent building openings.

## 8.7 Quality Control

Stormwater runoff captured by the on-site storm sewer system is conveyed to the existing municipal storm sewer system on Hilversum Lane. Minor system flows are then conveyed through an inline oil grit separator (OGS) unit located at the end of the municipal cul-de-sac before discharging to the existing ravine. As detailed in the Robinson Report, the OGS unit was sized to provide enhanced level (80% TSS removal) quality control for Phase 1 of the Huntley Hollow Subdivision (inclusive of the subject site; Block 27). The sizing of the OGS unit assumed a tributary drainage area and weighted runoff coefficient for the subject site. Refer to *Figure 5: OGS Unit Drainage Area Plan* from the Robinson Report, provided under **Appendix F**, which demonstrates the drainage area used to size the OGS unit. The

parameters used in sizing the OGS unit have been compared to the current parameters in the table below.

**Table 8.5: OGS Unit Sizing Parameters**

Design	Tributary Area (ha)	Runoff Coeff.
Robinson Report <sup>1</sup>	0.31	0.69
Current	0.20	0.72

Notes:

1. Approved Robinson Report (May 2024) for Huntley Hollow Subdivision.

As shown in the table above, the tributary area to the OGS unit has been reduced by approximately 36% while the weighted runoff coefficient has increased by approximately 4%. As demonstrated in **Table 7.1**, the revised parameters have reduced the peak flow rate to the minor system and therefore the treatment efficiency of the unit should not be negatively impacted. The OGS unit is a Stormceptor EFO8 model with a sediment storage capacity of 8780 litres and a maximum treatment rate of 1700 L/s. The OGS unit forms part of the amended Environmental Compliance Approval (ECA) issued by the Ministry of the Environment, Conservation and Parks for the Huntley Hollow Subdivision and associated stormwater management controls in the ravine. A copy of the issued ECA is provided under **Appendix F** for reference.

Additional quality control will be provided by the proposed Tempest LMF ICDs. The Tempest ICDs eliminate the passage of odours and floatables (i.e. oil, gasoline, leaves and other floating debris) and allows for debris and sediments to collect in the structures (refer to the Tempest technical manual provided under **Appendix F**).

Although stormwater runoff from the subject site which is captured by the minor system will receive quality control via the municipal OGS unit, the proposed surface treatments of the site plan do not warrant extensive quality control measures to protect the downstream watercourse against TSS. Approximately 44% of the site is comprised of building roof which is considered to generate 'clean' runoff. Approximately 40% of the site is comprised of landscaped area which is also considered to generate 'clean' runoff. The remaining 16% of the site is comprised of hard surface area, however, much of this area consists of terraces and pedestrian sidewalks/pathways. The implementation of an underground garage and elimination of surface parking areas reduces the level of TSS and hydrocarbons that could potentially be borne in stormwater runoff from the site. Surface vegetation will provide added quality control as discussed further under **Section 8.8** below.

## **8.8 Low Impact Development (LID)**

Low Impact Development (LID) is a stormwater management strategy that seeks to mitigate the impacts of increased runoff and stormwater pollution by managing runoff as close to its source as possible. LID comprises a set of site design strategies that minimize runoff through distributed, small scale structural practices that mimic natural or predevelopment hydrology through the processes of infiltration, evapotranspiration, harvesting, filtration and detention of stormwater. These practices can effectively remove nutrients, pathogens and metals from runoff, and they reduce the volume and intensity of stormwater flows. [Low Impact Development Technical Guidance Report, Aquafor Beech, February 2021].

City of Ottawa Technical Bulletin IWSTB-2024-04, notes that infiltration/exfiltration systems will not be permitted on sites with clay/silt soils due to their poor hydraulic properties. Based on the Geotechnical Investigation completed by Paterson, silty clay is anticipated to be encountered throughout the subject site (refer to geotechnical excerpts provided under **Appendix F**). Therefore, in accordance with IWSTB-2024-04 infiltration/exfiltration LID practices are not suitable for the subject site.

Much of site's stormwater runoff will be conveyed via grassed drainage swales and/or surface sheet flow over vegetated areas. A vegetative buffer of approximately 6.0m is provided between the developed portion of the site and the eastern property boundary adjacent to the existing ravine and watercourse. Surface vegetation will provide a degree of quality cleansing by reducing flow velocities, promoting infiltration and evapotranspiration during low intensity events, and filtration. The City of Ottawa does not have any guidelines to quantify the level of quality control achieved from such measures; however, surface vegetation will provide an overall benefit from a stormwater quality perspective.

## 9.0 UNDERGROUND PARKING GARAGE RAMP DESIGN

The proposed site plan for the subject site has incorporated an underground parking garage which will be accessed by a new entrance connection to the Hilversum Lane cul-de-sac. A detailed design of the parking garage ramp has been completed to ensure vehicle movements can be accommodated without conflicts.

An alignment has been created along the inside edge of the proposed ramp which represents the steepest longitudinal slopes which will be experienced by vehicles. The alignment has been offset from the inside edge by a distance of 0.60 m to represent the approximate path of travel of the vehicle tires. The proposed profile for the ramp has incorporated two vertical curves to ensure a smooth transition between varying longitudinal slopes.

Using AutoTURN Pro software, a vertical simulation of the ramp has been completed to assess any conflicts with vehicular movements. The vertical simulation has been completed based on the following parameters:

- Vehicle template for passenger vehicle (TAC-2017).
- Vehicle ground clearance reduced to 0.12 m.
- Set bottom of body clearance of 0.02 m.

The completed simulation has verified that there will be no conflicts with the proposed ramp profile using the parameters above. In other words, a vehicle with a ground clearance of 0.10 m or greater can utilize the ramp without a risk of bottoming out. Refer to the Parking Garage Ramp Plan & Profile (DWG. 25094-P1) provided under **Appendix B**.

## 10.0 EROSION AND SEDIMENT CONTROL

Prior to construction and until vegetation has been re-established in disturbed areas, temporary erosion and sediment control measures must be implemented to mitigate the impact of construction on receiving watercourses and existing infrastructure. The following erosion and sediment control (ESC) measures have been proposed for the subject site:

- Limiting the extent of exposed soils at any given time.
- Erosion and sediment control measures shall be maintained until vegetation has been re-established in all disturbed areas. Re-vegetate disturbed areas in accordance with approved Landscape Plan as soon as possible.

- Stockpile soil away (15 metres or greater) from watercourses, drainage features and top of steep slopes.
- Installation of silt sacks between frame and cover on all proposed and existing catch basins and open cover storm manholes until construction is completed.
- Silt fence barriers to be installed and maintained along property boundaries and where indicated on the erosion and sediment control plans.
- Installation of straw bale flow check dams where indicated on the erosion and sediment control plans.
- Installation of mud mats at all construction entrances.
- For dry weather periods (active and/or inactive construction phases) inspections of ESC measures shall be undertaken on a weekly basis.
- Inspection of ESC measures shall be undertaken immediately after major storm events (>25mm of rain in 24 hour period), significant snowmelt events (melting of snow at a rate which adversely affects the performance and function of the system), and extreme weather events.
- Visual inspections shall also be undertaken in anticipation of large storm events (or a series of rainfall and/or snowmelt days) that could potentially yield significant runoff volumes.
- Identify and rectify any deficiencies and undertake necessary maintenance measures as soon as possible.
- Inspections and maintenance of temporary ESC measures shall continue until they are no longer required.
- The Contractor shall ensure that records of inspection are taken, including at a minimum:
  - the inspector's name;
  - date of inspection;
  - visual observations;
  - any necessary remedial measures taken to maintain the interim ESC measures.
- Care shall be taken to prevent damage to ESC during construction operations.
- In some cases, barriers may be removed temporarily to accommodate construction operations. The affected barriers shall be reinstated immediately after construction operations are completed.
- ESC should be adjusted during construction to adapt to site features as the site becomes developed.
- ESC shall be cleaned of accumulated sedimentation as required and replaced as necessary.
- During the course of construction, if the Engineer believes that additional prevention methods are required to control erosion and sedimentation, the Contractor shall implement additional measures, as required, to the satisfaction of the Engineer.
- Construction and maintenance requirements for erosion and sediment controls are to comply with Ontario Provincial Standard Specification (OPSS) 805.

Refer to the Erosion and Sediment Control Plan (DWG. 25094-ESC1) provided under **Appendix B** for more details.

## 11.0 CONCLUSIONS

It has been demonstrated that the proposed site plan development located at 391 Hilversum Lane can be adequately serviced and stormwater management requirements can be achieved in accordance with current City of Ottawa guidelines and overarching reports. Specifically, the development of the site will include the following key servicing and stormwater management design features:

- Water supply will be provided by an extension of the existing 203mm diameter watermain stub off Hilversum Lane.
- Fire protection will be provided by a new on-site hydrant and by the existing hydrant located on Hilversum Lane.
- Sanitary flows will be conveyed to the existing sanitary sewer system on Hilversum Lane via a connection to the existing 200mm diameter sanitary sewer stub.
- Stormwater runoff (minor system) will be conveyed to the existing storm sewer system on Hilversum Lane via a connection to the existing 375mm diameter storm sewer stub.
- Stormwater peak flows will be restricted to the allowable release rates established in the overarching Robinson Report prepared for the Huntley Hollow Subdivision.
- Adequate on-site storage will be provided for all events up to and including the 100-year design event.
- The major system design will convey overland flow to the adjacent municipal right-of-way.
- Quality control of stormwater runoff will be provided by the existing inline OGS unit located on Hilversum Lane, LMF ICDs and vegetative buffer.
- Erosion and sediment control measures will be implemented prior to construction and maintained until vegetation has been re-established in disturbed areas.

Report Prepared By:



---

Brandon MacKechnie, P.Eng.  
Project Engineer

## Appendix A

Pre-Consultation Notes

Superseded Plan of Subdivision  
(prepared by FMW)

Plan of Subdivision (prepared by FMW)

Huntley Hollow General Plan of  
Services (DWG. 19008-S2)

Huntley Hollow Grading Plan  
(DWG. 19008-GR2)

Carp Short Term Upgrades  
Presentation

Correspondence with City

May 5, 2025

Robin Daigle  
Inverness Homes Inc.  
Via email: [robin@invernesshomes.ca](mailto:robin@invernesshomes.ca)

**Subject: Pre-Consultation: Meeting Feedback  
Proposed Site Plan Control Application – 391 Hilversum Lane**

Please find below information regarding next steps as well as consolidated comments from the above-noted pre-consultation meeting held on April 30, 2025.

### **Pre-Consultation Preliminary Assessment**

1 <input type="checkbox"/>	2 <input checked="" type="checkbox"/>	3 <input type="checkbox"/>	4 <input type="checkbox"/>	5 <input type="checkbox"/>
----------------------------	---------------------------------------	----------------------------	----------------------------	----------------------------

One (1) indicates that considerable major revisions are required while five (5) suggests that the proposal appears to meet the City's key land use policies and guidelines. This assessment is purely advisory and does not consider technical aspects of the proposal or in any way guarantee application approval.

### **Next Steps**

1. A review of the proposal and materials submitted for the above-noted pre-consultation has been undertaken. For your next submission, please submit the required Application Form, together with the necessary studies and/or plans to [planningcirculations@ottawa.ca](mailto:planningcirculations@ottawa.ca), copy (cc:) to the file lead and planning support.
2. In your subsequent pre-consultation or application submission, please ensure that all comments or issues detailed herein are addressed. A detailed cover letter stating how each issue has been addressed is requested with the submission materials. Please coordinate the numbering of your responses within the cover letter with the comment number(s) herein.
3. Please note, if your development proposal changes significantly in scope, design, or density it is recommended that a subsequent pre-consultation application be submitted.

### **Supporting Information and Material Requirements**

1. The attached **Study and Plan Identification List** outlines the information and material that has been identified, during this phase of pre-consultation, as either required (R) or advised (A) as part of a future complete application submission.

- a. The required plans and studies must meet the City's Terms of Reference (ToR) and/or Guidelines, as available on [Ottawa.ca](http://Ottawa.ca). These ToR and Guidelines outline the specific requirements that must be met for each plan or study to be deemed adequate.

### **Consultation with Technical Agencies**

1. You are encouraged to consult with technical agencies early in the development process and throughout the development of your project concept. A list of technical agencies and their contact information is enclosed.

### **Planning**

Comments:

1. The site is within the Rural Transect of the City of Ottawa's [Official Plan](#) (2022) and is designated Village. Under the [Village of Carp Secondary Plan](#), the site is designated Village Residential 3. The property is zoned Village Residential Third Density Subzone I Rural Exception Nine-Hundred and Thirty-Two with a Holding Zone (V3I[932r]-h) under the City's [Zoning By-law](#).
  - a. A major challenge in the Village of Carp identified by the Secondary Plan is the lack of affordable housing, particularly for seniors and young people. The applicant should consider the provision of affordable units within the proposed apartment building. Details are provided below on the City's Affordable Housing Community Improvement Plan, and supports exist at other levels of government to support affordable housing development within the private sector.
2. The subject site is within a draft approved subdivision (City files D07-16-19-0034 and D07-16-21-0012). The conditions of the subdivision must be fulfilled and the subdivision registered prior to the registration of a site plan agreement for this site.
3. There is a Holding Zone affecting this property. The hold associated with this rural exception can only be lifted once it has been demonstrated, to the satisfaction of the City, that there is sufficient servicing capacity for the development. An application for [Lifting the Holding By-law](#) will need to be submitted once sufficient servicing capacity is available prior to the site plan application.
4. The following plans and reports are required for the planning portion of a formal application for Site Plan Control:
  - a. A Site Place that conforms to the [City's Site Plan Terms of Reference](#). The Site Plan shall be consistent with other plans and reports submitted in support of this application.

- i. Setbacks for environmental constraints must be clearly marked and will assist with any future discussions on design concepts.
- b. A [Zoning Confirmation Report](#) that shows the proposed development's conformity with the City of Ottawa's Zoning By-law (ZBL).
- c. [Building elevations](#) that demonstrate the visual of proposed development to understand facing of building including direction of sunlight, height, doors, and windows.
- d. A [Plan of Survey](#) outlining the boundary of the subject property and any other relevant information including utility lines, registered easements, etc.
- e. A [Landscape Plan](#) that identifies any existing natural features and shows any tree plantings or soft landscaping proposed to support the development.

#### Site-Specific Comments on the Proposed Design

5. The proposed site plan lists 46 vehicular parking spaces being provided (40 underground spaces and six spaces at grade). However, 47 parking spaces are required: 39 residence parking spaces (1 per dwelling unit x 39 units) as well as eight visitor parking spaces (0.2 per dwelling unit x 39 units, rounded to the nearest whole number).
6. No bicycle parking is shown on the plan. The plan must include 20 bicycle parking spaces (0.5 per dwelling unit). Staff encourage the applicant to consider an interior secured bike room for residents in addition to an exterior secure and covered bike rack for visitors.
7. Ensure that the site's design meets the [City's accessibility design standards and features](#).
  - a. It appears that one Type A parking space is provided within the center of the roundabout; however, two accessible parking spaces are required (one Type A and one Type B) as per the [City's Traffic and Parking By-law](#). There is also no appropriate access aisle provided adjacent to the accessible parking space.
  - b. Staff would recommend that the applicant explores designs that place the accessible parking spaces closer to the front entrance, without the need to cross the drive aisle.
  - c. Tactile Walking Surface Indicators (TWSIs) should be considered at walkways entering the drive aisle/parking area.

- d. Staff appreciate the overhang over the front entrance, and recommend benches to be located nearby.
8. The common amenity areas provided on the concept plan do not appear to meet the Zoning By-law requirements. Section 137 requires that 6m<sup>2</sup> per dwelling unit be provided (234m<sup>2</sup> for 39 units) and 50% of this total must be provided as communal amenity area (117m<sup>2</sup>). The yoga, exercise and activity room appear to only be 86m<sup>2</sup>. If feasible, in addition to the internal amenities, outdoor amenity space should be considered. 54m<sup>2</sup> of the communal amenity space must be aggregated.
9. Snow storage must be shown or noted on the plan.
10. Staff are not supportive of the auto-centric focus of the front entrance, especially considering that the site is located at the end of a cul-de-sac. If the front entrance was located closer to the street, drop off and pick up functions as well as access by fire services could occur in the street.
11. As the application is over six residential units, the [City's Solid Waste Collection Design Guidelines for Multi-Unit Residential Development](#) will apply. If the development cannot meet the guidelines due to site design, a Waste Management Brief may be required in coordination with Solid Waste Services to find an acceptable strategy.
12. The City is working on [a new Zoning By-law](#). The applicant asked for details regarding possible reductions in parking minimums for Villages. Policy staff have [recommended different options for parking](#) in Villages to Council, and there are concerns by Council to remove parking minimums in the Villages entirely. It could be the case that the parking minimums for multi-unit developments could change with the new Zoning By-law, but it is not clear at this time what direction Council will choose after being presented the options for parking minimums in villages. The minimum visitor parking requirement is proposed to be lowered to 0.1 spaces per dwelling unit from 0.2 spaces per dwelling unit.


Please contact Jerrica Gilbert, Planner II, for follow-up questions.

### **Urban Design**

Comments:

13. The following plans and reports will be required as part of a complete submission for site plan:
  - a. Urban Design Brief (Terms of Reference attached)
  - b. Site Plan
  - c. Building Elevations
  - d. Landscape Plan
  - e. Floor Plans (Optional)

14. Staff recognize that the site has three critical frontages: Hilversum Lane, the proposed park, and the environmental area.
15. Staff do not support the amount of auto-oriented functions at the front of the building along Hilversum Lane. Consolidation is needed so that the building can engage with the public realm and its surroundings. With the current scheme, staff believe that the following area (Figure 1 below) could be optimized if the parking ramp was internal to the building.

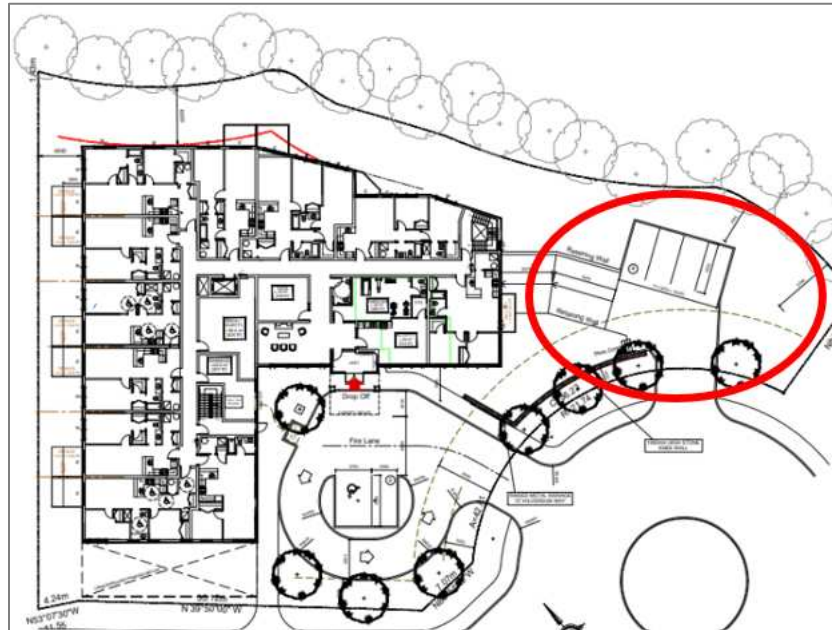

16. Staff are looking to understand the ground floor interface with Hilversum Lane, the proposed park, and the environmental area. Ground floor units with individual entrances and amenity areas are recommended.
17. The public realm should be bolstered with tree planting and other softscape.
18. If possible, Urban Design staff would like to review the alternate site plan options that were discussed at the meeting.

Please contact Nader Kadri, Planner III – Urban Design, for follow-up questions.

### **Engineering**

Comments:

19. A servicing report is required.
20. The Stormwater Management Criteria, for the subject site, is to be based on the following:

- a. Application of the IDF information derived from the Meteorological Services of Canada rainfall data, taken from the MacDonal Cartier Airport, collected 1966 to 1997.
- b. A calculated time of concentration (cannot be less than 10 minutes).
- c. The quantity control criteria is  $c = 0.65$  (to be up-rated for infrequent storms). Designs showing a runoff coefficient higher shall retain the delta on site.
- d. The stormwater quality control criteria is that of 80 % TSS removal.
- e. Low Impact Development techniques (LID) are required.

## 21. Water

- a. There is limited capacity.
- b. Water data card (future requirement).
- c. Water Boundary condition requests must include the location of the service (map or plan with connection location(s) indicated) and the expected loads required by the proposed development, including calculations. Please provide the following information:
  - i. Location of service
  - ii. Type of development
  - iii. The amount of fire flow required (per Tech Bulletin IWSTB-2024-05)- limited capacity in the Village of Carp may control the size of development and/or may require costly additional fire control techniques (to be provided at the cost of the owner).
  - iv. Average daily demand: \_\_\_ l/s.
  - v. Maximum daily demand: \_\_\_ l/s.
  - vi. Maximum hourly daily demand: \_\_\_ l/s.
- d. Fire route to be designated with By-law, copying the engineering reviewer, at [fireroutes@ottawa.ca](mailto:fireroutes@ottawa.ca). The fire route appears tight for a firetruck.

## 22. Sewer (sanitary and storm)

- a. Capacity in the subdivision is, presently, limited to 264.3 persons, as stated in the Servicing and Stormwater Management Report, prepared by Robinson Land Development, project no. 19008, revised May 2024, for

the foreseeable future. A holding provision, or some other mechanism will be required to limit development amongst proposals.

23. A grading plan is required. The grading plan shall include the datums used to establish horizontal and vertical co-ordination for the site. Grading is required for each and every TWSI.
24. A geotechnical report is required (including, a detailed sensitive marine clay investigation including, but not limited to Atterberg Limits, consolidation testing, sensitivity values, shrinkage testing and Nilcon vane shear test results). A seasonal high groundwater estimate is required, over spring estimates will not be accepted.
25. A slope stability report is required by the Morgenstern-Price method.
26. A fluvial geomorphological report is required.
27. The construction constraints on the project are that of the surrounding subdivision still being constructed. The drop off spot seems hard to turn in and out of.
28. There are no [Capital Works Projects](#) scheduled that affect this project, at April 25, 2025, but this may change.
29. Development cannot obtain Site Plan Control approval until after the subdivision is registered and the holding provision is either cleared or revised.
30. The Building Code does not address ramp grades. Underground ramps should be limited to a 12% grade and must contain a subsurface melting device when exceeding 6%. Ramp grades steeper than 15% can be psychological barriers to some drivers. The winter weather in Ottawa can be troublesome for steeper grades, even those with melting devices. Please note that curves can see the grade steepen in the inside of the bend. When the underground parking ramp's break over slope exceeds 8%, a vertical-curve transition should be used, which will need detailed grading to carry the transition. Without the transition, "bottoming out" of vehicles may occur.

Please contact Damien Whittaker, Senior Engineer - Infrastructure Applications, for follow-up questions.

### **Noise**

Comments:

31. A Surface Transportation Noise study is not required.

Please contact Josiane Gervais, Transportation Project Manager, for follow-up questions.

## Transportation

### Comments:

#### 32. Follow Transportation Impact Assessment Guidelines:

- a. Submit a Screening Form applicable to the Site Plan application at your earliest convenience to [josiane.gervais@ottawa.ca](mailto:josiane.gervais@ottawa.ca).
- b. If a Transportation Impact Assessment is required. Please submit the Scoping/Forecasting report to [josiane.gervais@ottawa.ca](mailto:josiane.gervais@ottawa.ca) at your earliest convenience. The applicant is responsible to submit the Scoping Report prior to application and must allow for a 14 day circulation period. The Strategy Report (including Synchro files) must be submitted with the formal submission to deem complete. The applicant is strongly encouraged to submit the Strategy Report to the TPM prior to formal submission and allow for a 14 day circulation period. Note that the [TIA Guidelines](#) have been updated, the changes are available on the City's website.
- c. If a TIA is not required, complete and submit the [Transportation Demand Management Measures Checklist](#) and the [Transportation Demand Management Supportive Development Design and Infrastructure Checklist](#) in support of the application.

#### 33. Ensure that the development proposal complies with the Right-of-Way protection requirements of the Official Plan's [Schedule C16](#).

#### 34. The site is within proximity of the following arterials/collectors, as per the OP:

- a. Carp Road (2-lane arterial)
- b. Langstaff Drive (2-lane collector)
- c. Donald B. Munro (2-lane collector)

#### 35. As the site proposed is residential, AODA legislation applies for all areas accessible to the public (i.e. outdoor pathways, parking, etc.). Provide a 1.5m wide access aisle next to the accessible parking stall.

#### 36. On site plan:

- a. Ensure site access meets the City's [Private Approach Bylaw](#).
- b. Show all details of the roads abutting the site; include such items as pavement markings, signage, accesses, on-street parking, and/or sidewalks.

- c. Clearly distinguish between where the curbs are depressed and where they are full height.
- d. Turning movement diagrams required for all accesses showing the largest vehicle to access/egress the site.
- e. Turning movement diagrams required for internal movements (loading areas, garbage).
- f. Show all curb radii measurements; ensure that all curb radii are reduced as much as possible and fall within TAC guidelines (Figure 8.5.1).
- g. Show dimensions for site elements (i.e. lane/aisle widths, access width and throat length, parking stalls, sidewalks, pedestrian pathways, etc.)
- h. Sidewalk is to be continuous across access as per City Specification 7.1.
- i. Show slope of garage ramp on site plan. Note that underground ramps should be limited to a 12% grade and must contain a subsurface melting device when exceeding 6%. Ramp grades greater than 15% can be psychological barriers to some drivers. When the underground parking ramp's break over slope exceeds 8%, a vertical-curve transition or a transition slope of half the ramp slope should be used. Without this transition, bottoming out of vehicles may occur.

Please contact Josiane Gervais, Transportation Project Manager, for follow-up questions.

## **Environment**

Comments:

- 37. Please provide an up-to-date Environmental Impact Statement (EIS) and Tree Conservation Report (TCR) for the project. The submission must include a new Information Gathering Form (IGF) for the proposed development area. This information will help determine an appropriate and detailed site plan layout, and incorporate Ministry of the Environment, Conservation and Parks (MECP) direction as per the requirements under the Planning Act and Species at Risk (SAR).
- 38. If the proposed buildings are four storeys in height or under, a discussion on Bird Safe Design Guidelines will not be a requirement within the EIS. Although not a requirement, the proponent is still encouraged to reference the guidelines and incorporate any design features they deem beneficial to the project.
- 39. Please ensure the plans and drawings clearly delineate the top of bank, the top of slope, natural heritage/habitat setbacks, and natural hazard setbacks, etc., as per the requirements of the Official Plan (Section 4.9.3), Secondary Plan, Carp

River Watershed/Subwatershed Study, and/or applicable agency legislation and stipulations. This may include, but is not limited to, the local Conservation Authority, the Department of Fisheries and Oceans, the Ministry of the Environment, Conservation and Parks (MECP), etc. For example, any Blanding's Turtle habitat should be up-to-date and clearly delineated.

40. The integrated and updated EIS/TCR with associated drawings specifically delineated important setbacks and/or vegetative buffers must be made available on site throughout the various phases of development (i.e., site preparation, site alterations, grading, development and until the site has been reestablished to pre-conditions or better). In addition, this information, along with any applicable training material must be provided to all the onsite supervisors. The intent is to ensure due diligence due to the sensitive nature of the subject area, habitat, and/or species at risk.
41. Sweeps of the work area should be completed prior to each workday, and any Species at Risk (SAR) occurrences must be submitted to the Natural Heritage Information Centre (NHIC), the Ministry of the Environment, Conservation and Parks (MECP), and the proponents project biologist as soon as possible. Work that may impact the species must be halted until further direction is obtained from the Ministry.
42. The integrated EIS/TCR report must include a discussion on temporary exclusion fencing (Species at Risk Branch Best Practices Technical Note, Reptile and Amphibian Exclusion Fencing - Version 1.1, dated July 2013) that will be used during site alterations and development, such as in the vicinity of the ravine corridor. The intent is to ensure that turtles or other sensitive wildlife species cannot access the construction area. Any permanent exclusionary fencing and locations should also be detailed within the report. For example, please detail the temporary exclusion fencing measures along the outer edge of the Category 2 Blanding's turtle habitat, as well as the permanent fencing measures that should be located inside of any proposed pathway alignment.
43. Please provide a Landscape Plan to support the application. The submitted information will help ensure no adverse impacts to the existing tree cover on the property and on the adjacent lands. The plan may also help with achieving the City's long-term tree canopy targets. In addition, any endangered species, such as Butternut trees, must be identified on the plan and appropriately addressed prior to site alterations and development. Low Impact Development (LID) strategies are also encouraged, where feasible. Although LID strategies help with stormwater management, they also help achieve additional greenspace and locally appropriate native tree species and tree cover.
44. Please provide a Lot Grading and Drainage Plan and ensure any proposed site alterations, grading and development are outside of any natural heritage or hazard areas, including Blanding's turtle habitat.

Please contact Kim MacDonald, Environmental Planner, for follow-up questions.

## **Forestry**

Comments:

### Tree Protection

45. A Tree Conservation Report is required, in accordance with Schedule E of the Tree Protection By-law. Ownership of all trees on the subject site and with Critical Root Zones extending onto the subject site must be determined, and plans must show how they will be protected from proposed works. This may be combined with the Landscape Plan, but must show the locations of tree protection fencing and note any required mitigation measures.
  - a. Given that the only trees near the site are within the ravine area, they are a very high priority to retain. The TCR should, however, identify any trees within the ravine area which may present undue risk to the subject site, and provide mitigation or management recommendations.
46. A permit is required prior to removal of any protected trees on site. The tree permit will be released upon site plan approval. Monetary compensation for City trees must be paid before the permit is issued. Please contact the planner associated with the file or the Planning Forester, Nancy Young ([Nancy.young@ottawa.ca](mailto:Nancy.young@ottawa.ca)) for information on obtaining the tree permit.
47. To ensure that no harm is caused to breeding birds, tree removal and vegetation clearing should be avoided during the migratory bird season (April 15 – August 15) as specified by The City of Ottawa's Environmental Impact Study Guidelines.

### Landscaping

48. A Landscape Plan is required with this application and must address all requirements within the Landscape Plan Terms of Reference [https://documents.ottawa.ca/sites/documents/files/landscape\\_tor\\_en.pdf](https://documents.ottawa.ca/sites/documents/files/landscape_tor_en.pdf) , including the projection of canopy cover toward the target of 40%, and confirmation of adequate soil volumes to support any proposed trees.
49. The Landscape Plan must show the setback distances between proposed and existing trees to buildings and underground structures to ensure that both the above and below-ground space proposed is sufficient for tree planting in the Right of Way (across the full frontage) and other landscaped areas.
50. Site Plan applications should provide areas for tree planting on site to increase the canopy cover and shade for residents and visitors to the site.

51. Planting of large-growing native trees must be prioritized where sufficient soil volume and conditions allow (including geotechnical restrictions), particularly within the City-owned ROW.
52. Please provide the approved Geotechnical Report and map to confirm any tree planting restrictions.
  - a. The Landscape Plan must show restricted planting areas as recommended in the approved Geotechnical Report and confirm that all required conditions for planting at reduced setbacks are met. This should be provided in the notes block for clarity.
  - b. Confirm with the Geotechnical Engineer if tree planting restrictions apply where underground parking is proposed [e.g. deep foundations]. If yes, the section of underground parking close to the road frontage must be reduced to provide sufficient setbacks to plant trees in the ROW.
53. Confirm what is proposed within the constrained area between the building and the treed edge of the ravine. If this is to be open space, it would be a good candidate for tree planting opportunities to increase the canopy cover of the site.
54. Consider aligning the underground parking with above-ground parking/hard surface, to limit impacts to softscape elsewhere.
55. The Official Plan section 4.8.2, sub 3 provides the following direction related to tree planting related to site plans:
  - a) Preserve and provide space for mature, healthy trees on private and public property, including the provision of adequate volumes of high-quality soil as recommended by a Landscape Architect;
  - b) On urban properties subject to site plan control or community planning permits, development shall create tree planting areas within the site and in the adjacent boulevard, as applicable, that meet the soil volume requirements in any applicable City standards or best management practices or in accordance with the recommendation of a Landscape Architect;

Please contact Nancy Young, Forester, for follow-up questions.

### **Parkland**

Comments:

56. Parkland Dedication
  - a. Parkland Dedication is required for the developemnt as per [By-law No. 2022-280](#).

- b. The lot was accounted for in the parkland dedication requirements for the related subdivision application. No further parkland dedication is required.

#### 57. Park Adjacency

- a. The subject sites abuts the future park block with the site plan showing the building at 4.5 meters from the park property line and the terraces within 1 meter of the park fence line. Parks staff will be looking at the elevation drawings for this side of the building. Would encourage landscaping on this side of the building.

Please contact Anissa McAlpine, Parks Planner, for follow-up questions.

### **Mississippi Valley Conservation Authority**

Comments:

58. MVCA mapping sources identify a watercourse adjacent to the subject property. MVCA regulates activities including straightening, changing, diverting or interfering in any way with the existing channel or the shoreline of a watercourse under Ontario Regulation 41/24. Under Ontario Regulation 41/24, written permission is required from the MVCA prior to the initiation of any works.

59. Please note that MVCA does not have flooding or erosion hazard mapping completed for this watercourse.

- a. MVCA understands that the Limit of Hazard Lands were established through the subdivision process for 147 Langstaff. The Limit of Hazard Lands should be shown on the plans, and all grading and development is to be located outside on this limit.

60. MVCA may review the stormwater management plan with a focus on quantity management with respect to natural hazards from the receiving watercourse perspective.

Please contact Mercedes Liedtke, Environmental Planner, for follow-up questions.

### **Other**

61. The High Performance Development Standard (HPDS) is a collection of voluntary and required standards that raise the performance of new building projects to achieve sustainable and resilient design and will be applicable to Site Plan Control and Plan of Subdivision applications.

- a. The HPDS was passed by Council on April 13, 2022, but is not in effect at this time, as Council has referred the 2023 HPDS Update Report back to staff with the direction to bring forward an updated report to Committee at

a later date. The timing of an updated report to Committee is unknown at this time, and updates will be shared when they are available.

- b. Please refer to the HPDS information at [ottawa.ca/HPDS](http://ottawa.ca/HPDS) for more information.
62. Under the Affordable Housing Community Improvement Plan, a Tax Increment Equivalent Grant (TIEG) program was created to incentivize the development of affordable rental units. It provides a yearly fixed grant for 20 years. The grant helps offset the revenue loss housing providers experience when incorporating affordable units in their developments.
- a. To be eligible for the TIEG program you must meet the following criteria:
    - i. the greater of five units OR 15 per cent of the total number of units within the development must be made affordable
    - ii. provide a minimum of 15 per cent of each unit type in the development as affordable
    - iii. enter into an agreement with the city to ensure the units maintain affordable for a minimum period of 20 years at or below the city-wide average market rent for the entire housing stock based on building form and unit type, as defined by the Canada Mortgage and Housing Corporation
    - iv. must apply after a formal Site Plan Control submission, or Building Permit submission for projects not requiring Site Plan Control, and prior to Occupancy Permit issuance
  - b. Please refer to the TIEG information at [Affordable housing community improvement plan / Plan d'améliorations communautaires pour le logement abordable](#) for more details or contact the TIEG coordinator via email at [affordablehousingcip@ottawa.ca](mailto:affordablehousingcip@ottawa.ca).

### **Concluding Remarks**

Should there be any questions, please do not hesitate to contact myself or the contact identified for the above areas / disciplines.

Yours Truly,  
Jerrica Gilbert  
Planner II, Development Review – Rural



Encl. Supplementary Development Information, List of Technical Agencies to Consult, Study and Plan Identification List, Urban Design Brief Terms of Reference, High Performance Development Standards Pre-consultation Handout and Checklist, City of Ottawa Accessibility Checklist, MVCA Regulation Map

c.c. Damien Whittaker, Senior Engineer - Infrastructure Applications  
Josiane Gervais, Transportation Project Manager  
Kim MacDonald, Environmental Planner  
Nancy Young, Planning Forester  
Anissa McAlpine, Parks Planner  
Nader Kadri, Planner III – Urban Design  
Sarah McCormick, Planner III – Rural  
Cass Scлаuzero, Planner II – Rural

## **SUPPLEMENTARY DEVELOPMENT INFORMATION**

The following details have been compiled to provide additional information on matters for consideration throughout the application approval and development process. Please note, this document is updated from time to time and should be reviewed for each project proposed to be undertaken.

### **General**

- Refer to [Planning application submission information and materials](#) and [fees](#) for further information on preparing for application submission. Be aware that other fees and permits may be required, outside of the development review process.
- Additional information is available related to [building permits, development charges, and the Accessibility Design Standards](#).
- You may obtain background drawings by contacting [geoinformation@ottawa.ca](mailto:geoinformation@ottawa.ca).
- Plans are to be standard A1 size (594 mm x 841 mm) or Arch D size (609.6 mm x 914.4 mm) sheets, dimensioned in metric and utilizing an appropriate Metric scale (1:200, 1:250, 1:300, 1:400 or 1:500).
- All PDF submitted documents are to be unlocked, flattened and not saved as a portfolio file.
- Where private roads are proposed:
  - Submit a Private Roadway Street Naming application to Building Code Services Branch for any internal private road network.
  - Applications are available at all Client Service Centres and the private roadway approval process takes three months.

### **Servicing and Site Works**

Servicing and site works shall be in accordance with the following documents:

- Ottawa Sewer Design Guidelines (October 2012)
- Ottawa Design Guidelines – Water Distribution (2010)
- Geotechnical Investigation and Reporting Guidelines for Development Applications in the City of Ottawa (2007)
- City of Ottawa Slope Stability Guidelines for Development Applications (revised 2012)
- City of Ottawa Environmental Noise Control Guidelines (January, 2016)
- City of Ottawa Park and Pathway Development Manual (2012)
- City of Ottawa Accessibility Design Standards (2012)
- Ottawa Standard Tender Documents (latest version)
- Ontario Provincial Standards for Roads & Public Works (2013)

### **Exterior Site Lighting**

Where proposed, requires certification by an acceptable professional engineer, licensed in the Province of Ontario, which states that the exterior site lighting has been designed to meet the following criteria:

- It uses only fixtures that meet the criteria for Full Cut-Off (Sharp cut-off) classification, as recognized by the Illuminating Engineering Society of North America (IESNA or IES), and
- It results in minimal light spillage onto adjacent properties. As a guideline, 0.5 foot-candle is normally the maximum allowable spillage.

The location of the fixtures, fixture type (make, model, part number and the mounting height) must be shown on one of the approved plans.

### **City Surveyor Direction**

- The determination of property boundaries, minimum setbacks and other regulatory constraints are a critical component of development. An Ontario Land Surveyor (O.L.S.) needs to be consulted at the outset of a project to ensure properties are properly defined and can be used as the geospatial framework for the development.
- Topographic details may also be required for a project and should be either carried out by the O.L.S. that has provided the Legal Survey or done in consultation with the O.L.S. to ensure that the project is integrated to the appropriate control network.

Questions regarding the above requirements can be directed to the City's Surveyor, Andre Roy, at [Andre.Roy1@ottawa.ca](mailto:Andre.Roy1@ottawa.ca).

### **Waste Management**

- New multi-unit residential development, defined as containing six (6) or more units, intending to receive City waste collection services will be required, as of June 1, 2022, to participate in the City's Green Bin program in accordance with Council's approval of the [multi-residential waste diversion strategy](#). The development must include adequate facilities for the proper storage of allocated garbage, recycling, and green bin containers and such facilities built in accordance with the approved site design. Questions regarding this change and requirements can be directed to [Andre.Laplante@ottawa.ca](mailto:Andre.Laplante@ottawa.ca).
- For sites containing:
  - One or more buildings with a total GFA greater than 2000 square metres;
  - Retail shopping complexes with a total GFA greater than 10,000 square metres;
  - Sites containing office buildings with total GFA greater than 10,000 square metres;
  - Hotels and motels with more than 75 units;
  - Hospitals (human);
  - Educational institutions with more than 350 students; or
  - Manufacturing establishments working more than 16,000 person-hours in a month

A Waste Reduction Workplan Summary is required for the construction project as required by O.Reg. 102/94, being "Waste Audits and Waste Reduction Work Plans" made under the Environmental Protection Act, RSO 1990, c E.19, as amended.

### **Fire Routes**

- Fire routes are required to be designated by By-law for Fire Services to establish them as a legal fire route. Where a development proposes to establish a fire route, an Application for Fire Route Designation is to be made. Questions regarding the designation of fire routes and required process can be directed to [fireroutes@ottawa.ca](mailto:fireroutes@ottawa.ca).

### **Dewatering Activities**

- Project contractors and/or your engineers are required to contact the Sewer Use Program to arrange for the proper agreements or approvals to allow for the discharge of water from construction dewatering activities to the City's sanitary or storm sewer system. Please contact the Sewer Use Duty Officer at 613-580-2424 ext. 23326 and/or [suppue@ottawa.ca](mailto:suppue@ottawa.ca).

### **Backflow Prevention Devices for Premise Isolation**

- Buildings or facilities installing a backflow preventer for premise isolation of the drinking water system must register with the City's Backflow Prevention Program where a moderate or severe hazard may be caused in accordance with CSA B64.10 "Selection and Installation of Backflow Preventers". Please contact the Backflow Prevention Program at 613-580-2424 ext. 22299 or [backflow@ottawa.ca](mailto:backflow@ottawa.ca) to submit a Premise Isolation Survey.

### **Energy Considerations**

- Are you considering harvesting thermal energy from the wastewater infrastructure or harvesting geothermal energy?
  - Additional information can be found on the City [website](#) or by contacting [Melissa Jort-Conway](#).

### **Flood Plain Mapping and Climate Change**

- An interactive map, for informational purposes only, showing the results of on-going flood plain mapping work completed by the Conservation Authorities in partnership with the City is now available. This mapping may be used to identify known riverine flood hazards for a property or area. The map and additional related information can be found on [Ottawa.ca](#).

### **Blasting**

- Where blasting may take place:
  - Blasting activities will be required to conform to the City's Standard S.P. No. F-1201 entitled Use of Explosives, as amended.
  - To avoid future delays in process, including the Municipal Consent process for shoring, ensure communication with necessary entities, including utilities, is undertaken early.
- Blasting and pile driving activities in the vicinity of Enbridge Gas Distribution and Storage (GDS) facilities require prior approval by GDS. The Blasting and Pile Driving Form, referenced in Enbridge's [Third Party Requirements in the Vicinity of Natural Gas Facilities Standard](#), must be provided to [mark-ups@enbridge.com](mailto:mark-ups@enbridge.com) by the Owner of the proposed work for all blasting and pile driving operations. In addition, a licensed blasting consultant's stamped validation report must be submitted to GDS for review if blasting is to occur within thirty (30) metres of GDS facilities. The request must be submitted a minimum of four weeks prior to the beginning of work to allow sufficient time for review.

## Archaeological

- Archaeological Resources
  - Should potential archaeological resources be encountered during excavation activities, all Work in the area must stop immediately and the Owner shall contact a provincially licensed archaeologist.
  - If during the process of development deeply buried/undetected archaeological remains are uncovered, the Owner shall immediately notify the Archaeology Section of the Ontario Ministry of Tourism, Culture and Sport.
  - In the event that human remains are encountered during construction, the Owner shall immediately contact the police, the Ministry of Tourism, Culture and Sport and the Registrar of Cemeteries, Cemeteries Regulation Unit, Ministry of Consumer and Business Services, Consumer Protection Branch.

## Trees

- The City's Tree Protection Bylaw, being By-Law No. 2020-340, as amended, requires that any trees to be removed shall be removed in accordance with an approved Tree Permit and Tree Conservation Report and that all retained trees will be protected in accordance with an approved Tree Conservation Report.

## Limiting Distance and Parks

- A Limiting Distance Agreement may be required by Building Code Services before building permit(s) can be issued with respect to the proximity of the building to a park block. The City will consider entering into a Limiting Distance Agreement with the Owner with such Agreement to be confirmed through the City's Reality Initiatives & Development Branch. A Limiting Distance Agreement is at the expense of the Owner.

## Development Constructability

How a development is constructed, its constructability, is being looked at earlier in the development review process to raise awareness of potential impacts to the City's right of way and facilitate earlier issue resolution with stakeholders. Where a construction management plan is required as part of the site plan or subdivision application approval, conditions will be included that set out the specific parameters to be addressed for the specific project. However, please note the following construction and traffic management requirements and considerations in the development of your project.

- **Open Lane (includes all vehicular lanes, transit lanes and cycling lanes) Requirements**
  - Unless specified in the site-specific conditions to be provided by City of Ottawa Traffic Management at the time of approval, the following requirements must be adhered to and accommodated as part of any proposed encroachments and construction management plan. The standard requirements outlined in this section shall further apply to cycling facilities and Transit.
    - All lanes are to function uninterrupted at all times.
    - No interruption or blockage of traffic is permitted.
    - No loading or unloading from an open lane is permitted.
    - All vehicular travel lanes are to be a minimum of 3.5 metres in width.

- All cycling lanes are to be a minimum of 1.5 metres.
- **Pedestrian Requirements**
  - Unless specified in the site-specific conditions provided by City of Ottawa Traffic Management at the time of approval, the contractor is required to maintain a minimum width of 1.5 metres for a pedestrian facility on one side of the corridor at all times; even in instances where a pedestrian facility was not present prior to construction.
  - The facility shall include a free and unobstructed hard surface acceptable for the use of all pedestrians including those with accessibility challenges and shall maintain access to all buildings and street crossings.
  - The facility must always be maintained in a clean condition and in a good state of repair to the satisfaction of the City.
  - Any change of level which is over 13 millimetres in height is to be provided with a smooth non-tripping transition.
  - Any temporary barriers or fencing shall include a cane detectable boundary protection with edge or barrier at least 75 millimetres high above the ground surface.
  - If works overhead are required, a 2.1 metre minimum clear headroom must be provided.
  - If overhead protection is required above the pedestrian facility, it is to be offset a minimum of 600 millimetres from any travel lane.
- **Transit Requirements**
  - Travel lanes accommodating OC Transpo must be a minimum of 3.5 metres in width and have a minimum 4.5 metre vertical clearance at all times.
  - Should access to a bus stop be impacted, the developer will be required to email [TOPConstructionandDetours@ottawa.ca](mailto:TOPConstructionandDetours@ottawa.ca) a minimum of 20 working days prior to work commencing to coordinate any site-specific conditions as part of the work. This includes temporary relocation of transit stops, removal of bus shelters or stops and transit detour routes.
  - The contractor may be required to relocate and provide a suitable alternative to OC Transpo's bus stop to the satisfaction of OC Transpo
  - The Contractor shall provide OC Transpo with a minimum of ten (10) working days' notice to coordinate temporary relocation of bus stops. When a bus stop and/or shelter must be temporarily relocated, the contractor may be required to provide stop infrastructure (i.e. bench, bus and/or shelter pads), to the satisfaction of OC Transpo.
  - All temporary stop locations including infrastructure are to be fully accessible in accordance with City of Ottawa [Accessibility Design Standards](#) and to the satisfaction of the OC Transpo.
  - Temporary bus stops are to be constructed and ready for use prior to the start of any works that would impact the regular bus stop location(s).
- **Public Consultation**
  - May include, but not be limited to, proponent lead public meeting(s), letter notification(s) and information dissemination via print, electronic means or social media, to impacted properties above and beyond the notification requirements specified in the Road Activity By-law.
- **General Considerations for all Applications**
  - A comprehensive construction management plan should include and consider the following:
    - The proposed stages of construction and the anticipated durations of each stage and any impact to existing travel lanes, pedestrian

facilities, cycling facilities and/or transit facilities. Any proposed encroachment should be identified and dimensioned on the site plan for review of feasibility.

- The proposed constructability methods being used as part of the proposed development (ie: fly forming, Peri forming etc.) and any additional traffic impacts/interruptions anticipated with proposed methods. If a crane is being placed on site, the location should be identified, and show the overhead impacts of the crane.
  - Consideration that any tie-backs and/or shoring within the City of Ottawa Right of Way are subject to Municipal Consent in advance of commencement of the project. Approval for encroachments is not guaranteed if impacts to transportation facilities cannot be addressed to the City's satisfaction.
  - Identify any truck hauling routes to and from the proposed development site and any proposed accesses. Designated heavy truck routes are to be followed at all times, however, if a deviation is required from the existing heavy truck route network, then a structural review may be required as part of an [Over-dimensional Vehicle Project Permit](#).
  - Identify the location of any site trailers and the location. Note, if placing a site trailer above any walk-through scaffolding or on the second floor (or above), an engineering drawing must be submitted to building code services for review. More information can be found on the [Building Permit Approval process](#).
  - Identify equipment and/or materials storage locations as required. Storage is not permitted on the road or the roadway shoulders or boulevards, unless the storage areas are identified in the traffic control plan and appropriate traffic control devices protect the equipment or materials.
- Any work as part of the development that requires a road cut, road closure or encroachment will be subject to the [Road Activity By-law](#) and potential site-specific conditions identified at site plan or subdivision approval which will be noted on the subsequent Permit(s). Information about [construction in the right-of-way](#) including applying for permits and associated fees can be found on the City's website.

## List of Technical Agencies to Consult

### Proposed Site Plan Control Application – 319 Hilversum– PC2025-0124

<input type="checkbox"/>	Zayo	<a href="mailto:Utility.Circulations@Zayo.com">Utility.Circulations@Zayo.com</a>
<input type="checkbox"/>	Bell Canada	<a href="mailto:circulations@bell.ca">circulations@bell.ca</a>
<input type="checkbox"/>	Telus Communications	<a href="mailto:Engineering.Requests@telus.com">Engineering.Requests@telus.com</a> / <a href="mailto:jovica.stojanovski@telus.com">jovica.stojanovski@telus.com</a>
<input type="checkbox"/>	Rogers Communications	<a href="mailto:OPE.Ottawa@rci.rogers.com">OPE.Ottawa@rci.rogers.com</a>
<input type="checkbox"/>	Enbridge Gas Distribution	<a href="mailto:municipalplanning@enbridge.com">municipalplanning@enbridge.com</a>
<input type="checkbox"/>	O.C. District School Board	<a href="mailto:planningcirculations@ocdsb.ca">planningcirculations@ocdsb.ca</a>
<input type="checkbox"/>	O.C. Catholic School Board	<a href="mailto:planningcirculations@ocsb.ca">planningcirculations@ocsb.ca</a>
<input type="checkbox"/>	Conseil des écoles publiques	<a href="mailto:planification@cepeo.on.ca">planification@cepeo.on.ca</a>
<input type="checkbox"/>	Conseil des écoles catholiques du Centre-Est	<a href="mailto:planification@ecolecatholique.ca">planification@ecolecatholique.ca</a>
<input type="checkbox"/>	Hydro One Networks (Local Distribution)	<a href="mailto:Ottawa.circulations@HydroOne.com">Ottawa.circulations@HydroOne.com</a>
<input type="checkbox"/>	Conservation Authority	MVCA – <a href="mailto:info@mvc.on.ca">info@mvc.on.ca</a>

METRIC  
DISTANCES AND COORDINATES SHOWN ON THIS PLAN ARE IN METRES  
AND CAN BE CONVERTED TO FEET BY DIVIDING BY 0.3048

APPROVED UNDER SECTION 51 OF  
THE PLANNING ACT BY THE CITY OF OTTAWA  
THIS \_\_\_\_\_ DAY OF \_\_\_\_\_ 2023.  
GENERAL MANAGER  
PLANNING AND GROWTH MANAGEMENT DEPARTMENT  
PLANNING AND INFRASTRUCTURE PORTFOLIO  
CITY OF OTTAWA

PLAN 4M-  
I certify that this Plan is registered in the Land Registry  
Office for the Land Titles Division of Ottawa-Carleton  
at \_\_\_\_\_ o'clock on the \_\_\_\_\_ day of \_\_\_\_\_  
and entered in the register for Property Identifier \_\_\_\_\_  
and required consents are registered as Plan Document  
N \_\_\_\_\_  
Land Registrar  
THE SUBDIVISION REPRESENTED BY THIS PLAN AFFECTS



PLAN OF SUBDIVISION OF  
PART OF NELSON STREET IN FRONT OF  
LOTS 49 TO 54, (BOTH INCLUSIVE)  
(CLOSED BY BY-LAW NO. 2007-295, INST. OC751815)  
AND  
PART OF BLOCKS "A", "B" & "C"  
AND  
ALL OF LOTS 6 TO 21 (BOTH INCLUSIVE)  
PART OF LOT 49,  
ALL OF LOTS 50, 51, 52 & 53  
PART OF LOTS 54, 55 & 56  
PART OF JOHN STREET (NOT OPEN)  
REGISTERED PLAN No. 148  
AND  
PART OF LOT 18, CONCESSION 2  
GEOGRAPHIC TOWNSHIP OF HUNTLEY  
CITY OF OTTAWA

SCALE 1:500  
0 10 20 30 40 50 metres  
FAIRHALL, MOFFATT & WOOLAND LIMITED  
ONTARIO LAND SURVEYORS

- NOTES
- BEARINGS ARE GRID AND ARE REFERRED TO THE SOUTHWESTERLY LIMIT OF LANGSTAFF DRIVE SHOWN ON PLAN 4R-24903 AS HAVING A BEARING OF N 43°10'30" W AND ARE REFERRED TO THE CENTRAL MERIDIAN, 76°30' W LONGITUDE WITH ZONE 9, NAD83 ORIGINAL.
  - DISTANCES ARE GRID AND CAN BE CONVERTED TO FEET BY MULTIPLYING BY THE COMBINED SCALE FACTOR 0.99995.
  - LIMIT OF HAZARD LANDS DERIVED FROM DRAWING NO. P04918-1 (REV.3) BY PATERSON GROUP, CONSULTING ENGINEERS DATED AUGUST, 2019.
  - ALL FOUND SURVEY MONUMENTS ARE STAMPED (857) UNLESS NOTED OTHERWISE.

- LEGEND
- - SURVEY MONUMENT SET
  - - SURVEY MONUMENT FOUND
  - SB - STANDARD IRON BAR
  - SSB - SHORT STANDARD IRON BAR
  - IR - IRON BAR
  - (P) - PLAN 4R-XXXX
  - (S) - SET
  - (M) - MEASURED
  - (E57) - FAIRHALL, MOFFATT & WOOLAND LIMITED, O.L.S.
  - (S0) - SOURCE UNKNOWN
  - (WT) - WITNESS
  - PIN - PROPERTY IDENTIFIER NUMBER
  - (647) - H. W. FARLEY, O.L.S.
  - (1287) - FARLEY, SMITH & DENIS SURVEYING LTD., O.L.S.
  - (BF) - BOARD FENCE
  - (CLF) - CHAIN LINK FENCE
  - UP - UTILITY POLE
  - GP - GATE POST

COORDINATES WERE DERIVED FROM PLAN 4R-32761 AND ARE WTM ZONE 9, NAD83 ORIGINAL.  
COORDINATES HAVE BEEN DETERMINED TO AN URBAN ACCURACY IN ACCORDANCE WITH SECTION 142(3) OF CASE 216/10.

POINT ID	EASTING	NORTHING
71	341285.762	5023205.124
74	341400.980	5023082.320
75	341450.310	5023020.297
01919791113	340278.632	5022845.905
01919770765	341631.95	5021238.914

COORDINATES CANNOT IN THEMSELVES BE USED TO RE-ESTABLISH CORNERS OR BOUNDARIES SHOWN ON THIS PLAN.





OWNER'S CERTIFICATE  
THIS IS TO CERTIFY THAT:  
1. BLOCKS 1 TO 34, BOTH INCLUSIVE, THE STREETS, NAMELY STREET 1 & STREET 2, AND THE STREET WIDENING, NAMELY BLOCK 35, HAVE BEEN LAID OUT IN ACCORDANCE WITH OUR INSTRUCTIONS.  
2. THE STREETS AND THE STREET WIDENING ARE HEREBY DEDICATED TO THE CORPORATION OF THE CITY OF OTTAWA AS PUBLIC HIGHWAYS, DATED THIS \_\_\_\_\_ DAY OF \_\_\_\_\_ 2023.

SURVEYOR'S CERTIFICATE  
I CERTIFY THAT:  
1. THIS SURVEY AND PLAN ARE CORRECT AND IN ACCORDANCE WITH THE SURVEY ACT, THE SURVEYORS ACT AND THE LAND TITLES ACT AND THE REGULATIONS MADE UNDER THEM.  
2. THE SURVEY WAS COMPLETED ON \_\_\_\_\_

DATE \_\_\_\_\_ JOHN H. GUTHR  
ONTARIO LAND SURVEYOR

**Fairhall  
Moffatt &  
Woodland**  
Ontario Land Surveyors  
Sharing and Land Information Services  
100-100 TERRY FOR DRIVE, FARM 1, ONTARIO K2L 4K0  
TEL: (613) 961-2880 FAX: (613) 961-1465  
www.fmw.ca

JOB No.	Z 22 0 0 0
E	341276, N 5023039
REFERENCE No.	144 - 2 HUNTLEY
	28 - 148 HUNTLEY
	5 (PLAN 4M2000) (PLAN 4R-148)
	www.fmw.ca

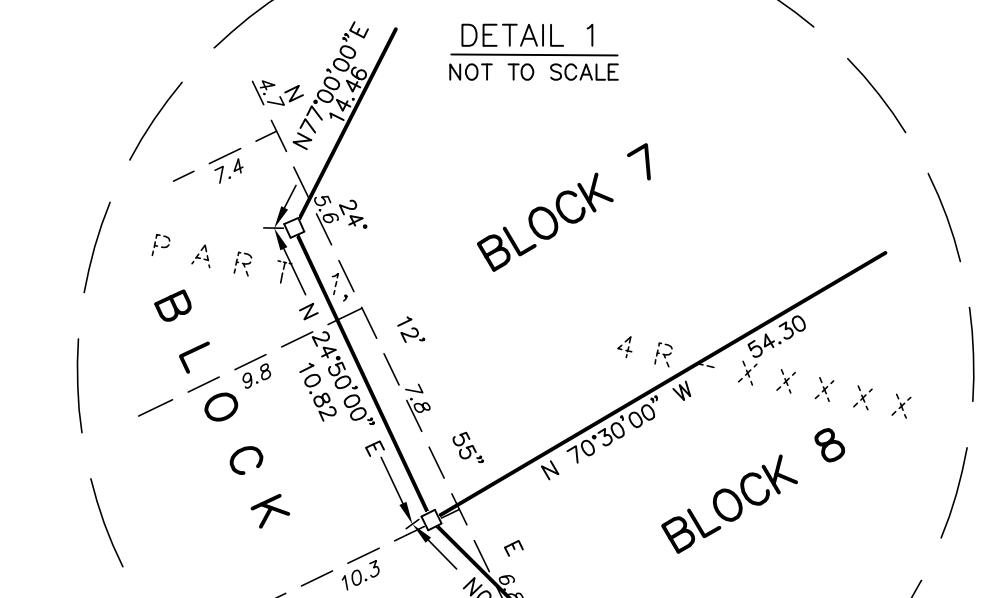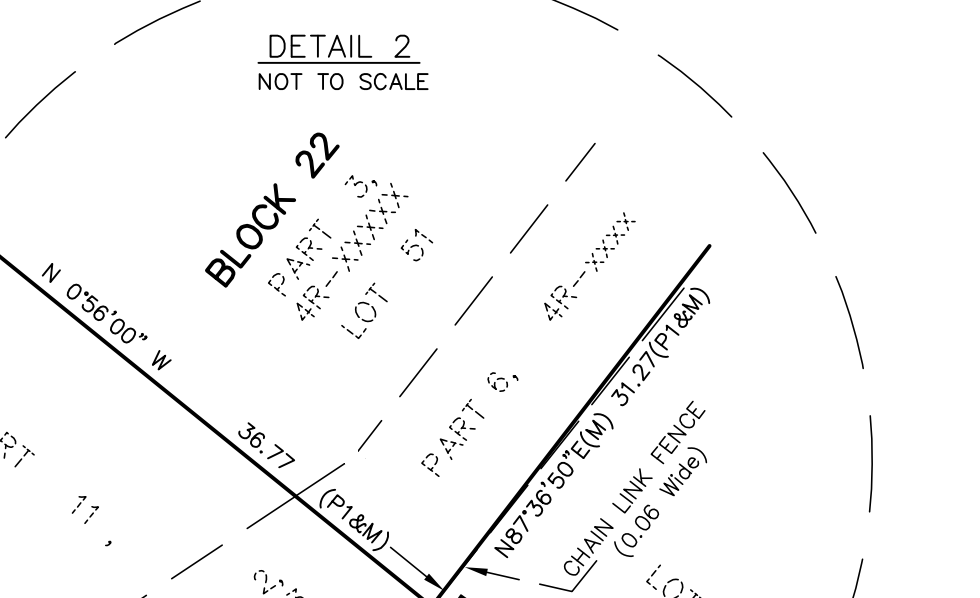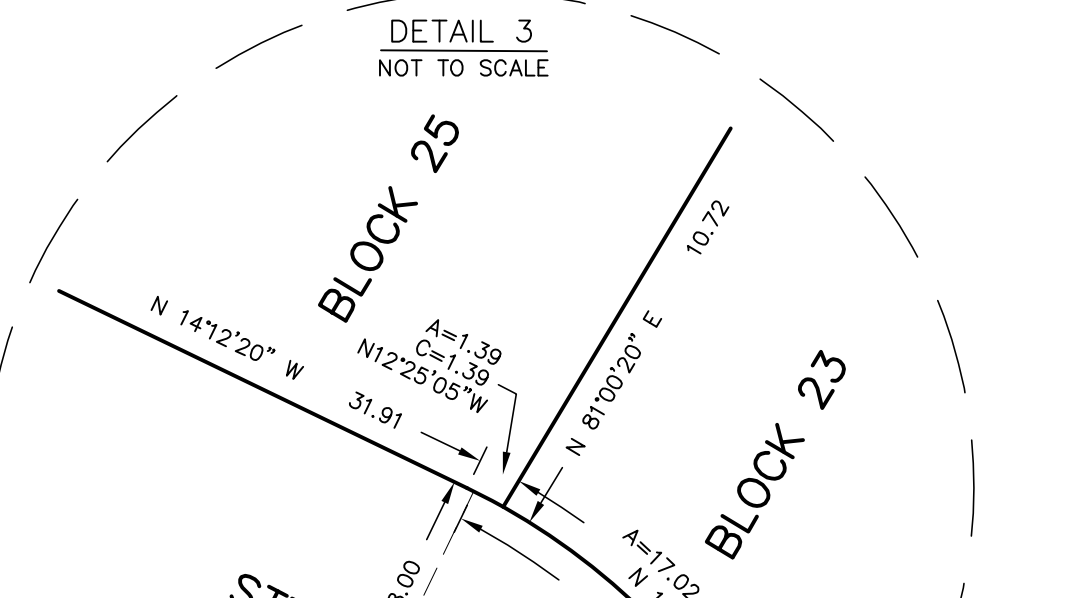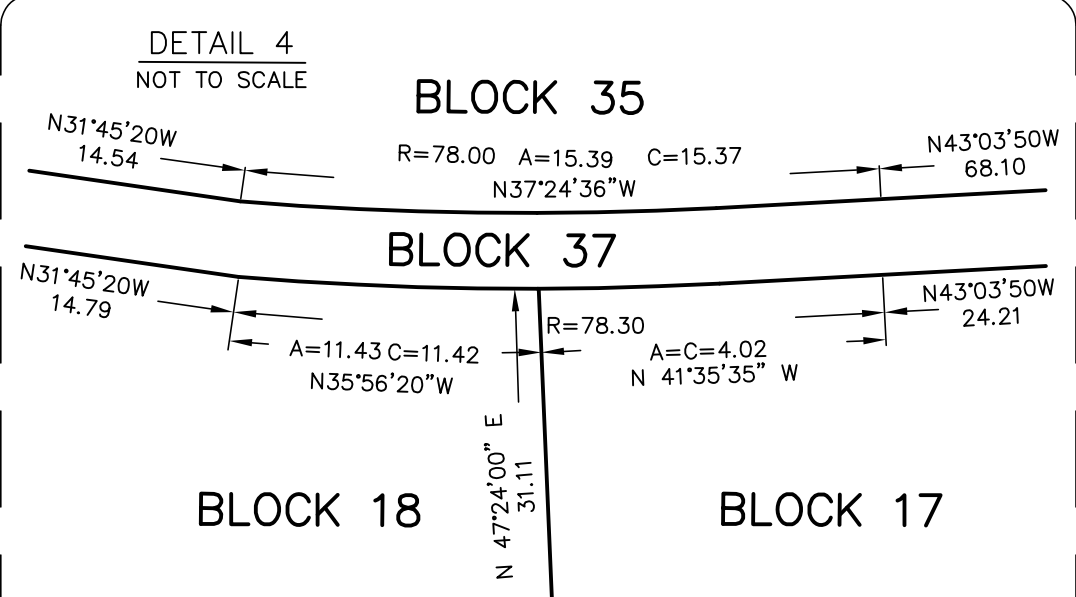

METRIC  
DISTANCES AND COORDINATES SHOWN ON THIS PLAN ARE IN METRES  
AND CAN BE CONVERTED TO FEET BY DIVIDING BY 0.3048

APPROVED UNDER SECTION 51 OF  
THE PLANNING ACT BY THE CITY OF OTTAWA  
THIS \_\_\_\_\_ DAY OF \_\_\_\_\_ 2025.  
  
MARGARITA WALLACE, P.Eng., RPP  
GENERAL MANAGER, PLANNING, DEVELOPMENT  
AND BUILDING SERVICES DEPARTMENT,  
CITY OF OTTAWA

**PLAN 4M-**

I certify that this Plan is registered in the Land Registry  
Office for the Land Titles Division of Ottawa-Carleton  
N° 4 of \_\_\_\_\_ of the \_\_\_\_\_ day of \_\_\_\_\_ 2025  
and entered in the parcel register for Property Identifier  
04533-2351  
and required consents are registered as Plan Document  
N° \_\_\_\_\_  
  
Representative for Land Registrar

THIS PLAN COMPRISES ALL OF PIN 04533-2351.  
ALL OF BLOCK 16 - SUBJECT TO EASEMENT OC2175125.  
PART OF BLOCK 8 - SUBJECT TO EASEMENT OC1177620.  
PART OF BLOCK 17 - SUBJECT TO EASEMENT N773756.  
PART OF BLOCK 17 & 19 - SUBJECT TO EASEMENT N771192.

PLAN OF SUBDIVISION OF  
LOTS 6 TO 13 (INCLUSIVE)  
NORTH SIDE OF JOHN STREET,  
LOTS 14 TO 21 (INCLUSIVE)  
SOUTH SIDE OF JOHN STREET,  
LOTS 52 & 53  
PART OF LOTS 54, 55 & 56  
NORTH SIDE OF NELSON STREET,  
LOTS 50 & 51,  
PART OF LOT 49  
SOUTH SIDE OF NELSON STREET  
AND  
PART OF BLOCKS "A", "B" & "C"  
AND  
PART OF NELSON STREET  
(CLOSED BY BY-LAW NO. 2007-295, INST. OC751815),  
PART OF JOHN STREET  
(CLOSED BY OC2554675),  
REGISTERED PLAN 148  
AND  
PART OF LOT 18, CONVESSION 2  
GEOGRAPHIC TOWNSHIP OF HUNTERLY  
CITY OF OTTAWA

SCALE 1 : 500  
0 10 20 30 40 50 metres

FAIRHALL, MOFFATT & WOODLAND LIMITED  
ONTARIO LAND SURVEYORS

COORDINATES WERE DERIVED FROM PLAN 4R-32761  
AND ARE MTM ZONE 9, NAD83 ORIGINAL.

COORDINATES HAVE BEEN DETERMINED TO AN URBAN ACCURACY  
IN ACCORDANCE WITH SECTION 14(2) OF OREG. 216/10.

POINT ID	EASTING	NORTHING
71	341285.762	5023205.124
74	341400.980	5023082.320
75	341403.319	5023020.297
0191979113	340276.632	5023845.905
01919770765	341631.95	5021238.914

COORDINATES CANNOT BE THEMSELVES BE USED TO RE-ESTABLISH  
CORNER OR BOUNDARIES SHOWN ON THIS PLAN.

- NOTES**
- BEARINGS ARE GRID AND ARE REFERRED TO THE SOUTHWESTERLY LIMIT OF  
LANGSTAFF DRIVE SHOWN ON PLAN 4R-24903 AS HAVING A BEARING OF  
N 43°10'30" W AND ARE REFERRED TO THE CENTRAL MERIDIAN, 76°30' W  
LONGITUDE WITH ZONE 9, NAD83 ORIGINAL.
  - DISTANCES ARE GRID AND CAN BE CONVERTED TO GRID BY  
MULTIPLYING BY THE COMBINED SCALE FACTOR 0.99995.
  - ALL FOUND SURVEY MONUMENTS ARE STAMPED (857) UNLESS NOTED OTHERWISE.
  - ALL BARS SET ARE SSB'S & PB (ALTERNATE AND REDUCED LENGTH MONUMENTS  
SET DUE TO UNDERGROUND UTILITY HAZARD) UNLESS NOTED OTHERWISE.

- LEGEND**
- SM - SURVEY MONUMENT SET
  - SB - SURVEY MONUMENT FOUND
  - SB - STANDARD IRON BAR
  - SSB - SHORT STANDARD IRON BAR
  - PB - PLASTIC BAR
  - R - ROUND
  - RB - IRON BAR
  - PL - PLAN 4R-36495
  - PI - PLAN 4R-32761
  - SI - SET
  - W - MEASURED
  - (857) - FAIRHALL, MOFFATT & WOODLAND LIMITED, O.L.S.
  - (S) - SOURCE UNKNOWN
  - (WT) - WITNESS
  - PN - PROPERTY IDENTIFIER NUMBER
  - (F47) - H. S. FARLEY, O.L.S.
  - (1287) - FARLEY, SMITH & DENIS SURVEYING LTD., O.L.S.
  - (BF) - BOARD FENCE
  - (CLF) - CHAIN LINK FENCE
  - UP - UTILITY POLE
  - DP - DATE POST
  - PF - POST & WIDE FENCE

**OWNER'S CERTIFICATE**

THIS IS TO CERTIFY THAT:

- BLOCKS 1 TO 16, BOTH INCLUSIVE, THE STREETS, NAMELY RUELLE HILVERSUM LANE &  
COUR FAIR ISLE COURT, THE STREET WIDENING NAMELY BLOCK 19 AND THE RESERVES  
NAMELY BLOCKS 20, 21, 22 & 23 HAVE BEEN LAID OUT IN ACCORDANCE  
WITH OUR INSTRUCTIONS.
- THE STREETS AND THE STREET WIDENING ARE HEREBY DEDICATED TO CITY OF OTTAWA  
AS PUBLIC HIGHWAYS.

DATED THIS \_\_\_\_\_ 2025. HUNTERLY HOLLOW INC.  
DAY OF \_\_\_\_\_ 2025.

**SURVEYOR'S CERTIFICATE**

I CERTIFY THAT:

- THIS SURVEY AND PLAN ARE CORRECT AND IN ACCORDANCE  
WITH THE SURVEY ACT, THE SURVEYORS ACT AND THE LAND  
TITLES ACT AND THE REGULATIONS MADE UNDER THEM.
- THE SURVEY WAS COMPLETED ON SEPTEMBER 04, 2025.







SEPTEMBER 04, 2025


JOHN H. GUTRI  
ONTARIO LAND SURVEYOR

THIS PLAN RELATES TO ADS PLAN SUBMISSION FORM NUMBER V-69760.


**Fairhall  
Moffatt &  
Woodland**  
Ontario Land Surveyors  
Chartered and Land Information Services  
100-620 Bloor Street East, Toronto, Ontario M5G 1A5  
Tel: (416) 593-0961 Fax: (416) 593-1466  
www.fmw.com

JOB No. 222000  
E 341276, N 5023039  
REFERENCE No. 144 - 2 HUNTERLY  
28 - 148 HUNTERLY

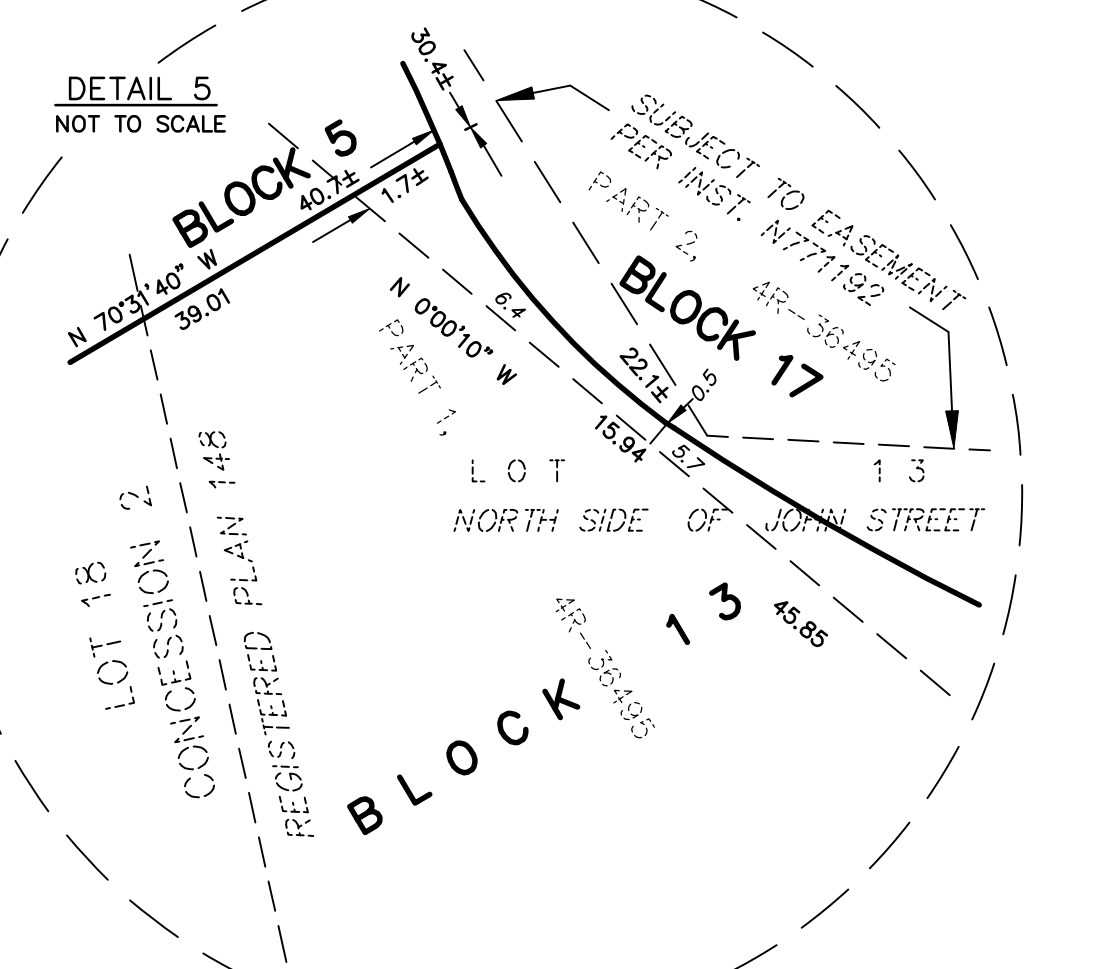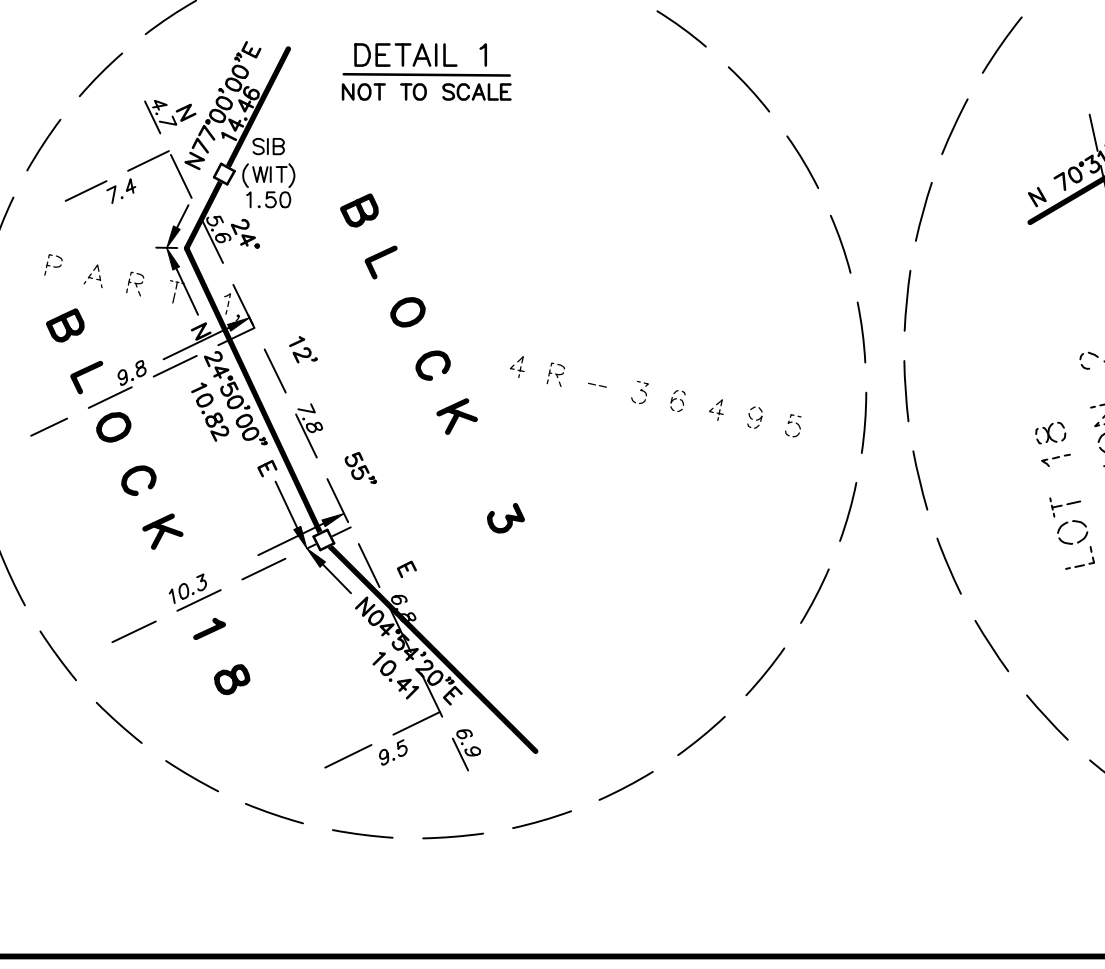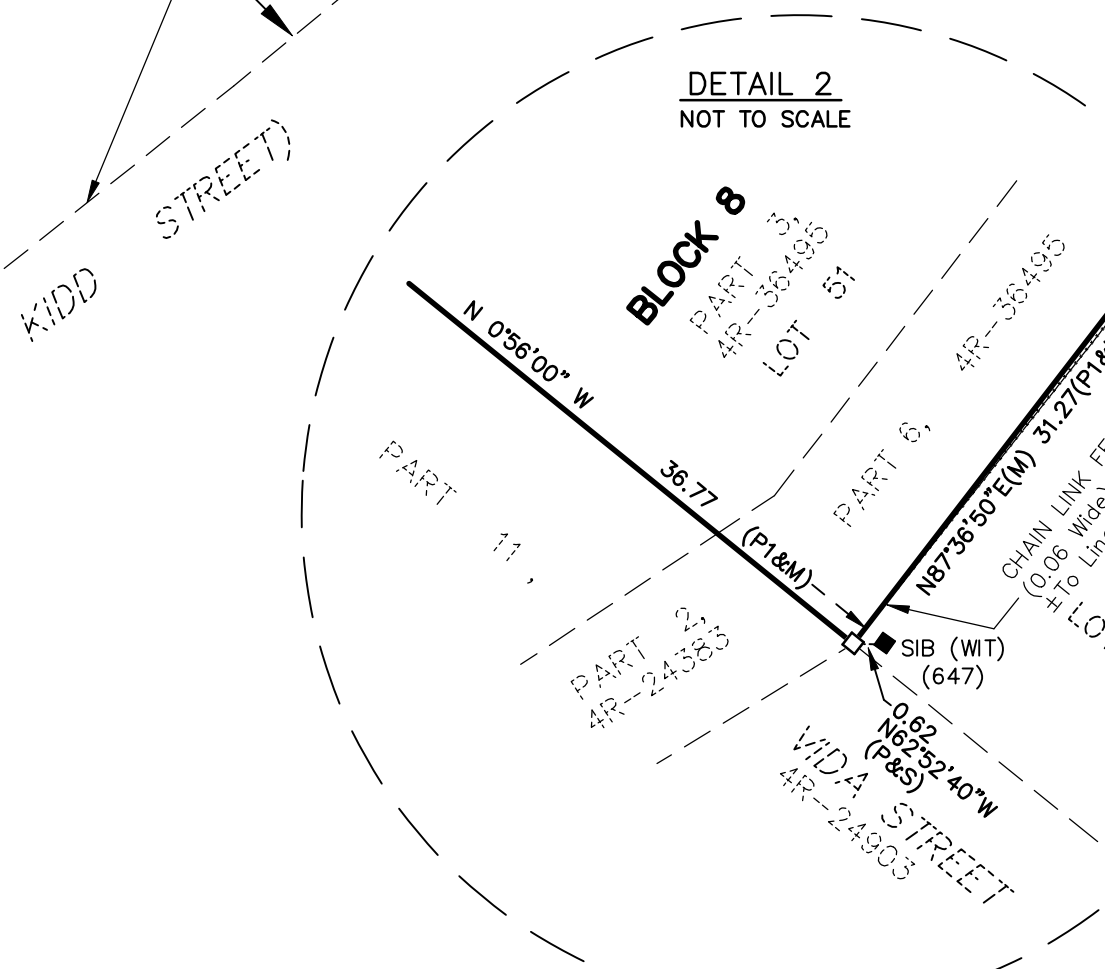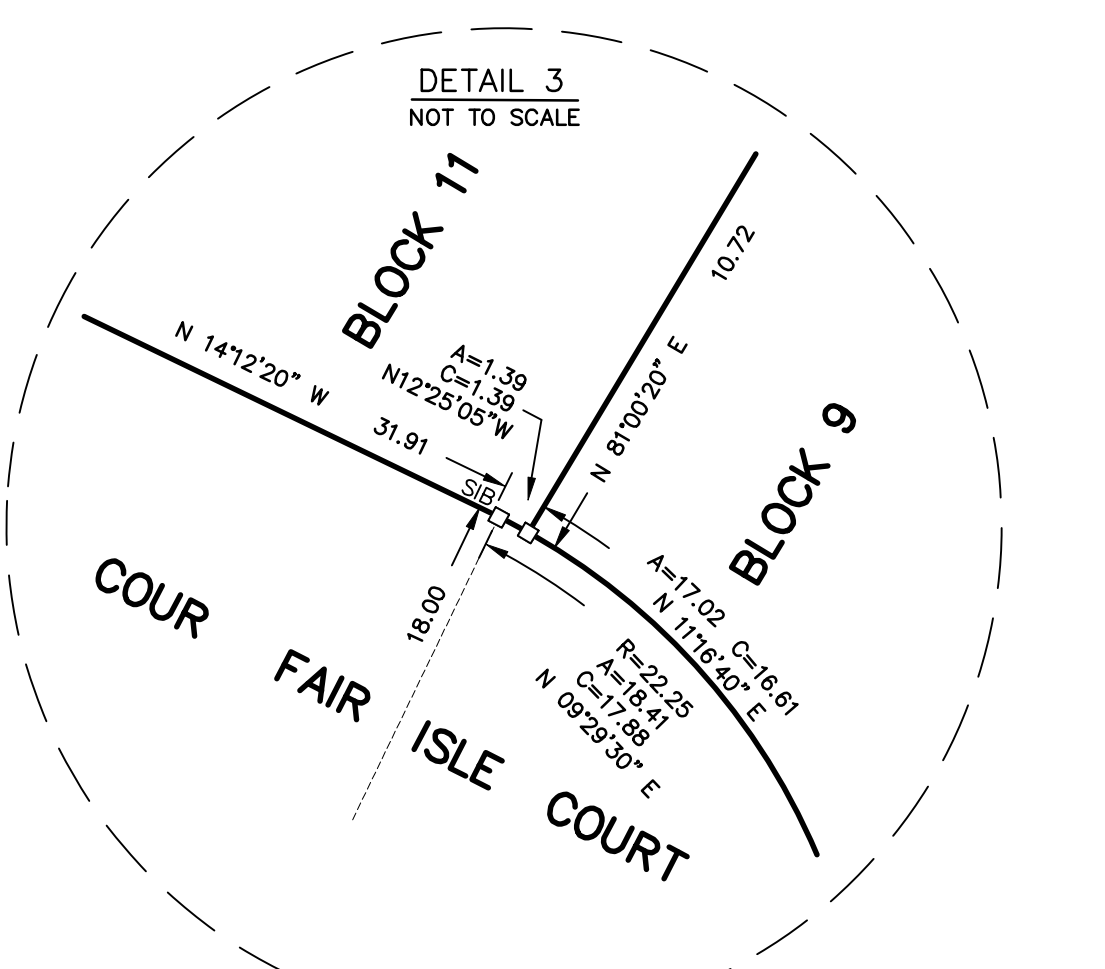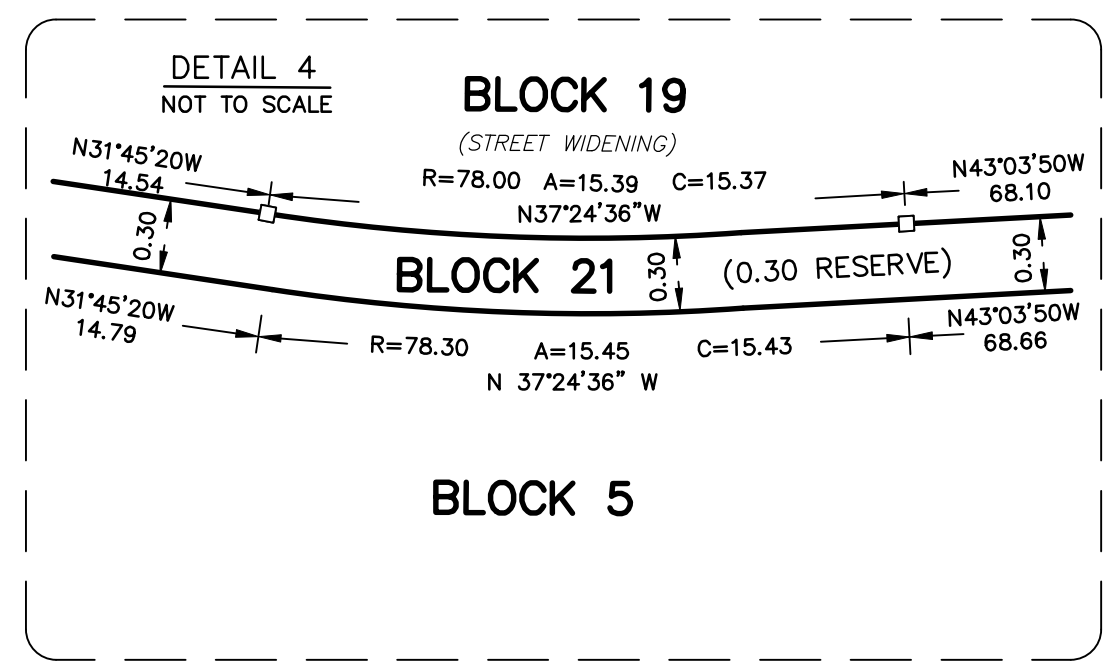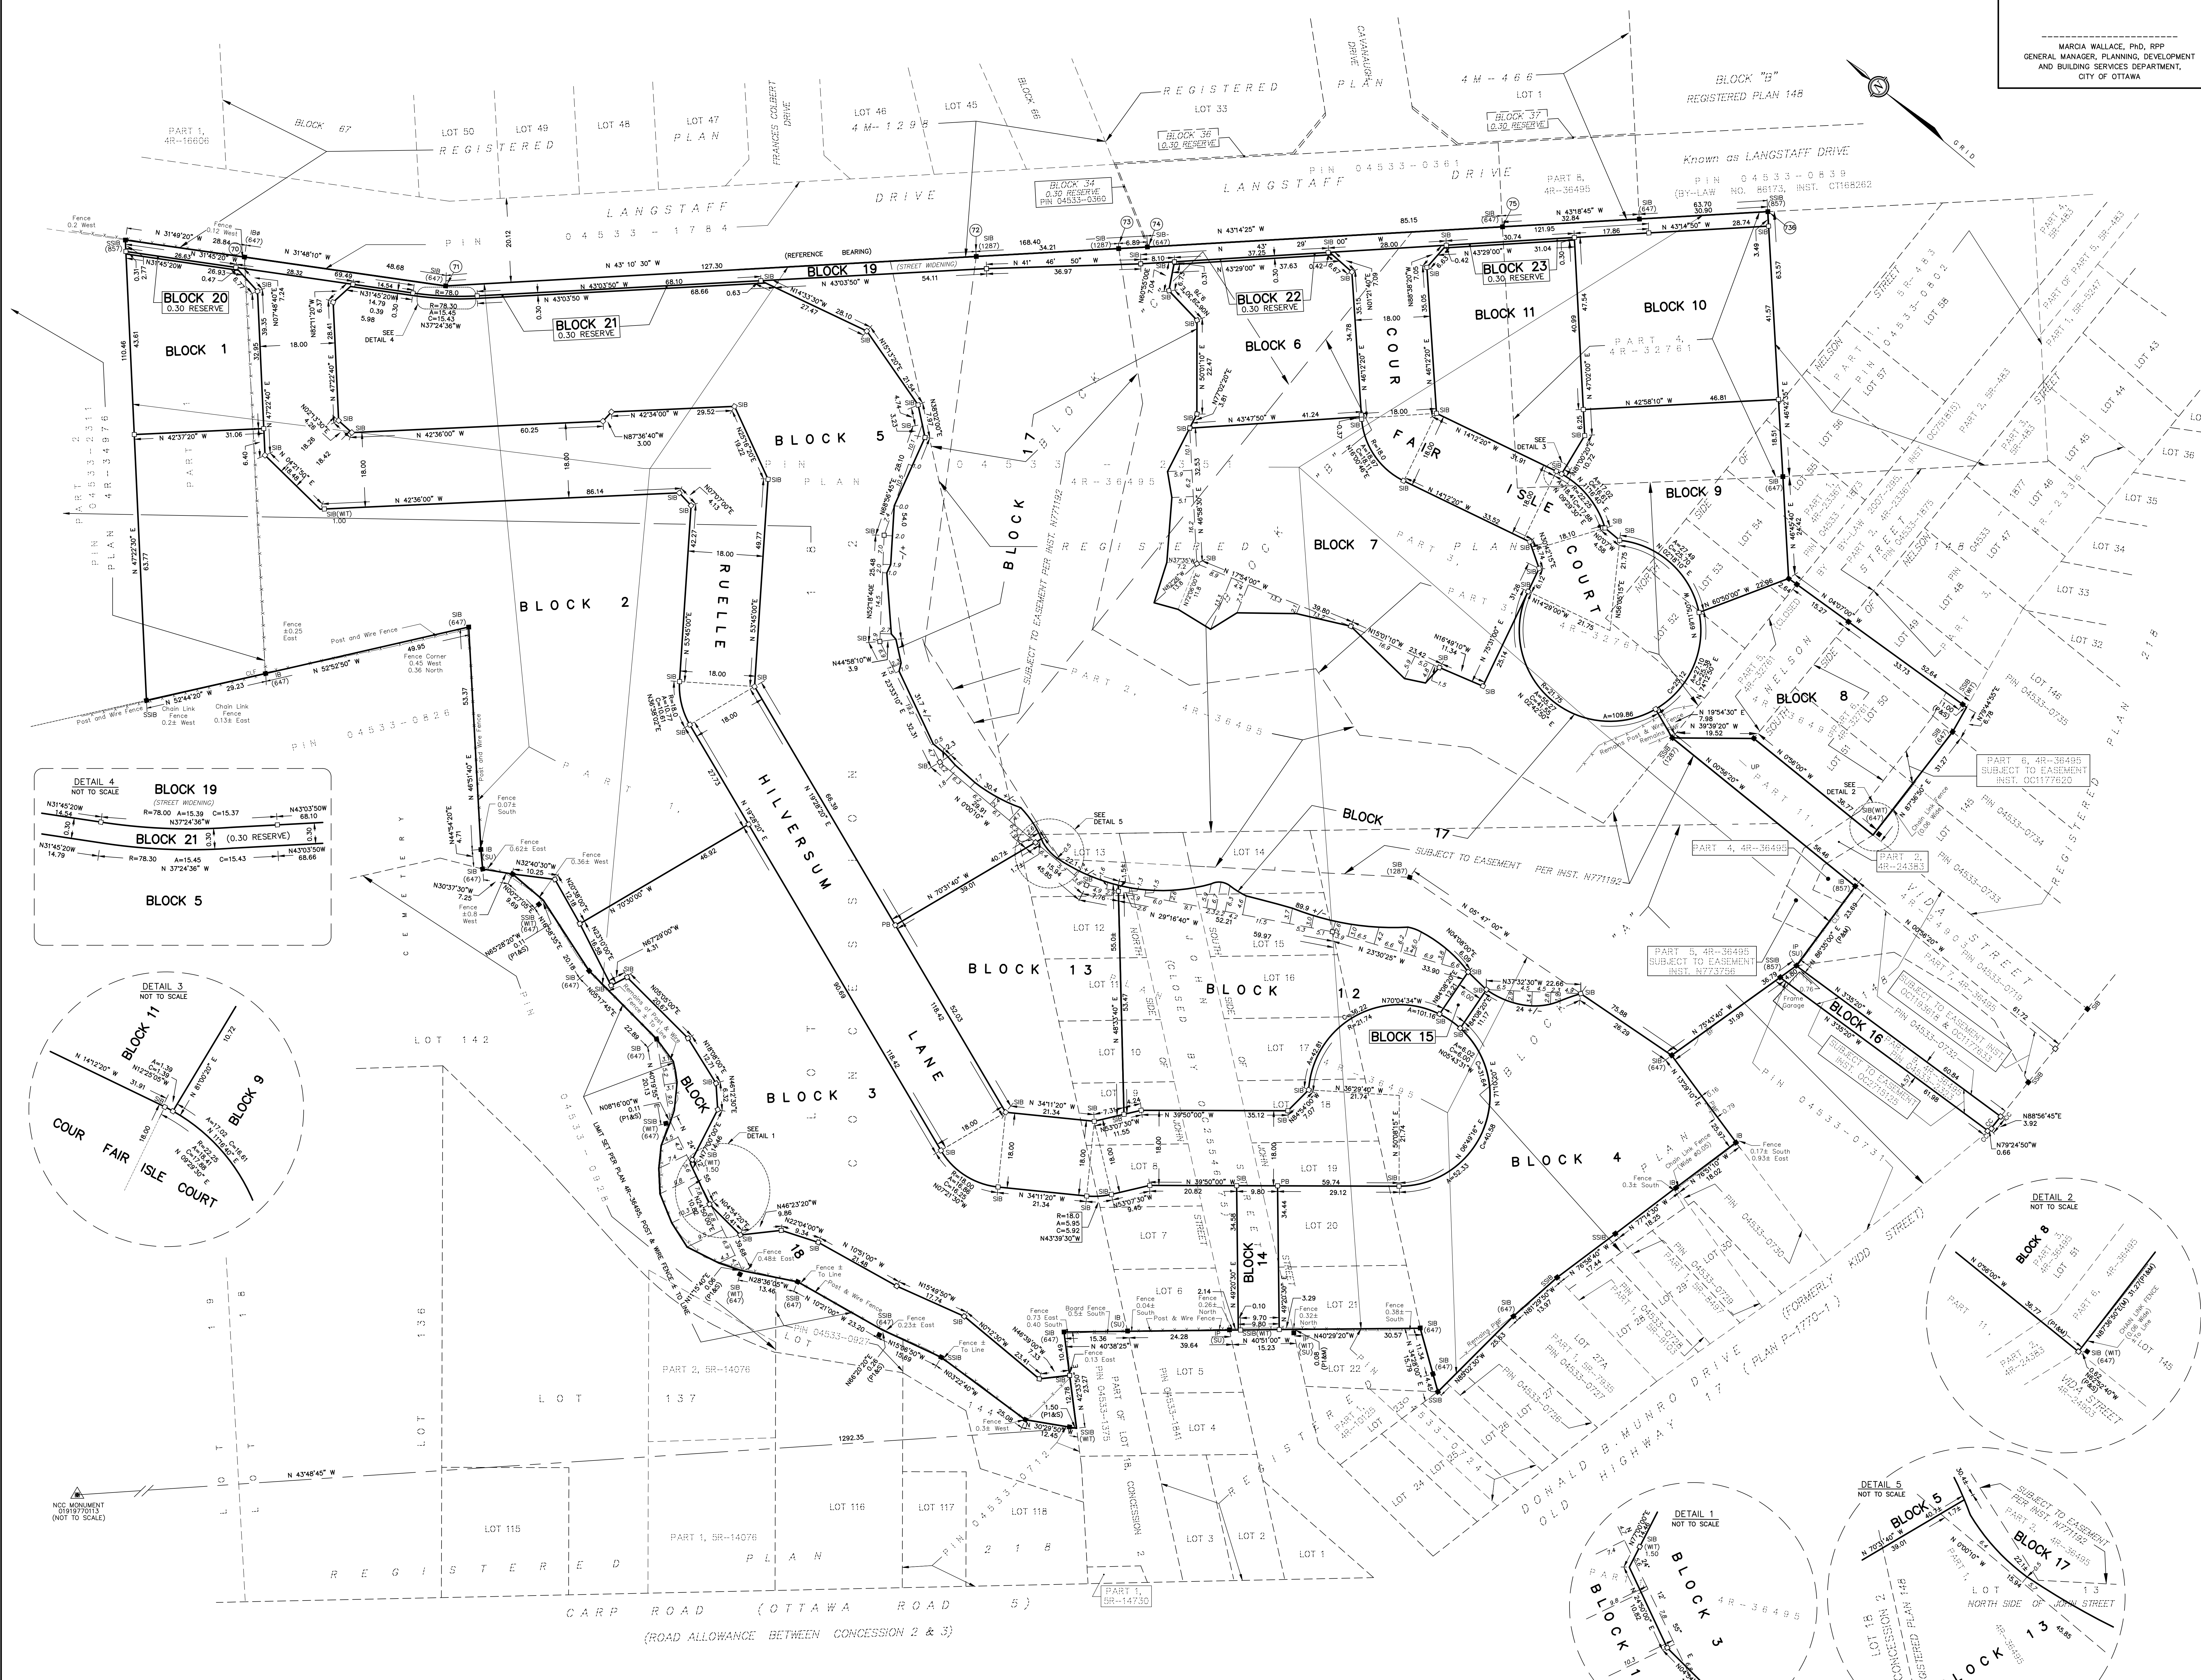


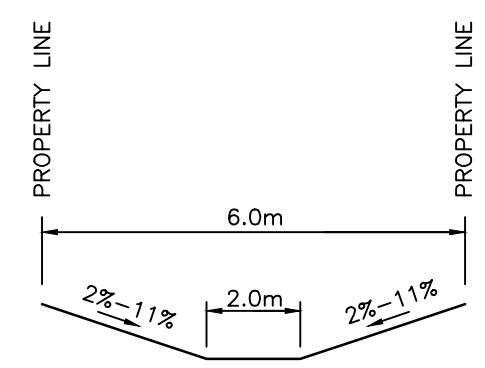


BLOCK 31 OVERLAND FLOW SECTION B-B

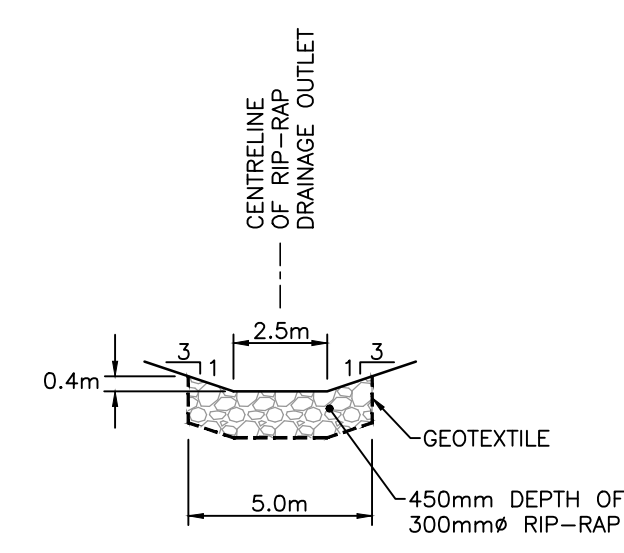

STREET 1 & 2 RIP RAP OUTLET SECTION A-A

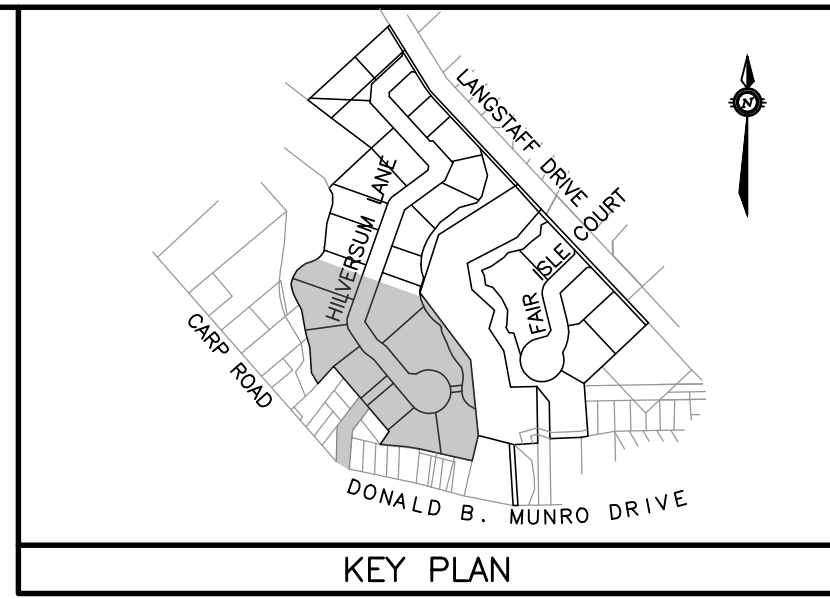


KEY PLAN

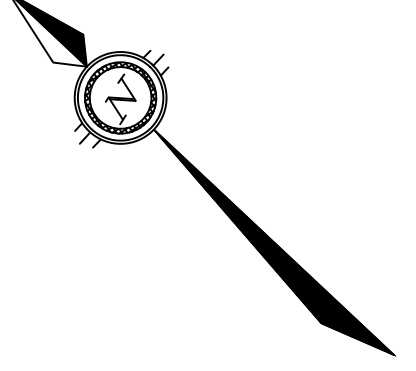


LEGEND

- SINGLE SERVICE
  - 135mm<sup>Ø</sup> SANITARY
  - 150mm<sup>Ø</sup> STORM
  - 19mm<sup>Ø</sup> WATER
- DOUBLE SERVICE
  - 2-135mm<sup>Ø</sup> SANITARY
  - 2-150mm<sup>Ø</sup> STORM
  - 2-19mm<sup>Ø</sup> WATER
- PROPERTY BOUNDARY
- PHASE LIMIT
- LIMIT OF HAZARD LANDS
- SANITARY SEWER AND MANHOLE
- STORM SEWER AND MANHOLE
- CONCRETE HEADWALL
- WATERMAIN
- VALVE AND VALVE BOX
- HYDRANT WITH VALVE AND VALVE BOX
- ROADSIDE CATCH BASIN
- ROADSIDE DOUBLE CATCH BASIN
- LANDSCAPE CATCH BASIN ELBOW
- LANDSCAPE CATCH BASIN TEE
- SWALE WITH 250mm<sup>Ø</sup> SUBDRAIN
- EXISTING SANITARY SEWER AND MANHOLE
- EXISTING STORM SEWER AND MANHOLE
- EXISTING WATERMAIN
- EXISTING CATCH BASIN
- EXISTING HYDRANT
- EXISTING DITCH
- EXISTING OVERHEAD UTILITIES

NOTE: ALL SERVICES REQUIRE PRESSURE REDUCING VALVES (PRVs)

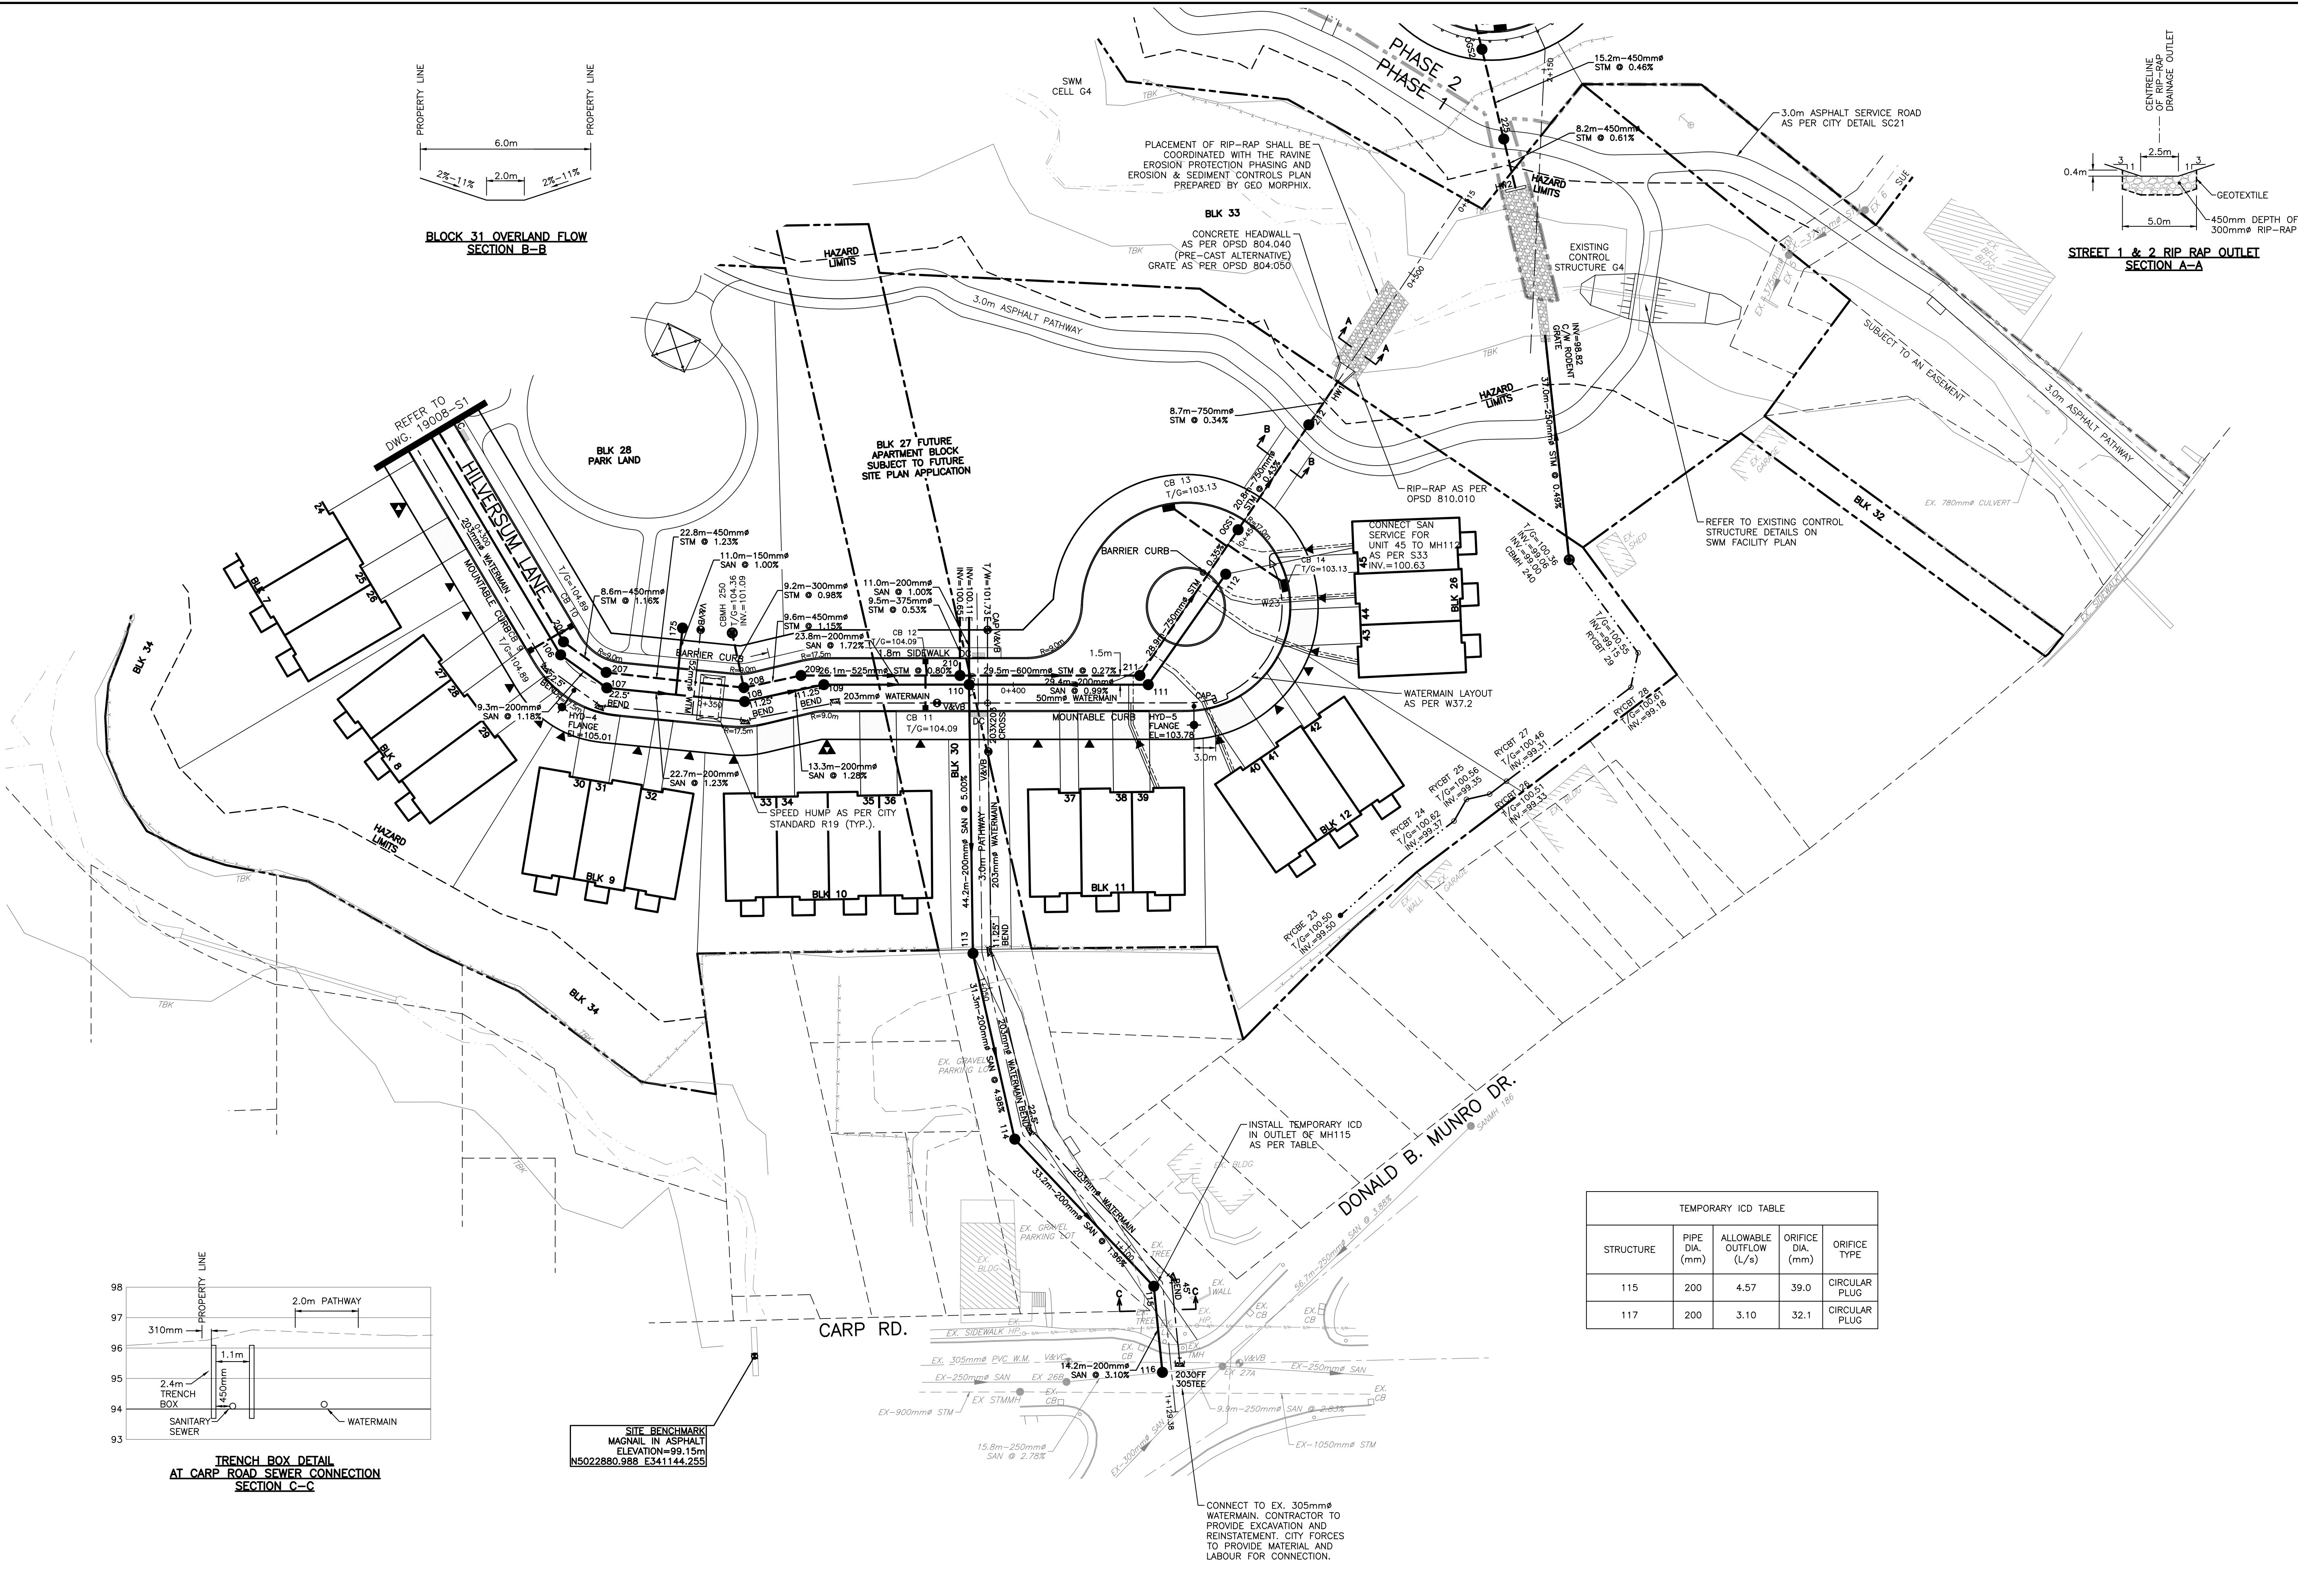

TEMPORARY ICD TABLE				
STRUCTURE	PIPE DIA. (mm)	ALLOWABLE OUTFLOW (L/s)	ORIFICE DIA. (mm)	ORIFICE TYPE
115	200	4.57	39.0	CIRCULAR PLUG
117	200	3.10	32.1	CIRCULAR PLUG


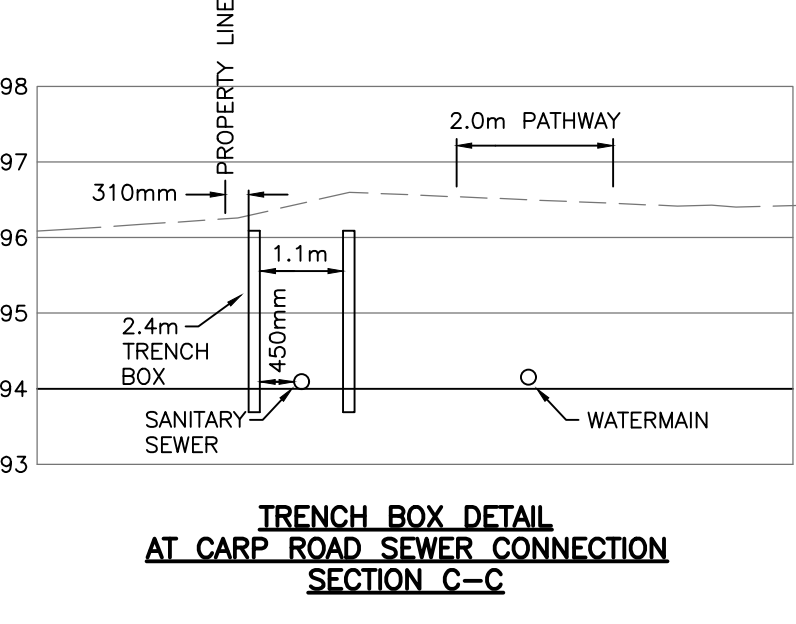


TRENCH BOX DETAIL AT CARP ROAD SEWER CONNECTION SECTION C-C

SITE BENCHMARK  
MAGNAIL IN ASPHALT  
ELEVATION=99.15m  
N5022880.988 E341144.255

NOTES  
THE POSITION OF ALL POLE LINES, CONDUITS, WATERMANS, SEWERS AND OTHER UNDERGROUND AND OVERGROUND UTILITIES AND STRUCTURES IS NOT NECESSARILY SHOWN ON THE CONTRACT DRAWINGS, AND WHERE SHOWN, THE ACCURACY OF THE POSITION OF SUCH UTILITIES AND STRUCTURES IS NOT GUARANTEED. BEFORE STARTING WORK, DETERMINE THE EXACT LOCATION OF ALL SUCH UTILITIES AND STRUCTURES AND ASSUME ALL LIABILITY FOR DAMAGE TO THEM.  
GEODEIC SURVEY DERIVED FROM COSINE STATION 0011968U054. LOCATION DESCRIPTION: OLD HIGHWAY 17 BRIDGE OVER CARP RIVER ON CARP-STITTSVILLE ROAD, 0.2 KM SOUTH OF C.N.R. CROSSING IN VILLAGE OF CARP. TABLE IN TOP OF WEST WALL, 30 CM FROM NORTH END, 24 CM FROM WEST EDGE. VERTICAL CONTROL DATA, DATUM: CGVD2878, FIRST ORDER, ELEVATION: 93.861. COORDINATE SYSTEM: MTM ZONE 9; NAD 83 DATUM (CAN83-9)

NO.	REVISION DESCRIPTION	DATE	BY
7	ISSUED FOR MECP ECA	23/09/24	BLM
6	ISSUED FOR PHASE 1 TENDER	06/09/24	BLM
5	REVISED PER CITY COMMENTS	12/07/24	BLM
4	REVISED PER CITY COMMENTS	28/05/24	BLM
3	REVISED PER CITY COMMENTS	22/03/24	BLM
2	REVISED PER CITY COMMENTS	09/11/23	BLM
1	ISSUED FOR REVIEW	24/05/23	BLM

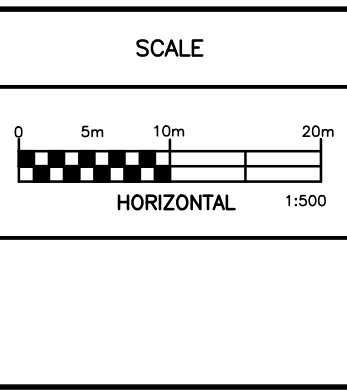

**Robinson**  
Land Development

CONSULTING ENGINEERS  
350 PALLADIUM DRIVE  
KANATA, ONTARIO K2V 1A8  
TELEPHONE (613) 592-6060




DESIGN	JHB
CHECKED	BLM
DRAWN	JHB
CHECKED	BLM
APPROVED	BLM

**INVERNESS HOMES**  
38 AURIGA DRIVE, SUITE 200  
OTTAWA, ON K2E 8A6

147 LANGSTAFF DRIVE  
CARP, ON

**GENERAL PLAN OF SERVICES**

PROJECT No.	19008
SURVEY	RLD
DATED	SEPTEMBER 2024
DWG. No.	19008-S2

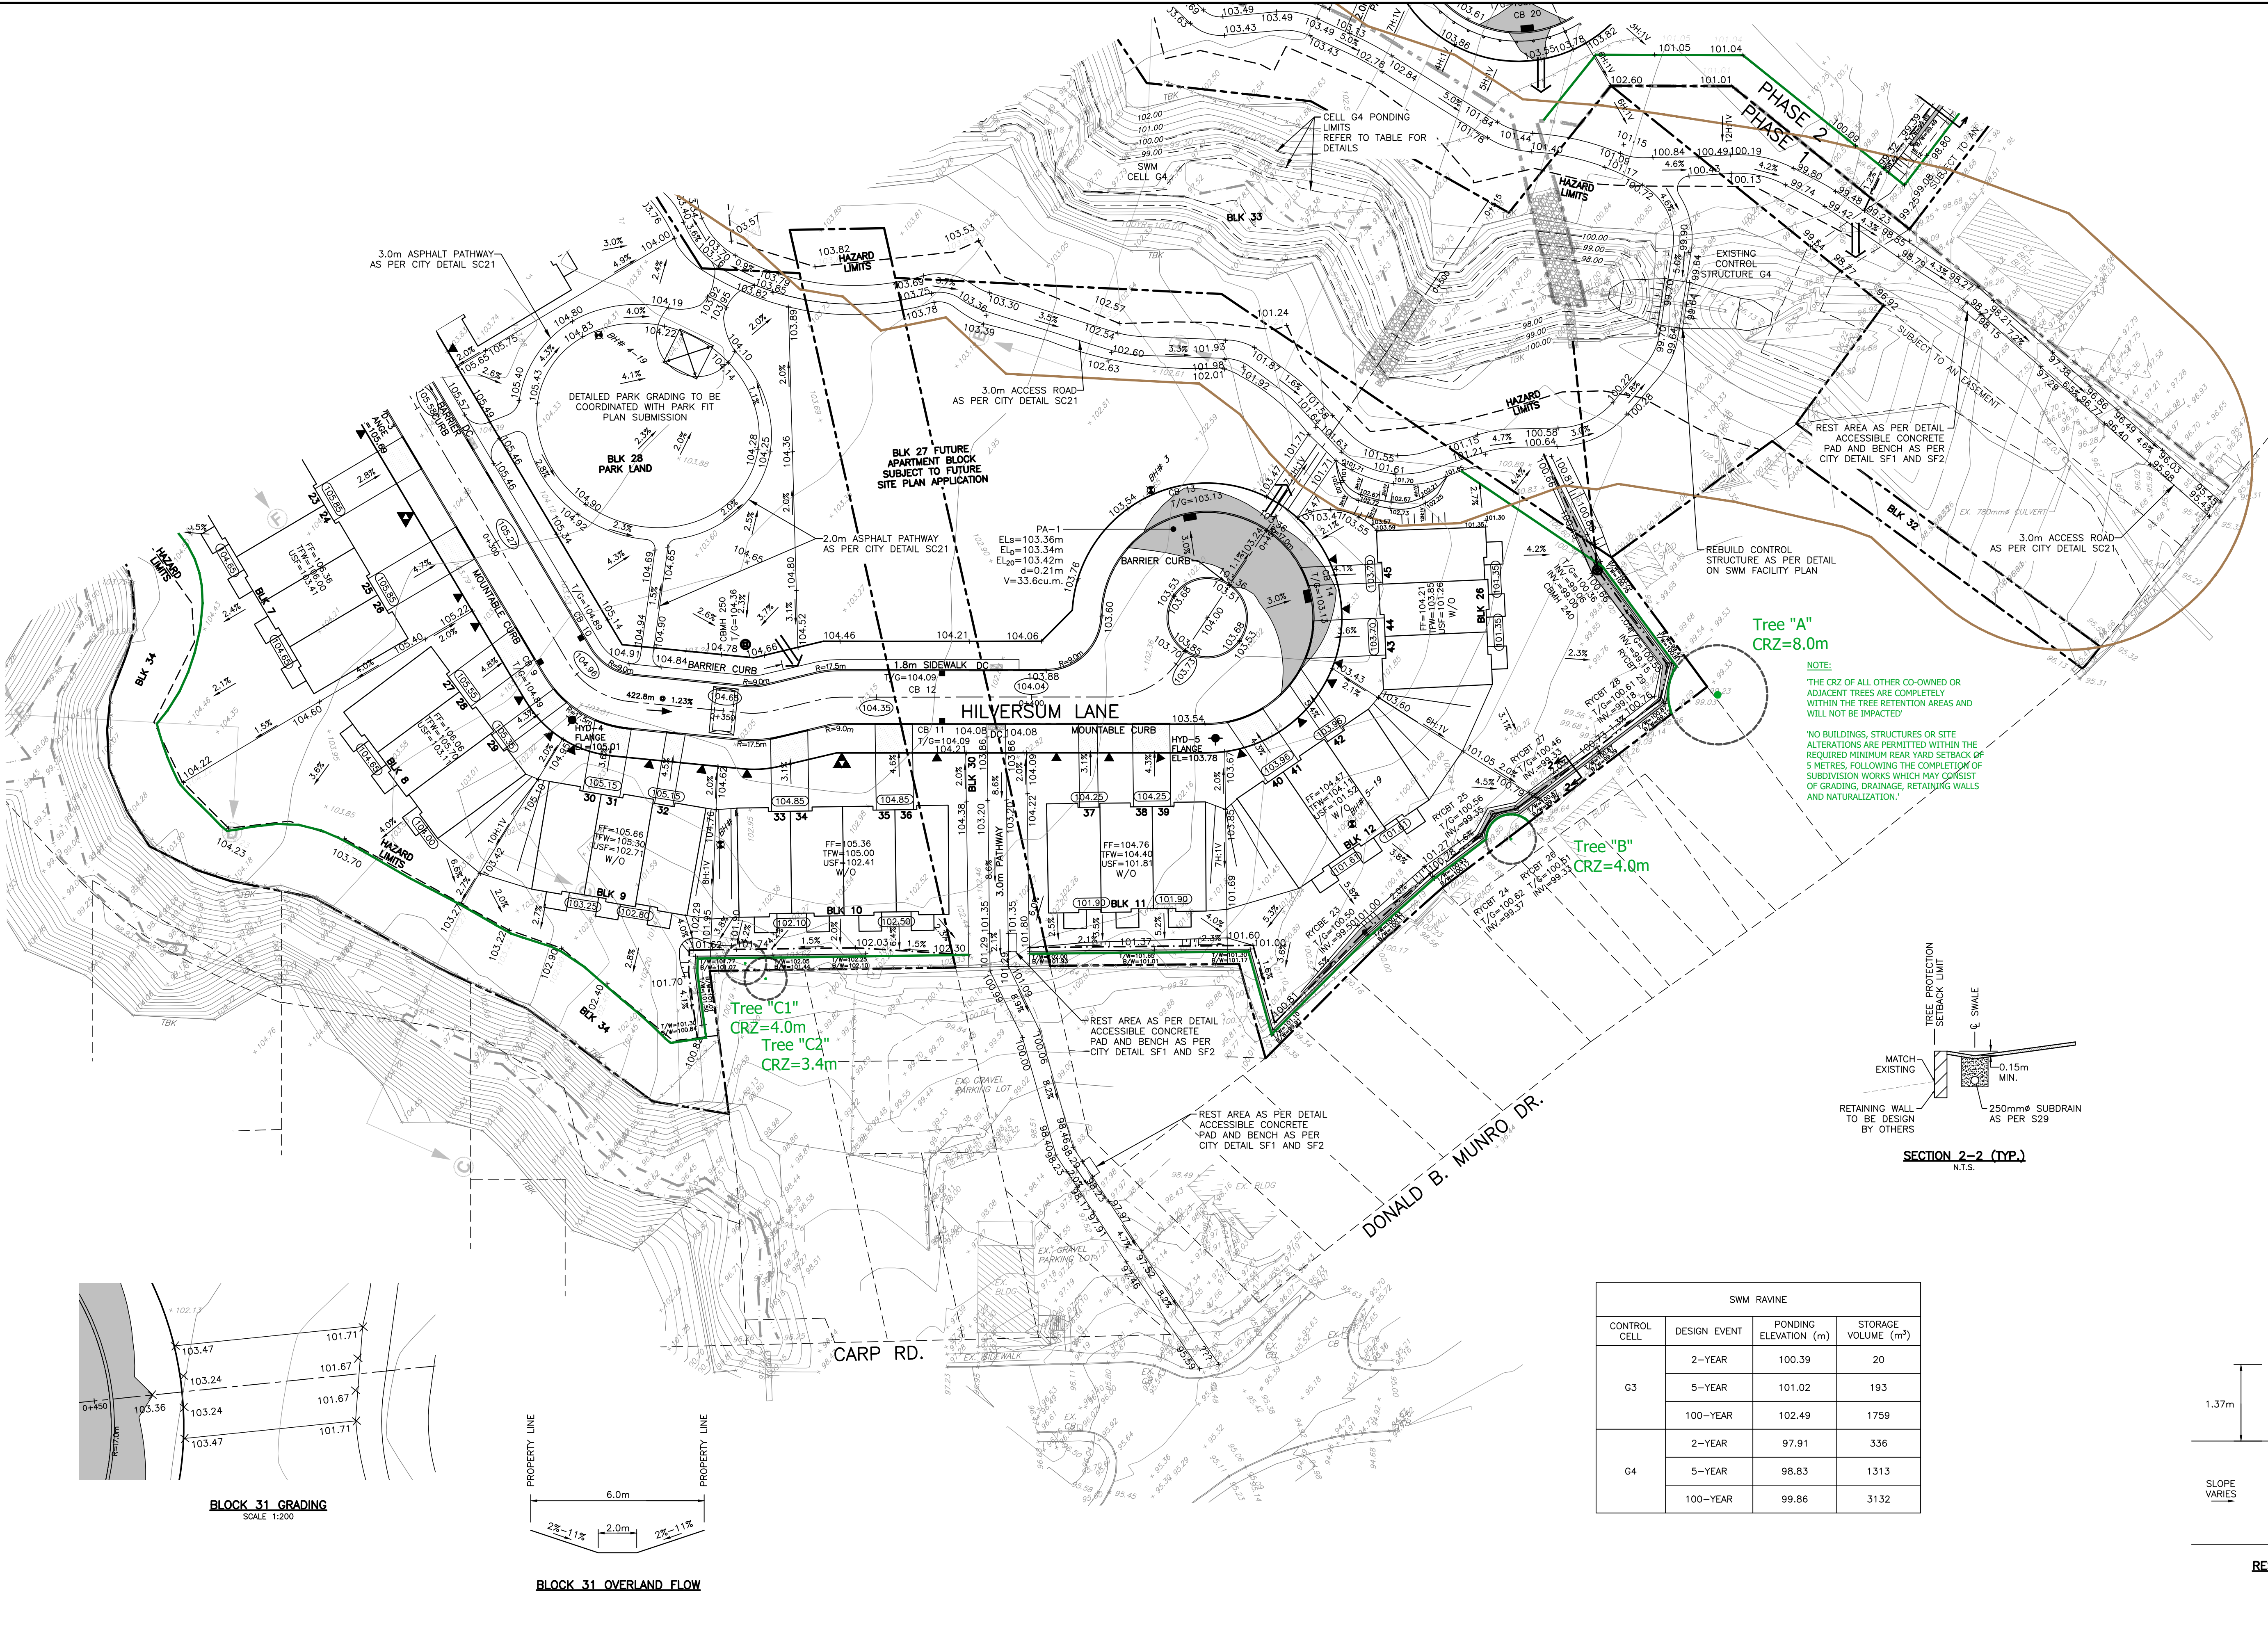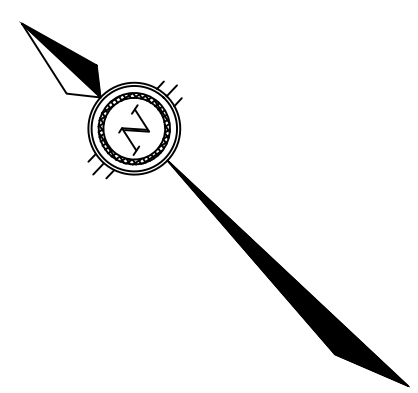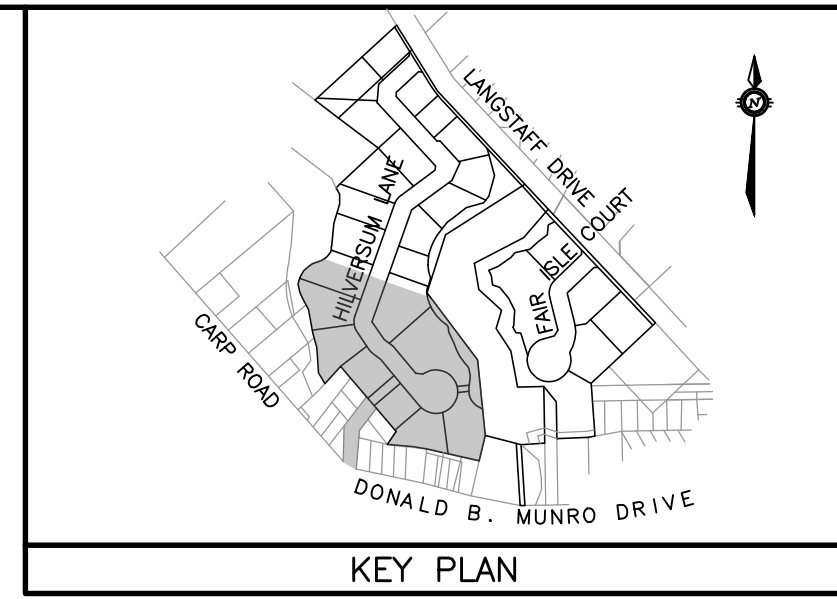

- LEGEND**
- PROPERTY BOUNDARY
  - LIMIT OF HAZARD LANDS
  - PHASING LIMIT
  - TREE RETENTION SETBACK (AS PER EIS)
  - TURTLE HABITAT SETBACK (AS PER EIS)
  - EXISTING ELEVATION
  - PROPOSED GRADE
  - PROPOSED DRAINAGE SLOPE AND DIRECTION
  - DRIVEWAY/REAR TERRACE GRADE
  - CENTRELINE OF ROAD GRADE
  - EXISTING CATCH BASIN
  - EXISTING DITCH
  - HYDRANT
  - ROADSIDE CATCH BASIN
  - ROADSIDE DOUBLE CATCH BASIN
  - LANDSCAPE CATCH BASIN ELBOW
  - LANDSCAPE CATCH BASIN TEE
  - SWALE WITH 250mm# SUBDRAIN
  - SWALE
  - RETAINING WALL
  - TERRACING
  - DRIVEWAY LOCATION
  - NOISE WALL
  - SLOPE STABILITY SECTION
  - MAX. STATIC PONDING LIMIT
  - MAJOR OVERLAND FLOW ROUTE
- PA-1 PONDING AREA ID  
 EL<sub>s</sub>=97.00 MAXIMUM STATIC PONDING ELEVATION  
 EL<sub>d</sub>=97.02 100-YR DYNAMIC PONDING ELEVATION  
 EL<sub>g</sub>=97.08 100-YR + 20% PONDING ELEVATION  
 d=0.17m 100-YR DYNAMIC PONDING DEPTH  
 V=83.1cu.m. AVAILABLE SURFACE STORAGE VOLUME
- FF: FINISHED FLOOR  
 TFW: TOP OF FOUNDATION WALL  
 USF: UNDERSIDE OF FOOTING  
 R1: NUMBER OF RISERS


**Tree "A"**  
CRZ=8.0m

**NOTE:**  
"THE CRZ OF ALL OTHER CO-OWNED OR ADJACENT TREES ARE COMPLETELY WITHIN THE TREE RETENTION AREAS AND WILL NOT BE IMPACTED"




**Tree "B"**  
CRZ=4.0m

**Tree "C1"**  
CRZ=4.0m

**Tree "C2"**  
CRZ=3.4m

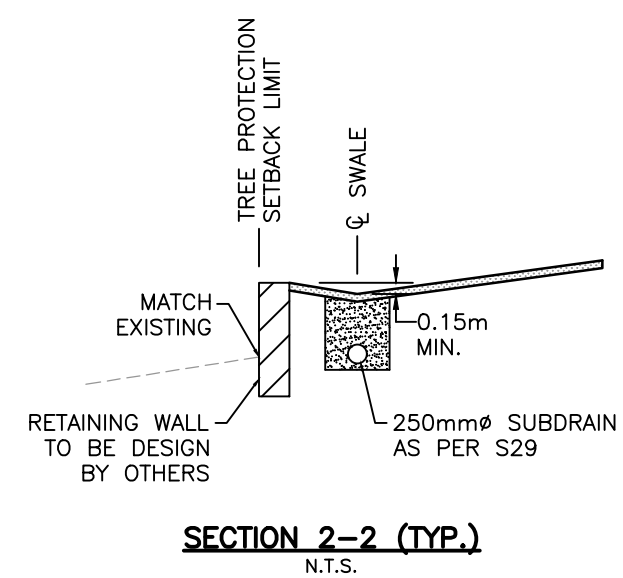

SWM RAVINE			
CONTROL CELL	DESIGN EVENT	PONDING ELEVATION (m)	STORAGE VOLUME (m <sup>3</sup> )
G3	2-YEAR	100.39	20
	5-YEAR	101.02	193
	100-YEAR	102.49	1759
G4	2-YEAR	97.91	336
	5-YEAR	98.83	1313
	100-YEAR	99.86	3132

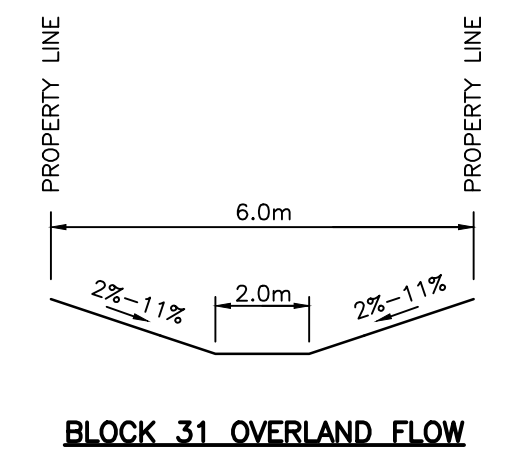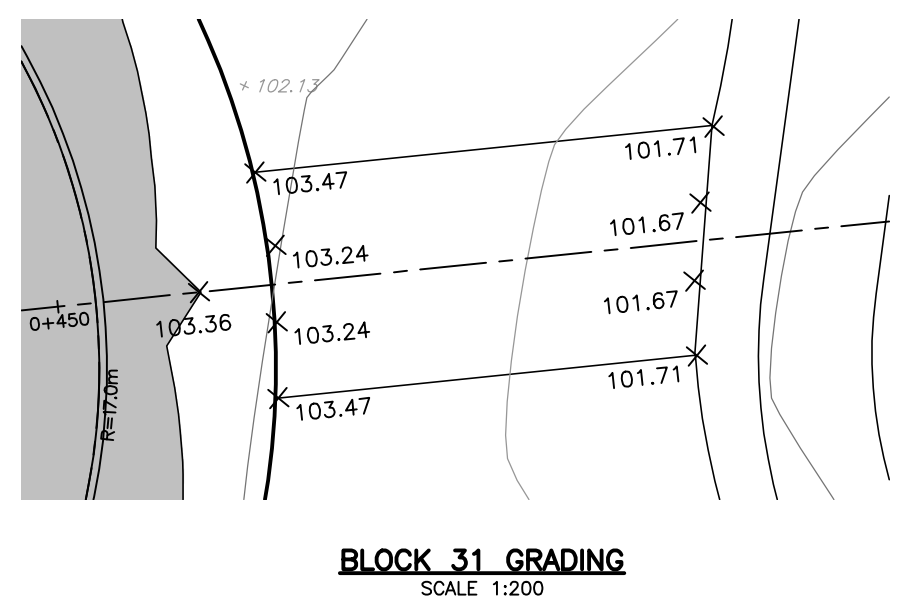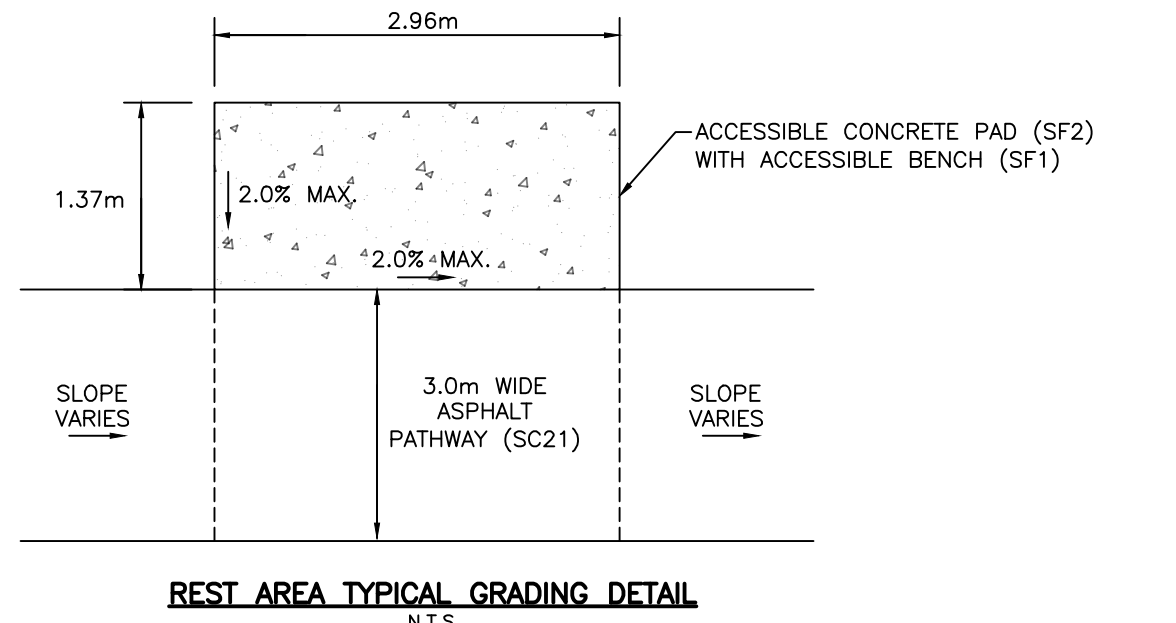


**NOTES**

THE POSITION OF ALL POLE LINES, CONDUITS, WATERMANS, SEWERS AND OTHER UNDERGROUND AND OVERGROUND UTILITIES AND STRUCTURES IS NOT NECESSARILY SHOWN ON THE CONTRACT DRAWINGS, AND WHERE SHOWN, THE ACCURACY OF THE POSITION OF SUCH UTILITIES AND STRUCTURES IS NOT GUARANTEED. BEFORE STARTING WORK, DETERMINE THE EXACT LOCATION OF ALL SUCH UTILITIES AND STRUCTURES AND ASSUME ALL LIABILITY FOR DAMAGE TO THEM.

GEODETIC SURVEY DERIVED FROM COSINE STATION 0011968U054. LOCATION DESCRIPTION: OLD HIGHWAY 17 BRIDGE OVER CARP RIVER ON CARP-STITTSVILLE ROAD, 0.2 KM SOUTH OF C.N.R. CROSSING IN VILLAGE OF CARP, TABLET IN TOP OF WEST WALL, 30 CM FROM NORTH END, 24 CM FROM WEST EDGE. VERTICAL CONTROL, DATA, DATUM: CGVD2878, FIRST ORDER, ELEVATION: 93.861. COORDINATE SYSTEM: MTM ZONE 9; NAD 83 DATUM (CAN83-9)

NO.	REVISION DESCRIPTION	DATE	BY
7	ISSUED FOR MECP ECA	23/09/24	BLM
6	ISSUED FOR PHASE 1 TENDER	06/09/24	BLM
5	REVISED PER CITY COMMENTS	12/07/24	BLM
4	REVISED PER CITY COMMENTS	28/05/24	BLM
3	REVISED PER CITY COMMENTS	22/03/24	BLM
2	REVISED PER CITY COMMENTS	09/11/23	BLM
1	ISSUED FOR REVIEW	24/05/23	BLM

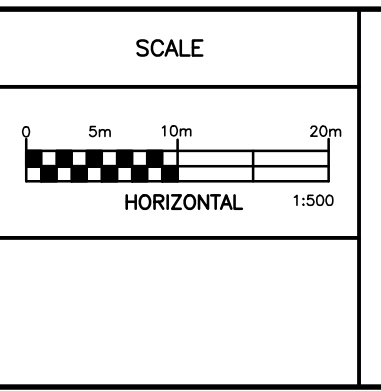

**Robinson**  
Land Development

CONSULTING ENGINEERS  
350 PALLADIUM DRIVE  
KANATA, ONTARIO K2V 1A8  
TELEPHONE (613) 592-6060

DESIGN	JHB
CHECKED	BLM
DRAWN	JHB
CHECKED	BLM
APPROVED	BLM

**INVERNESS HOMES**  
38 AURIGA DRIVE, SUITE 200  
OTTAWA, ON K2E 8A6

**147 LANGSTAFF DRIVE**  
CARP, ON

**GRADING PLAN**

PROJECT No.	19008
SURVEY	RLD
DATED	SEPTEMBER 2024
DWG. No.	19008-GR2

FILE No. D07-16-21-0012 PLAN No. 19168

## Brandon Mackechnie

---

**Subject:** FW: 147 Langstaff Drive - updates

---

**From:** McCormick, Sarah <[sarah.mccormick@ottawa.ca](mailto:sarah.mccormick@ottawa.ca)>

**Sent:** October 21, 2025 9:00 AM

**To:** Robin Daigle <[robin@invernesshomes.ca](mailto:robin@invernesshomes.ca)>; Joshua Laginski <[joshua@invernesshomes.ca](mailto:joshua@invernesshomes.ca)>

**Cc:** Brown, Adam <[Adam.Brown@ottawa.ca](mailto:Adam.Brown@ottawa.ca)>; Jack Stirling <[jack@tsgdi.ca](mailto:jack@tsgdi.ca)>; Alison Stirling <[alison@tsgdi.ca](mailto:alison@tsgdi.ca)>; Kyle MacHutchon <[kyle@invernesshomes.ca](mailto:kyle@invernesshomes.ca)>; michael.polowin <[michael.polowin@gowlingwlg.com](mailto:michael.polowin@gowlingwlg.com)>

**Subject:** 147 Langstaff Drive - updates

Good morning,

We have been advised by our Infrastructure and Planning group, that after reviewing the residual capacity of both the sanitary and water services within the Village of Carp that sufficient capacity is available for the 39-unit apartment dwelling on Block 12 of the draft 4M Plan. Boundary conditions for this block will be made available to you shortly, under separate cover.

Further, please see below the new and revised conditions proposed for the subdivision agreement, for your review and concurrence. I note that Block 12 has been left out of the Phase 2 lands given the above servicing capacity update.

### New Conditions

- a) **Phasing:** The Owner acknowledges and agrees that while the subdivision is being registered in whole, that development will occur in phases as follows: (a) Phase 1 is to include Street 1 (Hilversum Lane), Blocks 1-5, 12-23; and (b) Phase 2 is to include Street 2 (Fair Isle Court) and Blocks 6 to 11. The Owner further acknowledges and agrees that Phase 2 of development can only occur once it has been demonstrated that sufficient water and sanitary capacity is available for the Phase 2 lands.
- b) **Inhibiting order:** The Owners acknowledges and agrees that an inhibiting order will be left on lands within Phase 2 of the development until: (a) it is demonstrated that sufficient sanitary and water capacity is available to service the Blocks; and (b) that securities, fees and insurance documents for Phase 2, have been provided to the City.
- c) **Lifting of hold:** The Owner acknowledges and agrees that the holding zone on Blocks 6-11, can only be lifted once the following occurs: (a) it is demonstrated that sufficient sanitary and water capacity is available to service the Blocks; and (b) that securities, fees and insurance documents for Phase 2, have been provided to the City.
- d) **Block 16:** The Owner acknowledges and agrees that Block 16 is of insufficient size in terms of lot area and lot frontage to be considered a buildable lot.

### Revise Condition

- e) **Block 8:** Condition 11 of the draft approval will be updated in the subdivision agreement as follows: The Owner(s) of Block 9 is responsible, in perpetuity, for the ownership and maintenance the open area identified as Block 8.

Upon your concurrence of these conditions, I will ask the legal clerk to update the subdivision agreement with these conditions and the other outstanding comments Inverness provided in Robin's email dated September 17<sup>th</sup>.

If you have any questions or comments related to the above, please do not hesitate to contact me.

Regards,  
Sarah

**Sarah McCormick** MCIP, RPP

**Planner III / Urbaniste III**

Development Review, Rural Services / Examen des projets d'aménagement, Service ruraux

Planning, Development, and Building Services Department

Direction générale des services de la planification, de l'aménagement et du bâtiment

City of Ottawa / Ville d'Ottawa

110 av Laurier Avenue West/ouest - 4th Floor/4<sup>e</sup> étage

Ottawa, ON, K1P 1J1

☎ 613.580.2424 ext./poste 24487

This e-mail originates from the City of Ottawa e-mail system. Any distribution, use or copying of this e-mail or the information it contains by other than the intended recipient(s) is unauthorized. Thank you.

Le présent courriel a été expédié par le système de courriels de la Ville d'Ottawa. Toute distribution, utilisation ou reproduction du courriel ou des renseignements qui s'y trouvent par une personne autre que son destinataire prévu est interdite. Je vous remercie de votre collaboration.

Classified as City of Ottawa - Internal / Ville d'Ottawa - classé interne

This email originated from an External Sender. Please do not click links, open attachments or reply unless you recognize the source.

# Carp Short Term Upgrades: Brief History and Status

*Water Resources Planning and Engineering Branch*

October 6, 2025

Meeting requested by:  
Inverness Homes

Prepared by:

Stan Mathew, P.Eng, Program Manager, Intensification Servicing

Hiran Sandanayake, P.Eng, Manager, Water Resources Planning and Engineering




# Meeting Agenda

- Introductions
- Servicing Context for the Village of Carp
- Consequences of Inadequate Capacity
- Scope of Carp Short Term Capacity Upgrades
  - Current Key Project Complexities
  - Project Next Steps




# Introductions

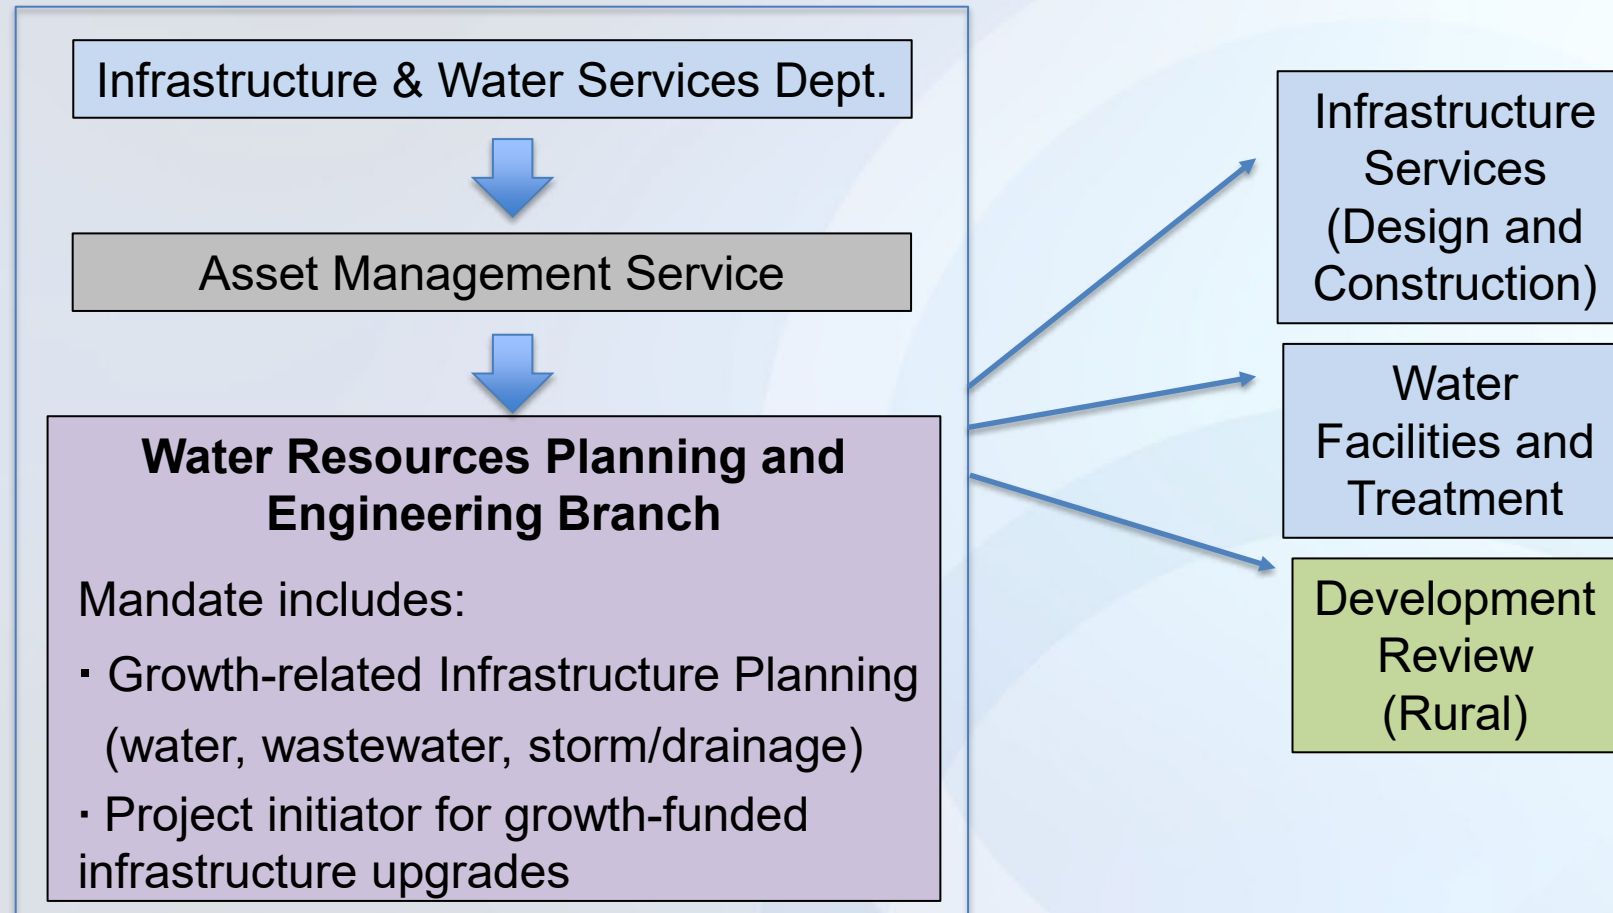

# Servicing Context for the Village of Carp

## Key Milestones

- CDP in 2004
- EA in 2009 (Stantec)
- Short-term Functional Design in 2022
- Short-term Detailed Design in 2024
  - Includes capacity for 147 Langstaff
- Long-term Functional Design in 2025

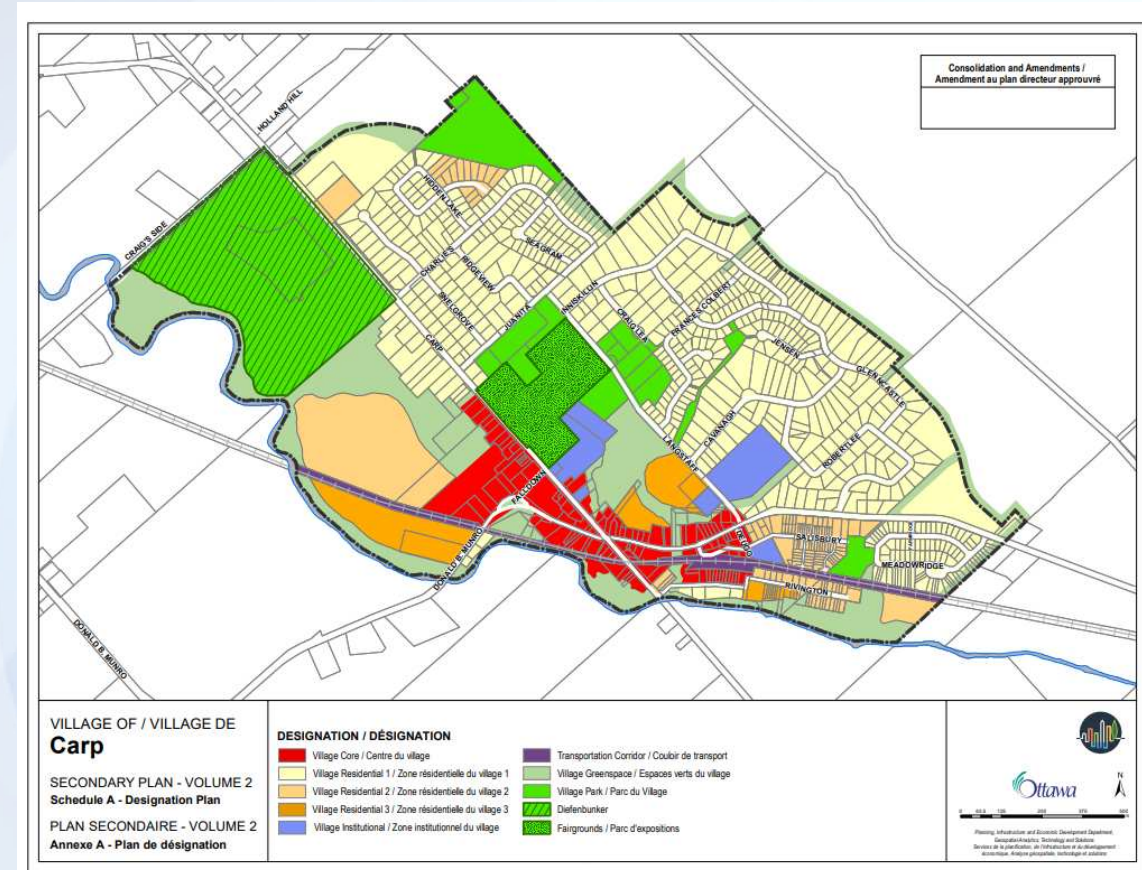

# Consequences of Inadequate Capacity

- **Wastewater**
  - Significant flood risk at the station and existing basements without upgrades (including station overflow)
    - Need upgrade from 51 lps to 75 lps max flow rates, overflow installation
- **Water**
  - Significant level of service (low pressure) risk in the existing system during Max Day and Peak Hour demand scenarios
    - Pumping considerations for maintaining water quality treatment through GAC system
    - Need station upgrade from 14 lps to 27 lps in the Max Day scenario

# Scope of Carp Short-term Capacity Upgrades

## Creating Capacity for Growth

- **Wastewater (Pumping Station)**
  - Replace pumps (based on existing forcemain constraints)
  - New gravity overflow connection from the station to existing sewer
  - New electrical service, generator; general upgrades to current standards
- **Water (Treatment Plant and Pumping Station)**
  - New pumps: well pumps and station pumps
  - Upgrades to Granulated Activated Carbon process – pumping scheme
  - Addition of provisions for on-site backwash of upgraded GAC system
  - Replacement of electrical services and motor control center

# Current Key Project Complexities

## Major Design Challenges

- **Wastewater (little to no schedule impacts)**
  - Confirmation of overflow configuration (completed)
  - Other pump station components are generally OK

# Current Key Project Complexities

## Major Design Challenges

- **Water (moderate schedule risk)**
  - Pumping scheme (managing low flows and much higher peak flows)
    - Critical for existing residents and future growth
  - 2024 well condition assessment
    - Strategy developed to maintain existing well capacity
    - Critical for existing residents and future growth
  - Various operational concerns with changes to GAC filtration and backwash
    - Important for City's ability to maintain delivery of clean, safe drinking water

# Project Next Steps

## Current Estimated Schedule – Short-term Capacity Upgrades

Milestone	Estimated Date
Complete Detailed Design	Q4 2026
Complete Tendering/Award	Q1 2027
Commence Construction	Q2 2027
Complete Construction	Q4 2028



## Appendix B

Site Plan  
(prepared by Peter Mansfield Architect)

Servicing Plan (DWG. 25094-S1)

Grading and Drainage Plan  
(DWG. 25094-GR1)

Notes & Details  
(DWG. 25094-N1)

Erosion and Sediment Control Plan  
(DWG. 25094-ESC1)

Parking Garage Ramp Plan & Plan  
(DWG. 25094-P1)

No.:	Issued For:	Date:
1	For SPA	Nov 03-2025
2	For SPA (WITH LANDSCAPE)	Nov 20-2025


It is the responsibility of the appropriate Contractor to verify all dimensions on site and report all errors and/or omissions to the Architect.

All Contractors must comply with pertinent codes & by-laws.

Do not scale drawings. This drawing may not be used for construction until signed. Architect's copyright reserved.

Metric Scale Drawing: All measurements are in millimeters (mm) unless otherwise noted.

Symbol Legend:

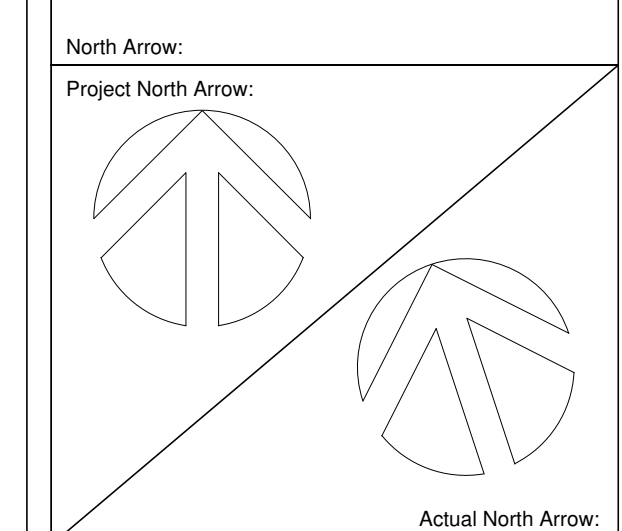


Architect:




**Peter Mansfield, Architect**  
 B. Tech., M. Arch., O.A.A.  
 122 Bridge Street, Almonte, ON  
 613-256-5213

Project Title:  
 Proposed 39 Unit Apartment Building  
 27 Hilversum Way, Carp, ON

Drawing List:  
 Site Plan

Job No.:	2404	Drawing No.:	<b>A0.0</b>
Scale:	As Noted		
Date:	Nov 03-2025		
Drawn By:	PM	Reviewed By:	

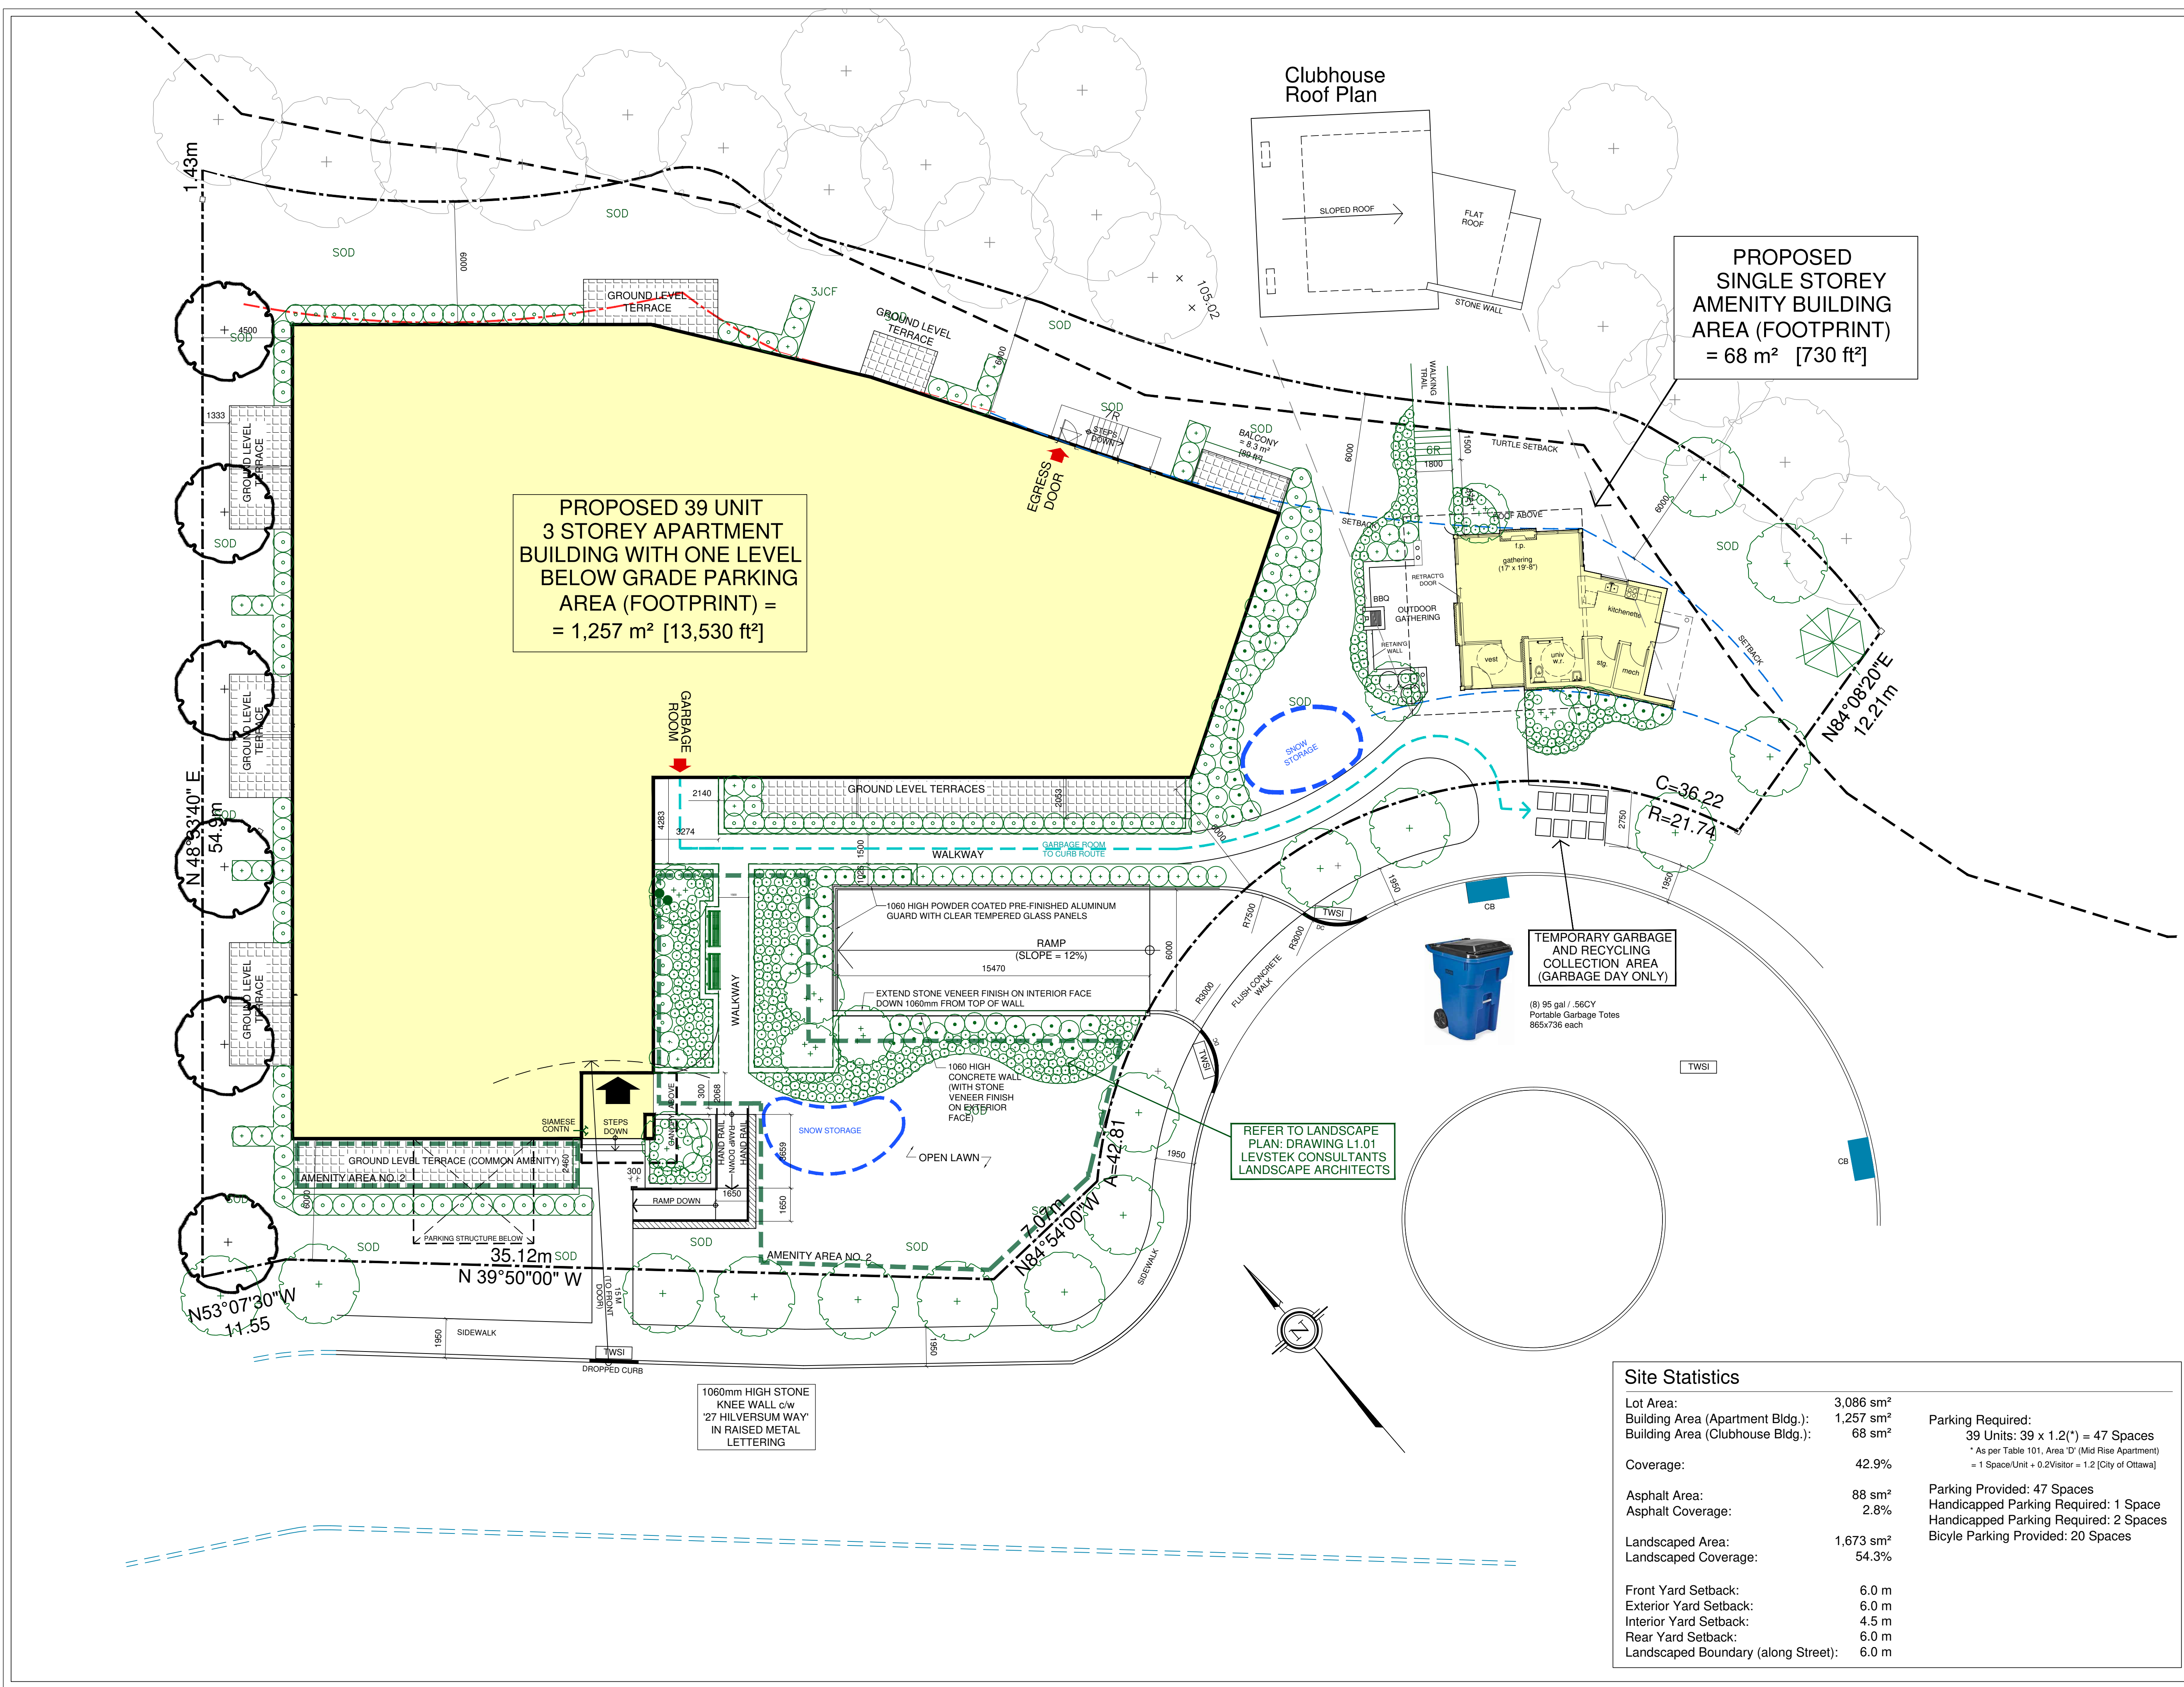

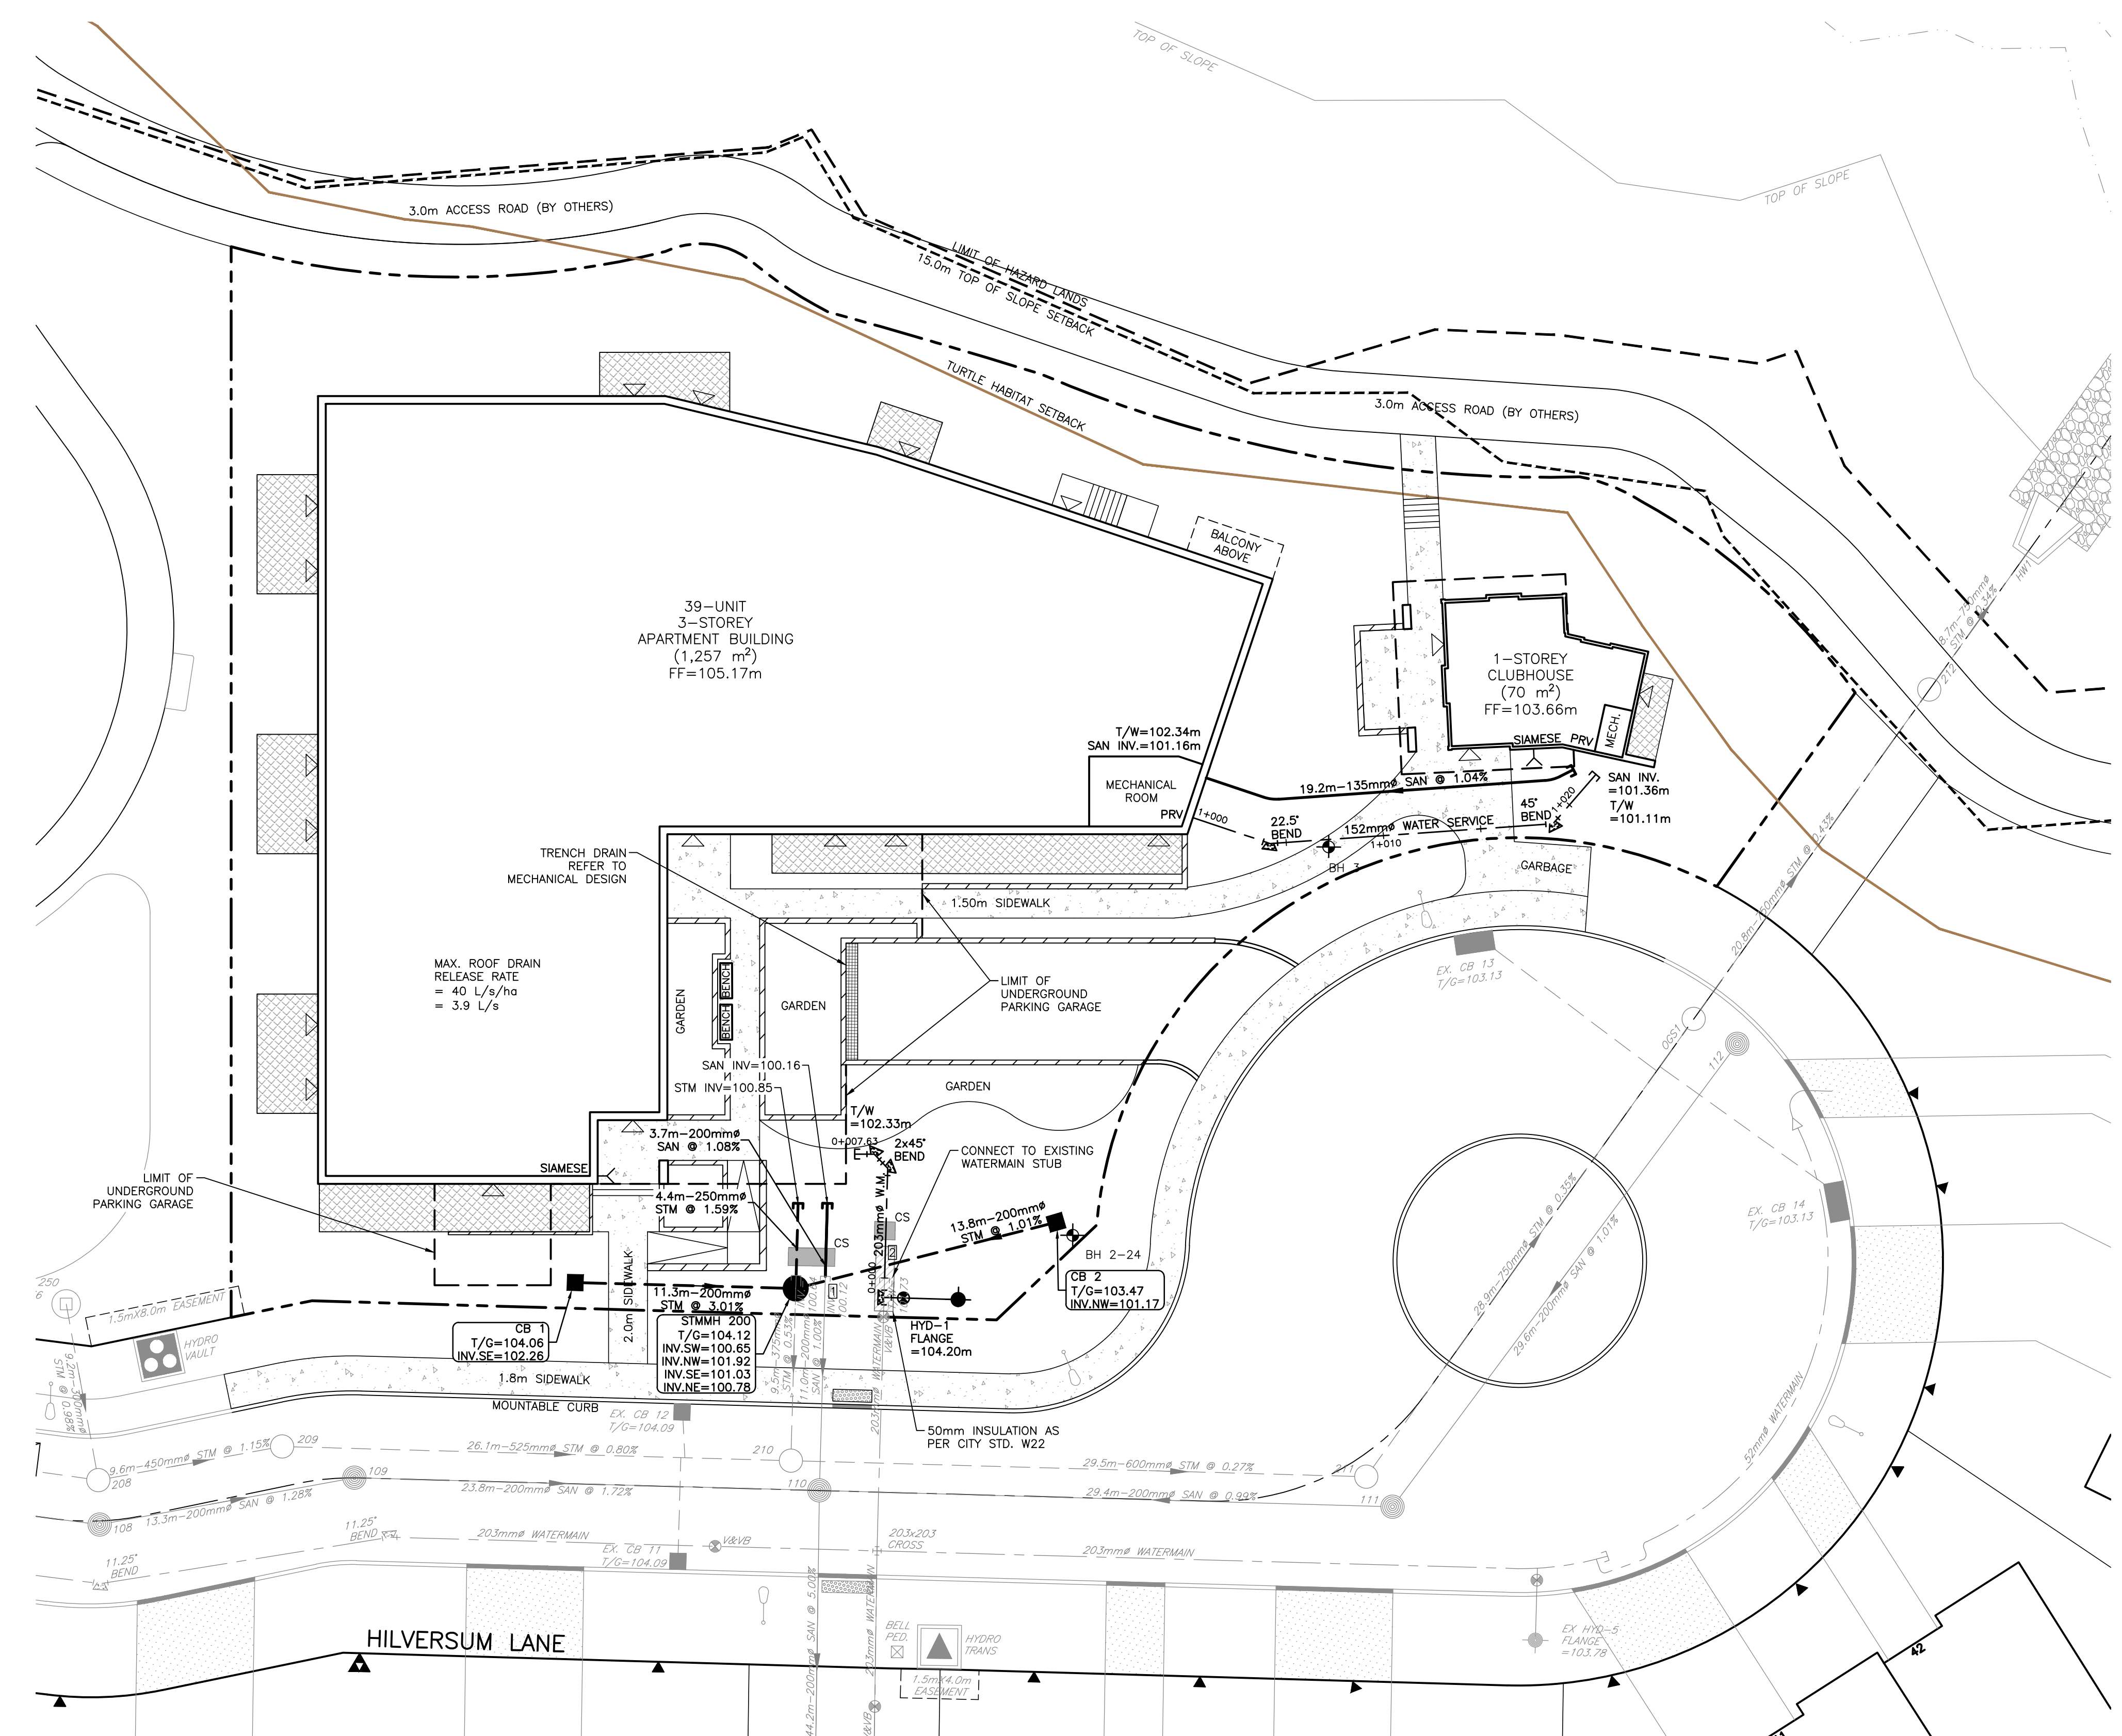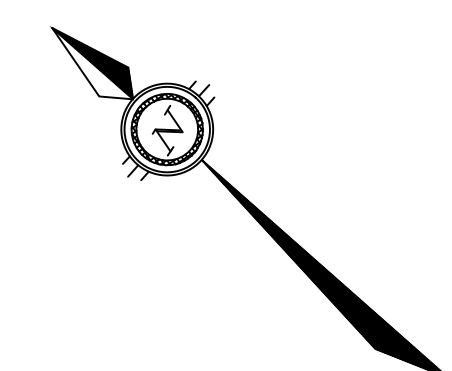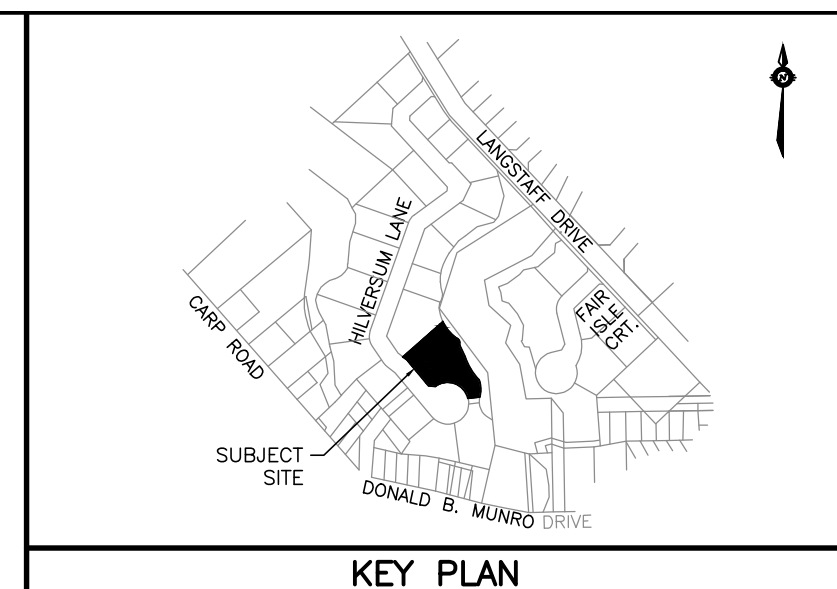

- LEGEND**
- PROPERTY BOUNDARY
  - LIMIT OF HAZARD LANDS
  - 15.0m TOP OF SLOPE SETBACK
  - TURTLE HABITAT SETBACK (AS PER EIS)
  - EXISTING HYDRANT
  - EXISTING CATCH BASIN
  - EXISTING WATERMAIN
  - EXISTING VALVE & VALVE BOX
  - EXISTING SANITARY SEWER & MANHOLE
  - EXISTING STORM SEWER & MANHOLE
  - EXISTING LIGHT STANDARD
  - PROPOSED HYDRANT
  - WATERMAIN
  - V&VB
  - PRV
  - Y
  - CATCH BASIN
  - SANITARY SEWER & MANHOLE (WATERTIGHT COVER)
  - STORM SEWER & MANHOLE
  - CS
  - sc
  - ▽
  - 
  - ▨ INSULATION (AS PER CITY STD. W22/S35)
  - ⊕ BOREHOLE (REFER TO GEOTECHNICAL REPORT)

CROSSING TABLE			
CROSSING No.	SERVICE	INVERT/OBVERT	SEPARATION (m)
1	STORM	101.05	0.73
	SANITARY	100.32	
2	WATER	101.53	0.25
	STORM	101.28	

INLET CONTROL DEVICE (ICD) TABLE			
STRUCTURE	2-YR HEAD (m)	2-YR PEAK FLOW (L/s)	ORIFICE TYPE
CB 1	1.7	7.4	TEMPEST LMF 80, SLIDE
CB 2	2.2	10.8	TEMPEST LMF 90, SLIDE

203mm WATERMAIN GRADE TABLE - BUILDING SERVICE				
STATION	FINISHED GRADE (m)	TOP OF WATER (m)	COVER DEPTH (m)	COMMENTS
0+000	103.93	101.73	2.20	CONNECT TO EXISTING STUB
0+000.6	104.09	101.73	2.36	STORM CROSSING
0+005.6	104.59	102.19	2.40	45° HORZ. BEND
0+006.6	104.73	102.33	2.40	45° HORZ. BEND
0+007.6	104.94	102.33	2.61	CAP


152mm WATERMAIN GRADE TABLE - CLUB HOUSE SERVICE				
STATION	FINISHED GRADE (m)	TOP OF WATER (m)	COVER DEPTH (m)	COMMENTS
1+000	104.74	102.34	2.40	MECHANICAL ROOM
1+004.2	104.14	101.74	2.40	22.5° HORZ. BEND
1+010	103.68	101.28	2.40	TOP OF WATERMAIN
1+018.7	103.39	100.99	2.40	45° HORZ. BEND
1+022.1	103.51	101.11	2.40	CAP

NOTES:  
 1. CONNECTIONS TO LIVE WATERMANS TO BE COMPLETED BY CITY FORCES. CONTRACTOR TO PROVIDE EXCAVATION, MATERIAL, BACKFILL AND ASSISTANCE AS REQUIRED.

**NOT FOR CONSTRUCTION**

**NOTES**  
 THE POSITION OF ALL POLE LINES, CONDUITS, WATERMANS, SEWERS AND OTHER UNDERGROUND AND OVERGROUND UTILITIES AND STRUCTURES IS NOT NECESSARILY SHOWN ON THE CONTRACT DRAWINGS, AND WHERE SHOWN, THE ACCURACY OF THE POSITION OF SUCH UTILITIES AND STRUCTURES IS NOT GUARANTEED. BEFORE STARTING WORK, DETERMINE THE EXACT LOCATION OF ALL SUCH UTILITIES AND STRUCTURES AND ASSUME ALL LIABILITY FOR DAMAGE TO THEM.  
 GEODETIC SURVEY DERIVED FROM COSINE STATION 0011968U054. LOCATION DESCRIPTION: OLD HIGHWAY 17 BRIDGE OVER CARP RIVER ON CARP-STITTSVILLE ROAD, 0.2 KM SOUTH OF C.N.R. CROSSING IN VILLAGE OF CARP. TABLE IN TOP OF WEST WALL, 30 CM FROM NORTH END, 24 CM FROM WEST EDGE. VERTICAL CONTROL DATA, DATUM: CGVD28:78, FIRST ORDER, ELEVATION: 93.861. COORDINATE SYSTEM: MTM ZONE 9; NAD 83 DATUM (CAN83-9)

NO.	REVISION DESCRIPTION	DATE	BY
1	ISSUED FOR REVIEW	21/11/25	BLM

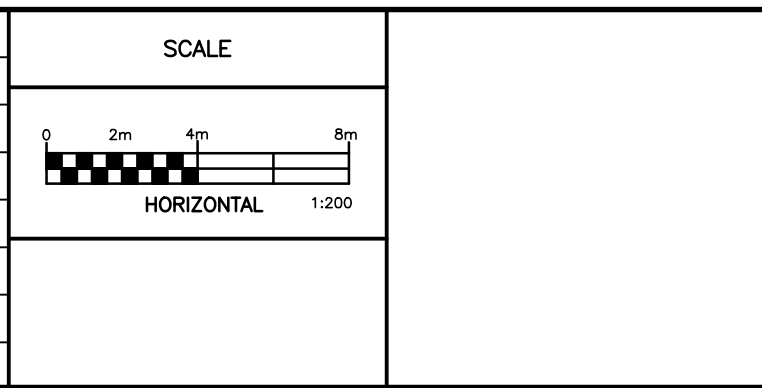

**Robinson**  
 Land Development

350 Palladium Drive  
 Ottawa, ON K2V 1A8  
 (613) 592-6060 rcii.com









DESIGN	BLM
CHECKED	SG
DRAWN	BLM
CHECKED	SG
APPROVED	BLM

**INVERNESS HOMES**  
 38 AURIGA DRIVE, SUITE 200  
 OTTAWA, ON K2E 8A6

**391 HILVERSUM LANE**  
 CARP, ON

**SERVICING PLAN**

PROJECT No.	25094
SURVEY	---
DATED	NOV. 2025
DWG. No.	25094-S1

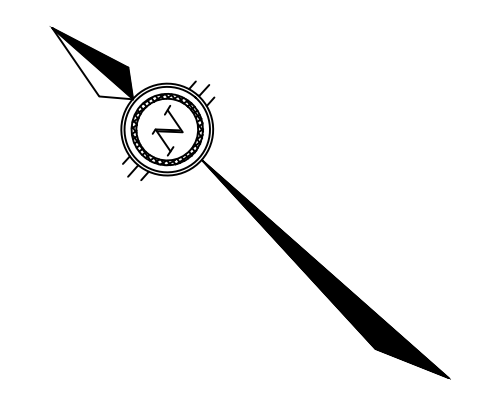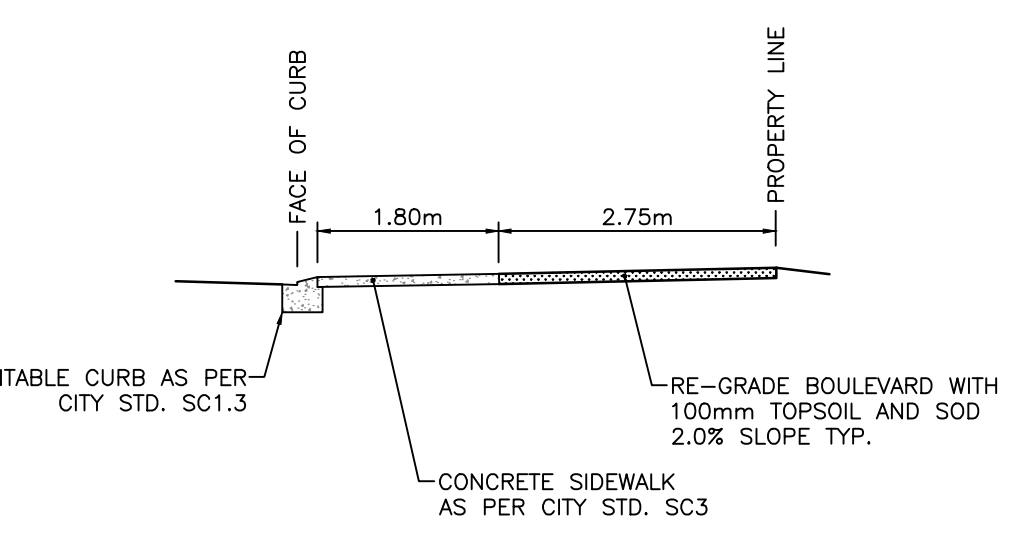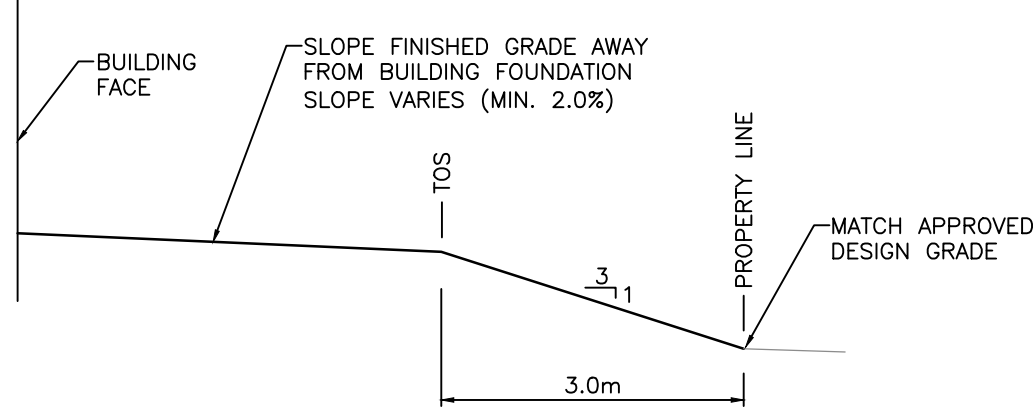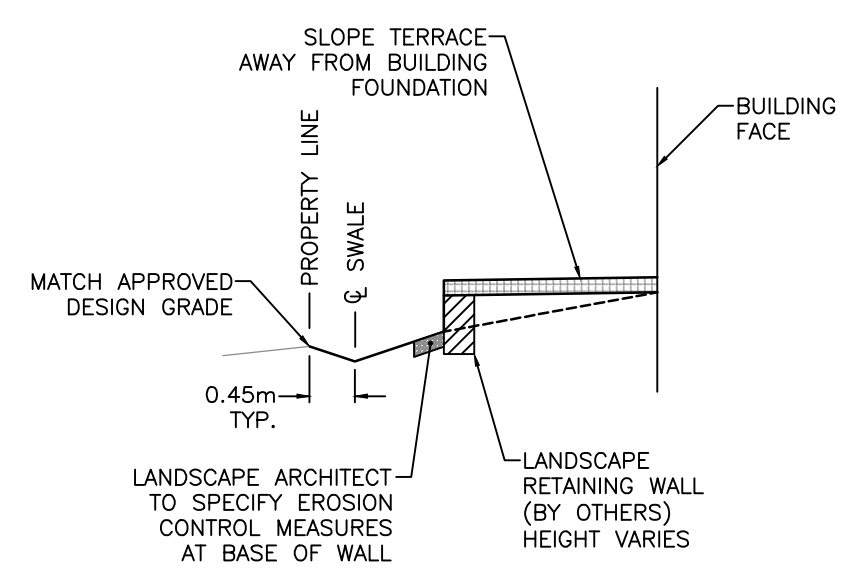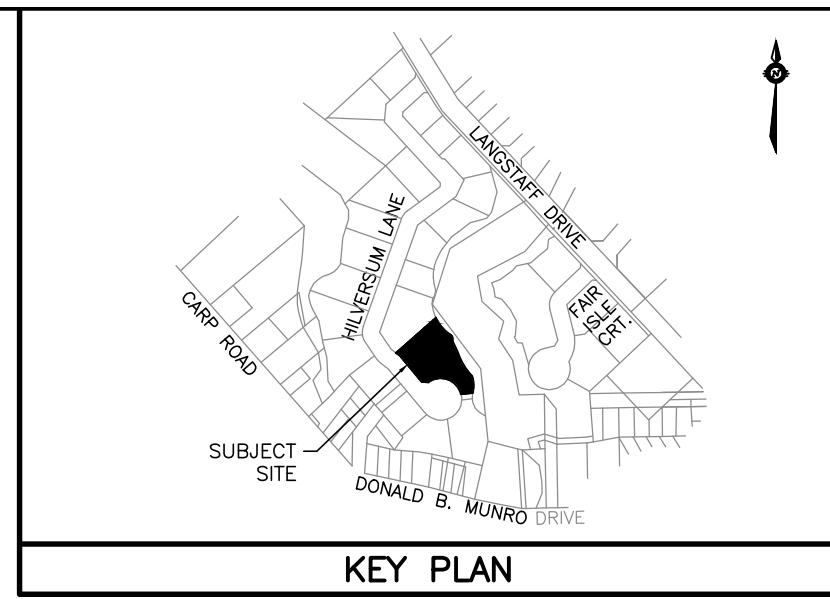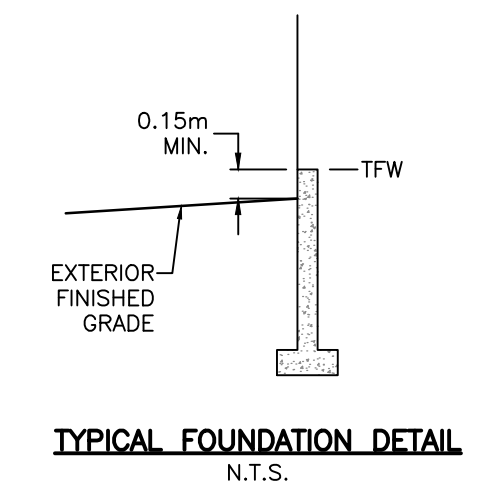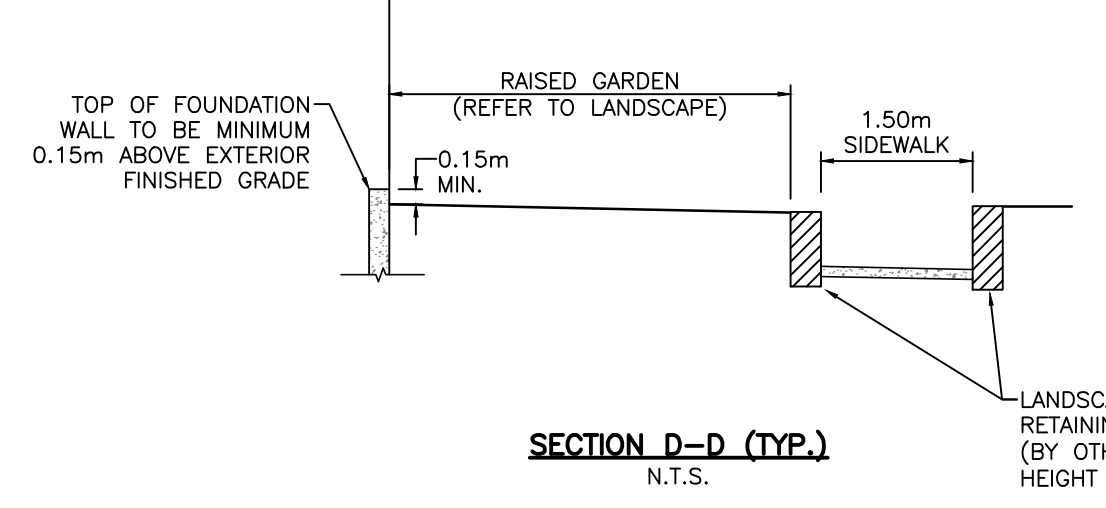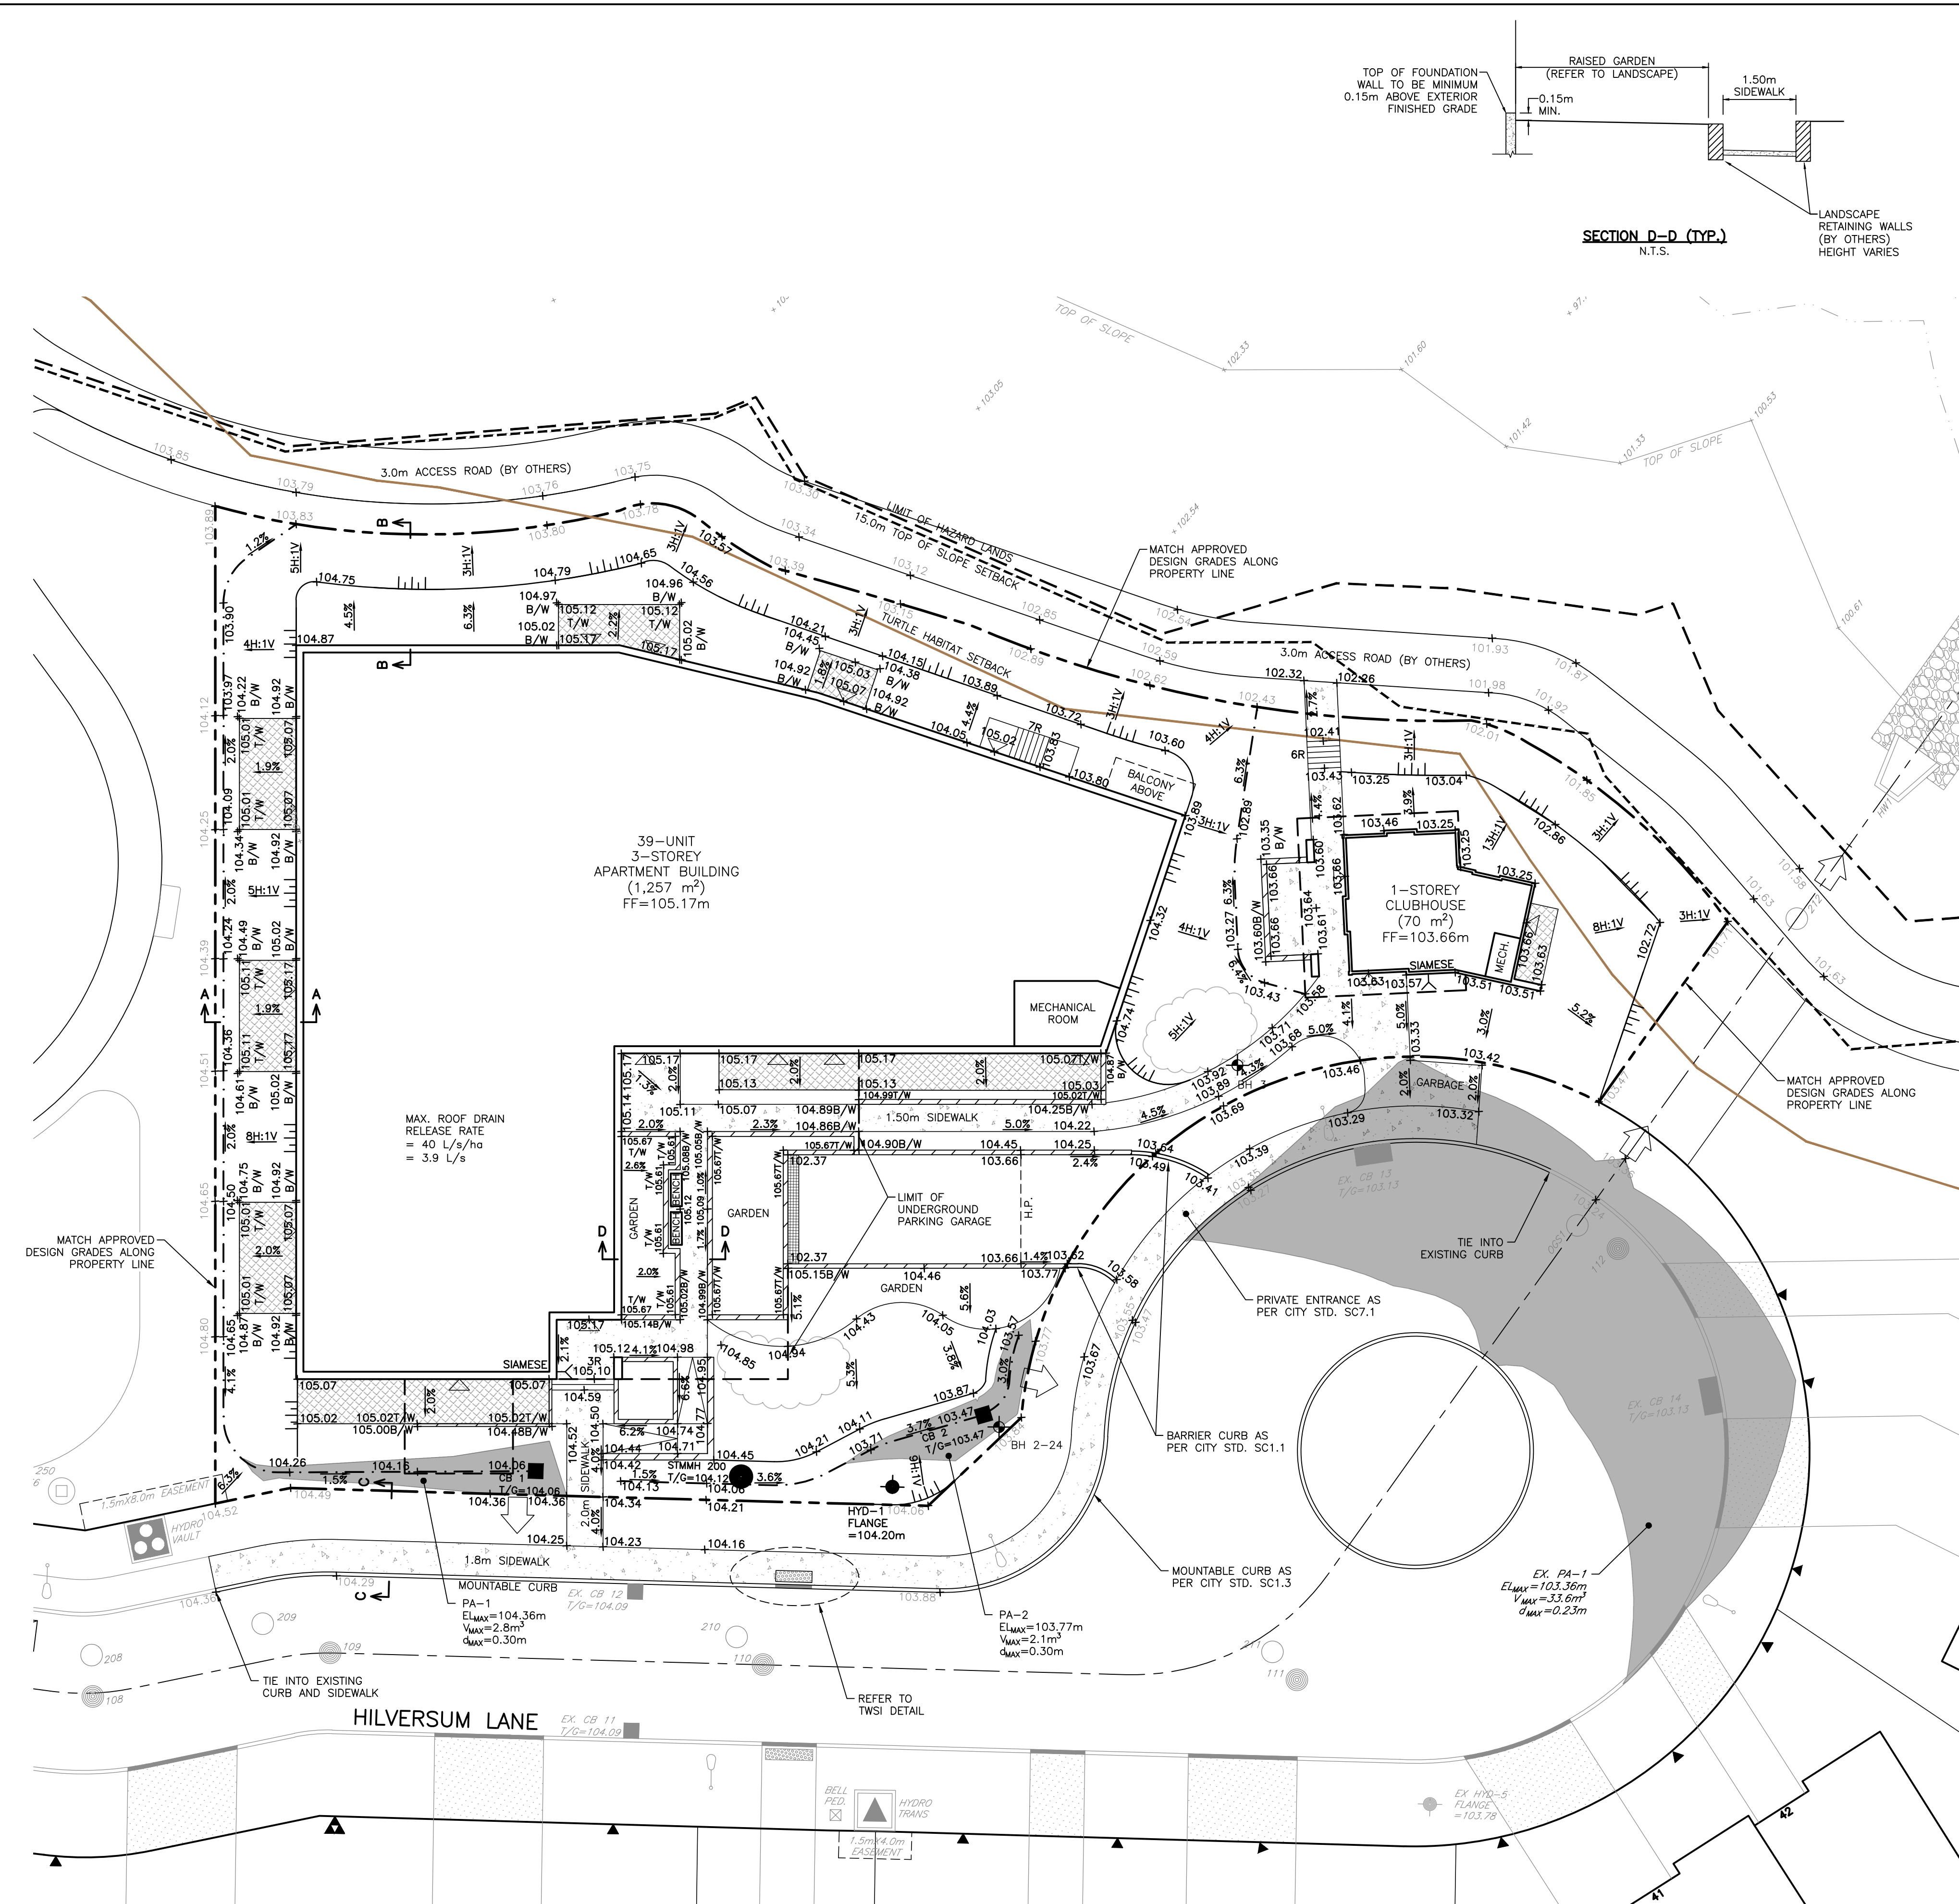

- LEGEND**
- PROPERTY BOUNDARY
  - LIMIT OF HAZARD LANDS
  - 15.0m TOP OF SLOPE SETBACK
  - TURTLE HABITAT SETBACK (AS PER EIS)
  - +103.00 EXISTING ELEVATION
  - x104.00 PROPOSED GRADE
  - x104.00 APPROVED DESIGN GRADE
  - 2.0% PROPOSED DRAINAGE SLOPE & DIRECTION
  - 3R PROPOSED NUMBER OF RISERS
  - EXISTING HYDRANT
  - EXISTING CATCH BASIN
  - EXISTING SANITARY MANHOLE
  - EXISTING STORM MANHOLE
  - EXISTING LIGHT STANDARD
  - PROPOSED HYDRANT
  - CATCH BASIN
  - SANITARY MANHOLE (WATERTIGHT COVER)
  - STORM MANHOLE
  - BUILDING ENTRANCE
  - BOREHOLE (REFER TO GEOTECHNICAL REPORT)
  - TERRACING (3H:1V MAX.)
  - SWALE
  - RETAINING WALL
  - H.P. HIGH POINT
  - DC DEPRESSED CURB WITH TWSI
  - MAJOR OVERLAND FLOW ROUTE
  - MAX. STATIC PONDING LIMIT
  - PA-1 PONDING AREA ID
  - E<sub>max</sub> MAXIMUM STATIC PONDING ELEVATION
  - V<sub>max</sub> MAXIMUM AVAILABLE SURFACE STORAGE
  - d<sub>max</sub> MAXIMUM STATIC PONDING DEPTH
  - SNOW STORAGE (REFER TO SITE PLAN)


NOTE: NO SURFACE PONDING OCCURS DURING THE 2-YEAR THROUGH 100-YEAR DESIGN EVENTS.

**NOTES**

THE POSITION OF ALL POLE LINES, CONDUITS, WATERMANS, SEWERS AND OTHER UNDERGROUND AND OVERGROUND UTILITIES AND STRUCTURES IS NOT NECESSARILY SHOWN ON THE CONTRACT DRAWINGS, AND WHERE SHOWN, THE ACCURACY OF THE POSITION OF SUCH UTILITIES AND STRUCTURES IS NOT GUARANTEED. BEFORE STARTING WORK, DETERMINE THE EXACT LOCATION OF ALL SUCH UTILITIES AND STRUCTURES AND ASSUME ALL LIABILITY FOR DAMAGE TO THEM.

GEODETIC SURVEY DERIVED FROM COSINE STATION 001196BU054. LOCATION DESCRIPTION: OLD HIGHWAY 17 BRIDGE OVER CARP RIVER ON CARP-STITTSVILLE ROAD, 0.2 KM SOUTH OF C.N.R. CROSSING IN VILLAGE OF CARP. TABLE IN TOP OF WEST WALL, 30 CM FROM NORTH END, 24 CM FROM WEST EDGE. VERTICAL CONTROL DATA, DATUM: CGVD2878, FIRST ORDER, ELEVATION: 93.861. COORDINATE SYSTEM: MTM ZONE 9; NAD 83 DATUM (CAN83-9)

NO.	REVISION DESCRIPTION	DATE	BY
1	ISSUED FOR REVIEW	21/11/25	BLM

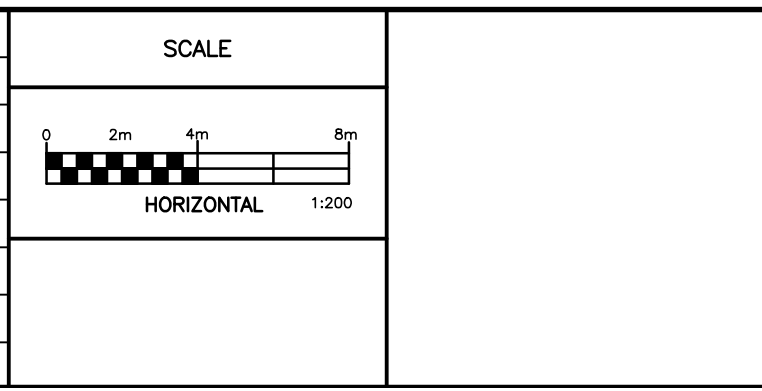

**Robinson**  
Land Development

350 Palladium Drive  
Ottawa, ON K2V 1A8  
(613) 592-6060 rcii.com

DESIGN	BLM
CHECKED	SG
DRAWN	BLM
CHECKED	SG
APPROVED	BLM

**INVERNESS HOMES**  
38 AURIGA DRIVE, SUITE 200  
OTTAWA, ON K2E 8A6

391 HILVERSUM LANE  
CARP, ON

**GRADING AND DRAINAGE PLAN**

PROJECT No.	25094
SURVEY	---
DATED	NOV. 2025
DWG. No.	25094-GR1

**NOT FOR CONSTRUCTION**

**GENERAL NOTES:**

- ALL WORKS AND MATERIALS SHALL CONFORM TO THE LATEST REVISIONS OF THE STANDARDS AND SPECIFICATIONS OF THE CITY OF OTTAWA AND ONTARIO PROVINCIAL STANDARD DRAWINGS (OPSD) AND SPECIFICATIONS (OPSS), AS AMENDED BY THE CITY OF OTTAWA.
- THE CONTRACTOR SHALL CONFIRM THE LOCATION OF ALL EXISTING UTILITIES WITHIN THE SITE AND ADJACENT WORK AREAS. THE CONTRACTOR SHALL BE RESPONSIBLE FOR PROTECTING ALL EXISTING UTILITIES TO THE SATISFACTION OF THE AUTHORITY HAVING JURISDICTION. THE CONTRACTOR SHALL BE RESPONSIBLE FOR REPAIR OR REPLACEMENT OF ANY SERVICES OR UTILITIES DISTURBED DURING CONSTRUCTION, TO THE SATISFACTION OF THE AUTHORITY HAVING JURISDICTION.
- ALL DIMENSIONS AND ELEVATIONS SHALL BE CHECKED AND VERIFIED IN THE FIELD BY THE CONTRACTOR PRIOR TO THE START OF CONSTRUCTION. ANY DISCREPANCIES SHALL BE REPORTED IMMEDIATELY TO THE ENGINEER.
- DESIGN ELEVATIONS OVER ARE TO BE ADHERED TO WITH NO CHANGES WITHOUT PRIOR WRITTEN APPROVAL BY ROBINSON LAND DEVELOPMENT.
- ANY AREAS BEYOND THE LIMIT OF THE SITE DISTURBED DURING CONSTRUCTION SHALL BE RESTORED TO ORIGINAL CONDITION OR BETTER TO THE SATISFACTION OF THE AUTHORITY HAVING JURISDICTION AT THE CONTRACTOR'S EXPENSE.
- ALL WORK SHALL BE COMPLETED IN ACCORDANCE WITH THE "OCCUPATIONAL HEALTH AND SAFETY ACT AND REGULATIONS FOR CONSTRUCTION PROJECTS". THE GENERAL CONTRACTOR SHALL BE DEEMED TO BE THE CONSTRUCTOR AS DEFINED IN THE ACT.
- ALL CONSTRUCTION SIGNAGE MUST CONFORM TO THE M.T.O. MANUAL OF UNIFORM TRAFFIC CONTROL DEVICES (LATEST AMENDMENT).
- ALL DIMENSIONS ARE IN METERS UNLESS OTHERWISE SPECIFIED.
- THE CONTRACTOR WILL BE RESPONSIBLE FOR ADDITIONAL BEDDING OR ADDITIONAL STRENGTH PIPE IF THE MAXIMUM TRENCH WIDTH, AS SPECIFIED BY OPSD, IS EXCEEDED.
- ALL NECESSARY CLEARING AND GRUBBING SHALL BE COMPLETED BY THE CONTRACTOR. REVIEW WITH THE CITY OF OTTAWA PRIOR TO AND TREE CUTTING.
- REFER TO GEOTECHNICAL MEMORANDUM PREPARED BY PATERSON GROUP, DATED NOVEMBER 5, 2025.
- THE CONTRACTOR IS RESPONSIBLE FOR AND SHALL PROVIDE FOR DEWATERING, SUPPORT AND PROTECTION OF EXCAVATIONS AND TRENCHING AS WELL AS RELEASE OF ANY PUMPED GROUNDWATER IN A CONTROLLED AND APPROVED MANNER.
- DO NOT CONSTRUCT UNLESS DRAWINGS THAT ARE NOT MARKED "ISSUED FOR CONSTRUCTION".
- CONTRACTOR IS RESPONSIBLE FOR ALL LAYOUT FOR CONSTRUCTION PURPOSES.
- CLAY SEALS SHALL BE INSTALLED WITHIN SEWER TRENCHES IN ACCORDANCE WITH CITY STANDARD SB.
- MOVEMENT OF MATERIAL ON AND/OR OFF SITE SHALL BE IN ACCORDANCE WITH ONTARIO EXCESS SOIL REGULATION O.REG. 406/19.
- THE CONTRACTOR SHALL COMPLETE A CCTV INSPECTION OF ALL NEW SANITARY AND STORM SEWERS. A COPY OF THE VIDEO INSPECTION SHALL BE PROVIDED TO THE ENGINEER FOR REVIEW.

**STORM SEWERS:**

- ALL REINFORCED CONCRETE STORM SEWER PIPE SHALL BE IN ACCORDANCE WITH CSA A257.2 (LATEST AMENDMENT). ALL NON-REINFORCED CONCRETE STORM SEWER PIPE SHALL BE IN ACCORDANCE WITH CSA A257.1 (LATEST AMENDMENT). PIPE SHALL BE JOINTED WITH STD. RUBBER GASKETS AS PER CSA A257.3 (LATEST AMENDMENT).
- ALL STORM SEWER TRENCH AND BEDDING SHALL BE IN ACCORDANCE WITH CITY OF OTTAWA STD. S6 AND S7 CLASS 'B' UNLESS OTHERWISE SPECIFIED. BEDDING AND COVER MATERIAL SHALL BE SPECIFIED BY PROJECT GEOTECHNICAL ENGINEER.
- ALL PVC STORM SEWERS ARE TO BE SDR 35 APPROVED PER C.S.A. B182.2 OR LATEST AMENDMENT, UNLESS OTHERWISE SPECIFIED.
- STORM MANHOLE FRAME AND COVERS SHALL BE AS PER CITY OF OTTAWA STD. S24.1.
- CATCH BASIN MANHOLE FRAME AND COVERS SHALL BE AS PER CITY OF OTTAWA STD. S28.1.
- STORM SEWER SEWERS LESS THAN 600mm SHALL BE CONSTRUCTED WITH A 300mm SLUMP. FOR STORM SEWERS 900mm AND OVER USE BENCHING IN ACCORDANCE WITH OPSD 701.021.
- THE STORM SEWER CLASSES HAVE BEEN DESIGNED BASED ON BEDDING CONDITIONS SPECIFIED ABOVE. WHERE THE SLOPE IS EXCEEDED, THE CONTRACTOR SHALL BE REQUIRED TO PROVIDE ADDITIONAL BEDDING, A DIFFERENT TYPE OF BEDDING OR A HIGHER PIPE STRENGTH AT HIS OWN EXPENSE AND SHALL ALSO BE RESPONSIBLE FOR EXTRA TEMPORARY AND/OR PERMANENT REPAIRS MADE NECESSARY BY THE WIDENED TRENCH.
- ALL STORM MANHOLES SHALL BE 1200mm DIAMETER AS PER OPSD 701.010 UNLESS OTHERWISE NOTED.
- ALL CATCH BASINS SHALL BE 600mm X 600mm AS PER OPSD 705.010 UNLESS OTHERWISE NOTED.

**SANITARY SEWERS:**


- ALL SANITARY SEWERS 200mm IN DIAMETER (OR GREATER) SHALL BE PVC SDR 35, IN ACCORDANCE WITH CITY OF OTTAWA STANDARDS.
- ALL SANITARY SERVICES 135mm IN DIAMETER SHALL BE PVC SDR 38, IN ACCORDANCE WITH CITY OF OTTAWA STANDARDS.
- ALL SANITARY SEWERS/SERVICES WITH LESS THAN 2.5m HORIZONTAL SEPARATION TO WATERMANS SHALL BE CONSTRUCTED USING SERVICE PIPE IN ACCORDANCE WITH OPSS 144.1, WITH JOINTS CAPABLE OF 345 KPa MINIMUM, CONFORMING TO PSM PVC, CSA B182.2/CSA B182.7 OR CSA B137.3 OR AWWA 302.
- SANITARY SEWER TRENCH AND BEDDING SHALL BE AS PER CITY OF OTTAWA STD. S6 AND S7, CLASS 'B' BEDDING UNLESS OTHERWISE NOTED.
- ALL SANITARY SERVICES ARE TO BE EQUIPPED WITH APPROVED BACKWATER VALVES.
- SANITARY MANHOLE FRAME AND COVERS SHALL BE WATER TIGHT AS PER CITY OF OTTAWA STD. S24.
- SANITARY SEWER MANHOLES SHALL BE BENCHED AS PER OPSD 701.021.
- SANITARY PRE-CAST MANHOLE SHALL BE CONSTRUCTED WITH A HIGHER PERCENTAGE OF SILICA FUME IN THE CONCRETE TO MAKE IT MORE DENSE AND LESS SUSCEPTIBLE TO CORROSION OR PINHOLE LEAKS.
- FOR SANITARY MANHOLES, DEPENDING ON THE ELEVATION OF THE GROUNDWATER TABLE, AND BASED ON THE RECOMMENDATION OF THE PROJECT GEOTECHNICAL CONSULTANT, CREEK SEALS, OR A SIMILAR PRODUCT, SHALL BE INSTALLED IN THE PRE-CAST MANHOLE SECTION TO JUST BELOW THE MANHOLE FRAME TO PREVENT INFILTRATION.
- CONTRACTOR SHALL PERFORM EXFILTRATION TESTING, IN THE PRESENCE OF THE CONSULTANT, FOR ALL SANITARY SEWERS IN ACCORDANCE WITH OPSS 410.

**WATER SUPPLY:**

- ALL PVC WATERMANS SHALL BE EQUAL TO AWWA C-900 CLASS 150, SDR 18, OR APPROVED EQUAL.
- WATERMAIN TRENCH AND BEDDING SHALL BE IN ACCORDANCE WITH CITY OF OTTAWA STANDARD W17, UNLESS OTHERWISE SPECIFIED. BEDDING AND COVER MATERIAL SHALL BE SPECIFIED BY PROJECT GEOTECHNICAL ENGINEER.
- ALL PVC WATERMANS SHALL BE INSTALLED WITH A 10 GAUGE STRANDED COPPER TWO OR RWJ TRACER WIRE IN ACCORDANCE WITH CITY OF OTTAWA STD. W36.
- CATHODIC PROTECTION IS REQUIRED ON ALL METALLIC FITTINGS AS PER CITY OF OTTAWA STD. W40 AND W42.
- CONTRACTOR TO SUPPLY HYDRANT EXTENSION TO ADJUST THE LENGTH OF HYDRANT BARREL IF REQUIRED.
- FIRE HYDRANTS SHALL BE INSTALLED AS PER CITY OF OTTAWA STD. W19, AND LOCATED AS PER CITY STD. W18.
- VALVE IN BOXES SHALL BE INSTALLED AS PER CITY OF OTTAWA STD. W24.
- WATERMAIN IN FILL AREAS TO BE INSTALLED WITH RESTRAINED JOINTS AS PER CITY OF OTTAWA STD. W25.5 AND W25.6.
- THRUST BLOCKING OF WATERMAIN TO BE INSTALLED AS PER CITY OF OTTAWA STD. W25.3 AND W25.4. THE CONTRACTOR SHALL PROVIDE ALL TEMPORARY CAPS, PLUGS AND BLOW-OFFS AND NOZZLES REQUIRED FOR TESTING AND DISINFECTION OF THE WATERMAIN.
- INSULATION FOR WATERMAIN CROSSING OVER AND BELOW SEWER SHALL BE IN ACCORDANCE WITH CITY OF OTTAWA STD. W25.2 AND W25, RESPECTIVELY, WHERE WATERMAIN COVER IS LESS THAN 2.4m.
- THE MINIMUM VERTICAL SEPARATION BETWEEN WATERMANS AND SEWERS SHALL BE 0.25m FOR WATERMANS CROSSING OVER THE SEWER AS PER CITY STD. W25.2.
- FOR CROSSING UNDER SEWER, ADEQUATE STRUCTURAL SUPPORT FOR THE SEWERS IS REQUIRED TO PREVENT EXCESSIVE DEFLECTION OF JOINTS AND SETTLING. THE LENGTH OF WATERMAIN PIPE SHALL BE CENTERED AT THE POINT OF CROSSING SO THAT THE JOINTS WILL BE EQUIDISTANT AND AS FAR AS POSSIBLE FROM THE SEWER AS PER CITY STD. W25. MINIMUM VERTICAL SEPARATION IS 0.50m.
- CONNECTION TO EXISTING WATERMAIN TO BE PERFORMED BY CITY FORCES. CONTRACTOR TO PROVIDE EXCAVATION, MATERIAL, BACKFILL AND ASSISTANCE AS REQUIRED.
- SWABBING, DISINFECTION, AND HYDROSTATIC TESTING TO BE CONDUCTED AS PER CITY OF OTTAWA STANDARDS IN THE PRESENCE OF A CITY INSPECTOR AND/OR CONSULTANT.


**ROADWORK SPECIFICATIONS:**

- CONCRETE BARRIER CURB SHALL BE IN ACCORDANCE WITH CITY OF OTTAWA STD. SC1.1.
- CONCRETE MOUNTABLE CURB SHALL BE IN ACCORDANCE WITH CITY OF OTTAWA STD. SC1.3.
- ALL BARRIER CURBS TO BE 150mm ABOVE FINISHED ASPHALT GRADE UNLESS OTHERWISE NOTED.
- CONCRETE SIDEWALK SHALL BE IN ACCORDANCE WITH CITY OF OTTAWA STD. SC3.
- TWSIS SHALL BE INSTALLED IN ACCORDANCE WITH CITY OF OTTAWA STD. SC7.3.
- ANY PAVEMENT REINSTATEMENT FOR SERVICE AND UTILITY CUTS SHALL BE IN ACCORDANCE WITH CITY OF OTTAWA STD. R10.
- GRANULAR "A" SHALL BE PLACED TO A MINIMUM THICKNESS OF 300mm AROUND ALL STRUCTURES WITHIN PAVEMENT AREA.
- ALL GRANULAR FOR ROADS SHALL BE COMPACTED TO A MINIMUM OF 98% STANDARD PROCTOR DENSITY.
- SUB-EXCAVATE SOFT AREAS AND FILL WITH GRANULAR "B" COMPACTED IN MAXIMUM 300mm LIFTS.
- ALL EDGES OF DISTURBED PAVEMENT SHALL BE SAW-CUT TO FORM A NEAT AND STRAIGHT LINE PRIOR TO PLACING NEW ASPHALT.

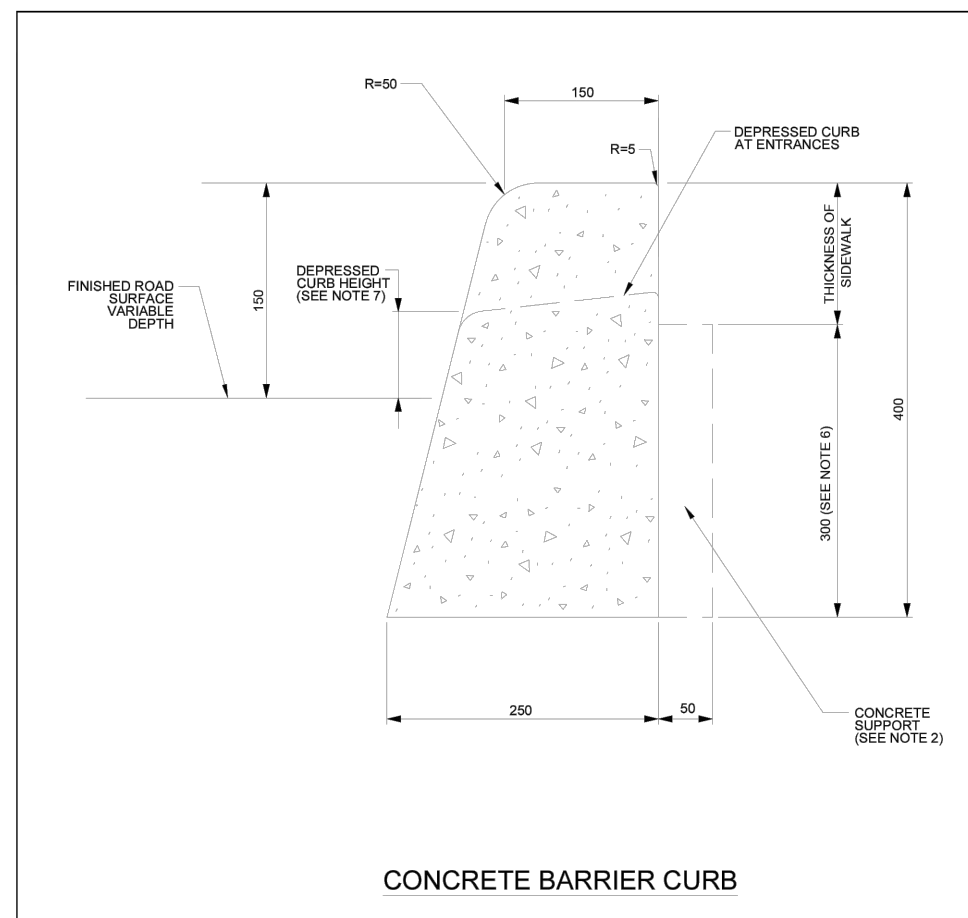


**CONCRETE BARRIER CURB FOR GRANULAR BASE PAVEMENT (MODIFIED OPSD-600.110)**

DATE: MAR 2003  
REV: MAR 2025  
DWG No.: SC1.1

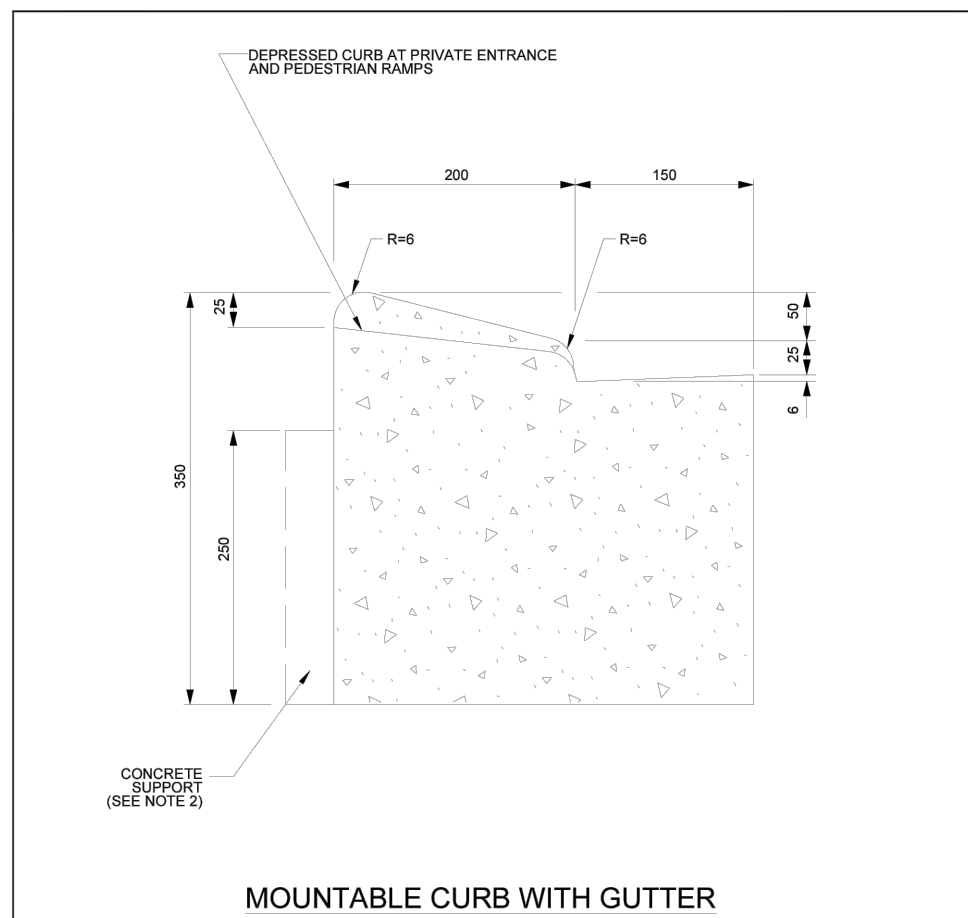


**CONCRETE MOUNTABLE CURB WITH GUTTER FOR GRANULAR BASE PAVEMENT**

DATE: MAR 2003  
REV: FEB 2025  
DWG No.: SC1.3

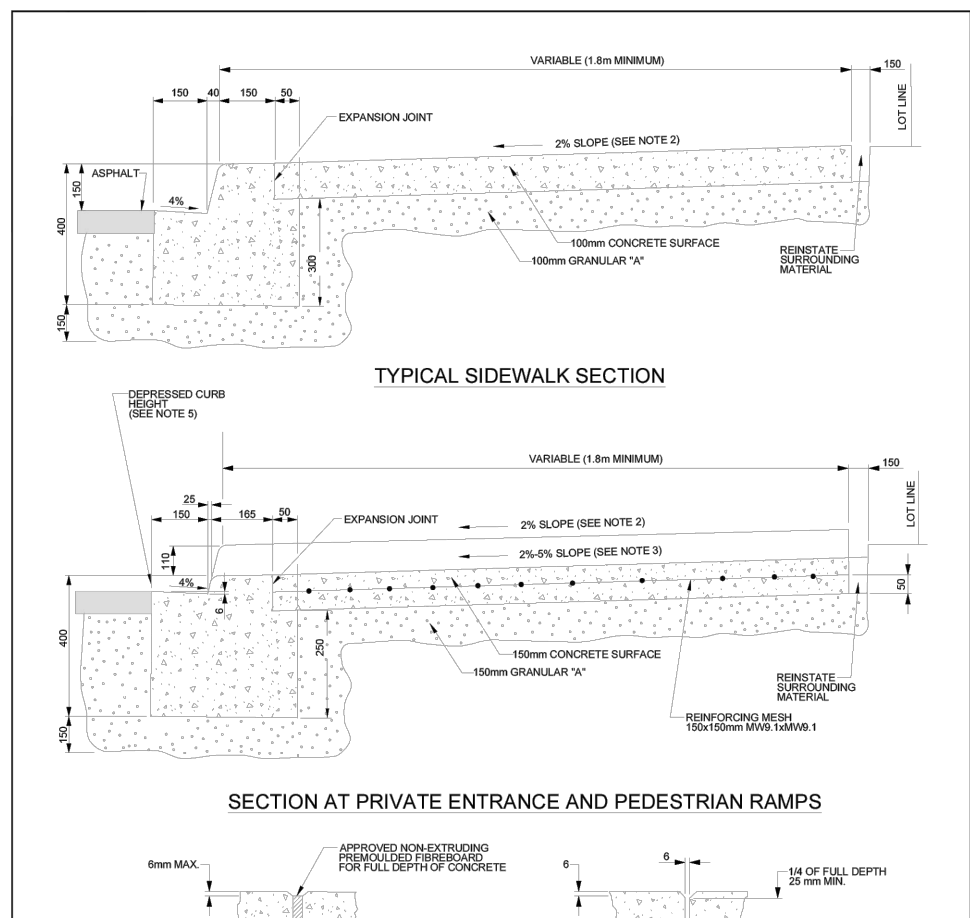


**CONCRETE CURB AND GUTTER WITH SIDEWALK**

DATE: MAR 2003  
REV: MAR 2025  
DWG No.: SC3

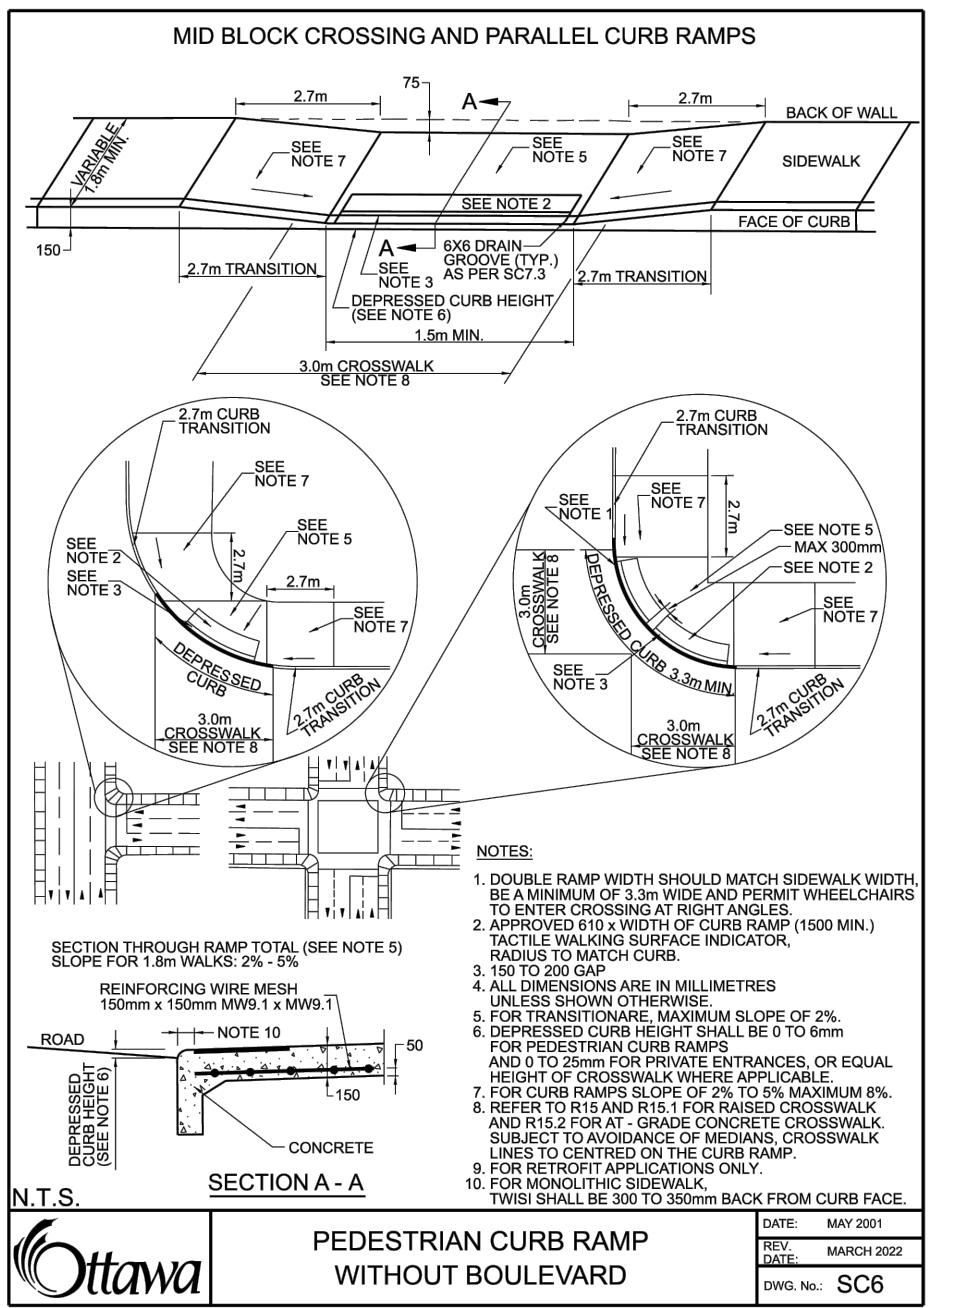


**PEDESTRIAN CURB RAMP WITHOUT BOULEVARD**

DATE: MAR 2003  
REV: MAR 2025  
DWG No.: SC6

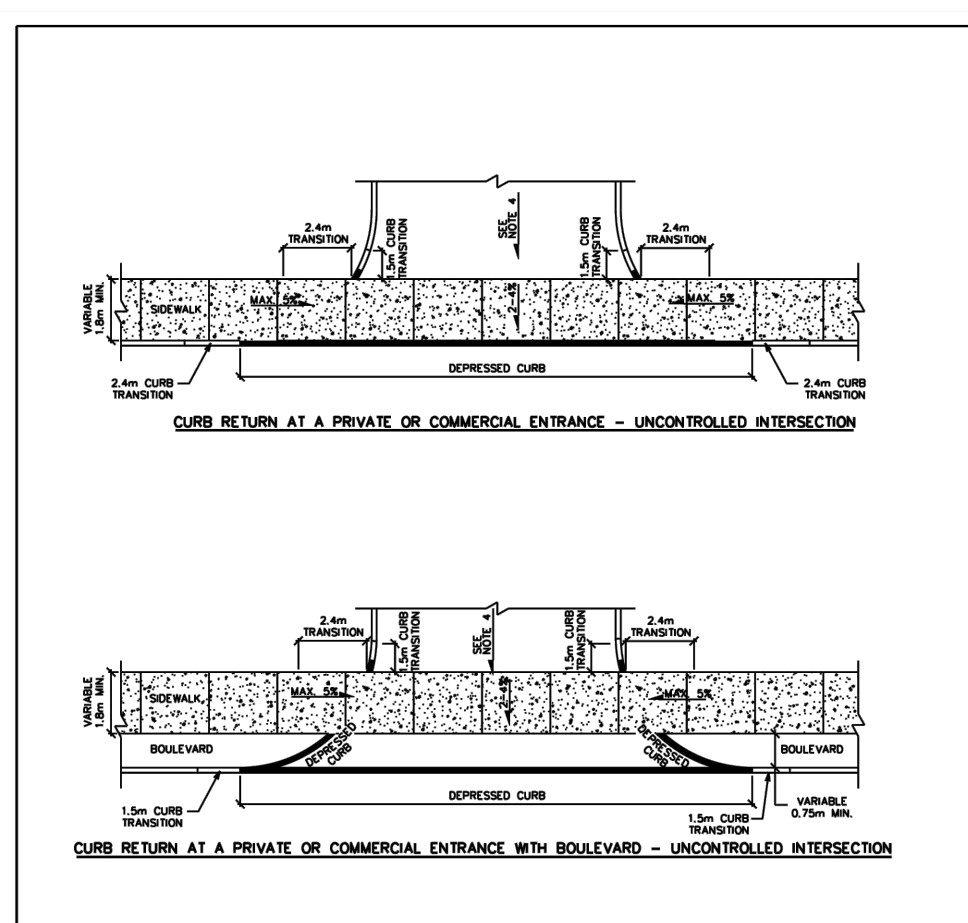


**CURB RETURN ENTRANCES - UNCONTROLLED INTERSECTIONS**

DATE: MARCH 2007  
REV: MARCH 2021  
DWG No.: SC7.1

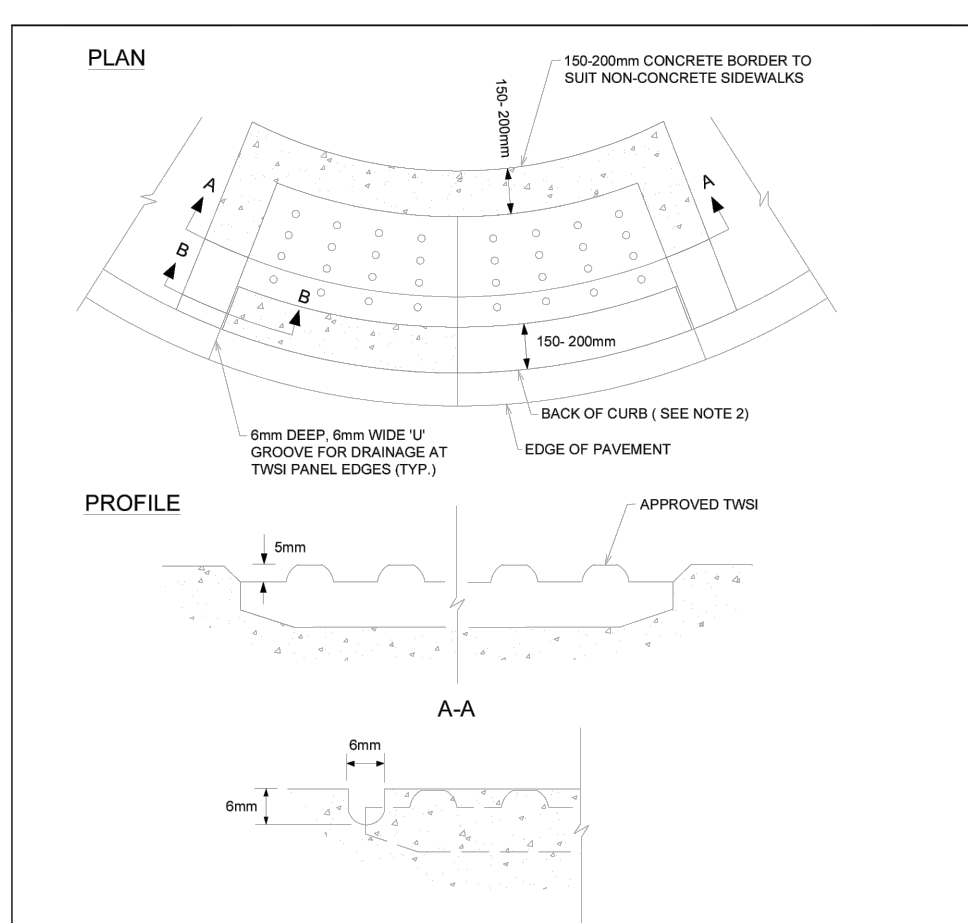


**TWSI DETAIL**

DATE: MAR 2013  
REV: FEB 2025  
DWG No.: SC7.3

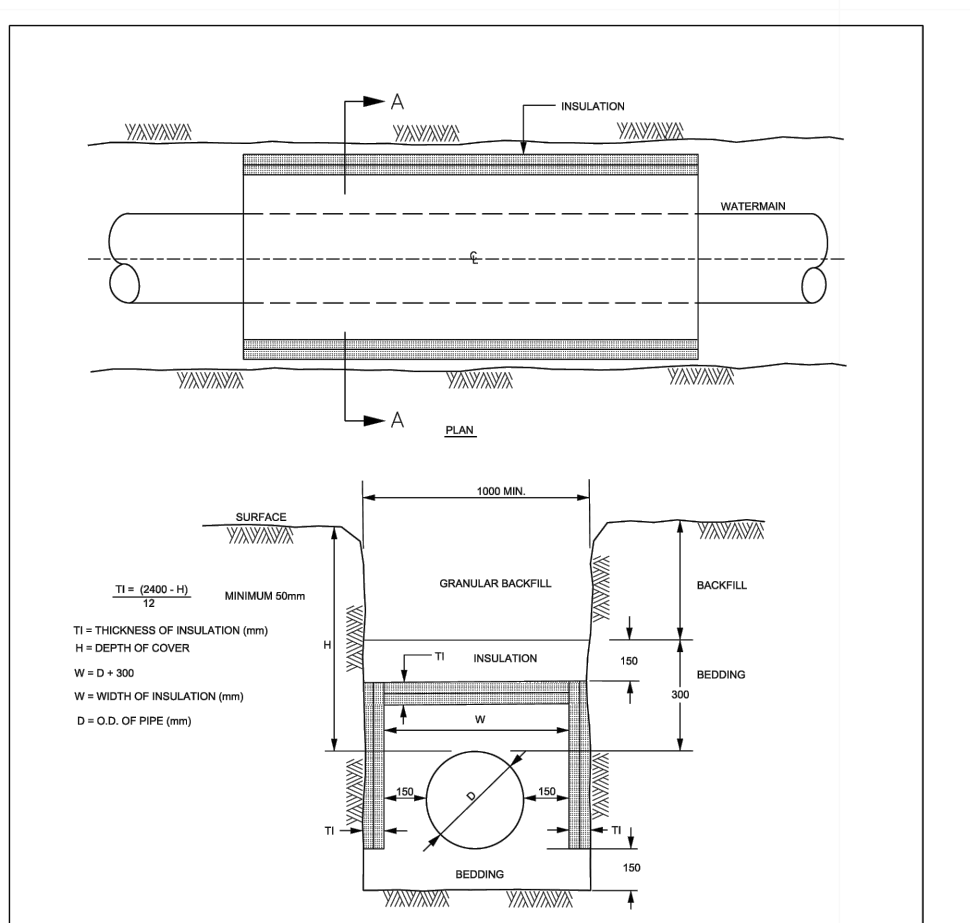


**THERMAL INSULATION FOR WATERMANS IN SHALLOW TRENCHES**

DATE: MAY 2001  
REV: MARCH 2013  
DWG No.: W22

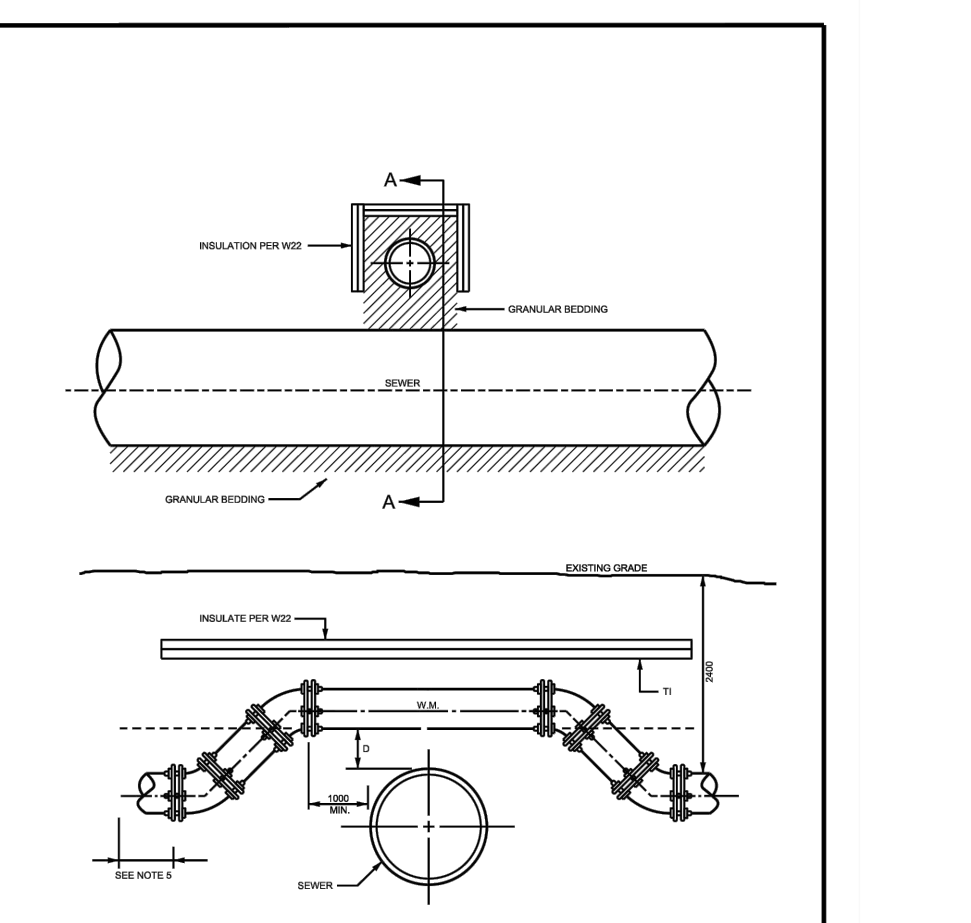


**WATERMAIN CROSSING OVER SEWER**

DATE: MAY 2001  
REV: MARCH 2013  
DWG No.: W22.2

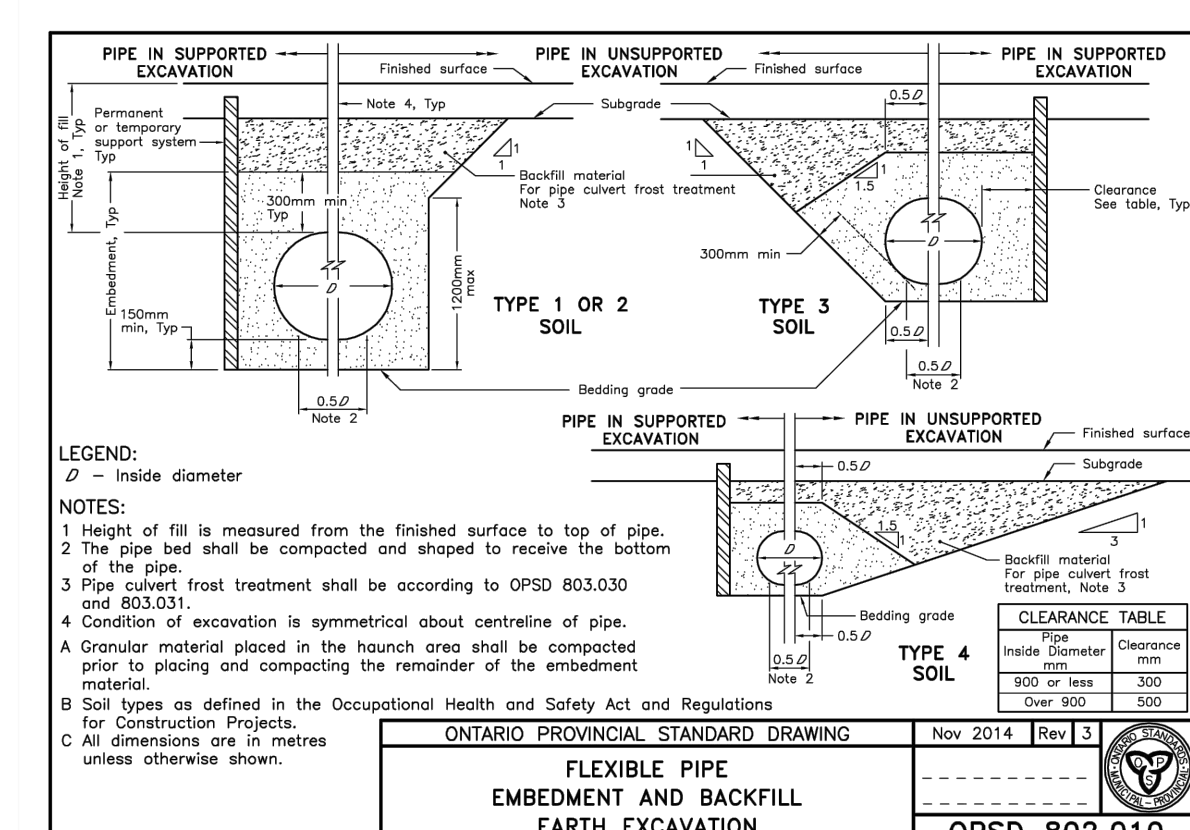

**FLEXIBLE PIPE EMBEDMENT AND BACKFILL EARTH EXCAVATION**

OPSD 802.010

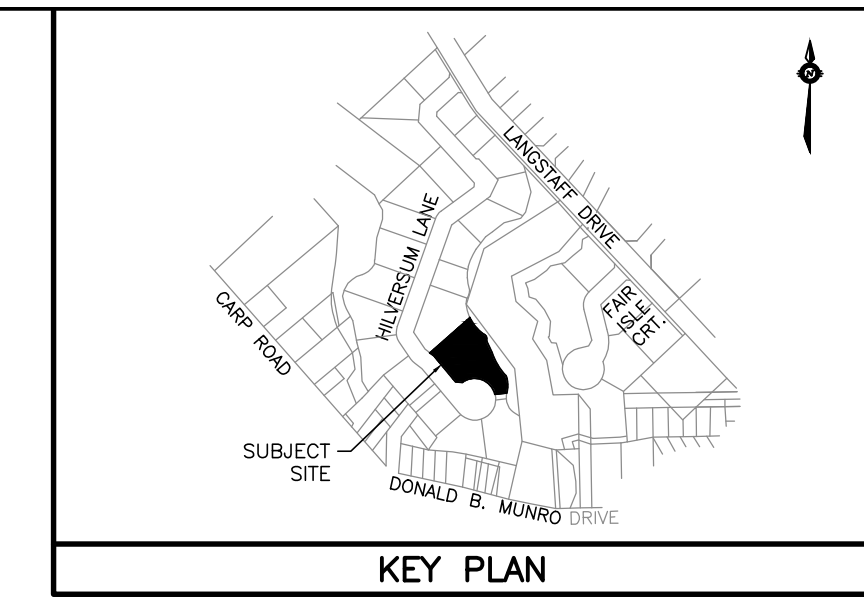

**NOTES**


THE POSITION OF ALL POLE LINES, CONDUITS, WATERMANS, SEWERS AND OTHER UNDERGROUND AND OVERGROUND UTILITIES AND STRUCTURES IS NOT NECESSARILY SHOWN ON THE CONTRACT DRAWINGS, AND WHERE SHOWN, THE ACCURACY OF THE POSITION OF SUCH UTILITIES AND STRUCTURES IS NOT GUARANTEED. BEFORE STARTING WORK, DETERMINE THE EXACT LOCATION OF ALL SUCH UTILITIES AND STRUCTURES AND ASSUME ALL LIABILITY FOR DAMAGE TO THEM.

GEODETIC SURVEY DERIVED FROM COSINE STATION 0011968U054. LOCATION DESCRIPTION: OLD HIGHWAY 17 BRIDGE OVER CARP RIVER ON CARP-STITTSVILLE ROAD, 0.2 KM SOUTH OF C.N.R. CROSSING IN VILLAGE OF CARP. TABLE IN TOP OF WEST WALL, 30 CM FROM NORTH END, 24 CM FROM WEST EDGE. VERTICAL CONTROL DATA, DATUM: CGVD28/78, FIRST ORDER, ELEVATION: 93.861. COORDINATE SYSTEM: MTM ZONE 9; NAD 83 DATUM (CAN83-9)

NO.	REVISION DESCRIPTION	DATE	BY
1	ISSUED FOR REVIEW	21/11/25	BLM

SCALE	

SCALE	

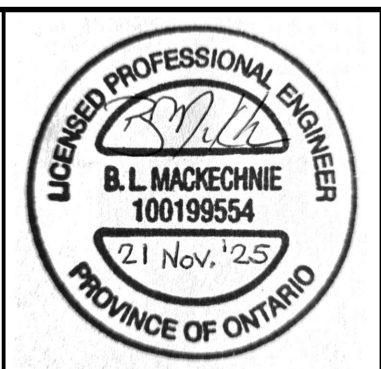

**Robinson Land Development**

350 Palladium Drive  
Ottawa, ON K2V 1A8  
(613) 592-6060 rcii.com

DESIGN	BLM
CHECKED	SG
DRAWN	BLM
CHECKED	SG
APPROVED	BLM


**INVERNESS HOMES**  
38 AURIGA DRIVE, SUITE 200  
OTTAWA, ON K2E 8A6

**391 HILVERSUM LANE**  
CARP, ON

**NOT FOR CONSTRUCTION**





PROJECT No. 25094  
SURVEY ----  
DATED NOV. 2025  
DWG No. 25094-N1

**NOTES & DETAILS**


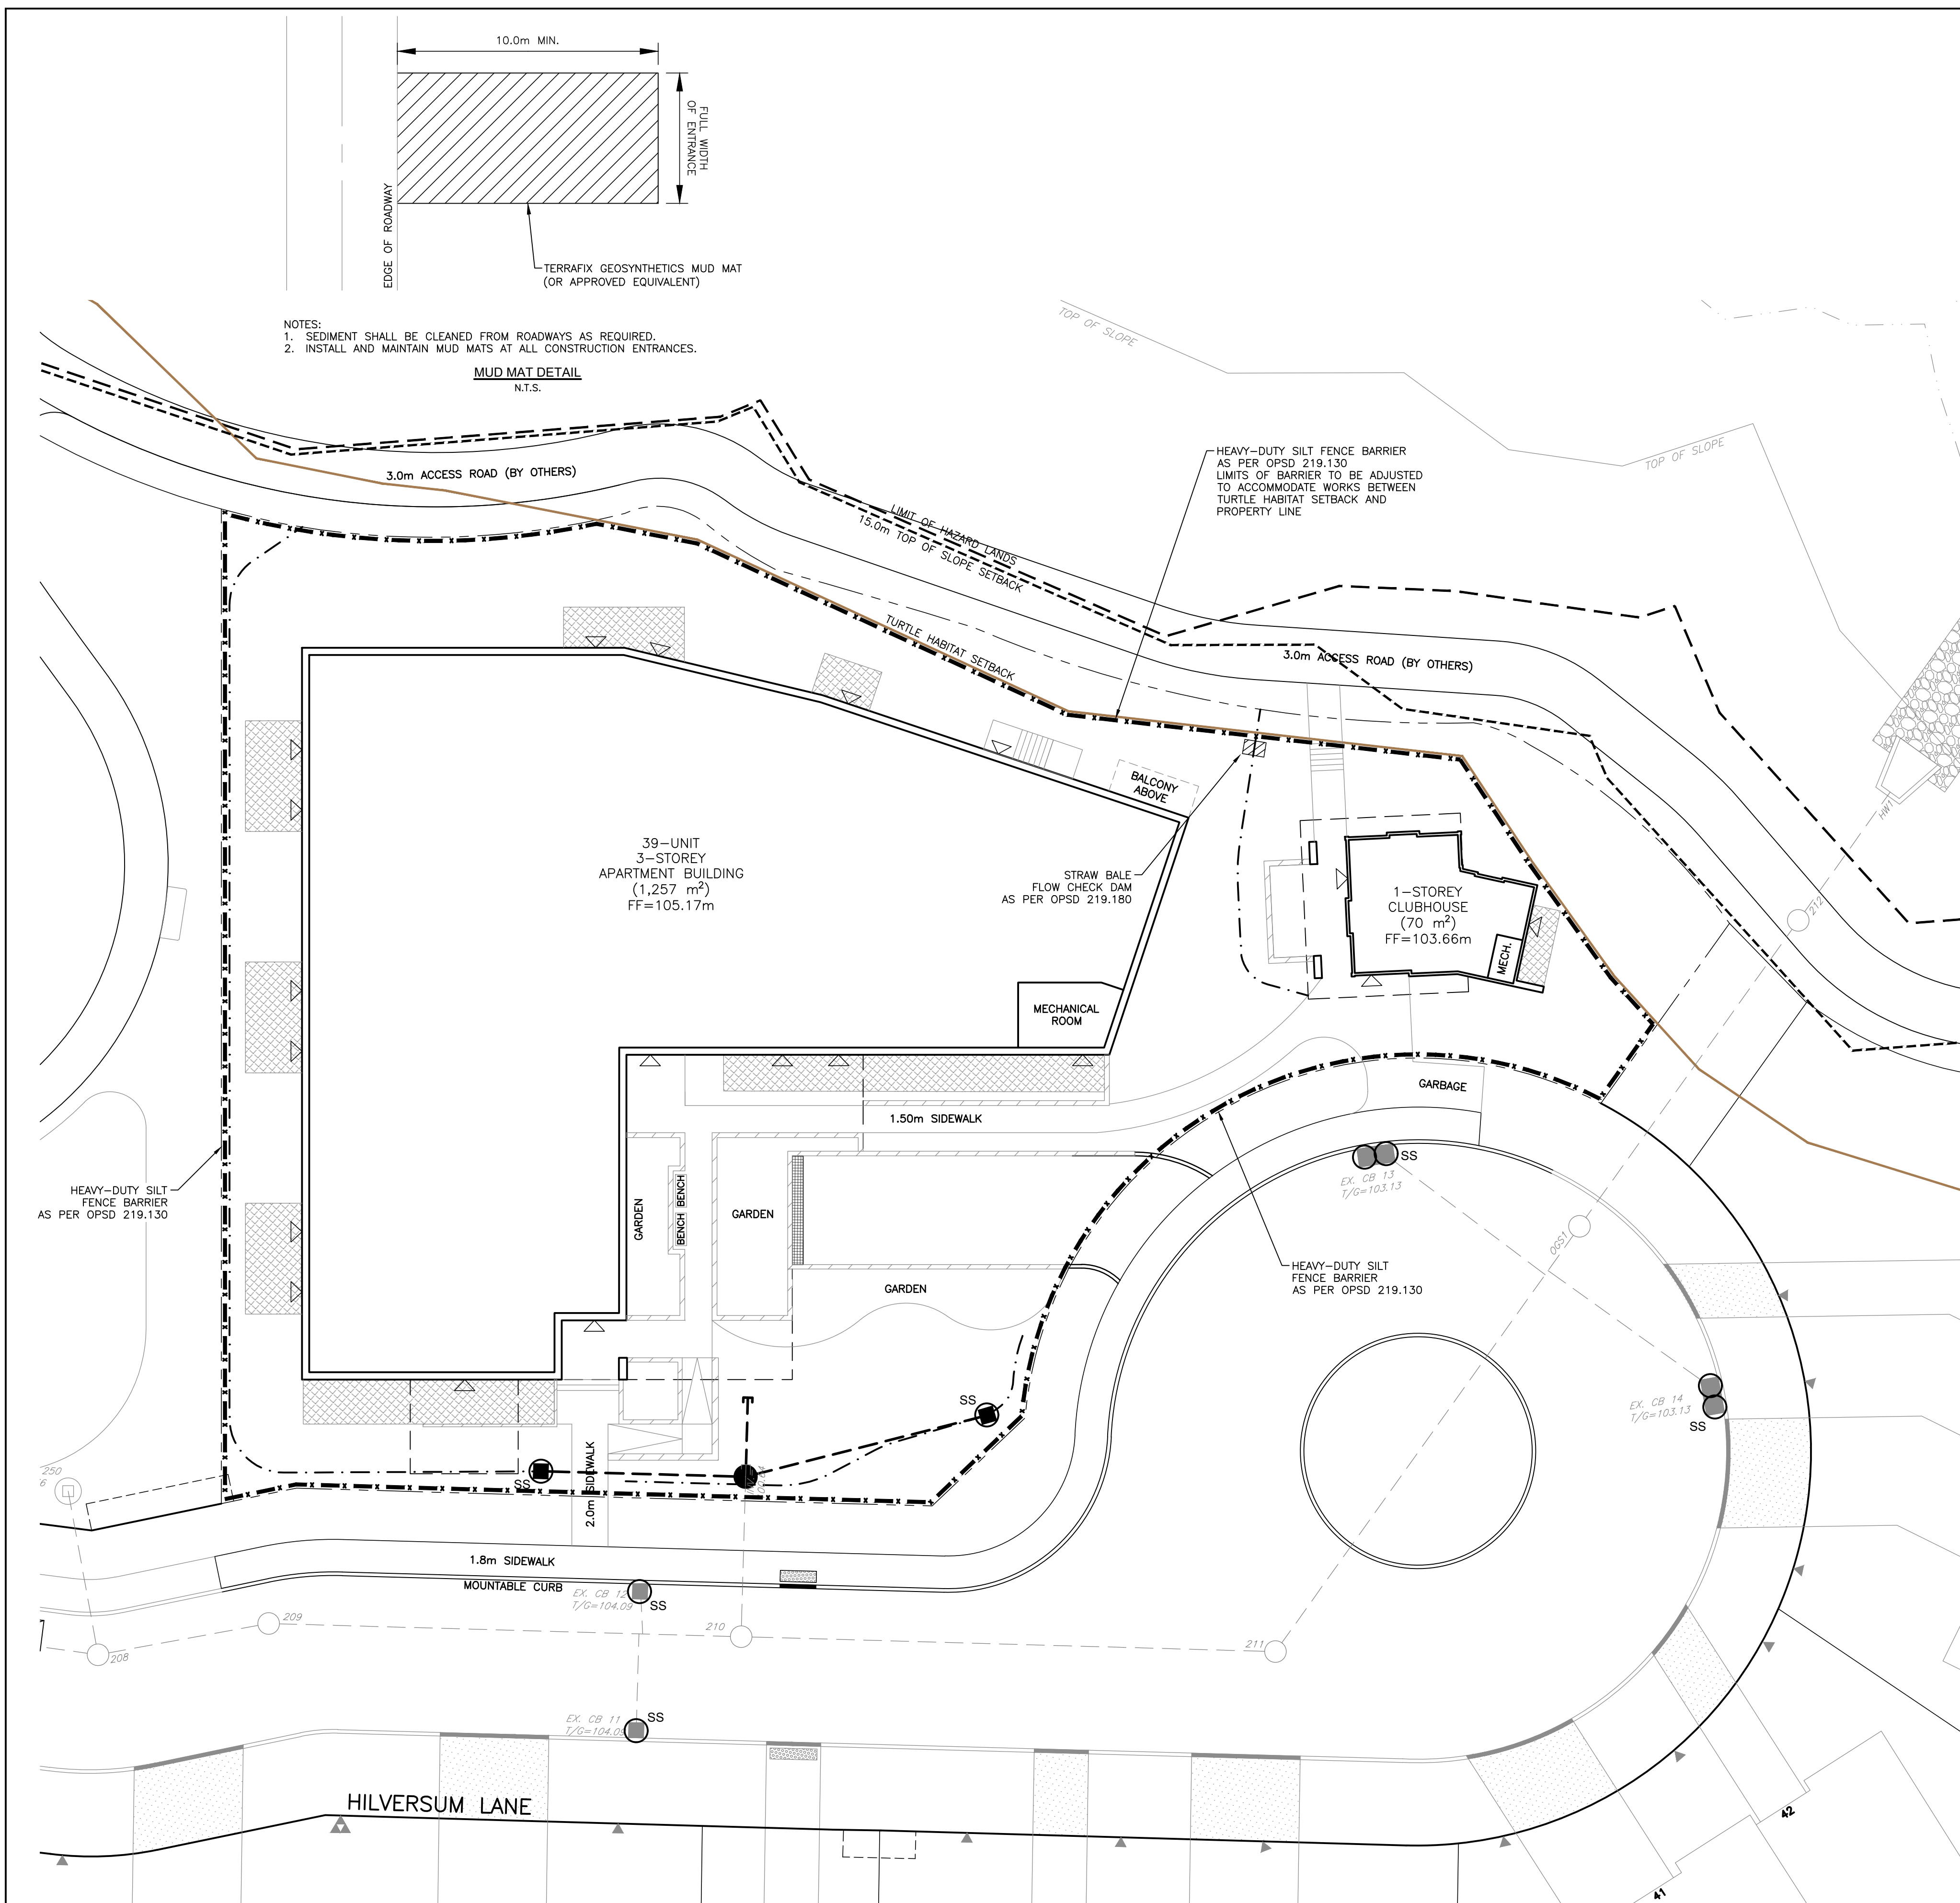


NOTES:  
 1. SEDIMENT SHALL BE CLEANED FROM ROADWAYS AS REQUIRED.  
 2. INSTALL AND MAINTAIN MUD MATS AT ALL CONSTRUCTION ENTRANCES.

MUD MAT DETAIL  
 N.T.S.

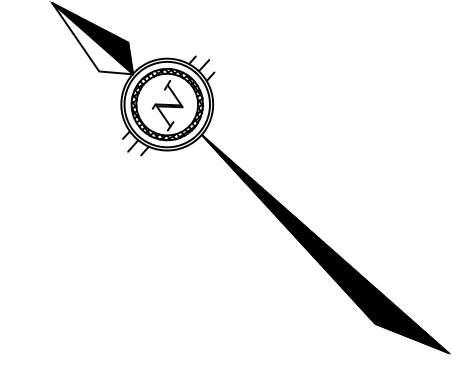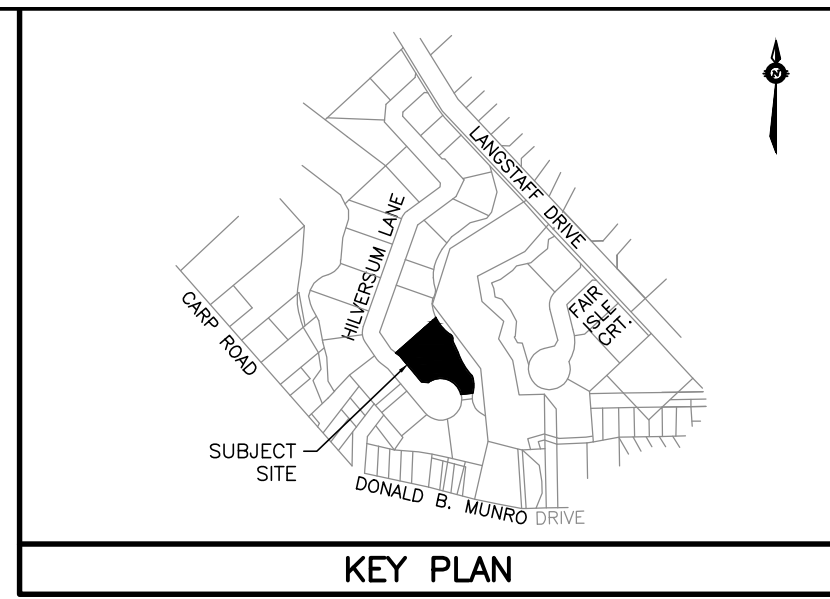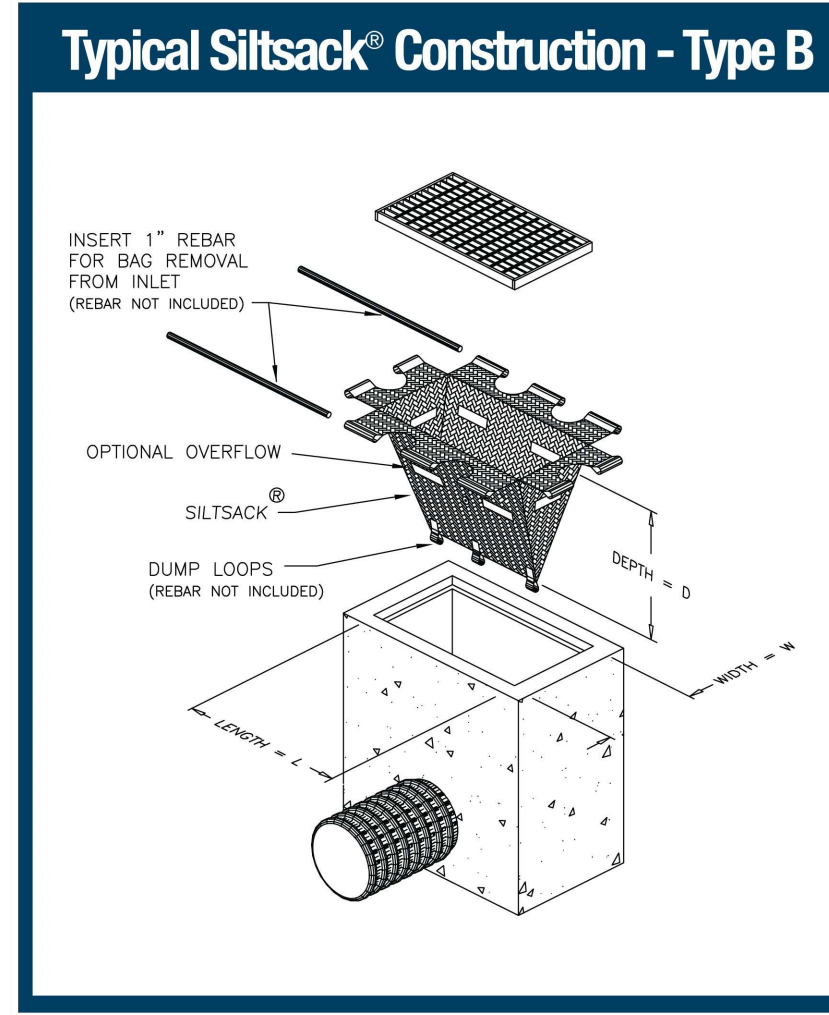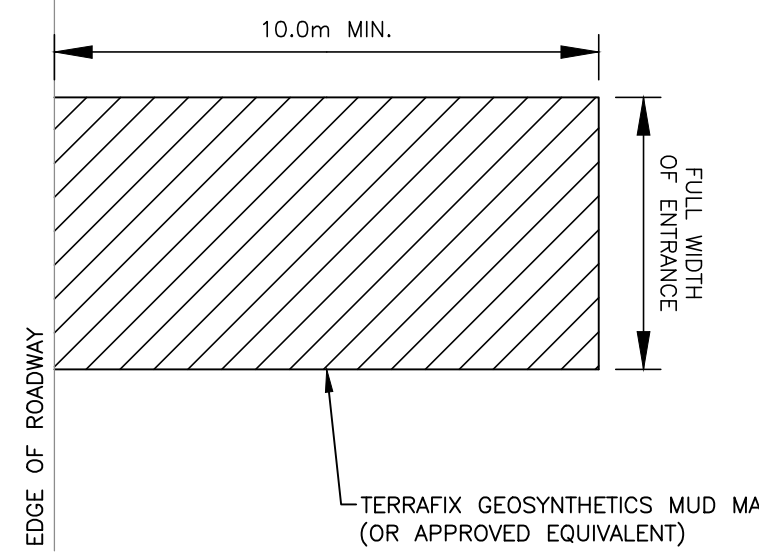

- LEGEND**
- PROPERTY BOUNDARY
  - - - - - LIMIT OF HAZARD LANDS
  - - - - - 15.0m TOP OF SLOPE SETBACK
  - TURTLE HABITAT SETBACK (AS PER EIS)
  - EXISTING CATCH BASIN
  - EXISTING STORM SEWER & MANHOLE
  - CATCH BASIN
  - STORM SEWER & MANHOLE
  - - - - - SWALE
  - - - - - HEAVY-DUTY SILT FENCE BARRIER
  - SS SILT SACK (OR APPROVED EQUIVALENT)
  - ▨ STRAW BALE FLOW CHECK DAM

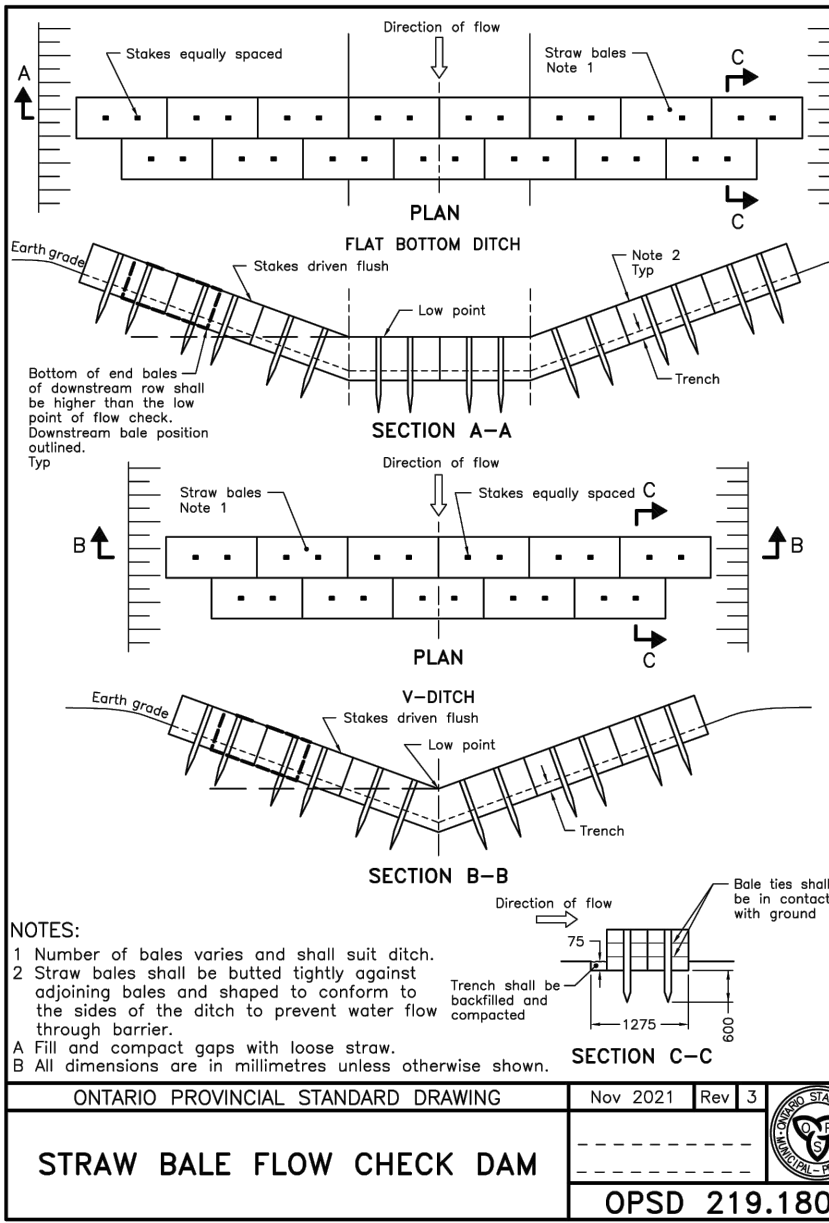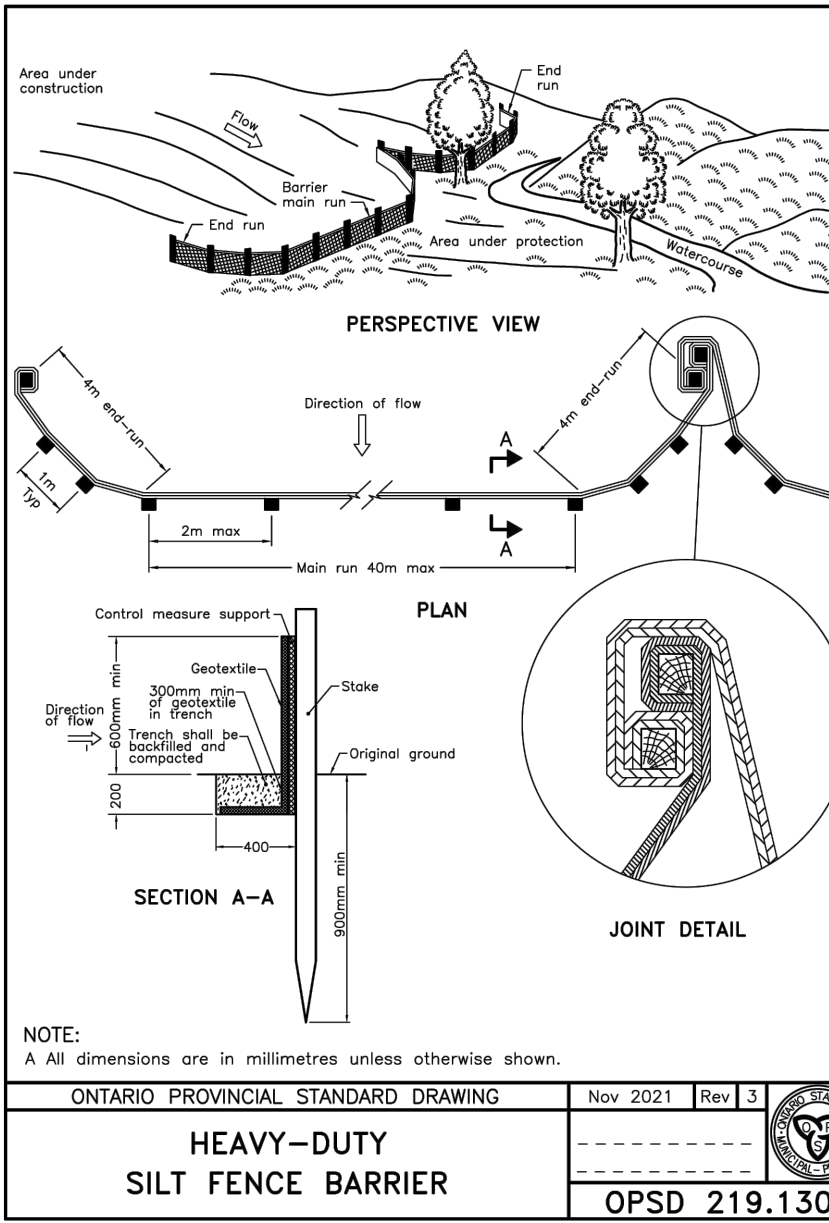

- NOTES:**
1. THE CONTRACTOR SHALL IMPLEMENT EROSION AND SEDIMENT CONTROL MEASURES TO PROVIDE FOR PROTECTION OF THE AREA DRAINAGE SYSTEM AND THE ULTIMATE RECEIVING WATERCOURSE DURING CONSTRUCTION ACTIVITIES. THE CONTRACTOR ACKNOWLEDGES THAT FAILURE TO IMPLEMENT APPROPRIATE EROSION AND SEDIMENT CONTROL MEASURES MAY BE SUBJECT TO PENALTIES IMPOSED BY ANY APPLICABLE REGULATORY AGENCY.
  2. LIMIT THE EXTENT OF EXPOSED SOILS AT ANY GIVEN TIME.
  3. EROSION AND SEDIMENT CONTROL MEASURES SHALL BE MAINTAINED UNTIL VEGETATION HAS BEEN RE-ESTABLISHED IN ALL DISTURBED AREAS. RE-VEGETATE DISTURBED AREAS AS SOON AS POSSIBLE.
  4. CONTRACTOR SHALL MINIMIZE THE AMOUNT OF STOCKPILED MATERIAL. ALL STOCKPILED SOIL SHALL BE AWAY (15 METRES OR GREATER) FROM WATERCOURSES, DRAINAGE FEATURES AND TOP OF STEEP SLOPES. THE DOWNSTREAM SIDE OF ALL STOCKPILES SHALL BE PROTECTED WITH SILT FENCE, FIBRE ROLLS OR EQUIVALENT MEASURES PRIOR TO A RAINFALL EVENT.
  5. SILT SACKS ARE TO BE PLACED UNDERNEATH THE FRAME AND COVER OF ALL PROPOSED AND EXISTING CATCH BASIN AND OPEN COVER STORM MANHOLES UNTIL CONSTRUCTION IS COMPLETED.
  6. HEAVY-DUTY SILT FENCE BARRIERS SHALL BE INSTALLED AS PER OPSD 219.130 WHERE INDICATED AND MAINTAINED AS REQUIRED.
  7. DURING ACTIVE CONSTRUCTION PERIODS, VISUAL INSPECTIONS SHALL BE UNDERTAKEN ON A WEEKLY BASIS AND AFTER MAJOR STORM EVENTS (>25mm RAIN IN 24 HOUR PERIOD) ON SEDIMENT CONTROL BARRIERS AND ANY DAMAGE REPAIRED IMMEDIATELY.
  8. EROSION AND SEDIMENT CONTROL BARRIERS SHALL ALSO BE ASSESSED (AND REPAIRED AS REQUIRED) FOLLOWING SIGNIFICANT SNOWMELT EVENTS.
  9. VISUAL INSPECTIONS SHALL ALSO BE UNDERTAKEN IN ANTICIPATION OF LARGE STORM EVENTS (OR A SERIES OF RAINFALL AND/OR SNOWMELT DAYS) THAT COULD POTENTIALLY YIELD SIGNIFICANT RUNOFF VOLUMES.
  10. CARE SHALL BE TAKEN TO PREVENT DAMAGE TO EROSION AND SEDIMENT CONTROLS DURING CONSTRUCTION OPERATIONS.
  11. IN SOME CASES, BARRIERS MAY BE REMOVED TEMPORARILY TO ACCOMMODATE THE CONSTRUCTION OPERATIONS. THE AFFECTED BARRIERS SHALL BE REINSTATED IMMEDIATELY AFTER CONSTRUCTION OPERATIONS ARE COMPLETED.
  12. SEDIMENT CONTROL DEVICES SHALL BE CLEANED OF ACCUMULATED SEDIMENTATION AS REQUIRED AND REPLACED AS NECESSARY.
  13. DURING THE COURSE OF CONSTRUCTION, IF THE ENGINEER BELIEVES THAT ADDITIONAL PREVENTION METHODS ARE REQUIRED TO CONTROL EROSION AND SEDIMENTATION, THE CONTRACTOR SHALL IMPLEMENT ADDITIONAL MEASURES, AS REQUIRED, TO THE SATISFACTION OF THE ENGINEER.
  14. CONSTRUCTION AND MAINTENANCE REQUIREMENTS FOR EROSION AND SEDIMENT CONTROLS ARE TO COMPLY WITH OPSS 805.
  15. MUD MATS SHALL BE INSTALLED AT ALL CONSTRUCTION ENTRANCES.
  16. INSPECTION AND MAINTENANCE OF TEMPORARY ESC MEASURES SHALL CONTINUE UNTIL THEY ARE NO LONGER REQUIRED.
  17. THE CONTRACTOR SHALL ENSURE THAT RECORDS OF INSPECTION ARE TAKEN, INCLUDING INSPECTOR'S NAME, DATE OF INSPECTION, VISUAL OBSERVATIONS, AND ANY NECESSARY REMEDIAL MEASURES TAKEN TO MAINTAIN INTERIM ESC MEASURES.


**NOT FOR CONSTRUCTION**

NOTES

THE POSITION OF ALL POLE LINES, CONDUITS, WATERMANS, SEWERS AND OTHER UNDERGROUND AND OVERGROUND UTILITIES AND STRUCTURES IS NOT NECESSARILY SHOWN ON THE CONTRACT DRAWINGS, AND WHERE SHOWN, THE ACCURACY OF THE POSITION OF SUCH UTILITIES AND STRUCTURES IS NOT GUARANTEED. BEFORE STARTING WORK, DETERMINE THE EXACT LOCATION OF ALL SUCH UTILITIES AND STRUCTURES AND ASSUME ALL LIABILITY FOR DAMAGE TO THEM.

GEODETIC SURVEY DERIVED FROM COSINE STATION 0011968U054. LOCATION DESCRIPTION: OLD HIGHWAY 17 BRIDGE OVER CARP RIVER ON CARP-STITTSVILLE ROAD, 0.2 KM SOUTH OF C.N.R. CROSSING IN VILLAGE OF CARP. TABLE IN TOP OF WEST WALL, 30 CM FROM NORTH END, 24 CM FROM WEST EDGE. VERTICAL CONTROL DATA, DATUM: CGVD2878, FIRST ORDER, ELEVATION: 93.861. COORDINATE SYSTEM: MTM ZONE 9; NAD 83 DATUM (CAN83-9)

NO.	REVISION DESCRIPTION	DATE	BY
1	ISSUED FOR REVIEW	21/11/25	BLM

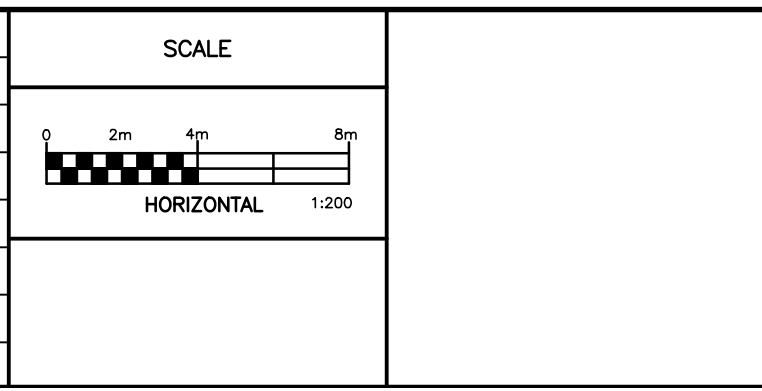

**Robinson**  
 Land Development

350 Palladium Drive  
 Ottawa, ON K2V 1A8  
 (613) 592-6060 rcii.com

DESIGN	BLM
CHECKED	SG
DRAWN	BLM
CHECKED	SG
APPROVED	BLM



**INVERNESS HOMES**  
 38 AURIGA DRIVE, SUITE 200  
 OTTAWA, ON K2E 8A6

**391 HILVERSUM LANE**  
 CARP, ON

PROJECT No.	25094
SURVEY	----
DATED	NOV. 2025
DWG. No.	25094-ESC1

**EROSION AND SEDIMENT CONTROL PLAN**




**NOT FOR CONSTRUCTION**

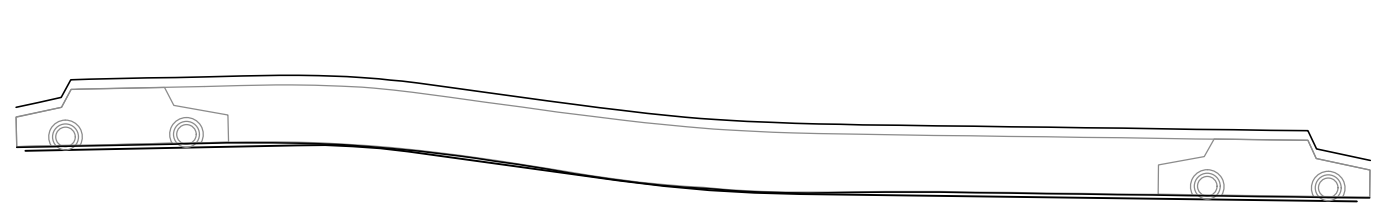

SCALE:  
HORZ: 1:200  
VERT: 1:200

Ground Clearance (units: m)  
Part # Front Wheelbase Rear  
#1 0.12 0.12 0.12


Width : 2.00  
Track : 2.00  
Lock to Lock Time : 6.0  
Steering Angle : 35.9

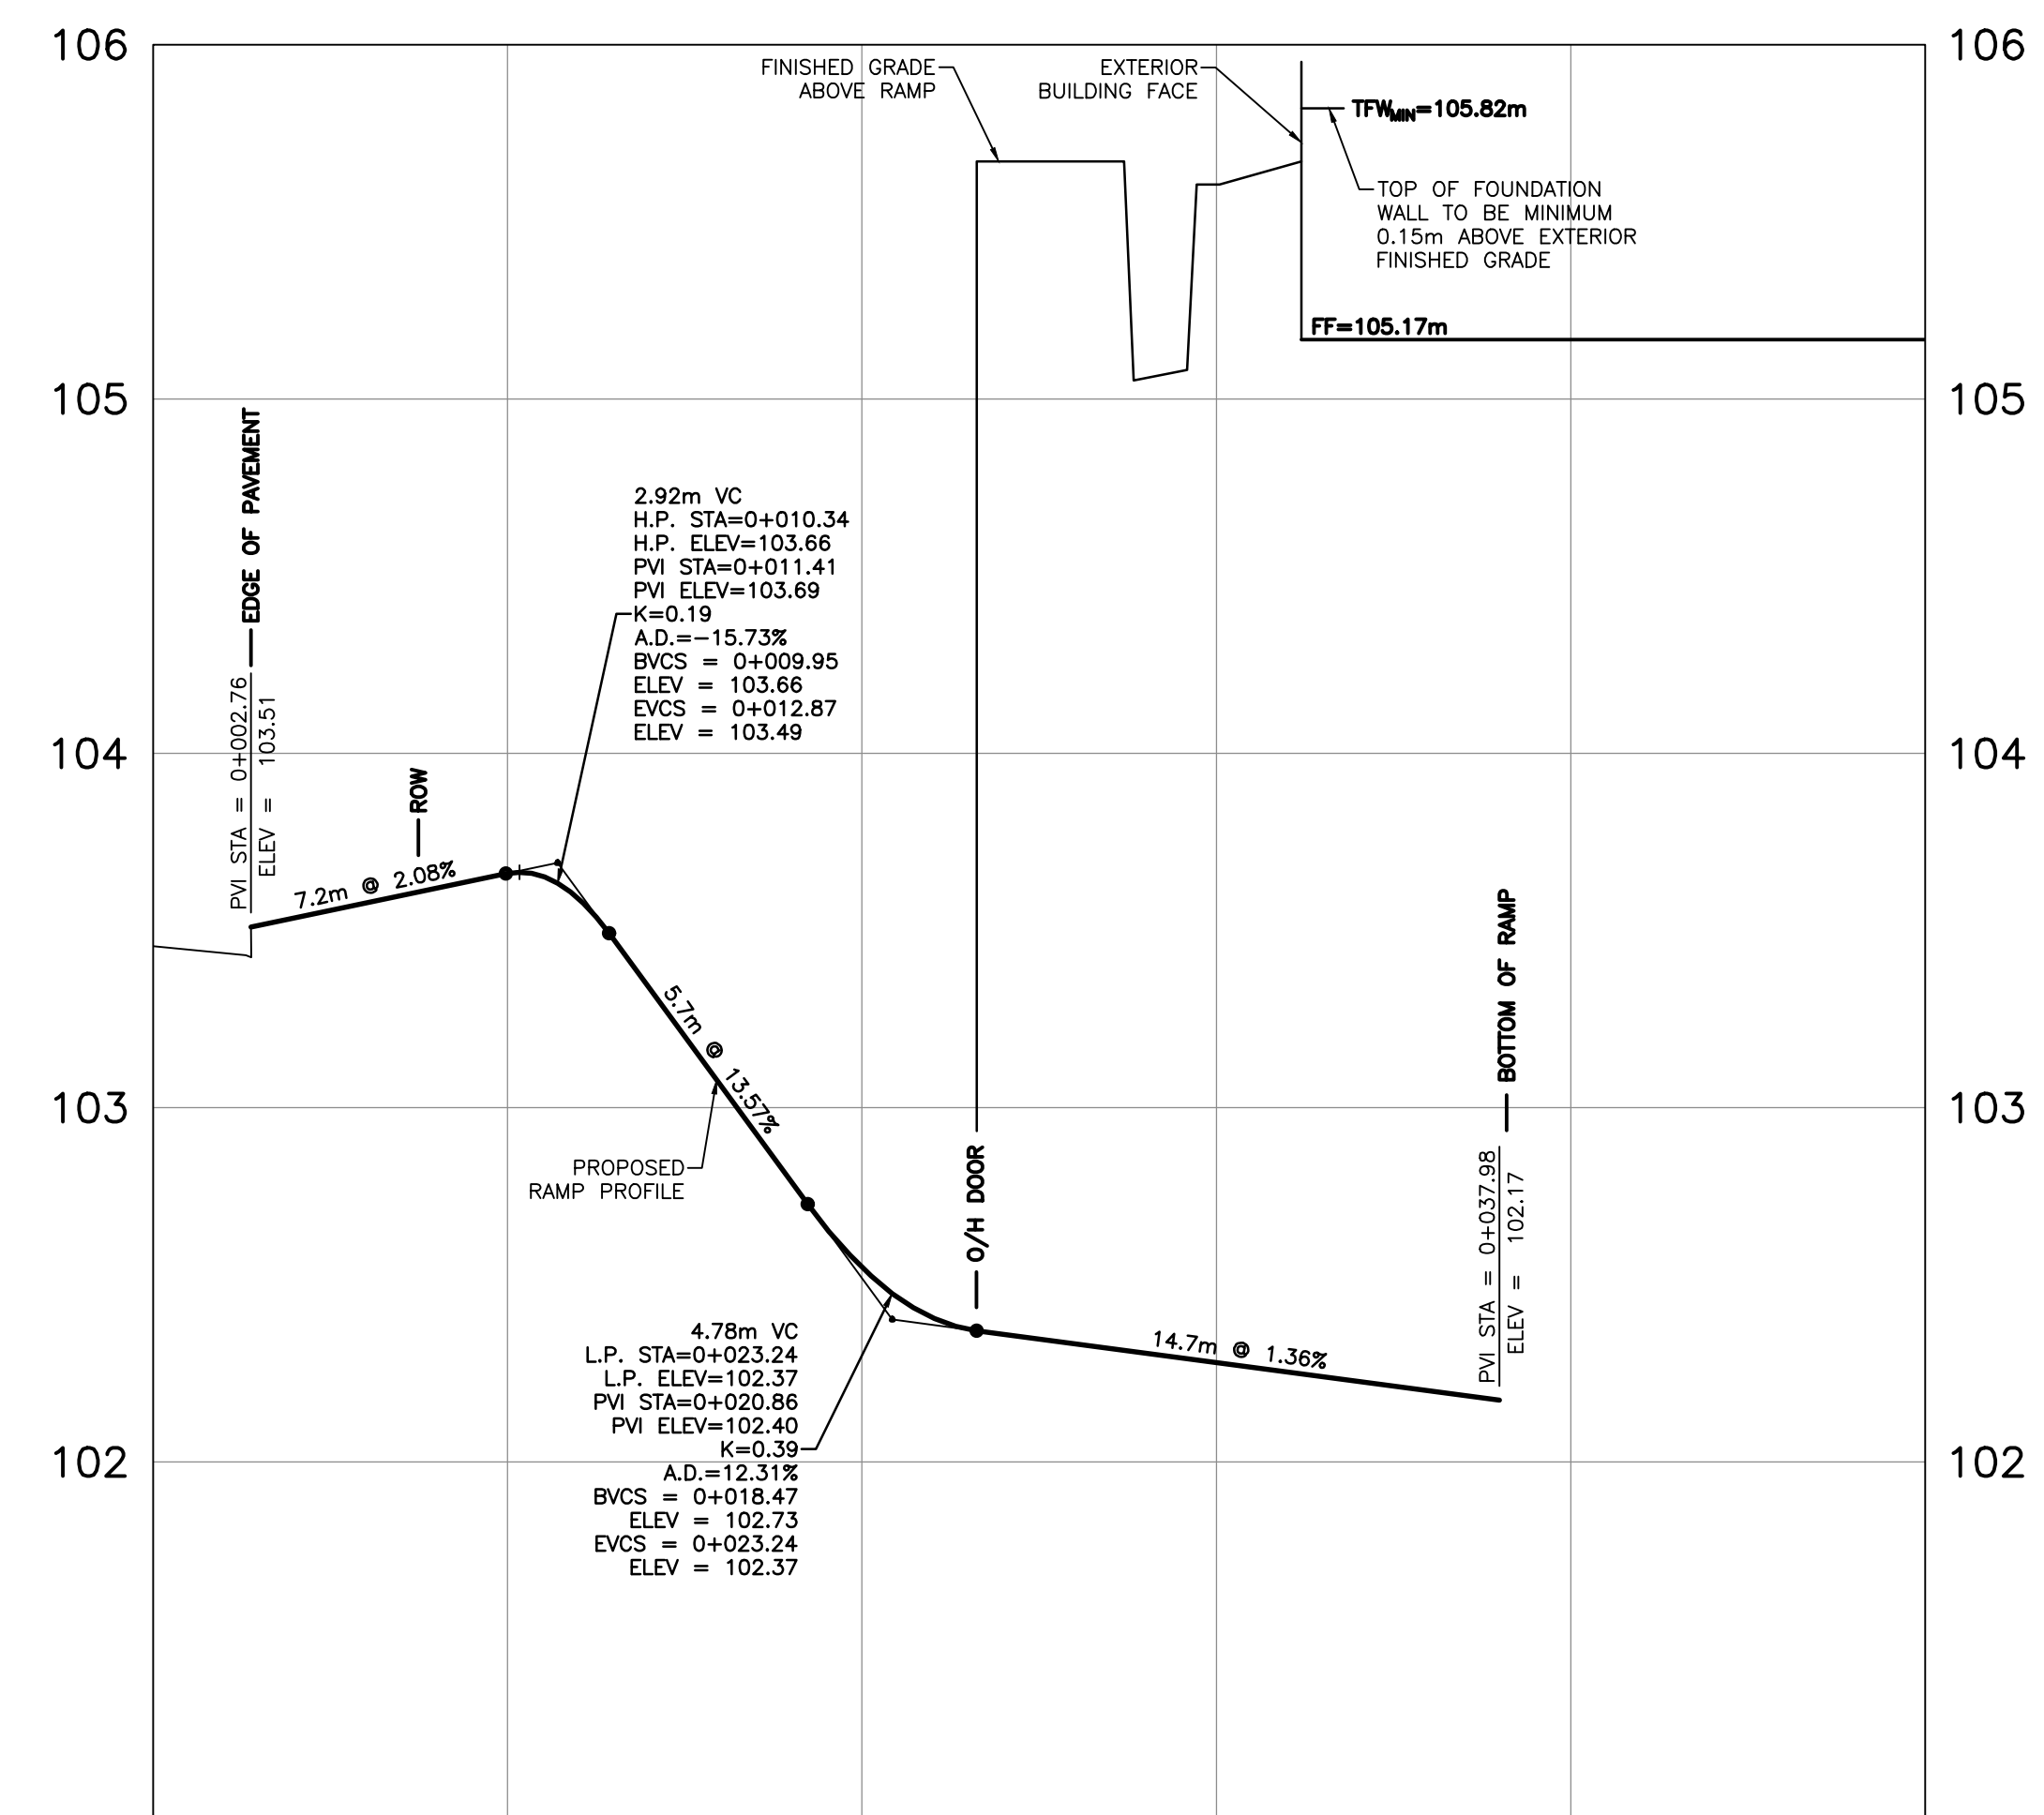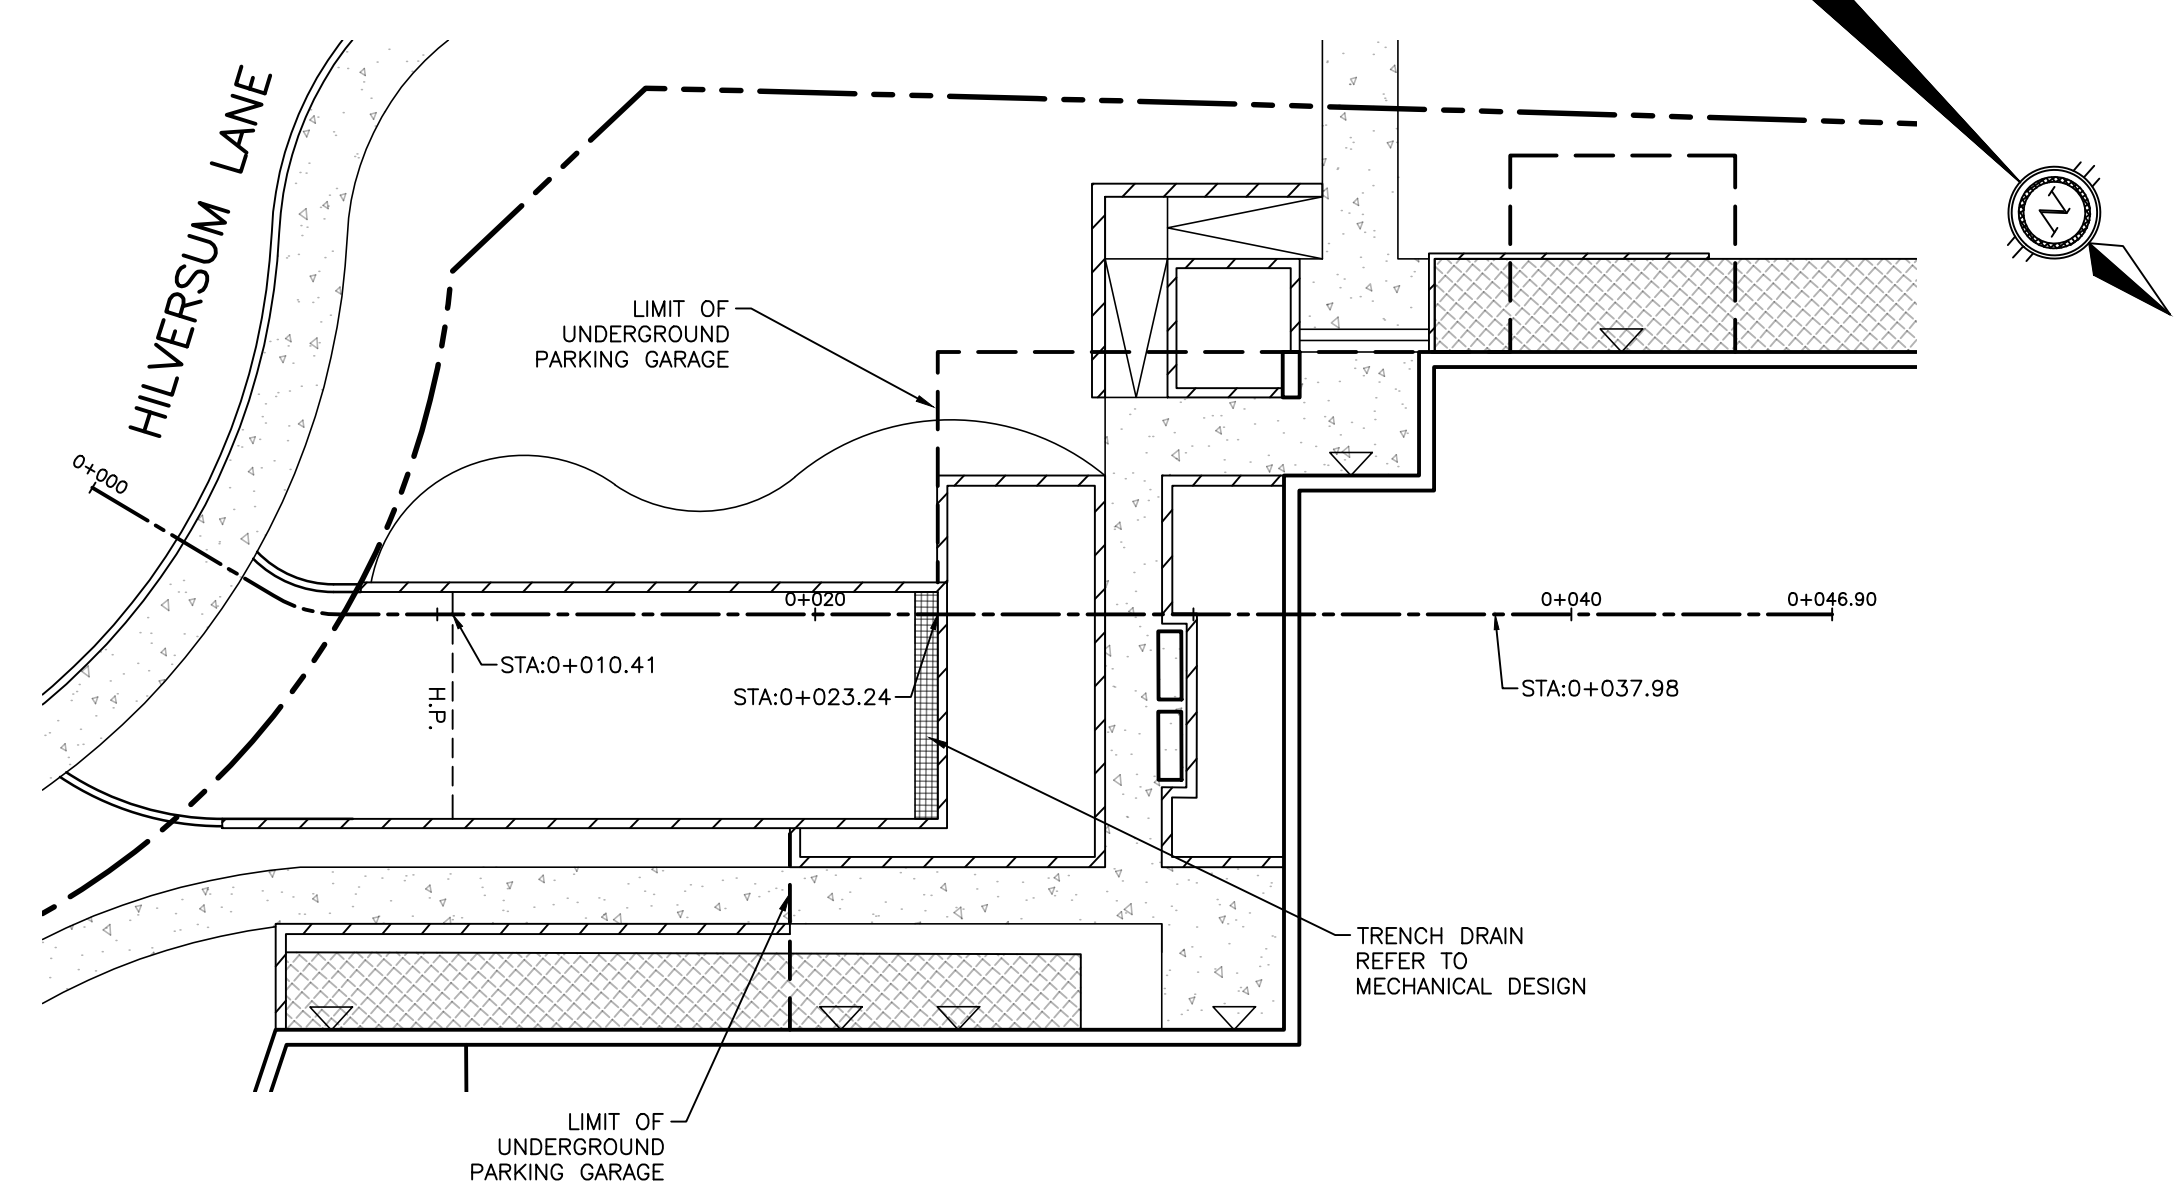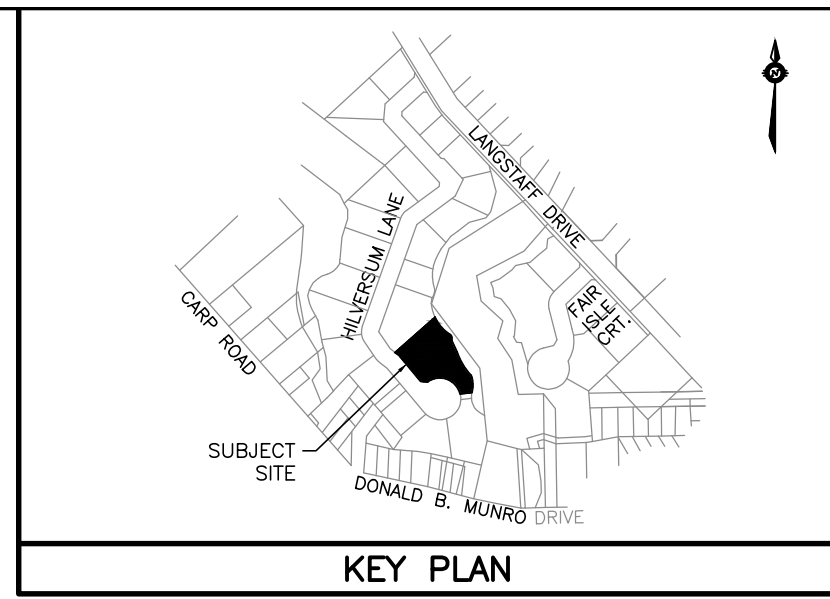

PROPOSED RAMP ELEVATION	103.51	103.66	103.63	102.55	102.48	102.28	102.17	PROPOSED RAMP ELEVATION
CHAINAGE	0+000	0+010	0+020	0+030	0+040	0+050	0+060	CHAINAGE

**NOTES**  
THE POSITION OF ALL POLE LINES, CONDUITS, WATERMANS, SEWERS AND OTHER UNDERGROUND AND OVERGROUND UTILITIES AND STRUCTURES IS NOT NECESSARILY SHOWN ON THE CONTRACT DRAWINGS, AND WHERE SHOWN, THE ACCURACY OF THE POSITION OF SUCH UTILITIES AND STRUCTURES IS NOT GUARANTEED. BEFORE STARTING WORK, DETERMINE THE EXACT LOCATION OF ALL SUCH UTILITIES AND STRUCTURES AND ASSUME ALL LIABILITY FOR DAMAGE TO THEM.  
GEODETIC SURVEY DERIVED FROM COSINE STATION 0011968U054. LOCATION DESCRIPTION: OLD HIGHWAY 17 BRIDGE OVER CARP RIVER ON CARP-STITTSVILLE ROAD, 0.2 KM SOUTH OF C.N.R. CROSSING IN VILLAGE OF CARP, TABLET IN TOP OF WEST WALL, 30 CM FROM NORTH END, 24 CM FROM WEST EDGE. VERTICAL CONTROL DATA, DATUM: CGVD28-78, FIRST ORDER, ELEVATION: 93.861. COORDINATE SYSTEM: MTM ZONE 9; NAD 83 DATUM (CAN83-9)

NO.	REVISION DESCRIPTION	DATE	BY
1	ISSUED FOR REVIEW	21/11/25	BLM

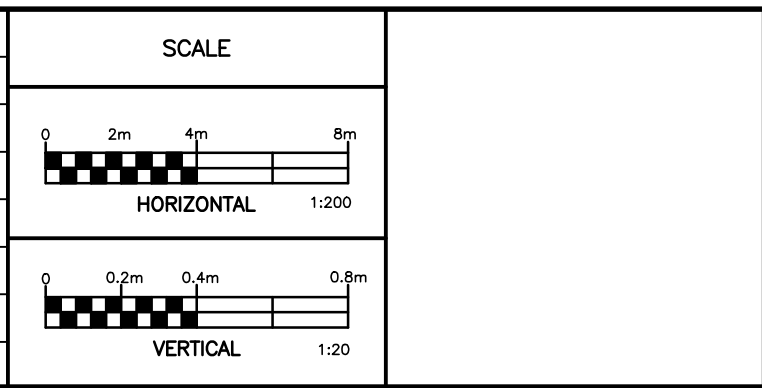

**Robinson**  
Land Development  
350 Palladium Drive  
Ottawa, ON K2V 1A8  
(613) 592-6060 rcii.com

DESIGN	BLM
CHECKED	SG
DRAWN	BLM
CHECKED	SG
APPROVED	BLM

**INVERNESS HOMES**  
38 AURIGA DRIVE, SUITE 200  
OTTAWA, ON K2E 8A6  
  
391 HILVERSUM LANE  
CARP, ON

**PARKING GARAGE RAMP  
PLAN & PROFILE**

PROJECT No.	25094
SURVEY	----
DATED	NOV. 2025
DWG. No.	25094-P1

## Appendix C

Robinson Report Excerpts

Water Demand Calculations

Fire Flow Calculations (OBC)

Fire Flow Calculations (FUS)

Boundary Conditions

Figure 3.0: Hydraulic Water Model

Table C1: Peak Hour Model Outputs

Table C2: Max. Day Model Outputs

Table C3: Max. Day Plus  
Fire Flow Outputs

Table C4: Pipe Report

Figure 4.0: Hydrant Coverage Plan

*Given the large difference in flow requirements between the peak hourly flow and fire flow, the City may consider assuming the firm capacity consists of the sum of the pump capacities with the largest unit out of service. The degree of fire protection to be provided for a municipality is to the discretion of the municipality. The plant is originally designed with one standby pump and it would be reasonable to continue with one standby pump in the future.*

Functional Design Report (prepared by RVA, dated July 2022)

*With regards to the water treatment facility, the proposed upgrades include replacement of the well pumps, MCC, standby generator (which provides standby power to both the water treatment facility and wastewater pumping station), and additional piping and site improvements to allow for the use of frac tanks for GAC backwashing.*

*The proposed improvements are intended to provide a short term upgrade to the water treatment facility and wastewater pumping station, to improve the reliability of both facilities, provide additional capacity to allow for development within the catchment area of the facilities, and ensure compliance with NFPA 820 requirements. It is understood that the long term plan for the water treatment facility and the pumping station involves significant capacity expansion, including twinning the sewage forcemain and potentially connecting the village of Carp to the City's main water distribution system, all of which will be examined as part of a separate assignment and are not included in the scope of work for this assignment. [source: RVA Report]*

Through recent consultations, the City of Ottawa has indicated that the available fire flow for the proposed development is 6,750 L/min (112.5 L/s; capacity of a single high lift pump) based on the findings of the RVA Report. This is a reduction from the available fire flow of 9,300 L/min (155 L/s) provided by the City in 2019. Refer to correspondence with the City in **Appendix B**.

## 5.2 Proposed System

A new municipal watermain system with connections to the existing village system will be required to service the proposed development for domestic use and fire protection. The watermain system for the proposed development will provide a total of three connections to the existing watermain systems as follows:

- A connection to the existing 203 mm diameter watermain on Langstaff Drive via Street 1 (to be completed as part of Phase 1).
- A connection to the existing 305 mm diameter watermain on Carp Road via the unopened John Street road allowance (to be completed as part of Phase 1).
- A connection to the existing 203 mm diameter watermain on Langstaff Drive via Street 2 (to be completed as part of Phase 2).

The proposed municipal watermains have been designed to be 203 mm in diameter in keeping with current City standards. Each townhouse unit will be serviced with individual 19 mm water services. The apartment blocks (to be developed under separate site plan applications) will be provided with 203 mm diameter watermain stubs. New fire hydrants will be provided within the municipal right-of-ways with maximum spacing of 110 metres in accordance with the current Ottawa Water Design Guidelines (OWDG).

## 5.3 Water Distribution Hydraulic Model

A water distribution hydraulic model was created using H2OMap Water software for the proposed development. The hydraulic model incorporated the proposed watermain layout,

proposed hydrant locations and hydrant elevations, boundary conditions, and typical “C” factors in accordance with the current OWDG. Refer to the developed hydraulic model and boundary conditions provided in **Appendix B**.

#### 5.4 Domestic Water Demands

Since the total population for the development is less than 500 persons, maximum day and maximum hour peaking factors shall follow Table 3-3 of the MECP Water Design Guidelines as per Section 4.2.8 of the OWDG. Domestic water demands have been calculated for each phase of the development in accordance with the current OWDG as follows:

• Average Day Demand	280 L/person/day	(OWDG; ISTB-2021-03)
• Max. Daily Demand	2.9 x Avg. Day	(MECP; Table 3-3)
• Max. Hourly Demand	4.3 x Avg. Day	(MECP; Table 3-3)
• Townhouses	2.7 persons/unit	(OWDG; Table 4.1)
• Apartments	2.1 persons/unit	(OWDG; Table 4.1)

##### Phase 1

Population = (73 TH units x 2.7 cap/unit) + (32 apt. units x 2.1 cap/unit) = **264.3 persons**

Average Day Demand = (264.3 persons) x (280 L/person/day) / 86400 s/day = **0.86 L/s**

Maximum Daily Demand = (2.9) x (0.86 L/s) = **2.48 L/s**

Maximum Hour Demand = (4.3) x (0.86 L/s) = **3.68 L/s**

##### Phase 2

Population = (8 TH units x 2.7 cap/unit) + (96 apt. units x 2.1 cap/unit) = **223.2 persons**

Average Day Demand = (223.2 persons) x (280 L/person/day) / 86400 s/day = **0.72 L/s**

Maximum Daily Demand = (2.9) x (0.72 L/s) = **2.10 L/s**

Maximum Hour Demand = (4.3) x (0.72 L/s) = **3.11 L/s**

##### Total

Population = **487.5 persons**

Average Day Demand = (487.5 persons) x (280 L/person/day) / 86400 s/day = **1.58 L/s**

Maximum Daily Demand = (2.9) x (1.58 L/s) = **4.58 L/s**

Maximum Hour Demand = (4.3) x (1.58 L/s) = **6.79 L/s**

Refer to the watermain design sheet provided in **Appendix B** for more details.

Water demands for park blocks can vary significantly depending on the proposed park design. Once a conceptual park design is provided by the City, the hydraulic model can be updated accordingly to accommodate the anticipated demands from the park, if required. The private park lands (Block 22) located in Phase 2 is not proposed to have a water service and therefore will not generate any water demands.

**WATER DEMAND CALCULATIONS**

391 Hilversum Lane, Carp, ON  
Project No. 25094



JUNCTION NODE	RESIDENTIAL POPULATION				COMMERCIAL AREA (ha)	INSTITUTIONAL AREA (ha)	CLUB HOUSE		BASIC DAY DEMAND (L/s)					MAX. DAY DEMAND (L/s)					PEAK HOUR DEMAND (L/s)					AVG. DAY DEMAND (m <sup>3</sup> /day)
	APARTMENT UNIT COUNT			TOTAL POPULATION			WATER CLOSET <sup>5</sup> (L/s)	WASH BASIN (L/s)	RES.	COMM.	INST.	CH	TOTAL	RES.	COMM.	INST.	CH	TOTAL	RES.	COMM.	INST.	CH	TOTAL	
	BACHELOR	1-BEDROOM	2-BEDROOM																					
CONNECTION 1	2	20	17	66.5			0.007	0.009	0.22			0.016	0.23	0.62			0.045	0.67	0.93			0.067	0.99	20.0
<b>Total</b>	<b>2</b>	<b>20</b>	<b>17</b>	<b>66.5</b>					<b>0.22</b>			<b>0.016</b>	<b>0.23</b>	<b>0.62</b>			<b>0.045</b>	<b>0.67</b>	<b>0.93</b>			<b>0.067</b>	<b>0.99</b>	<b>20.0</b>

Notes:

- Per unit populations as per OWDG Table 4.1.
- For populations less than 500 persons, peaking factors as per MOE Table 3-3 (OWDG; Section 4.2.8)
- Peaking factor for use with basic day demand as per MOE Table 3-3.
- Peaking factors established in overarching Robinson Report (May 2024) prepared for Huntley Hollow Subdivision.
- Water closet demand assumes 12 hours of use per day.

No. of Fixtures:		Demand:	
Water Closet	2	Water Closet	150 L / per fixture / per hour of use
Wash Basin	2	Wash Basin	375 L / per fixture / per day

Per Unit Populations

Bachelor =	1.4	persons/unit
1-Bedroom =	1.4	persons/unit
2-Bedroom =	2.1	persons/unit

Basic Day Demand:

Residential	280	L/person/day
Commercial	28000	L/ha/day
Institutional	28000	L/ha/day

Max. Day Demand:

Residential	2.9	x Avg. Day <sup>4</sup>
Commercial	1.5	x Avg. Day
Institutional	1.5	x Avg. Day

Peak Hour Demand:

Residential	4.3	x Avg. Day <sup>3,4</sup>
Commercial	1.8	x Max. Day
Institutional	1.8	x Max. Day

**Table 3-3: Peaking Factors for Drinking-Water Systems Serving Fewer than 500 People**

DWELLING UNITS SERVICED	EQUIVALENT POPULATION	NIGHT MINIMUM HOUR FACTOR	MAXIMUM DAY FACTOR	PEAK HOUR FACTOR
10	30	0.1	9.5	14.3
50	150	0.1	4.9	7.4
100	300	0.2	3.6	5.4
150	450	0.3	3.0	4.5
167	500	0.4	2.9	4.3

(Source: MOE Design Guidelines for Drinking-Water Systems)

## Calculation of Required Fire Flow

$$Q = KVS_{Tot}$$

where

Q = minimum supply of water in litres (L)

K = water supply coefficient from Table 1

V = total building volume in cubic metres

$S_{Tot}$  = total of spatial coefficient values from property line exposures on all sides, as obtained from the formula:

Ref: OBC Appendix A-3.2.5.7

### **Water Supply Coefficient:**

Classification:

$$K = 18 \quad (\text{Table 1})$$

### **Total Building Volume:**

$$\text{BLDG Area} = 1,257.00 \text{ m}^2$$

$$\text{Height} = 9.1 \text{ m}$$

$$V = 11,438.70 \text{ m}^3$$

### **Total Spatial Coefficient:**

$$S_{TOT} = 2.0 \quad (\text{Figure 1})$$

### **Minimum Water Supply:**

$$Q_{MIN} = 411,793 \text{ L}$$

### **Required Water Supply Flow Rate:**

$$Q_{REQ} = 9000 \text{ L/min} \quad (\text{Table 2})$$

**Table 1:  
Water Supply Coefficient - K**

TYPE OF CONSTRUCTION	Classification by Group or Division in Accordance with Table 3.1.2.1 of the Ontario Building Code				
	A-2	A-4	A-1 A-3<	E-2	F-1
Building is of noncombustible construction with fire separations and fire-resistance ratings provided in accordance with Subsection 3.2.2. of the OBC, including loadbearing walls, columns and arches.	10	12	14	17	23
Building is of noncombustible construction or of heavy timber construction conforming to Article 3.1.4.6. of the OBC. Floor assemblies are fire separations but with no fire-resistance rating. Roof assemblies, mezzanines, loadbearing walls, columns and arches do not have a fire-resistance rating.	16	19	22	27	37
Building is of combustibile construction with fire separations and fire-resistance ratings provided in accordance with Subsection 3.2.2. of the OBC, including loadbearing walls, columns and arches. Noncombustible construction may be used in lieu of fire-resistance rating where permitted in Subsection 3.2.2. of the OBC.	18	22	25	31	41
Building is of combustibile construction. Floor assemblies are fire separations but with no fire-resistance rating. Roof assemblies, mezzanines, loadbearing walls, columns and arches do not have a fire-resistance rating.	23	28	32	39	53
Column 1	2	3	4	5	6

<b>Table 2: Minimum Water Supply Flow Rates</b>	
<b>Building Code, Part 3 Buildings</b>	<b>Required Minimum Water Supply Flow Rate (L/min.)</b>
<b>One-storey building with building area not exceeding 600m<sup>2</sup> (excluding F-1 occupancies)</b>	1800
<b>All other buildings</b>	2700 (If $Q \leq 108,000L$ ) <sup>(1)</sup> 3600 (If $Q > 108,000L$ <b>and</b> $\leq 135,000L$ ) <sup>(1)</sup> 4500 (If $Q > 135,000L$ <b>and</b> $\leq 162,000L$ ) <sup>(1)</sup> 5400 (If $Q > 162,000L$ <b>and</b> $\leq 190,000L$ ) <sup>(1)</sup> 6300 (If $Q > 190,000L$ <b>and</b> $\leq 270,000L$ ) <sup>(1)</sup> 9000 (If $Q > 270,000L$ ) <sup>(1)</sup>

Note: <sup>(1)</sup>  $Q = KVS_{Tot}$  as referenced in Section 3(a)

$$S_{Tot} = 1.0 + [(S_{Side1}) + (S_{Side2}) + (S_{Side3}) + \dots \text{etc.}]$$

where

$S_{Side}$  values are obtained from Figure 1, as modified by Sections 6.3 (e) and 6.3 (f) of this guideline, and

$S_{Tot}$  need not exceed 2.0

(see also Section 7.0 of this guideline)


(e) Where a masonry wall with a minimum fire-resistance rating of 2 hours and no unprotected openings is provided as an exterior wall, the spatial coefficient " $S_{Side}$ " for this side of the new building may be considered equal to 0. This exterior masonry wall shall be provided with a minimum 150 mm parapet. Firewalls that divide a structure into two or more buildings may be given similar consideration when evaluating the exposure of the buildings to each other.

Section (e) is not applicable.

(f) The spatial coefficient " $S_{Side}$ " may be considered equal to 0 when the exposed building is on the same property and is less than 10 m<sup>2</sup> in building area.

Section (f) is not applicable.

	$S_{side}$	Exposure Distance	
$S_{side1} =$	0.5	4.5	(north side; north PL)
$S_{side2} =$	0.0	15.1	(west side; CL of Hilversum Lane)
$S_{side3} =$	0.4	6.1	(east side; east PL)
$S_{side4} =$	0.5	4.25	(south side; midpoint to club house)
$S_{TOT} =$	2.0		

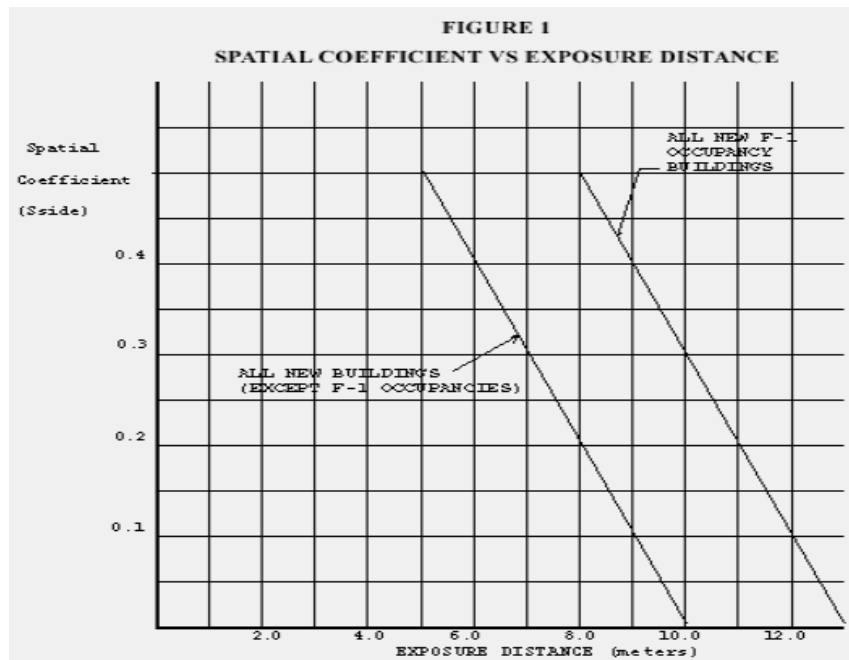

**Project Name:** Hilversum Lane Site Plan  
**Project Location:** 391 Hilversum Lane, Carp, ON  
**Project No:** 25094  
**Date:** Nov. 10, 2025

**Building Type:** Residential Apartment  
**Building Being Considered:** 3-Storey Apartment



**Calculations for Total Required Fire Flow**

Step	Parameter				Value	
A	Type of Construction	Options	C	Ordinary Construction (Type III)	1.0	
		Wood Frame (Type V)	1.5			
		Ordinary Construction (Type III)	1.0			
		Non-Combustible Construction (Type II)	0.8			
		Fire Resistive Construction (Type I)	0.6			
B	Third Floor Area				1257.0 m <sup>2</sup>	
	Second Floor Area				1257.0 m <sup>2</sup>	
	Ground Floor Area				1257.0 m <sup>2</sup>	
	<b>Total Effective Floor Area</b>				<b>3,771.0 m<sup>2</sup></b>	
C	<b>Fire Flow</b>				<b>14,000 L/min</b>	
D	Occupancy Class	Options	Charge	Limited Combustible	-0.15	
		Non-combustible	-0.25			
		Limited Combustible	-0.15			
		Combustible	0.00			
		Free burning	0.15			
	Rapid Burning	0.25				
<b>Occupancy Adjustment</b>				<b>-2100 L/min</b>		
<b>Fire Flow</b>				<b>11,900 L/min</b>		
E	Sprinkler Protection	Options	Charge	Automatic Sprinkler Protection	-0.30	
		Automatic Sprinkler Protection	-0.30			
		None	0.00			
		Water Supply is Standard for System and Hose Lines	-0.10			
	Full Supervision of the Sprinkler System	-0.10	Yes	-0.10		
<b>Sprinkler Reduction</b>				<b>-5,950 L/min</b>		
F	<b>Exposures</b>					
	<b>West Side</b>					
	Subject Building and Exposed Building Fully Protected with Automatic Sprinkler Systems				No	
	Exposed Building Fully Protected with Automatic Sprinkler Systems				No	
	Exposed Wall Length				34 m	
	Exposed Wall No. of Storeys				2	
	Length-Height Factor of Exposed Wall				68 m.storeys	
	Construction Type of Exposed Wall	Options	Wood Frame			
		Wood Frame				
		Ordinary with Unprotected Openings				
		Ordinary without Unprotected Openings				
		Noncombustible or Fire Resistive with Unprotected Openings				
	Noncombustible or Fire Resistive without Unprotected Openings					
	Separation Distance				>30m; no exposure	32.8 m
	<b>West Side Exposure Charge</b>					<b>0.00</b>
	<b>North Side</b>					
	Subject Building and Exposed Building Fully Protected with Automatic Sprinkler Systems				No	
	Exposed Building Fully Protected with Automatic Sprinkler Systems				No	
	Exposed Wall Length				17.6 m	
	Exposed Wall No. of Storeys				2	
	Length-Height Factor of Exposed Wall				35.2 m.storeys	
	Construction Type of Exposed Wall	Options	Wood Frame			
		Wood Frame				
		Ordinary with Unprotected Openings				
		Ordinary without Unprotected Openings				
		Noncombustible or Fire Resistive with Unprotected Openings				
	Noncombustible or Fire Resistive without Unprotected Openings					
Separation Distance				>30m; no exposure	44.0 m	
<b>North Side Exposure Charge</b>					<b>0.00</b>	
<b>East Side</b>						
Subject Building and Exposed Building Fully Protected with Automatic Sprinkler Systems				No		
Exposed Building Fully Protected with Automatic Sprinkler Systems				No		
Exposed Wall Length				60 m		
Exposed Wall No. of Storeys				3		
Length-Height Factor of Exposed Wall				180 m.storeys		
Construction Type of Exposed Wall	Options	Ordinary with Unprotected Openings				
	Wood Frame					
	Ordinary without Unprotected Openings					

	Noncombustible or Fire Resistive with Unprotected Openings		
	Noncombustible or Fire Resistive without Unprotected Openings		
	Separation Distance	>30m; no exposure	77.0 m
	<b>East Side Exposure Charge</b>		<b>0.00</b>
	<b>South Side</b>		
	Subject Building and Exposed Building Fully Protected with Automatic Sprinkler Systems		Yes
	Exposed Building Fully Protected with Automatic Sprinkler Systems		Yes
	Exposed Wall Length		7.7 m
	Exposed Wall No. of Storeys		1
	Length-Height Factor of Exposed Wall		7.7 m.storeys
	Construction Type of Exposed Wall	<b>Options</b>	
		Wood Frame	Wood Frame
		Ordinary with Unprotected Openings	
		Ordinary without Unprotected Openings	
		Noncombustible or Fire Resistive with Unprotected Openings	
	Noncombustible or Fire Resistive without Unprotected Openings		
	Separation Distance	+3m; see note 2	11.7 m
	<b>South Side Exposure Charge</b>		<b>0.00</b>
	<b>Total Exposure Charge</b>		<b>0 &lt; 0.75</b>
	<b>Increase for Exposures</b>		<b>0 L/min</b>
<b>G</b>	<b>Total Required Fire Flow</b>		<b>6,000 L/min</b>

**Notes:**

1. Fire flow calculations have been prepared in accordance with Fire Underwriters Survey (v. 2020)
2. Where buildings are at a diagonal to each other, the shortest separation distance is increased by 3 metres and used as the exposure distance (Ref. FUS v.2020 pg.30).

<b>Project Name:</b> Hilversum Lane Site Plan <b>Project Location:</b> 391 Hilversum Lane, Carp, ON <b>Project No:</b> 25094 <b>Date:</b> Nov. 10, 2025  <b>Building Type:</b> Club House <b>Building Being Considered:</b> Club House	<h1 style="margin: 0;">Robinson</h1> <h2 style="margin: 0;">Land Development</h2>
--	---

**Calculations for Total Required Fire Flow**

Step	Parameter			Value	
<b>A</b>	<b>Type of Construction</b>	<b>Options</b>	<b>C</b>	Wood Frame (Type V) 1.5	
		Wood Frame (Type V)	1.5		
		Ordinary Construction (Type III)	1.0		
		Non-Combustible Construction (Type II)	0.8		
		Fire Resistive Construction (Type I)	0.6		
Ground Floor Area				70.0 m <sup>2</sup>	
<b>Total Effective Floor Area</b>				<b>70.0 m<sup>2</sup></b>	
<b>C</b>	<b>Fire Flow</b>			<b>3,000 L/min</b>	
<b>D</b>	<b>Occupancy Class</b>	<b>Options</b>	<b>Charge</b>	Limited Combustible -0.15	
		Non-combustible	-0.25		
		Limited Combustible	-0.15		
		Combustible	0.00		
		Free burning	0.15		
		Rapid Burning	0.25		
	<b>Occupancy Adjustment</b>				<b>-450 L/min</b>
<b>Fire Flow</b>				<b>2,550 L/min</b>	
<b>E</b>	<b>Sprinkler Protection</b>	<b>Options</b>	<b>Charge</b>	Automatic Sprinkler Protection -0.30	
		Automatic Sprinkler Protection	-0.30		
		None	0.00		
		Water Supply is Standard for System and Hose Lines	-0.10		
		Full Supervision of the Sprinkler System	-0.10		
	<b>Sprinkler Reduction</b>				<b>-1,275 L/min</b>
<b>F</b>	<b>Exposures</b>				
	<b>West Side</b>				
	Subject Building and Exposed Building Fully Protected with Automatic Sprinkler Systems				No
	Exposed Building Fully Protected with Automatic Sprinkler Systems				No
	Exposed Wall Length				25.6 m
	Exposed Wall No. of Storeys				2
	Length-Height Factor of Exposed Wall				51.2 m.storeys
	Construction Type of Exposed Wall	<b>Options</b>	Wood Frame	56	m
		Wood Frame			
		Ordinary with Unprotected Openings			
		Ordinary without Unprotected Openings			
		Noncombustible or Fire Resistive with Unprotected Openings			
		Noncombustible or Fire Resistive without Unprotected Openings			
	Separation Distance >30m; no exposure				56 m
	<b>West Side Exposure Charge</b>				<b>0.00</b>
	<b>North Side</b>				
	Subject Building and Exposed Building Fully Protected with Automatic Sprinkler Systems				Yes
	Exposed Building Fully Protected with Automatic Sprinkler Systems				Yes
	Exposed Wall Length				13.8 m
	Exposed Wall No. of Storeys				3
	Length-Height Factor of Exposed Wall				41.4 m.storeys
	Construction Type of Exposed Wall	<b>Options</b>	Ordinary with Unprotected Openings	11.7	m
		Wood Frame			
		Ordinary with Unprotected Openings			
		Ordinary without Unprotected Openings			
Noncombustible or Fire Resistive with Unprotected Openings					
Noncombustible or Fire Resistive without Unprotected Openings					
Separation Distance +3m; see note 2				11.7 m	
<b>North Side Exposure Charge</b>				<b>0.00</b>	
<b>East Side</b>					
Subject Building and Exposed Building Fully Protected with Automatic Sprinkler Systems				No	
Exposed Building Fully Protected with Automatic Sprinkler Systems				No	
Exposed Wall Length				60 m	
Exposed Wall No. of Storeys				3	
Length-Height Factor of Exposed Wall				180 m.storeys	
Construction Type of Exposed Wall	<b>Options</b>	Ordinary with Unprotected Openings	11.7	m	
	Wood Frame				
	Ordinary with Unprotected Openings				
	Ordinary without Unprotected Openings				
	Noncombustible or Fire Resistive with Unprotected Openings				
	Noncombustible or Fire Resistive without Unprotected Openings				

Separation Distance		>30m; no exposure	77.0	m
<b>East Side Exposure Charge</b>			<b>0.00</b>	
<b>South Side</b>				
Subject Building and Exposed Building Fully Protected with Automatic Sprinkler Systems			No	
Exposed Building Fully Protected with Automatic Sprinkler Systems			No	
Exposed Wall Length			25.6	m
Exposed Wall No. of Storeys			2	
Length-Height Factor of Exposed Wall			51.2	m.storeys
Construction Type of Exposed Wall	<b>Options</b>		Wood Frame	
	Wood Frame			
	Ordinary with Unprotected Openings			
	Ordinary without Unprotected Openings			
	Noncombustible or Fire Resistive with Unprotected Openings			
Noncombustible or Fire Resistive without Unprotected Openings				
Separation Distance		>30m; no exposure	38.0	m
<b>South Side Exposure Charge</b>			<b>0.00</b>	
<b>Total Exposure Charge</b>			<b>0</b>	<b>&lt; 0.75</b>
<b>Increase for Exposures</b>			<b>0</b>	<b>L/min</b>
<b>G</b>	<b>Total Required Fire Flow</b>		<b>1,000</b>	<b>L/min</b>

**Notes:**

1. Fire flow calculations have been prepared in accordance with Fire Underwriters Survey (v. 2020)
2. Where buildings are at a diagonal to each other, the shortest separation distance is increased by 3 metres and used as the exposure distance (Ref. FUS v.2020 pg.30).

## Boundary Conditions 391 Hilversum Lane (Carp Village)

### Provided Information

Scenario	Demand	
	L/min	L/s
Average Daily Demand	14	0.23
Maximum Daily Demand	109	1.82
Peak Hour	164	2.73
Fire Flow Demand #1	6,000	100.00

### Location



## Results

### Connection 1 – Hilversum Lane

Demand Scenario	Head (m)	Pressure <sup>1</sup> (psi)
Maximum HGL	164.1	87.0
Peak Hour	154.4	73.2
Max Day plus Fire Flow #1	154.9	74.0


<sup>1</sup> Ground Elevation = 102.9 m

## Notes

1. Demands for proposed Connection 1 at existing water main stub were assigned to upstream junction at Hilversum Lane off the public looped watermain. The engineer must calculate headloss off the dead-end main.
2. As per the Ontario Building Code in areas that may be occupied, the static pressure at any fixture shall not exceed 552 kPa (80 psi.) Pressure control measures to be considered are as follows, in order of preference:
  - If possible, systems to be designed to residual pressures of 345 to 552 kPa (50 to 80 psi) in all occupied areas outside of the public right-of-way without special pressure control equipment.
  - Pressure reducing valves to be installed immediately downstream of the isolation valve in the home/ building, located downstream of the meter so it is owner maintained.

## **Disclaimer**

The boundary condition information is based on current operation of the city water distribution system. The computer model simulation is based on the best information available at the time. The operation of the water distribution system can change on a regular basis, resulting in a variation in boundary conditions. The physical properties of watermain deteriorate over time, as such must be assumed in the absence of actual field test data. The variation in physical watermain properties can therefore alter the results of the computer model simulation. Fire Flow analysis is a reflection of available flow in the watermain; there may be additional restrictions that occur between the watermain and the hydrant that the model cannot take into account.

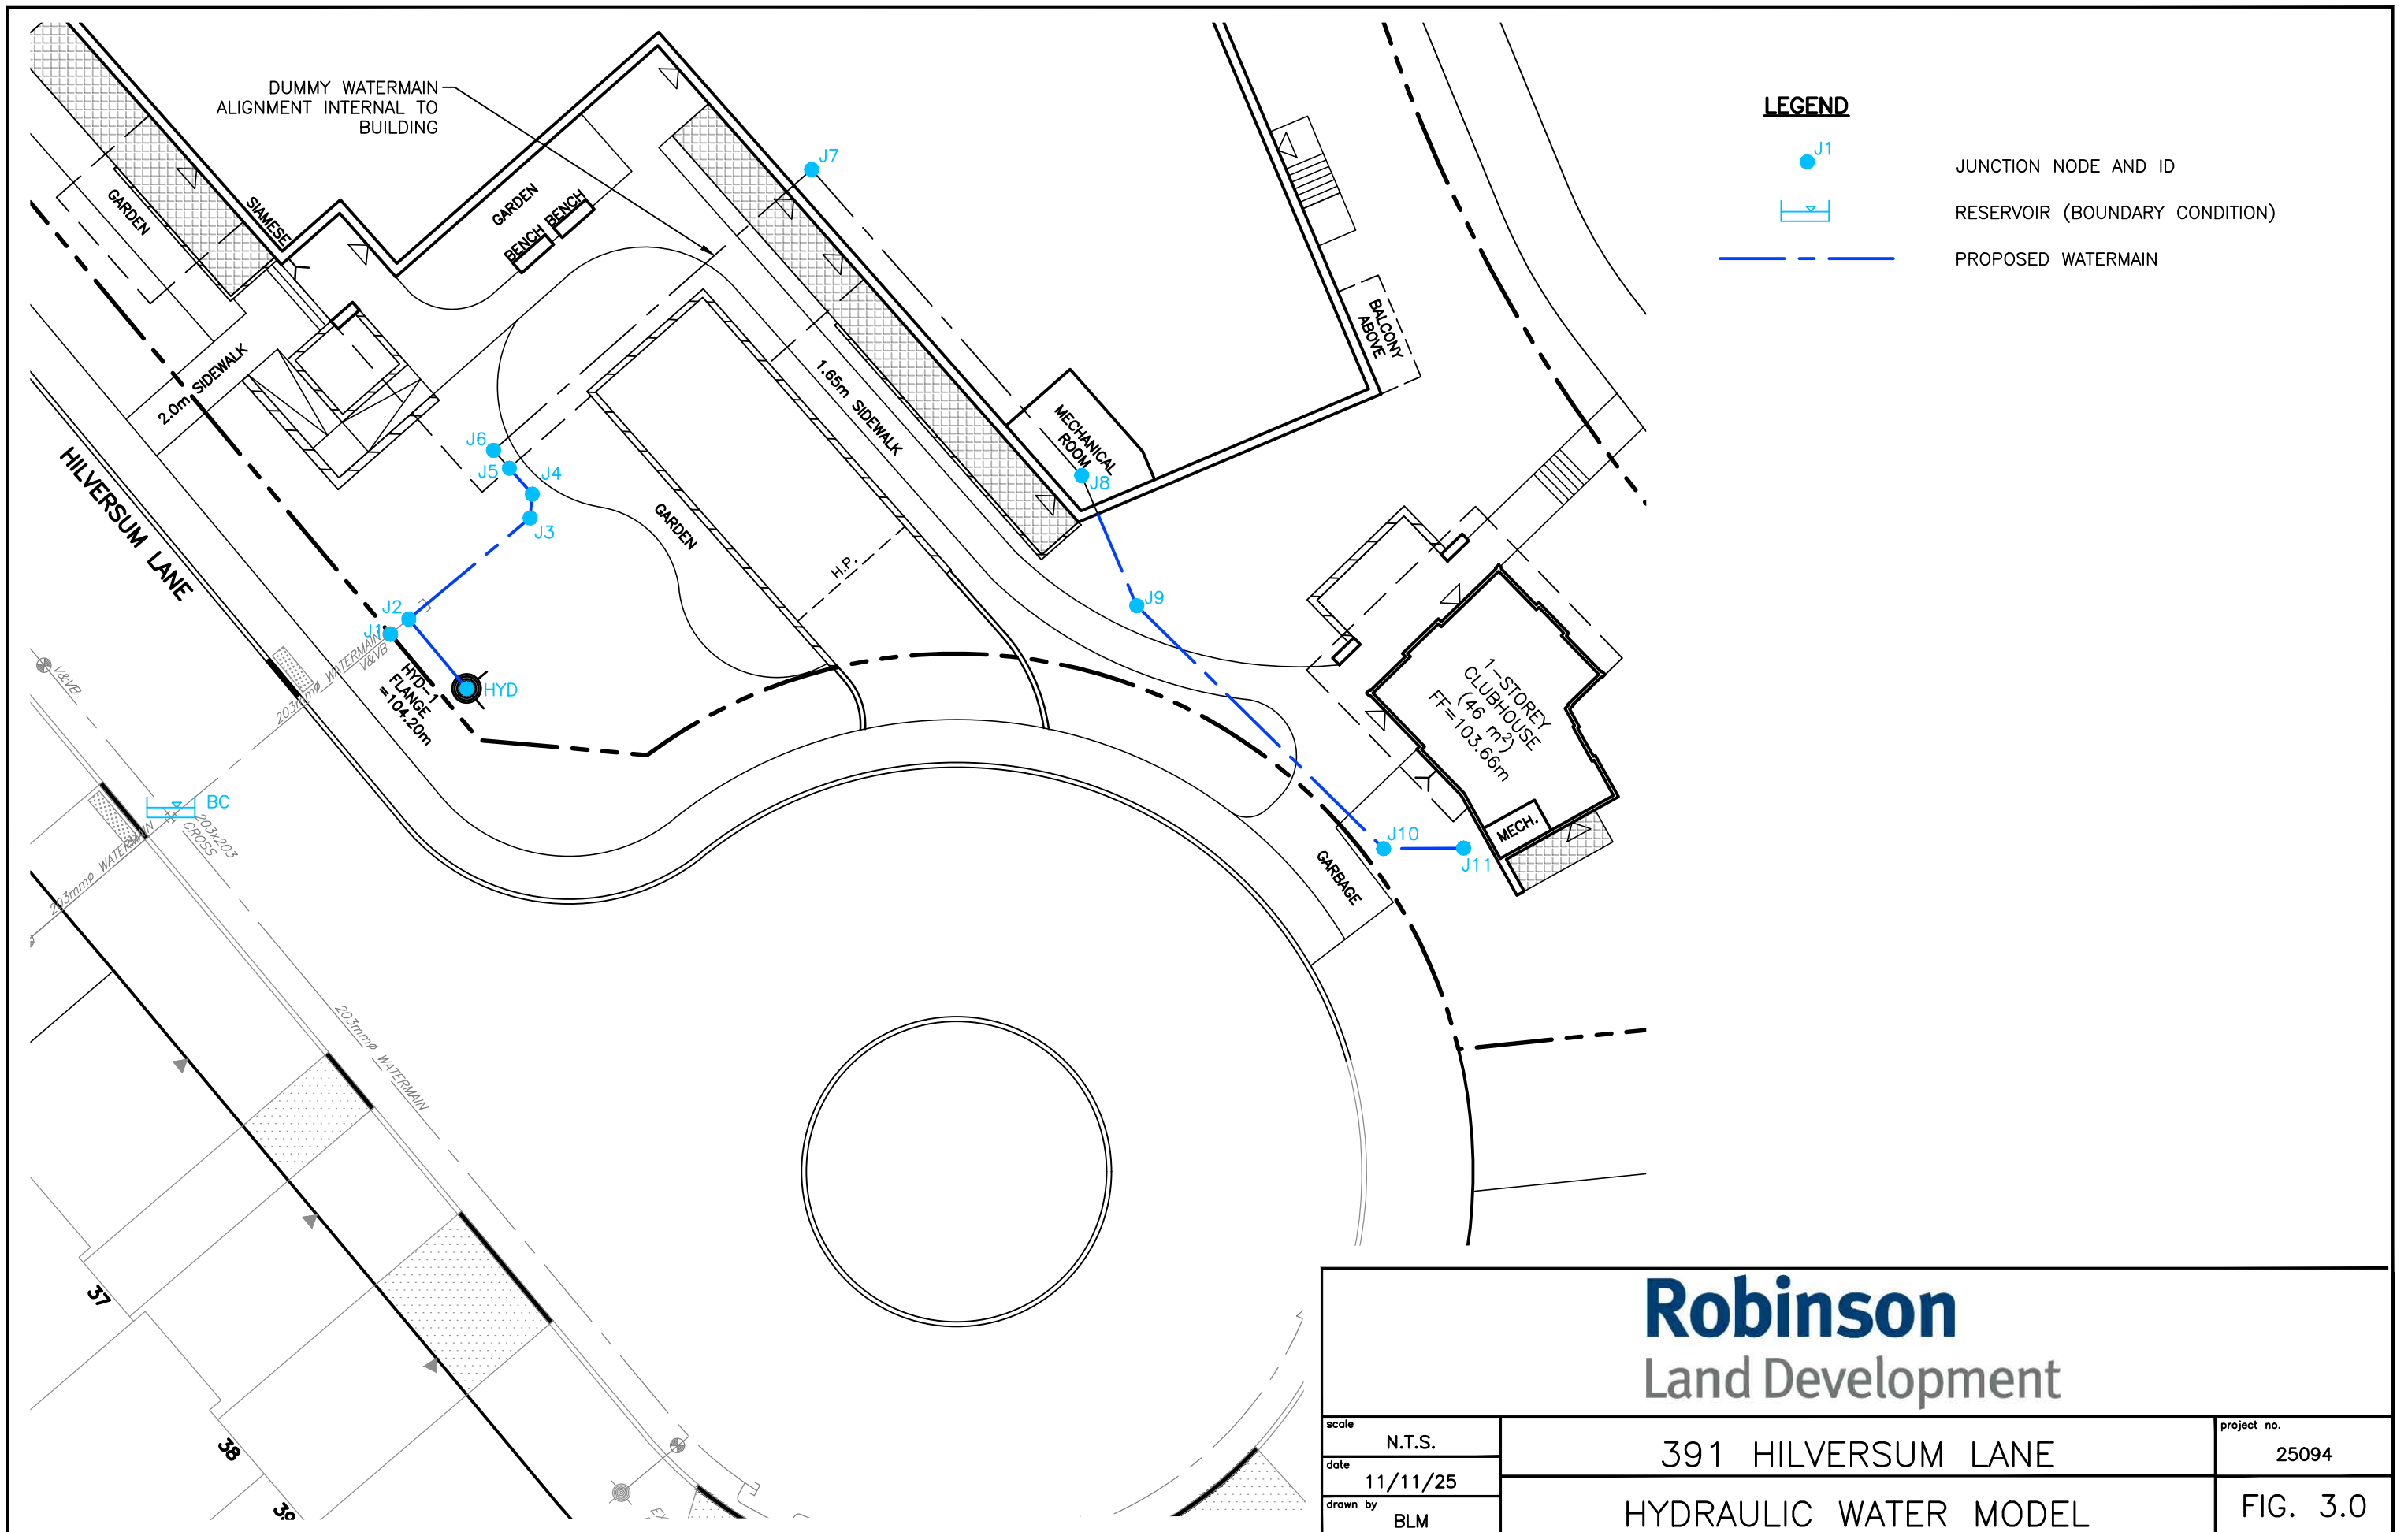

# Robinson

## Land Development

scale	N.T.S.	391 HILVERSUM LANE	project no.	25094
date	11/11/25		HYDRAULIC WATER MODEL	FIG. 3.0
drawn by	BLM			

**Table C1: Peak Hour Model Outputs**

<b>Junction ID</b>	<b>Demand (L/s)</b>	<b>Elevation (m)</b>	<b>Head (m)</b>	<b>Pressure (psi)</b>
J1	0.000	104.13	154.40	71.81
J2	0.000	104.12	154.40	71.83
J3	0.000	104.43	154.40	71.39
J4	0.000	104.52	154.40	71.26
J5	0.000	104.60	154.40	71.14
J6	0.000	104.66	154.40	71.06
J7	0.930	105.17	154.40	70.33
J8	0.000	105.17	154.40	70.33
J9	0.000	104.10	154.40	71.86
J10	0.000	103.40	154.40	72.86
J11	0.067	103.66	154.40	72.49
HYD	0.000	104.20	154.40	71.71

**Table C2: Max. Day Model Outputs**


<b>Junction ID</b>	<b>Demand (L/s)</b>	<b>Elevation (m)</b>	<b>Head (m)</b>	<b>Pressure (psi)</b>
J1	0.00	104.13	164.10	85.67
J2	0.00	104.12	164.10	85.69
J3	0.00	104.43	164.10	85.24
J4	0.00	104.52	164.10	85.11
J5	0.00	104.60	164.10	85.00
J6	0.00	104.66	164.10	84.91
J7	0.62	105.17	164.10	84.19
J8	0.00	105.17	164.10	84.19
J9	0.00	104.10	164.10	85.71
J10	0.00	103.40	164.10	86.71
J11	0.05	103.66	164.10	86.34
HYD	0.00	104.20	164.10	85.57

**Table C3: Max. Day Plus Fire Flow Outputs**

<b>Junction ID</b>	<b>Available Fire Flow (L/s)</b>	<b>Available Fire Flow (L/min)</b>	<b>Available Flow Pressure (psi)</b>
HYD	400.81	24,048.60	20.00

**Table C4: Pipe Report**

<b>Pipe ID</b>	<b>Inlet Junction</b>	<b>Outlet Junction</b>	<b>Length (m)</b>	<b>Diameter (mm)</b>	<b>Roughness</b>
C1	J1	J2	1.0	203	110
C2	J2	J3	6.6	203	110
C3	J3	J4	1.0	203	110
C4	J4	J5	1.5	203	110
C5	J5	J6	1.0	203	110
C6	J6	J7	17.8	203	110
C7	J7	J8	17.1	203	110
C8	J8	J9	5.9	152	100
C9	J9	J10	14.6	152	100
C10	J10	J11	3.3	152	100
C11	R1	J1	12.0	203	110
C12	J2	J12	3.8	152	100

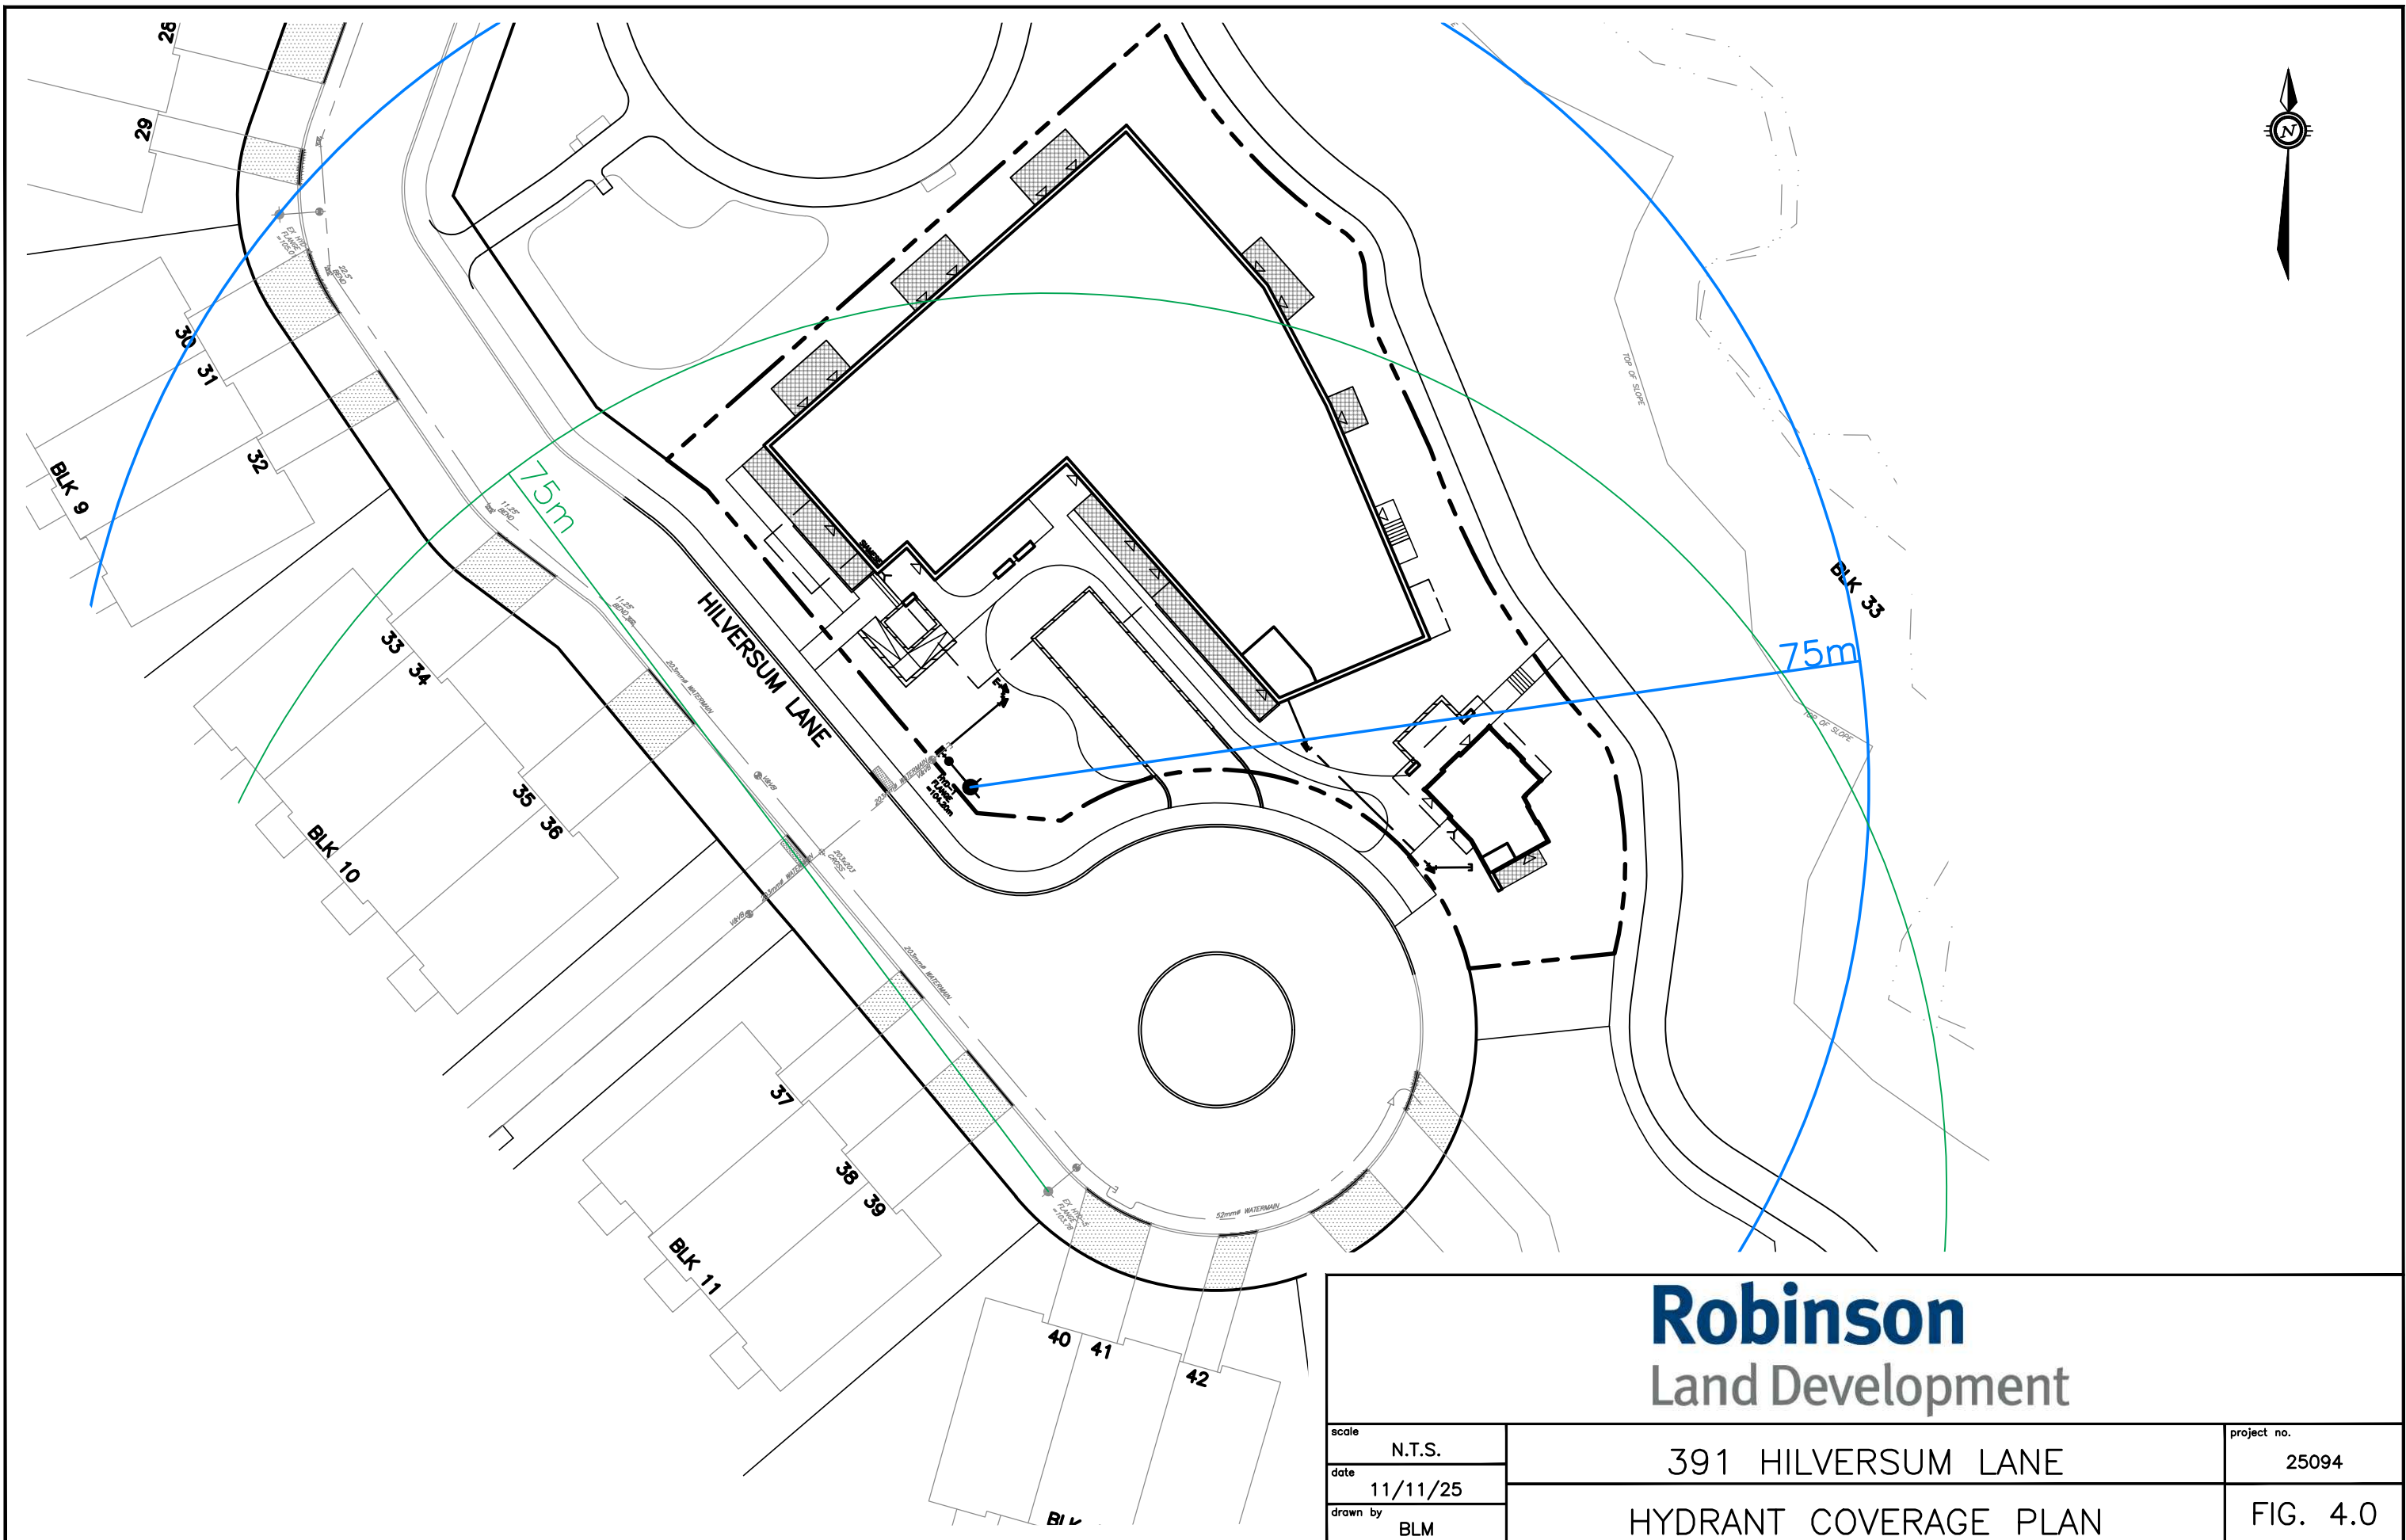

# Robinson

## Land Development

scale	N.T.S.	391 HILVERSUM LANE	project no.	25094
date	11/11/25		HYDRANT COVERAGE PLAN	FIG. 4.0
drawn by	BLM			

Appendix D

Robinson Report Excerpts

Huntley Hollow Sanitary  
Sewer Design Sheet

Huntley Hollow Sanitary Drainage Area  
Plan (DWG. 19008-SAN1)

Appendix 4-A

Sanitary Sewer Design Sheet

- *Inflow and infiltration comprise a significant portion of the current instantaneous flow, likely due to the low population density of the Village of Carp.*
- *Flow increases due to future development will result in an estimated total instantaneous peak flow of 77.827 L/s – 94.197 L/s, depending if measured values or annual values are used.*
- *The forcemain operates well within its maximum operating and maximum surge pressures in the existing configuration, with significant headroom available on a pressure basis to increase the station capacity.*
- *Hydraulic evaluation (transient analysis) will be required to determine the maximum flowrate possible through the existing forcemain.”*

*Technical Memorandum #2 (prepared by RVA, dated March 2022)*

*With respect to capacity expansion, transient analysis evaluation determined that the maximum flow that can be safely conveyed by the existing forcemain at the wastewater pumping station is 75 L/s.*

*Functional Design Report (prepared by RVA, dated July 2022)*

*The existing piping and control devices within the station are suitable for use with the new pumps at the target flowrate of 75 L/s.*

*With regards to the pumping station, the proposed upgrades include replacement of pumps, MCC, and upgrades to address NFPA820 issues including HVAC replacement, replacement of non-rated electrical components and equipment, and building layout modifications.*

*The proposed improvements are intended to provide a short term upgrade to the water treatment facility and wastewater pumping station, to improve the reliability of both facilities, provide additional capacity to allow for development within the catchment area of the facilities, and ensure compliance with NFPA 820 requirements. It is understood that the long term plan for the water treatment facility and the pumping station involves significant capacity expansion, including twinning the sewage forcemain and potentially connecting the village of Carp to the City’s main water distribution system, all of which will be examined as part of a separate assignment and are not included in the scope of work for this assignment. [source: RVA Report]*

As identified in the Draft Conditions (condition 29; provided in **Appendix A**), the construction of buildings may be restricted on certain lots and/or blocks until such time as municipal servicing capacity is available. The City acknowledges that, as long as the Owner continues to develop the property in a continuous, timely and orderly manner, any and all available servicing capacity shall be allocated to this development (along with other developments given the same priority). Only after sufficient servicing capacity is available beyond the requirements of this development, shall the City assign the capacity to other developments.

The City confirmed via email that based on some short-term upgrades that will be completed soon at the WWPS, the first phase of the proposed development should be able to be accommodated within the Village system. Refer to correspondence with the City in **Appendix C**.

## **6.2 Sanitary Sewer Design**

A new municipal sanitary sewer system with connections to the existing village system will be required to service the proposed development for sewage flows. The sanitary sewer

system for the proposed development will provide a total of two connections to the existing sanitary systems as follows:

- A connection to the existing 250 mm diameter sanitary sewer on Carp Road via the unopened John Street road allowance (i.e. block of land located between 3740 Carp Road and 422 Donald B. Munro Drive); to be completed as part of Phase 1).
- A connection to the existing 250 mm diameter sanitary sewer on Langstaff Drive via Street 2; to be completed as part of Phase 2.

The proposed municipal sanitary sewers have been designed to be 200 mm in diameter. Each townhouse unit will be serviced with individual 135 mm sanitary services. The apartment blocks (to be developed under separate site plan applications) will be provided with 200 mm diameter sanitary sewer stubs. Population densities for the apartment blocks have been established based on assumed unit counts provided by the Developer.

The sanitary sewer system has been designed using the following parameters in keeping with the current OSDG:

Average Residential Flow	280 L/cap/day
Peaking Factor for Residential Flow (Harmon Formula, Max. = 4.0, Min. = 2.0, P = Population in 1000's)	$1 + (14 / (4 + P^{1/2})) \times 0.80$
Harmon Correction Factor	0.8
I/I Dry	0.05 L/s/ha
I/I Wet	0.28 L/s/ha
I/I Total	0.33 L/s/ha
Population Density (townhouse units)	2.7 persons/unit
Population Density (apartment units)	2.1 persons/unit
Minimum Full Flow Velocity	0.60 m/s
Maximum Full Flow Velocity	3.0 m/s
Minimum Pipe Diameter	200 mm

The peak sanitary design flow (Phase 1) to the existing 250 mm diameter sanitary sewer on Carp Road has been calculated as follows:

Population = 264.3 persons

Peaking Factor = **3.48**

Peak Population Flow = (3.48) x (264.3 persons) x (280 L/cap/day) / 86400 s/day = **2.98 L/s**

Extraneous Flow = (4.80 ha) x (0.33 L/sha) = **1.58 L/s**

Peak Design Flow = (2.98 L/s) + (1.58 L/s) = **4.57 L/s**

The peak sanitary design flow (Phase 2) to the existing 250 mm diameter sanitary sewer on Langstaff Drive has been calculated as follows:

Population = 223.2


Peaking Factor = **3.50**

Peak Population Flow = (3.50) x (223.2 persons) x (280 L/cap/day) / 86400 s/day = **2.53 L/s**

Extraneous Flow = (1.70 ha) x (0.33 L/sha) = **0.56 L/s**

Peak Design Flow = (2.53 L/s) + (0.56 L/s) = **3.10 L/s**



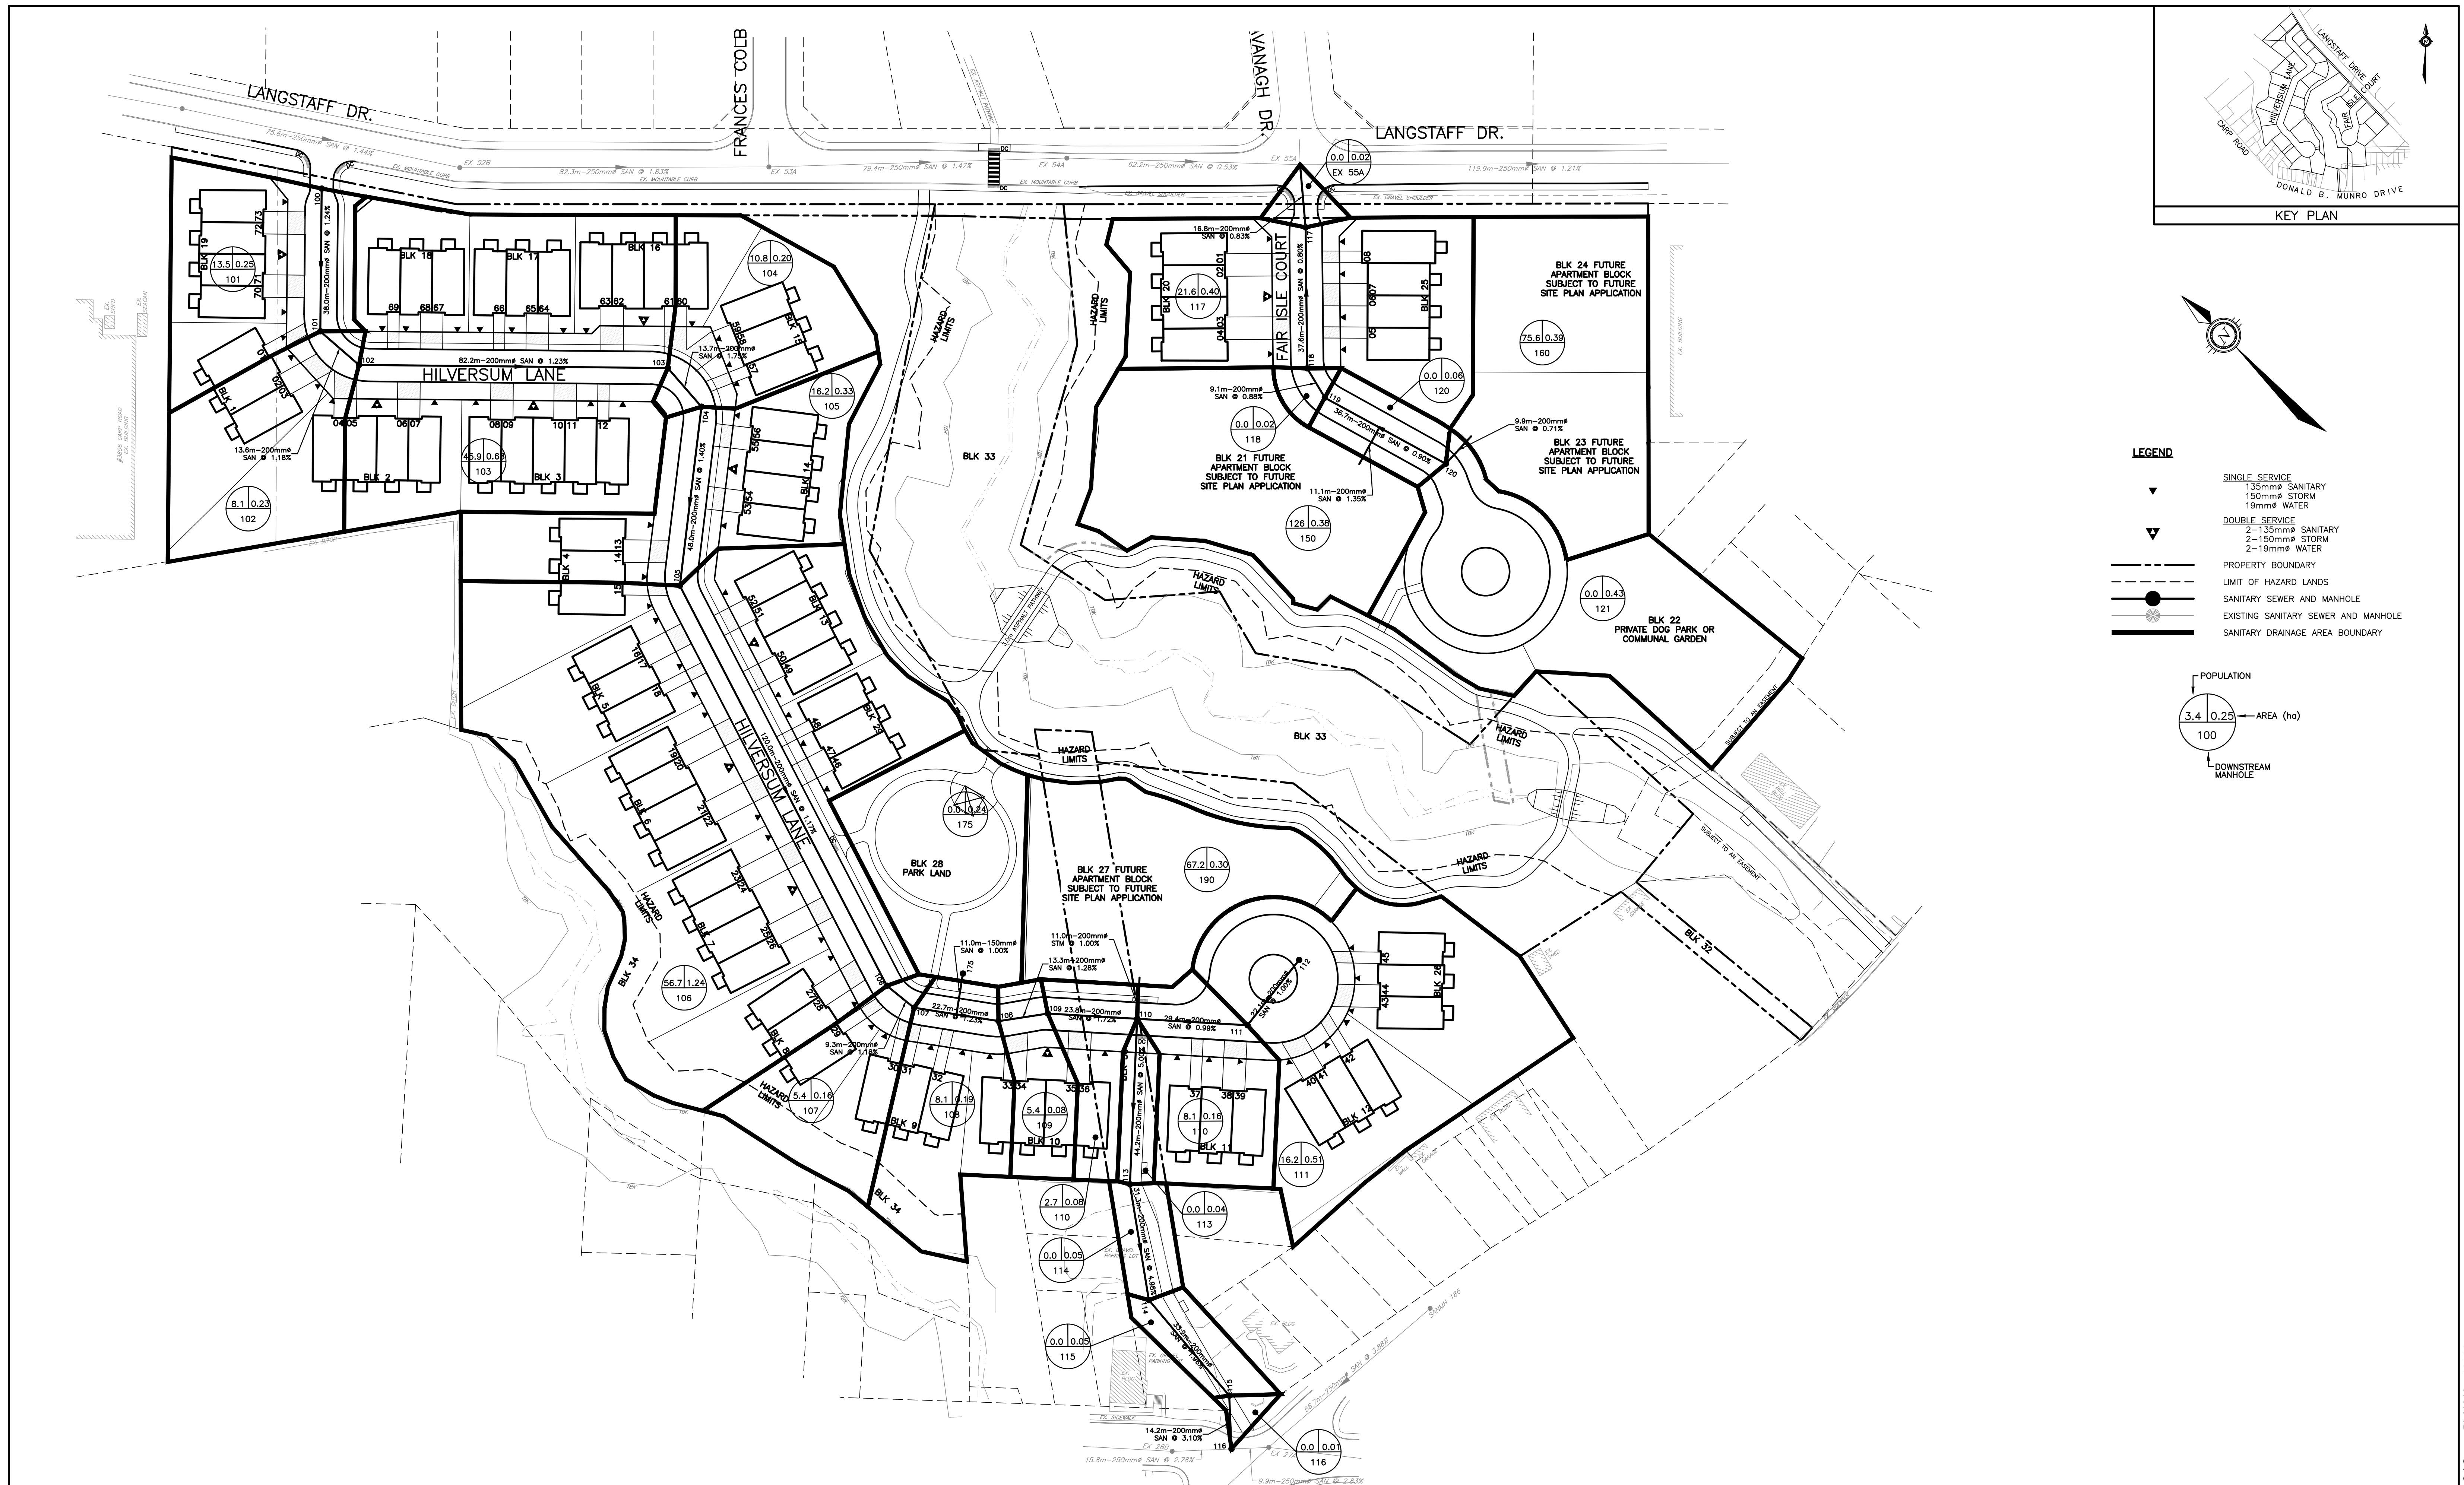


**NOTES**

THE POSITION OF ALL POLE LINES, CONDUITS, WATERMANS, SEWERS AND OTHER UNDERGROUND AND OVERGROUND UTILITIES AND STRUCTURES IS NOT NECESSARILY SHOWN ON THE CONTRACT DRAWINGS, AND WHERE SHOWN, THE ACCURACY OF THE POSITION OF SUCH UTILITIES AND STRUCTURES IS NOT GUARANTEED. BEFORE STARTING WORK, DETERMINE THE EXACT LOCATION OF ALL SUCH UTILITIES AND STRUCTURES AND ASSUME ALL LIABILITY FOR DAMAGE TO THEM.

GEODETIC SURVEY DERIVED FROM COSINE STATION 0011968U054. LOCATION DESCRIPTION: OLD HIGHWAY 17 BRIDGE OVER CARP RIVER ON CARP-STITTSVILLE ROAD, 0.2 KM SOUTH OF C.N.R. CROSSING IN VILLAGE OF CARP, TABLET IN TOP OF WEST WALL, 30 CM FROM NORTH END, 24 CM FROM WEST EDGE. VERTICAL CONTROL DATA, DATUM: CGVD28/78, FIRST ORDER, ELEVATION: 93.861. COORDINATE SYSTEM: MTM ZONE 9; NAD 83 DATUM (CAN83-9)

NO.	REVISION DESCRIPTION	DATE	BY
7	ISSUED FOR MECP ECA	23/09/24	BLM
6	ISSUED FOR PHASE 1 TENDER	06/09/24	BLM
5	REVISED PER CITY COMMENTS	12/07/24	BLM
4	REVISED PER CITY COMMENTS	28/05/24	BLM
3	REVISED PER CITY COMMENTS	22/03/24	BLM
2	REVISED PER CITY COMMENTS	09/11/23	BLM
1	ISSUED FOR REVIEW	24/05/23	BLM

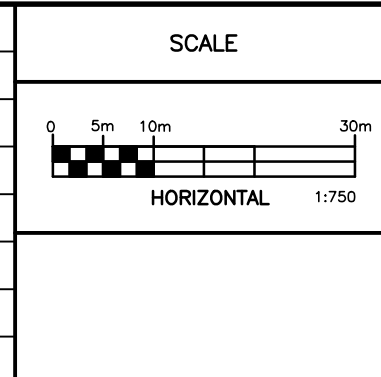

**Robinson**  
Land Development

CONSULTING ENGINEERS  
350 PALLADIUM DRIVE  
KANATA, ONTARIO K2V 1A8  
TELEPHONE (613) 592-6060

DESIGN	JHB
CHECKED	BLM
DRAWN	JHB
CHECKED	BLM
APPROVED	BLM

**INVERNESS HOMES**  
38 AURIGA DRIVE, SUITE 200  
OTTAWA, ON K2E 8A6

**147 LANGSTAFF DRIVE**  
CARP, ON

**SANITARY DRAINAGE AREA PLAN**

PROJECT No.	19008
SURVEY	RLD
DATED	SEPTEMBER 2024
DWG. No.	19008-SAN1

APPENDIX 4-A

DAILY SEWAGE FLOW FOR VARIOUS ESTABLISHMENTS

---

**APPENDIX 4-A**  
DAILY SEWAGE FLOW FOR VARIOUS TYPES OF ESTABLISHMENTS

## APPENDIX 4-A

## DAILY SEWAGE FLOW FOR VARIOUS ESTABLISHMENTS

## From The MOE Guidelines (\* indicates adapted for Ottawa)

ITEM	UNIT OF MEASURE	DAILY VOLUME IN LITRES
<b>AIRPORTS</b>		
- Not including food	per passenger	20
- Catering	per meal served	12
- Employees	per person	40
<b>ASSEMBLY HALLS</b>		
- Where no kitchen or meals provided	per person	8
- With varying facilities provided (range)	per person	8-36
<b>BAR OR COCKTAIL LOUNGE</b>		
- Separate establishment Minimum food service	per seat	125
- Part of a hotel or motel	per seat	70
- Customer	per customer	8
- Staff	per employee	50
<b>BEAUTY SALON</b>	per station	650
	per person	130
<b>BOWLING ALLEYS</b>		
- With no bar or restaurant	per alley	400
- With bar and/or restaurant	per alley	800
<b>CAMPS</b>		
- Day camps – no meals	per person	50
- Day & night camps	per person	150
- Primitive camps	per person	40
- Summer Camps with showers, Toilets, handwashing & cooking	per person	150
- as above without flush toilet	per person	75
- Construction camps – Flush toilet	per person	200
- No Flush toilet	per person	125
- Migrant workers camp – central Bathroom	per person	125
- Youth camps	per person	200
- Resort camps – limited pumping	per person	200
- Resort camps – non resident staff	per person	50
- Luxury camps	per person	400
<b>CAMPGROUNDS, TENT AND TRAILER PARKS</b>		
<i>Site with water and sewer connection For recreational vehicles (e.g. trailer And motor homes)-TRL Sites</i>		
• Sewer connected to sewage system (SS) At nearby comfort station (CS)	per site	375(475)-425(525)

## APPENDIX 4-A

## DAILY SEWAGE FLOW FOR VARIOUS ESTABLISHMENTS

ITEM	UNIT OF MEASURE	DAILY VOLUME IN LITRES
<ul style="list-style-type: none"> <li>• Sewer connected to a SS other than the one at SC               <ul style="list-style-type: none"> <li>- sewage generated at the CS</li> <li>- sewage to connected SS when CS is available</li> <li>- sewage to connected SS when no CS available</li> </ul> </li> </ul>	<ul style="list-style-type: none"> <li>per site</li> <li>per site</li> <li>per site</li> </ul>	<ul style="list-style-type: none"> <li>275-375</li> <li>100(200)-60(150)</li> <li>125(425)</li> </ul>
<i>Sites with no sewer connections.</i>		
<i>Water supplied by a connection or From a nearby faucet</i>		
<ul style="list-style-type: none"> <li>• sewage generated at a nearby CS</li> <li>• sewage to vehicle tanks (TRL sites)</li> <li>• Grey water to nearby Class 2 SS</li> </ul>	<ul style="list-style-type: none"> <li>per site</li> <li>per site</li> <li>per site</li> </ul>	<ul style="list-style-type: none"> <li>275-425</li> <li>60(150)-100(400)</li> <li>15-25</li> </ul>
For more details on designs flows and related assumptions see Section 14-2-16 and Appendix 14.2.1. Figures in brackets are for tank design.		
<b>(CAR) WASH</b>		
<ul style="list-style-type: none"> <li>- Hand wash</li> <li>- Truck wash</li> </ul>	<ul style="list-style-type: none"> <li>per car</li> <li>per truck</li> </ul>	<ul style="list-style-type: none"> <li>200</li> <li>400</li> </ul>
<b>CHURCHES</b>		
<ul style="list-style-type: none"> <li>- With kitchen facilities</li> <li>- No kitchen facilities</li> <li>- Kitchen wastes – paper service</li> <li>- Kitchen wastes – normal service</li> </ul>	<ul style="list-style-type: none"> <li>per sanctuary seat</li> <li>per sanctuary seat</li> <li>per meal</li> <li>per meal</li> </ul>	<ul style="list-style-type: none"> <li>30</li> <li>15</li> <li>5</li> <li>15</li> </ul>
<b>COUNTRY CLUBS</b>		
<ul style="list-style-type: none"> <li>- Residents</li> <li>- Non residents – no meals</li> <li>- Showers during use</li> <li>- Water closets</li> <li>- Wash basins</li> <li>- Urinals – hand flush</li> <li>- Showers</li> <li>- Day staff</li> </ul>	<ul style="list-style-type: none"> <li>per person</li> <li>per person</li> <li>per fixture</li> <li>per fixture</li> <li>per fixture</li> <li>per person</li> <li>per person</li> </ul>	<ul style="list-style-type: none"> <li>375</li> <li>100</li> <li>1800</li> <li>550</li> <li>350</li> <li>350</li> <li>20</li> <li>150</li> </ul>
<b>DANCE HALLS</b>		
<ul style="list-style-type: none"> <li>- Hall – washrooms only-per day in use</li> <li>- Dance hall restaurant</li> <li>- Dance hall bar</li> <li>- Dance hall plus restaurant plus bar</li> </ul>	<ul style="list-style-type: none"> <li>per m<sup>2</sup></li> <li>per seat</li> <li>per seat</li> <li>per patron</li> </ul>	<ul style="list-style-type: none"> <li>15</li> <li>125</li> <li>20</li> <li>150</li> </ul>

## APPENDIX 4-A

## DAILY SEWAGE FLOW FOR VARIOUS ESTABLISHMENTS

ITEM	UNIT OF MEASURE	DAILY VOLUME IN LITRES
<b>DOG KENNELS</b>	per closure	75
<b>DINING HALLS</b> – see restaurants		
<b>DWELLINGS</b>		
- Single family houses, apartments Condominiums, cottages, etc.	per person	350
- Each dwelling unit of -	1 bedroom	275
- Each dwelling unit of -	2 bedrooms	1100
- Each dwelling unit of -	3 bedrooms	1600
- Each dwelling unit of -	4 bedrooms	2000
- Add for each bedroom over 4	per bedroom	300
- Boarding or Rooming houses	per person	200
- Boarding or Rooming houses without meals or laundry	per person	150
- Non resident staff	per person	40
- Luxury homes – 4 bedrooms	per residence	3000
- Luxury homes – 5 bedrooms	per residence	3500
- Luxury homes – add for each bedroom over 5		500
<b>EMPLOYEES – VARIOUS LOCATIONS</b>		
- Factory or plant workers per day or per shift – includes showers but no industrial	per person	125
- Factory or plant workers as above but no showers	per person	75
- Various buildings and places of Employment – e.g. store employees, Office workers – depends on facilities	per person	75 *
- Medical Office buildings, dental Offices and medical clinics		
- Doctors, nurses & medical staff	per person	275
- Office staff	per person	75
- Patients	per person	25

**HOTELS – See Motels**

## APPENDIX 4-A

## DAILY SEWAGE FLOW FOR VARIOUS ESTABLISHMENTS

ITEM	UNIT OF MEASURE	DAILY VOLUME IN LITRES
<b>INSTITUTIONS</b>		
- Hospitals – including laundry	per bed	1400 *
- Hospitals - excluding laundry	per bed	550
- Nursing homes & rest homes	per bed	450
- Other institutional residences	per person	400
<b>LAUNDRY</b>		
- Household type automatic washer Each use	per fill, wash and rinse	20
- Household type automatic washer Each use	as above plus permanent press	170
- Laundromat	per customer or per wash	170
- Laundromat per day	per machine	2000
- Auto washers in apartment bldgs	per machine	1200
<b>MOTELS AND HOTELS</b>		
Residential portion:		
- With full housekeeping facilities	per person	225
- With bath or toilet only (private)	per person	180
- With central bath only		150
No residential portions:		
- With dining room, add	per seat	125
- With bar or cocktail lounge, add	per seat	70
- Non resident staff, add	per person	40
<b>MOBILE HOME PARKS</b>		
- Mobile home – single bedroom	per unit	750
- Mobile home – 2 bedrooms	per unit	1000
- Mobile home – 3 bedrooms	per unit	1200
<b>PARKS, BEACHES, PICNIC GROUNDS, PUBLIC SWIMMING POOLS**</b>		
- Picnic and fairgrounds with Bathhouses showers and toilets	per person	50
- Picnic and fairgrounds Flush toilets only	per person	20
- Swimming pools & beaches with Bathrooms, showers and toilets	per person	40

\*\* *Varies with facilities provided. Based on parks and picnic grounds of about 75 people per acre*

## APPENDIX 4-A

## DAILY SEWAGE FLOW FOR VARIOUS ESTABLISHMENTS

ITEM	UNIT OF MEASURE	DAILY VOLUME IN LITRES
<b>RESTAURANTS AND DINING ROOMS</b>		
- Ordinary (not 24 hour) restaurant	per seat	125
- 24 hour restaurant	per seat	200
- 24 hour intercity freeway restaurant	per seat	375
- 24 hour intercity freeway restaurant with showers		400
- Auto dishwasher and/or waste disposer		
- ordinary restaurant	per seat	12
- 24 hour restaurant	per seat	24
- Kitchen and toilet wastes only	per seat	115
- Kitchen and toilet wastes	per patron	35 *
- Banquet rooms – each banquet	per seat	30
- Drive-in restaurants	per seat	125
- Drive-in - all paper service	per car space	60
- Drive-in - all paper service	per inside seat	60
- Taverns, bars and cocktail lounges With minimum food service	per seat	125
- Night club restaurant	per seat	175
<b>SCHOOLS</b>		
- Day school with cafeteria, gym And showers	per person	90
- Day school with cafeteria <u>or</u> Gym and showers	per person	60
- Day school without cafeteria or Gym and showers	per person	30
- Boarding schools	per resident	275
- Boarding schools non resident staff	per person	50
<b>SERVICE STATIONS</b>		
- Car servicing (one service bay)	per car	40
- Catch basins in garage floors for Floor cleaning	per basin	375
<b>SHOPPING CENTRES</b>		
- Retail stores – washrooms only	per square metre of store area	5
- Retail stores area – parking area	per parking space	6
- Retail store area – employees	per person	40
- Retail store area – toilet rooms	per toilet room	2000

## APPENDIX 4-A

## DAILY SEWAGE FLOW FOR VARIOUS ESTABLISHMENTS

<b>ITEM</b>	<b>UNIT OF MEASURE</b>	<b>DAILY VOLUME IN LITRES</b>
<b>THEATRES</b>		
- Drive-in theatres – no food service	per car space	20
- Drive-in theatres with food service	per car space	40
- Auditoriums or theatres – no food	per seat	20
- Movie theatre	per seat	15

**MISCELLANEOUS WATER USE ESTIMATES**  
**FOR SEWAGE FLOW COMPUTATIONS**

<b><u>DETAILS</u></b>	<b><u>UNITS</u></b>	<b><u>ESTIMATED WATER SUPPLY NEEDS PER UNITS (LITRES)</u></b>
1. Showers		
(a) Golf clubs	per person	40
(b) Public parks, etc.	per fixture per hour of use	575
2. Water Closets – Public parks, etc.	per fixture per hour of use	150
3. Wash basins	per fixture per day	375
4. Urinals (hand flush) Public parks, etc.	per fixture per hour Of use	375
5. Whirlpools type baths depends on make and model.		
- Types discharging after Each use	per use	130-680
- Re-circulating type	per filling (or discharge)	1300 and up

LOCATION			APARTMENT UNIT COUNT			RESIDENTIAL FLOW						CLUB HOUSE					INFILTRATION			PEAK DESIGN FLOW (L/s)	PIPE							
STREET	FROM MH	TO MH	BACHELOR	1-BEDROOM	2-BEDROOM	INDIVIDUAL		CUMULATIVE		PEAK FACTOR	PEAK POP. FLOW (L/s)	WATER CLOSET DEMAND (L/s)	ACCU. DEMAND (L/s)	WASH BASIN DEMAND (L/s)	ACCU. DEMAND (L/s)	PEAK FACTOR	PEAK FLOW (L/s)	AREA (ha)	ACCU. AREA (ha)		EXTRAN. FLOW (L/s)	LENGTH (m)	DIAMETER (mm)	SLOPE (%)	CAPACITY (L/s)	FULL FLOW VELOCITY (m/s)	EXCESS CAPACITY (L/s)	PERCENT FULL
						POP.	AREA (ha)	POP.	AREA (ha)																			
<b>TO HILVERSUM LANE SANITARY SEWER</b>																												
PRIVATE	CLUB HOUSE	BLDG				0.0	0.06	0.0	0.06	3.80	0.00	0.013	0.013	0.008	0.008	3.68	0.08	0.06	0.06	0.02	0.10	19.2	135.00	1.04	11.74	0.82	11.64	0.82
PRIVATE	BLDG	STUB	2	20	17	66.5	0.25	66.5	0.31	3.63	0.78	0.000	0.013	0.000	0.008	3.68	0.08	0.25	0.31	0.10	0.96	3.7	201.16	1.08	34.65	1.09	33.69	2.77

<b>DESIGN PARAMETERS</b>																											
Average Daily Flow = 280 L/person/day														Miscellaneous Water Use Estimates (Appendix 4-A):													
Institutional Flow = 28,000 L/ha/day														Water Closet 550 L/per fixture/per day													
Industrial Flow =														Wash Basin 350 L/per fixture/per day													
Maximum Residential Peak Factor = 4.0														Per Unit Populations:													
Harmon - Correction Factor (K) = 0.8														Single Family 3.4 persons/unit													
Club House Peak Factor = 3.68														Semi-detached 2.7 persons/unit													
Extraneous Flow = 0.33 L/s/ha														Duplex 2.3 persons/unit													
Minimum Velocity = 0.6 m/s														Townhouse 2.7 persons/unit													
Maximum Velocity = 3.0 m/s														Apartments:													
														Bachelor 1.4 persons/unit													
														1 Bedroom 1.4 persons/unit													
														2 Bedroom 2.1 persons/unit													
														3 Bedroom 3.1 persons/unit													
														Average Apt. 1.8 persons/unit													
														Fixture Counts:													
														Water Closet Fixtures 2													
														Wash Basin Fixtures 2													

## Appendix E

Robinson Report Excerpts

Huntley Hollow Storm  
Sewer Design Sheet

Huntley Hollow Storm Drainage Area  
Plan (DWG. 19008-STM1)

Runoff Coefficient Calculations

Storm Sewer Design Sheet

Storm Drainage Area Plan  
(DWG. 25094-STM1)

outlet for the property (i.e. the existing SWM ravine). The proposed storm sewer system will consist of gravity storm sewers ranging from 250 mm to 750 mm in diameter. Each townhouse unit will be serviced with individual 150 mm storm services. The apartment blocks (to be developed under separate site plan applications) will be provided with storm sewer stubs which have been sized based on the block area and an assumed runoff coefficient. The storm sewer system for the proposed development will provide a total of three outlets to the existing SWM ravine as follows:

- A 750 mm diameter storm sewer outlet via Street 1 and Block 31 servicing the Phase 1 lands (to be completed as part of Phase 1).
- A 250 mm diameter storm sewer outlet via Block 26 servicing rear yard drainage from Blocks 11, 12 and 26 within the Phase 1 lands (to be completed as part of Phase 1).
- A 450 mm diameter storm sewer outlet via Street 2 servicing the Phase 2 lands (to be completed as part of Phase 2).

The storm sewer system has been designed using the following parameters:

Design Level of Service	2-Yr event for local roads
Inlet Time of Concentration	10 minutes
Rainfall Intensity	City of Ottawa IDF curve equations
Manning's Roughness Coefficient	0.013
Minimum Full Flow Velocity	0.80 m/s
Maximum Full Flow Velocity	3.0 m/s
Minimum Pipe Diameter	250 mm
Runoff Coefficients	0.90 for impervious areas (hard surface area and roofs) 0.80 for gravel surfaces 0.20 for pervious areas

The peak storm sewer design flows to the SWM ravine have been calculated using the Rational Method and are summarized in **Table 7.1** below.

**Table 7.1: 2-Year Peak Storm Sewer Design Flows**

SWM Ravine Cell Outlet	Outlet Pipe Diameter (mm)	2.78AC	Time of Conc. (min)	2-Yr Rainfall Intensity (mm/hr)	2-Yr Peak Design Flow (L/s)
G4	750	5.22	14.56	62.84	327.75
G4	250	0.38	15.00	61.77	23.26
G4	450	2.48	11.53	71.40	177.20

Notes:

1. Rainfall intensity calculated using City of Ottawa IDF curve equations.
2. Runoff coefficients calculated based on maximum zoning requirements. Refer to sample calculations under **Appendix D**.
3. Flows calculated using the Rational Method. Refer to Storm Sewer Design Sheet under **Appendix D**.

At the Site Plan Applications stage, the minor system flows from the apartment blocks will need to be controlled to the allocated rates. Allocated minor system flows from the apartment blocks have been summarized in **Table 7.2** below.

**Table 7.2: Allocated Minor System Flows from Apartment Blocks**

Block ID	Area (ha)	Runoff Coefficient	Peak Design Flow (L/s)
21	0.37	0.69	54.99
23-24	0.38	0.69	56.56
27	0.31	0.69	46.26

Notes:

1. Flows calculated using the Rational Method. Refer to Storm Sewer Design Sheet under **Appendix D**.

The current zoning provisions for the apartment blocks have a maximum 50% lot coverage requirement which equates to a runoff coefficient of 0.55. To be conservative and to account for any potential zoning amendments the runoff coefficients for the apartment blocks have been increased to 0.69 (70% impervious). Refer to Storm Drainage Area Plan (DWG. 19008-STM1), runoff coefficient calculations, and the Storm Sewer Design Sheets provided in **Appendix D** for more details.

As requested by the City, a 300 mm diameter storm service terminating at a catch basin manhole structure (2.0 m inside the property line) has been provided for the park block (Block 28). Minor system flows from the entire park block have been allocated for within the proposed storm sewer system on Street 1. To ensure a conservative design, the major system flows from the park block have also been assumed to drain towards the roadway and not directly to the ravine.

## 7.2 Storm Sewer Outlet Design

The proposed storm sewer systems for Street 1 and Street 2 outlet to the existing SWM ravine upstream of existing control structure G4. The outlet reaches between the end of the storm sewer pipes and the ravine bottom have been assessed to ensure that there is adequate capacity to convey peak flows and that adequate protection for erosive forces is provided. Each outlet channel has been assessed based on the peak flow rate through the outlet pipe (i.e. calculated using PCSWMM). To convey the peak flow rates, each outlet channel is proposed to have a 2.5 m flat bottom width, with 3H:1V side slopes, and a total depth of 0.40 m. The proposed channel depth of 0.40 m provides a freeboard of over 0.30 m beyond the minimum channel depth required to convey the 100-year flow rates. Refer to outlet channel calculations under **Appendix D**.

As requested by the City, the pipe outlets have been assessed using USDA design charts. The USDA design charts provide recommended apron lengths and rip-rap sizing for outlet protection. For the Street 1 pipe outlet, the USDA design charts recommend an apron length of 5.2 m and a nominal rip-rap diameter of 0.15 m based on a pipe discharge rate of 1.1 m<sup>3</sup>/s (calculated using PCSWMM) and a 762 mm (30 inch) pipe diameter. Due to the natural topography of the ravine side slopes, the rip-rap treatment is proposed to extend to the bottom of the channel for a total length of 14.8 m. To further reduce erosive forces for the Street 1 pipe outlet, the headwall is proposed to include a pre-cast apron with energy dissipators (OPSD 804.040). The total width of rip-rap treatment will be 5.0 m. For the Street 2 pipe outlet, the USDA design charts recommend an apron length of 5.4 m and a nominal rip-rap diameter of 0.20 m based on a pipe discharge rate of 0.570 m<sup>3</sup>/s (calculated using PCSWMM) and a 457 mm (18 inch) pipe diameter. Due to the natural topography of the

**STORM SEWER DESIGN SHEET**  
for  
**147 LANGSTAFF DRIVE, CARP**

LOCATION				AREA (ha)	C	2 YR		TIME OF CONC. (min)	2 YR RAINFALL INTENSITY (mm/hr)	2 YR PEAK FLOW (L/s)	PROPOSED SEWER						
DRAINAGE AREA	STREET NAME	FROM MH	TO MH			INDIV. 2.78AC	ACCUM. 2.78AC				PIPE DIA. (mm)	GRADE (%)	LENGTH (m)	CAPACITY (L/s)	FULL FLOW VELOCITY (m/s)	TIME OF FLOW (min)	2-YR PERCENT FULL
<b>TO SWM RAVINE CELL G4:</b>																	
	STREET 1	200	201	0.00	0.00	0.00	0.00	10.00	76.81	0.00	251.46	1.25	37.7	67.60	1.36	0.46	0%
	STREET 1	201	202	0.00	0.00	0.00	0.00	10.46	75.08	0.00	251.46	1.18	14.4	65.68	1.32	0.18	0%
STM21	STREET 1	RYCBT 38	MAIN	0.33	0.45	0.41	0.41	15.00	61.77	25.61	251.46	1.01	31.7	60.76	1.22	0.43	42%
	STREET 1	RYCB 23	MAIN	0.00	0.00	0.00	0.41	15.43	60.77	25.20	251.46	3.50	5.3	113.11	2.28	0.04	22%
STM1 + STM2	STREET 1	202	203	0.52	0.74	1.07	1.48	10.64	74.42	110.47	366.42	1.24	82.2	183.74	1.74	0.79	60%
	STREET 1	203	204	0.00	0.00	0.00	1.48	11.43	71.72	106.46	366.42	1.21	14.0	181.50	1.72	0.14	59%
	STREET 1	204	205	0.00	0.00	0.00	1.48	11.56	71.28	105.80	366.42	1.24	49.9	183.74	1.74	0.48	58%
STM3 + STM4 + STM5	STREET 1	205	206	0.83	0.73	1.68	3.17	12.04	69.76	220.96	457.00	1.23	116.9	329.82	2.01	0.97	67%
	STREET 1	206	207	0.00	0.00	0.00	3.17	13.01	66.90	211.89	457.00	1.16	8.6	320.29	1.95	0.07	66%
	STREET 1	207	208	0.00	0.00	0.00	3.17	13.08	66.69	211.24	457.00	1.23	22.8	329.82	2.01	0.19	64%
STM22	PARK	250	208	0.24	0.50	0.34	0.34	10.00	76.81	26.06	299.36	0.98	9.2	95.28	1.35	0.11	27%
	STREET 1	208	209	0.00	0.00	0.00	3.51	13.27	66.17	232.02	457.00	1.15	9.6	318.91	1.94	0.08	73%
STM6	STREET 1	209	210	0.24	0.72	0.48	3.99	13.36	65.94	262.85	533.00	0.80	26.1	400.89	1.80	0.24	66%
STM13	BLK 27	CAP	210	0.31	0.69	0.60	0.60	10.00	76.81	46.26	366.42	0.53	9.5	120.12	1.14	0.14	39%
	STREET 1	210	211	0.00	0.00	0.00	4.59	13.60	65.29	299.57	610.00	0.27	29.5	333.76	1.14	0.43	90%
STM7	STREET 1	211	OGS1	0.33	0.69	0.63	5.22	14.03	64.16	334.65	762.00	0.35	28.9	687.79	1.51	0.32	49%
	STREET 1	OGS1	212	0.00	0.00	0.00	5.22	14.35	63.35	330.43	762.00	0.43	20.8	762.36	1.67	0.21	43%
	STREET 1	212	HW1	0.00	0.00	0.00	5.22	14.56	62.84	327.75	762.00	0.34	8.7	677.90	1.49	0.10	48%
<b>TO SWM RAVINE CELL G4:</b>																	
STM8	STREET 2	220	221	0.19	0.80	0.42	0.42	10.00	76.81	32.04	251.46	1.30	37.8	68.93	1.39	0.45	46%
	STREET 2	221	222	0.00	0.00	0.00	0.42	10.45	75.10	31.33	251.46	1.26	9.5	67.87	1.37	0.12	46%
	STREET 2	222	223	0.00	0.00	0.00	0.42	10.57	74.68	31.15	251.46	1.28	18.7	68.40	1.38	0.23	46%
STM14	BLK 21	CAP	223	0.37	0.69	0.72	0.72	10.00	76.81	54.99	366.42	0.58	8.6	125.66	1.19	0.12	44%
STM11	STREET 2	RYCB 22	RYCB 21	0.09	0.59	0.15	0.15	15.00	61.77	9.44	251.46	3.50	6.0	113.11	2.28	0.04	8%
	STREET 2	RYCB 21	MAIN	0.00	0.00	0.00	0.15	15.04	61.66	9.43	251.46	3.50	6.3	113.11	2.28	0.05	8%
STM9	STREET 2	223	224	0.08	0.53	0.12	1.41	10.80	73.88	104.24	366.42	1.28	19.6	186.68	1.77	0.18	56%
STM15 + STM16	BLK 23/24	CAP	224	0.38	0.69	0.74	0.74	10.00	76.81	56.56	366.42	0.50	12.1	116.67	1.11	0.18	48%
STM10	STREET 2	224	OGS2	0.18	0.65	0.33	2.48	10.98	73.23	181.76	457.00	1.58	46.7	373.81	2.28	0.34	49%
	STREET 2	OGS2	225	0.00	0.00	0.00	2.48	11.32	72.08	178.89	457.00	0.46	15.2	201.70	1.23	0.21	89%
	STREET 2	225	HW2	0.00	0.00	0.00	2.48	11.53	71.40	177.20	457.00	0.61	8.2	232.27	1.42	0.10	76%
<b>TO SWM RAVINE CELL G4:</b>																	
STM12	BLK 26	CBMH 240	OUTLET	0.31	0.44	0.38	0.38	15.00	61.77	23.26	251.46	0.49	37.0	42.32	0.85	0.72	55%



**Design Parameters**

Notes:


- Rainfall intensity calculated using City of Ottawa IDF curve equations.
- Peak flows calculated using the Rational Method.  
 $Q = 2.78CIA$ , where:  
 Q = Peak Flow (L/s)  
 A = Drainage Area (ha)  
 I = Rainfall Intensity (mm/hr)  
 C = Runoff Coefficient
- Manning's roughness coefficient = 0.013
- Full flow velocity: MIN 0.8 m/s; MAX 3.0 m/s (City of Ottawa Sewer Design Guidelines, v.2012)

**IDF curve equations (Intensity in mm/hr)**

100 year Intensity	=	$1735.688 / (\text{Time in min} + 6.014)^{0.820}$
50 year Intensity	=	$1569.580 / (\text{Time in min} + 6.014)^{0.820}$
25 year Intensity	=	$1402.884 / (\text{Time in min} + 6.018)^{0.819}$
10 year Intensity	=	$1174.184 / (\text{Time in min} + 6.014)^{0.816}$
5 year Intensity	=	$998.071 / (\text{Time in min} + 6.053)^{0.814}$
2 year Intensity	=	$732.951 / (\text{Time in min} + 6.199)^{0.810}$

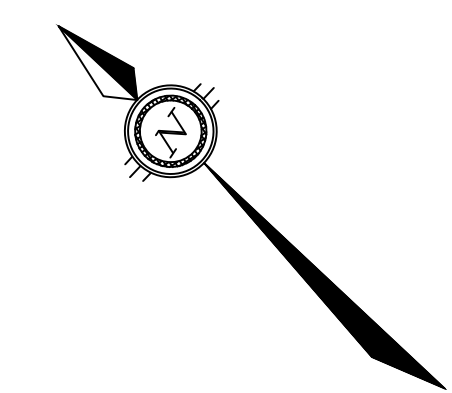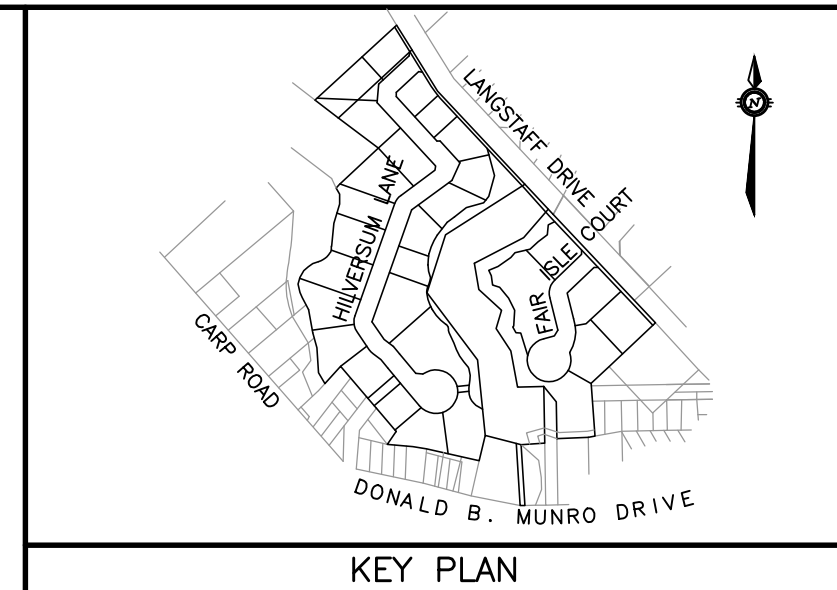


- LEGEND**
- PROPERTY BOUNDARY
  - - - LIMIT OF HAZARD LANDS
  - EXISTING STORM SEWER & MANHOLE
  - EXISTING CATCH BASIN
  - - - STORM SEWER & MANHOLE
  - ROADSIDE CATCH BASIN
  - ROADSIDE DOUBLE CATCH BASIN
  - LANDSCAPE CATCH BASIN ELBOW
  - LANDSCAPE CATCH BASIN TEE
  - - - SWALE
  - - - SWALE WITH 250mm $\phi$  SUBDRAIN
  - STORM DRAINAGE AREA BOUNDARY
  - ⇒ MAJOR OVERLAND FLOW ROUTE

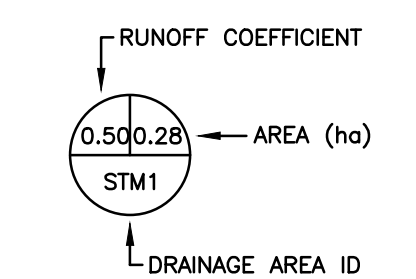

ALLOCATED MINOR SYSTEM FLOWS			
BLOCK ID	AREA (ha)	RUNOFF COEFFICIENT	MODELLED MINOR SYSTEM FLOW (L/s)
21	0.37	0.69	56
22	0.24	0.50	0
23	0.19	0.69	29
24	0.19	0.69	29
27	0.31	0.69	47
28	0.24	0.50	26

BLOCK ID	ALLOCATED MAJOR SYSTEM FLOWS		
	MAJOR SYSTEM FLOWS (L/s)		
	2-YR	5-YR	100-YR
21	0	32	116
22	21	31	65
23	0	13	53
24	0	14	54
27	0	22	87
28	0	4	54

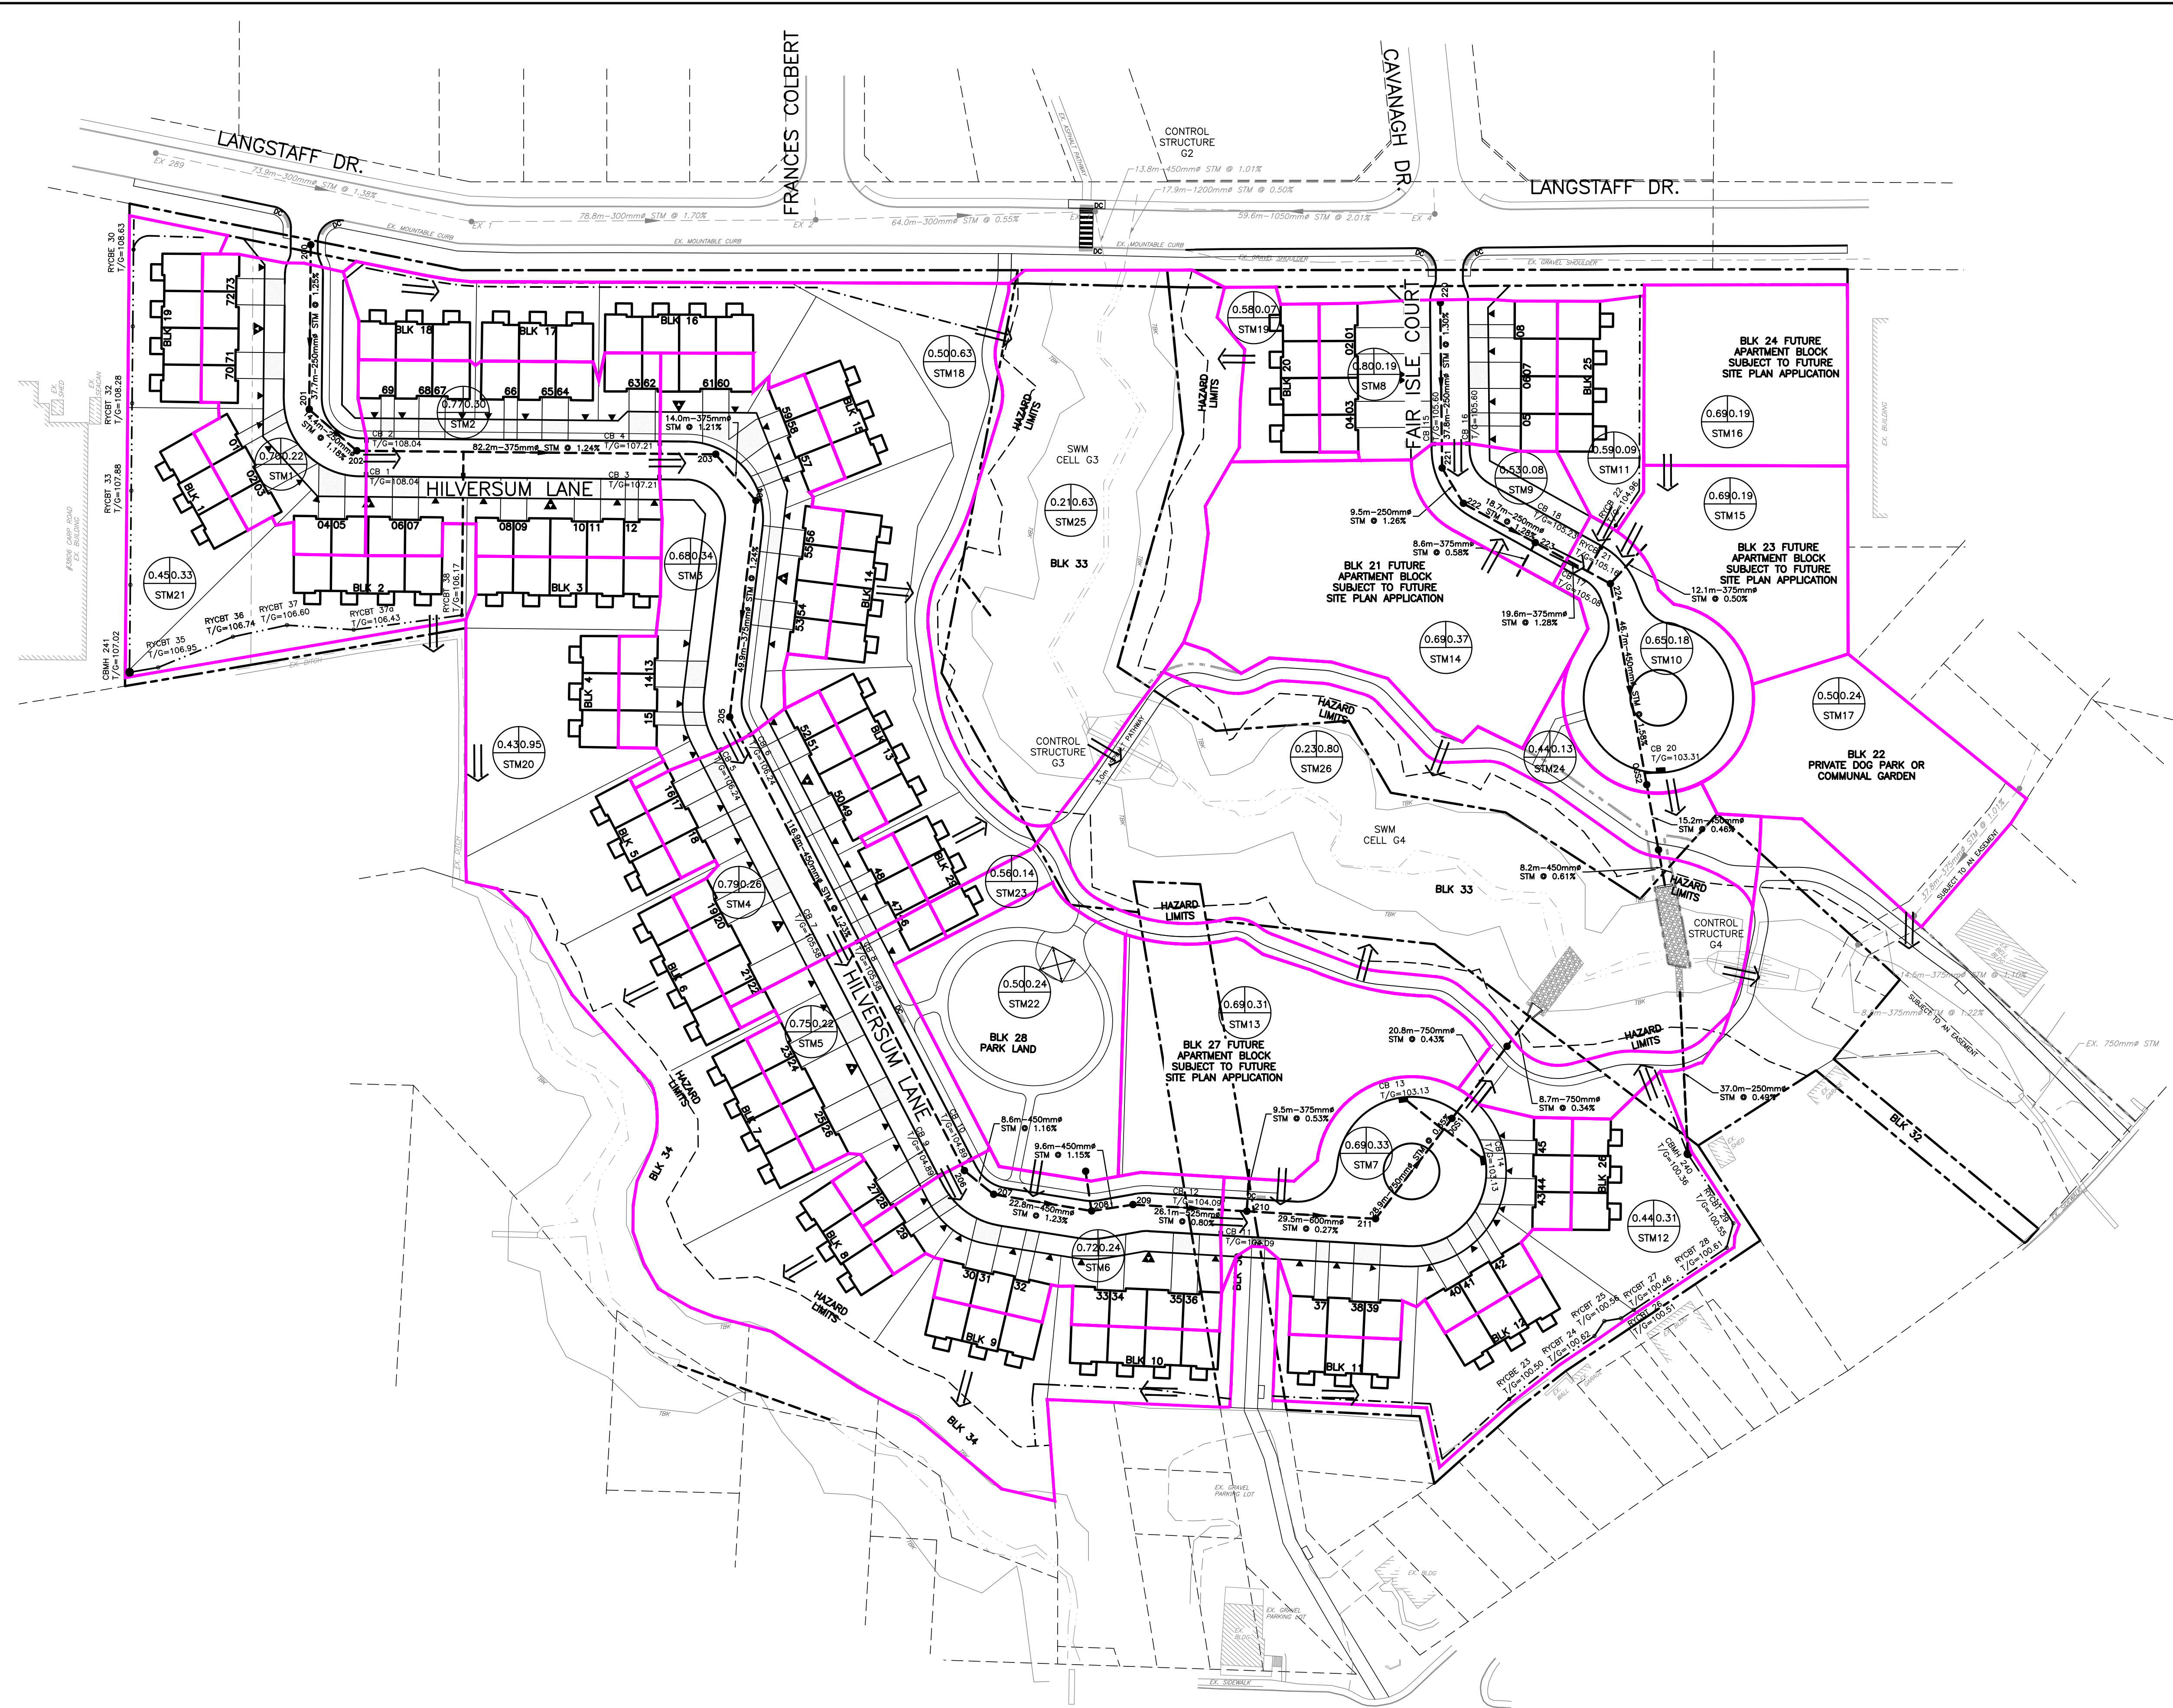


**NOTES**

THE POSITION OF ALL POLE LINES, CONDUITS, WATERMANS, SEWERS AND OTHER UNDERGROUND AND OVERGROUND UTILITIES AND STRUCTURES IS NOT NECESSARILY SHOWN ON THE CONTRACT DRAWINGS, AND WHERE SHOWN, THE ACCURACY OF THE POSITION OF SUCH UTILITIES AND STRUCTURES IS NOT GUARANTEED. BEFORE STARTING WORK, DETERMINE THE EXACT LOCATION OF ALL SUCH UTILITIES AND STRUCTURES AND ASSUME ALL LIABILITY FOR DAMAGE TO THEM.

GEODETIC SURVEY DERIVED FROM COSINE STATION 0011968U054. LOCATION DESCRIPTION: OLD HIGHWAY 17 BRIDGE OVER CARP RIVER ON CARP-STITTSVILLE ROAD, 0.2 KM SOUTH OF C.N.R. CROSSING IN VILLAGE OF CARP, TABLET IN TOP OF WEST WALL, 30 CM FROM NORTH END, 24 CM FROM WEST EDGE. VERTICAL CONTROL DATA, DATUM: CGVD28/78, FIRST ORDER, ELEVATION: 93.861. COORDINATE SYSTEM: MTM ZONE 9; NAD 83 DATUM (CAN83-9)

NO.	REVISION DESCRIPTION	DATE	BY
7	ISSUED FOR MECP ECA	23/09/24	BLM
6	ISSUED FOR PHASE 1 TENDER	06/09/24	BLM
5	REVISED PER CITY COMMENTS	12/07/24	BLM
4	REVISED PER CITY COMMENTS	28/05/24	BLM
3	REVISED PER CITY COMMENTS	22/03/24	BLM
2	REVISED PER CITY COMMENTS	09/11/23	BLM
1	ISSUED FOR REVIEW	24/05/23	BLM

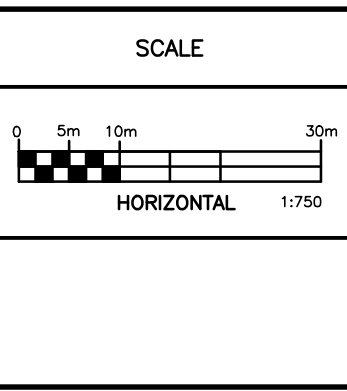

**Robinson**  
Land Development

CONSULTING ENGINEERS  
350 PALLADIUM DRIVE  
KANATA, ONTARIO K2V 1A8  
TELEPHONE (613) 592-6060

DESIGN	JHB
CHECKED	BLM
DRAWN	JHB
CHECKED	BLM
APPROVED	BLM

**INVERNESS HOMES**  
38 AURIGA DRIVE, SUITE 200  
OTTAWA, ON K2E 8A6

147 LANGSTAFF DRIVE  
CARP, ON

**STORM DRAINAGE AREA PLAN**

PROJECT No.	19008
SURVEY	RLD
DATED	SEPTEMBER 2024
DWG. No.	19008-STM1

**Runoff Coefficient Calculations**

Drainage Area ID	Impervious Area (ha)	Pervious Area (ha)	Gravel Area (ha)	Total Area (ha)	C	C (100 YR)	Percent Impervious (%)
R1	0.10	0.00	0.00	0.10	0.90	1.00	100.0
STM1	0.01	0.01	0.00	0.02	0.50	0.63	43.1
STM2	0.01	0.03	0.00	0.04	0.35	0.44	21.5
FF1	0.01	0.00	0.00	0.01	0.90	1.00	100.0
FF2	0.03	0.01	0.00	0.04	0.67	0.84	67.7
FF3	0.03	0.08	0.00	0.11	0.42	0.53	31.4

Runoff Coefficients:

C impervious = 0.90

C pervious = 0.20

C gravel = 0.80

C<sub>100</sub> = C \* 1.25 (Max. 1.0)

**Cummulative Runoff Coefficient Calculations**

Drainage Area ID	Impervious Area (ha)	Pervious Area (ha)	Gravel Area (ha)	Total Area (ha)	C	C (100 YR)	Percent Impervious (%)
R1 + FF1	0.11	0.00	0.00	0.11	0.90	1.00	100.0
MINOR SYSTEM	0.12	0.04	0.00	0.16	0.74	0.92	76.7
TO EX OGS	0.15	0.05	0.00	0.20	0.72	0.91	74.9
TOTAL SITE	0.18	0.13	0.00	0.31	0.62	0.77	59.3

**STORM SEWER DESIGN SHEET  
391 HILVERSUM LANE, VILLAGE OF CARP**

LOCATION			AREA (ha)	C	C (100 YR)	2-YR		100-YR		TIME OF CONC. (min)	2-YR RAINFALL INTENSITY (mm/hr)	2-YR PEAK FLOW (L/s)	100-YR RAINFALL INTENSITY (mm/hr)	100-YR PEAK FLOW (L/s)	100-YR RESTRICTED FLOW (L/s)	CUMULATIVE RESTRICTED FLOW (L/s)	PROPOSED SEWER							
DRAINAGE AREA	FROM MH	TO MH				INDIV. 2.78AC	ACCUM. 2.78AC	INDIV. 2.78AC	ACCUM. 2.78AC								PIPE DIA. (mm)	GRADE (%)	LENGTH (m)	CAPACITY (L/s)	FULL FLOW VELOCITY (m/s)	TIME OF FLOW (min)	2-YR PERCENT FULL	100-YR PERCENT FULL WITH RESTRICTED CONTROLS
<b>TO HILVERSUM LANE STORM SEWER</b>																								
R1 + FF1	BLDG	200	0.11	0.90	1.00	0.27	0.27	0.30	0.30	10.00	76.81	20.60	178.56	53.21	8.17	8.17	251.46	1.59	4.4	76.24	1.54	0.05	27%	11%
STM1	CB 1	200	0.02	0.50	0.63	0.02	0.02	0.03	0.03	10.00	76.81	1.79	178.56	5.20	7.40	7.40	201.16	3.01	11.3	57.85	1.82	0.10	3%	13%
STM2	CB 2	200	0.04	0.35	0.44	0.03	0.03	0.04	0.04	10.00	76.81	2.63	178.56	7.65	10.80	10.80	201.16	1.01	13.8	33.51	1.05	0.22	8%	32%
	200	EX210	0.00	0.00	0.00	0.00	0.33	0.00	0.37	10.22	75.98	24.75	176.59	65.33	0.00	26.37	366.42	0.53	8.8	120.12	1.14	0.13	21%	22%



**Design Parameters**

Notes:



- Rainfall intensity calculated using City of Ottawa IDF curve equations.
- Peak flows calculated using the Rational Method.  
 $Q = 2.78CIA$ , where:  
 Q = Peak Flow (L/s)  
 A = Drainage Area (ha)  
 I = Rainfall Intensity (mm/hr)  
 C = Runoff Coefficient
- Manning's roughness coefficient = 0.013
- Full flow velocity: MIN 0.8 m/s; MAX 3.0 m/s (City of Ottawa Sewer Design Guidelines, v.2012)

**IDF curve equations (Intensity in mm/hr)**

100 year Intensity =  $1735.688 / (\text{Time in min} + 6.014)^{0.820}$   
 50 year Intensity =  $1569.580 / (\text{Time in min} + 6.014)^{0.820}$   
 25 year Intensity =  $1402.884 / (\text{Time in min} + 6.018)^{0.819}$   
 10 year Intensity =  $1174.184 / (\text{Time in min} + 6.014)^{0.816}$   
 5 year Intensity =  $998.071 / (\text{Time in min} + 6.053)^{0.814}$   
 2 year Intensity =  $732.951 / (\text{Time in min} + 6.199)^{0.810}$

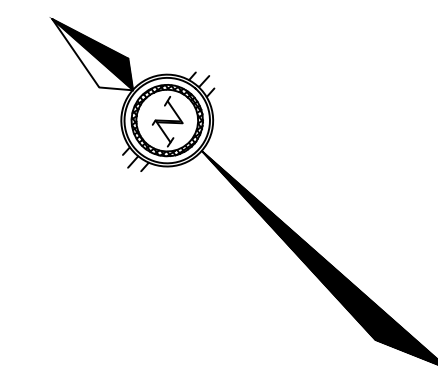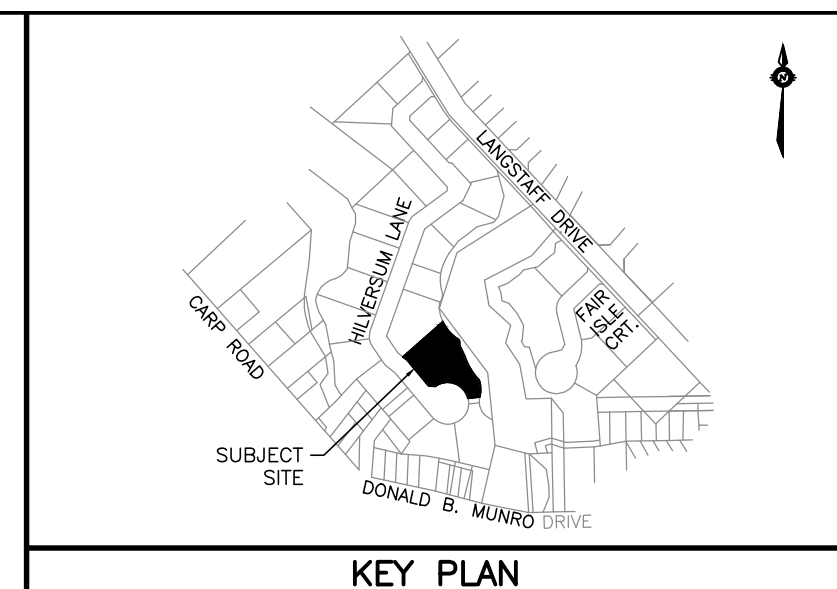

- LEGEND**
- PROPERTY BOUNDARY
  - LIMIT OF HAZARD LANDS
  - 15.0m TOP OF SLOPE SETBACK
  - TURTLE HABITAT SETBACK (AS PER EIS)
  - EXISTING CATCH BASIN
  - EXISTING STORM SEWER & MANHOLE
  - CATCH BASIN
  - STORM SEWER & MANHOLE
  - ▽ BUILDING ENTRANCE
  - STORM DRAINAGE AREA BOUNDARY

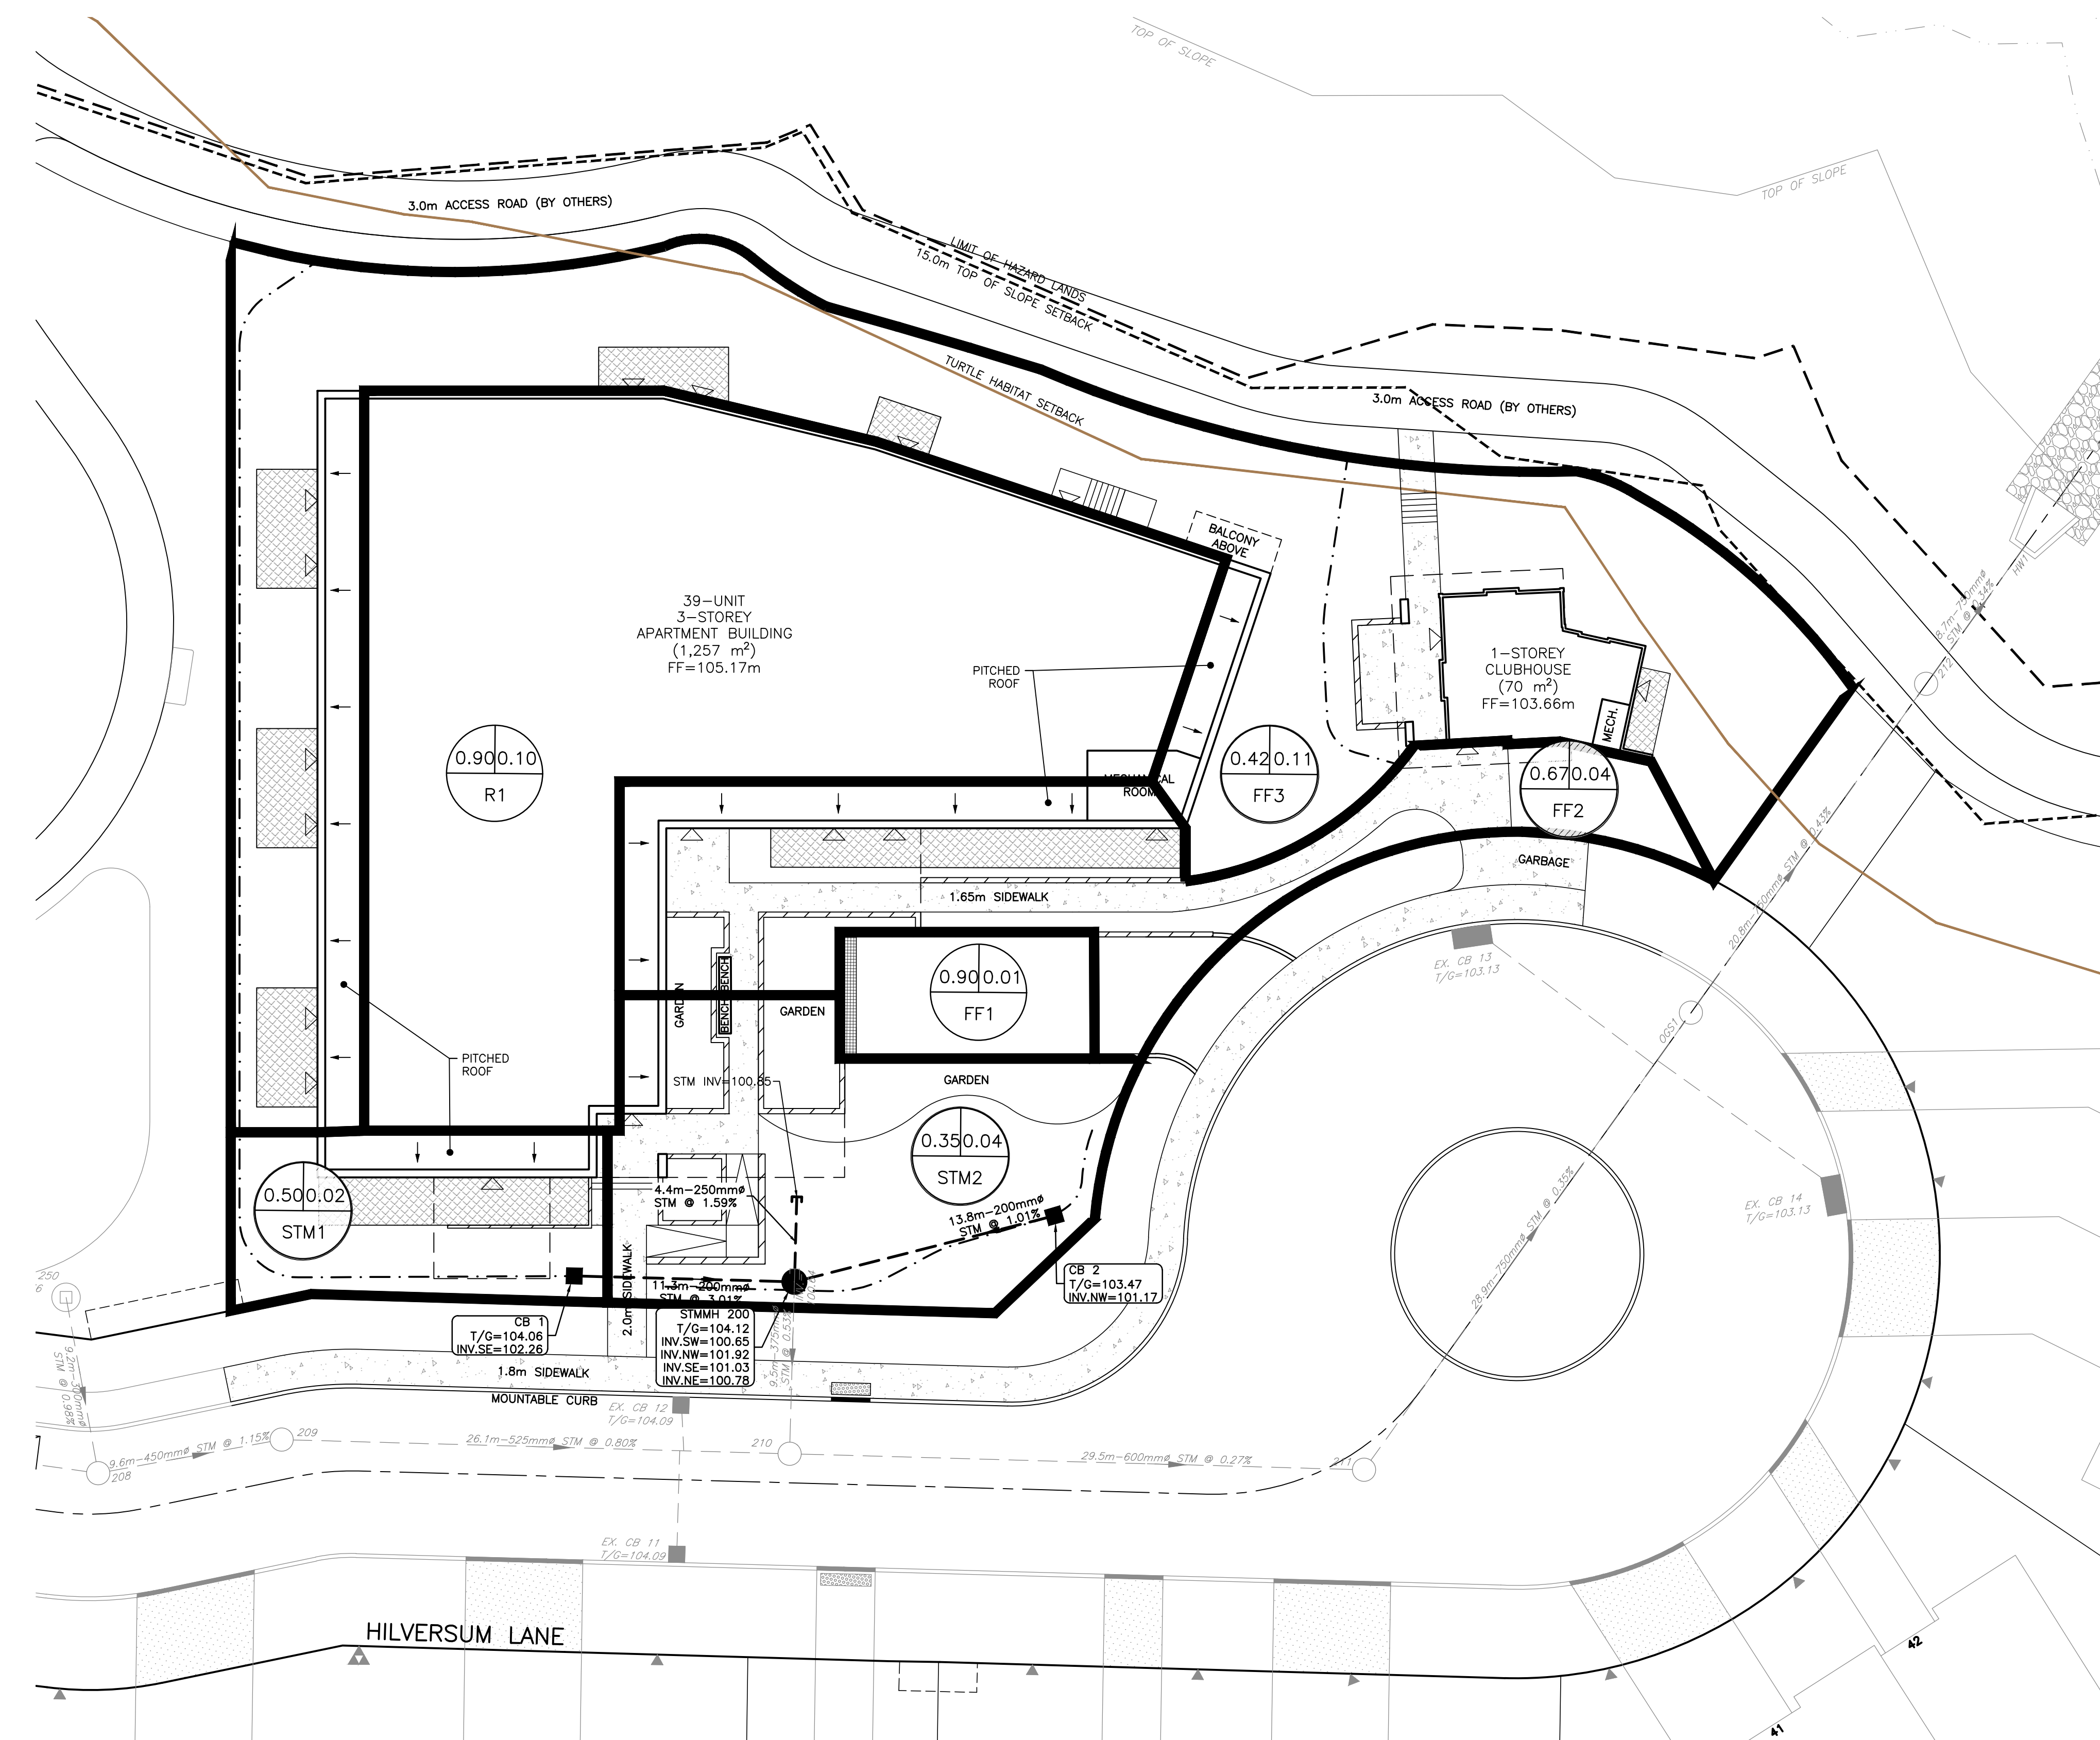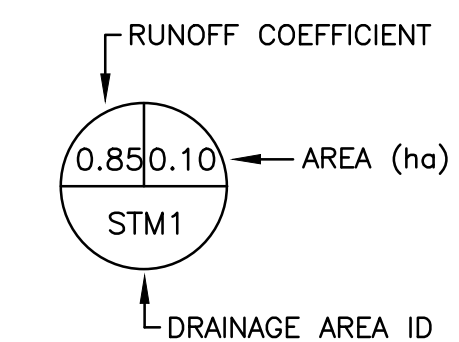



**NOT FOR CONSTRUCTION**

**NOTES**

THE POSITION OF ALL POLE LINES, CONDUITS, WATERMANS, SEWERS AND OTHER UNDERGROUND AND OVERGROUND UTILITIES AND STRUCTURES IS NOT NECESSARILY SHOWN ON THE CONTRACT DRAWINGS, AND WHERE SHOWN, THE ACCURACY OF THE POSITION OF SUCH UTILITIES AND STRUCTURES IS NOT GUARANTEED. BEFORE STARTING WORK, DETERMINE THE EXACT LOCATION OF ALL SUCH UTILITIES AND STRUCTURES AND ASSUME ALL LIABILITY FOR DAMAGE TO THEM.

GEODETIC SURVEY DERIVED FROM COSINE STATION 0011968U054. LOCATION DESCRIPTION: OLD HIGHWAY 17 BRIDGE OVER CARP RIVER ON CARP-STITTSVILLE ROAD, 0.2 KM SOUTH OF C.N.R. CROSSING IN VILLAGE OF CARP. TABLET IN TOP OF WEST WALL, 30 CM FROM NORTH END, 24 CM FROM WEST EDGE. VERTICAL CONTROL DATA, DATUM: CGVD28:78, FIRST ORDER, ELEVATION: 93.861. COORDINATE SYSTEM: MTM ZONE 9; NAD 83 DATUM (CAN83-9)

NO.	REVISION DESCRIPTION	DATE	BY
1	ISSUED FOR REVIEW	21/11/25	BLM

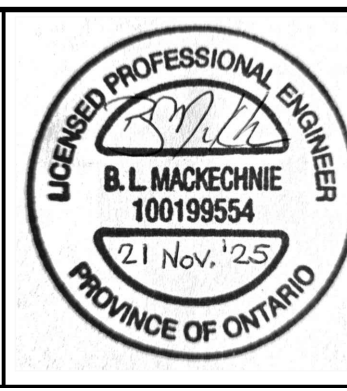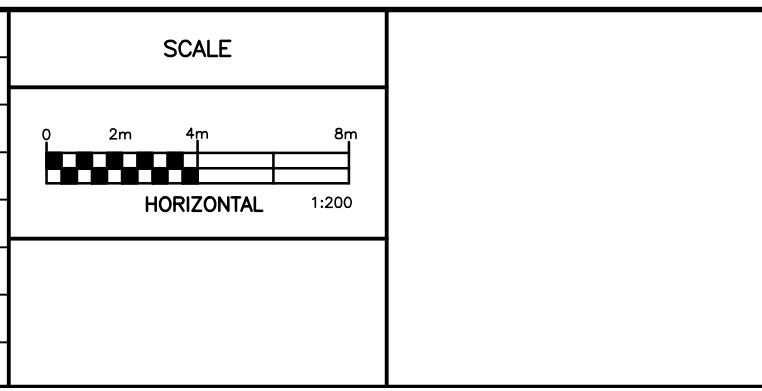

**Robinson Land Development**

350 Palladium Drive  
Ottawa, ON K2V 1A8  
(613) 592-6060 rcii.com

DESIGN	BLM
CHECKED	SG
DRAWN	BLM
CHECKED	SG
APPROVED	BLM

**INVERNESS HOMES**  
38 AURIGA DRIVE, SUITE 200  
OTTAWA, ON K2E 8A6

391 HILVERSUM LANE  
CARP, ON

**STORM DRAINAGE AREA PLAN**

PROJECT No.	25094
SURVEY	---
DATED	NOV. 2025
DWG. No.	25094-STM1

Appendix F

Robinson Report Excerpts

LMF ICD Flow Curves

Tempest ICD Technical Manual

Table F1: Ponding and Orifice  
Calculations

Free Flow Calculations

Storage Volume Tables

*Figure 5: OGS Unit Drainage Area Plan*

Amended ECA

Geotechnical Excerpts

therefore is in accordance with the OSDG. Refer to **Table E5** in **Appendix E** for more details.

### **Park Land**

The proposed grading design for the designated park land (Block 28) generally follows the natural topography of the property which slopes from the Street 1 right-of-way towards the existing SWM ravine. It is likely that major system flows from the park land will be conveyed uncontrolled to the existing SWM ravine upstream of existing control structure G4, although to ensure a conservative design while also allowing for park design flexibility, it has been assumed that all major system flow will be conveyed to the adjacent road network. The park block has been modelled using an assumed runoff coefficient value of 0.50 to account for the future development plans of the park.

### **Private Dog Park/Communal Garden**

Also due to topography, major system flows from the private dog park/communal garden (Block 22) will be conveyed uncontrolled to the existing ravine downstream of control structure G4. These flows have been accounted for in the total flow tributary to the existing Donald B. Munro road crossing culvert. Block 22 has been modelled using an assumed runoff coefficient value of 0.50 to account for the future development plans of the block.

### **Apartment Blocks**

To be conservative, the major system design has assumed that all major system flow from the apartment blocks (Block 21, 23, 24, and 27) will be conveyed to the proposed road networks. This approach ensures that the road network and overland flow routes are designed with adequate capacity to convey the full major system flows from the apartment blocks. At the Site Plan Application stage, it must be demonstrated that the major system flows from apartment blocks do not exceed the allocated values. Note that the modelling has assumed no major system storage on site, again to ensure design flexibility while also ensuring a conservative analysis.

As discussed with the City, a drainage easement will be required within Block 23 and Block 24 to allow major system flows from Block 24 to be conveyed through Block 23 to reach Street 2. This ensures that at the Site Plan Application stage, the development of Block 23 must be designed to accommodate major system flow from Block 24. The allocated major system flows from the blocks have been summarized in **Table 8.12** below.

**Table 8.12: Allocated Major System Flows from Blocks**

Block No.	Description	Minor System Flow (L/s)	Major System Flows (L/s)		
			2-Yr	5-Yr	100-Yr
Block 21	Apartment – Phase 2	56	0	32	116
Block 22	Dog Park – Phase 2	0	21	31	65
Block 23	Apartment – Phase 2	29	0	13	53
Block 24	Apartment – Phase 2	29	0	14	54
Block 27	Apartment – Phase 1	47	0	22	87
Block 28	Park – Phase 1	26	0	4	54

**Table 8.14: West Ravine Peak Flows**

Development Condition	C Value	Area (ha)	Tc*2 (min.)	Peak Flow*1 (L/s)		
				2-Yr	5-Yr	100-Yr
Pre	0.20	2.06	13.1	76.4	103.5	221.3
Post	0.43	0.95	10.0	87.2	118.3	249.9

Notes:

2. Peak flows calculated using the Rational Method ( $Q=2.78CiA$ )
3. Time of concentration values estimated using the Uplands Method (Minimum  $T_c = 10$  min).

As demonstrated in the table above, the post-development peak flows to the west ravine will increase due to a higher runoff coefficient and shorter time of concentration. A section of the existing west ravine was assessed immediately downstream of the subject site (approximately 13 metres upstream of Carp Road). Channel calculations have demonstrated that only an additional 0.01 metres of channel depth is required to accommodate the increased peak flow under the post-development condition. Supporting calculations and a West Ravine Drainage Area Plan are provided under **Appendix E**. The use of surface drainage as opposed to storm sewers will minimize the potential for converged flows within the ravine. Since the majority of the runoff is conveyed to ravine via overland sheet flow from landscape areas and the ravine has adequate capacity to convey the increase in peak flow there are no concerns for negative impacts (i.e. erosion and/or flooding) within the ravine or adjacent properties as a result of the development. Since the runoff is considered “clean” (i.e. from grassed areas and roofs), quality control is not required prior to discharging off-site.

### 8.13 Quality Control

As outlined in the PSR Report, drainage areas 1 and 1a (i.e. the proposed development lands) may require additional treatment to achieve level 2 (“normal level” 70% TSS removal) quality control. A 70% TSS removal target was also outlined in the overarching CRWSS and recommended by the MVCA during pre-consultation. However, to be applicable for the City of Ottawa’s Transfer of Review (TOR) program an enhanced level (80% TSS removal) target will be implemented for this development.

Quality control for the proposed development will be provided by installing inline oil-grit separator (OGS) units upstream of the storm outlets to the existing SWM ravine. One OGS unit per storm outlet will be required. The rear yard storm outlet from Block 26 will not require an inline OGS unit since the runoff is from grass and roof areas which are considered ‘clean’ and do not require additional treatment. The OGS units have been located within the municipal roadways to allow for easy access and maintenance.

The proposed OGS units have been appropriately sized to provide enhanced level (80% TSS removal) quality control based on parameters (i.e. area and percent impervious) of the tributary drainage areas and using a FINE PSD. The unit for the Street 1 outlet is proposed to be a Stormceptor EFO8 and the unit for the Street 2 outlet is proposed to be a Stormceptor EFO6, both designed by Imbrium Systems (or approved equivalent). The Stormceptor EFO model removes stormwater pollutants through gravity separation and floatation, and features a design which generates positive removal of total suspended solids (TSS) throughout each storm event, including high intensity storms. Captured pollutants include sediments, free oils, and sediment-bound pollutants such as nutrients, heavy metals, and petroleum hydrocarbons. The technology incorporates an internal bypass to convey excessive stormwater flows from high-intensity storms through the device without resuspension and washout (scour) of previously captured pollutants. The EFO unit has been

third-party tested in accordance with the Canadian ETV Procedure for Laboratory Testing of Oil-Grit Separators and has been third-party verified in accordance with the ISO 14034 Environmental Technology Verification (ETV). Refer to the OGS specifications provided in **Appendix E** for more details. Note that the losses created by the OGS units have been accounted for in the modelling through an equivalent exit loss coefficient.

The technology incorporates an internal bypass to convey excessive stormwater flows from high-intensity storms through the device without resuspension and washout (scour) of previously captured pollutants. When prescribed surface loading rates are exceeded, ponding water can overtop the weir height and bypass the lower treatment chamber, exiting directly through the outlet pipe. Hydraulic testing and scour testing demonstrate that the internal bypass effectively prevents scour at all bypass flow rates. Increasing the bypass flow rate does not increase the orifice-controlled flow rate into the lower treatment chamber where sediment is stored. This internal bypass feature allows for in-line installation, avoiding the cost of additional bypass structures. During bypass, treatment continues in the lower chamber at the maximum flow rate. The Stormceptor EFO's lower design surface loading rate is favorable for minimizing re-entrainment and washout of captured light liquids. An ISO 14034 ETV Verification Statement which summarizes the results of third-party testing and verification in accordance with ETV protocol has been provided in **Appendix E**.

Operation and maintenance of the units shall be performed in accordance with the manufacturer's recommendations (provided in **Appendix E**). Inspection of the units shall be performed as follows:

- Post-construction inspection is required prior to putting the Stormceptor into service.
- Routine inspections are recommended during the first year of operation to accurately assess pollutant accumulation.
- Inspection frequency in subsequent years is based on the maintenance plan developed in the first year.
- Inspections should also be performed immediately after oil, fuel, or other chemical spills.

For optimum performance and normal operation, the units should be cleaned out once the sediment depth reaches the recommended maintenance sediment depths noted below (refer also to *Table 3* of the Owner's Manual provided in **Appendix E**).

EFO6: 305 mm  
EFO8: 610 mm

The sizing report for the EFO6 unit indicates an estimated average annual sediment volume of 842 litres per year which is far less than the noted maximum sediment volume capacity of 3470 litres. For the EFO8 unit, the estimated average annual sediment volume is 1628 litres per year which is also far less than the noted maximum sediment volume capacity of 8780 litres. The frequency of inspection and maintenance should be adjusted based on site conditions to ensure the units are operating and performing as intended, however, yearly inspection and maintenance (at minimum) is recommended.

The surface vegetation within the SWM ravine and off-site ditch system which will provide additional quality cleansing via filtration prior to stormwater reaching the downstream receiver (i.e. Carp River). From the Carp EMP, "*Protection of remnant natural vegetation, particularly in the lowermost forested areas of the two major ravines and anywhere in the largely open upper reaches of the stream channels, encourages the natural regeneration of tree cover along ravine slopes. This enhances the wildlife corridor capacity of the ravines as well as increasing their stormwater containment contributions.*"

Chart 1: LMF 14 Preset Flow Curves

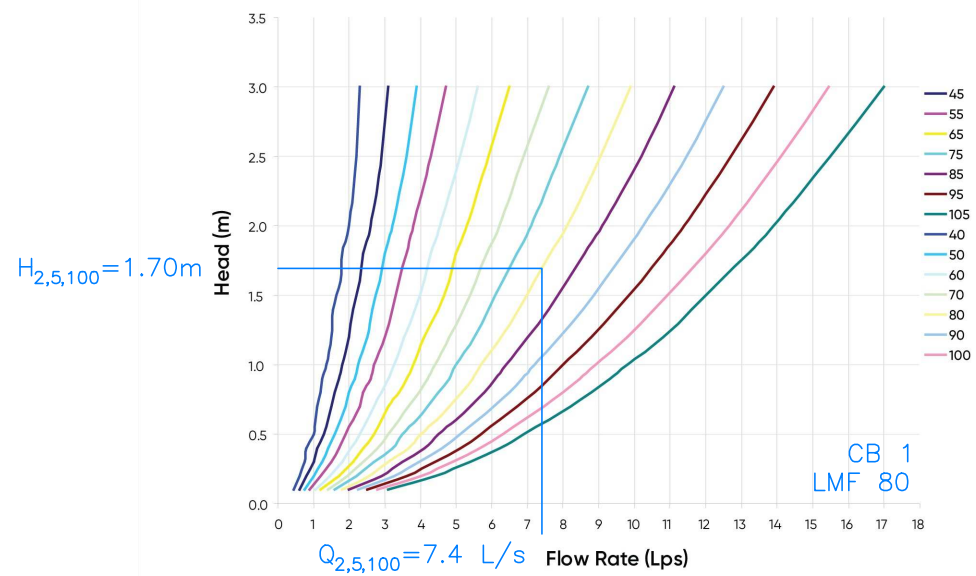


Chart 2: LMF Flow vs. ICD Alternatives

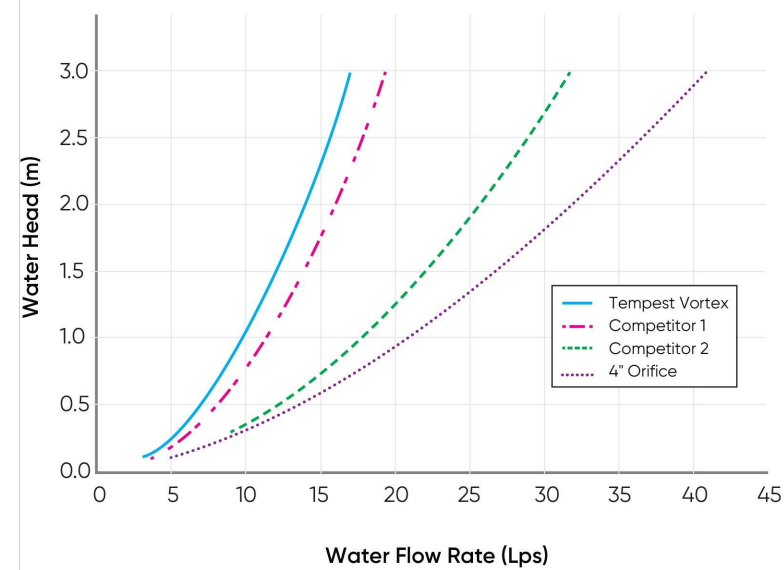


Chart 1: LMF 14 Preset Flow Curves


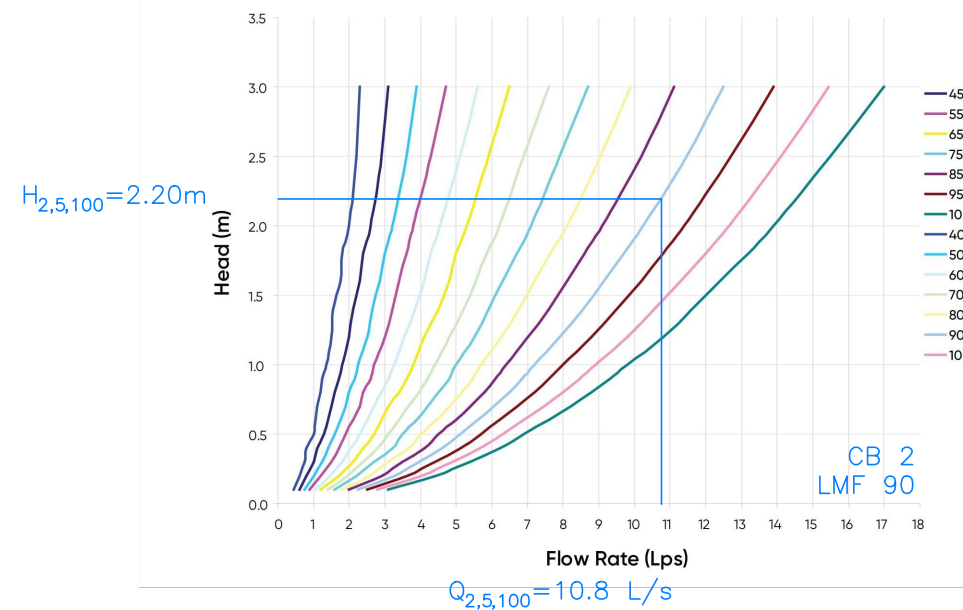


Chart 2: LMF Flow vs. ICD Alternatives



# Volume III: TEMPEST INLET CONTROL DEVICES

Municipal Technical  
Manual Series

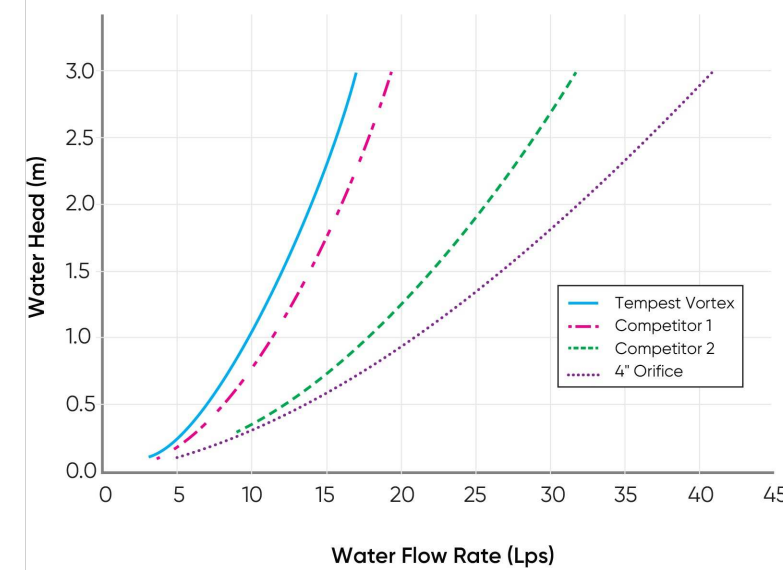

SECOND EDITION

LMF (Low to Medium Flow) ICD

HF (High Flow) ICD

MHF (Medium to High Flow) ICD



**IPEX**

by aliaxis

# IPEX Tempest™ Inlet Control Devices


Municipal Technical Manual Series

Vol. I, 2nd Edition

© 2022 by IPEX. All rights reserved. No part of this book may be used or reproduced in any manner whatsoever without prior written permission.

For information contact: IPEX, Marketing,  
1425 North Service Road East, Oakville, Ontario, Canada, L6H 1A7

The information contained here within is based on current information and product design at the time of publication and is subject to change without notification. IPEX does not guarantee or warranty the accuracy, suitability for particular applications, or results to be obtained therefrom.

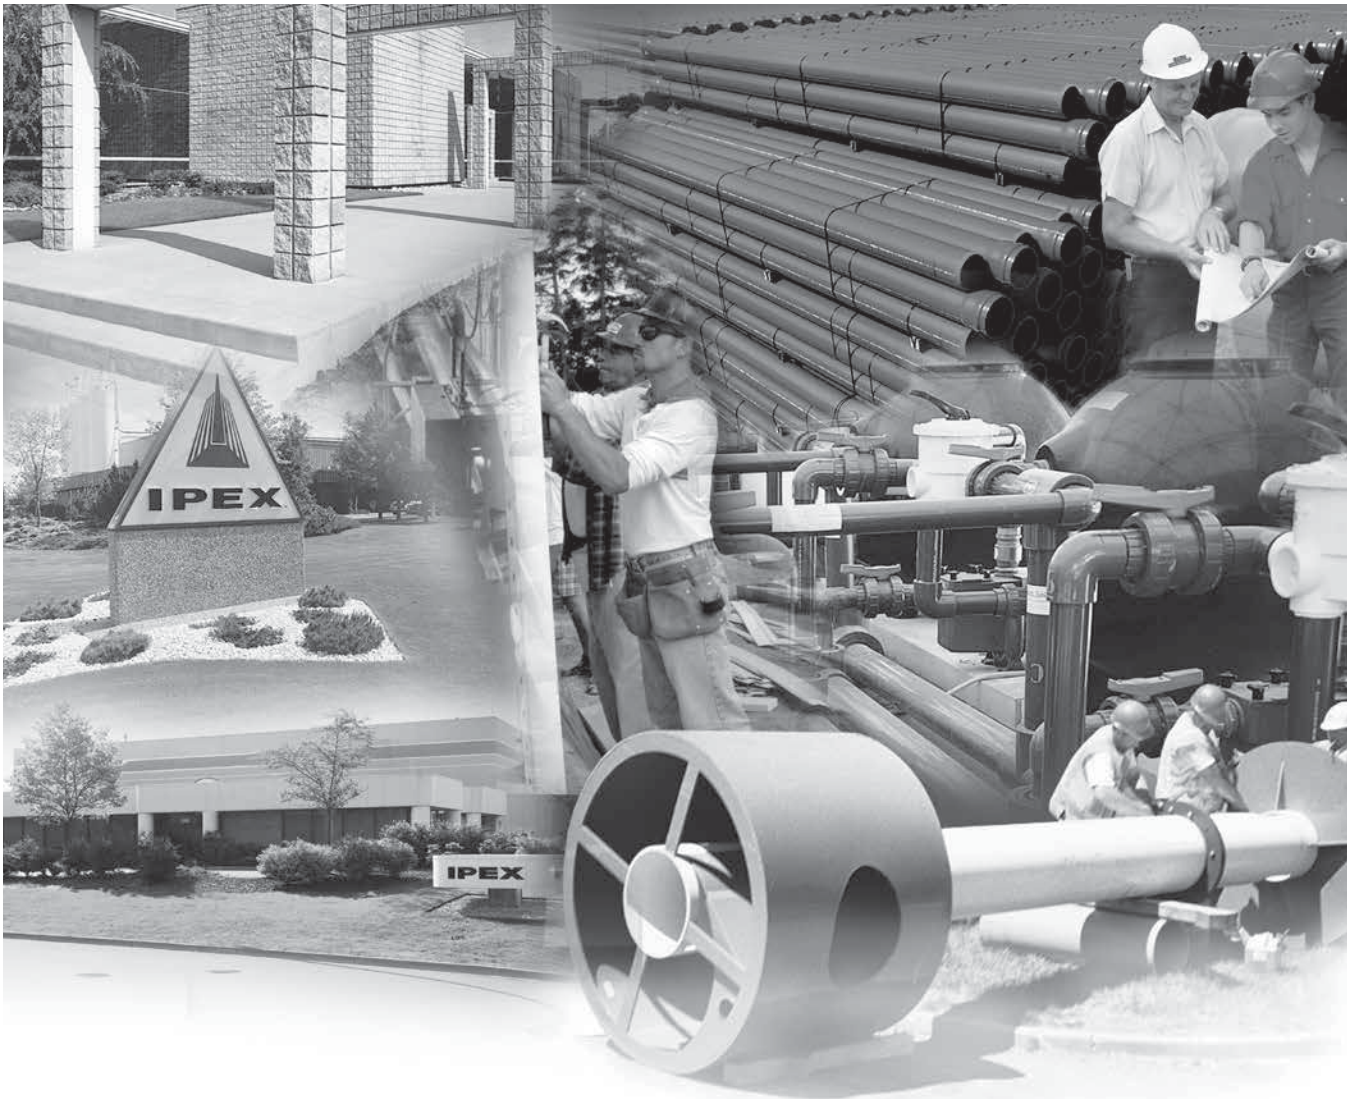

## ABOUT IPEX

At IPEX, we have been manufacturing non-metallic pipe and fittings since 1951. We formulate our own compounds and maintain strict quality control during production. Our products are made available for customers thanks to a network of regional stocking locations throughout North America. We offer a wide variety of systems including complete lines of piping, fittings, valves and custom-fabricated items.

More importantly, we are committed to meeting our customers' needs. As a leader in the plastic piping industry, IPEX continually develops new products, modernizes manufacturing facilities and acquires innovative process technology. In addition, our staff take pride in their work, making available to customers their extensive thermoplastic knowledge and field experience. IPEX personnel are committed to improving the safety, reliability and performance of thermoplastic materials. We are involved in several standards committees and are members of and/or comply with the organizations listed on this page.

For specific details about any IPEX product, contact our customer service department.

---

# CONTENTS

## TEMPEST INLET CONTROL DEVICES Technical Manual

### About IPEX

<b>Section One:</b>	<b>Product Information: TEMPEST Low, Medium Flow (LMF) ICD</b>	
	Purpose .....	4
	Product Description .....	4
	Product Function .....	4
	Product Construction .....	4
	Product Applications .....	4
	Chart 1: LMF 14 Preset Flow Curves .....	5
	Chart 2: LMF Flow Vs. ICD Alternatives .....	5
	<b>Product Installation</b>	
	Instructions to assemble a TEMPEST LMF ICD into a square catch basin: .....	6
	Instructions to assemble a TEMPEST LMF ICD into a round catch basin: .....	6
	<b>Product Technical Specification</b>	
	General .....	7
	Materials .....	7
	Dimensioning .....	7
	Installation .....	7
<b>Section Two:</b>	<b>Product Information: TEMPEST High Flow (HF) &amp; Medium, High Flow (MHF) ICD</b>	
	Product Description .....	8
	Product Function .....	8
	Product Construction .....	8
	Product Applications .....	8
	Chart 3: HF & MHF Preset Flow Curves .....	9
	<b>Product Installation</b>	
	Instructions to assemble a TEMPEST HF or MHF ICD into a square catch basin: .....	10
	Instructions to assemble a TEMPEST HF or MHF ICD into a round catch basin: .....	10
	Instructions to assemble a TEMPEST HF Sump into a square or round catch basin: ...	11
	<b>Product Technical Specification</b>	
	General .....	11
	Materials .....	11
	Dimensioning .....	11
	Installation .....	11

**PRODUCT INFORMATION: TEMPEST LOW, MEDIUM FLOW (LMF) ICD**

**Purpose**

To control the amount of storm water runoff entering a sewer system by allowing a specified flow volume out of a catch basin or manhole at a specified head. This approach conserves pipe capacity so that catch basins downstream do not become uncontrollably surcharged, which can lead to basement floods, flash floods and combined sewer overflows.

**Product Description**

Our LMF ICD is designed to accommodate catch basins or manholes with sewer outlet pipes 6" in diameter and larger. Any storm sewer larger than 12" may require custom modification. However, IPEX can custom build a TEMPEST device to accommodate virtually any storm sewer size.

Available in 14 preset flow curves, the LMF ICD has the ability to provide flow rates: 2lps – 17lps (31gpm – 270gpm)

**Product Function**


The LMF ICD vortex flow action allows the LMF ICD to provide a narrower flow curve using a larger orifice than a conventional orifice plate ICD, making it less likely to clog. When comparing flows at the same head level, the LMF ICD has the ability to restrict more flow than a conventional ICD during a rain event, preserving greater sewer capacity.

**Product Construction**


Constructed from durable PVC, the LMF ICD is light weight 8.9 Kg (19.7 lbs).

**Product Applications**


Will accommodate both square and round applications:

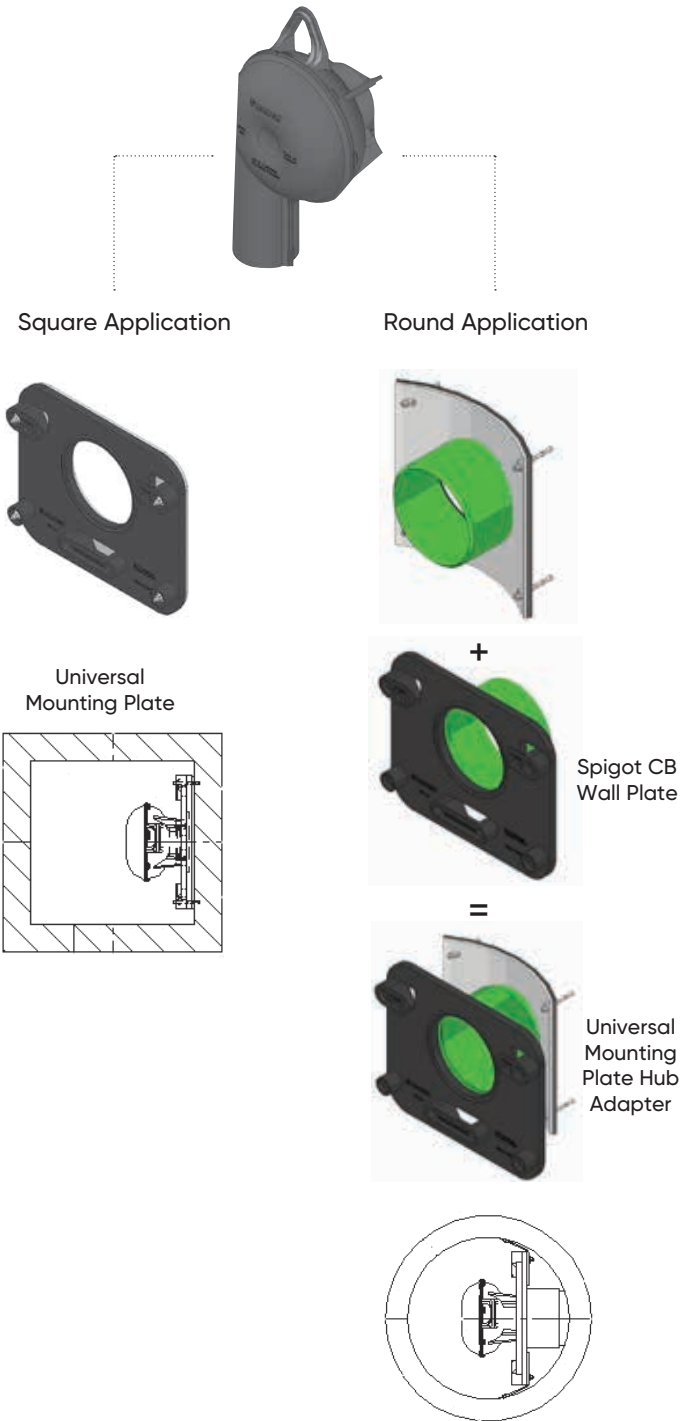

**Chart 1: LMF 14 Preset Flow Curves**

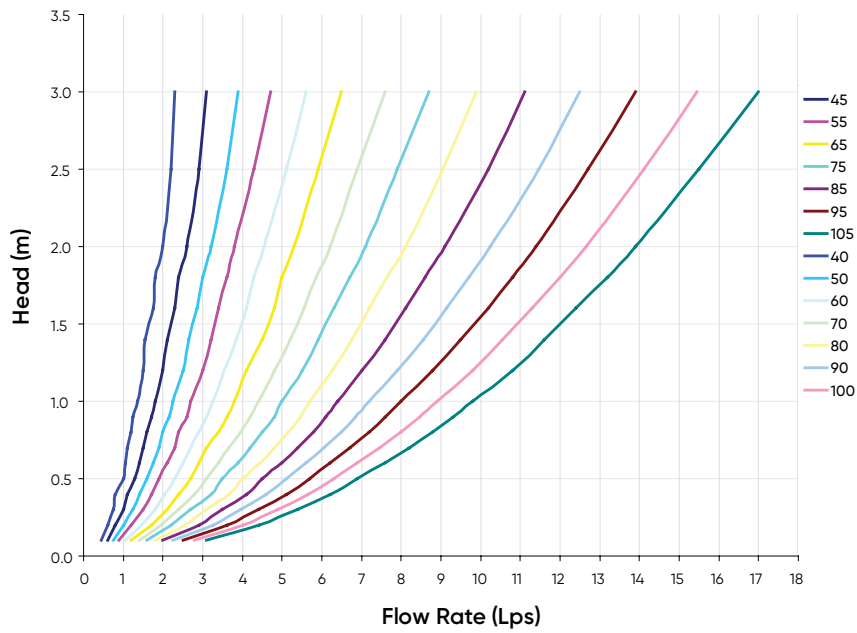

**Chart 2: LMF Flow vs. ICD Alternatives**

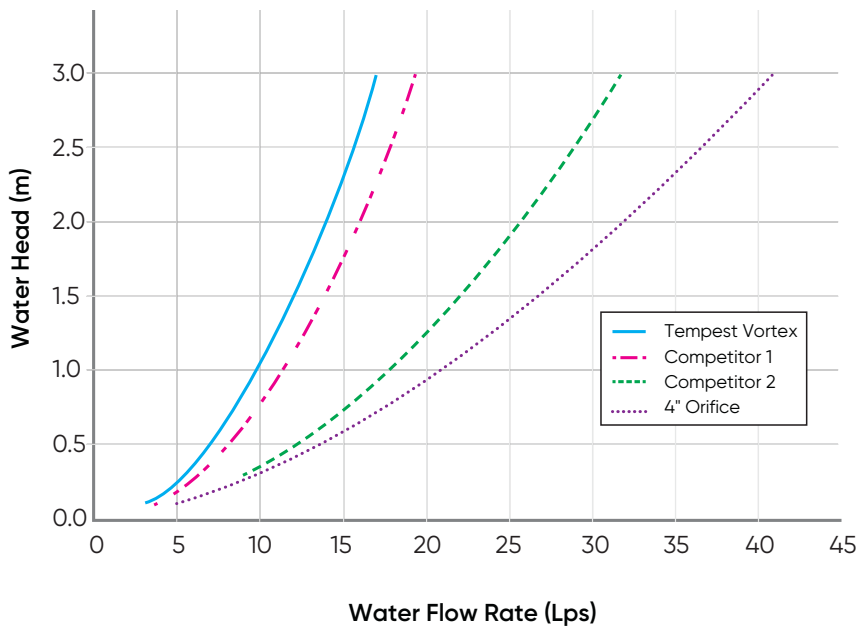

## PRODUCT INSTALLATION

### Instructions to assemble a TEMPEST LMF ICD into a Square Catch Basin:

#### STEPS:

1. Materials and tooling verification:
  - Tooling: impact drill, 3/8" concrete bit, torque wrench for 9/16" nut, hand hammer, level, and marker.
  - Material: (4) concrete anchor 3/8 x 3-1/2, (4) washers, (4) nuts, universal mounting plate, ICD device.
2. Use the mounting wall plate to locate and mark the hole (4) pattern on the catch basin wall. You should use a level to ensure that the plate is at the horizontal.
3. Use an impact drill with a 3/8" concrete bit to make the four holes at a minimum of 1-1/2" depth up to 2-1/2". Clean the concrete dust from the holes.
4. Install the anchors (4) in the holes by using a hammer. Thread the nuts on the top of the anchors to protect the threads when you hit the anchors with the hammer. Remove the nuts from the ends of the anchors.
5. Install the universal mounting plate on the anchors and screw the 4 nuts in place with a maximum torque of 40 N.m (30 lbf-ft). There should be no gap between the wall mounting plate and the catch basin wall.
6. From the ground above using a reach bar, lower the ICD device by hooking the end of the reach bar to the handle of the ICD device. Align the triangular plate portion into the mounting wall plate. Push down the device to be sure it has centered in to the universal mounting plate and has created a seal.



#### WARNING

- Verify that the outlet pipe doesn't protrude into the catch basin. If it does, cut down the pipe flush to the catch basin wall.
- Call your IPEX representative for more information or if you have any questions about our products.

### Instructions to assemble a TEMPEST LMF ICD into a Round Catch Basin:

#### STEPS:

1. Materials and tooling verification.
  - Tooling: impact drill, 3/8" concrete bit, torque wrench for 9/16" nut, hand hammer, level and marker.
  - Material: (4) concrete anchor 3/8 x 3-1/2, (4) washers and (4) nuts, spigot CB wall plate, universal mounting plate hub adapter, ICD device.
2. Use the spigot catch basin wall plate to locate and mark the hole (4) pattern on the catch basin wall. You should use a level to ensure that the plate is at the horizontal.
3. Use an impact drill with a 3/8" concrete bit to make the four holes at a depth between 1-1/2" to 2-1/2". Clean the concrete dust from the holes.
4. Install the anchors (4) in the holes by using a hammer. Thread the nuts on the top of the anchors to protect the threads when you hit the anchors with the hammer. Remove the nuts from the ends of the anchors.
5. Install the CB spigot wall plate on the anchors and screw the 4 nuts in place with a maximum torque of 40 N.m (30 lbf-ft). There should be no gap between the spigot wall plate and the catch basin wall.
6. Apply solvent cement on the hub of the universal mounting plate, hub adapter and the spigot of the CB wall plate, then slide the hub over the spigot. Make sure the universal mounting plate is at the horizontal and its hub is completely inserted onto the spigot. Normally, the corners of the universal mounting plate hub adapter should touch the catch basin wall.
7. From ground above using a reach bar, lower the ICD device by hooking the end of the reach bar to the handle of the ICD device. Align the triangular plate portion into the mounting wall plate. Push down the device to be sure it has centered in to the mounting plate and has created a seal.



#### WARNING

- Verify that the outlet pipe doesn't protrude into the catch basin. If it does, cut back the pipe flush to the catch basin wall.
- The solvent cement which is used in this installation is to be approved for PVC.
- The solvent cement should not be used below 0°C (32°F) or in a high humidity environment. Refer to the IPEX solvent cement guide to confirm the required curing time or visit the IPEX Online Solvent Cement Training Course available at [ipexna.com](http://ipexna.com).
- Call your IPEX representative for more information or if you have any questions about our products.

## PRODUCT TECHNICAL SPECIFICATION

### General

Inlet control devices (ICD's) are designed to provide flow control at a specified rate for a given water head level and also provide odour and floatable control. All ICD's will be IPEX Tempest or approved equal.

All devices shall be removable from a universal mounting plate. An operator from street level using only a T-bar with a hook will be able to retrieve the device while leaving the universal mounting plate secured to the catch basin wall face. The removal of the TEMPEST devices listed above must not require any unbolting or special manipulation or any special tools.

High Flow (HF) Sump devices will consist of a removable threaded cap which can be accessible from street level with out entry into the catchbasin (CB). The removal of the threaded cap shall not require any special tools other than the operator's hand.

ICD's shall have no moving parts.

### Materials

ICD's are to be manufactured from Polyvinyl Chloride (PVC) or Polyurethane material, designed to be durable enough to withstand multiple freeze-thaw cycles and exposure to harsh elements.

The inner ring seal will be manufactured using a Buna or Nitrile material with hardness between Duro 50 and Duro 70.

The wall seal is to be comprised of a 3/8" thick Neoprene Closed Cell Sponge gasket which is attached to the back of the wall plate.

All hardware will be made from 304 stainless steel.

### Dimensioning

The Low Medium Flow (LMF), High Flow (HF) and the High Flow (HF) Sump shall allow for a minimum outlet pipe diameter of 200mm with a 600mm deep Catch Basin sump.

### Installation

Contractor shall be responsible for securing, supporting and connecting the ICD's to the existing influent pipe and catchbasin/manhole structure as specified and designed by the Engineer.

## PRODUCT INFORMATION: TEMPEST HF & MHF ICD

### Product Description

Our HF, HF Sump and MHF ICD's are designed to accommodate catch basins or manholes with sewer outlet pipes 6" in diameter or larger. Any storm sewer larger than 12" may require custom modification. However, IPEX can custom build a TEMPEST device to accommodate virtually any storm sewer size.

Available in 5 preset flow curves, these ICDs have the ability to provide constant flow rates: 9lps (143 gpm) and greater

### Product Function

**TEMPEST HF (High Flow):** designed to manage moderate to higher flows 15 L/s (240 gpm) or greater and prevent the propagation of odour and floatables. With this device, the cross-sectional area of the device is larger than the orifice diameter and has been designed to limit head losses. The HF ICD can also be ordered without flow control when only odour and floatable control is required.



**TEMPEST HF (High Flow) Sump:** The height of a sewer outlet pipe in a catch basin is not always conveniently located. At times it may be located very close to the catch basin floor, not providing enough sump for one of the other TEMPEST ICDs with universal back plate to be installed. In these applications, the HF Sump is offered. The HF Sump offers the same features and benefits as the HF ICD; however, is designed to raise the outlet in a square or round catch basin structure. When installed, the HF sump is fixed in place and not easily removed. Any required service to the device is performed through a clean-out located in the top of the device which can be often accessed from ground level.



**TEMPEST MHF (Medium to High Flow):** The MHF plate or plug is designed to control flow rates 9 L/s (143 gpm) or greater. It is not designed to prevent the propagation of odour and floatables.



### Product Construction

The HF, HF Sump and MHF ICDs are built to be light weight at a maximum weight of 6.8 Kg (14.6 lbs).

### Product Applications

The HF and MHF ICD's are available to accommodate both square and round applications:




HF ICD



MHF ICD

#### Square Application

Universal Mounting Plate



#### Round Application

Spigot CB Wall Plate




Universal Mounting Plate Hub Adapter




+


=



The HF Sump is available to accommodate low to no sump applications in both square and round catch basins:

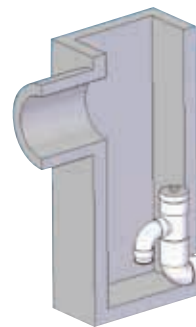


Square Catch Basin

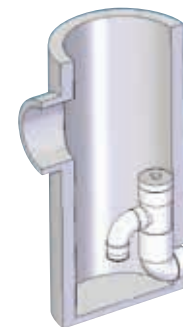

Round Catch Basin

**Chart 3: HF & MHF Preset Flow Curves**

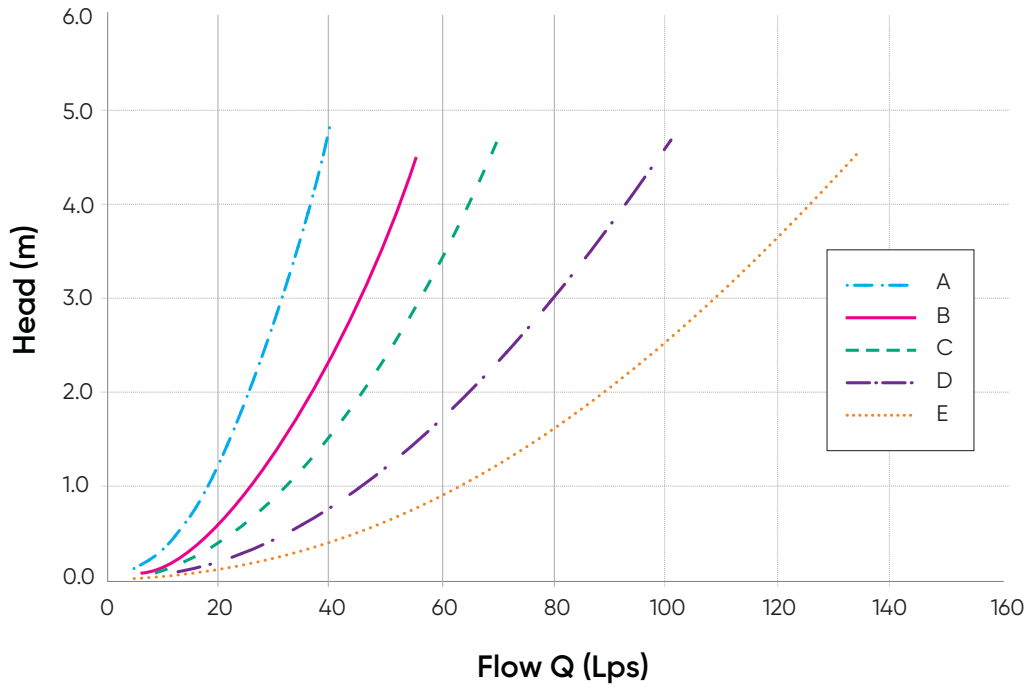

## PRODUCT INSTALLATION

### Instructions to assemble a TEMPEST HF or MHF ICD into a Square Catch Basin:

1. Materials and tooling verification:
  - Tooling: impact drill, 3/8" concrete bit, torque wrench for 9/16" nut, hand hammer, level, and marker.
  - Material: (4) concrete anchor 3/8 x 3-1/2, (4) washers, (4) nuts, universal mounting plate, ICD device
2. Use the mounting wall plate to locate and mark the hole (4) pattern on the catch basin wall. You should use a level to ensure that the plate is at the horizontal.
3. Use an impact drill with a 3/8" concrete bit to make the four holes at a minimum of 1-1/2" depth up to 2-1/2". Clean the concrete dust from the holes.
4. Install the anchors (4) in the holes by using a hammer. Thread the nuts on the top of the anchors to protect the threads when you hit the anchors with the hammer. Remove the nuts from the ends of the anchors.
5. Install the universal wall mounting plate on the anchors and screw the 4 nuts in place with a maximum torque of 40 N.m (30 lbf-ft). There should be no gap between the wall mounting plate and the catch basin wall.
6. From the ground above using a reach bar, lower the device by hooking the end of the reach bar to the handle of the ICD device. Align the triangular plate portion into the mounting wall plate. Push down the device to be sure it has centered in to the universal wall mounting plate and has created a seal.



#### WARNING

- Verify that the outlet pipe doesn't protrude into the catch basin. If it does, cut down the pipe flush to the catch basin wall.
- Call your IPEX representative for more information or if you have any questions about our products.

### Instructions to assemble a TEMPEST HF or MHF ICD into a Round Catch Basin:

#### STEPS:

1. Materials and tooling verification.
  - Tooling: impact drill, 3/8" concrete bit, torque wrench for 9/16" nut, hand hammer, level and marker.
  - Material: (4) concrete anchor 3/8 x 3-1/2, (4) washers and (4) nuts, spigot CB wall plate, universal mounting plate hub adapter, ICD device.
2. Use the round catch basin spigot adaptor to locate and mark the hole (4) pattern on the catch basin wall. You should use a level to ensure that the plate is at the horizontal.
3. Use an impact drill with a 3/8" concrete bit to make the four holes at a depth between 1-1/2" to 2-1/2". Clean the concrete dust from the holes.
4. Install the anchors (4) in the holes by using a hammer. Thread the nuts on the top of the anchors to protect the threads when you hit the anchors with the hammer. Remove the nuts from the ends of the anchors.
5. Install the spigot CB wall plate on the anchors and screw the 4 nuts in place with a maximum torque of 40 N.m (30 lbf-ft). There should be no gap between the spigot CB wall plate and the catch basin wall.
6. Put solvent cement on the hub of the universal mounting plate, hub adapter and the spigot of the CB wall plate, then slide the hub over the spigot. Make sure the universal mounting plate is at the horizontal and its hub is completely inserted onto the spigot. Normally, the corners of the hub adapter should touch the catch basin wall.
7. From ground above using a reach bar, lower the device by hooking the end of the reach bar to the handle of the ICD device. Align the triangular plate portion into the mounting wall plate. Push down the device to be sure it has centered in to the wall mounting plate and has created a seal.



#### WARNING

- Verify that the outlet pipe doesn't protrude into the catch basin. If it does, cut down the pipe flush to the catch basin wall.
- The solvent cement which is used in this installation is to be approved for PVC.
- The solvent cement should not be used below 0°C (32°F) or in a high humidity environment. Refer to the IPEX solvent cement guide to confirm the required curing time or visit the IPEX Online Solvent Cement Training Course available at [www.ipexinc.com](http://www.ipexinc.com).
- Call your IPEX representative for more information or if you have any questions about our products.

## Instructions to assemble a TEMPEST HF Sump into a Square or Round Catch Basin:

### STEPS:

1. Materials and tooling verification:
  - Tooling: impact drill, 3/8" concrete bit, torque wrench for 9/16" nut, hand hammer, level, mastic tape and metal strapping
  - Material: (2) concrete anchor 3/8 x 3-1/2, (2) washers, (2) nuts, HF Sump pieces (2).
2. Apply solvent cement to the spigot end of the top half of the sump. Apply solvent cement to the hub of the bottom half of the sump. Insert the spigot of the top half of the sump into the hub of the bottom half of the sump.
3. Install the 8" spigot of the device into the outlet pipe. Use the mastic tape to seal the device spigot into the outlet pipe. You should use a level to be sure that the fitting is standing at the vertical.
4. Use an impact drill with a 3/8" concrete bit to make a series of 2 holes along each side of the body throat. The depth of the hole should be between 1-1/2" to 2-1/2". Clean the concrete dust from the 2 holes.
5. Install the anchors (2) in the holes by using a hammer. Put the nuts on the top of the anchors to protect the threads when you hit the anchors. Remove the nuts from the ends of the anchors.
6. Cut the metal strapping to length and connect each end of the strapping to the anchors. Screw the nuts in place with a maximum torque of 40 N.m (30 lbf-ft). The device should be completely flush with the catch basin wall.



### WARNING

- Verify that the outlet pipe doesn't protrude into the catch basin. If it does, cut down the pipe flush to the catch basin wall.
- The solvent cement which is used in this installation is to be approved for PVC.
- The solvent cement should not be used below 0°C (32°F) or in a high humidity environment. Refer to the IPEX solvent cement guide to confirm the required curing time or visit the IPEX Online Solvent Cement Training Course available at [www.ipexinc.com](http://www.ipexinc.com).
- Call your IPEX representative for more information or if you have any questions about our products.

## PRODUCT TECHNICAL SPECIFICATION

### General

Inlet control devices (ICD's) are designed to provide flow control at a specified rate for a given water head level and also provide odour and floatable control where specified. All ICD's will be IPEX Tempest or approved equal.

All devices shall be removable from a universal mounting plate. An operator from street level using only a T-bar with a hook shall be able to retrieve the device while leaving the universal mounting plate secured to the catch basin wall face. The removal of the TEMPEST devices listed above shall not require any unbolting or special manipulation or any special tools.

High Flow (HF) Sump devices shall consist of a removable threaded cap which can be accessible from street level with out entry into the catchbasin (CB). The removal of the threaded cap shall not require any special tools other than the operator's hand.

ICD's shall have no moving parts.

### Materials

ICD's are to be manufactured from Polyvinyl Chloride (PVC) or Polyurethane material, designed to be durable enough to withstand multiple freeze-thaw cycles and exposure to harsh elements.

The inner ring seal will be manufactured using a Buna or Nitrile material with hardness between Duro 50 and Duro 70.

The wall seal is to be comprised of a 3/8" thick Neoprene Closed Cell Sponge gasket which is attached to the back of the wall plate.

All hardware will be made from 304 stainless steel.

### Dimensioning

The Low Medium Flow (LMF), High Flow (HF) and the High Flow (HF) Sump shall allow for a minimum outlet pipe diameter of 200mm with a 600mm deep Catch Basin sump.

### Installation

Contractor shall be responsible for securing, supporting and connecting the ICD's to the existing influent pipe and catchbasin/manhole structure as specified and designed by the Engineer.

---

NOTES

# SALES AND CUSTOMER SERVICE

IPEX Inc.

Toll Free: (866) 473-9462

[ipexna.com](http://ipexna.com)

## About the IPEX Group of Companies

As leading suppliers of thermoplastic piping systems, the IPEX Group of Companies provides our customers with some of the largest and most comprehensive product lines. All IPEX products are backed by more than 50 years of experience. With state-of-the-art manufacturing facilities and distribution centers across North America, we have established a reputation for product innovation, quality, end-user focus and performance.

Markets served by IPEX group products are:

- Electrical systems
- Telecommunications and utility piping systems
- PVC, CPVC, PP, ABS, PEX, FR-PVDF and PE pipe and fittings (1/4" to 48")
- Industrial process piping systems
- Municipal pressure and gravity piping systems
- Plumbing and mechanical piping systems
- PE Electrofusion systems for gas and water
- Industrial, plumbing and electrical cements
- Irrigation systems

Products manufactured by IPEX Inc.

Tempest™ is a trademark of IPEX Branding Inc.

This literature is published in good faith and is believed to be reliable. However it does not represent and/or warrant in any manner the information and suggestions contained in this brochure. Data presented is the result of laboratory tests and field experience.

A policy of ongoing product improvement is maintained. This may result in modifications of features and/or specifications without notice.



**Table F1: Ponding and Orifice Calculations**

Structure	Drainage Area	Outlet Pipe Inv. Elev. (m)	Outlet Pipe Diam. (m)	C/L Orifice Elev. (m)	T/G Elev. (m)	2-YR Ponding Depth (m)	2-YR Ponding Elev. (m)	2-YR Head (m)	5-YR Ponding Depth (m)	5-YR Ponding Elev. (m)	5-YR Head (m)	100-YR Ponding Depth (m)	100-YR Ponding Elev. (m)	100-YR Head (m)	100-YR + 20% Ponding Depth (m)	100-YR + 20% Ponding Elev. (m)	100-YR + 20% Head (m)	2-YR Flow Rate (L/s)	5-YR Flow Rate (L/s)	100-YR Flow Rate (L/s)	100-YR + 20% Flow Rate (L/s)	Orifice Area <sup>4</sup> (m <sup>2</sup> )	Equivalent Orifice Diameter <sup>5</sup> (mm)	Orifice Type
CB 1	STM1	102.26	0.201	102.36	104.06	0.00	104.06	1.70	0.00	104.06	1.70	0.00	104.06	1.70	0.00	104.06	1.70	7.4	7.4	7.4	7.4	0.002	52	Tempest LMF 80, Slide
CB 2	STM2	101.17	0.201	101.27	103.47	0.00	103.47	2.20	0.00	103.47	2.20	0.00	103.47	2.20	0.00	103.47	2.20	10.8	10.8	10.8	10.8	0.003	59	Tempest LMF 90, Slide

Notes:

1. Ponding depths are measured from the ponding elevation to the T/G elevation.
2. Heads are measured from the ponding elevation to the centreline of orifice elevation.
3. Orifice Area =  $(Q/1000) / 0.61(2*9.81*H_{100})^{0.5}$  (OSDG Section 8.3.8.1)
4. Orifice areas are calculated using 2-year head and flow rate values.
5. Equivalent orifice diameter for a standard circular orifice. Since diameter would be less than 83mm, vortex style ICD has been specified.

**Free Flow Calculations - Area FF1 (to U/G Parking Garage)**

Area ID = FF1  
 Area (ha) = 0.01  
 C = 0.90  
 C (100 YR) = 1.00

Design Event	Time (min)	Rainfall Intensity (mm/hr)	Flow (L/s)
2 Year	10	76.8	1.6
	15	61.8	1.3
	20	52.0	1.1
	25	45.2	1.0
	30	40.0	0.9
	35	36.1	0.8
5 Year	10	104.2	2.2
	15	83.6	1.8
	20	70.3	1.5
	25	60.9	1.3
	30	53.9	1.1
	35	48.5	1.0
100 Year	10	178.6	4.2
	15	142.9	3.4
	20	120.0	2.8
	25	103.8	2.5
	30	91.9	2.2
	35	82.6	2.0

Notes:

1. Rainfall intensity calculated using City of Ottawa IDF curve equations.
2. Flow calculated using the Rational Method.  $Q=2.78CiA$
3.  $C (100 YR) = C + 25\%$  (Max. 1.0)

**Free Flow Calculations - Area FF2 (to Hilversum Lane)**

Area ID = FF2  
 Area (ha) = 0.04  
 C = 0.67  
 C (100 YR) = 0.84

Design Event	Time (min)	Rainfall Intensity (mm/hr)	Flow (L/s)
2 Year	10	76.8	5.6
	15	61.8	4.5
	20	52.0	3.8
	25	45.2	3.3
	30	40.0	2.9
	35	36.1	2.6
5 Year	10	104.2	7.6
	15	83.6	6.1
	20	70.3	5.1
	25	60.9	4.4
	30	53.9	3.9
	35	48.5	3.5
100 Year	10	178.6	16.3
	15	142.9	13.0
	20	120.0	10.9
	25	103.8	9.5
	30	91.9	8.4
	35	82.6	7.5

Notes:

1. Rainfall intensity calculated using City of Ottawa IDF curve equations.
2. Flow calculated using the Rational Method.  $Q=2.78CiA$
3.  $C (100 YR) = C + 25\%$  (Max. 1.0)

**Free Flow Calculations - Area FF3 (to Ravine)**

Area ID = FF3  
 Area (ha) = 0.11  
 C = 0.42  
 C (100 YR) = 0.53

Design Event	Time (min)	Rainfall Intensity (mm/hr)	Flow (L/s)
2 Year	10	76.8	9.9
	15	61.8	8.0
	20	52.0	6.7
	25	45.2	5.8
	30	40.0	5.2
	35	36.1	4.7
5 Year	10	104.2	13.4
	15	83.6	10.8
	20	70.3	9.1
	25	60.9	7.9
	30	53.9	7.0
	35	48.5	6.3
100 Year	10	178.6	28.8
	15	142.9	23.0
	20	120.0	19.3
	25	103.8	16.7
	30	91.9	14.8
	35	82.6	13.3

Notes:

1. Rainfall intensity calculated using City of Ottawa IDF curve equations.
2. Flow calculated using the Rational Method.  $Q=2.78CiA$
3.  $C (100 YR) = C + 25\%$  (Max. 1.0)

**Storage Volume Calculations - Area R1 (ROOF)**

Area ID = R1  
 Area (ha) = 0.10  
 C = 0.90  
 C (100 YR) = 1.00

2-Year Release Rate (L/s) = 3.9  
 5-Year Release Rate (L/s) = 3.9  
 100-Year Release Rate (L/s) = 3.9  
 100-Year + 20% Release Rate (L/s) = 3.9  
 Roof Drain Release Rate (L/s/ha) = 40.0

Design Event	Time (min)	Rainfall Intensity (mm/hr)	Flow (L/s)	Release Rate (L/s)	Net Runoff to be Stored (L/s)	Storage Required (m <sup>3</sup> )
2 Year	15	61.8	15.3	3.9	11.3	10.2
	20	52.0	12.8	3.9	8.9	10.7
	<b>25</b>	<b>45.2</b>	<b>11.2</b>	<b>3.9</b>	<b>7.2</b>	<b>10.8</b>
	30	40.0	9.9	3.9	5.9	10.7
	35	36.1	8.9	3.9	5.0	10.4
	40	32.9	8.1	3.9	4.2	10.0
5 Year	25	60.9	15.0	3.9	11.1	16.6
	30	53.9	13.3	3.9	9.4	16.9
	<b>35</b>	<b>48.5</b>	<b>12.0</b>	<b>3.9</b>	<b>8.0</b>	<b>16.9</b>
	40	44.2	10.9	3.9	7.0	16.7
	45	40.6	10.0	3.9	6.1	16.4
100 Year	50	64.0	17.5	3.9	13.6	40.8
	55	59.6	16.4	3.9	12.4	41.0
	<b>60</b>	<b>55.9</b>	<b>15.3</b>	<b>3.9</b>	<b>11.4</b>	<b>41.0</b>
	65	52.6	14.4	3.9	10.5	40.9
	70	49.8	13.7	3.9	9.7	40.8
100 Year + 20%	75	47.3	13.0	3.9	9.0	40.6
	60	67.1	18.4	3.9	14.5	52.0
	65	63.2	17.3	3.9	13.4	52.2
	<b>70</b>	<b>59.7</b>	<b>16.4</b>	<b>3.9</b>	<b>12.4</b>	<b>52.3</b>
	75	56.7	15.6	3.9	11.6	52.2
	80	54.0	14.8	3.9	10.9	52.1
85	51.5	14.1	3.9	10.2	52.0	

Notes:

1. Rainfall intensity calculated using City of Ottawa IDF curve equations.
2. Provided storage volumes have been calculated using Civil3D by Autodesk.
3. Flow calculated using the Rational Method.  $Q=2.78CiA$
4.  $C(100\text{ YR}) = C + 25\%$  (Max. 1.0)

**Storage Volume Calculations - Area STM1 (CB 1)**

Area ID = STM1  
 Area (ha) = 0.02  
 C = 0.50  
 C (100 YR) = 0.63

2-Year Release Rate (L/s) = 7.4  
 5-Year Release Rate (L/s) = 7.4  
 100-Year Release Rate (L/s) = 7.4  
 100-Year + 20% Release Rate (L/s) = 7.4  
 Available Surface Storage Volume (m<sup>3</sup>) = 2.8

Design Event	Time (min)	Rainfall Intensity (mm/hr)	Flow (L/s)	Release Rate (L/s)	Net Runoff to be Stored (L/s)	Storage Required (m <sup>3</sup> )
2 Year	10	76.8	1.8	7.4	-5.6	-3.4
	15	61.8	1.4	7.4	-6.0	-5.4
	20	52.0	1.2	7.4	-6.2	-7.4
	25	45.2	1.1	7.4	-6.3	-9.5
	30	40.0	0.9	7.4	-6.5	-11.6
	35	36.1	0.8	7.4	-6.6	-13.8
5 Year	10	104.2	2.4	7.4	-5.0	-3.0
	15	83.6	1.9	7.4	-5.5	-4.9
	20	70.3	1.6	7.4	-5.8	-6.9
	25	60.9	1.4	7.4	-6.0	-9.0
	30	53.9	1.3	7.4	-6.1	-11.1
	35	48.5	1.1	7.4	-6.3	-13.2
100 Year	10	178.6	5.2	7.4	-2.2	-1.3
	15	142.9	4.2	7.4	-3.2	-2.9
	20	120.0	3.5	7.4	-3.9	-4.7
	25	103.8	3.0	7.4	-4.4	-6.6
	30	91.9	2.7	7.4	-4.7	-8.5
	35	82.6	2.4	7.4	-5.0	-10.5
100 Year + 20%	10	214.3	6.2	7.4	-1.2	-0.7
	15	171.5	5.0	7.4	-2.4	-2.2
	20	143.9	4.2	7.4	-3.2	-3.8
	25	124.6	3.6	7.4	-3.8	-5.7
	30	110.2	3.2	7.4	-4.2	-7.5
	35	99.1	2.9	7.4	-4.5	-9.5

Notes:

1. Rainfall intensity calculated using City of Ottawa IDF curve equations.
2. Provided storage volumes have been calculated using Civil3D by Autodesk.
3. Flow calculated using the Rational Method.  $Q=2.78CiA$
4.  $C(100\text{ YR}) = C + 25\%$  (Max. 1.0)


**Storage Volume Calculations - Area STM2 (CB 2)**

Area ID =	STM2	2-Year Release Rate (L/s) =	10.8
Area (ha) =	0.04	5-Year Release Rate (L/s) =	10.8
C =	0.35	100-Year Release Rate (L/s) =	10.8
C (100 YR) =	0.44	100-Year + 20% Release Rate (L/s) =	10.8
		Available Surface Storage Volume (m <sup>3</sup> ) =	2.1

Design Event	Time (min)	Rainfall Intensity (mm/hr)	Flow (L/s)	Release Rate (L/s)	Net Runoff to be Stored (L/s)	Storage Required (m <sup>3</sup> )
<b>2 Year</b>	10	76.8	2.6	10.8	-8.2	-4.9
	15	61.8	2.1	10.8	-8.7	-7.8
	20	52.0	1.8	10.8	-9.0	-10.8
	25	45.2	1.5	10.8	-9.3	-13.9
	30	40.0	1.4	10.8	-9.4	-17.0
	35	36.1	1.2	10.8	-9.6	-20.1
<b>5 Year</b>	10	104.2	3.6	10.8	-7.2	-4.3
	15	83.6	2.9	10.8	-7.9	-7.1
	20	70.3	2.4	10.8	-8.4	-10.1
	25	60.9	2.1	10.8	-8.7	-13.1
	30	53.9	1.8	10.8	-9.0	-16.1
	35	48.5	1.7	10.8	-9.1	-19.2
<b>100 Year</b>	10	178.6	7.6	10.8	-3.2	-1.9
	15	142.9	6.1	10.8	-4.7	-4.2
	20	120.0	5.1	10.8	-5.7	-6.8
	25	103.8	4.4	10.8	-6.4	-9.5
	30	91.9	3.9	10.8	-6.9	-12.4
	35	82.6	3.5	10.8	-7.3	-15.3
<b>100 Year + 20%</b>	10	214.3	9.2	10.8	-1.6	-1.0
	15	171.5	7.3	10.8	-3.5	-3.1
	20	143.9	6.2	10.8	-4.6	-5.6
	25	124.6	5.3	10.8	-5.5	-8.2
	30	110.2	4.7	10.8	-6.1	-10.9
	35	99.1	4.2	10.8	-6.6	-13.8

Notes:

1. Rainfall intensity calculated using City of Ottawa IDF curve equations.
2. Provided storage volumes have been calculated using Civil3D by Autodesk.
3. Flow calculated using the Rational Method.  $Q=2.78CiA$
4. C (100 YR) = C + 25% (Max. 1.0)

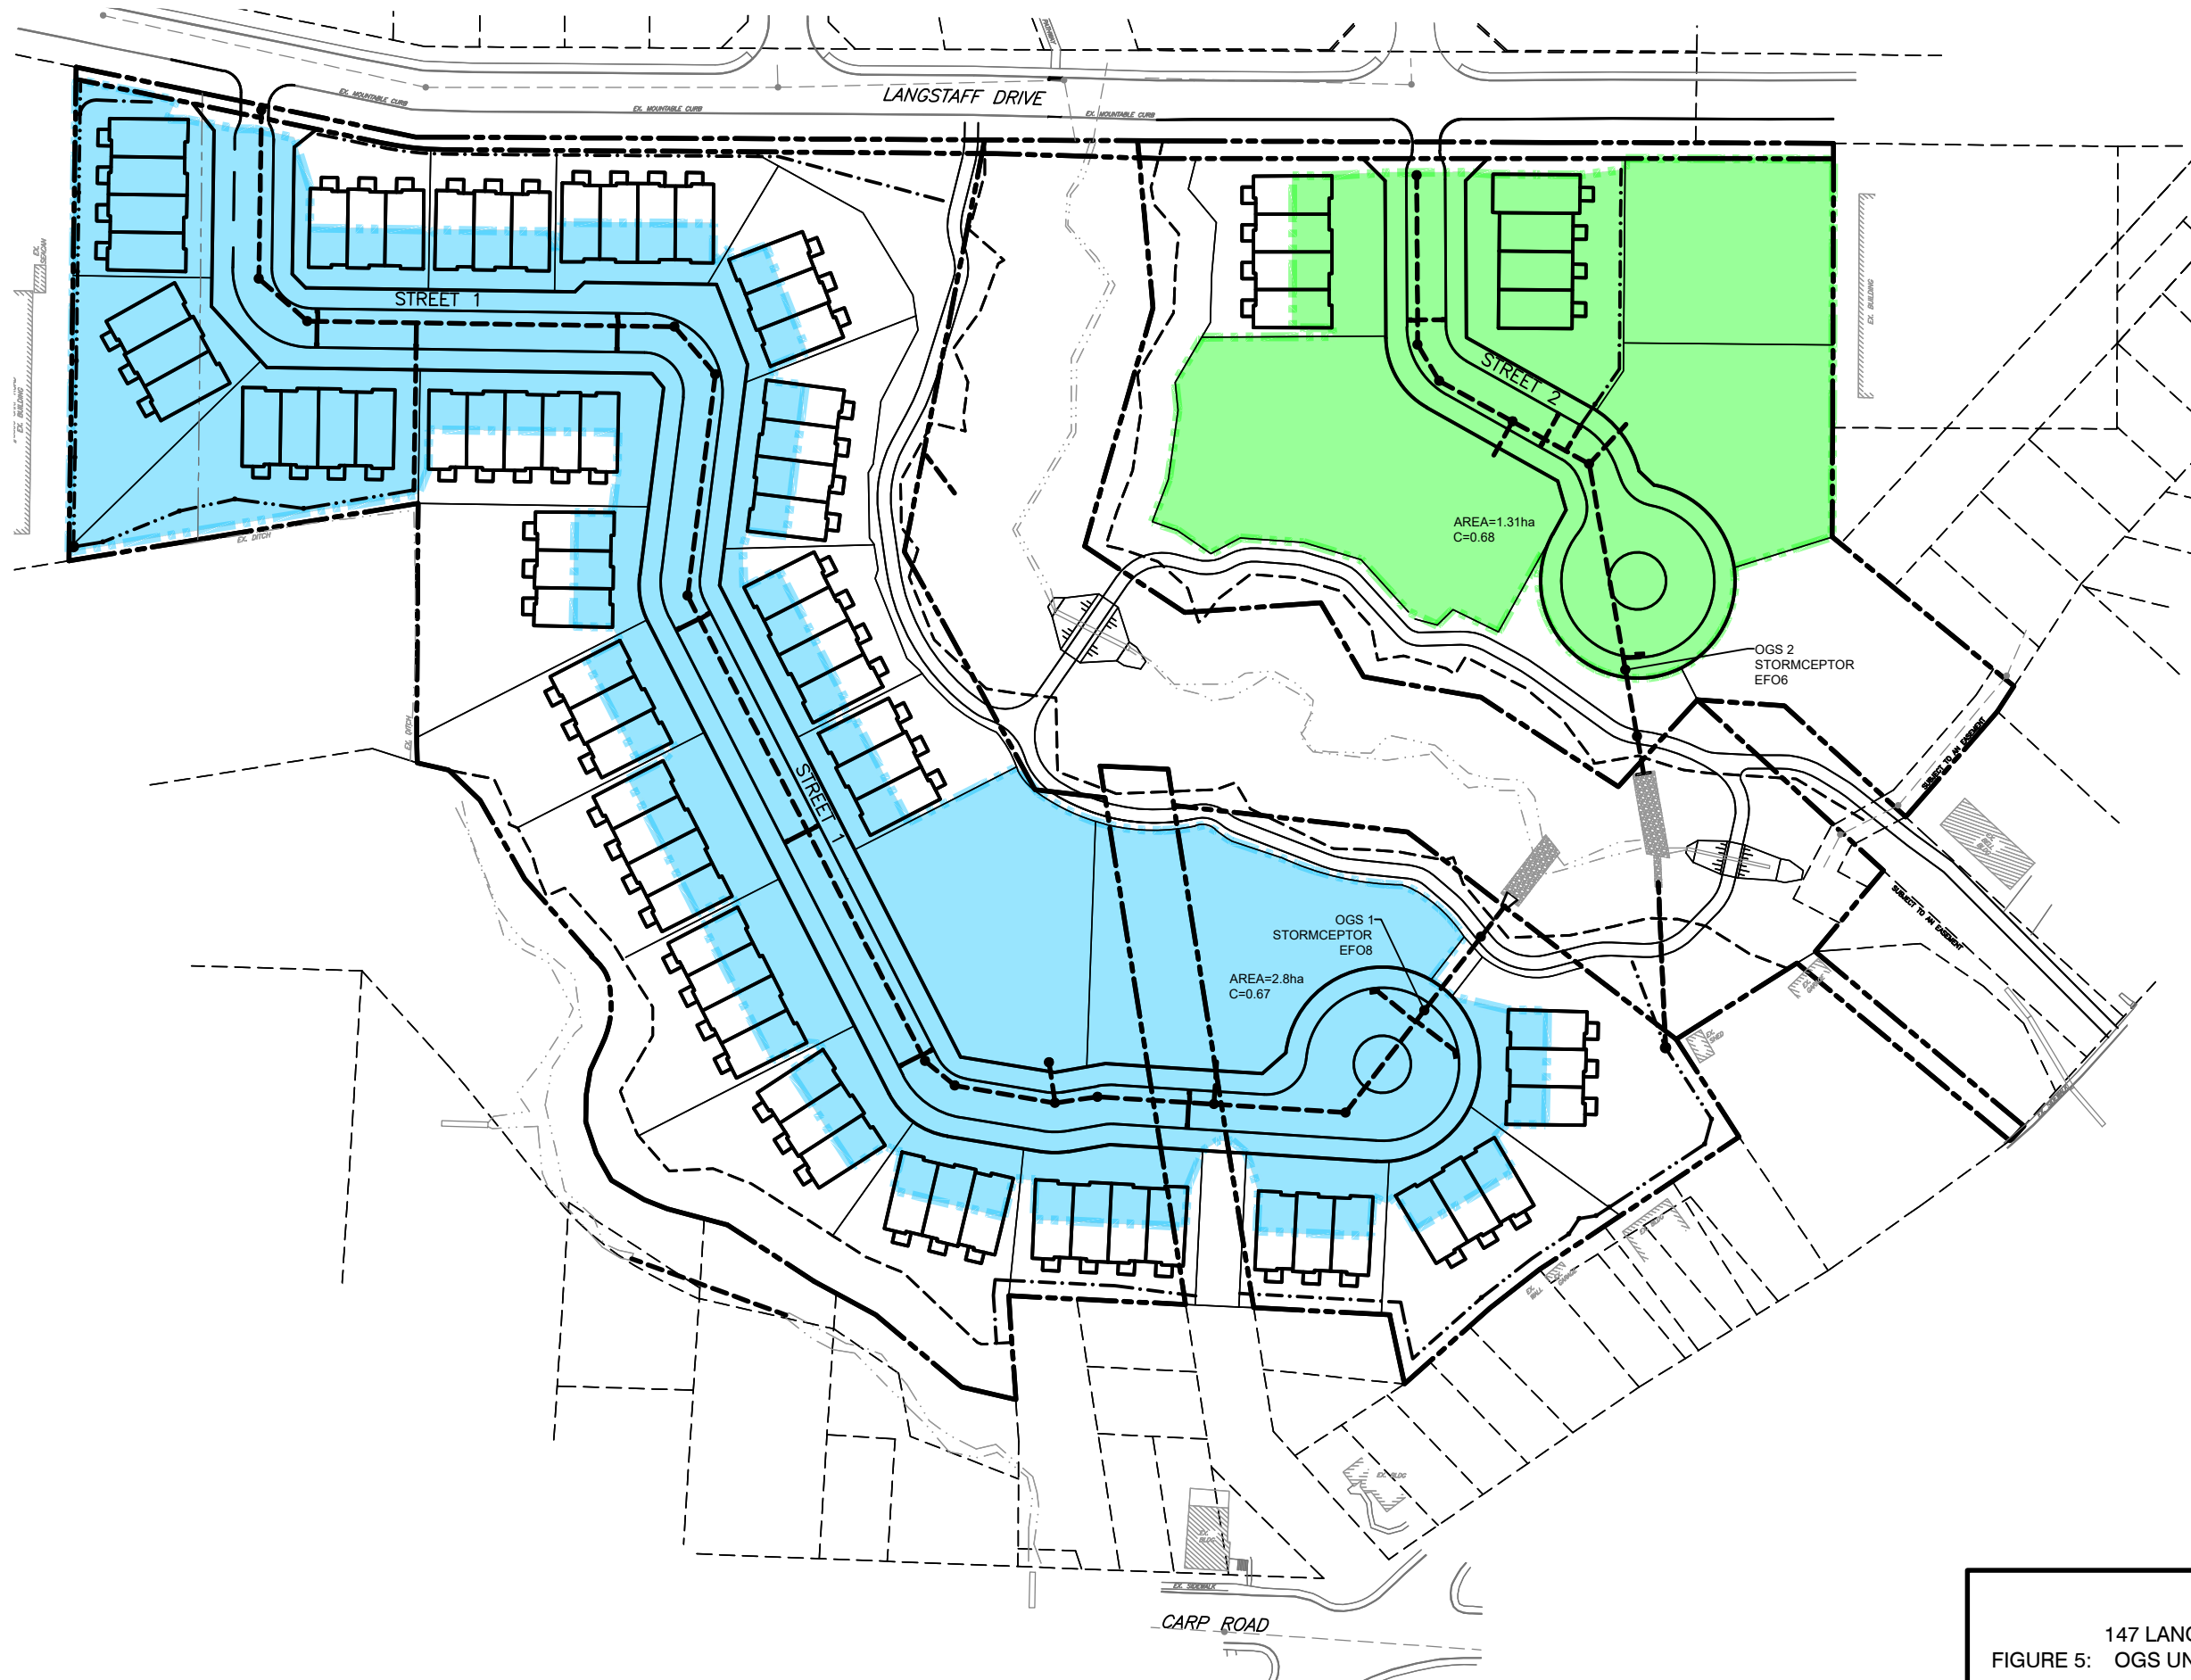

147 LANGSTAFF DRIVE  
FIGURE 5: OGS UNIT DRAINAGE AREA PLAN

**AMENDED ENVIRONMENTAL COMPLIANCE APPROVAL**

NUMBER 0840-DB8H9K  
Issue Date: December 2, 2024

Inverness Homes Inc.  
38 Auriga Drive, Unit 200  
Ottawa, Ontario  
K2E 8A5

Site Location: 147 Langstaff Drive, Village of Carp  
City of Ottawa, Ontario

*You have applied under section 20.2 of Part II.1 of the Environmental Protection Act, R.S.O. 1990, c. E. 19 (Environmental Protection Act) for approval of:*

The establishment of stormwater management Works to serve the current subdivision application of 147 Langstaff, located in the Village of Carp, consisting of the following:

- **oil and grit separator OGS 1 (catchment area 2.8 hectares):** one (1) oil and grit separator, Model EF08 or Equivalent Equipment, located within the Hilversum Lane cul-de-sac with a surface outlet 30 metres beyond, providing Enhanced Level of protection, having a sediment storage capacity of 8780 litres, an oil storage capacity of 1070 litres, and a maximum treatment rate of 1700 litres per second, receiving inflow from the storm sewer located in proposed Hilversum Lane discharging via a 750 millimetre diameter outlet pipe to the unnamed watercourse located between Langstaff Drive and Donald B. Munro Drive;
- **oil and grit separator OGS 2 (catchment area 1.31 hectares):** one (1) oil and grit separator, Model EF06 or Equivalent Equipment, located at the end of proposed Fair Isle Court, providing Enhanced Level of protection, having a sediment storage capacity of 3470 litres, an oil storage capacity of 610 litres, and a maximum treatment rate of 990 litres per second, receiving inflow from the storm sewer located in proposed Fair Isle Court discharging via a 450 millimetre diameter outlet pipe to the unnamed watercourse located between Langstaff Drive and Donald B. Munro Drive;

the modifications to existing stormwater management Works to serve the 147 Langstaff development application and some upstream lands to the northeast of Langstaff Drive, located in the Village of Carp, for the collection, transmission, treatment and disposal of stormwater runoff from a total catchment area of 51.6 hectares, to attenuate post-development peak flows to pre-development peak flows for all storm events up to and including the 100-year storm event, discharging to the un-named watercourse located on 147 Langstaff between Langstaff Drive and Donald B. Munro Drive, consisting of the following:

- **Existing stormwater management facility G3 (catchment area 47.6 hectares- with 1.33 hectares from this development):** one (1) dry pond, located between Langstaff Drive and Donald B. Munro Drive, 130 meters south of Langstaff Drive, having a 100-year provided storage volume of 1759 cubic metres at a ponding elevation of 102.49 meters (2.59 meters depth), complete with one pipe, consisting of a 675 millimetre diameter storm sewer, one (1) emergency overflow weir and riprap-lined spillway, allowing a maximum discharge of 1940 litres per second under the 100-year storm event to watercourse located on 147 Langstaff between Langstaff Drive and Donald B. Munro Drive;
- **Existing stormwater management facility G4 (catchment area 51.8 hectares- with 5.48 hectares from this development):** one (1) dry pond, located between Langstaff Drive and Donald B. Munro Drive, 285 meters south of Langstaff Drive, having a 100-year provided storage volume of 3132 cubic metres at a ponding elevation of 99.86 meters (2.96 meters depth), complete with one pipe, consisting of a 450 millimetre diameter storm sewer, one (1) emergency overflow weir and riprap-lined spillway, allowing a maximum discharge of 1330 litres per second under the 100-year storm event to watercourse located on 147 Langstaff between Langstaff Drive and Donald B. Munro Drive;

including erosion/sedimentation control measures during construction and all other controls and appurtenances essential for the proper operation of the aforementioned Works;

all in accordance with the submitted application and supporting documents listed in Schedule "A" forming part of this approval.

**Previous Works:**

**Facility G1:**

- a wet pond with a forebay located in the ravine block with an approximately 30 meters wide outlet structure on the north east side of Langstaff Drive having approximate permanent volume of 930 cubic meters, extended detention volume of 640 cubic meters and a maximum storage volume of 1,940 cubic meters,

- one (1) 450 millimetres diameter outlet conveyance pipe with a 600 millimetres by 600 millimetres grated ditch inlet catchbasin outlet structure fitted with a 90 millimetres diameter horizontal orifice plate,

- a 10.0 meters wide by 450 millimetres deep rip-rapped emergency overflow weir on the berm;

including erosion/sedimentation control measures during construction and all other controls and appurtenances essential for the proper operation of the aforementioned Works;

all in accordance with the submitted application and supporting documents listed in Schedule "A" forming part of this approval.

*For the purpose of this environmental compliance approval, the following definitions apply:*

**Definitions:**

1. "Approval" means this entire document and any schedules attached to it, and the application;
2. "Director" means a person appointed by the Minister pursuant to section 5 of the EPA for the purposes of Part II.1 of the EPA;
3. "District Manager" means the District Manager of the appropriate local District Office of the

Ministry, where the Works are geographically located;

4. "EPA" means the *Environmental Protection Act*, R.S.O. 1990, c.E.19, as amended;
5. "Equivalent Equipment" means a substituted equipment or like-for-like equipment that meets the required quality and performance standards of the approved named equipment;
6. "Ministry" means the ministry of the government of Ontario responsible for the EPA and OWRA and includes all officials, employees or other persons acting on its behalf;
7. "MNR" means the Ministry of Natural Resources and Forestry of the government of Ontario and includes all officials, employees or other persons acting on its behalf;
8. "OMAFRA" means the Ministry of Agriculture, Food and Rural Affairs of the government of Ontario and includes all officials, employees or other persons acting on its behalf;
9. "Owner" means Inverness Homes Inc., and includes its successors and assignees;
10. "OWRA" means the *Ontario Water Resources Act*, R.S.O. 1990, c. O.40, as amended;
11. "Previous Works" means those portions of the sewage Works previously approved under an Approval;
12. "Works" means the sewage Works described in the Owner's application, and this Approval.

*You are hereby notified that this environmental compliance approval is issued to you subject to the terms and conditions outlined below:*

## **Terms and Conditions:**

### **1. GENERAL CONDITIONS**

1. The Owner shall ensure that any person authorized to carry out work on or operate any aspect of the Works is notified of this Approval and the conditions herein and shall take all reasonable measures to ensure any such person complies with the same.
2. Except as otherwise provided by these Conditions, the Owner shall design, build, install, operate and maintain the Works in accordance with the description given in this Approval, and the application for approval of the Works.
3. Where there is a conflict between a provision of any document in the schedule referred to in this Approval and the conditions of this Approval, the conditions in this Approval shall take precedence, and where there is a conflict between the documents in the schedule, the document bearing the most recent date shall prevail.
4. Where there is a conflict between the documents listed in Schedule "A" and the application, the application shall take precedence unless it is clear that the purpose of the document was to amend the application.
5. The conditions of this Approval are severable. If any condition of this Approval, or the application of any requirement of this Approval to any circumstance, is held invalid or unenforceable, the application of such condition to other circumstances and the remainder of

this Approval shall not be affected thereby.

6. The issuance of, and compliance with the conditions of, this Approval does not:
  - a. relieve any person of any obligation to comply with any provision of any applicable statute, regulation or other legal requirement, including, but not limited to, the obligation to obtain approval from the local conservation authority/MNRF/OMAFRA necessary to construct or operate the sewage works; or
  - b. limit in any way the authority of the Ministry to require certain steps be taken to require the Owner to furnish any further information related to compliance with this Approval.

## **2. EXPIRY OF APPROVAL**

1. This Approval will cease to apply to those parts of the Works which have not been constructed within five (5) years of the date of this Approval.
2. In the event that completion and commissioning of any portion of the Works is anticipated to be delayed beyond the specified expiry period, the Owner shall submit an application of extension to the expiry period, at least twelve (12) months prior to the end of the period. The application for extension shall include the reason(s) for the delay, whether there is any design change(s) and a review of whether the standards applicable at the time of Approval of the Works are still applicable at the time of request for extension, to ensure the ongoing protection of the environment.

## **3. CHANGE OF OWNER**

1. The Owner shall notify the District Manager and the Director, in writing, of any of the following changes within thirty (30) days of the change occurring:
  - a. change of Owner;
  - b. change of address of the Owner;
  - c. change of partners where the Owner is or at any time becomes a partnership, and a copy of the most recent declaration filed under the *Business Names Act*, R.S.O. 1990, c.B17 shall be included in the notification to the District Manager; or
  - d. change of name of the corporation where the Owner is or at any time becomes a corporation, and a copy of the most current information filed under the *Corporations Information Act*, R.S.O. 1990, c. C39 shall be included in the notification to the District Manager.
2. In the event of any change in ownership of the Works, other than a change to a successor municipality, the Owner shall notify in writing the succeeding owner of the existence of this Approval, and a copy of such notice shall be forwarded to the District Manager and the Director.
3. The Owner shall ensure that all communications made pursuant to this condition refer to the number at the top of this Approval.

#### **4. OPERATION AND MAINTENANCE**

1. If applicable, any proposed storm sewers or other stormwater conveyance in this Approval can be constructed but not operated until the proposed stormwater management facilities in this Approval or any other Approval that are designed to service the storm sewers or other stormwater conveyance are in operation.
2. The Owner shall make all necessary investigations, take all necessary steps and obtain all necessary approvals so as to ensure that the physical structure, siting and operations of the Works do not constitute a safety or health hazard to the general public.
3. The Owner shall inspect and ensure that the design minimum liquid retention volume is maintained in the Works at all times, except when maintenance is required.
4. The Owner shall undertake an inspection of the condition of the Works, at least once a year, and undertake any necessary cleaning and maintenance to ensure that sediment, debris and excessive decaying vegetation are removed from the Works to prevent the excessive build-up of sediment, oil/grit, debris and/or decaying vegetation, to avoid reduction of the capacity and/or permeability of the Works, as applicable. The Owner shall also regularly inspect and clean out the inlet to and outlet from the Works to ensure that these are not obstructed.
5. The Owner shall construct, operate and maintain the Works with the objective that the effluent from the Works is essentially free of floating and settleable solids and does not contain oil or any other substance in amounts sufficient to create a visible film, sheen, foam or discoloration on the receiving waters.
6. The Owner shall maintain a logbook to record the results of these inspections and any cleaning and maintenance operations undertaken, and shall keep the logbook at the Owner's administrative office for inspection by the Ministry. The logbook shall include the following:
  - a. the name of the Works; and
  - b. the date and results of each inspection, maintenance and cleaning, including an estimate of the quantity of any materials removed and method of clean-out of the Works.
7. The Owner shall prepare an operations manual prior to the commencement of operation of the Works that includes, but is not necessarily limited to, the following information:
  - a. operating and maintenance procedures for routine operation of the Works;
  - b. inspection programs, including frequency of inspection, for the Works and the methods or tests employed to detect when maintenance is necessary;
  - c. repair and maintenance programs, including the frequency of repair and maintenance for the Works;
  - d. contingency plans and procedures for dealing with potential spills and any other abnormal situations and for notifying the District Manager; and
  - e. procedures for receiving, responding and recording public complaints, including recording any follow-up actions taken.

8. The Owner shall maintain the operations manual current and retain a copy at the Owner's administrative office for the operational life of the Works. Upon request, the Owner shall make the manual available to Ministry staff.

## **5. TEMPORARY EROSION AND SEDIMENT CONTROL**

1. The Owner shall install and maintain temporary sediment and erosion control measures during construction and conduct inspections once every two (2) weeks and after each significant storm event (a significant storm event is defined as a minimum of 25 mm of rain in any 24 hours period). The inspections and maintenance of the temporary sediment and erosion control measures shall continue until they are no longer required and at which time they shall be removed and all disturbed areas reinstated properly.
2. The Owner shall maintain records of inspections and maintenance which shall be made available for inspection by the Ministry, upon request. The record shall include the name of the inspector, date of inspection, and the remedial measures, if any, undertaken to maintain the temporary sediment and erosion control measures.

## **6. REPORTING**

1. One (1) week prior to the start-up of the operation of the Works, the Owner shall notify the District Manager (in writing) of the pending start-up date.
2. The Owner shall, upon request, make all reports, manuals, plans, records, data, procedures and supporting documentation available to Ministry staff.
3. The Owner shall prepare a performance report within ninety (90) days following the end of the period being reported upon, and submit the report(s) to the District Manager when requested. The first such report shall cover the first annual period following the commencement of operation of the Works and subsequent reports shall be prepared to cover successive annual periods following thereafter. The reports shall contain, but shall not be limited to, the following information:
  - a. a description of any operating problems encountered and corrective actions taken;
  - b. a summary of all maintenance carried out on any major structure, equipment, apparatus, mechanism or thing forming part of the Works, including an estimate of the quantity of any materials removed from the Works;
  - c. a summary of any complaints received during the reporting period and any steps taken to address the complaints;
  - d. a summary of all spill or abnormal discharge events; and
  - e. any other information the District Manager requires from time to time.

## **7. RECORD KEEPING**

1. The Owner shall retain for a minimum of five (5) years from the date of their creation, all records and information related to or resulting from the operation, maintenance and monitoring activities required by this Approval.

## **Schedule "A"**

1. Application for Environmental Compliance Approval, dated September 13, 2024, received on October 16, 2024, submitted by Inverness Homes Inc.;
2. Transfer of Review Letter of Recommendation, dated October 16, 2024 and signed by Damien Whittaker, PEng., Senior Engineer - Infrastructure Applications, City of Ottawa, including the following supporting documents:
  - a. Final Plans and Specifications prepared by Robinson Consultants Inc.
  - b. Pipe Data Form - Watermain, Storm Sewer, Sanitary Sewer, and Forcemain Design Supplement to Application for Approval for Water and Sewage Works.
  - c. Hydraulic Design Sheets prepared by Robinson Consultants Inc.
  - d. Stormwater Management Report prepared by Robinson Consultants Inc.
  - e. Design brief, calculations and specifications prepared by Robinson Consultants Inc..
3. Emails received on: November 01, 2024 from Connie Rivington-Howie, D & H Rivington Enterprises Inc., November 14, 2024 from Damien Whittaker, City of Ottawa, and November 27, 2024 from Damien Whittaker, City of Ottawa and Brandon MacKechnie, Robinson Consultants Inc.
4. Application for the Approval of the Municipal and Private Sewage Works dated April 19, 2001, design report, final drawings and addendum documents prepared and submitted by David McManus Engineering Ltd. and PSR Group Ltd., Consulting Engineers; submitted by D & H Rivington Enterprises Incorporated for the approval of ECA No. 8260-5LJQH5.

*The reasons for the imposition of these terms and conditions are as follows:*

**Reasons:**

1. Condition 1 is imposed to ensure that the Works are constructed and operated in the manner in which they were described and upon which approval was granted. This condition is also included to emphasize the precedence of conditions in the Approval and the practice that the Approval is based on the most current document, if several conflicting documents are submitted for review. Condition 1.6 is included to emphasize that the issuance of this Approval does not diminish any other statutory and regulatory obligations to which the Owner is subject in the construction, maintenance and operation of the Works. The Condition specifically highlights the need to obtain any necessary conservation authority approvals. The Condition also emphasizes the fact that this Approval doesn't limit the authority of the Ministry to require further information.
2. Condition 2 is included to ensure that, when the Works are constructed, the Works will meet the standards that apply at the time of construction to ensure the ongoing protection of the environment.
3. Condition 3 is included to ensure that the Ministry records are kept accurate and current with respect to the approved Works and to ensure that subsequent owners of the Works are made aware of the Approval and continue to operate the Works in compliance with it.
4. Condition 4 is included as regular inspection and necessary removal of sediment and excessive decaying vegetation from the Works are required to mitigate the impact of sediment, debris and/or decaying vegetation on the treatment capacity of the Works. The Condition also ensures that adequate storage is maintained in the Works at all times as required by the design. Furthermore, this Condition is included to ensure that the Works are operated and maintained to function as designed.
5. Condition 5 is included as installation, regular inspection and maintenance of the temporary sediment and erosion control measures is required to mitigate the impact on the downstream receiving watercourse during construction until they are no longer required.
6. Condition 6 is included to provide a performance record for future references, to ensure that the Ministry is made aware of problems as they arise, and to provide a compliance record for all the terms and conditions outlined in this Approval, so that the Ministry can work with the Owner in resolving any problems in a timely manner.
7. Condition 7 is included to require that all records are retained for a sufficient time period to adequately evaluate the long-term operation and maintenance of the Works.

**Upon issuance of the environmental compliance approval, I hereby revoke Approval No(s).  
8260-5LJQH5 issued on June 9, 2003**

In accordance with Section 139 of the *Environmental Protection Act*, you may by written notice served upon

me and the Ontario Land Tribunal within 15 days after receipt of this notice, require a hearing by the Tribunal. Section 142 of the *Environmental Protection Act* provides that the notice requiring the hearing ("the Notice") shall state:

- a. The portions of the environmental compliance approval or each term or condition in the environmental compliance approval in respect of which the hearing is required, and;
- b. The grounds on which you intend to rely at the hearing in relation to each portion appealed.

Pursuant to subsection 139(3) of the *Environmental Protection Act*, a hearing may not be required with respect to any terms and conditions in this environmental compliance approval, if the terms and conditions are substantially the same as those contained in an approval that is amended or revoked by this environmental compliance approval.

The Notice should also include:

- 1. The name of the appellant;
- 2. The address of the appellant;
- 3. The environmental compliance approval number;
- 4. The date of the environmental compliance approval;
- 5. The name of the Director, and;
- 6. The municipality or municipalities within which the project is to be engaged in.

And the Notice should be signed and dated by the appellant.

This Notice must be served upon:

Registrar\*  
Ontario Land Tribunal  
655 Bay Street, Suite 1500  
Toronto, Ontario  
M5G 1E5  
OLT.Registrar@ontario.ca

and

The Director appointed for the purposes of Part II.1 of the *Environmental Protection Act*  
Ministry of the Environment, Conservation and Parks  
135 St. Clair Avenue West, 1st Floor  
Toronto, Ontario  
M4V 1P5

\* Further information on the Ontario Land Tribunal's requirements for an appeal can be obtained directly from the Tribunal at: Tel: (416) 212-6349 or 1 (866) 448-2248, or [www.olt.gov.on.ca](http://www.olt.gov.on.ca)

The above noted activity is approved under s.20.3 of Part II.1 of the *Environmental Protection Act*.

DATED AT TORONTO this 2nd day of December, 2024



---

Aziz Ahmed, P.Eng.  
Director  
appointed for the purposes of Part II.1 of the  
*Environmental Protection Act*

AL/

c: District Manager, MECP Ottawa  
Clerk, City of Ottawa (D07-16-21-0012 (formerly D07-16-19-0034))  
Damien Whittaker, Senior Engineer, Infrastructure Applications, City of Ottawa  
Brandon MacKechnie, Robinson Consultants Inc.  
Kyle MacHutchon, President, Inverness Homes Inc.



## 2.0 Site Conditions

### 2.1 Surface Conditions

The subject site at Block 27 is currently vacant and undeveloped. An approximately 4 to 6 m deep ravine, with mature trees lining the top of slope, is located approximately 15 to 25 m east of Block 27. The site is further bordered by Hilversum Lane and future residential development blocks to the south and west, and by a future park to the north,. The ground surface across Block 27 is relatively flat at an approximate geodetic elevation of 102 to 103 m.

### 2.2 Subsurface Profile


Generally, the subsurface profile encountered at the test hole locations within, and in the surrounding area, of Block 27 consists of a thin layer of topsoil overlying a silty clay deposit. The silty clay deposit generally consists of a hard to stiff, brown silty clay crust extending to approximate depths of 4.6 to 5.9 m below the existing ground surface, underlain by a stiff to firm, grey silty clay deposit. Silty sand to sandy silt seams were encountered throughout the silty clay deposit at various locations and depths throughout the borehole locations. A 1.1 m thick layer of sandy silt and a deposit of clayey silt were encountered directly above and below the silty clay deposit, respectively, at the location of borehole BH 3. Further, a deposit of silty sand was encountered underlying the grey silty clay at a depth of 5.9 m below the existing ground surface at the location of borehole BH 4.

Based on available geological mapping, bedrock in the area consists of interbedded limestone and shale of the Verulam Formation, with overburden drift thickness ranging between 15 and 50 m. The referenced geological mapping can be found at the Geological Survey of Canada website, Open File 5311, 2008. (<https://doi.org/10.4095/226165>).

Reference should be made to the Soil Profile and Test Data sheets, attached to the current memorandum, for specific details of the soil profile encountered at each borehole location.

### 2.3 Groundwater

Groundwater levels (GWL) were measured in boreholes BH 3-23 and BH 4-23 on August 29, 2023, boreholes BH 4-19 and BH 5-19 on July 18, 2019, and in boreholes BH 3 and BH 4 on November 3, 2008. Groundwater levels were recorded at each borehole location and are presented in Table 1 below, and on the Soil Profile and Test Data sheets attached to the current memorandum. Further, long-term groundwater monitoring was completed at boreholes BH 2-34 and BH 3-24 between March and May 2024. The results of the long-term groundwater monitoring are attached to this memorandum.

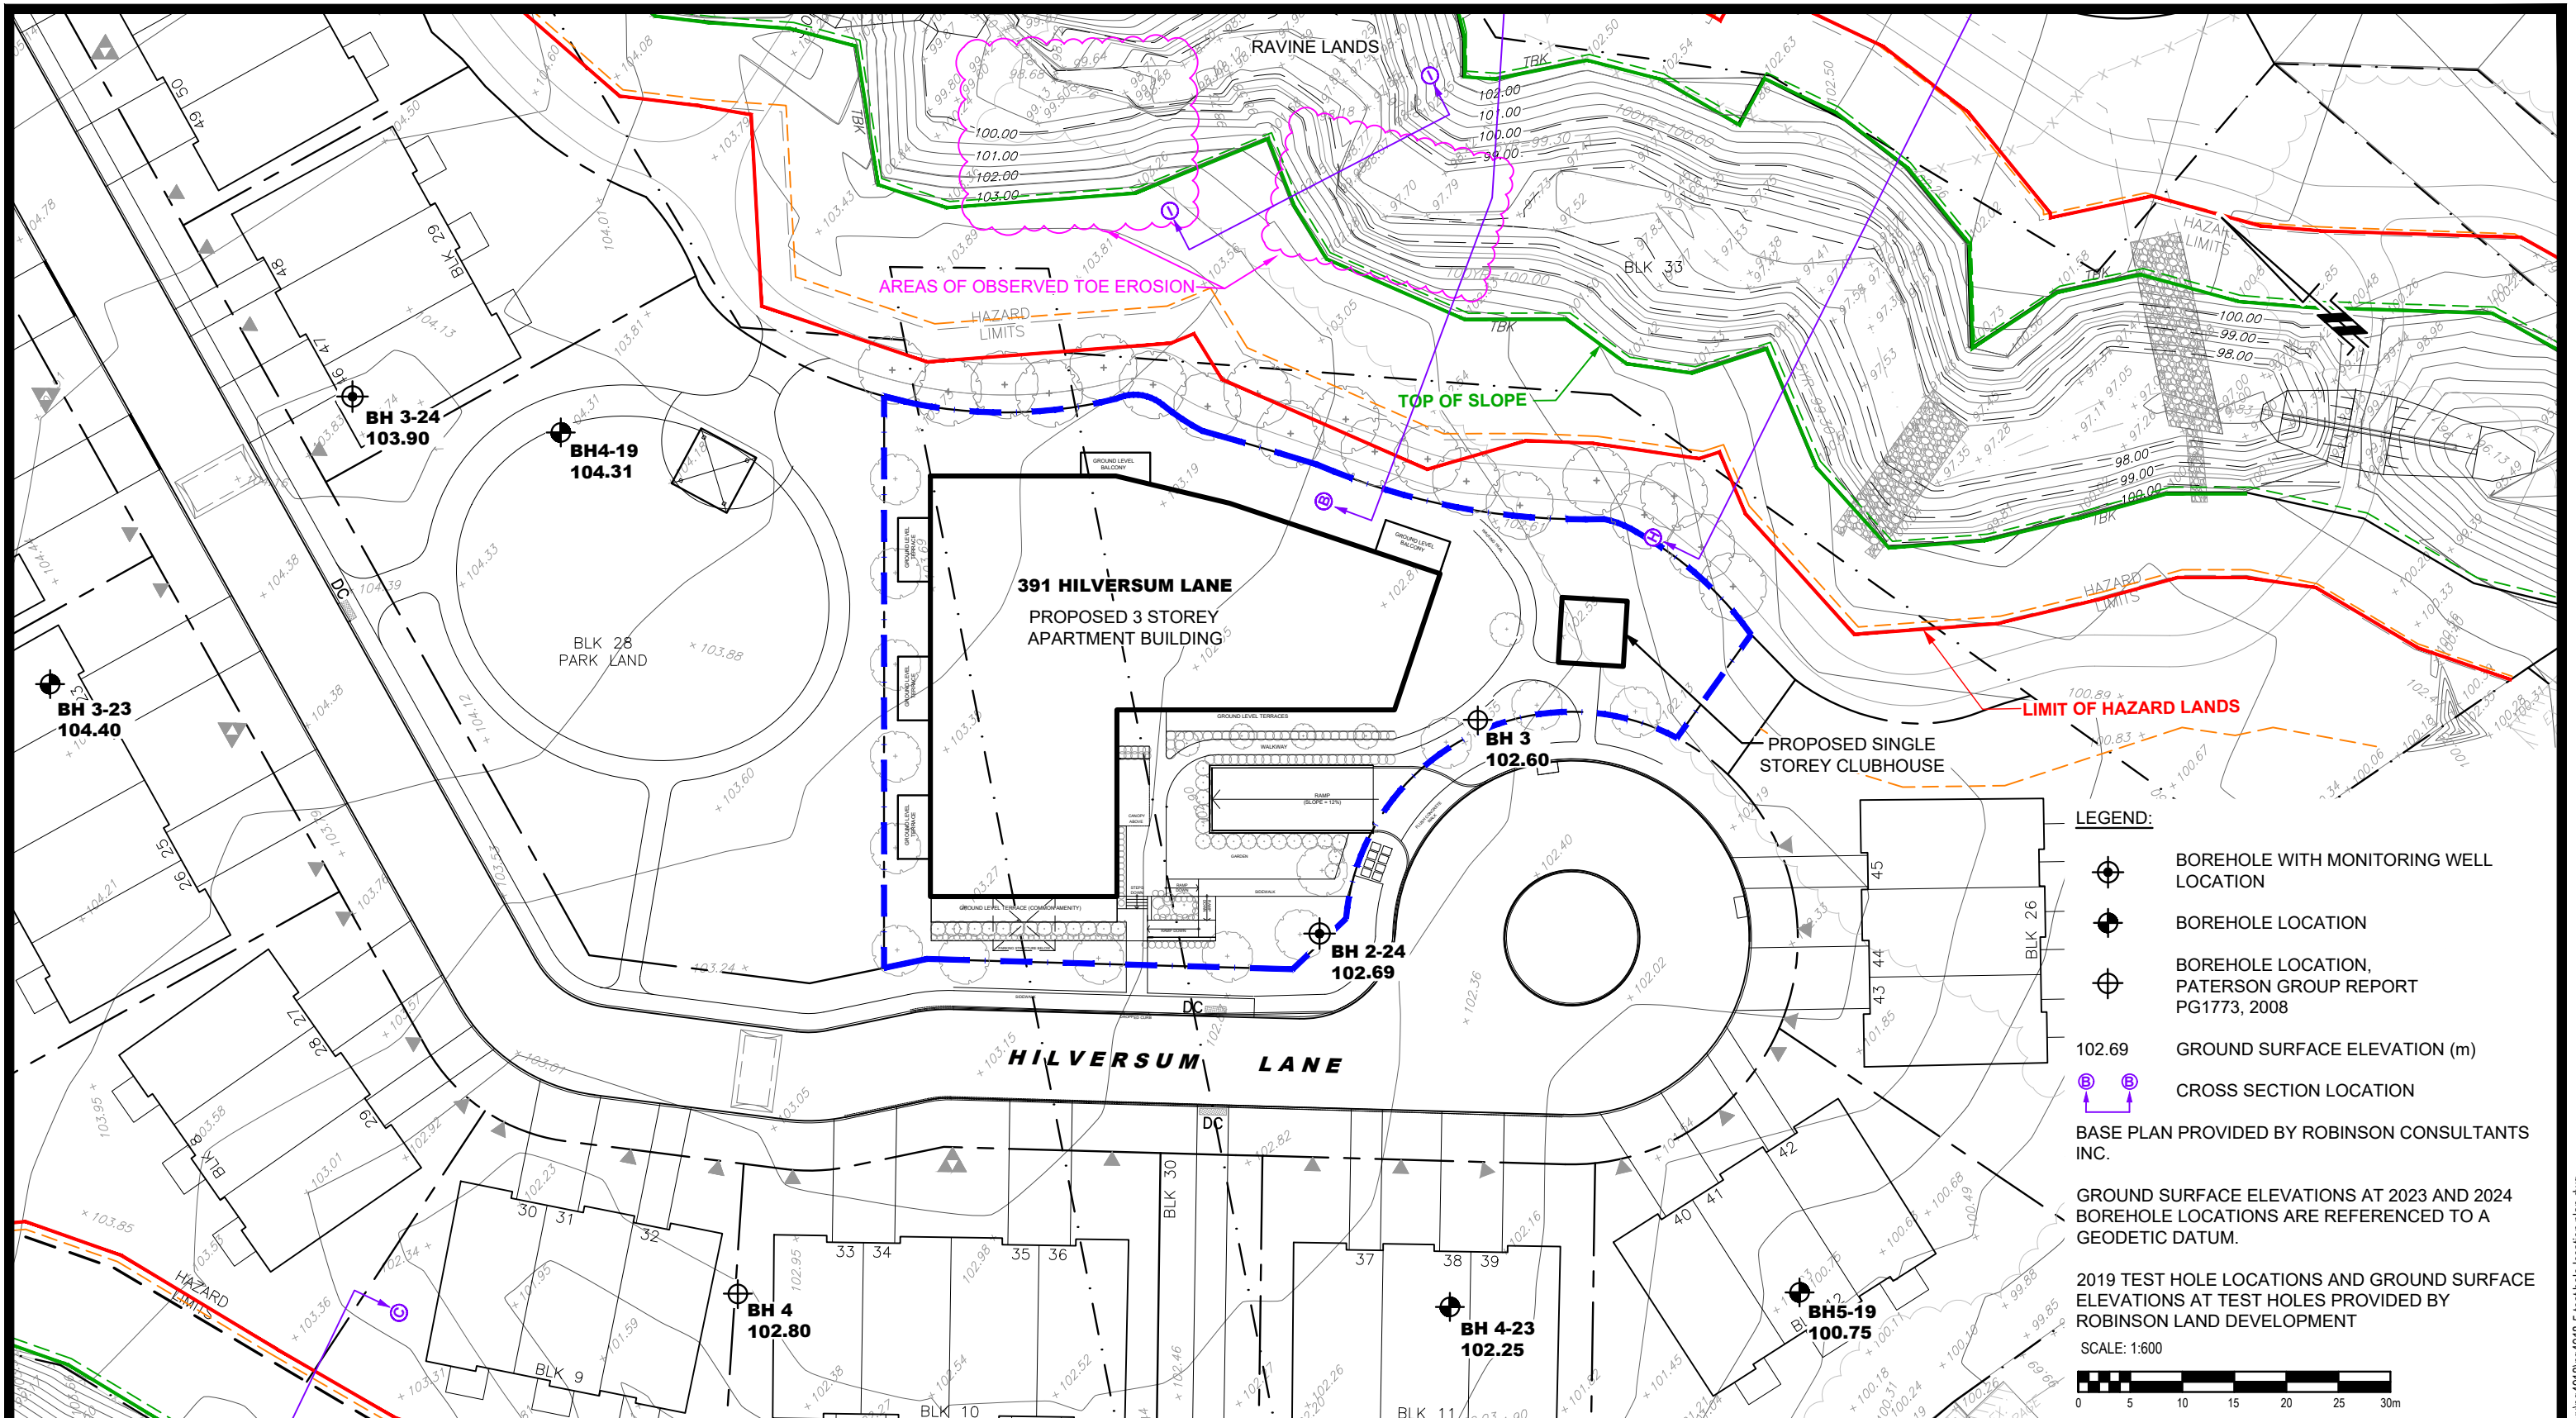

NO.	REVISIONS	DATE	INITIAL

**INVERNESS HOMES  
GEOTECHNICAL MEMORANDUM  
PROPOSED PHASE 1 APARTMENT BUILDING  
391 HILVERSUM LANE**

**TEST HOLE LOCATION PLAN**

OTTAWA, ONTARIO

Scale:	1:600	Date:	10/2025
Drawn by:	ZS	Report No.:	PG4918-MEMO.15
Checked by:	NP	Dwg. No.:	<b>PG4918-5</b>
Approved by:	SD	Revision No.:	

EASTING: 341268.32    NORTHING: 5022923.884    ELEVATION: 102.69  
 DATUM: Ground surface elevations provided by Robinson Land Development.  
 REMARKS:  
 BORINGS BY: CME-55 Low Clearance Drill    DATE: March 7, 2024

FILE NO. **PG4918**  
 HOLE NO. **BH 2-24**

SAMPLE DESCRIPTION	STRATA PLOT	SAMPLE				DEPTH (m)	ELEV. (m)	Pen. Resist. Blows / 0.3m ● 50 mm Dia. Cone				MONITORING WELL CONSTRUCTION
		TYPE	NUMBER	% RECOVERY	N VALUE or RQD			20	40	60	80	
<b>GROUND SURFACE</b>												
TOPSOIL and organics Hard to very stiff brown <b>SILTY CLAY</b>	0.15					0	102.69					
		SS	1	92	7	2	100.69					
		SS	2	92	8	3	99.69					
		SS	3	92	5	5	97.69					
- Intermittent silt seams @ 5.03m												
Stiff grey <b>SILTY CLAY</b>	5.49					6	96.69					
		SS	4	92	1	7	95.69					
		SS	5	92	1	8	94.69					
End of Borehole	8.23											

20 40 60 80 100  
**Shear Strength (kPa)**  
 ▲ Undisturbed    △ Remoulded


EASTING: 341245.506    NORTHING: 5023027.668    ELEVATION: 103.9  
 DATUM: Ground surface elevations provided by Robinson Land Development.  
 REMARKS:  
 BORINGS BY: CME-55 Low Clearance Drill                      DATE: March 7, 2024

FILE NO. **PG4918**  
 HOLE NO. **BH 3-24**

SAMPLE DESCRIPTION	STRATA PLOT	SAMPLE				DEPTH (m)	ELEV. (m)	Pen. Resist. Blows / 0.3m ● 50 mm Dia. Cone				MONITORING WELL CONSTRUCTION
		TYPE	NUMBER	% RECOVERY	N VALUE or RQD			○ Water Content %				
								20	40	60	80	
<b>GROUND SURFACE</b>												
TOPSOIL and organics Hard to very stiff <b>SILTY CLAY</b>	0.15					0	103.90					
		SS	1	92	4	2	101.90					
		SS	2	92	4	3	100.90					
		SS	3	92	3	5	98.90					
Stiff grey <b>SILTY CLAY</b> with intermittent silt seams	5.49					6	97.90					
		SS	4	92	1	7	96.90					
- Clayey silt seams from 7.77m to 8.08m	8.23					8	95.90					
End of Borehole												

20 40 60 80 100  
**Shear Strength (kPa)**  
 ▲ Undisturbed    △ Remoulded

Figure 4: BH2-24 - Monitoring Well Water Elevations

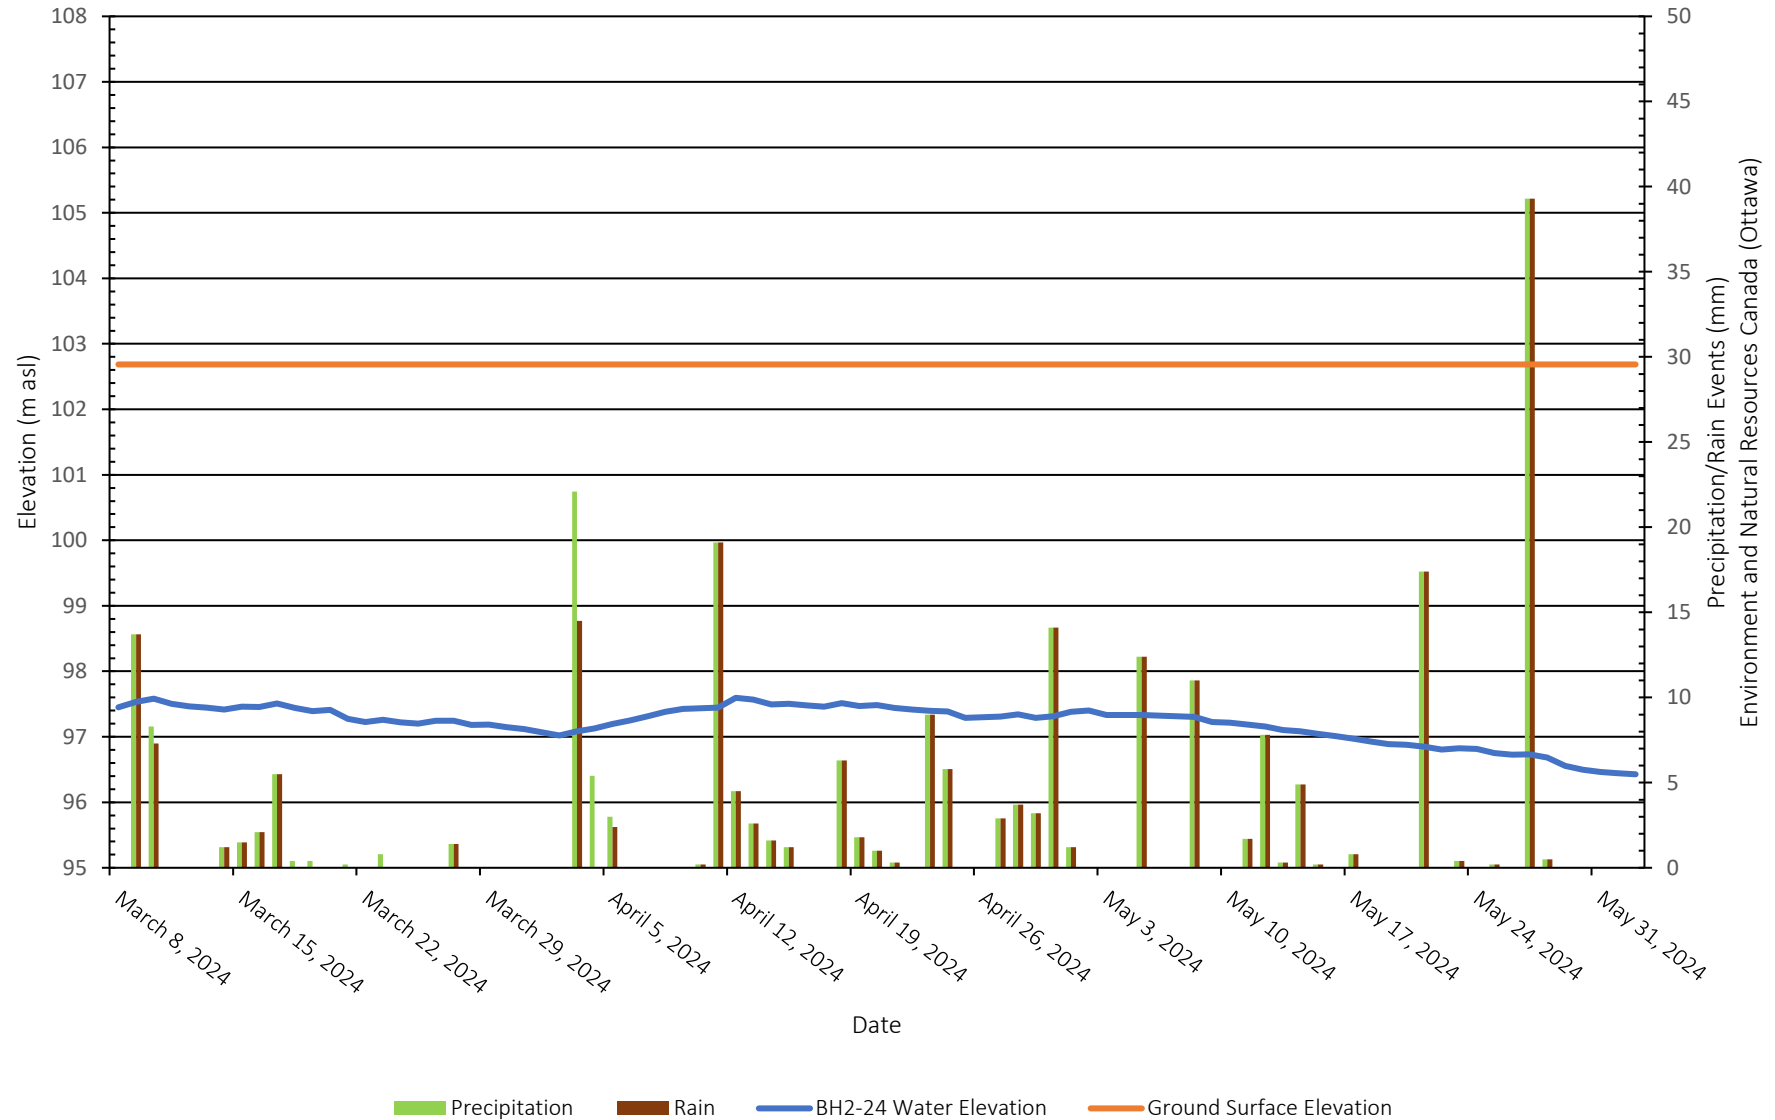

Precipitation Rain BH2-24 Water Elevation Ground Surface Elevation

Figure 5: BH3-24 - Monitoring Well Water Elevations

