

GENERAL NOTES

1. VERIFY ALL DIMENSIONS PRIOR TO CONSTRUCTION.
2. DO NOT SCALE DRAWINGS.
3. REPORT ALL DISCOVERIES OF ERRORS, OMISSIONS OR DISCREPANCIES TO THE DESIGN ENGINEER AS APPLICABLE.
4. USE ONLY LATEST REVISED DRAWINGS OR THOSE THAT ARE MARKED "ISSUED FOR CONSTRUCTION".
5. DESIGN AND CONSTRUCTION OF THIS PROJECT SHALL COMPLY WITH THE PROVINCIAL AND LOCAL BUILDING CODES LATEST EDITION.
6. ALL WORKS AND MATERIALS USED SHALL COMPLY AS REQUIRED BY THE BUILDING CODE LATEST EDITION.
7. THIS DRAWING SHALL BE READ IN CONJUNCTION WITH ALL RELEVANT DRAWINGS & SPECIFICATIONS.
8. EVERYTHING IS TO BE CONSIDERED NEW UNLESS SPECIFIED EXISTING OTHERWISE.
9. RESPECTING ALL WORK IN THE CITY RIGHT-OF-WAY, THE CONTRACTOR IS TO PROVIDE AT LEAST 48 HOURS PRIOR NOTICE TO THE CITY OF OTTAWA PUBLIC WORKS DEPARTMENT STAFF.
10. A ROAD OCCUPANCY PERMIT WILL BE REQUIRED FOR ANY WORK DONE IN THE MUNICIPAL ROAD ALLOWANCE.
11. ALL RESTORATION OR WORK DONE IN THE ROAD ALLOWANCE MUST BE COMPLETED AS PER CITY STANDARD.
12. THE PERFORMANCE GUARANTEE WILL NOT BE REFUNDED BY THE CITY UNLESS THE WORKS HAVE BEEN INSPECTED BY CITY REPRESENTATIVES AND DEEMED TO BE COMPLETE AND SATISFACTORY.

EX. UTILITIES NOTES


EXISTING INFORMATION REGARDING UTILITIES ALONG MONTREAL RD AND SHEFFORD RD TO BE SITE VERIFIED
 INFORMATION REGARDING EXISTING STORM, SANITARY AND WATER EXTRACTED FROM BOUNDARY AND TOPOGRAPHIC SURVEY DATED 2024-11-23 BY NOTHERN LINK AND "SHEFFORD RD CH 0+000 TO 0+283 - DRG # 87-1268-6" DATED APRIL 1988 BY R.W. CONNELLY ASSOCIATED LTD.

SERVICES NOTES:

CONTACT LOCAL UTILITY AGENCIES (GAS, HYDRO & TELEPHONE) TO LOCATE THE EXISTING INCOMING SERVICES, AND USE THE SAME TO SERVE NEW INSTALLATIONS (IF APPLICABLE).

LEGEND

- EXISTING CATCHBASIN
- EXISTING MANHOLE
- NEW SANITARY MANHOLE
- NEW CATCHBASIN
- NEW C.B./M.H.
- NEW STORM MANHOLE
- PROPERTY LINE
- CATCHMENT AREA BOUNDARY
- OVERLAND FLOW
- PROPOSED STORM SEWER
- INSULATED PIPE
- SUB-CATCHMENT AREA COEFFICIENT
- SUB-CATCHMENT AREA
- SUB-CATCHMENT RUNOFF COEFFICIENT

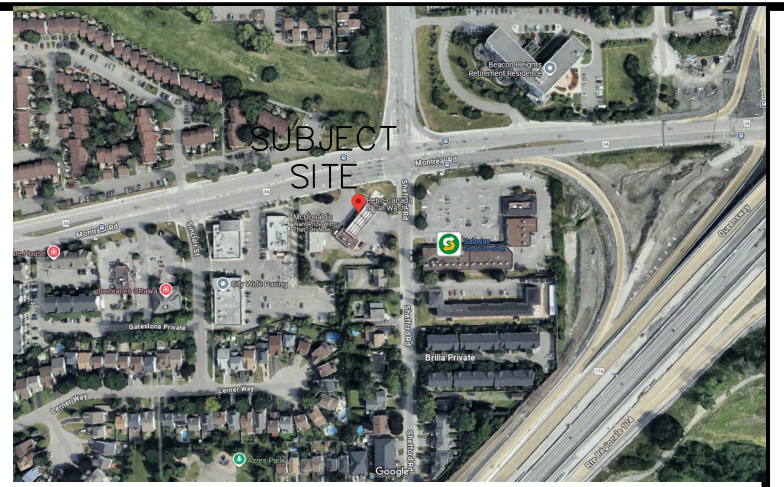

KEY PLAN
NTS

PLAN OF SURVEY OF
 BLOCK 60 AND PART OF BLOCK 59
 REGISTERED PLAN 4M-916
 AND PART OF LOT 16
 CONCESSION 1 (OTTAWA FRONT)
 (GEOGRAPHIC TOWNSHIP OF GLOUCESTER)
 CITY OF OTTAWA

BEARING
 BEARINGS SHOWN HEREON ARE GRID AND ARE REFERRED TO THE WESTERLY LIMIT OF SHEFFORD ROAD AS DERIVED FROM OBSERVED CONTROL POINTS 'A' AND 'B' AND HAVING A BEARING OF N 21°22'10" W.
 GRID BEARINGS ARE 3' MTM ZONE 09, CENTRAL MERIDIAN 76°30' WEST LONGITUDE, NAD83 (CSRS-2010.0).

ISSUE TABLE

TO	FOR	DATE
SUNCOR	ISSUED FOR REVIEW	16 MAR '26

BEARING ROTATION:
 FOR BEARING COMPARISONS, A ROTATION OF 00°39'40" COUNTER-CLOCKWISE WAS APPLIED TO PLAN P3.

BENCHMARK
 ELEVATIONS SHOWN HEREON ARE GEODETIC AND WERE DERIVED FROM GNSS OBSERVATIONS TO OUR CONTROL NETWORK. ELEVATIONS ARE REFERENCED TO OUR LOCAL BENCHMARK:

LOCAL BENCHMARK:
 THE TOP NUT OF A FIRE HYDRANT LOCATED APPROXIMATELY 14m SOUTH OF DRIVEWAY ENTRANCE TO THE SUBJECT LANDS ALONG SHEFFORD ROAD AND HAVING AN ELEVATION OF 67.88. (NAD83; CSRS: v7-2010, GEOD MODEL HT2.0-2002.0)

REVISION TABLE

REV.	DESCRIPTION	DRAWN	APP'D.	DATE

ISSUE TABLE

TO	FOR	DATE
SUNCOR	ISSUED FOR REVIEW	16 MAR '26

METRIC
 ALL DIMENSIONS ARE IN MILLIMETRES U.N.O. CONTRACTOR TO CHECK/VERIFY ALL DIMENSIONS PRIOR TO COMMENCEMENT OF WORK. ALL DISCREPANCIES TO BE REPORTED TO THE PROJECT DESIGNER. DO NOT SCALE DRAWINGS.



CONSULTANT

 J + B ENGINEERING INC.
 TORONTO: 25 GERRARD ST. E. SUITE 201, WILLOWDALE, ON L2Y 1G8, 416 223 7918
 CALGARY: 6361 15th AVE. SW. SUITE 200, CALGARY, AB T2C 0E2, 403 503 2256



DRAWING TITLE:
STORM SEWER REFERENCE SHEET

PROJECT:
 2180 MONTREAL RD @SHEFFORD RD
 OTTAWA, ON

DRAWN BY: EM	CAD INFO.: SHEET SIZE D (559 x 864)
DRAWING SCALE: 1:200	PETRO-CANADA
DATE DRAWN: DEC 03 '25	CONSULTANT 250344-P-306
CHECKED BY:	PLOT SCALE 1:1
APPROVED BY:	PLOT CONFIGURATION
STD No./OUTLET No. 65004	SHEET No. P306

Pipe ID	LENGTH OF PIPE	Pipe Dia. (m)	Area (m ²)	Perimeter (m)	Hydraulic Radius (m)	Slope (m/m)	Roughness Coefficient	Velocity (m/s)	Max. Pipe Flow (m ³ /s)	Actual Pipe Flow (m ³ /s)	Percentage of Flow	Servicing Catchment Structure
1	19.400	0.250	0.049	0.785	0.063	0.010	0.013	1.211	0.059	0.033	55%	CB1
2	18.200	0.250	0.049	0.785	0.063	0.010	0.013	1.211	0.059	0.027	46%	CB2
3	9.400	0.150	0.018	0.471	0.038	0.010	0.013	0.862	0.015	0.002	16%	CANOPY RWL 1
4	9.100	0.150	0.018	0.471	0.038	0.010	0.013	0.862	0.015	0.002	16%	CANOPY RWL 2
5	32.900	0.600	0.283	1.885	0.150	0.010	0.013	2.172	0.614	0.060	10%	CBMH1
6	6.300	0.150	0.018	0.471	0.038	0.010	0.013	0.862	0.015	0.002	16%	CANOPY RWL 3
7	9.500	0.150	0.018	0.471	0.038	0.010	0.013	0.862	0.015	0.002	16%	CANOPY RWL 4
8	12.900	0.300	0.071	0.942	0.075	0.010	0.013	1.368	0.097	0.030	31%	STM MH1
9	8.200	0.400	0.126	1.257	0.100	0.010	0.013	1.657	0.208	0.118	57%	CBMH2
10	20.400	0.250	0.049	0.785	0.063	0.020	0.013	1.713	0.084	0.007	8%	EX.STM MH1
11	9.400	0.300	0.071	0.942	0.075	0.005	0.013	0.967	0.068	0.017	25%	CB3
12	11.200	0.150	0.018	0.471	0.038	0.020	0.013	1.219	0.022	0.014	66%	BUILDING
13	28.900	0.600	0.283	1.885	0.150	0.005	0.013	1.536	0.434	0.049	11%	CBMH3
14	19.500	0.300	0.071	0.942	0.075	0.010	0.013	1.368	0.097	0.002	2%	CB4
15	16.700	0.600	0.283	1.885	0.150	0.010	0.013	2.172	0.614	0.084	14%	CBMH4
16*	4.100	0.121	0.011	0.380	0.030	0.010	0.013	0.747	0.009	0.202	100%*	STM MH3
17	3.900	0.400	0.126	1.257	0.100	0.010	0.013	1.657	0.208	0.202	97%	STM MH4

*FLOW CONTROLLED BY 121mm ORIFICE TUBE.

Storm Inlet Structure	Catchment ID	Drainage Catchment Area (m ²)	Drainage		Runoff Coefficient (100-yr Storm)	Intensity of 100yr storm at Tc=10min (mm/hr)	100 yr Storm flow @ Tc=10 min (m ³ /s)	Runoff Volume (m ³)
			Impervious (m ²)	Pervious (m ²)				
CB1	A	970.27	635.49	334.78	0.68	178.56	0.033	19.527
CBMH1	B	521.37	495.57	25.80	0.87	178.56	0.022	13.476
CB2	C	625.87	610.77	15.10	0.88	178.56	0.027	16.484
CBMH2	D	574.36	574.36	0.00	0.90	178.56	0.026	15.396
EX.STM MH1	E	146.50	146.50	0.00	0.90	178.56	0.007	3.927
CB3	F	606.60	285.99	320.61	0.56	178.56	0.017	10.053
CBMH3	G	385.11	205.60	179.51	0.60	178.56	0.011	6.848
CB4	N	150.40	0.00	150.40	0.25	178.56	0.002	1.120
CBMH4	H	923.22	677.00	246.22	0.73	178.56	0.033	19.980
BUILDING	I	316.64	316.64	0.00	0.90	178.56	0.014	8.488
CANOPY RWL 1	J	54.67	54.67	0.00	0.90	178.56	0.002	1.465
CANOPY RWL 2	K	54.51	54.51	0.00	0.90	178.56	0.002	1.461
CANOPY RWL 3	L	54.46	54.46	0.00	0.90	178.56	0.002	1.460
CANOPY RWL 4	M	54.02	54.02	0.00	0.90	178.56	0.002	1.448
TOTAL		5438	4165.58	1272.42			0.20	121.13

1 STORM SEWER REFERENCE SHEET
 P-306 SCALE 1:200